


Mercury Contamination in Water Sources

Comparison with WHO drinking water guidelines | All samples within safe limits

Sampling Location

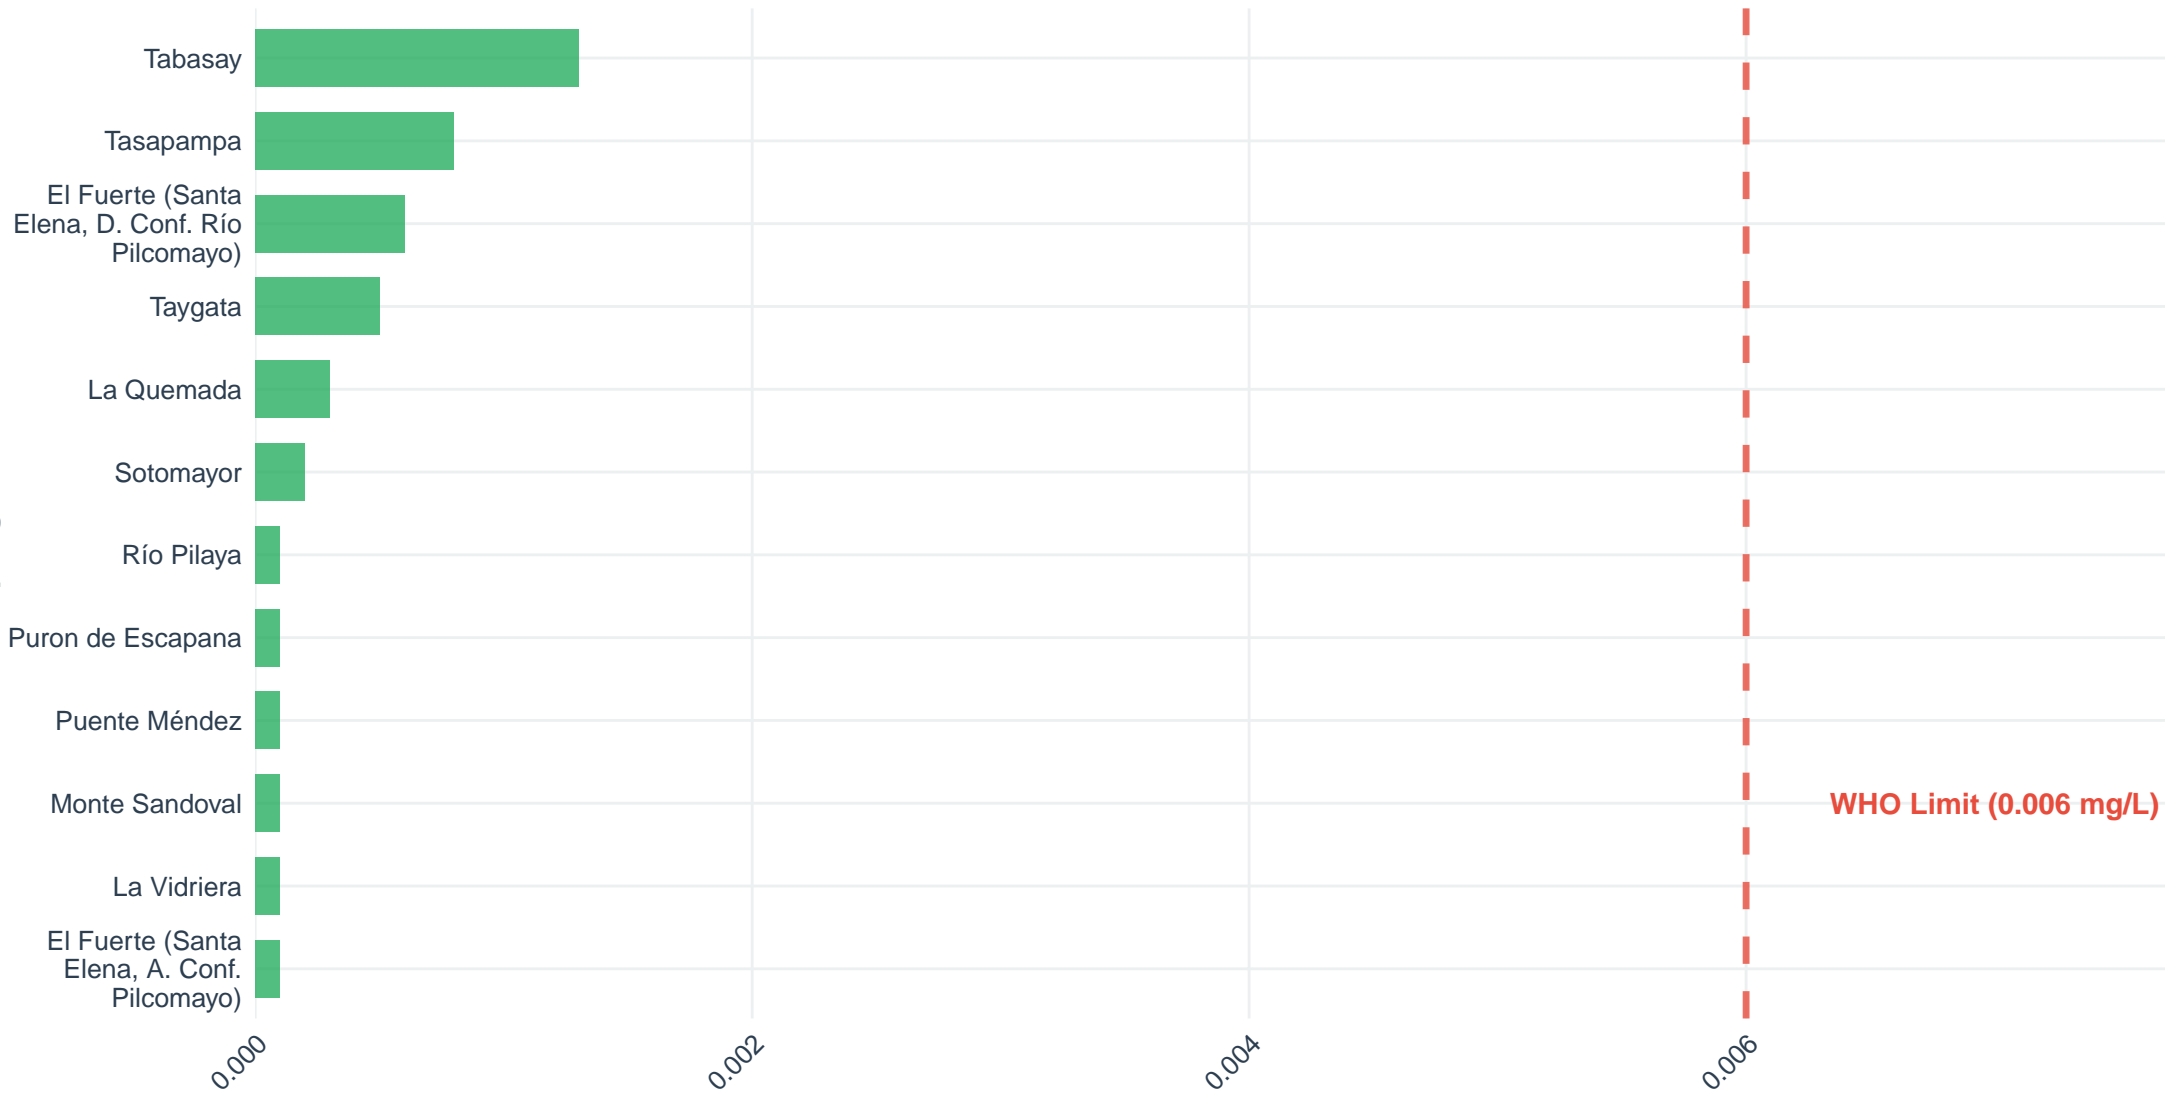

WHO Limit (0.006 mg/L)

Mercury Concentration (mg/L)

Risk Level ■ Safe