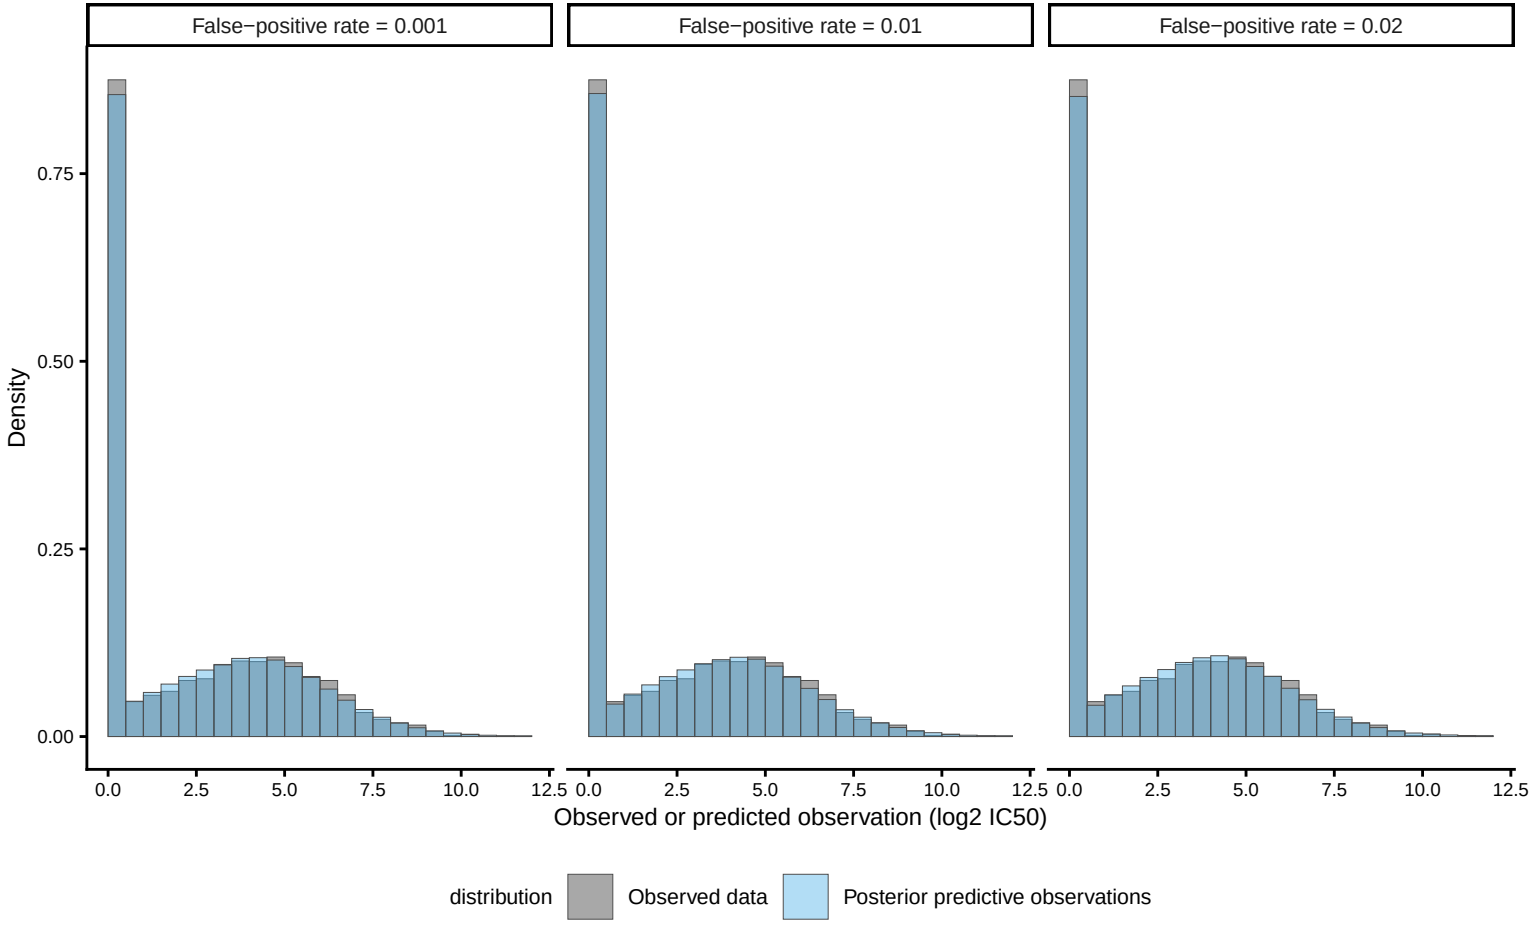
False−positive rate = 0.001
False−positive rate = 0.01
False−positive rate = 0.02
Density
0.00
0.25
0.50
0.75
0.0
2.5
5.0
7.5
10.0
12.5
Observed or predicted observation (log2 IC50)
distribution
Observed data
Posterior predictive observations