



Capacity Ablation: FCI and PAS Metrics


Flow Concentration Index (FCI)

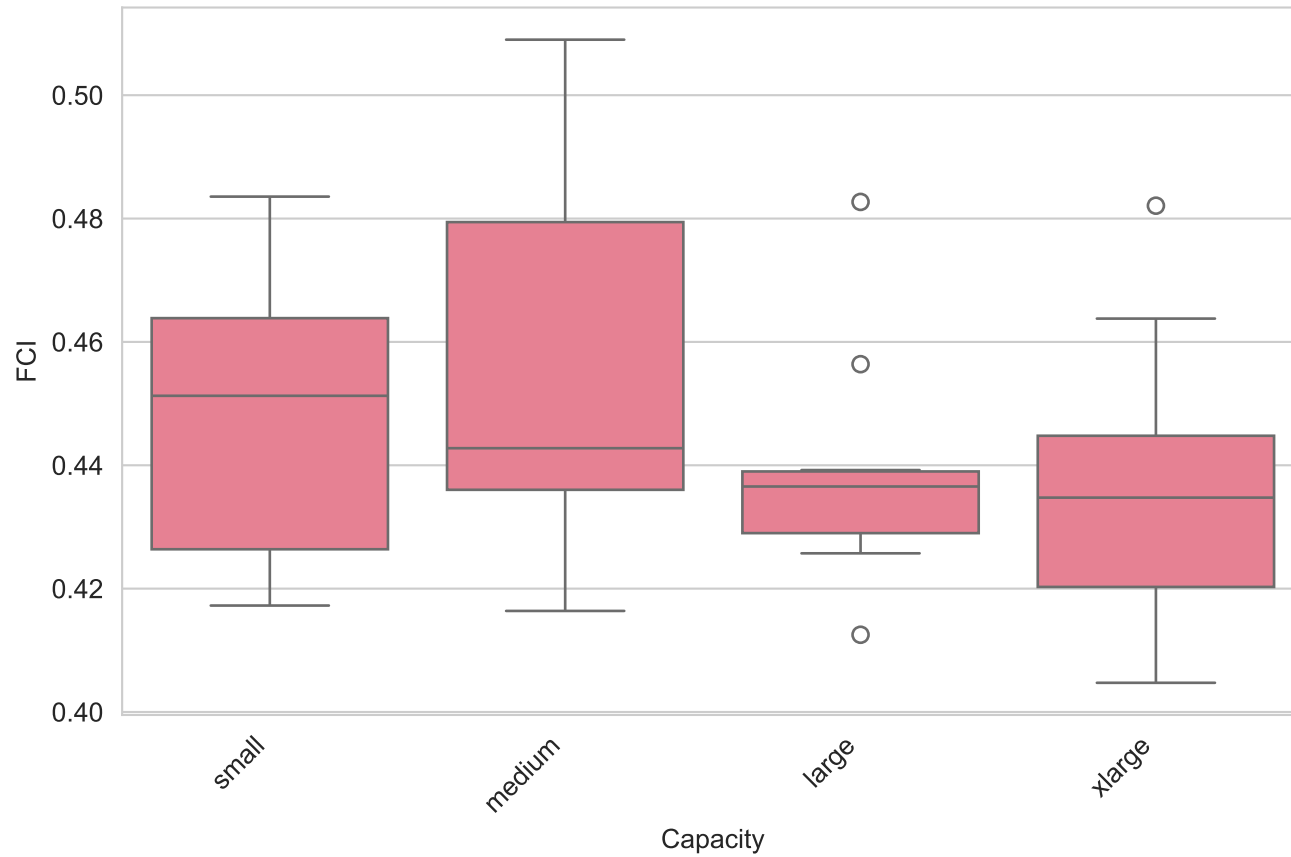


Preference-Aligned Spread (PAS)

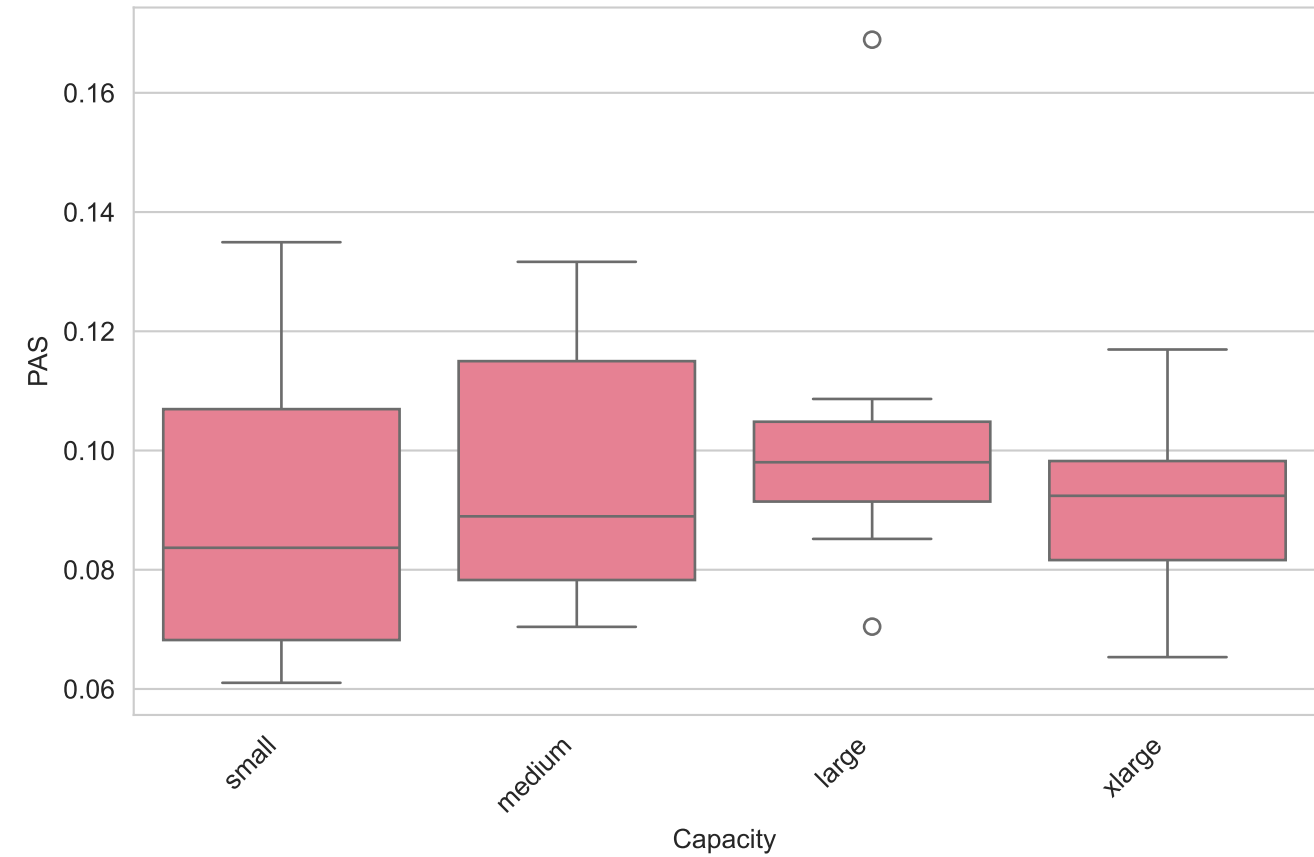

FCI Distribution

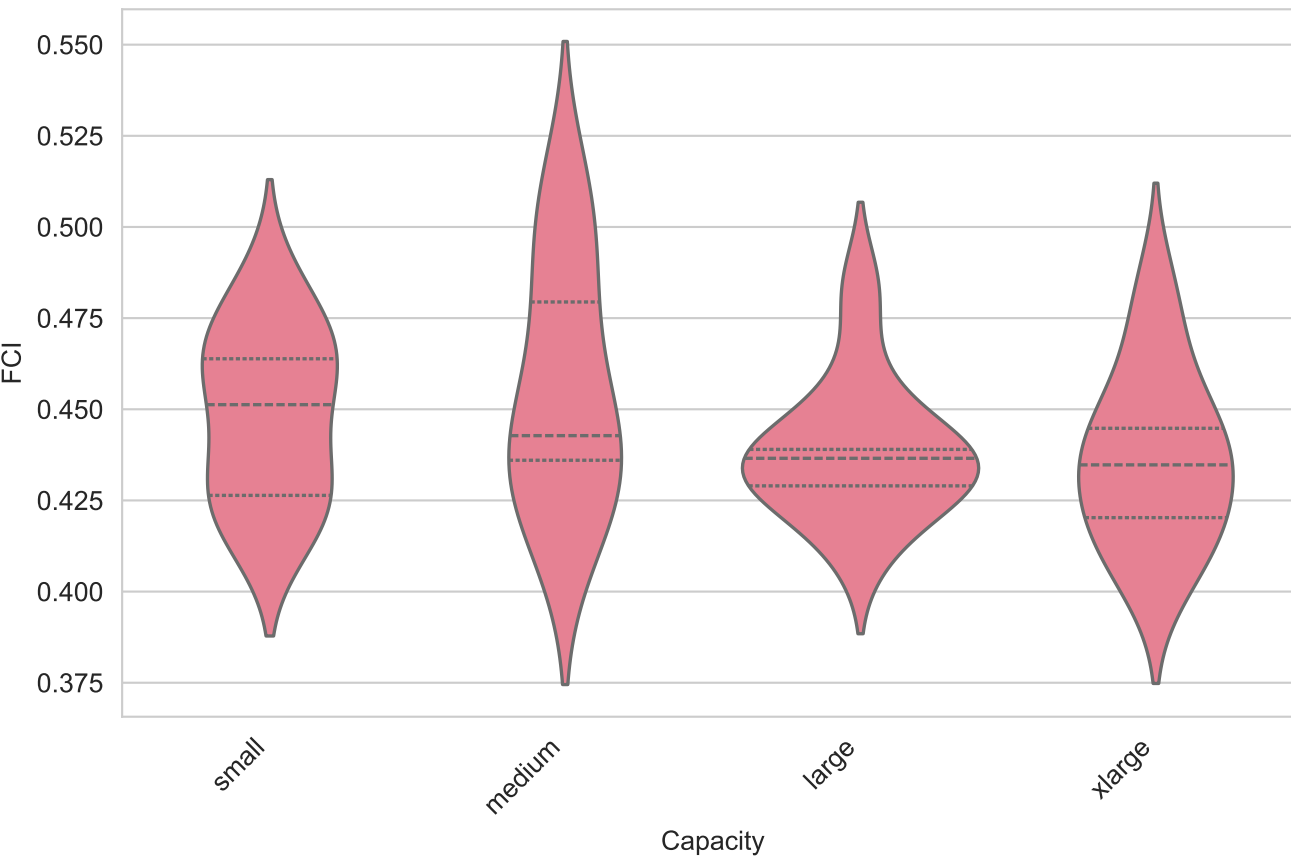


PAS Distribution

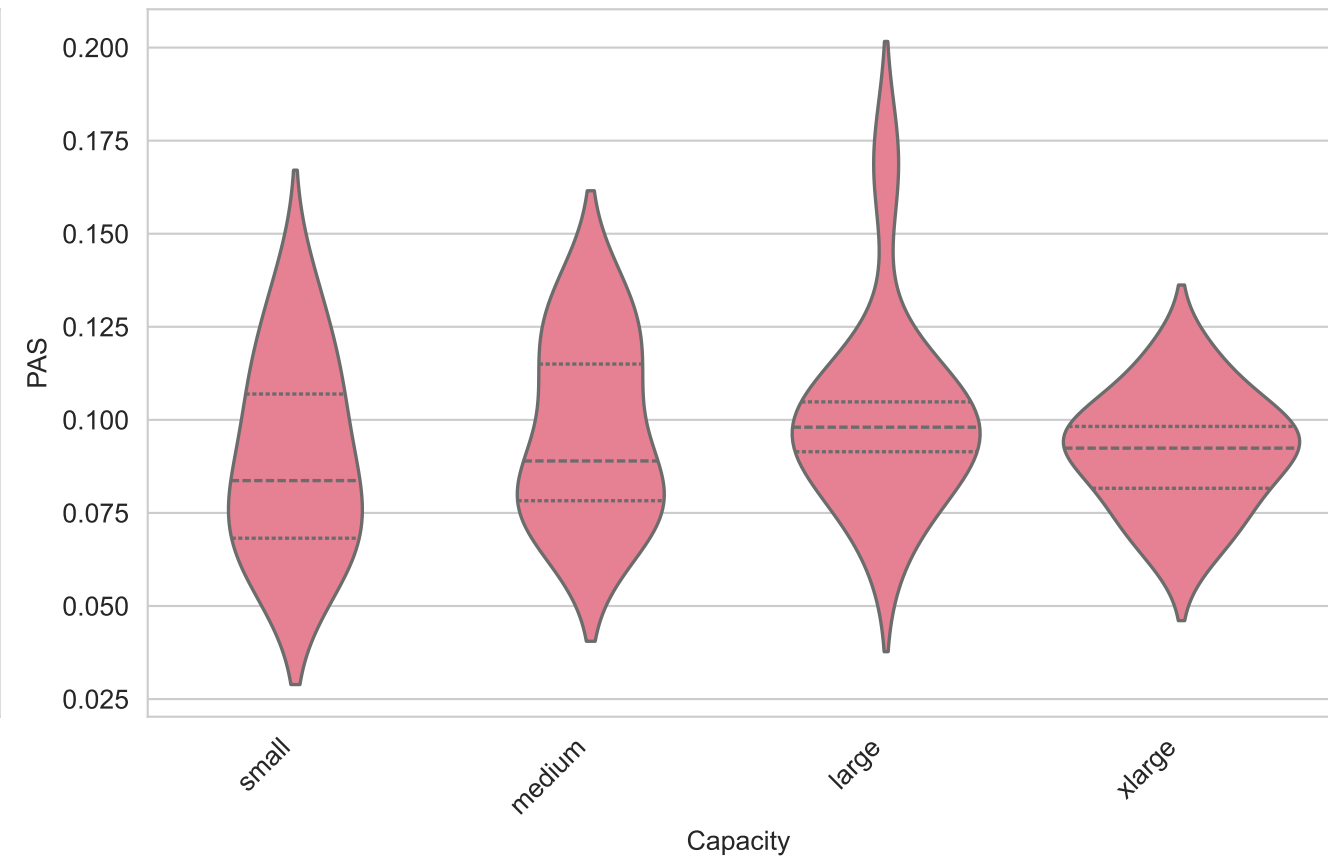


Capacity Ablation: Detailed Breakdown


FCI by Capacity and Conditioning

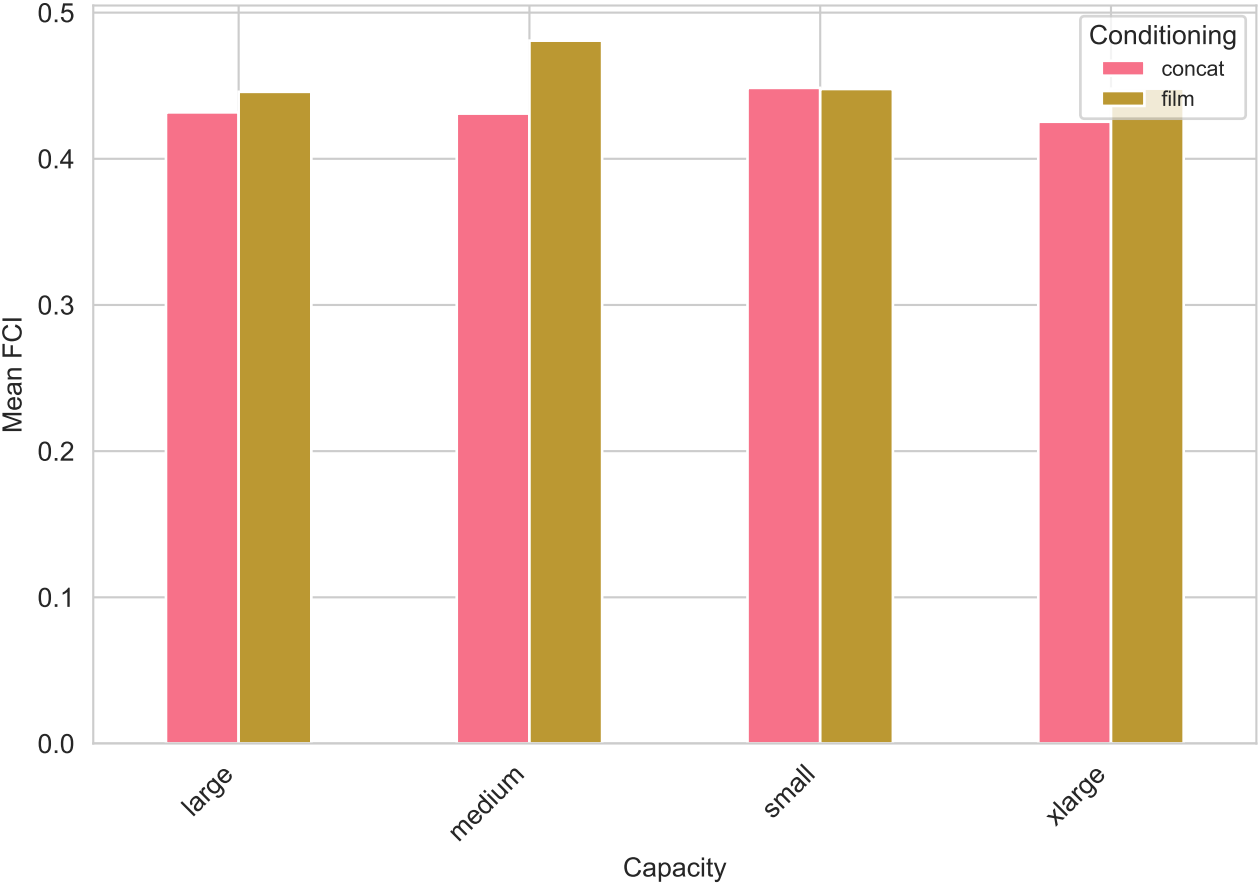


PAS by Capacity and Conditioning

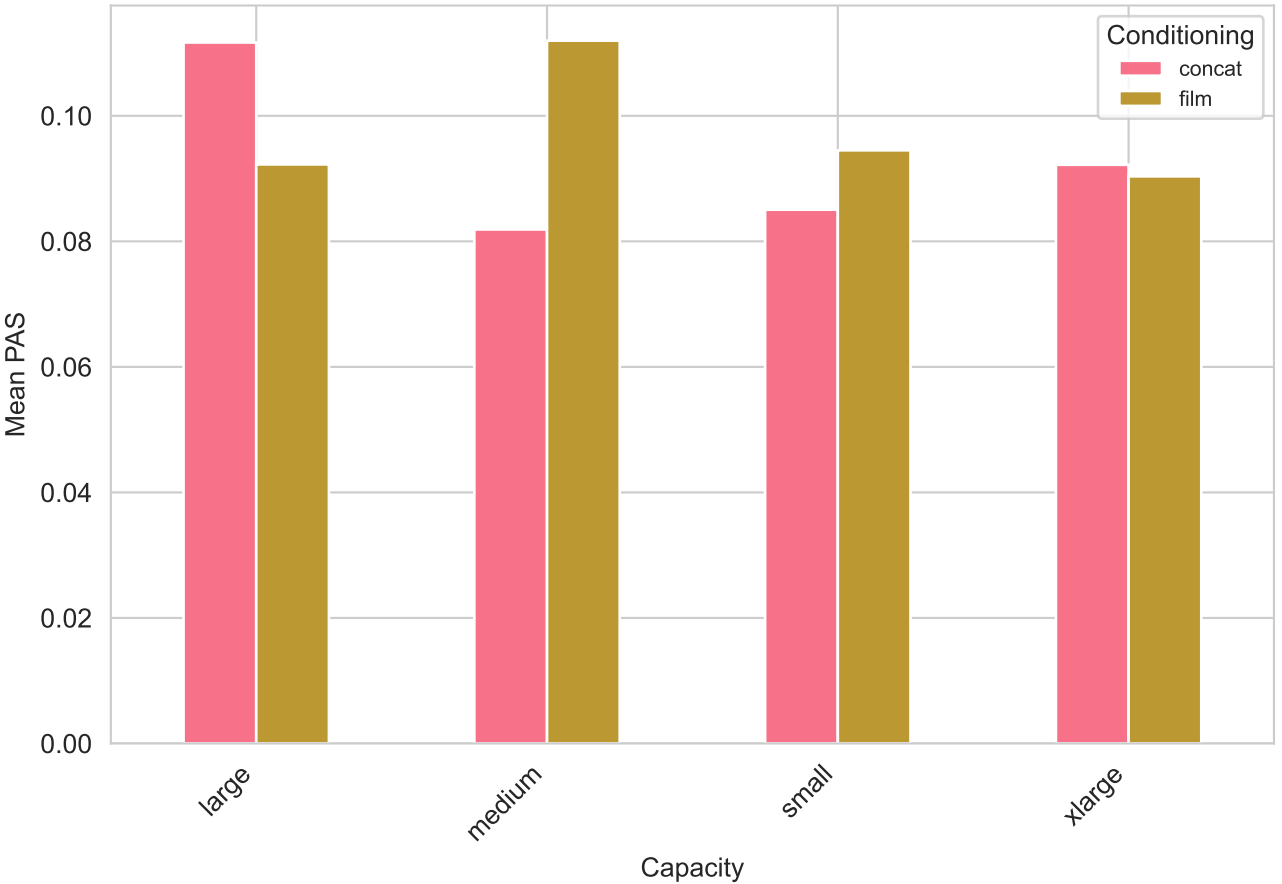



FCI vs Training Time

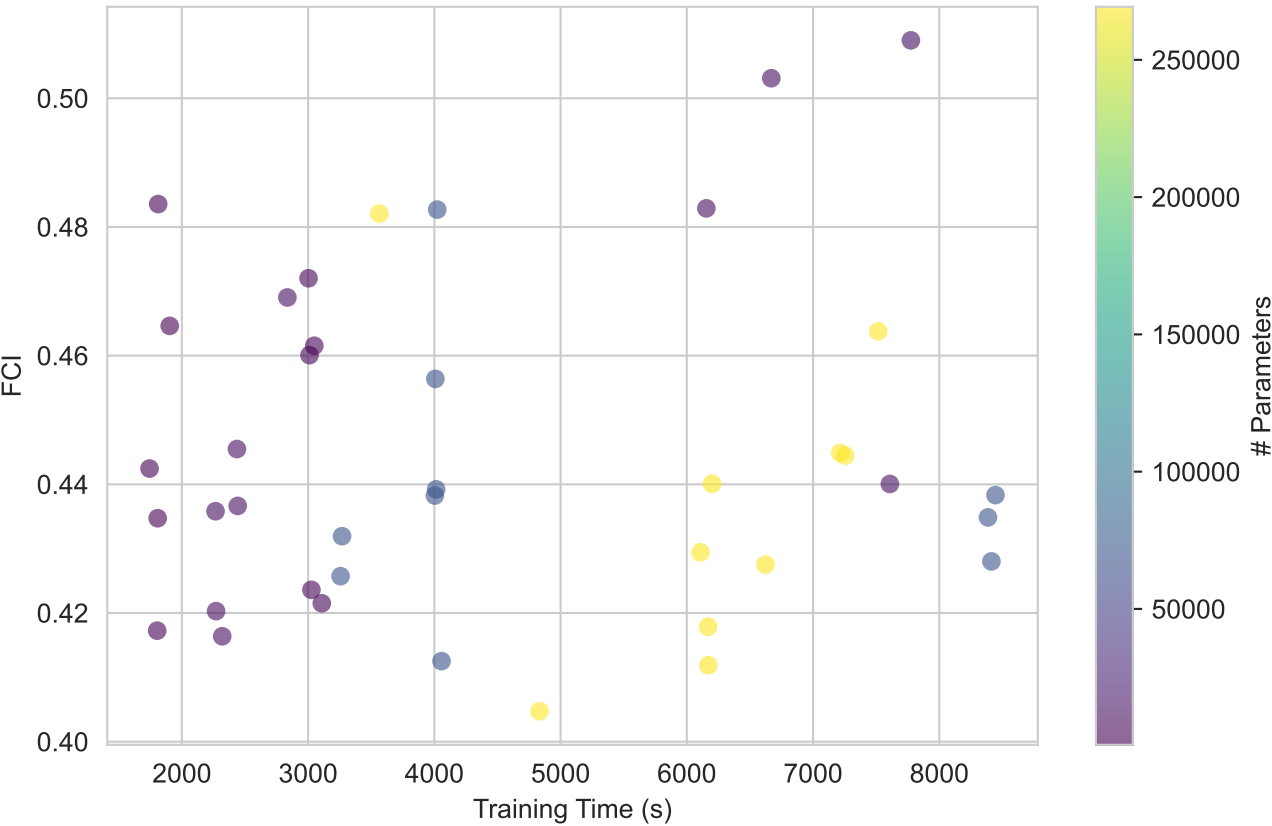

PAS vs Training Time

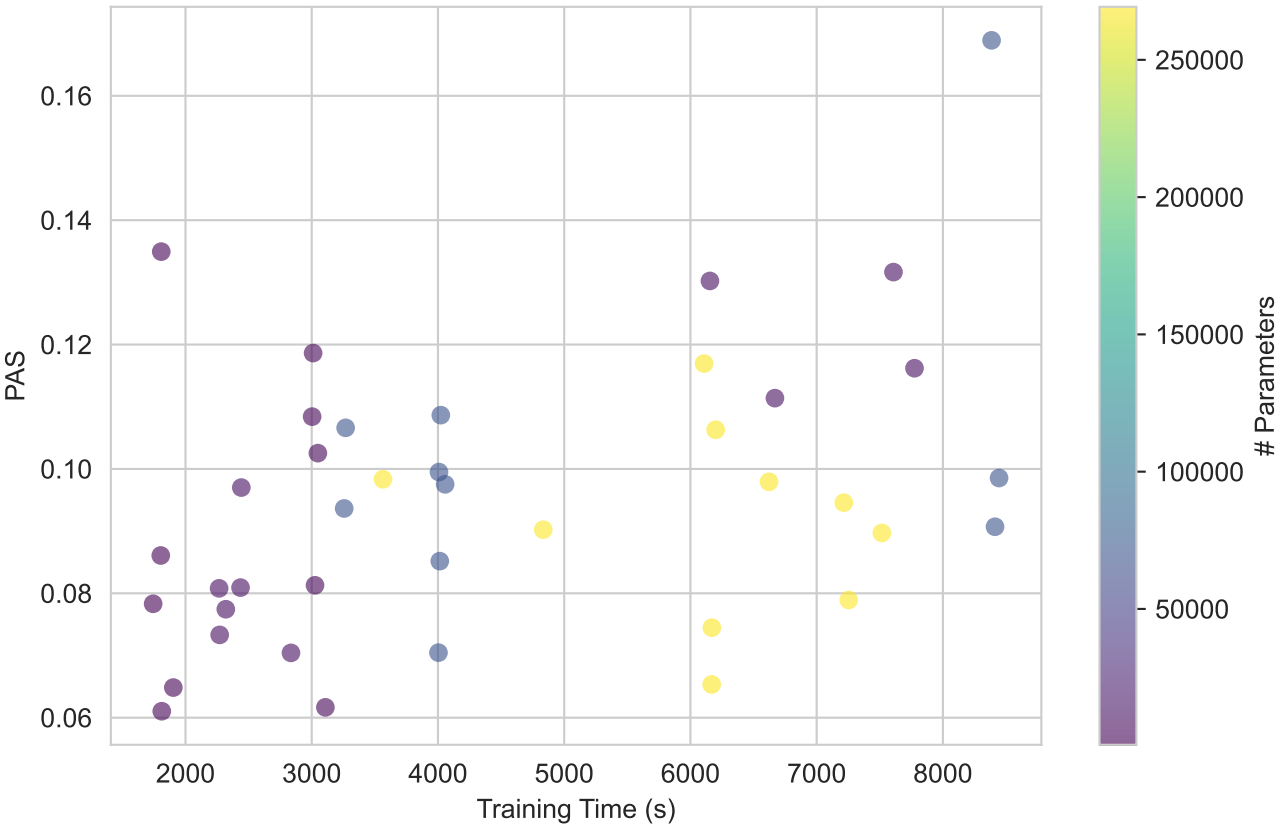

Capacity Ablation: Statistics and Correlations

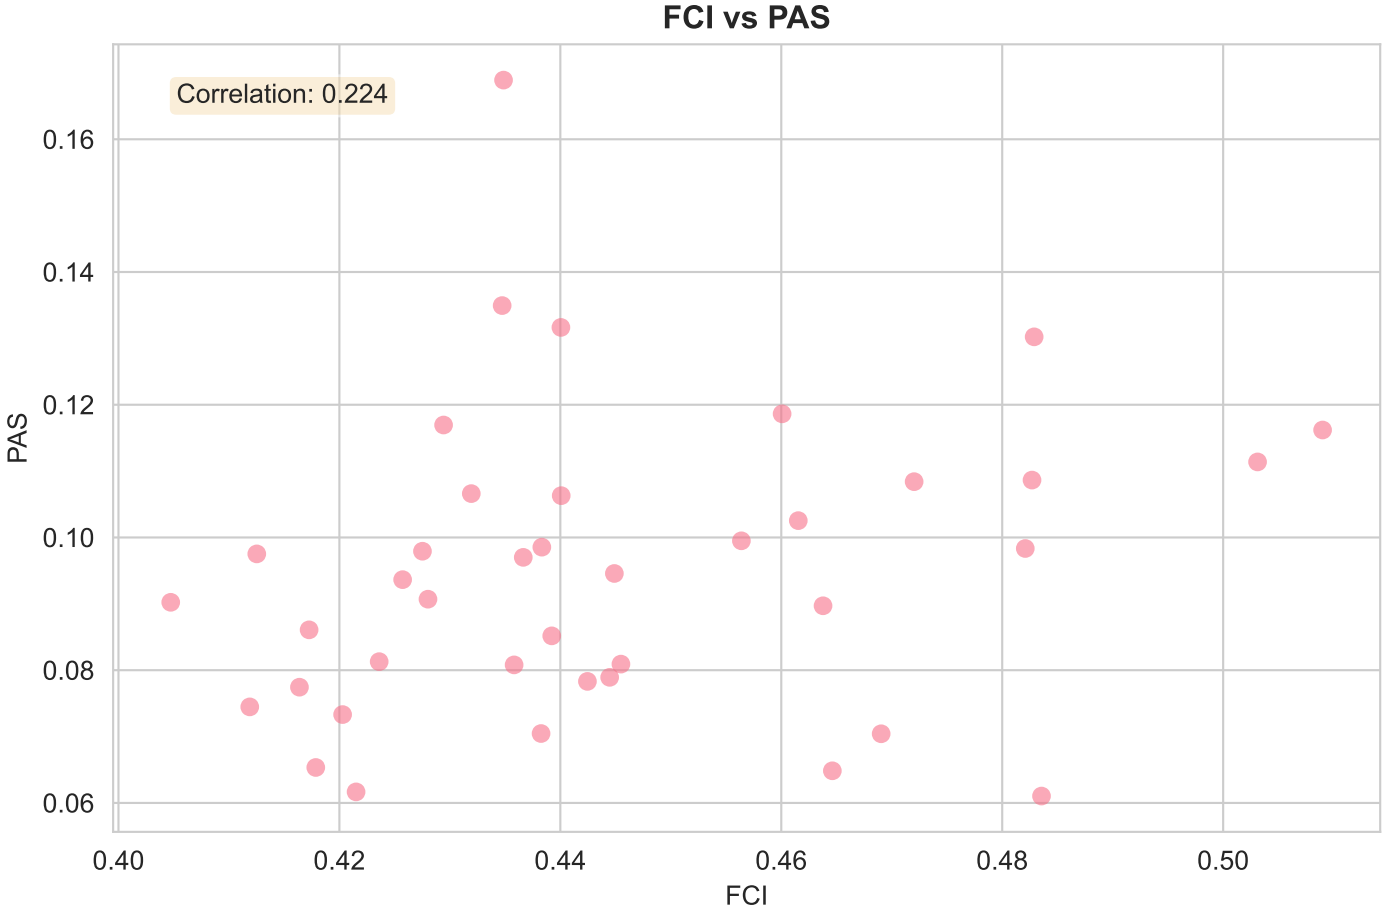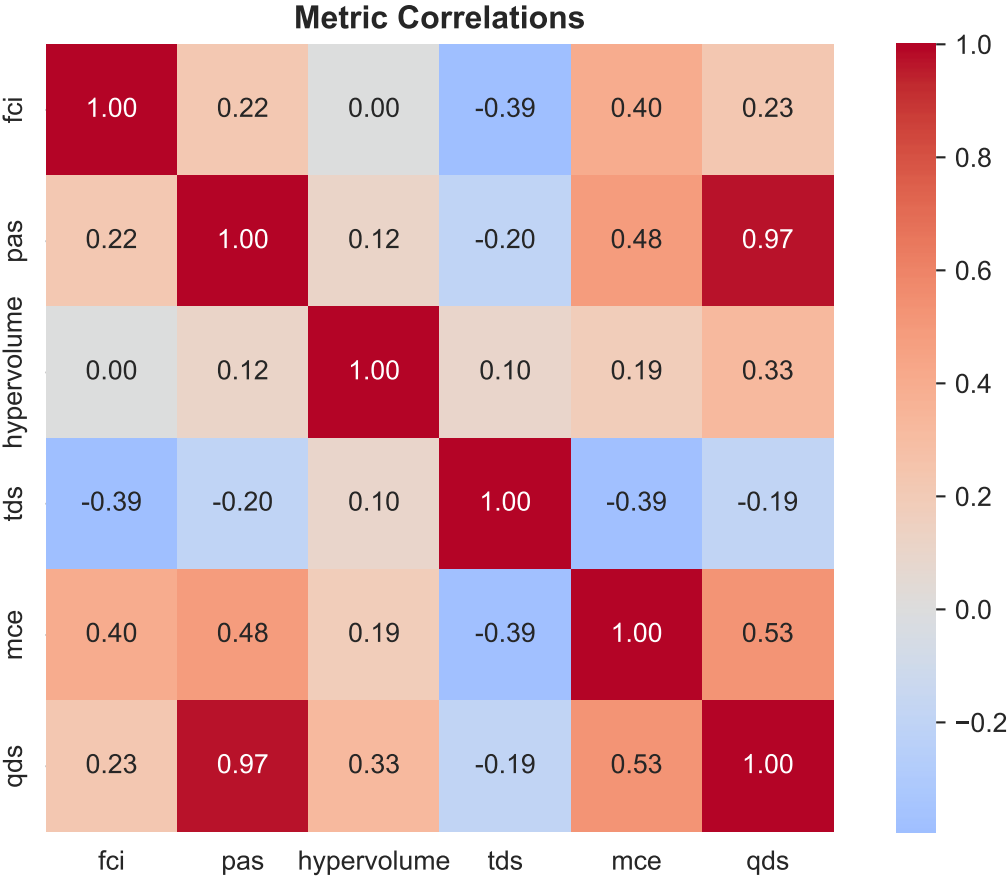

FCI Summary Statistics

Statistic	FCI
count	40.0000
mean	0.4449
std	0.0256
min	0.4047
25%	0.4271
50%	0.4388
75%	0.4621
max	0.5090

PAS Summary Statistics

Statistic	PAS
count	40.0000
mean	0.0950
std	0.0226
min	0.0610
25%	0.0788
50%	0.0941
75%	0.1071
max	0.1689