



Dieckow in-vivo — Monod dFBA cross-system prediction (kinetics calibrated on Heine 2025 in-vitro only)


Plan A: personalised — Pg fraction
(▲=CT2/dysbiotic, ●=CT1/commensal)

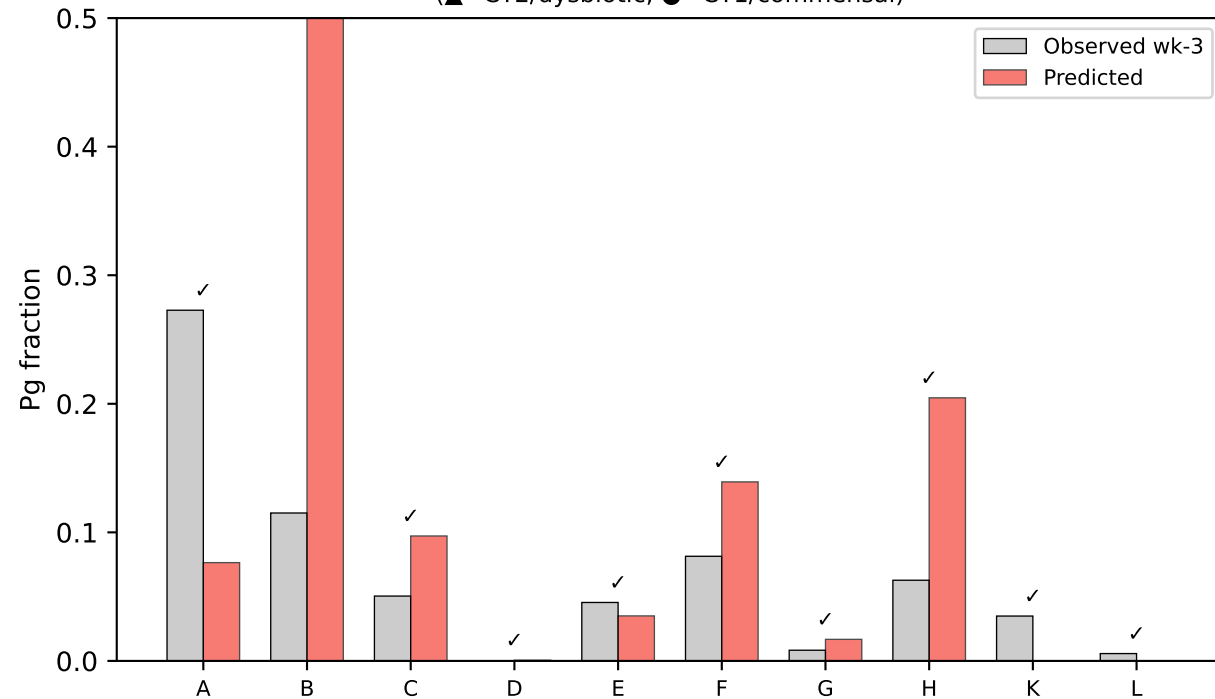

Plan A: personalised
mean RMSE=0.176 Pg-class 10/10

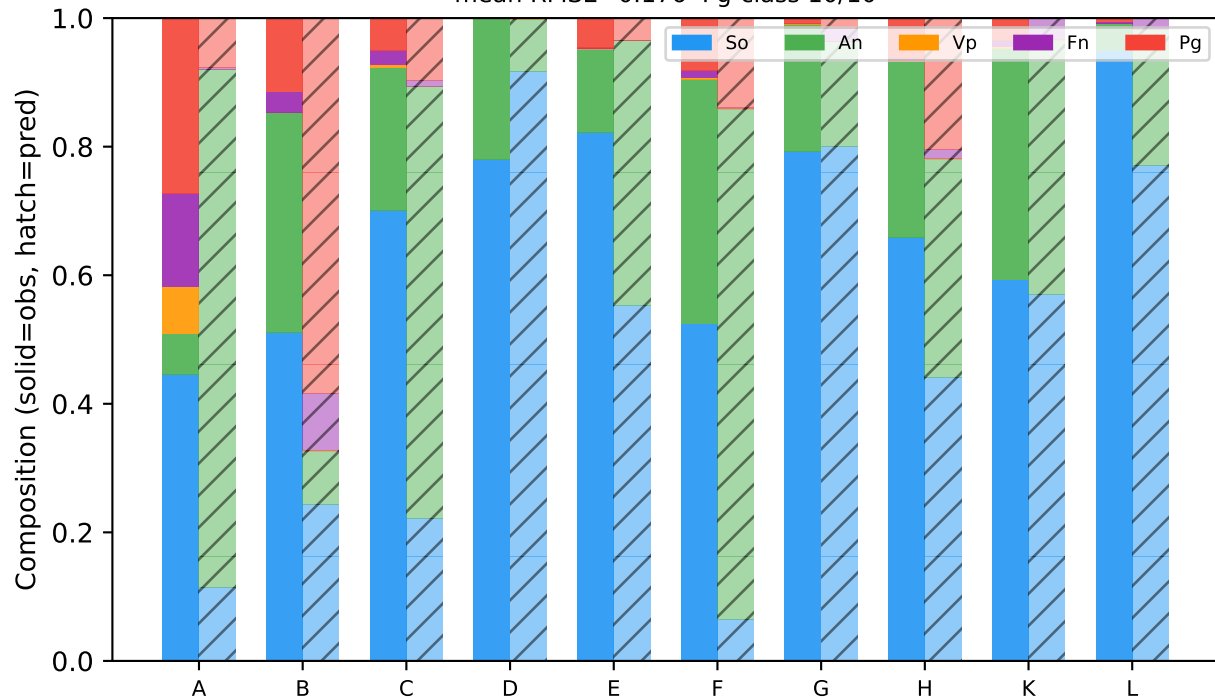

Plan B: attractor-only — Pg fraction
(▲=CT2/dysbiotic, ●=CT1/commensal)

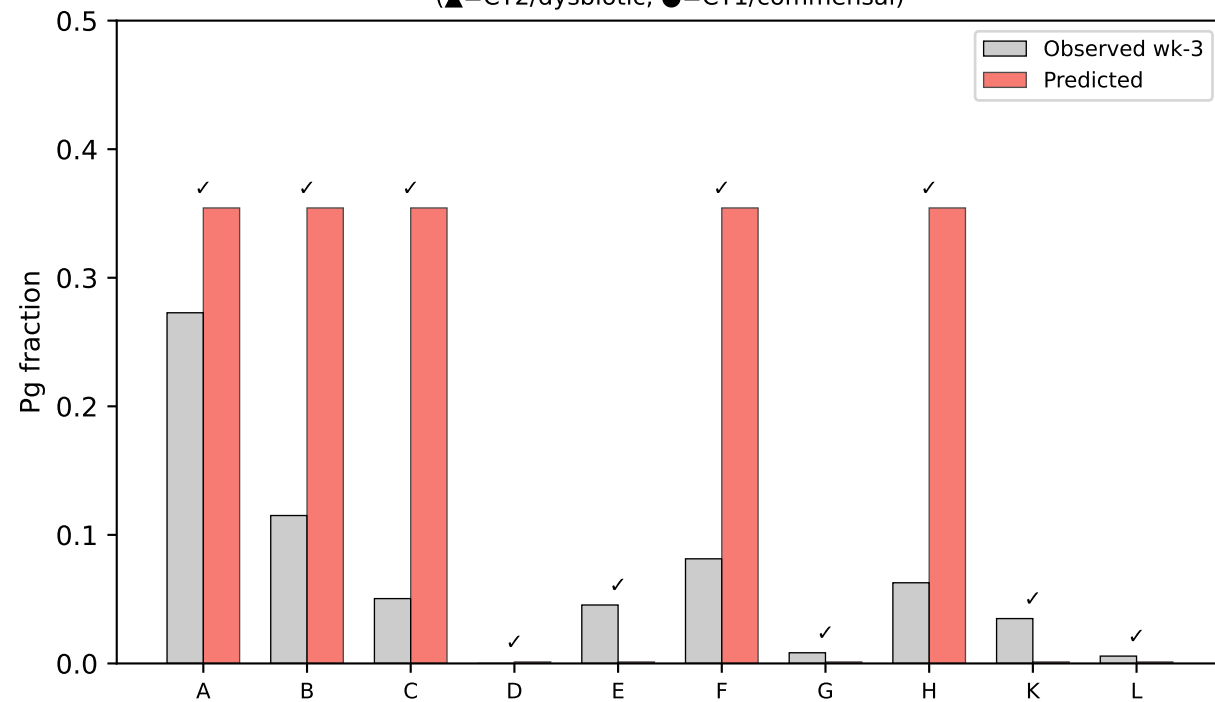

Plan B: attractor-only
mean RMSE=0.260 Pg-class 10/10

