


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

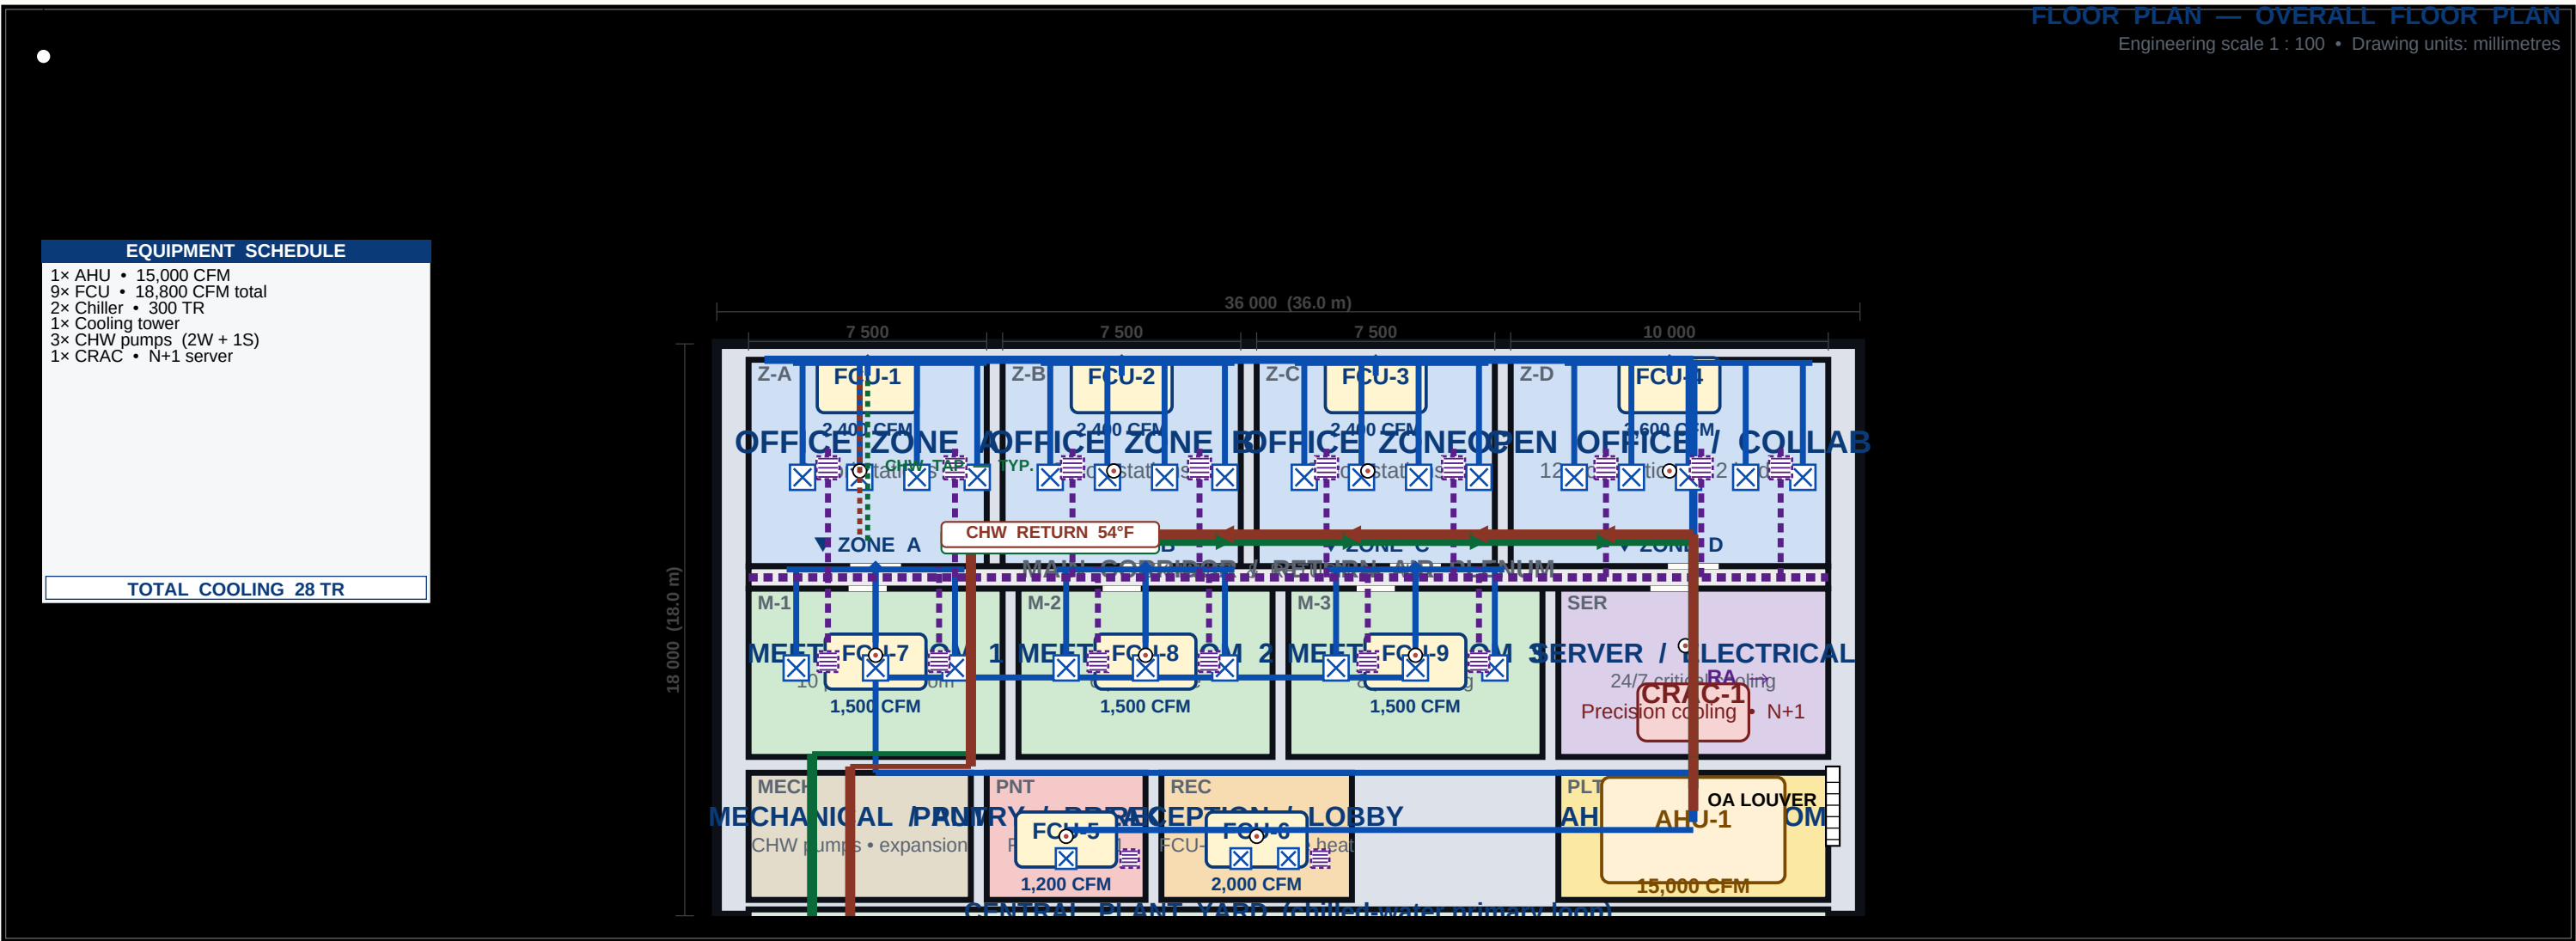

Alnchors

PROJECT
Multi-Zone AC System
OVERALL FLOOR PLAN

DATE
2026-07-20
REV. B (A3 multipage)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION


- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

AHU Air-Handling Unit
FCU Fan-Coil Unit
VAV Variable Air Volume
CRAC Computer Room A/C
CHW Chilled Water
CW Condenser Water
OA Outside Air
RA Return Air
SA Supply Air
TR Ton of Refrigeration
CFM Cubic Feet / Minute
DDC Direct Digital Control
MERV Minimum Efficiency Reporting Value
NC Noise Criterion
N+1 One redundant unit

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

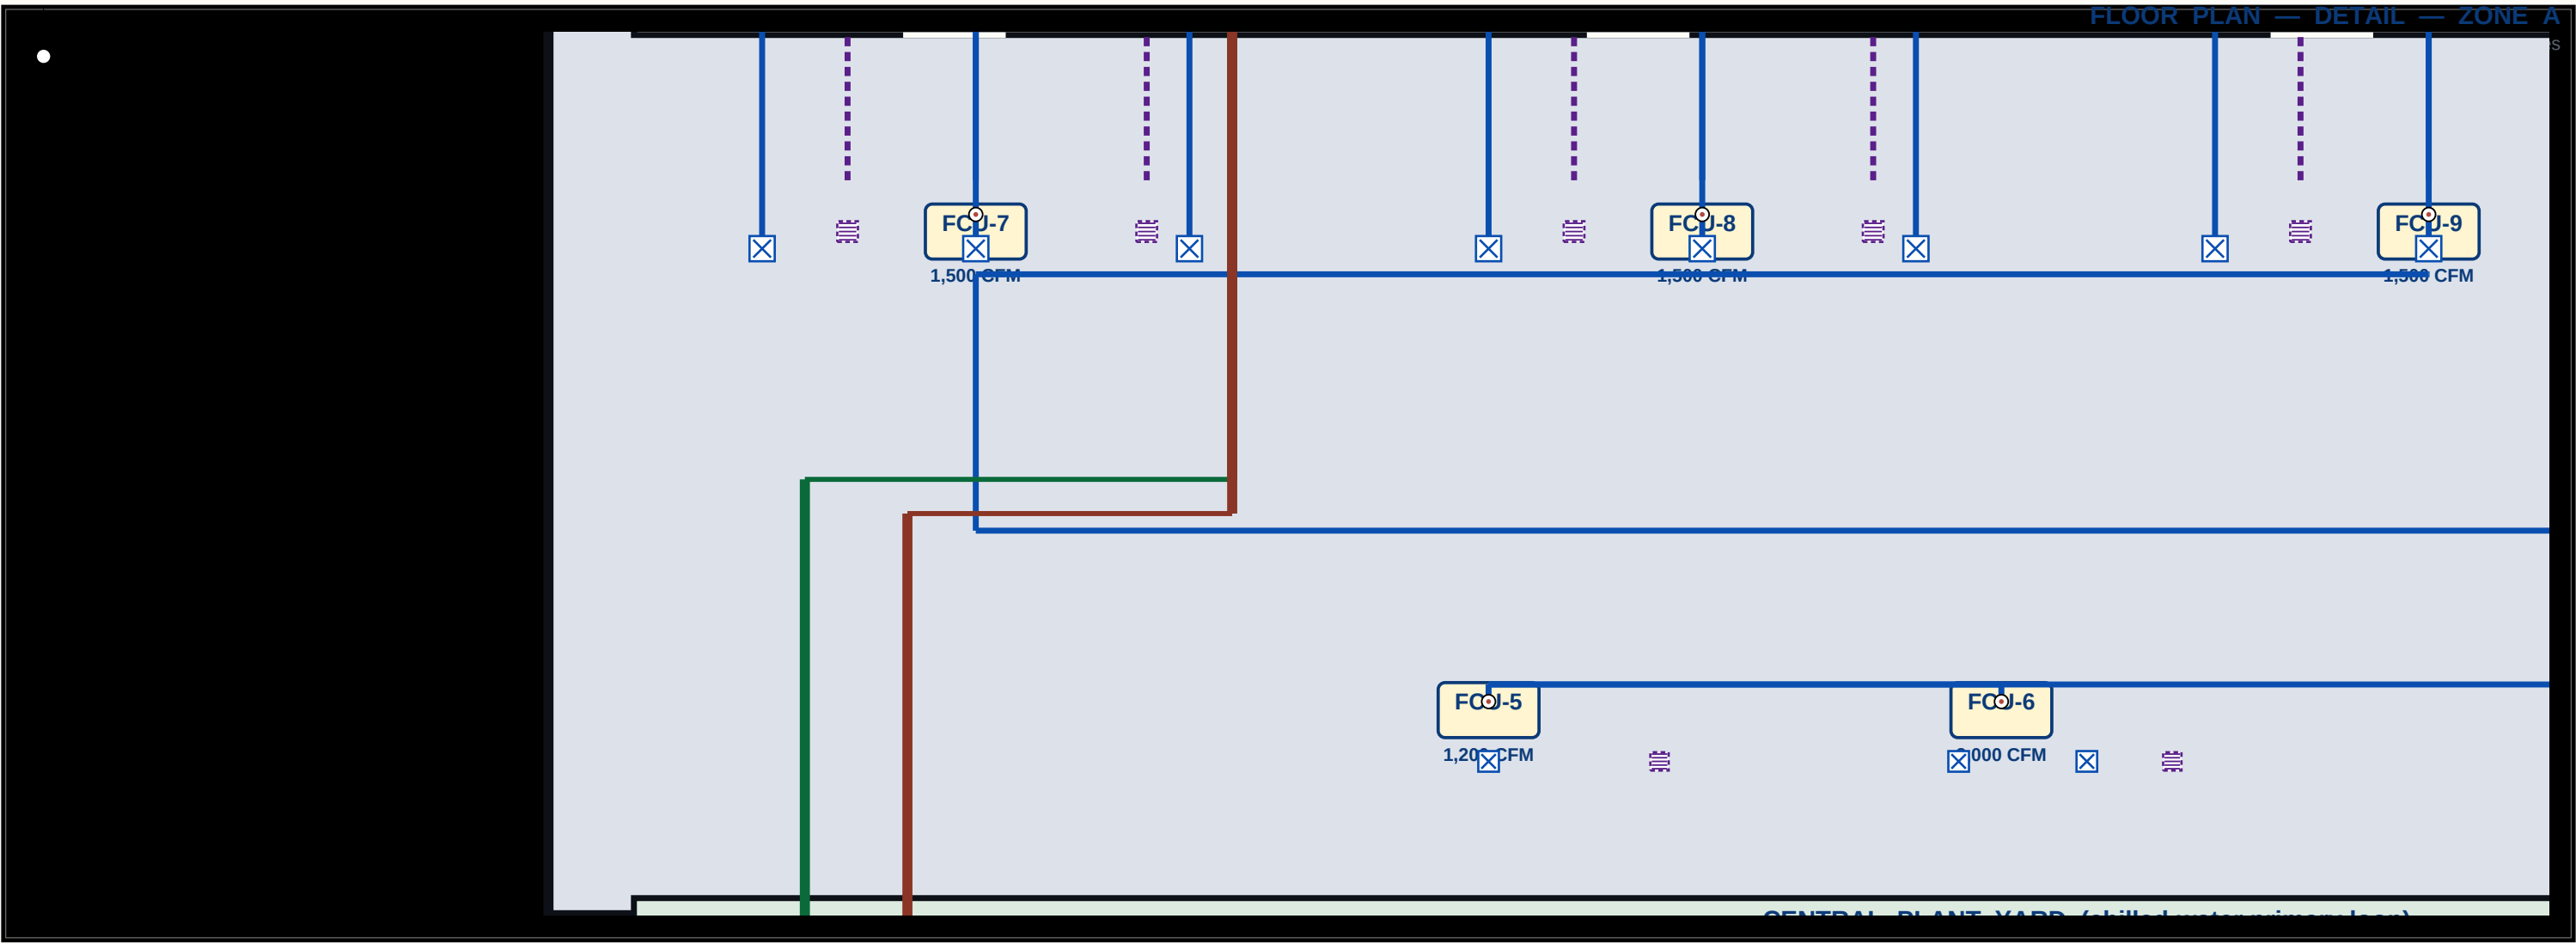


LEGEND	
Office zone	Air-Handling Unit (AHU)
Meeting / training	Fan-Coil Unit (FCU)
Server / electrical	Water-cooled chiller
AHU plant room	Cooling tower (induced draft)
Mechanical / pump	CRAC Precision cooling (server room)
Pantry / breakout	Primary chilled-water pump
Reception / lobby	Supply diffuser (4-way)
Corridor / return plenum	Return-air grille
Central plant yard	Zone thermostat (BACnet)

Alnchors LMAC & Great Buildings Engineering	PROJECT Multi-Zone AC System DETAIL — ZONE A	DATE 2026-07-20 REV. B (A3 multipage)
	DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION	
Supply duct (cool air) Return duct (warm air) CHW supply 44°F / 7°C CHW return 54°F / 12°C Condenser water (CW) Building / partition wall Flow direction arrow North arrow	• Total cooling load (est.): 28 TR • 1× AHU 15,000 CFM (4-zone VAV) • 9× FCUs zone + meeting + amenity • 2× 150 TR chillers (N+1) • 1× induced-draft cooling tower • 3× primary CHW pumps (2W + 1S) • CHW ΔT 10°F (44°F / 54°F) • OA: 20 CFM/person ASHRAE 62.1 • Filtration: MERV-13 (AHU) + MERV-8 (FCU) • Controls: BACnet/Modbus DDC, VAV zone dampers • Acoustics: NC-35 offices, NC-40 open zones • Server room: dedicated CRAC N+1, 24/7	AHU Air-Handling Unit FCU Fan-Coil Unit VAV Variable Air Volume CRAC Computer Room A/C CHW Chilled Water CW Condenser Water OA Outside Air RA Return Air SA Supply Air TR Ton of Refrigeration CFM Cubic Feet / Minute DDC Direct Digital Control MERV Minimum Efficiency Reporting Value NC Noise Criterion N+1 One redundant unit

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

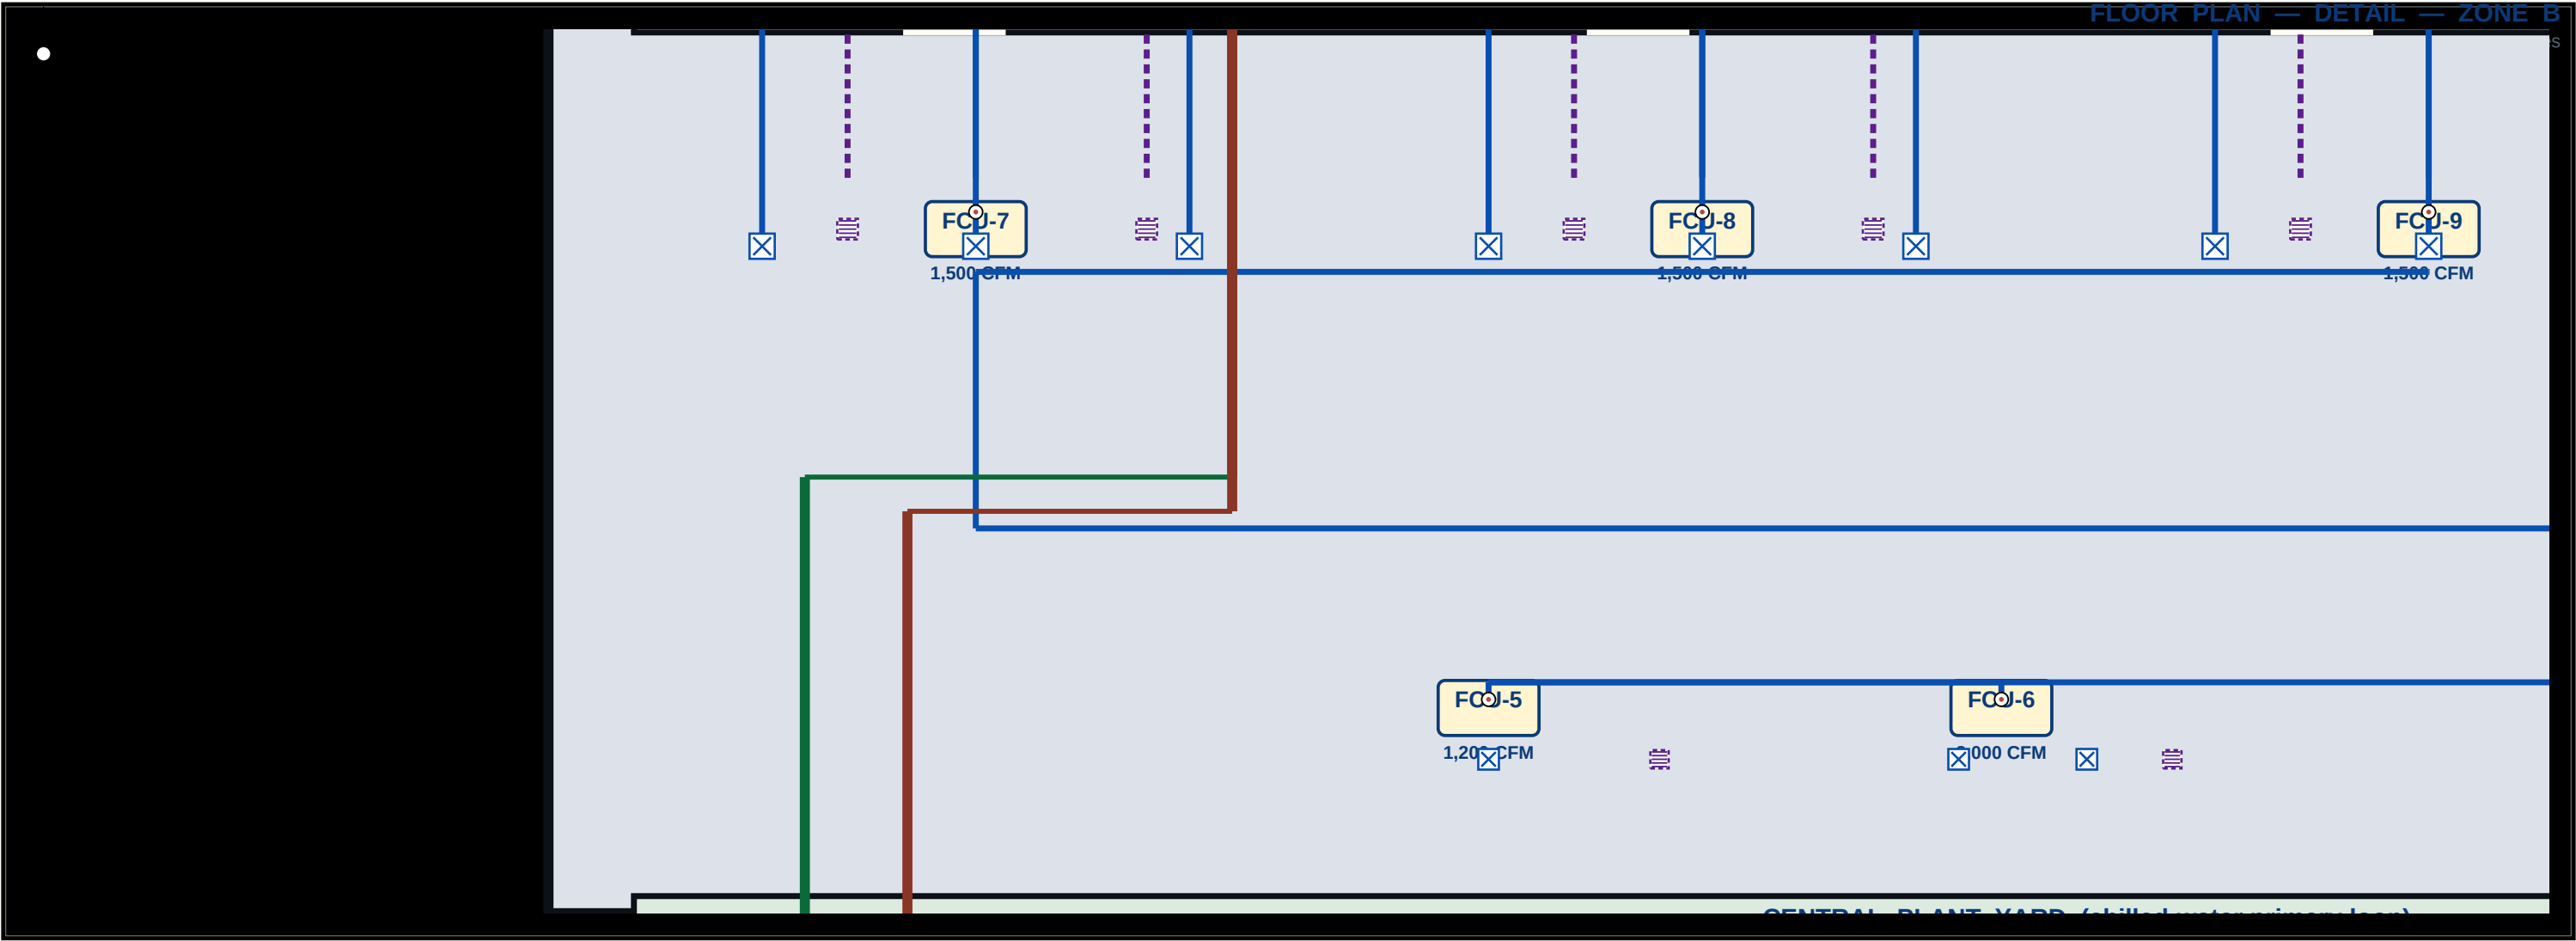


LEGEND	
Office zone	Air-Handling Unit (AHU)
Meeting / training	Fan-Coil Unit (FCU)
Server / electrical	Water-cooled chiller
AHU plant room	Cooling tower (induced draft)
Mechanical / pump	CRAC Precision cooling (server room)
Pantry / breakout	Primary chilled-water pump
Reception / lobby	Supply diffuser (4-way)
Corridor / return plenum	Return-air grille
Central plant yard	Zone thermostat (BACnet)

Alnchors LMAC & Great Buildings Engineering	PROJECT Multi-Zone AC System DETAIL — ZONE B	DATE 2026-07-20 REV. B (A3 multipage)
	DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION	
Supply duct (cool air) Return duct (warm air) CHW supply 44°F / 7°C CHW return 54°F / 12°C Condenser water (CW) Building / partition wall Flow direction arrow North arrow • Total cooling load (est.): 28 TR • 1× AHU 15,000 CFM (4-zone VAV) • 9× FCUs zone + meeting + amenity • 2× 150 TR chillers (N+1) • 1× induced-draft cooling tower • 3× primary CHW pumps (2W + 1S) • CHW ΔT 10°F (44°F / 54°F) • OA: 20 CFM/person ASHRAE 62.1 • Filtration: MERV-13 (AHU) + MERV-8 (FCU) • Controls: BACnet/Modbus DDC, VAV zone dampers • Acoustics: NC-35 offices, NC-40 open zones • Server room: dedicated CRAC N+1, 24/7 AHU Air-Handling Unit FCU Fan-Coil Unit VAV Variable Air Volume CRAC Computer Room A/C CHW Chilled Water CW Condenser Water OA Outside Air RA Return Air SA Supply Air TR Ton of Refrigeration CFM Cubic Feet / Minute DDC Direct Digital Control MERV Minimum Efficiency Reporting Value NC Noise Criterion N+1 One redundant unit		

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

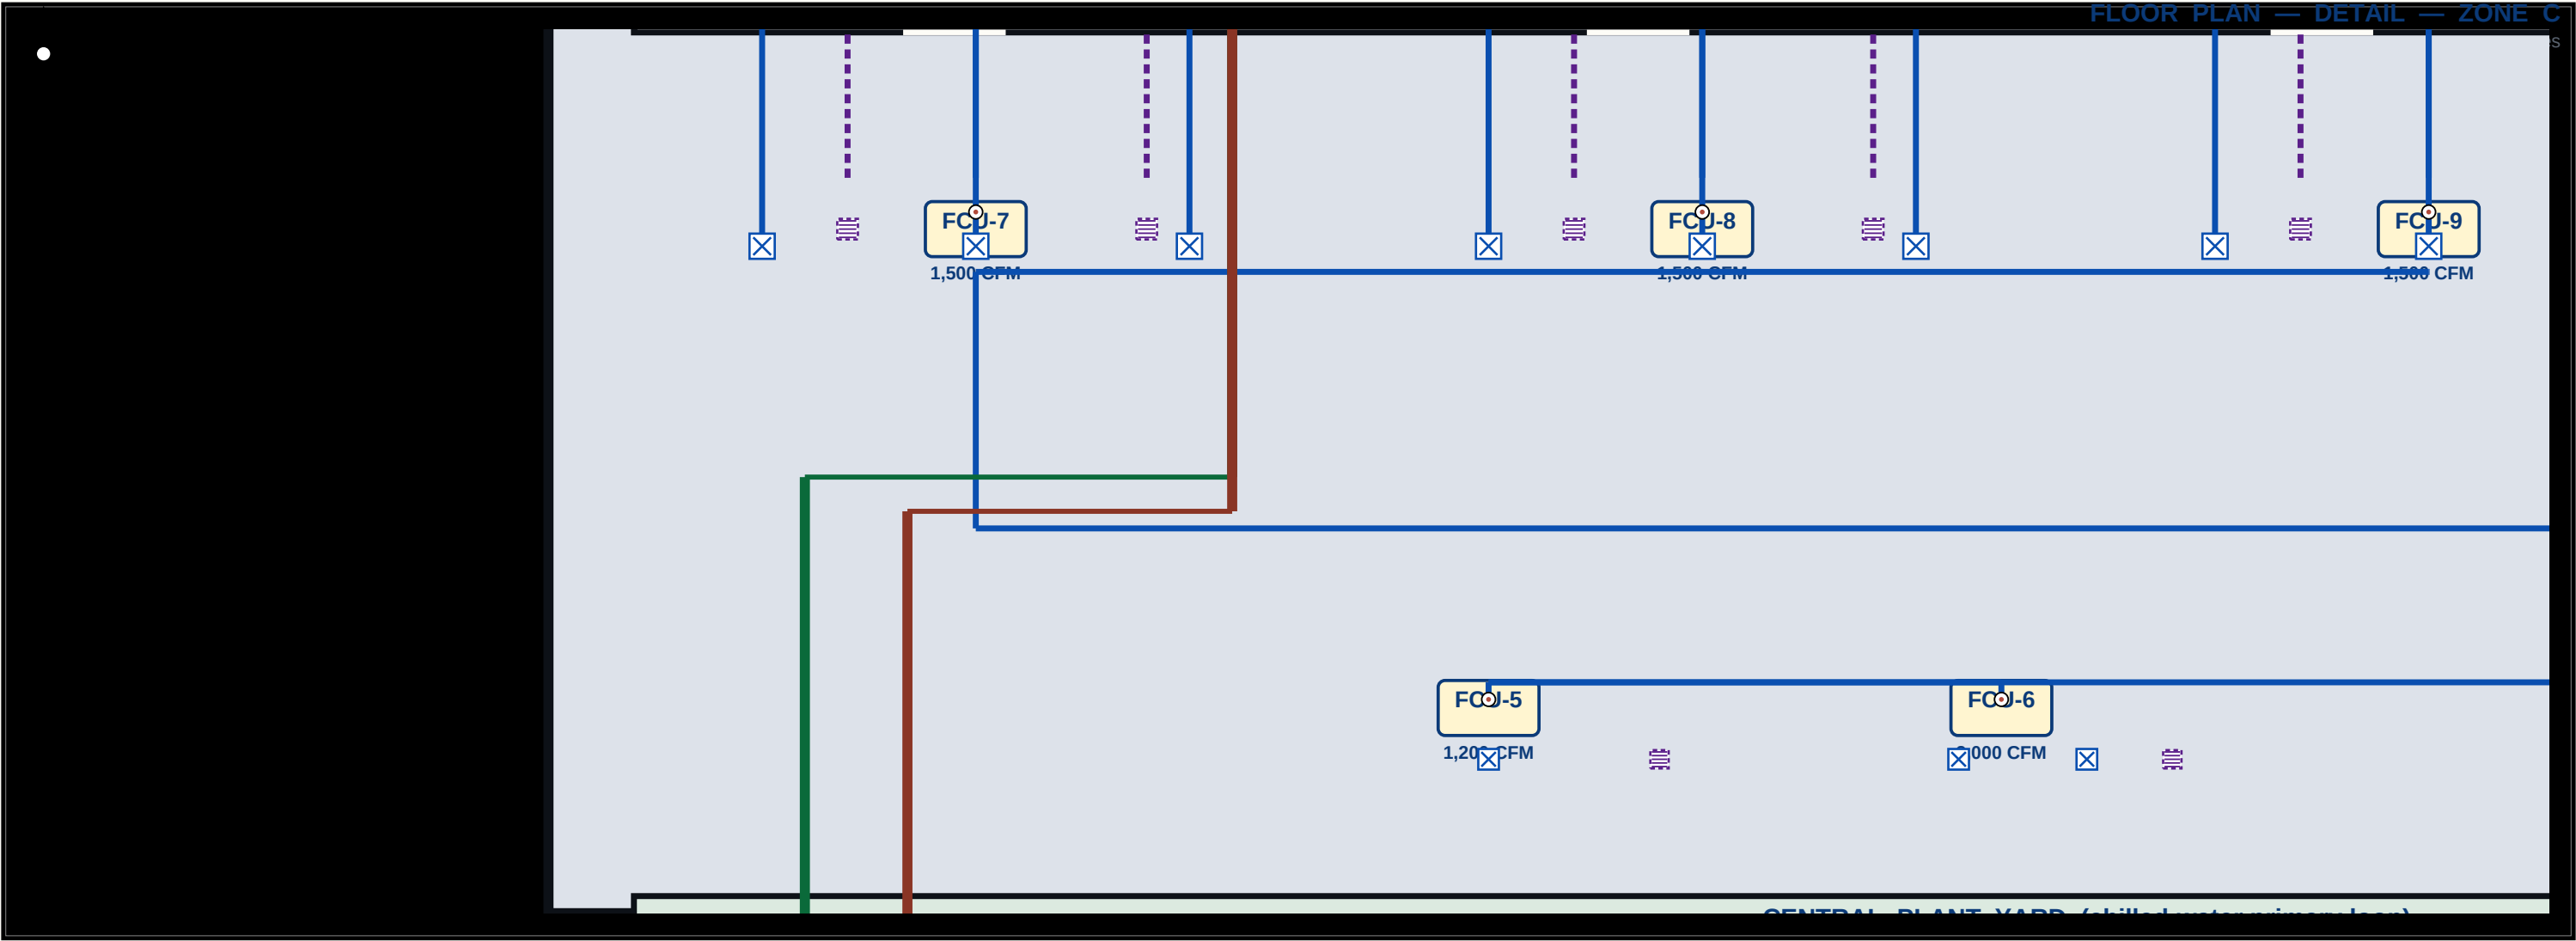


LEGEND	
Office zone	Air-Handling Unit (AHU)
Meeting / training	Fan-Coil Unit (FCU)
Server / electrical	Water-cooled chiller
AHU plant room	Cooling tower (induced draft)
Mechanical / pump	CRAC Precision cooling (server room)
Pantry / breakout	Primary chilled-water pump
Reception / lobby	Supply diffuser (4-way)
Corridor / return plenum	Return-air grille
Central plant yard	Zone thermostat (BACnet)

Alnchors LMAC & Great Buildings Engineering	PROJECT Multi-Zone AC System DETAIL — ZONE C	DATE 2026-07-20 REV. B (A3 multipage)
	DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION	
Supply duct (cool air) Return duct (warm air) CHW supply 44°F / 7°C CHW return 54°F / 12°C Condenser water (CW) Building / partition wall Flow direction arrow North arrow	• Total cooling load (est.): 28 TR • 1× AHU 15,000 CFM (4-zone VAV) • 9× FCUs zone + meeting + amenity • 2× 150 TR chillers (N+1) • 1× induced-draft cooling tower • 3× primary CHW pumps (2W + 1S) • CHW ΔT 10°F (44°F / 54°F) • OA: 20 CFM/person ASHRAE 62.1 • Filtration: MERV-13 (AHU) + MERV-8 (FCU) • Controls: BACnet/Modbus DDC, VAV zone dampers • Acoustics: NC-35 offices, NC-40 open zones • Server room: dedicated CRAC N+1, 24/7	AHU Air-Handling Unit FCU Fan-Coil Unit VAV Variable Air Volume CRAC Computer Room A/C CHW Chilled Water CW Condenser Water OA Outside Air RA Return Air SA Supply Air TR Ton of Refrigeration CFM Cubic Feet / Minute DDC Direct Digital Control MERV Minimum Efficiency Reporting Value NC Noise Criterion N+1 One redundant unit

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

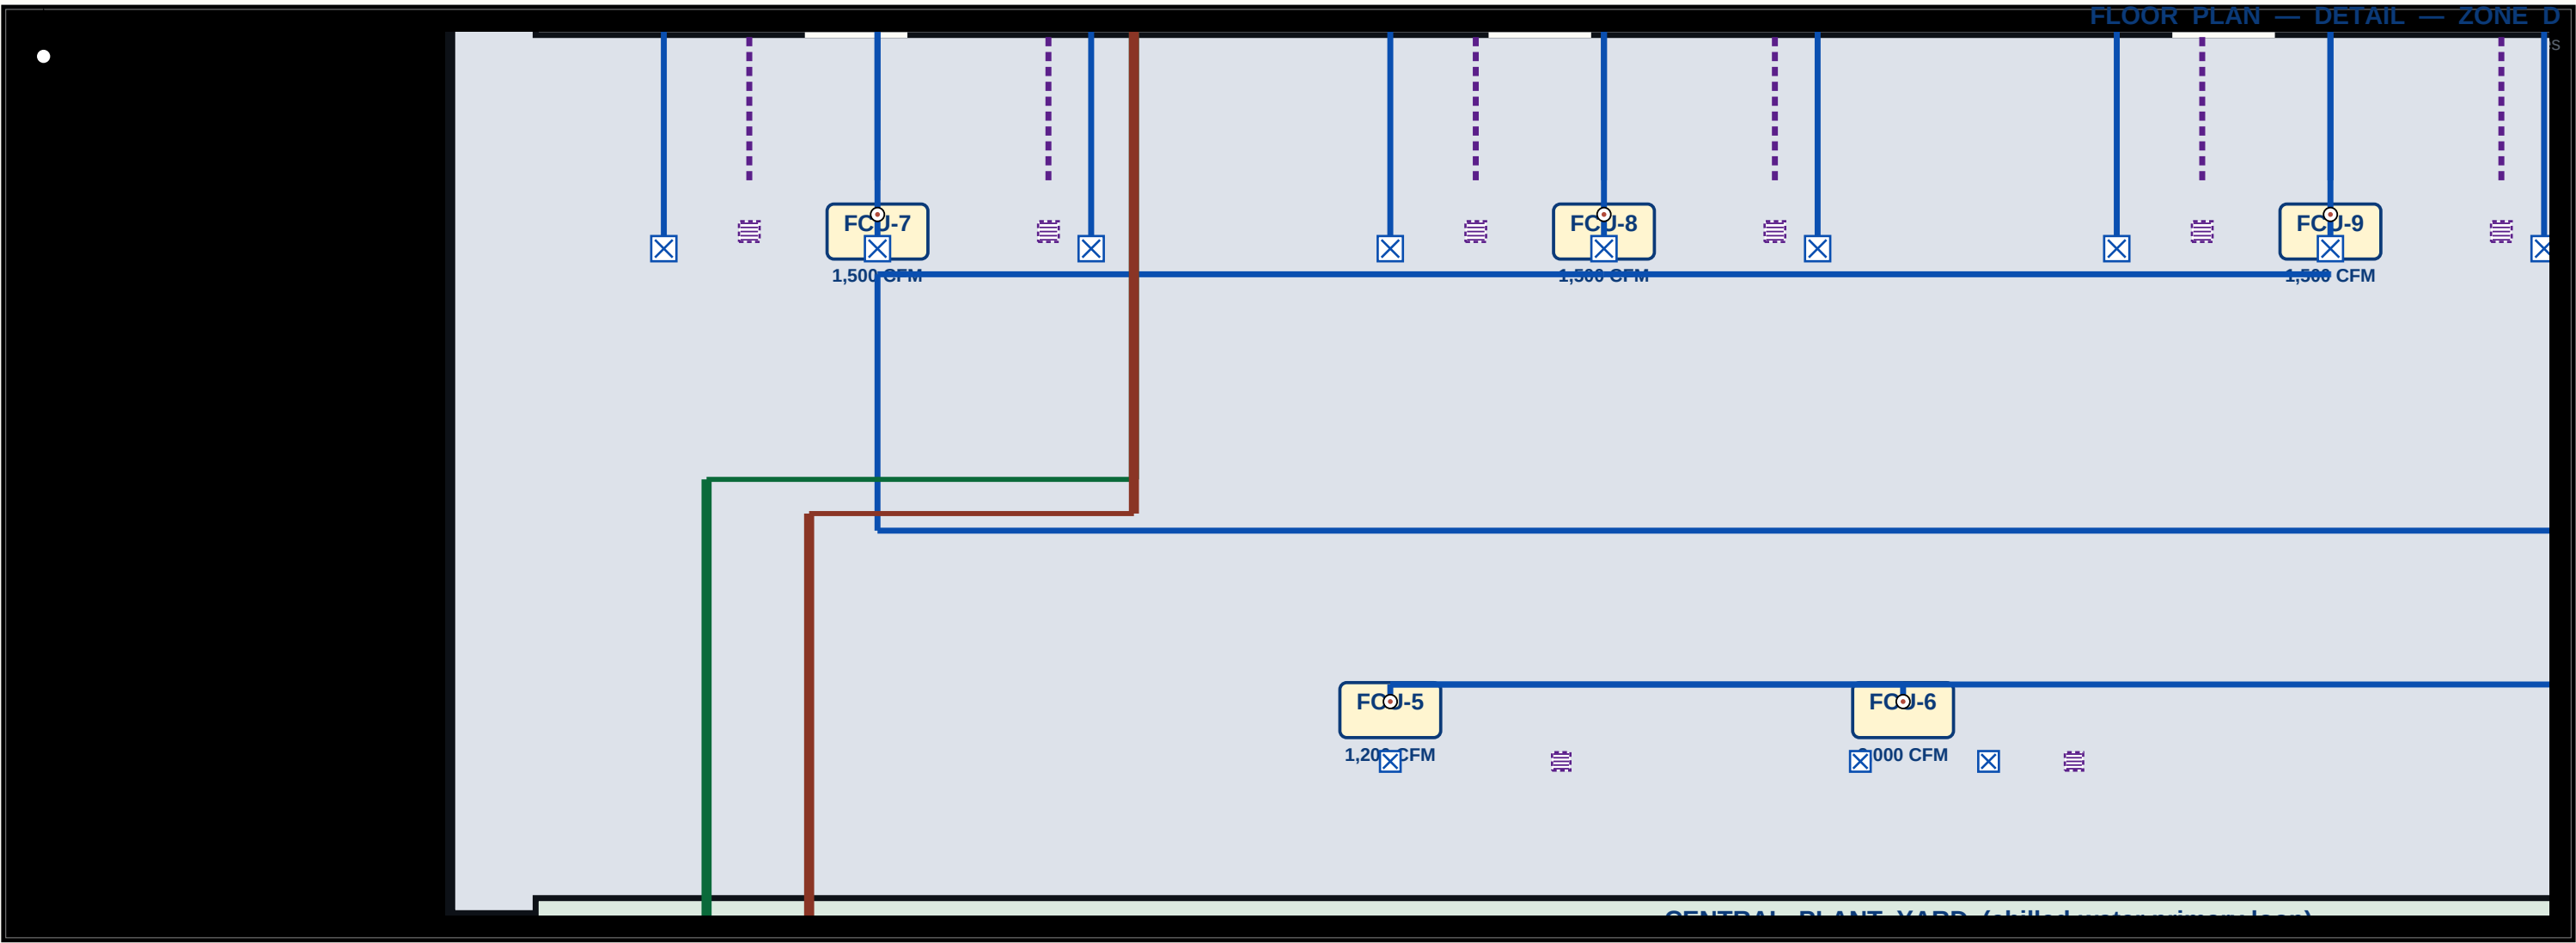


LEGEND	
Office zone	Air-Handling Unit (AHU)
Meeting / training	Fan-Coil Unit (FCU)
Server / electrical	Water-cooled chiller
AHU plant room	Cooling tower (induced draft)
Mechanical / pump	CRAC Precision cooling (server room)
Pantry / breakout	Primary chilled-water pump
Reception / lobby	Supply diffuser (4-way)
Corridor / return plenum	Return-air grille
Central plant yard	Zone thermostat (BACnet)

Alnchors LMAC & Great Buildings Engineering	PROJECT Multi-Zone AC System DETAIL — ZONE D	DATE 2026-07-20 REV. B (A3 multipage)
	DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION	
Supply duct (cool air) Return duct (warm air) CHW supply 44°F / 7°C CHW return 54°F / 12°C Condenser water (CW) Building / partition wall Flow direction arrow North arrow • Total cooling load (est.): 28 TR • 1× AHU 15,000 CFM (4-zone VAV) • 9× FCUs zone + meeting + amenity • 2× 150 TR chillers (N+1) • 1× induced-draft cooling tower • 3× primary CHW pumps (2W + 1S) • CHW ΔT 10°F (44°F / 54°F) • OA: 20 CFM/person ASHRAE 62.1 • Filtration: MERV-13 (AHU) + MERV-8 (FCU) • Controls: BACnet/Modbus DDC, VAV zone dampers • Acoustics: NC-35 offices, NC-40 open zones • Server room: dedicated CRAC N+1, 24/7 AHU Air-Handling Unit FCU Fan-Coil Unit VAV Variable Air Volume CRAC Computer Room A/C CHW Chilled Water CW Condenser Water OA Outside Air RA Return Air SA Supply Air TR Ton of Refrigeration CFM Cubic Feet / Minute DDC Direct Digital Control MERV Minimum Efficiency Reporting Value NC Noise Criterion N+1 One redundant unit		

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

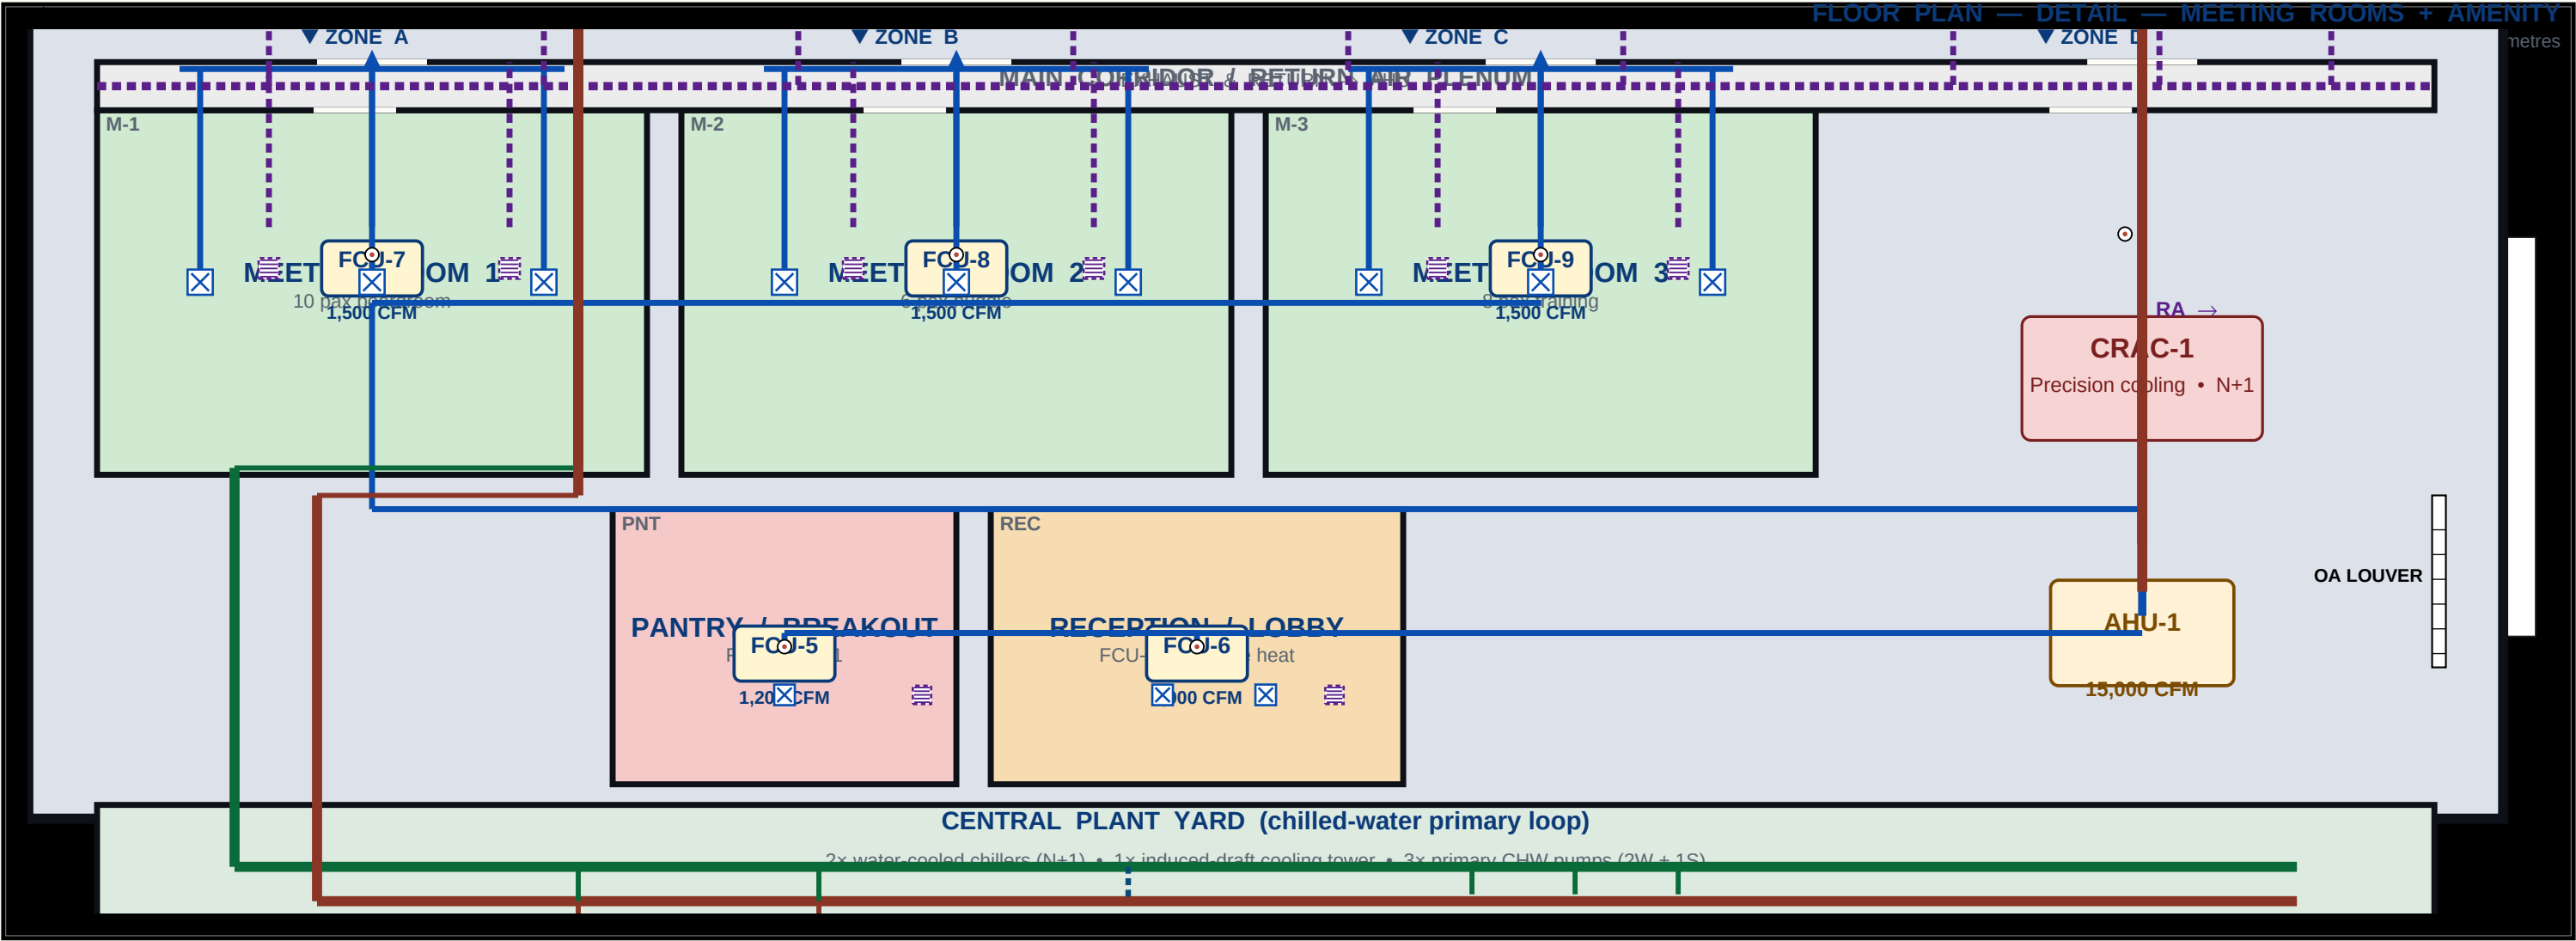

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Alnchors

HVAC & Smart Building Engineering

PROJECT

Multi-Zone AC System

DETAIL — MEETING ROOMS + AMENITY

DATE

2026-07-20

REV. B (A3 multipage)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

• Total cooling load (est.): 28 TR

• 1× AHU 15,000 CFM (4-zone VAV)

• 9× FCUs zone + meeting + amenity

• 2× 150 TR chillers (N+1)

• 1× induced-draft cooling tower

• 3× primary CHW pumps (2W + 1S)

• CHW ΔT 10°F (44°F / 54°F)

• OA: 20 CFM/person ASHRAE 62.1

• Filtration: MERV-13 (AHU) + MERV-8 (FCU)

• Controls: BACnet/Modbus DDC, VAV zone dampers

• Acoustics: NC-35 offices, NC-40 open zones

• Server room: dedicated CRAC N+1, 24/7

AHU Air-Handling Unit

FCU Fan-Coil Unit

VAV Variable Air Volume

CRAC Computer Room A/C

CHW Chilled Water

CW Condenser Water

OA Outside Air

RA Return Air

SA Supply Air

TR Ton of Refrigeration

CFM Cubic Feet / Minute

DDC Direct Digital Control

MERV Minimum Efficiency Reporting Value


NC Noise Criterion

N+1 One redundant unit

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

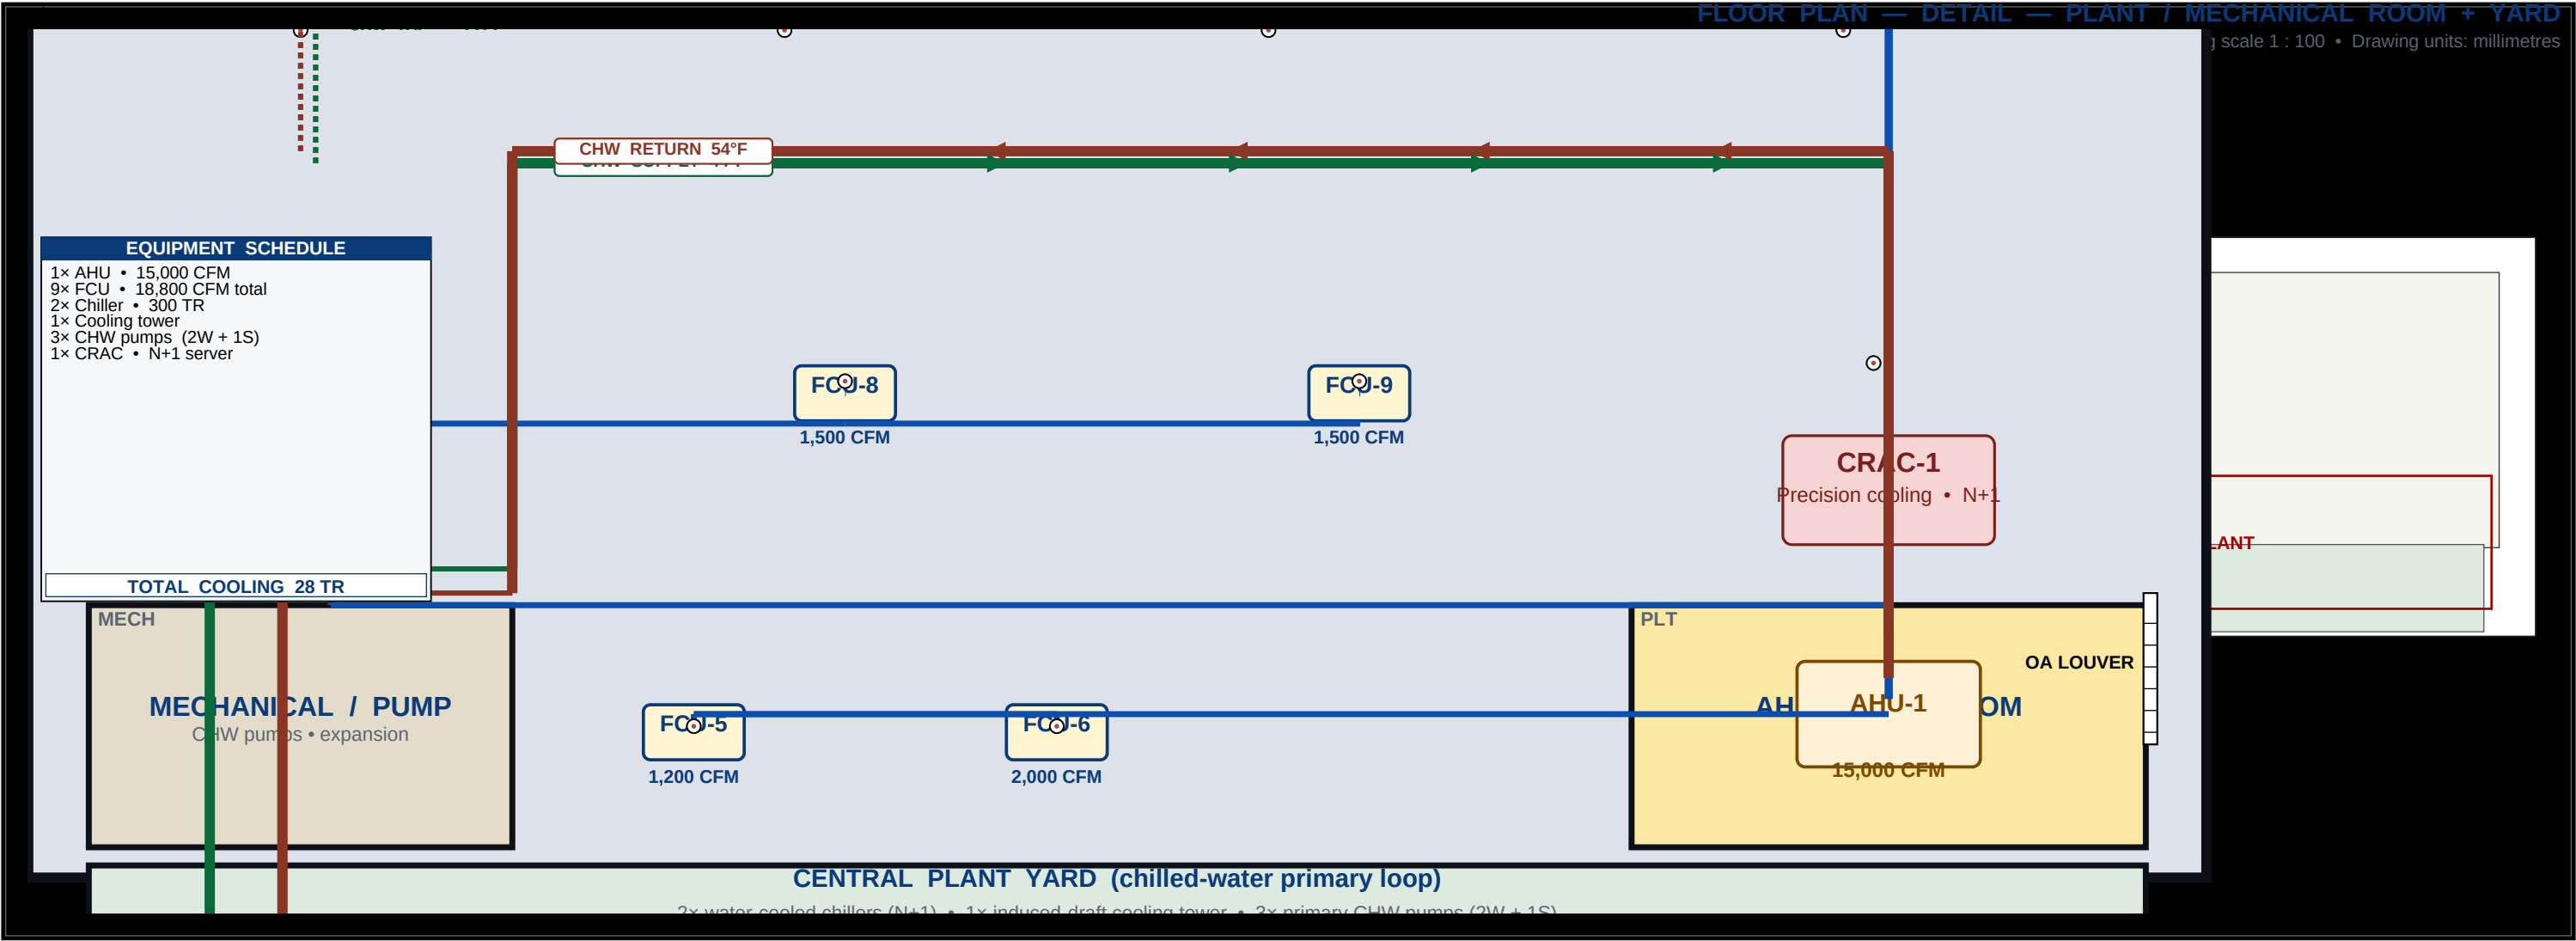

Alnchors

PROJECT
Multi-Zone AC System
DETAIL — PLANT / MECHANICAL ROOM + YARD

DATE
2026-07-20
REV. B (A3 multipage)

LEGEND

- Office zone
- Meeting / training
- Server / electrical
- AHU plant room
- Mechanical / pump
- Pantry / breakout
- Reception / lobby
- Corridor / return plenum
- Central plant yard

- Air-Handling Unit (AHU)
- Fan-Coil Unit (FCU)
- Water-cooled chiller
- Cooling tower (induced draft)
- Precision cooling (server room)
- Primary chilled-water pump
- Supply diffuser (4-way)
- Return-air grille
- Zone thermostat (BACnet)

- Supply duct (cool air)
- Return duct (warm air)
- CHW supply 44°F / 7°C
- CHW return 54°F / 12°C
- Condenser water (CW)
- Building / partition wall
- Flow direction arrow
- North arrow

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7


- AHU Air-Handling Unit
- FCU Fan-Coil Unit
- VAV Variable Air Volume
- CRAC Computer Room A/C
- CHW Chilled Water
- CW Condenser Water
- OA Outside Air
- RA Return Air
- SA Supply Air
- TR Ton of Refrigeration
- CFM Cubic Feet / Minute
- DDC Direct Digital Control
- MERV Minimum Efficiency Reporting Value
- NC Noise Criterion
- N+1 One redundant unit

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

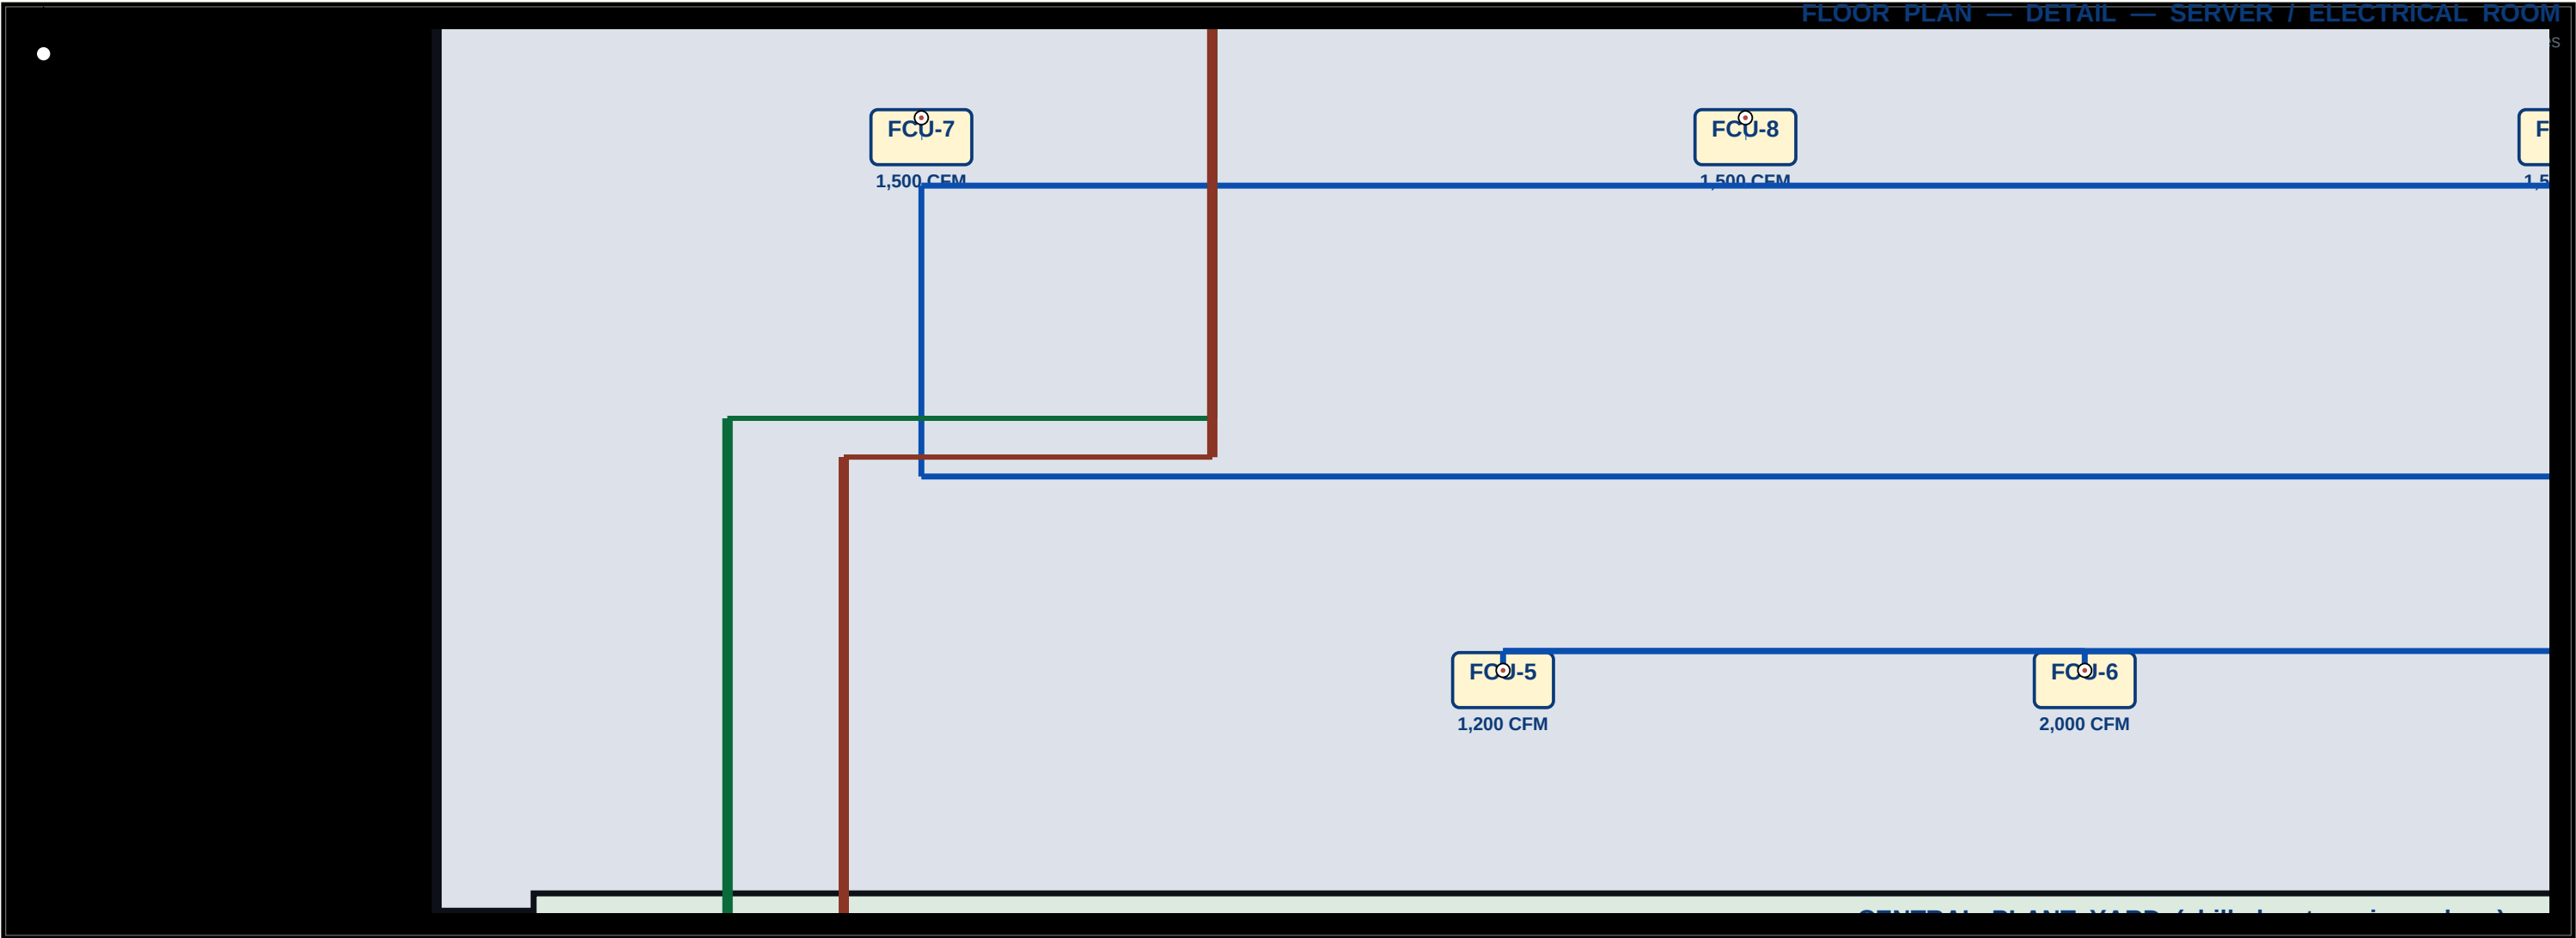

LEGEND			
Office zone Meeting / training Server / electrical AHU plant room Mechanical / pump Pantry / breakout Reception / lobby Corridor / return plenum Central plant yard	Air-Handling Unit (AHU) Fan-Coil Unit (FCU) Water-cooled chiller Cooling tower (induced draft) CRAC Precision cooling (server room) Primary chilled-water pump Supply diffuser (4-way) Return-air grille Zone thermostat (BACnet)	Supply duct (cool air) Return duct (warm air) CHW supply 44°F / 7°C CHW return 54°F / 12°C Condenser water (CW) Building / partition wall Flow direction arrow North arrow	PROJECT Multi-Zone AC System DETAIL — SERVER / ELECTRICAL ROOM DATE 2026-07-20 REV. B (A3 multipage) DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION • Total cooling load (est.): 28 TR • 1× AHU 15,000 CFM (4-zone VAV) • 9× FCUs zone + meeting + amenity • 2× 150 TR chillers (N+1) • 1× induced-draft cooling tower • 3× primary CHW pumps (2W + 1S) • CHW ΔT 10°F (44°F / 54°F) • OA: 20 CFM/person ASHRAE 62.1 • Filtration: MERV-13 (AHU) + MERV-8 (FCU) • Controls: BACnet/Modbus DDC, VAV zone dampers • Acoustics: NC-35 offices, NC-40 open zones • Server room: dedicated CRAC N+1, 24/7 AHU Air-Handling Unit FCU Fan-Coil Unit VAV Variable Air Volume CRAC Computer Room A/C CHW Chilled Water CW Condenser Water OA Outside Air RA Return Air SA Supply Air TR Ton of Refrigeration CFM Cubic Feet / Minute DDC Direct Digital Control MERV Minimum Efficiency Reporting Value NC Noise Criterion N+1 One redundant unit