


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — OVERALL FLOOR PLAN

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

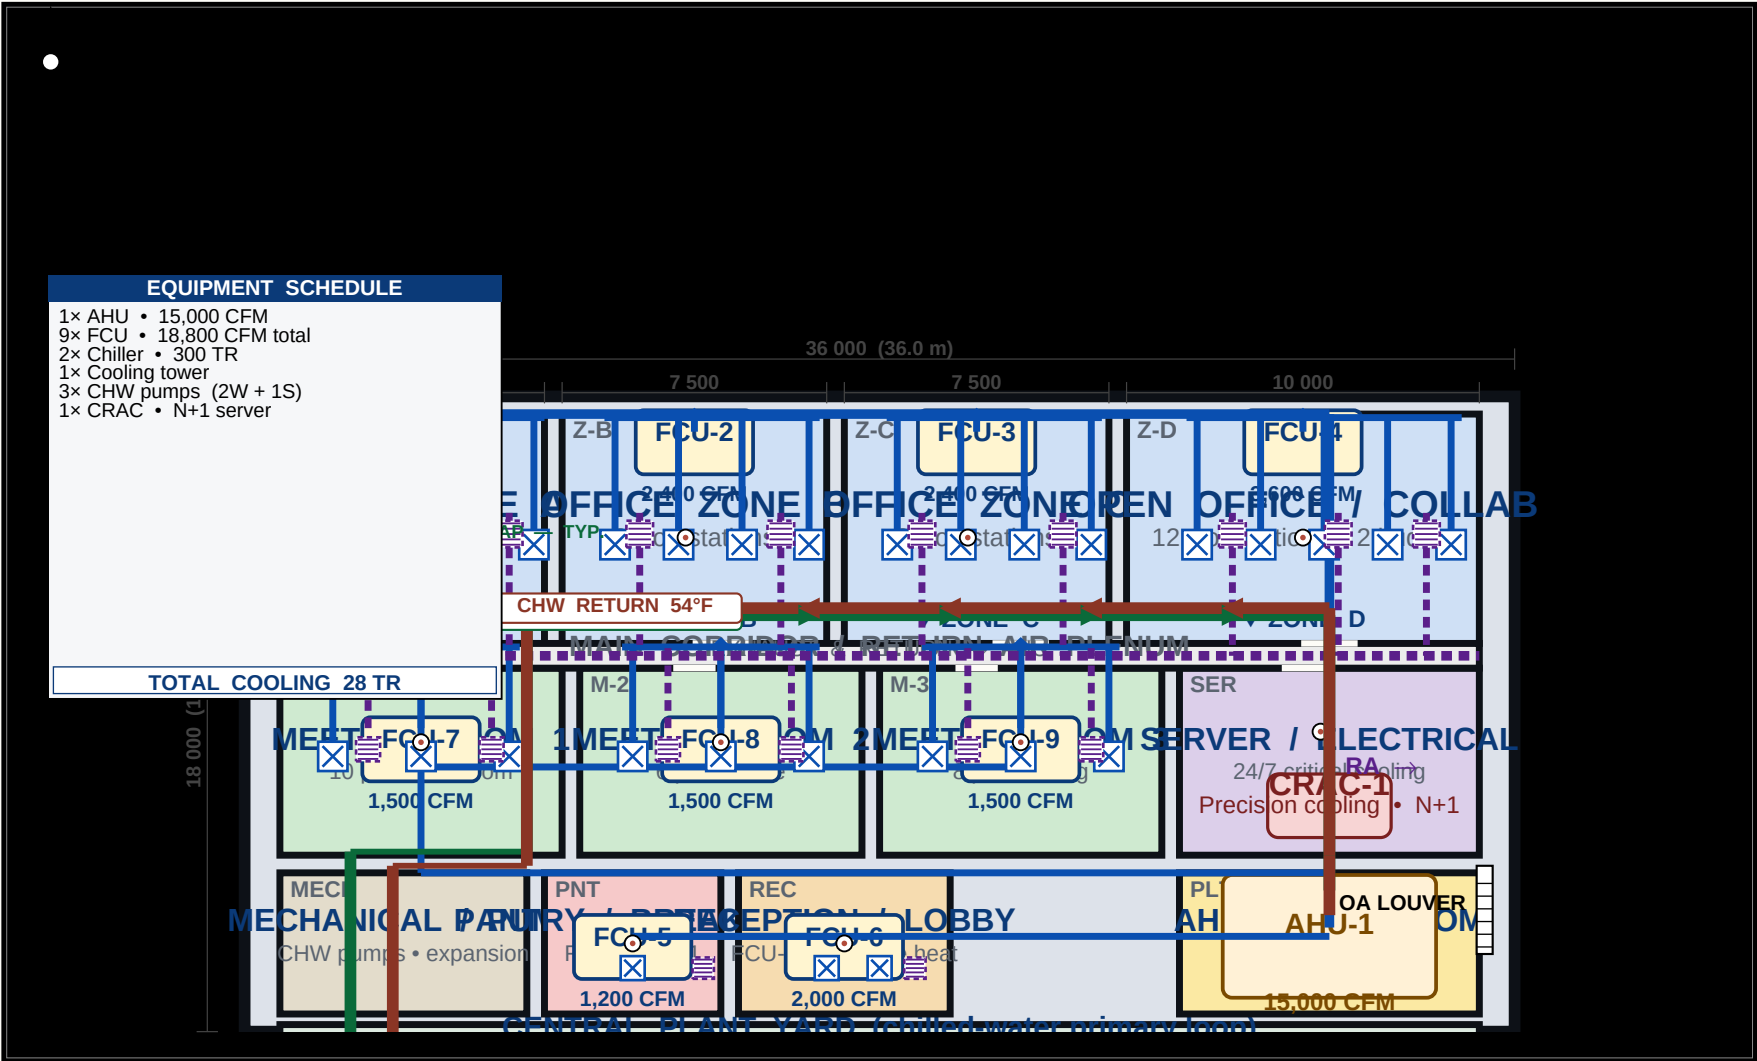

PROJECT

Multi-Zone AC System

OVERALL FLOOR PLAN

DATE

2026-01-01

REV. B

Alnchors

WAC & Smart Building Engineering

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

AHU

Air-Handling Unit

FCU

Fan-Coil Unit

VAV

Variable Air Volume

CRAC

Computer Room A/C

CHW

Chilled Water

CW

Condenser Water

OA

Outside Air

RA

Return Air

SA

Supply Air

TR

Ton of Refrigeration

CFM

Cubic Feet / Minute

DDC

Direct Digital Control

MERV

Minimum Efficiency Reporting Value

NC

Noise Criterion

N+1

One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — ZONE A

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

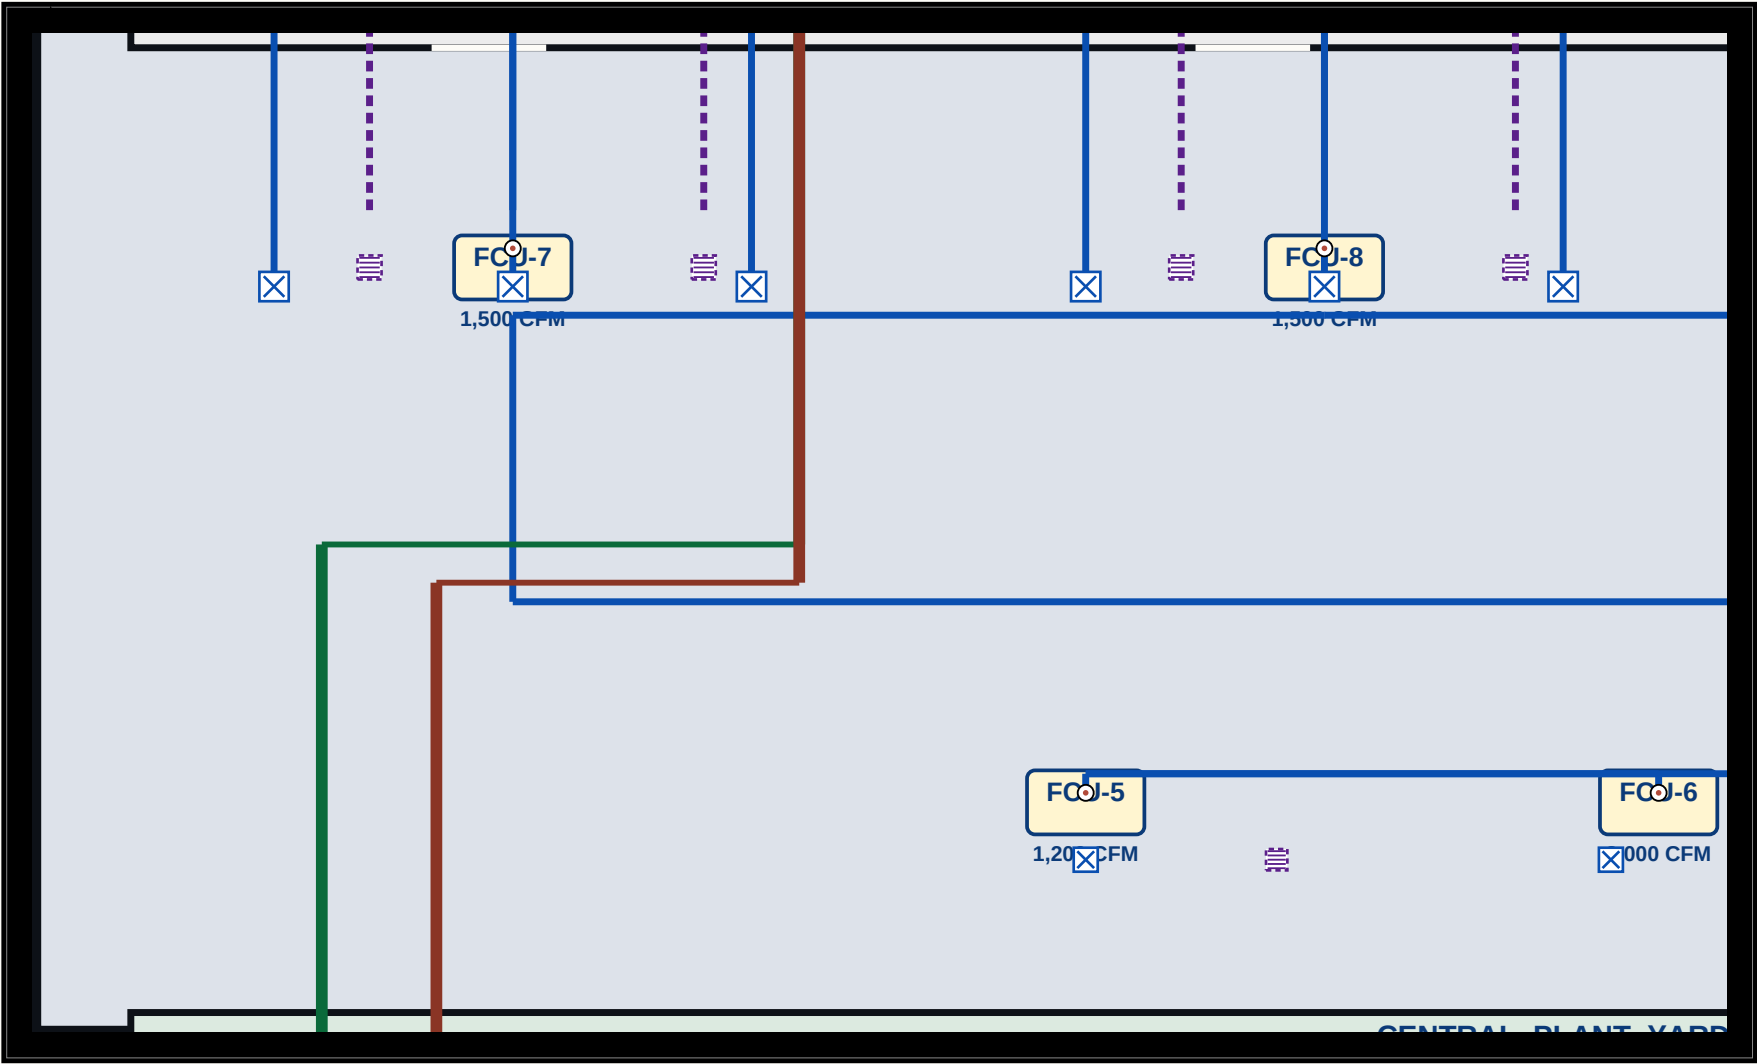

Alnchors

PROJECT
Multi-Zone AC System
DETAIL — ZONE A

DATE
2026-0
REV. B

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

- Office zone
- Meeting / training
- Server / electrical
- AHU plant room
- Mechanical / pump
- Pantry / breakout
- Reception / lobby
- Corridor / return plenum
- Central plant yard

- Air-Handling Unit (AHU)
- Fan-Coil Unit (FCU)
- Water-cooled chiller
- Cooling tower (induced draft)
- Precision cooling (server room)
- Primary chilled-water pump
- Supply diffuser (4-way)
- Return-air grille
- Zone thermostat (BACnet)

- Supply duct (cool air)
- Return duct (warm air)
- CHW supply 44°F / 7°C
- CHW return 54°F / 12°C
- Condenser water (CW)
- Building / partition wall
- Flow direction arrow
- North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

- AHU Air-Handling Unit
- FCU Fan-Coil Unit
- VAV Variable Air Volume
- CRAC Computer Room A/C
- CHW Chilled Water
- CW Condenser Water
- OA Outside Air
- RA Return Air
- SA Supply Air
- TR Ton of Refrigeration
- CFM Cubic Feet / Minute
- DDC Direct Digital Control
- MERV Minimum Efficiency Reporting Value
- NC Noise Criterion
- N+1 One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — ZONE B

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

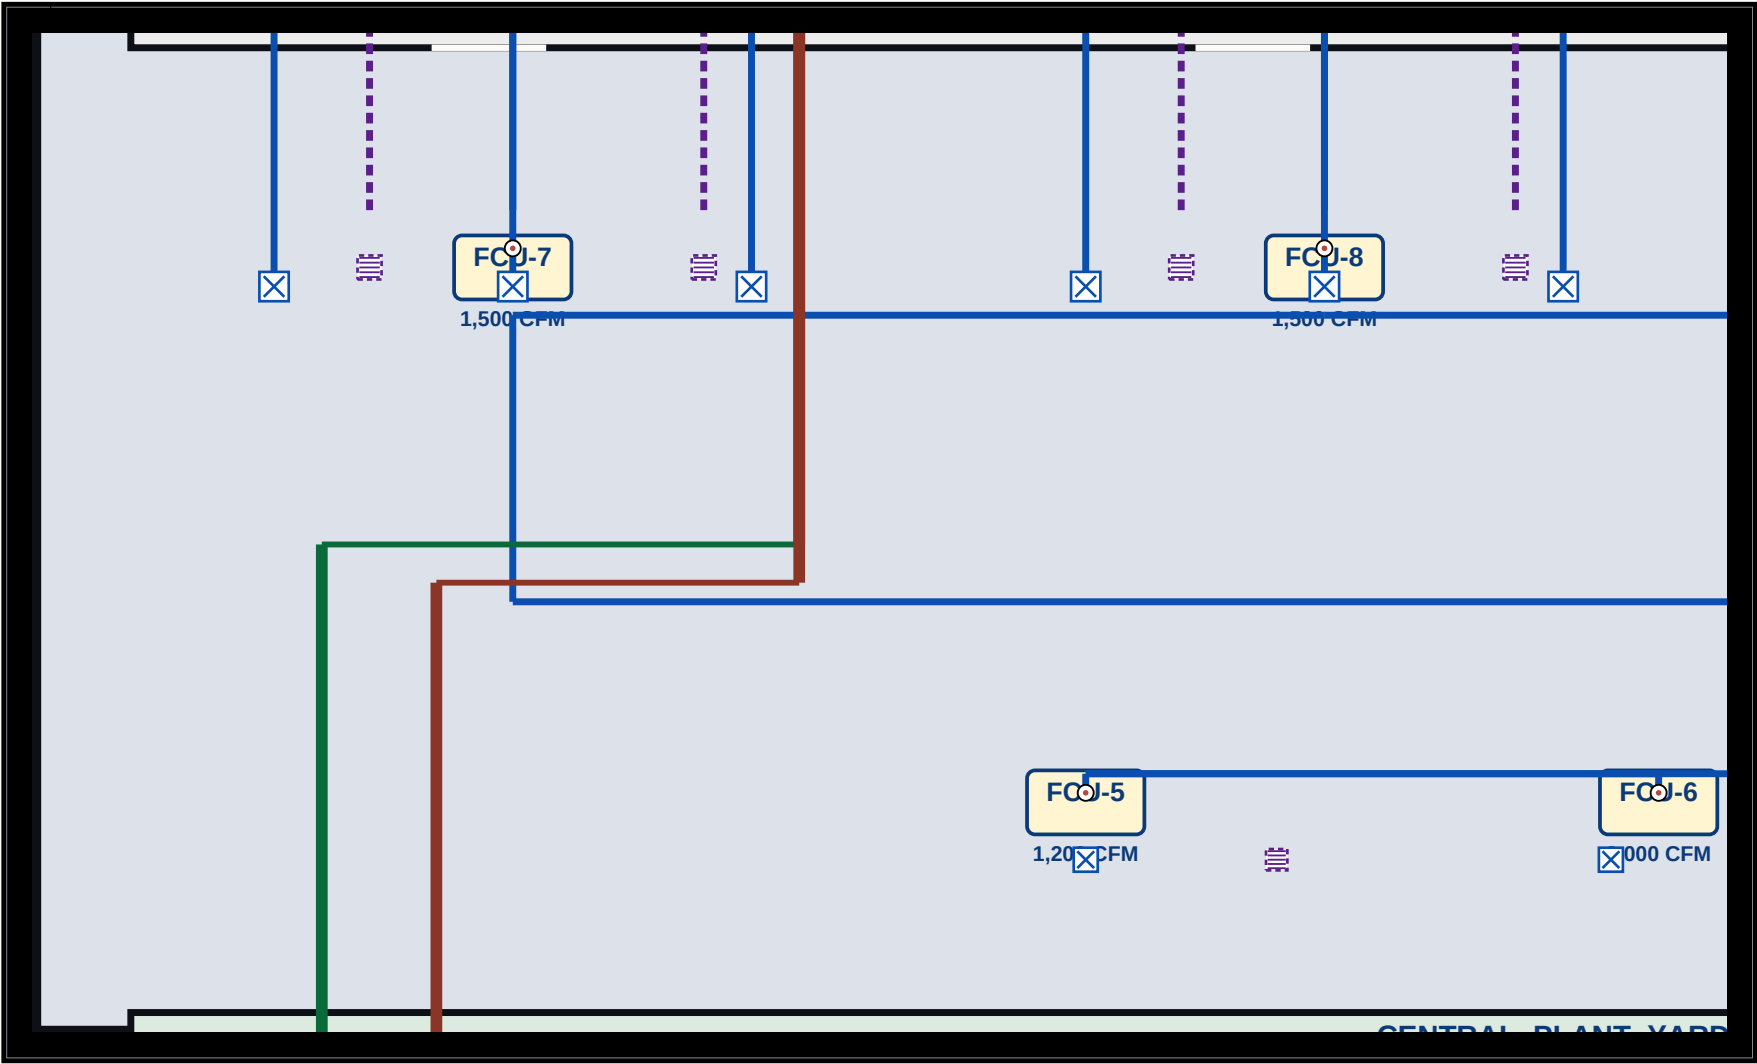

Project

Multi-Zone AC System

DETAIL — ZONE B

2026-01-15

REV. B

ANCHORS

WAC & Smart Building Engineering

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

AHU

FCU

VAV

CRAC

CHW

CW

OA

RA

SA

TR

CFM

DDC

MERV

NC

N+1

Air-Handling Unit

Fan-Coil Unit

Variable Air Volume

Computer Room A/C

Chilled Water

Condenser Water

Outside Air

Return Air

Supply Air

Ton of Refrigeration

Cubic Feet / Minute

Direct Digital Control

Minimum Efficiency Reporting Value

Noise Criterion


One redundant unit

MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — ZONE C

Engineering scale 1 : 100 • Drawing units: millimetres

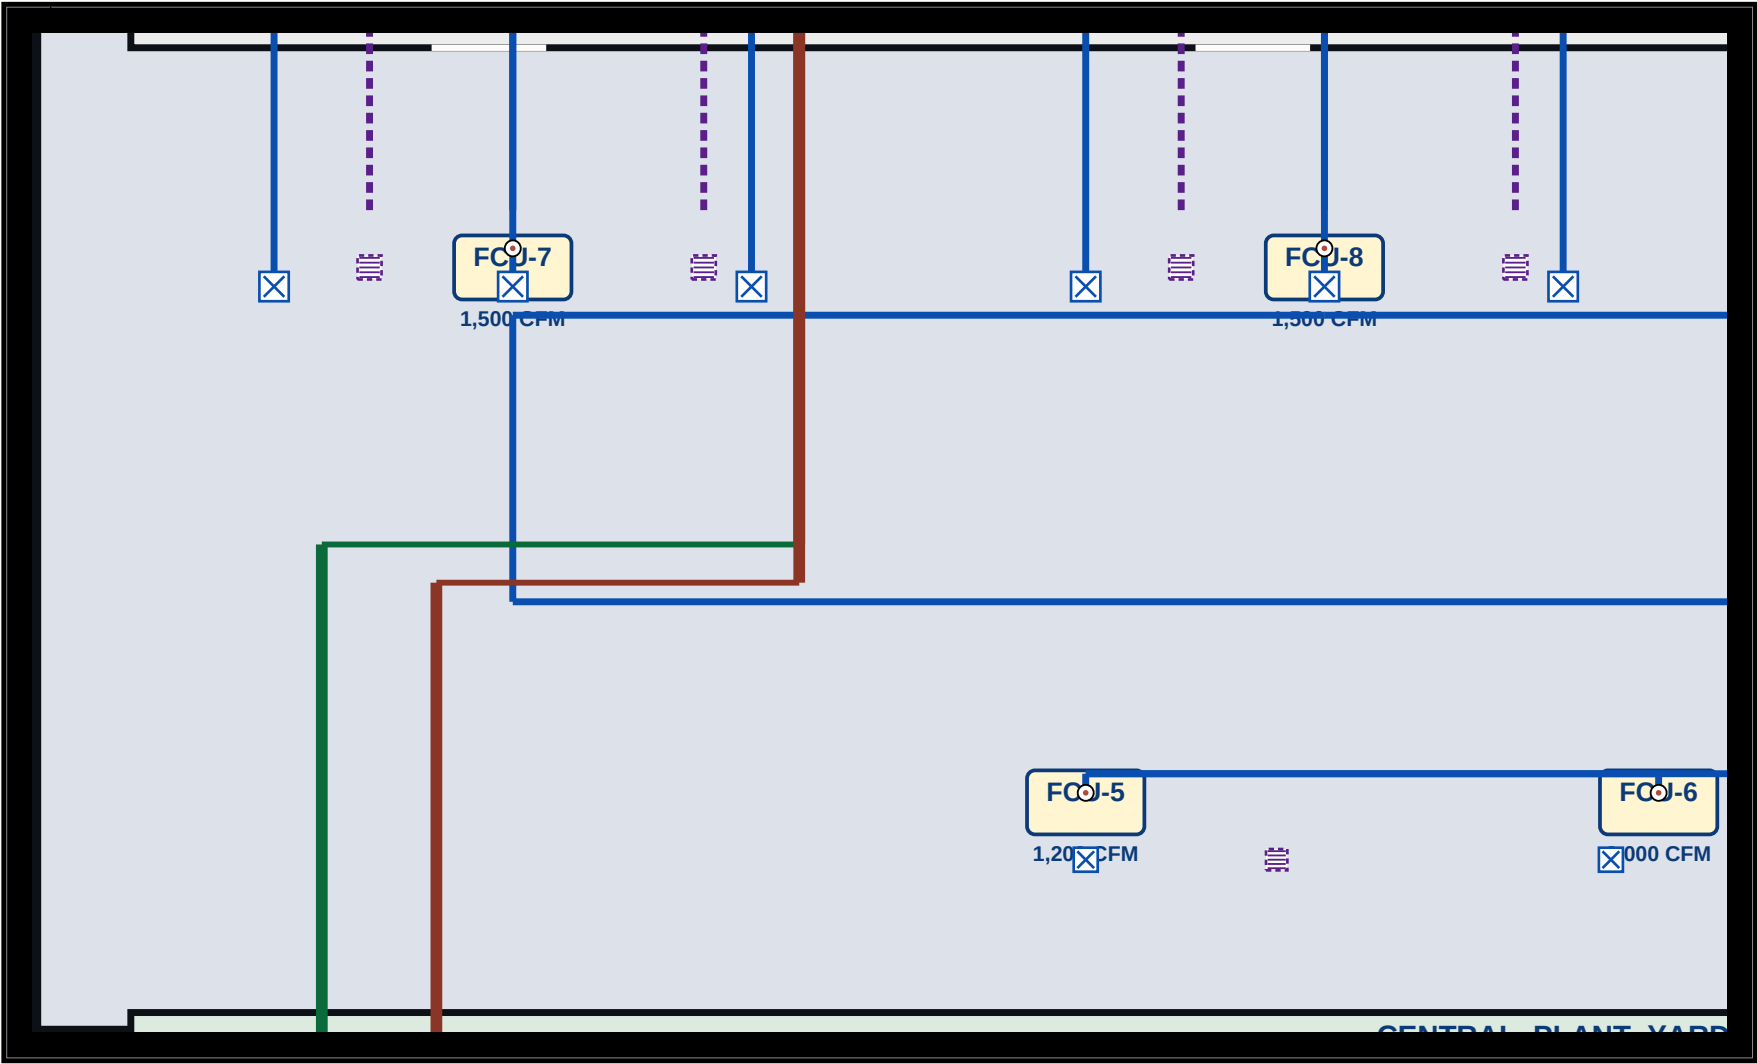

Alnchors

PROJECT
Multi-Zone AC System
DETAIL — ZONE C

DATE
2026-01-15
REV. B

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

- Office zone
- Meeting / training
- Server / electrical
- AHU plant room
- Mechanical / pump
- Pantry / breakout
- Reception / lobby
- Corridor / return plenum
- Central plant yard

- Air-Handling Unit (AHU)
- Fan-Coil Unit (FCU)
- Water-cooled chiller
- Cooling tower (induced draft)
- Precision cooling (server room)
- Primary chilled-water pump
- Supply diffuser (4-way)
- Return-air grille
- Zone thermostat (BACnet)

- Supply duct (cool air)
- Return duct (warm air)
- CHW supply 44°F / 7°C
- CHW return 54°F / 12°C
- Condenser water (CW)
- Building / partition wall
- Flow direction arrow
- North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

- AHU Air-Handling Unit
- FCU Fan-Coil Unit
- VAV Variable Air Volume
- CRAC Computer Room A/C
- CHW Chilled Water
- CW Condenser Water
- OA Outside Air
- RA Return Air
- SA Supply Air
- TR Ton of Refrigeration
- CFM Cubic Feet / Minute
- DDC Direct Digital Control
- MERV Minimum Efficiency Reporting Value
- NC Noise Criterion
- N+1 One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — ZONE D

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

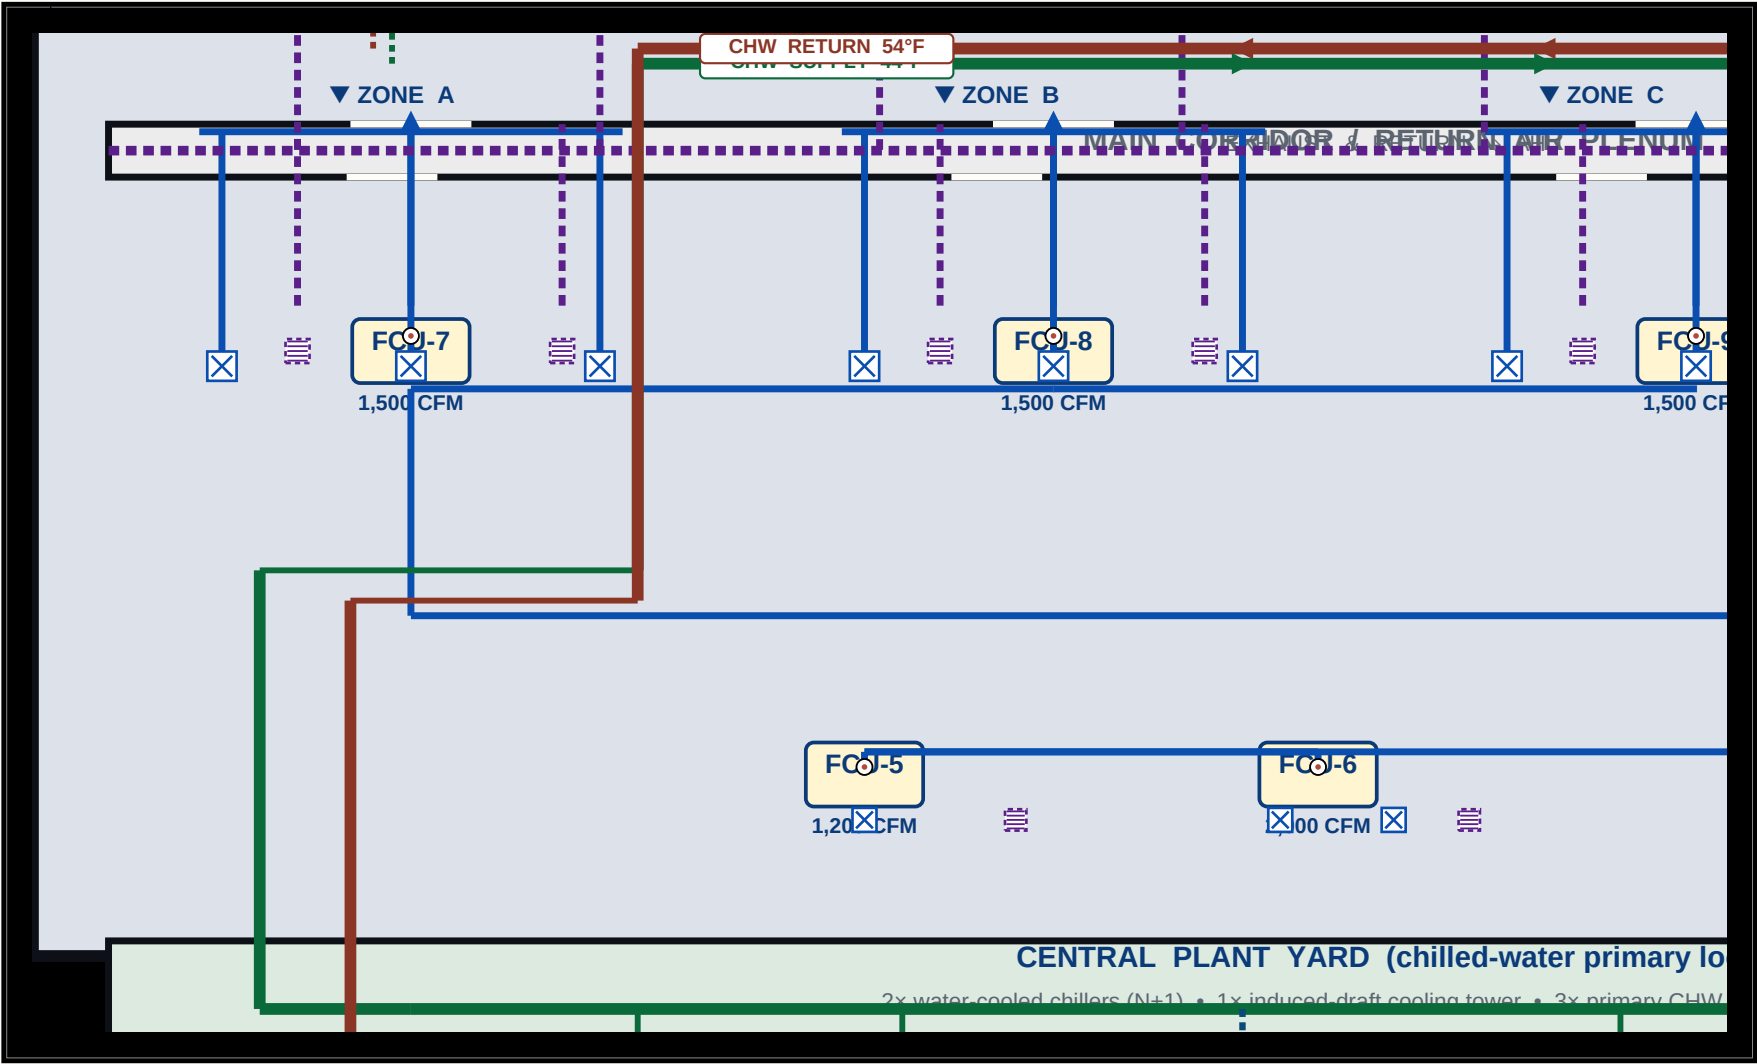

ANCHORS

WAC & Smart Building Engineering

PROJECT

Multi-Zone AC System

DETAIL — ZONE D

DATE

2026-01-01

REV. B

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

AHU	Air-Handling Unit
FCU	Fan-Coil Unit
VAV	Variable Air Volume
CRAC	Computer Room A/C
CHW	Chilled Water
CW	Condenser Water
OA	Outside Air
RA	Return Air
SA	Supply Air
TR	Ton of Refrigeration
CFM	Cubic Feet / Minute
DDC	Direct Digital Control
MERV	Minimum Efficiency Reporting Value
NC	Noise Criterion
N+1	One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — MEETING ROOMS + AMENITY

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

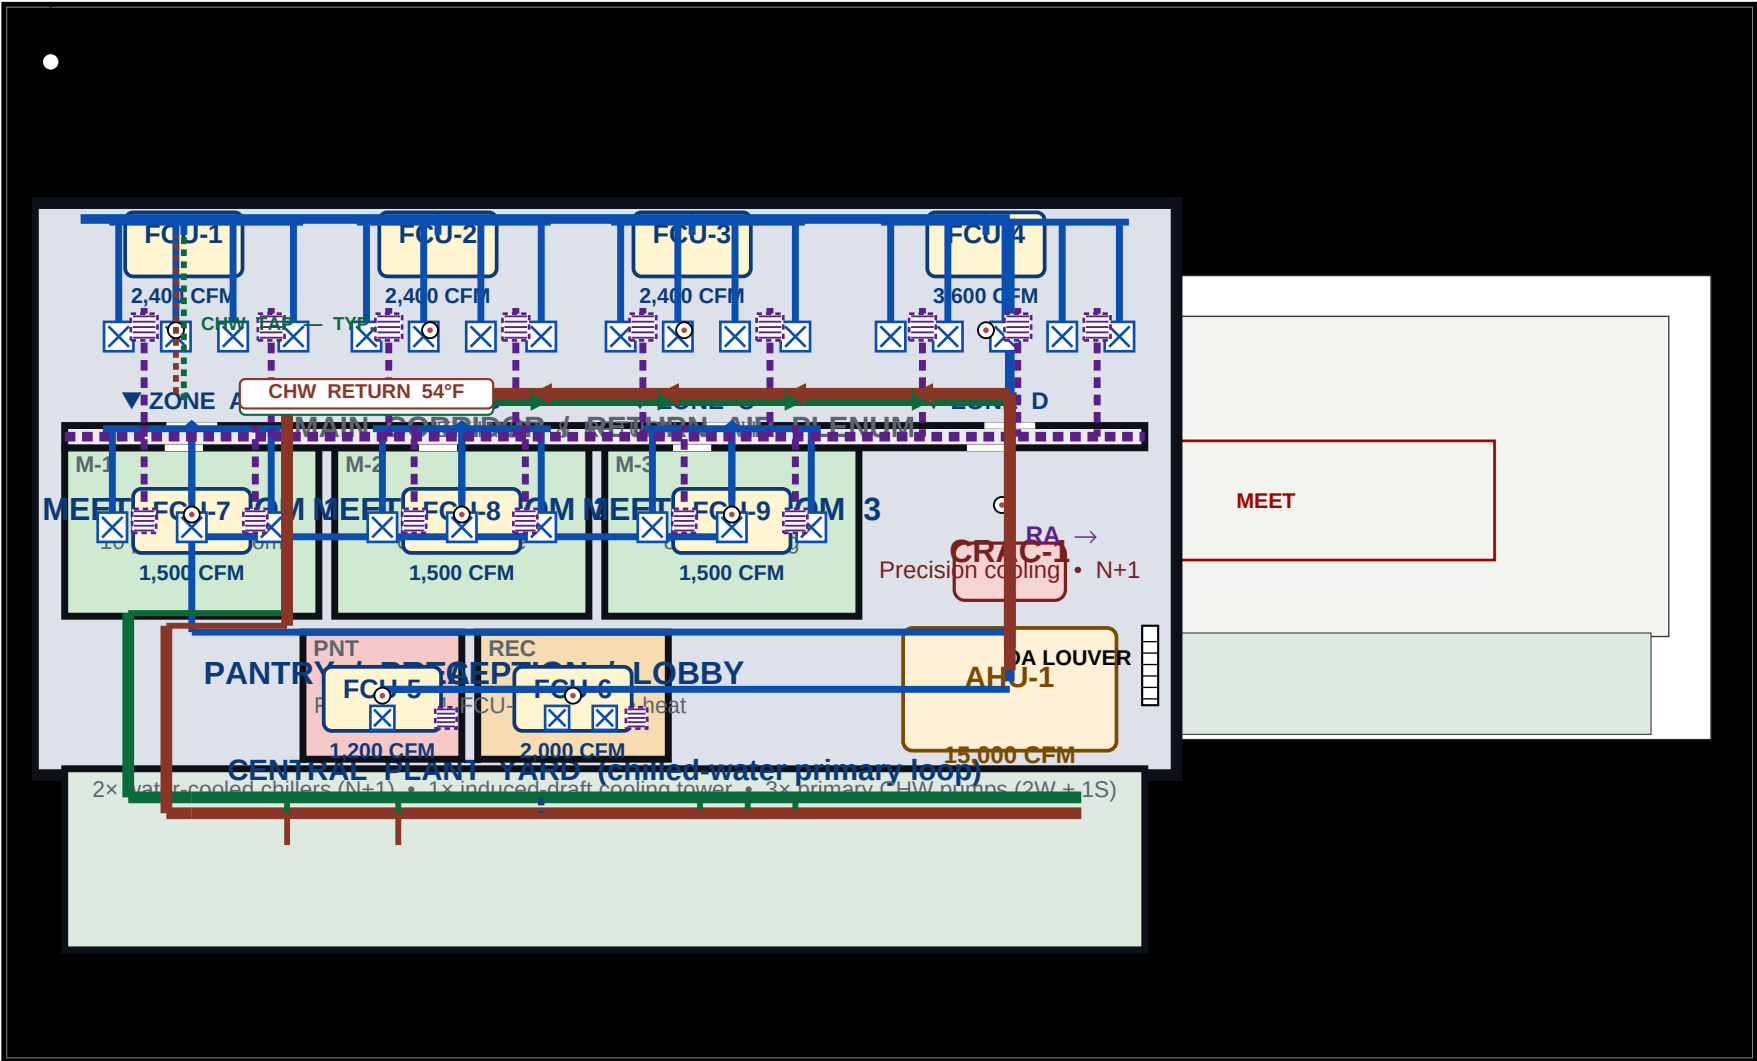

ANCHORS

WAC&S Smart Building Engineering

PROJECT

Multi-Zone AC System

DETAIL — MEETING ROOMS + AMENITY

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

AHU	Air-Handling Unit
FCU	Fan-Coil Unit
VAV	Variable Air Volume
CRAC	Computer Room A/C
CHW	Chilled Water
CW	Condenser Water
OA	Outside Air
RA	Return Air
SA	Supply Air
TR	Ton of Refrigeration
CFM	Cubic Feet / Minute
DDC	Direct Digital Control
MERV	Minimum Efficiency Reporting Value
NC	Noise Criterion
N+1	One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — PLANT / MECHANICAL ROOM + YARD

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

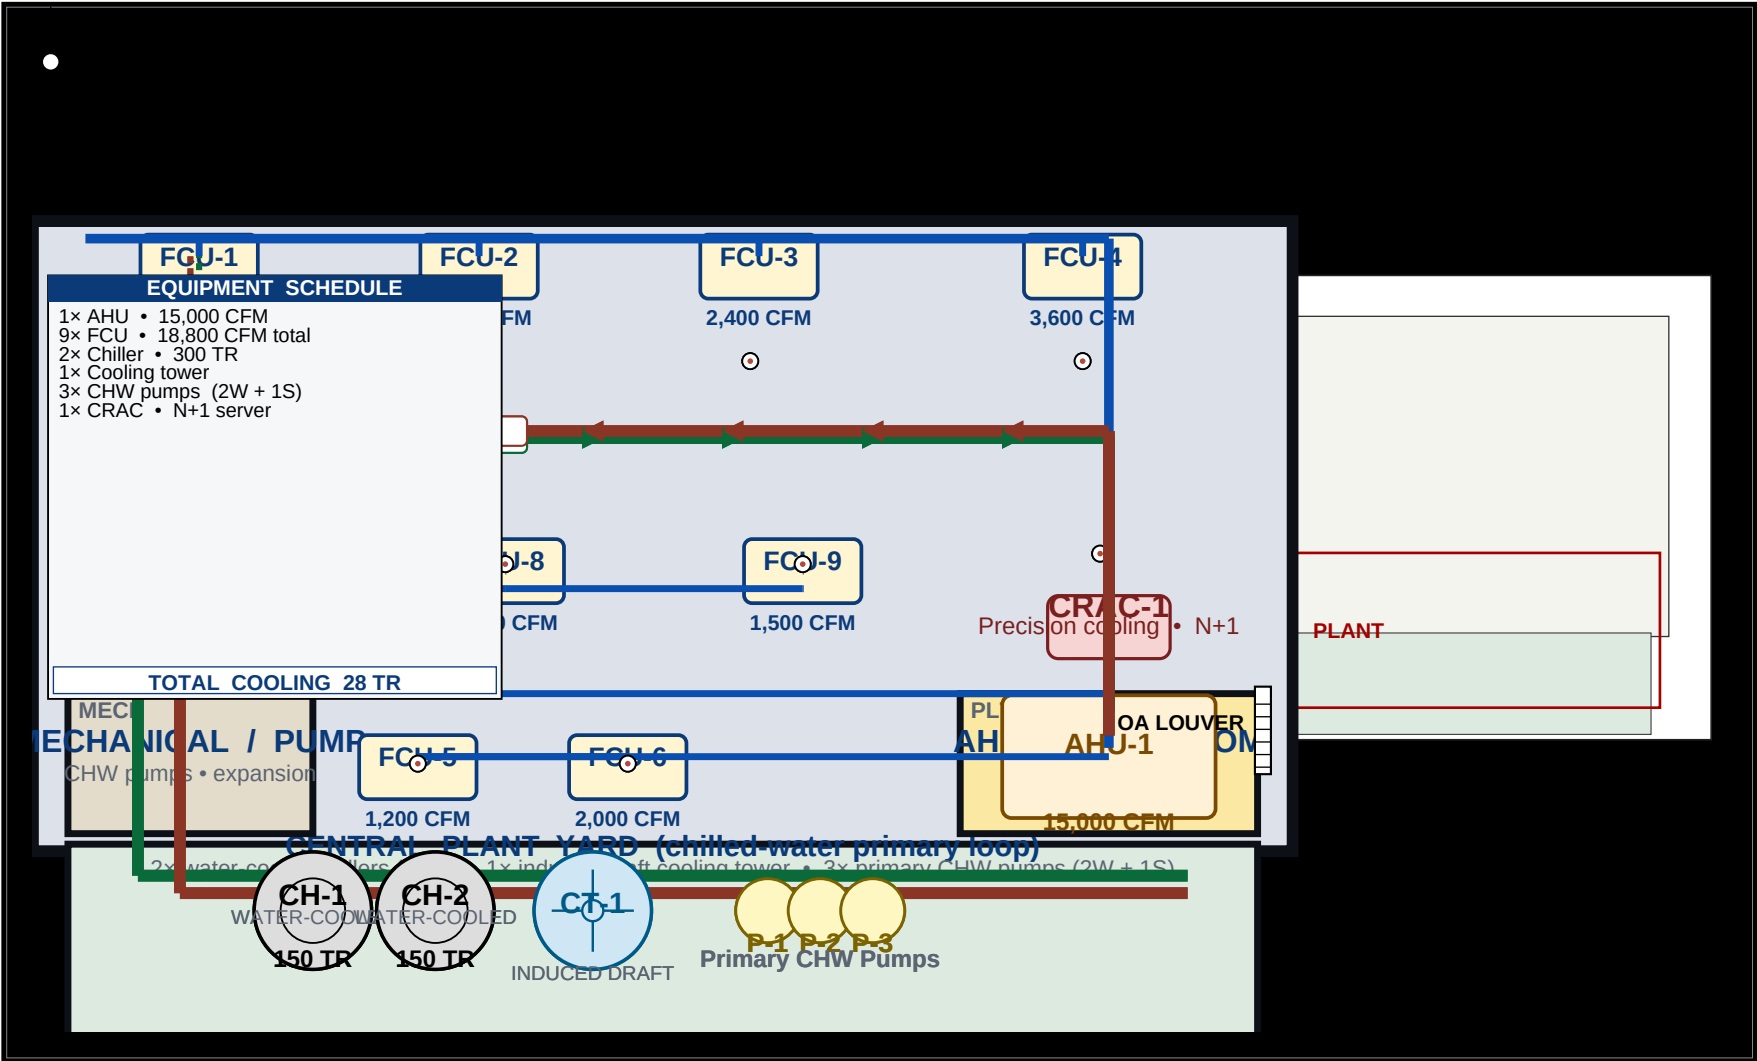

Alanchors

UK & Co. Smart Building Engineering

PROJECT

Multi-Zone AC System

DETAIL — PLANT / MECHANICAL ROOM + YARD

DATE

2026-01-01

REV. B

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

Office zone

Meeting / training

Server / electrical

AHU plant room

Mechanical / pump

Pantry / breakout

Reception / lobby

Corridor / return plenum

Central plant yard

Air-Handling Unit (AHU)

Fan-Coil Unit (FCU)

Water-cooled chiller

Cooling tower (induced draft)

Precision cooling (server room)

Primary chilled-water pump

Supply diffuser (4-way)

Return-air grille

Zone thermostat (BACnet)

Supply duct (cool air)

Return duct (warm air)

CHW supply 44°F / 7°C

CHW return 54°F / 12°C

Condenser water (CW)

Building / partition wall

Flow direction arrow

North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

AHU	Air-Handling Unit
FCU	Fan-Coil Unit
VAV	Variable Air Volume
CRAC	Computer Room A/C
CHW	Chilled Water
CW	Condenser Water
OA	Outside Air
RA	Return Air
SA	Supply Air
TR	Ton of Refrigeration
CFM	Cubic Feet / Minute
DDC	Direct Digital Control
MERV	Minimum Efficiency Reporting Value
NC	Noise Criterion
N+1	One redundant unit


MULTI-ZONE AIR CONDITIONING — SAMPLE FLOOR PLAN

4 office zones + corridor return • 1× AHU (15,000 CFM) + 9× FCUs • Chilled-water primary plant (2× 150 TR + induced-draft tower)

FLOOR PLAN — DETAIL — SERVER / ELECTRICAL ROOM

Engineering scale 1 : 100 • Drawing units: millimetres

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

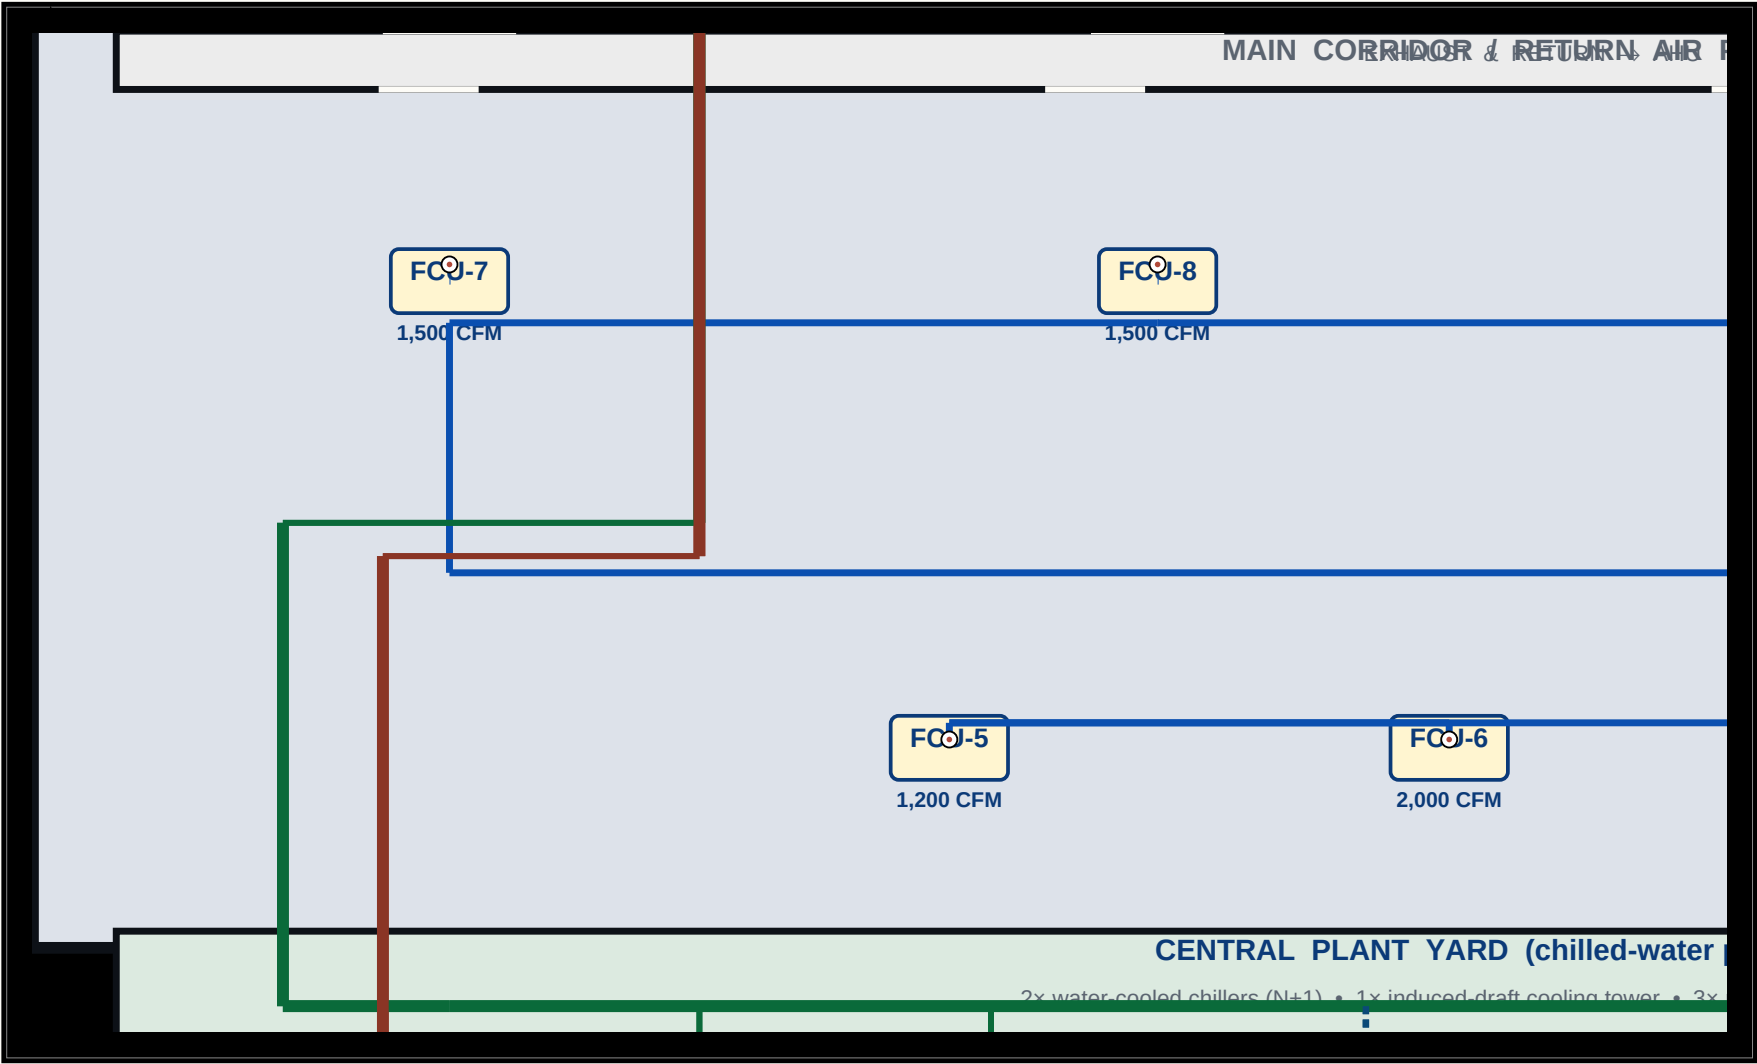

Alnchors

© 2024 ABC Smart Building Engineering

PROJECT
Multi-Zone AC System
DETAIL — SERVER / ELECTRICAL ROOM

DATE
2026-01-15
REV. B

DEMO / PITCH REFERENCE — NOT FOR CONSTRUCTION

SCALE

LEGEND

- Office zone
- Meeting / training
- Server / electrical
- AHU plant room
- Mechanical / pump
- Pantry / breakout
- Reception / lobby
- Corridor / return plenum
- Central plant yard

- Air-Handling Unit (AHU)
- Fan-Coil Unit (FCU)
- Water-cooled chiller
- Cooling tower (induced draft)
- Precision cooling (server room)
- Primary chilled-water pump
- Supply diffuser (4-way)
- Return-air grille
- Zone thermostat (BACnet)

- Supply duct (cool air)
- Return duct (warm air)
- CHW supply 44°F / 7°C
- CHW return 54°F / 12°C
- Condenser water (CW)
- Building / partition wall
- Flow direction arrow
- North arrow

DESIGN NOTES

- Total cooling load (est.): 28 TR
- 1× AHU 15,000 CFM (4-zone VAV)
- 9× FCUs zone + meeting + amenity
- 2× 150 TR chillers (N+1)
- 1× induced-draft cooling tower
- 3× primary CHW pumps (2W + 1S)
- CHW ΔT 10°F (44°F / 54°F)
- OA: 20 CFM/person ASHRAE 62.1
- Filtration: MERV-13 (AHU) + MERV-8 (FCU)
- Controls: BACnet/Modbus DDC, VAV zone dampers
- Acoustics: NC-35 offices, NC-40 open zones
- Server room: dedicated CRAC N+1, 24/7

ABBREVIATIONS

- AHU Air-Handling Unit
- FCU Fan-Coil Unit
- VAV Variable Air Volume
- CRAC Computer Room A/C
- CHW Chilled Water
- CW Condenser Water
- OA Outside Air
- RA Return Air
- SA Supply Air
- TR Ton of Refrigeration
- CFM Cubic Feet / Minute
- DDC Direct Digital Control
- MERV Minimum Efficiency Reporting Value
- NC Noise Criterion
- N+1 One redundant unit