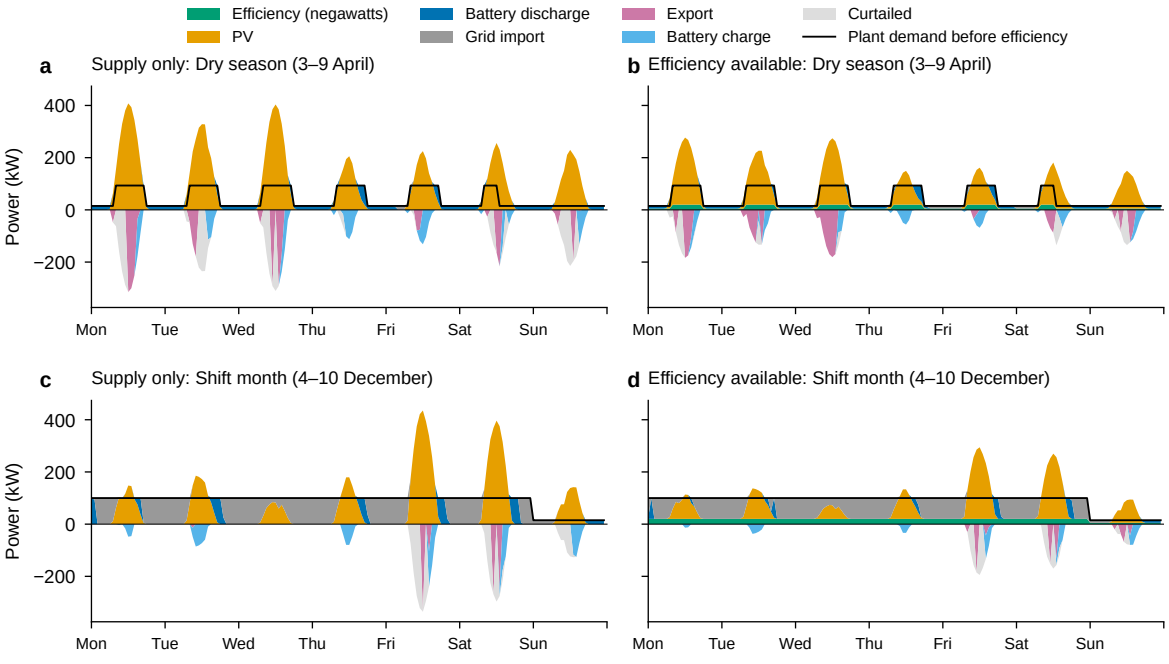
Efficiency (negawatts)
PV
Battery discharge
Grid import
Export
Battery charge
Curtailed
Plant demand before efficiency
a
Supply only: Dry season (3–9 April)
b
Efficiency available: Dry season (3–9 April)
c
Supply only: Shift month (4–10 December)
d
Efficiency available: Shift month (4–10 December)
Power (kW)
400
200
0
−200
Mon
Tue
Wed
Thu
Fri
Sat
Sun