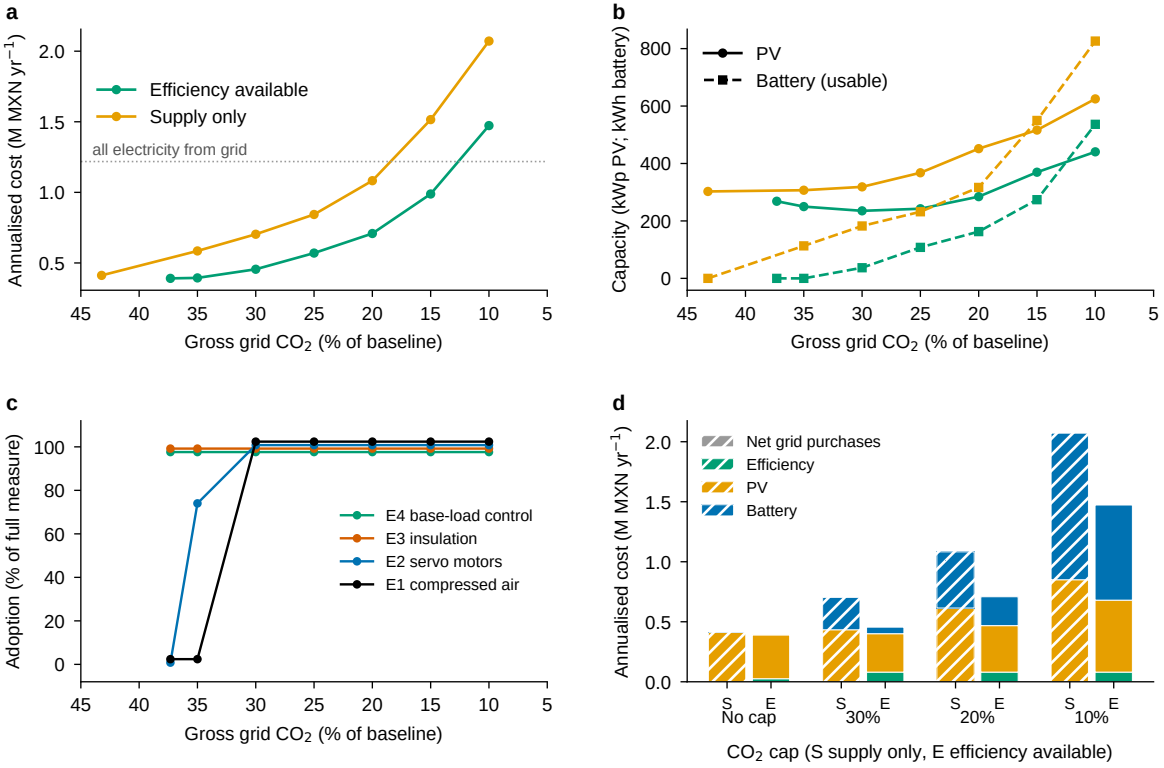
a
Annualised cost (M MXN yr^{-1})
2.0
1.5
1.0
0.5
Efficiency available
Supply only
all electricity from grid
45 40 35 30 25 20 15 10 5
Gross grid CO_2 (% of baseline)
b
Capacity (kWp PV; kWh battery)
800
600
400
200
0
PV
Battery (usable)
45 40 35 30 25 20 15 10 5
Gross grid CO_2 (% of baseline)
c
Adoption (% of full measure)
100
80
60
40
20
0
E4 base-load control
E3 insulation
E2 servo motors
E1 compressed air
45 40 35 30 25 20 15 10 5
Gross grid CO_2 (% of baseline)
d
Annualised cost (M MXN yr^{-1})
2.0
1.5
1.0
0.5
0.0
Net grid purchases
Efficiency
PV
Battery
S E
No cap
S E
30%
S E
20%
S E
10%
CO_2 cap (S supply only, E efficiency available)