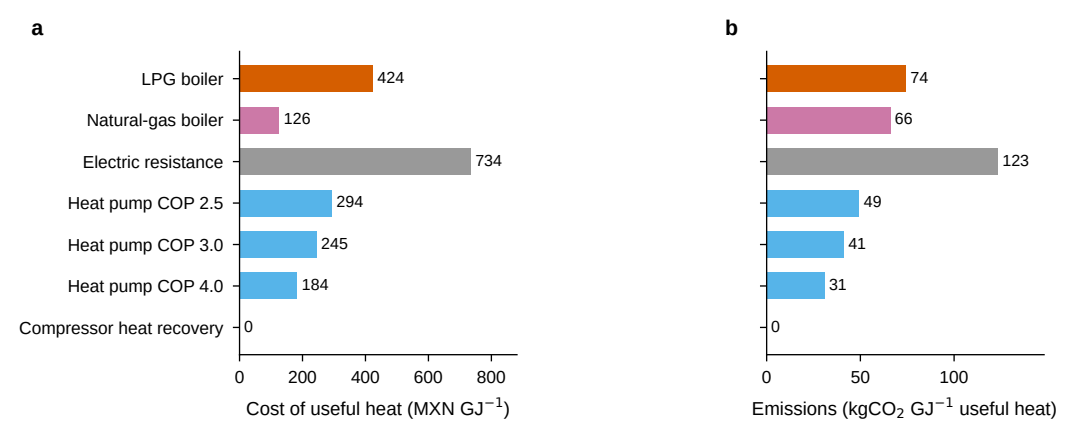
a
LPG boiler
Natural-gas boiler
Electric resistance
Heat pump COP 2.5
Heat pump COP 3.0
Heat pump COP 4.0
Compressor heat recovery
424
126
734
294
245
184
0
0
200
400
600
800
Cost of useful heat (MXN GJ−1)
b
74
66
123
49
41
31
0
0
50
100
Emissions (kgCO2 GJ−1 useful heat)