

7824 Zero Road, second floor


E-1 Electrical plan · packet for the electrical contractor

Devices, luminaires, alarms, low voltage and the circuit schedule for sub-panel P2, with one sheet per circuit.

Rev C · 2026-10-01 · Schematic for pricing and coordination, not a stamped construction document. Verify every dimension on site. Coordinates are feet from the north and west brick faces; the plan is drawn with east at the top and north on the left. Wall numbers match the concept drawing. Questions: name the sheet and the tag (for example E-1 R12).

Contents

1. E-1 sheet
2. Circuit sheets E-1.1 onward and E-1.D low voltage
3. Notes and open items
4. Schedules
5. Bill of materials

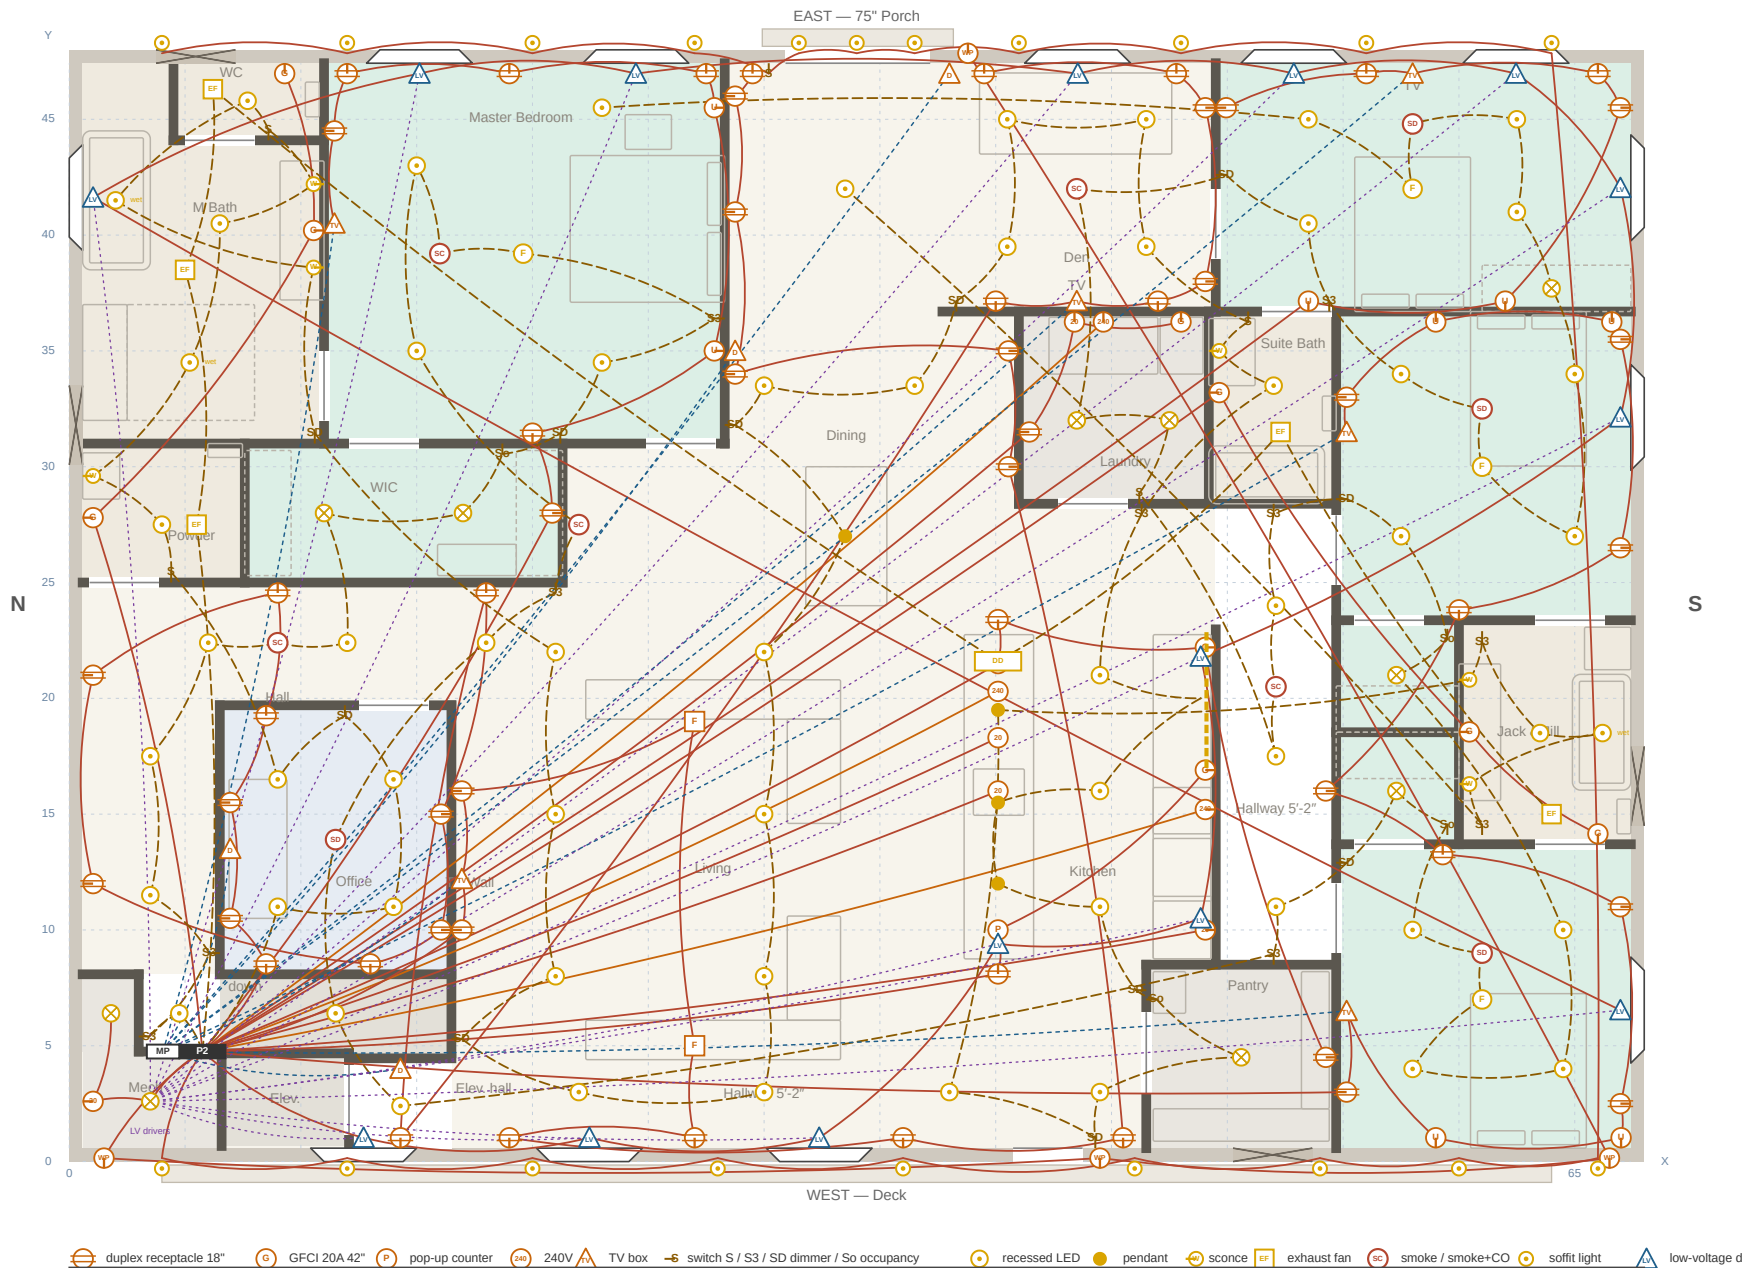

7824 Zero Road — second floor

Casper, Wyoming · 68' x 48' to brick, faces 7" inside · 9' ceiling · grid 5'
Wall numbers as the floor plan drawing of 2026-09-29

Electrical plan


Devices, luminaires, alarms and the circuit schedule for sub-panel P2

Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson

E-1

rev C · 2026-10-01

E-1.1 — circuit 1-2: Induction cooktop, 240V 40A 2P, #8 Cu · kitchen wall run

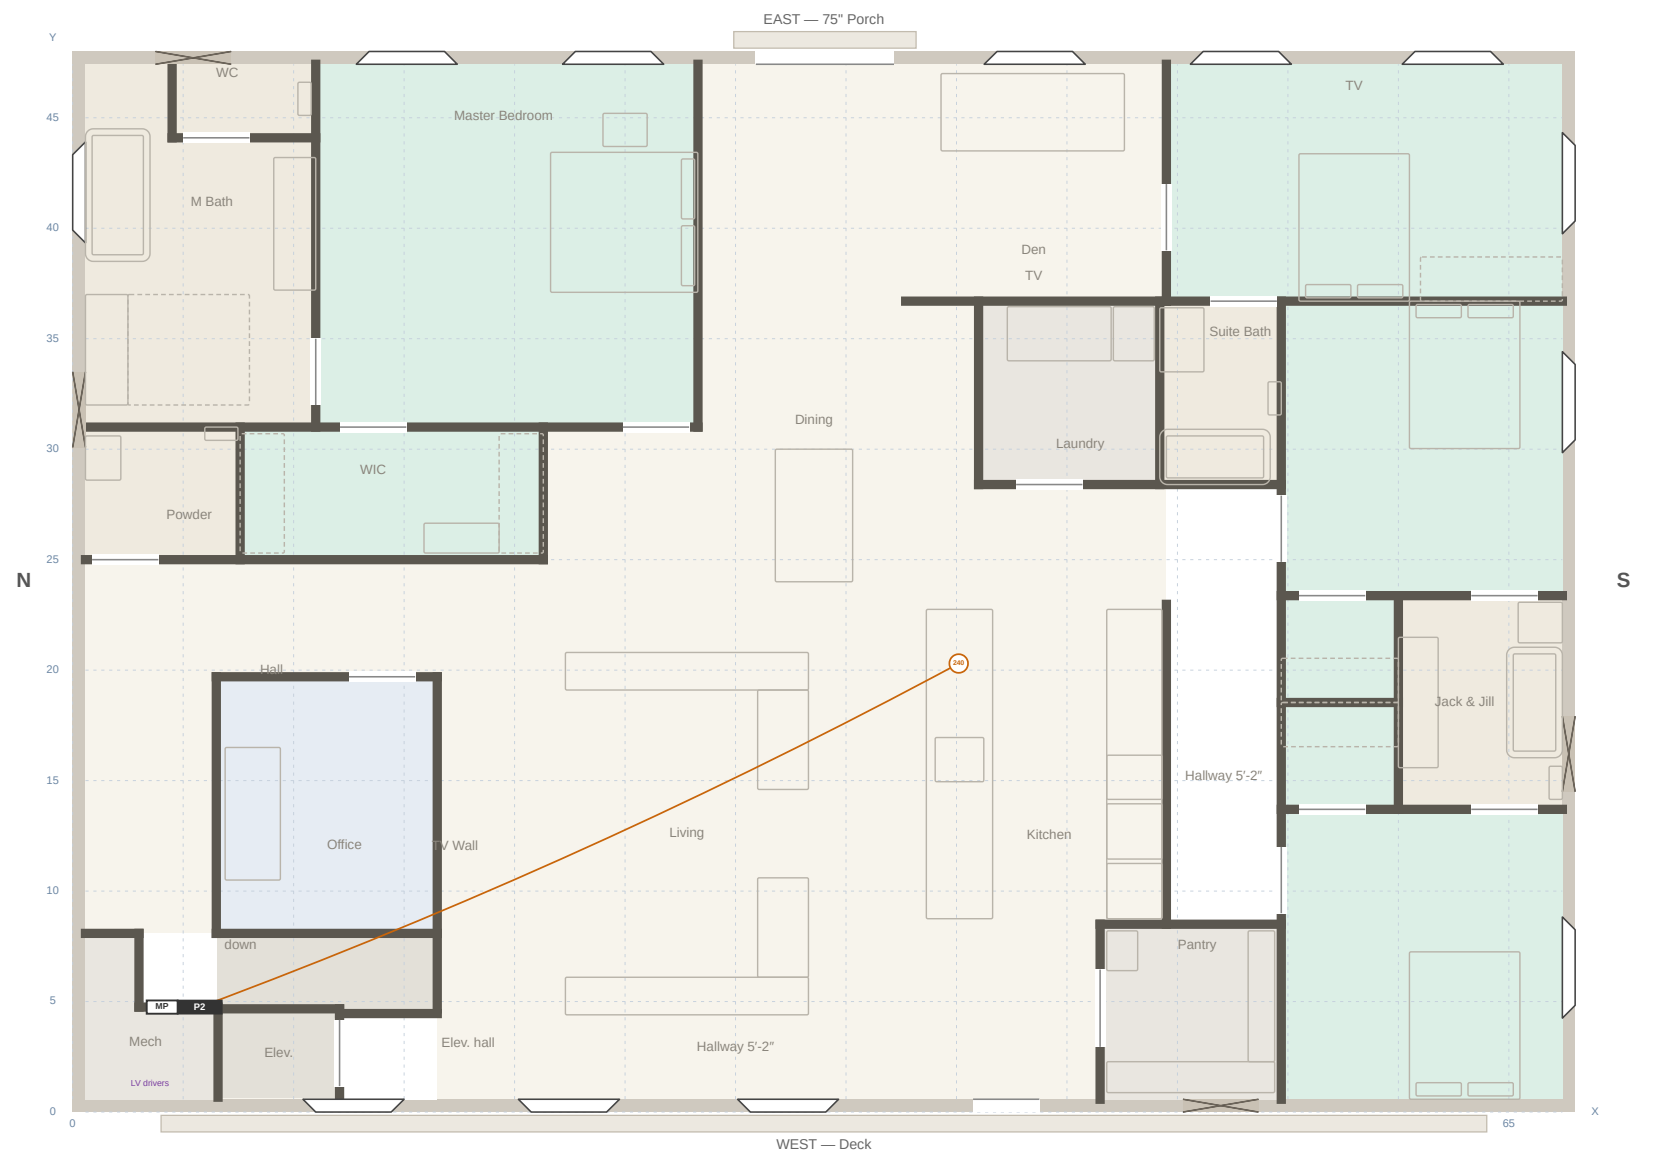


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor		Electrical plan	
Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5'		Devices, luminaires, alarms and the circuit schedule for sub-panel P2	
Wall numbers as the floor plan drawing of 2026-09-29		Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	

E-1


rev C · 2026-10-01

E-1.2 — circuit 3-4: Wall oven, side-opening, 240V 30A 2P, #10 Cu · kitchen wall run

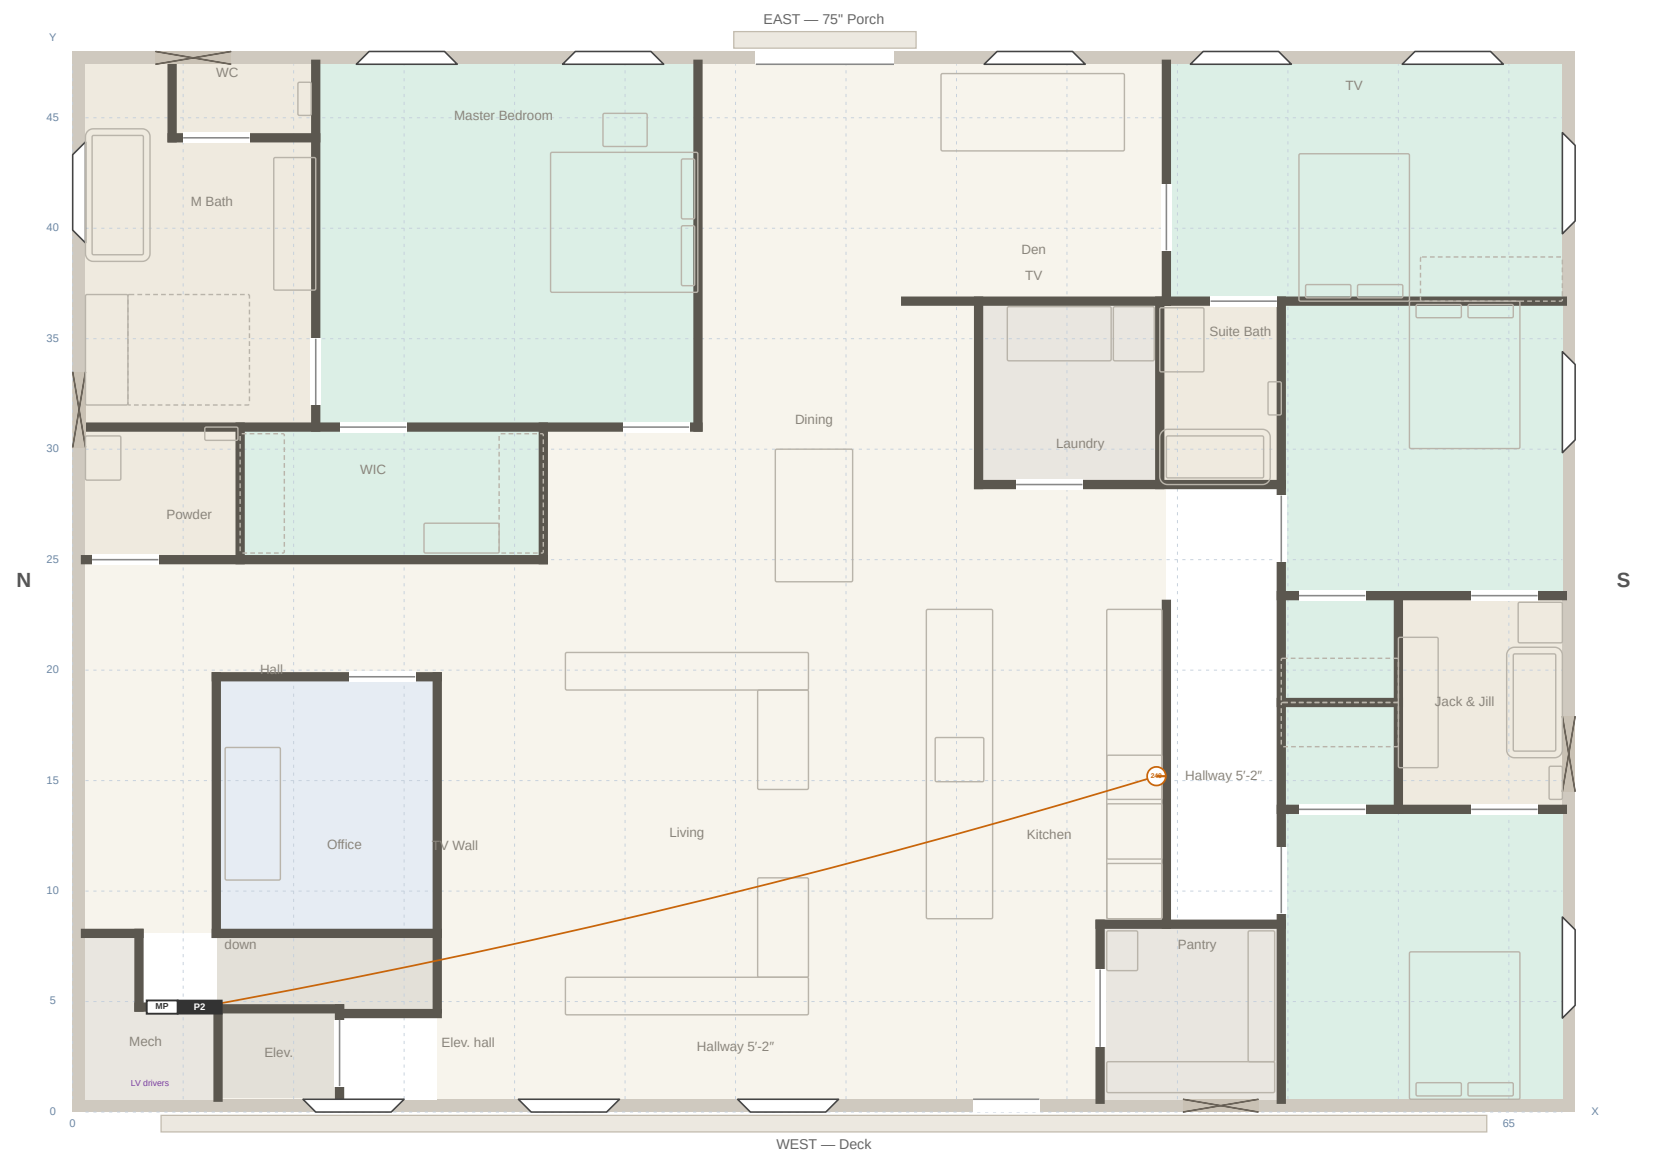


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.3 — circuit 5-6: Dryer, 240V 30A 2P, #10 Cu · laundry

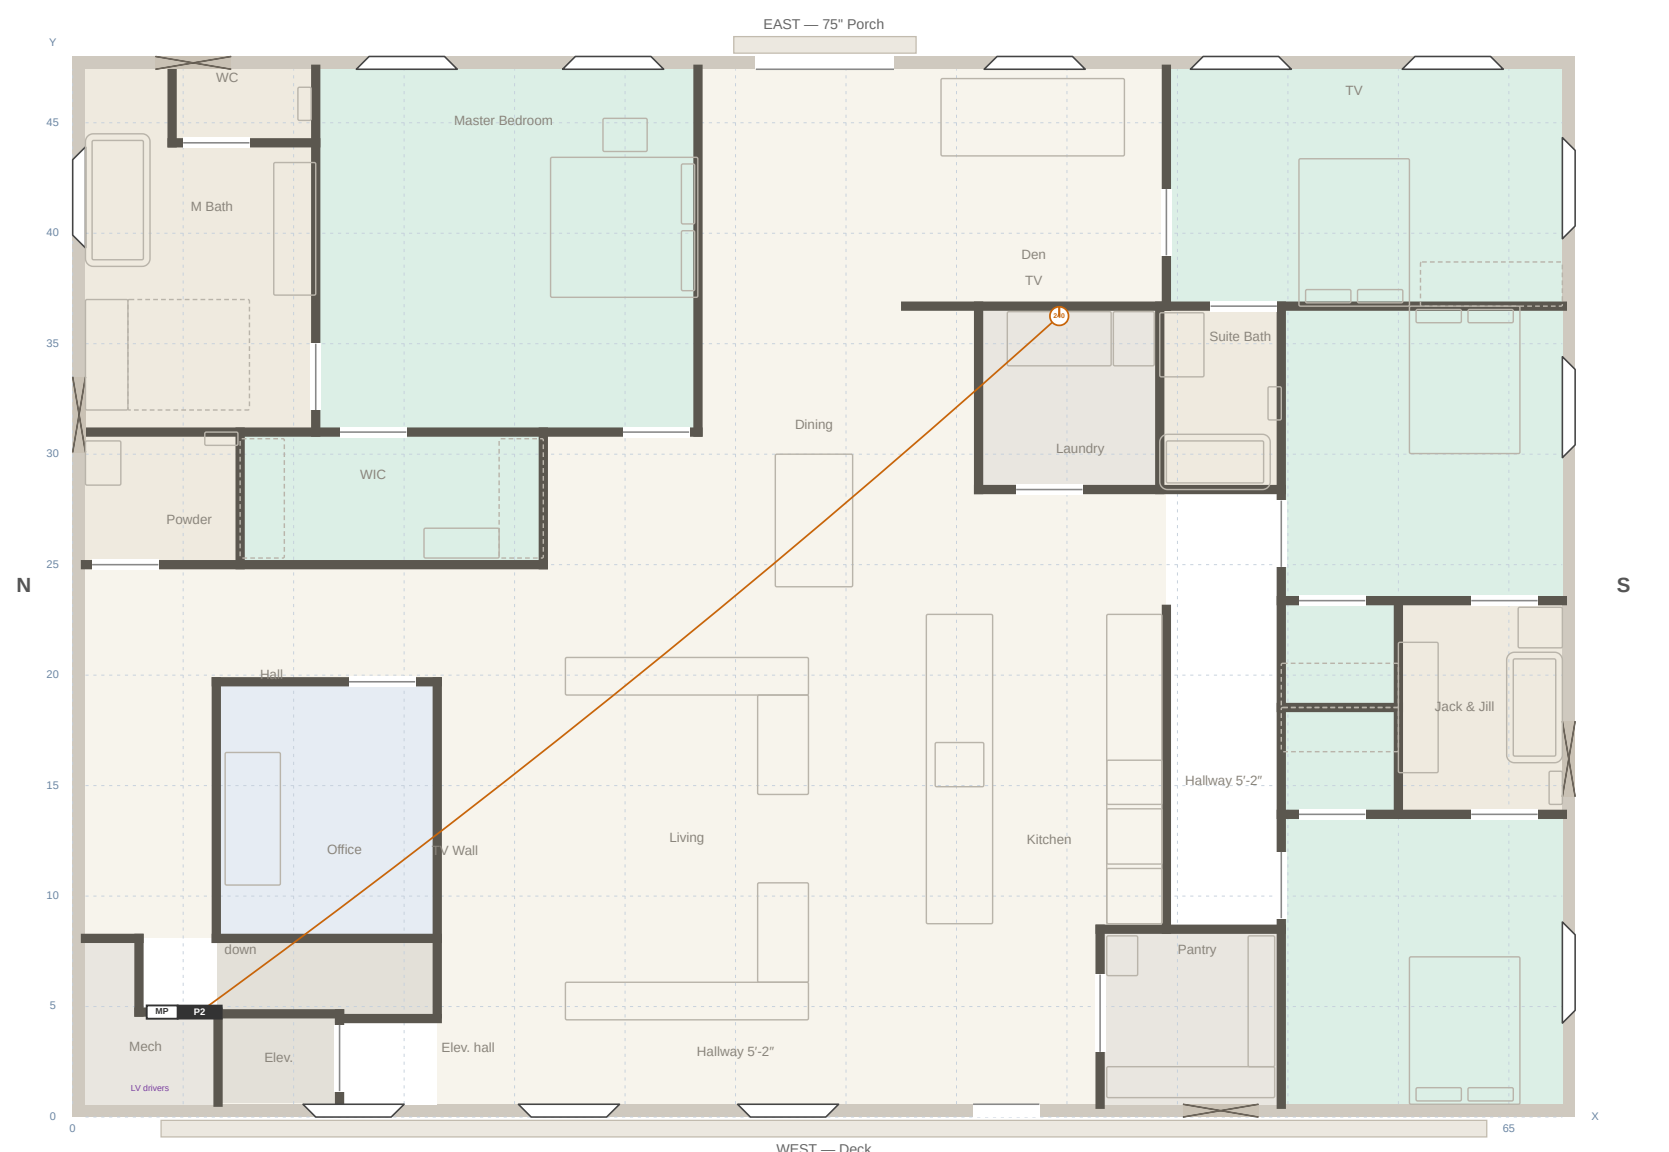


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.4 — circuit 7: Kitchen small appliance 1, 20A GFCI/AFCI, #12 · island sink end, wall run

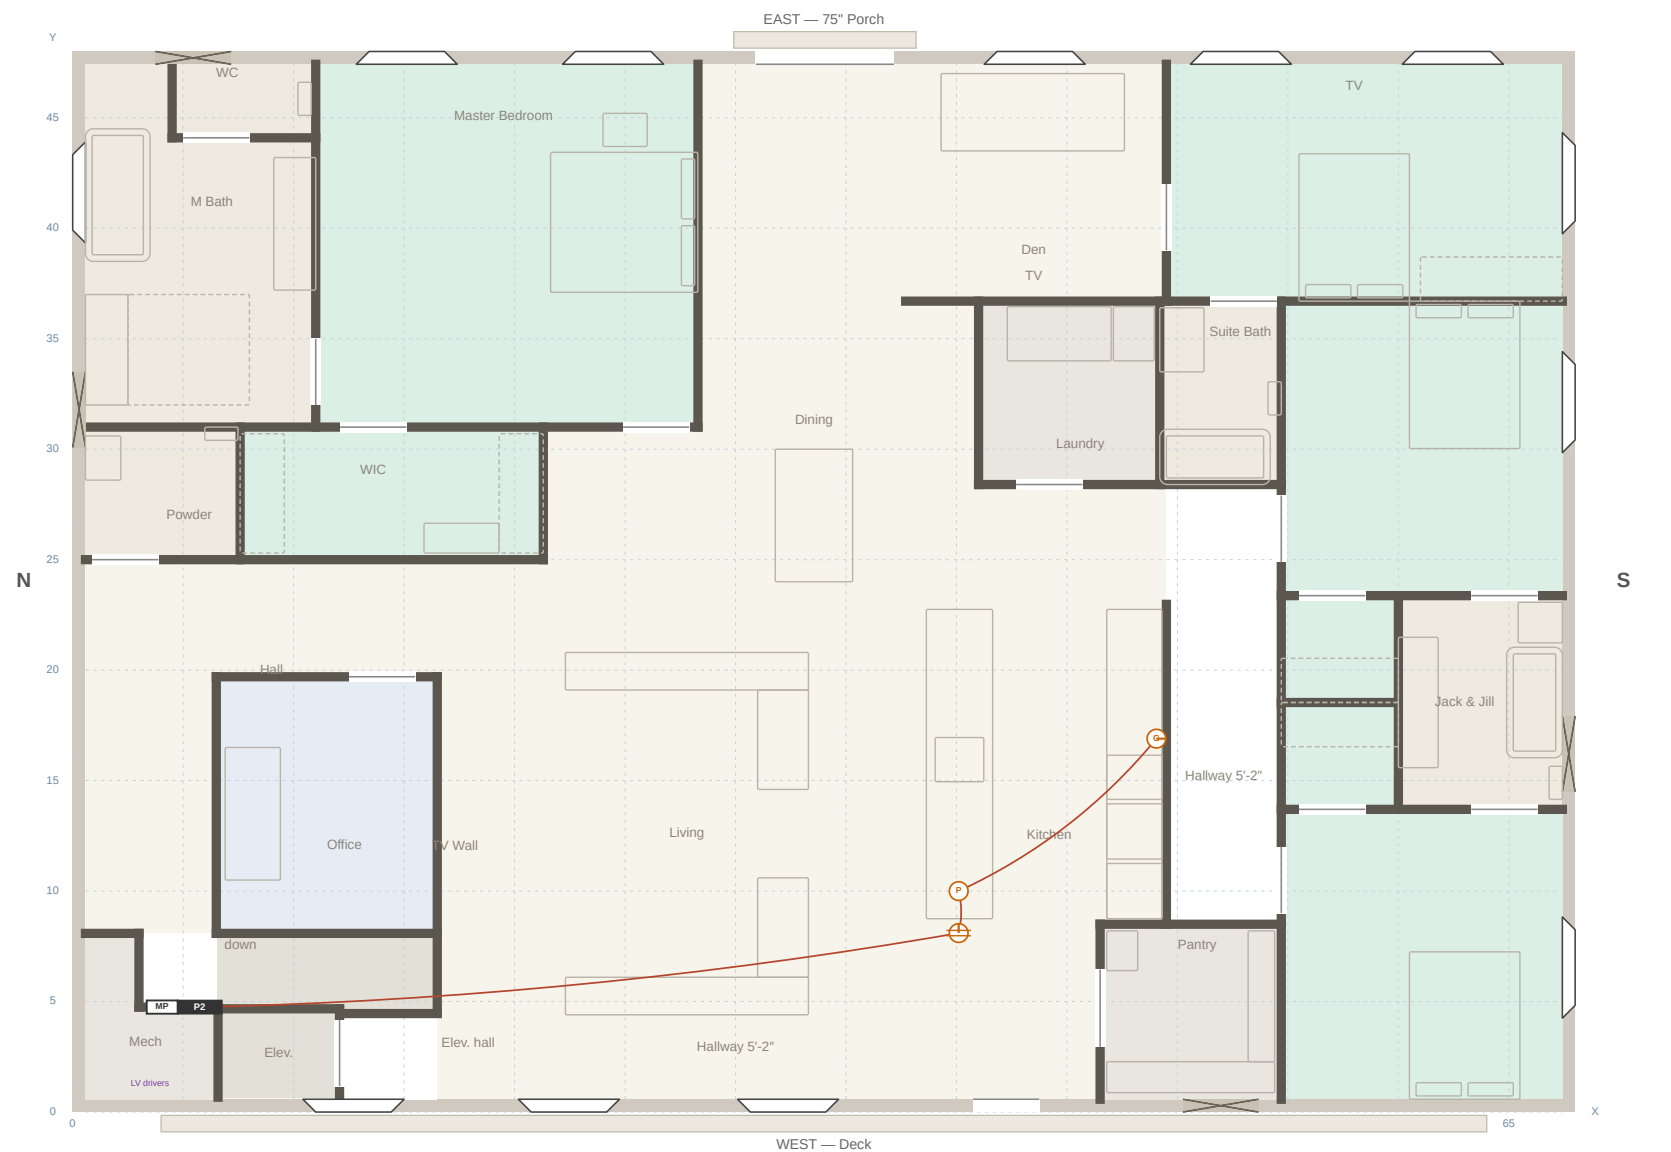

duplex receptacle 18"	GFCI 20A 42"	pop-up counter	240V	TV box	switch S / S3 / SD dimmer / So occupancy	recessed LED	pendant	sconce	exhaust fan	smoke / smoke+CO	soffit light	low-voltage d
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29						Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson			E-1 rev C · 2026-10-01 drawn for K. Christianson			

E-1.5 — circuit 8: Kitchen small appliance 2 + pantry, 20A GFCI/AFCI, #12 · island prep end, wall run, pantry

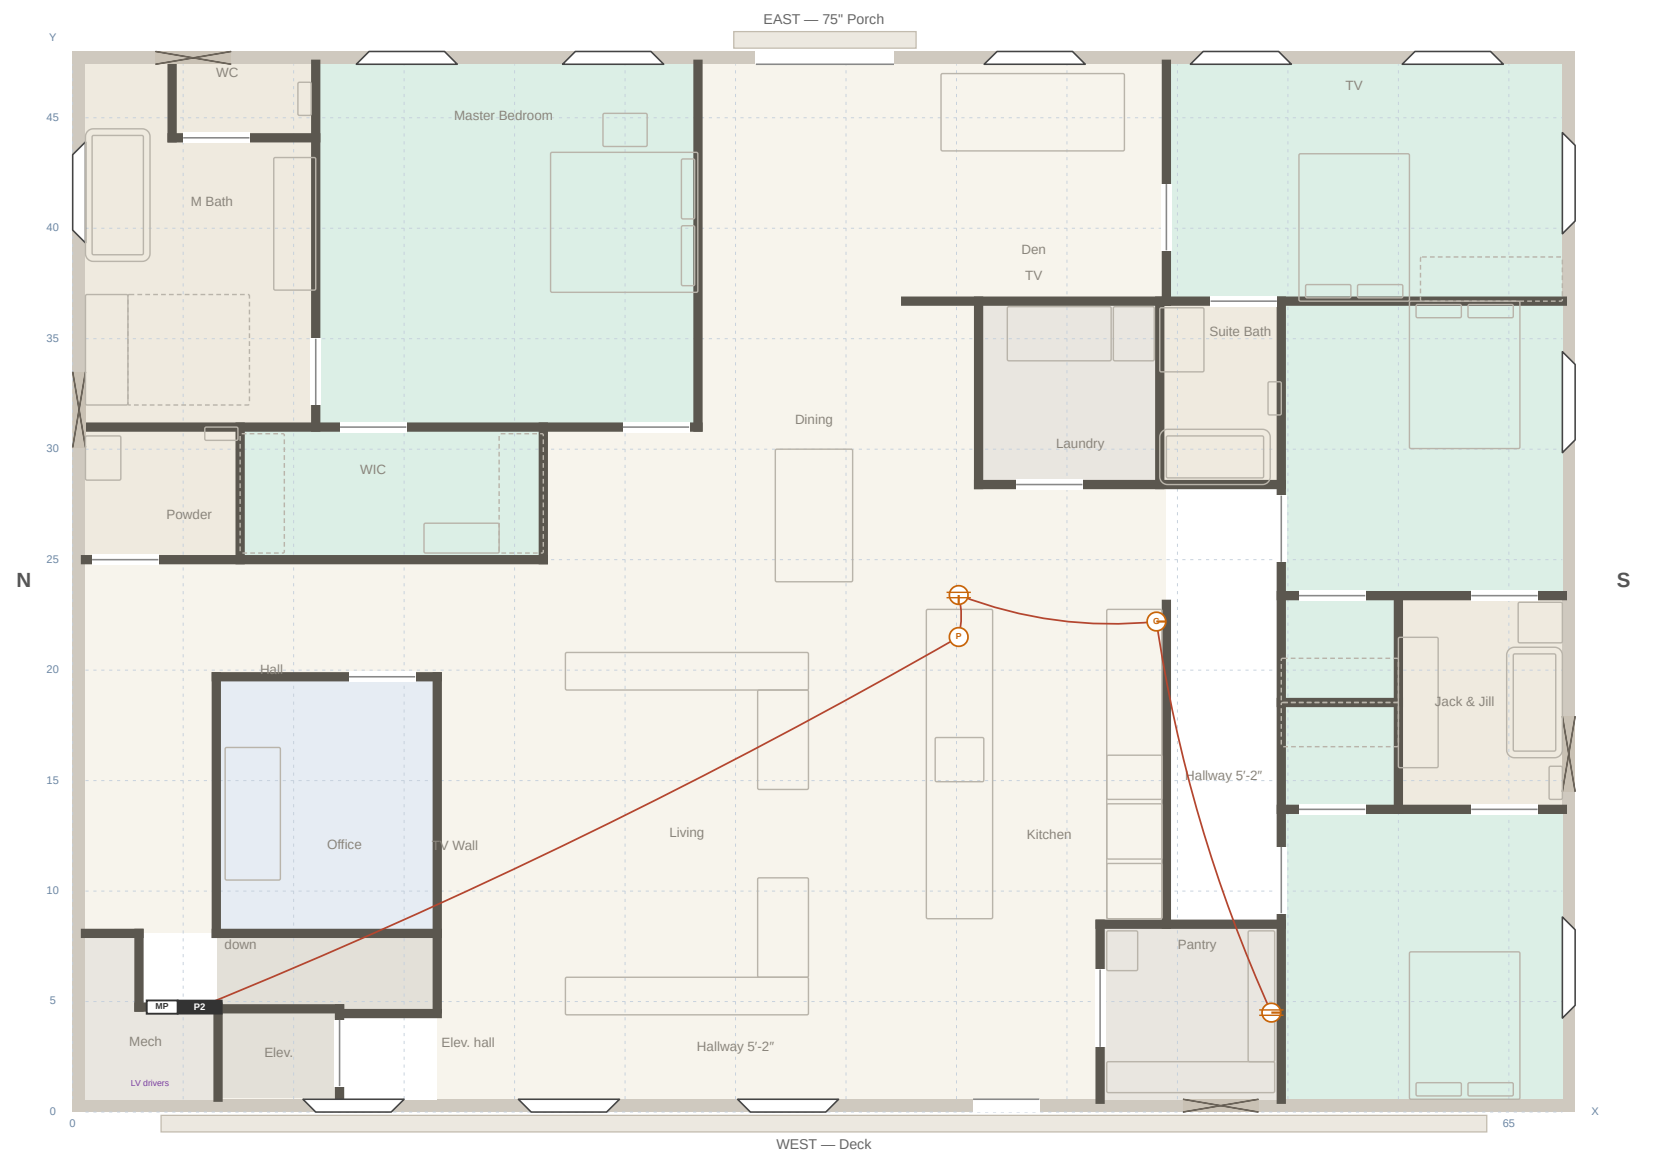


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor		Electrical plan	
Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5'		Devices, luminaires, alarms and the circuit schedule for sub-panel P2	
Wall numbers as the floor plan drawing of 2026-09-29		Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	

E-1


rev C · 2026-10-01

E-1.6 — circuit 9: Refrigerator, 20A AFCI, #12 · kitchen

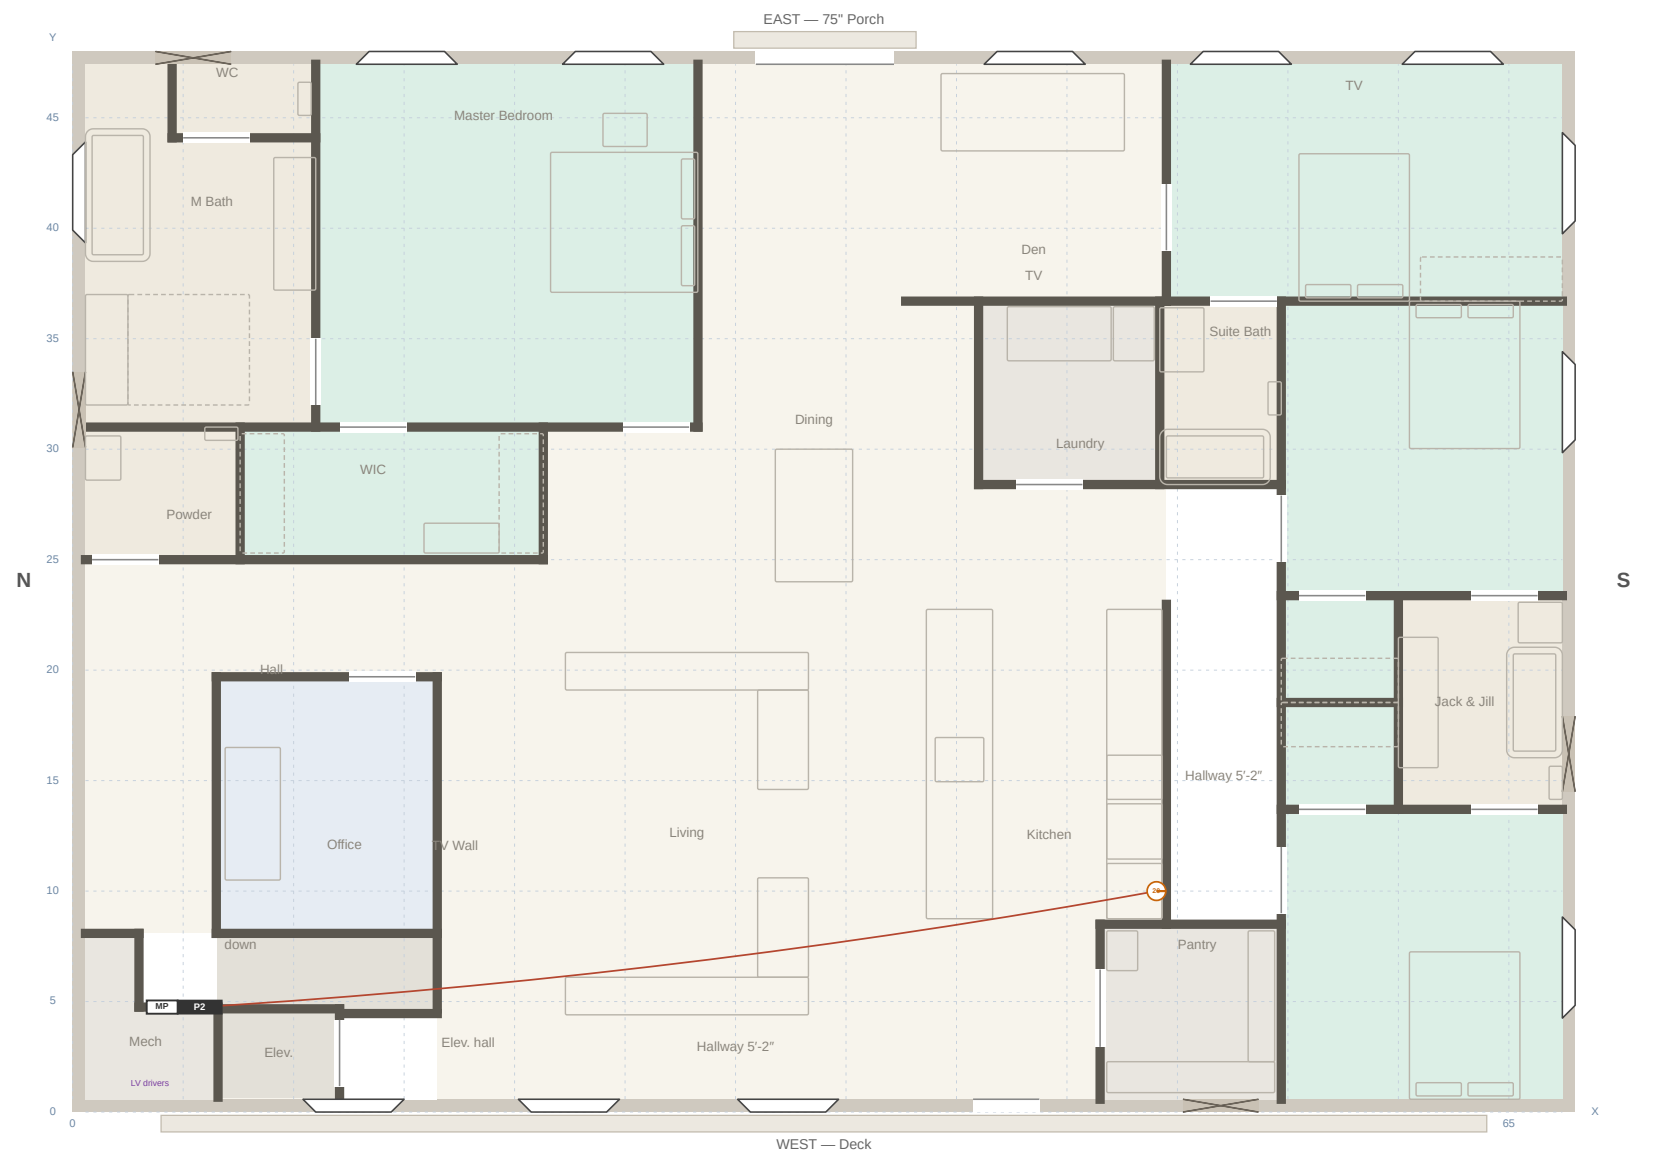


duplex receptacle 18"	GFCI 20A 42"	pop-up counter	240V	TV box	switch S / S3 / SD dimmer / So occupancy	recessed LED	pendant	sconce	exhaust fan	smoke / smoke+CO	soffit light	low-voltage d
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29						Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson			E-1 rev C · 2026-10-01 drawn for K. Christianson			

E-1.8 — circuit 11: Dishwasher drawers, 20A GFCI/AFCI, #12 · island

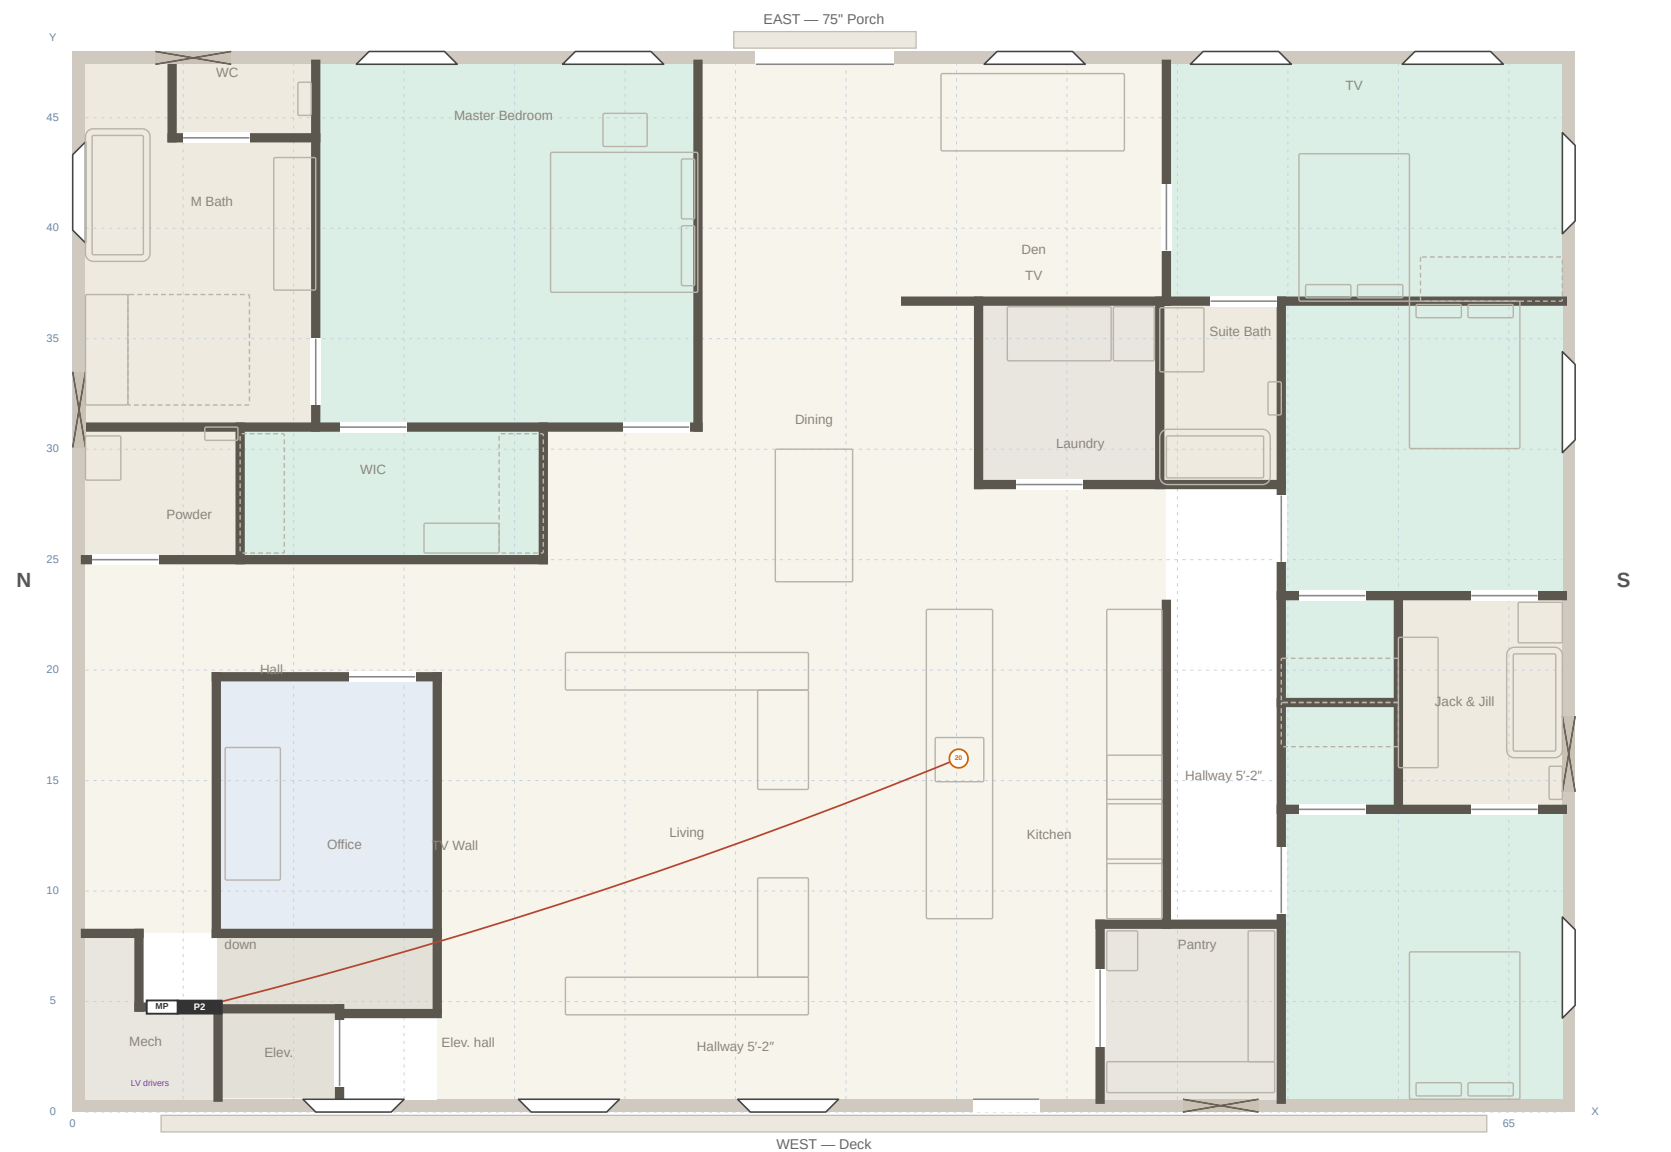


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.9 — circuit 12: Microwave drawer, 20A AFCI, #12 · island

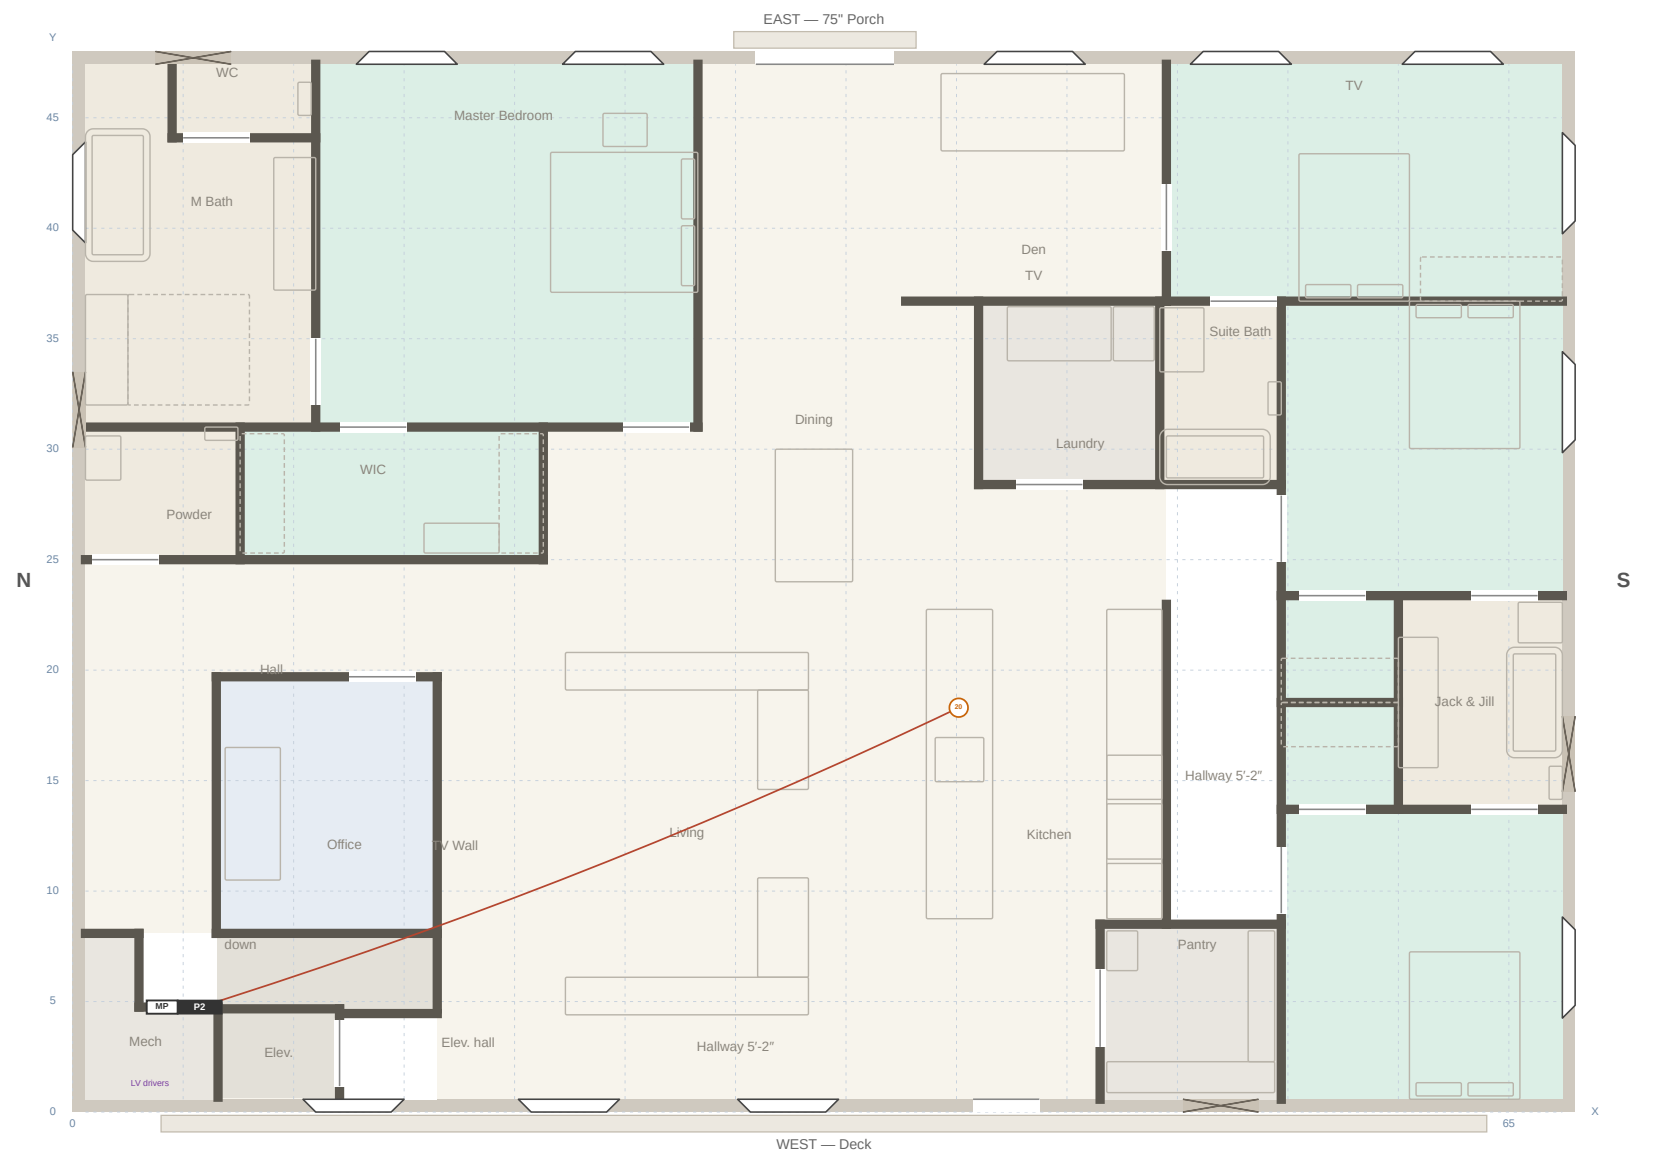


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.10 — circuit 13: Laundry: washer, sink, counter, 20A GFCI/AFCI, #12 · laundry

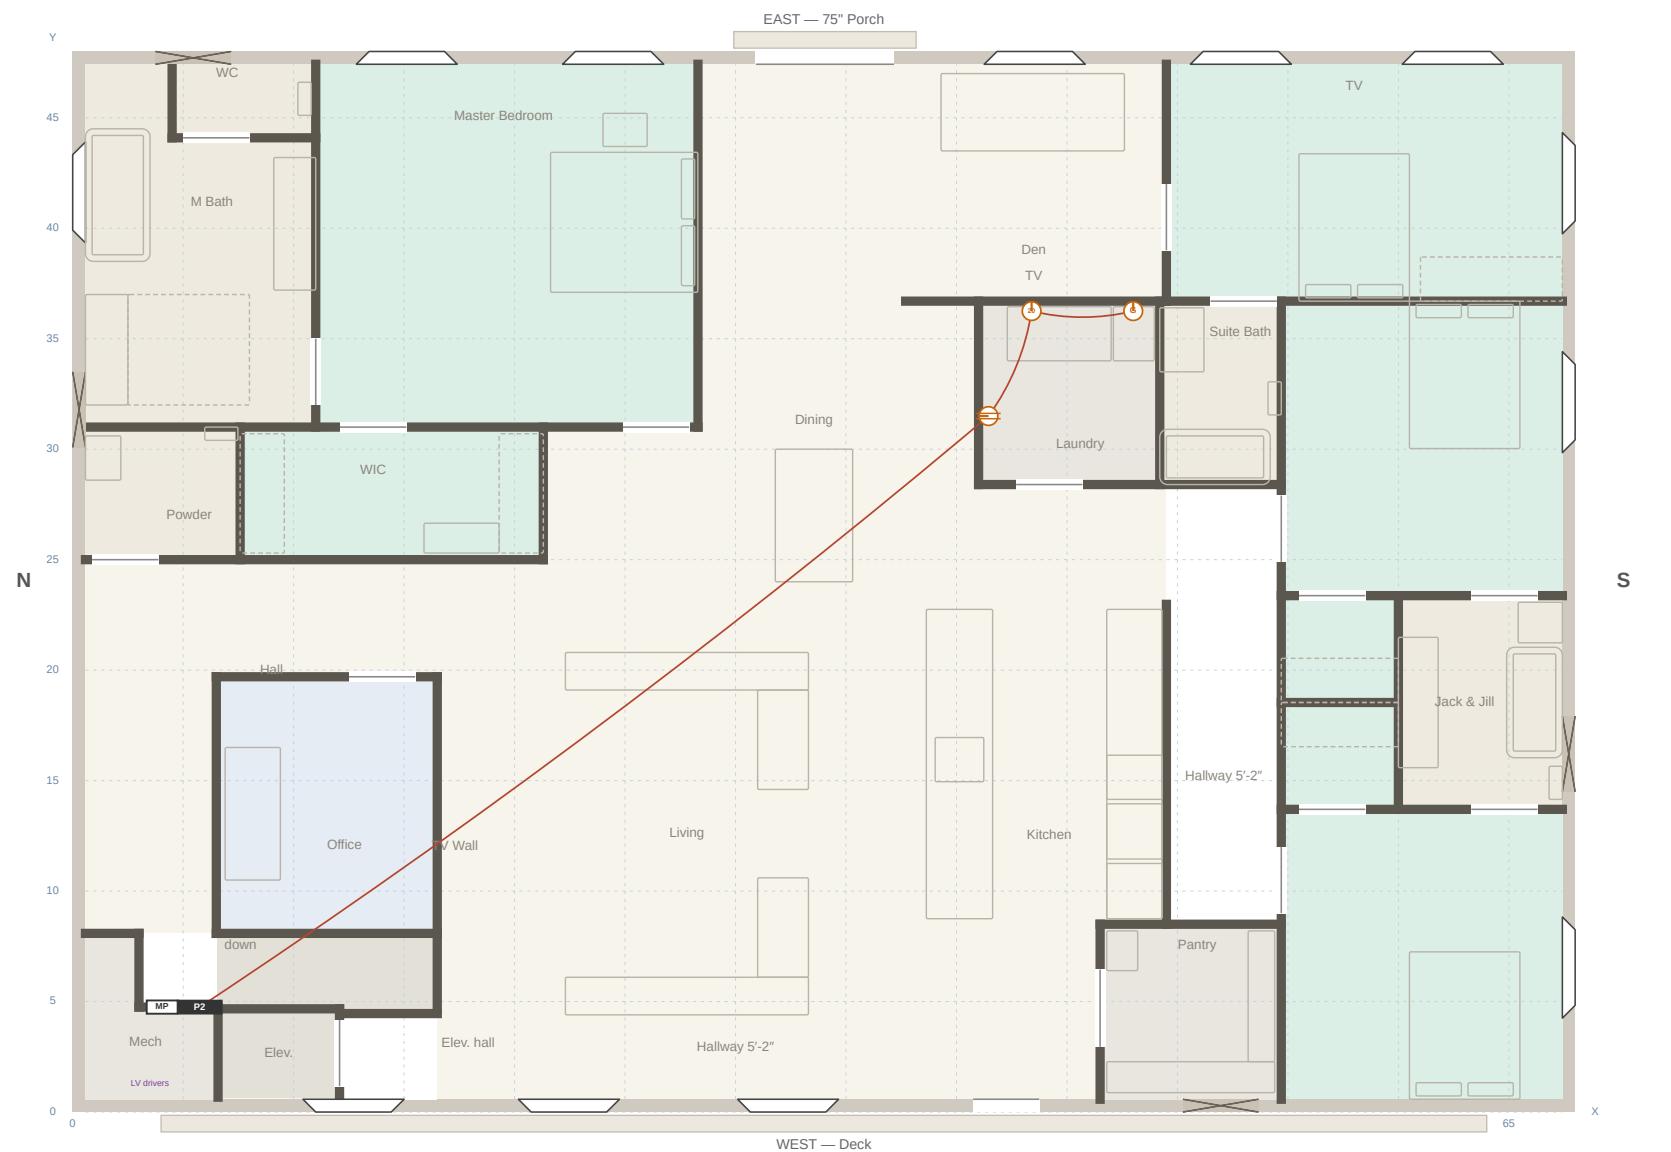

duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.11 — circuit 14: Bath receptacles west, 20A GFCI, #12 • master bath, WC, powder

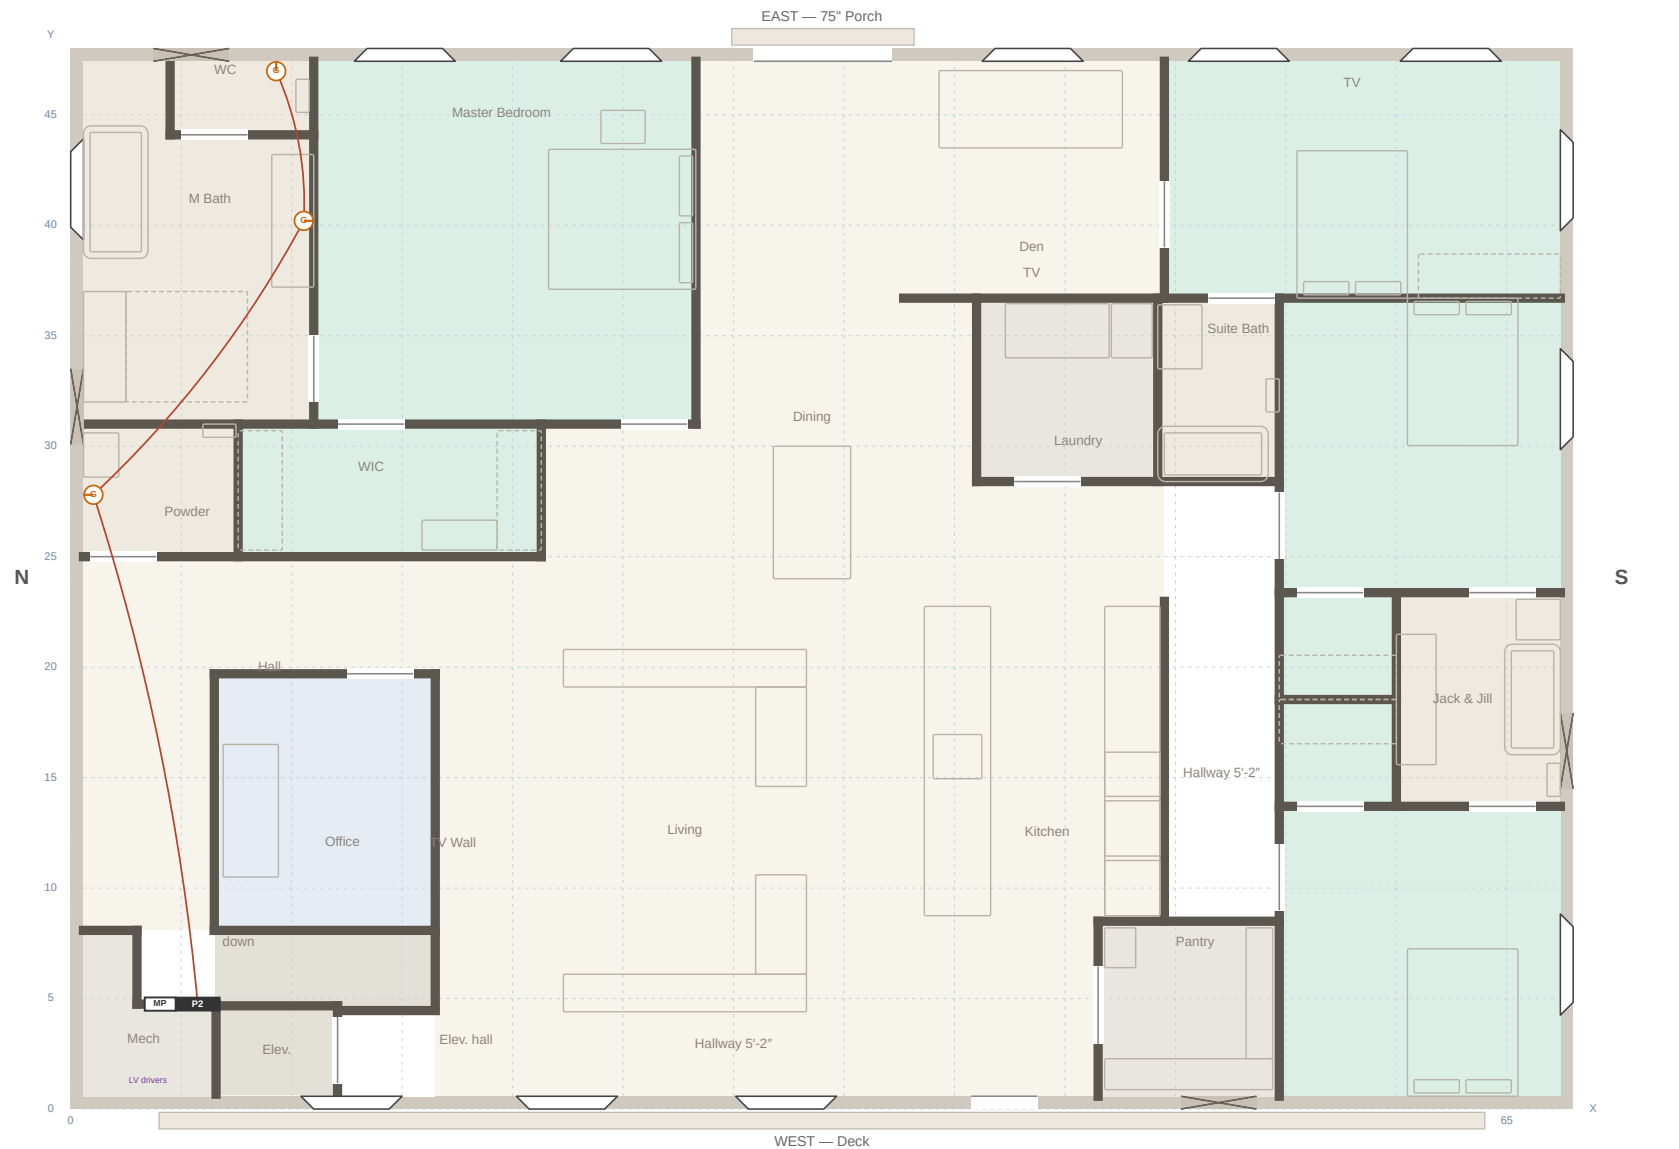

duplex receptacle 18"

GFCI 20A 42"

pop-up counter

240V

box

switch S

3 / SD dimmer / So occupancy

recessed LED

pendant

sconce

exhaust fan

smoke / smoke+CO

soffit light

low-voltage di

7824 Zero Road — second floor

Casper, Wyoming · 68' x 48' to brick, faces 7" inside · 9' ceiling · grid 5'
Wall numbers as the floor plan drawing of 2026-09-29

Electrical plan

Devices, luminaires, alarms and the circuit schedule for sub-panel P2


Schematic for pricing and coordination, not a stamped construction document. Verify on site. Drawn for K. Christianson

E-1

rev C · 2026-10-01


on site drawn for K. Christianson

E-1.12 — circuit 15: Bath receptacles east, 20A GFCI, #12 · suite bath, Jack & Jill

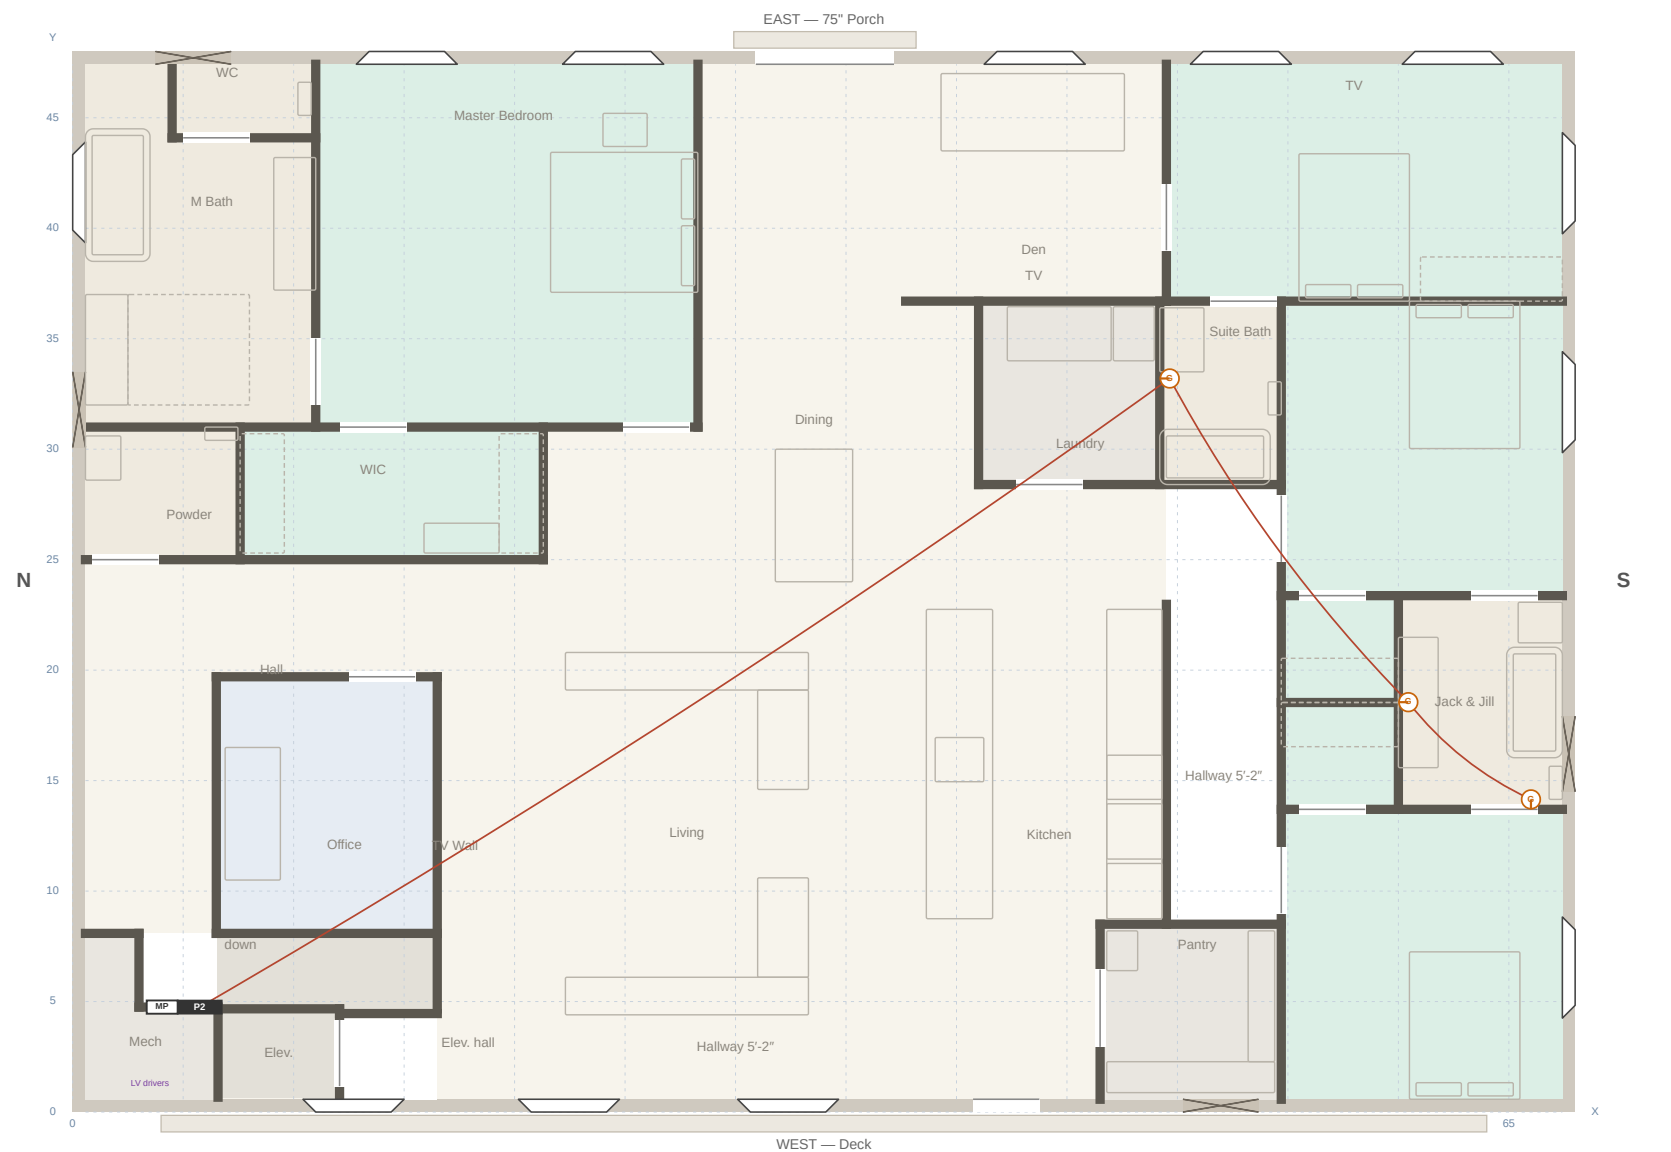


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.13 — circuit 16: Master suite receptacles, 15A AFCI, #14 · master bedroom, walk-in

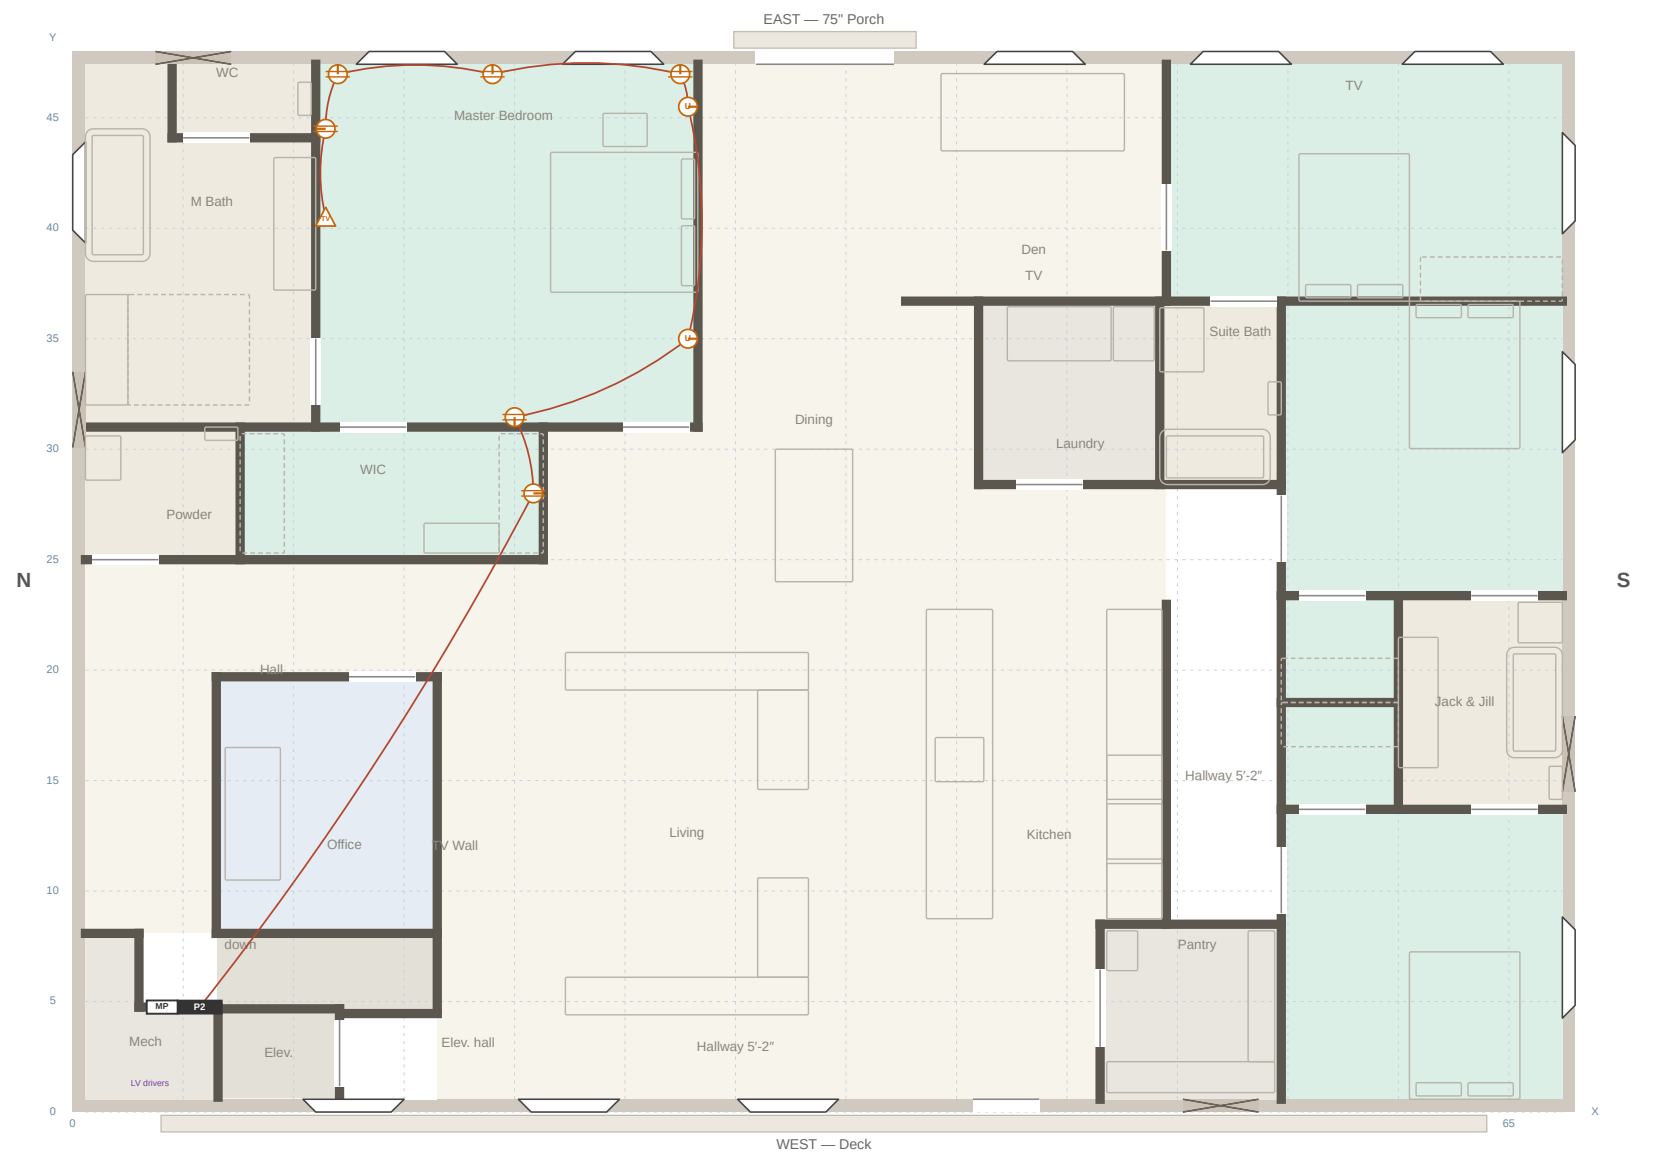


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.14 — circuit 17: Bedrooms 3 and 4 receptacles, 15A AFCI, #14 · bedrooms 3, 4, closets, wing hall

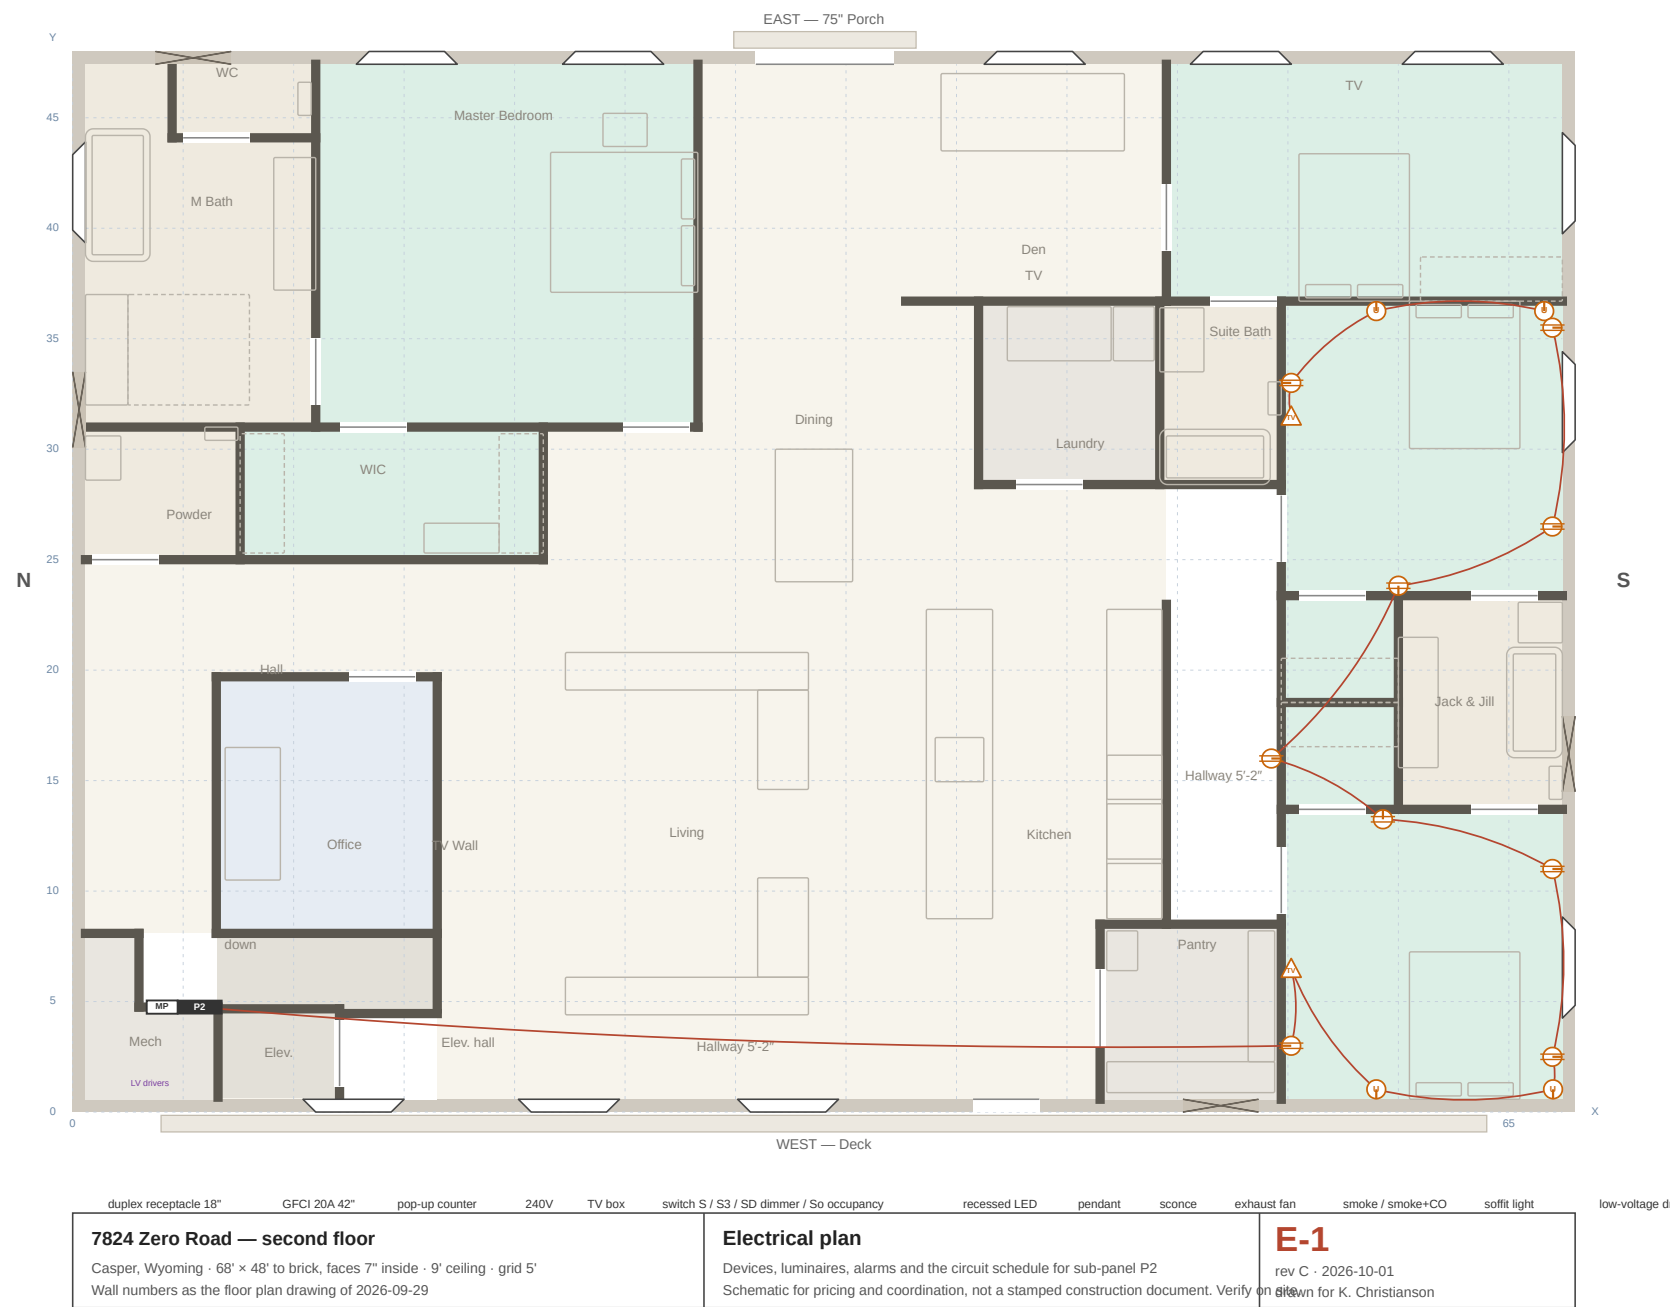


E-1.15 — circuit 18: 2nd Suite receptacles, 15A AFCI, #14 · 2nd Suite

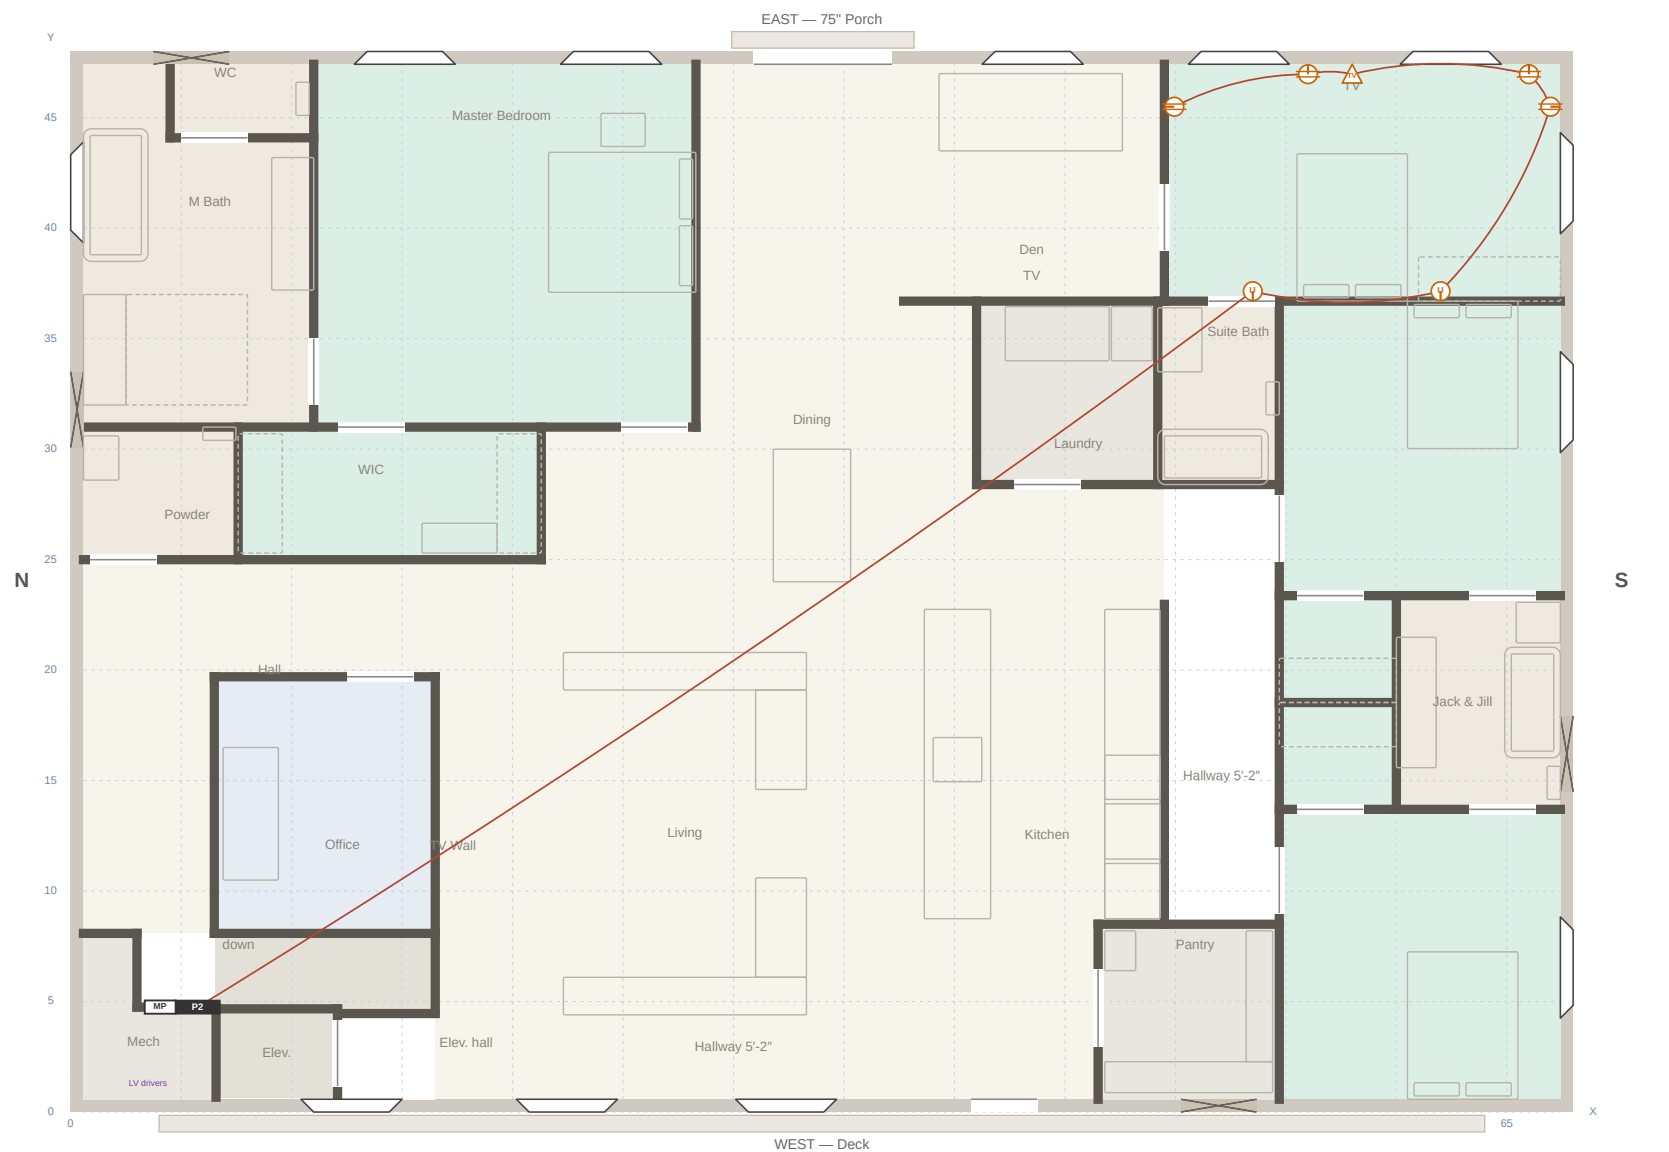


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.16 — circuit 19: Living and dining receptacles, 15A AFCI, #14 · living, hallway, dining, east entry

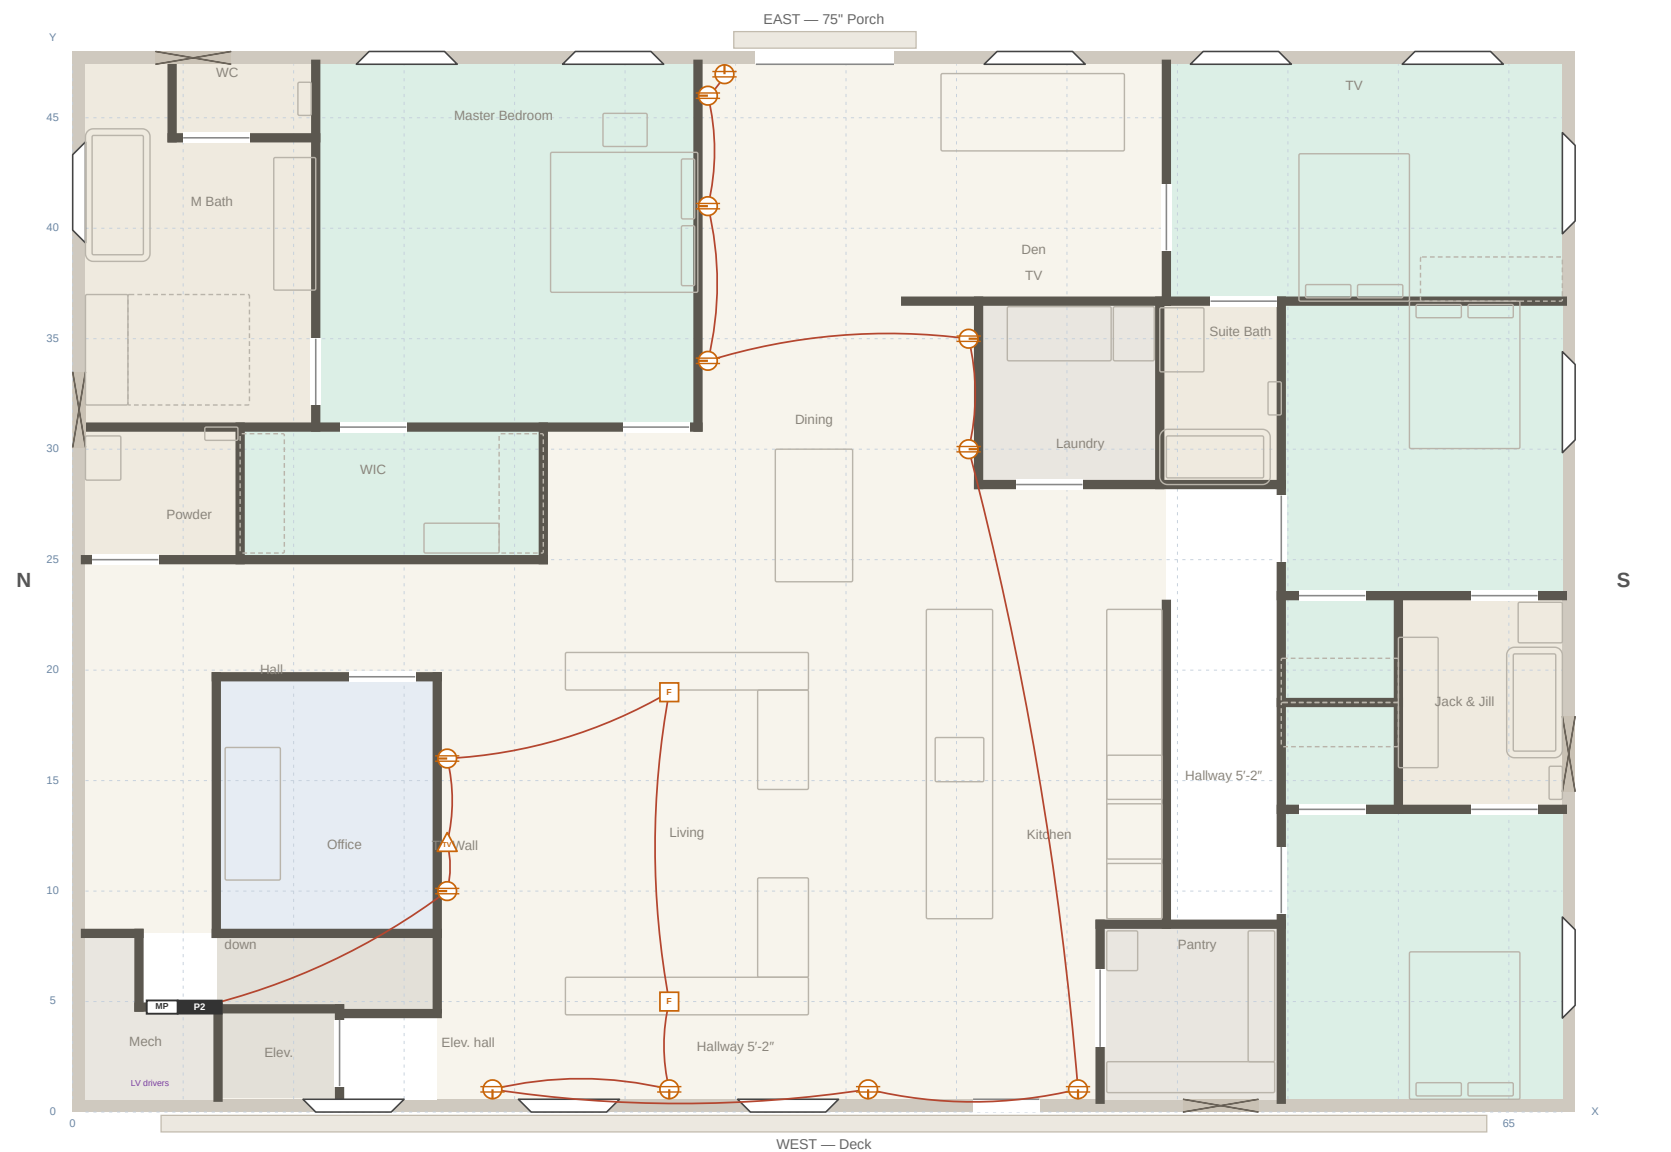


duplex receptacle 18"	GFCI 20A 42"	pop-up counter	240V	TV box	switch S / S3 / SD dimmer / So occupancy	recessed LED	pendant	sconce	exhaust fan	smoke / smoke+CO	soffit light	low-voltage d
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29						Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson			E-1 rev C · 2026-10-01 drawn for K. Christianson			

E-1.17 — circuit 20: Den, office, passage receptacles, 15A AFCI, #14 · den, office, passage, elevator hall

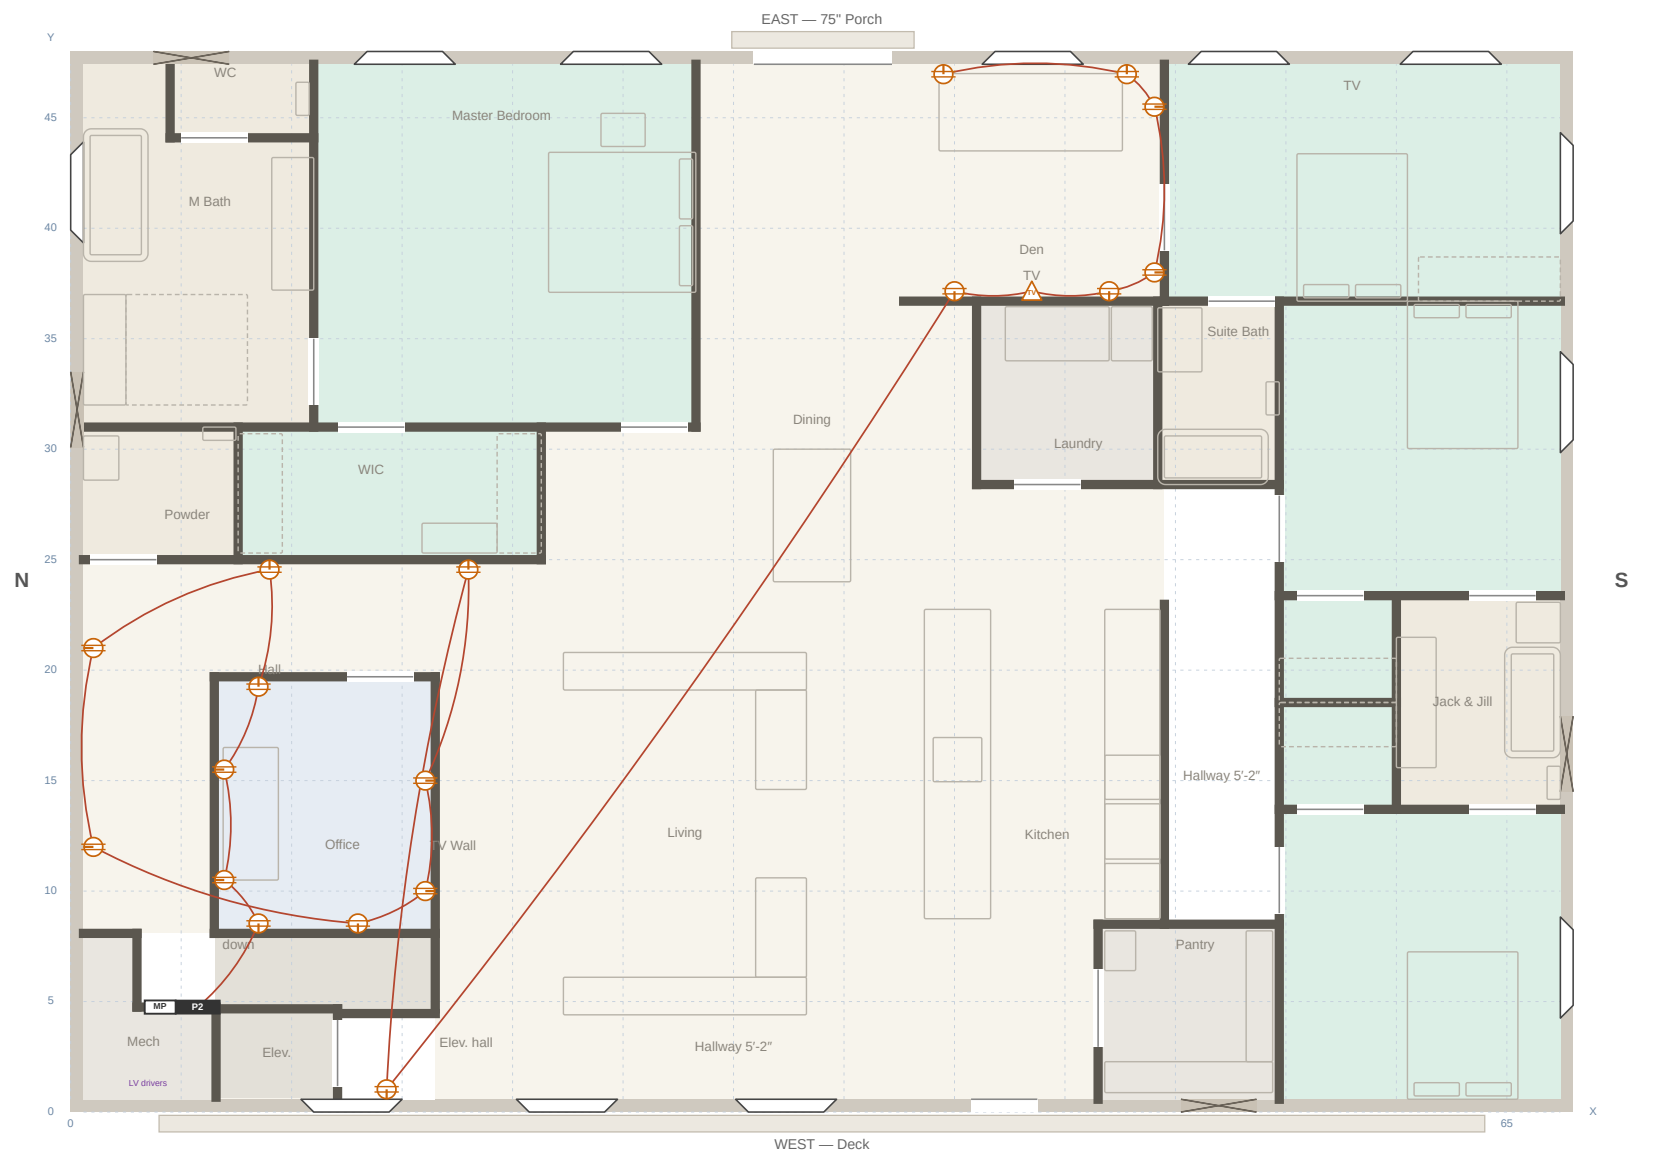


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.18 — circuit 21: Lighting A, 15A AFCI, #14 · living, dining, kitchen, den, office, baths

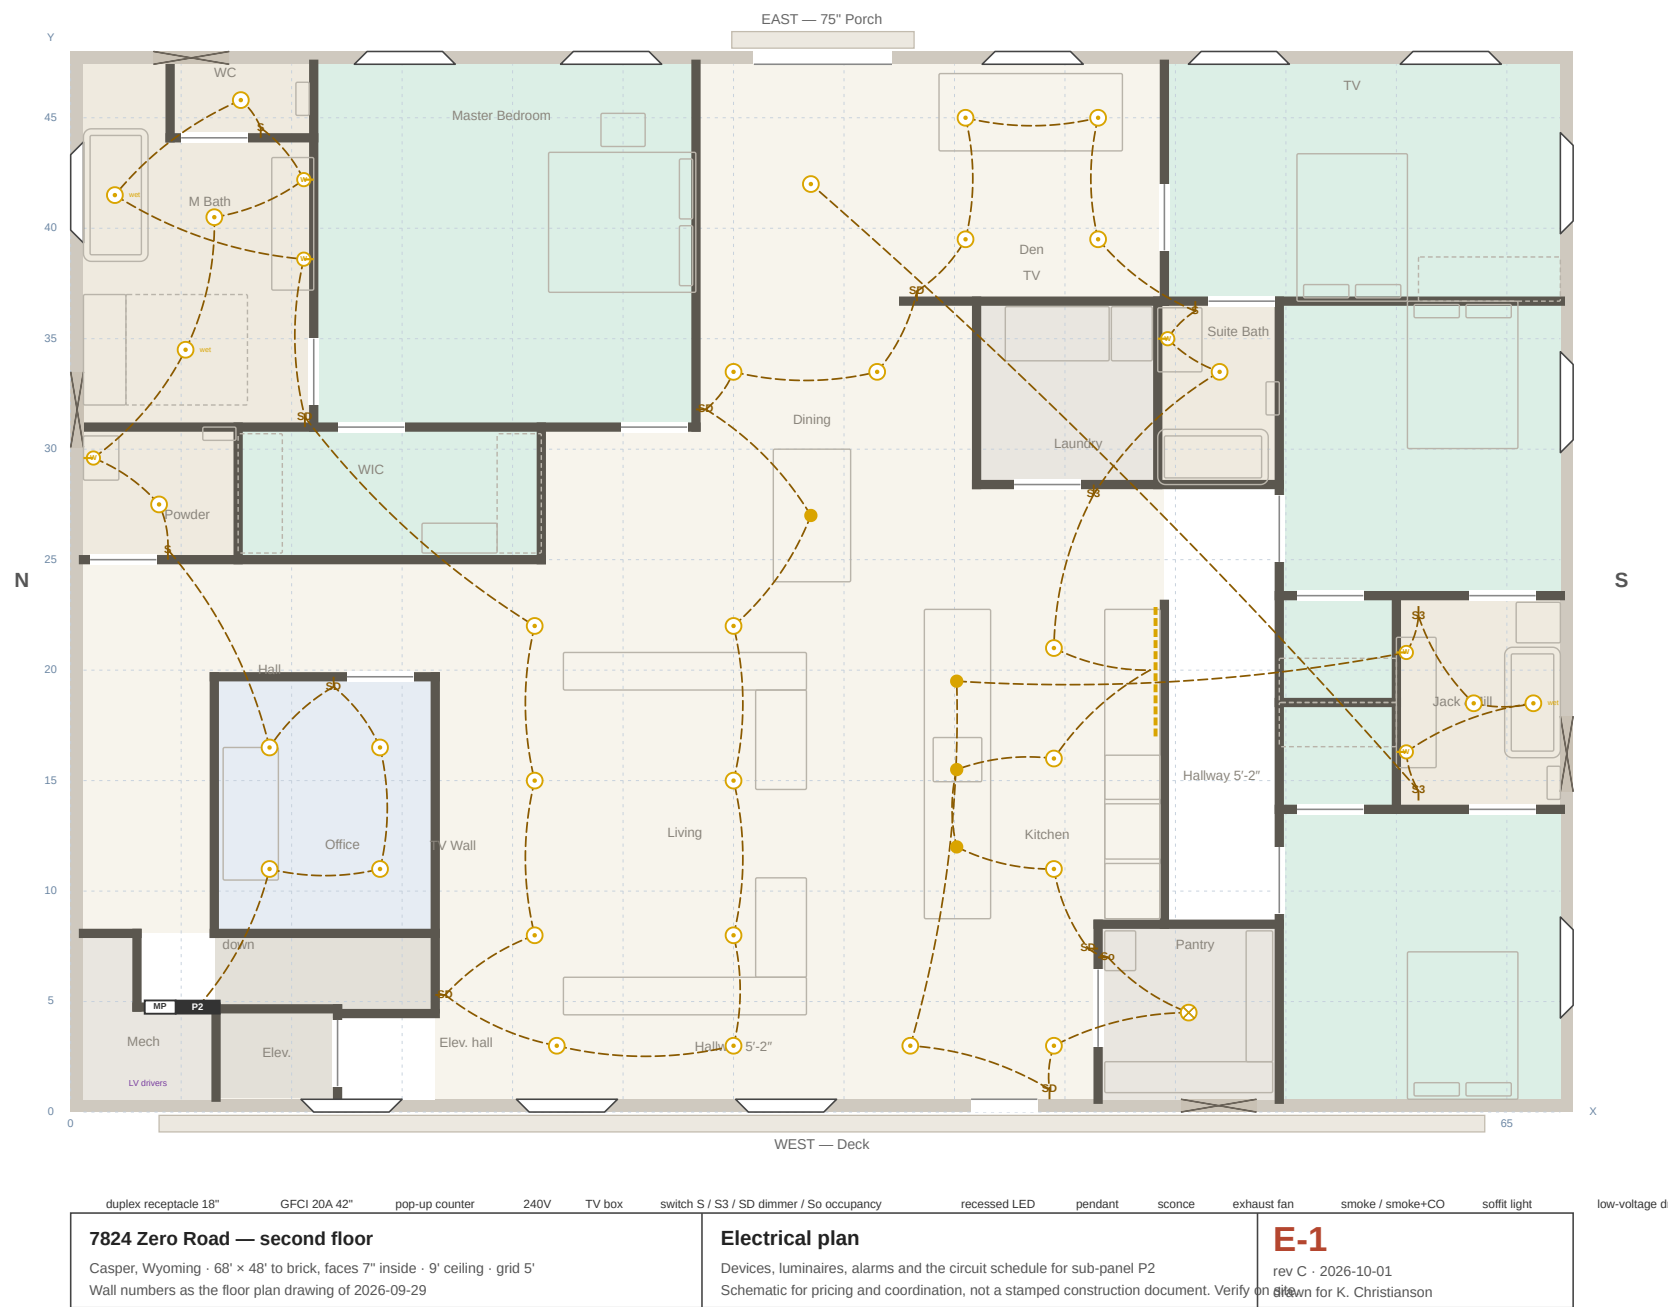


E-1.19 — circuit 22: Lighting B + alarms, 15A AFCI, #14 · bedrooms, closets, halls, stair, smoke/CO alarms

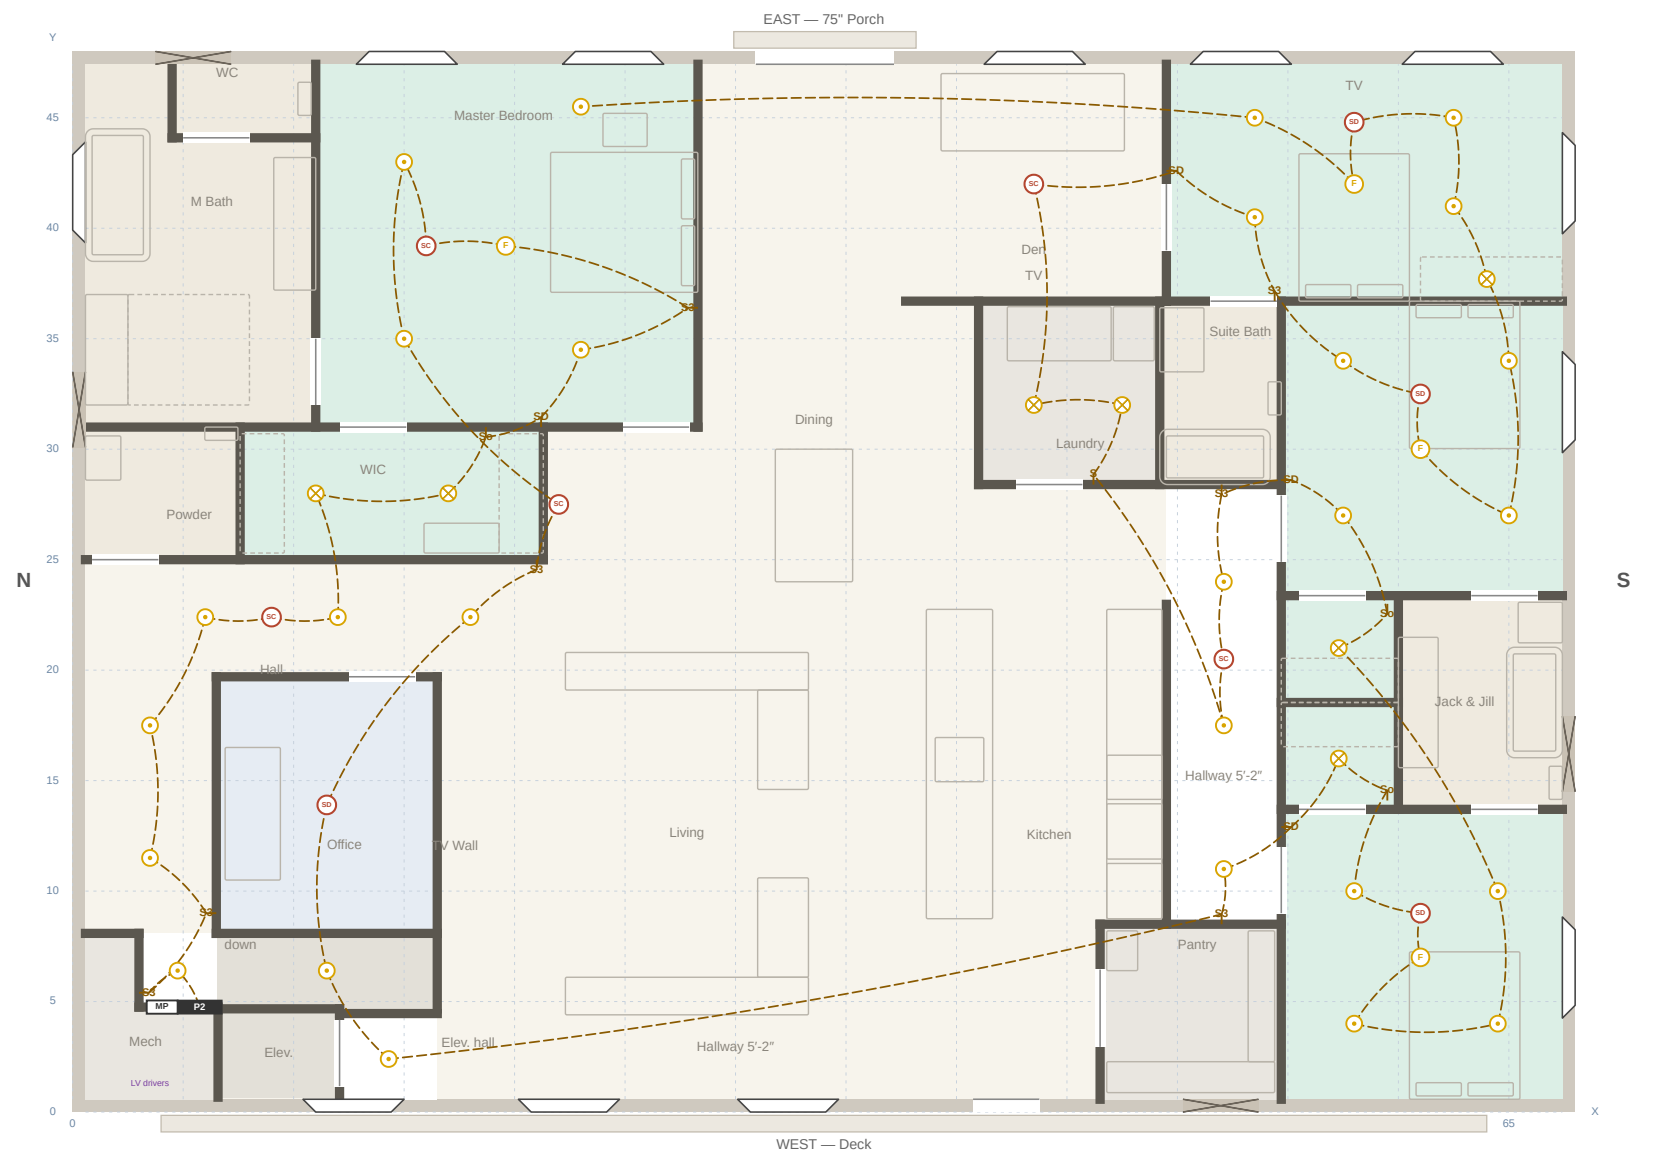


duplex receptacle 18"	GFCI 20A 42"	pop-up counter	240V	TV box	switch S / S3 / SD dimmer / So occupancy	recessed LED	pendant	sconce	exhaust fan	smoke / smoke+CO	soffit light	low-voltage d
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29						Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson			E-1 rev C · 2026-10-01 drawn for K. Christianson			

E-1.20 — circuit 23: Exhaust fans + hood, 15A AFCI, #14 · five bath fans, range hood

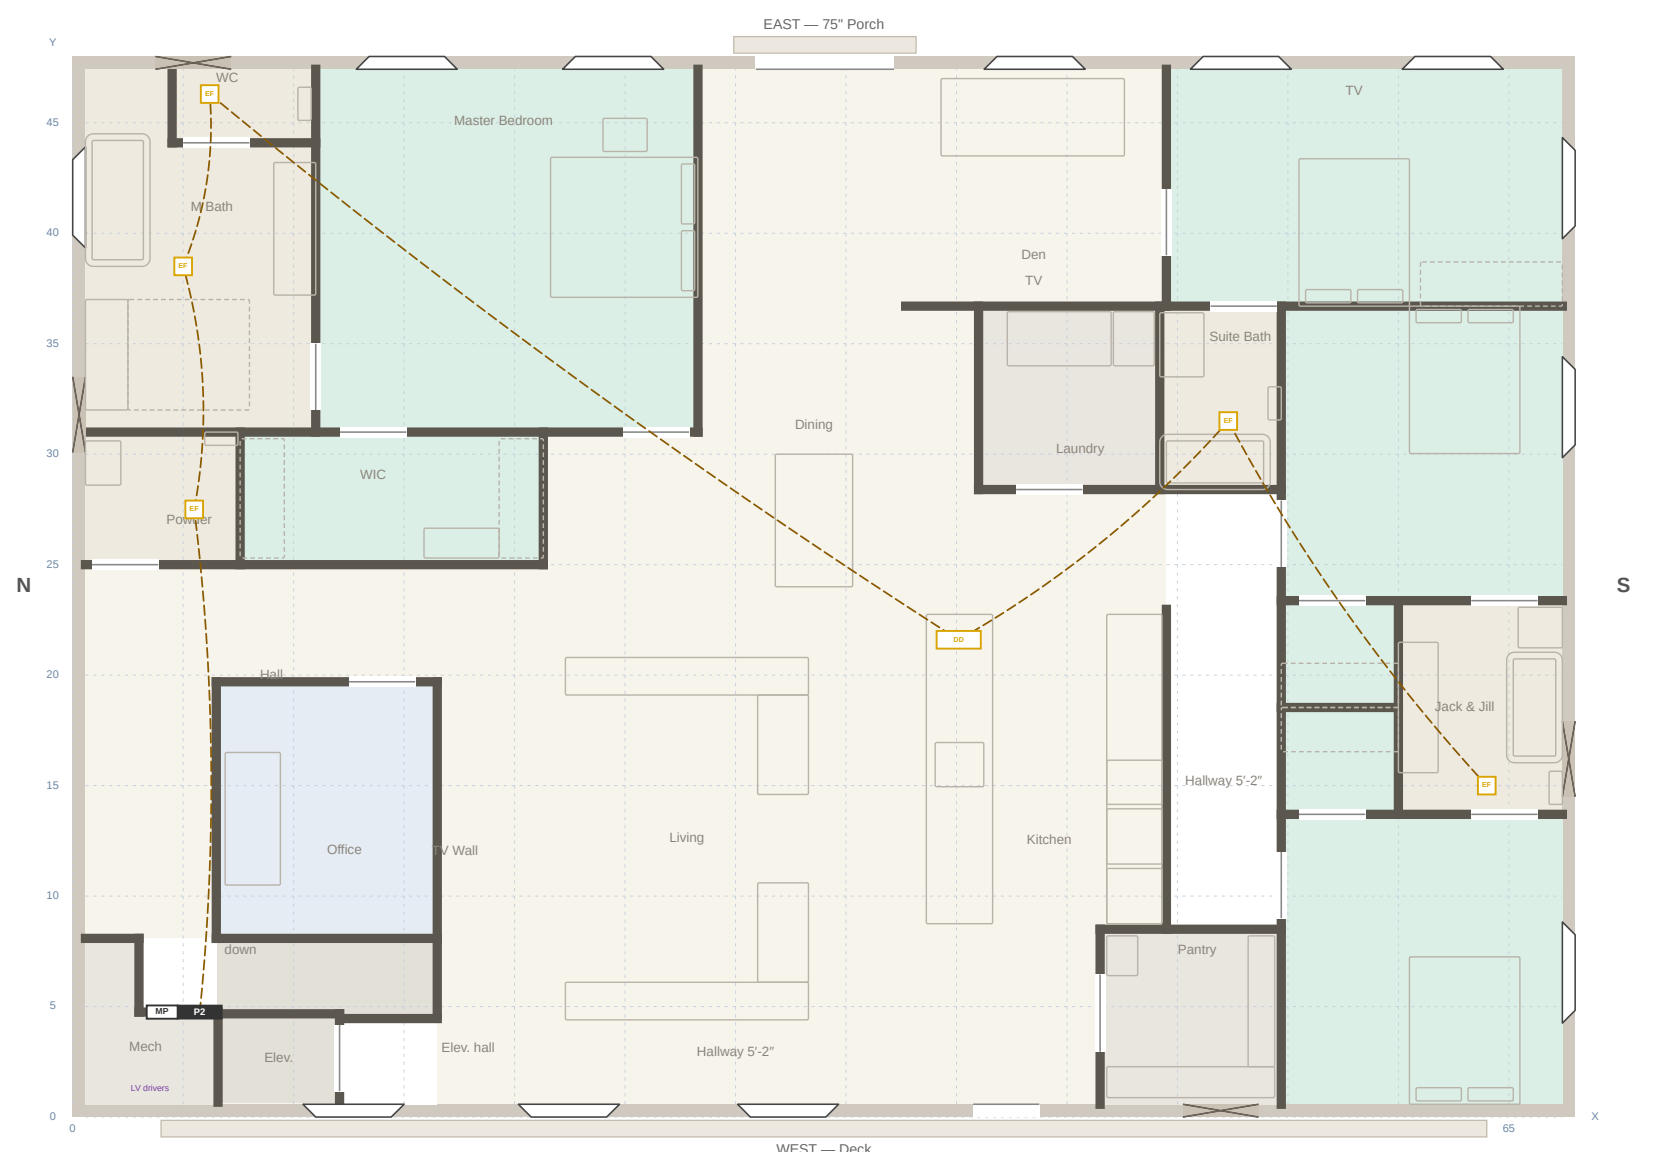


duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant sconce exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.21 — circuit 24: Exterior receptacles, 20A GFCI, #12 · soffit receptacles, west and east

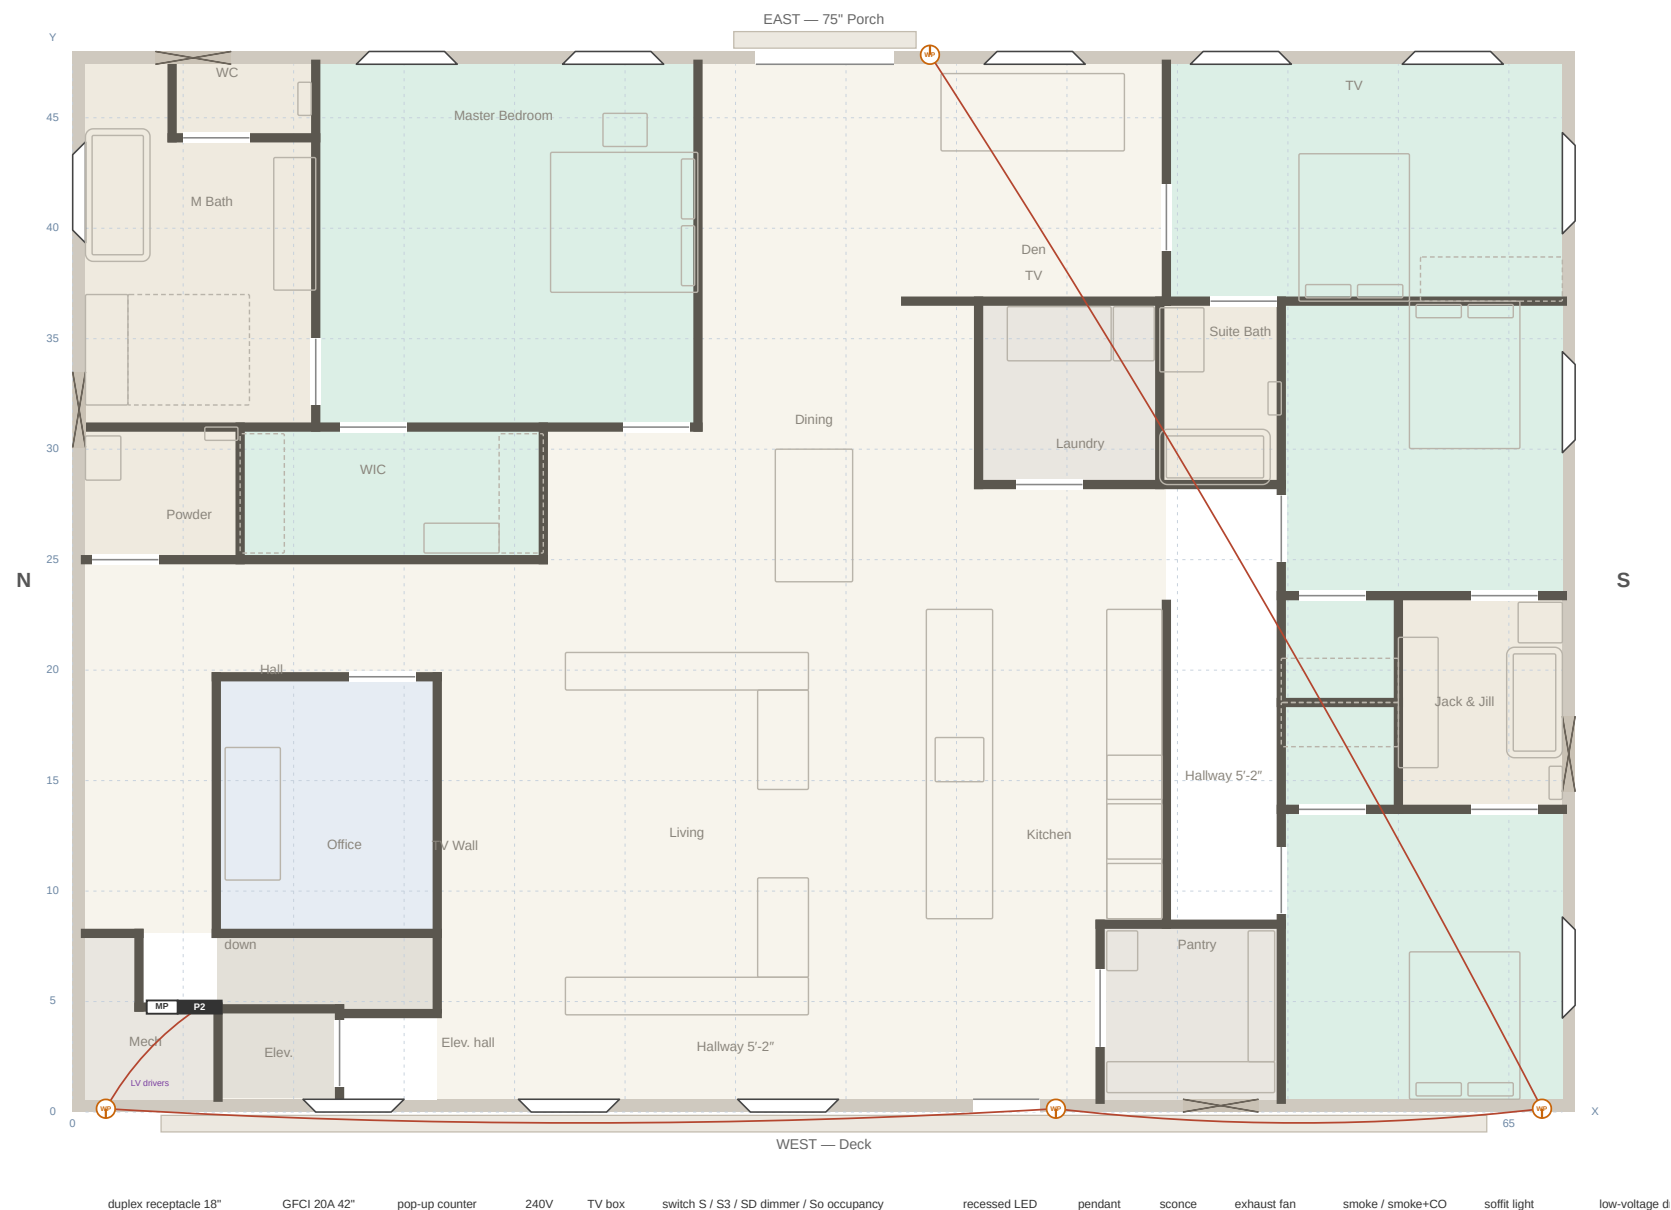


7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29	Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	E-1 rev C · 2026-10-01 drawn for K. Christianson
--	--	---


E-1.22 — circuit 25: Mech closet: ventilation unit, 15A, #14 · ERV / vents, service receptacle

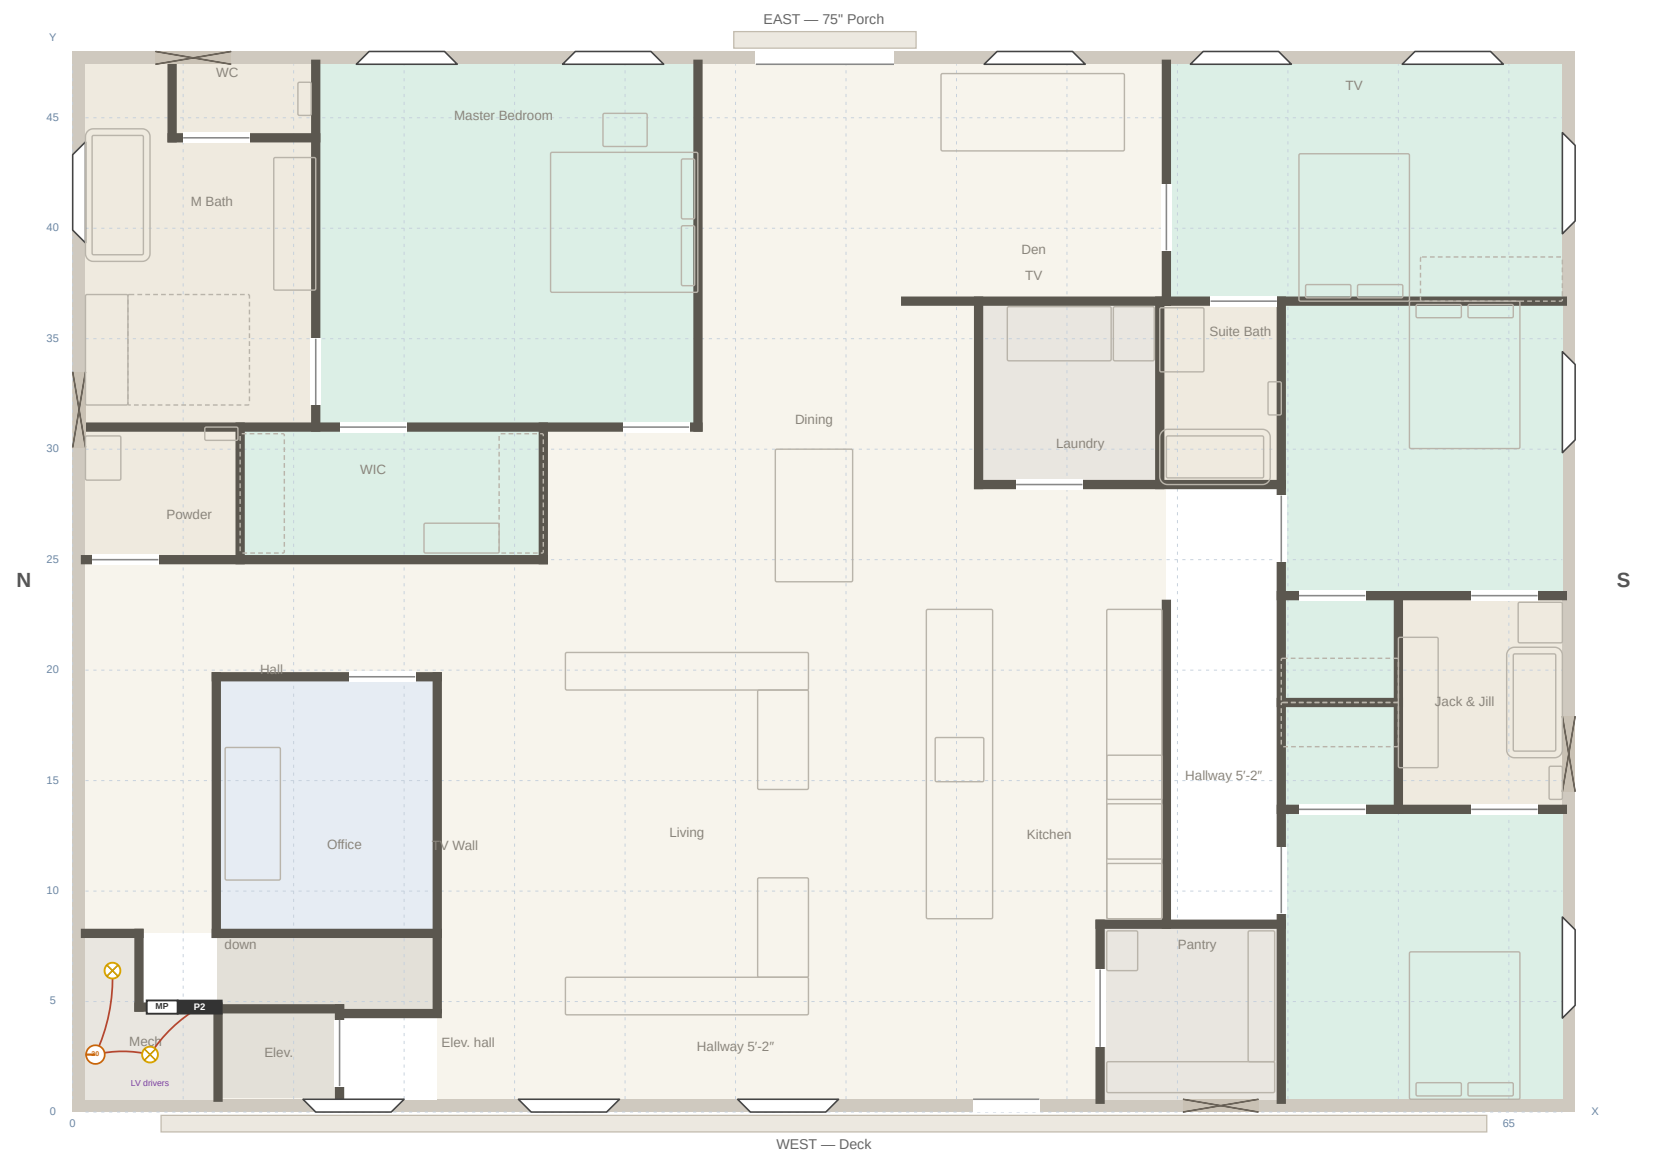

E-1.23 — circuit 26: Exterior soffit lighting, 15A, #14 · west soffit, east door group, east soffit; three switch legs

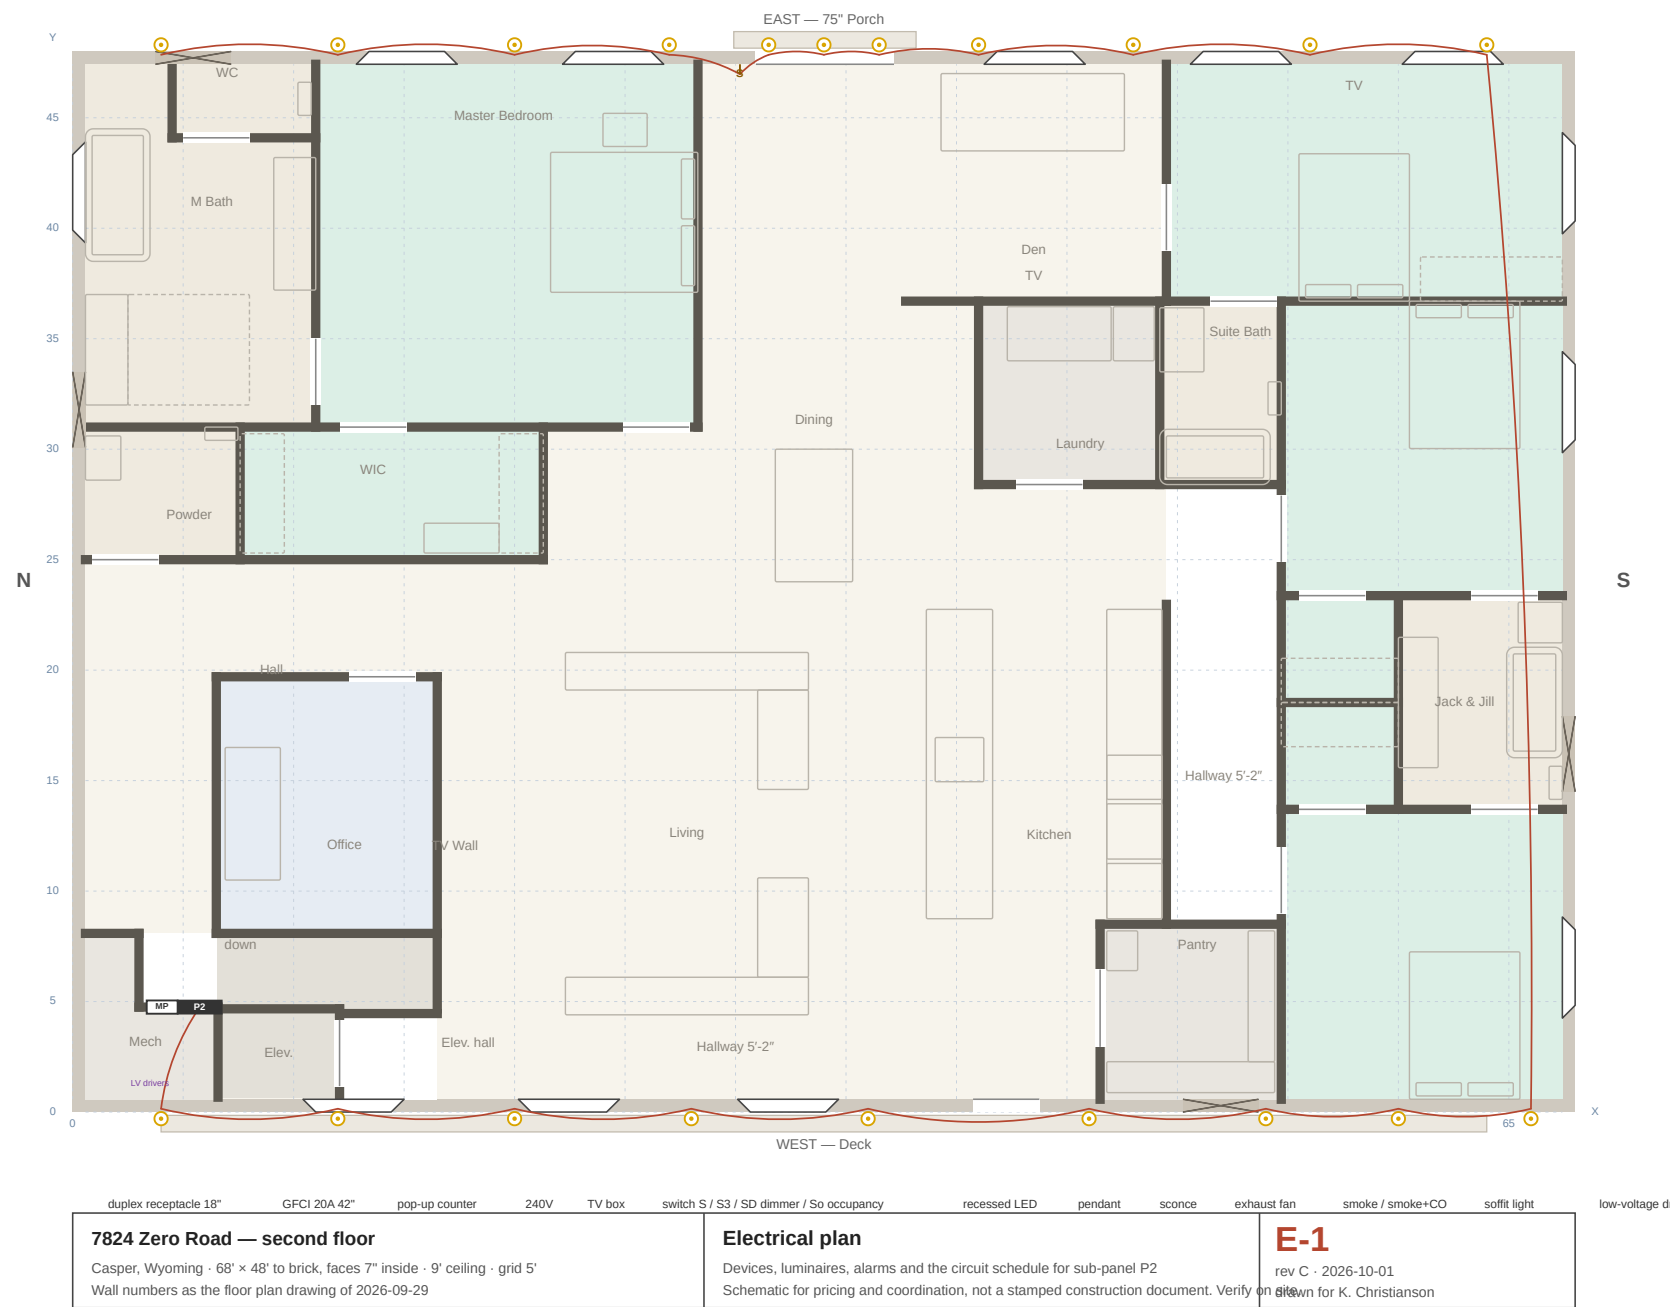


E-1.26 — circuit 30: Low-voltage power supplies, 15A, #14 · shade and LED drivers in the mech room

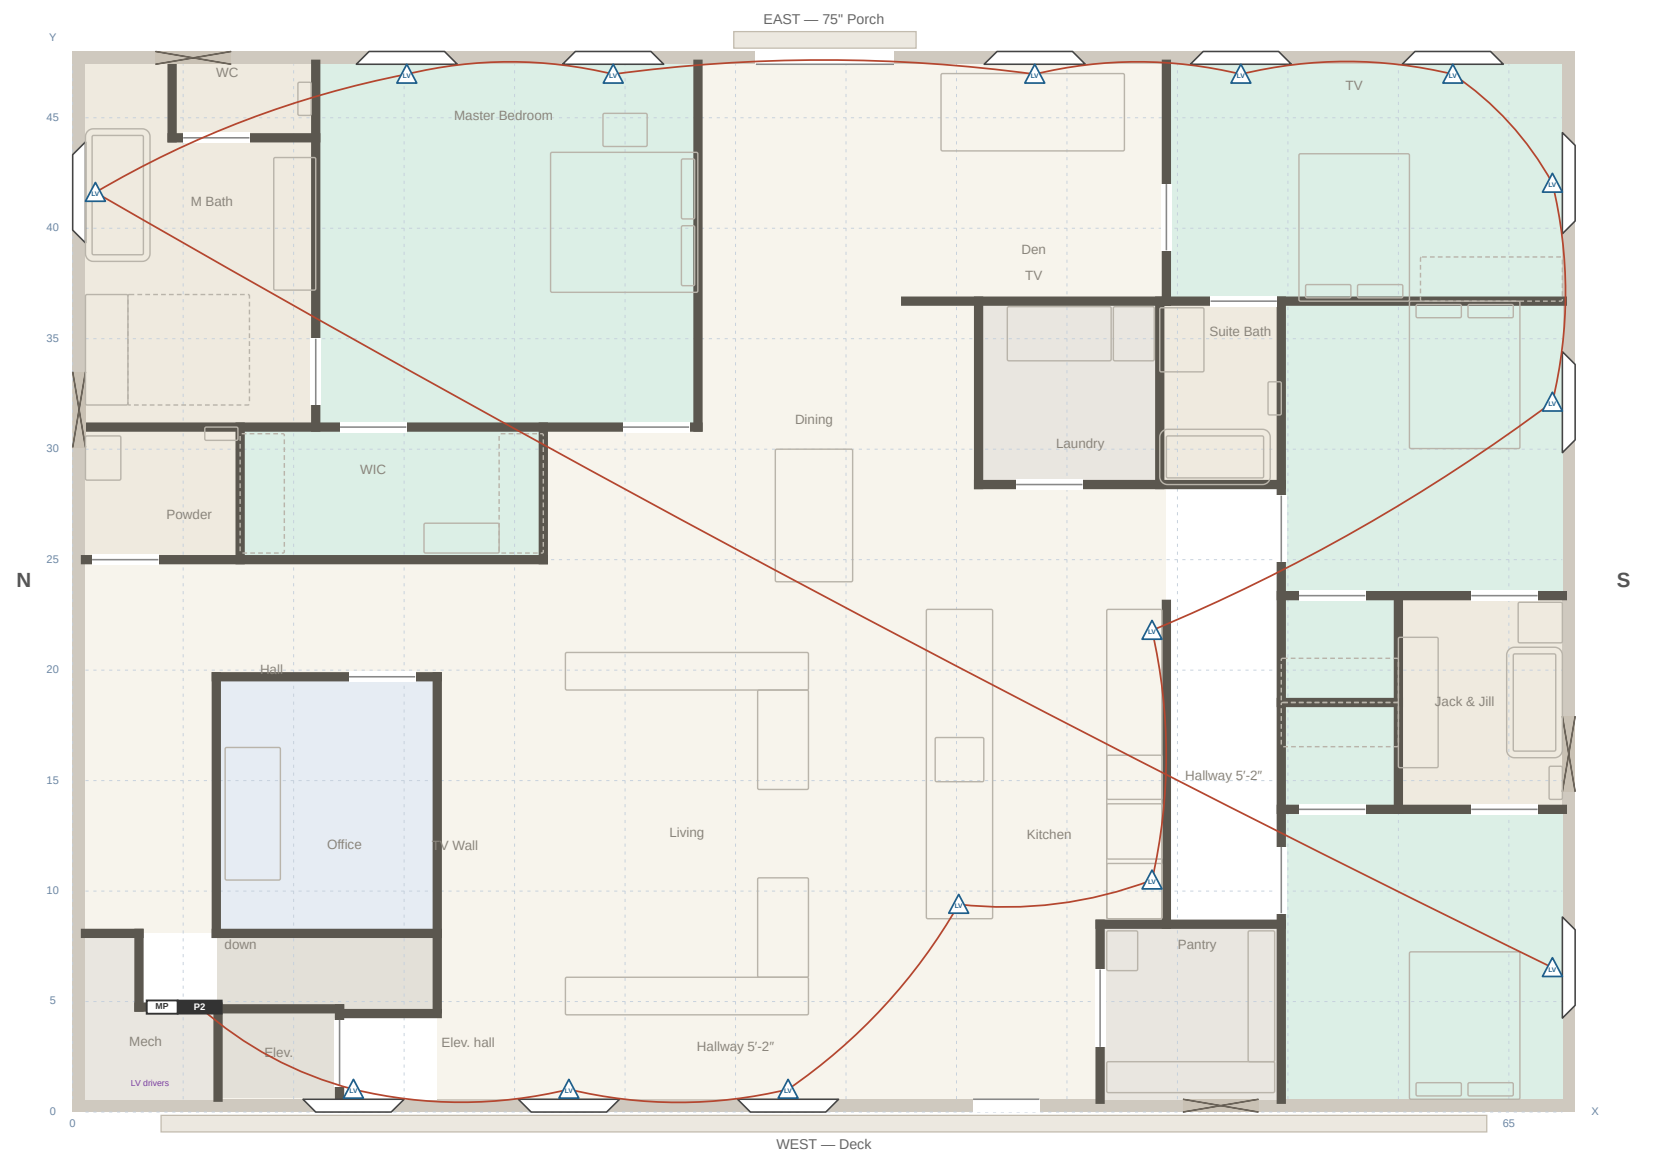

duplex receptacle 18" GFCI 20A 42" pop-up counter 240V TV box switch S / S3 / SD dimmer / So occupancy recessed LED pendant scone exhaust fan smoke / smoke+CO soffit light low-voltage d			
7824 Zero Road — second floor Casper, Wyoming · 68' × 48' to brick, faces 7" inside · 9' ceiling · grid 5' Wall numbers as the floor plan drawing of 2026-09-29		Electrical plan Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site for K. Christianson	
		E-1 rev C · 2026-10-01 drawn for K. Christianson	

E-1.D — Cat6, coax and low-voltage home runs

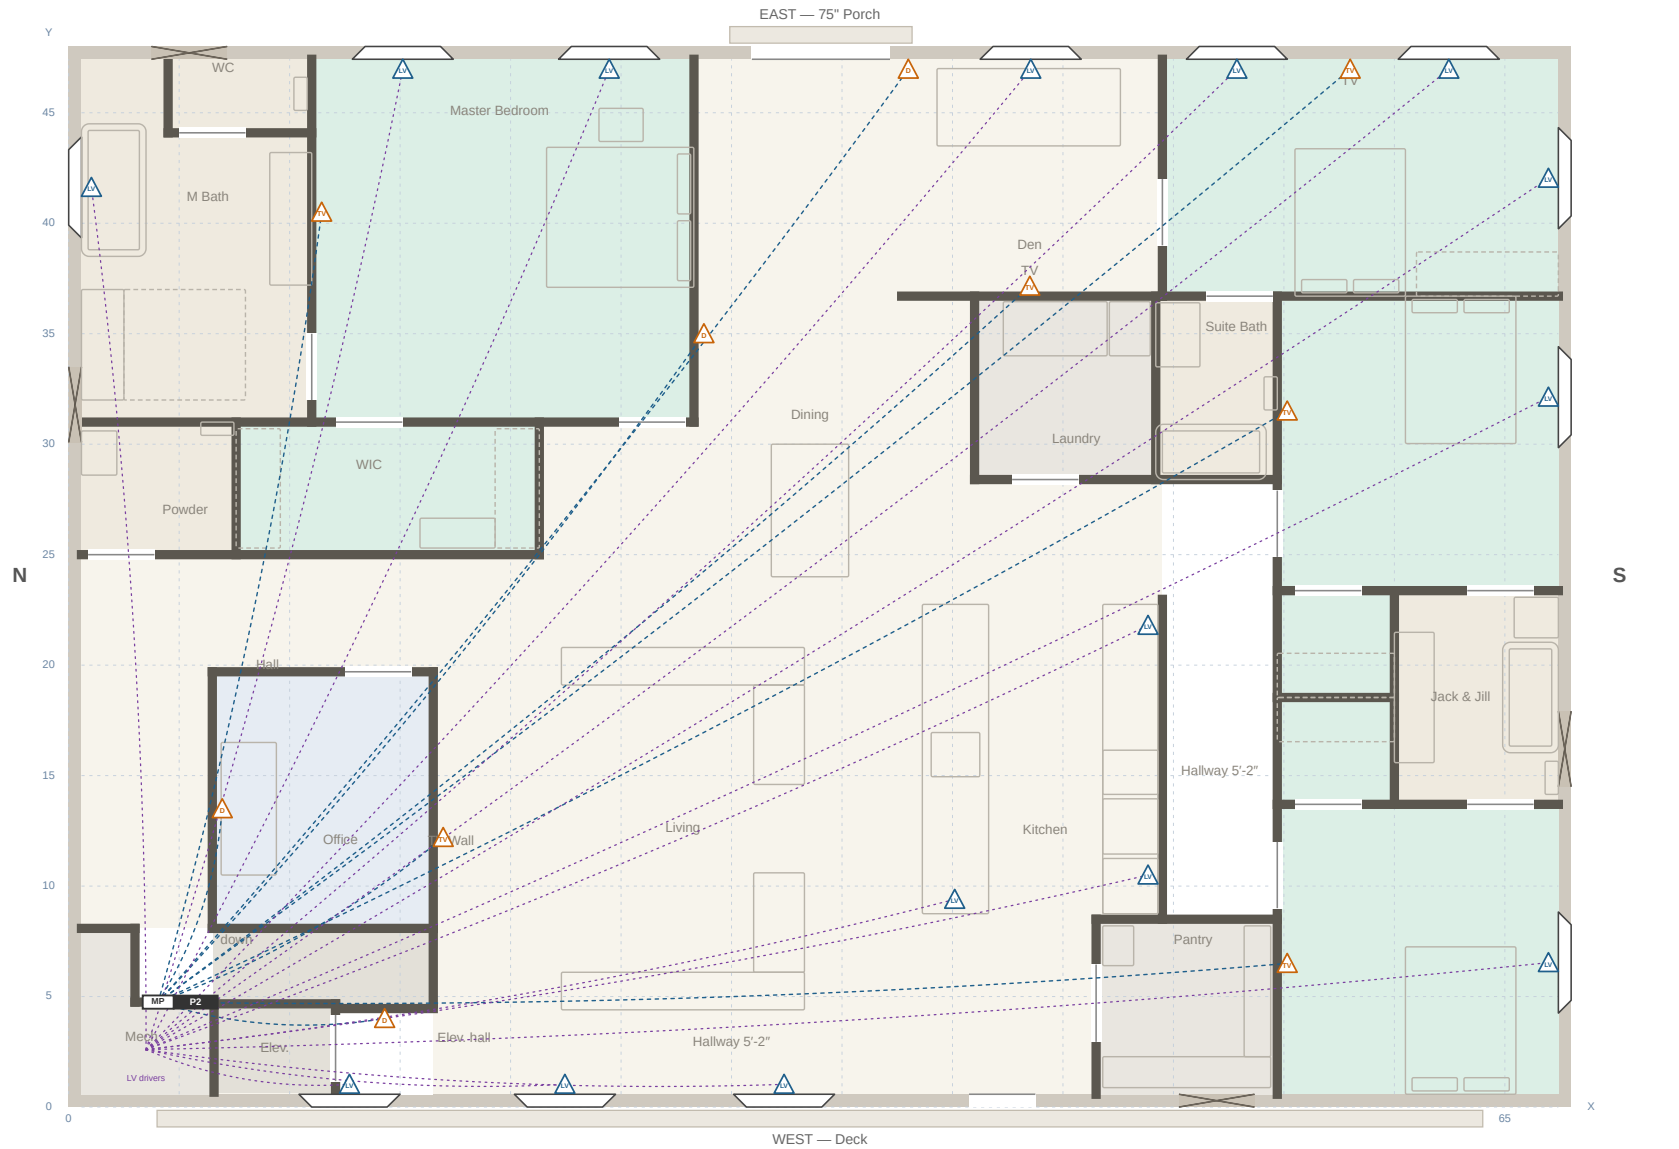

GFCI 20A 42"

240V TV

switch S /

/ SD dimmer / So occupancy

recessed LED

pendant

sconce

exhaust fan

smoke / smoke+CO

soffit light

 low-voltage di

Electrical plan

Devices, luminaires, alarms and the circuit schedule for sub-panel P2

Schematic for pricing and coordination, not a stamped construction document. Verify on site.

rev C · 2026-10-01

on site drawn for K. Christianson

Notes

1. Positions are taped from the nearest wall framing, exterior walls first. Interior walls: to the face of the studs; W# is the wall number on S-1. Exterior walls: to the face of the exterior studs as framed, 6" in from the brick. "On W12" means the item sits in that wall, and the distance runs along it. Wet walls are dimensioned to their 2x4 line: on the side a 2x6 or 2x10 grows toward, its face sits 1-1/2" (2x10: 5-1/4") closer.
2. Code basis: NEC 2023 (confirm the edition adopted by Casper / Natrona County). AFCI on every 120V 15A and 20A branch circuit except the bathroom receptacle circuits (210.12); GFCI at bathrooms, kitchen counters, laundry, dishwasher, exterior and within 6' of any sink (210.8).
3. Accessible mounting: every wall receptacle, 240V outlet and data outlet 30" AFF to centre; switches, dimmers and the GFCI receptacles above counters and vanities 42" AFF (reach range 15"–48"). Rocker switches throughout; no device above a counter deeper than 20".
4. Switch plan: every light belongs to one switch leg (table below). On the page, clicking a light highlights every light and switch on its leg; clicking a switch highlights every leg it serves. A switch tag that appears in several legs is a multi-gang bank, one rocker per leg.
5. Circuit sheets E-1.1 onward show one circuit each with its cable run drawn as a chain from P2 through every device in nearest-neighbour order (solid for receptacle and appliance circuits, dashed for lighting). The run is a proposed order, not a required one. E-1.D shows the Cat6 home runs to the media panel beside P2.
6. Sub-panel P2 and the media panel face the landing on wall 1. Bedroom 3's TV moves to wall 7: wall 10 is the closet door and the Jack & Jill pocket from end to end.
7. Kitchen: two 20A small-appliance circuits (7, 8). Island receptacles are pop-up units in the counter at the sink end and the prep end plus one in each end panel; the wall run has counter receptacles at 42". Cooktop, oven, refrigerator/freezer, dishwasher drawers and microwave drawer each on a dedicated circuit. Hood ducted 6" up through the roof.
8. Lighting: 4" recessed LED cans, 2700K, dimmable, on 0–10V or Lutron Caséta-type dimmers; wet-rated cans over the shower pad and tubs; closet fixtures surface LED with 12" clearance to shelves (410.16). Pendants over the island and the dining table. Hallway, stair and the great room on 3-way or multi-location dimmers.
9. Smoke alarms in every bedroom and the office; smoke + CO combination alarms outside each sleeping area (hall at the office, outside the master suite, wing hall, den). All 120V, interconnected, battery backup (IRC R314, R315).
10. Bath exhaust fans 110 CFM with humidity sensing, ducted to the exterior in rigid duct: powder and master bath to the north wall, WC to the east wall, suite bath and Jack & Jill up through the roof. Dryer: 4" rigid metal, up through the roof, 35' equivalent max.
11. TV locations get a recessed box with power and 2 × Cat6 at 60" AFF (no coax: everything streams); data outlets home-run to the media panel beside P2 on the landing (Cat6 to every TV, the office desk and the elevator hall for the controller).
12. Exterior soffits: LED downlights the length of the west soffit on one switch inside the deck door; on the east, three lights over the exit door on switch leg A and the rest of the east soffit on leg B, both rockers inside the east door (circuit 26). Weatherproof GFCI receptacles in the soffit at both ends of the west wall, at the deck door, and beside the east door (circuit 24).
13. Low voltage (purple on E-1.D): an 18/2 drop in 1/2" conduit at the head of every unblinded window for motorised shades (pull 18/4 instead where the shade brand wants wired control), at the island base for LED and charging, and at both kitchen cabinet runs for under-cabinet LED, all home-run to a driver board in the mech room on circuit 30. Cat6 also to the east door (doorbell, camera, lock at 48") and to a 2-gang touchscreen box on the dining face of wall 19, 12'-6" from east ext. wall, 48" AFF.

14. Kitchen: the induction cooktop is in the island (circuit 1-2, junction in the island base) with a downdraft vent whose blower and 6" duct run in the floor to the west wall (P-1). The wall run keeps the oven and the refrigerator/freezer plus a tall cabinet.
15. Elevator: 240V 30A and 120V 15A (car light and hoistway) from the main panel with a lockable disconnect at the machine space, telephone line in the car, all by the elevator contractor. Not on P2.

Open items

- Confirm the feeder route from the main panel to the mech closet, and the main panel's spare capacity (the 125A sub-panel assumes about 20 kVA of new load).
- Lighting control: simple dimmers as drawn, or a smart-home system (Caséta, RadioRA 3) with keypads at the bedside and the entry?
- Ceiling fans: fan-rated boxes are shown in the master, 2nd Suite and Bedrooms 3 and 4. Keep, or drop in favour of the cans?
- Receptacle finish and colour, and whether the kitchen pop-ups should include USB (nightstands get USB-C).
- Low-voltage: any ceiling speakers, and a camera at the west door to match the east.

Schedules

Circuit schedule, sub-panel P2

P2: 125A main-lug sub-panel in the mech closet, fed from the main panel below with #1 Cu (or 2/0 Al) THHN in 1-1/4" conduit, 4-wire, isolated neutral, bonded ground. Size by the NEC 220 load calculation; 125A assumed. The elevator keeps its own 240V 30A + 120V 15A feeds and disconnect from the main panel, by the elevator contractor.

Ckt	Load	Breaker	Wire	Serves	Devices
1-2	Induction cooktop	240V 40A 2P	#8 Cu	kitchen wall run	1
3-4	Wall oven, side-opening	240V 30A 2P	#10 Cu	kitchen wall run	1
5-6	Dryer	240V 30A 2P	#10 Cu	laundry	1
7	Kitchen small appliance 1	20A GFCI/AFCI	#12	island sink end, wall run	3
8	Kitchen small appliance 2 + pantry	20A GFCI/AFCI	#12	island prep end, wall run, pantry	4
9	Refrigerator	20A AFCI	#12	kitchen	1
10	Spare	20A	#12	—	0
11	Dishwasher drawers	20A GFCI/AFCI	#12	island	1
12	Microwave drawer	20A AFCI	#12	island	1
13	Laundry: washer, sink, counter	20A GFCI/AFCI	#12	laundry	3
14	Bath receptacles west	20A GFCI	#12	master bath, WC, powder	3
15	Bath receptacles east	20A GFCI	#12	suite bath, Jack & Jill	3

Ckt	Load	Breaker	Wire	Serves	Devices
16	Master suite receptacles	15A AFCI	#14	master bedroom, walk-in	9
17	Bedrooms 3 and 4 receptacles	15A AFCI	#14	bedrooms 3, 4, closets, wing hall	15
18	2nd Suite receptacles	15A AFCI	#14	2nd Suite	7
19	Living and dining receptacles	15A AFCI	#14	living, hallway, dining, east entry	15
20	Den, office, passage receptacles	15A AFCI	#14	den, office, passage, elevator hall	19
21	Lighting A	15A AFCI	#14	living, dining, kitchen, den, office, baths	58
22	Lighting B + alarms	15A AFCI	#14	bedrooms, closets, halls, stair, smoke/CO alarms	62
23	Exhaust fans + hood	15A AFCI	#14	five bath fans, range hood	6
24	Exterior receptacles	20A GFCI	#12	soffit receptacles, west and east	4
25	Mech closet: ventilation unit	15A	#14	ERV / vents, service receptacle	3
26	Exterior soffit lighting	15A	#14	west soffit, east door group, east soffit; three switch legs	21
27-28	Spare 2P	240V 30A 2P	—	future (sauna, EV on deck, etc.)	0
29	Spare	20A	#12	—	0
30	Low-voltage power supplies	15A	#14	shade and LED drivers in the mech room	15

Switch plan

One row per switch leg. Click a row to light up its switch and lights on the drawing.

Leg	What	Room	Switch(es)	Lights	Control	Notes
stair	Stair and landing	stair	S1 3-way switch (stair light, top; 3-way with the bottom of the stair (floor below))	L4 4" recessed LED, L5 4" recessed LED, L3 4" recessed LED	3-way with a switch at the bottom of the stair (floor below)	the elevator-hall can rides this leg so the arrival is never dark
mech	Mech room	mech room	—	L1 surface LED ceiling fixture, L2 surface LED ceiling fixture	integral occupancy sensors, no switch	the room has no door
office	Office cans	office	S2 dimmer (office door)	L6 4" recessed LED, L7 4" recessed LED, L8 4" recessed LED, L9 4" recessed LED	dimmer at the office door	
passage	Passage and hall cans	passage, hall	S3 3-way switch (passage lights, stair end); S4 3-way switch (passage lights, dining end)	L10 4" recessed LED, L11 4" recessed LED, L12 4" recessed LED, L13 4" recessed LED, L14 4" recessed LED	3-way: stair end and dining end	
powder-light	Powder room light and sconce	powder	S5 switch (powder: light + fan, two rockers)	L15 4" recessed LED, L16 wall sconce / vanity light	rocker 1 of a 2-gang at the door	

Leg	What	Room	Switch(es)	Lights	Control	Notes
powder - fan	Powder room fan	powder	S5 switch (powder: light + fan, two rockers)	L17 exhaust fan	rocker 2, with a 20-minute timer	
walkin	Walk-in closet	walk-in	S6 occupancy-sensor switch (walk-in, beyond the pocket of D12)	L18 surface LED, L19 surface LED	occupancy-sensor switch	
master - cans	Master bedroom cans	master bedroom	S7 dimmer (at the bedroom pocket door D13, strike side; 3-way with the bedside); S8 3-way switch (bedside, reachable from the bed)	L20 4" recessed LED, L21 4" recessed LED, L22 4" recessed LED, L23 4" recessed LED	3-way dimmer: door and bedside	the bedside switch is reachable from the bed
master - fan	Master bedroom fan box	master bedroom	S7 dimmer (at the bedroom pocket door D13, strike side; 3-way with the bedside)	L24 fan-rated ceiling box	rocker 2 at the door; fan speed from the fan remote	
mbath - cans	Master bath general can	master bath	S9 dimmer (bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers))	L27 4" recessed LED	rocker 1 of the 5-gang bank at the bath door	
mbath - shower	Shower light	master bath	S9 dimmer (bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers))	L25 4" recessed LED	rocker 2	wet-location can over the pad
mbath - tub	Tub light	master bath	S9 dimmer (bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers))	L26 4" recessed LED	rocker 3, dimmer	
mbath - sconces	Vanity sconces	master bath	S9 dimmer (bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers))	L28 wall sconce / vanity light, L29 wall sconce / vanity light	rocker 4, dimmer	
mbath - fan	Master bath fan	master bath	S9 dimmer (bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers))	L30 exhaust fan	rocker 5, humidity sensing runs it anyway	
wc - light	WC light	WC	S10 switch (WC: light + fan)	L31 4" recessed LED	rocker 1 of a 2-gang inside the WC door	
wc - fan	WC fan	WC	S10 switch (WC: light + fan)	L32 exhaust fan	rocker 2, timer	
living	Living cans	living	S11 dimmer (living cans, elevator end; 3-way); S12 dimmer (living cans, deck door; 3-way; exterior light)	L33 4" recessed LED, L34 4" recessed LED, L35 4" recessed LED, L36 4" recessed LED, L37 4" recessed LED, L38 4" recessed LED	3-way dimmer: elevator end and deck door	
hall - west	West hallway cans	hallway	S11 dimmer (living cans, elevator end; 3-way); S12 dimmer (living cans, deck door; 3-way; exterior light)	L39 4" recessed LED, L40 4" recessed LED, L41 4" recessed LED, L42 4" recessed LED	3-way, rocker 2 at both ends	

Leg	What	Room	Switch(es)	Lights	Control	Notes
west-soffit	West soffit lights	exterior, deck side	S12 dimmer (living cans, deck door; 3-way; exterior light)	L91 exterior soffit downlight, L92 exterior soffit downlight, L93 exterior soffit downlight, L94 exterior soffit downlight, L95 exterior soffit downlight, L96 exterior soffit downlight, L97 exterior soffit downlight, L98 exterior soffit downlight, L99 exterior soffit downlight	rocker 3 inside the deck door; photocell or timer optional	circuit 26
dining-pendant	Dining pendant	dining	S13 dimmer (dining pendant + cans, on wall 19 at the master bedroom door)	L43 pendant	dimmer, rocker 1 on wall 19	
dining-cans	Dining and east entry cans	dining	S13 dimmer (dining pendant + cans, on wall 19 at the master bedroom door)	L44 4" recessed LED, L45 4" recessed LED, L46 4" recessed LED	dimmer, rocker 2	
east-door	East door soffit lights (3)	exterior, east door	S14 switch (east door: two rockers, three door lights and the whole east soffit)	L100 exterior soffit downlight, L101 exterior soffit downlight, L102 exterior soffit downlight	rocker A inside the east door	
east-soffit	Whole east soffit	exterior, east	S14 switch (east door: two rockers, three door lights and the whole east soffit)	L103 exterior soffit downlight, L104 exterior soffit downlight, L105 exterior soffit downlight, L106 exterior soffit downlight, L107 exterior soffit downlight, L108 exterior soffit downlight, L109 exterior soffit downlight, L110 exterior soffit downlight	rocker B inside the east door	the three door lights stay on rocker A; rocker B adds the rest
kitchen-pendants	Island pendants	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way); S16 3-way switch (kitchen, dining end beside the laundry door; 3-way)	L49 pendant, L50 pendant, L51 pendant	3-way dimmer: hall end and dining end	
kitchen-cans	Kitchen aisle cans	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way); S16 3-way switch (kitchen, dining end beside the laundry door; 3-way)	L52 4" recessed LED, L53 4" recessed LED, L54 4" recessed LED	3-way dimmer, rocker 2	
kitchen-shelf	Under-shelf strip	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way)	L48 linear LED under shelf / cabinet	rocker 3 at the hall end	
downdraft	Cooktop downdraft	kitchen	—	L47 downdraft cooktop vent	controls on the unit	no wall switch
pantry	Pantry light	pantry	S17 occupancy-sensor switch (pantry, inside the door)	L55 surface LED ceiling fixture	occupancy-sensor switch inside the opening	
wing-hall	Wing hall cans	wing hallway	S18 3-way switch (wing hall, kitchen end); S19 3-way switch (wing hall, dining end)	L56 4" recessed LED, L57 4" recessed LED, L58 4" recessed LED	3-way: kitchen end and dining end	
laundry	Laundry lights	laundry	S20 switch (laundry, inside the door)	L59 surface LED ceiling fixture, L60 surface LED ceiling fixture	single switch inside the door	

Leg	What	Room	Switch(es)	Lights	Control	Notes
suite-bath-light	Suite bath can and sconce	suite bath	S21 switch (suite bath: can, sconce, fan)	L61 4" recessed LED, L62 wall sconce / vanity light	rocker 1 of a 2-gang inside the door	
suite-bath-fan	Suite bath fan	suite bath	S21 switch (suite bath: can, sconce, fan)	L63 exhaust fan	rocker 2, timer	
den	Den cans	den	S22 dimmer (den cans)	L64 4" recessed LED, L65 4" recessed LED, L66 4" recessed LED, L67 4" recessed LED	dimmer at the den opening	
mini-cans	2nd Suite cans	2nd Suite	S23 dimmer (2nd Suite door; 3-way); S24 3-way switch (bedside)	L68 4" recessed LED, L69 4" recessed LED, L70 4" recessed LED, L71 4" recessed LED	3-way dimmer: door and bedside	
mini-closet	2nd Suite wardrobe light	2nd Suite	S23 dimmer (2nd Suite door; 3-way)	L72 surface LED	rocker 2 at the door	
mini-fan	2nd Suite fan box	2nd Suite	S24 3-way switch (bedside)	L73 fan-rated ceiling box	rocker 2 at the bedside; speed from the fan remote	
bed4-cans	Bedroom 4 cans	Bedroom 4	S25 dimmer (Bedroom 4 door)	L74 4" recessed LED, L75 4" recessed LED, L76 4" recessed LED, L77 4" recessed LED	dimmer at the door	
bed4-fan	Bedroom 4 fan box	Bedroom 4	S25 dimmer (Bedroom 4 door)	L78 fan-rated ceiling box	rocker 2 at the door	
closet4	Closet 4	closet 4	S26 occupancy-sensor switch (closet 4)	L79 surface LED	occupancy-sensor switch	
jj-lights	Jack & Jill lights	Jack & Jill	S27 3-way switch (Bedroom 3 door: lights + fan, 3-way); S28 3-way switch (Bedroom 4 door: lights + fan, 3-way)	L80 4" recessed LED, L81 4" recessed LED, L82 wall sconce / vanity light, L83 wall sconce / vanity light	3-way at both doors, rocker 1	
jj-fan	Jack & Jill fan	Jack & Jill	S27 3-way switch (Bedroom 3 door: lights + fan, 3-way); S28 3-way switch (Bedroom 4 door: lights + fan, 3-way)	L84 exhaust fan	3-way at both doors, rocker 2, timer	
bed3-cans	Bedroom 3 cans	Bedroom 3	S29 dimmer (Bedroom 3 door)	L85 4" recessed LED, L86 4" recessed LED, L87 4" recessed LED, L88 4" recessed LED	dimmer at the door	
bed3-fan	Bedroom 3 fan box	Bedroom 3	S29 dimmer (Bedroom 3 door)	L89 fan-rated ceiling box	rocker 2 at the door	
closet3	Closet 3	closet 3	S30 occupancy-sensor switch (closet 3)	L90 surface LED	occupancy-sensor switch	

Device schedule

Tag	Device	Position	AFF	Circuit	Notes
X1	sub-panel P2, 125A, 30 space	on W1, 4'-10" from north ext. wall	60"	—	Sub-panel P2 on wall 1, landing face, top of cabinet 72" AFF; 36" clear in front on the landing
X2	media panel: Cat6 home runs, network switch	on W1, 3'-1" from north ext. wall	54"	—	Media panel beside P2 on the landing face of wall 1: every Cat6 home-runs here
R1	receptacle, 20A dedicated	on the north ext. wall, 2'-1" from west ext. wall	30"	25	ventilation unit (ERV) service receptacle
L1	surface LED ceiling fixture	2'-1" from west ext. wall, 3'-0" from north ext. wall	108"	25	mech room, fixture with integral occupancy sensor (no door, no switch)
L2	surface LED ceiling fixture	1'-4" from north ext. wall, 5'-11" from west ext. wall	108"	25	vent leg, fixture with integral occupancy sensor
L3	4" recessed LED, 2700K, IC, dimmable	1'-11" from west ext. wall, 2'-1" from W4	108"	22	elevator hall
R2	duplex receptacle, 15A	on the west ext. wall, 2'-1" from W4	30"	20	elevator hall
L4	4" recessed LED, 2700K, IC, dimmable	1'-6" from W28, 4'-10" from W27	108"	22	over the stair
L5	4" recessed LED, 2700K, IC, dimmable	1'-6" from W1, 1'-7" from W5	108"	22	landing
S1	3-way switch, rocker	on W5 south face, 6" from W1	42"	22	stair light, top; 3-way with the bottom of the stair (floor below)
L6	4" recessed LED, 2700K, IC, dimmable	2'-4" from W26, 2'-9" from W28	108"	21	
L7	4" recessed LED, 2700K, IC, dimmable	2'-4" from W26, 3'-0" from W29	108"	21	
L8	4" recessed LED, 2700K, IC, dimmable	2'-4" from W27, 2'-9" from W28	108"	21	
L9	4" recessed LED, 2700K, IC, dimmable	2'-4" from W27, 3'-0" from W29	108"	21	
S2	dimmer, rocker	on W29 west face, 4'-5" from W27	42"	21	office door
R3	duplex receptacle, 15A	on W26 south face, 2'-3" from W28	30"	20	
R4	data outlet, 2 × Cat6	on W26 south face, 5'-3" from W28	30"	—	desk
R5	duplex receptacle, 15A	on W26 south face, 4'-0" from W29	30"	20	
R6	duplex receptacle, 15A	on W27 north face, 1'-9" from W28	30"	20	
R7	duplex receptacle, 15A	on W27 north face, 4'-6" from W29	30"	20	
R8	duplex receptacle, 15A	on W28 east face, 1'-10" from W26	30"	20	
R9	duplex receptacle, 15A	on W28 east face, 3'-4" from W27	30"	20	
R10	duplex receptacle, 15A	on W29 west face, 1'-10" from W26	30"	20	
A1	smoke alarm, 120V interconnected w/ battery	4'-10" from W27, 5'-8" from W29	108"	22	office (could serve as a bedroom)

Tag	Device	Position	AFF	Circuit	Notes
L10	4" recessed LED, 2700K, IC, dimmable	3'-0" from north ext. wall, 6'-7" from W1	108"	22	
L11	4" recessed LED, 2700K, IC, dimmable	3'-0" from north ext. wall, 7'-4" from W18	108"	22	
L12	4" recessed LED, 2700K, IC, dimmable	2'-5" from W18, 5'-6" from north ext. wall	108"	22	
L13	4" recessed LED, 2700K, IC, dimmable	2'-5" from W18, 11'-6" from north ext. wall	108"	22	
L14	4" recessed LED, 2700K, IC, dimmable	17'-6" from north ext. wall, 21'-11" from west ext. wall	108"	22	
S3	3-way switch, rocker	on W26 north face, 4'-1" from W1	42"	22	passage lights, stair end
S4	3-way switch, rocker	on W18 west face, 20'-6" from north ext. wall	42"	22	passage lights, dining end
R11	duplex receptacle, 15A	on the north ext. wall, 3'-9" from W33	30"	20	
R12	duplex receptacle, 15A	on the north ext. wall, 3'-10" from W18	30"	20	
R13	duplex receptacle, 15A	on W18 west face, 8'-6" from north ext. wall	30"	20	
R14	duplex receptacle, 15A	on W18 west face, 17'-6" from north ext. wall	30"	20	
A2	smoke + CO alarm, 120V interconnected w/ battery	2'-5" from W18, 8'-6" from north ext. wall	108"	22	hall outside the office
L15	4" recessed LED, 2700K, IC, dimmable	2'-4" from W18, 3'-6" from north ext. wall	108"	21	
L16	wall sconce / vanity light	on the north ext. wall, 1'-3" from W20	72"	21	over the powder lav
L17	exhaust fan, 110 CFM, humidity sensing	2'-4" from W18, 5'-0" from north ext. wall	108"	23	powder, duct to the north wall
S5	switch, rocker	on W18 east face, 3'-11" from north ext. wall	42"	21	powder: light + fan, two rockers
R15	GFCI receptacle, 20A	on the north ext. wall, 2'-8" from W18	42"	14	42" AFF beside the lav
L18	surface LED, closet-rated (NEC 410.16)	2'-10" from W18, 3'-3" from W21	108"	22	
L19	surface LED, closet-rated (NEC 410.16)	2'-10" from W18, 4'-2" from W22	108"	22	
S6	occupancy-sensor switch	on W20 west face, 2'-5" from W22	42"	22	walk-in, beyond the pocket of D12
R16	duplex receptacle, 15A	on W22 north face, 2'-10" from W18	30"	16	
L20	4" recessed LED, 2700K, IC, dimmable	3'-10" from W23, 12'-6" from east ext. wall	108"	22	

Tag	Device	Position	AFF	Circuit	Notes
L21	4" recessed LED, 2700K, IC, dimmable	3'-10" from W23, 4'-6" from east ext. wall	108"	22	
L22	4" recessed LED, 2700K, IC, dimmable	5'-2" from W19, 13'-0" from east ext. wall	108"	22	
L23	4" recessed LED, 2700K, IC, dimmable	2'-0" from east ext. wall, 5'-2" from W19	108"	22	
L24	fan-rated ceiling box, switched	8'-4" from east ext. wall, 8'-5" from W23	108"	22	room centre
S7	dimmer, rocker	on W20 east face, 6'-11" from W19	42"	22	at the bedroom pocket door D13, strike side; 3-way with the bedside
S8	3-way switch, rocker	on W19 north face, 11'-1" from east ext. wall	42"	22	bedside, reachable from the bed
R17	duplex receptacle with USB-C, 15A	on W19 north face, 12'-6" from east ext. wall	30"	16	nightstand
R18	duplex receptacle with USB-C, 15A	on W19 north face, 2'-0" from east ext. wall	30"	16	nightstand
R19	duplex receptacle, 15A	on the east ext. wall, 10" from W23	30"	16	
R20	duplex receptacle, 15A	on the east ext. wall, 7'-10" from W23	30"	16	
R21	duplex receptacle, 15A	on the east ext. wall, 8" from W19	30"	16	
R22	recessed TV box: power + 2 × Cat6	on W23 south face, 7'-0" from east ext. wall	60"	16	TV on wall 23, 60" AFF
R23	duplex receptacle, 15A	on W23 south face, 3'-0" from east ext. wall	30"	16	
R24	duplex receptacle, 15A	on W20 east face, 8'-2" from W19	30"	16	
A3	smoke + CO alarm, 120V interconnected w/ battery	4'-10" from W23, 8'-4" from east ext. wall	108"	22	master bedroom
L25	4" recessed LED, wet location (shower / tub)	3'-4" from W20, 4'-8" from north ext. wall	108"	21	over the shower pad
L26	4" recessed LED, wet location (shower / tub)	1'-6" from north ext. wall, 6'-0" from east ext. wall	108"	21	over the tub
L27	4" recessed LED, 2700K, IC, dimmable	3'-5" from W25, 6'-0" from north ext. wall	108"	21	
L28	wall sconce / vanity light	on W23 north face, 5'-4" from W25	72"	21	vanity, left, beyond the D18 pocket
L29	wall sconce / vanity light	on W23 north face, 1'-9" from W25	72"	21	vanity, right
L30	exhaust fan, 110 CFM, humidity sensing	4'-6" from north ext. wall, 5'-5" from W25	108"	23	master bath, between shower and tub; duct to the north wall

Tag	Device	Position	AFF	Circuit	Notes
S9	dimmer, rocker	on W20 east face, 10'-1" from north ext. wall	42"	21	bath bank at the 6' opening: cans, shower, tub, sconces, fan (5 rockers)
R25	GFCI receptacle, 20A	on W23 north face, 3'-9" from W25	42"	14	vanity, 42" AFF, within 3' of both basins
L31	4" recessed LED, 2700K, IC, dimmable	1'-8" from east ext. wall, 3'-0" from W24	108"	21	WC
L32	exhaust fan, 110 CFM, humidity sensing	1'-2" from east ext. wall, 1'-6" from W24	108"	23	WC, duct to the east wall
S10	switch, rocker	on W25 east face, 2'-3" from W23	42"	21	WC: light + fan
R26	GFCI receptacle, 20A	on the east ext. wall, 1'-6" from W23	42"	14	bidet seat, beside the toilet
L33	4" recessed LED, 2700K, IC, dimmable	4'-4" from W27, 7'-6" from west ext. wall	108"	21	
L34	4" recessed LED, 2700K, IC, dimmable	4'-4" from W27, 14'-6" from west ext. wall	108"	21	
L35	4" recessed LED, 2700K, IC, dimmable	20'-6" from north ext. wall, 21'-6" from west ext. wall	108"	21	
L36	4" recessed LED, 2700K, IC, dimmable	7'-6" from west ext. wall, 13'-4" from W27	108"	21	
L37	4" recessed LED, 2700K, IC, dimmable	13'-4" from W27, 14'-6" from west ext. wall	108"	21	
L38	4" recessed LED, 2700K, IC, dimmable	21'-6" from west ext. wall, 29'-6" from north ext. wall	108"	21	
L39	4" recessed LED, 2700K, IC, dimmable	2'-6" from west ext. wall, 9'-9" from W4	108"	21	
L40	4" recessed LED, 2700K, IC, dimmable	2'-6" from west ext. wall, 16'-4" from W14	108"	21	
L41	4" recessed LED, 2700K, IC, dimmable	2'-6" from west ext. wall, 8'-4" from W14	108"	21	
L42	4" recessed LED, 2700K, IC, dimmable	1'-10" from W14, 2'-6" from west ext. wall	108"	21	
S11	dimmer, rocker	on W27 south face, 4'-10" from west ext. wall	42"	21	living cans, elevator end; 3-way
S12	dimmer, rocker	on the west ext. wall, 2'-0" from W14	42"	21	living cans, deck door; 3-way; exterior light
R27	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 44'-6" from the north brick corner	24"	24	west soffit receptacle at the deck door
R28	duplex receptacle, 15A	on the west ext. wall, 6'-9" from W4	30"	19	
R29	duplex receptacle, 15A	on the west ext. wall, 14'-9" from W4	30"	19	

Tag	Device	Position	AFF	Circuit	Notes
R30	duplex receptacle, 15A	on the west ext. wall, 10'-4" from W14	30"	19	
R31	duplex receptacle, 15A	on the west ext. wall, 10" from W14	30"	19	
R32	duplex receptacle, 15A	on W27 south face, 9'-6" from west ext. wall	30"	19	
R33	recessed TV box: power + 2 × Cat6	on W27 south face, 11'-8" from west ext. wall	60"	19	living TV centred on wall 27
R34	duplex receptacle, 15A	on W27 south face, 15'-6" from west ext. wall	30"	19	
R35	floor box receptacle	4'-6" from west ext. wall, 10'-4" from W27	—	19	under the north sofa
R36	floor box receptacle	10'-4" from W27, 18'-6" from west ext. wall	—	19	under the south sofa
A4	smoke + CO alarm, 120V interconnected w/ battery	6" from W22, 27'-0" from west ext. wall	108"	22	outside the master suite door
L43	pendant	12'-0" from W22, 20'-6" from east ext. wall	108"	21	over the table, dimmed
L44	4" recessed LED, 2700K, IC, dimmable	1'-6" from W19, 14'-0" from east ext. wall	108"	21	
L45	4" recessed LED, 2700K, IC, dimmable	4'-4" from W32, 14'-0" from east ext. wall	108"	21	
L46	4" recessed LED, 2700K, IC, dimmable	5'-0" from W19, 5'-6" from east ext. wall	108"	21	east entry
S13	dimmer, rocker	on W19 south face, 15'-8" from east ext. wall	42"	21	dining pendant + cans, on wall 19 at the master bedroom door
S14	switch, rocker	on the east ext. wall, 1'-9" from W19	42"	26	east door: two rockers, three door lights and the whole east soffit
R37	weatherproof GFCI receptacle, in-use cover	3.5" out from the east brick, 38'-10" from the north brick corner	24"	24	east soffit receptacle beside the door
R38	duplex receptacle, 15A	on W19 south face, 13'-6" from east ext. wall	30"	19	
R39	duplex receptacle, 15A	on W19 south face, 6'-6" from east ext. wall	30"	19	
R40	duplex receptacle, 15A	on W19 south face, 1'-6" from east ext. wall	30"	19	
R41	duplex receptacle, 15A	on the east ext. wall, 1'-0" from W19	30"	19	
R42	duplex receptacle, 15A	on W32 north face, 29'-6" from west ext. wall	30"	19	

Tag	Device	Position	AFF	Circuit	Notes
R43	duplex receptacle, 15A	on W32 north face, 34'-6" from west ext. wall	30"	19	
R44	pop-up counter receptacle, 20A GFCI	9'-3" from W16, 9'-6" from west ext. wall	34"	7	island, sink end
R45	pop-up counter receptacle, 20A GFCI	21'-0" from west ext. wall, 39'-7" from north ext. wall	34"	8	island, prep end
R46	duplex receptacle, 15A	6'-3" from W14, 8'-1" from west ext. wall	30"	7	island end panel
R47	duplex receptacle, 15A	22'-5" from west ext. wall, 39'-7" from north ext. wall	30"	8	island end panel
R48	receptacle, 20A dedicated	9'-3" from W16, 15'-6" from west ext. wall	30"	11	dishwasher drawers, under the island
R49	receptacle, 20A dedicated	9'-3" from W16, 17'-10" from west ext. wall	30"	12	microwave drawer, island
R50	receptacle, 20A dedicated	on W16 north face, 1'-4" from W15	30"	9	refrigerator / freezer, recessed box
R51	240V receptacle or junction	on W16 north face, 6'-6" from W15	30"	3-4	wall oven, side-opening
R52	240V receptacle or junction	19'-10" from west ext. wall, 39'-7" from north ext. wall	30"	1-2	induction cooktop in the island, junction below the counter
R53	GFCI receptacle, 20A	on W16 north face, 8'-3" from W15	42"	7	counter, 42" AFF
R54	GFCI receptacle, 20A	on W16 north face, 6'-0" from W31	42"	8	counter, 42" AFF
L47	downdraft cooktop vent, blower in the island, ducted in the floor	21'-1" from west ext. wall, 39'-7" from north ext. wall	—	23	downdraft blower in the island, 6" duct in the floor to the west wall (P-1)
L48	linear LED under shelf / cabinet	on W16 north face, 8'-3" from W31	54"	21	under the shelf, 5'-3"—11'-3" from W31
L49	pendant	9'-3" from W16, 11'-6" from west ext. wall	108"	21	
L50	pendant	9'-3" from W16, 15'-0" from west ext. wall	108"	21	
L51	pendant	9'-3" from W16, 19'-0" from west ext. wall	108"	21	
L52	4" recessed LED, 2700K, IC, dimmable	4'-10" from W16, 10'-6" from west ext. wall	108"	21	
L53	4" recessed LED, 2700K, IC, dimmable	4'-10" from W16, 15'-6" from west ext. wall	108"	21	
L54	4" recessed LED, 2700K, IC, dimmable	20'-6" from west ext. wall, 44'-0" from north ext. wall	108"	21	

Tag	Device	Position	AFF	Circuit	Notes
S15	dimmer, rocker	on W14 north face, 6'-11" from west ext. wall	42"	21	kitchen: pendants, cans, shelf light; 3-way
S16	3-way switch, rocker	on W31 west face, 8'-3" from W7	42"	21	kitchen, dining end beside the laundry door; 3-way
L55	surface LED ceiling fixture	3'-11" from W14, 4'-0" from west ext. wall	108"	21	pantry
S17	occupancy-sensor switch	on W14 south face, 6'-6" from west ext. wall	42"	21	pantry, inside the door
R55	duplex receptacle, 15A	on W7 north face, 4'-0" from west ext. wall	30"	8	pantry
L56	4" recessed LED, 2700K, IC, dimmable	2'-4" from W15, 2'-5" from W16	108"	22	
L57	4" recessed LED, 2700K, IC, dimmable	2'-5" from W16, 8'-10" from W15	108"	22	
L58	4" recessed LED, 2700K, IC, dimmable	4'-3" from W31, 51'-7" from north ext. wall	108"	22	
S18	3-way switch, rocker	on W15 east face, 2'-4" from W16	42"	22	wing hall, kitchen end
S19	3-way switch, rocker	on W31 west face, 2'-6" from W7	42"	22	wing hall, dining end
R56	duplex receptacle, 15A	on W7 north face, 7'-4" from W15	30"	17	
A5	smoke + CO alarm, 120V interconnected w/ battery	2'-5" from W16, 7'-9" from W31	108"	22	wing hall outside Bedrooms 3 and 4
R57	240V receptacle or junction	on W17 west face, 3'-6" from W32	30"	5-6	dryer; recessed dryer box in wall 17 for the vent and cord
R58	receptacle, 20A dedicated	on W17 west face, 2'-3" from W32	30"	13	washer
R59	GFCI receptacle, 20A	on W17 west face, 1'-0" from W30	42"	13	laundry sink, 42" AFF
R60	duplex receptacle, 15A	on W32 south face, 2'-11" from W31	30"	13	folding counter
L59	surface LED ceiling fixture	2'-4" from W32, 3'-5" from W31	108"	22	
L60	surface LED ceiling fixture	1'-6" from W30, 3'-5" from W31	108"	22	
S20	switch, rocker	on W31 east face, 2'-10" from W30	42"	22	laundry, inside the door
L61	4" recessed LED, 2700K, IC, dimmable	2'-6" from W7, 3'-0" from W9	108"	21	
L62	wall sconce / vanity light	on W30 south face, 1'-6" from W9	72"	21	over the suite vanity
L63	exhaust fan, 110 CFM, humidity sensing	2'-3" from W7, 2'-11" from W31	108"	23	suite bath, duct up through the roof
S21	switch, rocker	on W9 west face, 1'-6" from W30	42"	21	suite bath: can, sconce, fan
R61	GFCI receptacle, 20A	on W30 south face, 3'-4" from W9	42"	15	suite vanity, 42" AFF
L64	4" recessed LED, 2700K, IC, dimmable	8'-0" from east ext. wall, 8'-10" from W8	108"	21	
L65	4" recessed LED, 2700K, IC, dimmable	2'-10" from W8, 8'-0" from east ext. wall	108"	21	

Tag	Device	Position	AFF	Circuit	Notes
L66	4" recessed LED, 2700K, IC, dimmable	2'-6" from east ext. wall, 8'-10" from W8	108"	21	
L67	4" recessed LED, 2700K, IC, dimmable	2'-6" from east ext. wall, 2'-10" from W8	108"	21	
S22	dimmer, rocker	on W17 east face, 9'-10" from W19	42"	21	den cans
R62	duplex receptacle, 15A	on W17 east face, 9'-4" from W8	30"	20	
R63	recessed TV box: power + 2 × Cat6	on W17 east face, 5'-10" from W8	60"	20	den TV on wall 17
R64	duplex receptacle, 15A	on W17 east face, 2'-4" from W8	30"	20	
R65	duplex receptacle, 15A	on W8 north face, 9'-6" from east ext. wall	30"	20	
R66	duplex receptacle, 15A	on W8 north face, 2'-0" from east ext. wall	30"	20	
R67	duplex receptacle, 15A	on the east ext. wall, 9'-10" from W8	30"	20	
R68	duplex receptacle, 15A	on the east ext. wall, 1'-6" from W8	30"	20	
A6	smoke + CO alarm, 120V interconnected w/ battery	5'-6" from east ext. wall, 5'-10" from W8	108"	22	den, outside the 2nd Suite
L68	4" recessed LED, 2700K, IC, dimmable	7'-0" from east ext. wall, 14'-0" from south ext. wall	108"	22	
L69	4" recessed LED, 2700K, IC, dimmable	2'-6" from east ext. wall, 14'-0" from south ext. wall	108"	22	
L70	4" recessed LED, 2700K, IC, dimmable	5'-0" from south ext. wall, 6'-6" from east ext. wall	108"	22	
L71	4" recessed LED, 2700K, IC, dimmable	2'-6" from east ext. wall, 5'-0" from south ext. wall	108"	22	
L72	surface LED, closet-rated (NEC 410.16)	3'-6" from south ext. wall, 9'-10" from east ext. wall	108"	22	wardrobe strip
L73	fan-rated ceiling box, switched	5'-6" from east ext. wall, 9'-6" from south ext. wall	108"	22	
S23	dimmer, rocker	on W8 south face, 4'-11" from east ext. wall	42"	22	2nd Suite door; 3-way
S24	3-way switch, rocker	on W9 east face, 13'-1" from south ext. wall	42"	22	bedside
R69	duplex receptacle with USB-C, 15A	on W9 east face, 14'-0" from south ext. wall	30"	18	nightstand
R70	duplex receptacle with USB-C, 15A	on W9 east face, 5'-6" from south ext. wall	30"	18	nightstand

Tag	Device	Position	AFF	Circuit	Notes
R71	duplex receptacle, 15A	on W8 south face, 2'-0" from east ext. wall	30"	18	
R72	duplex receptacle, 15A	on the east ext. wall, 11'-6" from south ext. wall	30"	18	
R73	recessed TV box: power + 2 × Cat6	on the east ext. wall, 9'-6" from south ext. wall	60"	18	2nd Suite TV on the east wall
R74	duplex receptacle, 15A	on the east ext. wall, 1'-6" from south ext. wall	30"	18	
R75	duplex receptacle, 15A	on the south ext. wall, 2'-0" from east ext. wall	30"	18	
A7	smoke alarm, 120V interconnected w/ battery	2'-8" from east ext. wall, 9'-6" from south ext. wall	108"	22	2nd Suite
L74	4" recessed LED, 2700K, IC, dimmable	3'-6" from W11, 10'-0" from south ext. wall	108"	22	
L75	4" recessed LED, 2700K, IC, dimmable	2'-6" from W9, 10'-0" from south ext. wall	108"	22	
L76	4" recessed LED, 2700K, IC, dimmable	2'-6" from south ext. wall, 3'-6" from W11	108"	22	
L77	4" recessed LED, 2700K, IC, dimmable	2'-6" from south ext. wall, 2'-6" from W9	108"	22	
L78	fan-rated ceiling box, switched	6'-6" from W11, 6'-6" from south ext. wall	108"	22	
S25	dimmer, rocker	on W7 south face, 5'-1" from W11	42"	22	Bedroom 4 door
R76	duplex receptacle with USB-C, 15A	on W9 west face, 8'-6" from south ext. wall	30"	17	nightstand
R77	duplex receptacle with USB-C, 15A	on W9 west face, 11" from south ext. wall	30"	17	nightstand
R78	duplex receptacle, 15A	on W7 south face, 3'-6" from W9	30"	17	
R79	recessed TV box: power + 2 × Cat6	on W7 south face, 5'-0" from W9	60"	17	TV on wall 7
R80	duplex receptacle, 15A	on W11 east face, 7'-6" from south ext. wall	30"	17	
R81	duplex receptacle, 15A	on the south ext. wall, 3'-0" from W11	30"	17	
R82	duplex receptacle, 15A	on the south ext. wall, 1'-0" from W9	30"	17	
A8	smoke alarm, 120V interconnected w/ battery	4'-0" from W9, 6'-6" from south ext. wall	108"	22	Bedroom 4
L79	surface LED, closet-rated (NEC 410.16)	2'-2" from W11, 2'-5" from W7	108"	22	closet 4

Tag	Device	Position	AFF	Circuit	Notes
S26	occupancy-sensor switch	on W11 west face, 4" from W12	42"	22	closet 4
L80	4" recessed LED, 2700K, IC, dimmable	4'-0" from south ext. wall, 4'-8" from W10	108"	21	
L81	4" recessed LED, wet location (shower / tub)	1'-4" from south ext. wall, 4'-8" from W10	108"	21	over the tub
L82	wall sconce / vanity light	on W12 south face, 2'-5" from W10	72"	21	vanity, left
L83	wall sconce / vanity light	on W12 south face, 2'-5" from W11	72"	21	vanity, right
L84	exhaust fan, 110 CFM, humidity sensing	1'-2" from W10, 3'-6" from south ext. wall	108"	23	Jack & Jill, duct up through the roof
S27	3-way switch, rocker	on W10 east face, 6'-6" from south ext. wall	42"	21	Bedroom 3 door: lights + fan, 3-way
S28	3-way switch, rocker	on W11 west face, 6'-6" from south ext. wall	42"	21	Bedroom 4 door: lights + fan, 3-way
R83	GFCI receptacle, 20A	on W12 south face, 4'-8" from W11	42"	15	between the basins, 42" AFF
R84	GFCI receptacle, 20A	on W10 east face, 1'-6" from south ext. wall	42"	15	bidet seat, beside the toilet
L85	4" recessed LED, 2700K, IC, dimmable	3'-6" from west ext. wall, 9'-6" from south ext. wall	108"	22	
L86	4" recessed LED, 2700K, IC, dimmable	9'-6" from south ext. wall, 9'-6" from west ext. wall	108"	22	
L87	4" recessed LED, 2700K, IC, dimmable	3'-0" from south ext. wall, 3'-6" from west ext. wall	108"	22	
L88	4" recessed LED, 2700K, IC, dimmable	3'-0" from south ext. wall, 9'-6" from west ext. wall	108"	22	
L89	fan-rated ceiling box, switched	6'-6" from south ext. wall, 6'-6" from west ext. wall	108"	22	
S29	dimmer, rocker	on W7 south face, 12'-5" from west ext. wall	42"	22	Bedroom 3 door
R85	duplex receptacle with USB-C, 15A	on the west ext. wall, 8'-6" from south ext. wall	30"	17	nightstand
R86	duplex receptacle with USB-C, 15A	on the west ext. wall, 6" from south ext. wall	30"	17	nightstand
R87	duplex receptacle, 15A	on W7 south face, 2'-6" from west ext. wall	30"	17	
R88	duplex receptacle, 15A	on W10 west face, 8'-2" from south ext. wall	30"	17	

Tag	Device	Position	AFF	Circuit	Notes
R89	recessed TV box: power + 2 × Cat6	on W7 south face, 6'-0" from west ext. wall	60"	17	TV on wall 7 (wall 10 is all door and pocket now)
R90	duplex receptacle, 15A	on the south ext. wall, 2'-0" from west ext. wall	30"	17	
R91	duplex receptacle, 15A	on the south ext. wall, 10'-6" from west ext. wall	30"	17	
A9	smoke alarm, 120V interconnected w/ battery	6'-6" from south ext. wall, 8'-6" from west ext. wall	108"	22	Bedroom 3
L90	surface LED, closet-rated (NEC 410.16)	2'-2" from W10, 2'-5" from W7	108"	22	closet 3
S30	occupancy-sensor switch	on W10 east face, 4" from W12	42"	22	closet 3
R92	data outlet, 2 × Cat6	on W6 west face, 2'-1" from W4	30"	—	elevator controller / phone line, on wall 6
R93	data outlet, 2 × Cat6	on the east ext. wall, 9'-6" from W19	48"	—	east door: doorbell / camera / lock
R94	data outlet, 2 × Cat6	on W19 south face, 12'-6" from east ext. wall	48"	—	touchscreen insert on wall 19 (dining face), 2-gang box
X3	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	8'-11" from west ext. wall, 9'-3" from W16	84"	30	island: LED and charging, up through the island base
X4	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on W16 north face, 1'-10" from W15	84"	30	kitchen cabinets, north run: under-cabinet LED driver lead
X5	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on W16 north face, 6'-5" from W31	84"	30	kitchen cabinets, south run: under-cabinet LED driver lead
X6	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 6" from W4	90"	30	window head: motorised shade
X7	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 10'-3" from W4	90"	30	window head: motorised shade
X8	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 13'-11" from W14	90"	30	window head: motorised shade
X9	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 5'-0" from south ext. wall	90"	30	window head: motorised shade
X10	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 14'-8" from south ext. wall	90"	30	window head: motorised shade
X11	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 5'-10" from W8	90"	30	window head: motorised shade
X12	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 3'-8" from W19	90"	30	window head: motorised shade
X13	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 3'-11" from W23	90"	30	window head: motorised shade

Tag	Device	Position	AFF	Circuit	Notes
X14	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the north ext. wall, 5'-11" from east ext. wall	90"	30	window head: motorised shade
X15	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 6'-0" from west ext. wall	90"	30	window head: motorised shade
X16	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 4'-5" from W9	90"	30	window head: motorised shade
X17	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 5'-6" from east ext. wall	90"	30	window head: motorised shade
R95	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 1'-6" from the north brick corner	24"	24	west soffit receptacle, north end
R96	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 66'-6" from the north brick corner	24"	24	west soffit receptacle, south end
L91	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 4'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L92	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 12'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L93	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 20'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L94	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 28'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L95	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 36'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L96	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 46'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L97	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 54'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L98	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 60'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L99	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 66'-0" from the north brick corner	108"	26	west soffit, switched inside the deck door
L100	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 31'-6" from the north brick corner	108"	26	east soffit over the door, switch leg A
L101	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 34'-0" from the north brick corner	108"	26	east soffit over the door, switch leg A
L102	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 36'-6" from the north brick corner	108"	26	east soffit over the door, switch leg A

Tag	Device	Position	AFF	Circuit	Notes
L103	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 4'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L104	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 12'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L105	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 20'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L106	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 27'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L107	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 41'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L108	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 48'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L109	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 56'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L110	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 64'-0" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)

Bill of materials

Bill of materials

Rough-order quantities from the drawing geometry, for pricing. The contractor takes off the final list.

Item	Qty	Notes
4" recessed LED, 2700K, IC, dimmable	56	
duplex receptacle, 15A	53	
exterior soffit downlight, LED, wet location	20	
low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	15	
dimmer, rocker	11	
3-way switch, rocker	10	
GFCI receptacle, 20A	9	
duplex receptacle with USB-C, 15A	8	
wall sconce / vanity light	6	
recessed TV box: power + 2 × Cat6	6	
receptacle, 20A dedicated	5	

Item	Qty	Notes
surface LED ceiling fixture	5	
smoke + CO alarm, 120V interconnected w/ battery	5	
exhaust fan, 110 CFM, humidity sensing	5	
switch, rocker	5	
surface LED, closet-rated (NEC 410.16)	5	
data outlet, 2 × Cat6	4	
smoke alarm, 120V interconnected w/ battery	4	
occupancy-sensor switch	4	
fan-rated ceiling box, switched	4	
weatherproof GFCI receptacle, in-use cover	4	
pendant	4	
4" recessed LED, wet location (shower / tub)	3	
240V receptacle or junction	3	
floor box receptacle	2	
pop-up counter receptacle, 20A GFCI	2	
sub-panel P2, 125A, 30 space	1	
media panel: Cat6 home runs, network switch	1	
downdraft cooktop vent, blower in the island, ducted in the floor	1	
linear LED under shelf / cabinet	1	
Cable 8/3 NM-B	71 ft	chained run + 12' per device, +15%
Cable 10/3 NM-B	170 ft	chained run + 12' per device, +15%
Cable 12/2 NM-B	1090 ft	chained run + 12' per device, +15%
Cable 14/2 NM-B	5719 ft	chained run + 12' per device, +15%
14/3 NM-B for 3-way and multi-location switching	400 ft	40' per 3-way pair
Cat6 (two per TV/data outlet)	1532 ft	10 TV/data outlets
18/2 shade and LED cable in 1/2" ENT conduit	1329 ft	home runs to the mech room

Item	Qty	Notes
Breakers 240V 40A 2P	1	AFCI/GFCI types as listed on the circuit schedule
Breakers 240V 30A 2P	3	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A GFCI/AFCI	4	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A AFCI	2	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A	2	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A GFCI	3	AFCI/GFCI types as listed on the circuit schedule
Breakers 15A AFCI	8	AFCI/GFCI types as listed on the circuit schedule
Breakers 15A	3	AFCI/GFCI types as listed on the circuit schedule
Sub-panel 125A MLO, 30 space, with #1 Cu feeder from the main	1	feeder length to confirm
Device boxes, old-work and new-work, with covers	262	4" square for 240V and TV boxes

Quantities are rough-order take-offs from the drawing geometry, for pricing. The contractor takes off the final list.