

E-1 — All circuits (overview) · 7824 Zero Road, second floor · rev v61 · 2026-10-26

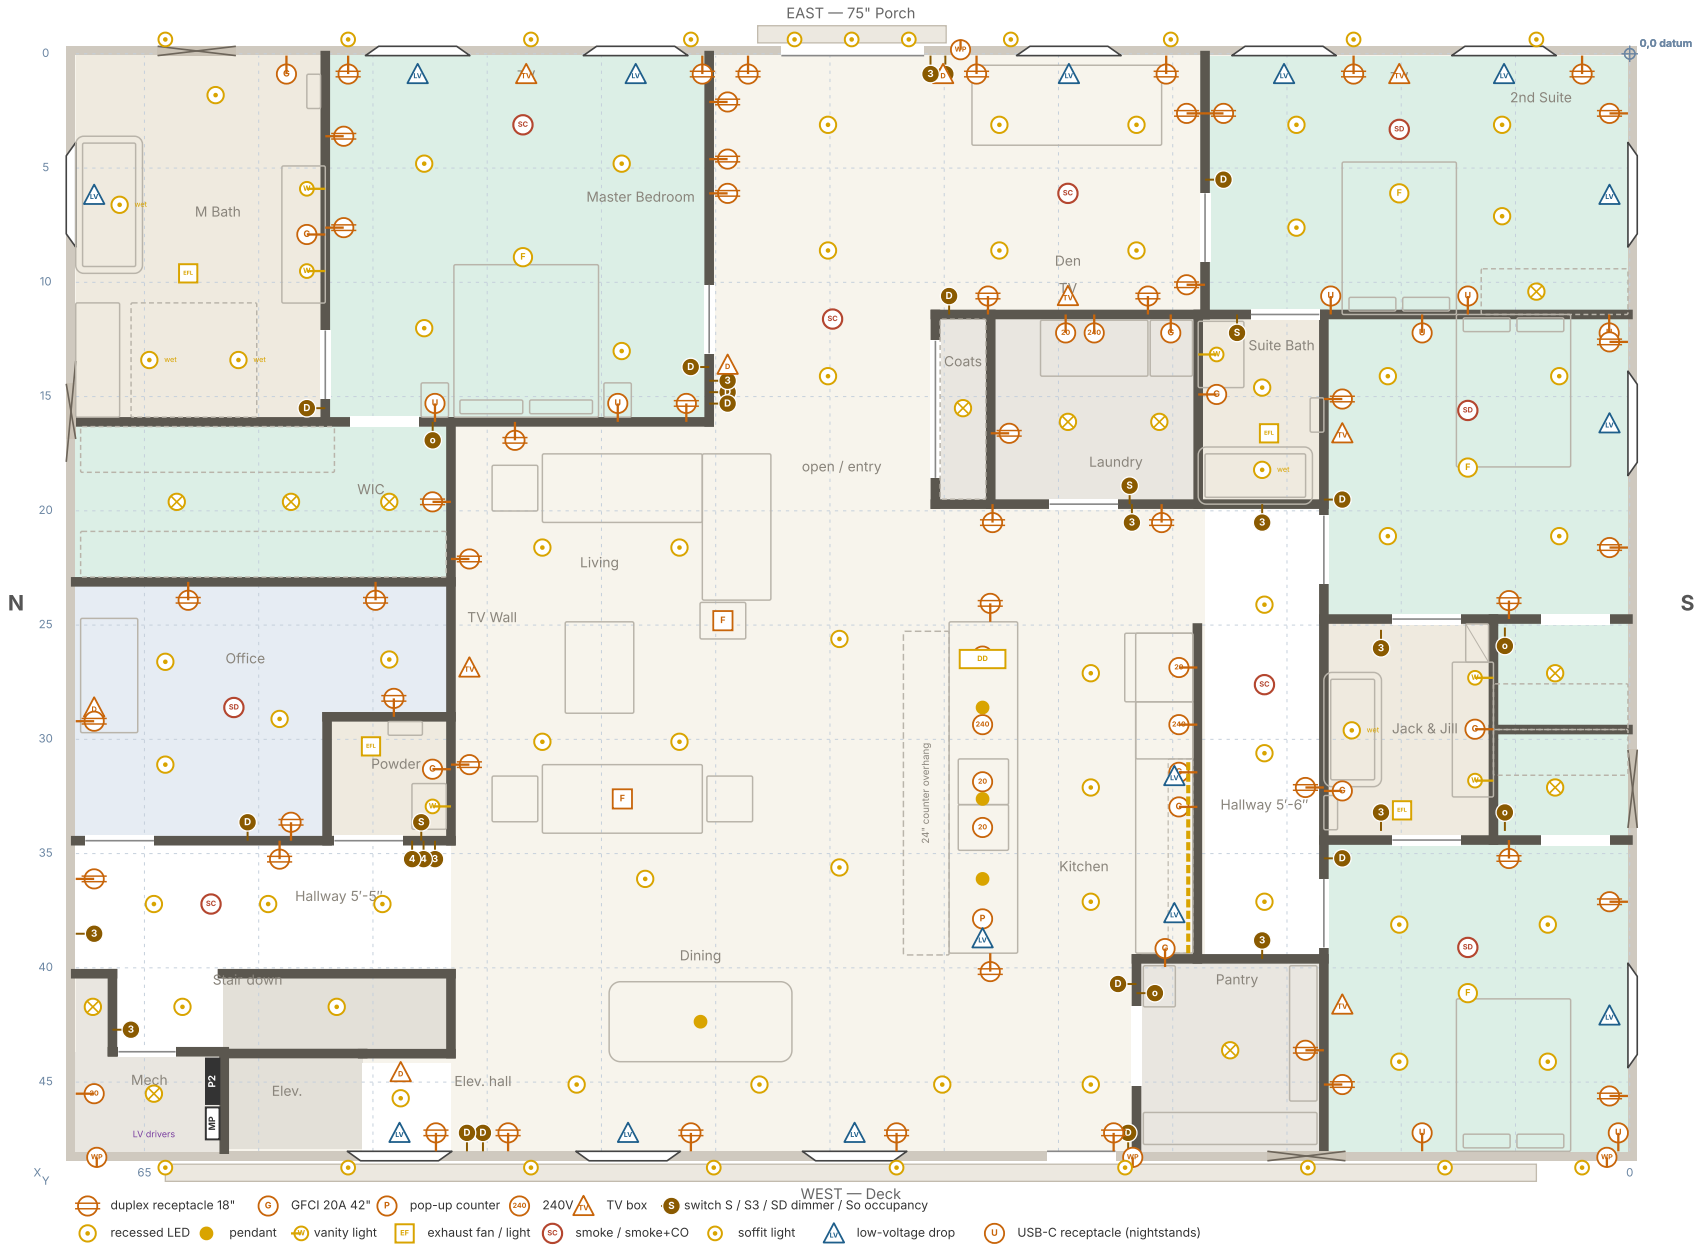


7824 Zero Road Casper, Wyoming · 68′-1″ × 48′-1¼″ in framing · 9′ ceiling · grid 5′, 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn J. K. Christianson

E-1.1 1-2 — Induction cooktop · 240V 40A 2P · 7824 Zero Road, second floor · rev v61 · 2026-10-26

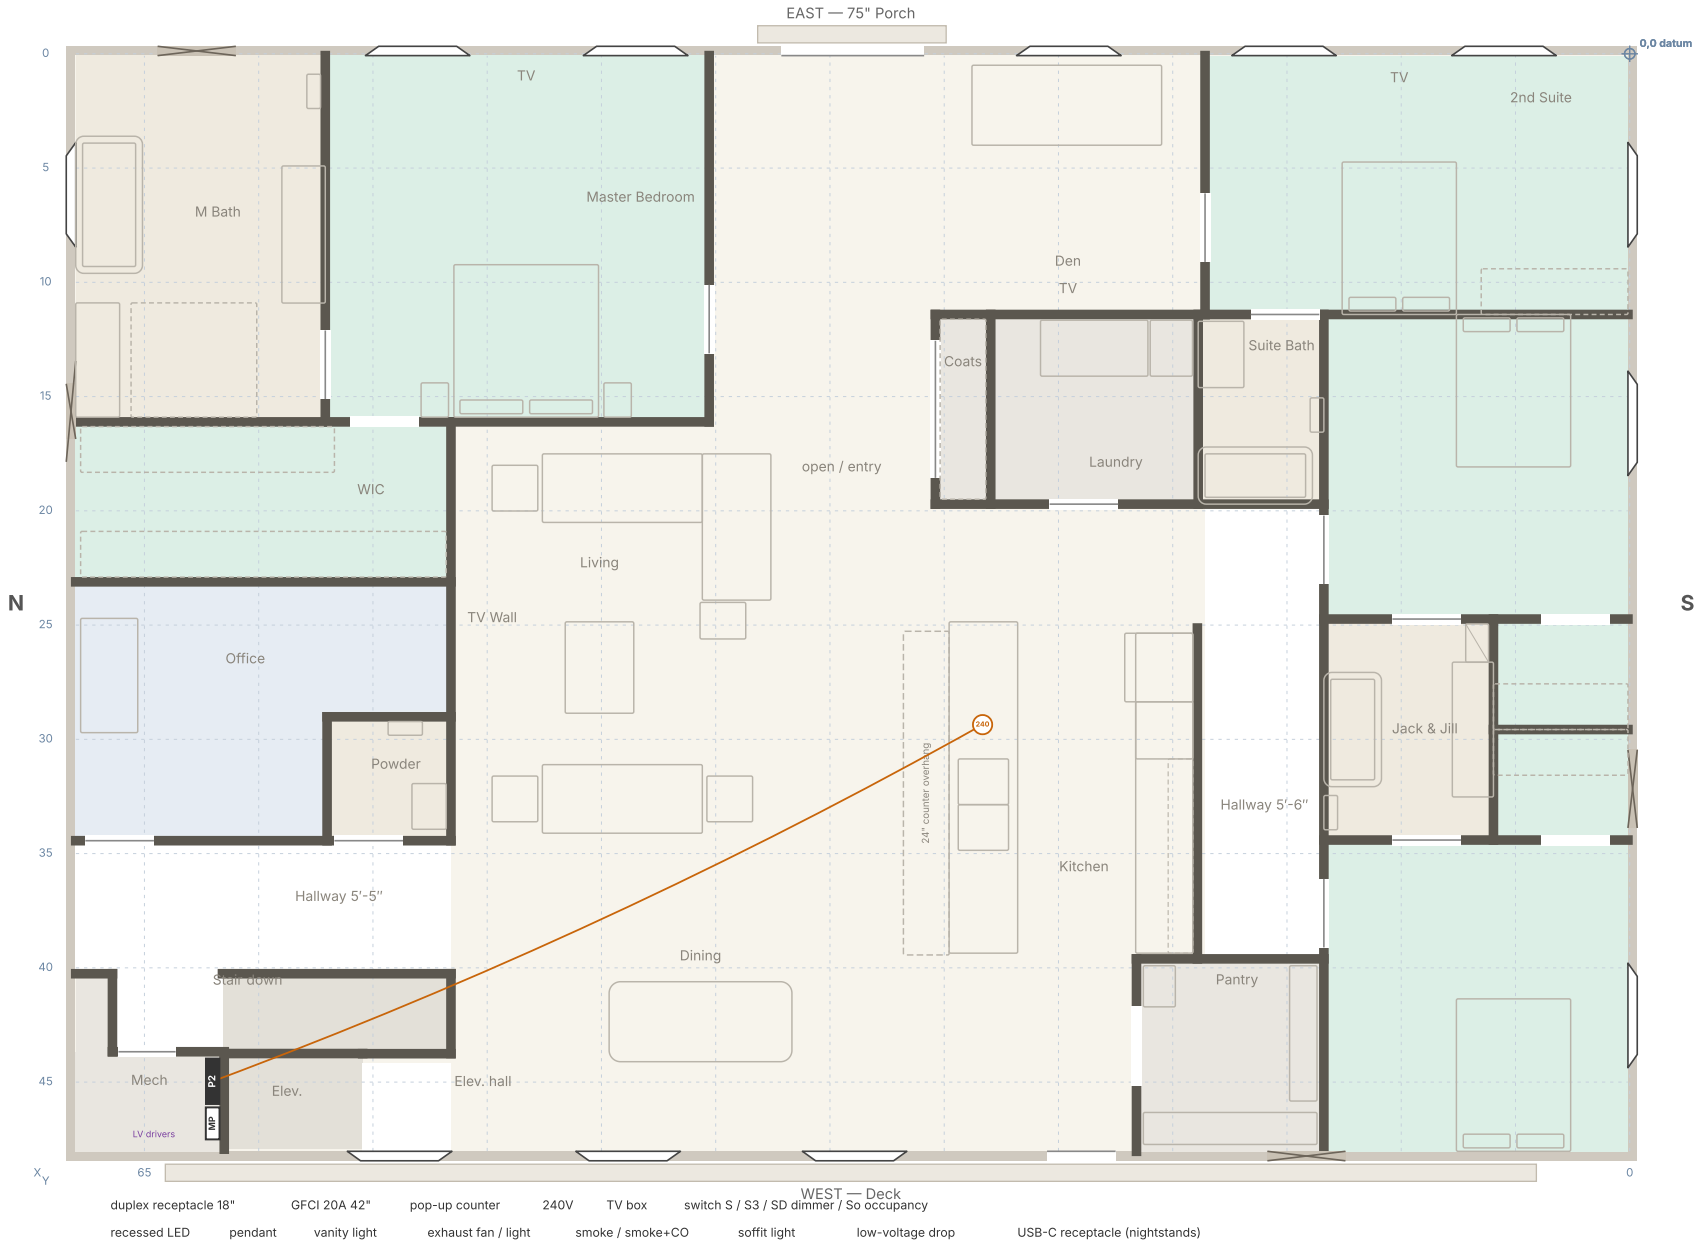


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.2 3-4 — Wall oven, side-opening · 240V 30A 2P · 7824 Zero Road, second floor · rev v61 · 2026-10-26

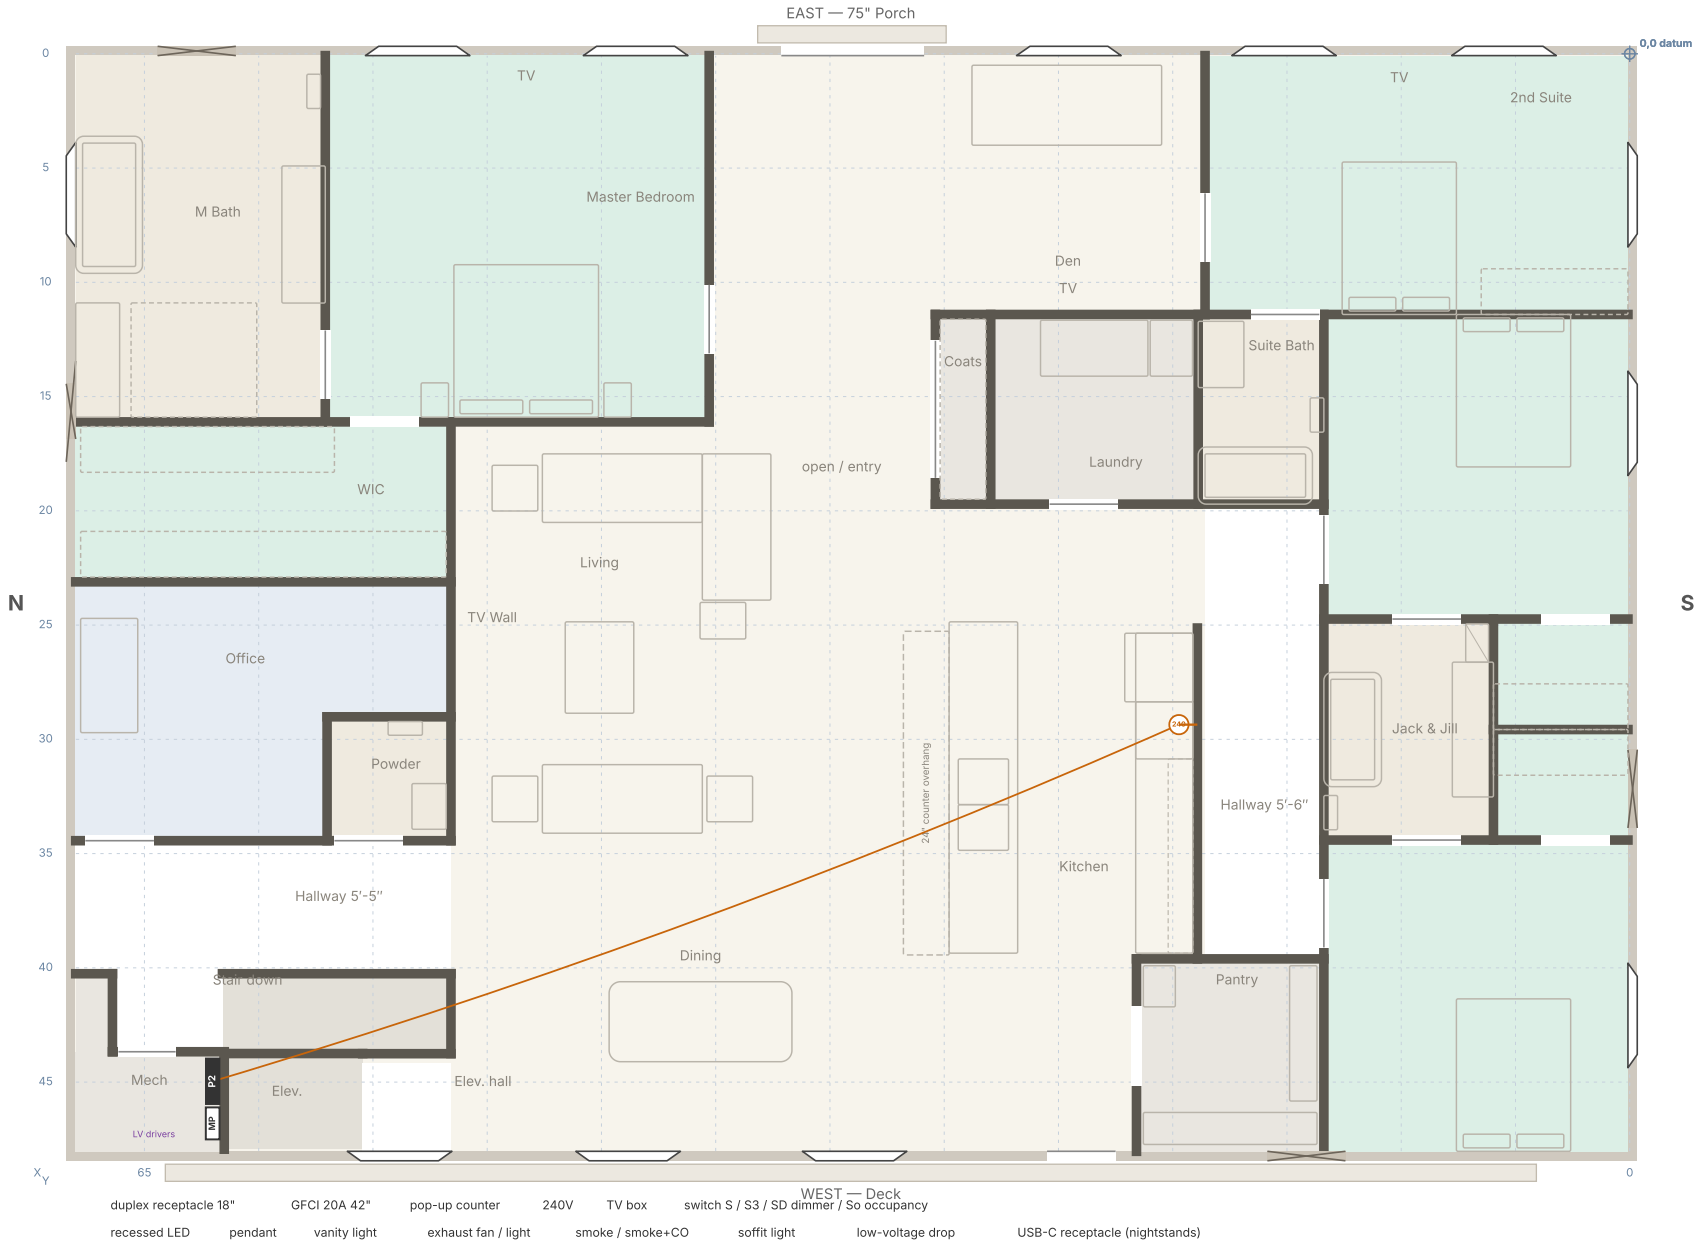


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.3 5-6 — Dryer · 240V 30A 2P · 7824 Zero Road, second floor · rev v61 · 2026-10-26

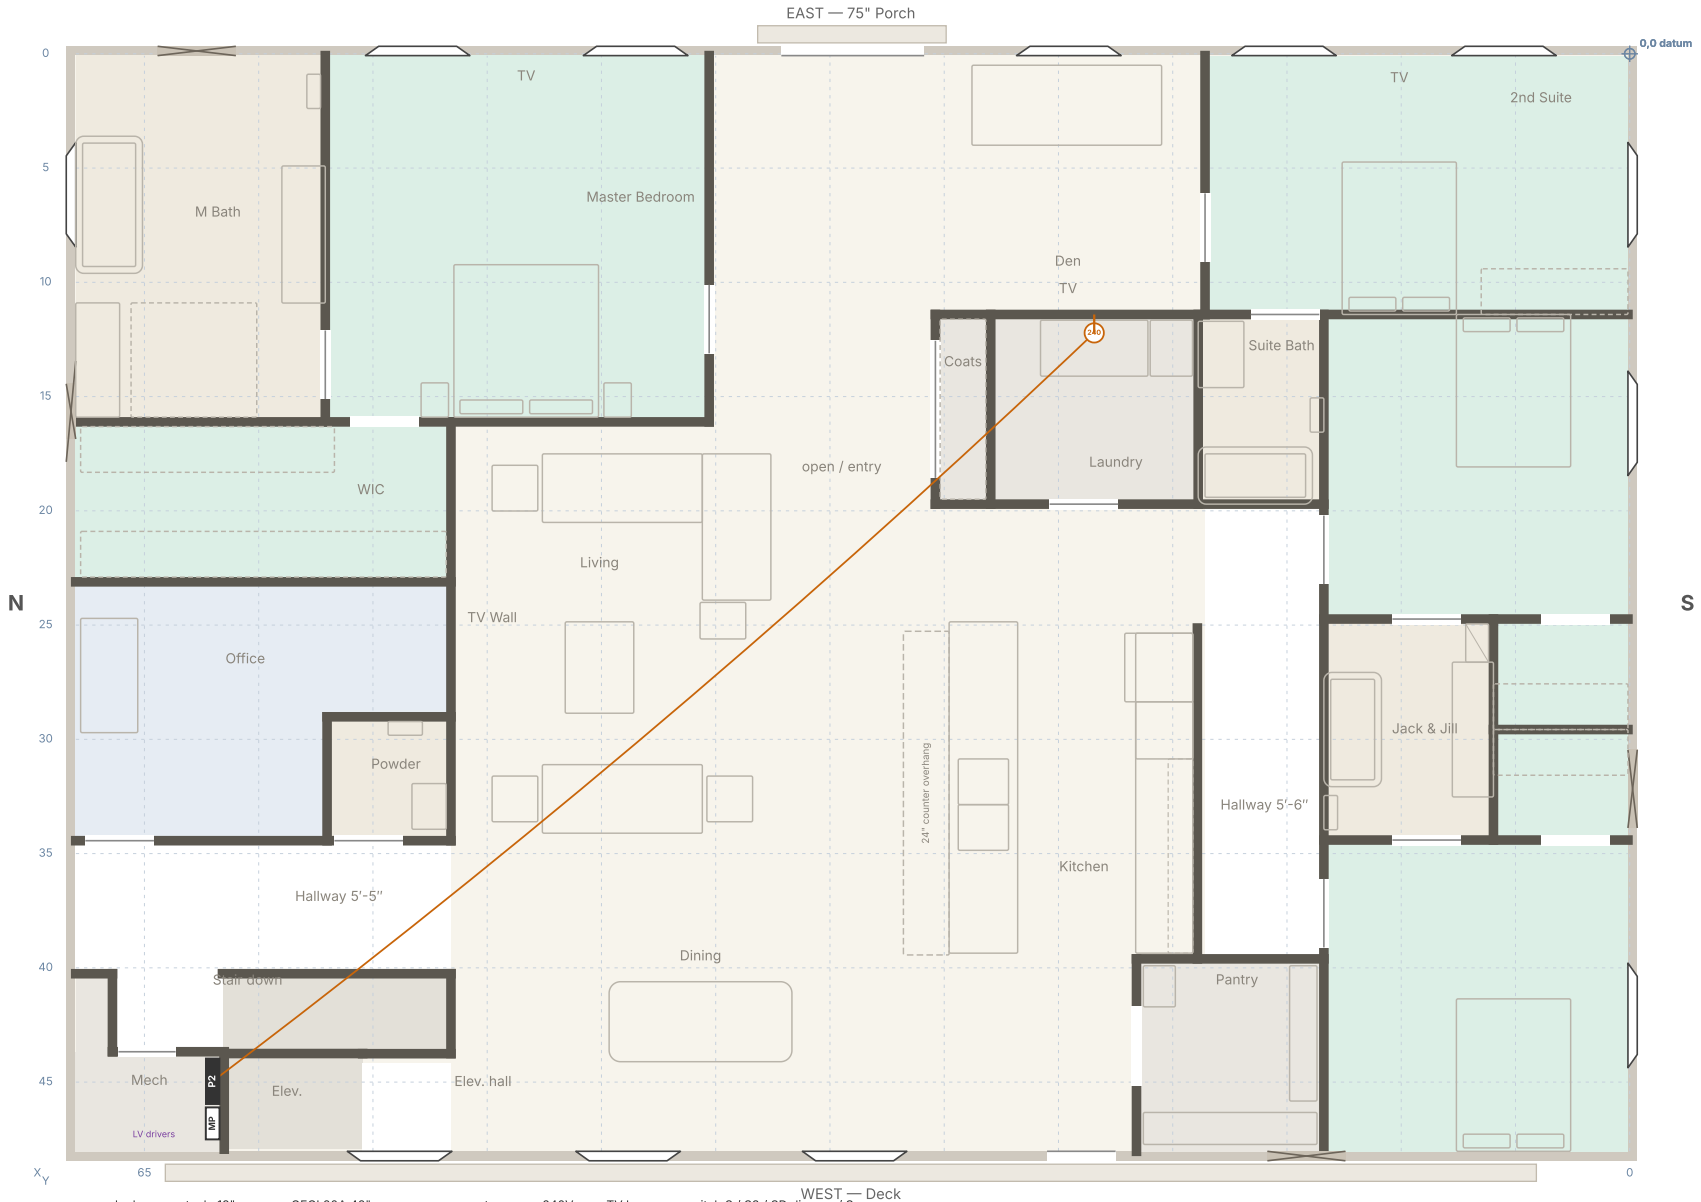

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.4 7 — Kitchen small appliance 1 · 20A GFCI/AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

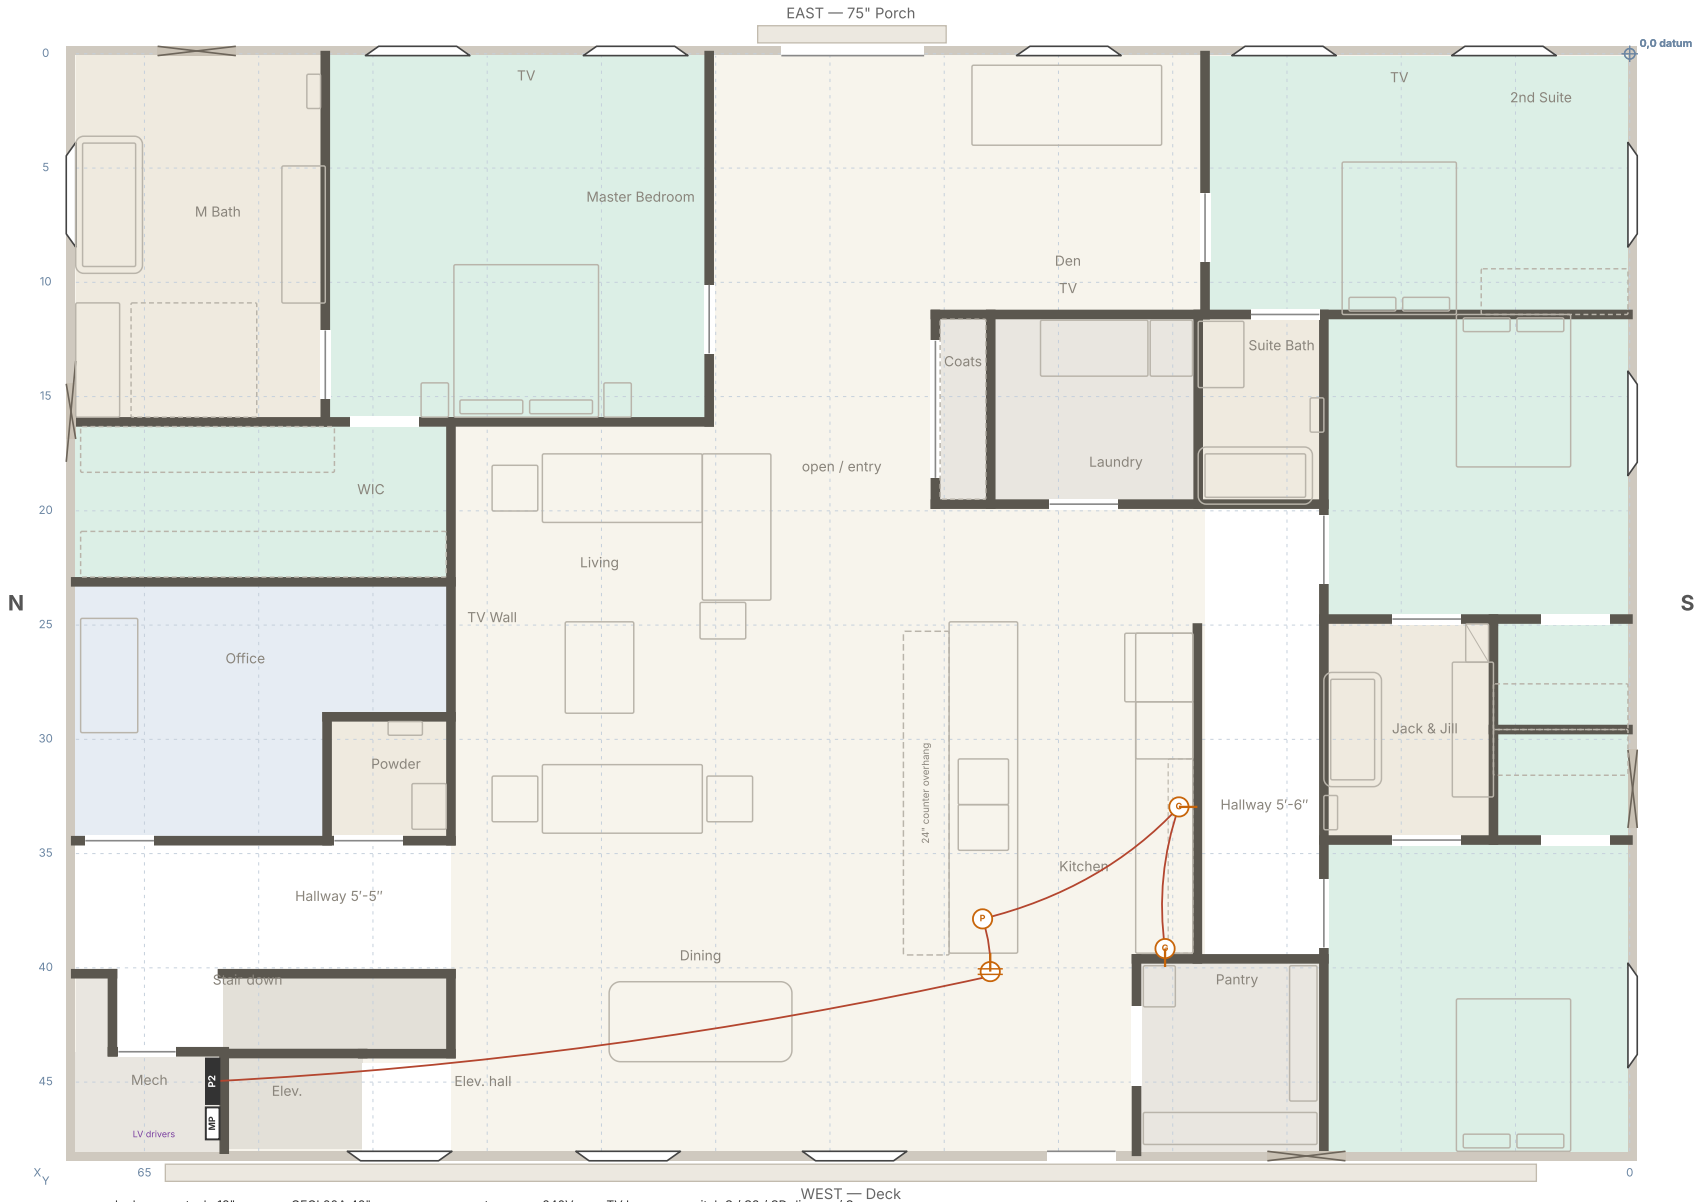


7824 Zero Road
Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE
Base plan 2026-09-29 · wall numbers as that drawing

Electrical plan
Devices, luminaires, alarms and the circuit schedule for sub-panel P2
Schematic for pricing and coordination, not a stamped construction document. Verify on site.

E-1
rev v61
drawn for K. Christianson

E-1.5 8 — Kitchen small appliance 2 + pantry · 20A GFCI/AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

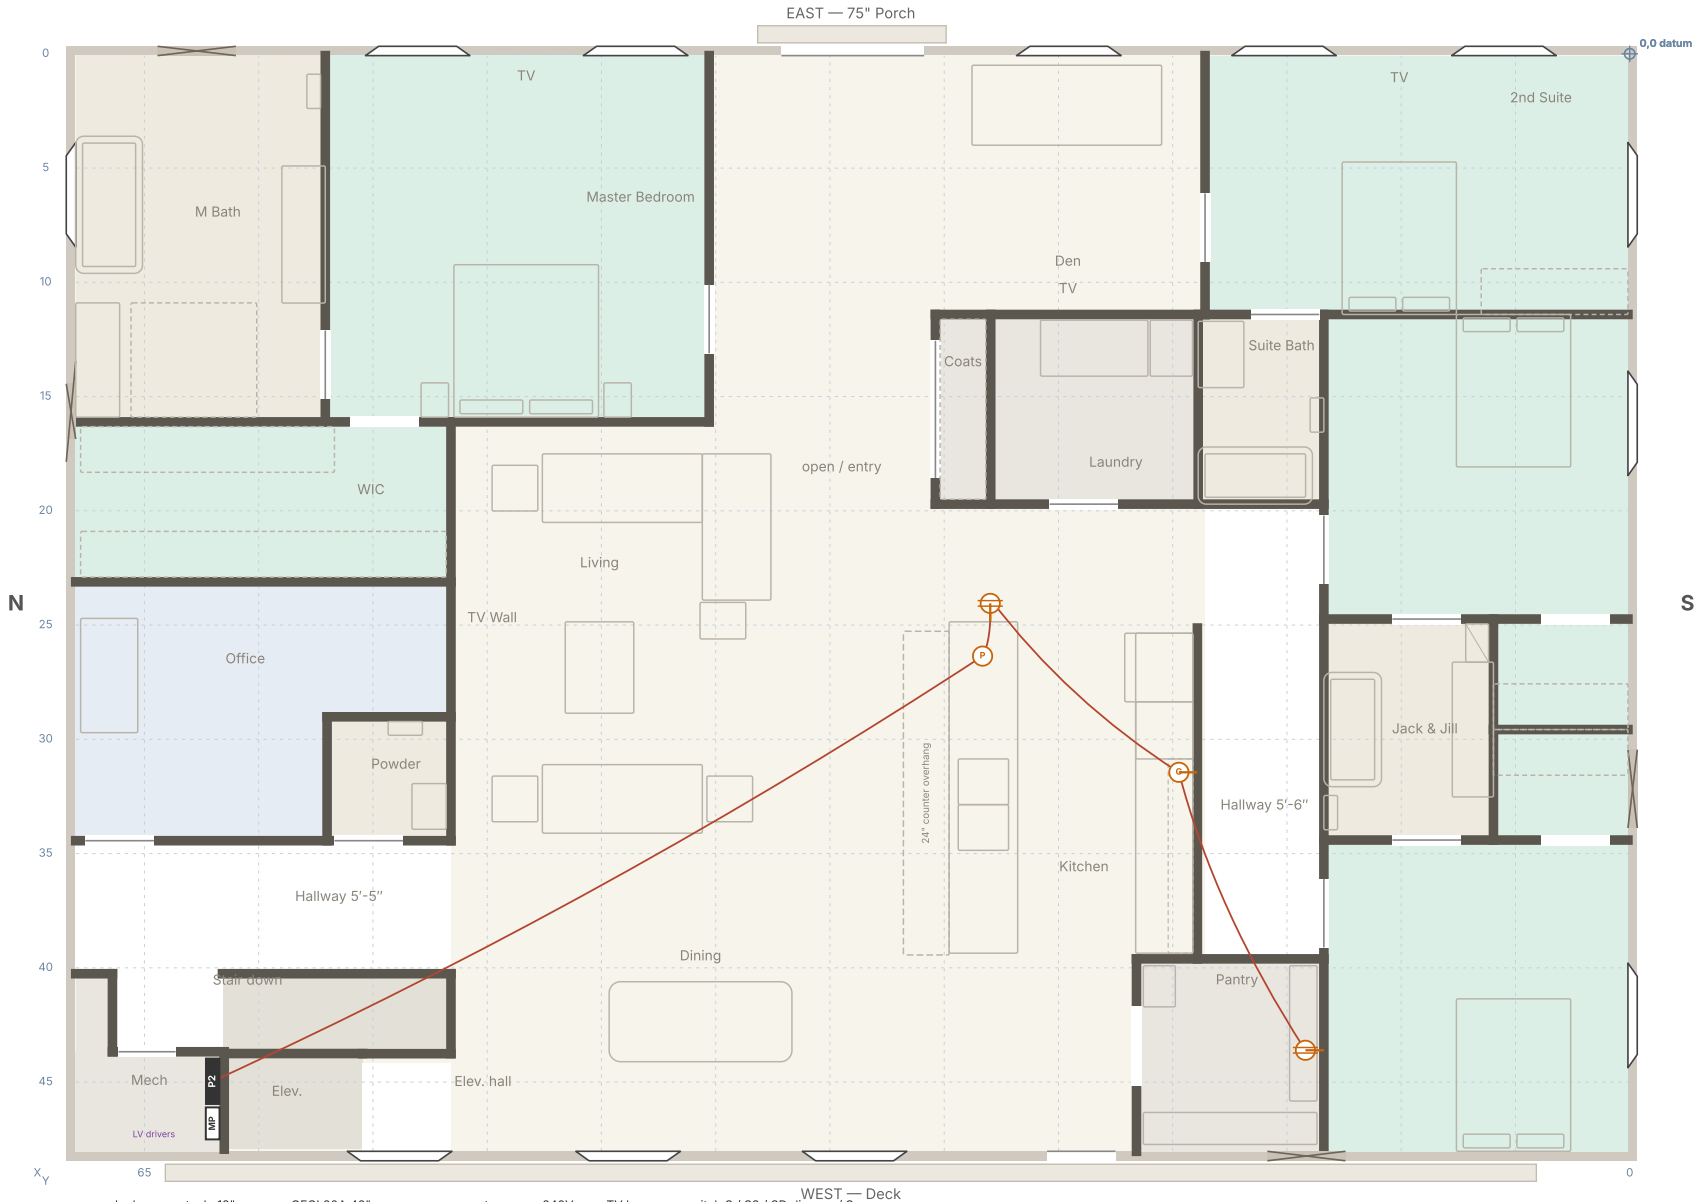


7824 Zero Road
Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE
Base plan 2026-09-29 · wall numbers as that drawing

Electrical plan
Devices, luminaires, alarms and the circuit schedule for sub-panel P2
Schematic for pricing and coordination, not a stamped construction document. Verify on site.


E-1
rev v61
drawn for K. Christianson

E-1.6 9 — Refrigerator · 20A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

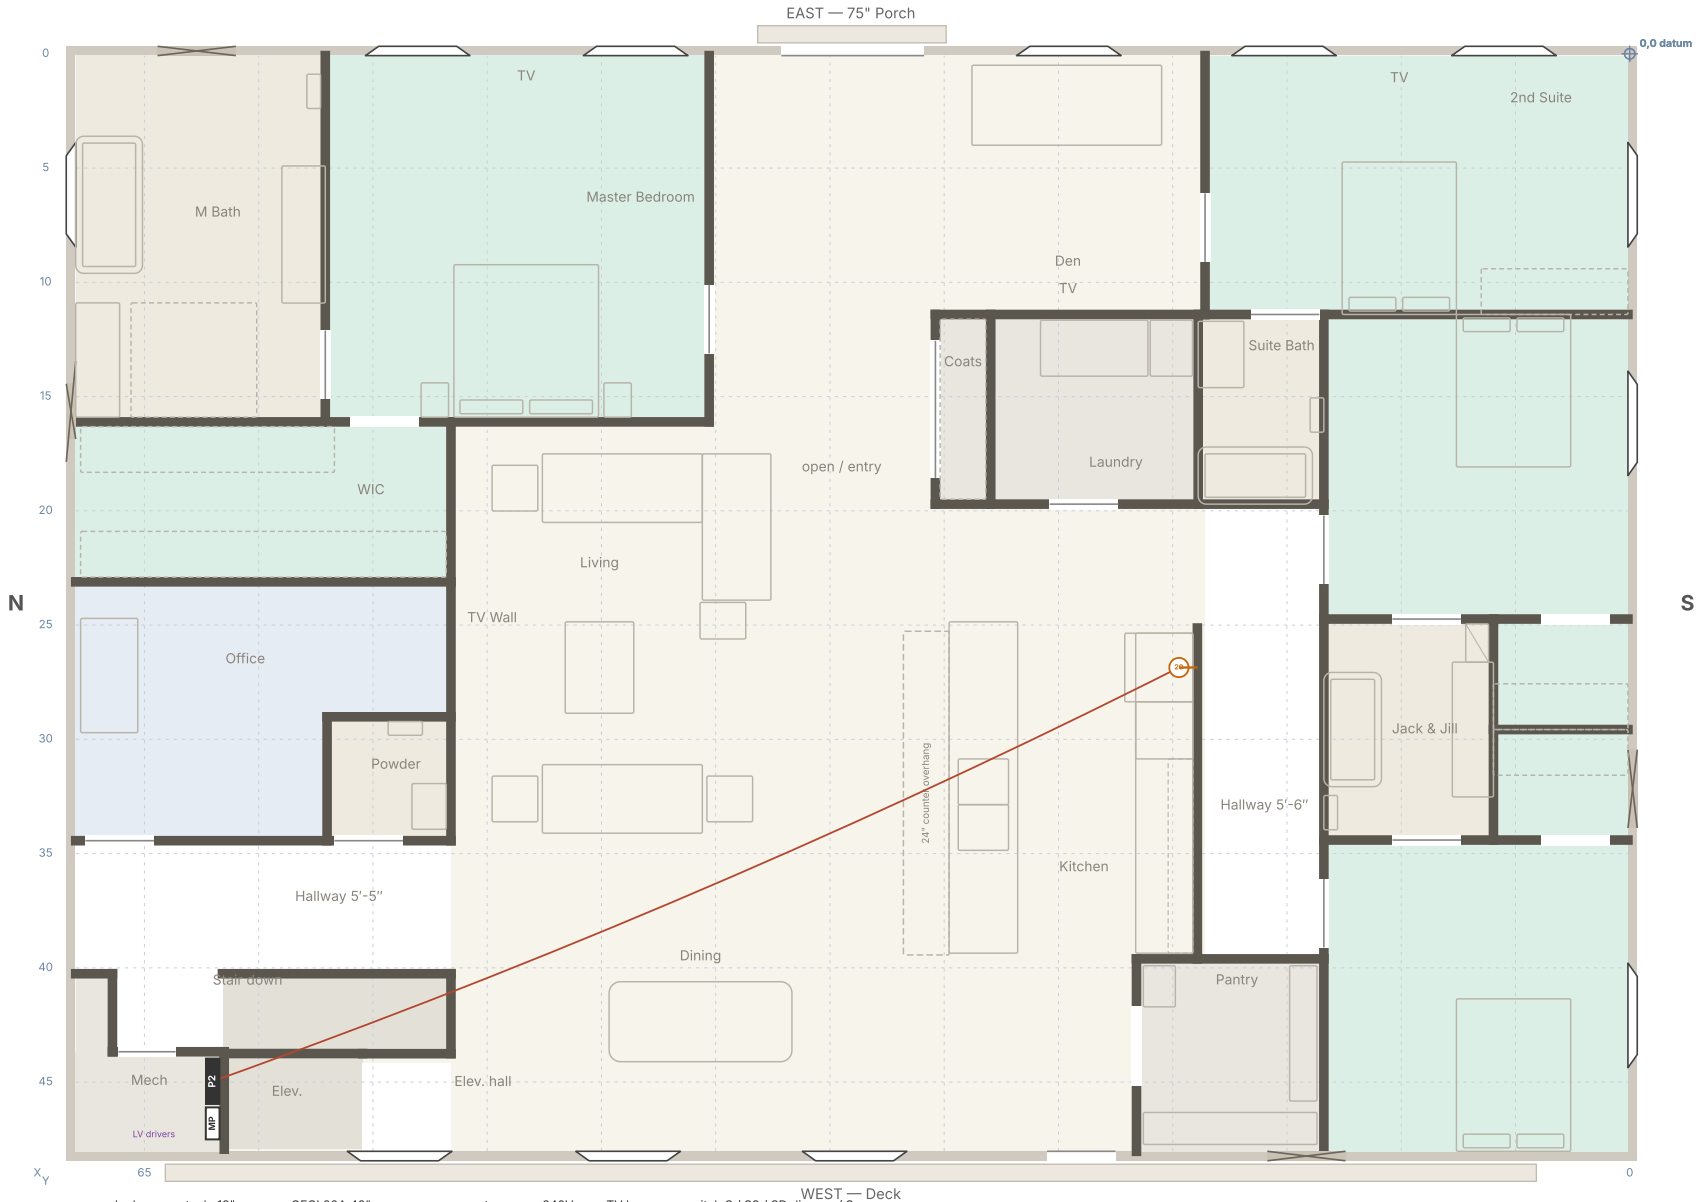

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.7 10 — Lighting C · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

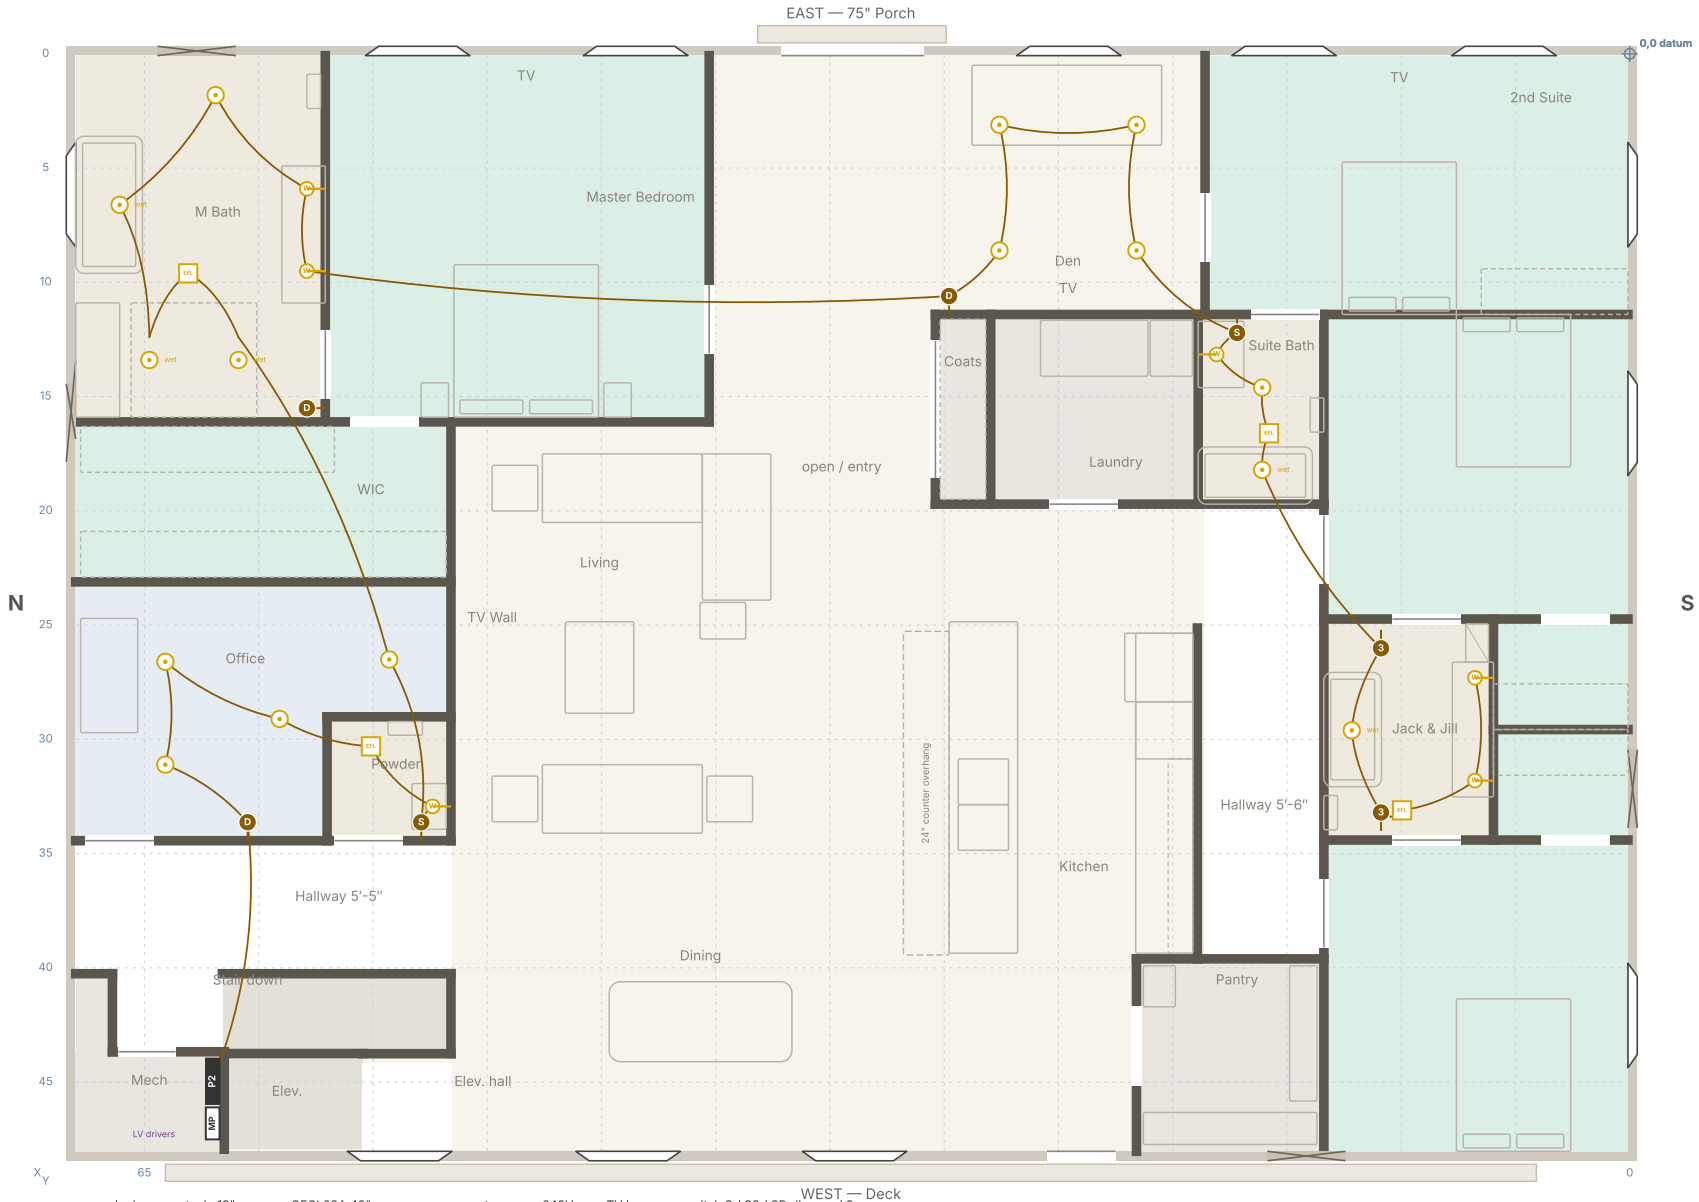


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.8 11 — Dishwasher drawers · 20A GFCI/AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

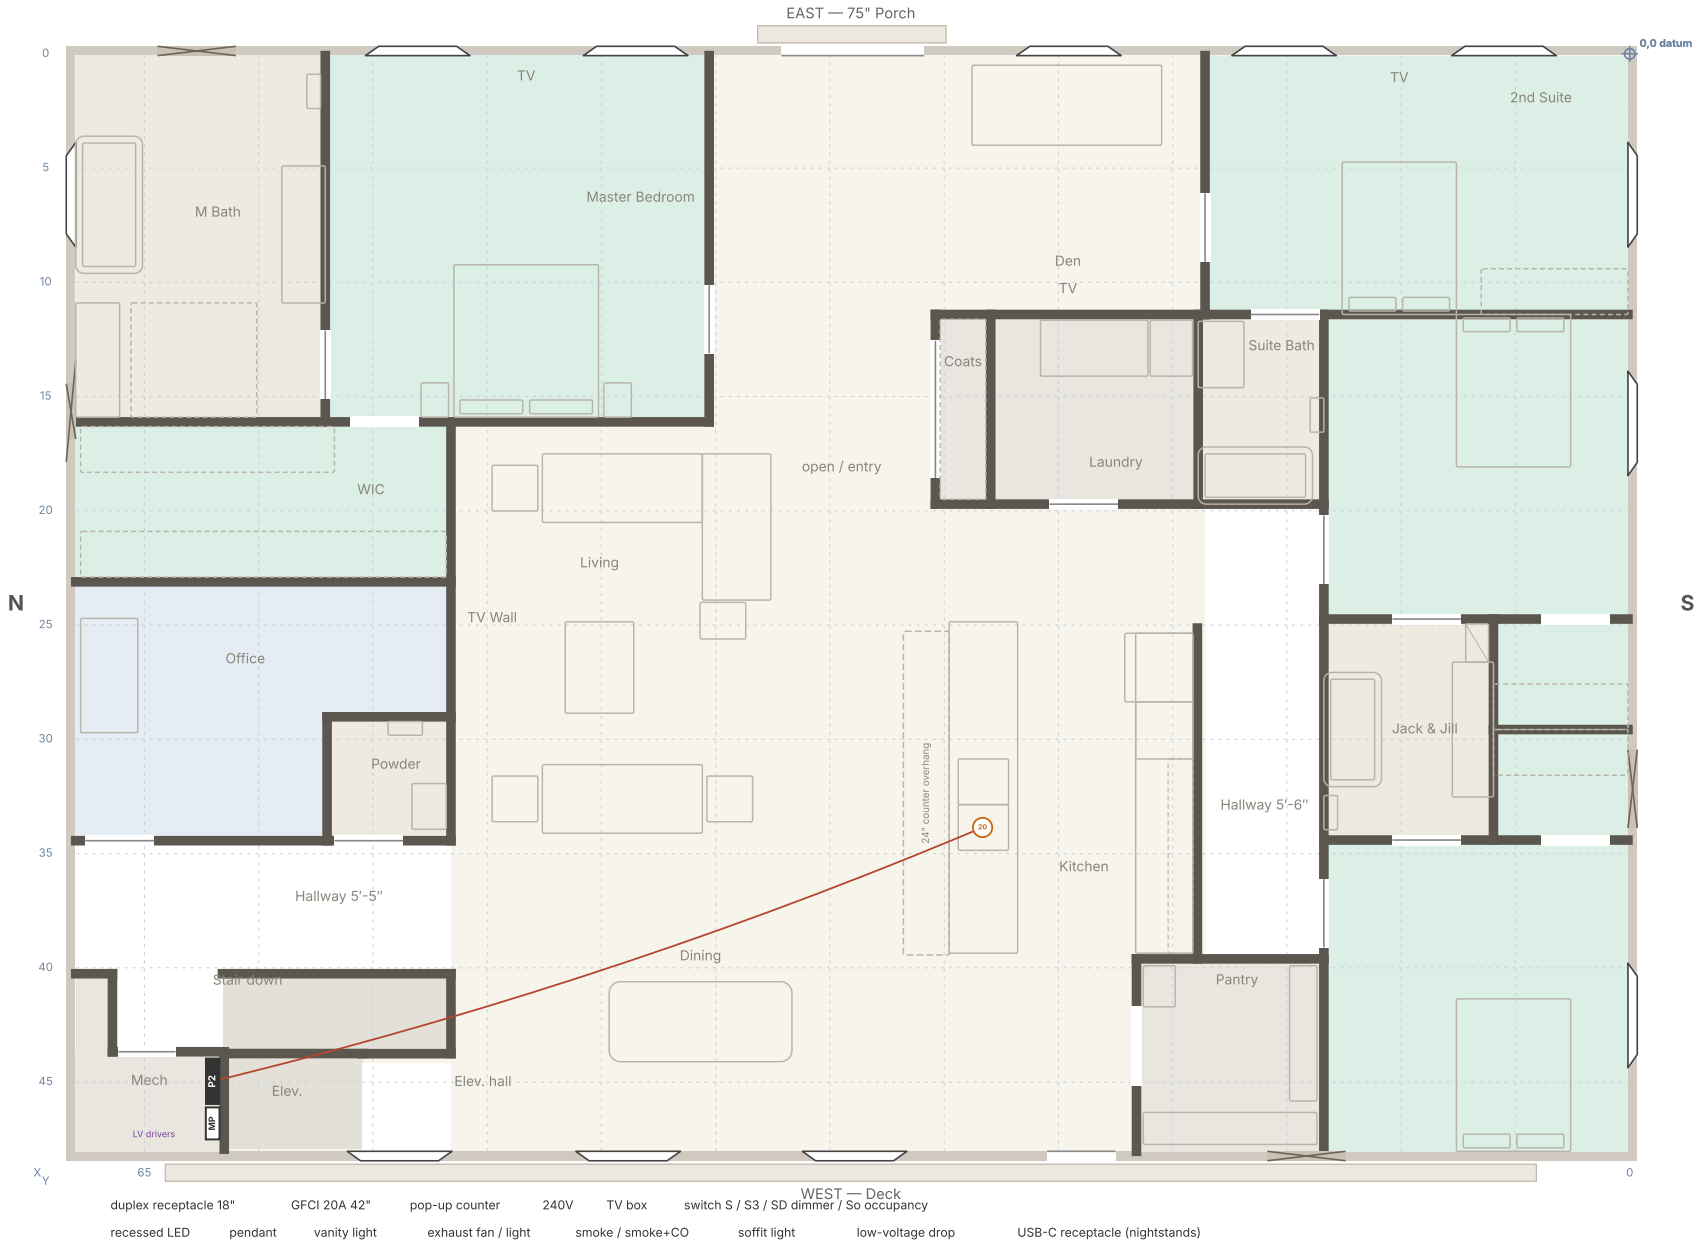


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.9 12 — Microwave drawer · 20A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

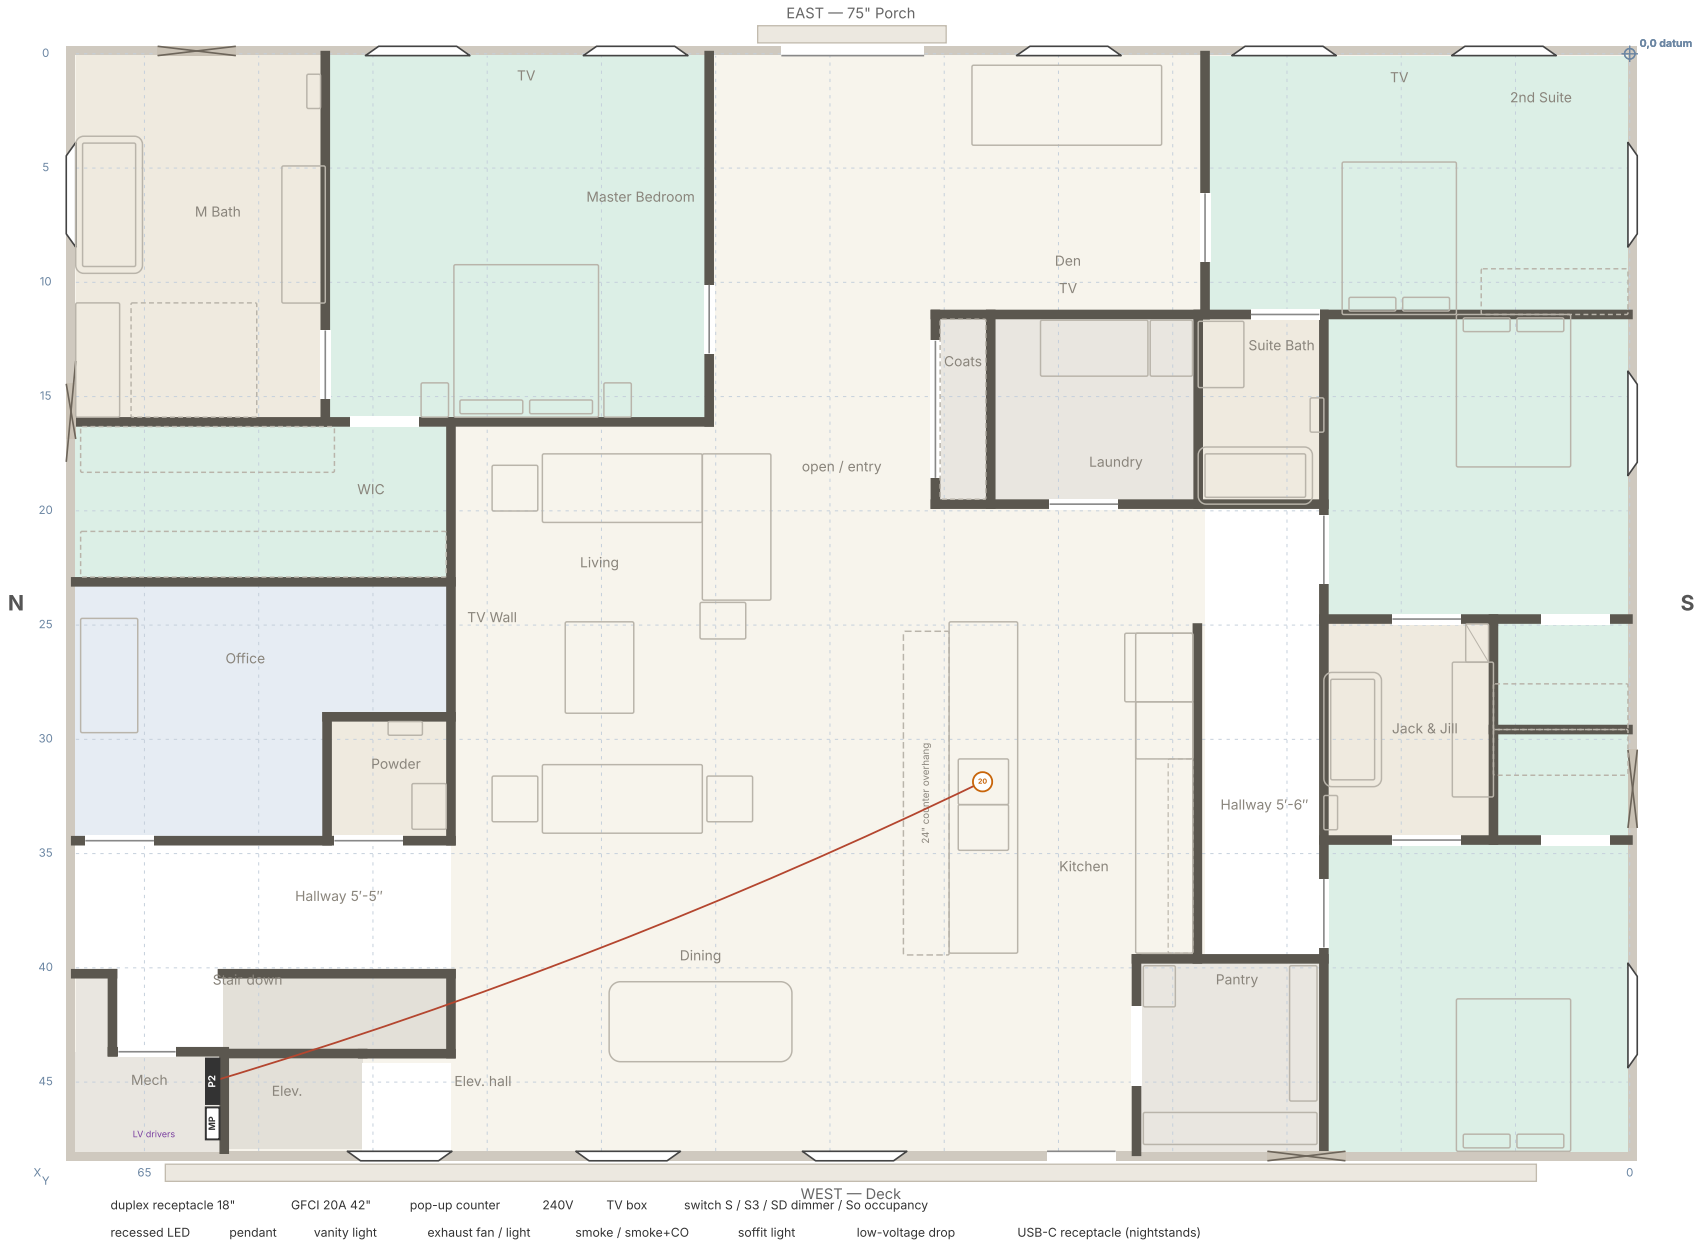


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.10 13 — Laundry: washer, sink, counter · 20A GFCI/AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

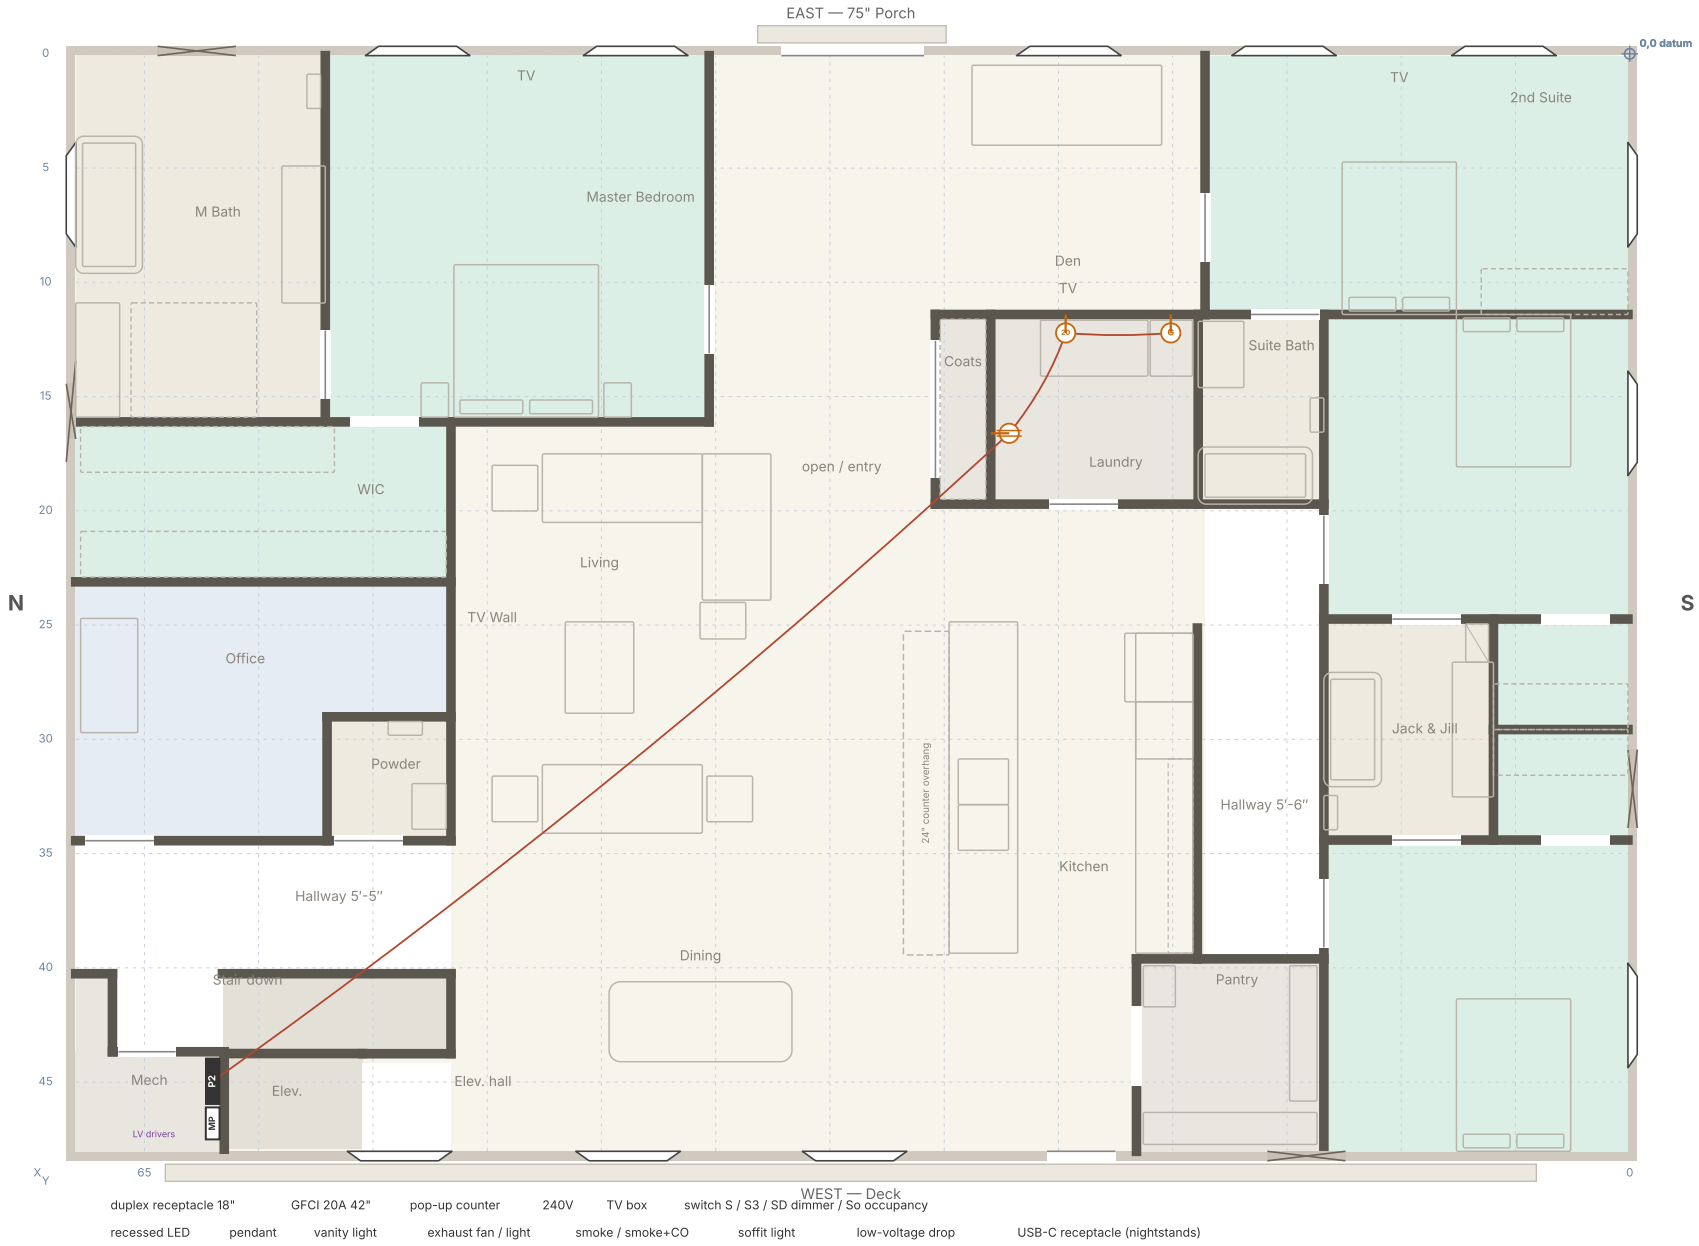

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.11 14 — Bath receptacles west · 20A GFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

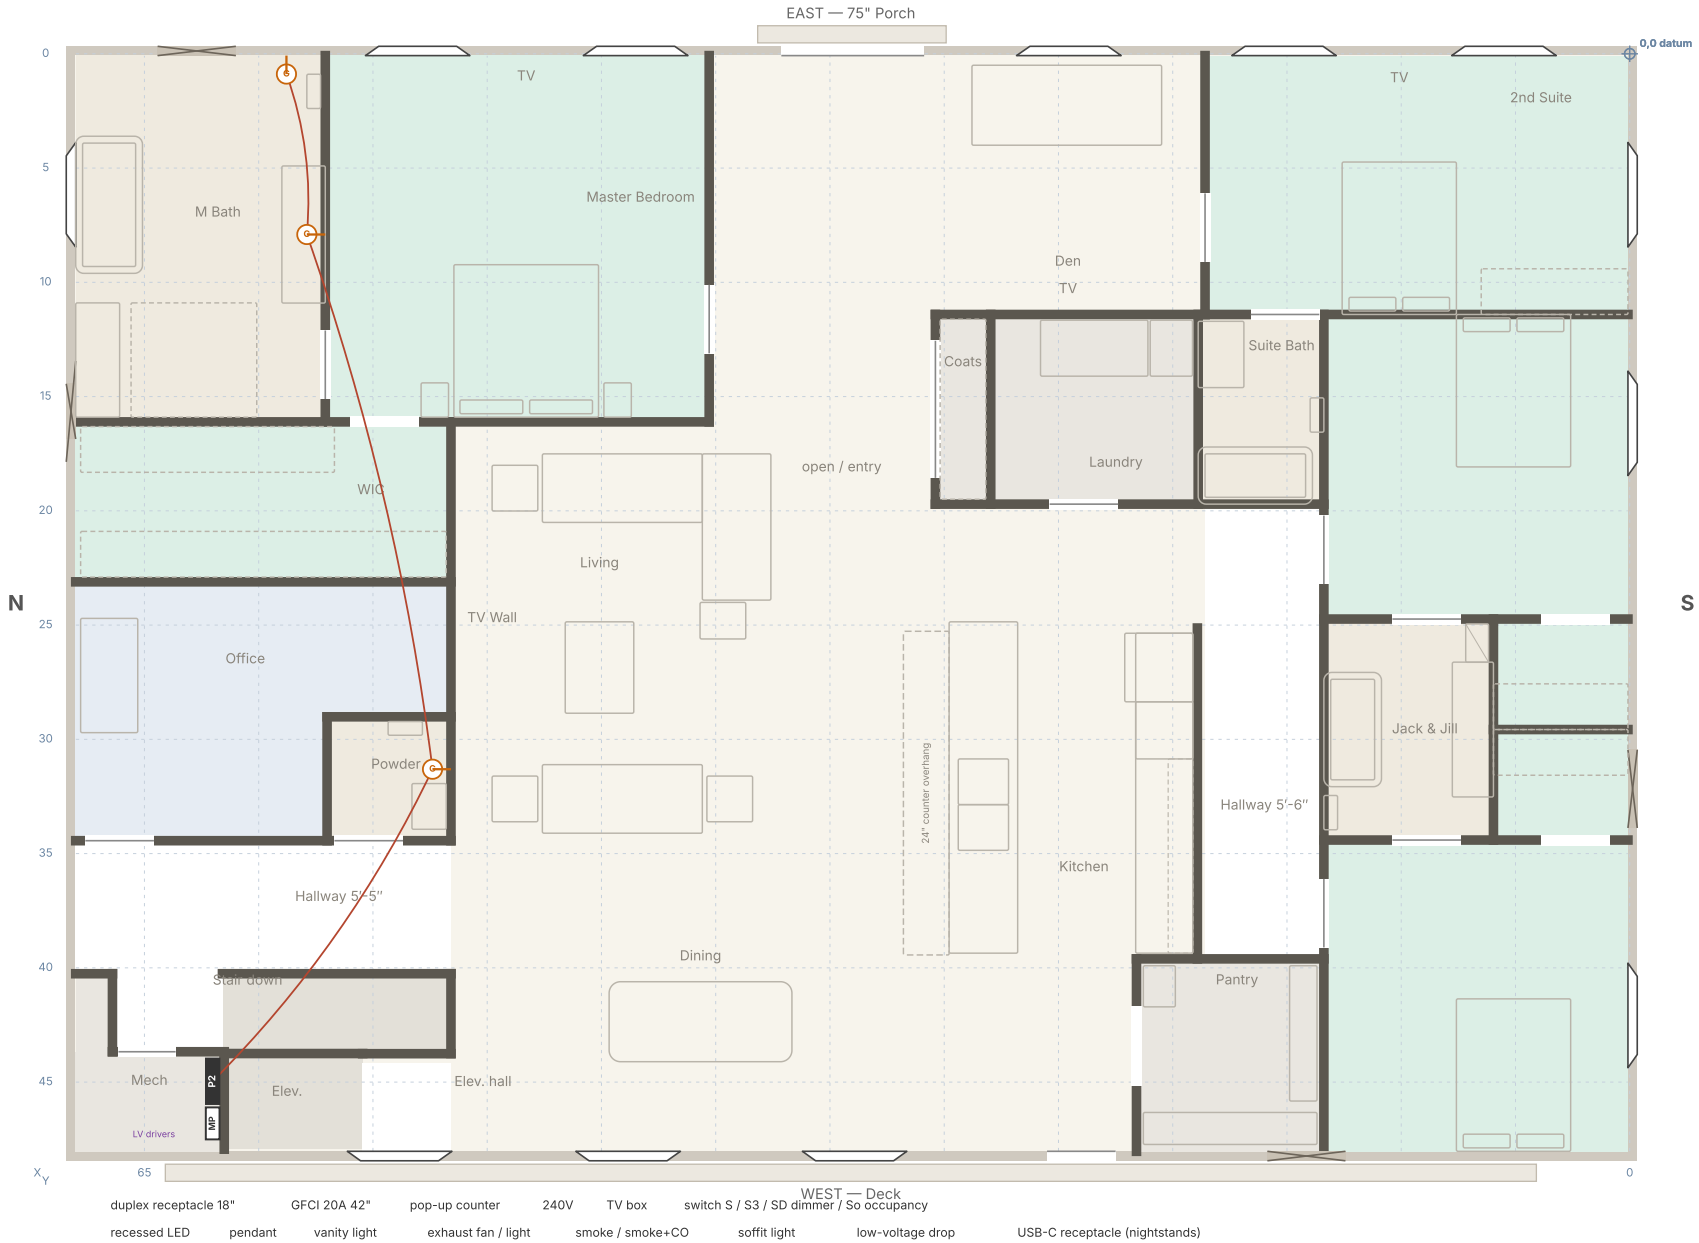

7824 Zero Road

Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE
Base plan 2026-09-29 · wall numbers as that drawing


Electrical plan

Devices, luminaires, alarms and the circuit schedule for sub-panel P2
Schematic for pricing and coordination, not a stamped construction document. Verify on site.

E-1

rev v61
drawn for K. Christianson

E-1.12 15 — Bath receptacles east · 20A GFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

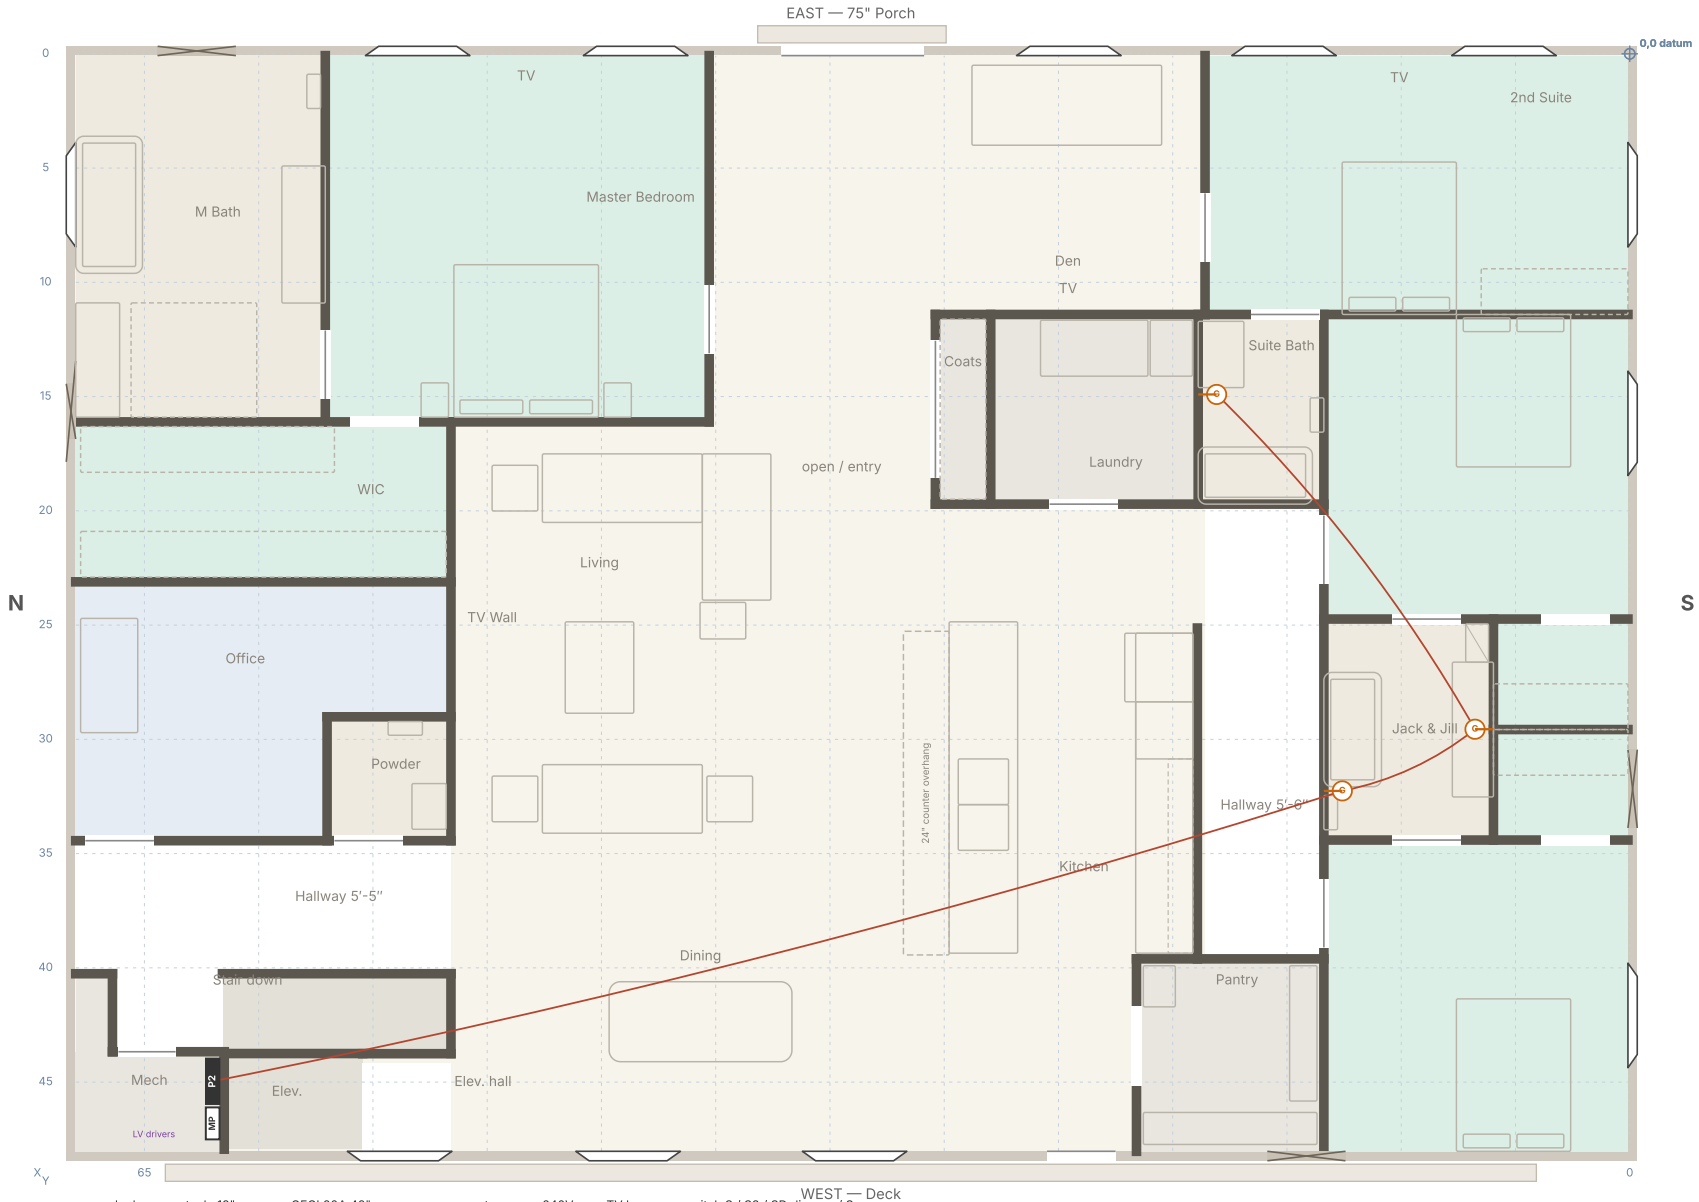


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.13 16 — Master suite receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

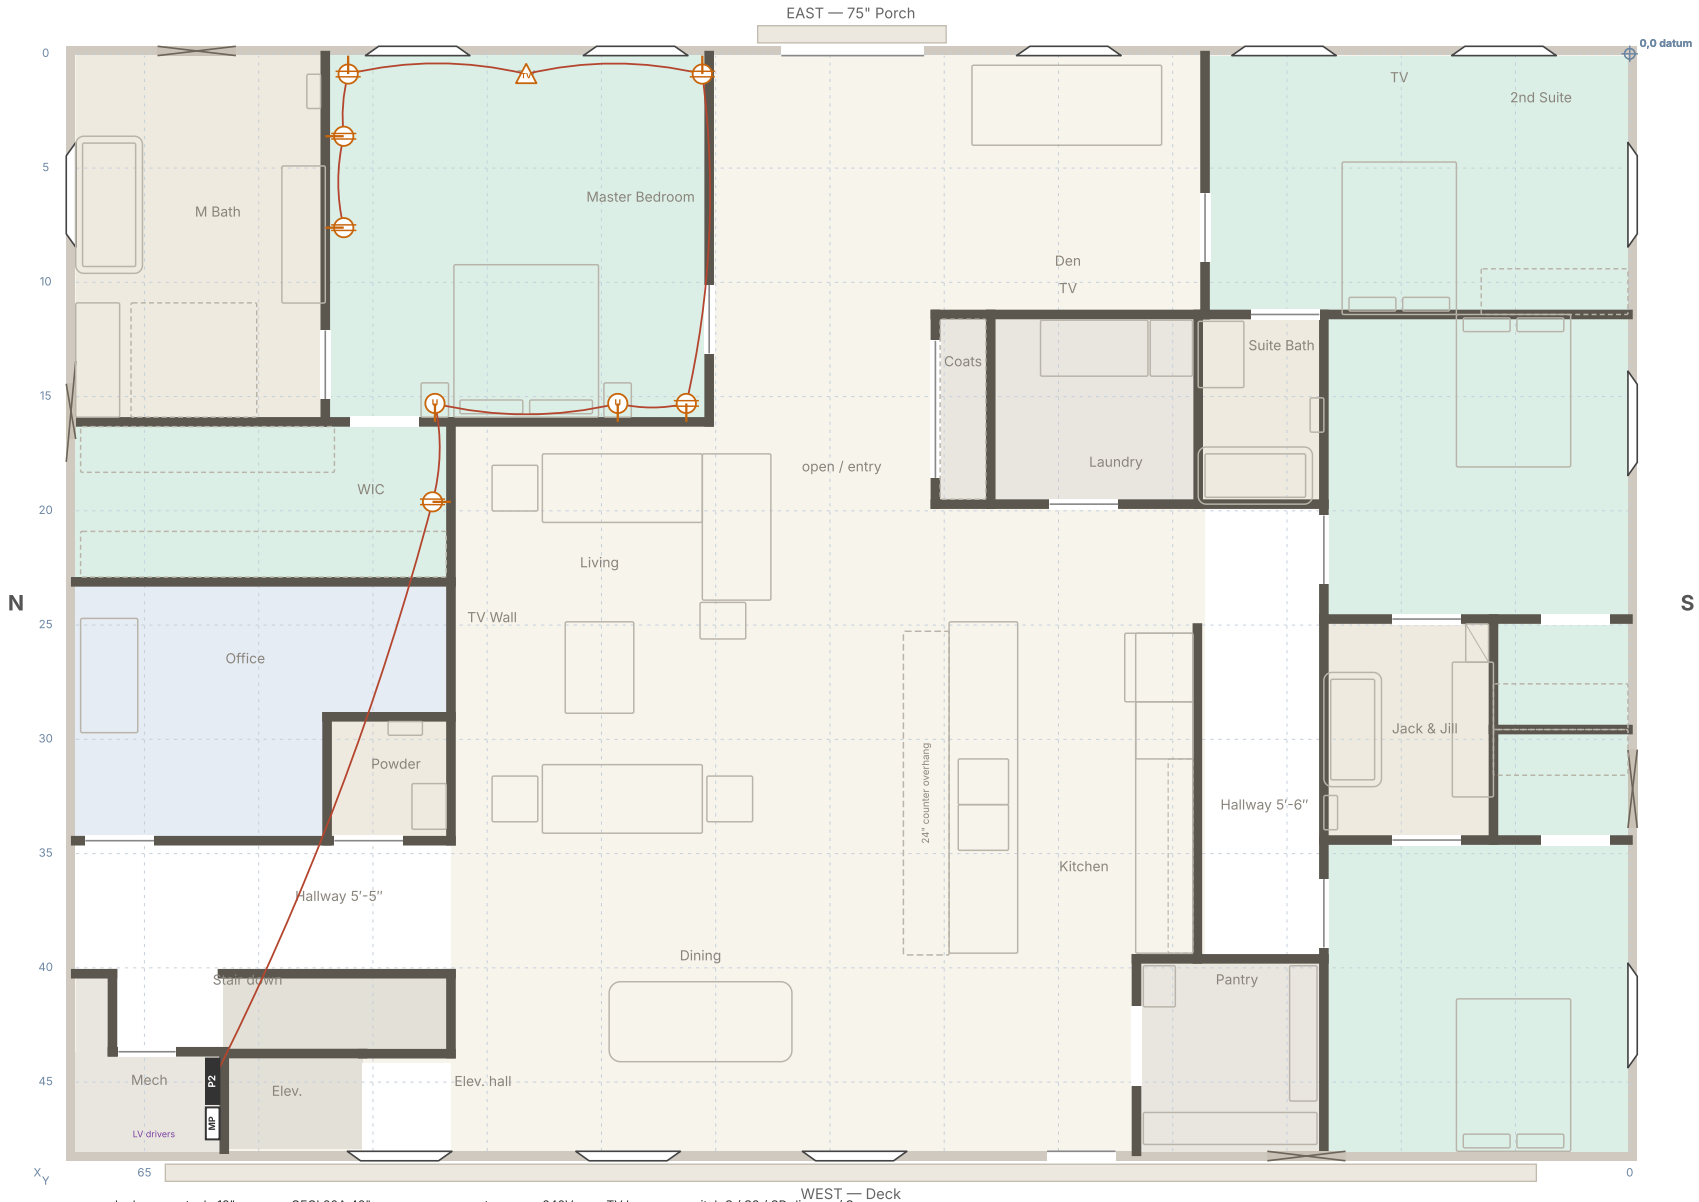


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.14 17 — Bedroom 3 receptacles + wing hall · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

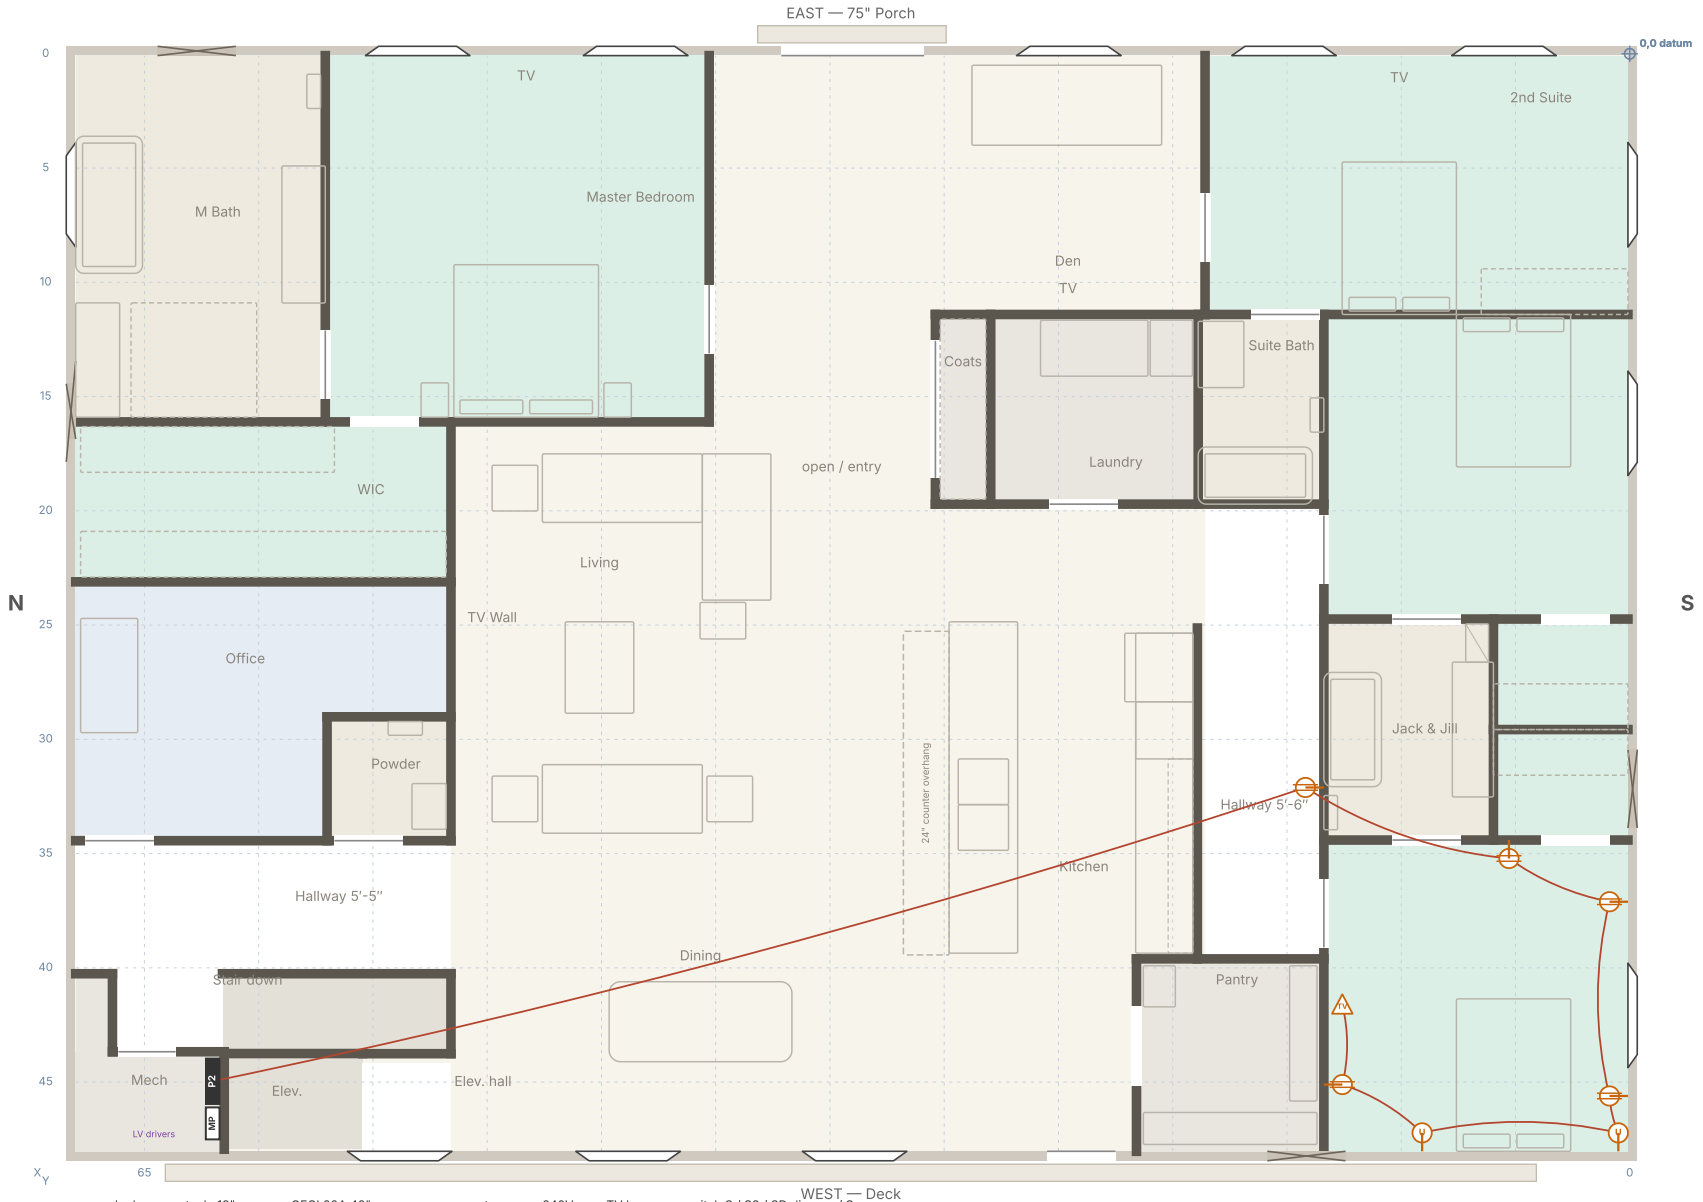


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.15 18 — 2nd Suite receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

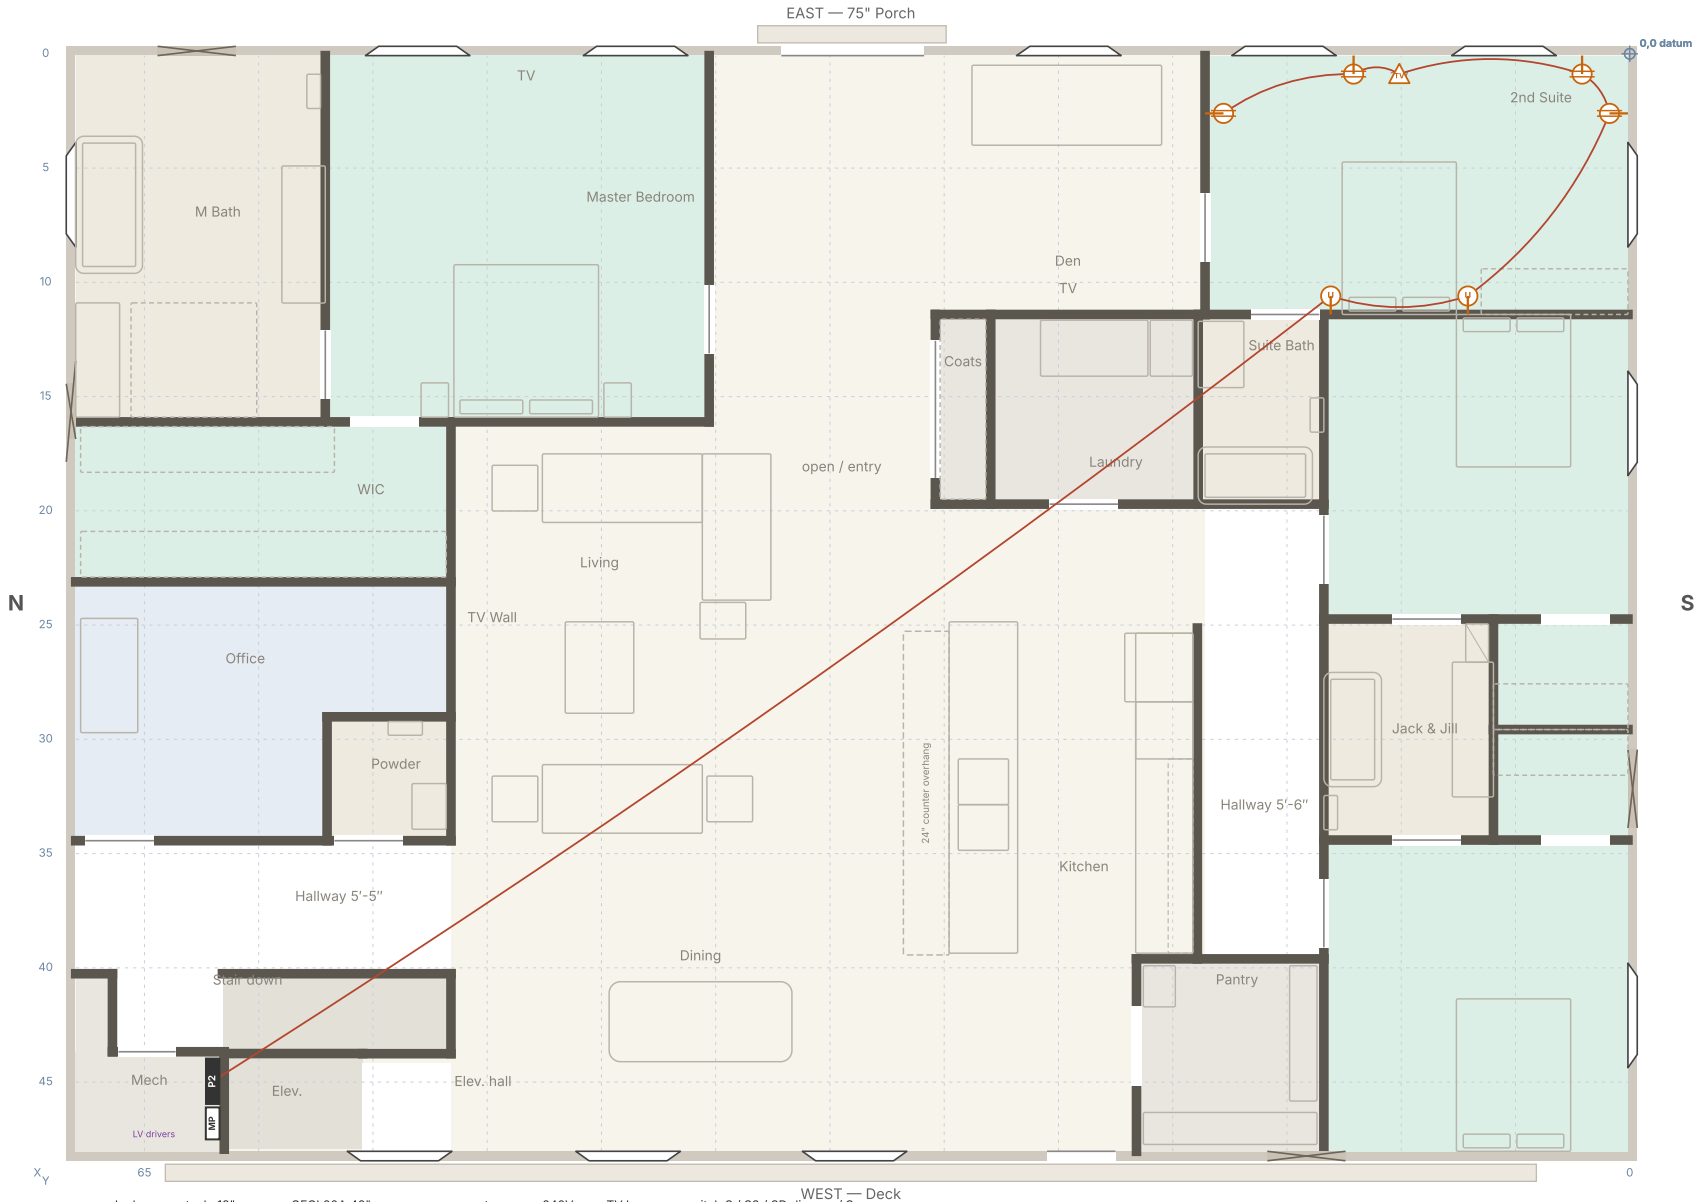

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.16 19 — Living receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

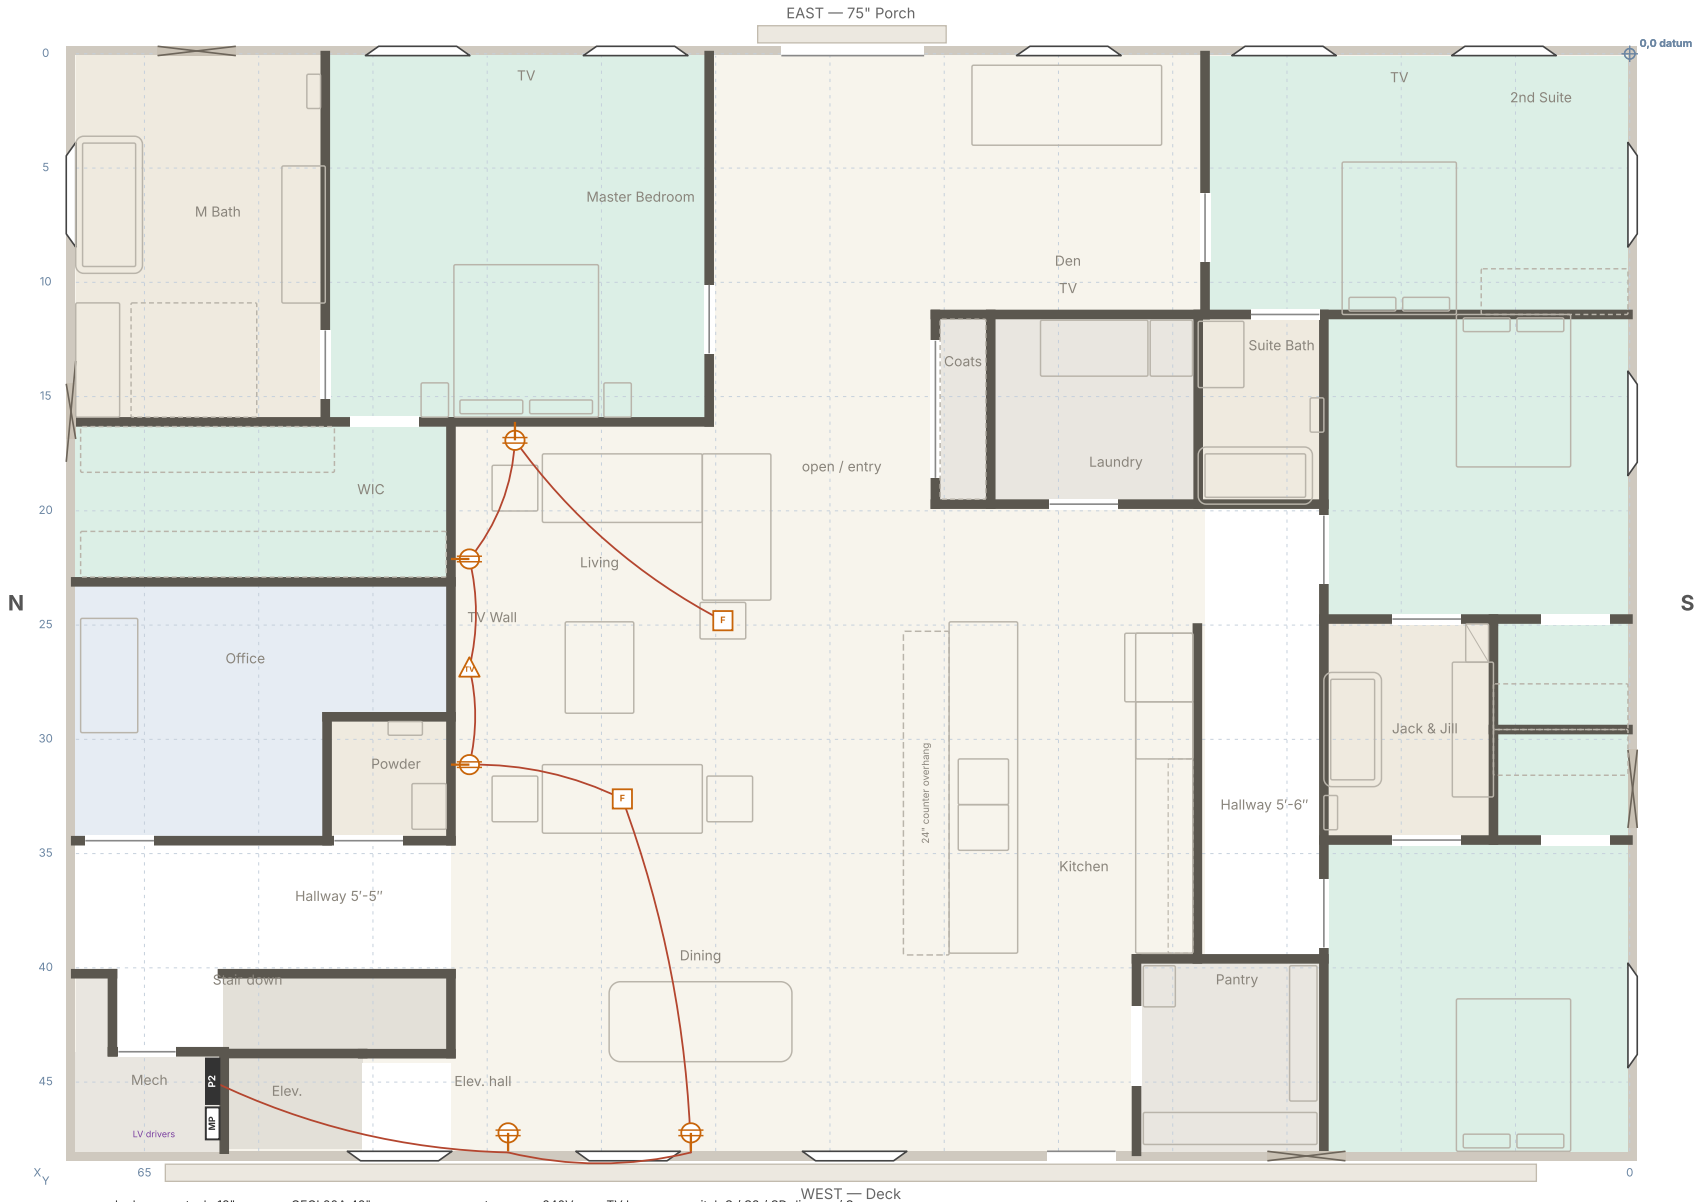


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.17 20 — Den, passage receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

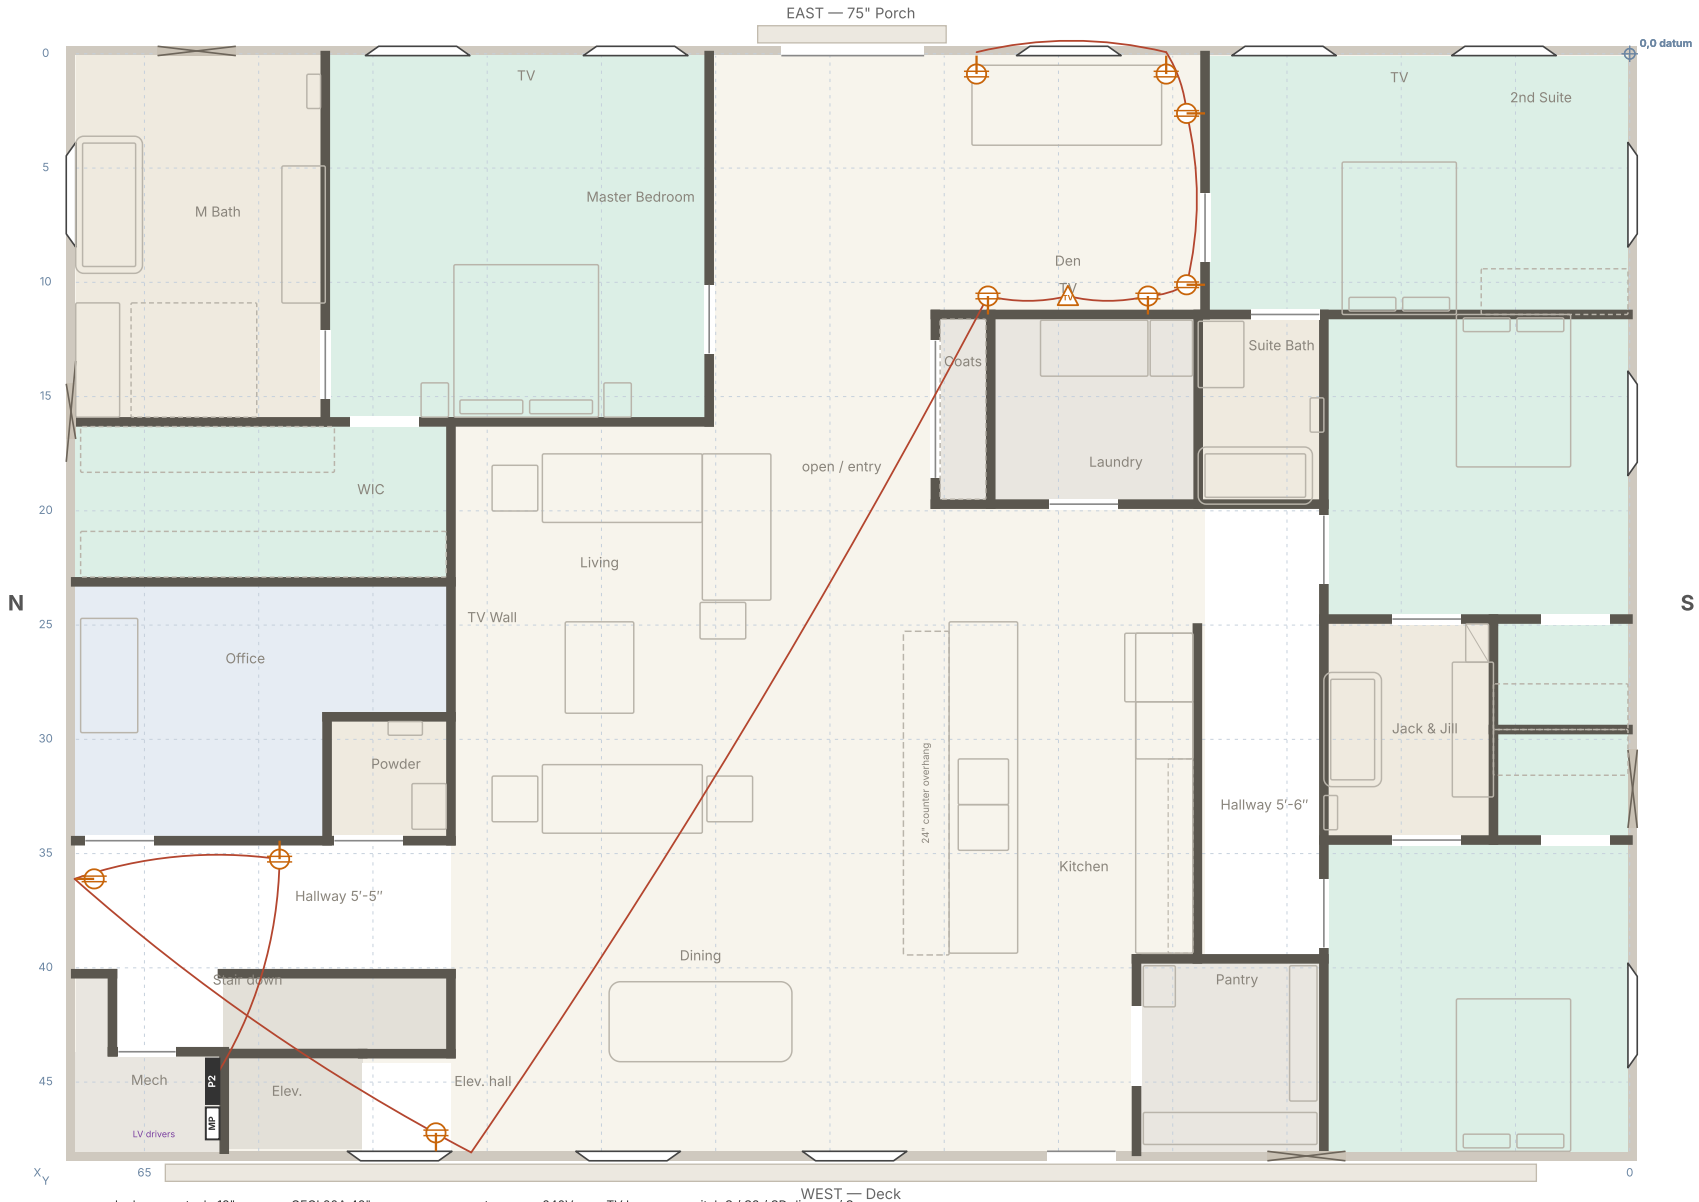


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.18 21 — Lighting A · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

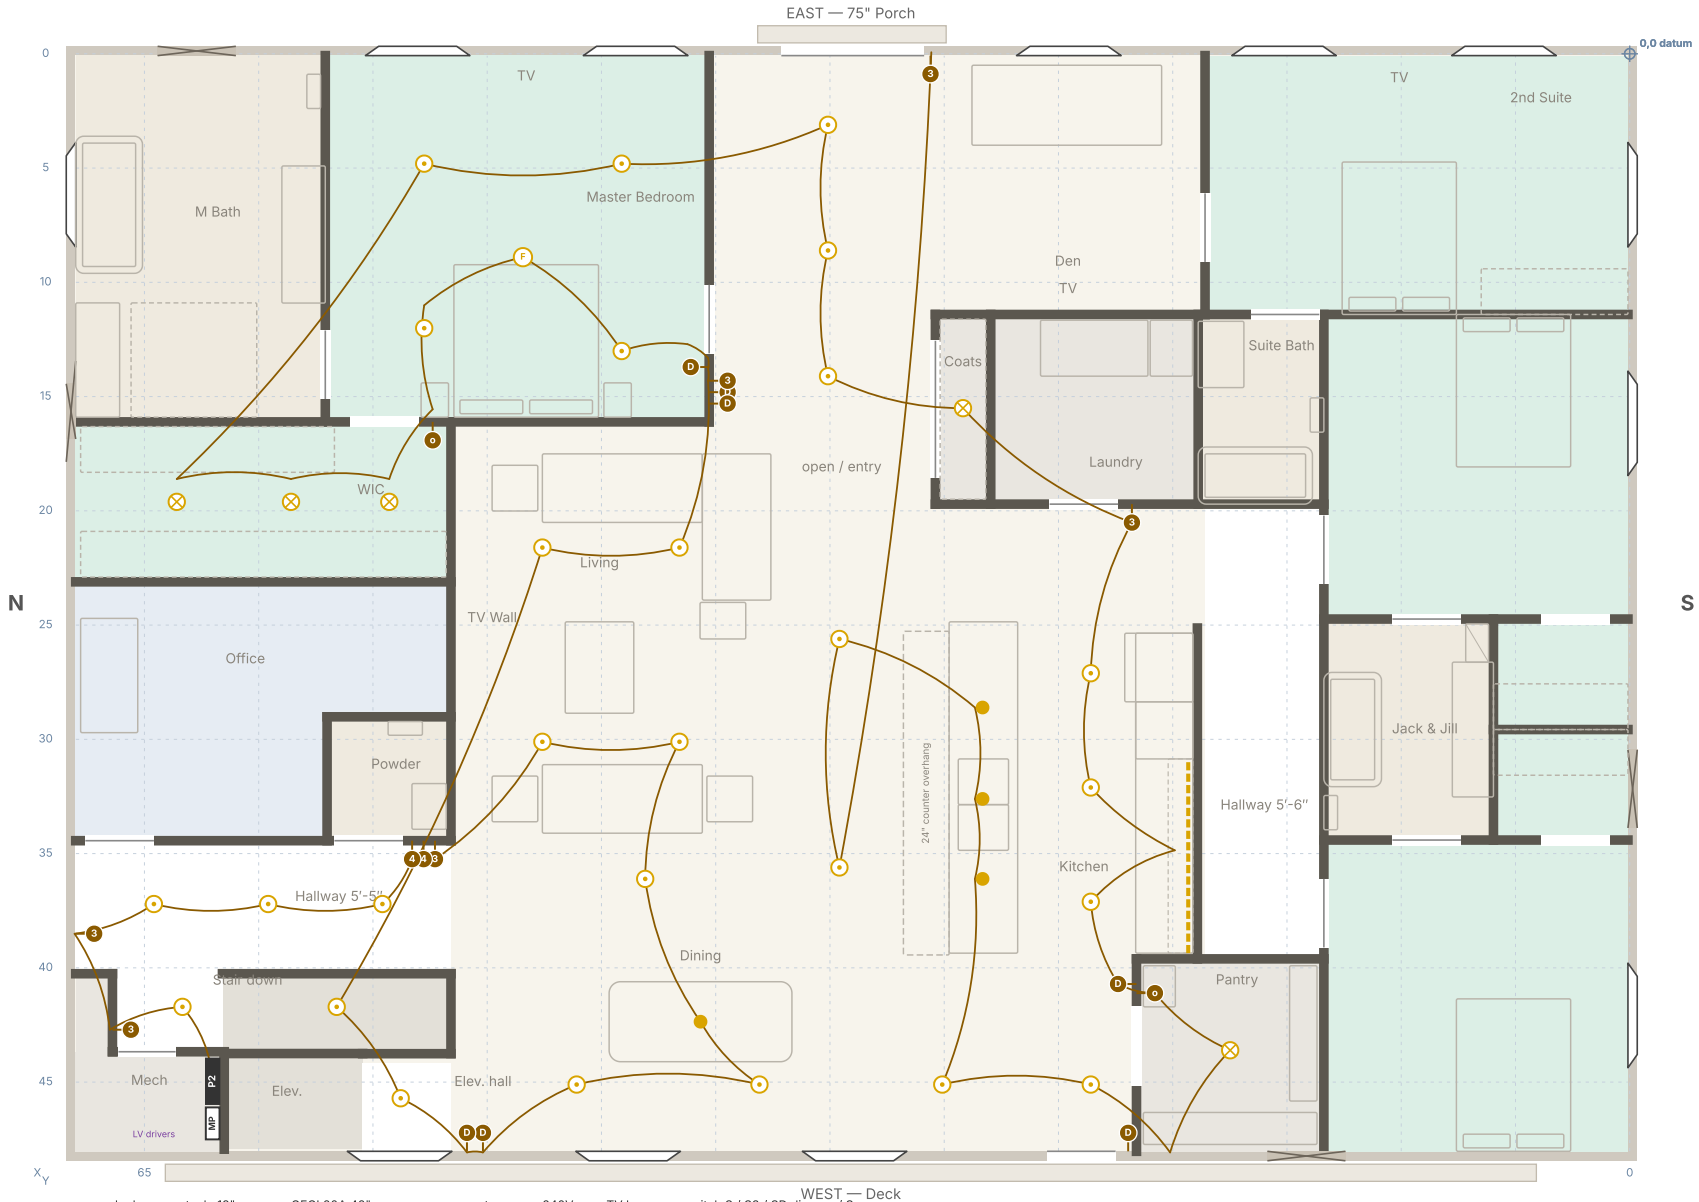

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.19 22 — Lighting B + alarms · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

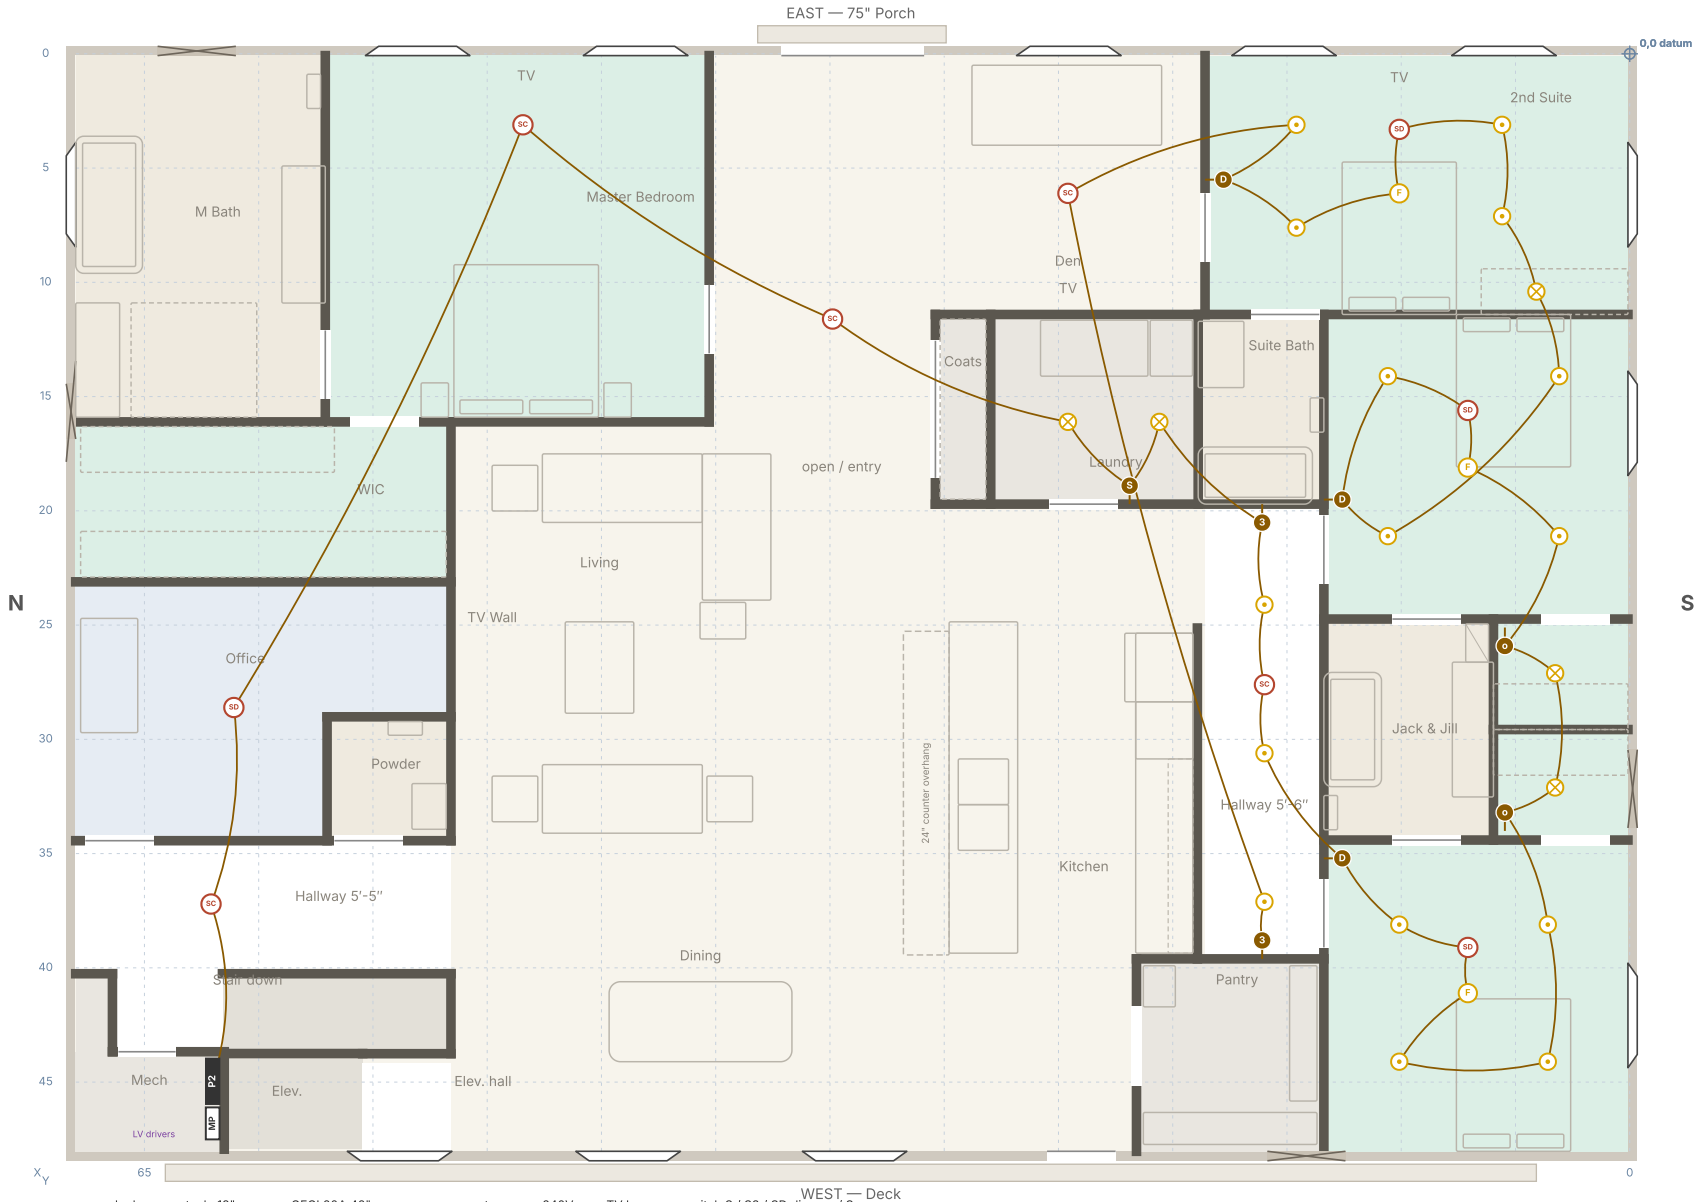


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.20 23 — Cooktop downdraft · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

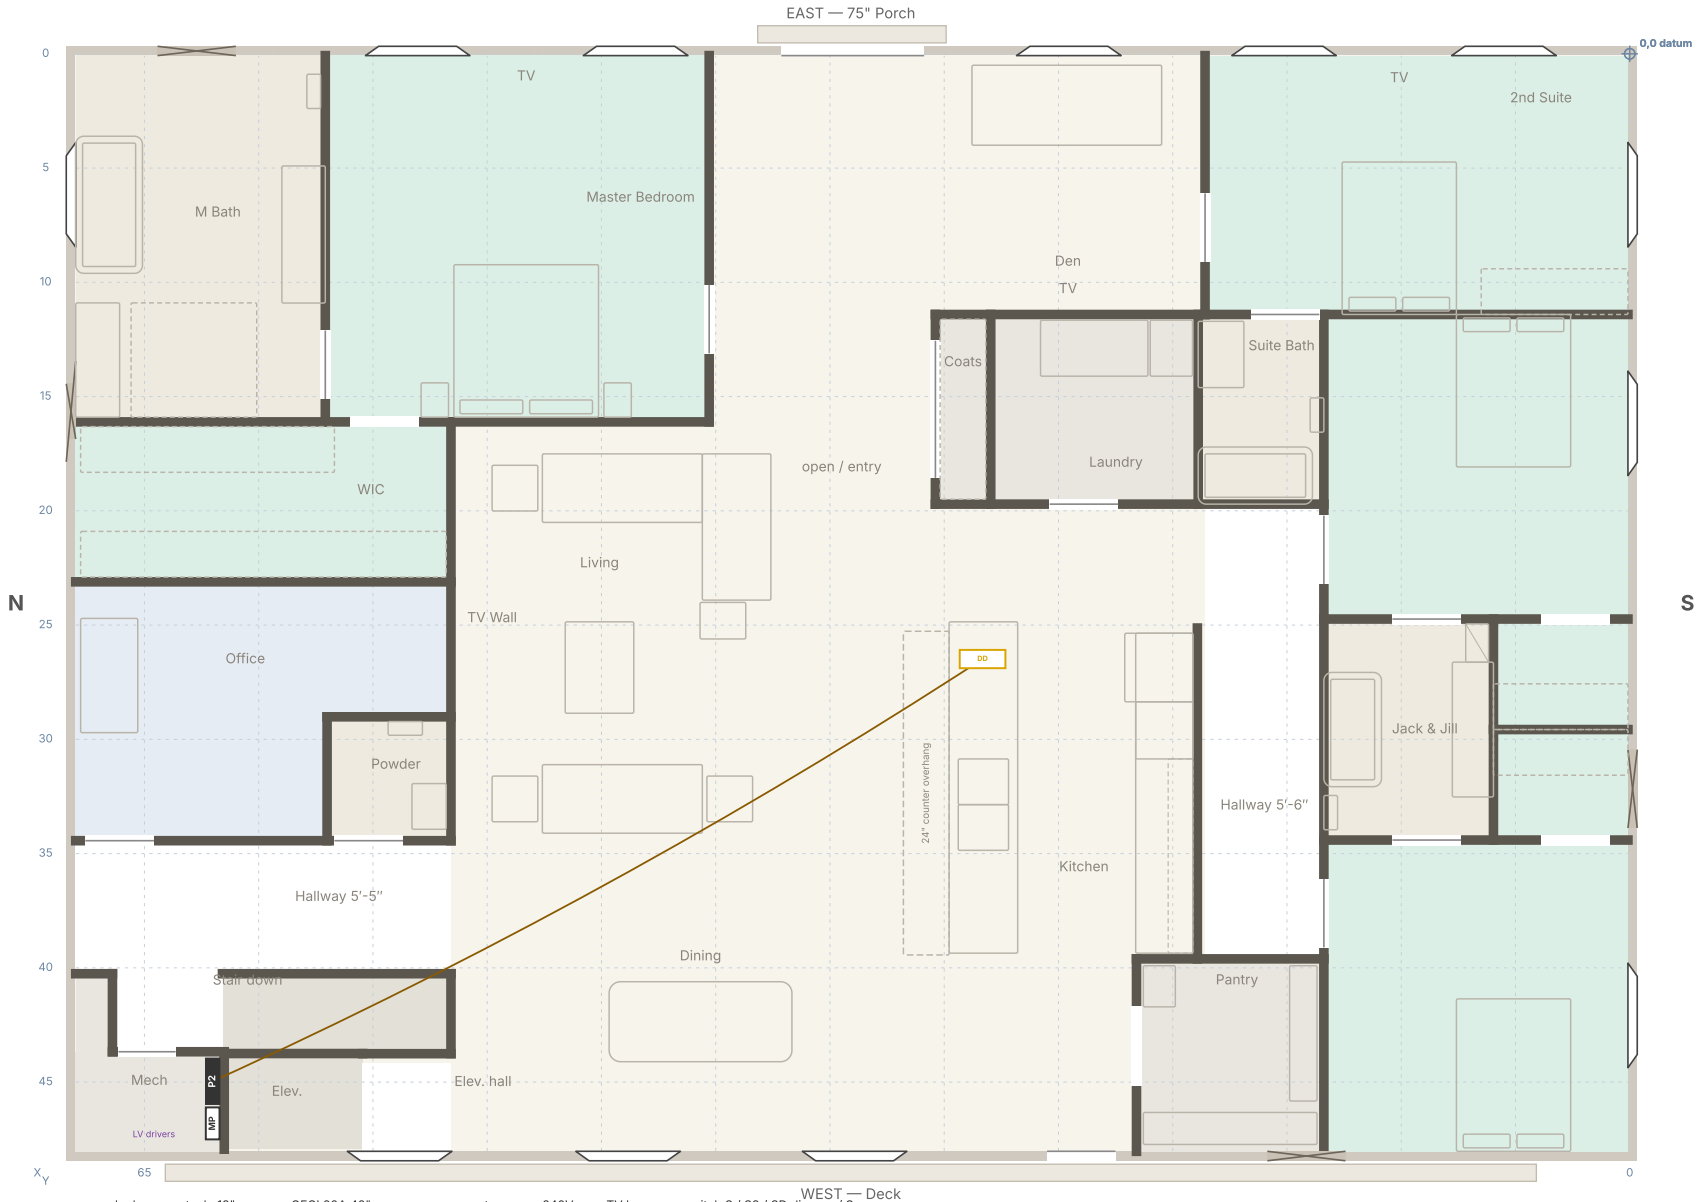


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.21 24 — Exterior receptacles · 20A GFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

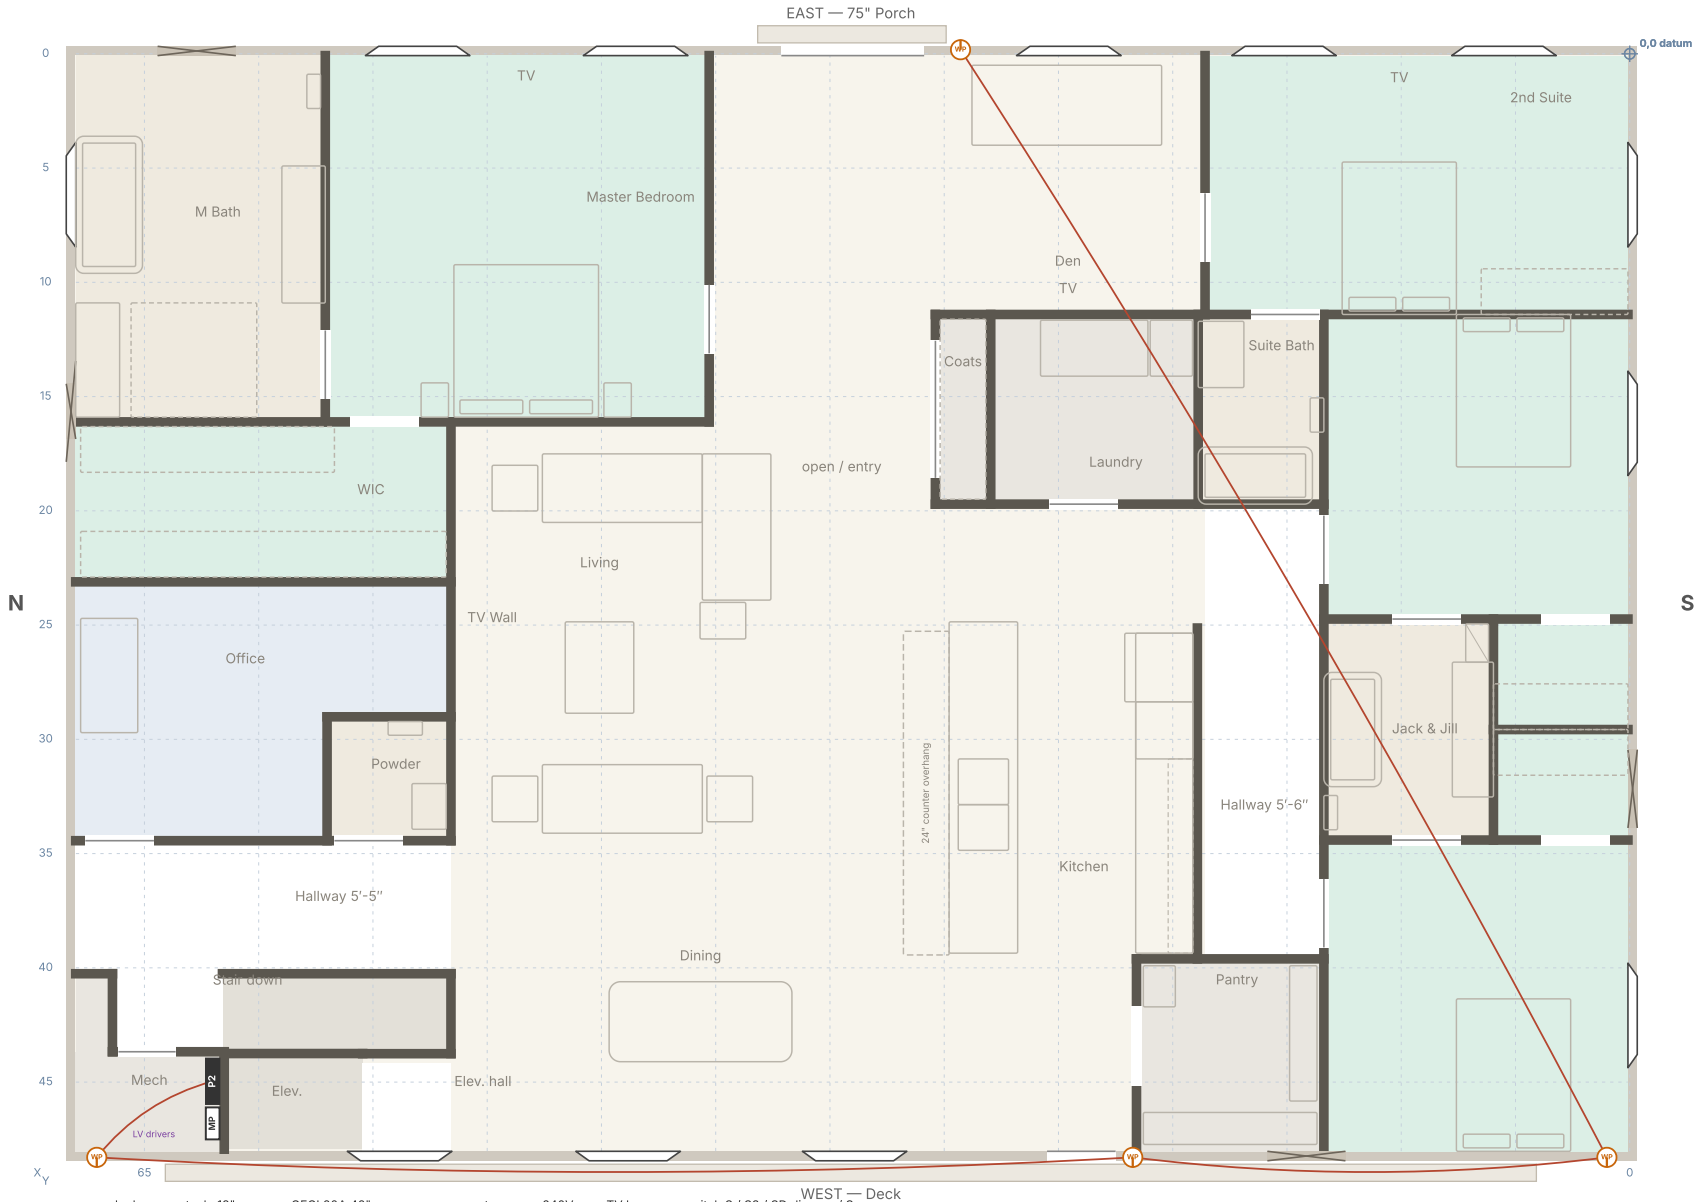


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.22 25 — Mech closet: ventilation unit · 20A · 7824 Zero Road, second floor · rev v61 · 2026-10-26

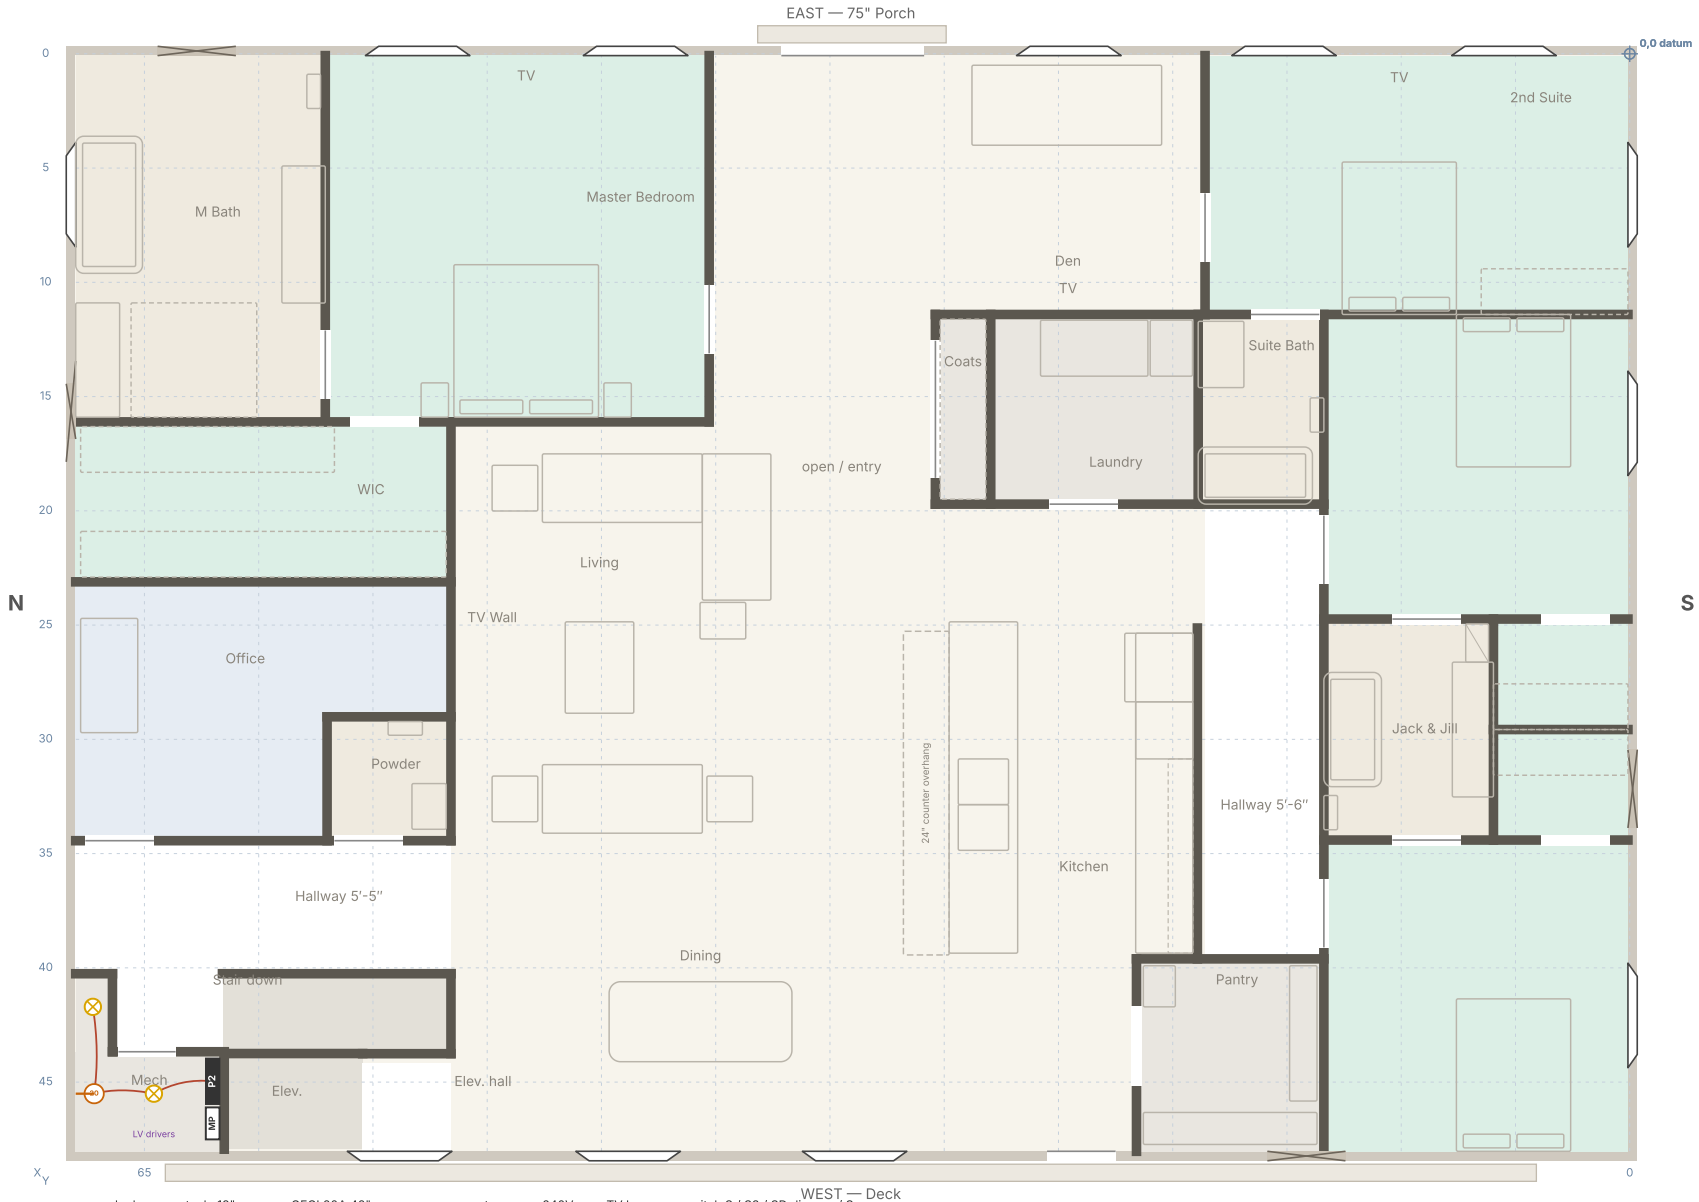


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.23 26 — Exterior soffit lighting · 15A · 7824 Zero Road, second floor · rev v61 · 2026-10-26

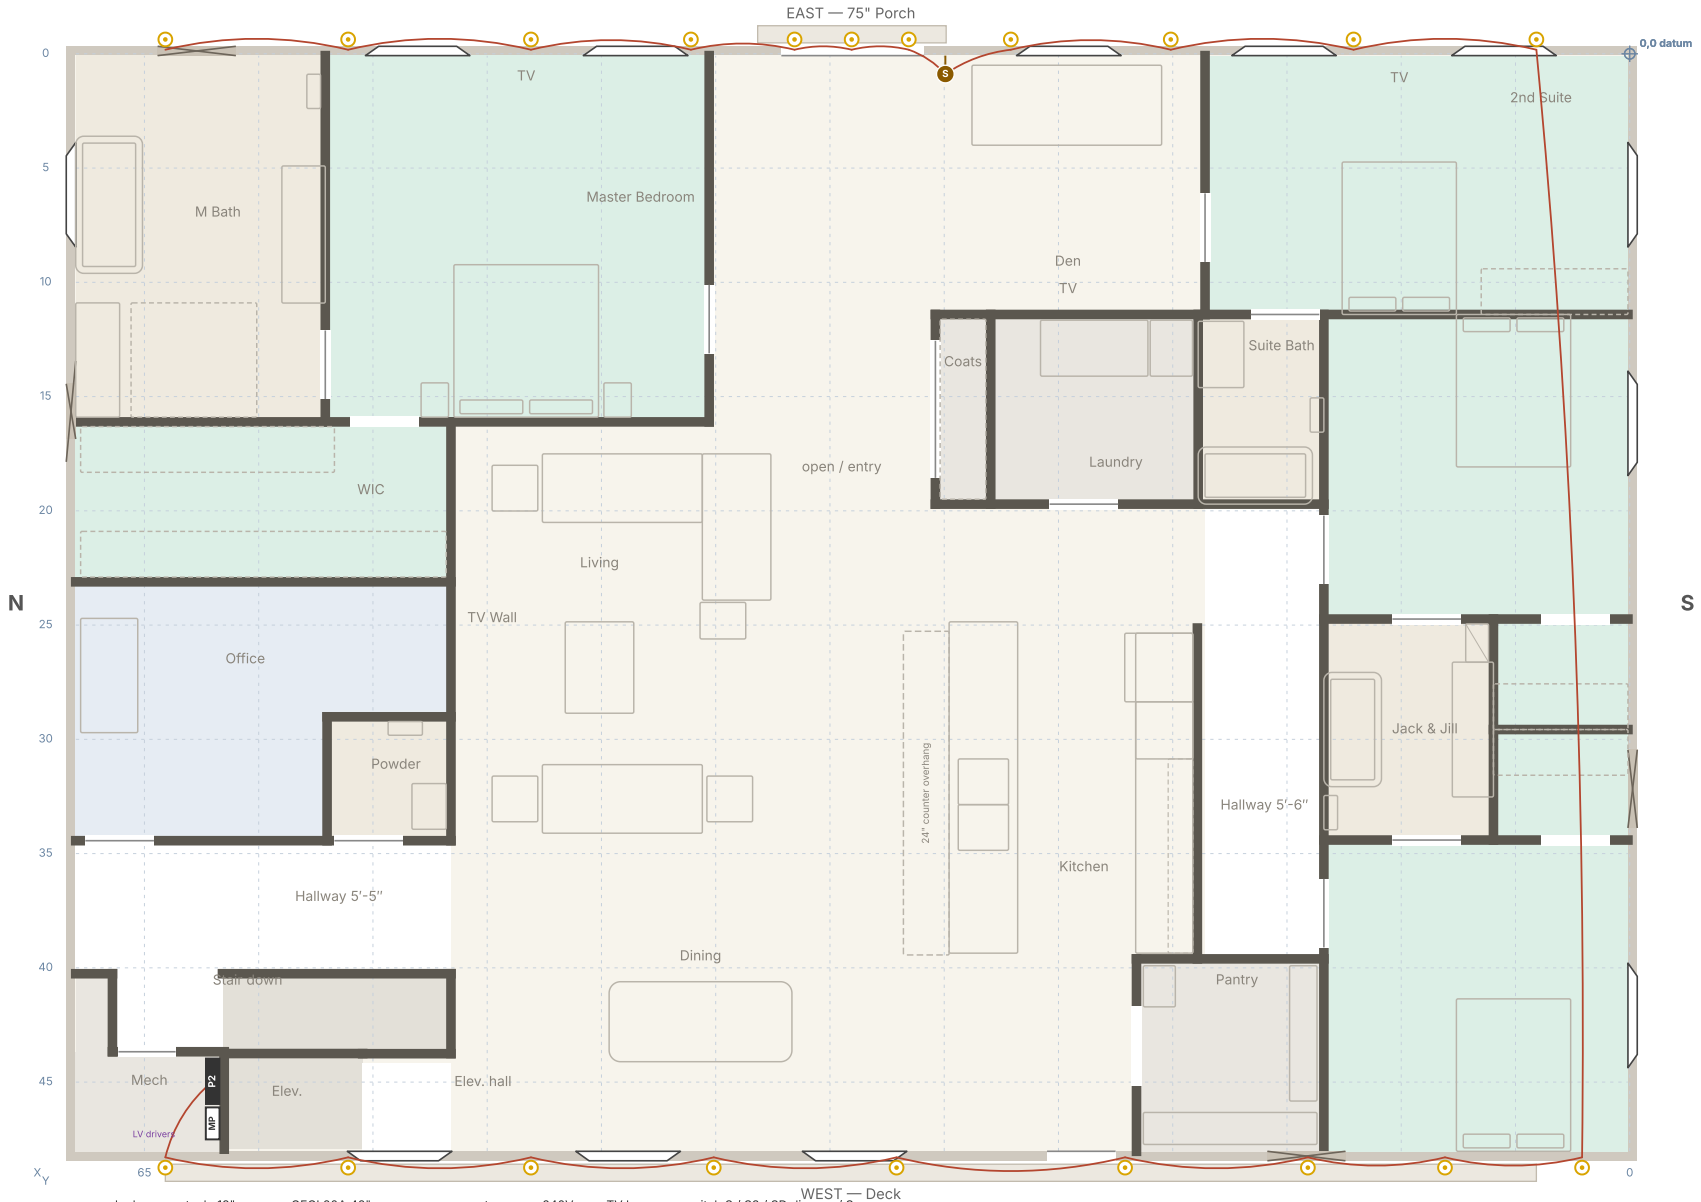

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.25 29 — Bedroom 4 receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

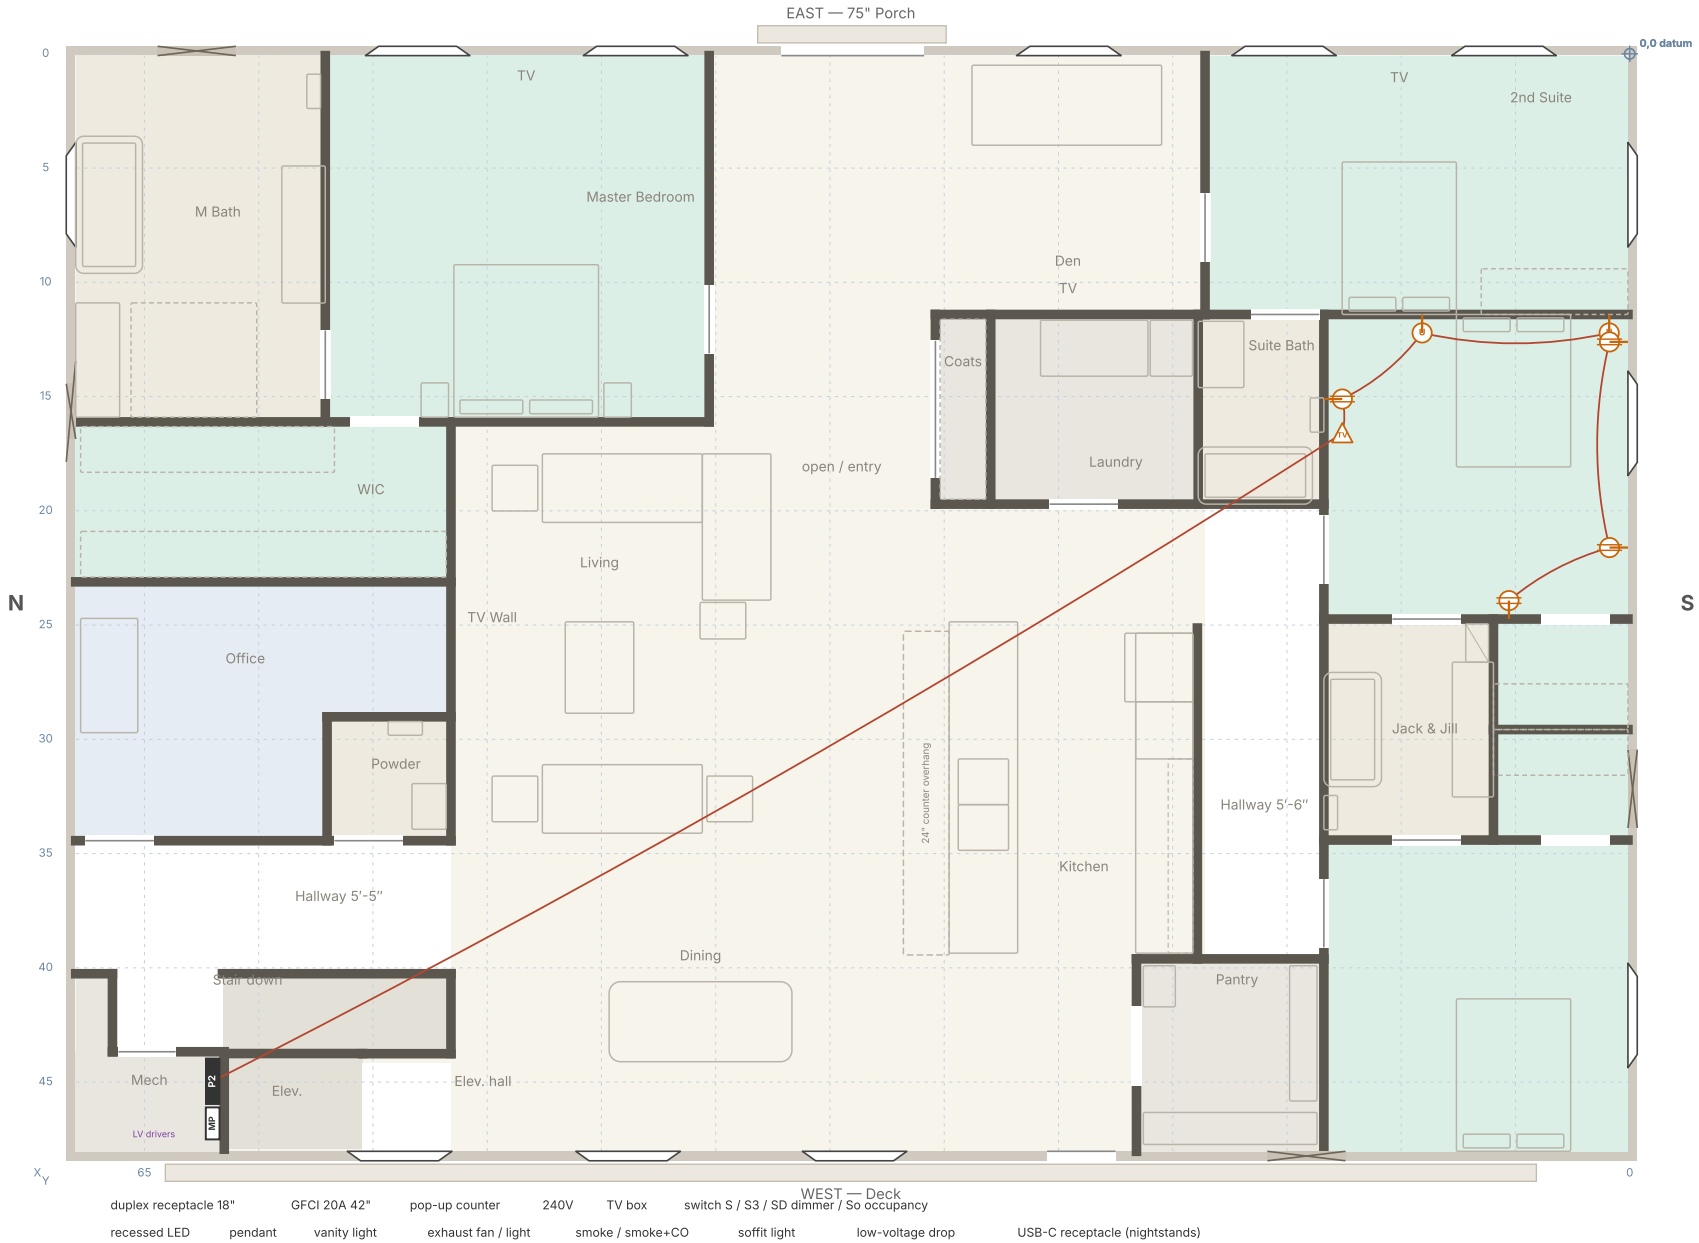


7824 Zero Road
Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE
Base plan 2026-09-29 · wall numbers as that drawing

Electrical plan
Devices, luminaires, alarms and the circuit schedule for sub-panel P2
Schematic for pricing and coordination, not a stamped construction document. Verify on site.

E-1
rev v61
drawn for K. Christianson

E-1.26 30 — Low-voltage power supplies · 15A · 7824 Zero Road, second floor · rev v61 · 2026-10-26

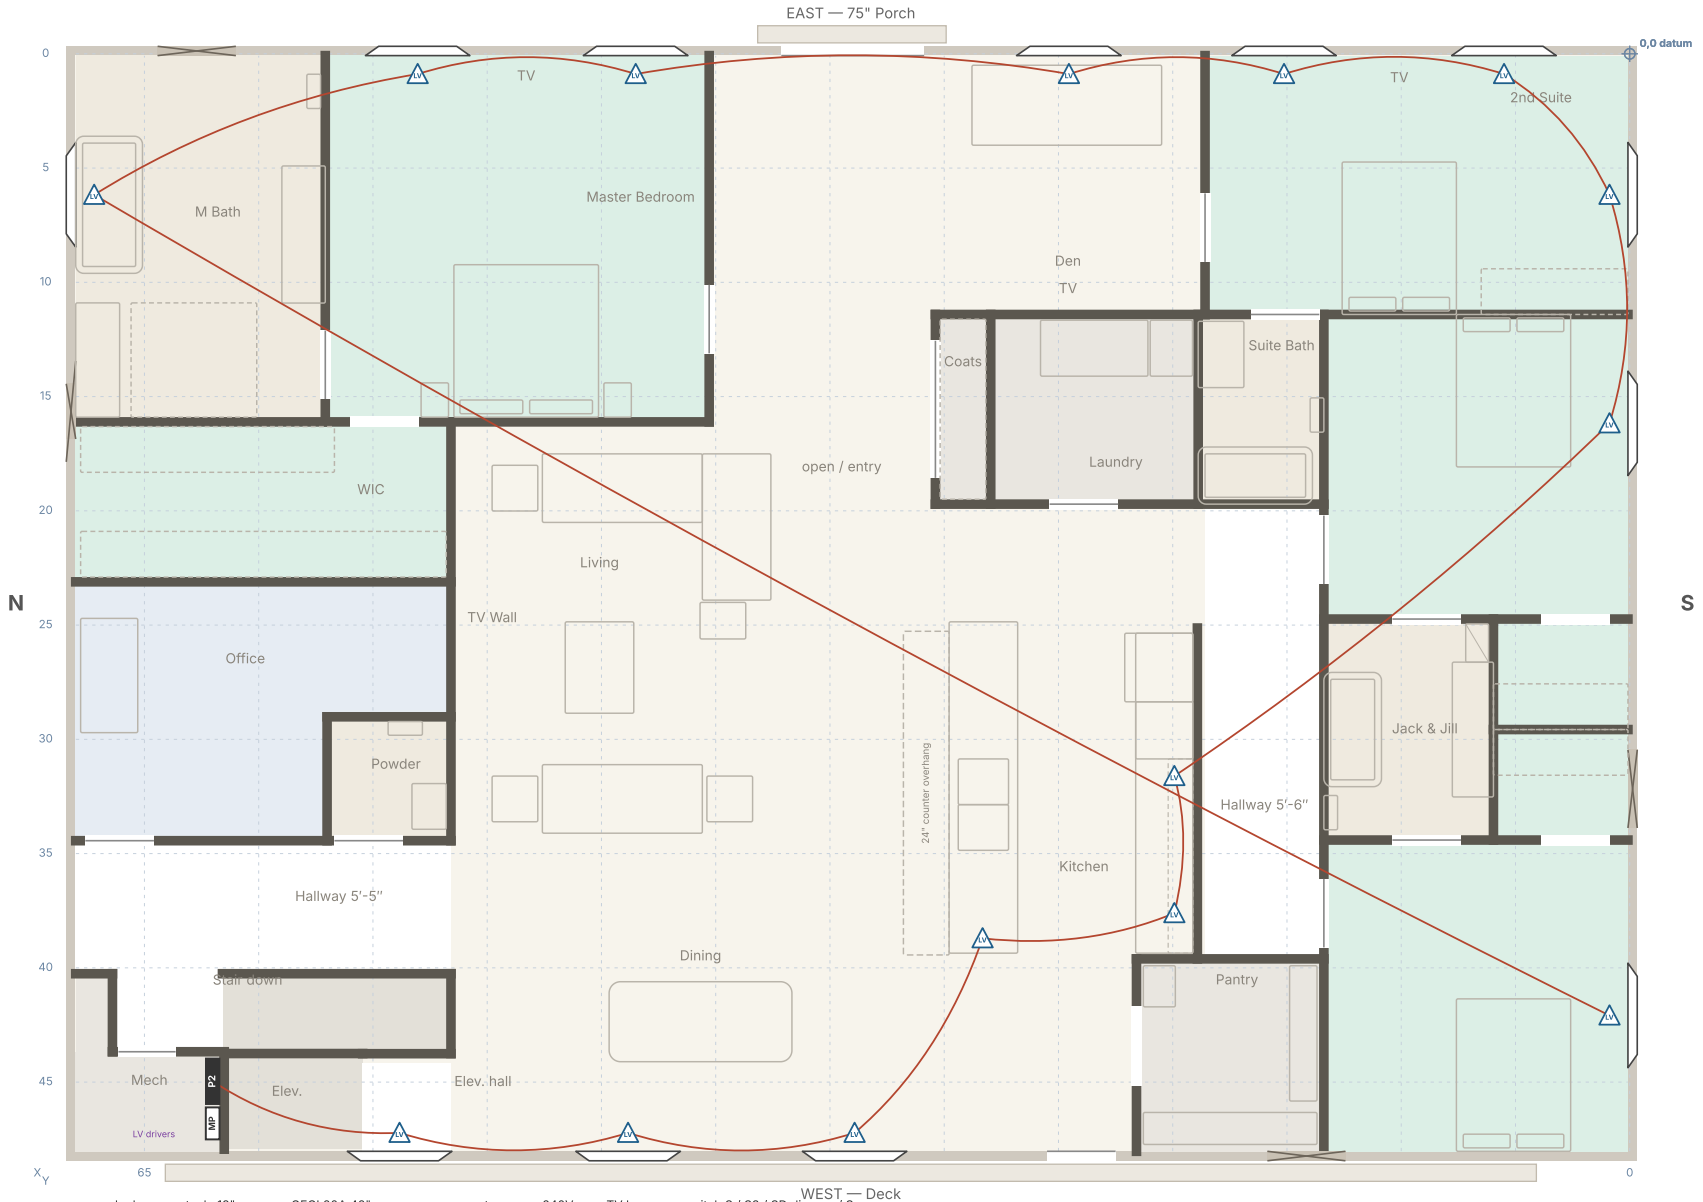


duplex receptacle 18" · GFCI 20A 42" · pop-up counter · 240V · TV box · switch S / S3 / SD dimmer / So occupancy

recessed LED · pendant · vanity light · exhaust fan / light · smoke / smoke+CO · soffit light · low-voltage drop · USB-C receptacle (nightstands)


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.27 31 — Office receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

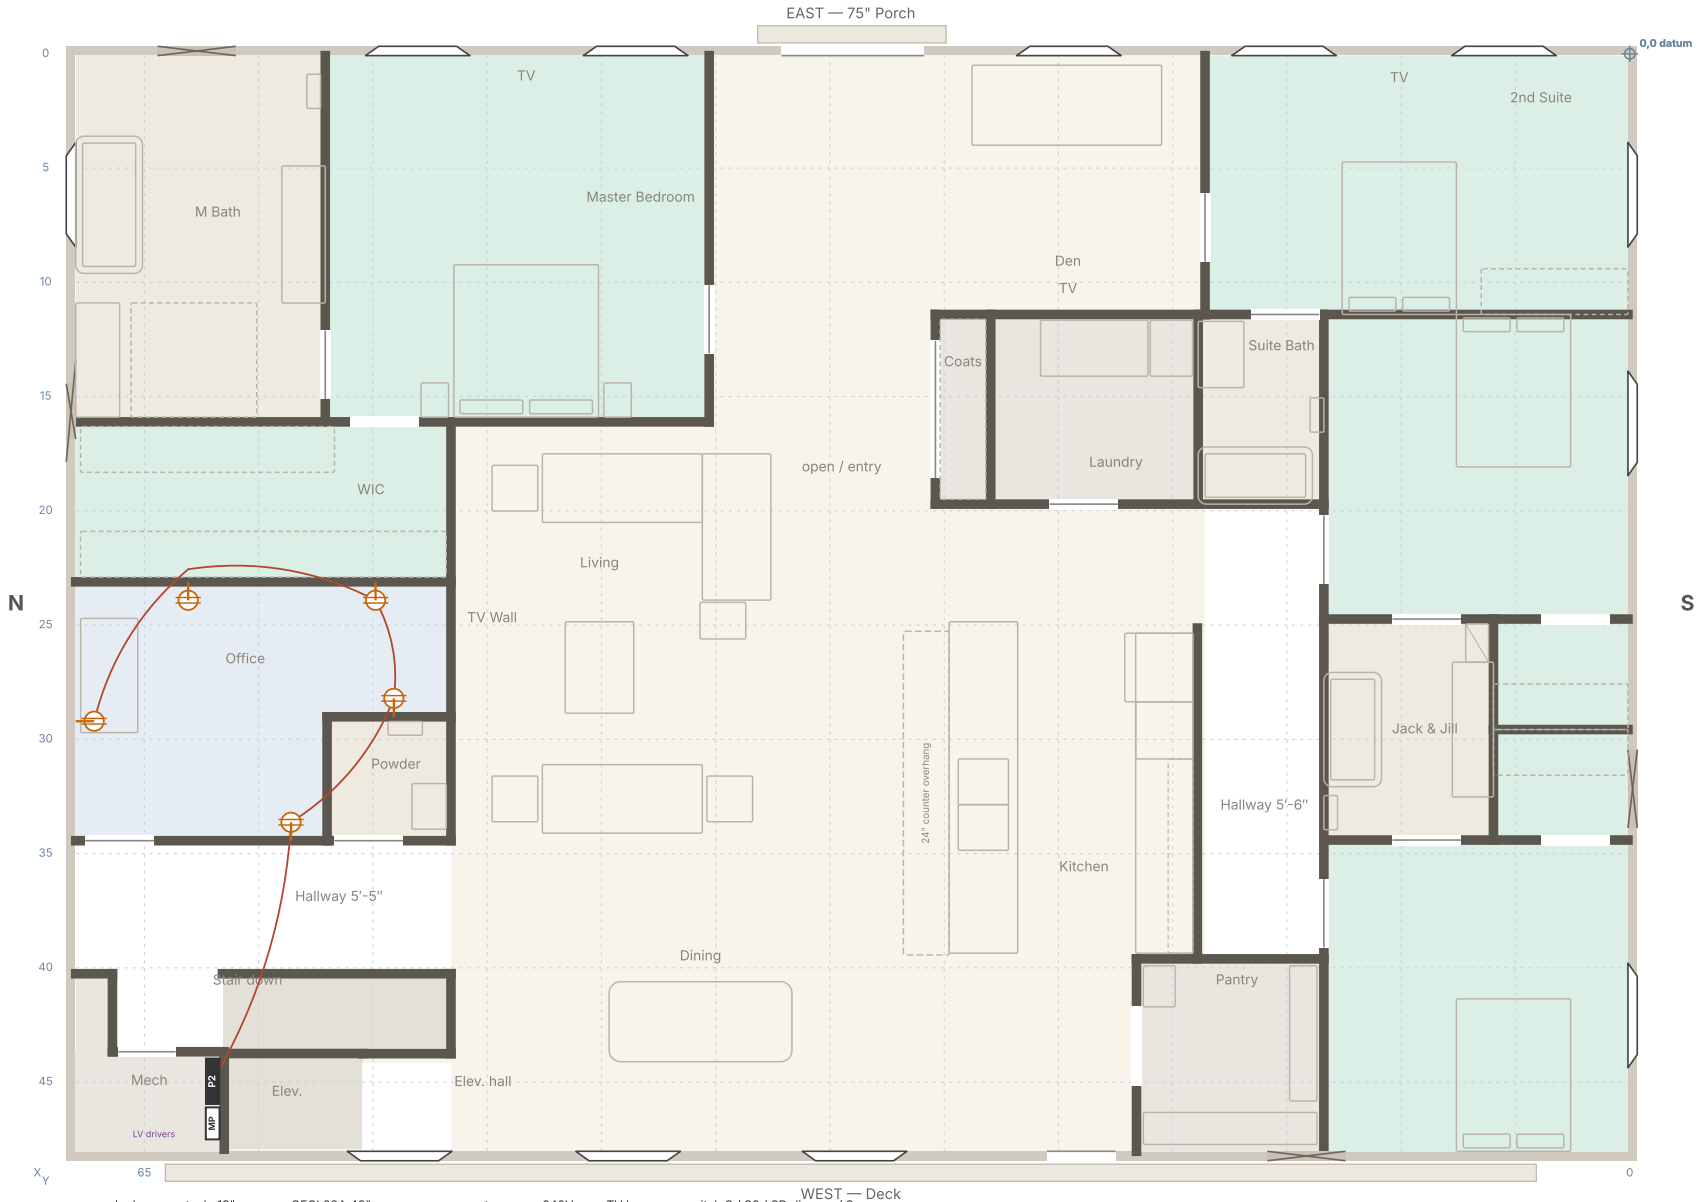


7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.28 32 — Dining, hallway, east entry receptacles · 15A AFCI · 7824 Zero Road, second floor · rev v61 · 2026-10-26

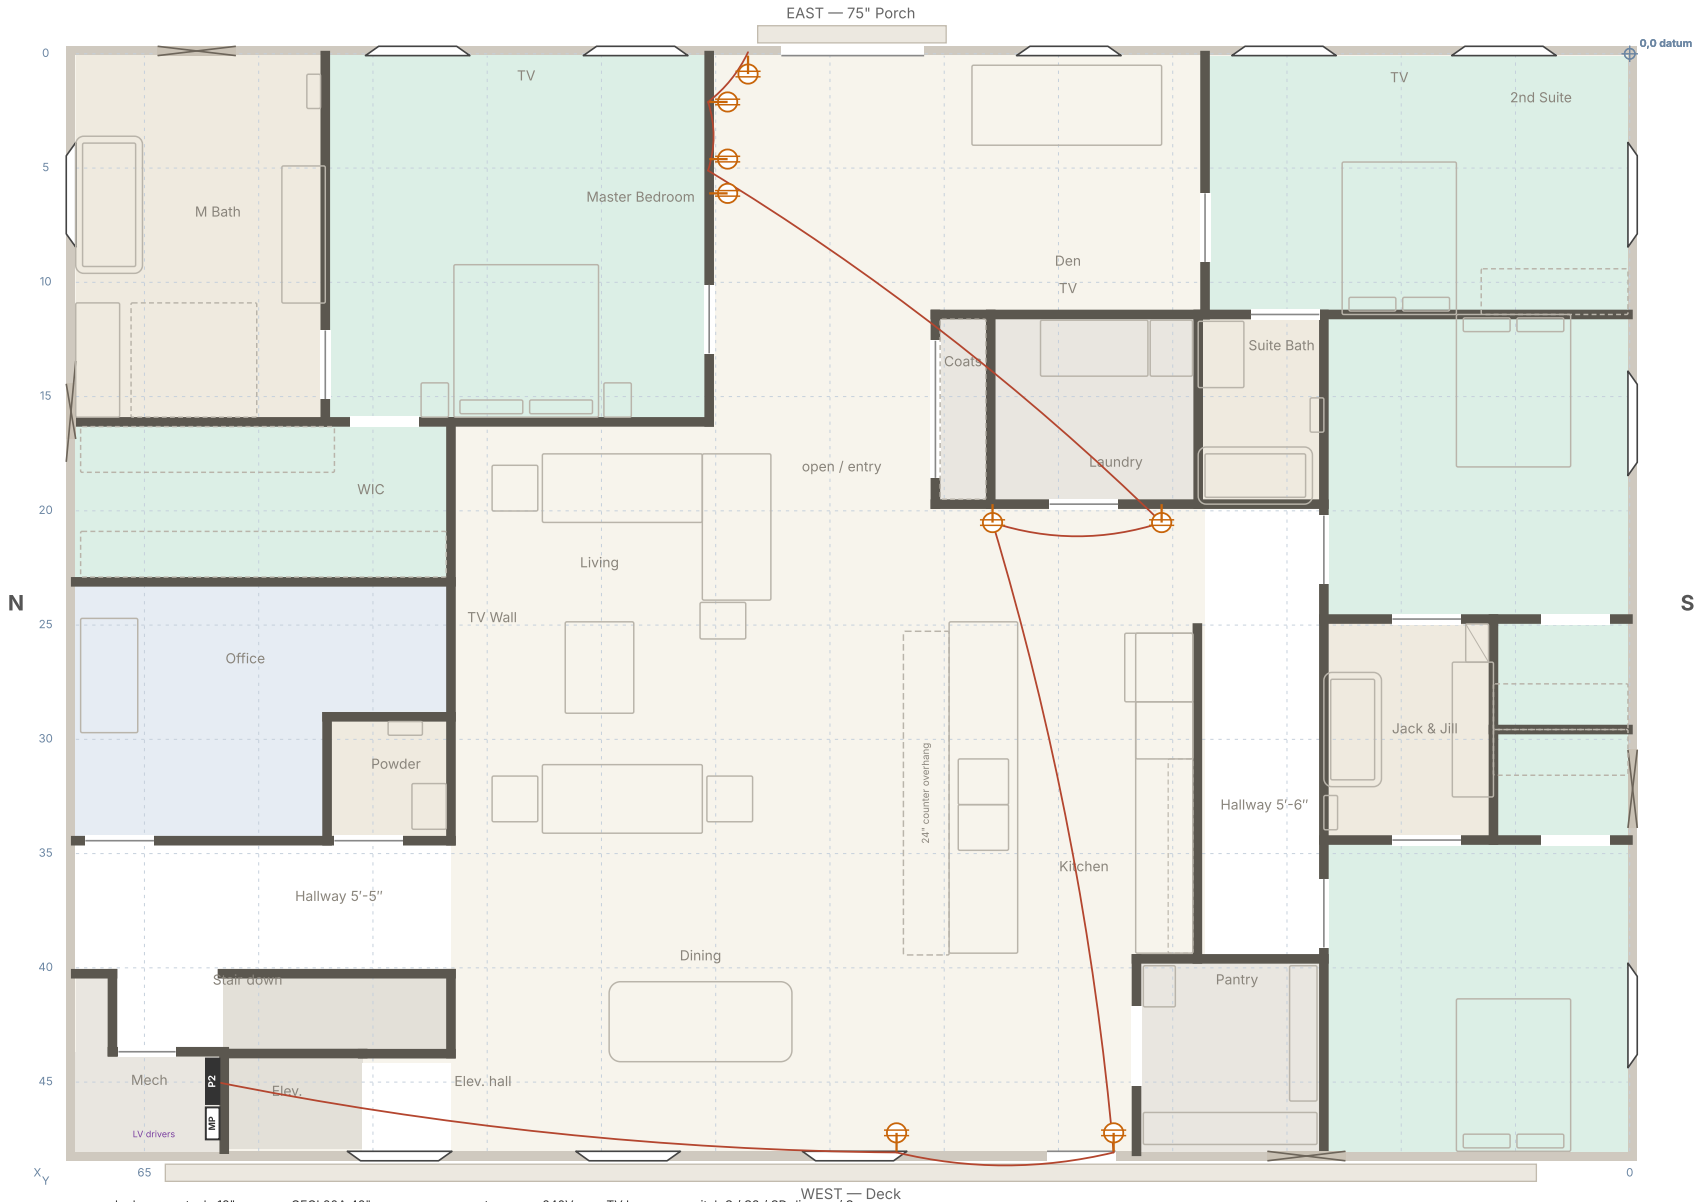

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1.D — Cat6 home runs to the media panel · 7824 Zero Road, second floor · rev v61 · 2026-10-26

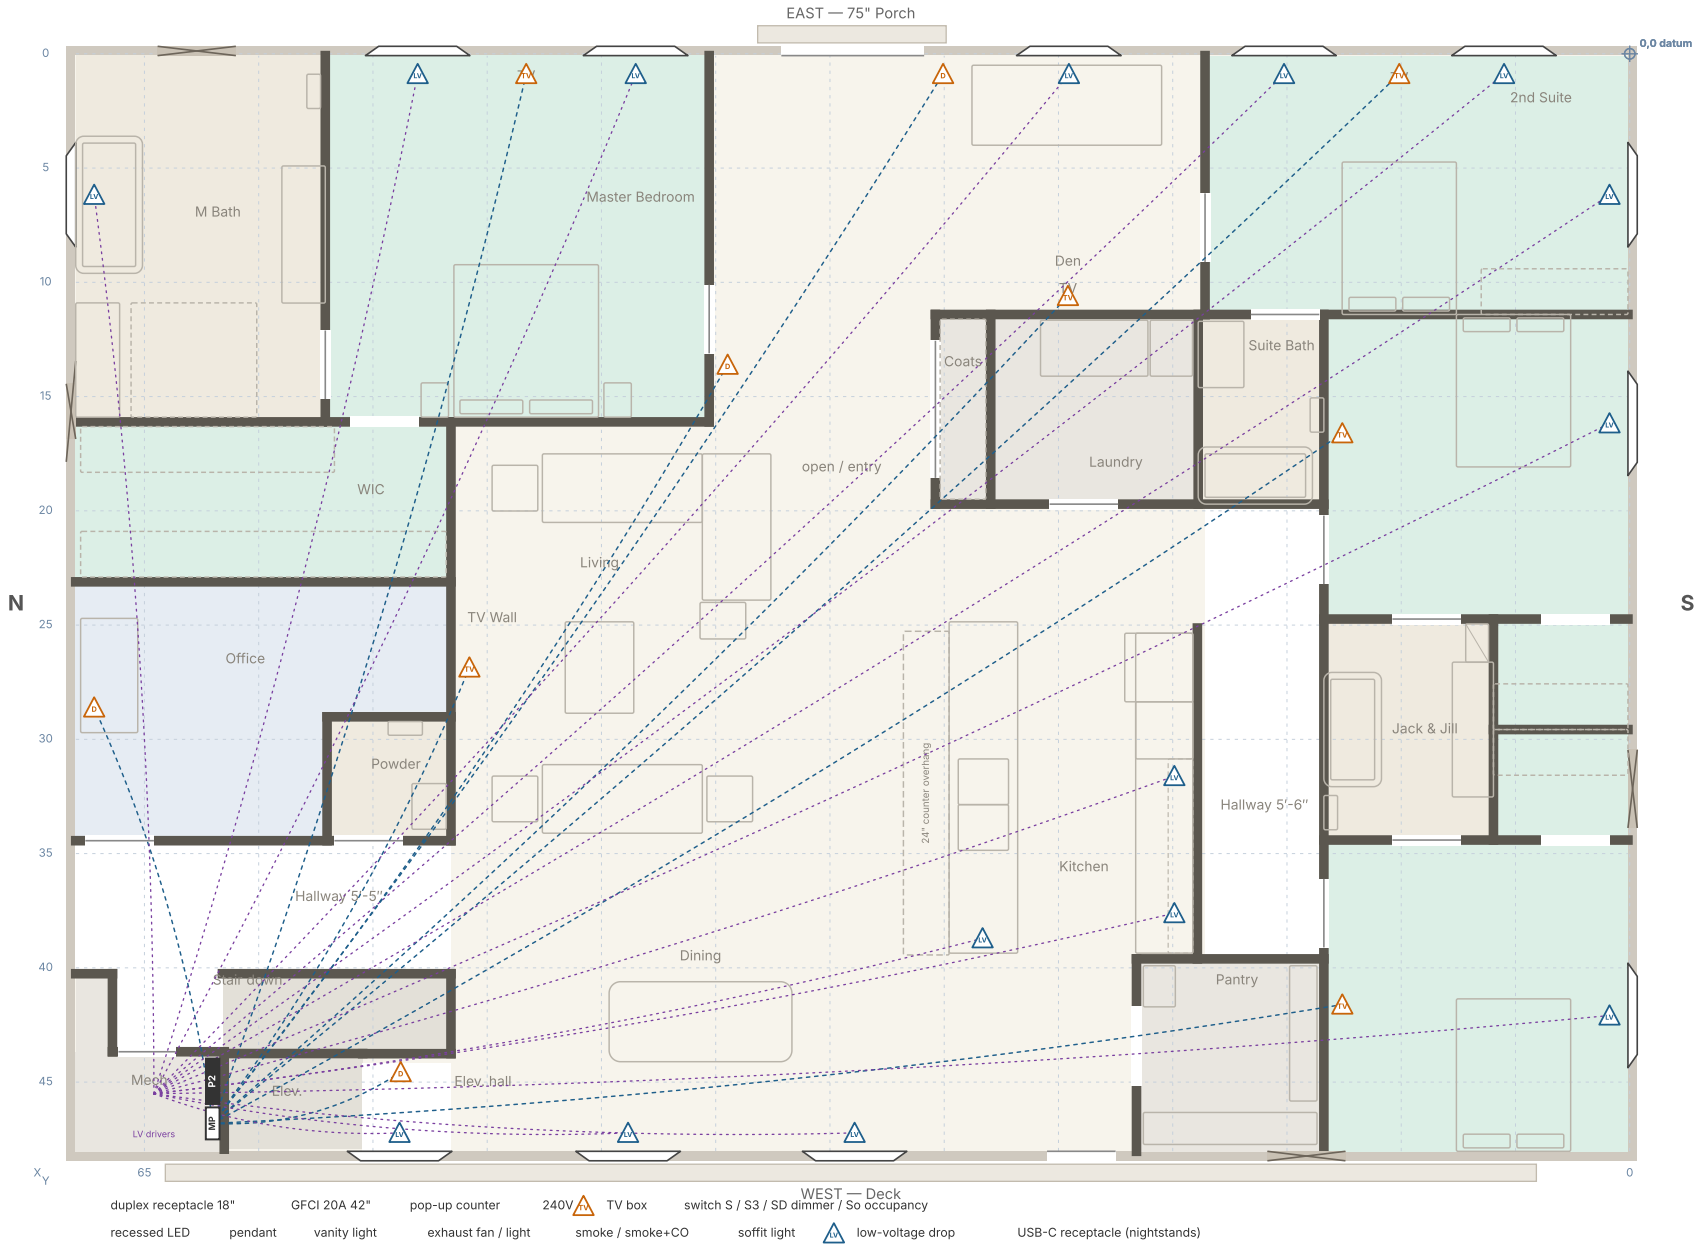

7824 Zero Road Casper, Wyoming · 68'-1" × 48'-1¼" in framing · 9' ceiling · grid 5', 0,0 at SE Base plan 2026-09-29 · wall numbers as that drawing	**Electrical plan** Devices, luminaires, alarms and the circuit schedule for sub-panel P2 Schematic for pricing and coordination, not a stamped construction document. Verify on site.	**E-1** rev v61 drawn for K. Christianson

E-1 Electrical

receptacles R# switches S# lights and fans L# alarms A#

Notes

1. Positions are taped from the nearest wall framing, exterior walls first. Interior walls: to the face of the studs; W# is the wall number on S-1. Exterior walls: to the face of the exterior studs as framed, 4" in from the brick (2×4s held 1/2" off the masonry). "On W12" means the item sits in that wall, and the distance runs along it. Staggered-stud walls are dimensioned to their 2×4 line: on the side they grow toward, the face sits 1-1/2" closer.
2. Code basis: NEC 2023 (confirm the edition adopted by Casper / Natrona County). AFCI on every 120V 15A and 20A branch circuit except the bathroom receptacle circuits (210.12); GFCI at bathrooms, kitchen counters, laundry, dishwasher, exterior and within 6' of any sink (210.8).
3. Accessible mounting: every wall receptacle, 240V outlet and data outlet 30" AFF to centre (owner); switches, dimmers and the GFCI receptacles above counters and vanities 42" AFF (reach range 15"–48"). Rocker switches throughout; no device above a counter deeper than 20". Nightstand receptacles are duplex + USB-C units.
4. Switch plan: every light belongs to one switch leg (table below). On the page, clicking a light highlights every light and switch on its leg; clicking a switch highlights every leg it serves. A switch tag that appears in several legs is a multi-gang bank, one rocker per leg.
5. Circuit sheets E-1.1 onward show one circuit each with its cable run drawn as a chain from P2 through every device in nearest-neighbour order (solid for receptacle and appliance circuits, dashed for lighting). The run is a proposed order, not a required one. E-1.D shows the Cat6 home runs to the media panel beside P2.
6. Sub-panel P2 and the media panel are surface-mounted on the north (mech-room) face of wall 2, the hoistway wall (owner, 2026-10-26); door D21 in wall 1 opens from the landing into the mech room for them and the ventilation unit. Bedroom 3's TV moves to wall 7: wall 10 is the closet door and the Jack & Jill pocket from end to end.
7. Kitchen: two 20A small-appliance circuits (7, 8). Island receptacles are pop-up units in the counter at the sink end and the prep end plus one in each end panel; the wall run has counter receptacles at 42". Cooktop, oven, refrigerator, dishwasher drawers and microwave drawer each on a dedicated circuit. Circuit check (2026-10-06): the ERV service receptacle R1 is a 20A device, so circuit 25 is 20A on #12 (NEC 210.21(B)(3) allows no 20A receptacle on a 15A circuit); Bedroom 4 moved to its own 15A circuit 29, leaving 17 to Bedroom 3 and the wing hall. Circuit rebalance (owner, 2026-10-09): Lighting A (21) carried 51 luminaires including the five bath fan/light units, about 733 W of LED at the design wattages, and Lighting B (22) 37 with the four fan boxes, about 619 W. Both were under the 1,440 W continuous limit of a 15A circuit, but one trip would darken half the floor, so the lights are now three circuits by area, whole switch legs only: 21 living, walkway, halls, stair, dining, east entry, kitchen, pantry, master bedroom, WIC and coat closet (38 luminaires, ~459 W); 10 Lighting C, office, den, powder, master bath, suite bath and Jack & Jill with the fan/light units (25, ~400 W); 22 the three east bedrooms, their closets, wing hall, laundry and the alarms (23, ~427 W). Design wattages: cans 9 W, wet cans 10 W, vanity lights 20 W, pendants 15 W, fan/light units 35 W, fan boxes 75 W. Receptacles: 19 and 20 carried 16 and 18 outlets on 15A, so P2 is a 40-space panel and they split by room: 19 living (8), 32 dining, hallway and east entry (8), 20 den, passage and elevator hall (10), 31 office (5); spaces 33-40 are spare, 27-28 the two-pole spare. The cooktop downdraft blower ducts 6" in the floor to the west wall (P-1).
8. Lighting: 4" recessed LED cans, 2700K, dimmable, on 0–10V or Lutron Caséta-type dimmers; wet-rated cans over the shower pad and tubs; closet fixtures surface LED with 12" clearance to shelves (410.16). Pendants over the island and the dining table. Hallway, stair and the great room on 3-way or multi-location dimmers. The living cans have four control points (S11, S12, S32 and S35 at the entry); the walkway cans L35, L38 and L112 are on their own 3-way dimmer: S34 beside S13 at the entry and S36 beside S32 at the hall end. Master bath: all cans, both vanity lights and the fan unit's light on one dimmer (owner, 2026-10-07); the 2-gang bank sits on wall 23 on the strike side of D18, between W20 and the door, 42" AFF. Wall 23 is a 2×4 wall (owner, 2026-10-12), so nothing can go in the pocket past the door.
9. Smoke alarms in every bedroom and the office; smoke + CO combination alarms outside each sleeping area (hall at the office, outside the master suite, wing hall, den). All 120V, interconnected, battery backup (IRC R314, R315).
10. Bath exhaust fans 110 CFM with humidity sensing and an integrated dimmable LED light (owner, 2026-10-07: the light switches with the room's other lights, the fan on its own rocker; one 14/3 from the bank to each unit, so the units sit on Lighting C, circuit 10), ducted to the exterior in rigid duct: master bath and powder teed together in the attic to one cap on the north gable wall, suite bath and Jack & Jill teed to one cap on the south gable wall (6" from each tee to its cap; insulated duct sloped to the cap). Dryer: 4" rigid metal, up into the ceiling and straight east to a wall cap high on the east ext. wall (owner, 2026-10-12), 35' equivalent max (about 29' as drawn).
11. TV locations get a recessed box with power and 2 × Cat6 at 60" AFF; data outlets home-run to a media panel in the mech closet beside P2 (Cat6 to every TV, office desk and the elevator hall for the controller).
12. Exterior soffits: LED downlights the length of the west soffit on one switch inside the deck door; on the east, three lights over the exit door on switch leg A and the rest of the east soffit on leg B, both rockers inside the east door (circuit 26). Weatherproof GFCI receptacles in the soffit at both ends of the west wall, at the deck door, and beside the east door (circuit 24).
13. Low voltage (purple on E-1.D): an 18/2 drop in 1/2" conduit at the head of every unblinded window for motorised shades (pull 18/4 instead where the shade brand wants wired control), at the island base for LED and charging, and at both kitchen cabinet runs for under-cabinet LED, all home-run to a driver board in the mech room on circuit 30. Cat6 also to the east door (doorbell, camera, lock at 48") and to a 2-gang touchscreen box on the entry face of wall 19, 15'-6" from east ext. wall, 48" AFF.
14. Kitchen: the induction cooktop is in the island (circuit 1-2, junction in the island base) with a downdraft vent whose blower and 6" duct run in the floor to the west wall (P-1). The wall run keeps the oven and refrigerator.

15. Elevator: 240V 30A and 120V 15A (car light and hoistway) from the main panel with a lockable disconnect at the machine space, telephone line in the car, all by the elevator contractor. Not on P2.
16. No heated floor or towel warmer in the master bath.
17. Office receptacles checked against NEC 210.52(A)(1) (owner asked, 2026-10-26): the office has one continuous wall space of about 52'-6" from the D15 jamb around the room and back to the door, so it needs a receptacle within 6' of each jamb and no more than 12' apart: five. It had eight. R3, R6 and R7 are gone, R13 moved 2'-2" south on W18 and R12 sits at the desk; R8, R10, R5 stay. R10 to R13 is 11'-8" along the wall, close to the 12' limit: keep the five where drawn.
18. Nightstand receptacles (U, duplex with USB-C) sit 6" off each side of the bed, 30" AFF, so the nightstand covers them.
19. Vanity lights: one over the mirror in the powder (L16) and the suite bath (L62), 78" AFF; two in the master bath and the Jack & Jill (owner, 2026-10-26).

Circuit schedule, sub-panel P2

P2: 125A main-lug sub-panel in the mech closet, fed from the main panel below with #1 Cu (or 2/0 Al) THHN in 1-1/4" conduit, 4-wire, isolated neutral, bonded ground. Size by the NEC 220 load calculation; 125A assumed. The elevator keeps its own 240V 30A + 120V 15A feeds and disconnect from the main panel, by the elevator contractor.

Ckt	Load	Breaker	Wire	Serves	Devices
1-2	Induction cooktop	240V 40A 2P	#8 Cu	kitchen wall run	1
3-4	Wall oven, side-opening	240V 30A 2P	#10 Cu	kitchen wall run	1
5-6	Dryer	240V 30A 2P	#10 Cu	laundry	1
7	Kitchen small appliance 1	20A GFCI/AFCI	#12	island sink end, wall run, W15	4
8	Kitchen small appliance 2 + pantry	20A GFCI/AFCI	#12	island prep end, wall run, pantry	4
9	Refrigerator	20A AFCI	#12	kitchen	1
10	Lighting C	15A AFCI	#14	office, den, powder, master bath, suite bath, Jack & Jill, the four bath fan/light units	32
11	Dishwasher drawers	20A GFCI/AFCI	#12	island	1
12	Microwave drawer	20A AFCI	#12	island	1
13	Laundry: washer, sink, counter	20A GFCI/AFCI	#12	laundry	3
14	Bath receptacles west	20A GFCI	#12	master bath, powder	3
15	Bath receptacles east	20A GFCI	#12	suite bath, Jack & Jill	3
16	Master suite receptacles	15A AFCI	#14	master bedroom, WIC	9
17	Bedroom 3 receptacles + wing hall	15A AFCI	#14	bedroom 3, closet 3, wing hall	8
18	2nd Suite receptacles	15A AFCI	#14	2nd Suite	7
19	Living receptacles	15A AFCI	#14	living, TV wall, floor boxes	8
20	Den, passage receptacles	15A AFCI	#14	den, passage, elevator hall	10
21	Lighting A	15A AFCI	#14	living, walkway, halls, stair, dining, east entry, kitchen, pantry, master bedroom, WIC, coat closet	55
22	Lighting B + alarms	15A AFCI	#14	2nd Suite, Bedrooms 3 and 4, their closets, wing hall, laundry, smoke/CO alarms	40
23	Cooktop downdraft	15A AFCI	#14	cooktop downdraft blower	1
24	Exterior receptacles	20A GFCI	#12	soffit receptacles, west and east	4
25	Mech closet: ventilation unit	20A	#12	ERV / vents, service receptacle	3

Ckt	Load	Breaker	Wire	Serves	Devices
26	Exterior soffit lighting	15A	#14	west soffit, east door group, east soffit; three switch legs	21
27-28	Spare 2P	240V 30A 2P	—	future (sauna, EV on deck, etc.)	0
29	Bedroom 4 receptacles	15A AFCI	#14	bedroom 4, closet 4	7
30	Low-voltage power supplies	15A	#14	shade and LED drivers in the mech room	15
31	Office receptacles	15A AFCI	#14	office	5
32	Dining, hallway, east entry receptacles	15A AFCI	#14	dining, hallway, east entry	8
33-40	Spare			eight spaces	0

Switch plan

One row per switch leg. Click a row to light up its switch and lights on the drawing.

Leg	What	Room	Switch(es)	Lights	Control	Notes
stair	Stair and landing	stair	S1 3-way switch (stair light, top; 3-way with the bottom of the stair (floor below))	L4 4" recessed LED, L5 4" recessed LED	3-way with a switch at the bottom of the stair (floor below)	
mech	Mech room	mech room	—	L1 surface LED ceiling fixture, L2 surface LED ceiling fixture	integral occupancy sensors, no switch	the room has no door
office	Office cans	office	S2 dimmer (office door)	L6 4" recessed LED, L7 4" recessed LED, L8 4" recessed LED, L9 4" recessed LED	dimmer at the office door	
passage	Hallway cans	hallway	S3 3-way switch (hall lights, stair end); S4 3-way switch (hall lights, living end)	L10 4" recessed LED, L11 4" recessed LED, L12 4" recessed LED	3-way: stair end and living end	
powder-light	Powder room lights	powder	S5 switch (powder: light + fan, two rockers)	L16 vanity light, L17 exhaust fan with integrated LED light (light)	rocker 1 of a 2-gang at the door	the vanity light and the fan unit's light on one rocker; the powder can was combined into the fan unit (owner, 2026-10-07)
powder-fan	Powder room fan	powder	S5 switch (powder: light + fan, two rockers)	L17 exhaust fan with integrated LED light (fan)	rocker 2, with a 20-minute timer	
walkin	WIC	WIC	S6 occupancy-sensor switch (WIC, beyond the pocket of D12)	L14 surface LED, L18 surface LED, L19 surface LED	occupancy-sensor switch	
coats	Coat closet	coat closet	—	L13 surface LED	integral occupancy sensor, no switch	the closet has a bifold door, no wall space for a switch inside
master-cans	Master Bedroom cans	master bedroom	S7 dimmer (at the bedroom pocket door D13, strike side)	L20 4" recessed LED, L21 4" recessed LED, L22 4" recessed LED, L23 4" recessed LED	dimmer at the door	the bedside 3-way was dropped (owner, 2026-10-06)
master-fan	Master Bedroom fan box	master bedroom	S7 dimmer (at the bedroom pocket door D13, strike side; 3-way with the bedside)	L24 fan-rated ceiling box	rocker 2 at the door; fan speed from the fan remote	

Leg	What	Room	Switch(es)	Lights	Control	Notes
`mbath-cans`	Master Bath lights	master bath	S9 dimmer (bath bank on wall 23, strike side of D18: lights, fan, 2 rockers)	L25 4" recessed LED, L26 4" recessed LED, L111 4" recessed LED, L116 4" recessed LED, L28 vanity light, L29 vanity light, L30 exhaust fan with integrated LED light (light)	rocker 1 of the 2-gang bank, dimmer	cans, vanity lights and the fan unit's light switch and dim together (owner, 2026-10-07); the WC walls are gone (owner, 2026-10-12), so the toilet can L116 is on this dimmer and the bath has one fan; the fan unit needs a dimmable integrated LED; the shower and tub cans are wet-location
`mbath-fan`	Master Bath fan	master bath	S9 dimmer (bath bank on wall 23, strike side of D18: lights, fan, 2 rockers)	L30 exhaust fan with integrated LED light (fan)	rocker 2, humidity sensing runs it anyway	
`living`	Living cans	living	S11 dimmer (living cans, elevator end; 3-way); S12 dimmer (living cans, deck door; 3-way; exterior light); S32 4-way switch (beside S4, hall end); S35 4-way switch (beside S13 on wall 19, entry)	L33 4" recessed LED, L34 4" recessed LED, L36 4" recessed LED, L37 4" recessed LED	dimmers at the elevator end and the deck door, 4-ways at the hall end and at the entry (wall 19)	
`walkway`	Walkway cans	dining to kitchen	S34 dimmer (beside S13 on wall 19, entry face); S36 3-way switch (beside S32 at the hall end)	L35 4" recessed LED, L38 4" recessed LED, L112 4" recessed LED	3-way dimmer: entry and hall end	the two walkway cans and the can between the table and the sitting area, on their own dimmer (owner, 2026-10-06)
`hall-west`	West hallway cans	hallway	S11 dimmer (living cans, elevator end; 3-way); S12 dimmer (living cans, deck door; 3-way; exterior light)	L3 4" recessed LED (elevator hall), L39 4" recessed LED, L40 4" recessed LED, L41 4" recessed LED, L42 4" recessed LED	3-way, rocker 2 at both ends	

Leg	What	Room	Switch(es)	Lights	Control	Notes
`west-soffit`	West soffit lights	exterior, deck side	S12 dimmer (living cans, deck door; 3-way; exterior light)	L91 exterior soffit downlight, L92 exterior soffit downlight, L93 exterior soffit downlight, L94 exterior soffit downlight, L95 exterior soffit downlight, L96 exterior soffit downlight, L97 exterior soffit downlight, L98 exterior soffit downlight, L99 exterior soffit downlight	rocker 3 inside the deck door; photocell or timer optional	circuit 26
`dining-pendant`	Dining pendant	dining	S33 dimmer (dining pendant, beside S11 at the elevator end)	L43 pendant	dimmer, beside S11, west wall	
`dining-cans`	East entry cans	entry	S13 dimmer (east entry cans, on wall 19 at the master bedroom door); S31 3-way switch (east door)	L44 4" recessed LED, L45 4" recessed LED, L46 4" recessed LED	3-way dimmer: wall 19 at the master bedroom door, and the east door	
`east-door`	East door soffit lights (3)	exterior, east door	S14 switch (east door, beside S31: two rockers, three door lights and the whole east soffit)	L100 exterior soffit downlight, L101 exterior soffit downlight, L102 exterior soffit downlight	rocker A inside the east door	
`east-soffit`	Whole east soffit	exterior, east	S14 switch (east door, beside S31: two rockers, three door lights and the whole east soffit)	L103 exterior soffit downlight, L104 exterior soffit downlight, L105 exterior soffit downlight, L106 exterior soffit downlight, L107 exterior soffit downlight, L108 exterior soffit downlight, L109 exterior soffit downlight, L110 exterior soffit downlight	rocker B inside the east door	the three door lights stay on rocker A; rocker B adds the rest
`kitchen-pendants`	Island pendants	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way); S16 3-way switch (kitchen, entry end beside the laundry door; 3-way)	L49 pendant, L50 pendant, L51 pendant	3-way dimmer: hall end and dining end	

Leg	What	Room	Switch(es)	Lights	Control	Notes
`kitchen-cans`	Kitchen aisle cans	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way); S16 3-way switch (kitchen, entry end beside the laundry door; 3-way)	L52 4" recessed LED, L53 4" recessed LED, L54 4" recessed LED	3-way dimmer, rocker 2	
`kitchen-shelf`	Under-cabinet strip	kitchen	S15 dimmer (kitchen: pendants, cans, shelf light; 3-way)	L48 linear LED under shelf / cabinet	rocker 3 at the hall end	
`downdraft`	Cooktop downdraft	kitchen	—	L47 downdraft cooktop vent	controls on the unit	no wall switch
`pantry`	Pantry light	pantry	S17 occupancy-sensor switch (pantry, inside the door)	L55 surface LED ceiling fixture	occupancy-sensor switch inside the opening	
`wing-hall`	Wing hall cans	wing hallway	S18 3-way switch (wing hall, kitchen end); S19 3-way switch (wing hall, entry end)	L56 4" recessed LED, L57 4" recessed LED, L58 4" recessed LED	3-way: kitchen end and entry end	
`laundry`	Laundry lights	laundry	S20 switch (laundry, inside the door)	L59 surface LED ceiling fixture, L60 surface LED ceiling fixture	single switch inside the door	
`suite-bath-light`	Suite Bath lights	suite bath	S21 switch (suite bath: can, vanity light, fan)	L61 4" recessed LED, L113 4" recessed LED wet location, L62 vanity light, L63 exhaust fan with integrated LED light (light)	rocker 1 of a 2-gang inside the door	shower light added (owner, 2026-10-07); one vanity light over the mirror (owner, 2026-10-26); everything switches together
`suite-bath-fan`	Suite Bath fan	suite bath	S21 switch (suite bath: can, vanity light, fan)	L63 exhaust fan with integrated LED light (fan)	rocker 2, timer	
`den`	Den cans	den	S22 dimmer (den cans)	L64 4" recessed LED, L65 4" recessed LED, L66 4" recessed LED, L67 4" recessed LED	dimmer at the den opening	
`mini-cans`	2nd Suite cans	2nd Suite	S23 dimmer (2nd Suite door)	L68 4" recessed LED, L69 4" recessed LED, L70 4" recessed LED, L71 4" recessed LED	dimmer at the door	
`mini-closet`	2nd Suite wardrobe light	2nd Suite	S23 dimmer (2nd Suite door)	L72 surface LED	rocker 2 at the door	

Leg	What	Room	Switch(es)	Lights	Control	Notes
`mini-fan`	2nd Suite fan box	2nd Suite	S23 dimmer (2nd Suite door)	L73 fan-rated ceiling box	rocker 3 at the door; speed from the fan remote	
`bed4-cans`	Bedroom 4 cans	Bedroom 4	S25 dimmer (Bedroom 4 door)	L74 4" recessed LED, L75 4" recessed LED, L76 4" recessed LED, L77 4" recessed LED	dimmer at the door	
`bed4-fan`	Bedroom 4 fan box	Bedroom 4	S25 dimmer (Bedroom 4 door)	L78 fan-rated ceiling box	rocker 2 at the door	
`closet4`	Closet 4	closet 4	S26 occupancy-sensor switch (closet 4)	L79 surface LED	occupancy-sensor switch	
`jj-lights`	Jack & Jill lights	Jack & Jill	S27 3-way switch (Bedroom 3 door: lights + fan, 3-way); S28 3-way switch (Bedroom 4 door: lights + fan, 3-way)	L81 4" recessed LED, L82 vanity light, L83 vanity light, L84 exhaust fan with integrated LED light (light)	3-way at both doors, rocker 1	L80 was combined into the fan unit (owner, 2026-10-07)
`jj-fan`	Jack & Jill fan	Jack & Jill	S27 3-way switch (Bedroom 3 door: lights + fan, 3-way); S28 3-way switch (Bedroom 4 door: lights + fan, 3-way)	L84 exhaust fan with integrated LED light (fan)	3-way at both doors, rocker 2, timer	
`bed3-cans`	Bedroom 3 cans	Bedroom 3	S29 dimmer (Bedroom 3 door)	L85 4" recessed LED, L86 4" recessed LED, L87 4" recessed LED, L88 4" recessed LED	dimmer at the door	
`bed3-fan`	Bedroom 3 fan box	Bedroom 3	S29 dimmer (Bedroom 3 door)	L89 fan-rated ceiling box	rocker 2 at the door	
`closet3`	Closet 3	closet 3	S30 occupancy-sensor switch (closet 3)	L90 surface LED	occupancy-sensor switch	

Device schedule

Tag	Device	Position	AFF	Circuit	Notes
X1	sub-panel P2, 125A, 40 space	on W2 north face, 3'-2" from west ext. wall	60"	—	Sub-panel P2 on the north (mech-room) face of wall 2, the existing hoistway wall: surface-mounted on a 3/4" plywood backer, nothing recessed into or run through the hoistway; top of cabinet 72" AFF; 30" wide x 36" deep clear in front; reached through door D21 from the landing (owner, 2026-10-26)
X2	media panel: Cat6 home runs, network switch	on W2 north face, 1'-4" from west ext. wall	54"	—	Media panel beside P2 on the mech-room face of wall 2, surface-mounted: every Cat6 home-runs here
R1	receptacle, 20A dedicated	on the north ext. wall, 2'-7" from west ext. wall	30"	25	ventilation unit (ERV) service receptacle
L1	surface LED ceiling fixture	2'-7" from west ext. wall, 3'-6" from north ext. wall	108"	25	mech room, fixture with integral occupancy sensor (no door, no switch)
L2	surface LED ceiling fixture	10" from north ext. wall, 6'-5" from west ext. wall	108"	25	vent leg, fixture with integral occupancy sensor
L3	4" recessed LED, 2700K, IC, dimmable	2'-5" from west ext. wall, 7'-7" from W2	108"	21	elevator hall
R2	duplex receptacle, 15A	on the west ext. wall, 9'-1" from W2	30"	20	elevator hall
L4	4" recessed LED, 2700K, IC, dimmable	1'-3" from W28, 4'-10" from W37	108"	21	over the stair
L5	4" recessed LED, 2700K, IC, dimmable	1'-10" from W1, 2'-11" from W5	108"	21	landing
S1	3-way switch, rocker	on W5 south face, 10" from W1	42"	21	stair light, top; 3-way with the bottom of the stair (floor below)
L6	4" recessed LED, 2700K, IC, dimmable	3'-2" from W34, 4'-0" from north ext. wall	108"	10	
L7	4" recessed LED, 2700K, IC, dimmable	3'-4" from W18, 4'-0" from north ext. wall	108"	10	
L8	4" recessed LED, 2700K, IC, dimmable	5'-2" from W34, 9'-0" from north ext. wall	108"	10	
L9	4" recessed LED, 2700K, IC, dimmable	2'-4" from W35, 13'-10" from north ext. wall	108"	10	
S2	dimmer, rocker	on W34 east face, 7'-7" from north ext. wall	42"	10	office door
R4	data outlet, 2 × Cat6	on the north ext. wall, 5'-4" from W18	30"	—	desk

Tag	Device	Position	AFF	Circuit	Notes
R5	duplex receptacle, 15A	on W18 west face, 5'-0" from north ext. wall	30"	31	
R8	duplex receptacle, 15A	on W34 east face, 9'-6" from north ext. wall	30"	31	
R9	duplex receptacle, 15A	on W34 west face, 9'-0" from north ext. wall	30"	20	
R10	duplex receptacle, 15A	on W35 east face, 14'-0" from north ext. wall	30"	31	
A1	smoke alarm, 120V interconnected w/ battery	5'-4" from W18, 7'-0" from north ext. wall	108"	22	office (could serve as a bedroom)
L10	4" recessed LED, 2700K, IC, dimmable	2'-7" from W34, 3'-6" from north ext. wall	108"	21	
L11	4" recessed LED, 2700K, IC, dimmable	2'-7" from W34, 8'-6" from north ext. wall	108"	21	
L12	4" recessed LED, 2700K, IC, dimmable	2'-7" from W34, 13'-6" from north ext. wall	108"	21	
L13	surface LED, closet-rated (NEC 410.16)	1'-1" from W38, 3'-11" from W17	108"	21	coat closet, integral occupancy sensor
L14	surface LED, closet-rated (NEC 410.16)	3'-4" from W18, 13'-10" from north ext. wall	108"	21	
S3	3-way switch, rocker	on the north ext. wall, 1'-7" from W33	42"	21	hall lights, stair end
S4	3-way switch, rocker	on W34 west face, 15'-10" from north ext. wall	42"	21	hall lights, living end
S32	4-way switch, rocker	on W34 west face, 15'-4" from north ext. wall	42"	21	living cans, 4-way beside S4 at the hall end (with S11, S12 and S35)
S36	3-way switch, rocker	on W34 west face, 14'-10" from north ext. wall	42"	21	walkway cans L35, L38 and L112, hall-end control: 3-way with S34; beside S32
S33	dimmer, rocker	on the west ext. wall, 11'-2" from W2	42"	21	dining pendant, beside S11
S34	dimmer, rocker	on W19 south face, 14'-10" from east ext. wall	42"	21	walkway cans L35, L38 and L112 on their own dimmer; 3-way with S36 at the hall end; beside S13 on wall 19 (entry face)
S35	4-way switch, rocker	on W19 south face, 14'-4" from east ext. wall	42"	21	living cans, 4-way beside S13 at the entry (with S11, S12 and S32)

Tag	Device	Position	AFF	Circuit	Notes
R11	duplex receptacle, 15A	on the north ext. wall, 1'-6" from W34	30"	20	
R12	duplex receptacle, 15A	on the north ext. wall, 5'-1" from W34	30"	31	desk
R13	duplex receptacle, 15A	on W18 west face, 13'-2" from north ext. wall	30"	31	
R14	duplex receptacle, 15A	on W20 west face, 2'-8" from W27	30"	19	living side of wall 20, behind the end table at the north end of the sectional (owner, 2026-10-26)
A2	smoke + CO alarm, 120V interconnected w/ battery	2'-7" from W34, 6'-0" from north ext. wall	108"	22	hall outside the office
L16	vanity light	on W27 north face, 1'-4" from W34	78"	10	over the powder lav, centred over the mirror; the only vanity light here (owner, 2026-10-26)
L17	exhaust fan with integrated LED light, 110 CFM, humidity sensing	1'-2" from W35, 1'-9" from W36	108"	10	powder, duct tees north to the north gable cap
S5	switch, rocker	on W34 east face, 1'-2" from W27	42"	10	powder: light + fan, two rockers
R15	GFCI receptacle, 20A	on W27 north face, 2'-2" from W35	42"	14	42" AFF beside the lav
L18	surface LED, closet-rated (NEC 410.16)	3'-4" from W18, 4'-6" from north ext. wall	108"	21	
L19	surface LED, closet-rated (NEC 410.16)	3'-4" from W18, 9'-6" from north ext. wall	108"	21	
S6	occupancy-sensor switch	on W20 west face, 15'-8" from north ext. wall	42"	21	WIC, latch side of D12
R16	duplex receptacle, 15A	on W27 north face, 3'-4" from W18	30"	16	
L20	4" recessed LED, 2700K, IC, dimmable	4'-2" from W23, 12'-0" from east ext. wall	108"	21	
L21	4" recessed LED, 2700K, IC, dimmable	4'-2" from W23, 4'-10" from east ext. wall	108"	21	
L22	4" recessed LED, 2700K, IC, dimmable	3'-8" from W19, 13'-0" from east ext. wall	108"	21	
L23	4" recessed LED, 2700K, IC, dimmable	3'-8" from W19, 4'-10" from east ext. wall	108"	21	
L24	fan-rated ceiling box, switched	8'-0" from W19, 8'-11" from east ext. wall	108"	21	room centre

Tag	Device	Position	AFF	Circuit	Notes
S7	dimmer, rocker	on W19 north face, 13'-8" from east ext. wall	42"	21	at the bedroom pocket door D13, strike side
R17	duplex receptacle with USB-C, 15A	on W20 east face, 4'-8" from W23	30"	16	nightstand
R18	duplex receptacle with USB-C, 15A	on W20 east face, 3'-10" from W19	30"	16	nightstand
R19	duplex receptacle, 15A	on the east ext. wall, 10" from W23	30"	16	
R20	duplex receptacle, 15A	on W23 south face, 7'-7" from east ext. wall	30"	16	
R21	duplex receptacle, 15A	on the east ext. wall, 2" from W19	30"	16	
R22	recessed TV box: power + 2 × Cat6	on the east ext. wall, 7'-10" from W19	60"	16	TV on the east wall, facing the bed
R23	duplex receptacle, 15A	on W23 south face, 3'-7" from east ext. wall	30"	16	
R24	duplex receptacle, 15A	on W20 east face, 10" from W19	30"	16	
A3	smoke + CO alarm, 120V interconnected w/ battery	3'-1" from east ext. wall, 8'-0" from W19	108"	22	master bedroom, 3 ft+ from the fan blade tips
L25	4" recessed LED, wet location (shower / tub)	2'-7" from W20, 7'-2" from north ext. wall	108"	10	over the shower pad, south half
L26	4" recessed LED, wet location (shower / tub)	2'-0" from north ext. wall, 6'-7" from east ext. wall	108"	10	over the tub
L28	vanity light	on W23 north face, 9'-6" from east ext. wall	72"	10	vanity, left, beyond the D18 pocket
L29	vanity light	on W23 north face, 5'-11" from east ext. wall	72"	10	vanity, right
L30	exhaust fan with integrated LED light, 110 CFM, humidity sensing	5'-0" from north ext. wall, 9'-7" from east ext. wall	108"	10	master bath, between shower and tub; duct to the north gable cap
S9	dimmer, rocker	on W23 north face, 5" from W20	42"	10	bath bank on wall 23 on the strike side of D18, between W20 and the door (the pocket fills the 2×4 wall past the door): lights on one dimmer, fan (2 rockers)
R25	GFCI receptacle, 20A	on W23 north face, 7'-11" from east ext. wall	42"	14	vanity, 42" AFF, within 3' of both basins
L116	4" recessed LED, 2700K, IC, dimmable	1'-10" from east ext. wall, 6'-2" from north ext. wall	108"	10	over the toilet (the WC is open to the bath, owner 2026-10-12)

Tag	Device	Position	AFF	Circuit	Notes
R26	GFCI receptacle, 20A	on the east ext. wall, 1'-6" from W23	42"	14	bidet seat, beside the toilet
L33	4" recessed LED, 2700K, IC, dimmable	3'-10" from W27, 18'-0" from west ext. wall	108"	21	
L34	4" recessed LED, 2700K, IC, dimmable	3'-10" from W27, 26'-6" from west ext. wall	108"	21	
L35	4" recessed LED, 2700K, IC, dimmable	12'-6" from west ext. wall, 33'-6" from north ext. wall	108"	21	walkway, dining to kitchen; own dimmer S34
L36	4" recessed LED, 2700K, IC, dimmable	9'-10" from W27, 18'-0" from west ext. wall	108"	21	
L37	4" recessed LED, 2700K, IC, dimmable	9'-10" from W27, 26'-6" from west ext. wall	108"	21	
L38	4" recessed LED, 2700K, IC, dimmable	15'-6" from W16, 22'-6" from west ext. wall	108"	21	walkway beside the living area; own dimmer S34
L39	4" recessed LED, 2700K, IC, dimmable	3'-0" from west ext. wall, 15'-3" from W2	108"	21	
L40	4" recessed LED, 2700K, IC, dimmable	3'-0" from west ext. wall, 16'-4" from W14	108"	21	
L41	4" recessed LED, 2700K, IC, dimmable	3'-0" from west ext. wall, 8'-4" from W14	108"	21	
L42	4" recessed LED, 2700K, IC, dimmable	1'-10" from W14, 3'-0" from west ext. wall	108"	21	
S11	dimmer, rocker	on the west ext. wall, 10'-5" from W2	42"	21	living cans, elevator end; 3-way
S12	dimmer, rocker	on the west ext. wall, 2" from W14	42"	21	living cans, deck door; 3-way; exterior light
R27	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 46'-8" from the north brick corner	24"	24	west soffit receptacle at the deck door
R28	duplex receptacle, 15A	on the west ext. wall, 12'-3" from W2	30"	19	
R29	duplex receptacle, 15A	on the west ext. wall, 19'-4" from W14	30"	19	
R30	duplex receptacle, 15A	on the west ext. wall, 10'-4" from W14	30"	32	
R31	duplex receptacle, 15A	on the west ext. wall, 10" from W14	30"	32	

Tag	Device	Position	AFF	Circuit	Notes
R32	duplex receptacle, 15A	on W27 south face, 17'-0" from west ext. wall	30"	19	
R33	recessed TV box: power + 2 × Cat6	on W27 south face, 21'-3" from west ext. wall	60"	19	living TV centred on wall 27
R34	duplex receptacle, 15A	on W27 south face, 26'-0" from west ext. wall	30"	19	
R35	floor box receptacle	7'-4" from W27, 15'-6" from west ext. wall	—	19	under the west sofa
R36	floor box receptacle	11'-9" from W27, 23'-4" from west ext. wall	—	19	under the end table
A4	smoke + CO alarm, 120V interconnected w/ battery	4'-4" from W38, 11'-7" from east ext. wall	108"	22	entry, outside the master bedroom door
L43	pendant	5'-9" from west ext. wall, 10'-9" from W37	108"	21	over the table centre, dimmed; 1,000+ lumens (a linear pendant about 5 ft long suits the 8 ft table)
L44	4" recessed LED, 2700K, IC, dimmable	4'-6" from W38, 14'-1" from east ext. wall	108"	21	east entry
L45	4" recessed LED, 2700K, IC, dimmable	5'-0" from W19, 8'-7" from east ext. wall	108"	21	east entry
L46	4" recessed LED, 2700K, IC, dimmable	3'-1" from east ext. wall, 5'-0" from W19	108"	21	east entry
S13	dimmer, rocker	on W19 south face, 15'-4" from east ext. wall	42"	21	east entry cans, on wall 19 at the master bedroom door; 3-way with S31
S14	switch, rocker	on the east ext. wall, 10'-2" from W19	42"	26	east door: two rockers, three door lights and the whole east soffit; beside S31 on the south side of the door (one bank, not switches on both sides)
R37	weatherproof GFCI receptacle, in-use cover	3.5" out from the east brick, 39'-2" from the north brick corner	24"	24	east soffit receptacle beside the door
R38	duplex receptacle, 15A	on W19 south face, 6'-1" from east ext. wall	30"	32	
R39	duplex receptacle, 15A	on W19 south face, 4'-7" from east ext. wall	30"	32	
R40	duplex receptacle, 15A	on W19 south face, 2'-1" from east ext. wall	30"	32	
R41	duplex receptacle, 15A	on the east ext. wall, 1'-6" from W19	30"	32	

Tag	Device	Position	AFF	Circuit	Notes
R42	duplex receptacle, 15A	on W31 west face, 14'-4" from W7	30"	32	west face of wall 31, between W38 and the laundry door (owner, 2026-10-26)
R99	duplex receptacle, 15A	on W31 west face, 6'-11" from W7	30"	32	west face of wall 31, between the laundry door and the hallway (owner, 2026-10-26)
R44	pop-up counter receptacle, 20A GFCI	10'-3" from west ext. wall, 39'-9" from north ext. wall	34"	7	island, sink end
R45	pop-up counter receptacle, 20A GFCI	9'-3" from W16, 21'-9" from west ext. wall	34"	8	island, prep end
R46	duplex receptacle, 15A	8'-9" from west ext. wall, 40'-1" from north ext. wall	30"	7	island end panel
R47	duplex receptacle, 15A	8'-11" from W16, 23'-3" from west ext. wall	30"	8	island end panel
R48	receptacle, 20A dedicated	9'-3" from W16, 14'-3" from west ext. wall	30"	11	dishwasher drawers, under the island
R49	receptacle, 20A dedicated	9'-3" from W16, 16'-3" from west ext. wall	30"	12	microwave drawer, island
R50	receptacle, 20A dedicated	on W16 north face, 7'-0" from W31	30"	9	refrigerator (GE PGE29BYTFS, 36"), recessed box
R52	240V receptacle or junction	on W16 north face, 9'-6" from W31	30"	3-4	GE PTS700LSZSS 30" wall oven, side swing, left hinge, in the 30" oven tower beside the fridge
R53	240V receptacle or junction	9'-3" from W16, 18'-9" from west ext. wall	30"	1-2	induction cooktop in the island, junction below the counter
R54	GFCI receptacle, 20A	on W16 north face, 6'-6" from W15	42"	7	counter, 42" AFF
R55	GFCI receptacle, 20A	on W16 north face, 8'-0" from W15	42"	8	counter, 42" AFF
L47	downdraft cooktop vent, blower in the island, ducted in the floor	9'-3" from W16, 21'-8" from west ext. wall	—	23	remote downdraft blower in the island base beside the cooktop, 6" duct in the floor to the west wall (P-1)
L48	linear LED under shelf / cabinet	on W16 north face, 1"–8'-7" from W15	50"	21	under the wall cabinets, W15 to the oven tower
L49	pendant	12'-0" from west ext. wall, 39'-9" from north ext. wall	108"	21	
L50	pendant	9'-3" from W16, 15'-6" from west ext. wall	108"	21	
L51	pendant	9'-3" from W16, 19'-6" from west ext. wall	108"	21	

Tag	Device	Position	AFF	Circuit	Notes
L52	4" recessed LED, 2700K, IC, dimmable	11'-0" from west ext. wall, 44'-6" from north ext. wall	108"	21	
L53	4" recessed LED, 2700K, IC, dimmable	4'-6" from W16, 16'-0" from west ext. wall	108"	21	
L54	4" recessed LED, 2700K, IC, dimmable	4'-6" from W16, 21'-0" from west ext. wall	108"	21	
S15	dimmer, rocker	on W14 north face, 7'-5" from west ext. wall	42"	21	kitchen: pendants, cans, shelf light; 3-way
S16	3-way switch, rocker	on W31 west face, 8'-3" from W7	42"	21	kitchen, entry end beside the laundry door; 3-way
L55	surface LED ceiling fixture	3'-11" from W14, 4'-6" from west ext. wall	108"	21	pantry
S17	occupancy-sensor switch	on W14 south face, 7'-0" from west ext. wall	42"	21	pantry, inside the door
R56	duplex receptacle, 15A	on W7 north face, 4'-6" from west ext. wall	30"	8	pantry
L56	4" recessed LED, 2700K, IC, dimmable	2'-4" from W15, 2'-5" from W7	108"	22	
L57	4" recessed LED, 2700K, IC, dimmable	2'-5" from W7, 8'-10" from W15	108"	22	
L58	4" recessed LED, 2700K, IC, dimmable	2'-5" from W7, 4'-3" from W31	108"	22	
S18	3-way switch, rocker	on W15 east face, 2'-6" from W7	42"	22	wing hall, kitchen end
S19	3-way switch, rocker	on W31 west face, 2'-6" from W7	42"	22	wing hall, entry end
R57	duplex receptacle, 15A	on W7 north face, 7'-4" from W15	30"	17	
A5	smoke + CO alarm, 120V interconnected w/ battery	2'-5" from W7, 7'-9" from W31	108"	22	wing hall outside Bedrooms 3 and 4
R58	240V receptacle or junction	on W17 west face, 4'-4" from W32	30"	5-6	dryer
R59	receptacle, 20A dedicated	on W17 west face, 3'-1" from W32	30"	13	washer
R60	GFCI receptacle, 20A	on W17 west face, 1'-0" from W30	42"	13	laundry sink, 42" AFF
R61	duplex receptacle, 15A	on W32 south face, 2'-11" from W31	30"	13	folding counter
L59	surface LED ceiling fixture	3'-3" from W32, 3'-5" from W31	108"	22	
L60	surface LED ceiling fixture	1'-6" from W30, 3'-5" from W31	108"	22	

Tag	Device	Position	AFF	Circuit	Notes
S20	switch, rocker	on W31 east face, 2'-10" from W30	42"	22	laundry, inside the door
L61	4" recessed LED, 2700K, IC, dimmable	2'-6" from W7, 3'-0" from W9	108"	10	
L62	vanity light	on W30 south face, 1'-7" from W9	78"	10	over the suite vanity, centred over the mirror; the only vanity light here (owner, 2026-10-26)
L63	exhaust fan with integrated LED light, 110 CFM, humidity sensing	2'-3" from W7, 2'-11" from W31	108"	10	suite bath, duct tees into the Jack & Jill duct to the south gable cap
S21	switch, rocker	on W9 west face, 1'-6" from W30	42"	10	suite bath: lights, fan
R62	GFCI receptacle, 20A	on W30 south face, 3'-4" from W9	42"	15	suite vanity, 42" AFF
L64	4" recessed LED, 2700K, IC, dimmable	8'-7" from east ext. wall, 8'-10" from W8	108"	10	
L65	4" recessed LED, 2700K, IC, dimmable	2'-10" from W8, 8'-7" from east ext. wall	108"	10	
L66	4" recessed LED, 2700K, IC, dimmable	3'-1" from east ext. wall, 8'-10" from W8	108"	10	
L67	4" recessed LED, 2700K, IC, dimmable	2'-10" from W8, 3'-1" from east ext. wall	108"	10	
S22	dimmer, rocker	on W17 east face, 10'-4" from W19	42"	10	den cans
R63	duplex receptacle, 15A	on W17 east face, 9'-4" from W8	30"	20	
R64	recessed TV box: power + 2 × Cat6	on W17 east face, 5'-10" from W8	60"	20	den TV on wall 17
R65	duplex receptacle, 15A	on W17 east face, 2'-4" from W8	30"	20	
R66	duplex receptacle, 15A	on W8 north face, 10'-1" from east ext. wall	30"	20	
R67	duplex receptacle, 15A	on W8 north face, 2'-7" from east ext. wall	30"	20	
R68	duplex receptacle, 15A	on the east ext. wall, 9'-10" from W8	30"	20	
R69	duplex receptacle, 15A	on the east ext. wall, 1'-6" from W8	30"	20	
A6	smoke + CO alarm, 120V interconnected w/ battery	5'-10" from W8, 6'-1" from east ext. wall	108"	22	den, outside the 2nd Suite

Tag	Device	Position	AFF	Circuit	Notes
L68	4" recessed LED, 2700K, IC, dimmable	7'-7" from east ext. wall, 14'-7" from south ext. wall	108"	22	
L69	4" recessed LED, 2700K, IC, dimmable	3'-1" from east ext. wall, 14'-7" from south ext. wall	108"	22	
L70	4" recessed LED, 2700K, IC, dimmable	5'-7" from south ext. wall, 7'-1" from east ext. wall	108"	22	
L71	4" recessed LED, 2700K, IC, dimmable	3'-1" from east ext. wall, 5'-7" from south ext. wall	108"	22	
L72	surface LED, closet-rated (NEC 410.16)	4'-1" from south ext. wall, 10'-5" from east ext. wall	108"	22	wardrobe strip
L73	fan-rated ceiling box, switched	6'-1" from east ext. wall, 10'-1" from south ext. wall	108"	22	
S23	dimmer, rocker	on W8 south face, 5'-6" from east ext. wall	42"	22	2nd Suite door: cans, wardrobe light, fan (3 rockers)
R70	duplex receptacle with USB-C, 15A	on W9 east face, 13'-1" from south ext. wall	30"	18	nightstand, north side of the bed, 6" off the bed (clear of the bath door)
R71	duplex receptacle with USB-C, 15A	on W9 east face, 7'-1" from south ext. wall	30"	18	nightstand, south side of the bed, 6" off the bed (clear of the closet)
R72	duplex receptacle, 15A	on W8 south face, 2'-7" from east ext. wall	30"	18	
R73	duplex receptacle, 15A	on the east ext. wall, 12'-1" from south ext. wall	30"	18	
R74	recessed TV box: power + 2 × Cat6	on the east ext. wall, 10'-1" from south ext. wall	60"	18	2nd Suite TV on the east wall
R75	duplex receptacle, 15A	on the east ext. wall, 2'-1" from south ext. wall	30"	18	
R76	duplex receptacle, 15A	on the south ext. wall, 2'-7" from east ext. wall	30"	18	
A7	smoke alarm, 120V interconnected w/ battery	3'-4" from east ext. wall, 10'-1" from south ext. wall	108"	22	2nd Suite
L74	4" recessed LED, 2700K, IC, dimmable	3'-6" from W11, 10'-7" from south ext. wall	108"	22	
L75	4" recessed LED, 2700K, IC, dimmable	2'-6" from W9, 10'-7" from south ext. wall	108"	22	

Tag	Device	Position	AFF	Circuit	Notes
L76	4" recessed LED, 2700K, IC, dimmable	3'-1" from south ext. wall, 3'-6" from W11	108"	22	
L77	4" recessed LED, 2700K, IC, dimmable	2'-6" from W9, 3'-1" from south ext. wall	108"	22	
L78	fan-rated ceiling box, switched	6'-6" from W11, 7'-1" from south ext. wall	108"	22	
S25	dimmer, rocker	on W7 south face, 5'-1" from W11	42"	22	Bedroom 4 door
R77	duplex receptacle with USB-C, 15A	on W9 west face, 9'-1" from south ext. wall	30"	29	nightstand
R78	duplex receptacle with USB-C, 15A	on W9 west face, 11" from south ext. wall	30"	29	nightstand
R79	duplex receptacle, 15A	on W7 south face, 3'-6" from W9	30"	29	
R80	recessed TV box: power + 2 × Cat6	on W7 south face, 5'-0" from W9	60"	29	TV on wall 7
R81	duplex receptacle, 15A	on W11 east face, 5'-3" from south ext. wall	30"	29	
R82	duplex receptacle, 15A	on the south ext. wall, 3'-0" from W11	30"	29	
R83	duplex receptacle, 15A	on the south ext. wall, 1'-0" from W9	30"	29	
A8	smoke alarm, 120V interconnected w/ battery	4'-0" from W9, 7'-1" from south ext. wall	108"	22	Bedroom 4
L79	surface LED, closet-rated (NEC 410.16)	2'-2" from W11, 3'-3" from south ext. wall	108"	22	closet 4
S26	occupancy-sensor switch	on W11 west face, 5'-6" from south ext. wall	42"	22	closet 4
L81	4" recessed LED, wet location (shower / tub)	1'-1" from W7, 4'-8" from W10	108"	10	over the tub
L82	vanity light	on W12 north face, 2'-5" from W10	72"	10	vanity, left
L83	vanity light	on W12 north face, 2'-5" from W11	72"	10	vanity, right
L84	exhaust fan with integrated LED light, 110 CFM, humidity sensing	1'-2" from W10, 3'-3" from W7	108"	10	Jack & Jill, duct to the south gable cap
S27	3-way switch, rocker	on W10 east face, 2'-3" from W7	42"	10	Bedroom 3 door: lights + fan, 3-way
S28	3-way switch, rocker	on W11 west face, 2'-3" from W7	42"	10	Bedroom 4 door: lights + fan, 3-way

Tag	Device	Position	AFF	Circuit	Notes
R84	GFCI receptacle, 20A	on W12 north face, 4'-8" from W11	42"	15	between the basins, 42" AFF
R85	GFCI receptacle, 20A	on W7 south face, 2'-0" from W10	42"	15	bidet seat, beside the toilet
L85	4" recessed LED, 2700K, IC, dimmable	4'-0" from west ext. wall, 10'-1" from south ext. wall	108"	22	
L86	4" recessed LED, 2700K, IC, dimmable	10'-0" from west ext. wall, 10'-1" from south ext. wall	108"	22	
L87	4" recessed LED, 2700K, IC, dimmable	3'-7" from south ext. wall, 4'-0" from west ext. wall	108"	22	
L88	4" recessed LED, 2700K, IC, dimmable	3'-7" from south ext. wall, 10'-0" from west ext. wall	108"	22	
L89	fan-rated ceiling box, switched	7'-0" from west ext. wall, 7'-1" from south ext. wall	108"	22	
S29	dimmer, rocker	on W7 south face, 12'-11" from west ext. wall	42"	22	Bedroom 3 door
R86	duplex receptacle with USB-C, 15A	on the west ext. wall, 9'-1" from south ext. wall	30"	17	nightstand
R87	duplex receptacle with USB-C, 15A	on the west ext. wall, 6" from south ext. wall	30"	17	nightstand
R88	duplex receptacle, 15A	on W7 south face, 3'-0" from west ext. wall	30"	17	
R89	duplex receptacle, 15A	on W10 west face, 5'-3" from south ext. wall	30"	17	
R90	recessed TV box: power + 2 × Cat6	on W7 south face, 6'-6" from west ext. wall	60"	17	TV on wall 7 (wall 10 is all door and pocket now)
R91	duplex receptacle, 15A	on the south ext. wall, 2'-6" from west ext. wall	30"	17	
R92	duplex receptacle, 15A	on the south ext. wall, 11'-0" from west ext. wall	30"	17	
A9	smoke alarm, 120V interconnected w/ battery	7'-1" from south ext. wall, 9'-0" from west ext. wall	108"	22	Bedroom 3
L90	surface LED, closet-rated (NEC 410.16)	2'-2" from W10, 3'-3" from south ext. wall	108"	22	closet 3
S30	occupancy-sensor switch	on W10 east face, 5'-6" from south ext. wall	42"	22	closet 3

Tag	Device	Position	AFF	Circuit	Notes
S31	3-way switch, rocker	on the east ext. wall, just south of the east door, 9'-0" from W19	42"	21	east entry cans, at the east door; 3-way with S13
R93	data outlet, 2 × Cat6	on W3 west face, 7'-7" from W2	30"	—	elevator controller / phone line, on wall 6
R94	data outlet, 2 × Cat6	on the east ext. wall, 10'-1" from W19	48"	—	east door: doorbell / camera / lock
R95	data outlet, 2 × Cat6	on W19 south face, 13'-7" from east ext. wall	48"	—	touchscreen insert on wall 19 (entry face), 2-gang box
X3	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	9'-5" from west ext. wall, 39'-9" from north ext. wall	12"	30	island: LED and charging, up through the island base
X4	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on W16 north face, 1'-10" from W15	84"	30	kitchen cabinets, north run: under-cabinet LED driver lead
X5	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on W16 north face, 7'-10" from W15	84"	30	kitchen cabinets, south run: under-cabinet LED driver lead
X6	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 7'-6" from W2	90"	30	window head: motorised shade
X7	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 17'-6" from W2	90"	30	window head: motorised shade
X8	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the west ext. wall, 12'-2" from W14	90"	30	window head: motorised shade
X9	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 5'-6" from south ext. wall	90"	30	window head: motorised shade

Tag	Device	Position	AFF	Circuit	Notes
X10	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 15'-2" from south ext. wall	90"	30	window head: motorised shade
X11	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 5'-9" from W8	90"	30	window head: motorised shade
X12	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 3'-1" from W19	90"	30	window head: motorised shade
X13	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the east ext. wall, 3'-11" from W23	90"	30	window head: motorised shade
X14	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the north ext. wall, 6'-2" from east ext. wall	90"	30	window head: motorised shade
X15	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 6'-0" from west ext. wall	90"	30	window head: motorised shade
X16	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 4'-7" from W9	90"	30	window head: motorised shade
X17	low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	on the south ext. wall, 6'-2" from east ext. wall	90"	30	window head: motorised shade
R96	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 1'-4" from the north brick corner	24"	24	west soffit receptacle, north end
R97	weatherproof GFCI receptacle, in-use cover	3.5" out from the west brick, 67'-5" from the north brick corner	24"	24	west soffit receptacle, south end
R98	GFCI receptacle, 20A	on W15 east face, 1'-3" from W16	42"	7	counter end on W15 (the pantry wall), 42" AFF

Tag	Device	Position	AFF	Circuit	Notes
L91	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 4'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L92	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 12'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L93	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 20'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L94	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 28'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L95	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 36'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L96	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 46'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L97	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 54'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L98	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 60'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L99	exterior soffit downlight, LED, wet location	3.5" out from the west brick, 66'-4" from the north brick corner	108"	26	west soffit, switched inside the deck door
L100	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 31'-10" from the north brick corner	108"	26	east soffit over the door, switch leg A
L101	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 34'-4" from the north brick corner	108"	26	east soffit over the door, switch leg A
L102	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 36'-10" from the north brick corner	108"	26	east soffit over the door, switch leg A
L103	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 4'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L104	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 12'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L105	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 20'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L106	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 27'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L107	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 41'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)

Tag	Device	Position	AFF	Circuit	Notes
L108	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 48'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L109	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 56'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L110	exterior soffit downlight, LED, wet location	3.5" out from the east brick, 64'-4" from the north brick corner	108"	26	east soffit, switch leg B (whole soffit)
L111	4" recessed LED, wet location (shower / tub)	3'-4" from north ext. wall, 13'-5" from east ext. wall	108"	10	over the shower pad, north half
L112	4" recessed LED, 2700K, IC, dimmable	12'-0" from west ext. wall, 25'-0" from north ext. wall	108"	21	between the dining table and the sitting area; own dimmer S34
L113	4" recessed LED, wet location (shower / tub)	1'-4" from W31, 2'-6" from W7	108"	10	over the suite tub / shower

Bill of materials

Rough-order quantities from the drawing geometry, for pricing. The contractor takes off the final list.

Item	Qty	Notes
4" recessed LED, 2700K, IC, dimmable	52	
duplex receptacle, 15A	50	
exterior soffit downlight, LED, wet location	20	
low-voltage drop: 18/2 (and 18/4 control where the shade brand needs it) in 1/2" conduit to the driver board	15	
dimmer, rocker	13	
3-way switch, rocker	10	
GFCI receptacle, 20A	10	
duplex receptacle with USB-C, 15A	8	
receptacle, 20A dedicated	5	
vanity light	6	
recessed TV box: power + 2 × Cat6	6	
surface LED ceiling fixture	5	
smoke + CO alarm, 120V interconnected w/ battery	5	
exhaust fan with integrated LED light, 110 CFM, humidity sensing	4	
switch, rocker	4	
4-way switch, rocker	2	S32, the living cans
surface LED, closet-rated (NEC 410.16)	7	
data outlet, 2 × Cat6	4	
smoke alarm, 120V interconnected w/ battery	4	
occupancy-sensor switch	4	
fan-rated ceiling box, switched	4	
weatherproof GFCI receptacle, in-use cover	4	
pendant	4	
4" recessed LED, wet location (shower / tub)	5	
240V receptacle or junction	3	
floor box receptacle	2	
pop-up counter receptacle, 20A GFCI	2	
sub-panel P2, 125A, 40 space	1	

Item	Qty	Notes
media panel: Cat6 home runs, network switch	1	
downdraft cooktop vent, blower in the island, ducted in the floor	1	
linear LED under shelf / cabinet	1	
Cable 8/3 NM-B	71 ft	chained run + 12' per device, +15%
Cable 10/3 NM-B	170 ft	chained run + 12' per device, +15%
Cable 12/2 NM-B	1203 ft	chained run + 12' per device, +15%
Cable 14/2 NM-B	5695 ft	chained run + 12' per device, +15%
14/3 NM-B for 3-way and multi-location switching	440 ft	40' per 3-way pair
Cat6 (two per TV/data outlet)	1532 ft	10 TV/data outlets
18/2 shade and LED cable in 1/2" ENT conduit	1329 ft	home runs to the mech room
Breakers 240V 40A 2P	1	AFCI/GFCI types as listed on the circuit schedule
Breakers 240V 30A 2P	3	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A GFCI/AFCI	4	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A AFCI	2	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A GFCI	3	AFCI/GFCI types as listed on the circuit schedule
Breakers 20A	1	AFCI/GFCI types as listed on the circuit schedule

Item	Qty	Notes
Breakers 15A AFCI	12	AFCI/GFCI types as listed on the circuit schedule
Breakers 15A	2	AFCI/GFCI types as listed on the circuit schedule
Sub-panel 125A MLO, 40 space, with #1 Cu feeder from the main	1	feeder length to confirm
Device boxes, old-work and new-work, with covers	263	4" square for 240V and TV boxes