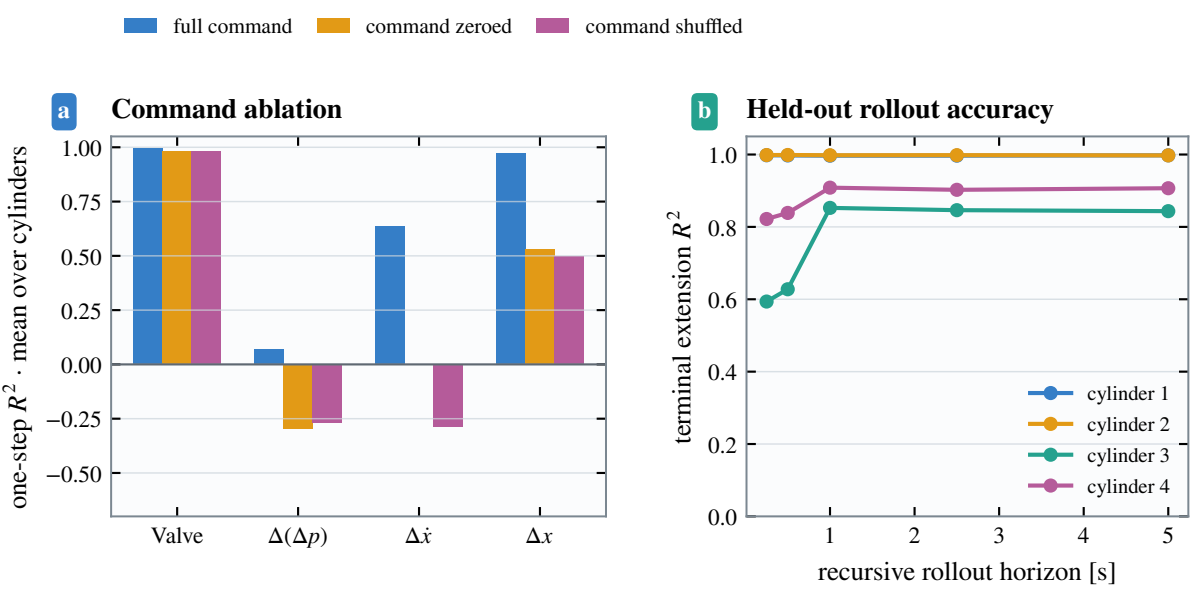
full command
command zeroed
command shuffled
a
Command ablation
one-step R^2 · mean over cylinders
1.00
0.75
0.50
0.25
0.00
−0.25
−0.50
Valve
$\Delta(\Delta p)$
$\Delta\dot{x}$
Δx
b
Held-out rollout accuracy
terminal extension R^2
1.0
0.8
0.6
0.4
0.2
0.0
1
2
3
4
5
recursive rollout horizon [s]
cylinder 1
cylinder 2
cylinder 3
cylinder 4