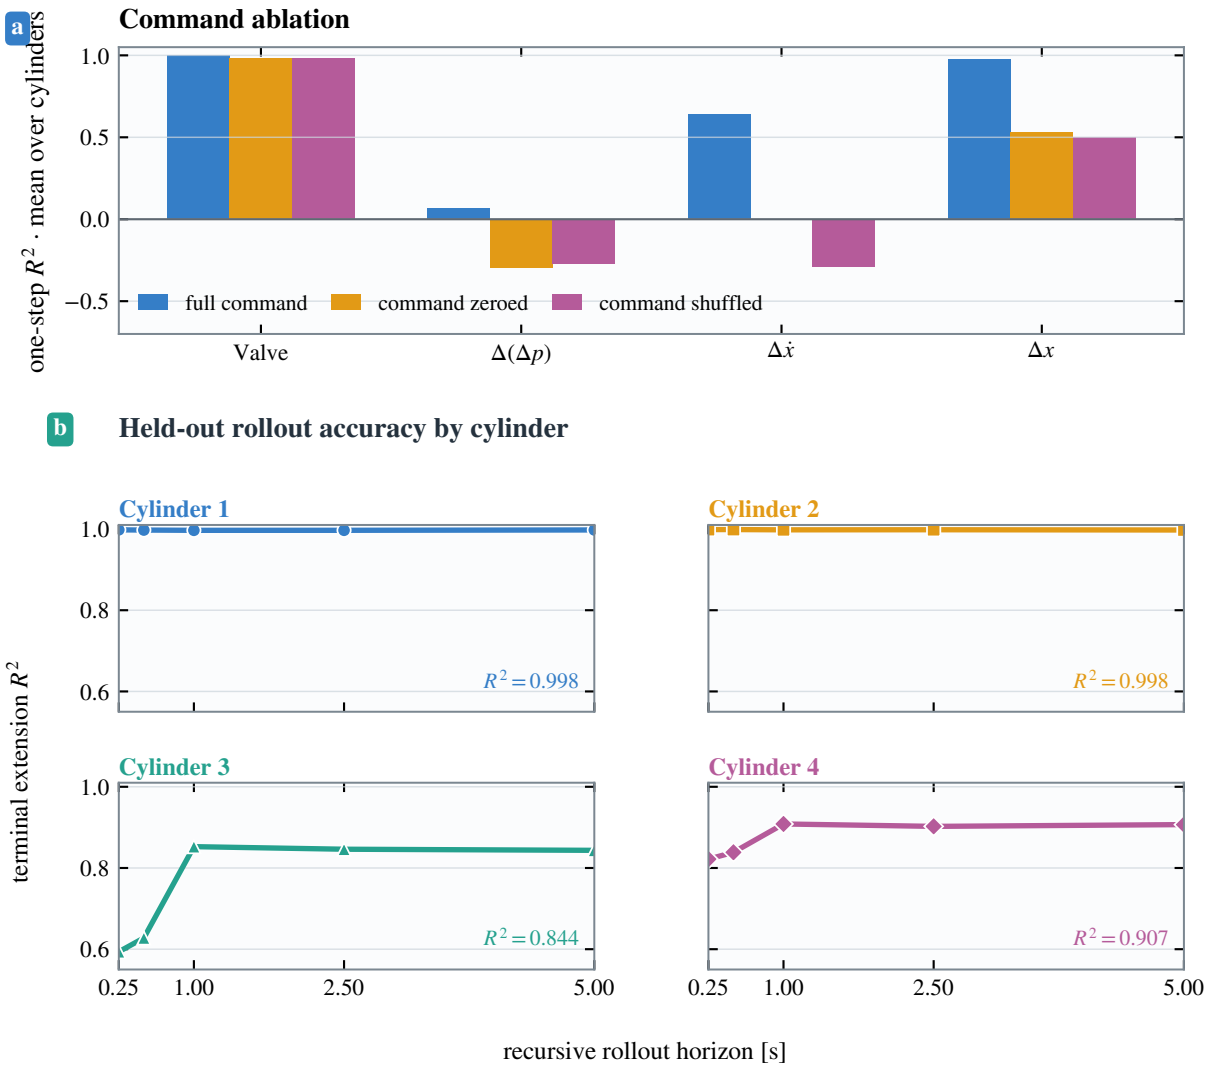
a
Command ablation
one-step R^2 · mean over cylinders
1.0
0.5
0.0
−0.5
full command
command zeroed
command shuffled
Valve
$\Delta(\Delta p)$
$\Delta\dot{x}$
Δx
b
Held-out rollout accuracy by cylinder
Cylinder 1
$R^2 = 0.998$
Cylinder 2
$R^2 = 0.998$
Cylinder 3
$R^2 = 0.844$
Cylinder 4
$R^2 = 0.907$
terminal extension R^2
1.0
0.8
0.6
0.25
1.00
2.50
5.00
recursive rollout horizon [s]