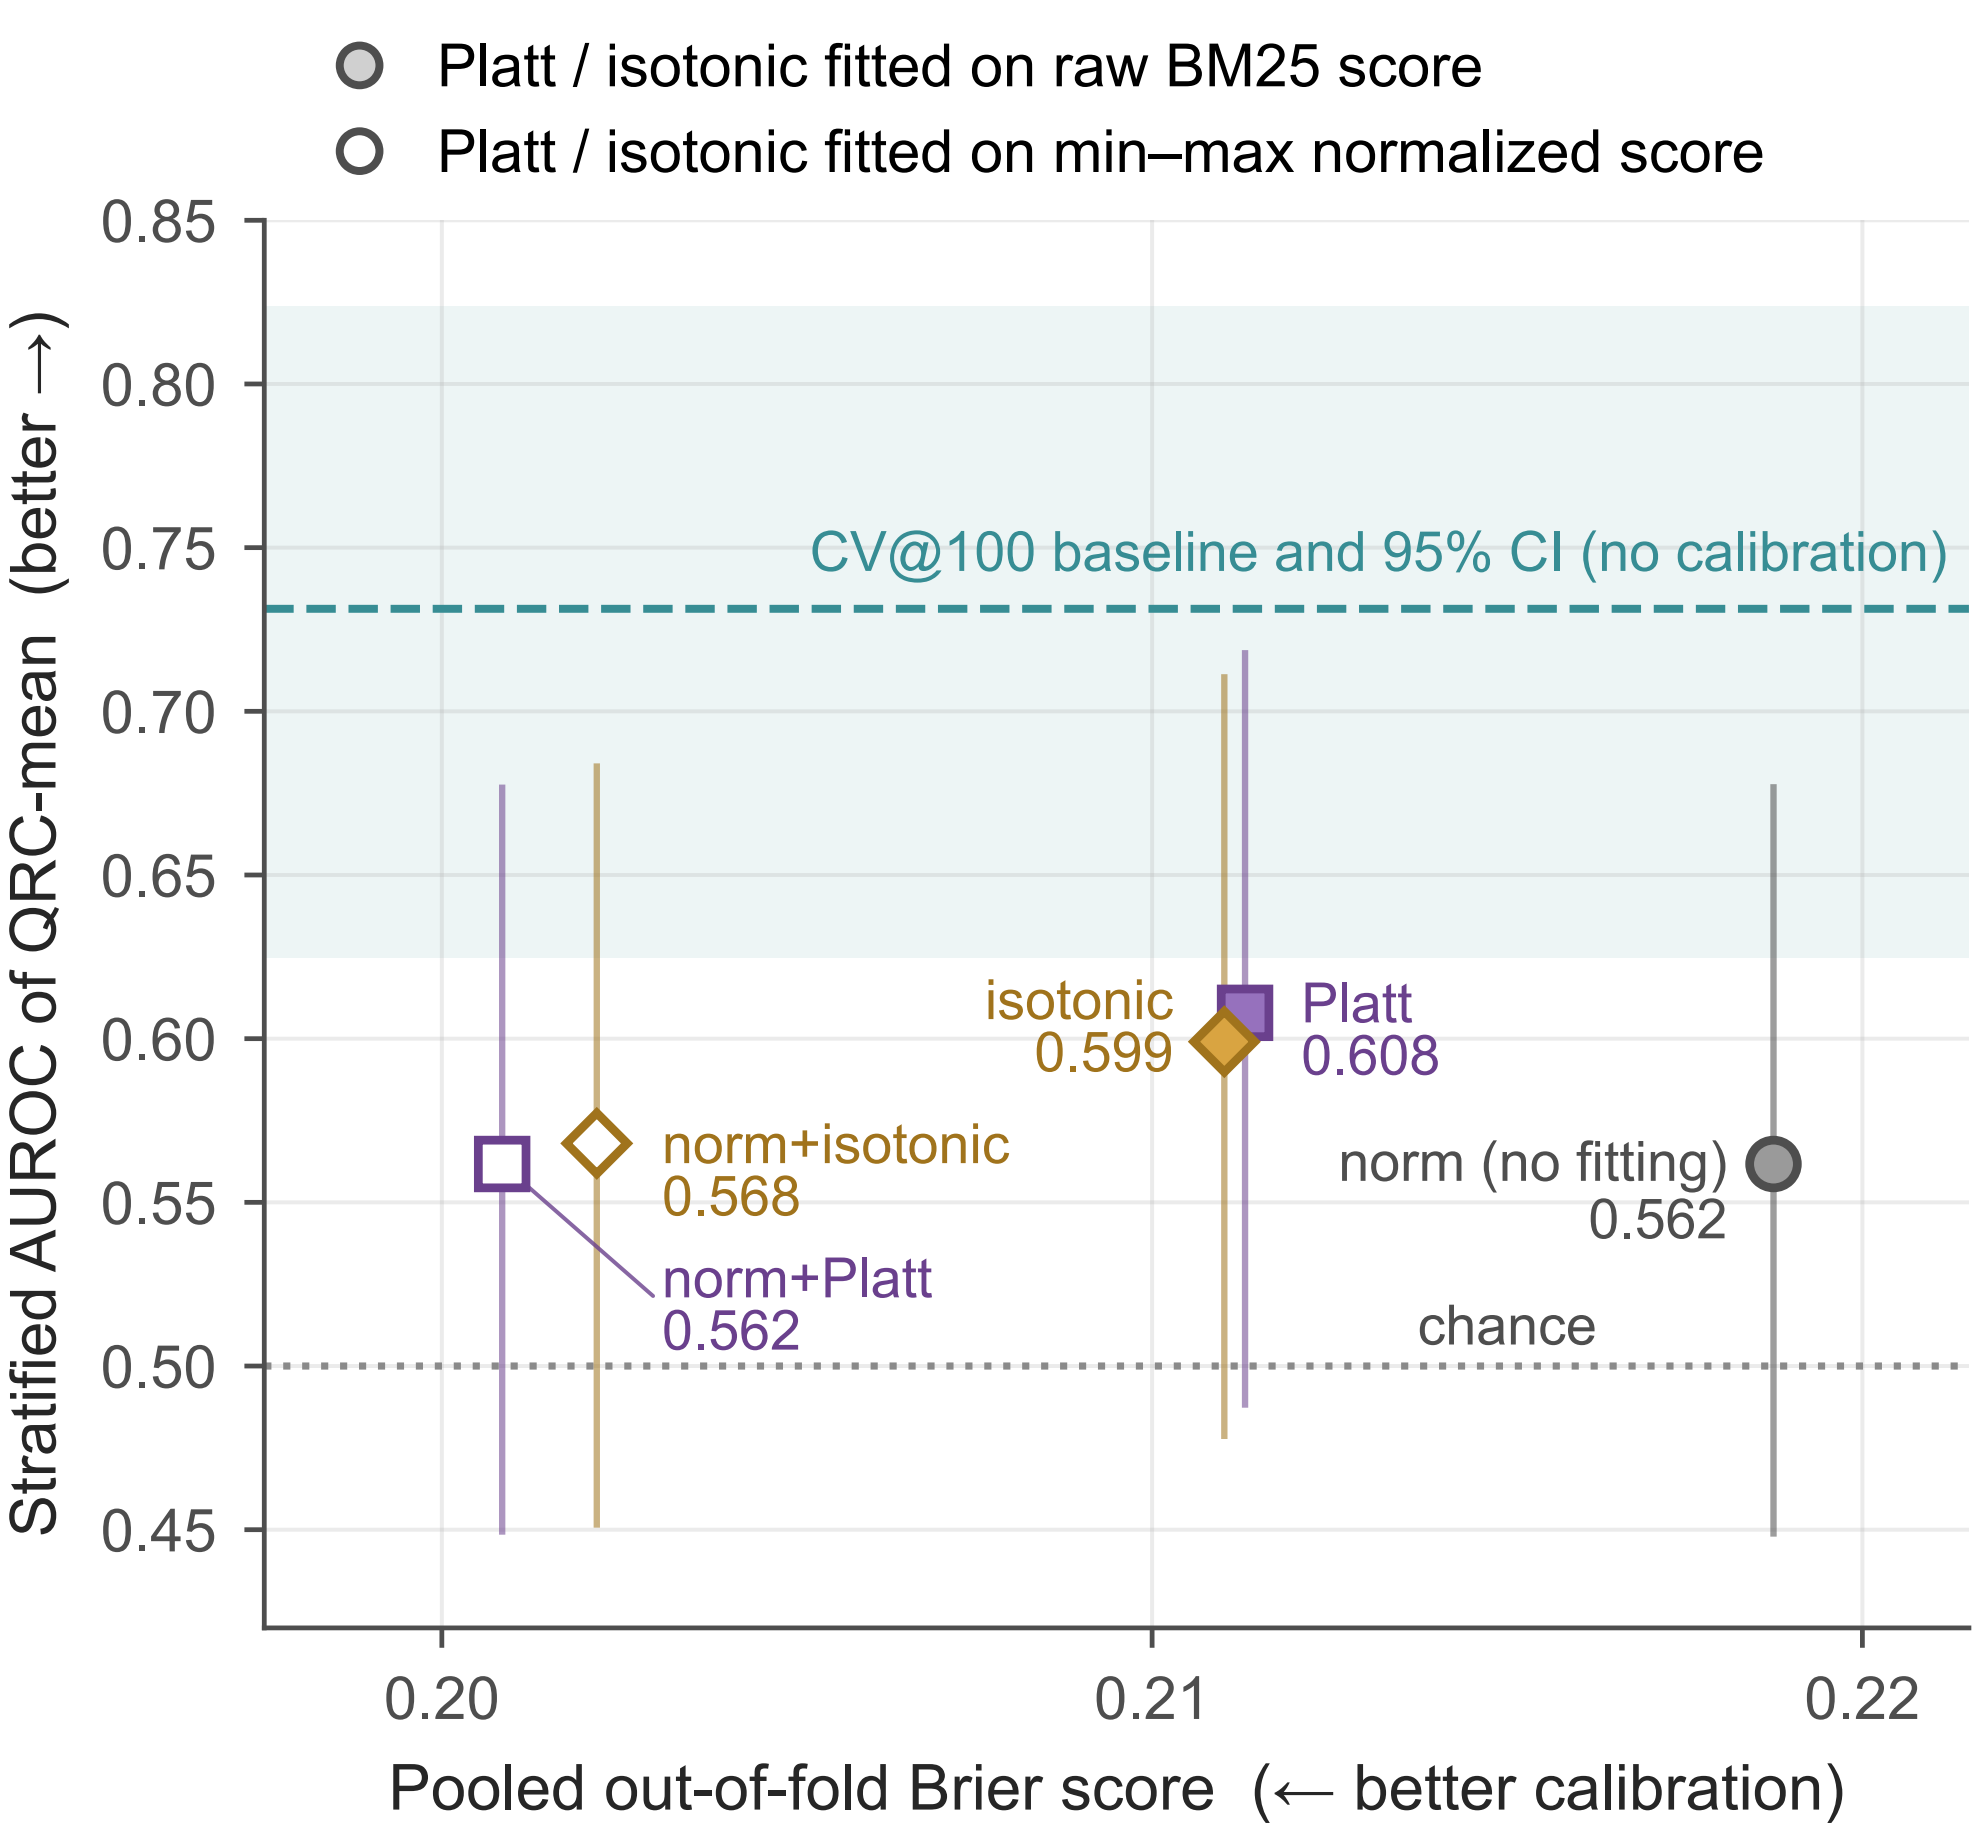
Platt / isotonic fitted on raw BM25 score
Platt / isotonic fitted on min–max normalized score
Stratified AUROC of QRC-mean (better →)
0.85
0.80
0.75
0.70
0.65
0.60
0.55
0.50
0.45
CV@100 baseline and 95% CI (no calibration)
isotonic
0.599
Platt
0.608
norm+isotonic
0.568
norm (no fitting)
0.562
norm+Platt
0.562
chance
0.20
0.21
0.22
Pooled out-of-fold Brier score (← better calibration)