



UC-C: Per-Benchmark Accuracy Before/After Calibrator Filtering

GPT-5-mini — $p_{\text{correct}} > 0.7$

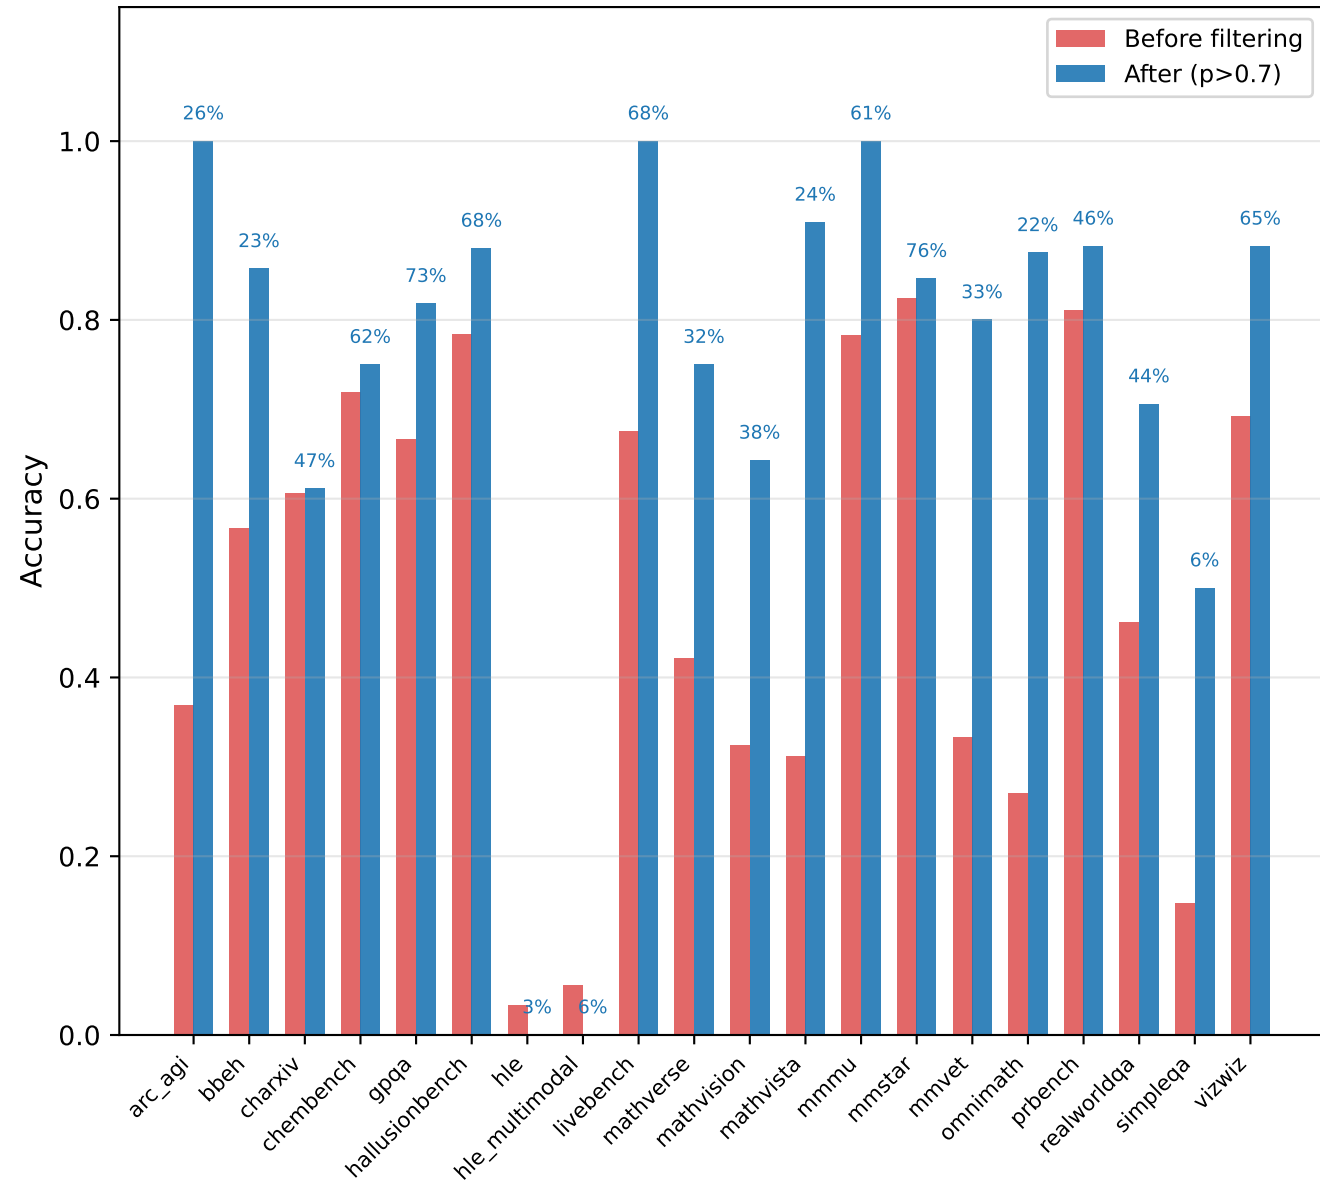

GPT-5.2 — $p_{\text{correct}} > 0.7$

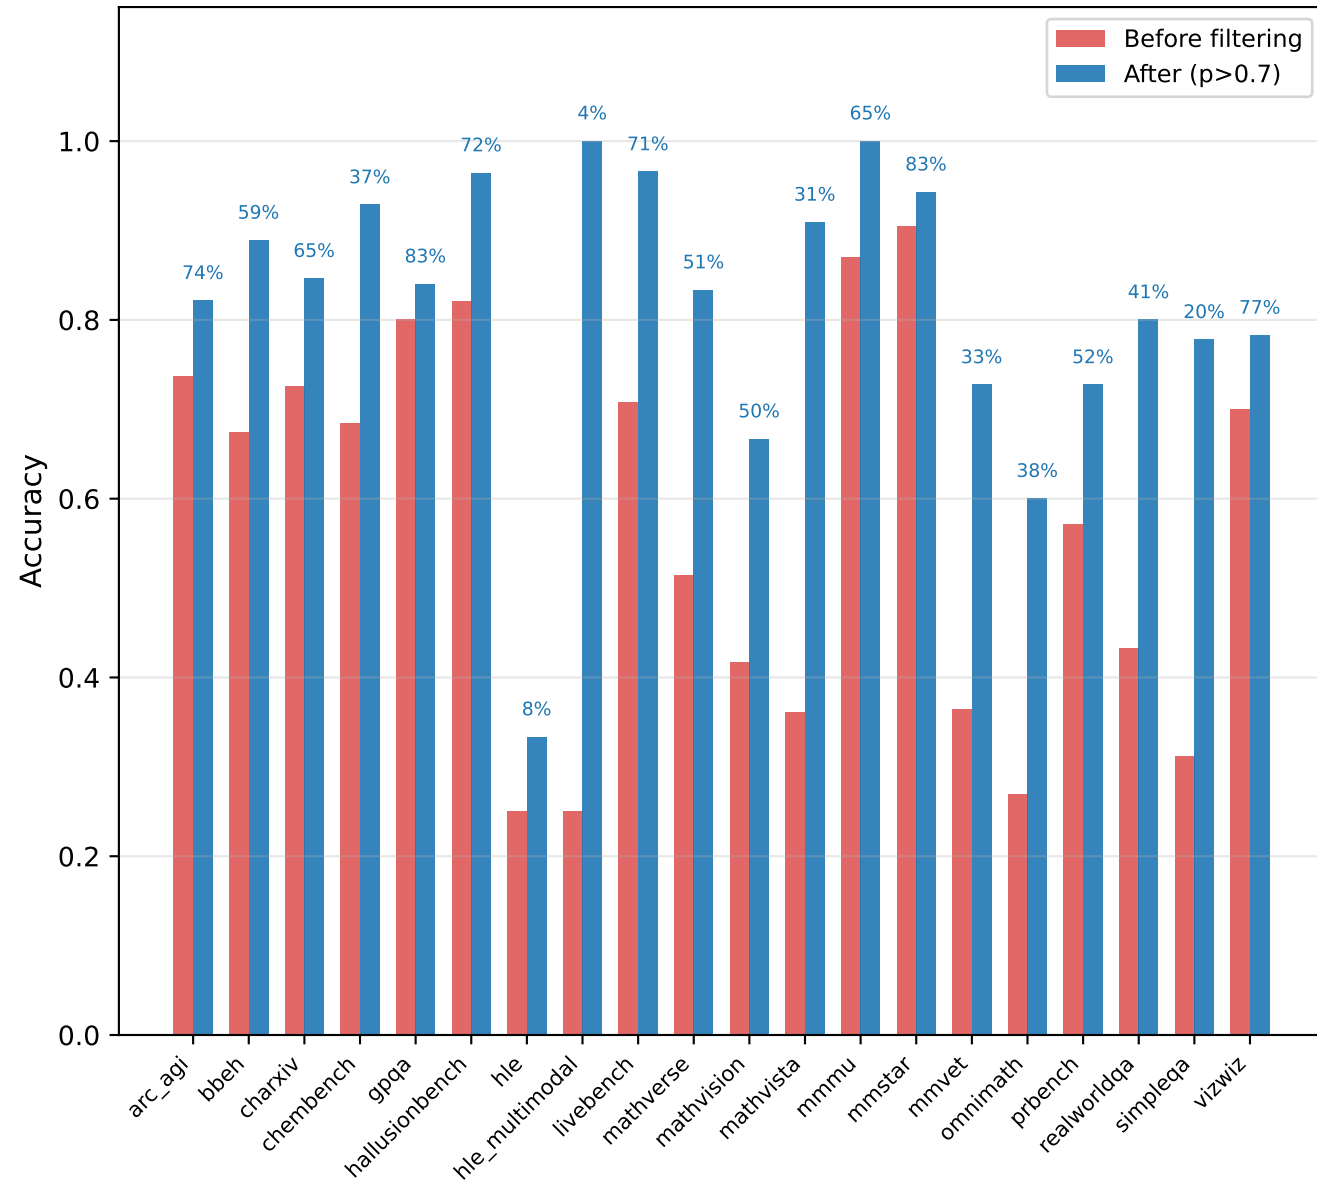

Qwen3.5 — $p_{\text{correct}} > 0.7$

