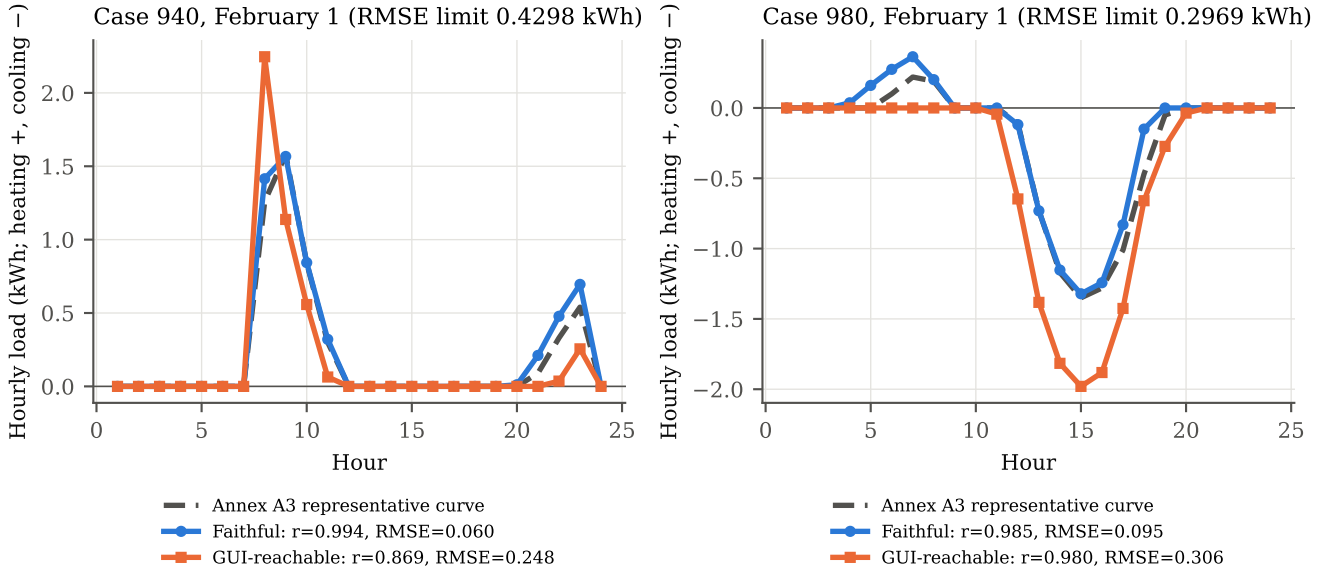
Case 940, February 1 (RMSE limit 0.4298 kWh)
Hourly load (kWh; heating +, cooling −)
Hour
Annex A3 representative curve
Faithful: r=0.994, RMSE=0.060
GUI-reachable: r=0.869, RMSE=0.248
Case 980, February 1 (RMSE limit 0.2969 kWh)
Hourly load (kWh; heating +, cooling −)
Hour
Annex A3 representative curve
Faithful: r=0.985, RMSE=0.095
GUI-reachable: r=0.980, RMSE=0.306