

Casa De Amparo_v4



Building Owner:

Location:

Created by:

File name: Casa De Amparo_v4.mdfz

Simulated by: TRACE 3D Plus 7.00

Room Cooling and Heating Loads by Component

ROOM_Ante Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	130	0	130	24.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	49	0	49	9.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	24	0	-15	10	1.8
Envelope Subtotal	24	177	-15	186	-
People	42	57	81	180	33.6
Lights	37	56	0	94	17.5
Miscellaneous Loads	34	0	0	34	6.4
Internal Subtotal	114	114	81	309	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	139	290	66	494	100.0
RA Sensible (Lights)	43	0	0	43	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.40
%OA	24	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	970
cfm/ton	500		
ft²/ton	1,963		
Btu/h-ft²	6.11		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-97	0	-97	49.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-24	0	-24	12.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-7.5
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-92	47.0
Envelope Subtotal	-88	-107	0	-198	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-1.8
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-84	-107	0	-195	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.19	No People(max)	0.40
%OA	24	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	970
cfm/Mbh	-106		
ft²/Mbh	-415		
Btu/h-ft²	-2.41		

Cooling Airflows

Main Fan cfm	21
Cooling ACH	1.30
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	21
Heating ACH	1.30
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	90
Other Roof	90
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	456
Exterior Floor	0
Internal Floor	0
Slab	90
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 152

ROOM_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	540	0	540	14.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	263	0	263	7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-22	0	-22	-0.6
Slab	0	-18	0	-18	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	381	0	-124	257	6.8
Envelope Subtotal	381	763	-124	1,020	-
People	305	447	482	1,233	32.8
Lights	344	522	0	866	23.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	648	969	482	2,099	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	250	0	250	6.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	1,029	1,977	358	3,364	100.0
RA Sensible (Lights)	395	0	0	395	-

Engineering Checks For Cooling

Cooling tons	0.28	No People(max)	3.11
%OA	37	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	9,250
cfm/ton	516		
ft²/ton	2,218		
Btu/h-ft²	5.41		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-593	0	-593	29.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-337	0	-337	16.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	27	0	27	-1.4
Slab	0	85	0	85	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-835	0	0	-873	43.2
Envelope Subtotal	-835	-818	0	-1,691	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-329	0	-329	16.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.1
Grand Total	-835	-1,150	0	-2,023	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.02	No People(max)	3.11
%OA	37	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	9,250
cfm/Mbh	-72		
ft²/Mbh	-307		
Btu/h-ft²	-3.26		

Cooling Airflows

Main Fan cfm	145
Cooling ACH	0.94
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	53
Calculated Ventilation ACH	0.34
Infiltration cfm	20
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	145
Heating ACH	0.94
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	53
Calculated Ventilation ACH	0.34
Infiltration cfm	20
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	671
Window	0
Door	0
Wall	332
Below-Grade Wall	0
Other Wall	332
Partition	1,426
Exterior Floor	0
Internal Floor	207
Slab	469
Other Floor	207

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 152

ROOM_Attrium 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	495	0	495	8.4
Other Roof	0	0	0	0	0.0
Glass	1,007	1,256	0	2,263	38.2
Door	0	0	0	0	0.0
Wall	0	1,196	0	1,196	20.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-524	0	-524	-8.8
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	262	0	-159	103	1.7
Envelope Subtotal	1,270	2,424	-159	3,534	-
People	316	394	500	1,210	20.4
Lights	357	457	0	813	13.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	673	851	500	2,024	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-0.7
Grand Total	1,942	3,234	341	5,517	100.0
RA Sensible (Lights)	409	0	0	409	-

Engineering Checks For Cooling

Cooling tons	0.46	No People(max)	3.23
%OA	22	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	5,793
cfm/ton	542		
ft²/ton	1,403		
Btu/h-ft²	8.55		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 82.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-730	0	-730	23.3
Other Roof	0	0	0	0	0.0
Glass	-1,036	0	0	-1,036	33.0
Door	0	0	0	0	0.0
Wall	0	-1,129	0	-1,129	36.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	330	0	330	-10.5
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	-524	0	0	-550	17.5
Envelope Subtotal	-1,559	-1,529	0	-3,115	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	0.7
Grand Total	-1,559	-1,550	0	-3,136	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.14	No People(max)	3.23
%OA	22	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	5,793
cfm/Mbh	-79		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	249
Cooling ACH	2.58
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	55
Calculated Ventilation ACH	0.57
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	249
Heating ACH	2.58
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	55
Calculated Ventilation ACH	0.57
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	704
Other Roof	704
Ceiling	0
Window	57
Door	0
Wall	715
Below-Grade Wall	0
Other Wall	715
Partition	0
Exterior Floor	0
Internal Floor	671
Slab	0
Other Floor	671

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 152

ROOM_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	19	0	19	1.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	40	0	40	2.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-56	5	0.3
Envelope Subtotal	60	50	-56	55	-
People	210	272	399	881	48.5
Lights	129	188	0	317	17.5
Miscellaneous Loads	341	0	0	341	18.8
Internal Subtotal	679	460	399	1,538	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	77	0	77	4.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.1
Grand Total	739	585	343	1,667	100.0
RA Sensible (Lights)	148	0	0	148	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.00
%OA	34	People per 1000 ft²	10
cfm/ft²	0.32	Volume (ft³)	2,395
cfm/ton	458		
ft²/ton	1,436		
Btu/h-ft²	8.36		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-21	0	-21	5.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	20.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	34	0	34	-9.0
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-227	60.1
Envelope Subtotal	-216	-65	0	-292	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-9.0
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-119	0	-119	31.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-182	-184	0	-377	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.38	No People(max)	2.00
%OA	34	People per 1000 ft²	10
cfm/ft²	0.32	Volume (ft³)	2,395
cfm/Mbh	-169		
ft²/Mbh	-530		
Btu/h-ft²	-1.89		

Cooling Airflows

Main Fan cfm	64
Cooling ACH	1.60
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	64
Heating ACH	1.60
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 152

ROOM_Clean Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	162	0	162	26.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	6	0	6	1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	31	0	-20	11	1.8
Envelope Subtotal	31	165	-20	176	-
People	54	72	102	228	36.8
Lights	47	72	0	119	19.2
Miscellaneous Loads	44	0	0	44	7.0
Internal Subtotal	144	144	102	390	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	175	308	82	565	100.0
RA Sensible (Lights)	54	0	0	54	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.51
%OA	26	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,224
cfm/ton	493		
ft²/ton	2,169		
Btu/h-ft²	5.53		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-122	0	-122	51.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	8.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-7.4
Other Floor	0	0	0	0	0.0
Infiltration	-110	0	0	-116	49.2
Envelope Subtotal	-110	-123	0	-239	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.9
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-106	-124	0	-235	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.23	No People(max)	0.51
%OA	26	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,224
cfm/Mbh	-99		
ft²/Mbh	-435		
Btu/h-ft²	-2.30		

Cooling Airflows

Main Fan cfm	23
Cooling ACH	1.13
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	23
Heating ACH	1.13
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	113
Other Roof	113
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	519
Exterior Floor	0
Internal Floor	0
Slab	113
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 152

ROOM_Comfort Room 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	144	0	144	13.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	31	0	31	3.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	108	0	108	-
People	88	123	168	378	36.2
Lights	93	145	0	238	22.8
Miscellaneous Loads	129	87	0	215	20.6
Internal Subtotal	309	355	168	832	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	309	460	168	937	100.0
RA Sensible (Lights)	106	0	0	106	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.84
%OA	58	People per 1000 ft²	10
cfm/ft²	0.44	Volume (ft³)	1,005
cfm/ton	474		
ft²/ton	1,072		
Btu/h-ft²	11.19		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-100	0	-100	55.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-47	0	-47	26.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-51	0	-51	28.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-9.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-180	0	-180	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	0	-181	0	-181	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.18	No People(max)	0.84
%OA	58	People per 1000 ft²	10
cfm/ft²	0.44	Volume (ft³)	1,005
cfm/Mbh	-205		
ft²/Mbh	-464		
Btu/h-ft²	-2.16		

Cooling Airflows

Main Fan cfm	37
Cooling ACH	2.21
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	37
Heating ACH	2.21
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	93
Other Roof	93
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	438
Exterior Floor	0
Internal Floor	0
Slab	93
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 152

ROOM_Comfort Room 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	97	0	97	8.3
Other Roof	0	0	0	0	0.0
Glass	92	64	0	155	13.3
Door	0	0	0	0	0.0
Wall	0	112	0	112	9.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-114	0	-114	-9.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	92	145	0	237	-
People	86	125	164	375	32.1
Lights	91	148	0	239	20.4
Miscellaneous Loads	126	88	0	214	18.3
Internal Subtotal	303	361	164	828	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	7	0	7	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.5
Grand Total	395	507	164	1,066	100.0
RA Sensible (Lights)	104	0	0	104	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.82
%OA	48	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	985
cfm/ton	488		
ft²/ton	923		
Btu/h-ft²	13.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-81	0	-81	23.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	36.5
Door	0	0	0	0	0.0
Wall	0	-161	0	-161	45.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-10.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-129	-186	0	-315	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-36	0	-36	10.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	1.0
Grand Total	-129	-225	0	-355	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.35	No People(max)	0.82
%OA	48	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	985
cfm/Mbh	-122		
ft²/Mbh	-231		
Btu/h-ft²	-4.33		

Cooling Airflows

Main Fan cfm	43
Cooling ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	43
Heating ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	80
Other Roof	80
Ceiling	11
Window	8
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	91
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 152

ROOM_Consult 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	142	0	142	10.2
Other Roof	0	0	0	0	0.0
Glass	76	53	0	129	9.3
Door	0	0	0	0	0.0
Wall	0	129	0	129	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-7.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	76	204	0	280	-
People	105	143	200	447	32.2
Lights	110	169	0	279	20.1
Miscellaneous Loads	153	101	0	254	18.3
Internal Subtotal	369	412	200	981	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	8	0	8	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.4
Grand Total	445	618	200	1,263	100.0
RA Sensible (Lights)	127	0	0	127	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.00
%OA	50	People per 1000 ft²	10
cfm/ft²	0.51	Volume (ft³)	1,199
cfm/ton	486		
ft²/ton	949		
Btu/h-ft²	12.64		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-101	0	-101	25.5
Other Roof	0	0	0	0	0.0
Glass	-131	0	0	-131	32.9
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	45.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-9.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-5.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-131	-222	0	-353	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-40	0	-40	10.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.9
Grand Total	-131	-266	0	-397	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.40	No People(max)	1.00
%OA	50	People per 1000 ft²	10
cfm/ft²	0.51	Volume (ft³)	1,199
cfm/Mbh	-129		
ft²/Mbh	-252		
Btu/h-ft²	-3.97		

Cooling Airflows

Main Fan cfm	51
Cooling ACH	2.55
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	51
Heating ACH	2.55
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	98
Other Roof	98
Ceiling	12
Window	8
Door	0
Wall	115
Below-Grade Wall	0
Other Wall	115
Partition	390
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 152

ROOM_Consult 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	143	0	143	10.0
Other Roof	0	0	0	0	0.0
Glass	76	54	0	130	9.1
Door	0	0	0	0	0.0
Wall	0	130	0	130	9.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-83	0	-83	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	76	233	0	309	-
People	107	146	203	455	31.7
Lights	112	173	0	285	19.8
Miscellaneous Loads	156	103	0	259	18.0
Internal Subtotal	375	422	203	999	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	8	0	8	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.4
Grand Total	450	657	203	1,310	100.0
RA Sensible (Lights)	129	0	0	129	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.02
%OA	49	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	1,218
cfm/ton	488		
ft²/ton	930		
Btu/h-ft²	12.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-102	0	-102	24.8
Other Roof	0	0	0	0	0.0
Glass	-131	0	0	-131	31.7
Door	0	0	0	0	0.0
Wall	0	-184	0	-184	44.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	27	0	27	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-5.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-131	-237	0	-368	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-41	0	-41	9.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.9
Grand Total	-131	-282	0	-412	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.41	No People(max)	1.02
%OA	49	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	1,218
cfm/Mbh	-129		
ft²/Mbh	-246		
Btu/h-ft²	-4.07		

Cooling Airflows

Main Fan cfm	53
Cooling ACH	2.61
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	53
Heating ACH	2.61
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	99
Other Roof	99
Ceiling	12
Window	8
Door	0
Wall	117
Below-Grade Wall	0
Other Wall	117
Partition	392
Exterior Floor	0
Internal Floor	0
Slab	112
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 9 of 152

ROOM_Corridor 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	448	0	448	35.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	372	0	372	29.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	67	0	-1	65	5.2
Envelope Subtotal	67	817	-1	883	-
People	0	0	0	0	0.0
Lights	109	155	0	263	20.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	109	155	0	263	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	175	971	-1	1,145	100.0
RA Sensible (Lights)	125	0	0	125	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	0.00
%OA	32	People per 1000 ft²	0
cfm/ft²	0.19	Volume (ft³)	3,546
cfm/ton	579		
ft²/ton	3,097		
Btu/h-ft²	3.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.8 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-341	0	-341	50.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-206	0	-206	30.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	54	0	54	-8.1
Other Floor	0	0	0	0	0.0
Infiltration	-172	0	0	-181	26.8
Envelope Subtotal	-172	-492	0	-673	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-172	-493	0	-674	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	0.00
%OA	32	People per 1000 ft²	0
cfm/ft²	0.19	Volume (ft³)	3,546
cfm/Mbh	-82		
ft²/Mbh	-439		
Btu/h-ft²	-2.28		

Cooling Airflows

Main Fan cfm	55
Cooling ACH	0.93
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	18
Calculated Ventilation ACH	0.30
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	55
Heating ACH	0.93
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	18
Calculated Ventilation ACH	0.30
Infiltration cfm	4
Min Stop/RH (%)	100

Areas ft²

Roof	318
Other Roof	318
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	318
Other Floor	0

ROOM_Corridor 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	690	0	690	29.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	677	0	677	28.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	143	0	-2	141	6.0
Envelope Subtotal	143	1,361	-2	1,502	-
People	0	0	0	0	0.0
Lights	234	328	0	562	23.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	234	328	0	562	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	25	0	25	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.1
Grand Total	377	1,713	-2	2,087	100.0
RA Sensible (Lights)	269	0	0	269	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	0.00
%OA	38	People per 1000 ft²	0
cfm/ft²	0.16	Volume (ft³)	7,619
cfm/ton	579		
ft²/ton	3,651		
Btu/h-ft²	3.29		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 82.1 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-549	0	-549	43.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-337	0	-337	26.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	112	0	112	-8.9
Other Floor	0	0	0	0	0.0
Infiltration	-370	0	0	-388	30.7
Envelope Subtotal	-370	-775	0	-1,163	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-100	0	-100	7.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-370	-876	0	-1,264	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.26	No People(max)	0.00
%OA	38	People per 1000 ft²	0
cfm/ft²	0.16	Volume (ft³)	7,619
cfm/Mbh	-80		
ft²/Mbh	-503		
Btu/h-ft²	-1.99		

Cooling Airflows

Main Fan cfm	101
Cooling ACH	0.80
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	0.30
Infiltration cfm	9
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	101
Heating ACH	0.80
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	0.30
Infiltration cfm	9
Min Stop/RH (%)	100

Areas

	ft²
Roof	516
Other Roof	516
Ceiling	170
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	2,442
Exterior Floor	0
Internal Floor	0
Slab	686
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 11 of 152

ROOM_Corridor 2.1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 37.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	225	0	225	55.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	25	0	-8	17	4.1
Envelope Subtotal	25	223	-8	240	-
People	0	0	0	0	0.0
Lights	32	60	0	91	22.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	32	60	0	91	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	43	0	43	10.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.0
Grand Total	57	325	-8	373	100.0
RA Sensible (Lights)	36	0	0	36	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.00
%OA	28	People per 1000 ft²	0
cfm/ft²	0.22	Volume (ft³)	1,026
cfm/ton	591		
ft²/ton	2,747		
Btu/h-ft²	4.37		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-75	0	-75	33.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-7.0
Other Floor	0	0	0	0	0.0
Infiltration	-50	0	0	-52	23.3
Envelope Subtotal	-50	-59	0	-111	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-113	0	-113	50.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-50	-172	0	-224	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.22	No People(max)	0.00
%OA	28	People per 1000 ft²	0
cfm/ft²	0.22	Volume (ft³)	1,026
cfm/Mbh	-82		
ft²/Mbh	-381		
Btu/h-ft²	-2.62		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	1.05
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	1.05
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	96
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	513
Exterior Floor	0
Internal Floor	0
Slab	96
Other Floor	0

ROOM_Corridor 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 6/21 18:00:00
 Outside DB / WB / HR 87.4 °F / 61.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	868	806	0	1,674	62.4
Door	0	0	0	0	0.0
Wall	0	39	0	39	1.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	304	0	304	11.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	114	0	114	4.2
Other Floor	0	0	0	0	0.0
Infiltration	70	0	-34	36	1.4
Envelope Subtotal	939	1,263	-34	2,167	-
People	0	0	0	0	0.0
Lights	151	235	0	386	14.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	151	235	0	386	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-26	0	-26	-1.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.7
Grand Total	1,089	1,453	-34	2,508	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	0.00
%OA	20	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	4,909
cfm/ton	586		
ft²/ton	1,957		
Btu/h-ft²	6.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,037	0	0	-1,037	60.3
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	3.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	21	0	21	-1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-5.4
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	14.6
Envelope Subtotal	-1,276	50	0	-1,237	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-454	0	-454	26.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	1.6
Grand Total	-1,276	-432	0	-1,719	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.72	No People(max)	0.00
%OA	20	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	4,909
cfm/Mbh	-71		
ft²/Mbh	-238		
Btu/h-ft²	-4.20		

Cooling Airflows

Main Fan cfm	122
Cooling ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	122
Heating ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 13 of 152

ROOM_Corridor 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,199	3,526	0	5,725	101.6
Door	0	0	0	0	0.0
Wall	0	103	0	103	1.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-629	0	-629	-11.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	887	0	887	15.7
Other Floor	0	0	0	0	0.0
Infiltration	86	0	-1	85	1.5
Envelope Subtotal	2,286	3,886	-1	6,170	-
People	0	0	0	0	0.0
Lights	119	195	0	314	5.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	119	195	0	314	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-867	0	-867	-15.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-120	0	-120	-2.1
Grand Total	2,405	3,094	-1	5,498	100.0
RA Sensible (Lights)	137	0	0	137	-

Engineering Checks For Cooling

Cooling tons	0.46	No People(max)	0.00
%OA	7	People per 1000 ft²	0
cfm/ft²	0.82	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	707		
Btu/h-ft²	16.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,010	0	0	-1,010	66.2
Door	0	0	0	0	0.0
Wall	0	-61	0	-61	4.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	47	0	47	-3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	75	0	75	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-199	13.0
Envelope Subtotal	-1,199	61	0	-1,148	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-351	0	-351	23.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.7
Grand Total	-1,199	-317	0	-1,526	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.53	No People(max)	0.00
%OA	7	People per 1000 ft²	0
cfm/ft²	0.82	Volume (ft³)	3,888
cfm/Mbh	-174		
ft²/Mbh	-212		
Btu/h-ft²	-4.72		

Cooling Airflows

Main Fan cfm	265
Cooling ACH	4.09
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	265
Heating ACH	4.09
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

ROOM_Corridor 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 37.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,943	3,833	0	5,776	112.7
Door	0	0	0	0	0.0
Wall	0	101	0	101	2.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-429	0	-429	-8.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	84	0	84	1.6
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-93	-17	-0.3
Envelope Subtotal	2,020	3,589	-93	5,516	-
People	0	0	0	0	0.0
Lights	153	236	0	388	7.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	153	236	0	388	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-860	0	-860	-16.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-93	0	-93	-1.8
Grand Total	2,173	2,873	-93	4,952	100.0
RA Sensible (Lights)	175	0	0	175	-

Engineering Checks For Cooling

Cooling tons	0.41	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	4,967
cfm/ton	589		
ft²/ton	1,003		
Btu/h-ft²	11.96		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,012	0	0	-1,012	60.2
Door	0	0	0	0	0.0
Wall	0	-65	0	-65	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	29	0	29	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-5.5
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-254	15.1
Envelope Subtotal	-1,253	56	0	-1,210	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-445	0	-445	26.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.6
Grand Total	-1,253	-416	0	-1,682	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.68	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	4,967
cfm/Mbh	-145		
ft²/Mbh	-246		
Btu/h-ft²	-4.07		

Cooling Airflows

Main Fan cfm	243
Cooling ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	243
Heating ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 15 of 152

ROOM_Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	59	0	59	3.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	700	0	700	36.8
Wall	0	813	0	813	42.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-149	0	-149	-7.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,420	0	1,420	-
People	0	0	0	0	0.0
Lights	88	125	0	213	11.2
Miscellaneous Loads	195	0	0	195	10.2
Internal Subtotal	283	125	0	408	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-1.3
Grand Total	283	1,521	0	1,804	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	0.00
%OA	13	People per 1000 ft²	0
cfm/ft²	0.46	Volume (ft³)	2,287
cfm/ton	578		
ft²/ton	1,268		
Btu/h-ft²	9.46		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-214	0	-214	20.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-412	0	-412	40.1
Wall	0	-595	0	-595	58.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	91	0	91	-8.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-1,081	0	-1,081	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	65	0	0	65	-6.3
Internal Subtotal	65	0	0	65	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.0
Grand Total	65	-1,091	0	-1,026	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.03	No People(max)	0.00
%OA	13	People per 1000 ft²	0
cfm/ft²	0.46	Volume (ft³)	2,287
cfm/Mbh	-85		
ft²/Mbh	-186		
Btu/h-ft²	-5.38		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	205
Other Roof	205
Ceiling	0
Window	0
Door	21
Wall	358
Below-Grade Wall	0
Other Wall	358
Partition	358
Exterior Floor	0
Internal Floor	0
Slab	205
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 16 of 152

ROOM_Emergency Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-118	0	-118	-7.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	822	0	822	53.4
Wall	0	180	0	180	11.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-202	0	-202	-13.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	674	0	674	-
People	0	0	0	0	0.0
Lights	82	114	0	196	12.7
Miscellaneous Loads	610	0	0	610	39.6
Internal Subtotal	693	114	0	806	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-35	0	-35	-2.2
Grand Total	693	753	0	1,446	100.0
RA Sensible (Lights)	95	0	0	95	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	0.00
%OA	15	People per 1000 ft²	0
cfm/ft²	0.39	Volume (ft³)	2,146
cfm/ton	578		
ft²/ton	1,485		
Btu/h-ft²	8.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-204	0	-204	30.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-414	0	-414	61.6
Wall	0	-178	0	-178	26.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	32	0	32	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	41	0	41	-6.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-722	0	-722	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	61	0	0	61	-9.1
Internal Subtotal	61	0	0	61	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.6
Grand Total	61	-733	0	-672	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	0.00
%OA	15	People per 1000 ft²	0
cfm/ft²	0.39	Volume (ft³)	2,146
cfm/Mbh	-104		
ft²/Mbh	-266		
Btu/h-ft²	-3.76		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	1.96
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.31
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	1.96
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.31
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	193
Other Roof	193
Ceiling	0
Window	0
Door	21
Wall	121
Below-Grade Wall	0
Other Wall	121
Partition	581
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 17 of 152

ROOM_Exam Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	210	0	210	14.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-143	0	-143	-10.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	53	0	53	-
People	129	177	246	552	38.9
Lights	136	209	0	345	24.4
Miscellaneous Loads	189	125	0	314	22.1
Internal Subtotal	454	511	246	1,211	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	454	562	246	1,262	100.0
RA Sensible (Lights)	156	0	0	156	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.23
%OA	64	People per 1000 ft²	10
cfm/ft²	0.40	Volume (ft³)	1,476
cfm/ton	465		
ft²/ton	1,170		
Btu/h-ft²	10.26		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-145	0	-145	101.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	12.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-14.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-143	0	-143	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	0	-143	0	-143	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.14	No People(max)	1.23
%OA	64	People per 1000 ft²	10
cfm/ft²	0.40	Volume (ft³)	1,476
cfm/Mbh	-342		
ft²/Mbh	-860		
Btu/h-ft²	-1.16		

Cooling Airflows

Main Fan cfm	49
Cooling ACH	1.99
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	1.26
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	49
Heating ACH	1.99
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	1.26
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	134
Other Roof	134
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	559
Exterior Floor	0
Internal Floor	0
Slab	134
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 18 of 152

ROOM_Fire Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 09:00:00
 Outside DB / WB / HR 81.4 °F / 59.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-95	0	-95	-9.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	808	0	808	79.8
Wall	0	118	0	118	11.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-184	0	-184	-18.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	640	0	640	-
People	0	0	0	0	0.0
Lights	37	55	0	92	9.1
Miscellaneous Loads	270	0	0	270	26.7
Internal Subtotal	307	55	0	362	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-33	0	-33	-3.2
Grand Total	307	663	0	970	100.0
RA Sensible (Lights)	42	0	0	42	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	951
cfm/ton	578		
ft²/ton	981		
Btu/h-ft²	12.23		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-92	0	-92	17.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-407	0	-407	78.6
Wall	0	-168	0	-168	32.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	111	0	111	-21.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-535	0	-535	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	27	0	0	27	-5.2
Internal Subtotal	27	0	0	27	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	2.0
Grand Total	27	-545	0	-518	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.52	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	951
cfm/Mbh	-90		
ft²/Mbh	-153		
Btu/h-ft²	-6.54		

Cooling Airflows

Main Fan cfm	47
Cooling ACH	2.97
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	47
Heating ACH	2.97
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	88
Other Roof	88
Ceiling	0
Window	0
Door	21
Wall	118
Below-Grade Wall	0
Other Wall	118
Partition	334
Exterior Floor	0
Internal Floor	0
Slab	88
Other Floor	0

ROOM_General Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	151	0	151	15.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	405	0	405	40.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	29	0	-15	14	1.4
Envelope Subtotal	29	552	-15	566	-
People	50	75	96	220	22.2
Lights	44	74	0	118	11.9
Miscellaneous Loads	41	0	0	41	4.1
Internal Subtotal	135	148	96	379	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	164	698	81	942	100.0
RA Sensible (Lights)	51	0	0	51	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.48
%OA	14	People per 1000 ft²	5
cfm/ft²	0.43	Volume (ft³)	1,147
cfm/ton	528		
ft²/ton	1,217		
Btu/h-ft²	9.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-115	0	-115	44.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-56	0	-56	21.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-104	0	0	-109	42.0
Envelope Subtotal	-104	-154	0	-263	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.6
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-99	-154	0	-259	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.26	No People(max)	0.48
%OA	14	People per 1000 ft²	5
cfm/ft²	0.43	Volume (ft³)	1,147
cfm/Mbh	-160		
ft²/Mbh	-369		
Btu/h-ft²	-2.71		

Cooling Airflows

Main Fan cfm	41
Cooling ACH	2.14
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	41
Heating ACH	2.14
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	535
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	238	0	238	5.5
Other Roof	0	0	0	0	0.0
Glass	164	127	0	292	6.7
Door	0	0	0	0	0.0
Wall	0	298	0	298	6.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-200	0	-200	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	116	0	-74	42	1.0
Envelope Subtotal	280	436	-74	642	-
People	553	793	1,106	2,451	56.7
Lights	191	287	0	478	11.1
Miscellaneous Loads	283	183	0	466	10.8
Internal Subtotal	1,027	1,263	1,106	3,395	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	90	0	90	2.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.5
Grand Total	1,307	1,768	1,032	4,107	100.0
RA Sensible (Lights)	219	0	0	219	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-149	0	-149	9.8
Other Roof	0	0	0	0	0.0
Glass	-269	0	0	-269	17.7
Door	0	0	0	0	0.0
Wall	0	-469	0	-469	30.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	98	0	98	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	69	0	69	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	20.7
Envelope Subtotal	-568	-450	0	-1,033	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-476	0	-476	31.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.6
Grand Total	-568	-935	0	-1,518	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	143
Cooling ACH	2.59
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	143
Heating ACH	2.59
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas

ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.34	No People(max)	5.52
%OA	64	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	3,317
cfm/ton	419		
ft²/ton	808		
Btu/h-ft²	14.85		

Engineering Checks For Heating

Heating Mbh	-1.52	No People(max)	5.52
%OA	64	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	3,317
cfm/Mbh	-94		
ft²/Mbh	-182		
Btu/h-ft²	-5.49		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 21 of 152

ROOM_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	160	0	160	4.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	313	0	313	7.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	145	0	145	3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-65	72	1.8
Envelope Subtotal	137	594	-65	665	-
People	492	686	984	2,162	54.8
Lights	170	257	0	427	10.8
Miscellaneous Loads	252	163	0	415	10.5
Internal Subtotal	914	1,107	984	3,005	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	89	0	89	2.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.2
Grand Total	1,051	1,781	919	3,751	100.0
RA Sensible (Lights)	195	0	0	195	-

Engineering Checks For Cooling

Cooling tons	0.31	No People(max)	4.92
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,953
cfm/ton	432		
ft²/ton	787		
Btu/h-ft²	15.25		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-130	0	-130	9.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-440	0	-440	32.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-126	0	-126	9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-280	20.9
Envelope Subtotal	-266	-634	0	-914	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-423	0	-423	31.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.1
Grand Total	-266	-1,059	0	-1,339	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.34	No People(max)	4.92
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,953
cfm/Mbh	-101		
ft²/Mbh	-184		
Btu/h-ft²	-5.43		

Cooling Airflows

Main Fan cfm	135
Cooling ACH	2.74
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	135
Heating ACH	2.74
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 22 of 152

ROOM_Hskp

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	92	0	92	25.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	18	0	18	4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	17	0	-11	7	1.8
Envelope Subtotal	17	108	-11	115	-
People	30	45	57	131	35.5
Lights	26	44	0	70	19.0
Miscellaneous Loads	24	0	0	24	6.5
Internal Subtotal	80	89	57	226	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	97	196	46	340	100.0
RA Sensible (Lights)	30	0	0	30	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.28
%OA	24	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	682
cfm/ton	499		
ft²/ton	2,006		
Btu/h-ft²	5.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-69	0	-69	51.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	11.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-8.3
Other Floor	0	0	0	0	0.0
Infiltration	-62	0	0	-64	47.5
Envelope Subtotal	-62	-74	0	-138	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-1.8
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-59	-74	0	-136	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.14	No People(max)	0.28
%OA	24	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	682
cfm/Mbh	-104		
ft²/Mbh	-419		
Btu/h-ft²	-2.39		

Cooling Airflows

Main Fan cfm	14
Cooling ACH	1.23
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	14
Heating ACH	1.23
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	65
Other Roof	65
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	396
Exterior Floor	0
Internal Floor	0
Slab	65
Other Floor	0

ROOM_Intake Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	233	0	233	36.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	172	0	172	26.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	35	0	-1	34	5.4
Envelope Subtotal	35	403	-1	438	-
People	0	0	0	0	0.0
Lights	57	79	0	136	21.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	57	79	0	136	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	92	481	-1	573	100.0
RA Sensible (Lights)	66	0	0	66	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.00
%OA	34	People per 1000 ft²	0
cfm/ft²	0.18	Volume (ft³)	1,858
cfm/ton	579		
ft²/ton	3,244		
Btu/h-ft²	3.70		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.6 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-181	0	-181	54.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	25.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-8.3
Other Floor	0	0	0	0	0.0
Infiltration	-90	0	0	-95	28.5
Envelope Subtotal	-90	-238	0	-332	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-90	-238	0	-333	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.33	No People(max)	0.00
%OA	34	People per 1000 ft²	0
cfm/ft²	0.18	Volume (ft³)	1,858
cfm/Mbh	-83		
ft²/Mbh	-466		
Btu/h-ft²	-2.15		

Cooling Airflows

Main Fan cfm	28
Cooling ACH	0.90
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	28
Heating ACH	0.90
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	169
Other Roof	169
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	689
Exterior Floor	0
Internal Floor	0
Slab	169
Other Floor	0

ROOM_Interview Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	87	0	87	3.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	564	0	564	24.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-56	0	-56	-2.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	584	0	584	-
People	166	216	316	697	30.0
Lights	174	256	0	430	18.5
Miscellaneous Loads	242	152	0	395	17.0
Internal Subtotal	583	624	316	1,522	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	19	0	19	0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	583	1,222	316	2,120	100.0
RA Sensible (Lights)	200	0	0	200	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.58
%OA	46	People per 1000 ft²	10
cfm/ft²	0.55	Volume (ft³)	1,894
cfm/ton	491		
ft²/ton	893		
Btu/h-ft²	13.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-121	0	-121	15.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-532	0	-532	68.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-7	0	-7	0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-621	0	-621	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-155	0	-155	19.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	0	-778	0	-778	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.78	No People(max)	1.58
%OA	46	People per 1000 ft²	10
cfm/ft²	0.55	Volume (ft³)	1,894
cfm/Mbh	-112		
ft²/Mbh	-203		
Btu/h-ft²	-4.93		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	40
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	40
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	119
Other Roof	119
Ceiling	51
Window	0
Door	0
Wall	313
Below-Grade Wall	0
Other Wall	313
Partition	325
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 25 of 152

ROOM_IT

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	242	0	242	22.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	67	0	67	6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	308	0	308	-
People	0	0	0	0	0.0
Lights	73	98	0	171	15.5
Miscellaneous Loads	539	0	0	539	49.0
Internal Subtotal	612	98	0	710	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	612	406	0	1,018	100.0
RA Sensible (Lights)	84	0	0	84	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.00
%OA	19	People per 1000 ft²	0
cfm/ft²	0.31	Volume (ft³)	1,896
cfm/ton	578		
ft²/ton	1,863		
Btu/h-ft²	6.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-164	0	-164	160.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	58.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	68	0	68	-66.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-156	0	-156	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	54	0	0	54	-52.8
Internal Subtotal	54	0	0	54	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.3
Grand Total	54	-156	0	-102	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.10	No People(max)	0.00
%OA	19	People per 1000 ft²	0
cfm/ft²	0.31	Volume (ft³)	1,896
cfm/Mbh	-480		
ft²/Mbh	-1,548		
Btu/h-ft²	-0.65		

Cooling Airflows

Main Fan cfm	49
Cooling ACH	1.55
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	49
Heating ACH	1.55
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	171
Other Roof	171
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	649
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

ROOM_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,123	0	1,123	4.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	573	0	573	2.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2,460	0	-2,460	-8.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-403	0	-403	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	160	0	-47	113	0.4
Envelope Subtotal	160	-1,167	-47	-1,055	-
People	1,215	1,670	2,894	5,780	20.9
Lights	225	349	0	574	2.1
Miscellaneous Loads	13,295	8,820	0	22,115	80.0
Internal Subtotal	14,736	10,839	2,894	28,469	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	-0.1
Grand Total	14,896	9,644	2,847	27,386	100.0
RA Sensible (Lights)	259	0	0	259	-

Engineering Checks For Cooling

Cooling tons	2.28	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/ton	1,095		
ft²/ton	167		
Btu/h-ft²	71.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-430	0	-430	35.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-380	0	-380	31.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	76	0	76	-6.3
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-434	35.8
Envelope Subtotal	-414	-778	0	-1,212	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-414	-779	0	-1,213	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/Mbh	-2,061		
ft²/Mbh	-315		
Btu/h-ft²	-3.17		

Cooling Airflows

Main Fan cfm	2,500
Cooling ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,500
Heating ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	402
Other Roof	402
Ceiling	0
Window	0
Door	0
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	766
Exterior Floor	0
Internal Floor	0
Slab	402
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 27 of 152

ROOM_Laundry

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	192	0	192	26.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1	0	1	0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-24	13	1.8
Envelope Subtotal	37	190	-24	203	-
People	64	84	122	270	37.1
Lights	56	83	0	139	19.2
Miscellaneous Loads	52	0	0	52	7.1
Internal Subtotal	172	168	122	461	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	209	356	98	663	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.61
%OA	27	People per 1000 ft²	5
cfm/ft²	0.22	Volume (ft³)	1,461
cfm/ton	492		
ft²/ton	2,204		
Btu/h-ft²	5.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-144	0	-144	52.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	7.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-7.5
Other Floor	0	0	0	0	0.0
Infiltration	-132	0	0	-138	49.9
Envelope Subtotal	-132	-143	0	-281	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	5	0	0	5	-1.9
Internal Subtotal	5	0	0	5	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-127	-144	0	-276	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.28	No People(max)	0.61
%OA	27	People per 1000 ft²	5
cfm/ft²	0.22	Volume (ft³)	1,461
cfm/Mbh	-98		
ft²/Mbh	-441		
Btu/h-ft²	-2.27		

Cooling Airflows

Main Fan cfm	27
Cooling ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	27
Heating ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	133
Other Roof	133
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	557
Exterior Floor	0
Internal Floor	0
Slab	133
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 28 of 152

ROOM_Long Term Belongings Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	160	0	160	24.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	38	0	38	5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	30	0	-19	11	1.8
Envelope Subtotal	30	195	-19	207	-
People	53	71	101	225	34.9
Lights	46	70	0	117	18.1
Miscellaneous Loads	43	0	0	43	6.7
Internal Subtotal	142	141	101	384	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	173	336	82	590	100.0
RA Sensible (Lights)	53	0	0	53	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-120	0	-120	50.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	9.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-7.3
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	48.3
Envelope Subtotal	-109	-126	0	-240	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.8
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-105	-126	0	-236	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	24
Cooling ACH	1.19
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.30
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	24
Heating ACH	1.19
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.30
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	111
Other Roof	111
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	516
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.50
%OA	25	People per 1000 ft²	5
cfm/ft²	0.24	Volume (ft³)	1,208
cfm/ton	497		
ft²/ton	2,049		
Btu/h-ft²	5.86		

Engineering Checks For Heating

Heating Mbh	-0.24	No People(max)	0.50
%OA	25	People per 1000 ft²	5
cfm/ft²	0.24	Volume (ft³)	1,208
cfm/Mbh	-103		
ft²/Mbh	-426		
Btu/h-ft²	-2.35		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 29 of 152

ROOM_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-70	0	-70	-1.6
Other Roof	0	0	0	0	0.0
Glass	426	945	0	1,371	30.5
Door	0	790	0	790	17.5
Wall	0	516	0	516	11.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-451	0	-451	-10.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-98	0	-98	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-123	-49	-1.1
Envelope Subtotal	500	1,631	-123	2,008	-
People	396	542	791	1,729	38.4
Lights	137	198	0	335	7.4
Miscellaneous Loads	202	126	0	329	7.3
Internal Subtotal	735	866	791	2,392	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-56	0	-56	-1.3
Grand Total	1,235	2,441	668	4,344	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	3.95
%OA	37	People per 1000 ft²	20
cfm/ft²	0.89	Volume (ft³)	2,373
cfm/ton	489		
ft²/ton	547		
Btu/h-ft²	21.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-222	0	-222	17.8
Other Roof	0	0	0	0	0.0
Glass	-262	0	0	-262	21.0
Door	0	-399	0	-399	32.0
Wall	0	-317	0	-317	25.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	144	0	144	-11.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	48	0	48	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-214	0	0	-225	18.0
Envelope Subtotal	-476	-745	0	-1,231	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	1.3
Grand Total	-476	-761	0	-1,248	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.25	No People(max)	3.95
%OA	37	People per 1000 ft²	20
cfm/ft²	0.89	Volume (ft³)	2,373
cfm/Mbh	-142		
ft²/Mbh	-159		
Btu/h-ft²	-6.29		

Cooling Airflows

Main Fan cfm	177
Cooling ACH	4.47
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.64
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	177
Heating ACH	4.47
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.64
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	212
Other Roof	212
Ceiling	0
Window	16
Door	21
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	499
Exterior Floor	0
Internal Floor	0
Slab	212
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 30 of 152

ROOM_Mechanical

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	248	0	248	21.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	67	0	67	5.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	75	0	75	6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	389	0	389	-
People	0	0	0	0	0.0
Lights	71	105	0	176	15.0
Miscellaneous Loads	528	0	0	528	45.0
Internal Subtotal	599	105	0	704	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	599	493	0	1,092	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.34	Volume (ft³)	1,856
cfm/ton	578		
ft²/ton	1,700		
Btu/h-ft²	7.06		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-176	0	-176	61.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-115	0	-115	40.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-90	0	-90	31.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	44	0	44	-15.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-338	0	-338	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	53	0	0	53	-18.5
Internal Subtotal	53	0	0	53	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	53	-338	0	-285	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.29	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.34	Volume (ft³)	1,856
cfm/Mbh	-184		
ft²/Mbh	-542		
Btu/h-ft²	-1.85		

Cooling Airflows

Main Fan cfm	53
Cooling ACH	1.71
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	53
Heating ACH	1.71
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	170
Other Roof	170
Ceiling	0
Window	0
Door	0
Wall	64
Below-Grade Wall	0
Other Wall	64
Partition	685
Exterior Floor	0
Internal Floor	0
Slab	170
Other Floor	0

ROOM_Meds

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	204	0	204	26.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	10	0	10	1.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-25	14	1.8
Envelope Subtotal	39	210	-25	224	-
People	68	89	129	287	36.7
Lights	60	88	0	148	18.9
Miscellaneous Loads	55	0	0	55	7.1
Internal Subtotal	183	177	129	490	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	222	386	104	712	100.0
RA Sensible (Lights)	68	0	0	68	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.65
%OA	27	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,553
cfm/ton	493		
ft²/ton	2,180		
Btu/h-ft²	5.50		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-153	0	-153	50.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-31	0	-31	10.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-7.4
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	48.5
Envelope Subtotal	-140	-161	0	-308	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	6	0	0	6	-1.8
Internal Subtotal	6	0	0	6	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-135	-161	0	-302	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.30	No People(max)	0.65
%OA	27	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,553
cfm/Mbh	-97		
ft²/Mbh	-428		
Btu/h-ft²	-2.34		

Cooling Airflows

Main Fan cfm	29
Cooling ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	29
Heating ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	141
Other Roof	141
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	572
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 32 of 152

ROOM_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 53.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	385	0	385	5.2
Other Roof	0	0	0	0	0.0
Glass	256	188	0	444	6.0
Door	0	275	0	275	3.7
Wall	0	333	0	333	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-329	0	-329	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	269	0	-128	141	1.9
Envelope Subtotal	525	798	-128	1,195	-
People	971	1,280	1,942	4,192	56.2
Lights	335	479	0	814	10.9
Miscellaneous Loads	497	305	0	802	10.7
Internal Subtotal	1,803	2,064	1,942	5,808	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	112	0	112	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-0.5
Grand Total	2,328	2,934	1,814	7,076	100.0
RA Sensible (Lights)	385	0	0	385	-

Engineering Checks For Cooling

Cooling tons	0.59	No People(max)	9.70
%OA	67	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	5,825
cfm/ton	408		
ft²/ton	823		
Btu/h-ft²	14.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-270	0	-270	10.5
Other Roof	0	0	0	0	0.0
Glass	-404	0	0	-404	15.6
Door	0	-415	0	-415	16.1
Wall	0	-470	0	-470	18.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	192	0	192	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	126	0	126	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-552	21.4
Envelope Subtotal	-929	-837	0	-1,793	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-766	0	-766	29.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	0.9
Grand Total	-929	-1,626	0	-2,581	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.58	No People(max)	9.70
%OA	67	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	5,825
cfm/Mbh	-93		
ft²/Mbh	-188		
Btu/h-ft²	-5.32		

Cooling Airflows

Main Fan cfm	241
Cooling ACH	2.48
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	241
Heating ACH	2.48
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 33 of 152

ROOM_Noisy Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	503	856	0	1,358	30.3
Door	0	925	0	925	20.7
Wall	0	390	0	390	8.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-475	0	-475	-10.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	140	0	140	3.1
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-72	15	0.3
Envelope Subtotal	589	1,836	-72	2,353	-
People	377	566	719	1,662	37.1
Lights	166	279	0	444	9.9
Miscellaneous Loads	184	133	0	317	7.1
Internal Subtotal	727	978	719	2,423	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-414	0	-414	-9.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-72	0	-72	-1.6
Grand Total	1,316	2,328	647	4,290	100.0
RA Sensible (Lights)	190	0	0	190	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.09	Volume (ft³)	2,156
cfm/ton	547		
ft²/ton	503		
Btu/h-ft²	23.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-266	0	0	-266	22.9
Door	0	-417	0	-417	36.0
Wall	0	-237	0	-237	20.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	112	0	112	-9.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	44	0	44	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-205	17.6
Envelope Subtotal	-460	-497	0	-968	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-174	0	-174	15.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	1.5
Grand Total	-460	-689	0	-1,159	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.16	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.09	Volume (ft³)	2,156
cfm/Mbh	-169		
ft²/Mbh	-155		
Btu/h-ft²	-6.45		

Cooling Airflows

Main Fan cfm	196
Cooling ACH	5.45
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	196
Heating ACH	5.45
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 34 of 152

ROOM_Noisy Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	320	0	320	10.9
Wall	0	78	0	78	2.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-53	0	-53	-1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-55	21	0.7
Envelope Subtotal	76	303	-55	324	-
People	380	568	723	1,671	56.9
Lights	167	280	0	447	15.2
Miscellaneous Loads	185	134	0	319	10.9
Internal Subtotal	732	982	723	2,437	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-6	0	-6	-0.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.4
Grand Total	807	1,267	669	2,744	100.0
RA Sensible (Lights)	191	0	0	191	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.61
%OA	38	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,170
cfm/ton	436		
ft²/ton	791		
Btu/h-ft²	15.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-416	0	-416	47.5
Wall	0	-123	0	-123	14.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	41	0	41	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-206	23.5
Envelope Subtotal	-196	-459	0	-664	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-201	0	-201	22.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.2
Grand Total	-196	-671	0	-876	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	3.61
%OA	38	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,170
cfm/Mbh	-114		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	100
Cooling ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	100
Heating ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 35 of 152

ROOM_Noisy Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	99	70	0	170	5.6
Door	0	309	0	309	10.2
Wall	0	144	0	144	4.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-243	0	-243	-8.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-47	0	-47	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-53	56	1.8
Envelope Subtotal	209	233	-53	388	-
People	382	559	729	1,670	54.9
Lights	168	276	0	444	14.6
Miscellaneous Loads	186	132	0	318	10.5
Internal Subtotal	737	967	729	2,432	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	46	0	46	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	945	1,229	675	2,850	100.0
RA Sensible (Lights)	193	0	0	193	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	11.0
Door	0	-384	0	-384	34.0
Wall	0	-220	0	-220	19.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	118	0	118	-10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	18.3
Envelope Subtotal	-322	-441	0	-772	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-345	0	-345	30.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	1.1
Grand Total	-322	-799	0	-1,130	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	105
Cooling ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	105
Heating ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	3.64
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	2,186
cfm/ton	440		
ft²/ton	767		
Btu/h-ft²	15.65		

Engineering Checks For Heating

Heating Mbh	-1.13	No People(max)	3.64
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	2,186
cfm/Mbh	-93		
ft²/Mbh	-161		
Btu/h-ft²	-6.21		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 36 of 152

ROOM_Office 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-20	0	-20	-1.3
Other Roof	0	0	0	0	0.0
Glass	217	517	0	733	47.4
Door	0	0	0	0	0.0
Wall	0	292	0	292	18.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	-3.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-73	0	-73	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	36	0	-55	-19	-1.2
Envelope Subtotal	252	662	-55	859	-
People	99	138	188	425	27.5
Lights	61	95	0	156	10.1
Miscellaneous Loads	48	0	0	48	3.1
Internal Subtotal	208	233	188	629	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.7
Grand Total	460	884	134	1,477	100.0
RA Sensible (Lights)	70	0	0	70	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	0.94
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,130
cfm/ton	525		
ft²/ton	765		
Btu/h-ft²	15.69		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-110	0	-110	22.4
Other Roof	0	0	0	0	0.0
Glass	-131	0	0	-131	26.6
Door	0	0	0	0	0.0
Wall	0	-176	0	-176	35.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1	0	-1	0.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-102	0	0	-107	21.8
Envelope Subtotal	-233	-267	0	-505	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-3.3
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.7
Grand Total	-217	-270	0	-493	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.49	No People(max)	0.94
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,130
cfm/Mbh	-131		
ft²/Mbh	-191		
Btu/h-ft²	-5.24		

Cooling Airflows

Main Fan cfm	65
Cooling ACH	3.45
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	65
Heating ACH	3.45
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	104
Other Roof	104
Ceiling	0
Window	8
Door	0
Wall	107
Below-Grade Wall	0
Other Wall	107
Partition	388
Exterior Floor	0
Internal Floor	0
Slab	104
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 37 of 152

ROOM_Office 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-50	0	-50	-3.5
Other Roof	0	0	0	0	0.0
Glass	233	516	0	748	51.3
Door	0	0	0	0	0.0
Wall	0	259	0	259	17.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-129	0	-129	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-39	0	-39	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	33	0	-56	-23	-1.6
Envelope Subtotal	265	557	-56	766	-
People	100	138	190	428	29.4
Lights	61	95	0	157	10.7
Miscellaneous Loads	49	0	0	49	3.3
Internal Subtotal	210	233	190	633	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.8
Grand Total	475	778	134	1,387	100.0
RA Sensible (Lights)	70	0	0	70	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	0.95
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,142
cfm/ton	521		
ft²/ton	823		
Btu/h-ft²	14.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-111	0	-111	24.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	27.9
Door	0	0	0	0	0.0
Wall	0	-176	0	-176	38.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	29	0	29	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-103	0	0	-108	23.4
Envelope Subtotal	-232	-238	0	-476	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-3.5
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.8
Grand Total	-216	-242	0	-463	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.46	No People(max)	0.95
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,142
cfm/Mbh	-130		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	105
Other Roof	105
Ceiling	0
Window	8
Door	0
Wall	108
Below-Grade Wall	0
Other Wall	108
Partition	389
Exterior Floor	0
Internal Floor	0
Slab	105
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 38 of 152

ROOM_Quiet Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 53.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	7	0	7	0.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-59	18	0.9
Envelope Subtotal	77	-20	-59	-2	-
People	274	417	521	1,212	62.7
Lights	120	206	0	326	16.9
Miscellaneous Loads	133	98	0	232	12.0
Internal Subtotal	527	721	521	1,770	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	31	0	31	1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	604	728	462	1,795	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.60
%OA	46	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/ton	398		
ft²/ton	872		
Btu/h-ft²	13.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-64	0	-64	17.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	41.4
Envelope Subtotal	-141	-41	0	-189	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-169	0	-169	47.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-141	-210	0	-358	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	2.60
%OA	46	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/Mbh	-166		
ft²/Mbh	-364		
Btu/h-ft²	-2.75		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 39 of 152

ROOM_Quiet Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	230	284	0	514	21.6
Door	0	0	0	0	0.0
Wall	0	92	0	92	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-63	0	-63	-2.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-60	17	0.7
Envelope Subtotal	307	302	-60	549	-
People	274	424	523	1,221	51.3
Lights	120	209	0	329	13.8
Miscellaneous Loads	134	100	0	233	9.8
Internal Subtotal	528	733	523	1,784	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-76	0	-76	-3.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.7
Grand Total	835	942	463	2,240	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	2.61
%OA	32	People per 1000 ft²	20
cfm/ft²	0.65	Volume (ft³)	1,568
cfm/ton	454		
ft²/ton	700		
Btu/h-ft²	17.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-130	0	0	-130	24.3
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	13.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	9.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-149	27.7
Envelope Subtotal	-272	-93	0	-372	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-161	0	-161	30.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.6
Grand Total	-272	-257	0	-536	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.54	No People(max)	2.61
%OA	32	People per 1000 ft²	20
cfm/ft²	0.65	Volume (ft³)	1,568
cfm/Mbh	-158		
ft²/Mbh	-244		
Btu/h-ft²	-4.10		

Cooling Airflows

Main Fan cfm	85
Cooling ACH	3.25
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	85
Heating ACH	3.25
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 40 of 152

ROOM_Quiet Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	401	0	401	17.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-63	0	-63	-2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-38	17	0.7
Envelope Subtotal	55	305	-38	322	-
People	275	435	524	1,235	55.3
Lights	121	215	0	336	15.0
Miscellaneous Loads	134	102	0	237	10.6
Internal Subtotal	530	753	524	1,808	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-29	0	-29	-1.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	585	1,024	486	2,095	100.0
RA Sensible (Lights)	139	0	0	139	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.62
%OA	36	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,573
cfm/ton	443		
ft²/ton	751		
Btu/h-ft²	15.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-225	0	-225	42.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	28.4
Envelope Subtotal	-142	-219	0	-368	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-157	0	-157	29.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-142	-376	0	-525	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.53	No People(max)	2.62
%OA	36	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,573
cfm/Mbh	-147		
ft²/Mbh	-250		
Btu/h-ft²	-4.00		

Cooling Airflows

Main Fan cfm	77
Cooling ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	77
Heating ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 41 of 152

ROOM_Resident Room 01

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 10:00:00
 Outside DB / WB / HR 86.6 °F / 61.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	514	0	786	31.8
Door	0	0	0	0	0.0
Wall	0	143	0	143	5.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-135	0	-135	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-50	-13	-0.5
Envelope Subtotal	309	495	-50	754	-
People	143	151	341	634	25.6
Lights	137	211	0	348	14.0
Miscellaneous Loads	338	335	0	674	27.2
Internal Subtotal	618	697	341	1,655	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-75	0	-75	-3.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.7
Grand Total	927	1,100	291	2,318	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.92	Volume (ft³)	1,486
cfm/ton	592		
ft²/ton	641		
Btu/h-ft²	18.72		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-170	0	0	-170	30.8
Door	0	0	0	0	0.0
Wall	0	-123	0	-123	22.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	5	0	5	-0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	25.5
Envelope Subtotal	-304	-92	0	-403	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-145	0	-145	26.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.8
Grand Total	-304	-241	0	-552	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.55	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.92	Volume (ft³)	1,486
cfm/Mbh	-207		
ft²/Mbh	-225		
Btu/h-ft²	-4.44		

Cooling Airflows

Main Fan cfm	114
Cooling ACH	4.60
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.57
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	114
Heating ACH	4.60
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.57
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	80
Below-Grade Wall	0
Other Wall	80
Partition	482
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 42 of 152

ROOM_Resident Room 02

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	533	0	806	32.7
Door	0	0	0	0	0.0
Wall	0	241	0	241	9.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-80	0	-80	-3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-40	0	-40	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	35	0	-30	5	0.2
Envelope Subtotal	308	653	-30	931	-
People	129	139	307	575	23.3
Lights	123	193	0	317	12.9
Miscellaneous Loads	305	308	0	613	24.9
Internal Subtotal	557	640	307	1,505	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-95	0	-95	-3.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.7
Grand Total	865	1,181	277	2,323	100.0
RA Sensible (Lights)	142	0	0	142	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.12
%OA	10	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,340
cfm/ton	608		
ft²/ton	577		
Btu/h-ft²	20.80		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-171	0	0	-171	29.4
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	31.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	3	0	3	-0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-121	0	0	-127	21.8
Envelope Subtotal	-292	-154	0	-452	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-126	0	-126	21.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.7
Grand Total	-292	-284	0	-582	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.58	No People(max)	1.12
%OA	10	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,340
cfm/Mbh	-202		
ft²/Mbh	-192		
Btu/h-ft²	-5.21		

Cooling Airflows

Main Fan cfm	118
Cooling ACH	5.28
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	118
Heating ACH	5.28
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	123
Window	10
Door	0
Wall	112
Below-Grade Wall	0
Other Wall	112
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	123
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 43 of 152

ROOM_Resident Room 03

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	515	0	787	27.5
Door	0	0	0	0	0.0
Wall	0	302	0	302	10.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-68	0	-68	-2.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	42	0	-36	6	0.2
Envelope Subtotal	315	722	-36	1,001	-
People	157	162	375	695	24.3
Lights	151	227	0	378	13.2
Miscellaneous Loads	372	362	0	734	25.7
Internal Subtotal	680	751	375	1,807	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-104	0	-104	-3.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.6
Grand Total	995	1,351	339	2,685	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.36
%OA	11	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,636
cfm/ton	588		
ft²/ton	610		
Btu/h-ft²	19.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-173	0	0	-173	24.9
Door	0	0	0	0	0.0
Wall	0	-224	0	-224	32.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-148	0	0	-155	22.3
Envelope Subtotal	-320	-213	0	-541	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-150	0	-150	21.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.6
Grand Total	-320	-367	0	-695	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.69	No People(max)	1.36
%OA	11	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,636
cfm/Mbh	-189		
ft²/Mbh	-196		
Btu/h-ft²	-5.10		

Cooling Airflows

Main Fan cfm	132
Cooling ACH	4.84
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	132
Heating ACH	4.84
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	148
Window	10
Door	0
Wall	136
Below-Grade Wall	0
Other Wall	136
Partition	450
Exterior Floor	0
Internal Floor	0
Slab	148
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 44 of 152

ROOM_Resident Room 04

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	517	0	790	28.9
Door	0	0	0	0	0.0
Wall	0	287	0	287	10.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	-2.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-34	6	0.2
Envelope Subtotal	313	699	-34	977	-
People	149	153	355	657	24.1
Lights	143	216	0	358	13.1
Miscellaneous Loads	352	343	0	696	25.5
Internal Subtotal	644	712	355	1,711	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-102	0	-102	-3.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.6
Grand Total	957	1,291	321	2,569	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,549
cfm/ton	591		
ft²/ton	603		
Btu/h-ft²	19.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-171	0	0	-171	19.8
Door	0	0	0	0	0.0
Wall	0	-488	0	-488	56.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	41	0	41	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	17.0
Envelope Subtotal	-311	-416	0	-734	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-127	0	-127	14.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-311	-547	0	-865	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,549
cfm/Mbh	-146		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	127
Cooling ACH	4.92
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	127
Heating ACH	4.92
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 45 of 152

ROOM_Resident Room 05

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	299	562	0	861	26.2
Door	0	0	0	0	0.0
Wall	0	726	0	726	22.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-142	0	-142	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	1.3
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-47	17	0.5
Envelope Subtotal	362	1,189	-47	1,504	-
People	152	213	361	726	22.1
Lights	145	255	0	400	12.2
Miscellaneous Loads	358	405	0	764	23.3
Internal Subtotal	655	873	361	1,889	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-256	0	-256	-7.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.6
Grand Total	1,017	1,786	314	3,118	100.0
RA Sensible (Lights)	167	0	0	167	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	1.31
%OA	11	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/ton	519		
ft²/ton	505		
Btu/h-ft²	23.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-178	0	0	-178	20.2
Door	0	0	0	0	0.0
Wall	0	-491	0	-491	56.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	42	0	42	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	17.0
Envelope Subtotal	-320	-416	0	-743	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-129	0	-129	14.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.5
Grand Total	-320	-550	0	-877	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	1.31
%OA	11	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/Mbh	-154		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	135
Cooling ACH	5.14
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	135
Heating ACH	5.14
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 46 of 152

ROOM_Resident Room 06

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	347	596	0	943	32.9
Door	0	0	0	0	0.0
Wall	0	313	0	313	10.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-237	0	-237	-8.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	72	0	72	2.5
Other Floor	0	0	0	0	0.0
Infiltration	61	0	-33	28	1.0
Envelope Subtotal	408	744	-33	1,120	-
People	143	205	341	689	24.1
Lights	137	245	0	382	13.3
Miscellaneous Loads	338	391	0	729	25.4
Internal Subtotal	619	841	341	1,801	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-189	0	-189	-6.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.8
Grand Total	1,027	1,373	308	2,708	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.24
%OA	10	People per 1000 ft²	10
cfm/ft²	1.14	Volume (ft³)	1,488
cfm/ton	625		
ft²/ton	550		
Btu/h-ft²	21.82		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-180	0	0	-180	27.9
Door	0	0	0	0	0.0
Wall	0	-198	0	-198	30.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	21.9
Envelope Subtotal	-314	-180	0	-501	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-138	0	-138	21.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.7
Grand Total	-314	-323	0	-644	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.64	No People(max)	1.24
%OA	10	People per 1000 ft²	10
cfm/ft²	1.14	Volume (ft³)	1,488
cfm/Mbh	-219		
ft²/Mbh	-193		
Btu/h-ft²	-5.18		

Cooling Airflows

Main Fan cfm	141
Cooling ACH	5.69
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	141
Heating ACH	5.69
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 47 of 152

ROOM_Resident Room 07

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	506	1,031	0	1,537	48.5
Door	0	0	0	0	0.0
Wall	0	298	0	298	9.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-192	0	-192	-6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-80	0	-80	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	47	0	-73	-26	-0.8
Envelope Subtotal	553	1,057	-73	1,538	-
People	145	190	345	679	21.4
Lights	139	243	0	382	12.0
Miscellaneous Loads	342	388	0	730	23.0
Internal Subtotal	626	821	345	1,791	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-287	0	-287	-9.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-1.0
Grand Total	1,179	1,560	272	3,010	100.0
RA Sensible (Lights)	159	0	0	159	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	1.25
%OA	10	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,504
cfm/ton	525		
ft²/ton	500		
Btu/h-ft²	24.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-290	0	0	-290	40.1
Door	0	0	0	0	0.0
Wall	0	-187	0	-187	25.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	17	0	17	-2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	29	0	29	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-136	0	0	-143	19.7
Envelope Subtotal	-425	-142	0	-574	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-142	0	-142	19.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	1.0
Grand Total	-425	-291	0	-723	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.72	No People(max)	1.25
%OA	10	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,504
cfm/Mbh	-182		
ft²/Mbh	-174		
Btu/h-ft²	-5.75		

Cooling Airflows

Main Fan cfm	132
Cooling ACH	5.26
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	132
Heating ACH	5.26
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	137
Window	18
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	442
Exterior Floor	0
Internal Floor	0
Slab	137
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 48 of 152

ROOM_Resident Room 08

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	504	1,091	0	1,595	48.7
Door	0	0	0	0	0.0
Wall	0	310	0	310	9.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-123	0	-123	-3.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-121	0	-121	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-73	-26	-0.8
Envelope Subtotal	552	1,157	-73	1,636	-
People	146	191	347	684	20.9
Lights	140	245	0	384	11.7
Miscellaneous Loads	345	390	0	735	22.4
Internal Subtotal	630	826	347	1,804	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-290	0	-290	-8.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-31	0	-31	-1.0
Grand Total	1,182	1,662	274	3,118	100.0
RA Sensible (Lights)	160	0	0	160	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-292	0	0	-292	38.4
Door	0	0	0	0	0.0
Wall	0	-190	0	-190	25.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-17	0	-17	2.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	18.9
Envelope Subtotal	-429	-177	0	-613	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-140	0	-140	18.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.9
Grand Total	-429	-325	0	-761	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	137
Cooling ACH	5.42
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	137
Heating ACH	5.42
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	18
Door	0
Wall	125
Below-Grade Wall	0
Other Wall	125
Partition	443
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	1.26
%OA	10	People per 1000 ft²	10
cfm/ft²	1.08	Volume (ft³)	1,515
cfm/ton	527		
ft²/ton	486		
Btu/h-ft²	24.69		

Engineering Checks For Heating

Heating Mbh	-0.76	No People(max)	1.26
%OA	10	People per 1000 ft²	10
cfm/ft²	1.08	Volume (ft³)	1,515
cfm/Mbh	-180		
ft²/Mbh	-166		
Btu/h-ft²	-6.02		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 49 of 152

ROOM_Resident Room 09

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	502	1,076	0	1,579	46.9
Door	0	0	0	0	0.0
Wall	0	423	0	423	12.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-122	0	-122	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-110	0	-110	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-74	-26	-0.8
Envelope Subtotal	551	1,266	-74	1,743	-
People	148	190	352	689	20.5
Lights	141	244	0	385	11.4
Miscellaneous Loads	349	389	0	738	21.9
Internal Subtotal	638	822	352	1,812	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-322	0	-322	-9.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-31	0	-31	-0.9
Grand Total	1,189	1,736	278	3,202	100.0
RA Sensible (Lights)	162	0	0	162	-

Engineering Checks For Cooling

Cooling tons	0.27	No People(max)	1.28
%OA	10	People per 1000 ft²	10
cfm/ft²	1.10	Volume (ft³)	1,534
cfm/ton	527		
ft²/ton	479		
Btu/h-ft²	25.05		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-290	0	0	-290	30.1
Door	0	0	0	0	0.0
Wall	0	-467	0	-467	48.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	41	0	41	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-138	0	0	-146	15.1
Envelope Subtotal	-428	-393	0	-828	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-127	0	-127	13.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.7
Grand Total	-428	-527	0	-962	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.96	No People(max)	1.28
%OA	10	People per 1000 ft²	10
cfm/ft²	1.10	Volume (ft³)	1,534
cfm/Mbh	-146		
ft²/Mbh	-133		
Btu/h-ft²	-7.52		

Cooling Airflows

Main Fan cfm	141
Cooling ACH	5.51
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	141
Heating ACH	5.51
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	140
Window	18
Door	0
Wall	285
Below-Grade Wall	0
Other Wall	285
Partition	285
Exterior Floor	0
Internal Floor	0
Slab	140
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 50 of 152

ROOM_Resident Room 10

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	231	193	0	424	15.2
Door	0	0	0	0	0.0
Wall	0	602	0	602	21.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-115	0	-115	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-15	0	-15	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-34	20	0.7
Envelope Subtotal	285	665	-34	916	-
People	150	214	357	721	25.9
Lights	143	248	0	391	14.1
Miscellaneous Loads	354	395	0	749	26.9
Internal Subtotal	648	857	357	1,861	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-140	0	-140	-5.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.7
Grand Total	933	1,363	323	2,619	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	1,557
cfm/ton	593		
ft²/ton	595		
Btu/h-ft²	20.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-299	0	0	-299	31.4
Door	0	0	0	0	0.0
Wall	0	-468	0	-468	49.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	62	0	62	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	15.5
Envelope Subtotal	-439	-373	0	-819	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-125	0	-125	13.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.8
Grand Total	-439	-506	0	-952	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	1,557
cfm/Mbh	-136		
ft²/Mbh	-136		
Btu/h-ft²	-7.35		

Cooling Airflows

Main Fan cfm	129
Cooling ACH	4.97
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	129
Heating ACH	4.97
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 51 of 152

ROOM_Resident Room 11

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	346	592	0	938	31.8
Door	0	0	0	0	0.0
Wall	0	323	0	323	11.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-241	0	-241	-8.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	69	0	69	2.3
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-34	29	1.0
Envelope Subtotal	410	743	-34	1,118	-
People	149	214	355	718	24.4
Lights	143	256	0	399	13.5
Miscellaneous Loads	352	408	0	760	25.8
Internal Subtotal	644	878	355	1,878	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-189	0	-189	-6.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.8
Grand Total	1,054	1,409	321	2,784	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.29
%OA	10	People per 1000 ft²	10
cfm/ft²	1.12	Volume (ft³)	1,549
cfm/ton	625		
ft²/ton	556		
Btu/h-ft²	21.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-179	0	0	-179	27.7
Door	0	0	0	0	0.0
Wall	0	-204	0	-204	31.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	7	0	7	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	22.7
Envelope Subtotal	-319	-169	0	-495	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-146	0	-146	22.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.7
Grand Total	-319	-321	0	-647	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.29
%OA	10	People per 1000 ft²	10
cfm/ft²	1.12	Volume (ft³)	1,549
cfm/Mbh	-224		
ft²/Mbh	-200		
Btu/h-ft²	-5.00		

Cooling Airflows

Main Fan cfm	145
Cooling ACH	5.62
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	145
Heating ACH	5.62
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	126
Below-Grade Wall	0
Other Wall	126
Partition	447
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 52 of 152

ROOM_Resident Room 12

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	346	596	0	942	31.8
Door	0	0	0	0	0.0
Wall	0	316	0	316	10.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-174	0	-174	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	70	0	70	2.4
Other Floor	0	0	0	0	0.0
Infiltration	63	0	-34	29	1.0
Envelope Subtotal	409	808	-34	1,182	-
People	146	210	348	705	23.8
Lights	140	251	0	391	13.2
Miscellaneous Loads	346	400	0	746	25.2
Internal Subtotal	632	862	348	1,842	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-199	0	-199	-6.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.8
Grand Total	1,041	1,447	315	2,803	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.27
%OA	9	People per 1000 ft²	10
cfm/ft²	1.16	Volume (ft³)	1,520
cfm/ton	630		
ft²/ton	542		
Btu/h-ft²	22.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-179	0	0	-179	27.7
Door	0	0	0	0	0.0
Wall	0	-201	0	-201	31.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-4	0	-4	0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	22.2
Envelope Subtotal	-317	-177	0	-501	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-143	0	-143	22.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.7
Grand Total	-317	-325	0	-648	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.27
%OA	9	People per 1000 ft²	10
cfm/ft²	1.16	Volume (ft³)	1,520
cfm/Mbh	-227		
ft²/Mbh	-195		
Btu/h-ft²	-5.13		

Cooling Airflows

Main Fan cfm	147
Cooling ACH	5.80
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	147
Heating ACH	5.80
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Resident Room 13

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	346	597	0	944	31.7
Door	0	0	0	0	0.0
Wall	0	316	0	316	10.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-161	0	-161	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	70	0	70	2.4
Other Floor	0	0	0	0	0.0
Infiltration	63	0	-34	29	1.0
Envelope Subtotal	409	823	-34	1,198	-
People	146	210	348	705	23.7
Lights	140	251	0	391	13.1
Miscellaneous Loads	346	400	0	745	25.1
Internal Subtotal	632	860	348	1,841	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-201	0	-201	-6.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.8
Grand Total	1,041	1,459	315	2,815	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.27
%OA	9	People per 1000 ft²	10
cfm/ft²	1.17	Volume (ft³)	1,521
cfm/ton	632		
ft²/ton	540		
Btu/h-ft²	22.22		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-180	0	0	-180	27.0
Door	0	0	0	0	0.0
Wall	0	-201	0	-201	30.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	3.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	21.7
Envelope Subtotal	-317	-195	0	-519	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-142	0	-142	21.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.7
Grand Total	-317	-342	0	-666	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	1.27
%OA	9	People per 1000 ft²	10
cfm/ft²	1.17	Volume (ft³)	1,521
cfm/Mbh	-223		
ft²/Mbh	-190		
Btu/h-ft²	-5.26		

Cooling Airflows

Main Fan cfm	148
Cooling ACH	5.84
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	148
Heating ACH	5.84
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 54 of 152

ROOM_Resident Room 14

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	288	611	0	899	28.5
Door	0	0	0	0	0.0
Wall	0	539	0	539	17.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-144	0	-144	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	0.3
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-34	20	0.6
Envelope Subtotal	343	1,014	-34	1,323	-
People	151	219	359	728	23.1
Lights	144	254	0	398	12.6
Miscellaneous Loads	356	405	0	761	24.1
Internal Subtotal	651	878	359	1,888	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-199	0	-199	-6.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.6
Grand Total	994	1,674	324	2,992	100.0
RA Sensible (Lights)	166	0	0	166	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	1.30
%OA	9	People per 1000 ft²	10
cfm/ft²	1.19	Volume (ft³)	1,565
cfm/ton	624		
ft²/ton	523		
Btu/h-ft²	22.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-178	0	0	-178	20.3
Door	0	0	0	0	0.0
Wall	0	-485	0	-485	55.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	17.0
Envelope Subtotal	-319	-413	0	-739	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-131	0	-131	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.5
Grand Total	-319	-548	0	-875	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	1.30
%OA	9	People per 1000 ft²	10
cfm/ft²	1.19	Volume (ft³)	1,565
cfm/Mbh	-178		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	156
Cooling ACH	5.98
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	156
Heating ACH	5.98
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 55 of 152

ROOM_Resident Room 15

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	539	0	812	28.9
Door	0	0	0	0	0.0
Wall	0	341	0	341	12.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	-3.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-37	0	-37	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-35	6	0.2
Envelope Subtotal	314	758	-35	1,037	-
People	151	155	358	664	23.6
Lights	144	217	0	361	12.8
Miscellaneous Loads	356	345	0	701	25.0
Internal Subtotal	651	716	358	1,725	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-102	0	-102	-3.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	964	1,355	324	2,643	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.01	Volume (ft³)	1,564
cfm/ton	595		
ft²/ton	592		
Btu/h-ft²	20.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.2
Other Roof	0	0	0	0	0.0
Glass	-172	0	0	-172	19.6
Door	0	0	0	0	0.0
Wall	0	-487	0	-487	55.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	41	0	41	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	16.9
Envelope Subtotal	-313	-415	0	-736	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-140	0	-140	15.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-313	-559	0	-880	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.01	Volume (ft³)	1,564
cfm/Mbh	-149		
ft²/Mbh	-148		
Btu/h-ft²	-6.76		

Cooling Airflows

Main Fan cfm	131
Cooling ACH	5.03
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	131
Heating ACH	5.03
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	1
Other Roof	1
Ceiling	141
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 56 of 152

ROOM_Resident Room 16

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	274	547	0	821	30.7
Door	0	0	0	0	0.0
Wall	0	286	0	286	10.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-144	0	-144	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-44	0	-44	-1.7
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-34	6	0.2
Envelope Subtotal	313	644	-34	924	-
People	146	153	348	648	24.2
Lights	140	214	0	354	13.2
Miscellaneous Loads	346	341	0	687	25.7
Internal Subtotal	632	708	348	1,688	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-83	0	-83	-3.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.7
Grand Total	945	1,251	315	2,511	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.27
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	1,520
cfm/ton	590		
ft²/ton	606		
Btu/h-ft²	19.80		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.2
Other Roof	0	0	0	0	0.0
Glass	-174	0	0	-174	26.3
Door	0	0	0	0	0.0
Wall	0	-203	0	-203	30.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-11	0	-11	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	21.8
Envelope Subtotal	-311	-187	0	-505	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-151	0	-151	22.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.7
Grand Total	-311	-343	0	-661	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.66	No People(max)	1.27
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	1,520
cfm/Mbh	-187		
ft²/Mbh	-192		
Btu/h-ft²	-5.21		

Cooling Airflows

Main Fan cfm	123
Cooling ACH	4.86
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	123
Heating ACH	4.86
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	1
Other Roof	1
Ceiling	137
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 57 of 152

ROOM_Sally Port

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-61	0	-61	-3.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,040	0	1,040	60.6
Wall	0	185	0	185	10.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-272	0	-272	-15.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	882	0	882	-
People	82	116	156	354	20.6
Lights	86	138	0	224	13.1
Miscellaneous Loads	119	82	0	202	11.7
Internal Subtotal	287	337	156	779	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	-2.5
Grand Total	287	1,175	156	1,618	100.0
RA Sensible (Lights)	99	0	0	99	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	0.78
%OA	28	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	933
cfm/ton	522		
ft²/ton	576		
Btu/h-ft²	20.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-90	0	-90	14.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-492	0	-492	81.5
Wall	0	-127	0	-127	21.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	98	0	98	-16.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-592	0	-592	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	2.0
Grand Total	0	-604	0	-604	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.60	No People(max)	0.78
%OA	28	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	933
cfm/Mbh	-117		
ft²/Mbh	-129		
Btu/h-ft²	-7.75		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	4.50
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	20
Calculated Ventilation ACH	1.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	4.50
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	20
Calculated Ventilation ACH	1.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	87
Other Roof	87
Ceiling	0
Window	0
Door	26
Wall	99
Below-Grade Wall	0
Other Wall	99
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	87
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 58 of 152

ROOM_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 53.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	190	0	190	5.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	187	0	187	5.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	-1.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	113	0	-61	52	1.5
Envelope Subtotal	113	303	-61	356	-
People	456	659	913	2,029	59.1
Lights	158	243	0	401	11.7
Miscellaneous Loads	234	154	0	388	11.3
Internal Subtotal	848	1,057	913	2,817	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	88	0	88	2.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.2
Grand Total	961	1,439	852	3,252	100.0
RA Sensible (Lights)	181	0	0	181	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-128	0	-128	12.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-275	0	-275	26.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	25.3
Envelope Subtotal	-247	-370	0	-629	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-394	0	-394	38.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-247	-766	0	-1,026	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	107
Cooling ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.27	No People(max)	4.56
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,738
cfm/ton	396		
ft²/ton	842		
Btu/h-ft²	14.25		

Engineering Checks For Heating

Heating Mbh	-1.03	No People(max)	4.56
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,738
cfm/Mbh	-105		
ft²/Mbh	-222		
Btu/h-ft²	-4.50		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 59 of 152

ROOM_Service

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	171	0	171	3.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,254	0	1,254	28.3
Wall	0	864	0	864	19.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	878	0	878	19.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	165	0	-91	75	1.7
Envelope Subtotal	165	3,154	-91	3,228	-
People	159	219	304	682	15.4
Lights	140	216	0	356	8.0
Miscellaneous Loads	39	0	0	39	0.9
Internal Subtotal	338	435	304	1,077	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-0.7
Grand Total	503	3,558	213	4,274	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	1.18	Volume (ft³)	3,642
cfm/ton	1,008		
ft²/ton	852		
Btu/h-ft²	14.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-332	0	-332	14.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-952	0	-952	40.7
Wall	0	-581	0	-581	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-202	0	-202	8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	85	0	85	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-329	0	0	-346	14.8
Envelope Subtotal	-329	-1,982	0	-2,327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.6
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	1.0
Grand Total	-316	-2,004	0	-2,337	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.34	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	1.18	Volume (ft³)	3,642
cfm/Mbh	-154		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	359
Cooling ACH	5.91
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	359
Heating ACH	5.91
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	323
Other Roof	323
Ceiling	0
Window	0
Door	49
Wall	389
Below-Grade Wall	0
Other Wall	389
Partition	580
Exterior Floor	0
Internal Floor	0
Slab	323
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 60 of 152

ROOM_Shower 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 52.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	77	0	77	7.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	44	0	44	4.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	6.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-25	15	1.4
Envelope Subtotal	40	182	-25	197	-
People	157	248	248	653	63.9
Lights	37	60	0	97	9.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	194	308	248	750	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	35	0	35	3.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	234	524	223	981	100.0
RA Sensible (Lights)	42	0	0	42	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	961
cfm/ton	445		
ft²/ton	980		
Btu/h-ft²	12.24		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-65	0	-65	17.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-62	0	-62	16.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	22.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-87	0	0	-91	24.6
Envelope Subtotal	-87	-193	0	-284	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-85	0	-85	23.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-87	-279	0	-370	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.37	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	961
cfm/Mbh	-98		
ft²/Mbh	-216		
Btu/h-ft²	-4.63		

Cooling Airflows

Main Fan cfm	36
Cooling ACH	2.25
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	36
Heating ACH	2.25
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	62
Other Roof	62
Ceiling	27
Window	0
Door	0
Wall	37
Below-Grade Wall	0
Other Wall	37
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	89
Other Floor	0

ROOM_Shower 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	124	0	124	8.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	80	0	80	5.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	283	0	283	19.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-44	3	0.2
Envelope Subtotal	48	477	-44	481	-
People	194	303	307	804	55.3
Lights	46	74	0	119	8.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	239	377	307	923	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	287	851	262	1,401	100.0
RA Sensible (Lights)	52	0	0	52	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,187
cfm/ton	469		
ft²/ton	847		
Btu/h-ft²	14.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-118	0	-118	36.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-57	0	-57	17.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-58	0	-58	17.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-107	0	0	-112	34.5
Envelope Subtotal	-107	-213	0	-326	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-107	-214	0	-326	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.33	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,187
cfm/Mbh	-168		
ft²/Mbh	-303		
Btu/h-ft²	-3.30		

Cooling Airflows

Main Fan cfm	55
Cooling ACH	2.78
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	55
Heating ACH	2.78
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	110
Other Roof	110
Ceiling	0
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	488
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 62 of 152

ROOM_Shower 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	337	0	337	23.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-31	12	0.9
Envelope Subtotal	43	359	-31	371	-
People	204	351	322	877	61.8
Lights	48	86	0	133	9.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	252	436	322	1,010	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-14	0	-14	-1.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	295	778	291	1,363	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,247
cfm/ton	454		
ft²/ton	914		
Btu/h-ft²	13.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-184	0	-184	42.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-29	0	-29	6.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-113	0	0	-118	27.1
Envelope Subtotal	-113	-192	0	-310	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-125	0	-125	28.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-113	-318	0	-436	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,247
cfm/Mbh	-118		
ft²/Mbh	-238		
Btu/h-ft²	-4.20		

Cooling Airflows

Main Fan cfm	52
Cooling ACH	2.50
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	52
Heating ACH	2.50
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	115
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	115
Other Floor	0

ROOM_Shower 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 18:00:00
 Outside DB / WB / HR 90.9 °F / 62.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	333	0	333	23.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	56	0	56	4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	42	0	-44	-2	-0.2
Envelope Subtotal	42	372	-44	370	-
People	202	352	320	875	62.1
Lights	48	86	0	133	9.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	250	438	320	1,008	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-21	0	-21	-1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	292	785	276	1,353	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,239
cfm/ton	459		
ft²/ton	916		
Btu/h-ft²	13.10		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	40.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-46	0	-46	10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-117	26.2
Envelope Subtotal	-112	-207	0	-324	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-123	0	-123	27.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-112	-330	0	-448	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.45	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,239
cfm/Mbh	-116		
ft²/Mbh	-231		
Btu/h-ft²	-4.33		

Cooling Airflows

Main Fan cfm	52
Cooling ACH	2.52
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	52
Heating ACH	2.52
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 64 of 152

ROOM_Shower 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 52.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	117	0	117	8.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	143	0	143	10.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-32	11	0.8
Envelope Subtotal	43	244	-32	255	-
People	203	346	321	870	65.7
Lights	48	84	0	132	10.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	251	430	321	1,002	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	14	0	14	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	686	289	1,269	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,243
cfm/ton	446		
ft²/ton	979		
Btu/h-ft²	12.26		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	39.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	12.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	25.6
Envelope Subtotal	-112	-216	0	-334	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-125	0	-125	27.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-112	-341	0	-459	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.46	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,243
cfm/Mbh	-103		
ft²/Mbh	-226		
Btu/h-ft²	-4.42		

Cooling Airflows

Main Fan cfm	47
Cooling ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	47
Heating ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 65 of 152

ROOM_Shower 6

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 52.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	117	0	117	9.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	97	0	97	7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-33	10	0.8
Envelope Subtotal	43	198	-33	208	-
People	203	350	321	874	67.8
Lights	48	85	0	133	10.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	251	435	321	1,007	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	21	0	21	1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	652	288	1,233	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	1,242
cfm/ton	442		
ft²/ton	1,008		
Btu/h-ft²	11.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-180	0	-180	41.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-36	0	-36	8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	26.8
Envelope Subtotal	-112	-195	0	-312	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-126	0	-126	28.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-112	-321	0	-439	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	1,242
cfm/Mbh	-104		
ft²/Mbh	-236		
Btu/h-ft²	-4.24		

Cooling Airflows

Main Fan cfm	45
Cooling ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	45
Heating ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 7

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	271	0	271	20.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	42	0	42	3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-31	20	1.5
Envelope Subtotal	52	303	-31	323	-
People	202	318	319	839	61.9
Lights	47	77	0	125	9.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	249	395	319	964	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	18	0	18	1.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	301	713	288	1,301	100.0
RA Sensible (Lights)	54	0	0	54	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-183	0	-183	41.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-29	0	-29	6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-111	0	0	-117	26.5
Envelope Subtotal	-111	-192	0	-309	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-132	0	-132	30.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-111	-325	0	-442	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	49
Cooling ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	49
Heating ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	1
Other Roof	1
Ceiling	113
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	1,235
cfm/ton	449		
ft²/ton	949		
Btu/h-ft²	12.64		

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	1,235
cfm/Mbh	-110		
ft²/Mbh	-233		
Btu/h-ft²	-4.29		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 67 of 152

ROOM_Shower 8

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 52.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	250	0	250	19.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	11	0	11	0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	51	0	-31	19	1.5
Envelope Subtotal	51	252	-31	271	-
People	197	316	312	825	63.8
Lights	46	77	0	123	9.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	244	392	312	948	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	25	0	25	1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	665	281	1,241	100.0
RA Sensible (Lights)	53	0	0	53	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,208
cfm/ton	446		
ft²/ton	975		
Btu/h-ft²	12.31		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-177	0	-177	39.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	9.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	25.7
Envelope Subtotal	-109	-201	0	-315	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-129	0	-129	29.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-109	-330	0	-445	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,208
cfm/Mbh	-104		
ft²/Mbh	-227		
Btu/h-ft²	-4.41		

Cooling Airflows

Main Fan cfm	46
Cooling ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	46
Heating ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	1
Other Roof	1
Ceiling	110
Window	0
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	421
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 68 of 152

ROOM_Soiled Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	154	0	154	25.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	19	0	19	3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	29	0	-19	11	1.8
Envelope Subtotal	29	170	-19	181	-
People	51	68	97	216	36.0
Lights	45	68	0	112	18.7
Miscellaneous Loads	41	0	0	41	6.9
Internal Subtotal	137	136	97	369	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	166	305	78	549	100.0
RA Sensible (Lights)	51	0	0	51	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.48
%OA	26	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,161
cfm/ton	495		
ft²/ton	2,115		
Btu/h-ft²	5.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-116	0	-116	51.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-7.3
Other Floor	0	0	0	0	0.0
Infiltration	-105	0	0	-110	48.8
Envelope Subtotal	-105	-119	0	-229	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.8
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-101	-119	0	-225	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.22	No People(max)	0.48
%OA	26	People per 1000 ft²	5
cfm/ft²	0.23	Volume (ft³)	1,161
cfm/Mbh	-101		
ft²/Mbh	-430		
Btu/h-ft²	-2.33		

Cooling Airflows

Main Fan cfm	23
Cooling ACH	1.19
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	23
Heating ACH	1.19
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	508
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Staff Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 37.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	848	0	848	19.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	748	0	748	17.0
Wall	0	144	0	144	3.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1,356	0	1,356	30.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	262	0	-88	174	3.9
Envelope Subtotal	262	3,083	-88	3,257	-
People	0	0	0	0	0.0
Lights	329	474	0	803	18.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	329	474	0	803	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	-0.6
Grand Total	591	3,530	-88	4,033	100.0
RA Sensible (Lights)	378	0	0	378	-

Engineering Checks For Cooling

Cooling tons	0.34	No People(max)	0.00
%OA	27	People per 1000 ft²	0
cfm/ft²	0.22	Volume (ft³)	10,720
cfm/ton	591		
ft²/ton	2,658		
Btu/h-ft²	4.51		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.6 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,034	0	-1,034	43.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-564	0	-564	23.6
Wall	0	-89	0	-89	3.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-309	0	-309	12.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	174	0	174	-7.3
Other Floor	0	0	0	0	0.0
Infiltration	-521	0	0	-547	22.9
Envelope Subtotal	-521	-1,822	0	-2,368	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	0.7
Grand Total	-521	-1,839	0	-2,386	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.39	No People(max)	0.00
%OA	27	People per 1000 ft²	0
cfm/ft²	0.22	Volume (ft³)	10,720
cfm/Mbh	-83		
ft²/Mbh	-374		
Btu/h-ft²	-2.67		

Cooling Airflows

Main Fan cfm	199
Cooling ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	54
Calculated Ventilation ACH	0.30
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	199
Heating ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	54
Calculated Ventilation ACH	0.30
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

	ft²
Roof	968
Other Roof	968
Ceiling	0
Window	0
Door	28
Wall	77
Below-Grade Wall	0
Other Wall	77
Partition	3,525
Exterior Floor	0
Internal Floor	0
Slab	968
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 70 of 152

ROOM_Stor.

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	26	0	26	14.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	76	0	76	41.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	4	0	-2	2	1.3
Envelope Subtotal	4	101	-2	104	-
People	8	19	15	41	22.4
Lights	7	19	0	26	13.9
Miscellaneous Loads	6	0	0	6	3.4
Internal Subtotal	21	38	15	73	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	-0.1
Grand Total	25	139	12	177	100.0
RA Sensible (Lights)	8	0	0	8	-

Engineering Checks For Cooling

Cooling tons	0.01	No People(max)	0.07
%OA	11	People per 1000 ft²	5
cfm/ft²	0.54	Volume (ft³)	174
cfm/ton	537		
ft²/ton	987		
Btu/h-ft²	12.16		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-20	0	-20	25.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-46	0	-46	58.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	3	0	3	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-16	0	0	-17	20.9
Envelope Subtotal	-16	-63	0	-80	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	1	0	0	1	-0.8
Internal Subtotal	1	0	0	1	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.0
Grand Total	-15	-63	0	-79	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.08	No People(max)	0.07
%OA	11	People per 1000 ft²	5
cfm/ft²	0.54	Volume (ft³)	174
cfm/Mbh	-100		
ft²/Mbh	-184		
Btu/h-ft²	-5.43		

Cooling Airflows

Main Fan cfm	8
Cooling ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.34
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	8
Heating ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.34
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	19
Other Roof	19
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	212
Exterior Floor	0
Internal Floor	0
Slab	19
Other Floor	0

ROOM_Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	75	0	75	15.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	36	0	36	7.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	115	0	115	24.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	22	0	-8	14	2.8
Envelope Subtotal	22	224	-8	238	-
People	27	44	52	123	25.8
Lights	24	44	0	68	14.1
Miscellaneous Loads	16	0	0	16	3.3
Internal Subtotal	67	88	52	207	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	7	0	7	1.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	89	318	44	451	100.0
RA Sensible (Lights)	28	0	0	28	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.26
%OA	16	People per 1000 ft²	5
cfm/ft²	0.38	Volume (ft³)	624
cfm/ton	521		
ft²/ton	1,385		
Btu/h-ft²	8.66		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-56	0	-56	23.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-54	0	-54	22.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-58	0	-58	24.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-56	0	0	-59	24.9
Envelope Subtotal	-56	-158	0	-217	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-0.9
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-22	0	-22	9.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-54	-180	0	-237	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.24	No People(max)	0.26
%OA	16	People per 1000 ft²	5
cfm/ft²	0.38	Volume (ft³)	624
cfm/Mbh	-82		
ft²/Mbh	-219		
Btu/h-ft²	-4.57		

Cooling Airflows

Main Fan cfm	20
Cooling ACH	1.92
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	20
Heating ACH	1.92
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100

Areas ft²

Roof	53
Other Roof	53
Ceiling	7
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	369
Exterior Floor	0
Internal Floor	0
Slab	60
Other Floor	0

ROOM_Toilet 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-26	0	-26	-2.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	439	0	439	40.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-5	0	-5	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	21	0	-17	4	0.4
Envelope Subtotal	21	408	-17	412	-
People	131	206	207	545	50.1
Lights	31	50	0	81	7.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	162	257	207	626	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	18	0	18	1.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	183	679	190	1,052	100.0
RA Sensible (Lights)	35	0	0	35	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-54	0	-54	15.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-175	0	-175	48.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-72	0	0	-76	21.0
Envelope Subtotal	-72	-215	0	-291	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-71	0	-71	19.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-72	-286	0	-362	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	41
Cooling ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	41
Heating ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	53
Other Roof	53
Ceiling	23
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	427
Exterior Floor	0
Interior Floor	0
Slab	76
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	802
cfm/ton	473		
ft²/ton	763		
Btu/h-ft²	15.73		

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	802
cfm/Mbh	-114		
ft²/Mbh	-184		
Btu/h-ft²	-5.43		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 73 of 152

ROOM_Toilet 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 50.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	104	0	104	15.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-56	0	-56	-8.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	26	0	-17	9	1.4
Envelope Subtotal	26	40	-17	50	-
People	121	200	192	513	76.5
Lights	28	49	0	77	11.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	150	248	192	590	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	176	287	175	638	100.0
RA Sensible (Lights)	33	0	0	33	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.29	Volume (ft³)	742
cfm/ton	341		
ft²/ton	1,165		
Btu/h-ft²	10.30		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-76	0	-76	49.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	12.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-6.8
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	45.5
Envelope Subtotal	-67	-84	0	-154	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-84	0	-154	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.15	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.29	Volume (ft³)	742
cfm/Mbh	-118		
ft²/Mbh	-401		
Btu/h-ft²	-2.49		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	408
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Toilet 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 50.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	98	0	98	14.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-48	0	-48	-7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	26	0	-17	9	1.4
Envelope Subtotal	26	44	-17	53	-
People	121	202	191	514	76.1
Lights	28	49	0	78	11.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	149	251	191	591	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	175	292	175	642	100.0
RA Sensible (Lights)	33	0	0	33	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	740
cfm/ton	345		
ft²/ton	1,153		
Btu/h-ft²	10.41		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-75	0	-75	46.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-27	0	-27	16.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	43.5
Envelope Subtotal	-67	-91	0	-161	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-91	0	-161	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.16	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	740
cfm/Mbh	-115		
ft²/Mbh	-384		
Btu/h-ft²	-2.60		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	1.46
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	1.46
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	407
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-117	0	-117	-0.8
Other Roof	0	0	0	0	0.0
Glass	5,173	11,553	0	16,726	109.7
Door	0	37	0	37	0.2
Wall	0	304	0	304	2.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,411	0	-1,411	-9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	718	0	718	4.7
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-19	46	0.3
Envelope Subtotal	5,239	11,084	-19	16,304	-
People	182	229	287	698	4.6
Lights	205	261	0	466	3.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	386	490	287	1,164	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-2,171	0	-2,171	-14.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-292	0	-292	-1.9
Grand Total	5,625	9,112	268	15,005	100.0
RA Sensible (Lights)	235	0	0	235	-

Engineering Checks For Cooling

Cooling tons	1.25	No People(max)	1.85
%OA	4	People per 1000 ft²	5
cfm/ft²	1.92	Volume (ft³)	4,445
cfm/ton	567		
ft²/ton	296		
Btu/h-ft²	40.54		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-53	0	-53	1.0
Other Roof	0	0	0	0	0.0
Glass	-3,602	0	0	-3,602	68.0
Door	0	-472	0	-472	8.9
Wall	0	-536	0	-536	10.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	550	0	550	-10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	147	0	147	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	8.0
Envelope Subtotal	-4,003	-363	0	-4,387	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-830	0	-830	15.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-82	0	-82	1.5
Grand Total	-4,003	-1,275	0	-5,299	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-5.30	No People(max)	1.85
%OA	4	People per 1000 ft²	5
cfm/ft²	1.92	Volume (ft³)	4,445
cfm/Mbh	-134		
ft²/Mbh	-70		
Btu/h-ft²	-14.29		

Cooling Airflows

Main Fan cfm	710
Cooling ACH	9.58
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	710
Heating ACH	9.58
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 76 of 152

Room Cooling and Heating Loads by Component

ROOM_Attrium 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	2,194	0	2,194	25.4
Other Roof	0	0	0	0	0.0
Glass	1,279	637	0	1,916	22.2
Door	0	0	0	0	0.0
Wall	0	2,146	0	2,146	24.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-800	0	-800	-9.3
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	284	0	-109	175	2.0
Envelope Subtotal	1,563	4,177	-109	5,631	-
People	316	399	500	1,215	14.1
Lights	535	695	0	1,230	14.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	851	1,094	500	2,445	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-59	0	-59	-0.7
Grand Total	2,414	5,212	391	8,017	100.0
RA Sensible (Lights)	614	0	0	614	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,337	0	-1,337	28.3
Other Roof	0	0	0	0	0.0
Glass	-1,303	0	0	-1,303	27.5
Door	0	0	0	0	0.0
Wall	0	-1,979	0	-1,979	41.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	469	0	469	-9.9
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	-524	0	0	-550	11.6
Envelope Subtotal	-1,826	-2,846	0	-4,698	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	0.7
Grand Total	-1,826	-2,878	0	-4,731	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	367
Cooling ACH	3.80
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	367
Heating ACH	3.80
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

	ft²
Roof	704
Other Roof	704
Ceiling	0
Window	57
Door	0
Wall	715
Below-Grade Wall	0
Other Wall	715
Partition	0
Exterior Floor	0
Internal Floor	671
Slab	0
Other Floor	671

Engineering Checks For Cooling

Cooling tons	0.67	No People(max)	3.23
%OA	0	People per 1000 ft²	5
cfm/ft²	0.57	Volume (ft³)	5,793
cfm/ton	550		
ft²/ton	966		
Btu/h-ft²	12.42		

Engineering Checks For Heating

Heating Mbh	-4.73	No People(max)	3.23
%OA	0	People per 1000 ft²	5
cfm/ft²	0.57	Volume (ft³)	5,793
cfm/Mbh	-78		
ft²/Mbh	-136		
Btu/h-ft²	-7.35		

ROOM_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	13	0	13	0.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-18	0	-18	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-26	34	1.6
Envelope Subtotal	60	19	-26	53	-
People	210	290	399	899	41.3
Lights	204	318	0	523	24.0
Miscellaneous Loads	341	0	0	341	15.6
Internal Subtotal	754	609	399	1,762	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	130	0	130	6.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	815	754	373	1,941	100.0
RA Sensible (Lights)	234	0	0	234	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	2.00
%OA	1	People per 1000 ft²	10
cfm/ft²	0.38	Volume (ft³)	2,395
cfm/ton	467		
ft²/ton	1,234		
Btu/h-ft²	9.72		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-39	0	-39	7.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-112	0	-112	22.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	36	0	36	-7.1
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-225	44.9
Envelope Subtotal	-216	-115	0	-341	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-6.8
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-194	0	-194	38.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-182	-310	0	-501	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.50	No People(max)	2.00
%OA	1	People per 1000 ft²	10
cfm/ft²	0.38	Volume (ft³)	2,395
cfm/Mbh	-151		
ft²/Mbh	-398		
Btu/h-ft²	-2.51		

Cooling Airflows

Main Fan cfm	76
Cooling ACH	1.90
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	76
Heating ACH	1.90
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Interior Floor	0
Slab	214
Other Floor	0

ROOM_Clean Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	436	0	436	46.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1	0	1	0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	61	0	-7	54	5.7
Envelope Subtotal	61	434	-7	488	-
People	54	74	102	230	24.3
Lights	59	93	0	152	16.0
Miscellaneous Loads	13	0	0	13	1.4
Internal Subtotal	126	167	102	395	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.4
Grand Total	187	598	95	880	100.0
RA Sensible (Lights)	68	0	0	68	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.51
%OA	0	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,224
cfm/ton	516		
ft²/ton	1,392		
Btu/h-ft²	8.62		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-227	0	-227	66.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	6.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-5.6
Other Floor	0	0	0	0	0.0
Infiltration	-110	0	0	-115	33.7
Envelope Subtotal	-110	-231	0	-347	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-106	-232	0	-343	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.34	No People(max)	0.51
%OA	0	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,224
cfm/Mbh	-110		
ft²/Mbh	-298		
Btu/h-ft²	-3.36		

Cooling Airflows

Main Fan cfm	38
Cooling ACH	1.86
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	38
Heating ACH	1.86
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	113
Other Roof	113
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	519
Exterior Floor	0
Internal Floor	0
Slab	113
Other Floor	0

ROOM_Comfort Room 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 14:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	375	0	375	25.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	75	0	75	5.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-5	0	-5	-0.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	439	0	439	-
People	88	121	168	376	25.1
Lights	0	104	0	104	6.9
Miscellaneous Loads	129	85	0	214	14.3
Internal Subtotal	217	310	168	694	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	217	745	168	1,129	100.0
RA Sensible (Lights)	370	0	0	370	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.84
%OA	1	People per 1000 ft²	10
cfm/ft²	0.55	Volume (ft³)	1,005
cfm/ton	492		
ft²/ton	890		
Btu/h-ft²	13.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-186	0	-186	58.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-84	0	-84	26.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-68	0	-68	21.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-320	0	-320	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	0	-321	0	-321	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.32	No People(max)	0.84
%OA	1	People per 1000 ft²	10
cfm/ft²	0.55	Volume (ft³)	1,005
cfm/Mbh	-144		
ft²/Mbh	-261		
Btu/h-ft²	-3.83		

Cooling Airflows

Main Fan cfm	46
Cooling ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	13
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.06
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	46
Heating ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	13
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.06
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	93
Other Roof	93
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	438
Exterior Floor	0
Internal Floor	0
Slab	93
Other Floor	0

ROOM_Comfort Room 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 14:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	310	0	310	19.5
Other Roof	0	0	0	0	0.0
Glass	123	34	0	158	9.9
Door	0	0	0	0	0.0
Wall	0	198	0	198	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-113	0	-113	-7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	123	419	0	543	-
People	86	123	164	373	23.5
Lights	0	106	0	106	6.7
Miscellaneous Loads	126	87	0	213	13.4
Internal Subtotal	212	316	164	692	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-1	0	-1	-0.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.5
Grand Total	335	726	164	1,226	100.0
RA Sensible (Lights)	362	0	0	362	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	0.82
%OA	2	People per 1000 ft²	10
cfm/ft²	0.62	Volume (ft³)	985
cfm/ton	501		
ft²/ton	803		
Btu/h-ft²	14.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-148	0	-148	25.9
Other Roof	0	0	0	0	0.0
Glass	-164	0	0	-164	28.6
Door	0	0	0	0	0.0
Wall	0	-286	0	-286	49.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	53	0	53	-9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-164	-360	0	-524	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-43	0	-43	7.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	1.0
Grand Total	-164	-410	0	-573	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.57	No People(max)	0.82
%OA	2	People per 1000 ft²	10
cfm/ft²	0.62	Volume (ft³)	985
cfm/Mbh	-89		
ft²/Mbh	-143		
Btu/h-ft²	-6.99		

Cooling Airflows

Main Fan cfm	51
Cooling ACH	3.11
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.06
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	51
Heating ACH	3.11
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.06
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	80
Other Roof	80
Ceiling	11
Window	8
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	91
Other Floor	0

ROOM_Consult 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	387	0	387	20.2
Other Roof	0	0	0	0	0.0
Glass	119	32	0	150	7.8
Door	0	0	0	0	0.0
Wall	0	240	0	240	12.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	119	544	0	662	-
People	105	141	200	446	23.3
Lights	0	121	0	121	6.3
Miscellaneous Loads	153	100	0	253	13.2
Internal Subtotal	258	362	200	820	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	1	0	1	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.5
Grand Total	377	897	200	1,474	100.0
RA Sensible (Lights)	442	0	0	442	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	1.00
%OA	2	People per 1000 ft²	10
cfm/ft²	0.61	Volume (ft³)	1,199
cfm/ton	500		
ft²/ton	813		
Btu/h-ft²	14.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-186	0	-186	28.7
Other Roof	0	0	0	0	0.0
Glass	-165	0	0	-165	25.5
Door	0	0	0	0	0.0
Wall	0	-323	0	-323	49.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	56	0	56	-8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-165	-427	0	-593	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-48	0	-48	7.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	1.0
Grand Total	-165	-482	0	-647	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.00
%OA	2	People per 1000 ft²	10
cfm/ft²	0.61	Volume (ft³)	1,199
cfm/Mbh	-95		
ft²/Mbh	-154		
Btu/h-ft²	-6.49		

Cooling Airflows

Main Fan cfm	61
Cooling ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.10
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	61
Heating ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.10
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	98
Other Roof	98
Ceiling	12
Window	8
Door	0
Wall	115
Below-Grade Wall	0
Other Wall	115
Partition	390
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

ROOM_Consult 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	393	0	393	20.0
Other Roof	0	0	0	0	0.0
Glass	118	33	0	151	7.7
Door	0	0	0	0	0.0
Wall	0	244	0	244	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	118	578	0	696	-
People	107	144	203	454	23.0
Lights	0	124	0	124	6.3
Miscellaneous Loads	156	102	0	258	13.1
Internal Subtotal	262	370	203	836	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.5
Grand Total	381	939	203	1,523	100.0
RA Sensible (Lights)	448	0	0	448	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	1.02
%OA	2	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,218
cfm/ton	501		
ft²/ton	800		
Btu/h-ft²	15.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-187	0	-187	27.9
Other Roof	0	0	0	0	0.0
Glass	-165	0	0	-165	24.6
Door	0	0	0	0	0.0
Wall	0	-328	0	-328	48.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	38	0	38	-5.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-165	-451	0	-616	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-49	0	-49	7.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.9
Grand Total	-165	-506	0	-671	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	1.02
%OA	2	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,218
cfm/Mbh	-95		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	64
Cooling ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.10
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	64
Heating ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.10
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	99
Other Roof	99
Ceiling	12
Window	8
Door	0
Wall	117
Below-Grade Wall	0
Other Wall	117
Partition	392
Exterior Floor	0
Internal Floor	0
Slab	112
Other Floor	0

ROOM_Corridor 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,228	0	1,228	48.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	314	0	314	12.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	95	0	-1	94	3.8
Envelope Subtotal	95	1,540	-1	1,634	-
People	0	0	0	0	0.0
Lights	0	186	0	186	7.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	186	0	186	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.3
Grand Total	95	1,718	-1	1,813	100.0
RA Sensible (Lights)	700	0	0	700	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	3,546
cfm/ton	578		
ft²/ton	1,956		
Btu/h-ft²	6.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-632	0	-632	63.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-248	0	-248	24.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-6.1
Other Floor	0	0	0	0	0.0
Infiltration	-172	0	0	-181	18.0
Envelope Subtotal	-172	-819	0	-1,000	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-172	-821	0	-1,002	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.00	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	3,546
cfm/Mbh	-87		
ft²/Mbh	-295		
Btu/h-ft²	-3.39		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	1.47
Sec Fan cfm	0
Input Ventilation cfm	17
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	1.47
Sec Fan cfm	0
Input Ventilation cfm	17
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	318
Other Roof	318
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	318
Other Floor	0

ROOM_Corridor 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,835	0	1,835	40.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	647	0	647	14.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	205	0	-2	203	4.5
Envelope Subtotal	205	2,476	-2	2,679	-
People	0	0	0	0	0.0
Lights	0	404	0	404	8.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	404	0	404	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-36	0	-36	-0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	-0.2
Grand Total	205	2,834	-2	3,037	100.0
RA Sensible (Lights)	1,504	0	0	1,504	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.23	Volume (ft³)	7,619
cfm/ton	578		
ft²/ton	2,509		
Btu/h-ft²	4.78		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,017	0	-1,017	53.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-445	0	-445	23.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	125	0	125	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-370	0	0	-388	20.5
Envelope Subtotal	-370	-1,338	0	-1,725	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-160	0	-160	8.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.1
Grand Total	-370	-1,501	0	-1,889	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.89	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.23	Volume (ft³)	7,619
cfm/Mbh	-78		
ft²/Mbh	-336		
Btu/h-ft²	-2.98		

Cooling Airflows

Main Fan cfm	146
Cooling ACH	1.15
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	9
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	146
Heating ACH	1.15
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	9
Min Stop/RH (%)	100

Areas

ft²	
Roof	516
Other Roof	516
Ceiling	170
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	2,442
Exterior Floor	0
Internal Floor	0
Slab	686
Other Floor	0

ROOM_Corridor 2.1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	190	0	190	31.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	19	0	0	19	3.1
Envelope Subtotal	19	186	0	205	-
People	0	0	0	0	0.0
Lights	0	78	0	78	12.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	78	0	78	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	119	0	119	19.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	-0.1
Grand Total	19	383	0	402	100.0
RA Sensible (Lights)	203	0	0	203	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.23	Volume (ft³)	1,026
cfm/ton	578		
ft²/ton	2,551		
Btu/h-ft²	4.70		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-103	0	-103	31.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-50	0	0	-52	16.0
Envelope Subtotal	-50	-86	0	-138	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-188	0	-188	57.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-50	-274	0	-326	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.33	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.23	Volume (ft³)	1,026
cfm/Mbh	-59		
ft²/Mbh	-262		
Btu/h-ft²	-3.82		

Cooling Airflows

Main Fan cfm	19
Cooling ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	19
Heating ACH	1.11
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	96
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	513
Exterior Floor	0
Internal Floor	0
Slab	96
Other Floor	0

ROOM_Corridor 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	899	376	0	1,274	37.4
Door	0	0	0	0	0.0
Wall	0	80	0	80	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	376	0	376	11.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	14	0	14	0.4
Other Floor	0	0	0	0	0.0
Infiltration	92	0	-2	90	2.7
Envelope Subtotal	991	846	-2	1,835	-
People	0	0	0	0	0.0
Lights	0	309	0	309	9.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	309	0	309	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	318	0	318	9.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.6
Grand Total	991	1,453	-2	2,442	100.0
RA Sensible (Lights)	969	0	0	969	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.29	Volume (ft³)	4,909
cfm/ton	578		
ft²/ton	2,010		
Btu/h-ft²	5.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,328	0	0	-1,328	54.6
Door	0	0	0	0	0.0
Wall	0	-112	0	-112	4.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-27	0	-27	1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	104	0	104	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	10.3
Envelope Subtotal	-1,567	-35	0	-1,613	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-774	0	-774	31.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-46	0	-46	1.9
Grand Total	-1,567	-855	0	-2,433	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.43	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.29	Volume (ft³)	4,909
cfm/Mbh	-48		
ft²/Mbh	-168		
Btu/h-ft²	-5.95		

Cooling Airflows

Main Fan cfm	118
Cooling ACH	1.44
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	118
Heating ACH	1.44
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

ROOM_Corridor 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,644	1,705	0	4,349	85.2
Door	0	0	0	0	0.0
Wall	0	216	0	216	4.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-378	0	-378	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	404	0	404	7.9
Other Floor	0	0	0	0	0.0
Infiltration	86	0	-1	85	1.7
Envelope Subtotal	2,730	1,947	-1	4,676	-
People	0	0	0	0	0.0
Lights	0	251	0	251	4.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	251	0	251	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-450	0	-450	-8.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-143	0	-143	-2.8
Grand Total	2,730	1,606	-1	4,335	100.0
RA Sensible (Lights)	767	0	0	767	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.64	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	897		
Btu/h-ft²	13.38		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,304	0	0	-1,304	60.4
Door	0	0	0	0	0.0
Wall	0	-109	0	-109	5.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	19	0	19	-0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	86	0	86	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-198	9.2
Envelope Subtotal	-1,492	-4	0	-1,506	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-607	0	-607	28.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	2.0
Grand Total	-1,492	-655	0	-2,157	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.16	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.64	Volume (ft³)	3,888
cfm/Mbh	-97		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	209
Cooling ACH	3.23
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	209
Heating ACH	3.23
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

ROOM_Corridor 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,271	1,799	0	4,070	89.7
Door	0	0	0	0	0.0
Wall	0	210	0	210	4.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-224	0	-224	-4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	67	0	67	1.5
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-94	-18	-0.4
Envelope Subtotal	2,347	1,852	-94	4,105	-
People	0	0	0	0	0.0
Lights	0	290	0	290	6.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	290	0	290	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-726	0	-726	-16.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-112	0	-112	-2.5
Grand Total	2,347	1,305	-94	3,558	100.0
RA Sensible (Lights)	981	0	0	981	-

Engineering Checks For Cooling

Cooling tons	0.30	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.42	Volume (ft³)	4,967
cfm/ton	593		
ft²/ton	1,396		
Btu/h-ft²	8.60		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,283	0	0	-1,283	54.0
Door	0	0	0	0	0.0
Wall	0	-116	0	-116	4.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-14	0	-14	0.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	104	0	104	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-253	10.7
Envelope Subtotal	-1,524	-26	0	-1,562	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-772	0	-772	32.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	1.8
Grand Total	-1,524	-841	0	-2,377	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.38	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.42	Volume (ft³)	4,967
cfm/Mbh	-74		
ft²/Mbh	-174		
Btu/h-ft²	-5.75		

Cooling Airflows

Main Fan cfm	176
Cooling ACH	2.13
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	176
Heating ACH	2.13
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

ROOM_Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	677	0	677	18.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	924	0	924	25.8
Wall	0	1,470	0	1,470	41.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-229	0	-229	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	2,840	0	2,840	-
People	0	0	0	0	0.0
Lights	167	239	0	406	11.3
Miscellaneous Loads	195	0	0	195	5.4
Internal Subtotal	362	239	0	601	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	-1.2
Grand Total	362	3,036	0	3,398	100.0
RA Sensible (Lights)	192	0	0	192	-

Engineering Checks For Cooling

Cooling tons	0.28	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.86	Volume (ft³)	2,287
cfm/ton	578		
ft²/ton	673		
Btu/h-ft²	17.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-393	0	-393	22.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-528	0	-528	30.5
Wall	0	-1,046	0	-1,046	60.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	132	0	132	-7.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	59	0	59	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-1,775	0	-1,775	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	65	0	0	65	-3.8
Internal Subtotal	65	0	0	65	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.0
Grand Total	65	-1,792	0	-1,727	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.73	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.86	Volume (ft³)	2,287
cfm/Mbh	-95		
ft²/Mbh	-110		
Btu/h-ft²	-9.09		

Cooling Airflows

Main Fan cfm	164
Cooling ACH	4.30
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	164
Heating ACH	4.30
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	205
Other Roof	205
Ceiling	0
Window	0
Door	21
Wall	358
Below-Grade Wall	0
Other Wall	358
Partition	358
Exterior Floor	0
Internal Floor	0
Slab	205
Other Floor	0

ROOM_Emergency Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	368	0	368	15.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	885	0	885	37.0
Wall	0	517	0	517	21.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-314	0	-314	-13.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,440	0	1,440	-
People	0	0	0	0	0.0
Lights	157	228	0	385	16.1
Miscellaneous Loads	427	0	0	427	17.9
Internal Subtotal	584	228	0	812	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-1.7
Grand Total	584	1,629	0	2,213	100.0
RA Sensible (Lights)	180	0	0	180	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.60	Volume (ft³)	2,146
cfm/ton	578		
ft²/ton	970		
Btu/h-ft²	12.37		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-378	0	-378	34.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-535	0	-535	48.2
Wall	0	-316	0	-316	28.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	28	0	28	-2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	47	0	47	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-1,154	0	-1,154	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	61	0	0	61	-5.5
Internal Subtotal	61	0	0	61	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.6
Grand Total	61	-1,172	0	-1,111	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.11	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.60	Volume (ft³)	2,146
cfm/Mbh	-96		
ft²/Mbh	-161		
Btu/h-ft²	-6.21		

Cooling Airflows

Main Fan cfm	107
Cooling ACH	2.99
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	2.99
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	193
Other Roof	193
Ceiling	0
Window	0
Door	21
Wall	121
Below-Grade Wall	0
Other Wall	121
Partition	581
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ROOM_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-9	0	-9	-0.1
Other Roof	0	0	0	0	0.0
Glass	6,071	5,420	0	11,491	99.4
Door	0	144	0	144	1.2
Wall	0	821	0	821	7.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,123	0	-1,123	-9.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	447	0	447	3.9
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-8	57	0.5
Envelope Subtotal	6,136	5,700	-8	11,828	-
People	182	225	287	694	6.0
Lights	307	390	0	697	6.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	489	615	287	1,391	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-1,734	0	-1,734	-15.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-271	0	-271	-2.3
Grand Total	6,625	4,309	279	11,213	100.0
RA Sensible (Lights)	353	0	0	353	-

Engineering Checks For Cooling

Cooling tons	0.93	No People(max)	1.85
%OA	0	People per 1000 ft²	5
cfm/ft²	1.42	Volume (ft³)	4,445
cfm/ton	564		
ft²/ton	397		
Btu/h-ft²	30.23		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-95	0	-95	1.4
Other Roof	0	0	0	0	0.0
Glass	-4,516	0	0	-4,516	64.6
Door	0	-611	0	-611	8.7
Wall	0	-935	0	-935	13.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	652	0	652	-9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	171	0	171	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	6.0
Envelope Subtotal	-4,917	-817	0	-5,755	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-1,107	0	-1,107	15.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-125	0	-125	1.8
Grand Total	-4,917	-2,049	0	-6,987	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-6.99	No People(max)	1.85
%OA	0	People per 1000 ft²	5
cfm/ft²	1.42	Volume (ft³)	4,445
cfm/Mbh	-75		
ft²/Mbh	-53		
Btu/h-ft²	-18.87		

Cooling Airflows

Main Fan cfm	527
Cooling ACH	7.11
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	527
Heating ACH	7.11
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

ROOM_Exam Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	530	0	530	27.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	412	0	412	-
People	129	176	246	551	28.0
Lights	0	151	0	151	7.7
Miscellaneous Loads	189	124	0	313	15.9
Internal Subtotal	318	451	246	1,015	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	318	857	246	1,421	100.0
RA Sensible (Lights)	544	0	0	544	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	1.23
%OA	2	People per 1000 ft²	10
cfm/ft²	0.46	Volume (ft³)	1,476
cfm/ton	478		
ft²/ton	1,039		
Btu/h-ft²	11.55		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-270	0	-270	100.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-8.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-268	0	-268	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	0	-268	0	-268	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.27	No People(max)	1.23
%OA	2	People per 1000 ft²	10
cfm/ft²	0.46	Volume (ft³)	1,476
cfm/Mbh	-211		
ft²/Mbh	-459		
Btu/h-ft²	-2.18		

Cooling Airflows

Main Fan cfm	57
Cooling ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	57
Heating ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²

Roof	134
Other Roof	134
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	559
Exterior Floor	0
Internal Floor	0
Slab	134
Other Floor	0

ROOM_Fire Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	160	0	160	9.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	875	0	875	54.2
Wall	0	458	0	458	28.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-283	0	-283	-17.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,203	0	1,203	-
People	0	0	0	0	0.0
Lights	69	108	0	177	11.0
Miscellaneous Loads	189	0	0	189	11.7
Internal Subtotal	259	108	0	367	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-36	0	-36	-2.2
Grand Total	259	1,275	0	1,534	100.0
RA Sensible (Lights)	80	0	0	80	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.93	Volume (ft³)	951
cfm/ton	578		
ft²/ton	620		
Btu/h-ft²	19.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 105.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-171	0	-171	20.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-527	0	-527	63.9
Wall	0	-297	0	-297	36.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	137	0	137	-16.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-835	0	-835	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	27	0	0	27	-3.3
Internal Subtotal	27	0	0	27	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	2.0
Grand Total	27	-851	0	-824	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.82	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.93	Volume (ft³)	951
cfm/Mbh	-90		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	74
Cooling ACH	4.67
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	74
Heating ACH	4.67
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	88
Other Roof	88
Ceiling	0
Window	0
Door	21
Wall	118
Below-Grade Wall	0
Other Wall	118
Partition	334
Exterior Floor	0
Internal Floor	0
Slab	88
Other Floor	0

ROOM_General Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	407	0	407	30.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	430	0	430	32.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	57	0	-4	53	4.0
Envelope Subtotal	57	833	-4	886	-
People	50	74	96	220	16.6
Lights	55	92	0	148	11.2
Miscellaneous Loads	12	0	0	12	0.9
Internal Subtotal	118	167	96	380	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	175	995	91	1,262	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	0.48
%OA	0	People per 1000 ft²	5
cfm/ft²	0.59	Volume (ft³)	1,147
cfm/ton	536		
ft²/ton	909		
Btu/h-ft²	13.20		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-214	0	-214	56.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-80	0	-80	21.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	-104	0	0	-108	28.5
Envelope Subtotal	-104	-275	0	-384	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.1
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-99	-276	0	-380	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.38	No People(max)	0.48
%OA	0	People per 1000 ft²	5
cfm/ft²	0.59	Volume (ft³)	1,147
cfm/Mbh	-148		
ft²/Mbh	-251		
Btu/h-ft²	-3.98		

Cooling Airflows

Main Fan cfm	56
Cooling ACH	2.93
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	56
Heating ACH	2.93
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	535
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	589	0	589	11.6
Other Roof	0	0	0	0	0.0
Glass	226	67	0	293	5.8
Door	0	0	0	0	0.0
Wall	0	607	0	607	11.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-186	0	-186	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	166	0	-41	124	2.4
Envelope Subtotal	392	1,046	-41	1,396	-
People	553	761	1,106	2,419	47.6
Lights	227	338	0	564	11.1
Miscellaneous Loads	283	181	0	464	9.1
Internal Subtotal	1,062	1,279	1,106	3,447	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	9	0	9	0.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.5
Grand Total	1,454	2,308	1,064	4,827	100.0
RA Sensible (Lights)	260	0	0	260	-

Engineering Checks For Cooling

Cooling tons	0.40	No People(max)	5.52
%OA	5	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	3,317
cfm/ton	451		
ft²/ton	687		
Btu/h-ft²	17.47		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-272	0	-272	12.8
Other Roof	0	0	0	0	0.0
Glass	-337	0	0	-337	15.8
Door	0	0	0	0	0.0
Wall	0	-832	0	-832	39.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	129	0	129	-6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	80	0	80	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	14.7
Envelope Subtotal	-637	-894	0	-1,546	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-573	0	-573	26.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.7
Grand Total	-637	-1,481	0	-2,132	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.13	No People(max)	5.52
%OA	5	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	3,317
cfm/Mbh	-85		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	181
Cooling ACH	3.27
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.16
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	181
Heating ACH	3.27
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.16
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

ROOM_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	525	0	525	11.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	571	0	571	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	81	0	81	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	148	0	-36	111	2.4
Envelope Subtotal	148	1,153	-36	1,264	-
People	492	682	984	2,158	47.0
Lights	202	303	0	505	11.0
Miscellaneous Loads	252	162	0	414	9.0
Internal Subtotal	946	1,147	984	3,077	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	30	0	30	0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.3
Grand Total	1,093	2,319	948	4,360	100.0
RA Sensible (Lights)	232	0	0	232	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	4.92
%OA	6	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	2,953
cfm/ton	452		
ft²/ton	677		
Btu/h-ft²	17.73		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-237	0	-237	12.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-779	0	-779	41.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-138	0	-138	7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-279	14.9
Envelope Subtotal	-266	-1,083	0	-1,363	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-512	0	-512	27.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.2
Grand Total	-266	-1,599	0	-1,878	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.88	No People(max)	4.92
%OA	6	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	2,953
cfm/Mbh	-88		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	164
Cooling ACH	3.33
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.18
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	164
Heating ACH	3.33
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.18
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

ROOM_Hskp

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	250	0	250	43.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	34	0	34	5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	34	0	-4	31	5.3
Envelope Subtotal	34	282	-4	313	-
People	30	45	57	132	22.9
Lights	33	56	0	89	15.5
Miscellaneous Loads	7	0	0	7	1.3
Internal Subtotal	70	102	57	228	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.4
Grand Total	104	382	53	539	100.0
RA Sensible (Lights)	38	0	0	38	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.28
%OA	0	People per 1000 ft²	5
cfm/ft²	0.41	Volume (ft³)	682
cfm/ton	521		
ft²/ton	1,266		
Btu/h-ft²	9.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-131	0	-131	62.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-26	0	-26	12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-5.4
Other Floor	0	0	0	0	0.0
Infiltration	-62	0	0	-64	30.9
Envelope Subtotal	-62	-146	0	-210	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-1.2
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	-59	-146	0	-208	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.21	No People(max)	0.28
%OA	0	People per 1000 ft²	5
cfm/ft²	0.41	Volume (ft³)	682
cfm/Mbh	-112		
ft²/Mbh	-273		
Btu/h-ft²	-3.66		

Cooling Airflows

Main Fan cfm	23
Cooling ACH	2.02
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	23
Heating ACH	2.02
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100

Areas ft²

Roof	65
Other Roof	65
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	396
Exterior Floor	0
Internal Floor	0
Slab	65
Other Floor	0

ROOM_Intake Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	653	0	653	49.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	163	0	163	12.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	50	0	-1	49	3.7
Envelope Subtotal	50	814	-1	863	-
People	0	0	0	0	0.0
Lights	0	95	0	95	7.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	95	0	95	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	50	905	-1	954	100.0
RA Sensible (Lights)	367	0	0	367	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	1,858
cfm/ton	578		
ft²/ton	1,947		
Btu/h-ft²	6.16		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-337	0	-337	66.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-105	0	-105	20.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-6.1
Other Floor	0	0	0	0	0.0
Infiltration	-90	0	0	-95	18.7
Envelope Subtotal	-90	-411	0	-505	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-90	-412	0	-506	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.51	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	1,858
cfm/Mbh	-91		
ft²/Mbh	-306		
Btu/h-ft²	-3.27		

Cooling Airflows

Main Fan cfm	46
Cooling ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	23
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	46
Heating ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	23
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	169
Other Roof	169
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	689
Exterior Floor	0
Internal Floor	0
Slab	169
Other Floor	0

ROOM_Interview Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	396	0	396	11.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	1,053	0	1,053	31.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-58	0	-58	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,383	0	1,383	-
People	166	215	316	696	21.0
Lights	0	184	0	184	5.6
Miscellaneous Loads	242	151	0	394	11.9
Internal Subtotal	408	550	316	1,274	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-31	0	-31	-0.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.2
Grand Total	408	1,894	316	2,618	100.0
RA Sensible (Lights)	697	0	0	697	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.58
%OA	0	People per 1000 ft²	10
cfm/ft²	0.70	Volume (ft³)	1,894
cfm/ton	508		
ft²/ton	723		
Btu/h-ft²	16.60		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-221	0	-221	17.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-935	0	-935	72.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	21	0	21	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	47	0	47	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-1,088	0	-1,088	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-199	0	-199	15.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.3
Grand Total	0	-1,291	0	-1,291	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.29	No People(max)	1.58
%OA	0	People per 1000 ft²	10
cfm/ft²	0.70	Volume (ft³)	1,894
cfm/Mbh	-86		
ft²/Mbh	-122		
Btu/h-ft²	-8.20		

Cooling Airflows

Main Fan cfm	111
Cooling ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	23
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	23
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	119
Other Roof	119
Ceiling	51
Window	0
Door	0
Wall	313
Below-Grade Wall	0
Other Wall	313
Partition	325
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

ROOM_IT

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	258	0	258	18.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	141	0	141	9.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	5	0	5	0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	405	0	405	-
People	0	0	0	0	0.0
Lights	138	196	0	334	23.3
Miscellaneous Loads	539	0	0	539	37.5
Internal Subtotal	677	196	0	873	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.0
Grand Total	677	600	0	1,277	100.0
RA Sensible (Lights)	159	0	0	159	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.39	Volume (ft³)	1,896
cfm/ton	578		
ft²/ton	1,485		
Btu/h-ft²	8.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-345	0	-345	112.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	18.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	42	0	42	-13.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-360	0	-360	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	54	0	0	54	-17.6
Internal Subtotal	54	0	0	54	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.3
Grand Total	54	-361	0	-307	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.31	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.39	Volume (ft³)	1,896
cfm/Mbh	-201		
ft²/Mbh	-515		
Btu/h-ft²	-1.94		

Cooling Airflows

Main Fan cfm	62
Cooling ACH	1.96
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	62
Heating ACH	1.96
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	171
Other Roof	171
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	649
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

ROOM_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,877	0	1,877	6.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	1,056	0	1,056	3.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2,245	0	-2,245	-7.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-351	0	-351	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	212	0	-24	188	0.6
Envelope Subtotal	212	337	-24	525	-
People	1,215	1,634	2,894	5,744	19.8
Lights	225	341	0	566	2.0
Miscellaneous Loads	13,295	8,630	0	21,925	75.7
Internal Subtotal	14,736	10,605	2,894	28,235	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-48	0	-48	-0.2
Grand Total	14,948	10,893	2,870	28,711	100.0
RA Sensible (Lights)	259	0	0	259	-

Engineering Checks For Cooling

Cooling tons	2.39	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/ton	1,045		
ft²/ton	160		
Btu/h-ft²	75.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 08:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-794	0	-794	43.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-674	0	-674	36.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-26	0	-26	1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	91	0	91	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-433	23.5
Envelope Subtotal	-414	-1,404	0	-1,838	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.2
Grand Total	-414	-1,408	0	-1,841	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.84	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/Mbh	-1,358		
ft²/Mbh	-208		
Btu/h-ft²	-4.81		

Cooling Airflows

Main Fan cfm	2,500
Cooling ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	133
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,500
Heating ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	133
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	402
Other Roof	402
Ceiling	0
Window	0
Door	0
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	766
Exterior Floor	0
Internal Floor	0
Slab	402
Other Floor	0

ROOM_Laundry

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	517	0	517	46.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-9	0	-9	-0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	73	0	-8	65	5.8
Envelope Subtotal	73	504	-8	568	-
People	64	87	122	272	24.5
Lights	71	108	0	179	16.1
Miscellaneous Loads	16	0	0	16	1.4
Internal Subtotal	150	195	122	467	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.4
Grand Total	223	694	113	1,031	100.0
RA Sensible (Lights)	81	0	0	81	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.61
%OA	0	People per 1000 ft²	5
cfm/ft²	0.36	Volume (ft³)	1,461
cfm/ton	514		
ft²/ton	1,417		
Btu/h-ft²	8.47		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-268	0	-268	66.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-132	0	0	-138	34.3
Envelope Subtotal	-132	-269	0	-406	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	5	0	0	5	-1.3
Internal Subtotal	5	0	0	5	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-127	-269	0	-402	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.40	No People(max)	0.61
%OA	0	People per 1000 ft²	5
cfm/ft²	0.36	Volume (ft³)	1,461
cfm/Mbh	-110		
ft²/Mbh	-303		
Btu/h-ft²	-3.30		

Cooling Airflows

Main Fan cfm	44
Cooling ACH	1.81
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	44
Heating ACH	1.81
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	133
Other Roof	133
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	557
Exterior Floor	0
Internal Floor	0
Slab	133
Other Floor	0

ROOM_Long Term Belongings Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	431	0	431	44.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	34	0	34	3.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-7	54	5.6
Envelope Subtotal	60	462	-7	516	-
People	53	73	101	226	23.4
Lights	58	91	0	149	15.4
Miscellaneous Loads	13	0	0	13	1.3
Internal Subtotal	124	163	101	388	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.4
Grand Total	185	622	94	901	100.0
RA Sensible (Lights)	67	0	0	67	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.50
%OA	2	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	1,208
cfm/ton	518		
ft²/ton	1,343		
Btu/h-ft²	8.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-224	0	-224	64.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-30	0	-30	8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-5.5
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	33.0
Envelope Subtotal	-109	-235	0	-349	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.2
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-105	-236	0	-345	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.35	No People(max)	0.50
%OA	2	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	1,208
cfm/Mbh	-113		
ft²/Mbh	-292		
Btu/h-ft²	-3.42		

Cooling Airflows

Main Fan cfm	39
Cooling ACH	1.94
Sec Fan cfm	0
Input Ventilation cfm	17
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.05
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	39
Heating ACH	1.94
Sec Fan cfm	0
Input Ventilation cfm	17
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.05
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	111
Other Roof	111
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	516
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

ROOM_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	737	0	737	13.1
Other Roof	0	0	0	0	0.0
Glass	490	357	0	847	15.1
Door	0	905	0	905	16.1
Wall	0	978	0	978	17.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-441	0	-441	-7.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-49	0	-49	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	117	0	-55	61	1.1
Envelope Subtotal	607	2,487	-55	3,038	-
People	396	545	791	1,732	30.9
Lights	162	232	0	394	7.0
Miscellaneous Loads	202	124	0	327	5.8
Internal Subtotal	760	901	791	2,453	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-70	0	-70	-1.3
Grand Total	1,367	3,318	736	5,421	100.0
RA Sensible (Lights)	186	0	0	186	-

Engineering Checks For Cooling

Cooling tons	0.45	No People(max)	3.95
%OA	0	People per 1000 ft²	20
cfm/ft²	1.14	Volume (ft³)	2,373
cfm/ton	500		
ft²/ton	438		
Btu/h-ft²	27.40		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 08:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-409	0	-409	22.5
Other Roof	0	0	0	0	0.0
Glass	-324	0	0	-324	17.9
Door	0	-517	0	-517	28.5
Wall	0	-559	0	-559	30.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	186	0	186	-10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	57	0	57	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-214	0	0	-225	12.4
Envelope Subtotal	-539	-1,241	0	-1,791	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	1.4
Grand Total	-539	-1,267	0	-1,816	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.82	No People(max)	3.95
%OA	0	People per 1000 ft²	20
cfm/ft²	1.14	Volume (ft³)	2,373
cfm/Mbh	-124		
ft²/Mbh	-109		
Btu/h-ft²	-9.17		

Cooling Airflows

Main Fan cfm	226
Cooling ACH	5.71
Sec Fan cfm	0
Input Ventilation cfm	44
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	226
Heating ACH	5.71
Sec Fan cfm	0
Input Ventilation cfm	44
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²

Roof	212
Other Roof	212
Ceiling	0
Window	16
Door	21
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	499
Exterior Floor	0
Internal Floor	0
Slab	212
Other Floor	0

ROOM_Mechanical

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 14:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	678	0	678	42.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	181	0	181	11.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	94	0	94	5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	949	0	949	-
People	0	0	0	0	0.0
Lights	135	205	0	340	21.3
Miscellaneous Loads	158	0	0	158	9.9
Internal Subtotal	294	205	0	499	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.3
Grand Total	294	1,149	0	1,443	100.0
RA Sensible (Lights)	155	0	0	155	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.45	Volume (ft³)	1,856
cfm/ton	578		
ft²/ton	1,286		
Btu/h-ft²	9.33		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-339	0	-339	59.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-204	0	-204	35.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-112	0	-112	19.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	35	0	35	-6.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-620	0	-620	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	53	0	0	53	-9.3
Internal Subtotal	53	0	0	53	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.3
Grand Total	53	-622	0	-569	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.57	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.45	Volume (ft³)	1,856
cfm/Mbh	-122		
ft²/Mbh	-272		
Btu/h-ft²	-3.68		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	2.26
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	2.26
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	170
Other Roof	170
Ceiling	0
Window	0
Door	0
Wall	64
Below-Grade Wall	0
Other Wall	64
Partition	685
Exterior Floor	0
Internal Floor	0
Slab	170
Other Floor	0

ROOM_Meds

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	547	0	547	45.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	5	0	5	0.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	78	0	-9	69	5.8
Envelope Subtotal	78	548	-9	617	-
People	68	92	129	289	24.2
Lights	75	114	0	190	15.9
Miscellaneous Loads	17	0	0	17	1.4
Internal Subtotal	160	206	129	495	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.4
Grand Total	237	750	121	1,108	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.65
%OA	0	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,553
cfm/ton	515		
ft²/ton	1,401		
Btu/h-ft²	8.57		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-284	0	-284	64.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-5.6
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-146	33.4
Envelope Subtotal	-140	-297	0	-443	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	6	0	0	6	-1.3
Internal Subtotal	6	0	0	6	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-135	-297	0	-438	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	0.65
%OA	0	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,553
cfm/Mbh	-109		
ft²/Mbh	-295		
Btu/h-ft²	-3.39		

Cooling Airflows

Main Fan cfm	48
Cooling ACH	1.85
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	48
Heating ACH	1.85
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	141
Other Roof	141
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	572
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ROOM_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,095	0	1,095	12.6
Other Roof	0	0	0	0	0.0
Glass	334	97	0	432	5.0
Door	0	368	0	368	4.2
Wall	0	607	0	607	7.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-318	0	-318	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-45	0	-45	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	291	0	-75	216	2.5
Envelope Subtotal	626	1,803	-75	2,354	-
People	971	1,273	1,942	4,185	48.1
Lights	398	564	0	962	11.1
Miscellaneous Loads	497	302	0	799	9.2
Internal Subtotal	1,866	2,139	1,942	5,947	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-9	0	-9	-0.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-49	0	-49	-0.6
Grand Total	2,491	3,884	1,867	8,242	100.0
RA Sensible (Lights)	457	0	0	457	-

Engineering Checks For Cooling

Cooling tons	0.69	No People(max)	9.70
%OA	5	People per 1000 ft²	20
cfm/ft²	0.63	Volume (ft³)	5,825
cfm/ton	447		
ft²/ton	707		
Btu/h-ft²	16.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-495	0	-495	14.1
Other Roof	0	0	0	0	0.0
Glass	-506	0	0	-506	14.4
Door	0	-543	0	-543	15.5
Wall	0	-833	0	-833	23.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	232	0	232	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	146	0	146	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-551	15.7
Envelope Subtotal	-1,032	-1,494	0	-2,551	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-923	0	-923	26.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-36	0	-36	1.0
Grand Total	-1,032	-2,453	0	-3,511	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.51	No People(max)	9.70
%OA	5	People per 1000 ft²	20
cfm/ft²	0.63	Volume (ft³)	5,825
cfm/Mbh	-88		
ft²/Mbh	-138		
Btu/h-ft²	-7.25		

Cooling Airflows

Main Fan cfm	307
Cooling ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	17
Calculated Ventilation ACH	0.18
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	307
Heating ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	17
Calculated Ventilation ACH	0.18
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

ROOM_Noisy Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	612	416	0	1,028	22.4
Door	0	1,109	0	1,109	24.1
Wall	0	819	0	819	17.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-503	0	-503	-10.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	0.6
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-42	45	1.0
Envelope Subtotal	698	1,868	-42	2,524	-
People	377	624	719	1,719	37.4
Lights	121	225	0	345	7.5
Miscellaneous Loads	184	147	0	331	7.2
Internal Subtotal	682	995	719	2,395	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-369	0	-369	-8.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-95	0	-95	-2.1
Grand Total	1,380	2,399	677	4,456	100.0
RA Sensible (Lights)	139	0	0	139	-

Engineering Checks For Cooling

Cooling tons	0.37	No People(max)	3.59
%OA	0	People per 1000 ft²	20
cfm/ft²	1.01	Volume (ft³)	2,156
cfm/ton	490		
ft²/ton	484		
Btu/h-ft²	24.79		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-334	0	0	-334	20.3
Door	0	-546	0	-546	33.2
Wall	0	-420	0	-420	25.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	145	0	145	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	51	0	51	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-204	12.4
Envelope Subtotal	-529	-769	0	-1,307	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-307	0	-307	18.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.7
Grand Total	-529	-1,104	0	-1,642	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.64	No People(max)	3.59
%OA	0	People per 1000 ft²	20
cfm/ft²	1.01	Volume (ft³)	2,156
cfm/Mbh	-111		
ft²/Mbh	-109		
Btu/h-ft²	-9.17		

Cooling Airflows

Main Fan cfm	182
Cooling ACH	5.06
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	182
Heating ACH	5.06
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ROOM_Noisy Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	395	0	395	13.1
Wall	0	145	0	145	4.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-125	0	-125	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-57	0	-57	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-31	45	1.5
Envelope Subtotal	76	358	-31	403	-
People	380	632	723	1,735	57.7
Lights	122	228	0	349	11.6
Miscellaneous Loads	185	149	0	334	11.1
Internal Subtotal	687	1,008	723	2,418	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	63	0	63	2.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	-0.5
Grand Total	762	1,415	693	2,869	100.0
RA Sensible (Lights)	140	0	0	140	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	3.61
%OA	1	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,170
cfm/ton	439		
ft²/ton	756		
Btu/h-ft²	15.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-548	0	-548	44.2
Wall	0	-220	0	-220	17.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	48	0	48	-3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	46	0	46	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-205	16.6
Envelope Subtotal	-196	-675	0	-880	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-341	0	-341	27.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.5
Grand Total	-196	-1,034	0	-1,239	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.24	No People(max)	3.61
%OA	1	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,170
cfm/Mbh	-85		
ft²/Mbh	-146		
Btu/h-ft²	-6.85		

Cooling Airflows

Main Fan cfm	105
Cooling ACH	2.90
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	105
Heating ACH	2.90
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ROOM_Ante Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	349	0	349	43.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	51	0	51	6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-5	43	5.4
Envelope Subtotal	48	398	-5	441	-
People	42	58	81	181	22.6
Lights	47	72	0	119	14.9
Miscellaneous Loads	10	0	0	10	1.3
Internal Subtotal	100	131	81	311	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.4
Grand Total	148	526	76	749	100.0
RA Sensible (Lights)	54	0	0	54	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.40
%OA	1	People per 1000 ft²	5
cfm/ft²	0.40	Volume (ft³)	970
cfm/ton	520		
ft²/ton	1,294		
Btu/h-ft²	9.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-181	0	-181	62.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-34	0	-34	11.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-5.4
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-91	31.7
Envelope Subtotal	-88	-200	0	-292	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-1.2
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	-84	-201	0	-289	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.29	No People(max)	0.40
%OA	1	People per 1000 ft²	5
cfm/ft²	0.40	Volume (ft³)	970
cfm/Mbh	-112		
ft²/Mbh	-280		
Btu/h-ft²	-3.57		

Cooling Airflows

Main Fan cfm	32
Cooling ACH	1.98
Sec Fan cfm	0
Input Ventilation cfm	13
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	32
Heating ACH	1.98
Sec Fan cfm	0
Input Ventilation cfm	13
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	90
Other Roof	90
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	456
Exterior Floor	0
Internal Floor	0
Slab	90
Other Floor	0

ROOM_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	929	0	929	18.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	568	0	568	11.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-39	0	-39	-0.7
Slab	0	-37	0	-37	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	381	0	-47	334	6.5
Envelope Subtotal	381	1,421	-47	1,755	-
People	305	494	482	1,280	24.8
Lights	515	867	0	1,382	26.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	820	1,360	482	2,662	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	162	0	162	3.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	-0.2
Grand Total	1,201	2,933	435	4,569	100.0
RA Sensible (Lights)	592	0	0	592	-

Engineering Checks For Cooling

Cooling tons	0.38	No People(max)	3.11
%OA	0	People per 1000 ft²	5
cfm/ft²	0.32	Volume (ft³)	9,250
cfm/ton	523		
ft²/ton	1,633		
Btu/h-ft²	7.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-1,055	0	-1,055	37.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-554	0	-554	19.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	40	0	40	-1.4
Slab	0	97	0	97	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-835	0	0	-873	30.9
Envelope Subtotal	-835	-1,472	0	-2,345	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-469	0	-469	16.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.2
Grand Total	-835	-1,948	0	-2,820	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.82	No People(max)	3.11
%OA	0	People per 1000 ft²	5
cfm/ft²	0.32	Volume (ft³)	9,250
cfm/Mbh	-71		
ft²/Mbh	-220		
Btu/h-ft²	-4.55		

Cooling Airflows

Main Fan cfm	199
Cooling ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	20
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	199
Heating ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	20
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	671
Window	0
Door	0
Wall	332
Below-Grade Wall	0
Other Wall	332
Partition	1,426
Exterior Floor	0
Internal Floor	207
Slab	469
Other Floor	207

ROOM_Noisy Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	118	36	0	154	4.9
Door	0	381	0	381	12.1
Wall	0	285	0	285	9.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-239	0	-239	-7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-49	0	-49	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-29	80	2.5
Envelope Subtotal	227	415	-29	613	-
People	382	592	729	1,703	54.0
Lights	122	213	0	336	10.7
Miscellaneous Loads	186	139	0	326	10.3
Internal Subtotal	691	944	729	2,364	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	54	0	54	1.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.6
Grand Total	919	1,393	699	3,011	100.0
RA Sensible (Lights)	141	0	0	141	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-155	0	0	-155	9.9
Door	0	-504	0	-504	32.2
Wall	0	-389	0	-389	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	141	0	141	-9.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	13.2
Envelope Subtotal	-352	-699	0	-1,061	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-483	0	-483	30.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	1.3
Grand Total	-352	-1,202	0	-1,564	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	111
Cooling ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.03
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

	ft²
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	3.64
%OA	1	People per 1000 ft²	20
cfm/ft²	0.61	Volume (ft³)	2,186
cfm/ton	444		
ft²/ton	726		
Btu/h-ft²	16.53		

Engineering Checks For Heating

Heating Mbh	-1.56	No People(max)	3.64
%OA	1	People per 1000 ft²	20
cfm/ft²	0.61	Volume (ft³)	2,186
cfm/Mbh	-71		
ft²/Mbh	-116		
Btu/h-ft²	-8.62		

ROOM_Office 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	351	0	351	16.6
Other Roof	0	0	0	0	0.0
Glass	251	190	0	441	20.8
Door	0	0	0	0	0.0
Wall	0	544	0	544	25.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	56	0	-23	32	1.5
Envelope Subtotal	306	1,021	-23	1,304	-
People	99	136	188	424	20.0
Lights	96	149	0	245	11.6
Miscellaneous Loads	48	0	0	48	2.3
Internal Subtotal	243	285	188	717	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.7
Grand Total	550	1,290	165	2,005	100.0
RA Sensible (Lights)	111	0	0	111	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	0.94
%OA	0	People per 1000 ft²	10
cfm/ft²	0.94	Volume (ft³)	1,130
cfm/ton	530		
ft²/ton	564		
Btu/h-ft²	21.28		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-203	0	-203	27.1
Other Roof	0	0	0	0	0.0
Glass	-164	0	0	-164	21.8
Door	0	0	0	0	0.0
Wall	0	-312	0	-312	41.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1	0	1	-0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-102	0	0	-107	14.2
Envelope Subtotal	-266	-490	0	-761	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-2.1
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.8
Grand Total	-250	-496	0	-751	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.75	No People(max)	0.94
%OA	0	People per 1000 ft²	10
cfm/ft²	0.94	Volume (ft³)	1,130
cfm/Mbh	-118		
ft²/Mbh	-125		
Btu/h-ft²	-8.00		

Cooling Airflows

Main Fan cfm	89
Cooling ACH	4.72
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	4.72
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	104
Other Roof	104
Ceiling	0
Window	8
Door	0
Wall	107
Below-Grade Wall	0
Other Wall	107
Partition	388
Exterior Floor	0
Internal Floor	0
Slab	104
Other Floor	0

ROOM_Office 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 13:00:00
 Outside DB / WB / HR 96.8 °F / 63.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	341	0	341	17.4
Other Roof	0	0	0	0	0.0
Glass	268	193	0	460	23.4
Door	0	0	0	0	0.0
Wall	0	510	0	510	26.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-180	0	-180	-9.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-24	29	1.5
Envelope Subtotal	320	844	-24	1,141	-
People	100	140	190	430	21.9
Lights	97	153	0	250	12.7
Miscellaneous Loads	49	0	0	49	2.5
Internal Subtotal	246	292	190	729	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.9
Grand Total	566	1,119	166	1,852	100.0
RA Sensible (Lights)	112	0	0	112	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	0.95
%OA	0	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,142
cfm/ton	526		
ft²/ton	617		
Btu/h-ft²	19.45		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-205	0	-205	29.0
Other Roof	0	0	0	0	0.0
Glass	-162	0	0	-162	22.8
Door	0	0	0	0	0.0
Wall	0	-312	0	-312	44.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-103	0	0	-108	15.2
Envelope Subtotal	-265	-450	0	-719	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-2.3
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.8
Grand Total	-248	-456	0	-709	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.71	No People(max)	0.95
%OA	0	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,142
cfm/Mbh	-114		
ft²/Mbh	-134		
Btu/h-ft²	-7.46		

Cooling Airflows

Main Fan cfm	81
Cooling ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	81
Heating ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	105
Other Roof	105
Ceiling	0
Window	8
Door	0
Wall	108
Below-Grade Wall	0
Other Wall	108
Partition	389
Exterior Floor	0
Internal Floor	0
Slab	105
Other Floor	0

ROOM_Quiet Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-85	0	-85	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-39	0	-39	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-26	39	2.0
Envelope Subtotal	64	-125	-26	-86	-
People	274	474	521	1,269	66.4
Lights	88	171	0	259	13.5
Miscellaneous Loads	133	111	0	245	12.8
Internal Subtotal	495	756	521	1,772	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	129	0	129	6.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	559	756	495	1,811	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.60
%OA	3	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	1,564
cfm/ton	420		
ft²/ton	864		
Btu/h-ft²	13.89		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-87	0	-87	17.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	30.1
Envelope Subtotal	-141	-61	0	-208	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-281	0	-281	57.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-141	-342	0	-490	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.49	No People(max)	2.60
%OA	3	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	1,564
cfm/Mbh	-129		
ft²/Mbh	-266		
Btu/h-ft²	-3.76		

Cooling Airflows

Main Fan cfm	63
Cooling ACH	2.42
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.08
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	63
Heating ACH	2.42
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.08
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Quiet Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	222	130	0	352	15.5
Door	0	0	0	0	0.0
Wall	0	207	0	207	9.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	-3.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-51	0	-51	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-45	32	1.4
Envelope Subtotal	299	208	-45	463	-
People	274	480	523	1,276	56.1
Lights	88	173	0	261	11.5
Miscellaneous Loads	134	113	0	247	10.8
Internal Subtotal	496	765	523	1,784	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-57	0	-57	-2.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.7
Grand Total	795	900	478	2,172	100.0
RA Sensible (Lights)	101	0	0	101	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-163	0	0	-163	21.8
Door	0	0	0	0	0.0
Wall	0	-126	0	-126	16.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-65	0	-65	8.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	19.8
Envelope Subtotal	-305	-161	0	-472	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-269	0	-269	36.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.8
Grand Total	-305	-436	0	-747	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	82
Cooling ACH	3.14
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	82
Heating ACH	3.14
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	2.61
%OA	1	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	1,568
cfm/ton	451		
ft²/ton	722		
Btu/h-ft²	16.62		

Engineering Checks For Heating

Heating Mbh	-0.75	No People(max)	2.61
%OA	1	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	1,568
cfm/Mbh	-109		
ft²/Mbh	-175		
Btu/h-ft²	-5.71		

ROOM_Quiet Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	770	0	770	31.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-174	0	-174	-7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-48	0	-48	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-19	36	1.4
Envelope Subtotal	55	549	-19	584	-
People	275	506	524	1,306	52.7
Lights	88	183	0	271	10.9
Miscellaneous Loads	134	119	0	253	10.2
Internal Subtotal	498	808	524	1,830	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-28	0	-28	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	-0.4
Grand Total	553	1,319	505	2,377	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	2.62
%OA	1	People per 1000 ft²	20
cfm/ft²	0.69	Volume (ft³)	1,573
cfm/ton	455		
ft²/ton	662		
Btu/h-ft²	18.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-400	0	-400	50.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	18.8
Envelope Subtotal	-142	-383	0	-532	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-258	0	-258	32.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-142	-643	0	-792	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.79	No People(max)	2.62
%OA	1	People per 1000 ft²	20
cfm/ft²	0.69	Volume (ft³)	1,573
cfm/Mbh	-114		
ft²/Mbh	-166		
Btu/h-ft²	-6.02		

Cooling Airflows

Main Fan cfm	90
Cooling ACH	3.43
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	90
Heating ACH	3.43
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	1
Calculated Ventilation ACH	0.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

ROOM_Resident Room 01

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 10:00:00
 Outside DB / WB / HR 86.6 °F / 61.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	309	247	0	556	25.9
Door	0	0	0	0	0.0
Wall	0	345	0	345	16.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-129	0	-129	-6.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-18	0	-18	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-30	7	0.3
Envelope Subtotal	346	444	-30	760	-
People	143	154	341	638	29.8
Lights	0	38	0	38	1.8
Miscellaneous Loads	338	363	0	701	32.7
Internal Subtotal	481	555	341	1,377	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-99	0	-99	-4.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.9
Grand Total	827	880	311	2,018	100.0
RA Sensible (Lights)	125	0	0	125	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.24
%OA	0	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	1,486
cfm/ton	489		
ft²/ton	737		
Btu/h-ft²	16.28		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-214	0	0	-214	27.2
Door	0	0	0	0	0.0
Wall	0	-218	0	-218	27.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	8	0	8	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	29	0	29	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	17.8
Envelope Subtotal	-348	-180	0	-535	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-246	0	-246	31.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.9
Grand Total	-348	-434	0	-788	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.79	No People(max)	1.24
%OA	0	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	1,486
cfm/Mbh	-104		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	82
Cooling ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	82
Heating ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	80
Below-Grade Wall	0
Other Wall	80
Partition	482
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

ROOM_Resident Room 02

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	308	257	0	565	25.6
Door	0	0	0	0	0.0
Wall	0	530	0	530	24.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-109	0	-109	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	35	0	-10	24	1.1
Envelope Subtotal	343	654	-10	986	-
People	129	142	307	578	26.2
Lights	0	35	0	35	1.6
Miscellaneous Loads	305	333	0	638	28.9
Internal Subtotal	434	510	307	1,251	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-124	0	-124	-5.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.9
Grand Total	776	1,021	297	2,094	100.0
RA Sensible (Lights)	113	0	0	113	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.12
%OA	0	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,340
cfm/ton	496		
ft²/ton	640		
Btu/h-ft²	18.75		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-216	0	0	-216	25.4
Door	0	0	0	0	0.0
Wall	0	-321	0	-321	37.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	8	0	8	-0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-121	0	0	-127	14.9
Envelope Subtotal	-337	-285	0	-628	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-215	0	-215	25.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.8
Grand Total	-337	-508	0	-850	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.85	No People(max)	1.12
%OA	0	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,340
cfm/Mbh	-102		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	3.90
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	3.90
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	123
Window	10
Door	0
Wall	112
Below-Grade Wall	0
Other Wall	112
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	123
Other Floor	0

ROOM_Resident Room 03

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	307	249	0	555	21.5
Door	0	0	0	0	0.0
Wall	0	656	0	656	25.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-103	0	-103	-4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-18	0	-18	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	42	0	-13	29	1.1
Envelope Subtotal	349	784	-13	1,119	-
People	157	167	375	699	27.0
Lights	0	41	0	41	1.6
Miscellaneous Loads	372	392	0	764	29.5
Internal Subtotal	530	600	375	1,504	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-151	0	-151	-5.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.8
Grand Total	879	1,211	362	2,451	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.36
%OA	0	People per 1000 ft²	10
cfm/ft²	0.74	Volume (ft³)	1,636
cfm/ton	493		
ft²/ton	668		
Btu/h-ft²	17.96		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-217	0	0	-217	21.3
Door	0	0	0	0	0.0
Wall	0	-396	0	-396	38.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-25	0	-25	2.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	35	0	35	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-148	0	0	-155	15.2
Envelope Subtotal	-365	-386	0	-758	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-256	0	-256	25.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.7
Grand Total	-365	-649	0	-1,021	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.02	No People(max)	1.36
%OA	0	People per 1000 ft²	10
cfm/ft²	0.74	Volume (ft³)	1,636
cfm/Mbh	-99		
ft²/Mbh	-134		
Btu/h-ft²	-7.46		

Cooling Airflows

Main Fan cfm	101
Cooling ACH	3.70
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	101
Heating ACH	3.70
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	4
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	148
Window	10
Door	0
Wall	136
Below-Grade Wall	0
Other Wall	136
Partition	450
Exterior Floor	0
Internal Floor	0
Slab	148
Other Floor	0

ROOM_Resident Room 04

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	140	107	0	247	9.1
Door	0	0	0	0	0.0
Wall	0	1,139	0	1,139	41.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-128	0	-128	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-73	0	-73	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-35	41	1.5
Envelope Subtotal	216	1,044	-35	1,226	-
People	149	205	355	709	26.0
Lights	0	45	0	45	1.7
Miscellaneous Loads	352	431	0	784	28.8
Internal Subtotal	501	681	355	1,537	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-153	0	-153	-5.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	-0.6
Grand Total	718	1,557	320	2,595	100.0
RA Sensible (Lights)	131	0	0	131	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.29
%OA	0	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,549
cfm/ton	507		
ft²/ton	597		
Btu/h-ft²	20.10		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-214	0	0	-214	16.0
Door	0	0	0	0	0.0
Wall	0	-859	0	-859	64.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	10.9
Envelope Subtotal	-354	-752	0	-1,113	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-220	0	-220	16.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-354	-980	0	-1,340	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.34	No People(max)	1.29
%OA	0	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,549
cfm/Mbh	-82		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	110
Cooling ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	110
Heating ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ROOM_Resident Room 05

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	412	247	0	660	20.1
Door	0	0	0	0	0.0
Wall	0	1,361	0	1,361	41.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-195	0	-195	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	0.9
Other Floor	0	0	0	0	0.0
Infiltration	72	0	-34	37	1.1
Envelope Subtotal	484	1,443	-34	1,893	-
People	152	223	361	735	22.4
Lights	0	46	0	46	1.4
Miscellaneous Loads	358	443	0	801	24.4
Internal Subtotal	510	712	361	1,583	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-301	0	-301	-9.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	-0.9
Grand Total	994	1,824	327	3,144	100.0
RA Sensible (Lights)	133	0	0	133	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	1.31
%OA	0	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/ton	518		
ft²/ton	501		
Btu/h-ft²	23.95		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-225	0	0	-225	16.5
Door	0	0	0	0	0.0
Wall	0	-865	0	-865	63.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	71	0	71	-5.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	11.0
Envelope Subtotal	-367	-755	0	-1,128	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-221	0	-221	16.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-367	-984	0	-1,358	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.36	No People(max)	1.31
%OA	0	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/Mbh	-100		
ft²/Mbh	-97		
Btu/h-ft²	-10.31		

Cooling Airflows

Main Fan cfm	136
Cooling ACH	5.18
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	136
Heating ACH	5.18
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

ROOM_Resident Room 06

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	419	289	0	708	26.0
Door	0	0	0	0	0.0
Wall	0	673	0	673	24.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-205	0	-205	-7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	0.5
Other Floor	0	0	0	0	0.0
Infiltration	61	0	-10	51	1.9
Envelope Subtotal	480	770	-10	1,240	-
People	143	225	341	709	26.1
Lights	0	45	0	45	1.7
Miscellaneous Loads	338	434	0	773	28.4
Internal Subtotal	482	705	341	1,527	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-142	0	-142	-5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	-1.1
Grand Total	962	1,303	331	2,596	100.0
RA Sensible (Lights)	125	0	0	125	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.24
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,488
cfm/ton	504		
ft²/ton	573		
Btu/h-ft²	20.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-229	0	0	-229	24.2
Door	0	0	0	0	0.0
Wall	0	-352	0	-352	37.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-16	0	-16	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	14.9
Envelope Subtotal	-363	-336	0	-706	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-233	0	-233	24.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.8
Grand Total	-363	-577	0	-947	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.24
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,488
cfm/Mbh	-115		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	109
Cooling ACH	4.40
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	109
Heating ACH	4.40
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

ROOM_Resident Room 07

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	591	375	0	966	35.3
Door	0	0	0	0	0.0
Wall	0	575	0	575	21.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-180	0	-180	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-46	0	-46	-1.7
Other Floor	0	0	0	0	0.0
Infiltration	74	0	-34	40	1.5
Envelope Subtotal	665	724	-34	1,356	-
People	145	202	345	691	25.2
Lights	0	44	0	44	1.6
Miscellaneous Loads	342	425	0	767	28.0
Internal Subtotal	487	671	345	1,503	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-209	0	-209	-7.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-37	0	-37	-1.3
Grand Total	1,152	1,150	311	2,613	100.0
RA Sensible (Lights)	127	0	0	127	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.25
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,504
cfm/ton	509		
ft²/ton	576		
Btu/h-ft²	20.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-367	0	0	-367	35.4
Door	0	0	0	0	0.0
Wall	0	-332	0	-332	32.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	26	0	26	-2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-136	0	0	-142	13.8
Envelope Subtotal	-503	-273	0	-782	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-242	0	-242	23.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.1
Grand Total	-503	-526	0	-1,035	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.03	No People(max)	1.25
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,504
cfm/Mbh	-107		
ft²/Mbh	-121		
Btu/h-ft²	-8.26		

Cooling Airflows

Main Fan cfm	111
Cooling ACH	4.43
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	4.43
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	137
Window	18
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	442
Exterior Floor	0
Internal Floor	0
Slab	137
Other Floor	0

ROOM_Resident Room 08

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	582	525	0	1,107	39.7
Door	0	0	0	0	0.0
Wall	0	606	0	606	21.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-125	0	-125	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-67	0	-67	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-63	-15	-0.5
Envelope Subtotal	630	939	-63	1,506	-
People	146	198	347	692	24.8
Lights	0	43	0	43	1.5
Miscellaneous Loads	345	413	0	758	27.2
Internal Subtotal	491	654	347	1,492	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-299	0	-299	-10.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-36	0	-36	-1.3
Grand Total	1,120	1,258	285	2,663	100.0
RA Sensible (Lights)	128	0	0	128	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-370	0	0	-370	33.9
Door	0	0	0	0	0.0
Wall	0	-336	0	-336	30.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-25	0	-25	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	34	0	34	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-143	13.1
Envelope Subtotal	-507	-327	0	-841	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-240	0	-240	22.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.0
Grand Total	-507	-578	0	-1,092	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	115
Cooling ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	115
Heating ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	18
Door	0
Wall	125
Below-Grade Wall	0
Other Wall	125
Partition	443
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.26
%OA	0	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,515
cfm/ton	516		
ft²/ton	569		
Btu/h-ft²	21.09		

Engineering Checks For Heating

Heating Mbh	-1.09	No People(max)	1.26
%OA	0	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,515
cfm/Mbh	-105		
ft²/Mbh	-116		
Btu/h-ft²	-8.62		

ROOM_Resident Room 09

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	494	353	0	847	26.3
Door	0	0	0	0	0.0
Wall	0	1,243	0	1,243	38.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-163	0	-163	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-91	0	-91	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-33	42	1.3
Envelope Subtotal	569	1,342	-33	1,878	-
People	148	212	352	711	22.1
Lights	0	46	0	46	1.4
Miscellaneous Loads	349	437	0	786	24.4
Internal Subtotal	497	695	352	1,543	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-293	0	-293	-9.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-1.0
Grand Total	1,066	1,711	319	3,096	100.0
RA Sensible (Lights)	129	0	0	129	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	1.28
%OA	0	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,534
cfm/ton	519		
ft²/ton	496		
Btu/h-ft²	24.19		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-364	0	0	-364	25.0
Door	0	0	0	0	0.0
Wall	0	-822	0	-822	56.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	67	0	67	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-138	0	0	-145	10.0
Envelope Subtotal	-502	-715	0	-1,224	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-220	0	-220	15.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	0.8
Grand Total	-502	-946	0	-1,456	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.46	No People(max)	1.28
%OA	0	People per 1000 ft²	10
cfm/ft²	1.05	Volume (ft³)	1,534
cfm/Mbh	-92		
ft²/Mbh	-88		
Btu/h-ft²	-11.36		

Cooling Airflows

Main Fan cfm	134
Cooling ACH	5.24
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	134
Heating ACH	5.24
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	140
Window	18
Door	0
Wall	285
Below-Grade Wall	0
Other Wall	285
Partition	285
Exterior Floor	0
Internal Floor	0
Slab	140
Other Floor	0

ROOM_Resident Room 10

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	235	105	0	340	11.6
Door	0	0	0	0	0.0
Wall	0	1,183	0	1,183	40.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-162	0	-162	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-10	44	1.5
Envelope Subtotal	289	1,101	-10	1,380	-
People	150	234	357	741	25.3
Lights	0	45	0	45	1.5
Miscellaneous Loads	354	435	0	789	27.0
Internal Subtotal	504	715	357	1,576	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-138	0	-138	-4.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.7
Grand Total	793	1,656	346	2,796	100.0
RA Sensible (Lights)	131	0	0	131	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,557
cfm/ton	506		
ft²/ton	557		
Btu/h-ft²	21.54		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-379	0	0	-379	26.2
Door	0	0	0	0	0.0
Wall	0	-826	0	-826	57.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	92	0	92	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	10.2
Envelope Subtotal	-520	-693	0	-1,220	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-216	0	-216	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.9
Grand Total	-520	-922	0	-1,449	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.45	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,557
cfm/Mbh	-81		
ft²/Mbh	-90		
Btu/h-ft²	-11.11		

Cooling Airflows

Main Fan cfm	118
Cooling ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	118
Heating ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Resident Room 11

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	351	305	0	656	23.6
Door	0	0	0	0	0.0
Wall	0	705	0	705	25.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-211	0	-211	-7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-11	43	1.5
Envelope Subtotal	405	769	-11	1,164	-
People	149	251	355	755	27.1
Lights	0	49	0	49	1.7
Miscellaneous Loads	352	467	0	819	29.4
Internal Subtotal	502	766	355	1,623	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-106	0	-106	-3.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.9
Grand Total	907	1,405	344	2,655	100.0
RA Sensible (Lights)	131	0	0	131	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.29
%OA	0	People per 1000 ft²	10
cfm/ft²	0.86	Volume (ft³)	1,549
cfm/ton	503		
ft²/ton	583		
Btu/h-ft²	20.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-228	0	0	-228	24.1
Door	0	0	0	0	0.0
Wall	0	-363	0	-363	38.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	11	0	11	-1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	15.5
Envelope Subtotal	-368	-319	0	-694	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-246	0	-246	25.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.8
Grand Total	-368	-573	0	-947	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.29
%OA	0	People per 1000 ft²	10
cfm/ft²	0.86	Volume (ft³)	1,549
cfm/Mbh	-118		
ft²/Mbh	-136		
Btu/h-ft²	-7.35		

Cooling Airflows

Main Fan cfm	111
Cooling ACH	4.30
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	4.30
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	126
Below-Grade Wall	0
Other Wall	126
Partition	447
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ROOM_Resident Room 12

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	351	306	0	657	23.7
Door	0	0	0	0	0.0
Wall	0	692	0	692	24.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-172	0	-172	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-10	43	1.5
Envelope Subtotal	404	798	-10	1,191	-
People	146	246	348	741	26.7
Lights	0	48	0	48	1.7
Miscellaneous Loads	346	458	0	804	29.0
Internal Subtotal	492	751	348	1,592	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-111	0	-111	-4.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.9
Grand Total	896	1,413	338	2,648	100.0
RA Sensible (Lights)	128	0	0	128	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,520
cfm/ton	504		
ft²/ton	574		
Btu/h-ft²	20.91		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-228	0	0	-228	24.1
Door	0	0	0	0	0.0
Wall	0	-357	0	-357	37.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2	0	-2	0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	15.2
Envelope Subtotal	-366	-327	0	-699	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-240	0	-240	25.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.8
Grand Total	-366	-575	0	-948	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,520
cfm/Mbh	-117		
ft²/Mbh	-134		
Btu/h-ft²	-7.46		

Cooling Airflows

Main Fan cfm	111
Cooling ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Resident Room 13

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	351	307	0	658	23.6
Door	0	0	0	0	0.0
Wall	0	692	0	692	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-153	0	-153	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-10	43	1.5
Envelope Subtotal	404	819	-10	1,212	-
People	146	245	348	740	26.5
Lights	0	48	0	48	1.7
Miscellaneous Loads	346	457	0	803	28.8
Internal Subtotal	492	750	348	1,591	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-114	0	-114	-4.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.9
Grand Total	896	1,431	338	2,665	100.0
RA Sensible (Lights)	128	0	0	128	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,521
cfm/ton	505		
ft²/ton	571		
Btu/h-ft²	21.02		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-229	0	0	-229	23.5
Door	0	0	0	0	0.0
Wall	0	-357	0	-357	36.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-31	0	-31	3.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	14.8
Envelope Subtotal	-366	-356	0	-728	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-239	0	-239	24.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.8
Grand Total	-366	-602	0	-975	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.97	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,521
cfm/Mbh	-115		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	112
Cooling ACH	4.42
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	112
Heating ACH	4.42
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Resident Room 14

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	348	304	0	652	21.1
Door	0	0	0	0	0.0
Wall	0	1,020	0	1,020	33.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-177	0	-177	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-10	45	1.4
Envelope Subtotal	403	1,121	-10	1,514	-
People	151	250	359	759	24.6
Lights	0	48	0	48	1.6
Miscellaneous Loads	356	465	0	821	26.6
Internal Subtotal	507	763	359	1,629	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-159	0	-159	-5.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.8
Grand Total	910	1,701	349	2,960	100.0
RA Sensible (Lights)	132	0	0	132	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,565
cfm/ton	510		
ft²/ton	529		
Btu/h-ft²	22.68		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-225	0	0	-225	16.6
Door	0	0	0	0	0.0
Wall	0	-856	0	-856	63.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	67	0	67	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	11.0
Envelope Subtotal	-366	-750	0	-1,123	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-222	0	-222	16.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-366	-980	0	-1,352	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.35	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,565
cfm/Mbh	-93		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	126
Cooling ACH	4.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	126
Heating ACH	4.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Resident Room 15

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3	0	3	0.1
Other Roof	0	0	0	0	0.0
Glass	307	260	0	567	21.8
Door	0	0	0	0	0.0
Wall	0	743	0	743	28.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-12	28	1.1
Envelope Subtotal	347	876	-12	1,211	-
People	151	159	358	668	25.7
Lights	0	39	0	39	1.5
Miscellaneous Loads	356	371	0	727	28.0
Internal Subtotal	506	569	358	1,433	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-158	0	-158	-6.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.8
Grand Total	854	1,266	346	2,466	100.0
RA Sensible (Lights)	132	0	0	132	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,564
cfm/ton	497		
ft²/ton	634		
Btu/h-ft²	18.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3	0	-3	0.2
Other Roof	0	0	0	0	0.0
Glass	-215	0	0	-215	15.8
Door	0	0	0	0	0.0
Wall	0	-859	0	-859	63.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	10.9
Envelope Subtotal	-356	-753	0	-1,117	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-234	0	-234	17.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-356	-995	0	-1,358	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.36	No People(max)	1.30
%OA	0	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,564
cfm/Mbh	-75		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	102
Cooling ACH	3.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	102
Heating ACH	3.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	141
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Resident Room 16

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3	0	3	0.1
Other Roof	0	0	0	0	0.0
Glass	308	264	0	572	23.4
Door	0	0	0	0	0.0
Wall	0	602	0	602	24.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-123	0	-123	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-12	27	1.1
Envelope Subtotal	348	721	-12	1,056	-
People	146	156	348	651	26.7
Lights	0	38	0	38	1.6
Miscellaneous Loads	346	365	0	711	29.1
Internal Subtotal	492	560	348	1,400	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-123	0	-123	-5.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.9
Grand Total	840	1,137	336	2,313	100.0
RA Sensible (Lights)	128	0	0	128	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.75	Volume (ft³)	1,520
cfm/ton	494		
ft²/ton	657		
Btu/h-ft²	18.26		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3	0	-3	0.3
Other Roof	0	0	0	0	0.0
Glass	-219	0	0	-219	22.6
Door	0	0	0	0	0.0
Wall	0	-360	0	-360	37.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-17	0	-17	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	14.9
Envelope Subtotal	-356	-347	0	-710	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-251	0	-251	25.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.8
Grand Total	-356	-605	0	-968	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.97	No People(max)	1.27
%OA	0	People per 1000 ft²	10
cfm/ft²	0.75	Volume (ft³)	1,520
cfm/Mbh	-98		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	95
Cooling ACH	3.75
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	95
Heating ACH	3.75
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	137
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Sally Port

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 13:00:00
 Outside DB / WB / HR 96.8 °F / 63.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	274	0	274	11.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,214	0	1,214	49.1
Wall	0	365	0	365	14.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-309	0	-309	-12.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,536	0	1,536	-
People	82	115	156	352	14.2
Lights	0	99	0	99	4.0
Miscellaneous Loads	119	81	0	201	8.1
Internal Subtotal	201	295	156	652	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-56	0	-56	-2.2
Grand Total	201	1,775	156	2,132	100.0
RA Sensible (Lights)	344	0	0	344	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	0.78
%OA	0	People per 1000 ft²	10
cfm/ft²	1.23	Volume (ft³)	933
cfm/ton	536		
ft²/ton	438		
Btu/h-ft²	27.40		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-166	0	-166	18.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-639	0	-639	70.2
Wall	0	-225	0	-225	24.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	116	0	116	-12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-891	0	-891	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	2.1
Grand Total	0	-910	0	-910	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.91	No People(max)	0.78
%OA	0	People per 1000 ft²	10
cfm/ft²	1.23	Volume (ft³)	933
cfm/Mbh	-105		
ft²/Mbh	-85		
Btu/h-ft²	-11.76		

Cooling Airflows

Main Fan cfm	95
Cooling ACH	6.11
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	95
Heating ACH	6.11
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	87
Other Roof	87
Ceiling	0
Window	0
Door	26
Wall	99
Below-Grade Wall	0
Other Wall	99
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	87
Other Floor	0

ROOM_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	501	0	501	12.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	352	0	352	8.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-32	0	-32	-0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-36	101	2.5
Envelope Subtotal	137	794	-36	895	-
People	456	648	913	2,017	50.2
Lights	187	288	0	475	11.8
Miscellaneous Loads	234	154	0	387	9.6
Internal Subtotal	877	1,089	913	2,879	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	41	0	41	1.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.3
Grand Total	1,014	1,913	877	3,804	100.0
RA Sensible (Lights)	215	0	0	215	-

Engineering Checks For Cooling

Cooling tons	0.32	No People(max)	4.56
%OA	8	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	2,738
cfm/ton	445		
ft²/ton	720		
Btu/h-ft²	16.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-235	0	-235	16.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-491	0	-491	34.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-22	0	-22	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	60	0	60	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	18.2
Envelope Subtotal	-247	-687	0	-946	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-476	0	-476	33.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.3
Grand Total	-247	-1,167	0	-1,426	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.43	No People(max)	4.56
%OA	8	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	2,738
cfm/Mbh	-99		
ft²/Mbh	-160		
Btu/h-ft²	-6.25		

Cooling Airflows

Main Fan cfm	141
Cooling ACH	3.09
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.24
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	141
Heating ACH	3.09
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.24
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

ROOM_Service

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	974	0	974	14.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,778	0	1,778	26.6
Wall	0	1,560	0	1,560	23.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	964	0	964	14.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	179	0	-67	112	1.7
Envelope Subtotal	179	5,261	-67	5,373	-
People	159	218	304	681	10.2
Lights	176	272	0	448	6.7
Miscellaneous Loads	39	0	0	39	0.6
Internal Subtotal	374	490	304	1,167	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-60	0	-60	-0.9
Grand Total	553	5,690	237	6,481	100.0
RA Sensible (Lights)	202	0	0	202	-

Engineering Checks For Cooling

Cooling tons	0.54	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	0.99	Volume (ft³)	3,642
cfm/ton	557		
ft²/ton	562		
Btu/h-ft²	21.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-612	0	-612	18.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-1,221	0	-1,221	36.0
Wall	0	-1,022	0	-1,022	30.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-272	0	-272	8.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	101	0	101	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-329	0	0	-345	10.2
Envelope Subtotal	-329	-3,024	0	-3,370	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.4
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-36	0	-36	1.1
Grand Total	-316	-3,060	0	-3,392	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.39	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	0.99	Volume (ft³)	3,642
cfm/Mbh	-89		
ft²/Mbh	-89		
Btu/h-ft²	-11.24		

Cooling Airflows

Main Fan cfm	301
Cooling ACH	4.96
Sec Fan cfm	0
Input Ventilation cfm	102
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	301
Heating ACH	4.96
Sec Fan cfm	0
Input Ventilation cfm	102
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	323
Other Roof	323
Ceiling	0
Window	0
Door	49
Wall	389
Below-Grade Wall	0
Other Wall	389
Partition	580
Exterior Floor	0
Internal Floor	0
Slab	323
Other Floor	0

ROOM_Shower 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	245	0	245	18.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	82	0	82	6.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	52	0	52	3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-10	38	2.8
Envelope Subtotal	48	371	-10	409	-
People	157	249	248	654	48.2
Lights	72	119	0	191	14.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	229	368	248	846	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	24	0	24	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	277	759	239	1,275	100.0
RA Sensible (Lights)	83	0	0	83	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	961
cfm/ton	470		
ft²/ton	754		
Btu/h-ft²	15.92		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-119	0	-119	22.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-110	0	-110	21.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-107	0	-107	20.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-87	0	0	-91	17.5
Envelope Subtotal	-87	-317	0	-408	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-111	0	-111	21.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-87	-428	0	-519	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.52	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	961
cfm/Mbh	-96		
ft²/Mbh	-154		
Btu/h-ft²	-6.49		

Cooling Airflows

Main Fan cfm	50
Cooling ACH	3.12
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	50
Heating ACH	3.12
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	62
Other Roof	62
Ceiling	27
Window	0
Door	0
Wall	37
Below-Grade Wall	0
Other Wall	37
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	89
Other Floor	0

ROOM_Shower 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	357	0	357	18.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	168	0	168	8.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	300	0	300	15.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	58	0	-29	30	1.5
Envelope Subtotal	58	815	-29	845	-
People	194	303	307	803	40.6
Lights	89	145	0	234	11.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	283	447	307	1,037	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	342	1,257	278	1,877	100.0
RA Sensible (Lights)	103	0	0	103	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.78	Volume (ft³)	1,187
cfm/ton	492		
ft²/ton	633		
Btu/h-ft²	18.96		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 08:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-219	0	-219	44.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-101	0	-101	20.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-76	0	-76	15.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-107	0	0	-112	23.0
Envelope Subtotal	-107	-375	0	-487	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-107	-376	0	-488	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.49	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.78	Volume (ft³)	1,187
cfm/Mbh	-158		
ft²/Mbh	-203		
Btu/h-ft²	-4.93		

Cooling Airflows

Main Fan cfm	77
Cooling ACH	3.89
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	77
Heating ACH	3.89
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	110
Other Roof	110
Ceiling	0
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	488
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

ROOM_Shower 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	633	0	633	34.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-12	31	1.7
Envelope Subtotal	43	525	-12	556	-
People	204	403	322	929	49.8
Lights	94	193	0	286	15.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	297	596	322	1,215	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-8	0	-8	-0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.4
Grand Total	341	1,106	310	1,756	100.0
RA Sensible (Lights)	108	0	0	108	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	1,247
cfm/ton	476		
ft²/ton	710		
Btu/h-ft²	16.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-328	0	-328	49.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-31	0	-31	4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-113	0	0	-118	17.8
Envelope Subtotal	-113	-334	0	-452	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-207	0	-207	31.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-113	-543	0	-661	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.66	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	1,247
cfm/Mbh	-105		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	115
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	423
Exterior Floor	0
Interior Floor	0
Slab	115
Other Floor	0

ROOM_Shower 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	629	0	629	33.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	-3.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-12	31	1.7
Envelope Subtotal	43	542	-12	573	-
People	202	404	320	927	49.4
Lights	93	193	0	286	15.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	296	597	320	1,213	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-9	0	-9	-0.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.4
Grand Total	339	1,123	308	1,770	100.0
RA Sensible (Lights)	107	0	0	107	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.68	Volume (ft³)	1,239
cfm/ton	477		
ft²/ton	700		
Btu/h-ft²	17.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-325	0	-325	48.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-51	0	-51	7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-117	17.4
Envelope Subtotal	-112	-351	0	-468	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-205	0	-205	30.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-112	-557	0	-675	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.68	Volume (ft³)	1,239
cfm/Mbh	-104		
ft²/Mbh	-153		
Btu/h-ft²	-6.54		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	3.39
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	3.39
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	213	0	213	13.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	47	0	47	2.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-1.8
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-14	29	1.8
Envelope Subtotal	43	231	-14	260	-
People	203	392	321	916	57.0
Lights	94	187	0	281	17.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	297	579	321	1,196	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	45	0	45	2.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	340	852	307	1,498	100.0
RA Sensible (Lights)	107	0	0	107	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,243
cfm/ton	460		
ft²/ton	829		
Btu/h-ft²	14.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-322	0	-322	46.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-72	0	-72	10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	16.9
Envelope Subtotal	-112	-369	0	-486	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-206	0	-206	29.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-112	-576	0	-694	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.69	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,243
cfm/Mbh	-83		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	57
Cooling ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	57
Heating ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 6

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	213	0	213	13.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-8	0	-8	-0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-15	28	1.8
Envelope Subtotal	43	176	-15	204	-
People	203	397	321	920	58.8
Lights	93	190	0	283	18.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	296	586	321	1,203	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	55	0	55	3.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	340	813	306	1,459	100.0
RA Sensible (Lights)	107	0	0	107	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	1,242
cfm/ton	457		
ft²/ton	852		
Btu/h-ft²	14.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-321	0	-321	48.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-117	17.8
Envelope Subtotal	-112	-334	0	-452	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-208	0	-208	31.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-112	-544	0	-661	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.66	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	1,242
cfm/Mbh	-84		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	56
Cooling ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	56
Heating ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 7

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 11:00:00
 Outside DB / WB / HR 91.7 °F / 64.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3	0	3	0.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	515	0	515	30.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	-2.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	44	0	-14	30	1.8
Envelope Subtotal	44	457	-14	488	-
People	202	343	319	864	51.5
Lights	93	164	0	257	15.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	295	507	319	1,120	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-31	0	-31	-1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	339	927	306	1,571	100.0
RA Sensible (Lights)	107	0	0	107	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,235
cfm/ton	466		
ft²/ton	786		
Btu/h-ft²	15.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-324	0	-324	48.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-31	0	-31	4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-111	0	0	-117	17.5
Envelope Subtotal	-111	-333	0	-450	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-216	0	-216	32.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-111	-550	0	-667	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,235
cfm/Mbh	-91		
ft²/Mbh	-154		
Btu/h-ft²	-6.49		

Cooling Airflows

Main Fan cfm	61
Cooling ACH	2.96
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	61
Heating ACH	2.96
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	113
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 8

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 11:00:00
 Outside DB / WB / HR 91.7 °F / 64.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3	0	3	0.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	477	0	477	29.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-67	0	-67	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-14	29	1.8
Envelope Subtotal	43	395	-14	425	-
People	197	340	312	849	52.8
Lights	91	162	0	253	15.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	288	502	312	1,102	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-18	0	-18	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.3
Grand Total	331	874	299	1,503	100.0
RA Sensible (Lights)	104	0	0	104	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	1,208
cfm/ton	463		
ft²/ton	804		
Btu/h-ft²	14.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-314	0	-314	47.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-47	0	-47	7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	17.2
Envelope Subtotal	-109	-339	0	-453	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-211	0	-211	31.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-109	-551	0	-665	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	1,208
cfm/Mbh	-87		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	58
Cooling ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	58
Heating ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	110
Window	0
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	421
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

ROOM_Soiled Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	416	0	416	45.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	16	0	16	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	58	0	-6	52	5.6
Envelope Subtotal	58	429	-6	480	-
People	51	70	97	218	23.8
Lights	56	87	0	144	15.7
Miscellaneous Loads	12	0	0	12	1.4
Internal Subtotal	119	158	97	374	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.4
Grand Total	177	583	90	851	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.48
%OA	0	People per 1000 ft²	5
cfm/ft²	0.38	Volume (ft³)	1,161
cfm/ton	517		
ft²/ton	1,365		
Btu/h-ft²	8.79		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-215	0	-215	65.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-25	0	-25	7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-5.5
Other Floor	0	0	0	0	0.0
Infiltration	-105	0	0	-109	33.4
Envelope Subtotal	-105	-222	0	-331	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-101	-222	0	-328	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.33	No People(max)	0.48
%OA	0	People per 1000 ft²	5
cfm/ft²	0.38	Volume (ft³)	1,161
cfm/Mbh	-112		
ft²/Mbh	-295		
Btu/h-ft²	-3.39		

Cooling Airflows

Main Fan cfm	37
Cooling ACH	1.91
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	37
Heating ACH	1.91
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	508
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Staff Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3,226	0	3,226	36.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,264	0	1,264	14.3
Wall	0	277	0	277	3.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1,301	0	1,301	14.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	284	0	-93	191	2.2
Envelope Subtotal	284	6,047	-93	6,237	-
People	0	0	0	0	0.0
Lights	0	563	0	563	6.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	563	0	563	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-75	0	-75	-0.8
Grand Total	284	6,535	-93	6,725	100.0
RA Sensible (Lights)	2,116	0	0	2,116	-

Engineering Checks For Cooling

Cooling tons	0.56	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	10,720
cfm/ton	586		
ft²/ton	1,594		
Btu/h-ft²	7.53		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,921	0	-1,921	53.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-732	0	-732	20.2
Wall	0	-159	0	-159	4.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-433	0	-433	11.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	193	0	193	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-521	0	0	-546	15.1
Envelope Subtotal	-521	-3,052	0	-3,599	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	0.8
Grand Total	-521	-3,082	0	-3,628	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.63	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	10,720
cfm/Mbh	-91		
ft²/Mbh	-246		
Btu/h-ft²	-4.07		

Cooling Airflows

Main Fan cfm	328
Cooling ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	50
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	328
Heating ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	50
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	968
Other Roof	968
Ceiling	0
Window	0
Door	28
Wall	77
Below-Grade Wall	0
Other Wall	77
Partition	3,525
Exterior Floor	0
Internal Floor	0
Slab	968
Other Floor	0

ROOM_Stor.

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	72	0	72	28.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	87	0	87	34.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	9	0	-1	8	3.3
Envelope Subtotal	9	157	-1	165	-
People	8	19	15	41	16.6
Lights	8	24	0	32	12.9
Miscellaneous Loads	2	0	0	2	0.7
Internal Subtotal	18	43	15	76	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	27	199	14	240	100.0
RA Sensible (Lights)	10	0	0	10	-

Engineering Checks For Cooling

Cooling tons	0.02	No People(max)	0.07
%OA	0	People per 1000 ft²	5
cfm/ft²	0.75	Volume (ft³)	174
cfm/ton	544		
ft²/ton	727		
Btu/h-ft²	16.51		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-37	0	-37	33.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-63	0	-63	55.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	3	0	3	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-16	0	0	-17	14.7
Envelope Subtotal	-16	-96	0	-113	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	1	0	0	1	-0.6
Internal Subtotal	1	0	0	1	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-15	-96	0	-112	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.11	No People(max)	0.07
%OA	0	People per 1000 ft²	5
cfm/ft²	0.75	Volume (ft³)	174
cfm/Mbh	-97		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	11
Cooling ACH	3.78
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	11
Heating ACH	3.78
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	19
Other Roof	19
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	212
Exterior Floor	0
Internal Floor	0
Slab	19
Other Floor	0

ROOM_Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	207	0	207	31.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	73	0	73	11.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	109	0	109	16.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	31	0	-3	29	4.3
Envelope Subtotal	31	387	-3	415	-
People	27	44	52	124	18.5
Lights	30	55	0	86	12.8
Miscellaneous Loads	7	0	0	7	1.0
Internal Subtotal	64	100	52	216	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	4	0	4	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	95	489	49	634	100.0
RA Sensible (Lights)	35	0	0	35	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.26
%OA	0	People per 1000 ft²	5
cfm/ft²	0.54	Volume (ft³)	624
cfm/ton	533		
ft²/ton	985		
Btu/h-ft²	12.18		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-103	0	-103	29.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-97	0	-97	27.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	22.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	12	0	12	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-56	0	0	-59	16.9
Envelope Subtotal	-56	-266	0	-325	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-0.6
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-27	0	-27	7.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-54	-293	0	-350	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.35	No People(max)	0.26
%OA	0	People per 1000 ft²	5
cfm/ft²	0.54	Volume (ft³)	624
cfm/Mbh	-80		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	28
Cooling ACH	2.69
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	28
Heating ACH	2.69
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	1
Min Stop/RH (%)	100

Areas ft²

Roof	53
Other Roof	53
Ceiling	7
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	369
Exterior Floor	0
Internal Floor	0
Slab	60
Other Floor	0

ROOM_Toilet 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	207	0	207	17.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	153	0	153	12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-8	32	2.7
Envelope Subtotal	40	351	-8	384	-
People	131	223	207	561	46.7
Lights	60	106	0	167	13.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	191	329	207	728	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	23	0	23	1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.3
Grand Total	231	700	200	1,132	100.0
RA Sensible (Lights)	69	0	0	69	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	802
cfm/ton	476		
ft²/ton	709		
Btu/h-ft²	16.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-100	0	-100	21.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-222	0	-222	46.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-72	0	0	-76	16.0
Envelope Subtotal	-72	-306	0	-382	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-93	0	-93	19.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-72	-400	0	-476	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.48	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	802
cfm/Mbh	-94		
ft²/Mbh	-140		
Btu/h-ft²	-7.14		

Cooling Airflows

Main Fan cfm	45
Cooling ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	4
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	45
Heating ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	4
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	53
Other Roof	53
Ceiling	23
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	427
Exterior Floor	0
Interior Floor	0
Slab	76
Other Floor	0

ROOM_Toilet 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	274	0	274	28.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-8	29	3.0
Envelope Subtotal	37	210	-8	238	-
People	121	201	192	514	53.3
Lights	56	96	0	152	15.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	177	297	192	666	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.4
Grand Total	214	503	183	900	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	742
cfm/ton	460		
ft²/ton	825		
Btu/h-ft²	14.55		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-141	0	-141	62.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-25	0	-25	11.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	12	0	12	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	31.2
Envelope Subtotal	-67	-154	0	-224	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	-67	-155	0	-225	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.22	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	742
cfm/Mbh	-154		
ft²/Mbh	-276		
Btu/h-ft²	-3.62		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	2.83
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	2.83
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	408
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Toilet 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	270	0	270	27.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-8	29	2.9
Envelope Subtotal	37	217	-8	246	-
People	121	203	191	515	52.9
Lights	56	97	0	153	15.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	177	300	191	667	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.3
Grand Total	213	514	183	910	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	740
cfm/ton	462		
ft²/ton	814		
Btu/h-ft²	14.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-139	0	-139	59.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-36	0	-36	15.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	12	0	12	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	29.9
Envelope Subtotal	-67	-163	0	-233	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	-67	-163	0	-233	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.23	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	740
cfm/Mbh	-150		
ft²/Mbh	-264		
Btu/h-ft²	-3.79		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	2.84
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	2.84
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	407
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

Zone Cooling and Heating Loads by Component

ZONE_ACT-Noisy-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	503	862	0	1,365	30.4
Door	0	925	0	925	20.6
Wall	0	389	0	389	8.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-473	0	-473	-10.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	136	0	136	3.0
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-72	15	0.3
Envelope Subtotal	589	1,839	-72	2,357	-
People	377	568	719	1,664	37.1
Lights	166	280	0	445	9.9
Miscellaneous Loads	184	134	0	318	7.1
Internal Subtotal	727	982	719	2,427	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-415	0	-415	-9.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-72	0	-72	-1.6
Grand Total	1,316	2,334	647	4,296	100.0
RA Sensible (Lights)	190	0	0	190	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-266	0	0	-266	22.9
Door	0	-417	0	-417	35.9
Wall	0	-237	0	-237	20.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	111	0	111	-9.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	44	0	44	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-205	17.6
Envelope Subtotal	-460	-498	0	-969	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-176	0	-176	15.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	1.5
Grand Total	-460	-691	0	-1,162	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	196
Cooling ACH	5.45
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	196
Heating ACH	5.45
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.09	Volume (ft³)	2,156
cfm/ton	548		
ft²/ton	502		
Btu/h-ft²	23.90		

Engineering Checks For Heating

Heating Mbh	-1.16	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.09	Volume (ft³)	2,156
cfm/Mbh	-169		
ft²/Mbh	-155		
Btu/h-ft²	-6.45		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 75

ZONE_ACT-Noisy-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	319	0	319	10.8
Wall	0	78	0	78	2.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-24	0	-24	-0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-54	21	0.7
Envelope Subtotal	76	332	-54	353	-
People	380	568	723	1,671	56.4
Lights	167	281	0	447	15.1
Miscellaneous Loads	185	134	0	319	10.8
Internal Subtotal	732	982	723	2,437	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-8	0	-8	-0.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.4
Grand Total	807	1,294	669	2,771	100.0
RA Sensible (Lights)	191	0	0	191	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.61
%OA	38	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	2,170
cfm/ton	438		
ft²/ton	783		
Btu/h-ft²	15.33		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-416	0	-416	46.6
Wall	0	-123	0	-123	13.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	26	0	26	-2.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-206	23.0
Envelope Subtotal	-196	-474	0	-679	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-202	0	-202	22.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.2
Grand Total	-196	-687	0	-892	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.89	No People(max)	3.61
%OA	38	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	2,170
cfm/Mbh	-113		
ft²/Mbh	-203		
Btu/h-ft²	-4.93		

Cooling Airflows

Main Fan cfm	101
Cooling ACH	2.79
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	101
Heating ACH	2.79
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 75

ZONE_ACT-Noisy-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	99	70	0	169	5.5
Door	0	309	0	309	10.1
Wall	0	145	0	145	4.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-227	0	-227	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-46	0	-46	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-53	56	1.8
Envelope Subtotal	209	251	-53	407	-
People	382	554	729	1,666	54.6
Lights	168	274	0	441	14.5
Miscellaneous Loads	186	130	0	317	10.4
Internal Subtotal	737	958	729	2,424	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	47	0	47	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.6
Grand Total	945	1,238	676	2,859	100.0
RA Sensible (Lights)	193	0	0	193	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,186
cfm/ton	441		
ft²/ton	764		
Btu/h-ft²	15.71		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	11.0
Door	0	-384	0	-384	33.9
Wall	0	-220	0	-220	19.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	114	0	114	-10.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	18.3
Envelope Subtotal	-322	-444	0	-776	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-346	0	-346	30.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	1.1
Grand Total	-322	-803	0	-1,134	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.13	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,186
cfm/Mbh	-93		
ft²/Mbh	-161		
Btu/h-ft²	-6.21		

Cooling Airflows

Main Fan cfm	105
Cooling ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	105
Heating ACH	2.88
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²

Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 75

ZONE_ACT-Quiet-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 53.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	15	0	15	0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-59	18	0.9
Envelope Subtotal	77	-12	-59	6	-
People	274	416	521	1,211	62.5
Lights	120	206	0	326	16.8
Miscellaneous Loads	133	98	0	231	11.9
Internal Subtotal	527	720	521	1,769	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	31	0	31	1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	604	735	462	1,802	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.60
%OA	46	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/ton	400		
ft²/ton	868		
Btu/h-ft²	13.82		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-70	0	-70	19.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-6.5
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	40.7
Envelope Subtotal	-141	-46	0	-194	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-170	0	-170	46.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-141	-216	0	-364	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	2.60
%OA	46	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/Mbh	-165		
ft²/Mbh	-358		
Btu/h-ft²	-2.79		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 75

ZONE_ACT-Quiet-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	230	289	0	519	21.6
Door	0	0	0	0	0.0
Wall	0	92	0	92	3.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	-2.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-60	17	0.7
Envelope Subtotal	307	317	-60	564	-
People	274	428	523	1,225	51.1
Lights	120	211	0	331	13.8
Miscellaneous Loads	134	101	0	234	9.8
Internal Subtotal	528	739	523	1,790	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-79	0	-79	-3.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.7
Grand Total	835	961	463	2,259	100.0
RA Sensible (Lights)	138	0	0	138	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-130	0	0	-130	23.5
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	12.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-67	0	-67	12.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-149	26.8
Envelope Subtotal	-271	-111	0	-389	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-161	0	-161	29.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.6
Grand Total	-271	-275	0	-554	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	86
Cooling ACH	3.29
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	86
Heating ACH	3.29
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	2.61
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	1,568
cfm/ton	459		
ft²/ton	694		
Btu/h-ft²	17.29		

Engineering Checks For Heating

Heating Mbh	-0.55	No People(max)	2.61
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	1,568
cfm/Mbh	-156		
ft²/Mbh	-236		
Btu/h-ft²	-4.24		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 75

ZONE_ACT-Quiet-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	401	0	401	17.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-53	0	-53	-2.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-32	0	-32	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-38	17	0.7
Envelope Subtotal	55	316	-38	333	-
People	275	432	524	1,232	55.0
Lights	121	214	0	334	14.9
Miscellaneous Loads	134	102	0	236	10.5
Internal Subtotal	530	748	524	1,802	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-28	0	-28	-1.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	585	1,031	486	2,102	100.0
RA Sensible (Lights)	139	0	0	139	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	2.62
%OA	35	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,573
cfm/ton	444		
ft²/ton	749		
Btu/h-ft²	16.02		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-225	0	-225	42.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-24	0	-24	4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	28.2
Envelope Subtotal	-142	-221	0	-370	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-158	0	-158	29.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-142	-380	0	-529	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.53	No People(max)	2.62
%OA	35	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	1,573
cfm/Mbh	-147		
ft²/Mbh	-248		
Btu/h-ft²	-4.03		

Cooling Airflows

Main Fan cfm	78
Cooling ACH	2.97
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	78
Heating ACH	2.97
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 75

ZONE_Admin

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-105	0	-105	-3.6
Other Roof	0	0	0	0	0.0
Glass	459	1,037	0	1,495	51.1
Door	0	0	0	0	0.0
Wall	0	512	0	512	17.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-225	0	-225	-7.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-79	0	-79	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-111	-46	-1.6
Envelope Subtotal	524	1,139	-111	1,552	-
People	199	273	379	850	29.1
Lights	122	188	0	310	10.6
Miscellaneous Loads	97	0	0	97	3.3
Internal Subtotal	418	460	379	1,257	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-24	0	-24	-0.8
Grand Total	942	1,576	267	2,785	100.0
RA Sensible (Lights)	140	0	0	140	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.89
%OA	17	People per 1000 ft²	10
cfm/ft²	0.64	Volume (ft³)	2,272
cfm/ton	522		
ft²/ton	816		
Btu/h-ft²	14.71		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-221	0	-221	23.5
Other Roof	0	0	0	0	0.0
Glass	-264	0	0	-264	28.0
Door	0	0	0	0	0.0
Wall	0	-352	0	-352	37.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	41	0	41	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-205	0	0	-215	22.8
Envelope Subtotal	-469	-488	0	-968	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	32	0	0	32	-3.4
Internal Subtotal	32	0	0	32	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.8
Grand Total	-437	-495	0	-943	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.94	No People(max)	1.89
%OA	17	People per 1000 ft²	10
cfm/ft²	0.64	Volume (ft³)	2,272
cfm/Mbh	-128		
ft²/Mbh	-201		
Btu/h-ft²	-4.98		

Cooling Airflows

Main Fan cfm	121
Cooling ACH	3.20
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	121
Heating ACH	3.20
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 75

ZONE_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	900	0	900	9.6
Other Roof	0	0	0	0	0.0
Glass	895	1,163	0	2,058	21.9
Door	0	0	0	0	0.0
Wall	0	1,659	0	1,659	17.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	-0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-102	0	-102	-1.1
Slab	0	23	0	23	0.2
Other Floor	0	0	0	0	0.0
Infiltration	619	0	-193	426	4.5
Envelope Subtotal	1,514	3,560	-193	4,881	-
People	621	825	982	2,428	25.8
Lights	700	962	0	1,662	17.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	1,321	1,787	982	4,090	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-336	0	-336	-3.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-45	0	-45	-0.5
Grand Total	2,834	4,966	789	8,590	100.0
RA Sensible (Lights)	804	0	0	804	-

Engineering Checks For Cooling

Cooling tons	0.72	No People(max)	6.33
%OA	29	People per 1000 ft²	5
cfm/ft²	0.30	Volume (ft³)	15,043
cfm/ton	524		
ft²/ton	1,770		
Btu/h-ft²	6.78		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 82.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-747	0	-747	15.0
Other Roof	0	0	0	0	0.0
Glass	-1,062	0	0	-1,062	21.4
Door	0	0	0	0	0.0
Wall	0	-1,740	0	-1,740	35.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-119	0	-119	2.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	88	0	88	-1.8
Slab	0	98	0	98	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	-1,359	0	0	-1,424	28.7
Envelope Subtotal	-2,421	-2,419	0	-4,905	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-33	0	-33	0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	0.6
Grand Total	-2,421	-2,479	0	-4,965	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-4.97	No People(max)	6.33
%OA	29	People per 1000 ft²	5
cfm/ft²	0.30	Volume (ft³)	15,043
cfm/Mbh	-76		
ft²/Mbh	-255		
Btu/h-ft²	-3.92		

Cooling Airflows

Main Fan cfm	375
Cooling ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	375
Heating ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100

Areas ft²

Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 75

ZONE_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	19	0	19	1.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	80	0	80	4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-48	12	0.7
Envelope Subtotal	60	89	-48	101	-
People	210	275	399	884	47.0
Lights	129	190	0	319	17.0
Miscellaneous Loads	341	0	0	341	18.1
Internal Subtotal	679	466	399	1,544	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	90	0	90	4.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.1
Grand Total	739	642	351	1,732	100.0
RA Sensible (Lights)	148	0	0	148	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.00
%OA	33	People per 1000 ft²	10
cfm/ft²	0.33	Volume (ft³)	2,395
cfm/ton	460		
ft²/ton	1,382		
Btu/h-ft²	8.68		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-21	0	-21	5.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	23.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	35	0	35	-8.4
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-227	55.4
Envelope Subtotal	-216	-83	0	-310	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-8.3
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-133	0	-133	32.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-182	-217	0	-409	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.41	No People(max)	2.00
%OA	33	People per 1000 ft²	10
cfm/ft²	0.33	Volume (ft³)	2,395
cfm/Mbh	-162		
ft²/Mbh	-488		
Btu/h-ft²	-2.05		

Cooling Airflows

Main Fan cfm	66
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	66
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Interior Floor	0
Slab	214
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 9 of 75

ZONE_Comfort/Consult

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	384	0	384	9.6
Other Roof	0	0	0	0	0.0
Glass	219	163	0	382	9.5
Door	0	0	0	0	0.0
Wall	0	373	0	373	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-264	0	-264	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-34	0	-34	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	219	622	0	841	-
People	298	411	567	1,275	31.8
Lights	313	486	0	799	19.9
Miscellaneous Loads	435	290	0	725	18.1
Internal Subtotal	1,046	1,187	567	2,800	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	24	0	24	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.4
Grand Total	1,266	1,815	567	3,648	100.0
RA Sensible (Lights)	360	0	0	360	-

Engineering Checks For Cooling

Cooling tons	0.30	No People(max)	2.83
%OA	49	People per 1000 ft²	10
cfm/ft²	0.52	Volume (ft³)	3,402
cfm/ton	488		
ft²/ton	932		
Btu/h-ft²	12.88		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-285	0	-285	24.2
Other Roof	0	0	0	0	0.0
Glass	-399	0	0	-399	33.9
Door	0	0	0	0	0.0
Wall	0	-526	0	-526	44.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	99	0	99	-8.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	62	0	62	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-399	-649	0	-1,048	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-117	0	-117	9.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.0
Grand Total	-399	-778	0	-1,176	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.18	No People(max)	2.83
%OA	49	People per 1000 ft²	10
cfm/ft²	0.52	Volume (ft³)	3,402
cfm/Mbh	-126		
ft²/Mbh	-241		
Btu/h-ft²	-4.15		

Cooling Airflows

Main Fan cfm	148
Cooling ACH	2.61
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	148
Heating ACH	2.61
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 10 of 75

ZONE_Corridor-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 6/21 18:00:00
 Outside DB / WB / HR 87.4 °F / 61.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	868	804	0	1,672	62.2
Door	0	0	0	0	0.0
Wall	0	39	0	39	1.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	307	0	307	11.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	115	0	115	4.3
Other Floor	0	0	0	0	0.0
Infiltration	70	0	-34	36	1.4
Envelope Subtotal	939	1,265	-34	2,169	-
People	0	0	0	0	0.0
Lights	151	235	0	385	14.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	151	235	0	385	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-22	0	-22	-0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.7
Grand Total	1,089	1,458	-34	2,513	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	0.00
%OA	20	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	4,909
cfm/ton	586		
ft²/ton	1,953		
Btu/h-ft²	6.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,037	0	0	-1,037	60.2
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	3.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	20	0	20	-1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-5.4
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	14.5
Envelope Subtotal	-1,275	50	0	-1,237	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-458	0	-458	26.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	1.6
Grand Total	-1,275	-436	0	-1,724	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.72	No People(max)	0.00
%OA	20	People per 1000 ft²	0
cfm/ft²	0.30	Volume (ft³)	4,909
cfm/Mbh	-71		
ft²/Mbh	-237		
Btu/h-ft²	-4.22		

Cooling Airflows

Main Fan cfm	123
Cooling ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	123
Heating ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 11 of 75

ZONE_Corridor-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 37.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,943	3,850	0	5,793	112.9
Door	0	0	0	0	0.0
Wall	0	101	0	101	2.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-435	0	-435	-8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	74	0	74	1.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-93	-17	-0.3
Envelope Subtotal	2,020	3,590	-93	5,517	-
People	0	0	0	0	0.0
Lights	153	236	0	389	7.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	153	236	0	389	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-859	0	-859	-16.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-93	0	-93	-1.8
Grand Total	2,172	2,875	-93	4,954	100.0
RA Sensible (Lights)	175	0	0	175	-

Engineering Checks For Cooling

Cooling tons	0.41	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	4,967
cfm/ton	589		
ft²/ton	1,003		
Btu/h-ft²	11.96		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,012	0	0	-1,012	60.0
Door	0	0	0	0	0.0
Wall	0	-65	0	-65	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	29	0	29	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-5.5
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-254	15.0
Envelope Subtotal	-1,253	56	0	-1,210	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-450	0	-450	26.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.6
Grand Total	-1,253	-421	0	-1,687	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.69	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.59	Volume (ft³)	4,967
cfm/Mbh	-144		
ft²/Mbh	-245		
Btu/h-ft²	-4.08		

Cooling Airflows

Main Fan cfm	243
Cooling ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	243
Heating ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 12 of 75

ZONE_Corridor-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,199	3,541	0	5,739	101.4
Door	0	0	0	0	0.0
Wall	0	103	0	103	1.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-608	0	-608	-10.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	878	0	878	15.5
Other Floor	0	0	0	0	0.0
Infiltration	86	0	-1	85	1.5
Envelope Subtotal	2,285	3,913	-1	6,197	-
People	0	0	0	0	0.0
Lights	119	195	0	315	5.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	119	195	0	315	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-868	0	-868	-15.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-119	0	-119	-2.1
Grand Total	2,404	3,121	-1	5,524	100.0
RA Sensible (Lights)	137	0	0	137	-

Engineering Checks For Cooling

Cooling tons	0.46	No People(max)	0.00
%OA	7	People per 1000 ft²	0
cfm/ft²	0.82	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	704		
Btu/h-ft²	17.05		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,010	0	0	-1,010	65.4
Door	0	0	0	0	0.0
Wall	0	-61	0	-61	4.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	32	0	32	-2.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	76	0	76	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-199	12.9
Envelope Subtotal	-1,199	47	0	-1,162	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-355	0	-355	23.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.7
Grand Total	-1,199	-335	0	-1,544	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.54	No People(max)	0.00
%OA	7	People per 1000 ft²	0
cfm/ft²	0.82	Volume (ft³)	3,888
cfm/Mbh	-172		
ft²/Mbh	-210		
Btu/h-ft²	-4.76		

Cooling Airflows

Main Fan cfm	266
Cooling ACH	4.11
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	266
Heating ACH	4.11
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 13 of 75

ZONE_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-117	0	-117	-0.8
Other Roof	0	0	0	0	0.0
Glass	5,180	11,666	0	16,846	111.1
Door	0	37	0	37	0.2
Wall	0	300	0	300	2.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,542	0	-1,542	-10.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	648	0	648	4.3
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-19	46	0.3
Envelope Subtotal	5,245	10,993	-19	16,219	-
People	182	233	287	702	4.6
Lights	205	266	0	471	3.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	386	499	287	1,172	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-2,173	0	-2,173	-14.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-294	0	-294	-1.9
Grand Total	5,632	9,025	268	14,924	100.0
RA Sensible (Lights)	235	0	0	235	-

Engineering Checks For Cooling

Cooling tons	1.24	No People(max)	1.85
%OA	4	People per 1000 ft²	5
cfm/ft²	1.91	Volume (ft³)	4,445
cfm/ton	567		
ft²/ton	298		
Btu/h-ft²	40.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.3 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-53	0	-53	1.0
Other Roof	0	0	0	0	0.0
Glass	-3,604	0	0	-3,604	68.3
Door	0	-473	0	-473	9.0
Wall	0	-536	0	-536	10.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	571	0	571	-10.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	147	0	147	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	8.0
Envelope Subtotal	-4,005	-344	0	-4,369	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-828	0	-828	15.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-82	0	-82	1.6
Grand Total	-4,005	-1,253	0	-5,279	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-5.28	No People(max)	1.85
%OA	4	People per 1000 ft²	5
cfm/ft²	1.91	Volume (ft³)	4,445
cfm/Mbh	-134		
ft²/Mbh	-70		
Btu/h-ft²	-14.29		

Cooling Airflows

Main Fan cfm	706
Cooling ACH	9.53
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	706
Heating ACH	9.53
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 14 of 75

ZONE_Exam/Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 47.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	369	0	369	17.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	-2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	30	0	-21	9	0.4
Envelope Subtotal	30	307	-21	316	-
People	182	244	347	773	36.7
Lights	182	275	0	458	21.7
Miscellaneous Loads	232	122	0	354	16.8
Internal Subtotal	596	642	347	1,585	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	627	945	325	1,898	100.0
RA Sensible (Lights)	209	0	0	209	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.73
%OA	49	People per 1000 ft²	8
cfm/ft²	0.34	Volume (ft³)	2,685
cfm/ton	478		
ft²/ton	1,415		
Btu/h-ft²	8.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-265	0	-265	65.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-70	0	-70	17.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-9.5
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-115	28.1
Envelope Subtotal	-109	-297	0	-412	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.1
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-105	-297	0	-408	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.41	No People(max)	1.73
%OA	49	People per 1000 ft²	8
cfm/ft²	0.34	Volume (ft³)	2,685
cfm/Mbh	-186		
ft²/Mbh	-549		
Btu/h-ft²	-1.82		

Cooling Airflows

Main Fan cfm	76
Cooling ACH	1.70
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	76
Heating ACH	1.70
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Interior Floor	0
Slab	246
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 15 of 75

ZONE_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	237	0	237	5.5
Other Roof	0	0	0	0	0.0
Glass	164	128	0	293	6.8
Door	0	0	0	0	0.0
Wall	0	296	0	296	6.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-201	0	-201	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	116	0	-74	42	1.0
Envelope Subtotal	280	432	-74	638	-
People	553	800	1,106	2,458	56.7
Lights	191	290	0	481	11.1
Miscellaneous Loads	283	184	0	467	10.8
Internal Subtotal	1,027	1,274	1,106	3,406	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	89	0	89	2.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.5
Grand Total	1,307	1,774	1,032	4,113	100.0
RA Sensible (Lights)	219	0	0	219	-

Engineering Checks For Cooling

Cooling tons	0.34	No People(max)	5.52
%OA	63	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	3,317
cfm/ton	420		
ft²/ton	807		
Btu/h-ft²	14.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-149	0	-149	9.8
Other Roof	0	0	0	0	0.0
Glass	-269	0	0	-269	17.7
Door	0	0	0	0	0.0
Wall	0	-469	0	-469	31.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	102	0	102	-6.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	69	0	69	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	20.7
Envelope Subtotal	-568	-447	0	-1,030	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-476	0	-476	31.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.6
Grand Total	-568	-932	0	-1,515	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.51	No People(max)	5.52
%OA	63	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	3,317
cfm/Mbh	-95		
ft²/Mbh	-182		
Btu/h-ft²	-5.49		

Cooling Airflows

Main Fan cfm	144
Cooling ACH	2.60
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	144
Heating ACH	2.60
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 16 of 75

ZONE_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	160	0	160	4.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	313	0	313	7.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	144	0	144	3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-65	72	1.8
Envelope Subtotal	137	593	-65	665	-
People	492	685	984	2,161	54.8
Lights	170	257	0	427	10.8
Miscellaneous Loads	252	163	0	415	10.5
Internal Subtotal	914	1,105	984	3,003	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	89	0	89	2.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.2
Grand Total	1,051	1,779	919	3,749	100.0
RA Sensible (Lights)	195	0	0	195	-

Engineering Checks For Cooling

Cooling tons	0.31	No People(max)	4.92
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,953
cfm/ton	432		
ft²/ton	788		
Btu/h-ft²	15.23		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-130	0	-130	9.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-440	0	-440	32.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-124	0	-124	9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-280	20.9
Envelope Subtotal	-266	-633	0	-913	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-422	0	-422	31.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.1
Grand Total	-266	-1,057	0	-1,337	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.34	No People(max)	4.92
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	2,953
cfm/Mbh	-101		
ft²/Mbh	-184		
Btu/h-ft²	-5.43		

Cooling Airflows

Main Fan cfm	135
Cooling ACH	2.74
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	135
Heating ACH	2.74
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 17 of 75

ZONE_Intake-HR-A

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	126	0	126	2.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	823	0	823	14.5
Wall	0	789	0	789	13.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-158	0	-158	-2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	96	0	-61	35	0.6
Envelope Subtotal	96	1,553	-61	1,588	-
People	404	558	720	1,681	29.7
Lights	354	533	0	887	15.7
Miscellaneous Loads	362	233	0	595	10.5
Internal Subtotal	1,121	1,323	720	3,163	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	46	0	46	0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	494	0	0	494	8.7
Time Delay Correction	0	-35	0	-35	-0.6
Grand Total	1,711	2,887	658	5,256	100.0
RA Sensible (Lights)	407	0	0	407	-

Engineering Checks For Cooling

Cooling tons	0.44	No People(max)	3.96
%OA	31	People per 1000 ft²	8
cfm/ft²	0.47	Volume (ft³)	5,646
cfm/ton	505		
ft²/ton	1,074		
Btu/h-ft²	11.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-457	0	-457	20.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-498	0	-498	22.2
Wall	0	-729	0	-729	32.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	-1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	102	0	102	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-177	0	0	-186	8.3
Envelope Subtotal	-177	-1,557	0	-1,743	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-243	0	-243	10.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-240	0	0	-240	10.7
Time Delay Correction	0	-16	0	-16	0.7
Grand Total	-417	-1,815	0	-2,241	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.24	No People(max)	3.96
%OA	31	People per 1000 ft²	8
cfm/ft²	0.47	Volume (ft³)	5,646
cfm/Mbh	-99		
ft²/Mbh	-210		
Btu/h-ft²	-4.76		

Cooling Airflows

Main Fan cfm	221
Cooling ACH	2.35
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	221
Heating ACH	2.35
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	0
Door	26
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

ZONE_Intake-HR-B

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 47.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	273	0	273	17.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	27	0	27	1.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2	0	-2	-0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	24	0	-16	8	0.5
Envelope Subtotal	24	288	-16	296	-
People	130	181	248	559	35.3
Lights	130	202	0	332	21.0
Miscellaneous Loads	163	86	0	249	15.7
Internal Subtotal	423	469	248	1,141	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	448	755	232	1,435	100.0
RA Sensible (Lights)	149	0	0	149	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	1.24
%OA	45	People per 1000 ft²	8
cfm/ft²	0.35	Volume (ft³)	1,976
cfm/ton	484		
ft²/ton	1,377		
Btu/h-ft²	8.71		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-198	0	-198	51.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-48	0	-48	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-78	0	-78	20.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-7.8
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-92	24.0
Envelope Subtotal	-88	-294	0	-386	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-0.9
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-84	-294	0	-383	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.38	No People(max)	1.24
%OA	45	People per 1000 ft²	8
cfm/ft²	0.35	Volume (ft³)	1,976
cfm/Mbh	-151		
ft²/Mbh	-430		
Btu/h-ft²	-2.33		

Cooling Airflows

Main Fan cfm	58
Cooling ACH	1.76
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	58
Heating ACH	1.76
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²

Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 19 of 75

ZONE_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,094	0	1,094	3.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,174	0	1,174	3.7
Wall	0	1,238	0	1,238	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,389	0	-1,389	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-378	0	-378	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	373	0	-215	159	0.5
Envelope Subtotal	373	1,739	-215	1,898	-
People	1,375	1,906	3,197	6,478	20.3
Lights	365	570	0	935	2.9
Miscellaneous Loads	13,334	8,899	0	22,233	69.7
Internal Subtotal	15,074	11,375	3,197	29,646	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-49	0	-49	-0.2
Grand Total	15,447	13,065	2,983	31,495	100.0
RA Sensible (Lights)	419	0	0	419	-

Engineering Checks For Cooling

Cooling tons	2.62	No People(max)	13.10
%OA	0	People per 1000 ft²	19
cfm/ft²	3.69	Volume (ft³)	8,226
cfm/ton	965		
ft²/ton	261		
Btu/h-ft²	45.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-760	0	-760	21.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-966	0	-966	27.4
Wall	0	-964	0	-964	27.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-205	0	-205	5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	163	0	163	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-742	0	0	-780	22.1
Envelope Subtotal	-742	-2,732	0	-3,513	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.4
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	0.7
Grand Total	-729	-2,759	0	-3,526	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.53	No People(max)	13.10
%OA	0	People per 1000 ft²	19
cfm/ft²	3.69	Volume (ft³)	8,226
cfm/Mbh	-718		
ft²/Mbh	-194		
Btu/h-ft²	-5.15		

Cooling Airflows

Main Fan cfm	2,532
Cooling ACH	18.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	18
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,532
Heating ACH	18.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	18
Min Stop/RH (%)	100

Areas

	ft²
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 20 of 75

ZONE_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 56.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-45	0	-45	-0.8
Other Roof	0	0	0	0	0.0
Glass	428	962	0	1,389	24.6
Door	0	798	0	798	14.2
Wall	0	590	0	590	10.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-354	0	-354	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-114	0	-114	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	112	0	-207	-95	-1.7
Envelope Subtotal	540	1,836	-207	2,169	-
People	589	841	1,098	2,529	44.9
Lights	182	273	0	456	8.1
Miscellaneous Loads	202	131	0	333	5.9
Internal Subtotal	974	1,245	1,098	3,317	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-59	0	-59	-1.0
Grand Total	1,514	3,022	891	5,427	100.0
RA Sensible (Lights)	209	0	0	209	-

Engineering Checks For Cooling

Cooling tons	0.45	No People(max)	5.93
%OA	27	People per 1000 ft²	20
cfm/ft²	0.80	Volume (ft³)	3,561
cfm/ton	526		
ft²/ton	656		
Btu/h-ft²	18.29		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-340	0	-340	21.6
Other Roof	0	0	0	0	0.0
Glass	-266	0	0	-266	16.9
Door	0	-402	0	-402	25.6
Wall	0	-376	0	-376	23.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	100	0	100	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	66	0	66	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-321	0	0	-338	21.5
Envelope Subtotal	-587	-952	0	-1,555	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	1.1
Grand Total	-587	-969	0	-1,572	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.57	No People(max)	5.93
%OA	27	People per 1000 ft²	20
cfm/ft²	0.80	Volume (ft³)	3,561
cfm/Mbh	-151		
ft²/Mbh	-189		
Btu/h-ft²	-5.29		

Cooling Airflows

Main Fan cfm	238
Cooling ACH	4.01
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	238
Heating ACH	4.01
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	16
Door	21
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 21 of 75

ZONE_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 54.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	385	0	385	5.2
Other Roof	0	0	0	0	0.0
Glass	256	188	0	444	5.9
Door	0	275	0	275	3.7
Wall	0	333	0	333	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-321	0	-321	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	269	0	-128	141	1.9
Envelope Subtotal	525	806	-128	1,202	-
People	971	1,280	1,942	4,192	56.1
Lights	335	479	0	814	10.9
Miscellaneous Loads	497	305	0	802	10.7
Internal Subtotal	1,803	2,064	1,942	5,808	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	111	0	111	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-38	0	-38	-0.5
Grand Total	2,328	2,942	1,813	7,084	100.0
RA Sensible (Lights)	385	0	0	385	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-270	0	-270	10.5
Other Roof	0	0	0	0	0.0
Glass	-404	0	0	-404	15.6
Door	0	-415	0	-415	16.1
Wall	0	-470	0	-470	18.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	191	0	191	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	126	0	126	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-552	21.4
Envelope Subtotal	-929	-838	0	-1,794	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-765	0	-765	29.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	0.9
Grand Total	-929	-1,626	0	-2,582	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	242
Cooling ACH	2.49
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	242
Heating ACH	2.49
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.59	No People(max)	9.70
%OA	66	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	5,825
cfm/ton	409		
ft²/ton	822		
Btu/h-ft²	14.60		

Engineering Checks For Heating

Heating Mbh	-2.58	No People(max)	9.70
%OA	66	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	5,825
cfm/Mbh	-94		
ft²/Mbh	-188		
Btu/h-ft²	-5.32		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 22 of 75

ZONE_RB-N-Corner

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	288	611	0	900	28.5
Door	0	0	0	0	0.0
Wall	0	539	0	539	17.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-146	0	-146	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	0.2
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-34	20	0.6
Envelope Subtotal	343	1,012	-34	1,321	-
People	151	219	359	728	23.1
Lights	144	254	0	398	12.6
Miscellaneous Loads	356	405	0	761	24.1
Internal Subtotal	651	878	359	1,887	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-197	0	-197	-6.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.6
Grand Total	994	1,673	324	2,991	100.0
RA Sensible (Lights)	166	0	0	166	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	1.30
%OA	9	People per 1000 ft²	10
cfm/ft²	1.19	Volume (ft³)	1,565
cfm/ton	624		
ft²/ton	523		
Btu/h-ft²	22.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-178	0	0	-178	20.3
Door	0	0	0	0	0.0
Wall	0	-485	0	-485	55.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	41	0	41	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	17.0
Envelope Subtotal	-319	-411	0	-737	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-132	0	-132	15.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.5
Grand Total	-319	-548	0	-874	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	1.30
%OA	9	People per 1000 ft²	10
cfm/ft²	1.19	Volume (ft³)	1,565
cfm/Mbh	-178		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	155
Cooling ACH	5.94
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	155
Heating ACH	5.94
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Interior Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 23 of 75

ZONE_RB-N-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.0
Other Roof	0	0	0	0	0.0
Glass	540	1,088	0	1,628	29.7
Door	0	0	0	0	0.0
Wall	0	625	0	625	11.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-230	0	-230	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-80	0	-80	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	80	0	-68	11	0.2
Envelope Subtotal	620	1,401	-68	1,953	-
People	297	309	707	1,312	23.9
Lights	284	429	0	713	13.0
Miscellaneous Loads	702	683	0	1,385	25.2
Internal Subtotal	1,283	1,420	707	3,410	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-166	0	-166	-3.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-34	0	-34	-0.6
Grand Total	1,902	2,622	638	5,163	100.0
RA Sensible (Lights)	326	0	0	326	-

Engineering Checks For Cooling

Cooling tons	0.43	No People(max)	2.57
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	3,084
cfm/ton	595		
ft²/ton	598		
Btu/h-ft²	20.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3	0	-3	0.2
Other Roof	0	0	0	0	0.0
Glass	-351	0	0	-351	22.8
Door	0	0	0	0	0.0
Wall	0	-692	0	-692	44.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-278	0	0	-293	19.0
Envelope Subtotal	-630	-595	0	-1,239	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-293	0	-293	19.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.6
Grand Total	-630	-897	0	-1,541	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.54	No People(max)	2.57
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	3,084
cfm/Mbh	-166		
ft²/Mbh	-167		
Btu/h-ft²	-5.99		

Cooling Airflows

Main Fan cfm	256
Cooling ACH	4.98
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	256
Heating ACH	4.98
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 24 of 75

ZONE_RB-N-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,023	1,799	0	2,822	31.7
Door	0	0	0	0	0.0
Wall	0	953	0	953	10.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-555	0	-555	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	203	0	203	2.3
Other Floor	0	0	0	0	0.0
Infiltration	189	0	-102	87	1.0
Envelope Subtotal	1,212	2,399	-102	3,510	-
People	442	630	1,052	2,124	23.8
Lights	423	752	0	1,175	13.2
Miscellaneous Loads	1,044	1,197	0	2,241	25.1
Internal Subtotal	1,909	2,579	1,052	5,540	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-550	0	-550	-6.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-68	0	-68	-0.8
Grand Total	3,121	4,360	950	8,431	100.0
RA Sensible (Lights)	486	0	0	486	-

Engineering Checks For Cooling

Cooling tons	0.70	No People(max)	3.83
%OA	10	People per 1000 ft²	10
cfm/ft²	1.15	Volume (ft³)	4,590
cfm/ton	628		
ft²/ton	545		
Btu/h-ft²	22.02		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-549	0	0	-549	27.8
Door	0	0	0	0	0.0
Wall	0	-605	0	-605	30.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-24	0	-24	1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	84	0	84	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-435	22.0
Envelope Subtotal	-963	-544	0	-1,529	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-432	0	-432	21.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.7
Grand Total	-963	-991	0	-1,975	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.98	No People(max)	3.83
%OA	10	People per 1000 ft²	10
cfm/ft²	1.15	Volume (ft³)	4,590
cfm/Mbh	-224		
ft²/Mbh	-194		
Btu/h-ft²	-5.15		

Cooling Airflows

Main Fan cfm	442
Cooling ACH	5.78
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	442
Heating ACH	5.78
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

ZONE_RB-S-Corner-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	517	0	789	28.9
Door	0	0	0	0	0.0
Wall	0	287	0	287	10.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-83	0	-83	-3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-34	6	0.2
Envelope Subtotal	313	694	-34	972	-
People	149	153	355	657	24.1
Lights	143	215	0	358	13.1
Miscellaneous Loads	352	343	0	695	25.5
Internal Subtotal	644	711	355	1,710	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-100	0	-100	-3.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	957	1,288	321	2,565	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,549
cfm/ton	591		
ft²/ton	604		
Btu/h-ft²	19.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-171	0	0	-171	19.9
Door	0	0	0	0	0.0
Wall	0	-489	0	-489	56.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	46	0	46	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	17.0
Envelope Subtotal	-311	-411	0	-729	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-129	0	-129	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-311	-544	0	-862	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,549
cfm/Mbh	-146		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	126
Cooling ACH	4.88
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	126
Heating ACH	4.88
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 26 of 75

ZONE_RB-S-Corner-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	299	562	0	861	26.2
Door	0	0	0	0	0.0
Wall	0	726	0	726	22.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-142	0	-142	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	1.3
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-47	17	0.5
Envelope Subtotal	362	1,188	-47	1,504	-
People	152	213	361	726	22.1
Lights	145	255	0	400	12.2
Miscellaneous Loads	358	406	0	764	23.3
Internal Subtotal	655	874	361	1,890	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-255	0	-255	-7.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.6
Grand Total	1,017	1,787	314	3,119	100.0
RA Sensible (Lights)	167	0	0	167	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	1.31
%OA	11	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/ton	519		
ft²/ton	505		
Btu/h-ft²	23.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-178	0	0	-178	20.2
Door	0	0	0	0	0.0
Wall	0	-491	0	-491	55.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	42	0	42	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	17.0
Envelope Subtotal	-320	-416	0	-743	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-131	0	-131	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.5
Grand Total	-320	-551	0	-878	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	1.31
%OA	11	People per 1000 ft²	10
cfm/ft²	1.03	Volume (ft³)	1,575
cfm/Mbh	-154		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	135
Cooling ACH	5.14
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	135
Heating ACH	5.14
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 27 of 75

ZONE_RB-S-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	806	1,548	0	2,354	30.1
Door	0	0	0	0	0.0
Wall	0	668	0	668	8.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-291	0	-291	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-86	0	-86	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	115	0	-99	17	0.2
Envelope Subtotal	921	1,839	-99	2,662	-
People	430	454	1,023	1,906	24.4
Lights	411	630	0	1,041	13.3
Miscellaneous Loads	1,015	1,003	0	2,018	25.8
Internal Subtotal	1,856	2,087	1,023	4,965	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-230	0	-230	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-50	0	-50	-0.6
Grand Total	2,777	3,645	924	7,346	100.0
RA Sensible (Lights)	472	0	0	472	-

Engineering Checks For Cooling

Cooling tons	0.61	No People(max)	3.72
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	4,463
cfm/ton	589		
ft²/ton	608		
Btu/h-ft²	19.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-525	0	0	-525	28.5
Door	0	0	0	0	0.0
Wall	0	-527	0	-527	28.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-12	0	-12	0.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	81	0	81	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-403	0	0	-423	23.0
Envelope Subtotal	-928	-458	0	-1,406	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-421	0	-421	22.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	0.7
Grand Total	-928	-893	0	-1,841	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.84	No People(max)	3.72
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	4,463
cfm/Mbh	-196		
ft²/Mbh	-202		
Btu/h-ft²	-4.95		

Cooling Airflows

Main Fan cfm	361
Cooling ACH	4.85
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	361
Heating ACH	4.85
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 28 of 75

ZONE_RB-S-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	347	596	0	943	32.9
Door	0	0	0	0	0.0
Wall	0	313	0	313	10.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-235	0	-235	-8.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	72	0	72	2.5
Other Floor	0	0	0	0	0.0
Infiltration	61	0	-33	28	1.0
Envelope Subtotal	408	746	-33	1,122	-
People	143	205	341	689	24.0
Lights	137	245	0	382	13.3
Miscellaneous Loads	338	390	0	729	25.4
Internal Subtotal	619	840	341	1,800	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-188	0	-188	-6.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.8
Grand Total	1,027	1,375	308	2,710	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.24
%OA	10	People per 1000 ft²	10
cfm/ft²	1.14	Volume (ft³)	1,488
cfm/ton	625		
ft²/ton	549		
Btu/h-ft²	21.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-180	0	0	-180	27.8
Door	0	0	0	0	0.0
Wall	0	-198	0	-198	30.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	21.9
Envelope Subtotal	-314	-181	0	-501	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-139	0	-139	21.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.7
Grand Total	-314	-324	0	-645	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.64	No People(max)	1.24
%OA	10	People per 1000 ft²	10
cfm/ft²	1.14	Volume (ft³)	1,488
cfm/Mbh	-219		
ft²/Mbh	-192		
Btu/h-ft²	-5.21		

Cooling Airflows

Main Fan cfm	141
Cooling ACH	5.69
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	141
Heating ACH	5.69
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

ZONE_RB-W-North

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	231	193	0	424	15.2
Door	0	0	0	0	0.0
Wall	0	602	0	602	21.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-115	0	-115	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-15	0	-15	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-34	20	0.7
Envelope Subtotal	285	665	-34	916	-
People	150	214	357	721	25.9
Lights	143	248	0	391	14.0
Miscellaneous Loads	354	395	0	749	26.9
Internal Subtotal	648	856	357	1,861	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-139	0	-139	-5.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-0.7
Grand Total	933	1,364	323	2,620	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	1,557
cfm/ton	593		
ft²/ton	595		
Btu/h-ft²	20.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-299	0	0	-299	31.3
Door	0	0	0	0	0.0
Wall	0	-468	0	-468	49.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	63	0	63	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	15.5
Envelope Subtotal	-439	-372	0	-818	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-127	0	-127	13.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.8
Grand Total	-439	-507	0	-953	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	1.00	Volume (ft³)	1,557
cfm/Mbh	-136		
ft²/Mbh	-136		
Btu/h-ft²	-7.35		

Cooling Airflows

Main Fan cfm	129
Cooling ACH	4.97
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	129
Heating ACH	4.97
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 30 of 75

ZONE_RB-W-South

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,466	3,208	0	4,674	47.6
Door	0	0	0	0	0.0
Wall	0	1,033	0	1,033	10.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-429	0	-429	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-312	0	-312	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	143	0	-220	-77	-0.8
Envelope Subtotal	1,610	3,500	-220	4,889	-
People	438	569	1,044	2,051	20.9
Lights	420	725	0	1,145	11.7
Miscellaneous Loads	1,036	1,157	0	2,193	22.3
Internal Subtotal	1,894	2,452	1,044	5,389	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-848	0	-848	-8.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-91	0	-91	-0.9
Grand Total	3,504	5,012	823	9,339	100.0
RA Sensible (Lights)	482	0	0	482	-

Engineering Checks For Cooling

Cooling tons	0.78	No People(max)	3.80
%OA	10	People per 1000 ft²	10
cfm/ft²	1.08	Volume (ft³)	4,554
cfm/ton	526		
ft²/ton	488		
Btu/h-ft²	24.59		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-907	0	0	-907	36.6
Door	0	0	0	0	0.0
Wall	0	-845	0	-845	34.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	46	0	46	-1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-411	0	0	-432	17.4
Envelope Subtotal	-1,318	-707	0	-2,046	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-412	0	-412	16.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	0.9
Grand Total	-1,318	-1,142	0	-2,480	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.48	No People(max)	3.80
%OA	10	People per 1000 ft²	10
cfm/ft²	1.08	Volume (ft³)	4,554
cfm/Mbh	-165		
ft²/Mbh	-153		
Btu/h-ft²	-6.54		

Cooling Airflows

Main Fan cfm	410
Cooling ACH	5.40
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	410
Heating ACH	5.40
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 31 of 75

ZONE_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 53.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	190	0	190	5.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	187	0	187	5.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	-1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	113	0	-61	52	1.5
Envelope Subtotal	113	297	-61	350	-
People	456	664	913	2,033	59.2
Lights	158	245	0	403	11.7
Miscellaneous Loads	234	156	0	389	11.3
Internal Subtotal	848	1,065	913	2,825	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	87	0	87	2.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.2
Grand Total	961	1,441	852	3,253	100.0
RA Sensible (Lights)	181	0	0	181	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-128	0	-128	12.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-275	0	-275	26.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	25.3
Envelope Subtotal	-247	-369	0	-629	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-394	0	-394	38.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-247	-765	0	-1,025	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	107
Cooling ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.27	No People(max)	4.56
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,738
cfm/ton	396		
ft²/ton	842		
Btu/h-ft²	14.25		

Engineering Checks For Heating

Heating Mbh	-1.02	No People(max)	4.56
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,738
cfm/Mbh	-105		
ft²/Mbh	-223		
Btu/h-ft²	-4.48		

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 32 of 75

ZONE_SHWR-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 52.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1	0	1	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	521	0	521	19.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	60	0	60	2.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	102	0	-63	40	1.5
Envelope Subtotal	102	562	-63	601	-
People	399	630	631	1,660	62.5
Lights	94	153	0	247	9.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	493	783	631	1,907	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	47	0	47	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.2
Grand Total	595	1,385	569	2,549	100.0
RA Sensible (Lights)	108	0	0	108	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,443
cfm/ton	448		
ft²/ton	959		
Btu/h-ft²	12.51		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-359	0	-359	40.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	42	0	42	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-220	0	0	-231	25.8
Envelope Subtotal	-220	-402	0	-634	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-262	0	-262	29.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-220	-665	0	-897	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.90	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,443
cfm/Mbh	-106		
ft²/Mbh	-227		
Btu/h-ft²	-4.41		

Cooling Airflows

Main Fan cfm	95
Cooling ACH	2.33
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	95
Heating ACH	2.33
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 33 of 75

ZONE_SHWR-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	670	0	670	23.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	89	0	89	3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-62	24	0.9
Envelope Subtotal	87	727	-62	751	-
People	406	699	642	1,748	61.4
Lights	95	170	0	266	9.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	502	870	642	2,014	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-22	0	-22	-0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.3
Grand Total	588	1,567	580	2,735	100.0
RA Sensible (Lights)	110	0	0	110	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	2,486
cfm/ton	455		
ft²/ton	909		
Btu/h-ft²	13.20		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-366	0	-366	41.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-77	0	-77	8.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-236	26.6
Envelope Subtotal	-224	-401	0	-636	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-249	0	-249	28.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-651	0	-886	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.89	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	2,486
cfm/Mbh	-117		
ft²/Mbh	-234		
Btu/h-ft²	-4.27		

Cooling Airflows

Main Fan cfm	104
Cooling ACH	2.51
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	104
Heating ACH	2.51
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 34 of 75

ZONE_SHWR-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 52.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	235	0	235	9.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	244	0	244	9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-65	21	0.8
Envelope Subtotal	87	449	-65	470	-
People	406	692	642	1,740	66.5
Lights	95	169	0	264	10.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	501	861	642	2,004	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	39	0	39	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	588	1,343	577	2,508	100.0
RA Sensible (Lights)	110	0	0	110	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	2,485
cfm/ton	444		
ft²/ton	991		
Btu/h-ft²	12.11		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-361	0	-361	40.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	10.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	26.1
Envelope Subtotal	-224	-414	0	-649	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-253	0	-253	28.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-668	0	-903	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.90	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	2,485
cfm/Mbh	-103		
ft²/Mbh	-229		
Btu/h-ft²	-4.37		

Cooling Airflows

Main Fan cfm	93
Cooling ACH	2.25
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	93
Heating ACH	2.25
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 35 of 75

ZONE_Support

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,015	0	1,015	18.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	329	0	329	5.8
Wall	0	687	0	687	12.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	77	0	77	1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	6	0	6	0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	2,114	0	2,114	-
People	0	0	0	0	0.0
Lights	278	402	0	680	12.1
Miscellaneous Loads	2,059	0	0	2,059	36.6
Internal Subtotal	2,337	402	0	2,739	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	464	0	0	464	8.2
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	2,801	2,510	0	5,311	100.0
RA Sensible (Lights)	319	0	0	319	-

Engineering Checks For Cooling

Cooling tons	0.44	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.42	Volume (ft³)	7,241
cfm/ton	578		
ft²/ton	1,363		
Btu/h-ft²	8.80		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.5 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-693	0	-693	25.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-1,236	0	-1,236	44.9
Wall	0	-1,063	0	-1,063	38.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	166	0	166	-6.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	138	0	138	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-2,687	0	-2,687	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	206	0	0	206	-7.5
Internal Subtotal	206	0	0	206	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-241	0	0	-241	8.7
Time Delay Correction	0	-33	0	-33	1.2
Grand Total	-35	-2,720	0	-2,755	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.75	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.42	Volume (ft³)	7,241
cfm/Mbh	-93		
ft²/Mbh	-219		
Btu/h-ft²	-4.57		

Cooling Airflows

Main Fan cfm	256
Cooling ACH	2.12
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	256
Heating ACH	2.12
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	657
Other Roof	657
Ceiling	0
Window	0
Door	63
Wall	661
Below-Grade Wall	0
Other Wall	661
Partition	1,959
Exterior Floor	0
Internal Floor	0
Slab	657
Other Floor	0

ZONE_Utility

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	4,045	0	4,045	24.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	145	0	145	0.9
Wall	0	91	0	91	0.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	3,525	0	3,525	21.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-36	0	-36	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	571	0	-264	307	1.9
Envelope Subtotal	571	7,770	-264	8,077	-
People	724	1,002	1,259	2,985	18.4
Lights	1,172	1,749	0	2,921	18.0
Miscellaneous Loads	824	0	0	824	5.1
Internal Subtotal	2,721	2,751	1,259	6,731	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	131	0	131	0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.1
Grand Total	3,291	10,630	995	14,916	100.0
RA Sensible (Lights)	1,346	0	0	1,346	-

Engineering Checks For Cooling

Cooling tons	1.24	No People(max)	7.15
%OA	25	People per 1000 ft²	2
cfm/ft²	0.23	Volume (ft³)	35,118
cfm/ton	539		
ft²/ton	2,355		
Btu/h-ft²	5.10		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.7 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3,103	0	-3,103	41.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-565	0	-565	7.6
Wall	0	-144	0	-144	1.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,778	0	-1,778	23.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	539	0	539	-7.2
Other Floor	0	0	0	0	0.0
Infiltration	-2,044	0	0	-2,143	28.8
Envelope Subtotal	-2,044	-5,051	0	-7,194	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	82	0	0	82	-1.1
Internal Subtotal	82	0	0	82	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-319	0	-319	4.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-22	0	-22	0.3
Grand Total	-1,961	-5,391	0	-7,452	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-7.45	No People(max)	7.15
%OA	25	People per 1000 ft²	2
cfm/ft²	0.23	Volume (ft³)	35,118
cfm/Mbh	-90		
ft²/Mbh	-393		
Btu/h-ft²	-2.54		

Cooling Airflows

Main Fan cfm	670
Cooling ACH	1.14
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	670
Heating ACH	1.14
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100

Areas

ft²

Roof	2,903
Other Roof	2,903
Ceiling	295
Window	0
Door	28
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 37 of 75

Zone Cooling and Heating Loads by Component

ZONE_ACT-Noisey-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	207	79	0	286	8.7
Door	0	386	0	386	11.8
Wall	0	277	0	277	8.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-175	0	-175	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-44	0	-44	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-27	48	1.5
Envelope Subtotal	282	523	-27	778	-
People	377	613	719	1,709	52.1
Lights	121	221	0	342	10.4
Miscellaneous Loads	184	144	0	328	10.0
Internal Subtotal	682	978	719	2,379	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	10	0	10	0.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.8
Grand Total	964	1,486	691	3,142	100.0
RA Sensible (Lights)	139	0	0	139	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-334	0	0	-334	20.3
Door	0	-545	0	-545	33.1
Wall	0	-420	0	-420	25.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	142	0	142	-8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	51	0	51	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-204	12.4
Envelope Subtotal	-528	-773	0	-1,311	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-309	0	-309	18.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	1.7
Grand Total	-528	-1,109	0	-1,647	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	118
Cooling ACH	3.28
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	118
Heating ACH	3.28
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/ton	451		
ft²/ton	686		
Btu/h-ft²	17.49		

Engineering Checks For Heating

Heating Mbh	-1.65	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/Mbh	-72		
ft²/Mbh	-109		
Btu/h-ft²	-9.17		

ZONE_ACT-Noisy-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	978	0	978	30.3
Wall	0	335	0	335	10.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-279	0	-279	-8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-23	0	-23	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	32	0	-29	3	0.1
Envelope Subtotal	32	1,011	-29	1,014	-
People	380	509	723	1,613	49.9
Lights	122	184	0	305	9.4
Miscellaneous Loads	185	120	0	305	9.4
Internal Subtotal	687	813	723	2,223	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-92	0	-92	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-52	0	-52	-1.6
Grand Total	719	1,680	695	3,093	100.0
RA Sensible (Lights)	140	0	0	140	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	3.61
%OA	33	People per 1000 ft²	20
cfm/ft²	0.64	Volume (ft³)	2,170
cfm/ton	448		
ft²/ton	702		
Btu/h-ft²	17.09		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-525	0	-525	42.0
Wall	0	-221	0	-221	17.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	23	0	23	-1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-205	16.4
Envelope Subtotal	-196	-678	0	-883	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-352	0	-352	28.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	1.4
Grand Total	-196	-1,046	0	-1,252	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.25	No People(max)	3.61
%OA	33	People per 1000 ft²	20
cfm/ft²	0.64	Volume (ft³)	2,170
cfm/Mbh	-92		
ft²/Mbh	-144		
Btu/h-ft²	-6.94		

Cooling Airflows

Main Fan cfm	116
Cooling ACH	3.21
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	116
Heating ACH	3.21
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ZONE_ACT-Noisy-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	118	28	0	146	4.6
Door	0	381	0	381	12.0
Wall	0	290	0	290	9.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-205	0	-205	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-43	0	-43	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-29	80	2.5
Envelope Subtotal	227	451	-29	649	-
People	382	587	729	1,698	53.4
Lights	122	211	0	334	10.5
Miscellaneous Loads	186	138	0	325	10.2
Internal Subtotal	691	936	729	2,356	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	50	0	50	1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.6
Grand Total	918	1,418	700	3,036	100.0
RA Sensible (Lights)	141	0	0	141	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	3.64
%OA	34	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	2,186
cfm/ton	445		
ft²/ton	720		
Btu/h-ft²	16.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-155	0	0	-155	9.8
Door	0	-503	0	-503	32.0
Wall	0	-388	0	-388	24.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	139	0	139	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	13.2
Envelope Subtotal	-352	-701	0	-1,063	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-490	0	-490	31.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	1.3
Grand Total	-352	-1,212	0	-1,573	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.57	No People(max)	3.64
%OA	34	People per 1000 ft²	20
cfm/ft²	0.62	Volume (ft³)	2,186
cfm/Mbh	-72		
ft²/Mbh	-116		
Btu/h-ft²	-8.62		

Cooling Airflows

Main Fan cfm	113
Cooling ACH	3.10
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	113
Heating ACH	3.10
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ZONE_ACT-Quiet-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-11	0	-11	-0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-41	0	-41	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-25	29	1.5
Envelope Subtotal	55	-51	-25	-22	-
People	274	477	521	1,272	64.8
Lights	88	172	0	260	13.2
Miscellaneous Loads	133	112	0	246	12.5
Internal Subtotal	495	761	521	1,777	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	110	0	110	5.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	549	815	496	1,860	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	2.60
%OA	42	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,564
cfm/ton	424		
ft²/ton	841		
Btu/h-ft²	14.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-95	0	-95	19.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	29.5
Envelope Subtotal	-141	-69	0	-217	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-282	0	-282	56.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-141	-352	0	-500	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.50	No People(max)	2.60
%OA	42	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	1,564
cfm/Mbh	-132		
ft²/Mbh	-261		
Btu/h-ft²	-3.83		

Cooling Airflows

Main Fan cfm	66
Cooling ACH	2.53
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	66
Heating ACH	2.53
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_ACT-Quiet-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	324	219	0	543	21.6
Door	0	0	0	0	0.0
Wall	0	228	0	228	9.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-126	0	-126	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-19	46	1.8
Envelope Subtotal	388	315	-19	685	-
People	274	484	523	1,281	51.1
Lights	88	174	0	262	10.5
Miscellaneous Loads	134	114	0	248	9.9
Internal Subtotal	496	773	523	1,791	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-44	0	-44	-1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-24	0	-24	-1.0
Grand Total	884	1,019	504	2,407	100.0
RA Sensible (Lights)	101	0	0	101	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-170	0	0	-170	21.9
Door	0	0	0	0	0.0
Wall	0	-125	0	-125	16.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-93	0	-93	12.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	19.1
Envelope Subtotal	-312	-187	0	-506	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-263	0	-263	34.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.8
Grand Total	-312	-457	0	-775	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	92
Cooling ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	92
Heating ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	2.61
%OA	30	People per 1000 ft²	20
cfm/ft²	0.70	Volume (ft³)	1,568
cfm/ton	457		
ft²/ton	652		
Btu/h-ft²	18.40		

Engineering Checks For Heating

Heating Mbh	-0.78	No People(max)	2.61
%OA	30	People per 1000 ft²	20
cfm/ft²	0.70	Volume (ft³)	1,568
cfm/Mbh	-118		
ft²/Mbh	-169		
Btu/h-ft²	-5.92		

ZONE_ACT-Quiet-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	261	0	261	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-39	0	-39	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	73	0	-23	50	2.4
Envelope Subtotal	73	126	-23	175	-
People	275	477	524	1,276	60.5
Lights	88	172	0	260	12.3
Miscellaneous Loads	134	112	0	246	11.7
Internal Subtotal	498	761	524	1,783	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	56	0	56	2.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	571	937	501	2,009	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.62
%OA	38	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,573
cfm/ton	434		
ft²/ton	783		
Btu/h-ft²	15.33		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-400	0	-400	50.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-16	0	-16	2.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	18.7
Envelope Subtotal	-142	-385	0	-533	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-260	0	-260	32.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-142	-647	0	-795	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.80	No People(max)	2.62
%OA	38	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,573
cfm/Mbh	-91		
ft²/Mbh	-165		
Btu/h-ft²	-6.06		

Cooling Airflows

Main Fan cfm	73
Cooling ACH	2.78
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	73
Heating ACH	2.78
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

ZONE_Admin

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	599	0	599	13.6
Other Roof	0	0	0	0	0.0
Glass	629	506	0	1,135	25.7
Door	0	0	0	0	0.0
Wall	0	1,204	0	1,204	27.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-238	0	-238	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	0.3
Other Floor	0	0	0	0	0.0
Infiltration	94	0	-11	83	1.9
Envelope Subtotal	722	2,085	-11	2,797	-
People	199	271	379	849	19.2
Lights	194	297	0	491	11.1
Miscellaneous Loads	97	0	0	97	2.2
Internal Subtotal	489	569	379	1,437	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-42	0	-42	-0.9
Grand Total	1,212	2,612	368	4,191	100.0
RA Sensible (Lights)	222	0	0	222	-

Engineering Checks For Cooling

Cooling tons	0.35	No People(max)	1.89
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	2,272
cfm/ton	527		
ft²/ton	542		
Btu/h-ft²	22.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-409	0	-409	28.2
Other Roof	0	0	0	0	0.0
Glass	-342	0	0	-342	23.6
Door	0	0	0	0	0.0
Wall	0	-618	0	-618	42.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	47	0	47	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-205	0	0	-215	14.8
Envelope Subtotal	-548	-910	0	-1,468	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	32	0	0	32	-2.2
Internal Subtotal	32	0	0	32	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	0.9
Grand Total	-515	-923	0	-1,448	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.45	No People(max)	1.89
%OA	11	People per 1000 ft²	10
cfm/ft²	0.97	Volume (ft³)	2,272
cfm/Mbh	-127		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	184
Cooling ACH	4.86
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	184
Heating ACH	4.86
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

ZONE_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	2,389	0	2,389	17.2
Other Roof	0	0	0	0	0.0
Glass	1,140	566	0	1,706	12.3
Door	0	0	0	0	0.0
Wall	0	3,094	0	3,094	22.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	128	0	128	0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-235	0	-235	-1.7
Slab	0	-8	0	-8	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	695	0	-62	633	4.5
Envelope Subtotal	1,835	5,933	-62	7,705	-
People	621	883	982	2,485	17.9
Lights	1,050	1,546	0	2,596	18.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	1,671	2,429	982	5,081	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-739	0	-739	-5.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	744	0	0	744	5.3
Time Delay Correction	0	-76	0	-76	-0.5
Grand Total	4,249	7,546	920	12,714	100.0
RA Sensible (Lights)	1,206	0	0	1,206	-

Engineering Checks For Cooling

Cooling tons	1.06	No People(max)	6.33
%OA	0	People per 1000 ft²	5
cfm/ft²	0.45	Volume (ft³)	15,043
cfm/ton	536		
ft²/ton	1,196		
Btu/h-ft²	10.03		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,377	0	-1,377	18.8
Other Roof	0	0	0	0	0.0
Glass	-1,345	0	0	-1,345	18.4
Door	0	0	0	0	0.0
Wall	0	-3,077	0	-3,077	42.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-238	0	-238	3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	134	0	134	-1.8
Slab	0	116	0	116	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	-1,359	0	0	-1,424	19.5
Envelope Subtotal	-2,704	-4,442	0	-7,210	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-53	0	-53	0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-47	0	-47	0.6
Grand Total	-2,704	-4,542	0	-7,311	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-7.31	No People(max)	6.33
%OA	0	People per 1000 ft²	5
cfm/ft²	0.45	Volume (ft³)	15,043
cfm/Mbh	-78		
ft²/Mbh	-173		
Btu/h-ft²	-5.78		

Cooling Airflows

Main Fan cfm	568
Cooling ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	33
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	568
Heating ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	33
Min Stop/RH (%)	100

Areas

ft²	
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

ZONE_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	25	0	25	1.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	86	0	86	3.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-18	0	-18	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-25	35	1.6
Envelope Subtotal	60	93	-25	129	-
People	210	294	399	902	39.8
Lights	204	322	0	526	23.2
Miscellaneous Loads	341	0	0	341	15.0
Internal Subtotal	754	616	399	1,769	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	136	0	136	6.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	815	841	374	2,030	100.0
RA Sensible (Lights)	234	0	0	234	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.00
%OA	28	People per 1000 ft²	10
cfm/ft²	0.40	Volume (ft³)	2,395
cfm/ton	472		
ft²/ton	1,180		
Btu/h-ft²	10.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-39	0	-39	7.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-140	0	-140	25.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	36	0	36	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-225	41.0
Envelope Subtotal	-216	-143	0	-368	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-6.2
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-215	0	-215	39.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-182	-359	0	-550	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.55	No People(max)	2.00
%OA	28	People per 1000 ft²	10
cfm/ft²	0.40	Volume (ft³)	2,395
cfm/Mbh	-145		
ft²/Mbh	-363		
Btu/h-ft²	-2.75		

Cooling Airflows

Main Fan cfm	80
Cooling ACH	2.00
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	80
Heating ACH	2.00
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

ZONE_Comfort/Consult

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,088	0	1,088	19.6
Other Roof	0	0	0	0	0.0
Glass	344	104	0	448	8.1
Door	0	0	0	0	0.0
Wall	0	698	0	698	12.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-251	0	-251	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	344	1,610	0	1,954	-
People	298	408	567	1,273	23.0
Lights	0	350	0	350	6.3
Miscellaneous Loads	435	288	0	723	13.1
Internal Subtotal	733	1,046	567	2,346	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	13	0	13	0.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	-0.5
Grand Total	1,077	2,644	567	4,287	100.0
RA Sensible (Lights)	1,252	0	0	1,252	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	2.83
%OA	40	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	3,402
cfm/ton	502		
ft²/ton	793		
Btu/h-ft²	15.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-521	0	-521	27.6
Other Roof	0	0	0	0	0.0
Glass	-478	0	0	-478	25.3
Door	0	0	0	0	0.0
Wall	0	-932	0	-932	49.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	136	0	136	-7.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-478	-1,246	0	-1,723	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-144	0	-144	7.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	0.9
Grand Total	-478	-1,407	0	-1,885	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.88	No People(max)	2.83
%OA	40	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	3,402
cfm/Mbh	-95		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	179
Cooling ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	179
Heating ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

ZONE_Corridor-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,118	1,705	0	3,823	83.1
Door	0	0	0	0	0.0
Wall	0	174	0	174	3.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-312	0	-312	-6.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	202	0	202	4.4
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-2	37	0.8
Envelope Subtotal	2,157	1,770	-2	3,925	-
People	0	0	0	0	0.0
Lights	0	249	0	249	5.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	249	0	249	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-444	0	-444	-9.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-98	0	-98	-2.1
Grand Total	2,157	1,477	-2	3,632	100.0
RA Sensible (Lights)	969	0	0	969	-

Engineering Checks For Cooling

Cooling tons	0.30	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.43	Volume (ft³)	4,909
cfm/ton	578		
ft²/ton	1,352		
Btu/h-ft²	8.88		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,281	0	0	-1,281	53.3
Door	0	0	0	0	0.0
Wall	0	-113	0	-113	4.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-36	0	-36	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	103	0	103	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	10.4
Envelope Subtotal	-1,519	-46	0	-1,578	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-784	0	-784	32.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	1.8
Grand Total	-1,519	-873	0	-2,404	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.40	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.43	Volume (ft³)	4,909
cfm/Mbh	-73		
ft²/Mbh	-170		
Btu/h-ft²	-5.88		

Cooling Airflows

Main Fan cfm	175
Cooling ACH	2.14
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	175
Heating ACH	2.14
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

ZONE_Corridor-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,632	1,668	0	4,300	77.5
Door	0	0	0	0	0.0
Wall	0	227	0	227	4.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-284	0	-284	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	423	0	423	7.6
Other Floor	0	0	0	0	0.0
Infiltration	110	0	-2	109	2.0
Envelope Subtotal	2,742	2,033	-2	4,774	-
People	0	0	0	0	0.0
Lights	0	312	0	312	5.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	312	0	312	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-378	0	-378	-6.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-142	0	-142	-2.6
Grand Total	2,742	1,826	-2	4,566	100.0
RA Sensible (Lights)	981	0	0	981	-

Engineering Checks For Cooling

Cooling tons	0.38	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	4,967
cfm/ton	578		
ft²/ton	1,088		
Btu/h-ft²	11.03		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,329	0	0	-1,329	55.0
Door	0	0	0	0	0.0
Wall	0	-114	0	-114	4.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-4	0	-4	0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	104	0	104	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-253	10.5
Envelope Subtotal	-1,571	-15	0	-1,597	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-775	0	-775	32.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-46	0	-46	1.9
Grand Total	-1,571	-835	0	-2,418	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.42	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	4,967
cfm/Mbh	-91		
ft²/Mbh	-171		
Btu/h-ft²	-5.85		

Cooling Airflows

Main Fan cfm	220
Cooling ACH	2.66
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	220
Heating ACH	2.66
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

ZONE_Corridor-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	916	380	0	1,296	43.2
Door	0	0	0	0	0.0
Wall	0	78	0	78	2.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	331	0	331	11.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	0.6
Other Floor	0	0	0	0	0.0
Infiltration	73	0	-1	72	2.4
Envelope Subtotal	988	806	-1	1,793	-
People	0	0	0	0	0.0
Lights	0	245	0	245	8.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	245	0	245	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	215	0	215	7.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.7
Grand Total	988	1,246	-1	2,233	100.0
RA Sensible (Lights)	767	0	0	767	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	1,741		
Btu/h-ft²	6.89		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,303	0	0	-1,303	59.9
Door	0	0	0	0	0.0
Wall	0	-109	0	-109	5.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-3	0	-3	0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	85	0	85	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-198	9.1
Envelope Subtotal	-1,492	-27	0	-1,528	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-605	0	-605	27.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	2.0
Grand Total	-1,492	-674	0	-2,176	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.18	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	3,888
cfm/Mbh	-49		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	108
Cooling ACH	1.67
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	108
Heating ACH	1.67
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

ZONE_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	41	0	41	0.3
Other Roof	0	0	0	0	0.0
Glass	6,334	5,796	0	12,130	100.7
Door	0	818	0	818	6.8
Wall	0	1,172	0	1,172	9.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,219	0	-1,219	-10.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-460	0	-460	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	140	0	-163	-23	-0.2
Envelope Subtotal	6,474	6,148	-163	12,459	-
People	182	254	287	723	6.0
Lights	307	441	0	748	6.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	489	695	287	1,471	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-1,948	0	-1,948	-16.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-287	0	-287	-2.4
Grand Total	6,963	4,609	124	11,696	100.0
RA Sensible (Lights)	353	0	0	353	-

Engineering Checks For Cooling

Cooling tons	0.97	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.50	Volume (ft³)	4,445
cfm/ton	572		
ft²/ton	380		
Btu/h-ft²	31.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-95	0	-95	1.4
Other Roof	0	0	0	0	0.0
Glass	-4,466	0	0	-4,466	64.2
Door	0	-642	0	-642	9.2
Wall	0	-937	0	-937	13.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	666	0	666	-9.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	169	0	169	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	6.1
Envelope Subtotal	-4,868	-840	0	-5,728	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-1,106	0	-1,106	15.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-124	0	-124	1.8
Grand Total	-4,868	-2,070	0	-6,958	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-6.96	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.50	Volume (ft³)	4,445
cfm/Mbh	-80		
ft²/Mbh	-53		
Btu/h-ft²	-18.87		

Cooling Airflows

Main Fan cfm	557
Cooling ACH	7.52
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	557
Heating ACH	7.52
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

ZONE_Exam/Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	957	0	957	32.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-30	0	-30	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-9	51	1.7
Envelope Subtotal	60	914	-9	965	-
People	182	248	347	777	26.2
Lights	58	241	0	299	10.1
Miscellaneous Loads	202	124	0	326	11.0
Internal Subtotal	442	613	347	1,402	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	-0.3
Grand Total	503	1,518	338	2,358	100.0
RA Sensible (Lights)	611	0	0	611	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.73
%OA	38	People per 1000 ft²	8
cfm/ft²	0.44	Volume (ft³)	2,685
cfm/ton	495		
ft²/ton	1,138		
Btu/h-ft²	10.54		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-493	0	-493	75.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-89	0	-89	13.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	42	0	42	-6.5
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	17.6
Envelope Subtotal	-109	-539	0	-654	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-0.7
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-105	-541	0	-651	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.73
%OA	38	People per 1000 ft²	8
cfm/ft²	0.44	Volume (ft³)	2,685
cfm/Mbh	-150		
ft²/Mbh	-344		
Btu/h-ft²	-2.91		

Cooling Airflows

Main Fan cfm	97
Cooling ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	97
Heating ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

	ft²
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

ZONE_Fire Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	285	0	285	15.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	929	0	929	50.4
Wall	0	525	0	525	28.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-192	0	-192	-10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,544	0	1,544	-
People	0	0	0	0	0.0
Lights	69	108	0	177	9.6
Miscellaneous Loads	81	0	0	81	4.4
Internal Subtotal	150	108	0	258	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-2.2
Grand Total	150	1,612	0	1,762	100.0
RA Sensible (Lights)	80	0	0	80	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	1.07	Volume (ft³)	951
cfm/ton	578		
ft²/ton	540		
Btu/h-ft²	22.22		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 105.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-170	0	-170	19.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-526	0	-526	61.4
Wall	0	-296	0	-296	34.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	102	0	102	-11.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-868	0	-868	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	27	0	0	27	-3.2
Internal Subtotal	27	0	0	27	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	1.9
Grand Total	27	-884	0	-857	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	0.00
%OA	0	People per 1000 ft²	0
cfm/ft²	1.07	Volume (ft³)	951
cfm/Mbh	-99		
ft²/Mbh	-92		
Btu/h-ft²	-10.87		

Cooling Airflows

Main Fan cfm	85
Cooling ACH	5.36
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	85
Heating ACH	5.36
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	88
Other Roof	88
Ceiling	0
Window	0
Door	21
Wall	118
Below-Grade Wall	0
Other Wall	118
Partition	334
Exterior Floor	0
Internal Floor	0
Slab	88
Other Floor	0

ZONE_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	586	0	586	11.3
Other Roof	0	0	0	0	0.0
Glass	223	104	0	327	6.3
Door	0	0	0	0	0.0
Wall	0	611	0	611	11.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-186	0	-186	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-64	0	-64	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	166	0	-40	126	2.4
Envelope Subtotal	389	1,051	-40	1,399	-
People	553	780	1,106	2,438	46.9
Lights	227	345	0	572	11.0
Miscellaneous Loads	283	185	0	468	9.0
Internal Subtotal	1,062	1,310	1,106	3,478	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	81	0	81	1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.5
Grand Total	1,451	2,417	1,065	4,933	100.0
RA Sensible (Lights)	260	0	0	260	-

Engineering Checks For Cooling

Cooling tons	0.41	No People(max)	5.52
%OA	49	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	3,317
cfm/ton	453		
ft²/ton	672		
Btu/h-ft²	17.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-272	0	-272	12.8
Other Roof	0	0	0	0	0.0
Glass	-324	0	0	-324	15.2
Door	0	0	0	0	0.0
Wall	0	-835	0	-835	39.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	135	0	135	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	80	0	80	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	14.7
Envelope Subtotal	-624	-893	0	-1,531	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-585	0	-585	27.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	0.6
Grand Total	-624	-1,491	0	-2,130	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.13	No People(max)	5.52
%OA	49	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	3,317
cfm/Mbh	-88		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	186
Cooling ACH	3.36
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	186
Heating ACH	3.36
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

ZONE_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	489	0	489	10.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	579	0	579	12.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	94	0	94	2.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	148	0	-36	112	2.4
Envelope Subtotal	148	1,137	-36	1,248	-
People	492	684	984	2,160	46.9
Lights	202	305	0	507	11.0
Miscellaneous Loads	252	163	0	415	9.0
Internal Subtotal	946	1,152	984	3,082	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	58	0	58	1.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.3
Grand Total	1,093	2,335	948	4,376	100.0
RA Sensible (Lights)	232	0	0	232	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	4.92
%OA	49	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	2,953
cfm/ton	453		
ft²/ton	675		
Btu/h-ft²	17.78		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-237	0	-237	12.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-783	0	-783	41.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-135	0	-135	7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-279	14.8
Envelope Subtotal	-266	-1,083	0	-1,362	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-522	0	-522	27.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.2
Grand Total	-266	-1,609	0	-1,888	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.89	No People(max)	4.92
%OA	49	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	2,953
cfm/Mbh	-88		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	165
Cooling ACH	3.35
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	165
Heating ACH	3.35
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

ZONE_Intake-HR-A

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,274	0	1,274	14.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,430	0	1,430	15.7
Wall	0	1,694	0	1,694	18.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-169	0	-169	-1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	81	0	-11	70	0.8
Envelope Subtotal	81	4,209	-11	4,280	-
People	404	559	720	1,683	18.5
Lights	72	494	0	566	6.2
Miscellaneous Loads	362	234	0	595	6.5
Internal Subtotal	838	1,287	720	2,845	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	23	0	23	0.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	560	0	0	560	6.2
Time Delay Correction	0	-92	0	-92	-1.0
Grand Total	1,480	5,426	709	7,615	100.0
RA Sensible (Lights)	1,491	0	0	1,491	-

Engineering Checks For Cooling

Cooling tons	0.63	No People(max)	3.96
%OA	21	People per 1000 ft²	8
cfm/ft²	0.71	Volume (ft³)	5,646
cfm/ton	524		
ft²/ton	741		
Btu/h-ft²	16.19		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-841	0	-841	26.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-673	0	-673	21.4
Wall	0	-1,284	0	-1,284	40.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	61	0	61	-1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	117	0	117	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-177	0	0	-186	5.9
Envelope Subtotal	-177	-2,619	0	-2,805	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-314	0	-314	10.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-29	0	-29	0.9
Grand Total	-177	-2,962	0	-3,148	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.15	No People(max)	3.96
%OA	21	People per 1000 ft²	8
cfm/ft²	0.71	Volume (ft³)	5,646
cfm/Mbh	-106		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	333
Cooling ACH	3.54
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	333
Heating ACH	3.54
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100

Areas ft²

Roof	438
Other Roof	438
Ceiling	78
Window	0
Door	26
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

ZONE_Intake-HR-B

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	709	0	709	30.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	96	0	96	4.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	43	0	43	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-7	42	1.8
Envelope Subtotal	48	838	-7	880	-
People	130	181	248	560	24.3
Lights	47	178	0	225	9.8
Miscellaneous Loads	139	86	0	225	9.8
Internal Subtotal	316	446	248	1,010	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.3
Grand Total	365	1,277	242	1,883	100.0
RA Sensible (Lights)	424	0	0	424	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.24
%OA	33	People per 1000 ft²	8
cfm/ft²	0.48	Volume (ft³)	1,976
cfm/ton	504		
ft²/ton	1,049		
Btu/h-ft²	11.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-367	0	-367	59.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-85	0	-85	13.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-114	0	-114	18.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-92	14.8
Envelope Subtotal	-88	-532	0	-624	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-0.6
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-84	-534	0	-622	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.62	No People(max)	1.24
%OA	33	People per 1000 ft²	8
cfm/ft²	0.48	Volume (ft³)	1,976
cfm/Mbh	-127		
ft²/Mbh	-265		
Btu/h-ft²	-3.77		

Cooling Airflows

Main Fan cfm	79
Cooling ACH	2.40
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	79
Heating ACH	2.40
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

ZONE_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	2,874	0	2,874	4.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	2,645	0	2,645	4.3
Wall	0	1,231	0	1,231	2.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,204	0	-1,204	-2.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-344	0	-344	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	380	0	-39	341	0.6
Envelope Subtotal	380	5,204	-39	5,545	-
People	1,375	1,883	3,197	6,456	10.5
Lights	401	619	0	1,021	1.7
Miscellaneous Loads	13,334	8,793	0	22,127	35.9
Internal Subtotal	15,110	11,296	3,197	29,604	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	26,138	0	0	26,138	42.4
Time Delay Correction	0	-167	0	-167	-0.3
Grand Total	41,629	16,332	3,158	61,119	100.0
RA Sensible (Lights)	461	0	0	461	-

Engineering Checks For Cooling

Cooling tons	5.09	No People(max)	13.10
%OA	8	People per 1000 ft²	19
cfm/ft²	4.07	Volume (ft³)	8,226
cfm/ton	548		
ft²/ton	135		
Btu/h-ft²	88.89		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,401	0	-1,401	2.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-1,287	0	-1,287	2.3
Wall	0	-1,698	0	-1,698	3.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-251	0	-251	0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	192	0	192	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	-742	0	0	-779	1.4
Envelope Subtotal	-742	-4,445	0	-5,224	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	0.0
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-49,888	0	0	-49,888	90.5
Time Delay Correction	0	-46	0	-46	0.1
Grand Total	-50,617	-4,491	0	-55,145	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-55.14	No People(max)	13.10
%OA	8	People per 1000 ft²	19
cfm/ft²	4.07	Volume (ft³)	8,226
cfm/Mbh	-51		
ft²/Mbh	-12		
Btu/h-ft²	-83.33		

Cooling Airflows

Main Fan cfm	2,793
Cooling ACH	20.37
Sec Fan cfm	0
Input Ventilation cfm	235
Calculated Ventilation cfm	235
Calculated Ventilation ACH	1.71
Infiltration cfm	18
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,793
Heating ACH	20.37
Sec Fan cfm	0
Input Ventilation cfm	235
Calculated Ventilation cfm	235
Calculated Ventilation ACH	1.71
Infiltration cfm	18
Min Stop/RH (%)	100

Areas ft²

Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

ZONE_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	941	0	941	11.9
Other Roof	0	0	0	0	0.0
Glass	623	514	0	1,137	14.3
Door	0	1,147	0	1,147	14.5
Wall	0	1,287	0	1,287	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-361	0	-361	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	147	0	-27	120	1.5
Envelope Subtotal	770	3,521	-27	4,265	-
People	589	841	1,098	2,528	31.9
Lights	251	372	0	623	7.9
Miscellaneous Loads	202	128	0	331	4.2
Internal Subtotal	1,043	1,341	1,098	3,483	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-105	0	-105	-1.3
Grand Total	1,814	4,758	1,071	7,642	100.0
RA Sensible (Lights)	289	0	0	289	-

Engineering Checks For Cooling

Cooling tons	0.64	No People(max)	5.93
%OA	21	People per 1000 ft²	20
cfm/ft²	1.07	Volume (ft³)	3,561
cfm/ton	497		
ft²/ton	466		
Btu/h-ft²	25.75		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-628	0	-628	27.0
Other Roof	0	0	0	0	0.0
Glass	-343	0	0	-343	14.7
Door	0	-545	0	-545	23.4
Wall	0	-658	0	-658	28.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	137	0	137	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	77	0	77	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-321	0	0	-337	14.5
Envelope Subtotal	-664	-1,618	0	-2,298	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	1.3
Grand Total	-664	-1,648	0	-2,328	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.33	No People(max)	5.93
%OA	21	People per 1000 ft²	20
cfm/ft²	1.07	Volume (ft³)	3,561
cfm/Mbh	-136		
ft²/Mbh	-127		
Btu/h-ft²	-7.87		

Cooling Airflows

Main Fan cfm	317
Cooling ACH	5.34
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	317
Heating ACH	5.34
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	16
Door	21
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

ZONE_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,090	0	1,090	12.3
Other Roof	0	0	0	0	0.0
Glass	330	150	0	480	5.4
Door	0	365	0	365	4.1
Wall	0	615	0	615	6.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-329	0	-329	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-95	0	-95	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	291	0	-73	218	2.5
Envelope Subtotal	621	1,796	-73	2,344	-
People	971	1,294	1,942	4,207	47.5
Lights	398	574	0	972	11.0
Miscellaneous Loads	497	307	0	804	9.1
Internal Subtotal	1,866	2,175	1,942	5,983	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	124	0	124	1.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-49	0	-49	-0.5
Grand Total	2,487	4,046	1,868	8,401	100.0
RA Sensible (Lights)	457	0	0	457	-

Engineering Checks For Cooling

Cooling tons	0.70	No People(max)	9.70
%OA	51	People per 1000 ft²	20
cfm/ft²	0.65	Volume (ft³)	5,825
cfm/ton	450		
ft²/ton	693		
Btu/h-ft²	17.32		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-495	0	-495	14.1
Other Roof	0	0	0	0	0.0
Glass	-487	0	0	-487	13.9
Door	0	-523	0	-523	14.9
Wall	0	-838	0	-838	23.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	227	0	227	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	144	0	144	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-551	15.7
Envelope Subtotal	-1,013	-1,485	0	-2,523	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-944	0	-944	27.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-34	0	-34	1.0
Grand Total	-1,013	-2,463	0	-3,501	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.50	No People(max)	9.70
%OA	51	People per 1000 ft²	20
cfm/ft²	0.65	Volume (ft³)	5,825
cfm/Mbh	-90		
ft²/Mbh	-139		
Btu/h-ft²	-7.19		

Cooling Airflows

Main Fan cfm	315
Cooling ACH	3.24
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	315
Heating ACH	3.24
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

ZONE_RB-N-Corner

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	132	47	0	179	7.2
Door	0	0	0	0	0.0
Wall	0	866	0	866	35.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-102	0	-102	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-12	53	2.1
Envelope Subtotal	198	791	-12	976	-
People	151	183	359	692	27.9
Lights	0	42	0	42	1.7
Miscellaneous Loads	356	405	0	761	30.7
Internal Subtotal	507	630	359	1,495	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-113	0	-113	-4.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-0.5
Grand Total	704	1,295	346	2,346	100.0
RA Sensible (Lights)	132	0	0	132	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.30
%OA	15	People per 1000 ft²	10
cfm/ft²	0.74	Volume (ft³)	1,565
cfm/ton	493		
ft²/ton	667		
Btu/h-ft²	17.99		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-224	0	0	-224	16.5
Door	0	0	0	0	0.0
Wall	0	-863	0	-863	63.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	72	0	72	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	10.9
Envelope Subtotal	-366	-752	0	-1,125	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-224	0	-224	16.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-366	-984	0	-1,357	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.36	No People(max)	1.30
%OA	15	People per 1000 ft²	10
cfm/ft²	0.74	Volume (ft³)	1,565
cfm/Mbh	-71		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	96
Cooling ACH	3.68
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	96
Heating ACH	3.68
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_RB-N-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	9	0	9	0.2
Other Roof	0	0	0	0	0.0
Glass	664	432	0	1,096	20.1
Door	0	0	0	0	0.0
Wall	0	1,652	0	1,652	30.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-277	0	-277	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-67	0	-67	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	152	0	-70	82	1.5
Envelope Subtotal	815	1,749	-70	2,495	-
People	297	404	707	1,408	25.9
Lights	0	88	0	88	1.6
Miscellaneous Loads	702	847	0	1,549	28.5
Internal Subtotal	998	1,339	707	3,045	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-315	0	-315	-5.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-46	0	-46	-0.9
Grand Total	1,814	2,728	637	5,179	100.0
RA Sensible (Lights)	260	0	0	260	-

Engineering Checks For Cooling

Cooling tons	0.43	No People(max)	2.57
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	3,084
cfm/ton	507		
ft²/ton	596		
Btu/h-ft²	20.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-5	0	-5	0.2
Other Roof	0	0	0	0	0.0
Glass	-438	0	0	-438	18.8
Door	0	0	0	0	0.0
Wall	0	-1,229	0	-1,229	52.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	68	0	68	-2.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-278	0	0	-292	12.5
Envelope Subtotal	-716	-1,095	0	-1,825	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-488	0	-488	20.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	0.7
Grand Total	-716	-1,599	0	-2,329	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.33	No People(max)	2.57
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	3,084
cfm/Mbh	-94		
ft²/Mbh	-110		
Btu/h-ft²	-9.09		

Cooling Airflows

Main Fan cfm	219
Cooling ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	219
Heating ACH	4.26
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

ZONE_RB-N-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	381	162	0	542	8.8
Door	0	0	0	0	0.0
Wall	0	694	0	694	11.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-275	0	-275	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-101	0	-101	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	189	0	-44	145	2.4
Envelope Subtotal	570	480	-44	1,006	-
People	442	675	1,052	2,169	35.1
Lights	0	135	0	135	2.2
Miscellaneous Loads	1,044	1,297	0	2,342	37.9
Internal Subtotal	1,486	2,108	1,052	4,646	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	170	0	170	2.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-0.5
Grand Total	2,056	2,727	1,008	5,791	100.0
RA Sensible (Lights)	387	0	0	387	-

Engineering Checks For Cooling

Cooling tons	0.48	No People(max)	3.83
%OA	18	People per 1000 ft²	10
cfm/ft²	0.60	Volume (ft³)	4,590
cfm/ton	477		
ft²/ton	793		
Btu/h-ft²	15.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-694	0	0	-694	24.1
Door	0	0	0	0	0.0
Wall	0	-1,074	0	-1,074	37.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-27	0	-27	0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	96	0	96	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-434	15.1
Envelope Subtotal	-1,108	-1,005	0	-2,133	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-726	0	-726	25.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-24	0	-24	0.8
Grand Total	-1,108	-1,755	0	-2,884	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.88	No People(max)	3.83
%OA	18	People per 1000 ft²	10
cfm/ft²	0.60	Volume (ft³)	4,590
cfm/Mbh	-80		
ft²/Mbh	-133		
Btu/h-ft²	-7.52		

Cooling Airflows

Main Fan cfm	230
Cooling ACH	3.01
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	230
Heating ACH	3.01
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

ZONE_RB-S-Corner-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	204	170	0	374	12.4
Door	0	0	0	0	0.0
Wall	0	1,390	0	1,390	46.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-167	0	-167	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-87	0	-87	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	70	0	-34	36	1.2
Envelope Subtotal	274	1,306	-34	1,546	-
People	149	226	355	730	24.2
Lights	0	47	0	47	1.6
Miscellaneous Loads	352	450	0	802	26.6
Internal Subtotal	501	722	355	1,578	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-221	0	-221	-7.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.6
Grand Total	775	1,789	321	2,885	100.0
RA Sensible (Lights)	131	0	0	131	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,549
cfm/ton	514		
ft²/ton	537		
Btu/h-ft²	22.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-214	0	0	-214	16.1
Door	0	0	0	0	0.0
Wall	0	-853	0	-853	64.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	75	0	75	-5.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	38	0	38	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	11.0
Envelope Subtotal	-354	-740	0	-1,101	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-223	0	-223	16.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-354	-970	0	-1,331	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.33	No People(max)	1.29
%OA	11	People per 1000 ft²	10
cfm/ft²	0.96	Volume (ft³)	1,549
cfm/Mbh	-93		
ft²/Mbh	-97		
Btu/h-ft²	-10.31		

Cooling Airflows

Main Fan cfm	124
Cooling ACH	4.80
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	124
Heating ACH	4.80
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ZONE_RB-S-Corner-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	131	61	0	192	6.7
Door	0	0	0	0	0.0
Wall	0	1,201	0	1,201	42.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-146	0	-146	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-11	44	1.5
Envelope Subtotal	186	1,087	-11	1,262	-
People	152	238	361	750	26.2
Lights	0	46	0	46	1.6
Miscellaneous Loads	358	442	0	800	28.0
Internal Subtotal	510	726	361	1,597	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-117	0	-117	-4.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.6
Grand Total	696	1,680	350	2,727	100.0
RA Sensible (Lights)	133	0	0	133	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/ton	504		
ft²/ton	578		
Btu/h-ft²	20.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-225	0	0	-225	16.6
Door	0	0	0	0	0.0
Wall	0	-858	0	-858	63.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	11.0
Envelope Subtotal	-367	-750	0	-1,123	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-223	0	-223	16.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.6
Grand Total	-367	-981	0	-1,355	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.35	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/Mbh	-85		
ft²/Mbh	-97		
Btu/h-ft²	-10.31		

Cooling Airflows

Main Fan cfm	115
Cooling ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	115
Heating ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

ZONE_RB-S-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	997	628	0	1,625	22.6
Door	0	0	0	0	0.0
Wall	0	1,599	0	1,599	22.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-409	0	-409	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-112	0	-112	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	219	0	-104	115	1.6
Envelope Subtotal	1,217	1,706	-104	2,819	-
People	430	604	1,023	2,056	28.6
Lights	0	133	0	133	1.9
Miscellaneous Loads	1,015	1,280	0	2,295	31.9
Internal Subtotal	1,445	2,018	1,023	4,485	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-427	0	-427	-5.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-69	0	-69	-1.0
Grand Total	2,661	3,229	919	6,809	100.0
RA Sensible (Lights)	376	0	0	376	-

Engineering Checks For Cooling

Cooling tons	0.57	No People(max)	3.72
%OA	14	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	4,463
cfm/ton	500		
ft²/ton	655		
Btu/h-ft²	18.32		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-657	0	0	-657	24.6
Door	0	0	0	0	0.0
Wall	0	-933	0	-933	34.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-13	0	-13	0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-403	0	0	-422	15.8
Envelope Subtotal	-1,059	-854	0	-1,933	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-718	0	-718	26.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-22	0	-22	0.8
Grand Total	-1,059	-1,594	0	-2,673	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.67	No People(max)	3.72
%OA	14	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	4,463
cfm/Mbh	-106		
ft²/Mbh	-139		
Btu/h-ft²	-7.19		

Cooling Airflows

Main Fan cfm	284
Cooling ACH	3.82
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	284
Heating ACH	3.82
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

ZONE_RB-S-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	138	61	0	199	9.6
Door	0	0	0	0	0.0
Wall	0	232	0	232	11.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-29	0	-29	-1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-14	38	1.8
Envelope Subtotal	190	235	-14	412	-
People	143	227	341	711	34.2
Lights	0	44	0	44	2.1
Miscellaneous Loads	338	422	0	761	36.6
Internal Subtotal	482	693	341	1,516	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	36	0	36	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.5
Grand Total	672	954	327	1,953	100.0
RA Sensible (Lights)	125	0	0	125	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.24
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,488
cfm/ton	481		
ft²/ton	762		
Btu/h-ft²	15.75		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-229	0	0	-229	24.1
Door	0	0	0	0	0.0
Wall	0	-352	0	-352	37.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-16	0	-16	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	14.8
Envelope Subtotal	-363	-336	0	-706	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-235	0	-235	24.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.8
Grand Total	-363	-579	0	-948	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.24
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,488
cfm/Mbh	-83		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	78
Cooling ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	78
Heating ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

ZONE_RB-W-North

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 42.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	540	461	0	1,000	35.2
Door	0	0	0	0	0.0
Wall	0	698	0	698	24.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-176	0	-176	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-11	29	1.0
Envelope Subtotal	580	950	-11	1,519	-
People	150	158	357	665	23.4
Lights	0	38	0	38	1.3
Miscellaneous Loads	354	369	0	723	25.4
Internal Subtotal	504	565	357	1,426	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-201	0	-201	-7.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-1.1
Grand Total	1,084	1,282	346	2,711	100.0
RA Sensible (Lights)	131	0	0	131	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,557
cfm/ton	504		
ft²/ton	575		
Btu/h-ft²	20.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-365	0	0	-365	25.2
Door	0	0	0	0	0.0
Wall	0	-830	0	-830	57.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	94	0	94	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	10.2
Envelope Subtotal	-505	-697	0	-1,209	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-225	0	-225	15.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.8
Grand Total	-505	-934	0	-1,446	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.45	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,557
cfm/Mbh	-79		
ft²/Mbh	-90		
Btu/h-ft²	-11.11		

Cooling Airflows

Main Fan cfm	114
Cooling ACH	4.39
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	114
Heating ACH	4.39
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_RB-W-South

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,140	1,519	0	3,659	37.6
Door	0	0	0	0	0.0
Wall	0	2,194	0	2,194	22.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-641	0	-641	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	150	0	150	1.5
Other Floor	0	0	0	0	0.0
Infiltration	188	0	-26	161	1.7
Envelope Subtotal	2,328	3,221	-26	5,523	-
People	438	678	1,044	2,160	22.2
Lights	0	135	0	135	1.4
Miscellaneous Loads	1,036	1,299	0	2,335	24.0
Internal Subtotal	1,474	2,113	1,044	4,631	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-680	0	-680	-7.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-137	0	-137	-1.4
Grand Total	3,802	4,516	1,017	9,336	100.0
RA Sensible (Lights)	384	0	0	384	-

Engineering Checks For Cooling

Cooling tons	0.78	No People(max)	3.80
%OA	10	People per 1000 ft²	10
cfm/ft²	1.06	Volume (ft³)	4,554
cfm/ton	515		
ft²/ton	488		
Btu/h-ft²	24.59		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-1,174	0	0	-1,174	32.4
Door	0	0	0	0	0.0
Wall	0	-1,480	0	-1,480	40.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	75	0	75	-2.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	106	0	106	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-411	0	0	-431	11.9
Envelope Subtotal	-1,585	-1,299	0	-2,904	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-682	0	-682	18.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-39	0	-39	1.1
Grand Total	-1,585	-2,020	0	-3,625	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.62	No People(max)	3.80
%OA	10	People per 1000 ft²	10
cfm/ft²	1.06	Volume (ft³)	4,554
cfm/Mbh	-111		
ft²/Mbh	-105		
Btu/h-ft²	-9.52		

Cooling Airflows

Main Fan cfm	401
Cooling ACH	5.28
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	401
Heating ACH	5.28
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

ZONE_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	499	0	499	12.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	357	0	357	8.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-38	0	-38	-0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-35	101	2.5
Envelope Subtotal	137	790	-35	891	-
People	456	659	913	2,028	49.8
Lights	187	292	0	480	11.8
Miscellaneous Loads	234	156	0	390	9.6
Internal Subtotal	877	1,108	913	2,898	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	84	0	84	2.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.3
Grand Total	1,014	1,970	877	3,861	100.0
RA Sensible (Lights)	215	0	0	215	-

Engineering Checks For Cooling

Cooling tons	0.32	No People(max)	4.56
%OA	52	People per 1000 ft²	20
cfm/ft²	0.63	Volume (ft³)	2,738
cfm/ton	447		
ft²/ton	709		
Btu/h-ft²	16.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-235	0	-235	16.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-493	0	-493	34.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	60	0	60	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	18.0
Envelope Subtotal	-247	-689	0	-948	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-485	0	-485	33.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.3
Grand Total	-247	-1,178	0	-1,437	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.44	No People(max)	4.56
%OA	52	People per 1000 ft²	20
cfm/ft²	0.63	Volume (ft³)	2,738
cfm/Mbh	-100		
ft²/Mbh	-159		
Btu/h-ft²	-6.29		

Cooling Airflows

Main Fan cfm	144
Cooling ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	144
Heating ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

ZONE_SHWR-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	7	0	7	0.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	1,050	0	1,050	31.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-120	0	-120	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-48	0	-48	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	120	0	-63	57	1.7
Envelope Subtotal	120	889	-63	946	-
People	399	747	631	1,777	52.8
Lights	184	357	0	541	16.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	583	1,104	631	2,318	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-96	0	-96	-2.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.3
Grand Total	703	1,886	568	3,157	100.0
RA Sensible (Lights)	211	0	0	211	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.61	Volume (ft³)	2,443
cfm/ton	474		
ft²/ton	774		
Btu/h-ft²	15.50		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-4	0	-4	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-636	0	-636	47.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-95	0	-95	7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	48	0	48	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-220	0	0	-231	17.1
Envelope Subtotal	-220	-687	0	-918	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-428	0	-428	31.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.2
Grand Total	-220	-1,117	0	-1,348	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.35	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.61	Volume (ft³)	2,443
cfm/Mbh	-93		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	125
Cooling ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	125
Heating ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

ZONE_SHWR-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	432	0	432	13.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-22	0	-22	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-1.8
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-30	57	1.8
Envelope Subtotal	87	355	-30	412	-
People	406	783	642	1,831	58.5
Lights	187	374	0	561	17.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	593	1,157	642	2,392	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	117	0	117	3.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.2
Grand Total	680	1,622	612	2,914	100.0
RA Sensible (Lights)	215	0	0	215	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	2,486
cfm/ton	457		
ft²/ton	853		
Btu/h-ft²	14.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-651	0	-651	48.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-87	0	-87	6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	17.5
Envelope Subtotal	-224	-690	0	-925	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-413	0	-413	30.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.2
Grand Total	-224	-1,105	0	-1,340	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.34	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	2,486
cfm/Mbh	-83		
ft²/Mbh	-155		
Btu/h-ft²	-6.45		

Cooling Airflows

Main Fan cfm	111
Cooling ACH	2.68
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	111
Heating ACH	2.68
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ZONE_SHWR-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 11:00:00
 Outside DB / WB / HR 91.7 °F / 64.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	1,030	0	1,030	30.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	-1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-34	0	-34	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	88	0	-27	61	1.8
Envelope Subtotal	88	943	-27	1,004	-
People	406	689	642	1,737	51.0
Lights	187	329	0	516	15.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	593	1,018	642	2,253	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-53	0	-53	-1.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.3
Grand Total	681	1,897	615	3,193	100.0
RA Sensible (Lights)	215	0	0	215	-

Engineering Checks For Cooling

Cooling tons	0.27	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.60	Volume (ft³)	2,485
cfm/ton	467		
ft²/ton	778		
Btu/h-ft²	15.42		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-649	0	-649	47.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-111	0	-111	8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	17.1
Envelope Subtotal	-224	-711	0	-946	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-426	0	-426	31.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.2
Grand Total	-224	-1,140	0	-1,375	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.38	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.60	Volume (ft³)	2,485
cfm/Mbh	-90		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	124
Cooling ACH	2.99
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	124
Heating ACH	2.99
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ZONE_Support

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,760	0	1,760	20.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,892	0	1,892	22.2
Wall	0	2,505	0	2,505	29.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-330	0	-330	-3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	5,811	0	5,811	-
People	0	0	0	0	0.0
Lights	459	659	0	1,118	13.1
Miscellaneous Loads	537	0	0	537	6.3
Internal Subtotal	995	659	0	1,654	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	630	0	0	630	7.4
Time Delay Correction	0	-101	0	-101	-1.2
Grand Total	1,626	6,369	0	7,994	100.0
RA Sensible (Lights)	527	0	0	527	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,109	0	-1,109	33.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-1,090	0	-1,090	32.5
Wall	0	-1,572	0	-1,572	46.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	137	0	137	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	137	0	137	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-3,497	0	-3,497	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	179	0	0	179	-5.3
Internal Subtotal	179	0	0	179	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	1.2
Grand Total	179	-3,537	0	-3,358	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	385
Cooling ACH	3.67
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	385
Heating ACH	3.67
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

	ft²
Roof	569
Other Roof	569
Ceiling	0
Window	0
Door	42
Wall	543
Below-Grade Wall	0
Other Wall	543
Partition	1,625
Exterior Floor	0
Internal Floor	0
Slab	569
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.67	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.73	Volume (ft³)	6,290
cfm/ton	578		
ft²/ton	787		
Btu/h-ft²	15.25		

Engineering Checks For Heating

Heating Mbh	-3.36	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.73	Volume (ft³)	6,290
cfm/Mbh	-115		
ft²/Mbh	-156		
Btu/h-ft²	-6.41		

ZONE_Utility

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 39.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	10,184	0	10,184	35.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,598	0	1,598	5.6
Wall	0	351	0	351	1.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	3,977	0	3,977	13.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	1,047	0	-65	982	3.4
Envelope Subtotal	1,047	16,056	-65	17,037	-
People	724	1,042	1,259	3,025	10.6
Lights	698	2,355	0	3,054	10.7
Miscellaneous Loads	247	0	0	247	0.9
Internal Subtotal	1,670	3,397	1,259	6,326	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-5	0	-5	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-162	0	-162	-0.6
Grand Total	2,717	19,285	1,194	23,196	100.0
RA Sensible (Lights)	5,324	0	0	5,324	-

Engineering Checks For Cooling

Cooling tons	1.93	No People(max)	7.15
%OA	15	People per 1000 ft²	2
cfm/ft²	0.36	Volume (ft³)	35,118
cfm/ton	548		
ft²/ton	1,514		
Btu/h-ft²	7.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 90.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-5,756	0	-5,756	51.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-761	0	-761	6.9
Wall	0	-254	0	-254	2.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2,330	0	-2,330	21.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	591	0	591	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-2,044	0	0	-2,141	19.3
Envelope Subtotal	-2,044	-8,511	0	-10,653	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	82	0	0	82	-0.7
Internal Subtotal	82	0	0	82	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-485	0	-485	4.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	0.4
Grand Total	-1,961	-9,039	0	-11,098	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-11.10	No People(max)	7.15
%OA	15	People per 1000 ft²	2
cfm/ft²	0.36	Volume (ft³)	35,118
cfm/Mbh	-95		
ft²/Mbh	-264		
Btu/h-ft²	-3.79		

Cooling Airflows

Main Fan cfm	1,060
Cooling ACH	1.81
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	1,060
Heating ACH	1.81
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100

Areas

ft²

Roof	2,903
Other Roof	2,903
Ceiling	295
Window	0
Door	28
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

System Component Selection Summary

Primary

System Name: DOAS to Zone Level Equipment Dehum and Reheat

System Type: Dedicated Outdoor Air System (DOAS)
Number of Zones: 0
Number of Rooms: 0

Component	Quantity
Cooling Coils	1
Heating Coils	2
Fans	1

Cooling Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design						Water Flow Conditions			
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)		Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB/WB (°F)	Leave DB/WB (°F)	Enter DB/WB (°F)	Leave DB/WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SCC-1		DX	Block		6.0	71.7	71.7	71.7	N/A	1,550	1,550	99.7	64.66	55.0	47.75	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SCC-1	DESUPERHEATER	Desuperheater	Peak	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
SHC-1		Electric	Block	12/21 04:00	36.4	36.4	N/A	1,550	1,550	32.1	55.0	N/A	N/A	N/A

Load/Airflows

Location				Cooling				Heating					
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
DOAS to Zone Level Equipment Dehum and Reheat			0	7/21 15:00	1,550	71,733	1,550	55.0	12/21 04:00	N/A	36,362	1,550	55.0

Fans

System	Zone	Type	Efficiency (%)	Efficiency with PRM Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
DOAS to Zone Level Equipment Dehum and Reheat SF-1		System	87.00	N/A	3.00	1,550	.63	N/A	100.00

System Name: Single Zone CV

System Type: Constant Volume (CV)
Number of Zones 1
Number of Rooms 2

Component	Quantity
Cooling Coils	1
Heating Coils	1
Fans	2

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SCC-1 Kitchen		DX	Block		7.9	94.8	94.8	49.4	N/A	2,532	2,500	98.8	66.71	62.7	54.15	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SHC-1 Kitchen		Electric	Block	12/21 04:00	163.2	163.2	N/A		2,532	2,500	32.1	95.0	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	9/21 16:00	2,532	28,511	2,532	64.0	12/21 04:00	2,532	3,488	2,532	75.0
		Kitchen	382	7/21 18:00	2,500	28,257	2,500	64.1	12/21 19:00	2,500	12,818	2,500	75.0
		Service	304	9/21 16:00	359	4,061	359	64.1	12/21 04:00	359	2,320	359	76.3

Fans

System	Zone	Type	Efficiency with PRM						Power with PRM	
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power (kW)	Fan Override (kW)	Motor Heat in Air (%)
	Kitchen_EXHAUST FAN	Zone	10.00	N/A	0.00	2,500	.00	N/A		100.00
Kitchen_Single Zone	CV SF-1	System	87.00	N/A	3.00	2,532	1.03	N/A		100.00

System Name: Variable Refrigerant Flow

System Type: Variable Air Volume (VAV)

Number of Zones 36

Number of Rooms 74

Component	Quantity
Cooling Coils	36
Heating Coils	72
Fans	36

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow (cfm)	Vent (cfm)	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)			(°F)	(°F)	(°F)	(°F)			
	VRFHP-1 ACT-Noisy-1	DX	Peak		0.3	3.4	3.1	1.2	N/A	196	38	72.4	60.81	57.1	54.71	N/A	N/A	N/A
	VRFHP-1 ACT-Noisy-2	DX	Peak		0.1	1.7	1.5	1.2	N/A	101	38	69.1	59.28	55.0	53.14	N/A	N/A	N/A
	VRFHP-1 ACT-Noisy-3	DX	Peak		0.1	1.8	1.6	1.2	N/A	105	38	69.3	59.36	55.0	53.14	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-1	DX	Peak		0.1	1.1	0.9	0.9	N/A	60	27	67.6	58.11	53.5	51.51	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-2	DX	Peak		0.1	1.5	1.4	0.9	N/A	86	27	70.2	59.62	55.0	53.14	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-3	DX	Peak		0.1	1.3	1.2	0.9	N/A	78	28	69.5	59.45	55.0	53.14	N/A	N/A	N/A
	VRFHP-1 Admin	DX	Peak		0.2	2.4	2.3	0.6	N/A	121	21	73.0	59.89	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Atrium	DX	Peak		0.5	6.5	6.3	2.9	N/A	375	108	71.2	58.98	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	DX	Peak		0.1	1.2	1.1	0.7	N/A	66	22	70.3	59.38	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	DX	Peak		0.2	1.9	1.8	2.0	N/A	148	72	66.9	57.26	55.0	52.53	N/A	N/A	N/A
	VRFHP-1 Corridor-N	DX	Peak		0.2	2.2	2.2	0.5	N/A	123	25	72.6	57.87	55.0	50.95	N/A	N/A	N/A
	VRFHP-1 Corridor-S	DX	Peak		0.4	4.8	4.8	0.5	N/A	243	25	74.1	58.33	55.0	50.85	N/A	N/A	N/A
	VRFHP-1 Corridor-W	DX	Peak		0.4	5.4	5.4	0.4	N/A	266	19	74.5	58.71	55.0	51.11	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	DX	Peak		1.2	14.8	14.6	0.7	N/A	706	31	74.9	59.40	55.0	51.64	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	DX	Peak		0.1	1.0	0.9	1.1	N/A	76	37	66.9	57.37	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Group	DX	Peak		0.1	1.4	1.3	2.9	N/A	144	91	63.3	55.91	54.4	52.17	N/A	N/A	N/A
	VRFHP-1 Hospitality	DX	Peak		0.1	1.4	1.3	2.5	N/A	135	81	64.0	56.29	54.8	52.48	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	DX	Peak		0.3	3.8	3.6	1.9	N/A	221	69	70.6	58.99	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	DX	Peak		0.1	0.8	0.8	0.8	N/A	58	26	67.8	57.74	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Lounge	DX	Peak		0.3	3.7	3.4	2.0	N/A	238	65	70.6	59.91	56.7	54.39	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	DX	Peak		0.2	2.3	2.2	5.0	N/A	242	160	62.7	55.57	54.0	51.88	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	DX	Peak		0.2	2.8	2.6	0.4	N/A	155	14	74.6	61.83	58.5	55.64	N/A	N/A	N/A

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 31

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	(MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 RB-N-East	DX	Peak		0.4	4.7	4.4	0.9	N/A	256	28	74.4	61.73	58.0	55.32	N/A	N/A	N/A
	VRFHP-1 RB-N-West	DX	Peak		0.7	7.8	7.3	1.3	N/A	442	42	74.5	61.89	58.7	55.77	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	DX	Peak		0.2	2.3	2.2	0.4	N/A	126	14	74.3	61.72	57.9	55.25	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	DX	Peak		0.2	2.9	2.7	0.4	N/A	135	14	74.4	60.53	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 RB-S-East	DX	Peak		0.6	6.7	6.2	1.3	N/A	361	41	74.3	61.70	57.9	55.22	N/A	N/A	N/A
	VRFHP-1 RB-S-West	DX	Peak		0.2	2.5	2.3	0.4	N/A	141	14	74.5	61.87	58.7	55.73	N/A	N/A	N/A
	VRFHP-1 RB-W-North	DX	Peak		0.2	2.4	2.2	0.4	N/A	129	14	74.4	61.71	57.9	55.27	N/A	N/A	N/A
	VRFHP-1 RB-W-South	DX	Peak		0.7	8.9	8.3	1.1	N/A	410	42	74.5	60.46	55.0	52.61	N/A	N/A	N/A
	VRFHP-1 Servery	DX	Peak		0.1	1.0	0.9	2.4	N/A	107	75	61.9	55.12	53.5	51.49	N/A	N/A	N/A
	VRFHP-1 SHWR-N	DX	Peak		0.2	2.7	2.1	0.0	N/A	95	0	76.6	63.41	55.0	53.53	N/A	N/A	N/A
	VRFHP-1 SHWR-S	DX	Peak		0.2	2.9	2.3	0.0	N/A	104	0	76.5	63.29	55.0	53.53	N/A	N/A	N/A
	VRFHP-1 SHWR-W	DX	Peak		0.2	2.7	2.1	0.0	N/A	93	0	76.6	63.48	55.0	53.53	N/A	N/A	N/A
	VRFHP-1 Support	DX	Peak		0.4	5.0	5.0	0.8	N/A	256	36	73.8	58.46	55.0	51.11	N/A	N/A	N/A
	VRFHP-1 Utility	DX	Peak		1.0	12.0	11.9	4.3	N/A	670	164	72.0	59.18	55.0	52.58	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)	
	VRFHP-1 ACT-Noisy-1	DX	Peak	12/21 24:00	3.4	0.6	N/A	196	38	67.1	83.9	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-1	Electric	Peak	12/21 24:00	1.7	0.6	N/A	196	38	67.1	75.7	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-2	DX	Peak	12/21 24:00	1.7	0.6	N/A	101	38	64.4	80.8	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-2	Electric	Peak	12/21 24:00	1.5	0.6	N/A	101	38	64.4	78.5	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-3	DX	Peak	12/21 24:00	1.8	0.6	N/A	105	38	64.5	81.2	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-3	Electric	Peak	12/21 24:00	1.7	0.6	N/A	105	38	64.5	80.4	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-1	DX	Peak	12/21 24:00	1.1	0.4	N/A	60	27	63.2	80.3	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-1	Electric	Peak	12/21 24:00	0.8	0.4	N/A	60	27	63.2	75.8	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-2	DX	Peak	12/21 24:00	1.5	0.4	N/A	86	27	65.2	82.6	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-2	Electric	Peak	12/21 24:00	1.0	0.4	N/A	86	27	65.2	76.2	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-3	DX	Peak	12/21 24:00	1.3	0.4	N/A	78	28	64.7	81.6	N/A	N/A	N/A	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 31

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 ACT-Quiet-3	Electric	Peak	12/21 24:00	0.9	0.4	N/A	78	28	64.7	76.5	N/A	N/A	N/A
	VRFHP-1 Admin	DX	Peak	12/21 04:00	2.4	0.3	N/A	121	21	67.4	86.9	N/A	N/A	N/A
	VRFHP-1 Admin	Electric	Peak	12/21 04:00	1.3	0.3	N/A	121	21	67.4	77.5	N/A	N/A	N/A
	VRFHP-1 Atrium	DX	Peak	12/21 24:00	6.5	1.7	N/A	375	108	65.7	82.6	N/A	N/A	N/A
	VRFHP-1 Atrium	Electric	Peak	12/21 24:00	6.6	1.7	N/A	375	108	65.7	82.7	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	DX	Peak	12/21 04:00	1.2	0.3	N/A	66	22	65.0	83.1	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	Electric	Peak	12/21 04:00	0.7	0.3	N/A	66	22	65.0	75.9	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	DX	Peak	12/21 24:00	1.9	1.1	N/A	148	72	62.7	75.0	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	Electric	Peak	12/21 24:00	2.3	1.1	N/A	148	72	62.7	77.7	N/A	N/A	N/A
	VRFHP-1 Corridor-N	DX	Peak	12/21 24:00	2.2	0.4	N/A	123	25	67.0	84.8	N/A	N/A	N/A
	VRFHP-1 Corridor-N	Electric	Peak	12/21 24:00	2.1	0.4	N/A	123	25	67.0	83.6	N/A	N/A	N/A
	VRFHP-1 Corridor-S	DX	Peak	12/21 24:00	4.8	0.4	N/A	243	25	68.5	87.8	N/A	N/A	N/A
	VRFHP-1 Corridor-S	Electric	Peak	12/21 24:00	2.1	0.4	N/A	243	25	68.5	76.7	N/A	N/A	N/A
	VRFHP-1 Corridor-W	DX	Peak	12/21 24:00	5.4	0.3	N/A	266	19	68.9	88.6	N/A	N/A	N/A
	VRFHP-1 Corridor-W	Electric	Peak	12/21 24:00	1.8	0.3	N/A	266	19	68.9	75.6	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	DX	Peak	12/21 24:00	14.8	0.5	N/A	706	31	69.3	89.7	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	Electric	Peak	12/21 24:00	5.7	0.5	N/A	706	31	69.3	77.3	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	DX	Peak	12/21 04:00	1.0	0.6	N/A	76	37	62.6	75.0	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	Electric	Peak	12/21 04:00	1.0	0.6	N/A	76	37	62.6	75.2	N/A	N/A	N/A
	VRFHP-1 Group	DX	Peak	12/21 24:00	1.4	1.4	N/A	144	91	60.5	70.0	N/A	N/A	N/A
	VRFHP-1 Group	Electric	Peak	12/21 24:00	2.9	1.4	N/A	144	91	60.5	80.2	N/A	N/A	N/A
	VRFHP-1 Hospitality	DX	Peak	12/21 24:00	1.4	1.2	N/A	135	81	61.0	70.8	N/A	N/A	N/A
	VRFHP-1 Hospitality	Electric	Peak	12/21 24:00	2.6	1.2	N/A	135	81	61.0	79.6	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	DX	Peak	12/21 24:00	3.8	1.1	N/A	221	69	65.3	82.2	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	Electric	Peak	12/21 24:00	3.3	1.1	N/A	221	69	65.3	79.8	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	DX	Peak	12/21 04:00	0.8	0.4	N/A	58	26	63.2	76.6	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	Electric	Peak	12/21 04:00	0.8	0.4	N/A	58	26	63.2	76.4	N/A	N/A	N/A
	VRFHP-1 Lounge	DX	Peak	12/21 24:00	3.7	1.0	N/A	238	65	65.9	80.9	N/A	N/A	N/A
	VRFHP-1 Lounge	Electric	Peak	12/21 24:00	2.6	1.0	N/A	238	65	65.9	76.4	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	DX	Peak	12/21 24:00	2.3	2.5	N/A	242	160	60.1	69.4	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	Electric	Peak	12/21 24:00	5.0	2.5	N/A	242	160	60.1	80.3	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	DX	Peak	12/21 24:00	2.8	0.2	N/A	155	14	68.6	86.0	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	Electric	Peak	12/21 24:00	1.1	0.2	N/A	155	14	68.6	75.4	N/A	N/A	N/A
	VRFHP-1 RB-N-East	DX	Peak	12/21 24:00	4.7	0.4	N/A	256	28	68.3	86.3	N/A	N/A	N/A

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 31

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undrsizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 RB-N-East	Electric	Peak	12/21 24:00	2.0	0.4	N/A	256	28	68.3	75.8	N/A	N/A	N/A
	VRFHP-1 RB-N-West	DX	Peak	12/21 24:00	7.8	0.6	N/A	442	42	68.6	85.8	N/A	N/A	N/A
	VRFHP-1 RB-N-West	Electric	Peak	12/21 24:00	2.6	0.6	N/A	381	42	68.3	75.0	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	DX	Peak	12/21 24:00	2.3	0.2	N/A	126	14	68.3	86.4	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	Electric	Peak	12/21 24:00	1.1	0.2	N/A	126	14	68.3	76.6	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	DX	Peak	12/21 24:00	2.9	0.2	N/A	135	14	68.4	89.7	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	Electric	Peak	12/21 24:00	1.1	0.2	N/A	135	14	68.4	76.3	N/A	N/A	N/A
	VRFHP-1 RB-S-East	DX	Peak	12/21 24:00	6.7	0.6	N/A	361	41	68.3	86.4	N/A	N/A	N/A
	VRFHP-1 RB-S-East	Electric	Peak	12/21 24:00	2.4	0.6	N/A	355	41	68.3	75.0	N/A	N/A	N/A
	VRFHP-1 RB-S-West	DX	Peak	12/21 24:00	2.5	0.2	N/A	141	14	68.6	85.9	N/A	N/A	N/A
	VRFHP-1 RB-S-West	Electric	Peak	12/21 24:00	0.8	0.2	N/A	124	14	68.4	75.0	N/A	N/A	N/A
	VRFHP-1 RB-W-North	DX	Peak	12/21 24:00	2.4	0.2	N/A	129	14	68.3	86.4	N/A	N/A	N/A
	VRFHP-1 RB-W-North	Electric	Peak	12/21 24:00	1.2	0.2	N/A	129	14	68.3	77.1	N/A	N/A	N/A
	VRFHP-1 RB-W-South	DX	Peak	12/21 24:00	8.9	0.6	N/A	410	42	68.5	89.6	N/A	N/A	N/A
	VRFHP-1 RB-W-South	Electric	Peak	12/21 24:00	3.1	0.6	N/A	410	42	68.5	75.9	N/A	N/A	N/A
	VRFHP-1 Servery	DX	Peak	12/21 24:00	1.0	1.2	N/A	107	75	59.5	68.6	N/A	N/A	N/A
	VRFHP-1 Servery	Electric	Peak	12/21 24:00	2.2	1.2	N/A	107	75	59.5	79.2	N/A	N/A	N/A
	VRFHP-1 SHWR-N	DX	Peak	12/21 24:00	2.7	0.0	N/A	95	0	70.0	97.8	N/A	N/A	N/A
	VRFHP-1 SHWR-N	Electric	Peak	12/21 24:00	0.9	0.0	N/A	95	0	70.0	79.1	N/A	N/A	N/A
	VRFHP-1 SHWR-S	DX	Peak	12/21 24:00	2.9	0.0	N/A	104	0	70.0	97.4	N/A	N/A	N/A
	VRFHP-1 SHWR-S	Electric	Peak	12/21 24:00	0.9	0.0	N/A	104	0	70.0	78.2	N/A	N/A	N/A
	VRFHP-1 SHWR-W	DX	Peak	12/21 24:00	2.7	0.0	N/A	93	0	70.0	98.0	N/A	N/A	N/A
	VRFHP-1 SHWR-W	Electric	Peak	12/21 24:00	0.9	0.0	N/A	93	0	70.0	79.4	N/A	N/A	N/A
	VRFHP-1 Support	DX	Peak	12/21 04:00	5.0	0.6	N/A	256	36	67.9	86.9	N/A	N/A	N/A
	VRFHP-1 Support	Electric	Peak	12/21 04:00	3.3	0.6	N/A	256	36	67.9	80.5	N/A	N/A	N/A
	VRFHP-1 Utility	DX	Peak	12/21 04:00	12.0	2.5	N/A	670	164	66.3	83.8	N/A	N/A	N/A
	VRFHP-1 Utility	Electric	Peak	12/21 04:00	9.9	2.5	N/A	670	164	66.3	80.7	N/A	N/A	N/A

Load/Airflows

Location			Cooling					Heating					
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	8/21 17:00	196	3,650	38	57.1	12/21 24:00	196	1,152	38	75.7
		Noisy Activity 1	180	8/21 17:00	196	3,643	38	57.1	12/21 24:00	196	1,149	38	75.7
	ACT-Noisy-2		181	7/21 18:00	101	2,101	38	55.0	12/21 24:00	101	883	38	78.5
		Noisy Activity 2	181	7/21 18:00	100	2,075	38	55.0	12/21 24:00	100	867	38	78.5
	ACT-Noisy-3		182	7/21 15:00	105	2,184	38	55.0	12/21 24:00	105	1,124	38	80.4
		Noisy Activity 3	182	7/21 15:00	105	2,174	38	55.0	12/21 24:00	105	1,120	38	80.4
	ACT-Quiet-1		130	9/21 14:00	60	1,339	27	53.5	12/21 24:00	60	357	27	75.8
		Quiet Activity 1	130	9/21 14:00	60	1,332	27	53.4	12/21 24:00	60	351	27	75.7
	ACT-Quiet-2		131	9/21 14:00	86	1,796	27	55.0	12/21 24:00	86	547	27	76.2
		Quiet Activity 2	131	9/21 14:00	85	1,778	27	54.8	12/21 24:00	85	529	27	76.1
	ACT-Quiet-3		131	7/21 18:00	78	1,616	28	55.0	12/21 24:00	78	522	28	76.5
		Quiet Activity 3	131	7/21 18:00	77	1,609	28	55.0	12/21 24:00	77	518	28	76.5
	Admin		189	10/21 13:00	121	2,517	21	55.0	12/21 04:00	121	932	21	77.5
		Office 1	94	10/21 14:00	65	1,344	10	55.0	12/21 04:00	65	487	10	77.4
		Office 2	95	10/21 13:00	60	1,253	10	55.0	12/21 04:00	60	458	10	77.4
	Attrium		1,267	7/21 17:00	375	7,800	108	55.0	12/21 24:00	375	4,900	108	82.7
		Attrium	622	7/21 17:00	145	3,006	53	55.0	12/21 24:00	145	1,984	53	83.4
		Attrium 2	645	9/21 16:00	249	5,176	55	55.0	12/21 24:00	249	3,109	55	82.2
	Chart/Hotel		200	7/21 19:00	66	1,381	22	55.0	12/21 04:00	66	399	22	75.9
		Chart/Hotel	200	7/21 19:00	64	1,324	22	55.0	12/21 04:00	64	366	22	75.6
	Comfort/Consult		283	7/21 17:00	148	3,081	72	55.0	12/21 24:00	148	1,176	72	77.7
		Comfort Room 2	82	7/21 16:00	43	902	21	55.0	12/21 24:00	43	355	21	78.0
		Consult 1	100	7/21 17:00	51	1,063	25	55.0	12/21 24:00	51	397	25	77.6
		Consult 2	102	7/21 17:00	53	1,107	26	55.0	12/21 24:00	53	412	26	77.5
	Corridor-N		409	6/21 18:00	123	2,547	25	55.0	12/21 24:00	123	1,712	25	83.6
		Corridor 3	409	6/21 18:00	122	2,542	25	55.0	12/21 24:00	122	1,707	25	83.6
	Corridor-S		414	10/21 13:00	243	5,047	25	55.0	12/21 24:00	243	1,674	25	76.7
		Corridor 5	414	10/21 13:00	243	5,045	25	55.0	12/21 24:00	243	1,670	25	76.7
	Corridor-W		324	7/21 17:00	266	5,525	19	55.0	12/21 24:00	266	1,534	19	75.6
		Corridor 4	324	7/21 17:00	265	5,499	19	55.0	12/21 24:00	265	1,516	19	75.6
	Entry/Waiting		370	7/21 09:00	706	14,656	31	55.0	12/21 24:00	706	5,258	31	77.3
		Entry/Waiting	370	7/21 09:00	710	14,737	31	55.0	12/21 24:00	710	5,278	31	77.3

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 9 of 31

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Exam/Storage		224	7/21 19:00	76	1,572	37	55.0	12/21 04:00	76	402	37	75.2
		Exam Room	123	7/21 19:00	49	1,016	31	55.0	12/21 19:00	49	143	31	75.0
		Long Term Belongings Storage	101	7/21 19:00	24	508	6	55.0	12/21 04:00	24	231	6	79.2
	Group		276	7/21 18:00	144	3,081	91	54.4	12/21 24:00	144	1,500	91	80.2
		Group	276	7/21 18:00	143	3,075	91	54.3	12/21 24:00	143	1,503	91	80.2
	Hospitality		246	7/21 16:00	135	2,830	81	54.8	12/21 24:00	135	1,324	81	79.6
		Hospitality	246	7/21 16:00	135	2,832	81	54.8	12/21 24:00	135	1,326	81	79.6
	Intake-HR-A		470	9/21 14:00	221	4,598	69	55.0	12/21 24:00	221	2,232	69	79.8
		Intake Corridor	155	7/21 18:00	28	573	9	55.0	12/21 20:00	28	328	9	81.6
		Interview Room	158	9/21 16:00	87	1,805	40	55.0	12/21 24:00	87	778	40	78.7
		Sally Port	78	10/21 13:00	70	1,462	20	55.0	12/21 19:00	70	604	20	78.4
		Shower 1	80	7/21 17:00	36	757	0	55.0	12/21 24:00	36	366	0	79.8
	Intake-HR-B		165	7/21 19:00	58	1,203	26	55.0	12/21 04:00	58	378	26	76.4
		Ante Room	81	7/21 19:00	21	428	5	55.0	12/21 04:00	21	191	5	79.0
		Comfort Room 1	84	7/21 18:00	37	770	21	55.0	12/21 07:00	37	181	21	75.0
	Lounge		297	10/21 14:00	238	4,536	65	56.7	12/21 24:00	238	1,556	65	76.4
		Lounge	198	10/21 14:00	177	3,676	65	55.0	12/21 19:00	177	1,237	65	76.8
		Shower 2	99	9/21 17:00	55	1,139	0	55.0	12/21 19:00	55	321	0	75.7
	Multipurpose/Dining		485	7/21 16:00	242	5,270	160	54.0	12/21 24:00	242	2,555	160	80.3
		Multipurpose/Dining	485	7/21 16:00	241	5,262	160	53.9	12/21 24:00	241	2,555	160	80.4
	RB-N-Corner		130	7/21 18:00	155	2,667	14	58.5	12/21 24:00	155	867	14	75.4
		Resident Room 14	130	7/21 18:00	156	2,668	14	58.5	12/21 24:00	156	867	14	75.4
	RB-N-East		257	7/21 10:00	256	4,524	28	58.0	12/21 24:00	256	1,527	28	75.8
		Resident Room 15	130	7/21 10:00	131	2,319	14	58.0	12/21 24:00	131	873	14	76.5
		Resident Room 16	127	7/21 10:00	123	2,196	14	57.9	12/21 24:00	123	654	14	75.2
	RB-N-West		383	7/21 17:00	442	7,481	42	58.7	12/21 24:00	442	1,954	42	75.0
		Resident Room 11	129	7/21 17:00	145	2,463	14	58.7	12/21 24:00	145	639	14	75.0
		Resident Room 12	127	7/21 17:00	147	2,488	14	58.8	12/21 24:00	147	641	14	75.0
		Resident Room 13	127	7/21 17:00	148	2,500	14	58.8	12/21 24:00	148	658	14	75.0
	RB-S-Corner-N		129	7/21 10:00	126	2,244	14	57.9	12/21 24:00	126	855	14	76.6
		Resident Room 04	129	7/21 10:00	127	2,248	14	57.9	12/21 24:00	127	858	14	76.6

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 10 of 31

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-Corner-S		131	9/21 17:00	135	2,804	14	55.0	12/21 24:00	135	871	14	76.3
		Resident Room 05	131	9/21 17:00	135	2,803	14	55.0	12/21 24:00	135	870	14	76.3
	RB-S-East		372	7/21 10:00	361	6,422	41	57.9	12/21 24:00	361	1,820	41	75.0
		Resident Room 01	124	8/21 10:00	114	2,027	14	58.0	12/21 24:00	114	545	14	75.0
		Resident Room 02	112	7/21 10:00	118	2,046	12	58.3	12/21 24:00	118	576	12	75.0
		Resident Room 03	136	7/21 10:00	132	2,346	15	57.9	12/21 24:00	132	687	15	75.1
	RB-S-West		124	7/21 17:00	141	2,402	14	58.7	12/21 24:00	141	638	14	75.0
		Resident Room 06	124	7/21 17:00	141	2,400	14	58.7	12/21 24:00	141	637	14	75.0
	RB-W-North		130	7/21 18:00	129	2,297	14	57.9	12/21 24:00	129	946	14	77.1
		Resident Room 10	130	7/21 18:00	129	2,296	14	57.9	12/21 24:00	129	945	14	77.1
	RB-W-South		380	10/21 14:00	410	8,516	42	55.0	12/21 24:00	410	2,459	42	75.9
		Resident Room 07	125	10/21 14:00	132	2,739	14	55.0	12/21 24:00	132	716	14	75.3
		Resident Room 08	126	10/21 14:00	137	2,844	14	55.0	12/21 24:00	137	754	14	75.4
		Resident Room 09	128	10/21 14:00	141	2,925	14	55.0	12/21 24:00	141	955	14	76.6
	Servery		228	7/21 17:00	107	2,401	75	53.5	12/21 24:00	107	1,012	75	79.2
		Servery	228	7/21 17:00	107	2,400	75	53.5	12/21 24:00	107	1,013	75	79.2
	SHWR-N		204	7/21 12:00	95	1,981	0	55.0	12/21 24:00	95	886	0	79.1
		Shower 7	103	7/21 12:00	49	1,013	0	55.0	12/21 24:00	49	436	0	78.7
		Shower 8	101	7/21 12:00	46	960	0	55.0	12/21 24:00	46	439	0	79.3
	SHWR-S		207	7/21 18:00	104	2,155	0	55.0	12/21 24:00	104	875	0	78.2
		Shower 3	104	7/21 18:00	52	1,073	0	55.0	12/21 24:00	52	430	0	78.1
		Shower 4	103	8/21 18:00	52	1,077	0	55.0	12/21 24:00	52	442	0	78.3
	SHWR-W		207	7/21 18:00	93	1,931	0	55.0	12/21 24:00	93	892	0	79.4
		Shower 5	104	7/21 18:00	47	980	0	55.0	12/21 24:00	47	453	0	79.4
		Shower 6	104	7/21 18:00	45	945	0	55.0	12/21 24:00	45	434	0	79.3
	Support		603	7/21 19:00	256	5,311	36	55.0	12/21 04:00	256	2,755	36	80.5
		Electric	191	9/21 15:00	87	1,803	11	55.0	12/21 04:00	87	1,026	11	81.5
		Emergency Electric	179	7/21 09:00	70	1,446	11	55.0	12/21 04:00	70	672	11	79.4
		Fire Room	79	8/21 09:00	47	970	5	55.0	12/21 04:00	47	518	5	80.8
		Mechanical	155	7/21 19:00	53	1,092	9	55.0	12/21 04:00	53	285	9	75.3

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 11 of 31

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Utility	2,926	7/21 19:00	670	13,920	164	55.0	12/21 04:00	670	7,352	164	80.7
		Clean Supply	102	7/21 19:00	23	482	6	55.0	12/21 04:00	23	230	6	79.6
		Corridor 1	295	7/21 18:00	55	1,146	18	55.0	12/21 24:00	55	665	18	81.8
		Corridor 2	635	7/21 18:00	101	2,089	38	55.0	12/21 24:00	101	1,246	38	82.1
		Corridor 2.1	85	9/21 16:00	18	382	5	55.0	12/21 24:00	18	222	5	81.8
		General Storage	96	7/21 19:00	41	861	6	55.0	12/21 04:00	41	254	6	76.0
		Hskp	57	7/21 19:00	14	294	3	55.0	12/21 04:00	14	133	3	79.2
		IT	158	7/21 19:00	49	1,018	9	55.0	12/21 04:00	49	102	9	75.0
		Laundry	122	7/21 19:00	27	565	7	55.0	12/21 04:00	27	270	7	79.7
		Meds	129	7/21 19:00	29	608	8	55.0	12/21 04:00	29	296	8	79.9
		Soiled Supply	97	7/21 19:00	23	471	6	55.0	12/21 04:00	23	220	6	79.5
		Staff Corridor	893	9/21 16:00	199	4,121	54	55.0	12/21 07:00	199	2,360	54	81.6
		Stor.	15	7/21 19:00	8	164	1	55.0	12/21 04:00	8	78	1	79.6
		Storage	52	7/21 18:00	20	407	3	55.0	12/21 04:00	20	235	3	81.7
		Toilet 1	67	7/21 10:00	41	862	0	55.0	12/21 24:00	41	359	0	78.4
		Toilet 2	62	7/21 18:00	18	462	0	50.4	12/21 19:00	18	151	0	78.1
		Toilet 3	62	7/21 18:00	18	467	0	50.6	12/21 19:00	18	158	0	78.3

Fans

			Efficiency with PRM					Power with PRM	Motor Heat
			Efficiency	Fan Override	Static Pressure	Flow Rate	Power	Fan Override	in Air
System	Zone	Type	(%)	(%)	(in. Wg)	(cfm)	(kW)	(kW)	(%)
	ACT-Noisy-1_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	196	.03	N/A	100.00
	ACT-Noisy-2_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	101	.01	N/A	100.00
	ACT-Noisy-3_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	105	.02	N/A	100.00
	ACT-Quiet-1_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	60	.01	N/A	100.00

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 12 of 31

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat in Air
			(%)	Fan Override (%)	Pressure (in. Wg)			Fan Override (kW)	
	ACT-Quiet-2_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	86	.01	N/A	100.00
	ACT-Quiet-3_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	78	.01	N/A	100.00
	Admin_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	121	.02	N/A	100.00
	Attrium_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	375	.06	N/A	100.00
	Chart/Hotel_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	66	.01	N/A	100.00
	Comfort/Consult_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	148	.02	N/A	100.00
	Corridor-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	123	.02	N/A	100.00
	Corridor-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	243	.04	N/A	100.00
	Corridor-W_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	266	.04	N/A	100.00
	Entry/Waiting_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	706	.10	N/A	100.00
	Exam/Storage_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	76	.01	N/A	100.00
	Group_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	144	.02	N/A	100.00
	Hospitality_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	135	.02	N/A	100.00
	Intake-HR-A_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	221	.03	N/A	100.00
	Intake-HR-B_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	58	.01	N/A	100.00
	Lounge_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	238	.03	N/A	100.00
	Multipurpose/Dining_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	242	.04	N/A	100.00
	RB-N-Corner_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	155	.02	N/A	100.00
	RB-N-East_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	256	.04	N/A	100.00
	RB-N-West_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	442	.06	N/A	100.00
	RB-S-Corner-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	126	.02	N/A	100.00
	RB-S-Corner-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	135	.02	N/A	100.00

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 13 of 31

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
	RB-S-East_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	361	.05	N/A	100.00
	RB-S-West_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	141	.02	N/A	100.00
	RB-W-North_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	129	.02	N/A	100.00
	RB-W-South_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	410	.06	N/A	100.00
	Servery_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	107	.02	N/A	100.00
	SHWR-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	95	.01	N/A	100.00
	SHWR-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	104	.02	N/A	100.00
	SHWR-W_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	93	.01	N/A	100.00
	Support_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	256	.04	N/A	100.00
	Utility_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	670	.10	N/A	100.00

Loop Name: Air Source VRF
Loop Type: VRF Loop
Number of Assigned Coils: 0

Pumps

Name	Type	Contol	Head (psig)	Flow (gpm)	Power (W)	Power per Flow (W/gpm)
------	------	--------	-------------	------------	-----------	------------------------

Plant Equipment

Name	Type	Nominal Capacity (tons)	Efficiency (COP)
Air Source VRF OVRF-1	Condenser Loop	10.98	0.00

System Component Selection Summary

ASHRAE 90.1-2010 Baseline

System Name: System 10 - 2010/2013

System Type: 90.1 Systems
Number of Zones 1
Number of Rooms 1

Component	Quantity
Cooling Coils	0
Heating Coils	1
Fans	1

Cooling Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow (cfm)	Vent (cfm)	Enter DB/WB	Leave DB/WB		Flow (gpm)	Enter Temp	Leave Temp
				Mo/D/Hr	(tons)	(MBh)	(MBh)	(MBh)	(MBh)			(°F)	(°F)	(°F)		(°F)	
																N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SHC-1		Electric	Block	12/21 04:00	3.8	3.8	N/A	85	0	70.0	113.8	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 10 - 2010/2013			79		0	0	85	55.0	12/21 04:00	85	3,807	85	105.0
		Fire Room	79	9/21 14:00	85	1,762	85	55.0	12/21 04:00	85	857	85	105.0
		Fire Room	79	7/21 10:00	74	1,534	74	55.0	12/21 04:00	74	824	74	105.0

Fans

System	Zone	Type	Efficiency with PRM						
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
System 10 - 2010/2013 SF-1		System	60.00	118.00	3.00	85	.05	.03	100.00

System Name: System 2 - 2007/2010/2013

System Type: 90.1 Systems
 Number of Zones 16
 Number of Rooms 27

Component	Quantity
Cooling Coils	16
Heating Coils	32
Fans	19

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow (cfm)	Vent (cfm)	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)			(°F)	(°F)	(°F)	(°F)			
SAAHP-1	Attrium	DX	Peak		1.5	17.4	14.1	0.0	N/A	568	0	79.0	60.88	55.0	51.11	N/A	N/A	N/A
SAAHP-1	Corridor-N	DX	Peak		0.5	5.9	5.2	0.3	N/A	175	25	83.4	61.81	55.0	51.09	N/A	N/A	N/A
SAAHP-1	Corridor-S	DX	Peak		0.6	7.3	6.4	0.5	N/A	220	25	82.9	61.67	55.0	51.09	N/A	N/A	N/A
SAAHP-1	Corridor-W	DX	Peak		0.3	4.1	3.6	0.5	N/A	108	19	87.2	63.10	55.0	51.09	N/A	N/A	N/A
SAAHP-1	RB-N-Corner	DX	Peak		0.3	3.4	2.7	0.3	N/A	96	14	81.6	62.21	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-N-East	DX	Peak		0.6	7.1	5.9	0.4	N/A	219	28	80.9	61.47	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-N-West	DX	Peak		0.7	8.5	6.6	0.8	N/A	230	42	82.6	62.70	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-S-Corner-N	DX	Peak		0.3	3.9	3.2	0.2	N/A	124	14	80.3	61.22	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-S-Corner-S	DX	Peak		0.3	3.8	3.0	0.2	N/A	115	14	80.0	61.52	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-S-East	DX	Peak		0.8	9.5	7.8	0.5	N/A	284	41	81.4	61.68	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-S-West	DX	Peak		0.2	2.9	2.2	0.3	N/A	78	14	82.4	62.65	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-W-North	DX	Peak		0.3	3.7	2.9	0.1	N/A	114	14	79.4	61.34	55.0	51.11	N/A	N/A	N/A
SAAHP-1	RB-W-South	DX	Peak		1.1	12.9	10.3	0.7	N/A	401	42	79.8	61.34	55.0	51.11	N/A	N/A	N/A
SAAHP-1	SHWR-N	DX	Peak		0.3	4.2	3.0	0.0	N/A	125	0	78.5	61.67	55.0	51.11	N/A	N/A	N/A
SAAHP-1	SHWR-S	DX	Peak		0.3	3.9	2.7	0.0	N/A	111	0	78.8	62.04	55.0	51.11	N/A	N/A	N/A
SAAHP-1	SHWR-W	DX	Peak		0.4	4.2	3.0	0.0	N/A	124	0	78.6	61.81	55.0	51.11	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING	Attrium	DX	Peak	12/21 24:00	17.4	17.4	N/A	568	0	70.0	99.9	N/A	N/A	N/A
SHC-1	Attrium	Electric	Peak	12/21 24:00	18.2	18.2	N/A	568	0	70.0	101.3	N/A	N/A	N/A
SAAHP-1HEATING	Corridor-N	DX	Peak	12/21 24:00	5.9	5.9	N/A	175	25	64.7	97.7	N/A	N/A	N/A
SHC-1	Corridor-N	Electric	Peak	12/21 24:00	6.8	6.8	N/A	175	25	64.7	102.6	N/A	N/A	N/A
SAAHP-1HEATING	Corridor-S	DX	Peak	12/21 24:00	7.3	7.3	N/A	220	25	65.7	98.2	N/A	N/A	N/A
SHC-1	Corridor-S	Electric	Peak	12/21 24:00	8.3	8.3	N/A	220	25	65.7	102.3	N/A	N/A	N/A
SAAHP-1HEATING	Corridor-W	DX	Peak	12/21 24:00	4.1	4.1	N/A	108	19	63.2	100.7	N/A	N/A	N/A
SHC-1	Corridor-W	Electric	Peak	12/21 24:00	4.4	4.4	N/A	108	19	63.2	103.0	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-Corner	DX	Peak	12/21 24:00	3.4	3.4	N/A	96	14	64.4	98.8	N/A	N/A	N/A
SHC-1	RB-N-Corner	Electric	Peak	12/21 24:00	3.8	3.8	N/A	96	14	64.4	102.7	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-East	DX	Peak	12/21 24:00	7.1	7.1	N/A	219	28	65.1	97.0	N/A	N/A	N/A
SHC-1	RB-N-East	Electric	Peak	12/21 24:00	8.4	8.4	N/A	219	28	65.1	102.5	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-West	DX	Peak	12/21 24:00	8.5	8.5	N/A	230	42	63.1	99.2	N/A	N/A	N/A
SHC-1	RB-N-West	Electric	Peak	12/21 24:00	9.4	9.4	N/A	230	42	63.1	103.0	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-Corner-N	DX	Peak	12/21 24:00	3.9	3.9	N/A	124	14	65.6	96.6	N/A	N/A	N/A
SHC-1	RB-S-Corner-N	Electric	Peak	12/21 24:00	4.6	4.6	N/A	124	14	65.6	102.3	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-Corner-S	DX	Peak	12/21 24:00	3.8	3.8	N/A	115	14	65.2	97.3	N/A	N/A	N/A
SHC-1	RB-S-Corner-S	Electric	Peak	12/21 24:00	4.4	4.4	N/A	115	14	65.2	102.4	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-East	DX	Peak	12/21 24:00	9.5	9.5	N/A	284	41	64.5	97.1	N/A	N/A	N/A
SHC-1	RB-S-East	Electric	Peak	12/21 24:00	11.1	11.1	N/A	284	41	64.5	102.6	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-West	DX	Peak	12/21 24:00	2.9	2.9	N/A	78	14	63.4	99.4	N/A	N/A	N/A
SHC-1	RB-S-West	Electric	Peak	12/21 24:00	3.2	3.2	N/A	78	14	63.4	102.9	N/A	N/A	N/A
SAAHP-1HEATING	RB-W-North	DX	Peak	12/21 24:00	3.7	3.7	N/A	114	14	65.3	96.7	N/A	N/A	N/A
SHC-1	RB-W-North	Electric	Peak	12/21 24:00	4.3	4.3	N/A	114	14	65.3	102.4	N/A	N/A	N/A
SAAHP-1HEATING	RB-W-South	DX	Peak	12/21 24:00	12.9	12.9	N/A	401	42	66.1	97.5	N/A	N/A	N/A
SHC-1	RB-W-South	Electric	Peak	12/21 24:00	14.9	14.9	N/A	401	42	66.1	102.2	N/A	N/A	N/A
SAAHP-1HEATING	SHWR-N	DX	Peak	12/21 24:00	4.2	4.2	N/A	125	0	70.0	102.6	N/A	N/A	N/A
SHC-1	SHWR-N	Electric	Peak	12/21 24:00	4.0	4.0	N/A	125	0	70.0	101.2	N/A	N/A	N/A
SAAHP-1HEATING	SHWR-S	DX	Peak	12/21 24:00	3.9	3.9	N/A	111	0	70.0	103.9	N/A	N/A	N/A
SHC-1	SHWR-S	Electric	Peak	12/21 24:00	3.6	3.6	N/A	111	0	70.0	101.3	N/A	N/A	N/A
SAAHP-1HEATING	SHWR-W	DX	Peak	12/21 24:00	4.2	4.2	N/A	124	0	70.0	103.1	N/A	N/A	N/A
SHC-1	SHWR-W	Electric	Peak	12/21 24:00	4.0	4.0	N/A	124	0	70.0	101.2	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Attrium		1,267	7/21 16:00	568	11,794	568	55.0	12/21 24:00	568	7,245	568	90.0
		Attrium	622	7/21 17:00	199	4,134	199	55.0	12/21 19:00	199	2,782	199	90.0
		Attrium 2	645	9/21 15:00	367	7,626	367	55.0	12/21 19:00	367	4,704	367	90.0
	Corridor-N		409	7/21 09:00	175	3,633	175	55.0	12/21 24:00	175	2,392	175	90.0
		Corridor 3	409	7/21 18:00	118	2,444	118	55.0	12/21 24:00	118	2,421	118	90.1
	Corridor-S		414	7/21 17:00	220	4,568	220	55.0	12/21 24:00	220	2,406	220	90.0
		Corridor 5	414	10/21 13:00	176	3,652	176	55.0	12/21 19:00	176	2,365	176	90.0
	Corridor-W		324	7/21 18:00	108	2,234	108	55.0	12/21 24:00	108	2,166	108	90.0
		Corridor 4	324	7/21 17:00	209	4,336	209	55.0	12/21 19:00	209	2,147	209	90.0
	RB-N-Corner		130	7/21 12:00	96	2,000	96	55.0	12/21 24:00	96	1,349	96	90.0
		Resident Room 14	130	7/21 18:00	126	2,611	126	55.0	12/21 24:00	126	1,345	126	90.0
	RB-N-East		257	9/21 14:00	219	4,541	219	55.0	12/21 24:00	219	2,315	219	90.0
		Resident Room 15	130	7/21 10:00	102	2,119	102	55.0	12/21 24:00	102	1,351	102	90.0
		Resident Room 16	127	7/21 10:00	95	1,977	95	55.0	12/21 24:00	95	961	95	90.0
	RB-N-West		383	7/21 17:00	230	4,782	230	55.0	12/21 24:00	230	2,863	230	90.0
		Resident Room 11	129	7/21 18:00	111	2,311	111	55.0	12/21 24:00	111	941	111	90.0
		Resident Room 12	127	7/21 18:00	111	2,309	111	55.0	12/21 24:00	111	941	111	90.0
		Resident Room 13	127	7/21 18:00	112	2,326	112	55.0	12/21 24:00	112	968	112	90.0
	RB-S-Corner-N		129	9/21 16:00	124	2,564	124	55.0	12/21 24:00	124	1,324	124	90.0
		Resident Room 04	129	9/21 14:00	110	2,275	110	55.0	12/21 19:00	110	1,333	110	90.0
	RB-S-Corner-S		131	7/21 18:00	115	2,376	115	55.0	12/21 24:00	115	1,348	115	90.0
		Resident Room 05	131	9/21 16:00	136	2,817	136	55.0	12/21 19:00	136	1,351	136	90.0
	RB-S-East		372	9/21 14:00	284	5,890	284	55.0	12/21 24:00	284	2,654	284	90.0
		Resident Room 01	124	8/21 10:00	82	1,707	82	55.0	12/21 19:00	82	782	82	90.0
		Resident Room 02	112	7/21 10:00	87	1,797	87	55.0	12/21 19:00	87	844	87	90.0
		Resident Room 03	136	7/21 10:00	101	2,090	101	55.0	12/21 19:00	101	1,014	101	90.0
	RB-S-West		124	7/21 18:00	78	1,626	78	55.0	12/21 24:00	78	942	78	90.0
		Resident Room 06	124	7/21 17:00	109	2,265	109	55.0	12/21 19:00	109	940	109	90.0
	RB-W-North		130	7/21 10:00	114	2,365	114	55.0	12/21 24:00	114	1,439	114	90.0
		Resident Room 10	130	7/21 18:00	118	2,450	118	55.0	12/21 19:00	118	1,442	118	90.0

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-W-South		380	7/21 17:00	401	8,318	401	55.0	12/21 24:00	401	3,604	401	90.0
		Resident Room 07	125	9/21 14:00	111	2,302	111	55.0	12/21 19:00	111	1,028	111	90.0
		Resident Room 08	126	10/21 14:00	115	2,379	115	55.0	12/21 19:00	115	1,085	115	90.0
		Resident Room 09	128	9/21 15:00	134	2,777	134	55.0	12/21 19:00	134	1,449	134	90.0
	SHWR-N		204	9/21 14:00	125	2,589	125	55.0	12/21 24:00	125	1,338	125	90.0
		Shower 7	103	7/21 11:00	61	1,266	61	55.0	12/21 24:00	61	661	61	90.0
		Shower 8	101	7/21 11:00	58	1,205	58	55.0	12/21 24:00	58	660	58	90.0
	SHWR-S		207	7/21 18:00	111	2,302	111	55.0	12/21 24:00	111	1,330	111	90.0
		Shower 3	104	7/21 18:00	70	1,446	70	55.0	12/21 19:00	70	656	70	90.0
		Shower 4	103	7/21 18:00	70	1,462	70	55.0	12/21 19:00	70	669	70	90.0
	SHWR-W		207	7/21 11:00	124	2,578	124	55.0	12/21 24:00	124	1,365	124	90.0
		Shower 5	104	7/21 18:00	57	1,192	57	55.0	12/21 19:00	57	688	57	90.0
		Shower 6	104	7/21 18:00	56	1,153	56	55.0	12/21 19:00	56	656	56	90.0

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM		Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Fan Override (kW)	
Attrium _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	568	.33	.17	100.00
Corridor-N _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	175	.10	.05	100.00
Corridor-S _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	220	.13	.07	100.00
Corridor-W _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	108	.06	.03	100.00
RB-N-Corner _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	96	.06	.03	100.00
RB-N-East _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	219	.13	.07	100.00
RB-N-West _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	230	.14	.07	100.00
RB-S-Corner-N _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	124	.07	.04	100.00
RB-S-Corner-S _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	115	.07	.03	100.00
RB-S-East _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	284	.17	.09	100.00
RB-S-West _System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	78	.05	.02	100.00

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 21 of 31

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
RB-W-North_System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	114	.07	.03	100.00
RB-W-South_System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	401	.24	.12	100.00
	SHWR-N_EXHAUST FAN	Zone	10.00	N/A	0.00	407	.00	N/A	100.00
SHWR-N_System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	125	.07	.04	100.00
	SHWR-S_EXHAUST FAN	Zone	10.00	N/A	0.00	414	.00	N/A	100.00
SHWR-S_System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	111	.07	.03	100.00
	SHWR-W_EXHAUST FAN	Zone	10.00	N/A	0.00	414	.00	N/A	100.00
SHWR-W_System 2 - 2007/2010/2013 SF-1		System	60.00	118.00	3.00	124	.07	.04	100.00

System Name: System 4 - 2007/2010/2013

System Type: 90.1 Systems
 Number of Zones 20
 Number of Rooms 46

Component	Quantity
Cooling Coils	20
Heating Coils	40
Fans	23

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow (cfm)	Vent (cfm)	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)			(°F)	(°F)	(°F)	(°F)			
SAAHP-1	ACT-Noisy-1	DX	Peak		0.4	4.9	3.7	0.7	N/A	118	38	83.4	63.13	53.1	50.02	N/A	N/A	N/A
SAAHP-1	ACT-Noisy-2	DX	Peak		0.4	4.9	3.7	0.7	N/A	116	38	83.7	63.28	53.1	50.02	N/A	N/A	N/A
SAAHP-1	ACT-Noisy-3	DX	Peak		0.4	4.8	3.6	0.7	N/A	113	38	83.9	63.26	53.1	50.02	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-1	DX	Peak		0.2	3.0	2.2	0.4	N/A	66	27	85.8	64.05	53.1	50.02	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-2	DX	Peak		0.3	3.6	2.7	0.4	N/A	92	27	81.6	62.44	53.1	50.02	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-3	DX	Peak		0.3	3.2	2.4	0.5	N/A	73	28	84.9	63.66	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Admin	DX	Peak		0.5	6.1	4.8	0.4	N/A	184	21	78.2	60.63	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Chart/Hotel	DX	Peak		0.3	3.3	2.5	0.4	N/A	80	22	83.9	63.18	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Comfort/Consult	DX	Peak		0.7	8.1	6.6	1.5	N/A	179	72	88.6	64.13	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Entry/Waiting	DX	Peak		1.4	16.2	13.8	0.5	N/A	557	31	76.9	59.55	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Exam/Storage	DX	Peak		0.4	4.4	3.5	0.8	N/A	97	37	87.9	63.96	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Group	DX	Peak		0.7	8.4	6.6	1.7	N/A	186	91	87.3	64.02	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Hospitality	DX	Peak		0.6	7.4	5.9	1.5	N/A	165	81	87.4	64.03	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Intake-HR-A	DX	Peak		1.1	12.9	10.3	1.4	N/A	333	69	83.0	62.29	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Intake-HR-B	DX	Peak		0.3	3.4	2.7	0.6	N/A	79	26	86.3	63.44	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Lounge	DX	Peak		1.0	11.5	8.9	1.2	N/A	317	65	80.2	61.65	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Multipurpose/Dining	DX	Peak		1.2	14.3	11.3	3.0	N/A	315	160	87.8	64.16	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Servery	DX	Peak		0.5	6.6	5.2	1.4	N/A	144	75	88.1	64.27	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Support	DX	Peak		1.0	11.5	10.0	0.5	N/A	385	31	78.1	59.79	53.1	50.02	N/A	N/A	N/A
SAAHP-1	Utility	DX	Peak		3.3	39.6	32.7	3.8	N/A	1,060	164	82.8	61.93	53.1	50.02	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING ACT-Noisy-1		DX	Peak	12/21 24:00	4.9	4.9	N/A	118	38	57.9	98.6	N/A	N/A	N/A
SHC-1 ACT-Noisy-1		Electric	Peak	12/21 24:00	5.6	5.6	N/A	118	38	57.9	104.3	N/A	N/A	N/A
SAAHP-1HEATING ACT-Noisy-2		DX	Peak	12/21 24:00	4.9	4.9	N/A	116	38	57.5	98.8	N/A	N/A	N/A
SHC-1 ACT-Noisy-2		Electric	Peak	12/21 24:00	5.5	5.5	N/A	116	38	57.5	104.4	N/A	N/A	N/A
SAAHP-1HEATING ACT-Noisy-3		DX	Peak	12/21 24:00	4.8	4.8	N/A	113	38	57.1	98.3	N/A	N/A	N/A
SHC-1 ACT-Noisy-3		Electric	Peak	12/21 24:00	5.5	5.5	N/A	113	38	57.1	104.5	N/A	N/A	N/A
SAAHP-1HEATING ACT-Quiet-1		DX	Peak	12/21 01:00	3.0	3.0	N/A	66	27	54.2	98.2	N/A	N/A	N/A
SHC-1 ACT-Quiet-1		Electric	Peak	12/21 01:00	3.4	3.4	N/A	66	27	54.2	105.2	N/A	N/A	N/A
SAAHP-1HEATING ACT-Quiet-2		DX	Peak	12/21 24:00	3.6	3.6	N/A	92	27	58.7	96.9	N/A	N/A	N/A
SHC-1 ACT-Quiet-2		Electric	Peak	12/21 24:00	4.3	4.3	N/A	92	27	58.7	104.1	N/A	N/A	N/A
SAAHP-1HEATING ACT-Quiet-3		DX	Peak	12/21 24:00	3.2	3.2	N/A	73	28	55.6	98.2	N/A	N/A	N/A
SHC-1 ACT-Quiet-3		Electric	Peak	12/21 24:00	3.7	3.7	N/A	73	28	55.6	104.8	N/A	N/A	N/A
SAAHP-1HEATING Admin		DX	Peak	12/21 04:00	6.1	6.1	N/A	184	21	65.7	97.8	N/A	N/A	N/A
SHC-1 Admin		Electric	Peak	12/21 04:00	6.9	6.9	N/A	184	21	65.7	102.3	N/A	N/A	N/A
SAAHP-1HEATING Chart/Hotel		DX	Peak	12/21 04:00	3.3	3.3	N/A	80	22	59.6	100.4	N/A	N/A	N/A
SHC-1 Chart/Hotel		Electric	Peak	12/21 04:00	3.6	3.6	N/A	80	22	59.6	103.9	N/A	N/A	N/A
SAAHP-1HEATING Comfort/Consult		DX	Peak	12/21 24:00	8.1	8.1	N/A	179	72	54.7	98.9	N/A	N/A	N/A
SHC-1 Comfort/Consult		Electric	Peak	12/21 24:00	9.3	9.3	N/A	179	72	54.7	105.1	N/A	N/A	N/A
SAAHP-1HEATING Entry/Waiting		DX	Peak	12/21 24:00	16.2	16.2	N/A	557	31	67.9	96.2	N/A	N/A	N/A
SHC-1 Entry/Waiting		Electric	Peak	12/21 24:00	19.4	19.4	N/A	557	31	67.9	101.8	N/A	N/A	N/A
SAAHP-1HEATING Exam/Storage		DX	Peak	12/21 01:00	4.4	4.4	N/A	97	37	55.4	99.0	N/A	N/A	N/A
SHC-1 Exam/Storage		Electric	Peak	12/21 01:00	4.9	4.9	N/A	97	37	55.4	104.9	N/A	N/A	N/A
SAAHP-1HEATING Group		DX	Peak	12/21 24:00	8.4	8.4	N/A	186	91	51.4	95.3	N/A	N/A	N/A
SHC-1 Group		Electric	Peak	12/21 24:00	10.4	10.4	N/A	186	91	51.4	105.9	N/A	N/A	N/A
SAAHP-1HEATING Hospitality		DX	Peak	12/21 24:00	7.4	7.4	N/A	165	81	51.4	95.2	N/A	N/A	N/A
SHC-1 Hospitality		Electric	Peak	12/21 24:00	9.2	9.2	N/A	165	81	51.4	105.9	N/A	N/A	N/A
SAAHP-1HEATING Intake-HR-A		DX	Peak	12/21 24:00	12.9	12.9	N/A	333	69	62.1	99.8	N/A	N/A	N/A
SHC-1 Intake-HR-A		Electric	Peak	12/21 24:00	14.0	14.0	N/A	333	69	62.1	103.2	N/A	N/A	N/A
SAAHP-1HEATING Intake-HR-B		DX	Peak	12/21 04:00	3.4	3.4	N/A	79	26	57.4	99.2	N/A	N/A	N/A
SHC-1 Intake-HR-B		Electric	Peak	12/21 04:00	3.8	3.8	N/A	79	26	57.4	104.4	N/A	N/A	N/A
SAAHP-1HEATING Lounge		DX	Peak	12/21 20:00	11.5	11.5	N/A	317	65	62.2	97.7	N/A	N/A	N/A
SHC-1 Lounge		Electric	Peak	12/21 20:00	13.3	13.3	N/A	317	65	62.2	103.2	N/A	N/A	N/A
SAAHP-1HEATING Multipurpose/Dining		DX	Peak	12/21 24:00	14.3	14.3	N/A	315	160	50.7	95.1	N/A	N/A	N/A
SHC-1 Multipurpose/Dining		Electric	Peak	12/21 24:00	17.9	17.9	N/A	315	160	50.7	106.1	N/A	N/A	N/A

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 24 of 31

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING Servery		DX	Peak	12/21 01:00	6.6	6.6	N/A	144	75	50.2	94.9	N/A	N/A	N/A
SHC-1 Servery		Electric	Peak	12/21 01:00	8.3	8.3	N/A	144	75	50.2	106.2	N/A	N/A	N/A
SAAHP-1HEATING Support		DX	Peak	12/21 04:00	11.5	11.5	N/A	385	31	66.9	96.1	N/A	N/A	N/A
SHC-1 Support		Electric	Peak	12/21 04:00	13.9	13.9	N/A	385	31	66.9	102.0	N/A	N/A	N/A
SAAHP-1HEATING Utility		DX	Peak	12/21 04:00	39.6	39.6	N/A	1,060	164	64.1	100.5	N/A	N/A	N/A
SHC-1 Utility		Electric	Peak	12/21 04:00	41.9	41.9	N/A	1,060	164	64.1	102.7	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	7/21 18:00	118	2,450	118	55.0	12/21 24:00	118	1,638	118	90.0
		Noisy Activity 1	180	8/21 17:00	182	3,779	182	55.0	12/21 19:00	182	1,632	182	90.0
	ACT-Noisy-2		181	7/21 09:00	116	2,398	116	55.0	12/21 24:00	116	1,242	116	90.0
		Noisy Activity 2	181	7/21 18:00	105	2,177	105	55.0	12/21 19:00	105	1,229	105	90.0
	ACT-Noisy-3		182	7/21 15:00	113	2,336	113	55.0	12/21 24:00	113	1,564	113	90.0
		Noisy Activity 3	182	7/21 15:00	111	2,312	111	55.0	12/21 24:00	111	1,554	111	90.0
	ACT-Quiet-1		130	7/21 18:00	66	1,364	66	55.0	12/21 24:00	66	493	66	90.0
		Quiet Activity 1	130	7/21 17:00	63	1,316	63	55.0	12/21 19:00	63	484	63	90.0
	ACT-Quiet-2		131	7/21 17:00	92	1,903	92	55.0	12/21 24:00	92	768	92	90.0
		Quiet Activity 2	131	9/21 15:00	82	1,695	82	55.0	12/21 19:00	82	740	82	90.0
	ACT-Quiet-3		131	7/21 16:00	73	1,508	73	55.0	12/21 24:00	73	789	73	90.0
		Quiet Activity 3	131	7/21 18:00	90	1,871	90	55.0	12/21 24:00	90	785	90	90.0
	Admin		189	7/21 17:00	184	3,823	184	55.0	12/21 04:00	184	1,438	184	90.0
		Office 1	94	9/21 14:00	89	1,840	89	55.0	12/21 04:00	89	746	89	90.0
		Office 2	95	9/21 13:00	81	1,685	81	55.0	12/21 04:00	81	704	81	90.0
	Chart/Hotel		200	7/21 19:00	80	1,656	80	55.0	12/21 04:00	80	541	80	90.0
		Chart/Hotel	200	7/21 19:00	76	1,569	76	55.0	12/21 04:00	76	492	76	90.0
	Comfort/Consult		283	7/21 15:00	179	3,720	179	55.0	12/21 24:00	179	1,885	179	90.0
		Comfort Room 2	82	7/21 14:00	51	1,062	51	55.0	12/21 24:00	51	573	51	90.0
		Consult 1	100	7/21 15:00	61	1,274	61	55.0	12/21 24:00	61	647	61	90.0
		Consult 2	102	7/21 15:00	64	1,320	64	55.0	12/21 24:00	64	671	64	90.0
	Entry/Waiting		370	10/21 14:00	557	11,571	557	55.0	12/21 24:00	557	6,937	557	90.0
		Entry/Waiting	370	7/21 09:00	527	10,933	527	55.0	12/21 24:00	527	6,966	527	90.0
	Exam/Storage		224	7/21 15:00	97	2,021	97	55.0	12/21 04:00	97	645	97	90.0
		Exam Room	123	7/21 15:00	57	1,175	57	55.0	12/21 20:00	57	268	57	90.0
		Long Term Belongings Storage	101	7/21 15:00	39	807	39	55.0	12/21 04:00	39	340	39	90.0
	Group		276	7/21 15:00	186	3,867	186	55.0	12/21 24:00	186	2,115	186	90.0
		Group	276	7/21 15:00	181	3,762	181	55.0	12/21 24:00	181	2,117	181	90.0
	Hospitality		246	7/21 15:00	165	3,428	165	55.0	12/21 24:00	165	1,875	165	90.0
		Hospitality	246	7/21 15:00	164	3,412	164	55.0	12/21 24:00	164	1,865	164	90.0

Load/Airflows

Location				Cooling				Heating					
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Intake-HR-A	470	7/21 17:00	333	6,906	333	55.0	12/21 24:00	333	3,139	333	90.0
		Intake Corridor	155	7/21 15:00	46	955	46	55.0	12/21 20:00	46	502	46	90.0
		Interview Room	158	9/21 15:00	111	2,302	111	55.0	12/21 24:00	111	1,290	111	90.0
		Sally Port	78	9/21 13:00	95	1,976	95	55.0	12/21 19:00	95	910	95	90.0
		Shower 1	80	7/21 15:00	50	1,036	50	55.0	12/21 24:00	50	515	50	90.0
		Intake-HR-B	165	7/21 15:00	79	1,641	79	55.0	12/21 04:00	79	618	79	90.0
		Ante Room	81	7/21 15:00	32	674	32	55.0	12/21 04:00	32	285	32	90.0
		Comfort Room 1	84	7/21 14:00	46	962	46	55.0	12/21 07:00	46	321	46	90.0
		Lounge	297	7/21 17:00	317	6,571	317	55.0	12/21 20:00	317	2,312	317	90.0
		Lounge	198	9/21 14:00	226	4,685	226	55.0	12/21 08:00	226	1,806	226	90.0
		Shower 2	99	9/21 15:00	77	1,598	77	55.0	12/21 08:00	77	483	77	90.0
		Multipurpose/Dining	485	7/21 15:00	315	6,533	315	55.0	12/21 24:00	315	3,475	315	90.0
		Multipurpose/Dining	485	7/21 15:00	307	6,376	307	55.0	12/21 24:00	307	3,485	307	90.0
		Servery	228	7/21 15:00	144	2,984	144	55.0	12/21 24:00	144	1,425	144	90.0
		Servery	228	7/21 15:00	141	2,927	141	55.0	12/21 24:00	141	1,414	141	90.0
		Support	524	9/21 15:00	385	7,994	385	55.0	12/21 04:00	385	3,358	385	90.0
		Electric	191	9/21 14:00	164	3,398	164	55.0	12/21 04:00	164	1,727	164	90.0
		Emergency Electric	179	7/21 10:00	107	2,213	107	55.0	12/21 04:00	107	1,111	107	90.0
		Mechanical	155	7/21 14:00	70	1,443	70	55.0	12/21 04:00	70	569	70	90.0

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	7/21 16:00	1,060	22,001	1,060	55.0	12/21 04:00	1,060	11,000	1,060	90.0
		Clean Supply	102	7/21 15:00	38	785	38	55.0	12/21 04:00	38	338	38	90.0
		Corridor 1	295	7/21 15:00	87	1,814	87	55.0	12/21 24:00	87	993	87	90.0
		Corridor 2	635	7/21 15:00	146	3,039	146	55.0	12/21 24:00	146	1,871	146	90.0
		Corridor 2.1	85	7/21 18:00	19	402	19	55.0	12/21 19:00	19	324	19	90.0
		General Storage	96	7/21 15:00	56	1,170	56	55.0	12/21 04:00	56	375	56	90.0
		Hskp	57	7/21 15:00	23	486	23	55.0	12/21 04:00	23	205	23	90.0
		IT	158	7/21 19:00	62	1,277	62	55.0	12/21 04:00	62	307	62	90.0
		Laundry	122	7/21 15:00	44	918	44	55.0	12/21 04:00	44	396	44	90.0
		Meds	129	7/21 15:00	48	987	48	55.0	12/21 04:00	48	432	48	90.0
		Soiled Supply	97	7/21 15:00	37	760	37	55.0	12/21 04:00	37	323	37	90.0
		Staff Corridor	893	9/21 14:00	328	6,818	328	55.0	12/21 07:00	328	3,603	328	90.0
		Stor.	15	7/21 15:00	11	226	11	55.0	12/21 04:00	11	111	11	90.0
		Storage	52	7/21 15:00	28	584	28	55.0	12/21 04:00	28	347	28	90.0
		Toilet 1	67	7/21 15:00	45	932	45	55.0	12/21 24:00	45	472	45	90.0
		Toilet 2	62	7/21 15:00	35	717	35	55.0	12/21 19:00	35	222	35	90.0
		Toilet 3	62	7/21 15:00	35	727	35	55.0	12/21 19:00	35	230	35	90.0

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM		Motor Heat in Air
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Fan Override (kW)	
ACT-Noisy-1	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	118	.07	.10	100.00
ACT-Noisy-2	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	116	.07	.09	100.00
ACT-Noisy-3	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	113	.07	.09	100.00
ACT-Quiet-1	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	66	.04	.05	100.00
ACT-Quiet-2	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	92	.05	.08	100.00
ACT-Quiet-3	System 4 - 2007/2010/2013 SF-1	System	60.00	43.00	3.00	73	.04	.06	100.00

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 28 of 31

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
Admin _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	184	.11	.15	100.00
Chart/Hotel _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	80	.05	.07	100.00
Comfort/Consult _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	179	.11	.15	100.00
Entry/Waiting _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	557	.33	.46	100.00
Exam/Storage _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	97	.06	.08	100.00
Group _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	186	.11	.15	100.00
Hospitality _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	165	.10	.14	100.00
Intake-HR-A _EXHAUST FAN		Zone	10.00	N/A	0.00	160	.00	N/A	100.00
Intake-HR-A _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	333	.20	.27	100.00
Intake-HR-B _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	79	.05	.06	100.00
Lounge _EXHAUST FAN		Zone	10.00	N/A	0.00	198	.00	N/A	100.00
Lounge _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	317	.19	.26	100.00
Multipurpose/Dining _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	315	.19	.26	100.00
Servery _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	144	.08	.12	100.00
Support _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	385	.23	.32	100.00
Utility _EXHAUST FAN		Zone	10.00	N/A	0.00	477	.00	N/A	100.00
Utility _System 4 - 2007/2010/2013 SF-1		System	60.00	43.00	3.00	1,060	.62	.87	100.00

System Name: System 4 - 2007/2010/2013_Copy

System Type: 90.1 Systems
Number of Zones 1
Number of Rooms 2

Component	Quantity
Cooling Coils	1
Heating Coils	2
Fans	2

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
System 4 - 2007/2010/2013	Kitchen	DX	Peak		7.3	87.9	69.3	4.8	N/A	2,793	235	77.0	60.23	53.1	50.02	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
System 4 - 2007/2010/2013	Kitchen	DX	Peak	12/21 04:00	87.9	87.9	N/A	2,793	235	66.8	97.5	N/A	N/A	N/A
System 4 - 2007/2010/2013	Kitchen	Electric	Peak	12/21 04:00	100.9	100.9	N/A	2,793	235	66.8	102.0	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System 4 - 2007/2010/2013_Copy			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	7/21 16:00	2,793	57,959	2,793	55.0	12/21 04:00	2,793	55,106	2,793	90.0
		Kitchen	382	7/21 16:00	2,500	51,853	2,500	55.0	12/21 08:00	2,500	51,271	2,500	90.0
		Service	304	9/21 15:00	301	6,243	301	55.0	12/21 04:00	301	3,376	301	90.0

Fans

System	Zone	Type	Efficiency with PRM						
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
	Kitchen_EXHAUST FAN	Zone	10.00	N/A	0.00	2,500	.00	N/A	100.00
Kitchen_System 4 - 2007/2010/2013_Copy SF-1		System	60.00	45.00	3.00	2,793	1.64	2.19	100.00

Psychrometric State Points

Simulation peak data is not available for this alternative because the simulation peak was not calculated. To view simulation peak data, go to the Load Design Parameters tab of Simulation Settings, set 'Perform special building block calculations during Design' to Yes and recalculate the alternative.

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-1_VRFHP-1_COOLING COIL

System Name :	ACT-Noisy-1_VRFHP-1		
Time of Peak :	unknown	Percent Outdoor Air	19.22 %
Coil Air Flow :	196 (cfm)	Air Specific Heat	0.244 (Btu/lb·°F)
Coil Capacity :	3 (MBh)	Air Density	0.0711 (lb/ft³)
Zone Space Sensible Loads	3.6 (MBh)	Air Density Specific Heat Factor	1.0409 Btuh/cfm-F
Outdoor Air Flow Rate	38 (cfm)	Latent Heat Factor	0.6557 Btuh/(cfm-gr/lb)
		Enthalpy Factor	4.2660 Btuh/(cfm-btu/lb)
		*Value has been adjusted for elevation	

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.6	50.1	
Return Air	75.0		68.6		
Outdoor Air	94.0	63.5	44.0		
Entering Coil	72.4	60.8	65.6		
Leaving Coil	57.1	54.7	63.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-2_VRFHP-1_COOLING COIL**System Name :** ACT-Noisy-2_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 101 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.1 (MBh)**Outdoor Air Flow Rate** 38 (cfm)**Percent Outdoor Air** 37.57 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.6	51.6	
Return Air	75.0		70.6		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	69.1	59.3	63.9		
Leaving Coil	55.0	53.1	60.6		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-3_VRFHP-1_COOLING COIL**System Name :** ACT-Noisy-3_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 105 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.2 (MBh)**Outdoor Air Flow Rate** 38 (cfm)**Percent Outdoor Air** 36.41 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.3	51.4	
Return Air	75.0		70.3		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	69.3	59.4	63.9		
Leaving Coil	55.0	53.1	60.6		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 39

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-1_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-1_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 60 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.3 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air**

45.62 %

Air Specific Heat

0.2436 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0392 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.3	49.9	
Return Air	75.0		68.3		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	67.6	58.1	61.2		
Leaving Coil	53.5	51.5	56.6		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-2_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-2_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 86 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.8 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air**

31.75 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.8	50.3	
Return Air	75.0		68.8		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	70.2	59.6	63.7		
Leaving Coil	55.0	53.1	60.6		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 39

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-3_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-3_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 78 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.6 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 35.42 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.2	51.3	
Return Air	75.0		70.2		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	69.5	59.5	64.0		
Leaving Coil	55.0	53.1	60.6		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Admin_VRFHP-1_COOLING COIL**System Name :** Admin_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 121 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 21 (cfm)**Percent Outdoor Air** 17.20 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.0	45.4	
Return Air	75.0		62.0		
Outdoor Air	88.4	57.7	26.4		
Entering Coil	73.0	59.9	60.4		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 39

Ideal Loads Peak : Cooling Coil Name : Attrium_VRFHP-1_COOLING COIL**System Name :** Attrium_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 375 (cfm)**Coil Capacity :** 6 (MBh)**Zone Space Sensible Loads** 7.8 (MBh)**Outdoor Air Flow Rate** 108 (cfm)**Percent Outdoor Air**

28.69 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.7	45.2	
Return Air	75.0		61.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	71.2	59.0	59.2		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Chart/Hotel_VRFHP-1_COOLING COIL**System Name :** Chart/Hotel_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 66 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.4 (MBh)**Outdoor Air Flow Rate** 22 (cfm)**Percent Outdoor Air**

33.03 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.2	49.1	
Return Air	75.0		67.2		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	70.3	59.4	62.4		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 39

Ideal Loads Peak : Cooling Coil Name : Comfort/Consult_VRFHP-1_COOLING COIL**System Name :** Comfort/Consult_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 148 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 3.1 (MBh)**Outdoor Air Flow Rate** 72 (cfm)**Percent Outdoor Air** 48.75 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.0	46.8	
Return Air	75.0		64.0		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	66.9	57.3	58.5		
Leaving Coil	55.0	52.5	58.2		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Corridor-N_VRFHP-1_COOLING COIL**System Name :** Corridor-N_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 123 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 25 (cfm)**Percent Outdoor Air** 20.00 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		51.9	38.1	
Return Air	75.0		51.9		
Outdoor Air	87.5	61.1	42.6		
Entering Coil	72.6	57.9	52.1		
Leaving Coil	55.0	50.9	52.1		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 39

Ideal Loads Peak : Cooling Coil Name : Corridor-S_VRFHP-1_COOLING COIL**System Name :** Corridor-S_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 243 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 5.0 (MBh)**Outdoor Air Flow Rate** 25 (cfm)**Percent Outdoor Air** 10.21 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		51.6	37.9	
Return Air	75.0		51.6		
Outdoor Air	88.4	57.7	26.4		
Entering Coil	74.1	58.3	51.7		
Leaving Coil	55.0	50.9	51.7		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Corridor-W_VRFHP-1_COOLING COIL**System Name :** Corridor-W_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 266 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 5.5 (MBh)**Outdoor Air Flow Rate** 19 (cfm)**Percent Outdoor Air** 7.30 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.6	
Return Air	75.0		52.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	74.5	58.7	52.7		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 39

Ideal Loads Peak : Cooling Coil Name : DOAS to Zone Level Equipment Dehum and Reheat SCC-1**System Name :** DOAS to Zone Level Equipment Dehum and Reheat**Time of Peak :** July 21 15:00**Coil Air Flow :** 1,550 (cfm)**Coil Capacity :** 72 (MBh)**Zone Space Sensible Loads** 124.1 (MBh)**Outdoor Air Flow Rate** 1,550 (cfm)**Percent Outdoor Air** 100.00 %**Air Specific Heat** 0.2426 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0349 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.1	46.9	
Return Air	76.5		64.0		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	99.7	64.7	40.4		
Leaving Coil	55.0	47.8	40.4		
Supply Fan					1.3

Ideal Loads Peak : Cooling Coil Name : Entry/Waiting_VRFHP-1_COOLING COIL**System Name :** Entry/Waiting_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 706 (cfm)**Coil Capacity :** 15 (MBh)**Zone Space Sensible Loads** 14.7 (MBh)**Outdoor Air Flow Rate** 31 (cfm)**Percent Outdoor Air** 4.46 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.2	40.5	
Return Air	75.0		55.2		
Outdoor Air	81.8	61.2	52.2		
Entering Coil	74.9	59.4	55.1		
Leaving Coil	55.0	51.6	54.7		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 39

Ideal Loads Peak : Cooling Coil Name : Exam/Storage_VRFHP-1_COOLING COIL**System Name :** Exam/Storage_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 76 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.6 (MBh)**Outdoor Air Flow Rate** 37 (cfm)**Percent Outdoor Air** 49.46 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		65.1	47.6	
Return Air	75.0		65.1		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	66.9	57.4	59.0		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Group_VRFHP-1_COOLING COIL**System Name :** Group_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 144 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 3.1 (MBh)**Outdoor Air Flow Rate** 91 (cfm)**Percent Outdoor Air** 63.40 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.5	50.1	
Return Air	75.0		68.5		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	63.3	55.9	58.5		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 9 of 39

Ideal Loads Peak : Cooling Coil Name : Hospitality_VRFHP-1_COOLING COIL**System Name :** Hospitality_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 135 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 2.8 (MBh)**Outdoor Air Flow Rate** 81 (cfm)**Percent Outdoor Air** 60.15 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.6	50.1	
Return Air	75.0		68.6		
Outdoor Air	96.9	66.1	52.3		
Entering Coil	64.0	56.3	59.0		
Leaving Coil	54.8	52.5	58.3		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Intake-HR-A_VRFHP-1_COOLING COIL**System Name :** Intake-HR-A_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 221 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 4.6 (MBh)**Outdoor Air Flow Rate** 69 (cfm)**Percent Outdoor Air** 31.35 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.6	46.5	
Return Air	75.0		63.6		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	70.6	59.0	60.2		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 10 of 39

Ideal Loads Peak : Cooling Coil Name : Intake-HR-B_VRFHP-1_COOLING COIL**System Name :** Intake-HR-B_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 58 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.2 (MBh)**Outdoor Air Flow Rate** 26 (cfm)**Percent Outdoor Air** 45.30 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.6	47.2	
Return Air	75.0		64.6		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	67.8	57.7	59.2		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Kitchen_Single Zone CV SCC-1**System Name :** Kitchen_Single Zone CV**Time of Peak :** July 21 15:00**Coil Air Flow :** 2,532 (cfm)**Coil Capacity :** 95 (MBh)**Zone Space Sensible Loads** 27.7 (MBh)**Outdoor Air Flow Rate** 2,500 (cfm)**Percent Outdoor Air** 98.73 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.7	43.7	
Return Air	75.2		59.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	98.8	66.7	52.3		
Leaving Coil	62.7	54.2	52.3		
Supply Fan					1.3

Alternative: Primary**File:** Casa De Amparo_v4.mdf**TRACE 3D Plus 7.00****Calculated at: Jun 11, 2026 - 10:50 PM**

214

Page 11 of 39

Ideal Loads Peak : Cooling Coil Name : Lounge_VRFHP-1_COOLING COIL**System Name :** Lounge_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 238 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 4.5 (MBh)**Outdoor Air Flow Rate** 65 (cfm)**Percent Outdoor Air** 27.43 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.7	50.2	
Return Air	75.0		68.7		
Outdoor Air	89.8	58.2	26.4		
Entering Coil	70.6	59.9	64.3		
Leaving Coil	56.7	54.4	62.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Multipurpose/Dining_VRFHP-1_COOLING COIL**System Name :** Multipurpose/Dining_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 242 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 5.3 (MBh)**Outdoor Air Flow Rate** 160 (cfm)**Percent Outdoor Air** 66.31 %**Air Specific Heat** 0.2436 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0392 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.6	50.2	
Return Air	75.0		68.6		
Outdoor Air	96.9	66.1	52.3		
Entering Coil	62.7	55.6	58.1		
Leaving Coil	54.0	51.9	57.3		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf**TRACE 3D Plus 7.00****Calculated at: Jun 11, 2026 - 10:50 PM**

214

Page 12 of 39

Ideal Loads Peak : Cooling Coil Name : RB-N-Corner_VRFHP-1_COOLING COIL**System Name :** RB-N-Corner_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 155 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.7 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 9.23 %**Air Specific Heat** 0.2441 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0413 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.3	49.9	
Return Air	75.0		68.3		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	74.6	61.8	66.8		
Leaving Coil	58.5	55.6	65.1		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-N-East_VRFHP-1_COOLING COIL**System Name :** RB-N-East_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 256 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 4.5 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 11.04 %**Air Specific Heat** 0.2441 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0413 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.4	50.0	
Return Air	75.0		68.4		
Outdoor Air	87.0	63.0	52.2		
Entering Coil	74.4	61.7	66.7		
Leaving Coil	58.0	55.3	64.6		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 13 of 39

Ideal Loads Peak : Cooling Coil Name : RB-N-West_VRFHP-1_COOLING COIL**System Name :** RB-N-West_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 442 (cfm)**Coil Capacity :** 8 (MBh)**Zone Space Sensible Loads** 7.5 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air**

9.53 %

Air Specific Heat

0.2441 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0413 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.7	50.2	
Return Air	75.0		68.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	74.5	61.9	67.2		
Leaving Coil	58.7	55.8	65.3		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-N_VRFHP-1_COOLING COIL**System Name :** RB-S-Corner-N_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 126 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.2 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air**

11.24 %

Air Specific Heat

0.2441 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0413 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.4	50.0	
Return Air	75.0		68.4		
Outdoor Air	87.0	63.0	52.2		
Entering Coil	74.3	61.7	66.7		
Leaving Coil	57.9	55.2	64.5		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 14 of 39

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-S_VRFHP-1_COOLING COIL

System Name : RB-S-Corner-S_VRFHP-1
Time of Peak : unknown
Coil Air Flow : 135 (cfm)
Coil Capacity : 3 (MBh)
Zone Space Sensible Loads 2.8 (MBh)
Outdoor Air Flow Rate 14 (cfm)

Percent Outdoor Air 10.70 %
Air Specific Heat 0.2437 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0396 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.0	45.4	
Return Air	75.0		62.0		
Outdoor Air	94.1	62.8	40.3		
Entering Coil	74.4	60.5	61.0		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-S-East_VRFHP-1_COOLING COIL

System Name : RB-S-East_VRFHP-1
Time of Peak : unknown
Coil Air Flow : 361 (cfm)
Coil Capacity : 7 (MBh)
Zone Space Sensible Loads 6.4 (MBh)
Outdoor Air Flow Rate 41 (cfm)

Percent Outdoor Air 11.35 %
Air Specific Heat 0.2441 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0413 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.4	50.0	
Return Air	75.0		68.4		
Outdoor Air	87.0	63.0	52.2		
Entering Coil	74.3	61.7	66.6		
Leaving Coil	57.9	55.2	64.4		
Supply Fan					0.5

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 15 of 39

Ideal Loads Peak : Cooling Coil Name : RB-S-West_VRFHP-1_COOLING COIL**System Name :** RB-S-West_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 141 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.4 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air**

9.66 %

Air Specific Heat

0.2441 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0413 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.7	50.2	
Return Air	75.0		68.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	74.5	61.9	67.1		
Leaving Coil	58.7	55.7	65.3		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-W-North_VRFHP-1_COOLING COIL**System Name :** RB-W-North_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 129 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air**

11.03 %

Air Specific Heat

0.2441 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0413 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.3	49.9	
Return Air	75.0		68.3		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	74.4	61.7	66.6		
Leaving Coil	57.9	55.3	64.5		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 16 of 39

Ideal Loads Peak : Cooling Coil Name : RB-W-South_VRFHP-1_COOLING COIL**System Name :** RB-W-South_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 410 (cfm)**Coil Capacity :** 9 (MBh)**Zone Space Sensible Loads** 8.5 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air** 10.19 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.5	45.0	
Return Air	75.0		61.5		
Outdoor Air	89.8	58.2	26.4		
Entering Coil	74.5	60.5	60.6		
Leaving Coil	55.0	52.6	58.5		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Servery_VRFHP-1_COOLING COIL**System Name :** Servery_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 107 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 2.4 (MBh)**Outdoor Air Flow Rate** 75 (cfm)**Percent Outdoor Air** 70.07 %**Air Specific Heat** 0.2436 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0392 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.6	50.2	
Return Air	75.0		68.6		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	61.9	55.1	57.5		
Leaving Coil	53.5	51.5	56.6		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf**TRACE 3D Plus 7.00****Calculated at: Jun 11, 2026 - 10:50 PM**

214

Page 17 of 39

Ideal Loads Peak : Cooling Coil Name : SHWR-N_VRFHP-1_COOLING COIL**System Name :** SHWR-N_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 95 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2439 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0405 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		71.2	52.0	
Return Air	75.0		71.2		
Outdoor Air	94.8	65.5	52.3		
Entering Coil	76.6	63.4	71.2		
Leaving Coil	55.0	53.5	62.1		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : SHWR-S_VRFHP-1_COOLING COIL**System Name :** SHWR-S_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 104 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.2 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2439 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0405 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.8	51.7	
Return Air	75.0		70.8		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	76.5	63.3	70.8		
Leaving Coil	55.0	53.5	62.1		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 18 of 39

Ideal Loads Peak : Cooling Coil Name : SHWR-W_VRFHP-1_COOLING COIL**System Name :** SHWR-W_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 93 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.9 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2439 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0405 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		71.5	52.2	
Return Air	75.0		71.5		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	76.6	63.5	71.5		
Leaving Coil	55.0	53.5	62.1		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Support_VRFHP-1_COOLING COIL**System Name :** Support_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 256 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 5.3 (MBh)**Outdoor Air Flow Rate** 36 (cfm)**Percent Outdoor Air** 14.15 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.6	
Return Air	75.0		52.7		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	73.8	58.5	52.7		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 19 of 39

Ideal Loads Peak : Cooling Coil Name : Utility_VRFHP-1_COOLING COIL

System Name : Utility_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 670 (cfm)

Coil Capacity : 12 (MBh)

Zone Space Sensible Loads 13.9 (MBh)

Outdoor Air Flow Rate 164 (cfm)

Percent Outdoor Air 24.51 %

Air Specific Heat 0.2437 (Btu/lb·°F)

Air Density 0.0711 (lb/ft³)

Air Density Specific Heat Factor 1.0396 Btuh/cfm-F

Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.7	44.4	
Return Air	75.0		60.7		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	72.0	59.2	58.7		
Leaving Coil	55.0	52.6	58.4		
Supply Fan					0.5

Psychrometric State Points

Simulation peak data is not available for this alternative because the simulation peak was not calculated. To view simulation peak data, go to the Load Design Parameters tab of Simulation Settings, set 'Perform special building block calculations during Design' to Yes and recalculate the alternative.

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-1 _System 4 - 2007/2010/2013 SAAHP-1

System Name :	ACT-Noisy-1 _System 4 - 2007/2010/2013		
Time of Peak :	July 21 17:00	Percent Outdoor Air	20.62 %
Coil Air Flow :	183 (cfm)	Air Specific Heat	0.2433 (Btu/lb·°F)
Coil Capacity :	7 (MBh)	Air Density	0.0711 (lb/ft³)
Zone Space Sensible Loads	3.8 (MBh)	Air Density Specific Heat Factor	1.0379 Btuh/cfm-F
Outdoor Air Flow Rate	38 (cfm)	Latent Heat Factor	0.6557 Btuh/(cfm-gr/lb)
		Enthalpy Factor	4.2660 Btuh/(cfm-btu/lb)
		*Value has been adjusted for elevation	

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		58.7	43.0	
Return Air	75.7		58.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	79.6	61.5	57.3		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-2_System 4 - 2007/2010/2013 SAAHP-1**System Name :** ACT-Noisy-2_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 107 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.1 (MBh)**Outdoor Air Flow Rate** 38 (cfm)**Percent Outdoor Air** 35.65 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.1	46.2	
Return Air	76.3		63.1		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	84.3	63.5	59.2		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-3_System 4 - 2007/2010/2013 SAAHP-1**System Name :** ACT-Noisy-3_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 112 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 38 (cfm)**Percent Outdoor Air** 34.11 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.2	45.5	
Return Air	76.2		62.2		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	83.9	63.3	58.8		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-1_System 4 - 2007/2010/2013 SAAHP-1**System Name :** ACT-Quiet-1_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 64 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.3 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air** 42.89 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.5	47.2	
Return Air	76.5		64.5		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	86.1	64.1	59.3		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-2_System 4 - 2007/2010/2013 SAAHP-1**System Name :** ACT-Quiet-2_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 84 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.6 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air** 32.73 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.7	45.9	
Return Air	76.2		61.3		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	83.4	62.2	54.5		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-3 _System 4 - 2007/2010/2013 SAAHP-1**System Name :** ACT-Quiet-3 _System 4 - 2007/2010/2013**Time of Peak :** July 21 17:00**Coil Air Flow :** 91 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 1.8 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 30.40 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.8	45.2	
Return Air	76.1		61.8		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	81.7	62.6	58.9		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Admin _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Admin _System 4 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 165 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 3.4 (MBh)**Outdoor Air Flow Rate** 21 (cfm)**Percent Outdoor Air** 12.60 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.7	40.8	
Return Air	76.3		55.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	79.1	60.6	53.8		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Attrium_System 2 - 2007/2010/2013 SAAHP-1**System Name :** Attrium_System 2 - 2007/2010/2013**Time of Peak :** July 21 16:00**Coil Air Flow :** 567 (cfm)**Coil Capacity :** 17 (MBh)**Zone Space Sensible Loads** 11.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.3	40.6	
Return Air	77.1		55.3		
Outdoor Air	96.9	66.1	52.3		
Entering Coil	79.0	60.9	55.3		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Chart/Hotel_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Chart/Hotel_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 79 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.5 (MBh)**Outdoor Air Flow Rate** 22 (cfm)**Percent Outdoor Air** 27.81 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.7	44.5	
Return Air	78.2		60.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	83.9	63.2	58.4		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Comfort/Consult _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Comfort/Consult _System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 178 (cfm)**Coil Capacity :** 8 (MBh)**Zone Space Sensible Loads** 3.7 (MBh)**Outdoor Air Flow Rate** 72 (cfm)**Percent Outdoor Air** 40.69 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.6	42.2	
Return Air	81.8		57.6		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	88.7	64.2	55.4		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Corridor-N _System 2 - 2007/2010/2013 SAAHP-1**System Name :** Corridor-N _System 2 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 118 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 25 (cfm)**Percent Outdoor Air** 20.78 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.6	
Return Air	83.4		52.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	88.6	63.5	52.6		
Leaving Coil	55.0	51.1	52.6		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Corridor-S_System 2 - 2007/2010/2013 SAAHP-1**System Name :** Corridor-S_System 2 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 177 (cfm)**Coil Capacity :** 6 (MBh)**Zone Space Sensible Loads** 3.6 (MBh)**Outdoor Air Flow Rate** 25 (cfm)**Percent Outdoor Air** 14.06 %**Air Specific Heat** 0.2432 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0375 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.3	38.4	
Return Air	80.4		52.3		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	84.9	61.9	50.6		
Leaving Coil	55.0	50.6	50.6		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Corridor-W_System 2 - 2007/2010/2013 SAAHP-1**System Name :** Corridor-W_System 2 - 2007/2010/2013**Time of Peak :** July 21 17:00**Coil Air Flow :** 210 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 4.4 (MBh)**Outdoor Air Flow Rate** 19 (cfm)**Percent Outdoor Air** 9.23 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.6	
Return Air	78.5		52.7		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	81.9	61.3	52.7		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Entry/Waiting _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Entry/Waiting _System 4 - 2007/2010/2013**Time of Peak :** July 21 09:00**Coil Air Flow :** 524 (cfm)**Coil Capacity :** 15 (MBh)**Zone Space Sensible Loads** 10.9 (MBh)**Outdoor Air Flow Rate** 31 (cfm)**Percent Outdoor Air** 6.01 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		53.5	39.3	
Return Air	75.7		53.5		
Outdoor Air	81.8	61.2	52.2		
Entering Coil	76.0	59.4	53.5		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Exam/Storage _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Exam/Storage _System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 97 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 37 (cfm)**Percent Outdoor Air** 38.41 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		58.0	42.5	
Return Air	81.0		58.0		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	87.9	64.0	55.8		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Group_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Group_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 182 (cfm)**Coil Capacity :** 8 (MBh)**Zone Space Sensible Loads** 3.8 (MBh)**Outdoor Air Flow Rate** 91 (cfm)**Percent Outdoor Air** 50.06 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.6	45.1	
Return Air	76.4		61.6		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	87.6	64.1	56.9		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Hospitality_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Hospitality_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 164 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 3.4 (MBh)**Outdoor Air Flow Rate** 81 (cfm)**Percent Outdoor Air** 49.42 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.5	45.0	
Return Air	76.4		61.5		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	87.4	64.1	56.9		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Intake-HR-A _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Intake-HR-A _System 4 - 2007/2010/2013**Time of Peak :** July 21 14:00**Coil Air Flow :** 302 (cfm)**Coil Capacity :** 11 (MBh)**Zone Space Sensible Loads** 5.5 (MBh)**Outdoor Air Flow Rate** 69 (cfm)**Percent Outdoor Air** 22.97 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		56.9	41.7	
Return Air	79.8		56.4		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	84.0	62.1	52.7		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Intake-HR-B _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Intake-HR-B _System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 78 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.6 (MBh)**Outdoor Air Flow Rate** 26 (cfm)**Percent Outdoor Air** 33.51 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.4	42.0	
Return Air	80.2		57.4		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	86.4	63.5	55.7		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Kitchen_System 4 - 2007/2010/2013_Copy SAAHP-1**System Name :** Kitchen_System 4 - 2007/2010/2013_Copy**Time of Peak :** July 21 15:00**Coil Air Flow :** 2,801 (cfm)**Coil Capacity :** 86 (MBh)**Zone Space Sensible Loads** 31.3 (MBh)**Outdoor Air Flow Rate** 235 (cfm)**Percent Outdoor Air**

8.38 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.9	41.0	
Return Air	75.1		55.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	77.1	60.0	54.4		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Lounge_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Lounge_System 4 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 293 (cfm)**Coil Capacity :** 10 (MBh)**Zone Space Sensible Loads** 6.1 (MBh)**Outdoor Air Flow Rate** 65 (cfm)**Percent Outdoor Air**

22.26 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		58.0	42.5	
Return Air	75.9		58.0		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	80.9	61.3	54.1		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Multipurpose/Dining _System 4 - 2007/2010/2013 SAAHP-1**System Name :** Multipurpose/Dining _System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 308 (cfm)**Coil Capacity :** 14 (MBh)**Zone Space Sensible Loads** 6.4 (MBh)**Outdoor Air Flow Rate** 160 (cfm)**Percent Outdoor Air** 52.02 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.9	45.3	
Return Air	76.4		61.9		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	88.1	64.2	56.9		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-N-Corner _System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-N-Corner _System 2 - 2007/2010/2013**Time of Peak :** July 21 17:00**Coil Air Flow :** 126 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.6 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 11.40 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.1	41.8	
Return Air	76.0		57.1		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	80.0	61.5	56.5		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-N-East_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-N-East_System 2 - 2007/2010/2013**Time of Peak :** July 21 11:00**Coil Air Flow :** 198 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 4.0 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 14.28 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.9	42.4	
Return Air	76.3		57.9		
Outdoor Air	91.7	64.5	52.2		
Entering Coil	80.4	61.8	57.1		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-N-West_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-N-West_System 2 - 2007/2010/2013**Time of Peak :** July 21 17:00**Coil Air Flow :** 336 (cfm)**Coil Capacity :** 11 (MBh)**Zone Space Sensible Loads** 7.0 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air** 12.53 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.5	42.2	
Return Air	76.1		57.5		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	80.3	61.7	56.9		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-N_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-S-Corner-N_System 2 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 109 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.98 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.1	41.8	
Return Air	76.1		57.1		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	81.0	61.5	54.9		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-S_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-S-Corner-S_System 2 - 2007/2010/2013**Time of Peak :** September 21 16:00**Coil Air Flow :** 136 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.8 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 10.63 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		56.5	41.4	
Return Air	75.9		56.5		
Outdoor Air	96.5	63.6	40.3		
Entering Coil	80.1	61.1	54.7		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-S-East_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-S-East_System 2 - 2007/2010/2013**Time of Peak :** July 21 11:00**Coil Air Flow :** 270 (cfm)**Coil Capacity :** 9 (MBh)**Zone Space Sensible Loads** 5.5 (MBh)**Outdoor Air Flow Rate** 41 (cfm)**Percent Outdoor Air** 15.13 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		58.2	42.7	
Return Air	76.4		58.2		
Outdoor Air	91.7	64.5	52.2		
Entering Coil	80.6	61.9	57.3		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-S-West_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-S-West_System 2 - 2007/2010/2013**Time of Peak :** July 21 17:00**Coil Air Flow :** 109 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.48 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.5	42.1	
Return Air	76.1		57.5		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	80.3	61.7	56.8		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-W-North_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-W-North_System 2 - 2007/2010/2013**Time of Peak :** July 21 18:00**Coil Air Flow :** 118 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.08 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.2	41.9	
Return Air	76.1		57.2		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	79.8	61.5	56.6		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : RB-W-South_System 2 - 2007/2010/2013 SAAHP-1**System Name :** RB-W-South_System 2 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 355 (cfm)**Coil Capacity :** 11 (MBh)**Zone Space Sensible Loads** 7.4 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air** 11.75 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		56.8	41.6	
Return Air	76.0		56.8		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	80.6	61.3	54.8		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Servery_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Servery_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 141 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 2.9 (MBh)**Outdoor Air Flow Rate** 75 (cfm)**Percent Outdoor Air** 53.30 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.1	45.5	
Return Air	76.5		62.1		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	88.4	64.3	56.9		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : SHWR-N_System 2 - 2007/2010/2013 SAAHP-1**System Name :** SHWR-N_System 2 - 2007/2010/2013**Time of Peak :** July 21 11:00**Coil Air Flow :** 120 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.4	44.2	
Return Air	76.7		60.4		
Outdoor Air	91.7	64.5	52.2		
Entering Coil	78.6	61.8	60.4		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : SHWR-S_System 2 - 2007/2010/2013 SAAHP-1**System Name :** SHWR-S_System 2 - 2007/2010/2013**Time of Peak :** July 21 18:00**Coil Air Flow :** 141 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.9 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.5	43.6	
Return Air	76.5		59.5		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	78.4	61.6	59.5		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : SHWR-W_System 2 - 2007/2010/2013 SAAHP-1**System Name :** SHWR-W_System 2 - 2007/2010/2013**Time of Peak :** July 21 18:00**Coil Air Flow :** 113 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 2.4 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.9	44.6	
Return Air	76.8		60.9		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	78.7	62.0	60.9		
Leaving Coil	55.0	51.1	52.7		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Support_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Support_System 4 - 2007/2010/2013**Time of Peak :** September 21 14:00**Coil Air Flow :** 340 (cfm)**Coil Capacity :** 10 (MBh)**Zone Space Sensible Loads** 6.5 (MBh)**Outdoor Air Flow Rate** 31 (cfm)**Percent Outdoor Air** 9.25 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.6	
Return Air	76.5		52.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	78.5	59.9	51.6		
Leaving Coil	53.1	50.0	51.6		
Supply Fan					1.9

Ideal Loads Peak : Cooling Coil Name : Utility_System 4 - 2007/2010/2013 SAAHP-1**System Name :** Utility_System 4 - 2007/2010/2013**Time of Peak :** July 21 15:00**Coil Air Flow :** 1,031 (cfm)**Coil Capacity :** 39 (MBh)**Zone Space Sensible Loads** 21.4 (MBh)**Outdoor Air Flow Rate** 164 (cfm)**Percent Outdoor Air** 15.93 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		54.5	39.9	
Return Air	80.0		54.5		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	83.0	62.0	54.1		
Leaving Coil	53.1	50.0	51.7		
Supply Fan					1.9

Outside Air / ASHRAE Standard 62.1 Summary

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	Ps People	ΣPz People	D Ps / ΣPz	Vou (cfm)	Vps (cfm)	Xs	Ev	Vot (cfm)	%OA Vot / Vps
DOAS to Zone Level Equipment Dehum and Reheat	Cooling	1,550	0	111	1	1,550	1,550	1	1	1,550	100.0%
	Heating	1,550	0	111	1	1,550	1,550	0.216	1	1,550	100.0%
Kitchen _Single Zone CV	Cooling	2,532	0	0	1	0	2,532	0	1	0	0.0%
	Heating	2,532	0	0	1	0	2,532	0	1	0	0.0%

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
DOAS to Zone Level Equipment Dehum and Reheat	5.15	111.06	0.08	12,966	1,550		1,550		1,550
ACT-Noisy-1	7.50	3.59	0.06	180	38	1.00	38	1.00	38
ACT-Noisy-2	7.50	3.62	0.06	181	38	1.00	38	1.00	38
ACT-Noisy-3	7.50	3.64	0.06	182	38	1.00	38	1.00	38
ACT-Quiet-1	7.50	2.61	0.06	130	27	1.00	27	1.00	27
ACT-Quiet-2	7.50	2.61	0.06	131	27	1.00	27	1.00	27
ACT-Quiet-3	7.50	2.62	0.06	131	28	1.00	28	1.00	28
Admin	5.00	1.89	0.06	189	21	1.00	21	1.00	21
Attrium	5.00	6.33	0.06	1,267	108	1.00	108	1.00	108
Chart/Hotel	5.00	2.00	0.06	200	22	1.00	22	1.00	22
Comfort/Consult	7.50	2.83	0.18	283	72	1.00	72	1.00	72
Corridor-N	0.00	0.00	0.06	409	25	1.00	25	1.00	25
Corridor-S	0.00	0.00	0.06	414	25	1.00	25	1.00	25
Corridor-W	0.00	0.00	0.06	324	19	1.00	19	1.00	19
Entry/Waiting	5.00	1.85	0.06	370	31	1.00	31	1.00	31
Exam/Storage	5.32	1.73	0.13	224	37	1.00	37	1.00	37
Group	7.50	5.53	0.18	276	91	1.00	91	1.00	91
Hospitality	7.50	4.92	0.18	246	81	1.00	81	1.00	81
Intake-HR-A	4.46	3.96	0.11	471	69	1.00	69	1.00	69
Intake-HR-B	5.06	1.24	0.12	165	26	1.00	26	1.00	26
Lounge	5.00	5.93	0.12	297	65	1.00	65	1.00	65

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 30

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
Multipurpose/Dining	7.50	9.71	0.18	485	160	1.00	160	1.00	160
RB-N-Corner	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-N-East	5.00	2.57	0.06	257	28	1.00	28	1.00	28
RB-N-West	5.00	3.83	0.06	383	42	1.00	42	1.00	42
RB-S-Corner-N	5.00	1.29	0.06	129	14	1.00	14	1.00	14
RB-S-Corner-S	5.00	1.31	0.06	131	14	1.00	14	1.00	14
RB-S-East	5.00	3.72	0.06	372	41	1.00	41	1.00	41
RB-S-West	5.00	1.24	0.06	124	14	1.00	14	1.00	14
RB-W-North	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-W-South	5.00	3.80	0.06	380	42	1.00	42	1.00	42
Servery	7.50	4.56	0.18	228	75	1.00	75	1.00	75
SHWR-N	0.00	4.07	0.00	204	0	1.00	0	1.00	0
SHWR-S	0.00	4.14	0.00	207	0	1.00	0	1.00	0
SHWR-W	0.00	4.14	0.00	207	0	1.00	0	1.00	0
Support	0.00	0.00	0.06	603	36	1.00	36	1.00	36
Utility	0.00	7.15	0.06	2,927	164	1.00	164	1.00	164
Kitchen_Single Zone CV	0.00	0.00	0.13	686	0		0		0
Kitchen	6.63	13.09	0.13	686	0	1.00	0	1.00	0

*Ventilation Sizing Factor: 1.00

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
DOAS to Zone Level Equipment Dehum and Reheat		1,550	1,550	1,550	1,550							
ACT-Noisy-1	Single Duct Mixer	38	38	38	37.73	0.961	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2	Single Duct Mixer	38	38	38	37.98	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3	Single Duct Mixer	38	38	38	38.25	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1	Single Duct Mixer	27	27	27	27.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2	Single Duct Mixer	27	27	27	27.43	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3	Single Duct Mixer	28	28	28	27.53	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Admin	Single Duct Mixer	21	21	21	20.83	0.860	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 30

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Attrium	Single Duct Mixer	108	108	108	107.67	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel	Single Duct Mixer	22	22	22	21.95	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult	Single Duct Mixer	72	72	72	72.28	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N	Single Duct Mixer	25	25	25	24.54	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S	Single Duct Mixer	25	25	25	24.84	0.511	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W	Single Duct Mixer	19	19	19	19.44	0.365	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting	Single Duct Mixer	31	31	31	31.49	0.223	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage	Single Duct Mixer	37	37	37	37.41	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Group	Single Duct Mixer	91	91	91	91.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality	Single Duct Mixer	81	81	81	81.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A	Single Duct Mixer	69	69	69	69.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B	Single Duct Mixer	26	26	26	26.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Lounge	Single Duct Mixer	65	65	65	65.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining	Single Duct Mixer	160	160	160	160.19	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner	Single Duct Mixer	14	14	14	14.34	0.461	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East	Single Duct Mixer	28	28	28	28.27	0.552	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West	Single Duct Mixer	42	42	42	42.08	0.476	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N	Single Duct Mixer	14	14	14	14.20	0.562	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S	Single Duct Mixer	14	14	14	14.44	0.535	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East	Single Duct Mixer	41	41	41	40.91	0.567	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West	Single Duct Mixer	14	14	14	13.64	0.483	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North	Single Duct Mixer	14	14	14	14.27	0.551	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South	Single Duct Mixer	42	42	42	41.75	0.509	1.00	0.00	0.00	0.00	0.00	1.000
Servery	Single Duct Mixer	75	75	75	75.31	1.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support	Single Duct Mixer	36	36	36	36.20	0.707	1.00	0.00	0.00	0.00	0.00	1.000
Utility	Single Duct Mixer	164	164	164	164.17	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen _Single Zone CV		2,532	2,532	2,532	0							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	2,532	2,532	2,532	0.00	0.000	.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 30

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
DOAS to Zone Level Equipment Dehum and Reheat		1,550	1,550	1,550	1,550							
ACT-Noisy-1	Single Duct Mixer	38	38	38	37.73	0.192	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2	Single Duct Mixer	38	38	38	37.98	0.376	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3	Single Duct Mixer	38	38	38	38.25	0.364	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1	Single Duct Mixer	27	27	27	27.37	0.456	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2	Single Duct Mixer	27	27	27	27.43	0.318	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3	Single Duct Mixer	28	28	28	27.53	0.354	1.00	0.00	0.00	0.00	0.00	1.000
Admin	Single Duct Mixer	21	21	21	20.83	0.172	1.00	0.00	0.00	0.00	0.00	1.000
Attrium	Single Duct Mixer	108	108	108	107.67	0.287	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel	Single Duct Mixer	22	22	22	21.95	0.330	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult	Single Duct Mixer	72	72	72	72.28	0.488	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N	Single Duct Mixer	25	25	25	24.54	0.200	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S	Single Duct Mixer	25	25	25	24.84	0.102	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W	Single Duct Mixer	19	19	19	19.44	0.073	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting	Single Duct Mixer	31	31	31	31.49	0.045	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage	Single Duct Mixer	37	37	37	37.41	0.495	1.00	0.00	0.00	0.00	0.00	1.000
Group	Single Duct Mixer	91	91	91	91.22	0.634	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality	Single Duct Mixer	81	81	81	81.20	0.602	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A	Single Duct Mixer	69	69	69	69.37	0.314	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B	Single Duct Mixer	26	26	26	26.22	0.453	1.00	0.00	0.00	0.00	0.00	1.000
Lounge	Single Duct Mixer	65	65	65	65.27	0.274	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining	Single Duct Mixer	160	160	160	160.19	0.663	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner	Single Duct Mixer	14	14	14	14.34	0.092	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East	Single Duct Mixer	28	28	28	28.27	0.110	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West	Single Duct Mixer	42	42	42	42.08	0.110	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N	Single Duct Mixer	14	14	14	14.20	0.112	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S	Single Duct Mixer	14	14	14	14.44	0.107	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East	Single Duct Mixer	41	41	41	40.91	0.115	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West	Single Duct Mixer	14	14	14	13.64	0.110	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North	Single Duct Mixer	14	14	14	14.27	0.110	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South	Single Duct Mixer	42	42	42	41.75	0.102	1.00	0.00	0.00	0.00	0.00	1.000
Servery	Single Duct Mixer	75	75	75	75.31	0.701	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 30

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
SHWR-S	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W	Single Duct Mixer	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support	Single Duct Mixer	36	36	36	36.20	0.141	1.00	0.00	0.00	0.00	0.00	1.000
Utility	Single Duct Mixer	164	164	164	164.17	0.245	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen_Single Zone CV		2,532	2,532	2,532	0							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	2,532	2,532	2,532	0.00	0.000	0.00	0.00	0.00	0.00	0.00	1.000

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
ACT-Noisy-1		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 1	7.50	3.59	0.06	180	0	100.00	0	100.00	0
ACT-Noisy-2		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 2	7.50	3.61	0.06	181	0	100.00	0	100.00	0
ACT-Noisy-3		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 3	7.50	3.64	0.06	182	0	100.00	0	100.00	0
ACT-Quiet-1		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 1	7.50	2.60	0.06	130	0	100.00	0	100.00	0
ACT-Quiet-2		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 2	7.50	2.61	0.06	131	0	100.00	0	100.00	0
ACT-Quiet-3		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 3	7.50	2.62	0.06	131	0	100.00	0	100.00	0
Admin		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Office 1	5.00	0.94	0.06	94	0	100.00	0	100.00	0
	Office 2	5.00	0.95	0.06	95	0	100.00	0	100.00	0
Atrium		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Atrium 2	5.00	3.23	0.06	645	0	100.00	0	100.00	0
	Atrium	5.00	3.11	0.06	622	0	100.00	0	100.00	0
Chart/Hotel		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Chart/Hotel	5.00	2.00	0.06	200	0	100.00	0	100.00	0
Comfort/Consult		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Comfort Room 2	7.50	0.82	0.18	82	0	100.00	0	100.00	0
	Consult 1	7.50	1.00	0.18	100	0	100.00	0	100.00	0
	Consult 2	7.50	1.02	0.18	102	0	100.00	0	100.00	0
Corridor-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 3	0.00	0.00	0.06	409	0	100.00	0	100.00	0
Corridor-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 5	0.00	0.00	0.06	414	0	100.00	0	100.00	0
Corridor-W		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 4	0.00	0.00	0.06	324	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 30

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
Entry/Waiting		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Entry/Waiting	5.00	1.85	0.06	370	0	100.00	0	100.00	0
Exam/Storage		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Exam Room	7.50	1.23	0.18	123	0	100.00	0	100.00	0
	Long Term Belongings Storage	0.00	0.50	0.06	101	0	100.00	0	100.00	0
Group		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Group	7.50	5.52	0.18	276	0	100.00	0	100.00	0
Hospitality		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Hospitality	7.50	4.92	0.18	246	0	100.00	0	100.00	0
Intake-HR-A		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Sally Port	7.50	0.78	0.18	78	0	100.00	0	100.00	0
	Interview Room	7.50	1.58	0.18	158	0	100.00	0	100.00	0
	Intake Corridor	0.00	0.00	0.06	155	0	100.00	0	100.00	0
	Shower 1	0.00	1.60	0.00	80	0	100.00	0	100.00	0
		0.00	1.60	0.00	80	0	100.00	0	100.00	0
Intake-HR-B		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Comfort Room 1	7.50	0.84	0.18	84	0	100.00	0	100.00	0
	Ante Room	0.00	0.40	0.06	81	0	100.00	0	100.00	0
Lounge		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Lounge	7.50	3.95	0.18	198	0	100.00	0	100.00	0
	Shower 2	0.00	1.98	0.00	99	0	100.00	0	100.00	0
Multipurpose/Dining		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Multipurpose/Dining	7.50	9.70	0.18	485	0	100.00	0	100.00	0
RB-N-Corner		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 14	5.00	1.30	0.06	130	0	100.00	0	100.00	0
RB-N-East		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 15	5.00	1.30	0.06	130	0	100.00	0	100.00	0
	Resident Room 16	5.00	1.27	0.06	127	0	100.00	0	100.00	0
RB-N-West		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 11	5.00	1.29	0.06	129	0	100.00	0	100.00	0
	Resident Room 12	5.00	1.27	0.06	127	0	100.00	0	100.00	0
	Resident Room 13	5.00	1.27	0.06	127	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 30

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
RB-S-Corner-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 04	5.00	1.29	0.06	129	0	100.00	0	100.00	0
RB-S-Corner-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 05	5.00	1.31	0.06	131	0	100.00	0	100.00	0
RB-S-East		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 02	5.00	1.12	0.06	112	0	100.00	0	100.00	0
	Resident Room 03	5.00	1.36	0.06	136	0	100.00	0	100.00	0
	Resident Room 01	5.00	1.24	0.06	124	0	100.00	0	100.00	0
RB-S-West		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 06	5.00	1.24	0.06	124	0	100.00	0	100.00	0
RB-W-North		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 10	5.00	1.30	0.06	130	0	100.00	0	100.00	0
RB-W-South		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 07	5.00	1.25	0.06	125	0	100.00	0	100.00	0
	Resident Room 08	5.00	1.26	0.06	126	0	100.00	0	100.00	0
	Resident Room 09	5.00	1.28	0.06	128	0	100.00	0	100.00	0
Servery		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Servery	7.50	4.56	0.18	228	0	100.00	0	100.00	0
SHWR-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 7	0.00	2.06	0.00	103	0	100.00	0	100.00	0
	Shower 8	0.00	2.01	0.00	101	0	100.00	0	100.00	0
SHWR-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 3	0.00	2.08	0.00	104	0	100.00	0	100.00	0
	Shower 4	0.00	2.06	0.00	103	0	100.00	0	100.00	0
SHWR-W		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 5	0.00	2.07	0.00	104	0	100.00	0	100.00	0
	Shower 6	0.00	2.07	0.00	104	0	100.00	0	100.00	0
Support		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Fire Room	0.00	0.00	0.06	79	0	100.00	0	100.00	0
	Electric	0.00	0.00	0.06	191	0	100.00	0	100.00	0
	Emergency Electric	0.00	0.00	0.06	179	0	100.00	0	100.00	0
	Mechanical	0.00	0.00	0.06	155	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 30

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
Utility		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Soiled Supply	0.00	0.48	0.06	97	0	100.00	0	100.00	0
	Clean Supply	0.00	0.51	0.06	102	0	100.00	0	100.00	0
	Hskp	0.00	0.28	0.06	57	0	100.00	0	100.00	0
	Laundry	0.00	0.61	0.06	122	0	100.00	0	100.00	0
	Meds	0.00	0.65	0.06	129	0	100.00	0	100.00	0
	Stor.	0.00	0.07	0.06	15	0	100.00	0	100.00	0
	Storage	0.00	0.26	0.06	52	0	100.00	0	100.00	0
	Staff Corridor	0.00	0.00	0.06	893	0	100.00	0	100.00	0
	Corridor 1	0.00	0.00	0.06	295	0	100.00	0	100.00	0
	Corridor 2	0.00	0.00	0.06	635	0	100.00	0	100.00	0
	Toilet 1	0.00	1.34	0.00	67	0	100.00	0	100.00	0
	Toilet 2	0.00	1.24	0.00	62	0	100.00	0	100.00	0
	Toilet 3	0.00	1.23	0.00	62	0	100.00	0	100.00	0
	IT	0.00	0.00	0.06	158	0	100.00	0	100.00	0
	General Storage	0.00	0.48	0.06	96	0	100.00	0	100.00	0
	Corridor 2.1	0.00	0.00	0.06	85	0	100.00	0	100.00	0

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Single Zone CV	N/A	N/A	N/A
Kitchen	0	174	0.00%
Kitchen	0	155	N/A
Service	0	19	N/A
Variable Refrigerant Flow	N/A	N/A	N/A
ACT-Noisy-1	196	0	0.00%
Noisy Activity 1	196	0	N/A
ACT-Noisy-2	101	0	0.00%
Noisy Activity 2	100	0	N/A
ACT-Noisy-3	105	0	0.00%
Noisy Activity 3	105	0	N/A
ACT-Quiet-1	60	0	0.00%
Quiet Activity 1	60	0	N/A
ACT-Quiet-2	86	0	0.00%
Quiet Activity 2	85	0	N/A
ACT-Quiet-3	78	0	0.00%
Quiet Activity 3	77	0	N/A
Admin	121	0	0.00%
Office 1	65	0	N/A
Office 2	60	0	N/A
Atrium	375	0	0.00%
Atrium	145	0	N/A
Atrium 2	249	0	N/A
Chart/Hotel	66	0	0.00%
Chart/Hotel	64	0	N/A
Comfort/Consult	148	0	0.00%
Comfort Room 2	43	0	N/A
Consult 1	51	0	N/A
Consult 2	53	0	N/A
Corridor-N	123	0	0.00%
Corridor 3	122	0	N/A
Corridor-S	243	0	0.00%

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 10 of 30

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Corridor 5	243	0	N/A
Corridor-W	266	0	0.00%
Corridor 4	265	0	N/A
Entry/Waiting	706	0	0.00%
Entry/Waiting	710	0	N/A
Exam/Storage	76	0	0.00%
Exam Room	49	0	N/A
Long Term Belongings Storage	24	0	N/A
Group	144	0	0.00%
Group	143	0	N/A
Hospitality	135	0	0.00%
Hospitality	135	0	N/A
Intake-HR-A	221	0	0.00%
Intake Corridor	28	0	N/A
Interview Room	87	0	N/A
Sally Port	70	0	N/A
Shower 1	36	0	N/A
Intake-HR-B	58	0	0.00%
Ante Room	21	0	N/A
Comfort Room 1	37	0	N/A
Lounge	238	0	0.00%
Lounge	177	0	N/A
Shower 2	55	0	N/A
Multipurpose/Dining	242	0	0.00%
Multipurpose/Dining	241	0	N/A
RB-N-Corner	155	0	0.00%
Resident Room 14	156	0	N/A
RB-N-East	256	0	0.00%
Resident Room 15	131	0	N/A
Resident Room 16	123	0	N/A
RB-N-West	442	0	0.00%
Resident Room 11	145	0	N/A
Resident Room 12	147	0	N/A

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 11 of 30

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Resident Room 13	148	0	N/A
RB-S-Corner-N	126	0	0.00%
Resident Room 04	127	0	N/A
RB-S-Corner-S	135	0	0.00%
Resident Room 05	135	0	N/A
RB-S-East	361	0	0.00%
Resident Room 01	114	0	N/A
Resident Room 02	118	0	N/A
Resident Room 03	132	0	N/A
RB-S-West	141	0	0.00%
Resident Room 06	141	0	N/A
RB-W-North	129	0	0.00%
Resident Room 10	129	0	N/A
RB-W-South	410	0	0.00%
Resident Room 07	132	0	N/A
Resident Room 08	137	0	N/A
Resident Room 09	141	0	N/A
Servery	107	0	0.00%
Servery	107	0	N/A
SHWR-N	95	0	0.00%
Shower 7	49	0	N/A
Shower 8	46	0	N/A
SHWR-S	104	0	0.00%
Shower 3	52	0	N/A
Shower 4	52	0	N/A
SHWR-W	93	0	0.00%
Shower 5	47	0	N/A
Shower 6	45	0	N/A
Support	256	0	0.00%
Electric	87	0	N/A
Emergency Electric	70	0	N/A
Fire Room	47	0	N/A
Mechanical	53	0	N/A
Utility	670	0	0.00%

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 12 of 30

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Clean Supply	23	0	N/A
Corridor 1	55	0	N/A
Corridor 2	101	0	N/A
Corridor 2.1	18	0	N/A
General Storage	41	0	N/A
Hskp	14	0	N/A
IT	49	0	N/A
Laundry	27	0	N/A
Meds	29	0	N/A
Soiled Supply	23	0	N/A
Staff Corridor	199	0	N/A
Stor.	8	0	N/A
Storage	20	0	N/A
Toilet 1	41	0	N/A
Toilet 2	18	0	N/A
Toilet 3	18	0	N/A

Outside Air / ASHRAE Standard 62.1 Summary

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	P _s People	ΣP_z People	D P _s / ΣP_z	V _{ou} (cfm)	V _{ps} (cfm)	X _s	Ev	V _{ot} (cfm)	%OA V _{ot} / V _{ps}
ACT-Noisy-1_System 4 - 2007/2010/2013	Cooling	183	0	4	1	38	183	1	1	38	20.6%
	Heating	183	0	4	1	38	183	0.473	1	38	20.6%
ACT-Noisy-2_System 4 - 2007/2010/2013	Cooling	107	0	4	1	38	107	1	1	38	35.6%
	Heating	107	0	4	1	38	107	0.622	1	38	35.6%
ACT-Noisy-3_System 4 - 2007/2010/2013	Cooling	112	0	4	1	38	112	1	1	38	34.1%
	Heating	112	0	4	1	38	112	0.503	1	38	34.1%
ACT-Quiet-1_System 4 - 2007/2010/2013	Cooling	64	0	3	1	27	64	1	1	27	42.9%
	Heating	64	0	3	1	27	64	1	1	27	42.9%
ACT-Quiet-2_System 4 - 2007/2010/2013	Cooling	84	0	3	1	27	84	1	1	27	32.7%
	Heating	84	0	3	1	27	84	0.733	1	27	32.7%
ACT-Quiet-3_System 4 - 2007/2010/2013	Cooling	91	0	3	1	28	91	1	1	28	30.4%
	Heating	91	0	3	1	28	91	0.716	1	28	30.4%
Admin_System 4 - 2007/2010/2013	Cooling	165	0	2	1	21	165	1	1	21	12.6%
	Heating	165	0	2	1	21	165	0.299	1	21	12.6%
Atrium_System 2 - 2007/2010/2013	Cooling	567	0	6	1	0	567	1	1	0	0.0%
	Heating	567	0	6	1	0	567	0	1	0	0.0%
Chart/Hotel_System 4 - 2007/2010/2013	Cooling	79	0	2	1	22	79	1	1	22	27.8%
	Heating	79	0	2	1	22	79	0.833	1	22	27.8%
Comfort/Consult_System 4 - 2007/2010/2013	Cooling	178	0	3	1	72	178	1	1	72	40.7%
	Heating	178	0	3	1	72	178	0.779	1	72	40.7%
Corridor-N_System 2 - 2007/2010/2013	Cooling	118	0	0	1	25	118	1	1	25	20.8%
	Heating	118	0	0	1	25	118	0.208	1	25	20.8%
Corridor-S_System 2 - 2007/2010/2013	Cooling	177	0	0	1	25	177	1	1	25	14.1%
	Heating	177	0	0	1	25	177	0.215	1	25	14.1%

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	Ps People	ΣP_z People	D Ps / ΣP_z	Vou (cfm)	Vps (cfm)	Xs	Ev	Vot (cfm)	%OA Vot / Vps
Corridor-W_System 2 - 2007/2010/2013	Cooling	210	0	0	1	19	210	1	1	19	9.2%
	Heating	210	0	0	1	19	210	0.184	1	19	9.2%
Entry/Waiting_System 4 - 2007/2010/2013	Cooling	524	0	2	1	31	524	1	1	31	6.0%
	Heating	524	0	2	1	31	524	0.093	1	31	6.0%
Exam/Storage_System 4 - 2007/2010/2013	Cooling	97	0	2	1	37	97	1	1	37	38.4%
	Heating	97	0	2	1	37	97	1	1	37	38.4%
Group_System 4 - 2007/2010/2013	Cooling	182	0	6	1	91	182	1	1	91	50.1%
	Heating	182	0	6	1	91	182	0.885	1	91	50.1%
Hospitality_System 4 - 2007/2010/2013	Cooling	164	0	5	1	81	164	1	1	81	49.4%
	Heating	164	0	5	1	81	164	0.893	1	81	49.4%
Intake-HR-A_System 4 - 2007/2010/2013	Cooling	302	0	4	1	69	302	1	1	69	23.0%
	Heating	302	0	4	1	69	302	0.456	1	69	23.0%
Intake-HR-B_System 4 - 2007/2010/2013	Cooling	78	0	1	1	26	78	1	1	26	33.5%
	Heating	78	0	1	1	26	78	0.871	1	26	33.5%
Kitchen_System 4 - 2007/2010/2013_Copy	Cooling	2,801	0	13	1	235	2,801	1	1	235	8.4%
	Heating	2,801	0	13	1	235	2,801	0.088	1	235	8.4%
Lounge_System 4 - 2007/2010/2013	Cooling	293	0	6	1	65	293	1	1	65	22.3%
	Heating	293	0	6	1	65	293	0.586	1	65	22.3%
Multipurpose/Dining_System 4 - 2007/2010/2013	Cooling	308	0	10	1	160	308	1	1	160	52.0%
	Heating	308	0	10	1	160	308	0.942	1	160	52.0%
RB-N-Corner_System 2 - 2007/2010/2013	Cooling	126	0	1	1	14	126	1	1	14	11.4%
	Heating	126	0	1	1	14	126	0.219	1	14	11.4%
RB-N-East_System 2 - 2007/2010/2013	Cooling	198	0	3	1	28	198	1	1	28	14.3%
	Heating	198	0	3	1	28	198	0.251	1	28	14.3%
RB-N-West_System 2 - 2007/2010/2013	Cooling	336	0	4	1	42	336	1	1	42	12.5%
	Heating	336	0	4	1	42	336	0.301	1	42	12.5%

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 15 of 30

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	Ps People	ΣP_z People	D Ps / ΣP_z	Vou (cfm)	Vps (cfm)	Xs	Ev	Vot (cfm)	%OA Vot / Vps
RB-S-Corner-N _System 2 - 2007/2010/2013	Cooling	109	0	1	1	14	109	1	1	14	13.0%
	Heating	109	0	1	1	14	109	0.219	1	14	13.0%
RB-S-Corner-S _System 2 - 2007/2010/2013	Cooling	136	0	1	1	14	136	1	1	14	10.6%
	Heating	136	0	1	1	14	136	0.219	1	14	10.6%
RB-S-East _System 2 - 2007/2010/2013	Cooling	270	0	4	1	41	270	1	1	41	15.1%
	Heating	270	0	4	1	41	270	0.316	1	41	15.1%
RB-S-West _System 2 - 2007/2010/2013	Cooling	109	0	1	1	14	109	1	1	14	12.5%
	Heating	109	0	1	1	14	109	0.297	1	14	12.5%
RB-W-North _System 2 - 2007/2010/2013	Cooling	118	0	1	1	14	118	1	1	14	12.1%
	Heating	118	0	1	1	14	118	0.203	1	14	12.1%
RB-W-South _System 2 - 2007/2010/2013	Cooling	355	0	4	1	42	355	1	1	42	11.8%
	Heating	355	0	4	1	42	355	0.238	1	42	11.8%
Servery _System 4 - 2007/2010/2013	Cooling	141	0	5	1	75	141	1	1	75	53.3%
	Heating	141	0	5	1	75	141	1	1	75	53.3%
SHWR-N _System 2 - 2007/2010/2013	Cooling	120	0	4	1	0	120	1	1	0	0.0%
	Heating	120	0	4	1	0	120	0	1	0	0.0%
SHWR-S _System 2 - 2007/2010/2013	Cooling	141	0	4	1	0	141	1	1	0	0.0%
	Heating	141	0	4	1	0	141	0	1	0	0.0%
SHWR-W _System 2 - 2007/2010/2013	Cooling	113	0	4	1	0	113	1	1	0	0.0%
	Heating	113	0	4	1	0	113	0	1	0	0.0%
Support _System 4 - 2007/2010/2013	Cooling	340	0	0	1	31	340	1	1	31	9.3%
	Heating	340	0	0	1	31	340	0.193	1	31	9.3%
System 10 - 2010/2013	Cooling	75	0	0	1	0	75	1	1	0	0.0%
	Heating	75	0	0	1	0	75	0	1	0	0.0%
Utility _System 4 - 2007/2010/2013	Cooling	1,031	0	7	1	164	1,031	1	1	164	15.9%
	Heating	1,031	0	7	1	164	1,031	0.307	1	164	15.9%

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
ACT-Noisy-1_System 4 - 2007/2010/2013	0.00	3.59	0.21	180	38		38		38
ACT-Noisy-1	0.00	3.59	0.21	180	38	1.00	38	1.00	38
ACT-Noisy-2_System 4 - 2007/2010/2013	0.00	3.62	0.21	181	38		38		38
ACT-Noisy-2	0.00	3.62	0.21	181	38	1.00	38	1.00	38
ACT-Noisy-3_System 4 - 2007/2010/2013	0.00	3.64	0.21	182	38		38		38
ACT-Noisy-3	0.00	3.64	0.21	182	38	1.00	38	1.00	38
ACT-Quiet-1_System 4 - 2007/2010/2013	0.00	2.61	0.21	130	27		27		27
ACT-Quiet-1	0.00	2.61	0.21	130	27	1.00	27	1.00	27
ACT-Quiet-2_System 4 - 2007/2010/2013	0.00	2.61	0.21	131	27		27		27
ACT-Quiet-2	0.00	2.61	0.21	131	27	1.00	27	1.00	27
ACT-Quiet-3_System 4 - 2007/2010/2013	0.00	2.62	0.21	131	28		28		28
ACT-Quiet-3	0.00	2.62	0.21	131	28	1.00	28	1.00	28
Admin_System 4 - 2007/2010/2013	0.00	1.89	0.11	189	21		21		21
Admin	0.00	1.89	0.11	189	21	1.00	21	1.00	21
Attrium_System 2 - 2007/2010/2013	0.00	6.33	0.00	1,267	0		0		0
Attrium	0.00	6.33	0.00	1,267	0	1.00	0	1.00	0
Chart/Hotel_System 4 - 2007/2010/2013	0.00	2.00	0.11	200	22		22		22
Chart/Hotel	0.00	2.00	0.11	200	22	1.00	22	1.00	22
Comfort/Consult_System 4 - 2007/2010/2013	0.00	2.83	0.26	283	72		72		72
Comfort/Consult	0.00	2.83	0.26	283	72	1.00	72	1.00	72
Corridor-N_System 2 - 2007/2010/2013	0.00	0.00	0.06	409	25		25		25
Corridor-N	0.00	0.00	0.06	409	25	1.00	25	1.00	25
Corridor-S_System 2 - 2007/2010/2013	0.00	0.00	0.06	414	25		25		25
Corridor-S	0.00	0.00	0.06	414	25	1.00	25	1.00	25
Corridor-W_System 2 - 2007/2010/2013	0.00	0.00	0.06	324	19		19		19
Corridor-W	0.00	0.00	0.06	324	19	1.00	19	1.00	19

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
Entry/Waiting_System 4 - 2007/2010/2013	0.00	1.85	0.09	370	32		31		31
Entry/Waiting	0.00	1.85	0.09	370	31	1.00	31	1.00	31
Exam/Storage_System 4 - 2007/2010/2013	0.00	1.73	0.17	224	38		37		37
Exam/Storage	0.00	1.73	0.17	224	37	1.00	37	1.00	37
Group_System 4 - 2007/2010/2013	0.00	5.53	0.33	276	91		91		91
Group	0.00	5.53	0.33	276	91	1.00	91	1.00	91
Hospitality_System 4 - 2007/2010/2013	0.00	4.92	0.33	246	81		81		81
Hospitality	0.00	4.92	0.33	246	81	1.00	81	1.00	81
Intake-HR-A_System 4 - 2007/2010/2013	0.00	3.96	0.15	471	69		69		69
Intake-HR-A	0.00	3.96	0.15	471	69	1.00	69	1.00	69
Intake-HR-B_System 4 - 2007/2010/2013	0.00	1.24	0.16	165	26		26		26
Intake-HR-B	0.00	1.24	0.16	165	26	1.00	26	1.00	26
Kitchen_System 4 - 2007/2010/2013_Copy	6.63	13.09	0.22	686	235		235		235
Kitchen	6.63	13.09	0.22	686	235	1.00	235	1.00	235
Lounge_System 4 - 2007/2010/2013	0.00	5.93	0.22	297	65		65		65
Lounge	0.00	5.93	0.22	297	65	1.00	65	1.00	65
Multipurpose/Dining_System 4 - 2007/2010/2013	0.00	9.71	0.33	485	160		160		160
Multipurpose/Dining	0.00	9.71	0.33	485	160	1.00	160	1.00	160
RB-N-Corner_System 2 - 2007/2010/2013	0.00	1.30	0.11	130	14		14		14
RB-N-Corner	0.00	1.30	0.11	130	14	1.00	14	1.00	14
RB-N-East_System 2 - 2007/2010/2013	0.00	2.57	0.11	257	28		28		28
RB-N-East	0.00	2.57	0.11	257	28	1.00	28	1.00	28
RB-N-West_System 2 - 2007/2010/2013	0.00	3.83	0.11	383	42		42		42
RB-N-West	0.00	3.83	0.11	383	42	1.00	42	1.00	42
RB-S-Corner-N_System 2 - 2007/2010/2013	0.00	1.29	0.11	129	14		14		14
RB-S-Corner-N	0.00	1.29	0.11	129	14	1.00	14	1.00	14

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 18 of 30

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
RB-S-Corner-S _System 2 - 2007/2010/2013	0.00	1.31	0.11	131	14		14		14
RB-S-Corner-S	0.00	1.31	0.11	131	14	1.00	14	1.00	14
RB-S-East _System 2 - 2007/2010/2013	0.00	3.72	0.11	372	41		41		41
RB-S-East	0.00	3.72	0.11	372	41	1.00	41	1.00	41
RB-S-West _System 2 - 2007/2010/2013	0.00	1.24	0.11	124	14		14		14
RB-S-West	0.00	1.24	0.11	124	14	1.00	14	1.00	14
RB-W-North _System 2 - 2007/2010/2013	0.00	1.30	0.11	130	14		14		14
RB-W-North	0.00	1.30	0.11	130	14	1.00	14	1.00	14
RB-W-South _System 2 - 2007/2010/2013	0.00	3.80	0.11	380	42		42		42
RB-W-South	0.00	3.80	0.11	380	42	1.00	42	1.00	42
Servery _System 4 - 2007/2010/2013	0.00	4.56	0.33	228	75		75		75
Servery	0.00	4.56	0.33	228	75	1.00	75	1.00	75
SHWR-N _System 2 - 2007/2010/2013	0.00	4.07	0.00	204	0		0		0
SHWR-N	0.00	4.07	0.00	204	0	1.00	0	1.00	0
SHWR-S _System 2 - 2007/2010/2013	0.00	4.14	0.00	207	0		0		0
SHWR-S	0.00	4.14	0.00	207	0	1.00	0	1.00	0
SHWR-W _System 2 - 2007/2010/2013	0.00	4.14	0.00	207	0		0		0
SHWR-W	0.00	4.14	0.00	207	0	1.00	0	1.00	0
Support _System 4 - 2007/2010/2013	0.00	0.00	0.06	524	31		31		31
Support	0.00	0.00	0.06	524	31	1.00	31	1.00	31
System 10 - 2010/2013	0.00	0.00	0.00	79	0		0		0
Fire Room	0.00	0.00	0.00	79	0	1.00	0	1.00	0
Utility _System 4 - 2007/2010/2013	0.00	7.15	0.06	2,927	164		164		164
Utility	0.00	7.15	0.06	2,927	164	1.00	164	1.00	164

*Ventilation Sizing Factor: 1.00

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
ACT-Noisy-1 _System 4 - 2007/2010/2013		183	183	183	38							
ACT-Noisy-1	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	183	183	183	37.73	0.206	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2 _System 4 - 2007/2010/2013		107	107	107	38							
ACT-Noisy-2	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	107	107	107	37.99	0.356	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3 _System 4 - 2007/2010/2013		112	112	112	38							
ACT-Noisy-3	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	112	112	112	38.25	0.341	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1 _System 4 - 2007/2010/2013		64	64	64	27							
ACT-Quiet-1	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	64	64	64	27.37	0.429	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2 _System 4 - 2007/2010/2013		84	84	84	27							
ACT-Quiet-2	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	84	84	84	27.42	0.327	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3 _System 4 - 2007/2010/2013		91	91	91	28							
ACT-Quiet-3	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	91	91	91	27.54	0.304	1.00	0.00	0.00	0.00	0.00	1.000
Admin _System 4 - 2007/2010/2013		165	165	165	21							
Admin	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	165	165	165	20.83	0.126	1.00	0.00	0.00	0.00	0.00	1.000
Attrium _System 2 - 2007/2010/2013		567	567	567	0							
Attrium	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	567	567	567	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel _System 4 - 2007/2010/2013		79	79	79	22							
Chart/Hotel	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	79	79	79	21.96	0.278	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult _System 4 - 2007/2010/2013		178	178	178	72							
Comfort/Consult	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	178	178	178	72.29	0.407	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N _System 2 - 2007/2010/2013		118	118	118	25							
Corridor-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	118	118	118	24.55	0.208	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S _System 2 - 2007/2010/2013		177	177	177	25							

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Corridor-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	177	177	177	24.84	0.141	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W _System 2 - 2007/2010/2013		210	210	210	19							
Corridor-W	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	210	210	210	19.44	0.092	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting _System 4 - 2007/2010/2013		524	524	524	31							
Entry/Waiting	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	524	524	524	31.48	0.060	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage _System 4 - 2007/2010/2013		97	97	97	37							
Exam/Storage	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	97	97	97	37.42	0.384	1.00	0.00	0.00	0.00	0.00	1.000
Group _System 4 - 2007/2010/2013		182	182	182	91							
Group	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	182	182	182	91.23	0.501	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality _System 4 - 2007/2010/2013		164	164	164	81							
Hospitality	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	164	164	164	81.19	0.494	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A _System 4 - 2007/2010/2013		302	302	302	69							
Intake-HR-A	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	302	302	302	69.37	0.230	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B _System 4 - 2007/2010/2013		78	78	78	26							
Intake-HR-B	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	78	78	78	26.22	0.335	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen _System 4 - 2007/2010/2013_Copy		2,801	2,801	2,801	235							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	2,801	2,801	2,801	234.59	0.084	1.00	0.00	0.00	0.00	0.00	1.000
Lounge _System 4 - 2007/2010/2013		293	293	293	65							
Lounge	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	293	293	293	65.26	0.223	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining _System 4 - 2007/2010/2013		308	308	308	160							
Multipurpose/Dining	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	308	308	308	160.18	0.520	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner _System 2 - 2007/2010/2013		126	126	126	14							
RB-N-Corner	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	126	126	126	14.34	0.114	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 21 of 30

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
RB-N-East_System 2 - 2007/2010/2013		198	198	198	28							
RB-N-East	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	198	198	198	28.27	0.143	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West_System 2 - 2007/2010/2013		336	336	336	42							
RB-N-West	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	336	336	336	42.07	0.125	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N_System 2 - 2007/2010/2013		109	109	109	14							
RB-S-Corner-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	109	109	109	14.20	0.130	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S_System 2 - 2007/2010/2013		136	136	136	14							
RB-S-Corner-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	136	136	136	14.44	0.106	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East_System 2 - 2007/2010/2013		270	270	270	41							
RB-S-East	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	270	270	270	40.90	0.151	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West_System 2 - 2007/2010/2013		109	109	109	14							
RB-S-West	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	109	109	109	13.63	0.125	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North_System 2 - 2007/2010/2013		118	118	118	14							
RB-W-North	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	118	118	118	14.27	0.121	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South_System 2 - 2007/2010/2013		355	355	355	42							
RB-W-South	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	355	355	355	41.74	0.118	1.00	0.00	0.00	0.00	0.00	1.000
Servery_System 4 - 2007/2010/2013		141	141	141	75							
Servery	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	141	141	141	75.31	0.533	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N_System 2 - 2007/2010/2013		120	120	120	0							
SHWR-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	120	120	120	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S_System 2 - 2007/2010/2013		141	141	141	0							
SHWR-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	141	141	141	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W_System 2 - 2007/2010/2013		113	113	113	0							

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
SHWR-W	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	113	113	113	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support _System 4 - 2007/2010/2013		340	340	340	31							
Support	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	340	340	340	31.45	0.093	1.00	0.00	0.00	0.00	0.00	1.000
System 10 - 2010/2013		75	75	75	0							
Fire Room	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	75	75	75	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Utility _System 4 - 2007/2010/2013		1,031	1,031	1,031	164							
Utility	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	1,031	1,031	1,031	164.17	0.159	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
ACT-Noisy-1 _System 4 - 2007/2010/2013		183	183	183	38							
ACT-Noisy-1	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	183	183	183	37.73	0.206	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2 _System 4 - 2007/2010/2013		107	107	107	38							
ACT-Noisy-2	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	107	107	107	37.99	0.356	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3 _System 4 - 2007/2010/2013		112	112	112	38							
ACT-Noisy-3	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	112	112	112	38.25	0.341	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1 _System 4 - 2007/2010/2013		64	64	64	27							
ACT-Quiet-1	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	64	64	64	27.37	0.429	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2 _System 4 - 2007/2010/2013		84	84	84	27							
ACT-Quiet-2	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	84	84	84	27.42	0.327	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3 _System 4 - 2007/2010/2013		91	91	91	28							
ACT-Quiet-3	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	91	91	91	27.54	0.304	1.00	0.00	0.00	0.00	0.00	1.000
Admin _System 4 - 2007/2010/2013		165	165	165	21							
Admin	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	165	165	165	20.83	0.126	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Attrium _System 2 - 2007/2010/2013		567	567	567	0							
Attrium	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	567	567	567	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel _System 4 - 2007/2010/2013		79	79	79	22							
Chart/Hotel	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	79	79	79	21.96	0.278	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult _System 4 - 2007/2010/2013		178	178	178	72							
Comfort/Consult	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	178	178	178	72.29	0.407	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N _System 2 - 2007/2010/2013		118	118	118	25							
Corridor-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	118	118	118	24.55	0.208	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S _System 2 - 2007/2010/2013		177	177	177	25							
Corridor-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	177	177	177	24.84	0.141	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W _System 2 - 2007/2010/2013		210	210	210	19							
Corridor-W	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	210	210	210	19.44	0.092	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting _System 4 - 2007/2010/2013		524	524	524	31							
Entry/Waiting	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	524	524	524	31.48	0.060	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage _System 4 - 2007/2010/2013		97	97	97	37							
Exam/Storage	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	97	97	97	37.42	0.384	1.00	0.00	0.00	0.00	0.00	1.000
Group _System 4 - 2007/2010/2013		182	182	182	91							
Group	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	182	182	182	91.23	0.501	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality _System 4 - 2007/2010/2013		164	164	164	81							
Hospitality	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	164	164	164	81.19	0.494	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A _System 4 - 2007/2010/2013		302	302	302	69							
Intake-HR-A	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	302	302	302	69.37	0.230	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B _System 4 - 2007/2010/2013		78	78	78	26							
Intake-HR-B	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	78	78	78	26.22	0.335	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Kitchen _System 4 - 2007/2010/2013_Copy		2,801	2,801	2,801	235							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	2,801	2,801	2,801	234.59	0.084	1.00	0.00	0.00	0.00	0.00	1.000
Lounge _System 4 - 2007/2010/2013		293	293	293	65							
Lounge	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	293	293	293	65.26	0.223	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining _System 4 - 2007/2010/2013		308	308	308	160							
Multipurpose/Dining	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	308	308	308	160.18	0.520	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner _System 2 - 2007/2010/2013		126	126	126	14							
RB-N-Corner	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	126	126	126	14.34	0.114	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East _System 2 - 2007/2010/2013		198	198	198	28							
RB-N-East	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	198	198	198	28.27	0.143	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West _System 2 - 2007/2010/2013		336	336	336	42							
RB-N-West	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	336	336	336	42.07	0.125	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N _System 2 - 2007/2010/2013		109	109	109	14							
RB-S-Corner-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	109	109	109	14.20	0.130	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S _System 2 - 2007/2010/2013		136	136	136	14							
RB-S-Corner-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	136	136	136	14.44	0.106	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East _System 2 - 2007/2010/2013		270	270	270	41							
RB-S-East	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	270	270	270	40.90	0.151	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West _System 2 - 2007/2010/2013		109	109	109	14							
RB-S-West	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	109	109	109	13.63	0.125	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North _System 2 - 2007/2010/2013		118	118	118	14							
RB-W-North	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	118	118	118	14.27	0.121	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South _System 2 - 2007/2010/2013		355	355	355	42							
RB-W-South	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	355	355	355	41.74	0.118	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Servery _System 4 - 2007/2010/2013		141	141	141	75							
Servery	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	141	141	141	75.31	0.533	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N _System 2 - 2007/2010/2013		120	120	120	0							
SHWR-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	120	120	120	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S _System 2 - 2007/2010/2013		141	141	141	0							
SHWR-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	141	141	141	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W _System 2 - 2007/2010/2013		113	113	113	0							
SHWR-W	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	113	113	113	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support _System 4 - 2007/2010/2013		340	340	340	31							
Support	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	340	340	340	31.45	0.093	1.00	0.00	0.00	0.00	0.00	1.000
System 10 - 2010/2013		75	75	75	0							
Fire Room	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	75	75	75	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Utility _System 4 - 2007/2010/2013		1,031	1,031	1,031	164							
Utility	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	1,031	1,031	1,031	164.17	0.159	1.00	0.00	0.00	0.00	0.00	1.000

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
System 10 - 2010/2013	75	0	0.00%
Fire Room	0	0	N/A
Fire Room	0	0	N/A
System 2 - 2007/2010/2013	N/A	N/A	N/A
Attrium	0	0	0.00%
Attrium	0	0	N/A
Attrium 2	0	0	N/A
Corridor-N	0	25	0.00%
Corridor 3	0	25	N/A
Corridor-S	0	25	0.00%
Corridor 5	0	25	N/A
Corridor-W	0	19	0.00%
Corridor 4	0	19	N/A
RB-N-Corner	0	15	0.00%
Resident Room 14	0	15	N/A
RB-N-East	0	28	0.00%
Resident Room 15	0	15	N/A
Resident Room 16	0	15	N/A
RB-N-West	0	42	0.00%
Resident Room 11	0	15	N/A
Resident Room 12	0	15	N/A
Resident Room 13	0	15	N/A
RB-S-Corner-N	0	15	0.00%
Resident Room 04	0	15	N/A
RB-S-Corner-S	0	15	0.00%
Resident Room 05	0	15	N/A
RB-S-East	0	40	0.00%
Resident Room 01	0	13	N/A
Resident Room 02	0	13	N/A
Resident Room 03	0	15	N/A
RB-S-West	0	13	0.00%
Resident Room 06	0	13	N/A

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
RB-W-North	0	15	0.00%
Resident Room 10	0	15	N/A
RB-W-South	0	42	0.00%
Resident Room 07	0	15	N/A
Resident Room 08	0	15	N/A
Resident Room 09	0	15	N/A
SHWR-N	0	0	0.00%
Shower 7	0	0	N/A
Shower 8	0	0	N/A
SHWR-S	0	0	0.00%
Shower 3	0	0	N/A
Shower 4	0	0	N/A
SHWR-W	0	0	0.00%
Shower 5	0	0	N/A
Shower 6	0	0	N/A
System 4 - 2007/2010/2013	N/A	N/A	N/A
ACT-Noisy-1	0	38	0.00%
Noisy Activity 1	0	38	N/A
ACT-Noisy-2	0	38	0.00%
Noisy Activity 2	0	38	N/A
ACT-Noisy-3	0	38	0.00%
Noisy Activity 3	0	38	N/A
ACT-Quiet-1	0	28	0.00%
Quiet Activity 1	0	28	N/A
ACT-Quiet-2	0	28	0.00%
Quiet Activity 2	0	28	N/A
ACT-Quiet-3	0	28	0.00%
Quiet Activity 3	0	28	N/A
Admin	0	21	0.00%
Office 1	0	11	N/A
Office 2	0	11	N/A
Chart/Hotel	0	21	0.00%
Chart/Hotel	0	21	N/A

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Comfort/Consult	0	72	0.00%
Comfort Room 2	0	21	N/A
Consult 1	0	25	N/A
Consult 2	0	25	N/A
Entry/Waiting	0	32	0.00%
Entry/Waiting	0	32	N/A
Exam/Storage	0	38	0.00%
Exam Room	0	21	N/A
Long Term Belongings Storage	0	17	N/A
Group	0	91	0.00%
Group	0	91	N/A
Hospitality	0	81	0.00%
Hospitality	0	81	N/A
Intake-HR-A	0	70	0.00%
Intake Corridor	0	23	N/A
Interview Room	0	23	N/A
Sally Port	0	11	N/A
Shower 1	0	13	N/A
Intake-HR-B	0	25	0.00%
Ante Room	0	13	N/A
Comfort Room 1	0	13	N/A
Lounge	0	66	0.00%
Lounge	0	44	N/A
Shower 2	0	21	N/A
Multipurpose/Dining	0	161	0.00%
Multipurpose/Dining	0	161	N/A
Servery	0	76	0.00%
Servery	0	76	N/A
Support	0	32	0.00%
Electric	0	11	N/A
Emergency Electric	0	11	N/A
Mechanical	0	8	N/A
Utility	0	163	0.00%
Clean Supply	0	6	N/A
Corridor 1	0	17	N/A

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 29 of 30

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Corridor 2	0	36	N/A
Corridor 2.1	0	4	N/A
General Storage	0	6	N/A
Hskp	0	4	N/A
IT	0	8	N/A
Laundry	0	6	N/A
Meds	0	6	N/A
Soiled Supply	0	6	N/A
Staff Corridor	0	51	N/A
Stor.	0	0	N/A
Storage	0	2	N/A
Toilet 1	0	4	N/A
Toilet 2	0	4	N/A
Toilet 3	0	4	N/A
System 4 - 2007/2010/2013_Copy	N/A	N/A	N/A
Kitchen	0	235	0.00%
Kitchen	0	133	N/A
Service	0	102	N/A

Plant Summary

Variable Refrigerant Flow Plant Summary

	Sizing Method	Cooling Peak Time Mo./Day/Time	Cooling Capacity (tons)	Heating Peak Time Mo./Day/Time	Heating Capacity (MBh)	Cond Flow Rate (gpm)
Air Source VRF OVRF-1	Peak	Sum of Peaks	10.98	Sum of Peaks	131.73	0

Plant Summary

This alternative does not include any cooling, heating, or VRF plants.

System Cooling Checksums

Kitchen_Single Zone CV

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	1,108	0	1,108	1.3	1.5
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	950	0	950	1.1	19.4
Wall	0	786	0	786	0.9	1.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,566	0	-1,566	-1.8	-1.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-384	0	-384	-0.4	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	411	0	-83	329	0.4	0.5
Envelope Subtotal	411	894	-83	1,223	1.4	-
People	1,375	1,906	3,197	6,478	7.4	9.5
Lights	365	570	0	935	1.1	2.0
RA Sensible (Lights)	-48	0	0	-48	-0.1	0.0
Miscellaneous Loads	13,333	8,898	0	22,232	25.5	32.5
Internal Subtotal	15,025	11,374	3,197	29,597	34.0	-
Ventilation	61,788	0	-12,415	49,374	56.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	3,503	0	-	3,503	4.0	-
Time Delay Correction	0	-41	-	-41	0.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1,022	0	2,351	3,373	3.9	-
Grand Total	81,749	12,227	-6,949	87,027	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/16:00		
Outside Air (DB/WB/HR):		96.5 / 63.6 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	1,094	1,094	3.8
	0	0	0	0.0
	0	0	0	0.0
	0	1,174	1,174	4.1
	0	1,238	1,238	4.3
	0	0	0	0.0
	0	0	0	0.0
	0	-1,389	-1,389	-4.8
	0	0	0	0.0
	0	0	0	0.0
	0	-378	-378	-1.3
	0	0	0	0.0
	373	0	373	1.3
	373	1,739	2,112	7.4
	1,375	1,906	3,281	11.4
	365	570	935	3.3
	-	-	-	-
	13,333	8,898	22,232	77.4
	15,073	11,374	26,448	92.0
	-	-	-	-
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-49	-49	-0.2
	0	-	0	0.0
	222	-	222	0.8
	15,669	13,065	28,734	100.0

Temperatures °F	
Supply	64.0
Return	75.2
Mixed Air	98.5
Fan Heat TD	1.3

Airflows cfm	
Main Fan	2,532
Ventilation	174
Infiltration	17
Min Stop / Reheat	2,532

Engineering Checks	
% OA	6.93
cfm/ft²	3.66
Btu/h-ft²	127.04
cfm/ton	345.68
ft²/ton	94.52
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

System Cooling Checksums

Attrium_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/16:00				
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	2,389	0	2,389	15.9	3.4
Other Roof	0	0	0	0	0.0	0.0
Glass	1,140	566	0	1,706	11.3	30.0
Door	0	0	0	0	0.0	0.0
Wall	0	3,093	0	3,093	20.5	3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	128	0	128	0.8	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	-235	0	-235	-1.6	-0.3
Slab	0	-8	0	-8	-0.1	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	694	0	-62	633	4.2	0.6
Envelope Subtotal	1,835	5,932	-62	7,705	51.2	-
People	621	883	982	2,485	16.5	2.0
Lights	1,050	1,546	0	2,596	17.2	3.0
RA Sensible (Lights)	1,206	0	0	1,206	8.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	2,877	2,429	982	6,287	41.7	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-739	0	-739	-4.9	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	1,140	0	-	1,140	7.6	-
Time Delay Correction	0	-76	-	-76	-0.5	-
Sizing Factor Correction	744	-	-	744	4.9	-
Over/Undersizing	2	0	1	3	0.0	-
Grand Total	6,597	7,545	920	15,062	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	2,389	2,389	20.3	704
Other Roof	0	0	0	0.0	704
Glass	1,140	566	1,706	14.5	57
Door	0	0	0	0.0	0
Wall	0	3,093	3,093	26.2	1,046
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	1,046
Partition	0	128	128	1.1	1,426
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	-235	-235	-2.0	878
Slab	0	-8	-8	-0.1	469
Other Floor	0	0	0	0.0	878
Infiltration	694	0	694	5.9	1,046
Envelope Subtotal	1,835	5,932	7,767	65.8	-
People	621	883	1,504	12.7	1,267
Lights	1,050	1,546	2,596	22.0	1,267
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	0	0	0	0.0	1,267
Internal Subtotal	1,671	2,429	4,100	34.8	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	-739	-739	-6.3	671
Ceiling			0	0.0	1,267
Refrigeration			0	0.0	1,267
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-76	-76	-0.6	-
Time Delay Correction	744	-	744	6.3	-
Sizing Factor Correction	2	-	2	0.0	-
Over/Undersizing	4,251	7,545	11,796	100.0	

Temperatures °F	
Supply	55.0
Return	77.0
Mixed Air	77.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	568
Ventilation	0
Infiltration	30
Min Stop / Reheat	568

Engineering Checks	
% OA	.00
cfm/ft²	.42
Btu/h-ft²	11.90
cfm/ton	424.20
ft²/ton	1,009.11
People	6
ft²/person	200.10

Areas ft²	
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Corridor-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/10:00						
Outside Air (DB/WB/HR): 87.0 / 63.0 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,965	1,602	0	3,567	69.1	55.1
Door	0	0	0	0	0.0	0.0
Wall	0	194	0	194	3.8	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-139	0	-139	-2.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-36	0	-36	-0.7	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	68	0	-2	67	1.3	0.7
Envelope Subtotal	2,033	1,621	-02	3,653	70.8	-
People	0	0	0	0	0.0	0.0
Lights	0	261	0	261	5.1	3.0
RA Sensible (Lights)	829	0	0	829	16.1	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	829	261	0	1,090	21.1	-
Ventilation	307	0	-8	299	5.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-317	0	-317	-6.1	-0.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	351	0	-	351	6.8	-
Time Delay Correction	0	-84	-	-84	-1.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	119	0	50	168	3.3	-
Grand Total	3,638	1,482	40	5,160	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/09:00					
Outside Air (DB/WB/HR): 81.8 / 61.2 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	2,118	1,705	3,823	105.2	65
Door	0	0	0	0.0	0
Wall	0	174	174	4.8	100
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	100
Partition	0	-311	-311	-8.6	1,360
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	202	202	5.6	439
Other Floor	0	0	0	0.0	0
Infiltration	39	0	39	1.1	100
Envelope Subtotal	2,157	1,770	3,927	108.1	-
People	0	0	0	0.0	409
Lights	0	249	249	6.8	409
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	0	0	0	0.0	409
Internal Subtotal	0	249	249	6.8	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	-444	-444	-12.2	439
Ceiling			0	0.0	409
Refrigeration			0	0.0	409
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-98	-98	-2.7	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	0	0	0.0	-
Grand Total	2,157	1,477	3,634	100.0	

Temperatures °F	
Supply	55.0
Return	80.5
Mixed Air	81.4
Fan Heat TD	1.9

Airflows cfm	
Main Fan	175
Ventilation	25
Infiltration	6
Min Stop / Reheat	175

Engineering Checks	
% OA	14.02
cfm/ft²	.43
Btu/h-ft²	12.62
cfm/ton	407.10
ft²/ton	951.30
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

Corridor-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	2,632	1,668	0	4,300	67.5	66.5
Door	0	0	0	0	0.0	0.0
Wall	0	227	0	227	3.6	2.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-284	0	-284	-4.5	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	423	0	423	6.6	1.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	110	0	-2	109	1.7	1.1
Envelope Subtotal	2,742	2,033	-02	4,774	74.9	-
People	0	0	0	0	0.0	0.0
Lights	0	312	0	312	4.9	3.1
RA Sensible (Lights)	870	0	0	870	13.7	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	870	312	0	1,182	18.6	-
Ventilation	502	0	-7	495	7.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-378	0	-378	-5.9	-0.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	441	0	-	441	6.9	-
Time Delay Correction	0	-142	-	-142	-2.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	4,556	1,825	-9	6,372	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/17:00					
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	2,632	1,668	4,300	94.1	65
Door	0	0	0	0.0	0
Wall	0	227	227	5.0	101
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	101
Partition	0	-284	-284	-6.2	1,365
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	423	423	9.2	444
Other Floor	0	0	0	0.0	0
Infiltration	110	0	110	2.4	101
Envelope Subtotal	2,742	2,033	4,775	104.5	-
People	0	0	0	0.0	414
Lights	0	312	312	6.8	414
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	0	0	0	0.0	414
Internal Subtotal	0	312	312	6.8	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	-378	-378	-8.3	444
Ceiling			0	0.0	414
Refrigeration			0	0.0	414
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-142	-142	-3.1	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	0	0	0.0	-
Grand Total	2,743	1,825	4,568	100.0	

Temperatures °F	
Supply	55.0
Return	79.3
Mixed Air	81.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	220
Ventilation	25
Infiltration	5
Min Stop / Reheat	220

Engineering Checks	
% OA	11.29
cfm/ft²	.53
Btu/h-ft²	15.41
cfm/ton	414.40
ft²/ton	779.48
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Interior Floor	0
Slab	444
Other Floor	0

Corridor-W_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,013	326	0	1,339	36.9	20.7
Door	0	0	0	0	0.0	0.0
Wall	0	77	0	77	2.1	0.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	302	0	302	8.3	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-34	0	-34	-0.9	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	105	0	-1	103	2.9	1.0
Envelope Subtotal	1,118	671	-01	1,788	49.3	-
People	0	0	0	0	0.0	0.0
Lights	0	245	0	245	6.8	3.1
RA Sensible (Lights)	620	0	0	620	17.1	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	620	245	0	865	23.8	-
Ventilation	480	0	-5	475	13.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	84	0	84	2.3	0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	216	0	-	216	5.9	-
Time Delay Correction	0	-25	-	-25	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	140	0	86	226	6.2	-
Grand Total	2,574	976	79	3,629	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Time		Percent	
	Instant	Delay		Related
	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0
	0	0	0	0
	915	380	1,296	65
	0	0	0	0
	0	78	78	100
	0	0	0	0
	0	0	0	100
	0	331	331	1,108
	0	0	0	0
	0	0	0	0
	0	17	17	349
	0	0	0	0
	73	0	73	100
	988	806	1,794	80.3
	0	0	0	0.0
	0	245	245	11.0
	-	-	-	-
	0	0	0	0.0
	0	245	245	11.0
	-	-	-	-
	0	215	215	9.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-20	-20	-0.9
	0	-	0	0.0
	0	-	0	0.0
	988	1,246	2,234	100.0

Temperatures °F	
Supply	55.0
Return	82.3
Mixed Air	85.3
Fan Heat TD	1.9

Airflows cfm	
Main Fan	108
Ventilation	19
Infiltration	4
Min Stop / Reheat	108

Engineering Checks	
% OA	18.06
cfm/ft²	.33
Btu/h-ft²	11.21
cfm/ton	355.91
ft²/ton	1,071.28
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

RB-N-Corner_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/14:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	155	53	0	208	7.0	20.6
Door	0	0	0	0	0.0	0.0
Wall	0	663	0	663	22.3	2.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-111	0	-111	-3.7	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-28	0	-28	-0.9	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	78	0	-13	66	2.2	0.2
Envelope Subtotal	233	577	-13	798	26.8	-
People	151	205	359	714	24.0	5.5
Lights	0	45	0	45	1.5	1.4
RA Sensible (Lights)	112	0	0	112	3.8	0.0
Miscellaneous Loads	356	433	0	789	26.5	6.1
Internal Subtotal	618	683	359	1,660	55.8	-
Ventilation	354	0	-57	298	10.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-39	0	-39	-1.3	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	193	0	-	193	6.5	-
Time Delay Correction	0	-12	-	-12	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	51	0	24	75	2.5	-
Grand Total	1,450	1,209	314	2,973	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/12:00			
Outside Air (DB/WB/HR):		94.8 / 65.5 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	of	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	132	47	179	8.9	10
	0	0	0	0.0	0
	0	866	866	43.3	288
	0	0	0	0.0	0
	0	0	0	0.0	288
	0	-102	-102	-5.1	288
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-19	-19	-1.0	142
	0	0	0	0.0	0
	65	0	65	3.3	288
	198	791	989	49.4	-
	151	183	334	16.7	130
	0	42	42	2.1	130
	-	-	-	-	-
	356	405	761	38.0	130
	507	630	1,137	56.8	-
	-	-	-	-	-
	0	-113	-113	-5.7	142
			0	0.0	130
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-13	-13	-0.6	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	705	1,295	2,000	100.0	

Temperatures °F	
Supply	55.0
Return	76.4
Mixed Air	79.7
Fan Heat TD	1.9

Airflows cfm	
Main Fan	96
Ventilation	14
Infiltration	3
Min Stop / Reheat	96

Engineering Checks	
% OA	14.88
cfm/ft²	.74
Btu/h-ft²	22.82
cfm/ton	388.91
ft²/ton	526.32
People	1
ft²/person	100.31

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-N-East_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	9	0	9	0.2	3.5
Other Roof	0	0	0	0	0.0	0.0
Glass	664	432	0	1,096	17.6	54.2
Door	0	0	0	0	0.0	0.0
Wall	0	1,652	0	1,652	26.6	4.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-277	0	-277	-4.5	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-67	0	-67	-1.1	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	152	0	-70	82	1.3	0.2
Envelope Subtotal	815	1,749	-70	2,495	40.1	-
People	297	404	707	1,408	22.6	5.5
Lights	0	88	0	88	1.4	1.4
RA Sensible (Lights)	227	0	0	227	3.6	0.0
Miscellaneous Loads	702	847	0	1,549	24.9	6.0
Internal Subtotal	1,225	1,339	707	3,271	52.6	-
Ventilation	687	0	-317	369	5.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-315	0	-315	-5.1	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	439	0	-	439	7.1	-
Time Delay Correction	0	-46	-	-46	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	2	0	1	2	0.0	-
Grand Total	3,168	2,728	320	6,215	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/14:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time	Percent		Related	
	Instant	Delay	Total	of	Area
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	9	9	0.2	3
	0	0	0	0.0	3
	664	432	1,096	24.1	20
	0	0	0	0.0	0
	0	1,652	1,652	36.4	412
	0	0	0	0.0	0
	0	0	0	0.0	412
	0	-277	-277	-6.1	733
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-67	-67	-1.5	280
	0	0	0	0.0	0
	152	0	152	3.3	412
	815	1,749	2,565	56.5	-
	297	404	701	15.4	257
	0	88	88	1.9	257
	-	-	-	-	-
	702	847	1,549	34.1	257
	998	1,339	2,338	51.5	-
	-	-	-	-	-
	0	-315	-315	-6.9	278
			0	0.0	257
			0	0.0	257
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-46	-46	-1.0	-
	0	-	0	0.0	-
	2	-	2	0.0	-
	1,815	2,728	4,543	100.0	

Temperatures °F	
Supply	55.0
Return	76.1
Mixed Air	79.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	219
Ventilation	28
Infiltration	6
Min Stop / Reheat	219

Engineering Checks	
% OA	12.92
cfm/ft²	.85
Btu/h-ft²	24.20
cfm/ton	422.54
ft²/ton	496.21
People	3
ft²/person	100.01

Areas ft²	
Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

RB-N-West_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	450	158	0	608	8.2	20.0
Door	0	0	0	0	0.0	0.0
Wall	0	717	0	717	9.7	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-248	0	-248	-3.3	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-98	0	-98	-1.3	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	229	0	-44	186	2.5	0.5
Envelope Subtotal	679	528	-44	1,164	15.7	-
People	442	625	1,052	2,119	28.5	5.5
Lights	0	135	0	135	1.8	1.4
RA Sensible (Lights)	316	0	0	316	4.3	0.0
Miscellaneous Loads	1,044	1,297	0	2,342	31.5	6.1
Internal Subtotal	1,802	2,058	1,052	4,912	66.2	-
Ventilation	1,039	0	-199	840	11.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	45	0	45	0.6	0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	462	0	-	462	6.2	-
Time Delay Correction	0	-33	-	-33	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	22	0	12	34	0.5	-
Grand Total	4,005	2,597	821	7,423	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/17:00			
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0			
	Time		Percent		Related Area
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	381	162	542	11.3	30
	0	0	0	0.0	0
	0	694	694	14.5	374
	0	0	0	0.0	0
	0	0	0	0.0	374
	0	-275	-275	-5.7	1,338
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-101	-101	-2.1	417
	0	0	0	0.0	0
	189	0	189	4.0	374
	570	480	1,050	21.9	-
	442	675	1,117	23.3	383
	0	135	135	2.8	383
	-	-	-	-	-
	1,044	1,297	2,342	48.9	383
	1,486	2,108	3,594	75.1	-
	-	-	-	-	-
	0	170	170	3.6	417
			0	0.0	383
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-32	-32	-0.7	-
	0	-	0	0.0	-
	2	-	2	0.0	-
	2,058	2,726	4,784	100.0	

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	80.7
Fan Heat TD	1.9

Airflows cfm	
Main Fan	230
Ventilation	42
Infiltration	9
Min Stop / Reheat	230

Engineering Checks	
% OA	18.26
cfm/ft²	.60
Btu/h-ft²	19.42
cfm/ton	372.59
ft²/ton	618.38
People	4
ft²/person	99.88

Areas ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

RB-S-Corner-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 9/21/16:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	204	170	0	374	11.0	37.0
Door	0	0	0	0	0.0	0.0
Wall	0	1,390	0	1,390	40.8	4.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-167	0	-167	-4.9	-0.6
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-87	0	-87	-2.5	-0.6
Other Floor	0	0	0	0	0.0	0.0
Infiltration	70	0	-34	36	1.1	0.1
Envelope Subtotal	274	1,306	-34	1,546	45.3	-
People	149	226	355	730	21.4	5.7
Lights	0	47	0	47	1.4	1.4
RA Sensible (Lights)	116	0	0	116	3.4	0.0
Miscellaneous Loads	352	450	0	802	23.5	6.2
Internal Subtotal	617	722	355	1,694	49.7	-
Ventilation	317	0	-155	162	4.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-221	0	-221	-6.5	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	248	0	-	248	7.3	-
Time Delay Correction	0	-19	-	-19	-0.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,457	1,788	166	3,411	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 9/21/16:00				
Outside Air (DB/WB/HR): 96.5 / 63.6 / 0.0				
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	204	170	374	14.6
	0	0	0	0.0
	0	1,390	1,390	54.2
	0	0	0	0.0
	0	0	0	0.0
	0	-167	-167	-6.5
	0	0	0	0.0
	0	0	0	0.0
	0	-87	-87	-3.4
	0	0	0	0.0
	70	0	70	2.7
	274	1,306	1,580	61.6
	149	226	375	14.6
	0	47	47	1.8
	-	-	-	-
	352	450	802	31.3
	501	722	1,223	47.7
	-	-	-	-
	0	-221	-221	-8.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-19	-19	-0.8
	0	-	0	0.0
	1	-	1	0.0
	776	1,788	2,565	100.0

Temperatures °F	
Supply	55.0
Return	76.0
Mixed Air	78.4
Fan Heat TD	1.9

Airflows cfm	
Main Fan	124
Ventilation	14
Infiltration	3
Min Stop / Reheat	124

Engineering Checks	
% OA	11.49
cfm/ft²	.96
Btu/h-ft²	26.45
cfm/ton	434.64
ft²/ton	453.97
People	1
ft²/person	100.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

RB-S-Corner-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/18:00						
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0						
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	131	61	0	192	5.9	19.0
Door	0	0	0	0	0.0	0.0
Wall	0	1,201	0	1,201	36.7	4.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-146	0	-146	-4.5	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-30	0	-30	-0.9	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	55	0	-11	44	1.3	0.2
Envelope Subtotal	186	1,087	-11	1,262	38.6	-
People	152	238	361	750	23.0	5.7
Lights	0	46	0	46	1.4	1.4
RA Sensible (Lights)	116	0	0	116	3.5	0.0
Miscellaneous Loads	358	442	0	800	24.5	6.1
Internal Subtotal	626	726	361	1,713	52.4	-
Ventilation	246	0	-50	196	6.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-117	0	-117	-3.6	-0.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	230	0	-	230	7.0	-
Time Delay Correction	0	-16	-	-16	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,288	1,680	301	3,269	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	131	61	192	8.1	10
	0	0	0	0.0	0
	0	1,201	1,201	50.5	289
	0	0	0	0.0	0
	0	0	0	0.0	289
	0	-146	-146	-6.1	289
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-30	-30	-1.3	143
	0	0	0	0.0	0
	55	0	55	2.3	289
	186	1,087	1,273	53.6	-
	152	238	389	16.4	131
	0	46	46	1.9	131
	-	-	-	-	-
	358	442	800	33.7	131
	510	726	1,236	52.0	-
	-	-	-	-	-
	0	-117	-117	-4.9	143
			0	0.0	131
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-16	-16	-0.7	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	697	1,680	2,377	100.0	

Temperatures °F	
Supply	55.0
Return	76.1
Mixed Air	78.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	115
Ventilation	14
Infiltration	3
Min Stop / Reheat	115

Engineering Checks	
% OA	12.61
cfm/ft²	.87
Btu/h-ft²	24.93
cfm/ton	420.34
ft²/ton	481.75
People	1
ft²/person	100.20

Areas ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

RB-S-East_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	997	628	0	1,625	19.8	53.6
Door	0	0	0	0	0.0	0.0
Wall	0	1,599	0	1,599	19.5	4.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-409	0	-409	-5.0	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-112	0	-112	-1.4	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	219	0	-104	115	1.4	0.4
Envelope Subtotal	1,217	1,706	-104	2,819	34.3	-
People	430	604	1,023	2,056	25.0	5.5
Lights	0	133	0	133	1.6	1.4
RA Sensible (Lights)	323	0	0	323	3.9	0.0
Miscellaneous Loads	1,015	1,280	0	2,295	27.9	6.2
Internal Subtotal	1,767	2,018	1,023	4,808	58.5	-
Ventilation	994	0	-475	519	6.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-427	0	-427	-5.2	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	569	0	-	569	6.9	-
Time Delay Correction	0	-69	-	-69	-0.8	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	2	0	1	3	0.0	-
Grand Total	4,549	3,229	445	8,222	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/14:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time		Percent		Related Area
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
	0	0	0	0.0	0
	0	0	0	0.0	0
	997	628	1,625	27.6	30
	0	0	0	0.0	0
	0	1,599	1,599	27.1	328
	0	0	0	0.0	0
	0	0	0	0.0	328
	0	-409	-409	-6.9	1,359
	0	0	0	0.0	0
	0	-112	-112	-1.9	406
	0	0	0	0.0	0
	219	0	219	3.7	328
	1,217	1,706	2,923	49.6	-
	430	604	1,034	17.5	372
	0	133	133	2.3	372
	-	-	-	-	-
	1,015	1,280	2,295	39.0	372
	1,445	2,018	3,462	58.8	-
	-	-	-	-	-
	0	-427	-427	-7.2	406
			0	0.0	372
			0	0.0	372
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-69	-69	-1.2	-
	0	-	0	0.0	-
	2		2	0.0	-
	2,663	3,229	5,892	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	79.5
Fan Heat TD	1.9

Airflows cfm	
Main Fan	284
Ventilation	41
Infiltration	9
Min Stop / Reheat	284

Engineering Checks	
% OA	14.41
cfm/ft²	.76
Btu/h-ft²	22.12
cfm/ton	414.27
ft²/ton	542.74
People	4
ft²/person	99.97

Areas ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

RB-S-West_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	154	51	0	206	8.1	20.4
Door	0	0	0	0	0.0	0.0
Wall	0	232	0	232	9.2	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-63	0	-63	-2.5	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-33	0	-33	-1.3	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	74	0	-14	60	2.4	0.5
Envelope Subtotal	229	188	-14	402	15.9	-
People	143	203	341	687	27.2	5.5
Lights	0	44	0	44	1.7	1.4
RA Sensible (Lights)	103	0	0	103	4.1	0.0
Miscellaneous Loads	338	422	0	761	30.1	6.1
Internal Subtotal	584	669	341	1,594	63.1	-
Ventilation	337	0	-65	272	10.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-8	0	-8	-0.3	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	157	0	-	157	6.2	-
Time Delay Correction	0	-11	-	-11	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	79	0	43	122	4.8	-
Grand Total	1,385	838	305	2,528	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	138	61	199	12.3
	0	0	0	0.0
	0	232	232	14.3
	0	0	0	0.0
	0	0	0	0.0
	0	-29	-29	-1.8
	0	0	0	0.0
	0	0	0	0.0
	0	-29	-29	-1.8
	0	0	0	0.0
	52	0	52	3.2
	190	235	425	26.2
	143	227	370	22.8
	0	44	44	2.7
	-	-	-	-
	338	422	761	46.8
	482	693	1,175	72.2
	-	-	-	-
	0	36	36	2.2
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-11	-11	-0.7
	0	-	0	0.0
	1	-	1	0.0
	672	954	1,627	100.0

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	80.5
Fan Heat TD	1.9

Airflows cfm	
Main Fan	78
Ventilation	14
Infiltration	3
Min Stop / Reheat	78

Engineering Checks	
% OA	17.40
cfm/ft²	.63
Btu/h-ft²	20.41
cfm/ton	371.94
ft²/ton	588.45
People	1
ft²/person	99.98

Areas ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

RB-W-North_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/10:00						
Outside Air (DB/WB/HR): 87.0 / 63.0 / 0.0						
	Time		Percent			
	Instant	Delay	Latent	Total	of	Btu/h
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	540	461	0	1,000	31.4	56.3
Door	0	0	0	0	0.0	0.0
Wall	0	698	0	698	21.9	2.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-176	0	-176	-5.5	-0.6
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-33	0	-33	-1.0	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	40	0	-11	29	0.9	0.1
Envelope Subtotal	580	950	-11	1,519	47.7	-
People	150	158	357	665	20.9	5.1
Lights	0	38	0	38	1.2	1.3
RA Sensible (Lights)	115	0	0	115	3.6	0.0
Miscellaneous Loads	354	369	0	723	22.7	5.6
Internal Subtotal	619	565	357	1,541	48.4	-
Ventilation	178	0	-50	129	4.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-201	0	-201	-6.3	-1.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	229	0	-	229	7.2	-
Time Delay Correction	0	-32	-	-32	-1.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,607	1,281	297	3,185	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/10:00	
Outside Air (DB/WB/HR):			87.0 / 63.0 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
540	461	1,000	42.3	18
0	0	0	0.0	0
0	698	698	29.5	288
0	0	0	0.0	0
0	0	0	0.0	288
0	-176	-176	-7.4	288
0	0	0	0.0	0
0	0	0	0.0	0
0	-33	-33	-1.4	142
0	0	0	0.0	0
40	0	40	1.7	288
580	950	1,530	64.6	-
150	158	308	13.0	130
0	38	38	1.6	130
-	-	-	-	-
354	369	723	30.5	130
504	565	1,069	45.2	-
-	-	-	-	-
		0	0.0	0
0	-201	-201	-8.5	142
		0	0.0	130
		0	0.0	130
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-32	-32	-1.4	-
0	-	0	0.0	-
1	-	1	0.0	-
1,085	1,281	2,366	100.0	

Temperatures °F	
Supply	55.0
Return	76.1
Mixed Air	77.5
Fan Heat TD	1.9

Airflows cfm	
Main Fan	114
Ventilation	14
Infiltration	3
Min Stop / Reheat	114

Engineering Checks	
% OA	12.52
cfm/ft²	.88
Btu/h-ft²	24.56
cfm/ton	429.48
ft²/ton	488.89
People	1
ft²/person	99.82

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-W-South_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	2,140	1,519	0	3,659	32.6	68.7
Door	0	0	0	0	0.0	0.0
Wall	0	2,194	0	2,194	19.6	4.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-641	0	-641	-5.7	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	150	0	150	1.3	0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	188	0	-26	161	1.4	0.3
Envelope Subtotal	2,328	3,221	-26	5,523	49.3	-
People	438	678	1,044	2,160	19.3	5.7
Lights	0	135	0	135	1.2	1.4
RA Sensible (Lights)	344	0	0	344	3.1	0.0
Miscellaneous Loads	1,036	1,299	0	2,335	20.8	6.2
Internal Subtotal	1,818	2,113	1,044	4,975	44.4	-
Ventilation	844	0	-122	722	6.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-680	0	-680	-6.1	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	804	0	-	804	7.2	-
Time Delay Correction	0	-137	-	-137	-1.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	3	0	1	4	0.0	-
Grand Total	5,797	4,516	896	11,209	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Time		Percent	
	Instant	Delay		Related
	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	2,140	1,519	3,659	44.0
	0	0	0	0.0
	0	2,194	2,194	26.4
	0	0	0	0.0
	0	0	0	0.0
	0	-641	-641	-7.7
	0	0	0	0.0
	0	0	0	0.0
	0	150	150	1.8
	0	0	0	0.0
	188	0	188	2.3
	2,328	3,221	5,549	66.7
	438	678	1,116	13.4
	0	135	135	1.6
	-	-	-	-
	1,036	1,299	2,335	28.1
	1,474	2,113	3,587	43.1
	-	-	-	-
	0	-680	-680	-8.2
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-137	-137	-1.7
	0	-	0	0.0
	3	-	3	0.0
	3,805	4,516	8,321	100.0

Temperatures °F	
Supply	55.0
Return	75.9
Mixed Air	77.9
Fan Heat TD	1.9

Airflows cfm	
Main Fan	401
Ventilation	42
Infiltration	9
Min Stop / Reheat	401

Engineering Checks	
% OA	10.42
cfm/ft²	1.06
Btu/h-ft²	29.56
cfm/ton	429.15
ft²/ton	406.28
People	4
ft²/person	99.87

Areas ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

SHWR-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	7	0	7	0.2	3.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	1,050	0	1,050	29.0	5.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-120	0	-120	-3.3	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-48	0	-48	-1.3	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	120	0	-63	57	1.6	0.3
Envelope Subtotal	120	889	-63	946	26.1	-
People	399	747	631	1,777	49.1	8.7
Lights	184	357	0	541	14.9	3.7
RA Sensible (Lights)	211	0	0	211	5.8	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	794	1,103	631	2,529	69.9	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-96	0	-96	-2.6	-0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	250	0	-	250	6.9	-
Time Delay Correction	0	-11	-	-11	-0.3	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,165	1,886	568	3,619	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/14:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time		Percent		Related Area
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	7	7	0.3	2
	0	0	0	0.0	2
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	1,050	1,050	40.6	202
	0	0	0	0.0	0
	0	0	0	0.0	202
	0	-120	-120	-4.6	844
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-48	-48	-1.9	225
	0	0	0	0.0	0
	120	0	120	4.6	202
	120	889	1,009	39.0	-
	399	747	1,146	44.2	204
	184	357	541	20.9	204
	-	-	-	-	-
	0	0	0	0.0	204
	583	1,103	1,686	65.1	-
	-	-	-	-	-
	0	-96	-96	-3.7	223
			0	0.0	204
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-11	-11	-0.4	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	704	1,886	2,590	100.0	

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	76.6
Fan Heat TD	1.9

Airflows cfm	
Main Fan	125
Ventilation	0
Infiltration	5
Min Stop / Reheat	125

Engineering Checks	
% OA	.00
cfm/ft²	.61
Btu/h-ft²	17.79
cfm/ton	413.65
ft²/ton	675.15
People	4
ft²/person	50.03

Areas ft²	
Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

SHWR-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/18:00						
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	432	0	432	12.9	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-22	0	-22	-0.7	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-55	0	-55	-1.6	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	87	0	-30	57	1.7	0.3
Envelope Subtotal	87	355	-30	412	12.3	-
People	406	783	642	1,831	54.6	8.8
Lights	187	374	0	561	16.7	3.7
RA Sensible (Lights)	215	0	0	215	6.4	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	808	1,157	642	2,607	77.8	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	117	0	117	3.5	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	222	0	-	222	6.6	-
Time Delay Correction	0	-6	-	-6	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,118	1,622	613	3,353	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	432	432	18.8	206
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	206
Partition	0	-22	-22	-1.0	845
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-55	-55	-2.4	229
Other Floor	0	0	0	0.0	0
Infiltration	87	0	87	3.8	206
Envelope Subtotal	87	355	441	19.2	-
People	406	783	1,189	51.6	207
Lights	187	374	561	24.4	207
-	-	-	-	-	-
0	0	0	0	0.0	207
593	1,157	1,750	76.0	-	-
-	-	-	-	-	-
0	117	117	5.1	229	
		0	0.0	207	
		0	0.0	0	
0	0	0	0.0	0	
-	-	-	-	-	-
0	-6	-6	-0.3	-	
0	-	0	0.0	-	
1	-	1	0.0	-	
Grand Total	681	1,622	2,303	100.0	

Temperatures °F	
Supply	55.0
Return	76.9
Mixed Air	76.9
Fan Heat TD	1.9

Airflows cfm	
Main Fan	111
Ventilation	0
Infiltration	5
Min Stop / Reheat	111

Engineering Checks	
% OA	.00
cfm/ft²	.54
Btu/h-ft²	16.19
cfm/ton	397.02
ft²/ton	741.50
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

SHWR-W_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/11:00						
Outside Air (DB/WB/HR): 91.7 / 64.5 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	1,030	0	1,030	28.2	5.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-54	0	-54	-1.5	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-34	0	-34	-0.9	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	88	0	-27	61	1.7	0.3
Envelope Subtotal	88	943	-27	1,004	27.5	-
People	406	689	642	1,737	47.5	8.4
Lights	187	329	0	516	14.1	3.5
RA Sensible (Lights)	215	0	0	215	5.9	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	807	1,018	642	2,468	67.5	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-53	0	-53	-1.5	-0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	249	0	-	249	6.8	-
Time Delay Correction	0	-11	-	-11	-0.3	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	2	0.0	-
Grand Total	1,146	1,897	616	3,658	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/11:00					
Outside Air (DB/WB/HR): 91.7 / 64.5 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	1,030	1,030	40.0	204
	0	0	0	0.0	0
	0	0	0	0.0	204
	0	-54	-54	-2.1	849
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-34	-34	-1.3	229
	0	0	0	0.0	0
	88	0	88	3.4	204
	88	943	1,031	40.0	-
	406	689	1,095	42.5	207
	187	329	516	20.0	207
	-	-	-	-	-
	0	0	0	0.0	207
	593	1,018	1,611	62.5	-
	-	-	-	-	-
	0	-53	-53	-2.1	229
			0	0.0	207
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-11	-11	-0.4	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	682	1,897	2,579	100.0	

Temperatures °F	
Supply	55.0
Return	76.7
Mixed Air	76.7
Fan Heat TD	1.9

Airflows cfm	
Main Fan	124
Ventilation	0
Infiltration	5
Min Stop / Reheat	124

Engineering Checks	
% OA	.00
cfm/ft²	.60
Btu/h-ft²	17.68
cfm/ton	407.53
ft²/ton	679.22
People	4
ft²/person	50.02

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ACT-Noisy-1_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	229	64	0	293	6.9	18.9
Door	0	371	0	371	8.8	17.7
Wall	0	276	0	276	6.5	1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-203	0	-203	-4.8	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-55	0	-55	-1.3	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	108	0	-28	80	1.9	0.5
Envelope Subtotal	337	453	-28	762	18.0	-
People	377	613	719	1,709	40.4	9.5
Lights	121	221	0	342	8.1	2.7
RA Sensible (Lights)	92	0	0	92	2.2	0.0
Miscellaneous Loads	184	144	0	328	7.8	1.8
Internal Subtotal	774	978	719	2,471	58.4	-
Ventilation	932	0	-244	688	16.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-72	0	-72	-1.7	-0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	237	0	-	237	5.6	-
Time Delay Correction	0	-25	-	-25	-0.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	97	0	72	169	4.0	-
Grand Total	2,377	1,334	519	4,229	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	207	79	286	11.7
	0	386	386	15.8
	0	277	277	11.3
	0	0	0	0.0
	0	0	0	0.0
	0	-175	-175	-7.1
	0	0	0	0.0
	0	0	0	0.0
	0	-44	-44	-1.8
	0	0	0	0.0
	75	0	75	3.1
	282	523	806	32.9
	377	613	990	40.4
	121	221	342	13.9
	-	-	-	-
	184	144	328	13.4
	682	978	1,660	67.8
	-	-	-	-
	0	10	10	0.4
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-25	-25	-1.0
	0	-	0	0.0
	-1	-	-1	-0.1
	963	1,486	2,449	100.0

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	83.4
Fan Heat TD	1.9

Airflows cfm	
Main Fan	118
Ventilation	38
Infiltration	4
Min Stop / Reheat	118

Engineering Checks	
% OA	31.95
cfm/ft²	.66
Btu/h-ft²	23.56
cfm/ton	335.13
ft²/ton	509.73
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ACT-Noisy-2_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	375	0	375	8.8	17.9
Wall	0	163	0	163	3.8	1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-181	0	-181	-4.3	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-56	0	-56	-1.3	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	108	0	-30	78	1.8	0.9
Envelope Subtotal	108	301	-30	380	8.9	-
People	380	636	723	1,739	40.9	9.6
Lights	122	229	0	351	8.3	2.7
RA Sensible (Lights)	89	0	0	89	2.1	0.0
Miscellaneous Loads	185	150	0	335	7.9	1.9
Internal Subtotal	776	1,015	723	2,514	59.2	-
Ventilation	939	0	-260	678	16.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	95	0	95	2.2	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	232	0	-	232	5.5	-
Time Delay Correction	0	-14	-	-14	-0.3	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	204	0	158	362	8.5	-
Grand Total	2,259	1,398	591	4,247	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/09:00			
Outside Air (DB/WB/HR):		81.8 / 61.2 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	of	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	978	978	40.8	21
	0	335	335	14.0	92
	0	0	0	0.0	0
	0	0	0	0.0	92
	0	-279	-279	-11.6	578
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-23	-23	-1.0	195
	0	0	0	0.0	0
	32	0	32	1.3	92
	32	1,011	1,043	43.5	-
	380	509	889	37.1	181
	122	184	305	12.7	181
	-	-	-	-	-
	185	120	305	12.7	181
	687	813	1,499	62.6	-
	-	-	-	-	-
	0	-92	-92	-3.9	195
			0	0.0	181
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-52	-52	-2.2	-
	0	-	0	0.0	-
	-1	-	-1	0.0	-
	717	1,680	2,397	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	83.7
Fan Heat TD	1.9

Airflows cfm	
Main Fan	116
Ventilation	38
Infiltration	5
Min Stop / Reheat	116

Engineering Checks	
% OA	32.86
cfm/ft²	.64
Btu/h-ft²	23.50
cfm/ton	326.61
ft²/ton	510.96
People	4
ft²/person	49.96

Areas ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ACT-Noisy-3_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	118	28	0	146	3.6	18.8
Door	0	381	0	381	9.4	18.1
Wall	0	290	0	290	7.2	1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-205	0	-205	-5.1	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-43	0	-43	-1.1	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	109	0	-29	80	2.0	0.5
Envelope Subtotal	227	451	-29	649	16.1	-
People	382	587	729	1,698	42.0	9.3
Lights	122	211	0	334	8.3	2.6
RA Sensible (Lights)	93	0	0	93	2.3	0.0
Miscellaneous Loads	186	138	0	324	8.0	1.8
Internal Subtotal	784	936	729	2,449	60.5	-
Ventilation	945	0	-251	694	17.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	50	0	50	1.2	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	226	0	-	226	5.6	-
Time Delay Correction	0	-20	-	-20	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	-1	-3	-0.1	-
Grand Total	2,181	1,417	448	4,046	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/15:00			
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	of	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	118	28	146	6.3	8
	0	381	381	16.3	21
	0	290	290	12.4	161
	0	0	0	0.0	0
	0	0	0	0.0	161
	0	-205	-205	-8.8	511
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-43	-43	-1.8	196
	0	0	0	0.0	0
	109	0	109	4.7	161
	227	451	678	29.1	-
	382	587	969	41.5	182
	122	211	334	14.3	182
	-	-	-	-	-
	186	138	324	13.9	182
	691	936	1,628	69.7	-
	-	-	-	-	-
	0	50	50	2.1	196
			0	0.0	182
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-20	-20	-0.9	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	917	1,417	2,334	100.0	

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	83.9
Fan Heat TD	1.9

Airflows cfm	
Main Fan	113
Ventilation	38
Infiltration	4
Min Stop / Reheat	113

Engineering Checks	
% OA	33.98
cfm/ft²	.62
Btu/h-ft²	22.23
cfm/ton	333.94
ft²/ton	540.17
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ACT-Quiet-1_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-36	0	-36	-1.4	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-42	0	-42	-1.6	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	78	0	-26	52	2.1	0.0
Envelope Subtotal	78	-78	-26	-26	-1.0	-
People	274	476	521	1,272	49.9	9.8
Lights	88	172	0	260	10.2	2.8
RA Sensible (Lights)	57	0	0	57	2.2	0.0
Miscellaneous Loads	133	112	0	246	9.6	1.9
Internal Subtotal	551	761	521	1,833	72.0	-
Ventilation	676	0	-227	449	17.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	56	0	56	2.2	0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	132	0	-	132	5.2	-
Time Delay Correction	0	-4	-	-4	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	56	0	50	106	4.2	-
Grand Total	1,494	734	318	2,546	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-11	-11	-0.8	575
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-41	-41	-3.0	142
	0	0	0	0.0	0
	55	0	55	4.0	0
	55	-51	3	0.2	-
	274	476	750	55.0	130
	88	172	260	19.0	130
	-	-	-	-	-
	133	112	246	18.0	130
	495	761	1,255	92.1	-
	-	-	-	-	-
	0	110	110	8.1	142
			0	0.0	130
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.3	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	548	815	1,363	100.0	

Temperatures °F	
Supply	55.0
Return	76.5
Mixed Air	85.8
Fan Heat TD	1.9

Airflows cfm	
Main Fan	66
Ventilation	27
Infiltration	3
Min Stop / Reheat	66

Engineering Checks	
% OA	41.64
cfm/ft²	.50
Btu/h-ft²	19.55
cfm/ton	309.85
ft²/ton	614.22
People	3
ft²/person	49.94

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-2_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	324	219	0	543	17.8	69.8
Door	0	0	0	0	0.0	0.0
Wall	0	228	0	228	7.5	4.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-126	0	-126	-4.1	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-6	0	-6	-0.2	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	65	0	-19	46	1.5	1.0
Envelope Subtotal	388	315	-19	685	22.4	-
People	274	484	523	1,281	42.0	9.8
Lights	88	174	0	262	8.6	2.8
RA Sensible (Lights)	71	0	0	71	2.3	0.0
Miscellaneous Loads	134	114	0	248	8.1	1.9
Internal Subtotal	567	773	523	1,862	61.0	-
Ventilation	555	0	-163	392	12.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-44	0	-44	-1.5	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	184	0	-	184	6.0	-
Time Delay Correction	0	-24	-	-24	-0.8	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	-1	-2	-0.1	-
Grand Total	1,692	1,019	340	3,051	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/17:00					
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	324	219	543	28.5	8
Door	0	0	0	0.0	0
Wall	0	228	228	12.0	48
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	48
Partition	0	-126	-126	-6.6	528
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-6	-6	-0.3	142
Other Floor	0	0	0	0.0	0
Infiltration	65	0	65	3.4	48
Envelope Subtotal	388	315	703	37.0	-
People	274	484	759	39.9	131
Lights	88	174	262	13.8	131
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	134	114	248	13.0	131
Internal Subtotal	496	773	1,269	66.7	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	-44	-44	-2.3	142
Ceiling			0	0.0	131
Refrigeration			0	0.0	0
Service Water	0	0	0	0.0	0
HVAC Equipment Losses	-	-	-	-	-
Adj Air Transfer Heat	0	-24	-24	-1.3	-
Supply Fan Heat	0	-	0	0.0	-
Time Delay Correction	-1	-	-1	-0.1	-
Grand Total	883	1,019	1,902	100.0	

Temperatures °F	
Supply	55.0
Return	76.0
Mixed Air	81.6
Fan Heat TD	1.9

Airflows cfm	
Main Fan	92
Ventilation	27
Infiltration	3
Min Stop / Reheat	92

Engineering Checks	
% OA	29.91
cfm/ft²	.70
Btu/h-ft²	23.37
cfm/ton	360.75
ft²/ton	513.78
People	3
ft²/person	50.05

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-3_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	263	0	263	9.7	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-96	0	-96	-3.5	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-40	0	-40	-1.5	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	79	0	-23	56	2.1	0.4
Envelope Subtotal	79	127	-23	183	6.8	-
People	275	477	524	1,276	47.2	9.7
Lights	88	172	0	260	9.6	2.8
RA Sensible (Lights)	63	0	0	63	2.3	0.0
Miscellaneous Loads	134	112	0	246	9.1	1.9
Internal Subtotal	560	761	524	1,845	68.2	-
Ventilation	680	0	-202	478	17.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	34	0	34	1.3	0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	146	0	-	146	5.4	-
Time Delay Correction	0	-5	-	-5	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	13	0	11	24	0.9	-
Grand Total	1,479	917	310	2,706	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/16:00					
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0					
	Time		Percent		Related Area
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	261	261	17.3	128
	0	0	0	0.0	0
	0	0	0	0.0	128
	0	-96	-96	-6.4	449
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-39	-39	-2.6	143
	0	0	0	0.0	0
	73	0	73	4.8	128
	73	126	198	13.2	-
	275	477	752	49.9	131
	88	172	260	17.3	131
	-	-	-	-	-
	134	112	246	16.3	131
	498	761	1,258	83.5	-
	-	-	-	-	-
	0	56	56	3.7	143
			0	0.0	131
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-5	-5	-0.3	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	570	937	1,507	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	84.8
Fan Heat TD	1.9

Airflows cfm	
Main Fan	73
Ventilation	28
Infiltration	3
Min Stop / Reheat	73

Engineering Checks	
% OA	37.89
cfm/ft²	.55
Btu/h-ft²	20.65
cfm/ton	322.31
ft²/ton	581.42
People	3
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Admin_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/17:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	599	0	599	11.7	2.9
Other Roof	0	0	0	0	0.0	0.0
Glass	629	506	0	1,135	22.1	73.0
Door	0	0	0	0	0.0	0.0
Wall	0	1,204	0	1,204	23.5	5.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-238	0	-238	-4.6	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	13	0	13	0.3	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	94	0	-11	83	1.6	0.4
Envelope Subtotal	722	2,085	-11	2,796	54.5	-
People	199	271	379	849	16.5	4.5
Lights	194	297	0	491	9.6	3.8
RA Sensible (Lights)	197	0	0	197	3.8	0.0
Miscellaneous Loads	97	0	0	97	1.9	0.5
Internal Subtotal	687	569	379	1,634	31.9	-
Ventilation	421	0	-49	372	7.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	369	0	-	369	7.2	-
Time Delay Correction	0	-42	-	-42	-0.8	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	2,199	2,612	319	5,130	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/17:00			
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
Roof	0	599	599	15.7	210
Other Roof	0	0	0	0.0	210
Glass	629	506	1,135	29.7	16
Door	0	0	0	0.0	0
Wall	0	1,204	1,204	31.5	215
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	215
Partition	0	-238	-238	-6.2	776
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	13	13	0.4	210
Other Floor	0	0	0	0.0	0
Infiltration	94	0	94	2.4	215
Envelope Subtotal	722	2,085	2,807	73.4	-
People	199	271	470	12.3	189
Lights	194	297	491	12.8	189
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	97	0	97	2.5	189
Internal Subtotal	489	569	1,058	27.7	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	0	0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration	0	0	0	0.0	189
Service Water	0	0	0	0.0	189
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-42	-42	-1.1	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	0	0	0.0	-
Grand Total	1,212	2,612	3,823	100.0	

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	78.2
Fan Heat TD	1.9

Airflows cfm	
Main Fan	184
Ventilation	21
Infiltration	5
Min Stop / Reheat	184

Engineering Checks	
% OA	11.31
cfm/ft²	.97
Btu/h-ft²	27.11
cfm/ton	430.92
ft²/ton	442.89
People	2
ft²/person	100.19

Areas ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Chart/Hotel_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	83	0	83	2.8	4.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	104	0	104	3.6	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-20	0	-20	-0.7	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	120	0	-27	93	3.2	0.0
Envelope Subtotal	120	166	-27	259	8.9	-
People	210	294	399	902	31.0	4.5
Lights	204	322	0	526	18.1	3.8
RA Sensible (Lights)	162	0	0	162	5.6	0.0
Miscellaneous Loads	102	0	0	102	3.5	0.5
Internal Subtotal	678	616	399	1,693	58.2	-
Ventilation	542	0	-124	419	14.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	55	0	55	1.9	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	160	0	-	160	5.5	-
Time Delay Correction	0	-4	-	-4	-0.1	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	187	0	141	329	11.3	-
Grand Total	1,687	833	390	2,910	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/19:00					
Outside Air (DB/WB/HR): 86.7 / 62.9 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	25	25	1.5	21
	0	0	0	0.0	21
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	86	86	5.2	707
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-18	-18	-1.1	214
	0	0	0	0.0	0
	60	0	60	3.6	0
	60	93	154	9.3	-
	210	294	503	30.4	200
	204	322	526	31.8	200
	-	-	-	-	-
	340	0	340	20.6	200
	754	616	1,370	82.7	-
	-	-	-	-	-
	0	136	136	8.2	193
			0	0.0	200
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.2	-
	0	-	0	0.0	-
	0	-	0	0.0	-
	815	841	1,656	100.0	

Temperatures °F	
Supply	55.0
Return	78.2
Mixed Air	83.8
Fan Heat TD	1.9

Airflows cfm	
Main Fan	80
Ventilation	22
Infiltration	5
Min Stop / Reheat	80

Engineering Checks	
% OA	27.52
cfm/ft²	.40
Btu/h-ft²	14.59
cfm/ton	329.02
ft²/ton	822.90
People	2
ft²/person	99.79

Areas ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Comfort/Consult_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	1,088	0	1,088	15.7	3.9
Other Roof	0	0	0	0	0.0	0.0
Glass	344	104	0	447	6.5	19.2
Door	0	0	0	0	0.0	0.0
Wall	0	698	0	698	10.1	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-251	0	-251	-3.6	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-28	0	-28	-0.4	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	344	1,610	00	1,954	28.2	-
People	298	408	567	1,273	18.4	4.5
Lights	0	350	0	350	5.1	5.7
RA Sensible (Lights)	749	0	0	749	10.8	0.0
Miscellaneous Loads	435	288	0	723	10.4	2.6
Internal Subtotal	1,481	1,046	567	3,094	44.7	-
Ventilation	1,785	0	-255	1,531	22.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	13	0	13	0.2	0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	359	0	-	359	5.2	-
Time Delay Correction	0	-26	-	-26	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	3,970	2,643	312	6,926	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	1,088	1,088	29.2	278
Other Roof	0	0	0	0.0	278
Glass	344	104	447	12.0	23
Door	0	0	0	0.0	0
Wall	0	698	698	18.8	336
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	336
Partition	0	-251	-251	-6.8	1,134
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-28	-28	-0.8	313
Other Floor	0	0	0	0.0	0
Infiltration	0	0	0	0.0	336
Envelope Subtotal	344	1,610	1,954	52.5	-
People	298	408	706	19.0	283
Lights	0	350	350	9.4	283
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	435	288	723	19.4	283
Internal Subtotal	733	1,046	1,779	47.8	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	13	13	0.3	36
Ceiling	0	0	0	0.0	283
Refrigeration	0	0	0	0.0	0
Service Water	0	0	0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-26	-26	-0.7	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	0	0	0.0	-
Grand Total	1,077	2,643	3,720	100.0	

Temperatures °F	
Supply	55.0
Return	81.7
Mixed Air	88.6
Fan Heat TD	1.9

Airflows cfm	
Main Fan	179
Ventilation	72
Infiltration	0
Min Stop / Reheat	179

Engineering Checks	
% OA	40.33
cfm/ft²	.63
Btu/h-ft²	24.45
cfm/ton	310.59
ft²/ton	491.11
People	3
ft²/person	100.16

Areas ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Entry/Waiting_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent				
	Instant	Delay	of		Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	117	0	117	0.8	2.1
Other Roof	0	0	0	0	0.0	0.0
Glass	6,756	4,383	0	11,139	81.0	43.0
Door	0	684	0	684	5.0	24.4
Wall	0	1,248	0	1,248	9.1	2.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,113	0	-1,113	-8.1	-1.9
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-331	0	-331	-2.4	-0.8
Other Floor	0	0	0	0	0.0	0.0
Infiltration	218	0	-78	141	1.0	0.2
Envelope Subtotal	6,974	4,988	-78	11,884	86.4	-
People	182	254	287	723	5.3	2.0
Lights	307	441	0	748	5.4	3.0
RA Sensible (Lights)	333	0	0	333	2.4	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	821	695	287	1,804	13.1	-
Ventilation	765	0	-274	491	3.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-1,477	0	-1,477	-10.7	-4.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	1,118	0	-	1,118	8.1	-
Time Delay Correction	0	-276	-	-276	-2.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	176	0	39	215	1.6	-
Grand Total	9,854	3,931	-26	13,759	100.0	

Fan Peak						
Peak Time (Mo/D/H:M):		10/21/14:00				
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0				
	Time	Percent				
	Instant	Delay	Total	of	Related	
	Sensible	Sensible	Sensible	Total	Area	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)	
	0	41	41	0.4	56	
	0	0	0	0.0	56	
	6,334	5,796	12,130	104.8	259	
	0	818	818	7.1	28	
	0	1,171	1,171	10.1	625	
	0	0	0	0.0	0	
	0	0	0	0.0	625	
	0	-1,219	-1,219	-10.5	591	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	0	-460	-460	-4.0	396	
	0	0	0	0.0	0	
	140	0	140	1.2	625	
	6,474	6,148	12,621	109.1	-	
	182	254	436	3.8	370	
	307	441	748	6.5	370	
	-	-	-	-	-	
	0	0	0	0.0	370	
	489	695	1,184	10.2	-	
	-	-	-	-	-	
	0	-1,948	-1,948	-16.8	339	
			0	0.0	370	
			0	0.0	0	
	0	0	0	0.0	0	
	-	-	-	-	-	
	0	-287	-287	-2.5	-	
	0	-	0	0.0	-	
	-2	-	-2	0.0	-	
	6,960	4,609	11,569	100.0		

Temperatures °F	
Supply	55.0
Return	75.6
Mixed Air	76.9
Fan Heat TD	1.9

Airflows cfm	
Main Fan	557
Ventilation	31
Infiltration	9
Min Stop / Reheat	557

Engineering Checks	
% OA	5.65
cfm/ft²	1.50
Btu/h-ft²	37.17
cfm/ton	486.22
ft²/ton	323.07
People	2
ft²/person	200.24

Areas ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Exam/Storage_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	957	0	957	25.8	3.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-30	0	-30	-0.8	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-13	0	-13	-0.3	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	60	0	-9	51	1.4	0.0
Envelope Subtotal	60	914	-09	965	26.0	-
People	182	248	347	777	20.9	3.5
Lights	58	241	0	299	8.1	4.1
RA Sensible (Lights)	376	0	0	376	10.1	0.0
Miscellaneous Loads	202	124	0	326	8.8	1.5
Internal Subtotal	819	613	347	1,779	47.9	-
Ventilation	924	0	-143	781	21.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	195	0	-	195	5.3	-
Time Delay Correction	0	-9	-	-9	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	1,998	1,518	195	3,711	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	957	957	47.3	246
Other Roof	0	0	0	0.0	246
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	0	0	0.0	0
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	0
Partition	0	-30	-30	-1.5	1,076
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-13	-13	-0.6	246
Other Floor	0	0	0	0.0	0
Infiltration	60	0	60	3.0	0
Envelope Subtotal	60	914	974	48.2	-
People	182	248	430	21.3	224
Lights	58	241	299	14.8	224
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	202	124	326	16.1	224
Internal Subtotal	442	613	1,056	52.2	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	0	0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration	0	0	0	0.0	224
Service Water	0	0	0	0.0	224
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-9	-9	-0.5	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	0	0	0.0	-
Grand Total	503	1,518	2,021	100.0	

Temperatures °F	
Supply	55.0
Return	81.0
Mixed Air	87.9
Fan Heat TD	1.9

Airflows cfm	
Main Fan	97
Ventilation	37
Infiltration	2
Min Stop / Reheat	97

Engineering Checks	
% OA	38.44
cfm/ft²	.44
Btu/h-ft²	16.60
cfm/ton	314.86
ft²/ton	723.38
People	2
ft²/person	129.32

Areas ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

Group_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	586	0	586	8.2	4.0
Other Roof	0	0	0	0	0.0	0.0
Glass	223	104	0	327	4.6	21.0
Door	0	0	0	0	0.0	0.0
Wall	0	611	0	611	8.6	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-186	0	-186	-2.6	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-64	0	-64	-0.9	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	166	0	-40	126	1.8	0.4
Envelope Subtotal	389	1,051	-40	1,399	19.6	-
People	553	780	1,106	2,438	34.2	8.8
Lights	227	345	0	572	8.0	3.0
RA Sensible (Lights)	132	0	0	132	1.9	0.0
Miscellaneous Loads	283	185	0	468	6.6	1.7
Internal Subtotal	1,195	1,310	1,106	3,610	50.6	-
Ventilation	2,254	0	-553	1,702	23.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	81	0	81	1.1	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	374	0	-	374	5.2	-
Time Delay Correction	0	-25	-	-25	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-2	0	-2	-4	-0.1	-
Grand Total	4,209	2,416	511	7,136	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	586	586	15.1
	0	0	0	0.0
	223	104	327	8.5
	0	0	0	0.0
	0	611	611	15.8
	0	0	0	0.0
	0	0	0	0.0
	0	-186	-186	-4.8
	0	0	0	0.0
	0	0	0	0.0
	0	-64	-64	-1.6
	0	0	0	0.0
	166	0	166	4.3
	389	1,051	1,440	37.2
	553	780	1,332	34.5
	227	345	572	14.8
	-	-	-	-
	283	185	468	12.1
	1,062	1,310	2,372	61.4
	-	-	-	-
	0	81	81	2.1
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-25	-25	-0.7
	0	-	0	0.0
	-2	-	-2	-0.1
	1,449	2,416	3,865	100.0

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	87.3
Fan Heat TD	1.9

Airflows cfm	
Main Fan	186
Ventilation	91
Infiltration	7
Min Stop / Reheat	186

Engineering Checks	
% OA	48.95
cfm/ft²	.67
Btu/h-ft²	25.83
cfm/ton	313.46
ft²/ton	464.81
People	6
ft²/person	49.99

Areas ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Hospitality_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	489	0	489	7.7	3.8
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	579	0	579	9.1	2.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	94	0	94	1.5	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-25	0	-25	-0.4	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	148	0	-36	112	1.8	0.4
Envelope Subtotal	148	1,137	-36	1,248	19.7	-
People	492	684	984	2,160	34.1	8.8
Lights	202	305	0	507	8.0	3.0
RA Sensible (Lights)	118	0	0	118	1.9	0.0
Miscellaneous Loads	252	163	0	415	6.6	1.7
Internal Subtotal	1,064	1,152	984	3,200	50.5	-
Ventilation	2,006	0	-494	1,512	23.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	58	0	58	0.9	0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	331	0	-	331	5.2	-
Time Delay Correction	0	-12	-	-12	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-2	0	-2	-4	-0.1	-
Grand Total	3,547	2,335	452	6,334	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Instant	Time Delay	Total	Percent of Total	Related Area
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(%)	(ft²)
Roof	0	489	489	14.3	129
Other Roof	0	0	0	0.0	129
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	579	579	16.9	260
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	260
Partition	0	94	94	2.7	528
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-25	-25	-0.7	262
Other Floor	0	0	0	0.0	0
Infiltration	148	0	148	4.3	260
Envelope Subtotal	148	1,137	1,284	37.5	-
People	492	684	1,176	34.3	246
Lights	202	305	507	14.8	246
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	252	163	415	12.1	246
Internal Subtotal	946	1,152	2,098	61.2	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	58	58	1.7	133
Ceiling	0	0	0	0.0	246
Refrigeration	0	0	0	0.0	0
Service Water	0	0	0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-12	-12	-0.3	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	-2	-	-2	-0.1	-
Grand Total	1,091	2,335	3,426	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	87.4
Fan Heat TD	1.9

Airflows cfm	
Main Fan	165
Ventilation	81
Infiltration	6
Min Stop / Reheat	165

Engineering Checks	
% OA	49.14
cfm/ft²	.67
Btu/h-ft²	25.76
cfm/ton	313.06
ft²/ton	466.13
People	5
ft²/person	50.01

Areas ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Intake-HR-A_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/16:00						
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0						
	Time		Percent			
	Instant	Delay	Latent	Total	of	Btu/h
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	1,466	0	1,466	13.5	3.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	1,444	0	1,444	13.3	56.3
Wall	0	1,576	0	1,576	14.5	3.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-267	0	-267	-2.5	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-29	0	-29	-0.3	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	91	0	-10	80	0.7	0.2
Envelope Subtotal	91	4,191	-10	4,271	39.3	-
People	404	559	720	1,683	15.5	3.6
Lights	72	494	0	566	5.2	4.4
RA Sensible (Lights)	1,178	0	0	1,178	10.8	0.0
Miscellaneous Loads	362	234	0	595	5.5	1.3
Internal Subtotal	2,017	1,287	720	4,023	37.0	-
Ventilation	1,580	0	-188	1,391	12.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-3	0	-3	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	667	0	-	667	6.1	-
Time Delay Correction	0	-96	-	-96	-0.9	-
Sizing Factor Correction	557	-	-	557	5.1	-
Over/Undersizing	40	0	25	65	0.6	-
Grand Total	4,951	5,379	546	10,876	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/17:00					
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0					
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,274	1,274	18.4	438
	0	0	0	0.0	438
	0	0	0	0.0	0
	0	1,430	1,430	20.7	26
	0	1,694	1,694	24.5	449
	0	0	0	0.0	0
	0	0	0	0.0	449
	0	-169	-169	-2.4	1,787
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-19	-19	-0.3	516
	0	0	0	0.0	0
	81	0	81	1.2	449
	81	4,209	4,290	62.1	-
	404	559	964	14.0	471
	72	494	566	8.2	471
	-	-	-	-	-
	362	234	595	8.6	471
	838	1,287	2,125	30.8	-
	-	-	-	-	-
	0	23	23	0.3	78
			0	0.0	471
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-92	-92	-1.3	-
	560	-	560	8.1	-
	0	-	0	0.0	-
	1,479	5,426	6,905	100.0	

Temperatures °F	
Supply	55.0
Return	79.3
Mixed Air	83.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	333
Ventilation	69
Infiltration	4
Min Stop / Reheat	333

Engineering Checks	
% OA	22.69
cfm/ft²	.65
Btu/h-ft²	23.13
cfm/ton	337.34
ft²/ton	519.14
People	4
ft²/person	118.82

Areas ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	0
Door	26
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

Intake-HR-B_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	709	0	709	24.6	3.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	96	0	96	3.3	3.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	43	0	43	1.5	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-9	0	-9	-0.3	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	48	0	-7	42	1.5	1.6
Envelope Subtotal	48	838	-07	880	30.5	-
People	130	181	248	560	19.4	3.4
Lights	47	178	0	225	7.8	3.9
RA Sensible (Lights)	284	0	0	284	9.8	0.0
Miscellaneous Loads	139	86	0	225	7.8	1.4
Internal Subtotal	600	446	248	1,294	44.9	-
Ventilation	648	0	-90	558	19.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	159	0	-	159	5.5	-
Time Delay Correction	0	-7	-	-7	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	1,455	1,277	152	2,884	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	709	709	43.2	183
Other Roof	0	0	0	0.0	183
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	96	96	5.8	27
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	27
Partition	0	43	43	2.6	894
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-9	-9	-0.6	183
Other Floor	0	0	0	0.0	0
Infiltration	48	0	48	3.0	27
Envelope Subtotal	48	838	886	54.0	-
People	130	181	312	19.0	165
Lights	47	178	225	13.7	165
-	-	-	-	-	-
139	86	225	13.7	165	
316	446	762	46.4	-	
-	-	-	-	-	-
0	0	0	0.0	0	
-	-	-	-	-	-
0	0	0	0.0	165	
-	-	-	-	-	-
0	0	0	0.0	0	
-	-	-	-	-	-
0	-7	-7	-0.4	-	
0	-	0	0.0	-	
0	-	0	0.0	-	
365	1,277	1,641	100.0		

Temperatures °F	
Supply	55.0
Return	80.2
Mixed Air	86.3
Fan Heat TD	1.9

Airflows cfm	
Main Fan	79
Ventilation	26
Infiltration	2
Min Stop / Reheat	79

Engineering Checks	
% OA	33.16
cfm/ft²	.48
Btu/h-ft²	17.53
cfm/ton	329.12
ft²/ton	684.99
People	1
ft²/person	132.76

Areas ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

Lounge_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/16:00						
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	1,095	0	1,095	11.2	3.4
Other Roof	0	0	0	0	0.0	0.0
Glass	623	430	0	1,052	10.7	67.7
Door	0	1,159	0	1,159	11.8	55.2
Wall	0	1,106	0	1,106	11.3	4.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-437	0	-437	-4.5	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	17	0	17	0.2	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	165	0	-27	138	1.4	0.6
Envelope Subtotal	787	3,369	-27	4,129	42.1	-
People	589	840	1,098	2,528	25.8	8.5
Lights	251	372	0	623	6.4	3.1
RA Sensible (Lights)	228	0	0	228	2.3	0.0
Miscellaneous Loads	202	128	0	331	3.4	1.1
Internal Subtotal	1,271	1,341	1,098	3,710	37.8	-
Ventilation	1,487	0	-253	1,234	12.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	635	0	-	635	6.5	-
Time Delay Correction	0	-107	-	-107	-1.1	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	133	0	70	204	2.1	-
Grand Total	4,314	4,602	888	9,804	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/17:00					
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	941	941	14.3	322
Other Roof	0	0	0	0.0	322
Glass	623	514	1,137	17.3	16
Door	0	1,147	1,147	17.5	21
Wall	0	1,287	1,287	19.6	250
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	250
Partition	0	-361	-361	-5.5	987
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-6	-6	-0.1	322
Other Floor	0	0	0	0.0	0
Infiltration	147	0	147	2.2	250
Envelope Subtotal	770	3,521	4,291	65.4	-
People	589	841	1,430	21.8	297
Lights	251	372	623	9.5	297
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	202	128	331	5.0	297
Internal Subtotal	1,043	1,341	2,385	36.3	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	-	-	0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration	-	-	0	0.0	297
Service Water	-	-	0	0.0	297
HVAC Equipment Losses	-	-	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-105	-105	-1.6	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	-5	-	-5	-0.1	-
Grand Total	1,809	4,757	6,566	100.0	

Temperatures °F	
Supply	55.0
Return	75.9
Mixed Air	80.2
Fan Heat TD	1.9

Airflows cfm	
Main Fan	317
Ventilation	65
Infiltration	7
Min Stop / Reheat	317

Engineering Checks	
% OA	20.61
cfm/ft²	1.07
Btu/h-ft²	33.07
cfm/ton	387.62
ft²/ton	363.16
People	6
ft²/person	50.04

Areas ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	16
Door	21
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

Multipurpose/Dining_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	1,090	0	1,090	8.9	4.1
Other Roof	0	0	0	0	0.0	0.0
Glass	330	150	0	480	3.9	20.6
Door	0	365	0	365	3.0	17.4
Wall	0	615	0	615	5.0	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-329	0	-329	-2.7	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-95	0	-95	-0.8	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	291	0	-73	218	1.8	0.7
Envelope Subtotal	621	1,796	-73	2,344	19.2	-
People	971	1,294	1,942	4,207	34.5	8.7
Lights	398	574	0	972	8.0	2.9
RA Sensible (Lights)	224	0	0	224	1.8	0.0
Miscellaneous Loads	497	307	0	804	6.6	1.7
Internal Subtotal	2,089	2,175	1,942	6,206	50.9	-
Ventilation	3,958	0	-1,004	2,954	24.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	124	0	124	1.0	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	632	0	-	632	5.2	-
Time Delay Correction	0	-49	-	-49	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-4	0	-3	-7	-0.1	-
Grand Total	7,296	4,046	861	12,204	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	1,090	1,090	16.7	266
Other Roof	0	0	0	0.0	266
Glass	330	150	480	7.4	23
Door	0	365	365	5.6	21
Wall	0	615	615	9.4	322
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	322
Partition	0	-329	-329	-5.0	788
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-95	-95	-1.5	508
Other Floor	0	0	0	0.0	0
Infiltration	291	0	291	4.5	322
Envelope Subtotal	621	1,796	2,417	37.0	-
People	971	1,294	2,265	34.7	485
Lights	398	574	972	14.9	485
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	497	307	804	12.3	485
Internal Subtotal	1,866	2,175	4,041	61.9	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	124	124	1.9	242
Ceiling			0	0.0	485
Refrigeration			0	0.0	485
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-49	-49	-0.7	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	-4	-	-4	-0.1	-
Over/Undersizing	2,483	4,046	6,529	100.0	

Temperatures °F	
Supply	55.0
Return	76.4
Mixed Air	87.8
Fan Heat TD	1.9

Airflows cfm	
Main Fan	315
Ventilation	160
Infiltration	12
Min Stop / Reheat	315

Engineering Checks	
% OA	50.87
cfm/ft²	.65
Btu/h-ft²	25.16
cfm/ton	309.64
ft²/ton	477.30
People	10
ft²/person	49.99

Areas ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Servery_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	499	0	499	8.9	4.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	357	0	357	6.4	2.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-38	0	-38	-0.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-29	0	-29	-0.5	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	137	0	-35	101	1.8	0.6
Envelope Subtotal	137	790	-35	891	15.8	-
People	456	659	913	2,028	36.1	8.9
Lights	187	292	0	480	8.5	3.0
RA Sensible (Lights)	102	0	0	102	1.8	0.0
Miscellaneous Loads	234	156	0	390	6.9	1.7
Internal Subtotal	979	1,108	913	3,000	53.3	-
Ventilation	1,861	0	-486	1,375	24.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	84	0	84	1.5	0.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	288	0	-	288	5.1	-
Time Delay Correction	0	-11	-	-11	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-2	0	-2	-3	-0.1	-
Grand Total	3,264	1,970	390	5,624	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	499	499	16.7	124
Other Roof	0	0	0	0.0	124
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	357	357	12.0	160
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	160
Partition	0	-38	-38	-1.3	620
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-29	-29	-1.0	244
Other Floor	0	0	0	0.0	0
Infiltration	137	0	137	4.6	160
Envelope Subtotal	137	790	927	31.1	-
People	456	659	1,115	37.4	228
Lights	187	292	480	16.1	228
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	234	156	390	13.1	228
Internal Subtotal	877	1,108	1,985	66.6	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	84	84	2.8	120
Ceiling	0	0	0	0.0	228
Refrigeration	0	0	0	0.0	0
Service Water	0	0	0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-11	-11	-0.4	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	-2	-	-2	-0.1	-
Grand Total	1,012	1,970	2,982	100.0	

Temperatures °F	
Supply	55.0
Return	76.4
Mixed Air	88.1
Fan Heat TD	1.9

Airflows cfm	
Main Fan	144
Ventilation	75
Infiltration	6
Min Stop / Reheat	144

Engineering Checks	
% OA	52.37
cfm/ft²	.63
Btu/h-ft²	24.66
cfm/ton	306.89
ft²/ton	486.92
People	5
ft²/person	50.04

Areas ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Support_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	1,760	0	1,760	18.1	3.1
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	1,892	0	1,892	19.4	45.1
Wall	0	2,505	0	2,505	25.7	4.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-330	0	-330	-3.4	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-17	0	-17	-0.2	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	00	5,810	00	5,810	59.6	-
People	0	0	0	0	0.0	0.0
Lights	459	659	0	1,118	11.5	3.1
RA Sensible (Lights)	484	0	0	484	5.0	0.0
Miscellaneous Loads	537	0	0	537	5.5	1.0
Internal Subtotal	1,479	659	0	2,138	21.9	-
Ventilation	764	0	-261	502	5.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	772	0	-	772	7.9	-
Time Delay Correction	0	-101	-	-101	-1.0	-
Sizing Factor Correction	630	-	-	630	6.5	-
Over/Undersizing	-2	0	0	-2	0.0	-
Grand Total	3,644	6,369	-262	9,751	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/15:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	1,760	1,760	22.0	569
Other Roof	0	0	0	0.0	569
Glass	0	0	0	0.0	0
Door	0	1,892	1,892	23.7	42
Wall	0	2,505	2,505	31.3	543
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	543
Partition	0	-330	-330	-4.1	1,625
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-17	-17	-0.2	569
Other Floor	0	0	0	0.0	0
Infiltration	0	0	0	0.0	543
Envelope Subtotal	0	5,810	5,810	72.7	-
People	0	0	0	0.0	524
Lights	459	659	1,118	14.0	524
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	537	0	537	6.7	524
Internal Subtotal	995	659	1,654	20.7	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	0	0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration	0	0	0	0.0	524
Service Water	0	0	0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-101	-101	-1.3	-
Sizing Factor Correction	630	-	630	7.9	-
Over/Undersizing	-2	-	-2	0.0	-
Grand Total	1,624	6,369	7,992	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	78.1
Fan Heat TD	1.9

Airflows cfm	
Main Fan	385
Ventilation	31
Infiltration	0
Min Stop / Reheat	385

Engineering Checks	
% OA	8.87
cfm/ft²	.68
Btu/h-ft²	18.62
cfm/ton	436.60
ft²/ton	645.04
People ft²/person	.00

Areas ft²	
Roof	569
Other Roof	569
Ceiling	0
Window	0
Door	42
Wall	543
Below-Grade Wall	0
Other Wall	543
Partition	1,625
Exterior Floor	0
Internal Floor	0
Slab	569
Other Floor	0

Utility_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	11,100	0	11,100	33.0	3.8
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	1,469	0	1,469	4.4	52.5
Wall	0	292	0	292	0.9	2.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	3,256	0	3,256	9.7	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-91	0	-91	-0.3	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	1,132	0	-65	1,066	3.2	9.8
Envelope Subtotal	1,132	16,026	-65	17,092	50.8	-
People	724	1,042	1,259	3,025	9.0	1.0
Lights	698	2,355	0	3,054	9.1	2.9
RA Sensible (Lights)	4,499	0	0	4,499	13.4	0.0
Miscellaneous Loads	247	0	0	247	0.7	0.1
Internal Subtotal	6,169	3,397	1,259	10,825	32.2	-
Ventilation	4,054	0	-240	3,814	11.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-75	0	-75	-0.2	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	2,126	0	-	2,126	6.3	-
Time Delay Correction	0	-163	-	-163	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	11	0	6	17	0.0	-
Grand Total	13,491	19,186	960	33,636	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time	Percent		Related	
	Instant	Delay	Total	of	Area
	Sensible	Sensible	Sensible	Total	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	10,183	10,183	46.3	2,903
	0	0	0	0.0	2,903
	0	0	0	0.0	0
	0	1,598	1,598	7.3	28
	0	351	351	1.6	109
	0	0	0	0.0	0
	0	0	0	0.0	109
	0	3,977	3,977	18.1	13,149
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-55	-55	-0.3	3,198
	0	0	0	0.0	0
	1,047	0	1,047	4.8	109
	1,047	16,055	17,102	77.7	-
	724	1,042	1,766	8.0	2,927
	698	2,355	3,054	13.9	2,927
	-	-	-	-	-
	247	0	247	1.1	2,927
	1,670	3,397	5,067	23.0	-
	-	-	-	-	-
	0	-5	-5	0.0	295
			0	0.0	2,927
			0	0.0	2,927
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-162	-162	-0.7	-
	0	-	0	0.0	-
	-3	-	-3	0.0	-
	2,714	19,284	21,998	100.0	

Temperatures °F	
Supply	55.0
Return	79.8
Mixed Air	82.8
Fan Heat TD	1.9

Airflows cfm	
Main Fan	1,060
Ventilation	164
Infiltration	46
Min Stop / Reheat	1,060

Engineering Checks	
% OA	15.49
cfm/ft²	.36
Btu/h-ft²	11.50
cfm/ton	378.16
ft²/ton	1,044.01
People	7
ft²/person	409.31

Areas ft²	
Roof	2,903
Other Roof	2,903
Ceiling	295
Window	0
Door	28
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

Kitchen_System 4 - 2007/2010/2013_Copy

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/16:00				
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
Roof	0	2,874	0	2,874	4.0	4.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	2,645	0	2,645	3.7	54.0
Wall	0	1,231	0	1,231	1.7	2.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,204	0	-1,204	-1.7	-0.9
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-344	0	-344	-0.5	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	380	0	-39	341	0.5	0.6
Envelope Subtotal	380	5,203	-39	5,544	7.7	-
People	1,375	1,883	3,197	6,456	9.0	9.4
Lights	401	619	0	1,021	1.4	2.2
RA Sensible (Lights)	421	0	0	421	0.6	0.0
Miscellaneous Loads	13,333	8,793	0	22,126	30.8	32.3
Internal Subtotal	15,531	11,295	3,197	30,024	41.8	-
Ventilation	5,346	0	-554	4,792	6.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	5,603	0	-	5,603	7.8	-
Time Delay Correction	0	-167	-	-167	-0.2	-
Sizing Factor Correction	26,137	-	-	26,137	36.4	-
Over/Undersizing	-32	0	-10	-43	-0.1	-
Grand Total	52,965	16,332	2,594	71,890	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/16:00	
Outside Air (DB/WB/HR):			96.9 / 66.1 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	2,874	2,874	5.0	726
0	0	0	0.0	726
0	0	0	0.0	0
0	2,645	2,645	4.6	49
0	1,231	1,231	2.1	607
0	0	0	0.0	0
0	0	0	0.0	607
0	-1,204	-1,204	-2.1	1,346
0	0	0	0.0	0
0	0	0	0.0	0
0	-344	-344	-0.6	726
0	0	0	0.0	0
380	0	380	0.7	607
380	5,203	5,584	9.6	-
1,375	1,883	3,258	5.6	686
401	619	1,021	1.8	686
-	-	-	-	-
13,333	8,793	22,126	38.2	686
15,110	11,295	26,405	45.6	-
-	-	-	-	-
		0	0.0	0
0	0	0	0.0	0
		0	0.0	686
		0	0.0	686
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-167	-167	-0.3	-
26,137	-	26,137	45.1	-
-32	-	-32	-0.1	-
41,595	16,332	57,926	100.0	

Temperatures °F	
Supply	55.0
Return	75.1
Mixed Air	77.0
Fan Heat TD	1.9

Airflows cfm	
Main Fan	2,793
Ventilation	235
Infiltration	17
Min Stop / Reheat	2,793

Engineering Checks	
% OA	15.30
cfm/ft²	2.24
Btu/h-ft²	104.94
cfm/ton	256.04
ft²/ton	114.42
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

System Heating Checksums

Kitchen_Single Zone CV

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-760	0	-760	0.7	-1.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-966	0	-966	0.9	-19.7
Wall	0	-964	0	-964	0.9	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-205	0	-205	0.2	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	163	0	163	-0.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-742	0	0	-742	0.7	-1.3
Envelope Subtotal	-742	-2,732	0	-3,475	3.2	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	13	0	0	13	0.0	0.0
Internal Subtotal	13	0	0	13	0.0	-
Ventilation	-97,049	0	0	-97,049	88.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-26	0	-26	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-9,488	0	0	-9,488	8.6	-
Grand Total	-107,267	-2,759	0	-110,026	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/16:00			
Outside Air (DB/WB/HR):		96.5 / 63.6 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,094	1,094	3.8	726
	0	0	0	0.0	726
	0	0	0	0.0	0
	0	1,174	1,174	4.1	49
	0	1,238	1,238	4.3	607
	0	0	0	0.0	0
	0	0	0	0.0	607
	0	-1,389	-1,389	-4.8	1,346
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-378	-378	-1.3	726
	0	0	0	0.0	0
	373	0	373	1.3	607
	373	1,739	2,112	7.4	-
	1,375	1,906	3,281	11.4	686
	365	570	935	3.3	686
	-	-	-	-	-
	13,333	8,898	22,232	77.4	686
	15,073	11,374	26,448	92.0	-
	-	-	-	-	-
	0	0	0	0.0	0
			0	0.0	686
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-49	-49	-0.2	-
	0	-	0	0.0	-
	222	-	222	0.8	-
	15,669	13,065	28,734	100.0	

Temperatures °F	
Supply	75.0
Return	70.0
Mixed Air	32.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	2,532
Ventilation	174
Infiltration	19
Min Stop / Reheat	2,532

Engineering Checks	
% OA	25.55
cfm/ft²	.99
Btu/h-ft²	-160.61
cfm/ton	-74.21
ft²/ton	-74.76
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

System Heating Checksums

System 10 - 2010/2013

The heating checksums report is not available for this system because the preheat coil is sized for the ventilation load. See the System Component Summary report for more details.

Attrium_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-1,377	0	-1,377	11.8	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,345	0	0	-1,345	11.5	-23.7
Door	0	0	0	0	0.0	0.0
Wall	0	-3,077	0	-3,077	26.4	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-238	0	-238	2.0	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	134	0	134	-1.2	0.2
Slab	0	116	0	116	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-1,359	0	0	-1,359	11.7	-1.4
Envelope Subtotal	-2,704	-4,442	0	-7,145	61.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-53	0	-53	0.5	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-47	0	-47	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-4,407	0	0	-4,407	37.8	-
Grand Total	-7,111	-4,542	0	-11,652	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time		Percent	
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	2,389	2,389	20.3
	0	0	0	0.0
	1,140	566	1,706	14.5
	0	0	0	0.0
	0	3,093	3,093	26.2
	0	0	0	0.0
	0	0	0	0.0
	0	128	128	1.1
	0	0	0	0.0
	0	-235	-235	-2.0
	0	-8	-8	-0.1
	0	0	0	0.0
	694	0	694	5.9
	1,835	5,932	7,767	65.8
	621	883	1,504	12.7
	1,050	1,546	2,596	22.0
	-	-	-	-
	0	0	0	0.0
	1,671	2,429	4,100	34.8
	-	-	-	-
	0	-739	-739	-6.3
		0	0	0.0
		0	0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-76	-76	-0.6
	744	-	744	6.3
	2	-	2	0.0
	4,251	7,545	11,796	100.0

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	568
Ventilation	0
Infiltration	35
Min Stop / Reheat	568

Engineering Checks	
% OA	.00
cfm/ft²	.28
Btu/h-ft²	-9.21
cfm/ton	-363.88
ft²/ton	-1,304.40
People	6
ft²/person	200.10

Areas	
	ft²
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Corridor-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,281	0	0	-1,281	28.2	-19.8
Door	0	0	0	0	0.0	0.0
Wall	0	-113	0	-113	2.5	-1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-36	0	-36	0.8	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	103	0	103	-2.3	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-239	0	0	-239	5.3	-2.5
Envelope Subtotal	-1,519	-46	0	-1,566	34.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-953	0	0	-953	21.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-784	0	-784	17.3	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-43	0	-43	0.9	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,197	0	0	-1,197	26.4	-
Grand Total	-3,670	-873	0	-4,543	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/09:00		
Outside Air (DB/WB/HR):		81.8 / 61.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0
	0	0	0	0
	2,118	1,705	3,823	105.2
	0	0	0	0
	0	174	174	4.8
	0	0	0	0.0
	0	0	0	0.0
	0	-311	-311	-8.6
	0	0	0	0.0
	0	0	0	0.0
	0	202	202	5.6
	0	0	0	0.0
	39	0	39	1.1
	2,157	1,770	3,927	108.1
	0	0	0	0.0
	0	249	249	6.8
	-	-	-	-
	0	0	0	0.0
	0	249	249	6.8
	-	-	-	-
	0	-444	-444	-12.2
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-98	-98	-2.7
	0	-	0	0.0
	0	-	0	0.0
	2,157	1,477	3,634	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	64.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	175
Ventilation	25
Infiltration	6
Min Stop / Reheat	175

Engineering Checks	
% OA	21.04
cfm/ft²	.29
Btu/h-ft²	-11.11
cfm/ton	-308.18
ft²/ton	-1,080.57
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

Corridor-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,329	0	0	-1,329	24.3	-20.5
Door	0	0	0	0	0.0	0.0
Wall	0	-114	0	-114	2.1	-1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-4	0	-4	0.1	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	104	0	104	-1.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-241	0	0	-241	4.4	-2.5
Envelope Subtotal	-1,571	-15	0	-1,585	28.9	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-965	0	0	-965	17.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-775	0	-775	14.1	-1.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-46	0	-46	0.8	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-2,106	0	0	-2,106	38.5	-
Grand Total	-4,642	-835	0	-5,477	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/17:00		
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	2,632	1,668	4,300	94.1
	0	0	0	0.0
	0	227	227	5.0
	0	0	0	0.0
	0	0	0	0.0
	0	-284	-284	-6.2
	0	0	0	0.0
	0	0	0	0.0
	0	423	423	9.2
	0	0	0	0.0
	110	0	110	2.4
	2,742	2,033	4,775	104.5
	0	0	0	0.0
	0	312	312	6.8
	-	-	-	-
	0	0	0	0.0
	0	312	312	6.8
	-	-	-	-
	0	-378	-378	-8.3
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-142	-142	-3.1
	0	-	0	0.0
	0	-	0	0.0
	2,743	1,825	4,568	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	65.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	220
Ventilation	25
Infiltration	6
Min Stop / Reheat	220

Engineering Checks	
% OA	21.17
cfm/ft²	.28
Btu/h-ft²	-13.24
cfm/ton	-257.06
ft²/ton	-906.95
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

Corridor-W_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,303	0	0	-1,303	44.0	-20.1
Door	0	0	0	0	0.0	0.0
Wall	0	-109	0	-109	3.7	-1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-3	0	-3	0.1	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	85	0	85	-2.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-189	0	0	-189	6.4	-2.0
Envelope Subtotal	-1,492	-27	0	-1,518	51.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-755	0	0	-755	25.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-605	0	-605	20.4	-1.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-43	0	-43	1.5	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-41	0	0	-41	1.4	-
Grand Total	-2,287	-674	0	-2,962	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	915	380	1,296	58.0
	0	0	0	0.0
	0	78	78	3.5
	0	0	0	0.0
	0	0	0	0.0
	0	331	331	14.8
	0	0	0	0.0
	0	0	0	0.0
	0	17	17	0.8
	0	0	0	0.0
	73	0	73	3.3
	988	806	1,794	80.3
	0	0	0	0.0
	0	245	245	11.0
	-	-	-	-
	0	0	0	0.0
	0	245	245	11.0
	-	-	-	-
	0	215	215	9.6
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-20	-20	-0.9
	0	-	0	0.0
	0	-	0	0.0
	988	1,246	2,234	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	63.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	108
Ventilation	19
Infiltration	5
Min Stop / Reheat	108

Engineering Checks	
% OA	18.40
cfm/ft²	.33
Btu/h-ft²	-9.15
cfm/ton	-427.98
ft²/ton	-1,312.58
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

RB-N-Corner_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-224	0	0	-224	8.9	-22.2
Door	0	0	0	0	0.0	0.0
Wall	0	-863	0	-863	34.1	-3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	72	0	72	-2.9	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	39	0	39	-1.5	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	5.6	-0.5
Envelope Subtotal	-366	-752	0	-1,118	44.1	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-557	0	0	-557	22.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-224	0	-224	8.8	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-8	0	-8	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-626	0	0	-626	24.7	-
Grand Total	-1,549	-984	0	-2,533	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/12:00		
Outside Air (DB/WB/HR):		94.8 / 65.5 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	132	47	179	8.9
	0	0	0	0.0
	0	866	866	43.3
	0	0	0	0.0
	0	0	0	0.0
	0	-102	-102	-5.1
	0	0	0	0.0
	0	0	0	0.0
	0	-19	-19	-1.0
	0	0	0	0.0
	65	0	65	3.3
	198	791	989	49.4
	151	183	334	16.7
	0	42	42	2.1
	-	-	-	-
	356	405	761	38.0
	507	630	1,137	56.8
	-	-	-	-
	0	-113	-113	-5.7
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-13	-13	-0.6
	0	-	0	0.0
	1	-	1	0.0
	705	1,295	2,000	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	64.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	96
Ventilation	14
Infiltration	4
Min Stop / Reheat	96

Engineering Checks	
% OA	21.79
cfm/ft²	.50
Btu/h-ft²	-19.43
cfm/ton	-311.81
ft²/ton	-617.86
People	1
ft²/person	100.31

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-N-East_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	per	
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-5	0	-5	0.1	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	-438	0	0	-438	7.8	-21.7
Door	0	0	0	0	0.0	0.0
Wall	0	-1,229	0	-1,229	22.0	-3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	68	0	68	-1.2	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	71	0	71	-1.3	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-278	0	0	-278	5.0	-0.7
Envelope Subtotal	-716	-1,095	0	-1,812	32.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,098	0	0	-1,098	19.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-488	0	-488	8.7	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-16	0	-16	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-2,172	0	0	-2,172	38.9	-
Grand Total	-3,987	-1,599	0	-5,585	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M): 9/21/14:00				
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0				
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
0	9	9	0.2	3
0	0	0	0.0	3
664	432	1,096	24.1	20
0	0	0	0.0	0
0	1,652	1,652	36.4	412
0	0	0	0.0	0
0	0	0	0.0	412
0	-277	-277	-6.1	733
0	0	0	0.0	0
0	0	0	0.0	0
0	-67	-67	-1.5	280
0	0	0	0.0	0
152	0	152	3.3	412
815	1,749	2,565	56.5	-
297	404	701	15.4	257
0	88	88	1.9	257
-	-	-	-	-
702	847	1,549	34.1	257
998	1,339	2,338	51.5	-
-	-	-	-	-
0	-315	-315	-6.9	278
		0	0.0	257
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-46	-46	-1.0	-
0	-	0	0.0	-
2	-	2	0.0	-
1,815	2,728	4,543	100.0	-

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	65.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	219
Ventilation	28
Infiltration	7
Min Stop / Reheat	219

Engineering Checks	
% OA	25.04
cfm/ft²	.44
Btu/h-ft²	-21.75
cfm/ton	-242.57
ft²/ton	-552.18
People	3
ft²/person	100.01

Areas ft²	
Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

RB-N-West_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-694	0	0	-694	9.2	-22.9
Door	0	0	0	0	0.0	0.0
Wall	0	-1,074	0	-1,074	14.2	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-27	0	-27	0.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	96	0	96	-1.3	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-414	0	0	-414	5.5	-1.2
Envelope Subtotal	-1,108	-1,005	0	-2,113	28.0	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,634	0	0	-1,634	21.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-726	0	-726	9.6	-1.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-24	0	-24	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-3,043	0	0	-3,043	40.4	-
Grand Total	-5,785	-1,755	0	-7,541	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	381	162	542	11.3
	0	0	0	0.0
	0	694	694	14.5
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-275	-275	-5.7
	0	0	0	0.0
	0	0	0	0.0
	0	-101	-101	-2.1
	0	0	0	0.0
	189	0	189	4.0
	570	480	1,050	21.9
	442	675	1,117	23.3
	0	135	135	2.8
	-	-	-	-
	1,044	1,297	2,342	48.9
	1,486	2,108	3,594	75.1
	-	-	-	-
	0	170	170	3.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-32	-32	-0.7
	0	-	0	0.0
	2	-	2	0.0
	2,058	2,726	4,784	100.0

Temperatures °F	
Supply	95.0
Return	70.0
Mixed Air	63.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	230
Ventilation	42
Infiltration	11
Min Stop / Reheat	230

Engineering Checks	
% OA	18.26
cfm/ft²	.60
Btu/h-ft²	-19.73
cfm/ton	-366.76
ft²/ton	-608.71
People	4
ft²/person	99.88

Areas ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

RB-S-Corner-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-214	0	0	-214	6.9	-21.2
Door	0	0	0	0	0.0	0.0
Wall	0	-853	0	-853	27.6	-3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	75	0	75	-2.4	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	38	0	38	-1.2	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-140	0	0	-140	4.5	-0.5
Envelope Subtotal	-354	-740	0	-1,094	35.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-551	0	0	-551	17.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-223	0	-223	7.2	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-8	0	-8	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,210	0	0	-1,210	39.2	-
Grand Total	-2,115	-970	0	-3,085	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M): 9/21/16:00				
Outside Air (DB/WB/HR): 96.5 / 63.6 / 0.0				
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	204	170	374	14.6
	0	0	0	0.0
	0	1,390	1,390	54.2
	0	0	0	0.0
	0	0	0	0.0
	0	-167	-167	-6.5
	0	0	0	0.0
	0	0	0	0.0
	0	-87	-87	-3.4
	0	0	0	0.0
	70	0	70	2.7
	274	1,306	1,580	61.6
	149	226	375	14.6
	0	47	47	1.8
	-	-	-	-
	352	450	802	31.3
	501	722	1,223	47.7
	-	-	-	-
	0	-221	-221	-8.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-19	-19	-0.8
	0	-	0	0.0
	1	-	1	0.0
	776	1,788	2,565	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	65.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	124
Ventilation	14
Infiltration	4
Min Stop / Reheat	124

Engineering Checks	
% OA	21.99
cfm/ft²	.50
Btu/h-ft²	-23.92
cfm/ton	-251.13
ft²/ton	-502.01
People	1
ft²/person	100.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

RB-S-Corner-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-225	0	0	-225	7.7	-22.2
Door	0	0	0	0	0.0	0.0
Wall	0	-858	0	-858	29.5	-3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	69	0	69	-2.4	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	39	0	39	-1.3	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-142	0	0	-142	4.9	-0.5
Envelope Subtotal	-367	-750	0	-1,116	38.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-561	0	0	-561	19.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-223	0	-223	7.7	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-8	0	-8	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,000	0	0	-1,000	34.4	-
Grand Total	-1,928	-981	0	-2,909	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0
	0	0	0	0
	131	61	192	8.1
	0	0	0	0
	0	1,201	1,201	50.5
	0	0	0	0
	0	0	0	0
	0	0	0	0
	0	-146	-146	-6.1
	0	0	0	0
	0	0	0	0
	0	-30	-30	-1.3
	0	0	0	0
	55	0	55	2.3
	186	1,087	1,273	53.6
	152	238	389	16.4
	0	46	46	1.9
	-	-	-	-
	358	442	800	33.7
	510	726	1,236	52.0
	-	-	-	-
	0	-117	-117	-4.9
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-16	-16	-0.7
	0	-	0	0.0
	1	-	1	0.0
	697	1,680	2,377	100.0

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	65.2
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	115
Ventilation	14
Infiltration	4
Min Stop / Reheat	115

Engineering Checks	
% OA	21.98
cfm/ft²	.50
Btu/h-ft²	-22.18
cfm/ton	-271.10
ft²/ton	-541.40
People	1
ft²/person	100.20

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

RB-S-East_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-657	0	0	-657	8.9	-21.7
Door	0	0	0	0	0.0	0.0
Wall	0	-933	0	-933	12.6	-2.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-13	0	-13	0.2	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	92	0	92	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-403	0	0	-403	5.4	-1.3
Envelope Subtotal	-1,059	-854	0	-1,913	25.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,589	0	0	-1,589	21.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-718	0	-718	9.7	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-22	0	-22	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-3,166	0	0	-3,166	42.7	-
Grand Total	-5,814	-1,594	0	-7,409	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/14:00		
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0		
	Time		Percent	
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0
	0	0	0	0
	997	628	1,625	30
	0	0	0	0
	0	1,599	1,599	328
	0	0	0	0
	0	0	0	328
	0	-409	-409	1,359
	0	0	0	0
	0	0	0	0
	0	-112	-112	406
	0	0	0	0
	219	0	219	328
	1,217	1,706	2,923	-
	430	604	1,034	372
	0	133	133	372
	-	-	-	-
	1,015	1,280	2,295	372
	1,445	2,018	3,462	-
	-	-	-	-
	0	-427	-427	406
			0	372
			0	372
			0	0
	0	0	0	0
	-	-	-	-
	0	-69	-69	-
	0	-	0	-
	2	-	2	-
	2,663	3,229	5,892	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	64.5
Fan Heat TD	0.0

Airflows cfm	
Main Fan	284
Ventilation	41
Infiltration	10
Min Stop / Reheat	284

Engineering Checks	
% OA	31.61
cfm/ft²	.35
Btu/h-ft²	-19.94
cfm/ton	-209.61
ft²/ton	-602.33
People	4
ft²/person	99.97

Areas ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

RB-S-West_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-229	0	0	-229	10.7	-22.6
Door	0	0	0	0	0.0	0.0
Wall	0	-352	0	-352	16.5	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-16	0	-16	0.8	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	32	0	32	-1.5	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-134	0	0	-134	6.3	-1.2
Envelope Subtotal	-363	-336	0	-699	32.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-530	0	0	-530	24.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-235	0	-235	11.0	-1.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-8	0	-8	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-665	0	0	-665	31.1	-
Grand Total	-1,557	-579	0	-2,136	100.0	-

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Instant	Time Delay	Total	Percent of Total	Related Area
	Sensible	Sensible	Sensible	Total	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	0	0	0.0	0
	0	0	0	0.0	0
	138	61	199	12.3	10
	0	0	0	0.0	0
	0	232	232	14.3	122
	0	0	0	0.0	0
	0	0	0	0.0	122
	0	-29	-29	-1.8	441
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-29	-29	-1.8	135
	0	0	0	0.0	0
	52	0	52	3.2	122
	190	235	425	26.2	-
	143	227	370	22.8	124
	0	44	44	2.7	124
	-	-	-	-	-
	338	422	761	46.8	124
	482	693	1,175	72.2	-
	-	-	-	-	-
	0	36	36	2.2	135
			0	0.0	124
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-11	-11	-0.7	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	672	954	1,627	100.0	-

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	63.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	78
Ventilation	14
Infiltration	3
Min Stop / Reheat	78

Engineering Checks	
% OA	29.69
cfm/ft²	.37
Btu/h-ft²	-17.24
cfm/ton	-258.02
ft²/ton	-696.42
People	1
ft²/person	99.98

Areas ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

RB-W-North_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-365	0	0	-365	12.6	-20.5
Door	0	0	0	0	0.0	0.0
Wall	0	-830	0	-830	28.7	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	93	0	93	-3.2	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	40	0	40	-1.4	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	4.9	-0.5
Envelope Subtotal	-505	-697	0	-1,202	41.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-554	0	0	-554	19.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-225	0	-225	7.8	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-12	0	-12	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-898	0	0	-898	31.1	-
Grand Total	-1,958	-934	0	-2,892	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/10:00	
Outside Air (DB/WB/HR):			87.0 / 63.0 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
540	461	1,000	42.3	18
0	0	0	0.0	0
0	698	698	29.5	288
0	0	0	0.0	0
0	0	0	0.0	288
0	-176	-176	-7.4	288
0	0	0	0.0	0
0	0	0	0.0	0
0	-33	-33	-1.4	142
0	0	0	0.0	0
40	0	40	1.7	288
580	950	1,530	64.6	-
150	158	308	13.0	130
0	38	38	1.6	130
-	-	-	-	-
354	369	723	30.5	130
504	565	1,069	45.2	-
-	-	-	-	-
		0	0.0	0
0	-201	-201	-8.5	142
		0	0.0	130
		0	0.0	130
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-32	-32	-1.4	-
0	-	0	0.0	-
1	-	1	0.0	-
1,085	1,281	2,366	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	65.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	114
Ventilation	14
Infiltration	4
Min Stop / Reheat	114

Engineering Checks	
% OA	20.34
cfm/ft²	.54
Btu/h-ft²	-22.30
cfm/ton	-291.23
ft²/ton	-538.50
People	1
ft²/person	99.82

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-W-South_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,174	0	0	-1,174	11.9	-22.0
Door	0	0	0	0	0.0	0.0
Wall	0	-1,480	0	-1,480	15.0	-2.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	75	0	75	-0.8	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	106	0	106	-1.1	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-411	0	0	-411	4.2	-0.8
Envelope Subtotal	-1,585	-1,299	0	-2,884	29.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,622	0	0	-1,622	16.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-682	0	-682	6.9	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-39	0	-39	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-4,615	0	0	-4,615	46.9	-
Grand Total	-7,821	-2,020	0	-9,841	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/17:00		
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	2,140	1,519	3,659	44.0
	0	0	0	0.0
	0	2,194	2,194	26.4
	0	0	0	0.0
	0	0	0	0.0
	0	-641	-641	-7.7
	0	0	0	0.0
	0	0	0	0.0
	0	150	150	1.8
	0	0	0	0.0
	188	0	188	2.3
	2,328	3,221	5,549	66.7
	438	678	1,116	13.4
	0	135	135	1.6
	-	-	-	-
	1,036	1,299	2,335	28.1
	1,474	2,113	3,587	43.1
	-	-	-	-
	0	-680	-680	-8.2
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-137	-137	-1.7
	0	-	0	0.0
	3	-	3	0.0
	3,805	4,516	8,321	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	66.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	401
Ventilation	42
Infiltration	11
Min Stop / Reheat	401

Engineering Checks	
% OA	23.75
cfm/ft²	.46
Btu/h-ft²	-25.95
cfm/ton	-214.35
ft²/ton	-462.77
People	4
ft²/person	99.87

Areas ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

SHWR-N_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-4	0	-4	0.2	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-636	0	-636	24.9	-3.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-95	0	-95	3.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	48	0	48	-1.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-220	0	0	-220	8.6	-1.1
Envelope Subtotal	-220	-687	0	-907	35.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-428	0	-428	16.7	-1.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,220	0	0	-1,220	47.7	-
Grand Total	-1,441	-1,117	0	-2,558	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/14:00		
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	7	7	0.3
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	1,050	1,050	40.6
	0	0	0	0.0
	0	0	0	0.0
	0	-120	-120	-4.6
	0	0	0	0.0
	0	0	0	0.0
	0	-48	-48	-1.9
	0	0	0	0.0
	120	0	120	4.6
	120	889	1,009	39.0
	399	747	1,146	44.2
	184	357	541	20.9
	-	-	-	-
	0	0	0	0.0
	583	1,103	1,686	65.1
	-	-	-	-
	0	-96	-96	-3.7
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-11	-11	-0.4
	0	-	0	0.0
	1	-	1	0.0
	704	1,886	2,590	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	125
Ventilation	0
Infiltration	6
Min Stop / Reheat	125

Engineering Checks	
% OA	.00
cfm/ft²	.32
Btu/h-ft²	-12.57
cfm/ton	-306.03
ft²/ton	-955.19
People	4
ft²/person	50.03

Areas ft²	
Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

SHWR-S_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	of	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	Total	ft²
					(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-651	0	-651	28.6	-3.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-87	0	-87	3.8	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	49	0	49	-2.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-224	0	0	-224	9.9	-1.1
Envelope Subtotal	-224	-690	0	-914	40.2	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-413	0	-413	18.1	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-945	0	0	-945	41.5	-
Grand Total	-1,169	-1,105	0	-2,275	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/18:00			
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0			
	Time	Percent		Related	
	Instant	Delay	Total	of	Area
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	432	432	18.8	206
	0	0	0	0.0	0
	0	0	0	0.0	206
	0	-22	-22	-1.0	845
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-55	-55	-2.4	229
	0	0	0	0.0	0
	87	0	87	3.8	206
	87	355	441	19.2	-
	406	783	1,189	51.6	207
	187	374	561	24.4	207
	-	-	-	-	-
	0	0	0	0.0	207
	593	1,157	1,750	76.0	-
	-	-	-	-	-
	0	117	117	5.1	229
			0	0.0	207
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-6	-6	-0.3	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	681	1,622	2,303	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	111
Ventilation	0
Infiltration	6
Min Stop / Reheat	111

Engineering Checks	
% OA	.00
cfm/ft²	.31
Btu/h-ft²	-10.99
cfm/ton	-342.09
ft²/ton	-1,092.99
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

SHWR-W_System 2 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-649	0	-649	25.5	-3.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-111	0	-111	4.4	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	49	0	49	-1.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-224	0	0	-224	8.8	-1.2
Envelope Subtotal	-224	-711	0	-935	36.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-426	0	-426	16.7	-1.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,183	0	0	-1,183	46.4	-
Grand Total	-1,407	-1,140	0	-2,548	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/11:00			
Outside Air (DB/WB/HR):		91.7 / 64.5 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	1,030	1,030	40.0	204
	0	0	0	0.0	0
	0	0	0	0.0	204
	0	-54	-54	-2.1	849
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-34	-34	-1.3	229
	0	0	0	0.0	0
	88	0	88	3.4	204
	88	943	1,031	40.0	-
	406	689	1,095	42.5	207
	187	329	516	20.0	207
	-	-	-	-	-
	0	0	0	0.0	207
	593	1,018	1,611	62.5	-
	-	-	-	-	-
	0	-53	-53	-2.1	229
			0	0.0	207
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-11	-11	-0.4	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	682	1,897	2,579	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	124
Ventilation	0
Infiltration	6
Min Stop / Reheat	124

Engineering Checks	
% OA	.00
cfm/ft²	.32
Btu/h-ft²	-12.31
cfm/ton	-313.45
ft²/ton	-975.38
People	4
ft²/person	50.02

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ACT-Noisy-1_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent			
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	Btu/h
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	per
						ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-334	0	0	-334	8.6	-21.5
Door	0	-545	0	-545	14.0	-26.0
Wall	0	-420	0	-420	10.8	-2.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	142	0	142	-3.6	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	51	0	51	-1.3	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-195	0	0	-195	5.0	-1.2
Envelope Subtotal	-528	-773	0	-1,301	33.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,465	0	0	-1,465	37.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-309	0	-309	8.0	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-27	0	-27	0.7	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-784	0	0	-784	20.2	-
Grand Total	-2,777	-1,109	0	-3,887	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/18:00	
Outside Air (DB/WB/HR):			91.4 / 64.4 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
207	79	286	11.7	16
0	386	386	15.8	21
0	277	277	11.3	174
0	0	0	0.0	0
0	0	0	0.0	174
0	-175	-175	-7.1	494
0	0	0	0.0	0
0	0	0	0.0	0
0	-44	-44	-1.8	193
0	0	0	0.0	0
75	0	75	3.1	174
282	523	806	32.9	-
377	613	990	40.4	180
121	221	342	13.9	180
-	-	-	-	-
184	144	328	13.4	180
682	978	1,660	67.8	-
-	-	-	-	-
		0	0.0	0
0	10	10	0.4	193
		0	0.0	180
		0	0.0	180
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-25	-25	-1.0	-
0	-	0	0.0	-
-1	-	-1	-0.1	-
963	1,486	2,449	100.0	

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	57.9
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	118
Ventilation	38
Infiltration	5
Min Stop / Reheat	118

Engineering Checks	
% OA	47.24
cfm/ft²	.44
Btu/h-ft²	-21.65
cfm/ton	-246.59
ft²/ton	-554.65
People	4
ft²/person	50.04

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ACT-Noisy-2_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-525	0	-525	13.7	-25.0
Wall	0	-221	0	-221	5.8	-2.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	23	0	23	-0.6	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	45	0	45	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-196	0	0	-196	5.1	-2.2
Envelope Subtotal	-196	-678	0	-873	22.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,475	0	0	-1,475	38.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-352	0	-352	9.1	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-17	0	-17	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,128	0	0	-1,128	29.3	-
Grand Total	-2,799	-1,046	0	-3,845	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/09:00		
Outside Air (DB/WB/HR):		81.8 / 61.2 / 0.0		
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	978	978	40.8
	0	335	335	14.0
	0	0	0	0.0
	0	0	0	0.0
	0	-279	-279	-11.6
	0	0	0	0.0
	0	0	0	0.0
	0	-23	-23	-1.0
	0	0	0	0.0
	32	0	32	1.3
	32	1,011	1,043	43.5
	380	509	889	37.1
	122	184	305	12.7
	-	-	-	-
	185	120	305	12.7
	687	813	1,499	62.6
	-	-	-	-
	0	-92	-92	-3.9
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-52	-52	-2.2
	0	-	0	0.0
	-1	-	-1	0.0
	717	1,680	2,397	100.0

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	57.5
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	116
Ventilation	38
Infiltration	5
Min Stop / Reheat	116

Engineering Checks	
% OA	62.72
cfm/ft²	.33
Btu/h-ft²	-21.28
cfm/ton	-189.03
ft²/ton	-564.40
People	4
ft²/person	49.96

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ACT-Noisy-3_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-155	0	0	-155	4.1	-19.9
Door	0	-503	0	-503	13.3	-24.0
Wall	0	-388	0	-388	10.2	-2.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	139	0	139	-3.7	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	52	0	52	-1.4	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-197	0	0	-197	5.2	-1.3
Envelope Subtotal	-352	-701	0	-1,053	27.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,486	0	0	-1,486	39.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-490	0	-490	12.9	-2.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-20	0	-20	0.5	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-745	0	0	-745	19.6	-
Grand Total	-2,582	-1,212	0	-3,794	100.0	

Fan Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time		Percent		Related	
	Instant	Delay		of		
	Sensible	Sensible	Total	Total	Area	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	118	28	146	6.3	8	
	0	381	381	16.3	21	
	0	290	290	12.4	161	
	0	0	0	0.0	0	
	0	0	0	0.0	161	
	0	-205	-205	-8.8	511	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	0	-43	-43	-1.8	196	
	0	0	0	0.0	0	
	109	0	109	4.7	161	
	227	451	678	29.1	-	
	382	587	969	41.5	182	
	122	211	334	14.3	182	
	-	-	-	-	-	
	186	138	324	13.9	182	
	691	936	1,628	69.7	-	
	-	-	-	-	-	
	0	50	50	2.1	196	
			0	0.0	182	
			0	0.0	0	
	0	0	0	0.0	0	
	-	-	-	-	-	
	0	-20	-20	-0.9	-	
	0	-	0	0.0	-	
	-1	-	-1	-0.1	-	
	917	1,417	2,334	100.0		

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	57.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	113
Ventilation	38
Infiltration	5
Min Stop / Reheat	113

Engineering Checks	
% OA	50.17
cfm/ft²	.42
Btu/h-ft²	-20.84
cfm/ton	-241.19
ft²/ton	-576.09
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ACT-Quiet-1_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/01:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-95	0	-95	3.9	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	26	0	26	-1.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	5.9	0.0
Envelope Subtotal	-141	-69	0	-211	8.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,063	0	0	-1,063	44.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-282	0	-282	11.7	-2.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-855	0	0	-855	35.4	-
Grand Total	-2,059	-352	0	-2,411	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/18:00			
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0			
	Time		Percent		Related Area
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-11	-11	-0.8	575
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-41	-41	-3.0	142
	0	0	0	0.0	0
	55	0	55	4.0	0
	55	-51	3	0.2	-
	274	476	750	55.0	130
	88	172	260	19.0	130
	-	-	-	-	-
	133	112	246	18.0	130
	495	761	1,255	92.1	-
	-	-	-	-	-
	0	110	110	8.1	142
			0	0.0	130
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.3	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	548	815	1,363	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	54.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	66
Ventilation	27
Infiltration	4
Min Stop / Reheat	66

Engineering Checks	
% OA	113.81
cfm/ft²	.18
Btu/h-ft²	-18.51
cfm/ton	-119.74
ft²/ton	-648.78
People	3
ft²/person	49.94

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-2_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-170	0	0	-170	5.8	-21.9
Door	0	0	0	0	0.0	0.0
Wall	0	-125	0	-125	4.2	-2.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-93	0	-93	3.2	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	30	0	30	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	4.8	-3.1
Envelope Subtotal	-312	-187	0	-499	16.9	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,065	0	0	-1,065	36.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-263	0	-263	8.9	-1.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-6	0	-6	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,112	0	0	-1,112	37.7	-
Grand Total	-2,489	-457	0	-2,945	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/17:00			
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	324	219	543	28.5	8
	0	0	0	0.0	0
	0	228	228	12.0	48
	0	0	0	0.0	0
	0	0	0	0.0	48
	0	-126	-126	-6.6	528
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-6	-6	-0.3	142
	0	0	0	0.0	0
	65	0	65	3.4	48
	388	315	703	37.0	-
	274	484	759	39.9	131
	88	174	262	13.8	131
	-	-	-	-	-
	134	114	248	13.0	131
	496	773	1,269	66.7	-
	-	-	-	-	-
	0	-44	-44	-2.3	142
			0	0.0	131
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-24	-24	-1.3	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	883	1,019	1,902	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	58.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	92
Ventilation	27
Infiltration	4
Min Stop / Reheat	92

Engineering Checks	
% OA	73.20
cfm/ft²	.29
Btu/h-ft²	-22.56
cfm/ton	-152.67
ft²/ton	-532.19
People	3
ft²/person	50.05

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-3_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-400	0	-400	15.6	-3.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-16	0	-16	0.6	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	31	0	31	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-142	0	0	-142	5.5	-1.2
Envelope Subtotal	-142	-385	0	-527	20.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,069	0	0	-1,069	41.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-260	0	-260	10.2	-1.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-2	0	-2	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-701	0	0	-701	27.4	-
Grand Total	-1,913	-647	0	-2,559	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	261	261	17.3
	0	0	0	0.0
	0	0	0	0.0
	0	-96	-96	-6.4
	0	0	0	0.0
	0	-39	-39	-2.6
	0	0	0	0.0
	73	0	73	4.8
	73	126	198	13.2
	275	477	752	49.9
	88	172	260	17.3
	-	-	-	-
	134	112	246	16.3
	498	761	1,258	83.5
	-	-	-	-
	0	56	56	3.7
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-5	-5	-0.3
	0	-	0	0.0
	-1	-	-1	-0.1
	570	937	1,507	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	55.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	73
Ventilation	28
Infiltration	4
Min Stop / Reheat	73

Engineering Checks	
% OA	71.61
cfm/ft²	.29
Btu/h-ft²	-19.53
cfm/ton	-180.32
ft²/ton	-614.73
People	3
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Admin_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/04:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-409	0	-409	8.9	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-342	0	0	-342	7.5	-22.0
Door	0	0	0	0	0.0	0.0
Wall	0	-618	0	-618	13.5	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	69	0	69	-1.5	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	47	0	47	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-205	0	0	-205	4.5	-1.0
Envelope Subtotal	-548	-910	0	-1,458	31.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	32	0	0	32	-0.7	0.2
Internal Subtotal	32	0	0	32	-0.7	-
Ventilation	-809	0	0	-809	17.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-13	0	-13	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-2,339	0	0	-2,339	51.0	-
Grand Total	-3,663	-923	0	-4,586	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Time	Percent		Related Area (ft²)
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	599	599	15.7
	0	0	0	0.0
	629	506	1,135	29.7
	0	0	0	0.0
	0	1,204	1,204	31.5
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-238	-238	-6.2
	0	0	0	0.0
	0	0	0	0.0
	0	13	13	0.4
	0	0	0	0.0
	94	0	94	2.4
	722	2,085	2,807	73.4
	199	271	470	12.3
	194	297	491	12.8
	-	-	-	-
	97	0	97	2.5
	489	569	1,058	27.7
	-	-	-	-
			0	0.0
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-42	-42	-1.1
	0	-	0	0.0
	0	-	0	0.0
	1,212	2,612	3,823	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	65.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	184
Ventilation	21
Infiltration	5
Min Stop / Reheat	184

Engineering Checks	
% OA	29.70
cfm/ft²	.37
Btu/h-ft²	-24.24
cfm/ton	-183.54
ft²/ton	-495.40
People	2
ft²/person	100.19

Areas ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Chart/Hotel_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-39	0	-39	1.6	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-140	0	-140	5.6	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	36	0	36	-1.5	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-216	0	0	-216	8.7	0.0
Envelope Subtotal	-216	-143	0	-359	14.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	34	0	0	34	-1.4	0.2
Internal Subtotal	34	0	0	34	-1.4	-
Ventilation	-853	0	0	-853	34.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-215	0	-215	8.7	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,095	0	0	-1,095	44.0	-
Grand Total	-2,130	-359	0	-2,489	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/19:00	
Outside Air (DB/WB/HR):			86.7 / 62.9 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	25	25	1.5	21
0	0	0	0.0	21
0	0	0	0.0	0
0	0	0	0.0	0
0	0	0	0.0	0
0	0	0	0.0	0
0	0	0	0.0	0
0	86	86	5.2	707
0	0	0	0.0	0
0	0	0	0.0	0
0	-18	-18	-1.1	214
0	0	0	0.0	0
60	0	60	3.6	0
60	93	154	9.3	-
210	294	503	30.4	200
204	322	526	31.8	200
-	-	-	-	-
340	0	340	20.6	200
754	616	1,370	82.7	-
-	-	-	-	-
		0	0.0	0
0	136	136	8.2	193
		0	0.0	200
		0	0.0	200
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-4	-4	-0.2	-
0	-	0	0.0	-
0	-	0	0.0	-
815	841	1,656	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	59.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	80
Ventilation	22
Infiltration	6
Min Stop / Reheat	80

Engineering Checks	
% OA	83.27
cfm/ft²	.13
Btu/h-ft²	-12.48
cfm/ton	-127.16
ft²/ton	-962.37
People	2
ft²/person	99.79

Areas ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Comfort/Consult_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-521	0	-521	8.0	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	-478	0	0	-478	7.4	-20.5
Door	0	0	0	0	0.0	0.0
Wall	0	-932	0	-932	14.4	-2.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	136	0	136	-2.1	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	71	0	71	-1.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	-478	-1,245	0	-1,723	26.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,808	0	0	-2,808	43.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-144	0	-144	2.2	-4.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-18	0	-18	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,790	0	0	-1,790	27.6	-
Grand Total	-5,075	-1,407	0	-6,482	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Time	Percent		Related Area (ft²)
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	1,088	1,088	29.2
	0	0	0	0.0
	344	104	447	12.0
	0	0	0	0.0
	0	698	698	18.8
	0	0	0	0.0
	0	0	0	0.0
	0	-251	-251	-6.8
	0	0	0	0.0
	0	0	0	0.0
	0	-28	-28	-0.8
	0	0	0	0.0
	0	0	0	0.0
	344	1,610	1,954	52.5
	298	408	706	19.0
	0	350	350	9.4
	-	-	-	-
	435	288	723	19.4
	733	1,046	1,779	47.8
	-	-	-	-
	0	13	13	0.3
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-26	-26	-0.7
	0	-	0	0.0
	0	-	0	0.0
	1,077	2,643	3,720	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	54.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	179
Ventilation	72
Infiltration	0
Min Stop / Reheat	179

Engineering Checks	
% OA	78.67
cfm/ft²	.32
Btu/h-ft²	-22.89
cfm/ton	-170.14
ft²/ton	-524.70
People	3
ft²/person	100.16

Areas ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Entry/Waiting_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-95	0	-95	0.8	-1.7
Other Roof	0	0	0	0	0.0	0.0
Glass	-4,466	0	0	-4,466	35.3	-17.3
Door	0	-642	0	-642	5.1	-23.0
Wall	0	-937	0	-937	7.4	-1.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	666	0	666	-5.3	1.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	169	0	169	-1.3	0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-401	0	0	-401	3.2	-0.7
Envelope Subtotal	-4,867	-840	0	-5,707	45.1	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,223	0	0	-1,223	9.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-1,106	0	-1,106	8.7	-3.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-124	0	-124	1.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-4,494	0	0	-4,494	35.5	-
Grand Total	-10,585	-2,070	0	-12,654	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/14:00		
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	41	41	0.4
	0	0	0	0.0
	6,334	5,796	12,130	104.8
	0	818	818	7.1
	0	1,171	1,171	10.1
	0	0	0	0.0
	0	0	0	0.0
	0	-1,219	-1,219	-10.5
	0	0	0	0.0
	0	0	0	0.0
	0	-460	-460	-4.0
	0	0	0	0.0
	140	0	140	1.2
	6,474	6,148	12,621	109.1
	182	254	436	3.8
	307	441	748	6.5
	-	-	-	-
	0	0	0	0.0
	489	695	1,184	10.2
	-	-	-	-
	0	-1,948	-1,948	-16.8
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-287	-287	-2.5
	0	-	0	0.0
	-2	-	-2	0.0
	6,960	4,609	11,569	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	67.9
Fan Heat TD	0.0

Airflows cfm	
Main Fan	557
Ventilation	31
Infiltration	10
Min Stop / Reheat	557

Engineering Checks	
% OA	9.31
cfm/ft²	.91
Btu/h-ft²	-34.18
cfm/ton	-320.82
ft²/ton	-351.27
People	2
ft²/person	200.24

Areas ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Exam/Storage_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/01:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-493	0	-493	14.3	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-89	0	-89	2.6	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	42	0	42	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-109	0	0	-109	3.2	0.0
Envelope Subtotal	-109	-539	0	-648	18.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	4	0	0	4	-0.1	0.0
Internal Subtotal	4	0	0	4	-0.1	-
Ventilation	-1,453	0	0	-1,453	42.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,351	0	0	-1,351	39.2	-
Grand Total	-2,909	-541	0	-3,449	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	957	957	47.3
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-30	-30	-1.5
	0	0	0	0.0
	0	0	0	0.0
	0	-13	-13	-0.6
	0	0	0	0.0
	60	0	60	3.0
	60	914	974	48.2
	182	248	430	21.3
	58	241	299	14.8
	-	-	-	-
	202	124	326	16.1
	442	613	1,056	52.2
	-	-	-	-
			0	0.0
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-9	-9	-0.5
	0	-	0	0.0
	0	-	0	0.0
	503	1,518	2,021	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	55.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	97
Ventilation	37
Infiltration	3
Min Stop / Reheat	97

Engineering Checks	
% OA	118.91
cfm/ft²	.14
Btu/h-ft²	-15.43
cfm/ton	-109.49
ft²/ton	-778.26
People	2
ft²/person	129.32

Areas ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

Group_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-272	0	-272	3.7	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	-324	0	0	-324	4.4	-20.9
Door	0	0	0	0	0.0	0.0
Wall	0	-835	0	-835	11.3	-2.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	135	0	135	-1.8	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	80	0	80	-1.1	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-299	0	0	-299	4.1	-1.1
Envelope Subtotal	-624	-893	0	-1,516	20.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-3,543	0	0	-3,543	48.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-585	0	-585	7.9	-3.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-13	0	-13	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,706	0	0	-1,706	23.2	-
Grand Total	-5,873	-1,491	0	-7,364	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/15:00	
Outside Air (DB/WB/HR):			98.8 / 66.7 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	586	586	15.1	146
0	0	0	0.0	146
223	104	327	8.5	16
0	0	0	0.0	0
0	611	611	15.8	295
0	0	0	0.0	0
0	0	0	0.0	295
0	-186	-186	-4.8	570
0	0	0	0.0	0
0	0	0	0.0	0
0	-64	-64	-1.6	294
0	0	0	0.0	0
166	0	166	4.3	295
389	1,051	1,440	37.2	-
553	780	1,332	34.5	276
227	345	572	14.8	276
-	-	-	-	-
283	185	468	12.1	276
1,062	1,310	2,372	61.4	-
-	-	-	-	-
		0	0.0	0
0	81	81	2.1	149
		0	0.0	276
		0	0.0	276
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-25	-25	-0.7	-
0	-	0	0.0	-
-2	-	-2	-0.1	-
1,449	2,416	3,865	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	51.5
Fan Heat TD	0.0

Airflows cfm	
Main Fan	186
Ventilation	91
Infiltration	8
Min Stop / Reheat	186

Engineering Checks	
% OA	88.46
cfm/ft²	.37
Btu/h-ft²	-26.66
cfm/ton	-168.08
ft²/ton	-450.45
People	6
ft²/person	49.99

Areas ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Hospitality_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-237	0	-237	3.6	-1.8
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-782	0	-782	12.0	-3.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-135	0	-135	2.1	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	71	0	71	-1.1	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-266	0	0	-266	4.1	-1.1
Envelope Subtotal	-266	-1,083	0	-1,349	20.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-3,153	0	0	-3,153	48.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-522	0	-522	8.0	-3.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-4	0	-4	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,512	0	0	-1,512	23.1	-
Grand Total	-4,931	-1,609	0	-6,540	100.0	-

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	489	489	14.3	129
	0	0	0	0.0	129
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	579	579	16.9	260
	0	0	0	0.0	0
	0	0	0	0.0	260
	0	94	94	2.7	528
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-25	-25	-0.7	262
	0	0	0	0.0	0
	148	0	148	4.3	260
	148	1,137	1,284	37.5	-
	492	684	1,176	34.3	246
	202	305	507	14.8	246
	-	-	-	-	-
	252	163	415	12.1	246
	946	1,152	2,098	61.2	-
	-	-	-	-	-
	0	58	58	1.7	133
			0	0.0	246
			0	0.0	246
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-12	-12	-0.3	-
	0	-	0	0.0	-
	-2	-	-2	-0.1	-
	1,091	2,335	3,426	100.0	-

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	51.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	165
Ventilation	81
Infiltration	7
Min Stop / Reheat	165

Engineering Checks	
% OA	88.80
cfm/ft²	.37
Btu/h-ft²	-26.60
cfm/ton	-167.78
ft²/ton	-451.44
People	5
ft²/person	50.01

Areas ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Intake-HR-A_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-841	0	-841	8.8	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-673	0	-673	7.1	-26.2
Wall	0	-1,284	0	-1,284	13.5	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	61	0	61	-0.6	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	117	0	117	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-177	0	0	-177	1.9	-0.4
Envelope Subtotal	-177	-2,619	0	-2,796	29.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,695	0	0	-2,695	28.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-314	0	-314	3.3	-4.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-29	0	-29	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-3,683	0	0	-3,683	38.7	-
Grand Total	-6,555	-2,962	0	-9,517	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Time	Percent		Related Area (ft²)
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	1,274	1,274	18.4
	0	0	0	0.0
	0	0	0	0.0
	0	1,430	1,430	20.7
	0	1,694	1,694	24.5
	0	0	0	0.0
	0	0	0	0.0
	0	-169	-169	-2.4
	0	0	0	0.0
	0	0	0	0.0
	0	-19	-19	-0.3
	0	0	0	0.0
	81	0	81	1.2
	81	4,209	4,290	62.1
	404	559	964	14.0
	72	494	566	8.2
	-	-	-	-
	362	234	595	8.6
	838	1,287	2,125	30.8
	-	-	-	-
	0	23	23	0.3
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-92	-92	-1.3
	560	-	560	8.1
	0	-	0	0.0
	1,479	5,426	6,905	100.0

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	62.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	333
Ventilation	69
Infiltration	5
Min Stop / Reheat	333

Engineering Checks	
% OA	45.32
cfm/ft²	.33
Btu/h-ft²	-20.24
cfm/ton	-193.02
ft²/ton	-593.29
People	4
ft²/person	118.82

Areas ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	0
Door	26
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

Intake-HR-B_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-367	0	-367	13.9	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-85	0	-85	3.2	-3.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-114	0	-114	4.3	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	33	0	33	-1.3	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-88	0	0	-88	3.3	-3.4
Envelope Subtotal	-88	-532	0	-620	23.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	3	0	0	3	-0.1	0.0
Internal Subtotal	3	0	0	3	-0.1	-
Ventilation	-1,018	0	0	-1,018	38.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,004	0	0	-1,004	38.0	-
Grand Total	-2,106	-534	0	-2,640	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/15:00	
Outside Air (DB/WB/HR):			98.8 / 66.7 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	709	709	43.2	183
0	0	0	0.0	183
0	0	0	0.0	0
0	0	0	0.0	0
0	96	96	5.8	27
0	0	0	0.0	0
0	0	0	0.0	27
0	43	43	2.6	894
0	0	0	0.0	0
0	0	0	0.0	0
0	-9	-9	-0.6	183
0	0	0	0.0	0
48	0	48	3.0	27
48	838	886	54.0	-
130	181	312	19.0	165
47	178	225	13.7	165
-	-	-	-	-
139	86	225	13.7	165
316	446	762	46.4	-
-	-	-	-	-
		0	0.0	0
0	0	0	0.0	0
		0	0.0	165
		0	0.0	165
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-7	-7	-0.4	-
0	-	0	0.0	-
0	-	0	0.0	-
365	1,277	1,641	100.0	

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	57.4
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	79
Ventilation	26
Infiltration	2
Min Stop / Reheat	79

Engineering Checks	
% OA	87.06
cfm/ft²	.18
Btu/h-ft²	-16.05
cfm/ton	-136.94
ft²/ton	-748.26
People	1
ft²/person	132.76

Areas	
	ft²
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

Lounge_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/20:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-628	0	-628	7.0	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-343	0	0	-343	3.8	-22.1
Door	0	-545	0	-545	6.0	-26.0
Wall	0	-658	0	-658	7.3	-2.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	137	0	137	-1.5	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	77	0	77	-0.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-321	0	0	-321	3.6	-1.3
Envelope Subtotal	-664	-1,618	0	-2,282	25.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,535	0	0	-2,535	28.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-30	0	-30	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-4,181	0	0	-4,181	46.3	-
Grand Total	-7,380	-1,648	0	-9,028	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/17:00		
Outside Air (DB/WB/HR):		94.5 / 65.4 / 0.0		
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
0	941	941	14.3	322
0	0	0	0.0	322
623	514	1,137	17.3	16
0	1,147	1,147	17.5	21
0	1,287	1,287	19.6	250
0	0	0	0.0	0
0	0	0	0.0	250
0	-361	-361	-5.5	987
0	0	0	0.0	0
0	0	0	0.0	0
0	-6	-6	-0.1	322
0	0	0	0.0	0
147	0	147	2.2	250
770	3,521	4,291	65.4	-
589	841	1,430	21.8	297
251	372	623	9.5	297
-	-	-	-	-
202	128	331	5.0	297
1,043	1,341	2,385	36.3	-
-	-	-	-	-
0	0	0	0.0	0
0	0	0	0.0	297
0	0	0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-105	-105	-1.6	-
0	-	0	0.0	-
-5	-	-5	-0.1	-
1,809	4,757	6,566	100.0	-

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	62.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	317
Ventilation	65
Infiltration	8
Min Stop / Reheat	317

Engineering Checks	
% OA	57.88
cfm/ft²	.38
Btu/h-ft²	-30.45
cfm/ton	-149.89
ft²/ton	-394.39
People	6
ft²/person	50.04

Areas ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	16
Door	21
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

Multipurpose/Dining_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-495	0	-495	3.9	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	-487	0	0	-487	3.8	-20.9
Door	0	-523	0	-523	4.1	-24.9
Wall	0	-838	0	-838	6.6	-2.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	227	0	227	-1.8	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	144	0	144	-1.1	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-526	0	0	-526	4.1	-1.7
Envelope Subtotal	-1,012	-1,485	0	-2,497	19.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-6,220	0	0	-6,220	49.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-944	0	-944	7.4	-3.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-34	0	-34	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-2,979	0	0	-2,979	23.5	-
Grand Total	-10,212	-2,463	0	-12,675	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/15:00			
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0			
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	1,090	1,090	16.7	266
	0	0	0	0.0	266
	330	150	480	7.4	23
	0	365	365	5.6	21
	0	615	615	9.4	322
	0	0	0	0.0	0
	0	0	0	0.0	322
	0	-329	-329	-5.0	788
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-95	-95	-1.5	508
	0	0	0	0.0	0
	291	0	291	4.5	322
	621	1,796	2,417	37.0	-
	971	1,294	2,265	34.7	485
	398	574	972	14.9	485
	-	-	-	-	-
	497	307	804	12.3	485
	1,866	2,175	4,041	61.9	-
	-	-	-	-	-
	0	124	124	1.9	242
			0	0.0	485
			0	0.0	485
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-49	-49	-0.7	-
	0	-	0	0.0	-
	-4	-	-4	-0.1	-
	2,483	4,046	6,529	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	50.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	315
Ventilation	160
Infiltration	14
Min Stop / Reheat	315

Engineering Checks	
% OA	94.53
cfm/ft²	.35
Btu/h-ft²	-26.13
cfm/ton	-160.45
ft²/ton	-459.55
People	10
ft²/person	49.99

Areas ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Servery_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/01:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	of	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	Total	ft²
					(%)	
Roof	0	-235	0	-235	4.0	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-494	0	-494	8.4	-3.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-21	0	-21	0.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	60	0	60	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-247	0	0	-247	4.2	-1.6
Envelope Subtotal	-247	-690	0	-937	16.0	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,925	0	0	-2,925	49.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-474	0	-474	8.1	-4.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-4	0	-4	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1,533	0	0	-1,533	26.1	-
Grand Total	-4,705	-1,168	0	-5,872	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Time	Percent		Related
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	499	499	16.7
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	357	357	12.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-38	-38	-1.3
	0	0	0	0.0
	0	0	0	0.0
	0	-29	-29	-1.0
	0	0	0	0.0
	137	0	137	4.6
	137	790	927	31.1
	456	659	1,115	37.4
	187	292	480	16.1
	-	-	-	-
	234	156	390	13.1
	877	1,108	1,985	66.6
	-	-	-	-
	0	84	84	2.8
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-11	-11	-0.4
	0	-	0	0.0
	-2	-	-2	-0.1
	1,012	1,970	2,982	100.0

Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	50.2
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	144
Ventilation	75
Infiltration	6
Min Stop / Reheat	144

Engineering Checks	
% OA	108.35
cfm/ft²	.30
Btu/h-ft²	-25.75
cfm/ton	-142.05
ft²/ton	-466.30
People	5
ft²/person	50.04

Areas	
	ft²
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Support_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-1,109	0	-1,109	12.2	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-1,090	0	-1,090	12.0	-26.0
Wall	0	-1,572	0	-1,572	17.2	-2.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	137	0	137	-1.5	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	137	0	137	-1.5	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	00	-3,497	0	-3,497	38.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	179	0	0	179	-2.0	0.3
Internal Subtotal	179	0	0	179	-2.0	-
Ventilation	-1,222	0	0	-1,222	13.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-40	0	-40	0.4	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-4,539	0	0	-4,539	49.8	-
Grand Total	-5,582	-3,537	0	-9,119	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/15:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,760	1,760	22.0	569
	0	0	0	0.0	569
	0	0	0	0.0	0
	0	1,892	1,892	23.7	42
	0	2,505	2,505	31.3	543
	0	0	0	0.0	0
	0	0	0	0.0	543
	0	-330	-330	-4.1	1,625
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-17	-17	-0.2	569
	0	0	0	0.0	0
	0	0	0	0.0	543
	0	5,810	5,810	72.7	-
	0	0	0	0.0	524
	459	659	1,118	14.0	524
	-	-	-	-	-
	537	0	537	6.7	524
	995	659	1,654	20.7	-
	-	-	-	-	-
	0	0	0	0.0	0
	0	0	0	0.0	524
	0	0	0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-101	-101	-1.3	-
	630	-	630	7.9	-
	-2	-	-2	0.0	-
	1,624	6,369	7,992	100.0	

Temperatures °F	
Supply	90.0
Return	70.0
Mixed Air	66.9
Fan Heat TD	0.0

Airflows cfm	
Main Fan	385
Ventilation	31
Infiltration	0
Min Stop / Reheat	385

Engineering Checks	
% OA	19.20
cfm/ft²	.31
Btu/h-ft²	-17.41
cfm/ton	-215.53
ft²/ton	-689.75
People	
ft²/person	.00

Areas ft²	
Roof	569
Other Roof	569
Ceiling	0
Window	0
Door	42
Wall	543
Below-Grade Wall	0
Other Wall	543
Partition	1,625
Exterior Floor	0
Internal Floor	0
Slab	569
Other Floor	0

Utility_System 4 - 2007/2010/2013

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-5,756	0	-5,756	17.2	-2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-761	0	-761	2.3	-27.2
Wall	0	-254	0	-254	0.8	-2.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-2,330	0	-2,330	6.9	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	591	0	591	-1.8	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-2,044	0	0	-2,044	6.1	-19.7
Envelope Subtotal	-2,044	-8,511	0	-10,554	31.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	82	0	0	82	-0.2	0.0
Internal Subtotal	82	0	0	82	-0.2	-
Ventilation	-6,377	0	0	-6,377	19.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-485	0	-485	1.4	-1.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-43	0	-43	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-16,166	0	0	-16,166	48.2	-
Grand Total	-24,504	-9,039	0	-33,543	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	10,183	10,183	46.3	2,903
	0	0	0	0.0	2,903
	0	0	0	0.0	0
	0	1,598	1,598	7.3	28
	0	351	351	1.6	109
	0	0	0	0.0	0
	0	0	0	0.0	109
	0	3,977	3,977	18.1	13,149
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-55	-55	-0.3	3,198
	0	0	0	0.0	0
	1,047	0	1,047	4.8	109
	1,047	16,055	17,102	77.7	-
	724	1,042	1,766	8.0	2,927
	698	2,355	3,054	13.9	2,927
	-	-	-	-	-
	247	0	247	1.1	2,927
	1,670	3,397	5,067	23.0	-
	-	-	-	-	-
	0	-5	-5	0.0	295
			0	0.0	2,927
			0	0.0	2,927
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-162	-162	-0.7	-
	0	-	0	0.0	-
	-3	-	-3	0.0	-
	2,714	19,284	21,998	100.0	

Temperatures °F	
Supply	95.0
Return	70.0
Mixed Air	64.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	1,060
Ventilation	164
Infiltration	53
Min Stop / Reheat	1,060

Engineering Checks	
% OA	15.49
cfm/ft²	.36
Btu/h-ft²	-11.47
cfm/ton	-379.22
ft²/ton	-1,046.94
People	7
ft²/person	409.31

Areas ft²	
Roof	2,903
Other Roof	2,903
Ceiling	295
Window	0
Door	28
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

Kitchen_System 4 - 2007/2010/2013_Copy

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-1,401	0	-1,401	2.1	-1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-1,287	0	-1,287	1.9	-26.3
Wall	0	-1,698	0	-1,698	2.6	-2.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-251	0	-251	0.4	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	192	0	192	-0.3	0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-742	0	0	-742	1.1	-1.3
Envelope Subtotal	-742	-4,445	0	-5,188	7.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	13	0	0	13	0.0	0.0
Internal Subtotal	13	0	0	13	0.0	-
Ventilation	-9,113	0	0	-9,113	13.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-46	0	-46	0.1	-
Sizing Factor Correction	-49,886	-	0	-49,886	75.1	-
Over/Undersizing	-2,177	0	0	-2,177	3.3	-
Grand Total	-61,905	-4,491	0	-66,396	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	2,874	2,874	5.0
	0	0	0	0.0
	0	0	0	0.0
	0	2,645	2,645	4.6
	0	1,231	1,231	2.1
	0	0	0	0.0
	0	0	0	0.0
	0	-1,204	-1,204	-2.1
	0	0	0	0.0
	0	0	0	0.0
	0	-344	-344	-0.6
	0	0	0	0.0
	380	0	380	0.7
	380	5,203	5,584	9.6
	1,375	1,883	3,258	5.6
	401	619	1,021	1.8
	-	-	-	-
	13,333	8,793	22,126	38.2
	15,110	11,295	26,405	45.6
	-	-	-	-
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-167	-167	-0.3
	26,137	-	26,137	45.1
	-32	-	-32	-0.1
	41,595	16,332	57,926	100.0


Temperatures	
	°F
Supply	90.0
Return	70.0
Mixed Air	66.8
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	2,793
Ventilation	235
Infiltration	19
Min Stop / Reheat	2,793

Engineering Checks	
% OA	92.16
cfm/ft²	.37
Btu/h-ft²	-96.92
cfm/ton	-46.01
ft²/ton	-123.89
People	13
ft²/person	52.37

Areas	
	ft²
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Envelope Summary

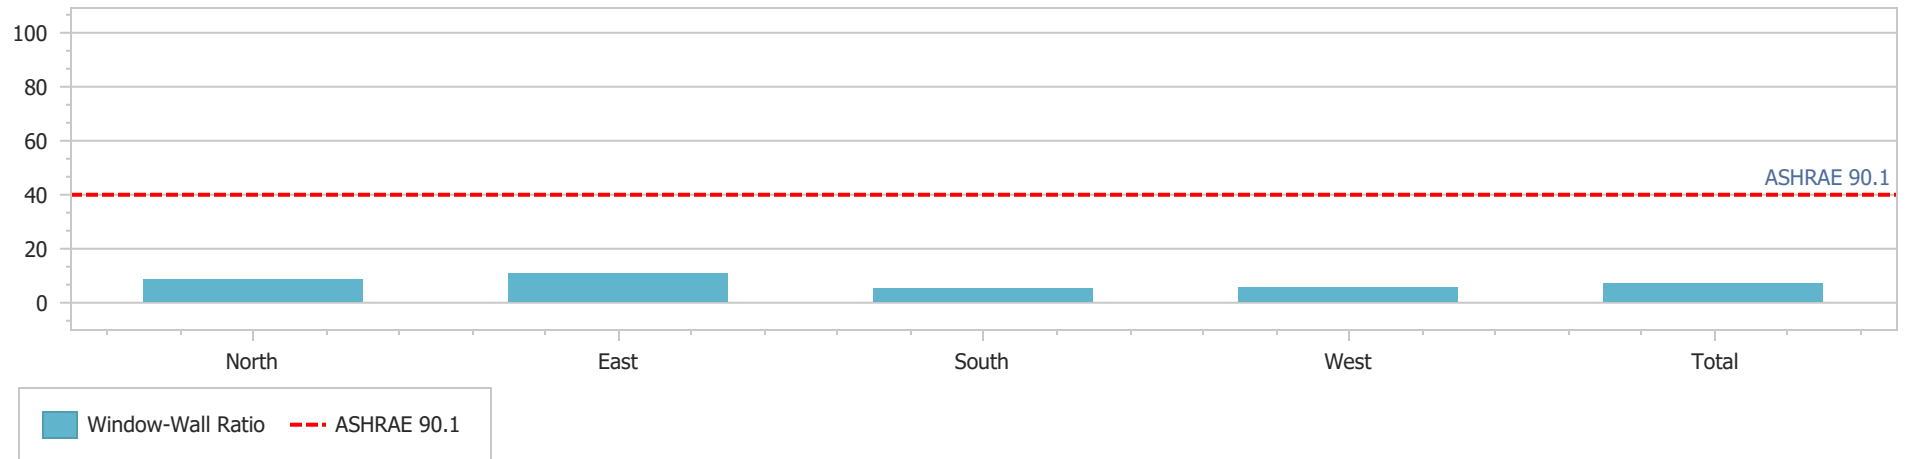

	North	East	South	West	Total
Gross Window-Wall Ratio	8.22	10.45	5.06	5.22	7.05

Ratios

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827
Gross Roof Area	ft²	0	0	0	0	15,695
Skylight Area	ft²	0	0	0	0	0
Skylight-Roof Ratio	%	0	0	0	0	0

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 05-05	Casa - Roof - Single Ply Over Tapered Insulation	0.3	87	0.026	0.027	180°	0 °	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 07-07	Casa - Roof - Single Ply Over Tapered Insulation	0.3	205	0.026	0.027	180°	0 °	
Roof 08-08	Casa - Roof - Single Ply Over Tapered Insulation	0.3	193	0.026	0.027	180°	0 °	
Roof 09-09	Casa - Roof - Single Ply Over Tapered Insulation	0.3	88	0.026	0.027	180°	0 °	
Roof 100-14	Casa - Roof - Single Ply Over Tapered Insulation	0.3	65	0.026	0.027	180°	0 °	
Roof 10-10	Casa - Roof - Single Ply Over Tapered Insulation	0.3	93	0.026	0.027	180°	0 °	
Roof 101-13	Casa - Roof - Single Ply Over Tapered Insulation	0.3	111	0.026	0.027	180°	0 °	
Roof 102-68	Casa - Roof - Single Ply Over Tapered Insulation	0.3	318	0.026	0.027	180°	0 °	
Roof 103-16	Casa - Roof - Single Ply Over Tapered Insulation	0.3	141	0.026	0.027	180°	0 °	
Roof 104-17	Casa - Roof - Single Ply Over Tapered Insulation	0.3	133	0.026	0.027	180°	0 °	
Roof 105-18	Casa - Roof - Single Ply Over Tapered Insulation	0.3	113	0.026	0.027	180°	0 °	
Roof 106-19	Casa - Roof - Single Ply Over Tapered Insulation	0.3	107	0.026	0.027	180°	0 °	
Roof 107-26	Casa - Roof - Single Ply Over Tapered Insulation	0.3	70	0.026	0.027	180°	0 °	
Roof 108-27	Casa - Roof - Single Ply Over Tapered Insulation	0.3	70	0.026	0.027	180°	0 °	
Roof 109-70	Casa - Roof - Single Ply Over Tapered Insulation	0.3	516	0.026	0.027	180°	0 °	
Roof 110-28	Casa - Roof - Single Ply Over Tapered Insulation	0.3	21	0.026	0.027	180°	0 °	
Roof 111-11	Casa - Roof - Single Ply Over Tapered Insulation	0.3	90	0.026	0.027	180°	0 °	
Roof 112-12	Casa - Roof - Single Ply Over Tapered Insulation	0.3	134	0.026	0.027	180°	0 °	
Roof 113-06	Casa - Roof - Single Ply Over Tapered Insulation	0.3	169	0.026	0.027	180°	0 °	
Roof 114-02	Casa - Roof - Single Ply Over Tapered Insulation	0.3	53	0.026	0.027	180°	0 °	
Roof 115-67	Casa - Roof - Single Ply Over Tapered Insulation	0.3	56	0.026	0.027	180°	0 °	
Roof 116-01	Casa - Roof - Single Ply Over Tapered Insulation	0.3	129	0.026	0.027	270°	0 °	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 117-20	Casa - Roof - Single Ply Over Tapered Insulation	0.3	124	0.026	0.027	270°	0 °	
Roof 118-69	Casa - Roof - Single Ply Over Tapered Insulation	0.3	19	0.026	0.027	263.33°	0 °	
Roof 119-21	Casa - Roof - Single Ply Over Tapered Insulation	0.3	266	0.026	0.027	180°	0 °	
Roof 120-22	Casa - Roof - Single Ply Over Tapered Insulation	0.3	146	0.026	0.027	180°	0 °	
Roof 121-23	Casa - Roof - Single Ply Over Tapered Insulation	0.3	53	0.026	0.027	180°	0 °	
Roof 122-24	Casa - Roof - Single Ply Over Tapered Insulation	0.3	98	0.026	0.027	180°	0 °	
Roof 123-25	Casa - Roof - Single Ply Over Tapered Insulation	0.3	99	0.026	0.027	270°	0 °	
Roof 124-43	Casa - Roof - Single Ply Over Tapered Insulation	0.3	80	0.026	0.027	224.96°	0 °	
Roof 125-04	Casa - Roof - Single Ply Over Tapered Insulation	0.3	119	0.026	0.027	180°	0 °	
Roof 126-03	Casa - Roof - Single Ply Over Tapered Insulation	0.3	62	0.026	0.027	180°	0 °	
Roof 128-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	175	0.026	0.027	90°	18 °	
Roof 129-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	177	0.026	0.027	0°	18 °	
Roof 130-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	175	0.026	0.027	270°	18 °	
Roof 131-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	177	0.026	0.027	180°	18 °	
Roof 134-10	Casa - Roof - Single Ply Over Tapered Insulation	0.3	862	0.026	0.027	90°	21 °	
Roof 136-12	Casa - Roof - Single Ply Over Tapered Insulation	0.3	792	0.026	0.027	90°	26 °	
Roof 137-80	Casa - Roof - Single Ply Over Tapered Insulation	0.3	6	0.026	0.027	270°	0 °	
Roof 138-81	Casa - Roof - Single Ply Over Tapered Insulation	0.3	4	0.026	0.027	180°	0 °	
Roof 38-38	Casa - Roof - Single Ply Over Tapered Insulation	0.3	170	0.026	0.027	180°	0 °	
Roof 62-62	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	270°	0 °	
Roof 63-63	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 64-64	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	
Roof 65-65	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	
Roof 80-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	702	0.026	0.027	358.52°	19 °	
Roof 81-01	Casa - Roof - Single Ply Over Tapered Insulation	0.3	815	0.026	0.027	180°	18 °	
Roof 83-03	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,095	0.026	0.027	270°	18 °	
Roof 84-04	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,058	0.026	0.027	90°	20 °	
Roof 86-06	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,096	0.026	0.027	270°	17 °	
Roof 88-08	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,766	0.026	0.027	360°	22 °	
Roof 90-31	Casa - Roof - Single Ply Over Tapered Insulation	0.3	105	0.026	0.027	180°	0 °	
Roof 91-71	Casa - Roof - Single Ply Over Tapered Insulation	0.3	968	0.026	0.027	180°	0 °	
Roof 92-32	Casa - Roof - Single Ply Over Tapered Insulation	0.3	104	0.026	0.027	180°	0 °	
Roof 93-33	Casa - Roof - Single Ply Over Tapered Insulation	0.3	212	0.026	0.027	180°	0 °	
Roof 94-34	Casa - Roof - Single Ply Over Tapered Insulation	0.3	110	0.026	0.027	180°	0 °	
Roof 95-39	Casa - Roof - Single Ply Over Tapered Insulation	0.3	107	0.026	0.027	180°	0 °	
Roof 96-35	Casa - Roof - Single Ply Over Tapered Insulation	0.3	402	0.026	0.027	180°	0 °	
Roof 97-36	Casa - Roof - Single Ply Over Tapered Insulation	0.3	323	0.026	0.027	180°	0 °	
Roof 98-37	Casa - Roof - Single Ply Over Tapered Insulation	0.3	85	0.026	0.027	180°	0 °	
Roof 99-15	Casa - Roof - Single Ply Over Tapered Insulation	0.3	171	0.026	0.027	180°	0 °	
SLAB 01_0	Casa - Slab On Grade_0	1	262	0.041	0.042		180 °	
SLAB 02_0	Casa - Slab On Grade_0	1	76	0.041	0.042		180 °	
SLAB 03_0	Casa - Slab On Grade_0	1	89	0.041	0.042		180 °	
SLAB 04_0	Casa - Slab On Grade_0	1	171	0.041	0.042		180 °	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 05_0	Casa - Slab On Grade_0	1	87	0.041	0.042		180 °	
SLAB 06_0	Casa - Slab On Grade_0	1	169	0.041	0.042		180 °	
SLAB 07_0	Casa - Slab On Grade_0	1	205	0.041	0.042		180 °	
SLAB 08_0	Casa - Slab On Grade_0	1	193	0.041	0.042		180 °	
SLAB 09_0	Casa - Slab On Grade_0	1	88	0.041	0.042		180 °	
SLAB 10_0	Casa - Slab On Grade_0	1	93	0.041	0.042		180 °	
SLAB 11_0	Casa - Slab On Grade_0	1	90	0.041	0.042		180 °	
SLAB 12_0	Casa - Slab On Grade_0	1	134	0.041	0.042		180 °	
SLAB 128_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	893	0.038	0.04		180 °	
SLAB 13_0	Casa - Slab On Grade_0	1	111	0.041	0.042		180 °	
SLAB 14_0	Casa - Slab On Grade_0	1	65	0.041	0.042		180 °	
SLAB 15_0	Casa - Slab On Grade_0	1	171	0.041	0.042		180 °	
SLAB 16_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 17_0	Casa - Slab On Grade_0	1	133	0.041	0.042		180 °	
SLAB 18_0	Casa - Slab On Grade_0	1	113	0.041	0.042		180 °	
SLAB 182_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	13	0.038	0.04		180 °	
SLAB 185_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	162	0.038	0.04		180 °	
SLAB 187_0	Casa - Slab On Grade_0	1	11	0.041	0.042		180 °	
SLAB 188_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	79	0.038	0.04		180 °	
SLAB 19_0	Casa - Slab On Grade_0	1	107	0.041	0.042		180 °	
SLAB 190_0	Casa - Slab On Grade_0	1	6	0.041	0.042		180 °	
SLAB 20_0	Casa - Slab On Grade_0	1	244	0.041	0.042		180 °	
SLAB 21_0	Casa - Slab On Grade_0	1	508	0.041	0.042		180 °	
SLAB 22_0	Casa - Slab On Grade_0	1	294	0.041	0.042		180 °	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 23_0	Casa - Slab On Grade_0	1	60	0.041	0.042		180 °	
SLAB 24_0	Casa - Slab On Grade_0	1	110	0.041	0.042		180 °	
SLAB 25_0	Casa - Slab On Grade_0	1	112	0.041	0.042		180 °	
SLAB 26_0	Casa - Slab On Grade_0	1	70	0.041	0.042		180 °	
SLAB 27_0	Casa - Slab On Grade_0	1	70	0.041	0.042		180 °	
SLAB 28_0	Casa - Slab On Grade_0	1	214	0.041	0.042		180 °	
SLAB 29_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 30_0	Casa - Slab On Grade_0	1	135	0.041	0.042		180 °	
SLAB 31_0	Casa - Slab On Grade_0	1	105	0.041	0.042		180 °	
SLAB 32_0	Casa - Slab On Grade_0	1	104	0.041	0.042		180 °	
SLAB 33_0	Casa - Slab On Grade_0	1	212	0.041	0.042		180 °	
SLAB 34_0	Casa - Slab On Grade_0	1	110	0.041	0.042		180 °	
SLAB 35_0	Casa - Slab On Grade_0	1	402	0.041	0.042		180 °	
SLAB 36_0	Casa - Slab On Grade_0	1	323	0.041	0.042		180 °	
SLAB 37_0	Casa - Slab On Grade_0	1	85	0.041	0.042		180 °	
SLAB 38_0	Casa - Slab On Grade_0	1	170	0.041	0.042		180 °	
SLAB 39_0	Casa - Slab On Grade_0	1	107	0.041	0.042		180 °	
SLAB 40_0	Casa - Slab On Grade_0	1	123	0.041	0.042		180 °	
SLAB 41_0	Casa - Slab On Grade_0	1	148	0.041	0.042		180 °	
SLAB 42_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 43_0	Casa - Slab On Grade_0	1	91	0.041	0.042		180 °	
SLAB 44_0	Casa - Slab On Grade_0	1	193	0.041	0.042		180 °	
SLAB 45_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 46_0	Casa - Slab On Grade_0	1	115	0.041	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 47_0	Casa - Slab On Grade_0	1	135	0.041	0.042		180 °	
SLAB 48_0	Casa - Slab On Grade_0	1	143	0.041	0.042		180 °	
SLAB 49_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 50_0	Casa - Slab On Grade_0	1	137	0.041	0.042		180 °	
SLAB 51_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 52_0	Casa - Slab On Grade_0	1	140	0.041	0.042		180 °	
SLAB 53_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 54_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 55_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 56_0	Casa - Slab On Grade_0	1	195	0.041	0.042		180 °	
SLAB 57_0	Casa - Slab On Grade_0	1	143	0.041	0.042		180 °	
SLAB 58_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 59_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 60_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 61_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 62_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 63_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 64_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 65_0	Casa - Slab On Grade_0	1	111	0.041	0.042		180 °	
SLAB 66_0	Casa - Slab On Grade_0	1	196	0.041	0.042		180 °	
SLAB 67_0	Casa - Slab On Grade_0	1	396	0.041	0.042		180 °	
SLAB 68_0	Casa - Slab On Grade_0	1	318	0.041	0.042		180 °	
SLAB 69_0	Casa - Slab On Grade_0	1	19	0.041	0.042		180 °	
SLAB 70_0	Casa - Slab On Grade_0	1	686	0.041	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 71_0	Casa - Slab On Grade_0	1	968	0.041	0.042		180 °	
SLAB 72_0	Casa - Slab On Grade_0	1	444	0.041	0.042		180 °	
SLAB 73_0	Casa - Slab On Grade_0	1	349	0.041	0.042		180 °	
SLAB 74_0	Casa - Slab On Grade_0	1	439	0.041	0.042		180 °	
SLAB 81_0	Casa - Slab On Grade_0	1	96	0.041	0.042		180 °	
SLAB 82_0	Casa - Slab On Grade_0	1	469	0.041	0.042		180 °	
WALL 101-Servery _0	Casa - Ext Wall - Wood Framed	0.3	160	0.046	0.048	0°	90 °	N
WALL 106-Multipurpose/Dining _0	Casa - Ext Wall - Wood Framed	0.3	322	0.046	0.048	0°	90 °	N
WALL 111-Group _0	Casa - Ext Wall - Wood Framed	0.3	202	0.046	0.048	0°	90 °	N
WALL 112-Group _0	Casa - Ext Wall - Wood Framed	0.3	93	0.046	0.048	270°	90 °	W
WALL 116-Storage _0	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	0°	90 °	N
WALL 119-Consult 1 _0	Casa - Ext Wall - Wood Framed	0.3	115	0.046	0.048	0°	90 °	N
WALL 122-Consult 2 _0	Casa - Ext Wall - Wood Framed	0.3	117	0.046	0.048	0°	90 °	N
WALL 13-Hospitality _0	Casa - Ext Wall - Wood Framed	0.3	164	0.046	0.048	0°	90 °	N
WALL 142-Resident Room 01 _0	Casa - Ext Wall - Wood Framed	0.3	80	0.046	0.048	90°	90 °	E
WALL 147-Office 2 _0	Casa - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 151-Office 1 _0	Casa - Ext Wall - Wood Framed	0.3	107	0.046	0.048	180°	90 °	S
WALL 155-Lounge _0	Casa - Ext Wall - Wood Framed	0.3	218	0.046	0.048	180°	90 °	S
WALL 164-Shower 2 _0	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	180°	90 °	S
WALL 170-Kitchen _0	Casa - Ext Wall - Wood Framed	0.3	218	0.046	0.048	270°	90 °	W
WALL 172-Service _0	Casa - Ext Wall - Wood Framed	0.3	149	0.046	0.048	180°	90 °	S
WALL 176-Service _0	Casa - Ext Wall - Wood Framed	0.3	241	0.046	0.048	270°	90 °	W
WALL 179-Unconditioned Room Trash _0	Casa - Ext Wall - Wood Framed	0.3	96	0.046	0.048	180°	90 °	S
WALL 195-Resident Room 02 _0	Casa - Ext Wall - Wood Framed	0.3	112	0.046	0.048	90°	90 °	E

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 199-Resident Room 03 _0	Casa - Ext Wall - Wood Framed	0.3	136	0.046	0.048	90°	90 °	E
WALL 202-Resident Room 04 _0	Casa - Ext Wall - Wood Framed	0.3	157	0.046	0.048	180°	90 °	S
WALL 203-Resident Room 04 _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 208-Comfort Room 2 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	0°	90 °	N
WALL 20-Shower 1 _0	Casa - Ext Wall - Wood Framed	0.3	37	0.046	0.048	90°	90 °	E
WALL 213-Noisy Activity 1 _0	Casa - Ext Wall - Wood Framed	0.3	174	0.046	0.048	270°	90 °	W
WALL 217-Shower 4 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 221-Shower 3 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 225-Resident Room 06 _0	Casa - Ext Wall - Wood Framed	0.3	122	0.046	0.048	270°	90 °	W
WALL 227-Resident Room 05 _0	Casa - Ext Wall - Wood Framed	0.3	160	0.046	0.048	180°	90 °	S
WALL 229-Resident Room 05 _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	270°	90 °	W
WALL 232-Quiet Activity 2 _0	Casa - Ext Wall - Wood Framed	0.3	48	0.046	0.048	180°	90 °	S
WALL 236-Resident Room 07 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	180°	90 °	S
WALL 239-Resident Room 08 _0	Casa - Ext Wall - Wood Framed	0.3	125	0.046	0.048	180°	90 °	S
WALL 242-Resident Room 09 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	180°	90 °	S
WALL 244-Resident Room 09 _0	Casa - Ext Wall - Wood Framed	0.3	159	0.046	0.048	270°	90 °	W
WALL 247-Resident Room 10 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	0°	90 °	N
WALL 248-Resident Room 10 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	270°	90 °	W
WALL 252-Shower 5 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 256-Shower 6 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 260-Noisy Activity 2 _0	Casa - Ext Wall - Wood Framed	0.3	92	0.046	0.048	0°	90 °	N
WALL 265-Quiet Activity 3 _0	Casa - Ext Wall - Wood Framed	0.3	128	0.046	0.048	270°	90 °	W
WALL 269-Resident Room 11 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	270°	90 °	W
WALL 26-Interview Room _0	Casa - Ext Wall - Wood Framed	0.3	183	0.046	0.048	90°	90 °	E

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 273-Resident Room 12 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 277-Resident Room 13 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 280-Resident Room 14 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 281-Resident Room 14 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	270°	90 °	W
WALL 283-Resident Room 15 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	90°	90 °	E
WALL 284-Resident Room 15 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 288-Resident Room 16 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	90°	90 °	E
WALL 292-Shower 7 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	90°	90 °	E
WALL 296-Shower 8 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	90°	90 °	E
WALL 301-Noisy Activity 3 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	90.55°	90 °	E
WALL 306-Hospitality _0	Casa - Ext Wall - Wood Framed	0.3	96	0.046	0.048	90°	90 °	E
WALL 311-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 312-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	381	0.046	0.048	90°	90 °	E
WALL 313-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	136	0.046	0.048	0°	90 °	N
WALL 390-Staff Corridor _0	Casa - Ext Wall - Wood Framed	0.3	77	0.046	0.048	180°	90 °	S
WALL 402-Corridor 5 _0	Casa - Ext Wall - Wood Framed	0.3	101	0.046	0.048	180°	90 °	S
WALL 40-Electric _0	Casa - Ext Wall - Wood Framed	0.3	230	0.046	0.048	180°	90 °	S
WALL 412-Corridor 4 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	270°	90 °	W
WALL 424-Corridor 3 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	0°	90 °	N
WALL 566-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	6	0.046	0.048	0°	90 °	N
WALL 567-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	45	0.046	0.048	270°	90 °	W
WALL 572-Unconditioned Room Room 01-01 _12	Casa - Ext Wall - Wood Framed	0.3	57	0.046	0.048	270°	90 °	W
WALL 584-Unconditioned Room Room 01-03 _12	Casa - Ext Wall - Wood Framed	0.3	54	0.046	0.048	180°	90 °	S
WALL 589-Unconditioned Room Room 01-04 _12	Casa - Ext Wall - Wood Framed	0.3	51	0.046	0.048	180°	90 °	S

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 612-Unconditioned Room Room 01-06 _12	Casa - Ext Wall - Wood Framed	0.3	57	0.046	0.048	0°	90 °	N
WALL 654-Unconditioned Room Room 01-04 _12	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	0°	90 °	N
WALL 726-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	179	0.046	0.048	180°	90 °	S
WALL 727-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	178	0.046	0.048	90°	90 °	E
WALL 728-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	179	0.046	0.048	0°	90 °	N
WALL 729-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	178	0.046	0.048	270°	90 °	W
WALL 730-Unconditioned Room Room 01-06 _12.6420052252	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	202.72°	90 °	S
WALL 731-Unconditioned Room Room 01-06 _12.7919128827	Casa - Ext Wall - Wood Framed	0.3	2	0.046	0.048	199.12°	90 °	S
WALL 733-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	22.72°	90 °	N
WALL 736-Unconditioned Room Room 01-03 _13.108842849	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	316.46°	90 °	N
WALL 738-Unconditioned Room Room 01-03 _12	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	316.54°	90 °	N
WALL 757-Attrium _13.2899728863	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	270°	90 °	W
WALL 758-Attrium _14.0210136804	Casa - Ext Wall - Wood Framed	0.3	25	0.046	0.048	270°	90 °	W
WALL 760-Attrium _14.2564019478	Casa - Ext Wall - Wood Framed	0.3	21	0.046	0.048	180°	90 °	S
WALL 761-Attrium _12.7378807681	Casa - Ext Wall - Wood Framed	0.3	39	0.046	0.048	180°	90 °	S
WALL 762-Attrium _12	Casa - Ext Wall - Wood Framed	0.3	156	0.046	0.048	90°	90 °	E
WALL 764-Attrium _14.1335978361	Casa - Ext Wall - Wood Framed	0.3	24	0.046	0.048	0°	90 °	N
WALL 771-Attrium _12.8311965203	Casa - Ext Wall - Wood Framed	0.3	35	0.046	0.048	0°	90 °	N
WALL 773-Unconditioned Room Room 01-08 _13.7195611268	Casa - Ext Wall - Wood Framed	0.3	22	0.046	0.048	270°	90 °	W
WALL 777-Unconditioned Room Room 01-08 _12	Casa - Ext Wall - Wood Framed	0.3	626	0.046	0.048	180°	90 °	S
WALL 780-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	179.55°	90 °	S
WALL 781-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	4	0.046	0.048	90°	90 °	E
WALL 782-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	4	0.046	0.048	180°	90 °	S
WALL 783-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	48	0.046	0.048	0°	90 °	N

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 11 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 799-Unconditioned Room Room 01-12 _12	Casa - Ext Wall - Wood Framed	0.3	304	0.046	0.048	270°	90 °	W
WALL 800-Unconditioned Room Room 01-12 _12	Casa - Ext Wall - Wood Framed	0.3	37	0.046	0.048	180°	90 °	S
WALL 835-Electric _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 836-Emergency Electric _0	Casa - Ext Wall - Wood Framed	0.3	121	0.046	0.048	90°	90 °	E
WALL 837-Mechanical _0	Casa - Ext Wall - Wood Framed	0.3	64	0.046	0.048	90°	90 °	E
WALL 838-Fire Room _0	Casa - Ext Wall - Wood Framed	0.3	118	0.046	0.048	90°	90 °	E
WALL 839-Comfort Room 1 _0	Casa - Ext Wall - Wood Framed	0.3	27	0.046	0.048	90°	90 °	E
WALL 840-Interview Room _0	Casa - Ext Wall - Wood Framed	0.3	130	0.046	0.048	180°	90 °	S
WALL 841-Sally Port _0	Casa - Ext Wall - Wood Framed	0.3	99	0.046	0.048	180°	90 °	S
WALL 842-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	180°	90 °	S
WALL 843-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	58	0.046	0.048	90°	90 °	E
WALL 846-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	112	0.046	0.048	359.48°	90 °	N
WALL 849-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	15	0.046	0.048	0°	90 °	N
WALL 850 - COPY-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	51	0.046	0.048	270.44°	90 °	W
WALL 851-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	28	0.046	0.048	180°	90 °	S
WALL 852-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	16	0.046	0.048	270.44°	90 °	W
WALL 853-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	19	0.046	0.048	180°	90 °	S
WALL 854-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	29	0.046	0.048	90°	90 °	E
WALL 855-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	46	0.046	0.048	0.44°	90 °	N
WALL 856-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	13	0.046	0.048	271.72°	90 °	W

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 102-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	187	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 12 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 107-Group _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 113-Group _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 114-Group _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 117-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 120-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 124-Soiled Supply _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 128-Toilet 2 _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 136-Chart/Hotel _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 140-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 144-Office 2 _0	Gypsum, Gypsum	0.3	44	0.28	0.452
WALL 368-Meds _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 369-Corridor 1 _0	Gypsum, Gypsum	0.3	78	0.28	0.452
WALL 36-Intake Corridor _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 370-Office 2 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 371-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	34	0.28	0.452
WALL 372-Office 1 _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 373-Lounge _0	Gypsum, Gypsum	0.3	218	0.28	0.452
WALL 374-Shower 2 _0	Gypsum, Gypsum	0.3	33	0.28	0.452
WALL 375-Shower 2 _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 376-Shower 2 _0	Gypsum, Gypsum	0.3	87	0.28	0.452
WALL 145-Office 2 _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 377-Kitchen _0	Gypsum, Gypsum	0.3	247	0.28	0.452
WALL 378-General Storage _0	Gypsum, Gypsum	0.3	110	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 379-General Storage _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 380-General Storage _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 381-General Storage _0	Gypsum, Gypsum	0.3	67	0.28	0.452
WALL 382-Service _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 383-Staff Corridor _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 384-Long Term Belongings Storage _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 385-Hskp _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 386-Electric _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 150-Office 1 _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 387-Emergency Electric _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 388-Mechanical _0	Gypsum, Gypsum	0.3	145	0.28	0.452
WALL 389-IT _0	Gypsum, Gypsum	0.3	203	0.28	0.452
WALL 392-Corridor 5 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 393-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 394-Corridor 5 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 395-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 396-Corridor 5 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 397-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 398-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 154-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 399-Corridor 5 _0	Gypsum, Gypsum	0.3	136	0.28	0.452
WALL 400-Corridor 5 _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 404-Corridor 4 _0	Gypsum, Gypsum	0.3	129	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 14 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 405-Corridor 4 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 406-Corridor 4 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 407-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 408-Corridor 4 _0	Gypsum, Gypsum	0.3	125	0.28	0.452
WALL 409-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 410-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 158-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 411-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 414-Corridor 3 _0	Gypsum, Gypsum	0.3	177	0.28	0.452
WALL 415-Corridor 3 _0	Gypsum, Gypsum	0.3	128	0.28	0.452
WALL 416-Corridor 3 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 417-Corridor 3 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 418-Corridor 3 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 419-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 420-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 421-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 422-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 165-Kitchen _0	Gypsum, Gypsum	0.3	88	0.28	0.452
WALL 423-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 44-Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 507-Chart/Hotel _0	Gypsum, Gypsum	0.3	50	0.28	0.452
WALL 511-Comfort Room 2 _0	Gypsum, Gypsum	0.3	76	0.28	0.452
WALL 512-Corridor 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 15 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 515-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 516-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 517-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 518-Corridor 2.1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 519-Corridor 2.1 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 166-Kitchen _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 520-Chart/Hotel _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 523-Corridor 2.1 _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 54-Comfort Room 1 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 550-Attrium _0	Gypsum, Gypsum	0.3	180	0.28	0.452
WALL 551-Attrium _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 552-Attrium _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 553-Attrium _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 401-Corridor 5 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 554-Attrium _0	Gypsum, Gypsum	0.3	287	0.28	0.452
WALL 555-Attrium _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 556-Attrium _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 171-Kitchen _0	Gypsum, Gypsum	0.3	245	0.28	0.452
WALL 557-Attrium _0	Gypsum, Gypsum	0.3	98	0.28	0.452
WALL 56-Comfort Room 1 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 59-Ante Room _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 60-Ante Room _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 61-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 64-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 65-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 68-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 72-Exam Room _0	Gypsum, Gypsum	0.3	17	0.28	0.452
WALL 73-Ante Room _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 177-Service _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 75-Hskp _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 78-Hskp _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 79-Ante Room _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 80-Comfort Room 1 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 81-Fire Room _0	Gypsum, Gypsum	0.3	36	0.28	0.452
WALL 848-Interview Room _0	Gypsum, Gypsum	0.3	6	0.28	0.452
WALL 87-Laundry _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 90-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 93-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 97-Hospitality _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 178-Service _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 181-IT _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 182-Fire Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 183-Fire Room _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 185-Emergency Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 187-General Storage _0	Gypsum, Gypsum	0.3	80	0.28	0.452
WALL 188-General Storage _0	Gypsum, Gypsum	0.3	157	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 17 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 18-Shower 1 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 193-Resident Room 01 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 197-Resident Room 02 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 201-Resident Room 03 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 205-Comfort Room 2 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 214-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 218-Shower 3 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 222-Resident Room 06 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 226-Resident Room 05 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 22-Interview Room _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 231-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 235-Quiet Activity 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 238-Resident Room 07 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 241-Resident Room 08 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 249-Resident Room 10 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 253-Shower 5 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 257-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 261-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 266-Quiet Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 270-Resident Room 11 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 274-Resident Room 12 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 278-Resident Room 13 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 286-Resident Room 15 _0	Gypsum, Gypsum	0.3	161	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 18 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 290-Resident Room 16 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 294-Shower 7 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 298-Noisy Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 299-Comfort Room 2 _0	Gypsum, Gypsum	0.3	15	0.28	0.452
WALL 304-Entry/Waiting _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 305-Entry/Waiting _0	Gypsum, Gypsum	0.3	134	0.28	0.452
WALL 307-Entry/Waiting _0	Gypsum, Gypsum	0.3	62	0.28	0.452
WALL 308-Entry/Waiting _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 309-Entry/Waiting _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 30-Interview Room _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 315-Corridor 1 _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 317-Corridor 1 _0	Gypsum, Gypsum	0.3	198	0.28	0.452
WALL 318-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 319-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	27	0.28	0.452
WALL 320-Servery _0	Gypsum, Gypsum	0.3	38	0.28	0.452
WALL 321-Servery _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 322-Corridor 1 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 323-Corridor 1 _0	Gypsum, Gypsum	0.3	73	0.28	0.452
WALL 324-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 325-Corridor 1 _0	Gypsum, Gypsum	0.3	11	0.28	0.452
WALL 326-Corridor 1 _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 327-Corridor 1 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 328-Corridor 1 _0	Gypsum, Gypsum	0.3	104	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 330-Corridor 1 _0	Gypsum, Gypsum	0.3	60	0.28	0.452
WALL 333-Comfort Room 2 _0	Gypsum, Gypsum	0.3	66	0.28	0.452
WALL 334-Comfort Room 2 _0	Gypsum, Gypsum	0.3	57	0.28	0.452
WALL 336-Consult 2 _0	Gypsum, Gypsum	0.3	117	0.28	0.452
WALL 337-Consult 1 _0	Gypsum, Gypsum	0.3	115	0.28	0.452
WALL 33-Intake Corridor _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 344-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 345-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 346-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 347-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 348-Corridor 2 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 349-Corridor 2 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 34-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 350-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 351-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 352-Corridor 2 _0	Gypsum, Gypsum	0.3	172	0.28	0.452
WALL 353-Corridor 2 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 358-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 359-Chart/Hotel _0	Gypsum, Gypsum	0.3	196	0.28	0.452
WALL 35-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 360-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 361-Staff Corridor _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 362-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 363-Soiled Supply _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 364-Soiled Supply _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 365-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 366-Laundry _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 367-Meds _0	Gypsum, Gypsum	0.3	132	0.28	0.452

Opaque Exterior Door

	Construction	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Gross Area (ft²)	Parent Surface
DOOR 00_D - WALL 260-Noisy Activity 2 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 260-Noisy Activity 2 _0
DOOR 01_D - WALL 301-Noisy Activity 3 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 301-Noisy Activity 3 _0
DOOR 02_D - WALL 106-Multipurpose/Dining _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 106-Multipurpose/Dining _0
DOOR 03_D - WALL 213-Noisy Activity 1 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 213-Noisy Activity 1 _0
DOOR 04_D - WALL 172-Service _0	CASA - EXT DOOR SWINGING	0.579	1.14	49	WALL 172-Service _0
DOOR 05_D - WALL 179-Unconditioned Room Trash _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 179-Unconditioned Room Trash _0
DOOR 06_D - WALL 390-Staff Corridor _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 390-Staff Corridor _0
DOOR 07_D - WALL 40-Electric _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 40-Electric _0
DOOR 11_D - WALL 155-Lounge _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 155-Lounge _0
DOOR 12_D - WALL 311-Entry/Waiting _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 311-Entry/Waiting _0
DOOR 22_D - WALL 836-Emergency Electric _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 836-Emergency Electric _0
DOOR 23_D - WALL 838-Fire Room _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 838-Fire Room _0
DOOR 24_D - WALL 841-Sally Port _0	CASA - EXT DOOR SWINGING	0.579	1.14	26	WALL 841-Sally Port _0

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 00_W - WALL 412-Corridor 4_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 412-Corridor 4_0	270°	W
WINDOW 39_W - WALL 729-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 729-Attrium 2_18	270°	W
WINDOW 40_W - WALL 729-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 729-Attrium 2_18	270°	W
WINDOW 51_W - WALL 213-Noisy Activity 1_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 52_W - WALL 213-Noisy Activity 1_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 57_W - WALL 225-Resident Room 06_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 225-Resident Room 06_0	270°	W
WINDOW 58_W - WALL 229-Resident Room 05_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 229-Resident Room 05_0	270°	W
WINDOW 59_W - WALL 269-Resident Room 11_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 269-Resident Room 11_0	270°	W
WINDOW 60_W - WALL 273-Resident Room 12_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 273-Resident Room 12_0	270°	W
WINDOW 61_W - WALL 277-Resident Room 13_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 277-Resident Room 13_0	270°	W
WINDOW 62_W - WALL 281-Resident Room 14_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 281-Resident Room 14_0	270°	W
WINDOW 06_W - WALL 402-Corridor 5_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 402-Corridor 5_0	180°	S
WINDOW 41_W - WALL 726-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 726-Attrium 2_18	180°	S
WINDOW 42_W - WALL 726-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 726-Attrium 2_18	180°	S
WINDOW 47_W - WALL 147-Office 2_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 147-Office 2_0	180°	S
WINDOW 48_W - WALL 151-Office 1_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 151-Office 1_0	180°	S
WINDOW 49_W - WALL 155-Lounge_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 155-Lounge_0	180°	S
WINDOW 50_W - WALL 155-Lounge_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 155-Lounge_0	180°	S
WINDOW 53_W - WALL 232-Quiet Activity 2_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 232-Quiet Activity 2_0	180°	S
WINDOW 54_W - WALL 236-Resident Room 07_0	90.1-13 Window Zone 4-6 Metal Oper	17.8	17.8	0.501	0.401	0.442	No	WALL 236-Resident Room 07_0	180°	S
WINDOW 55_W - WALL 239-Resident Room 08_0	90.1-13 Window Zone 4-6 Metal Oper	17.8	17.8	0.501	0.401	0.442	No	WALL 239-Resident Room 08_0	180°	S

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 22 of 49

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 56_W - WALL 242-Resident Room 09_0	90.1-13 Window Zone 4-6 Metal Oper	17.8	17.8	0.501	0.401	0.442	No	WALL 242-Resident Room 09_0	180°	S
WINDOW 04_W - WALL 313-Entry/Waiting_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 313-Entry/Waiting_0	0°	N
WINDOW 05_W - WALL 424-Corridor 3_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 424-Corridor 3_0	0°	N
WINDOW 07_W - WALL 247-Resident Room 10_0	90.1-13 Window Zone 4-6 Metal Oper	17.8	17.8	0.501	0.401	0.442	No	WALL 247-Resident Room 10_0	0°	N
WINDOW 45_W - WALL 728-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 728-Attrium 2_18	0°	N
WINDOW 46_W - WALL 728-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 728-Attrium 2_18	0°	N
WINDOW 66_W - WALL 208-Comfort Room 2_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 208-Comfort Room 2_0	0°	N
WINDOW 67_W - WALL 122-Consult 2_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 122-Consult 2_0	0°	N
WINDOW 68_W - WALL 119-Consult 1_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 119-Consult 1_0	0°	N
WINDOW 69_W - WALL 111-Group_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 111-Group_0	0°	N
WINDOW 70_W - WALL 111-Group_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 111-Group_0	0°	N
WINDOW 71_W - WALL 106-Multipurpose/Dining_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 72_W - WALL 106-Multipurpose/Dining_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 73_W - WALL 106-Multipurpose/Dining_0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 01_W - WALL 312-Entry/Waiting_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 02_W - WALL 312-Entry/Waiting_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 03_W - WALL 312-Entry/Waiting_0	90.1-13 Window Zone 4-6 Metal Oper	64.8	64.8	0.501	0.401	0.442	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 43_W - WALL 727-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 727-Attrium 2_18	90°	E
WINDOW 44_W - WALL 727-Attrium 2_18	90.1-13 Window Zone 4-6 Metal Oper	7.1	7.1	0.501	0.401	0.442	No	WALL 727-Attrium 2_18	90°	E
WINDOW 63_W - WALL 283-Resident Room 15_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 283-Resident Room 15_0	90°	E
WINDOW 64_W - WALL 288-Resident Room 16_0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 288-Resident Room 16_0	90°	E

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 23 of 49

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 65_W - WALL 301- Noisy Activity 3 _0	90.1-13 Window Zone 4-6 Metal Oper	7.8	7.8	0.501	0.401	0.442	No	WALL 301-Noisy Activity 3 _0	90.55°	E
WINDOW 74_W - WALL 203- Resident Room 04 _0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 203-Resident Room 04 _0	90°	E
WINDOW 75_W - WALL 199- Resident Room 03 _0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 199-Resident Room 03 _0	90°	E
WINDOW 76_W - WALL 195- Resident Room 02 _0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 195-Resident Room 02 _0	90°	E
WINDOW 77_W - WALL 142- Resident Room 01 _0	90.1-13 Window Zone 4-6 Metal Oper	10.1	10.1	0.501	0.401	0.442	No	WALL 142-Resident Room 01 _0	90°	E
Total or Average		0	827	0.501	0.401	0.442			0°	
North Total or Average		0	223.7	0.501	0.401	0.442			0°	
Non-North Total or Average		0	603.3	0.501	0.401	0.442			0°	

Sunlit Fraction


* Sunlit Fraction is available for calculation timesteps of 15 minutes or less.

	March 21 9am	March 21 Noon	March 21 3pm	June 21 9am	June 21 Noon	June 21 3pm	December 21 9am	December 21 Noon	December 21 3pm
None	0	0	0	0	0	0	0	0	0

Window Controls

	Control Name	Type	Shaded	Control	Glare Control
None					

Envelope Summary

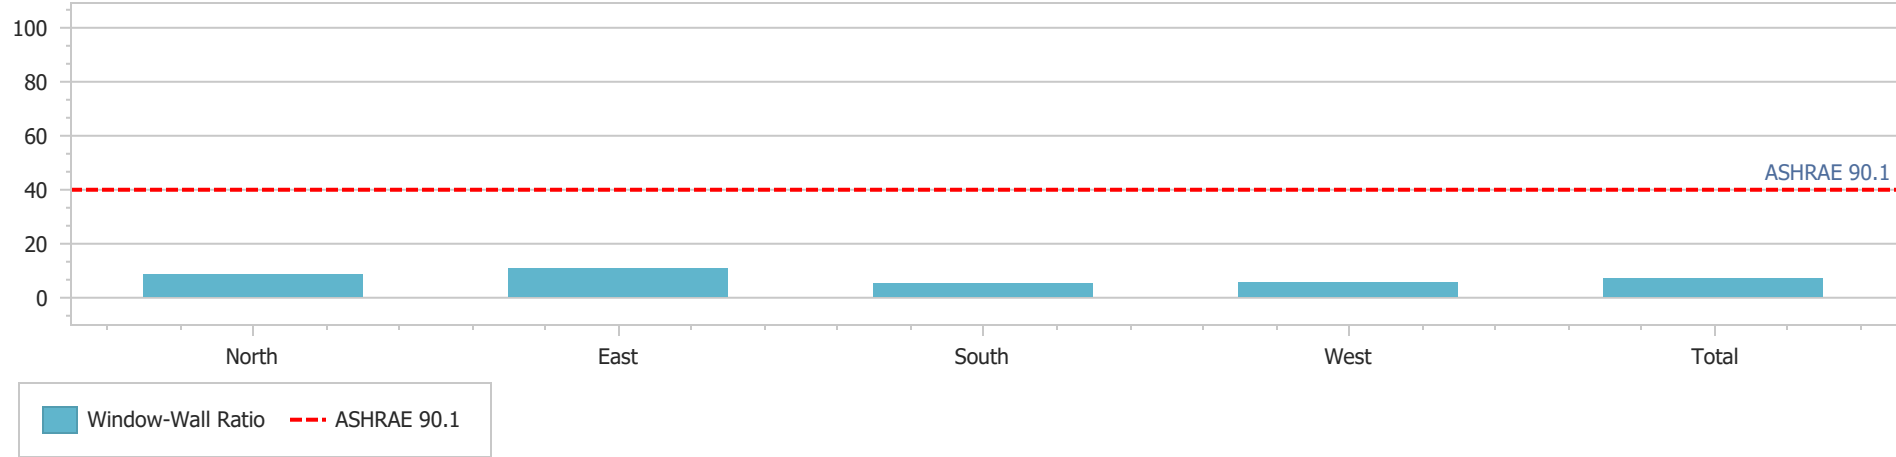

	North	East	South	West	Total
Gross Window-Wall Ratio	8.22	10.45	5.06	5.22	7.05

Ratios

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827
Gross Roof Area	ft²	0	0	0	0	15,695
Skylight Area	ft²	0	0	0	0	0
Skylight-Roof Ratio	%	0	0	0	0	0

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 05-05	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	87	0.047	0.049	180°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 07-07	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	205	0.047	0.049	180°	0 °	
Roof 08-08	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	193	0.047	0.049	180°	0 °	
Roof 09-09	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	88	0.047	0.049	180°	0 °	
Roof 100-14	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	65	0.047	0.049	180°	0 °	
Roof 10-10	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	93	0.047	0.049	180°	0 °	
Roof 101-13	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	111	0.047	0.049	180°	0 °	
Roof 102-68	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	318	0.047	0.049	180°	0 °	
Roof 103-16	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	141	0.047	0.049	180°	0 °	
Roof 104-17	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	133	0.047	0.049	180°	0 °	
Roof 105-18	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	113	0.047	0.049	180°	0 °	
Roof 106-19	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	107	0.047	0.049	180°	0 °	
Roof 107-26	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	70	0.047	0.049	180°	0 °	
Roof 108-27	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	70	0.047	0.049	180°	0 °	
Roof 109-70	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	516	0.047	0.049	180°	0 °	
Roof 110-28	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	21	0.047	0.049	180°	0 °	
Roof 111-11	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	90	0.047	0.049	180°	0 °	
Roof 112-12	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	134	0.047	0.049	180°	0 °	
Roof 113-06	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	169	0.047	0.049	180°	0 °	
Roof 114-02	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	53	0.047	0.049	180°	0 °	
Roof 115-67	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	56	0.047	0.049	180°	0 °	
Roof 116-01	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	129	0.047	0.049	270°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 117-20	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	124	0.047	0.049	270°	0 °	
Roof 118-69	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	19	0.047	0.049	263.33°	0 °	
Roof 119-21	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	266	0.047	0.049	180°	0 °	
Roof 120-22	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	146	0.047	0.049	180°	0 °	
Roof 121-23	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	53	0.047	0.049	180°	0 °	
Roof 122-24	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	98	0.047	0.049	180°	0 °	
Roof 123-25	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	99	0.047	0.049	270°	0 °	
Roof 124-43	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	80	0.047	0.049	224.96°	0 °	
Roof 125-04	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	119	0.047	0.049	180°	0 °	
Roof 126-03	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	62	0.047	0.049	180°	0 °	
Roof 128-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	175	0.047	0.049	90°	18 °	
Roof 129-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	177	0.047	0.049	0°	18 °	
Roof 130-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	175	0.047	0.049	270°	18 °	
Roof 131-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	177	0.047	0.049	180°	18 °	
Roof 134-10	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	862	0.047	0.049	90°	21 °	
Roof 136-12	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	792	0.047	0.049	90°	26 °	
Roof 137-80	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	6	0.047	0.049	270°	0 °	
Roof 138-81	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	4	0.047	0.049	180°	0 °	
Roof 38-38	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	170	0.047	0.049	180°	0 °	
Roof 62-62	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1	0.047	0.049	270°	0 °	
Roof 63-63	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1	0.047	0.049	180°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 64-64	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1	0.047	0.049	180°	0 °	
Roof 65-65	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1	0.047	0.049	180°	0 °	
Roof 80-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	702	0.047	0.049	358.52°	19 °	
Roof 81-01	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	815	0.047	0.049	180°	18 °	
Roof 83-03	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1,095	0.047	0.049	270°	18 °	
Roof 84-04	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1,058	0.047	0.049	90°	20 °	
Roof 86-06	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1,096	0.047	0.049	270°	17 °	
Roof 88-08	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	1,766	0.047	0.049	360°	22 °	
Roof 90-31	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	105	0.047	0.049	180°	0 °	
Roof 91-71	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	968	0.047	0.049	180°	0 °	
Roof 92-32	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	104	0.047	0.049	180°	0 °	
Roof 93-33	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	212	0.047	0.049	180°	0 °	
Roof 94-34	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	110	0.047	0.049	180°	0 °	
Roof 95-39	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	107	0.047	0.049	180°	0 °	
Roof 96-35	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	402	0.047	0.049	180°	0 °	
Roof 97-36	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	323	0.047	0.049	180°	0 °	
Roof 98-37	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	85	0.047	0.049	180°	0 °	
Roof 99-15	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	0.3	171	0.047	0.049	180°	0 °	
SLAB 01_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	262	0.04	0.042		180 °	
SLAB 02_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	76	0.04	0.042		180 °	
SLAB 03_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	89	0.04	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 04_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	171	0.04	0.042		180 °	
SLAB 05_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	87	0.04	0.042		180 °	
SLAB 06_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	169	0.04	0.042		180 °	
SLAB 07_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	205	0.04	0.042		180 °	
SLAB 08_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	193	0.04	0.042		180 °	
SLAB 09_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	88	0.04	0.042		180 °	
SLAB 10_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	93	0.04	0.042		180 °	
SLAB 11_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	90	0.04	0.042		180 °	
SLAB 12_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	134	0.04	0.042		180 °	
SLAB 128_0	90.1-10 Min Floors, Steel Joist Zone 3	0.3	893	0.053	0.056		180 °	
SLAB 13_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	111	0.04	0.042		180 °	
SLAB 14_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	65	0.04	0.042		180 °	
SLAB 15_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	171	0.04	0.042		180 °	
SLAB 16_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	141	0.04	0.042		180 °	
SLAB 17_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	133	0.04	0.042		180 °	
SLAB 18_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	113	0.04	0.042		180 °	
SLAB 182_0	90.1-10 Min Floors, Steel Joist Zone 3	0.3	13	0.053	0.056		180 °	
SLAB 185_0	90.1-10 Min Floors, Steel Joist Zone 3	0.3	162	0.053	0.056		180 °	
SLAB 187_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	11	0.04	0.042		180 °	
SLAB 188_0	90.1-10 Min Floors, Steel Joist Zone 3	0.3	79	0.053	0.056		180 °	
SLAB 19_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	107	0.04	0.042		180 °	
SLAB 190_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	6	0.04	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 20_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	244	0.04	0.042		180 °	
SLAB 21_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	508	0.04	0.042		180 °	
SLAB 22_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	294	0.04	0.042		180 °	
SLAB 23_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	60	0.04	0.042		180 °	
SLAB 24_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	110	0.04	0.042		180 °	
SLAB 25_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	112	0.04	0.042		180 °	
SLAB 26_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	70	0.04	0.042		180 °	
SLAB 27_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	70	0.04	0.042		180 °	
SLAB 28_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	214	0.04	0.042		180 °	
SLAB 29_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	142	0.04	0.042		180 °	
SLAB 30_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	135	0.04	0.042		180 °	
SLAB 31_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	105	0.04	0.042		180 °	
SLAB 32_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	104	0.04	0.042		180 °	
SLAB 33_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	212	0.04	0.042		180 °	
SLAB 34_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	110	0.04	0.042		180 °	
SLAB 35_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	402	0.04	0.042		180 °	
SLAB 36_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	323	0.04	0.042		180 °	
SLAB 37_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	85	0.04	0.042		180 °	
SLAB 38_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	170	0.04	0.042		180 °	
SLAB 39_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	107	0.04	0.042		180 °	
SLAB 40_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	123	0.04	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 41_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	148	0.04	0.042		180 °	
SLAB 42_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	141	0.04	0.042		180 °	
SLAB 43_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	91	0.04	0.042		180 °	
SLAB 44_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	193	0.04	0.042		180 °	
SLAB 45_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	114	0.04	0.042		180 °	
SLAB 46_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	115	0.04	0.042		180 °	
SLAB 47_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	135	0.04	0.042		180 °	
SLAB 48_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	143	0.04	0.042		180 °	
SLAB 49_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	142	0.04	0.042		180 °	
SLAB 50_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	137	0.04	0.042		180 °	
SLAB 51_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	138	0.04	0.042		180 °	
SLAB 52_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	140	0.04	0.042		180 °	
SLAB 53_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	142	0.04	0.042		180 °	
SLAB 54_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	114	0.04	0.042		180 °	
SLAB 55_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	114	0.04	0.042		180 °	
SLAB 56_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	195	0.04	0.042		180 °	
SLAB 57_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	143	0.04	0.042		180 °	
SLAB 58_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	141	0.04	0.042		180 °	
SLAB 59_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	138	0.04	0.042		180 °	
SLAB 60_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	138	0.04	0.042		180 °	
SLAB 61_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	142	0.04	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 62_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	142	0.04	0.042		180 °	
SLAB 63_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	138	0.04	0.042		180 °	
SLAB 64_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	114	0.04	0.042		180 °	
SLAB 65_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	111	0.04	0.042		180 °	
SLAB 66_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	196	0.04	0.042		180 °	
SLAB 67_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	396	0.04	0.042		180 °	
SLAB 68_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	318	0.04	0.042		180 °	
SLAB 69_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	19	0.04	0.042		180 °	
SLAB 70_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	686	0.04	0.042		180 °	
SLAB 71_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	968	0.04	0.042		180 °	
SLAB 72_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	444	0.04	0.042		180 °	
SLAB 73_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	349	0.04	0.042		180 °	
SLAB 74_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	439	0.04	0.042		180 °	
SLAB 81_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	96	0.04	0.042		180 °	
SLAB 82_0	90.1-10 Min Slab On Grade Unheated Floor, Zone 1-5_0	1	469	0.04	0.042		180 °	
WALL 101-Servery_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	160	0.084	0.091	0°	90 °	N
WALL 106-Multipurpose/Dining_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	322	0.084	0.091	0°	90 °	N
WALL 111-Group_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	202	0.084	0.091	0°	90 °	N
WALL 112-Group_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	93	0.084	0.091	270°	90 °	W
WALL 116-Storage_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	32	0.084	0.091	0°	90 °	N
WALL 119-Consult 1_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	115	0.084	0.091	0°	90 °	N
WALL 122-Consult 2_0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	117	0.084	0.091	0°	90 °	N

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 13-Hospitality _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	164	0.084	0.091	0°	90 °	N
WALL 142-Resident Room 01 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	80	0.084	0.091	90°	90 °	E
WALL 147-Office 2 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	108	0.084	0.091	180°	90 °	S
WALL 151-Office 1 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	107	0.084	0.091	180°	90 °	S
WALL 155-Lounge _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	218	0.084	0.091	180°	90 °	S
WALL 164-Shower 2 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	32	0.084	0.091	180°	90 °	S
WALL 170-Kitchen _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	218	0.084	0.091	270°	90 °	W
WALL 172-Service _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	149	0.084	0.091	180°	90 °	S
WALL 176-Service _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	241	0.084	0.091	270°	90 °	W
WALL 179-Unconditioned Room Trash _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	96	0.084	0.091	180°	90 °	S
WALL 195-Resident Room 02 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	112	0.084	0.091	90°	90 °	E
WALL 199-Resident Room 03 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	136	0.084	0.091	90°	90 °	E
WALL 202-Resident Room 04 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	157	0.084	0.091	180°	90 °	S
WALL 203-Resident Room 04 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	129	0.084	0.091	90°	90 °	E
WALL 208-Comfort Room 2 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	103	0.084	0.091	0°	90 °	N
WALL 20-Shower 1 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	37	0.084	0.091	90°	90 °	E
WALL 213-Noisy Activity 1 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	174	0.084	0.091	270°	90 °	W
WALL 217-Shower 4 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	103	0.084	0.091	270°	90 °	W
WALL 221-Shower 3 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	103	0.084	0.091	270°	90 °	W
WALL 225-Resident Room 06 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	122	0.084	0.091	270°	90 °	W
WALL 227-Resident Room 05 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	160	0.084	0.091	180°	90 °	S
WALL 229-Resident Room 05 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	129	0.084	0.091	270°	90 °	W
WALL 232-Quiet Activity 2 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	48	0.084	0.091	180°	90 °	S
WALL 236-Resident Room 07 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	124	0.084	0.091	180°	90 °	S

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 239-Resident Room 08 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	125	0.084	0.091	180°	90 °	S
WALL 242-Resident Room 09 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	126	0.084	0.091	180°	90 °	S
WALL 244-Resident Room 09 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	159	0.084	0.091	270°	90 °	W
WALL 247-Resident Room 10 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	126	0.084	0.091	0°	90 °	N
WALL 248-Resident Room 10 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	161	0.084	0.091	270°	90 °	W
WALL 252-Shower 5 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	102	0.084	0.091	0°	90 °	N
WALL 256-Shower 6 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	102	0.084	0.091	0°	90 °	N
WALL 260-Noisy Activity 2 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	92	0.084	0.091	0°	90 °	N
WALL 265-Quiet Activity 3 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	128	0.084	0.091	270°	90 °	W
WALL 269-Resident Room 11 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	126	0.084	0.091	270°	90 °	W
WALL 26-Interview Room _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	183	0.084	0.091	90°	90 °	E
WALL 273-Resident Room 12 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	124	0.084	0.091	270°	90 °	W
WALL 277-Resident Room 13 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	124	0.084	0.091	270°	90 °	W
WALL 280-Resident Room 14 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	161	0.084	0.091	0°	90 °	N
WALL 281-Resident Room 14 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	127	0.084	0.091	270°	90 °	W
WALL 283-Resident Room 15 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	127	0.084	0.091	90°	90 °	E
WALL 284-Resident Room 15 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	161	0.084	0.091	0°	90 °	N
WALL 288-Resident Room 16 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	124	0.084	0.091	90°	90 °	E
WALL 292-Shower 7 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	102	0.084	0.091	90°	90 °	E
WALL 296-Shower 8 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	100	0.084	0.091	90°	90 °	E
WALL 301-Noisy Activity 3 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	161	0.084	0.091	90.55°	90 °	E
WALL 306-Hospitality _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	96	0.084	0.091	90°	90 °	E
WALL 311-Entry/Waiting _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	108	0.084	0.091	180°	90 °	S
WALL 312-Entry/Waiting _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	381	0.084	0.091	90°	90 °	E

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 313-Entry/Waiting _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	136	0.084	0.091	0°	90 °	N
WALL 390-Staff Corridor _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	77	0.084	0.091	180°	90 °	S
WALL 402-Corridor 5 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	101	0.084	0.091	180°	90 °	S
WALL 40-Electric _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	230	0.084	0.091	180°	90 °	S
WALL 412-Corridor 4 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	100	0.084	0.091	270°	90 °	W
WALL 424-Corridor 3 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	100	0.084	0.091	0°	90 °	N
WALL 566-Unconditioned Room Room 01-00 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	6	0.084	0.091	0°	90 °	N
WALL 567-Unconditioned Room Room 01-00 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	45	0.084	0.091	270°	90 °	W
WALL 572-Unconditioned Room Room 01-01 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	57	0.084	0.091	270°	90 °	W
WALL 584-Unconditioned Room Room 01-03 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	54	0.084	0.091	180°	90 °	S
WALL 589-Unconditioned Room Room 01-04 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	51	0.084	0.091	180°	90 °	S
WALL 612-Unconditioned Room Room 01-06 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	57	0.084	0.091	0°	90 °	N
WALL 654-Unconditioned Room Room 01-04 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	1	0.084	0.091	0°	90 °	N
WALL 726-Attrium 2 _18	90.1-10 Min Wall, Steel Framed Zone 3	0.3	179	0.084	0.091	180°	90 °	S
WALL 727-Attrium 2 _18	90.1-10 Min Wall, Steel Framed Zone 3	0.3	178	0.084	0.091	90°	90 °	E
WALL 728-Attrium 2 _18	90.1-10 Min Wall, Steel Framed Zone 3	0.3	179	0.084	0.091	0°	90 °	N
WALL 729-Attrium 2 _18	90.1-10 Min Wall, Steel Framed Zone 3	0.3	178	0.084	0.091	270°	90 °	W
WALL 730-Unconditioned Room Room 01-06 _12.6420052252	90.1-10 Min Wall, Steel Framed Zone 3	0.3	0	0.084	0.091	202.72°	90 °	S
WALL 731-Unconditioned Room Room 01-06 _12.7919128827	90.1-10 Min Wall, Steel Framed Zone 3	0.3	2	0.084	0.091	199.12°	90 °	S
WALL 733-Unconditioned Room Room 01-00 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	0	0.084	0.091	22.72°	90 °	N
WALL 736-Unconditioned Room Room 01-03 _13.108842849	90.1-10 Min Wall, Steel Framed Zone 3	0.3	1	0.084	0.091	316.46°	90 °	N
WALL 738-Unconditioned Room Room 01-03 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	0	0.084	0.091	316.54°	90 °	N
WALL 757-Attrium _13.2899728863	90.1-10 Min Wall, Steel Framed Zone 3	0.3	32	0.084	0.091	270°	90 °	W
WALL 758-Attrium _14.0210136804	90.1-10 Min Wall, Steel Framed Zone 3	0.3	25	0.084	0.091	270°	90 °	W

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 760-Attrium _14.2564019478	90.1-10 Min Wall, Steel Framed Zone 3	0.3	21	0.084	0.091	180°	90 °	S
WALL 761-Attrium _12.7378807681	90.1-10 Min Wall, Steel Framed Zone 3	0.3	39	0.084	0.091	180°	90 °	S
WALL 762-Attrium _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	156	0.084	0.091	90°	90 °	E
WALL 764-Attrium _14.1335978361	90.1-10 Min Wall, Steel Framed Zone 3	0.3	24	0.084	0.091	0°	90 °	N
WALL 771-Attrium _12.8311965203	90.1-10 Min Wall, Steel Framed Zone 3	0.3	35	0.084	0.091	0°	90 °	N
WALL 773-Unconditioned Room Room 01-08 _13.7195611268	90.1-10 Min Wall, Steel Framed Zone 3	0.3	22	0.084	0.091	270°	90 °	W
WALL 777-Unconditioned Room Room 01-08 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	626	0.084	0.091	180°	90 °	S
WALL 780-Unconditioned Room Room 01-10 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	1	0.084	0.091	179.55°	90 °	S
WALL 781-Unconditioned Room Room 01-10 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	4	0.084	0.091	90°	90 °	E
WALL 782-Unconditioned Room Room 01-10 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	4	0.084	0.091	180°	90 °	S
WALL 783-Unconditioned Room Room 01-10 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	48	0.084	0.091	0°	90 °	N
WALL 799-Unconditioned Room Room 01-12 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	304	0.084	0.091	270°	90 °	W
WALL 800-Unconditioned Room Room 01-12 _12	90.1-10 Min Wall, Steel Framed Zone 3	0.3	37	0.084	0.091	180°	90 °	S
WALL 835-Electric _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	129	0.084	0.091	90°	90 °	E
WALL 836-Emergency Electric _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	121	0.084	0.091	90°	90 °	E
WALL 837-Mechanical _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	64	0.084	0.091	90°	90 °	E
WALL 838-Fire Room _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	118	0.084	0.091	90°	90 °	E
WALL 839-Comfort Room 1 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	27	0.084	0.091	90°	90 °	E
WALL 840-Interview Room _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	130	0.084	0.091	180°	90 °	S
WALL 841-Sally Port _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	99	0.084	0.091	180°	90 °	S
WALL 842-Unconditioned Room Room 00-80 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	127	0.084	0.091	180°	90 °	S
WALL 843-Unconditioned Room Room 00-80 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	58	0.084	0.091	90°	90 °	E
WALL 846-Unconditioned Room Room 00-80 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	112	0.084	0.091	359.48°	90 °	N
WALL 849-Unconditioned Room Room 00-80 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	15	0.084	0.091	0°	90 °	N

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 850 - COPY-Unconditioned Room Room 00-80 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	51	0.084	0.091	270.44°	90 °	W
WALL 851-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	28	0.084	0.091	180°	90 °	S
WALL 852-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	16	0.084	0.091	270.44°	90 °	W
WALL 853-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	19	0.084	0.091	180°	90 °	S
WALL 854-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	29	0.084	0.091	90°	90 °	E
WALL 855-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	46	0.084	0.091	0.44°	90 °	N
WALL 856-Unconditioned Room Room 00-81 _0	90.1-10 Min Wall, Steel Framed Zone 3	0.3	13	0.084	0.091	271.72°	90 °	W

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 102-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	187	0.28	0.452
WALL 107-Group _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 113-Group _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 114-Group _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 117-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 120-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 124-Soiled Supply _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 128-Toilet 2 _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 136-Chart/Hotel _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 140-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 144-Office 2 _0	Gypsum, Gypsum	0.3	44	0.28	0.452
WALL 368-Meds _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 369-Corridor 1 _0	Gypsum, Gypsum	0.3	78	0.28	0.452
WALL 36-Intake Corridor _0	Gypsum, Gypsum	0.3	83	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 370-Office 2 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 371-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	34	0.28	0.452
WALL 372-Office 1 _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 373-Lounge _0	Gypsum, Gypsum	0.3	218	0.28	0.452
WALL 374-Shower 2 _0	Gypsum, Gypsum	0.3	33	0.28	0.452
WALL 375-Shower 2 _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 376-Shower 2 _0	Gypsum, Gypsum	0.3	87	0.28	0.452
WALL 145-Office 2 _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 377-Kitchen _0	Gypsum, Gypsum	0.3	247	0.28	0.452
WALL 378-General Storage _0	Gypsum, Gypsum	0.3	110	0.28	0.452
WALL 379-General Storage _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 380-General Storage _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 381-General Storage _0	Gypsum, Gypsum	0.3	67	0.28	0.452
WALL 382-Service _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 383-Staff Corridor _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 384-Long Term Belongings Storage _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 385-Hskp _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 386-Electric _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 150-Office 1 _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 387-Emergency Electric _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 388-Mechanical _0	Gypsum, Gypsum	0.3	145	0.28	0.452
WALL 389-IT _0	Gypsum, Gypsum	0.3	203	0.28	0.452
WALL 392-Corridor 5 _0	Gypsum, Gypsum	0.3	174	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 393-Corridor 5_0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 394-Corridor 5_0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 395-Corridor 5_0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 396-Corridor 5_0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 397-Corridor 5_0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 398-Corridor 5_0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 154-Lounge_0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 399-Corridor 5_0	Gypsum, Gypsum	0.3	136	0.28	0.452
WALL 400-Corridor 5_0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 401-Corridor 5_0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 404-Corridor 4_0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 405-Corridor 4_0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 406-Corridor 4_0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 407-Corridor 4_0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 408-Corridor 4_0	Gypsum, Gypsum	0.3	125	0.28	0.452
WALL 409-Corridor 4_0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 410-Corridor 4_0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 158-Lounge_0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 411-Corridor 4_0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 414-Corridor 3_0	Gypsum, Gypsum	0.3	177	0.28	0.452
WALL 415-Corridor 3_0	Gypsum, Gypsum	0.3	128	0.28	0.452
WALL 416-Corridor 3_0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 417-Corridor 3_0	Gypsum, Gypsum	0.3	126	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 418-Corridor 3 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 419-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 420-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 421-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 422-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 165-Kitchen _0	Gypsum, Gypsum	0.3	88	0.28	0.452
WALL 423-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 44-Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 507-Chart/Hotel _0	Gypsum, Gypsum	0.3	50	0.28	0.452
WALL 511-Comfort Room 2 _0	Gypsum, Gypsum	0.3	76	0.28	0.452
WALL 512-Corridor 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 515-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 516-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 517-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 518-Corridor 2.1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 519-Corridor 2.1 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 166-Kitchen _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 520-Chart/Hotel _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 523-Corridor 2.1 _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 54-Comfort Room 1 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 550-Attrium _0	Gypsum, Gypsum	0.3	180	0.28	0.452
WALL 551-Attrium _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 552-Attrium _0	Gypsum, Gypsum	0.3	107	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 553-Attrium _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 554-Attrium _0	Gypsum, Gypsum	0.3	287	0.28	0.452
WALL 555-Attrium _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 556-Attrium _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 171-Kitchen _0	Gypsum, Gypsum	0.3	245	0.28	0.452
WALL 557-Attrium _0	Gypsum, Gypsum	0.3	98	0.28	0.452
WALL 56-Comfort Room 1 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 59-Ante Room _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 60-Ante Room _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 61-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 64-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 65-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 68-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 72-Exam Room _0	Gypsum, Gypsum	0.3	17	0.28	0.452
WALL 73-Ante Room _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 177-Service _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 75-Hskp _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 78-Hskp _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 79-Ante Room _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 80-Comfort Room 1 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 81-Fire Room _0	Gypsum, Gypsum	0.3	36	0.28	0.452
WALL 848-Interview Room _0	Gypsum, Gypsum	0.3	6	0.28	0.452
WALL 87-Laundry _0	Gypsum, Gypsum	0.3	154	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 90-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 93-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 97-Hospitality _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 178-Service _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 181-IT _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 182-Fire Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 183-Fire Room _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 185-Emergency Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 187-General Storage _0	Gypsum, Gypsum	0.3	80	0.28	0.452
WALL 188-General Storage _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 18-Shower 1 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 193-Resident Room 01 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 197-Resident Room 02 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 201-Resident Room 03 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 205-Comfort Room 2 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 214-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 218-Shower 3 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 222-Resident Room 06 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 226-Resident Room 05 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 22-Interview Room _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 231-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 235-Quiet Activity 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 238-Resident Room 07 _0	Gypsum, Gypsum	0.3	159	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 241-Resident Room 08 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 249-Resident Room 10 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 253-Shower 5 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 257-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 261-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 266-Quiet Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 270-Resident Room 11 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 274-Resident Room 12 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 278-Resident Room 13 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 286-Resident Room 15 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 290-Resident Room 16 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 294-Shower 7 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 298-Noisy Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 299-Comfort Room 2 _0	Gypsum, Gypsum	0.3	15	0.28	0.452
WALL 304-Entry/Waiting _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 305-Entry/Waiting _0	Gypsum, Gypsum	0.3	134	0.28	0.452
WALL 307-Entry/Waiting _0	Gypsum, Gypsum	0.3	62	0.28	0.452
WALL 308-Entry/Waiting _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 309-Entry/Waiting _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 30-Interview Room _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 315-Corridor 1 _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 317-Corridor 1 _0	Gypsum, Gypsum	0.3	198	0.28	0.452
WALL 318-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	43	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 319-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	27	0.28	0.452
WALL 320-Servery _0	Gypsum, Gypsum	0.3	38	0.28	0.452
WALL 321-Servery _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 322-Corridor 1 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 323-Corridor 1 _0	Gypsum, Gypsum	0.3	73	0.28	0.452
WALL 324-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 325-Corridor 1 _0	Gypsum, Gypsum	0.3	11	0.28	0.452
WALL 326-Corridor 1 _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 327-Corridor 1 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 328-Corridor 1 _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 330-Corridor 1 _0	Gypsum, Gypsum	0.3	60	0.28	0.452
WALL 333-Comfort Room 2 _0	Gypsum, Gypsum	0.3	66	0.28	0.452
WALL 334-Comfort Room 2 _0	Gypsum, Gypsum	0.3	57	0.28	0.452
WALL 336-Consult 2 _0	Gypsum, Gypsum	0.3	117	0.28	0.452
WALL 337-Consult 1 _0	Gypsum, Gypsum	0.3	115	0.28	0.452
WALL 33-Intake Corridor _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 344-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 345-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 346-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 347-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 348-Corridor 2 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 349-Corridor 2 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 34-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 350-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 351-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 352-Corridor 2 _0	Gypsum, Gypsum	0.3	172	0.28	0.452
WALL 353-Corridor 2 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 358-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 359-Chart/Hotel _0	Gypsum, Gypsum	0.3	196	0.28	0.452
WALL 35-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 360-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 361-Staff Corridor _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 362-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 363-Soiled Supply _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 364-Soiled Supply _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 365-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 366-Laundry _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 367-Meds _0	Gypsum, Gypsum	0.3	132	0.28	0.452

Opaque Exterior Door

	Construction	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Gross Area (ft²)	Parent Surface
DOOR 00_D - WALL 260-Noisy Activity 2 _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 260-Noisy Activity 2 _0
DOOR 01_D - WALL 301-Noisy Activity 3 _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 301-Noisy Activity 3 _0
DOOR 02_D - WALL 106-Multipurpose/Dining _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 106-Multipurpose/Dining _0
DOOR 03_D - WALL 213-Noisy Activity 1 _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 213-Noisy Activity 1 _0
DOOR 04_D - WALL 172-Service _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	49	WALL 172-Service _0

DOOR 05_D - WALL 179-Unconditioned Room Trash _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	28	WALL 179-Unconditioned Room Trash _0
DOOR 06_D - WALL 390-Staff Corridor _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	28	WALL 390-Staff Corridor _0
DOOR 07_D - WALL 40-Electric _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 40-Electric _0
DOOR 11_D - WALL 155-Lounge _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 155-Lounge _0
DOOR 12_D - WALL 311-Entry/Waiting _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	28	WALL 311-Entry/Waiting _0
DOOR 22_D - WALL 836-Emergency Electric _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 836-Emergency Electric _0
DOOR 23_D - WALL 838-Fire Room _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	21	WALL 838-Fire Room _0
DOOR 24_D - WALL 841-Sally Port _0	90.1-10 MIN SWINGING NONRES ZONE 1-6	0.757	2.119	26	WALL 841-Sally Port _0

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 00_W - WALL 412-Corridor 4_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 412-Corridor 4_0	270°	W
WINDOW 39_W - WALL 729-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 729-Attrium 2_18	270°	W
WINDOW 40_W - WALL 729-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 729-Attrium 2_18	270°	W
WINDOW 51_W - WALL 213-Noisy Activity 1_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 52_W - WALL 213-Noisy Activity 1_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 57_W - WALL 225-Resident Room 06_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 225-Resident Room 06_0	270°	W
WINDOW 58_W - WALL 229-Resident Room 05_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 229-Resident Room 05_0	270°	W
WINDOW 59_W - WALL 269-Resident Room 11_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 269-Resident Room 11_0	270°	W
WINDOW 60_W - WALL 273-Resident Room 12_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 273-Resident Room 12_0	270°	W
WINDOW 61_W - WALL 277-Resident Room 13_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 277-Resident Room 13_0	270°	W
WINDOW 62_W - WALL 281-Resident Room 14_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 281-Resident Room 14_0	270°	W
WINDOW 06_W - WALL 402-Corridor 5_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 402-Corridor 5_0	180°	S
WINDOW 41_W - WALL 726-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 726-Attrium 2_18	180°	S
WINDOW 42_W - WALL 726-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 726-Attrium 2_18	180°	S
WINDOW 47_W - WALL 147-Office 2_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 147-Office 2_0	180°	S
WINDOW 48_W - WALL 151-Office 1_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 151-Office 1_0	180°	S
WINDOW 49_W - WALL 155-Lounge_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 155-Lounge_0	180°	S
WINDOW 50_W - WALL 155-Lounge_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 155-Lounge_0	180°	S
WINDOW 53_W - WALL 232-Quiet Activity 2_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 232-Quiet Activity 2_0	180°	S
WINDOW 54_W - WALL 236-Resident Room 07_0	90.1-10 Window Zone 3A/B Nonmetal Frame	17.8	17.8	0.651	0.252	0.319	No	WALL 236-Resident Room 07_0	180°	S
WINDOW 55_W - WALL 239-Resident Room 08_0	90.1-10 Window Zone 3A/B Nonmetal Frame	17.8	17.8	0.651	0.252	0.319	No	WALL 239-Resident Room 08_0	180°	S

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 56_W - WALL 242-Resident Room 09_0	90.1-10 Window Zone 3A/B Nonmetal Frame	17.8	17.8	0.651	0.252	0.319	No	WALL 242-Resident Room 09_0	180°	S
WINDOW 04_W - WALL 313-Entry/Waiting_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 313-Entry/Waiting_0	0°	N
WINDOW 05_W - WALL 424-Corridor 3_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 424-Corridor 3_0	0°	N
WINDOW 07_W - WALL 247-Resident Room 10_0	90.1-10 Window Zone 3A/B Nonmetal Frame	17.8	17.8	0.651	0.252	0.319	No	WALL 247-Resident Room 10_0	0°	N
WINDOW 45_W - WALL 728-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 728-Attrium 2_18	0°	N
WINDOW 46_W - WALL 728-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 728-Attrium 2_18	0°	N
WINDOW 66_W - WALL 208-Comfort Room 2_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 208-Comfort Room 2_0	0°	N
WINDOW 67_W - WALL 122-Consult 2_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 122-Consult 2_0	0°	N
WINDOW 68_W - WALL 119-Consult 1_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 119-Consult 1_0	0°	N
WINDOW 69_W - WALL 111-Group_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 111-Group_0	0°	N
WINDOW 70_W - WALL 111-Group_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 111-Group_0	0°	N
WINDOW 71_W - WALL 106-Multipurpose/Dining_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 72_W - WALL 106-Multipurpose/Dining_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 73_W - WALL 106-Multipurpose/Dining_0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 01_W - WALL 312-Entry/Waiting_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 02_W - WALL 312-Entry/Waiting_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 03_W - WALL 312-Entry/Waiting_0	90.1-10 Window Zone 3A/B Nonmetal Frame	64.8	64.8	0.651	0.252	0.319	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 43_W - WALL 727-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 727-Attrium 2_18	90°	E
WINDOW 44_W - WALL 727-Attrium 2_18	90.1-10 Window Zone 3A/B Nonmetal Frame	7.1	7.1	0.651	0.252	0.319	No	WALL 727-Attrium 2_18	90°	E
WINDOW 63_W - WALL 283-Resident Room 15_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 283-Resident Room 15_0	90°	E
WINDOW 64_W - WALL 288-Resident Room 16_0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 288-Resident Room 16_0	90°	E

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 65_W - WALL 301- Noisy Activity 3 _0	90.1-10 Window Zone 3A/B Nonmetal Frame	7.8	7.8	0.651	0.252	0.319	No	WALL 301-Noisy Activity 3 _0	90.55°	E
WINDOW 74_W - WALL 203- Resident Room 04 _0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 203-Resident Room 04 _0	90°	E
WINDOW 75_W - WALL 199- Resident Room 03 _0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 199-Resident Room 03 _0	90°	E
WINDOW 76_W - WALL 195- Resident Room 02 _0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 195-Resident Room 02 _0	90°	E
WINDOW 77_W - WALL 142- Resident Room 01 _0	90.1-10 Window Zone 3A/B Nonmetal Frame	10.1	10.1	0.651	0.252	0.319	No	WALL 142-Resident Room 01 _0	90°	E
Total or Average		0	827	0.651	0.252	0.319			0°	
North Total or Average		0	223.7	0.651	0.252	0.319			0°	
Non-North Total or Average		0	603.3	0.651	0.252	0.319			0°	

Sunlit Fraction

* Sunlit Fraction is available for calculation timesteps of 15 minutes or less.

	March 21 9am	March 21 Noon	March 21 3pm	June 21 9am	June 21 Noon	June 21 3pm	December 21 9am	December 21 Noon	December 21 3pm
None	0	0	0	0	0	0	0	0	0

Window Controls

	Control Name	Type	Shaded	Control	Glare Control
None					

Load/Airflow Report

Primary

System Name: Single Zone CV

Location				Cooling						Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Kitchen	686	13.10	9/21 16:00	2,532	28,511	18.47	2,532	100	12/21 04:00	2,532	3,488	0	0
		Kitchen	382	11.56	7/21 18:00	2,500	28,257	32.72	2,500	100	12/21 19:00	2,500	12,818	0	0
		Service	304	1.52	9/21 16:00	359	4,061	5.91	359	100	12/21 04:00	359	2,320	0	0

System Name: Variable Refrigerant Flow

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Percent OA	
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	3.59	8/21 17:00	196	3,650	1.05	38	100	12/21 24:00	196	1,152	100	100
	Noisy Activity 1		180	3.59	8/21 17:00	196	3,643	1.05	38	100	12/21 24:00	196	1,149	100	100
	ACT-Noisy-2		181	3.61	7/21 18:00	101	2,101	1.05	38	100	12/21 24:00	101	883	100	100
	Noisy Activity 2		181	3.61	7/21 18:00	100	2,075	1.05	38	100	12/21 24:00	100	867	100	100
	ACT-Noisy-3		182	3.64	7/21 15:00	105	2,184	1.05	38	100	12/21 24:00	105	1,124	100	100
	Noisy Activity 3		182	3.64	7/21 15:00	105	2,174	1.05	38	100	12/21 24:00	105	1,120	100	100
	ACT-Quiet-1		130	2.60	9/21 14:00	60	1,339	1.05	27	100	12/21 24:00	60	357	100	100
	Quiet Activity 1		130	2.60	9/21 14:00	60	1,332	1.05	27	100	12/21 24:00	60	351	100	100
	ACT-Quiet-2		131	2.61	9/21 14:00	86	1,796	1.05	27	100	12/21 24:00	86	547	100	100
	Quiet Activity 2		131	2.61	9/21 14:00	85	1,778	1.05	27	100	12/21 24:00	85	529	100	100
	ACT-Quiet-3		131	2.62	7/21 18:00	78	1,616	1.05	28	100	12/21 24:00	78	522	100	100
	Quiet Activity 3		131	2.62	7/21 18:00	77	1,609	1.05	28	100	12/21 24:00	77	518	100	100
	Admin		189	1.89	10/21 13:00	121	2,517	0.55	21	100	12/21 04:00	121	932	100	100
	Office 1		94	0.94	10/21 14:00	65	1,344	0.55	10	100	12/21 04:00	65	487	100	100
	Office 2		95	0.95	10/21 13:00	60	1,253	0.55	10	100	12/21 04:00	60	458	100	100
	Attrium		1,267	6.33	7/21 17:00	375	7,800	0.43	108	100	12/21 24:00	375	4,900	100	100
	Attrium		622	3.11	7/21 17:00	145	3,006	0.34	53	100	12/21 24:00	145	1,984	100	100
	Attrium 2		645	3.23	9/21 16:00	249	5,176	0.57	55	100	12/21 24:00	249	3,109	100	100
	Chart/Hotel		200	2.00	7/21 19:00	66	1,381	0.55	22	100	12/21 04:00	66	399	100	100
	Chart/Hotel		200	2.00	7/21 19:00	64	1,324	0.55	22	100	12/21 04:00	64	366	100	100
	Comfort/Consult		283	2.83	7/21 17:00	148	3,081	1.27	72	100	12/21 24:00	148	1,176	100	100
	Comfort Room 2		82	0.82	7/21 16:00	43	902	1.27	21	100	12/21 24:00	43	355	100	100
	Consult 1		100	1.00	7/21 17:00	51	1,063	1.27	25	100	12/21 24:00	51	397	100	100
	Consult 2		102	1.02	7/21 17:00	53	1,107	1.27	26	100	12/21 24:00	53	412	100	100
	Corridor-N		409	0.00	6/21 18:00	123	2,547	0.30	25	100	12/21 24:00	123	1,712	100	100
	Corridor 3		409	0.00	6/21 18:00	122	2,542	0.30	25	100	12/21 24:00	122	1,707	100	100
	Corridor-S		414	0.00	10/21 13:00	243	5,047	0.30	25	100	12/21 24:00	243	1,674	100	100
	Corridor 5		414	0.00	10/21 13:00	243	5,045	0.30	25	100	12/21 24:00	243	1,670	100	100
	Corridor-W		324	0.00	7/21 17:00	266	5,525	0.30	19	100	12/21 24:00	266	1,534	100	100
	Corridor 4		324	0.00	7/21 17:00	265	5,499	0.30	19	100	12/21 24:00	265	1,516	100	100
	Entry/Waiting		370	1.85	7/21 09:00	706	14,656	0.43	31	100	12/21 24:00	706	5,258	100	100
	Entry/Waiting		370	1.85	7/21 09:00	710	14,737	0.43	31	100	12/21 24:00	710	5,278	100	100

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 13

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Exam/Storage	224	1.73	7/21 19:00	76	1,572	0.84	37	100	12/21 04:00	76	402	100	100
		Exam Room	123	1.23	7/21 19:00	49	1,016	1.28	31	100	12/21 19:00	49	143	100	100
		Long Term Belongings Storage	101	0.50	7/21 19:00	24	508	0.30	6	100	12/21 04:00	24	231	100	100
	Group		276	5.52	7/21 18:00	144	3,081	1.65	91	100	12/21 24:00	144	1,500	100	100
		Group	276	5.52	7/21 18:00	143	3,075	1.65	91	100	12/21 24:00	143	1,503	100	100
	Hospitality		246	4.92	7/21 16:00	135	2,830	1.65	81	100	12/21 24:00	135	1,324	100	100
		Hospitality	246	4.92	7/21 16:00	135	2,832	1.65	81	100	12/21 24:00	135	1,326	100	100
	Intake-HR-A		470	3.96	9/21 14:00	221	4,598	0.74	69	100	12/21 24:00	221	2,232	100	100
		Intake Corridor	155	0.00	7/21 18:00	28	573	0.30	9	100	12/21 20:00	28	328	100	100
		Interview Room	158	1.58	9/21 16:00	87	1,805	1.28	40	100	12/21 24:00	87	778	100	100
		Sally Port	78	0.78	10/21 13:00	70	1,462	1.28	20	100	12/21 19:00	70	604	100	100
		Shower 1	80	1.60	7/21 17:00	36	757	0.00	0	0	12/21 24:00	36	366	100	100
	Intake-HR-B		165	1.24	7/21 19:00	58	1,203	0.80	26	100	12/21 04:00	58	378	100	100
		Ante Room	81	0.40	7/21 19:00	21	428	0.30	5	100	12/21 04:00	21	191	100	100
		Comfort Room 1	84	0.84	7/21 18:00	37	770	1.28	21	100	12/21 07:00	37	181	100	100
	Lounge		297	5.93	10/21 14:00	238	4,536	1.10	65	100	12/21 24:00	238	1,556	100	100
		Lounge	198	3.95	10/21 14:00	177	3,676	1.65	65	100	12/21 19:00	177	1,237	100	100
		Shower 2	99	1.98	9/21 17:00	55	1,139	0.00	0	0	12/21 19:00	55	321	100	100
	Multipurpose/Dining		485	9.70	7/21 16:00	242	5,270	1.65	160	100	12/21 24:00	242	2,555	100	100
		Multipurpose/Dining	485	9.70	7/21 16:00	241	5,262	1.65	160	100	12/21 24:00	241	2,555	100	100
	RB-N-Corner		130	1.30	7/21 18:00	155	2,667	0.55	14	100	12/21 24:00	155	867	100	100
		Resident Room 14	130	1.30	7/21 18:00	156	2,668	0.55	14	100	12/21 24:00	156	867	100	100
	RB-N-East		257	2.57	7/21 10:00	256	4,524	0.55	28	100	12/21 24:00	256	1,527	100	100
		Resident Room 15	130	1.30	7/21 10:00	131	2,319	0.55	14	100	12/21 24:00	131	873	100	100
		Resident Room 16	127	1.27	7/21 10:00	123	2,196	0.55	14	100	12/21 24:00	123	654	100	100
	RB-N-West		383	3.83	7/21 17:00	442	7,481	0.55	42	100	12/21 24:00	442	1,954	100	100
		Resident Room 11	129	1.29	7/21 17:00	145	2,463	0.55	14	100	12/21 24:00	145	639	100	100
		Resident Room 12	127	1.27	7/21 17:00	147	2,488	0.55	14	100	12/21 24:00	147	641	100	100
		Resident Room 13	127	1.27	7/21 17:00	148	2,500	0.55	14	100	12/21 24:00	148	658	100	100
	RB-S-Corner-N		129	1.29	7/21 10:00	126	2,244	0.55	14	100	12/21 24:00	126	855	100	100
		Resident Room 04	129	1.29	7/21 10:00	127	2,248	0.55	14	100	12/21 24:00	127	858	100	100
	RB-S-Corner-S		131	1.31	9/21 17:00	135	2,804	0.55	14	100	12/21 24:00	135	871	100	100
		Resident Room 05	131	1.31	9/21 17:00	135	2,803	0.55	14	100	12/21 24:00	135	870	100	100

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 13

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-East		372	3.72	7/21 10:00	361	6,422	0.55	41	100	12/21 24:00	361	1,820	100	100
		Resident Room 01	124	1.24	8/21 10:00	114	2,027	0.55	14	100	12/21 24:00	114	545	100	100
		Resident Room 02	112	1.12	7/21 10:00	118	2,046	0.55	12	100	12/21 24:00	118	576	100	100
		Resident Room 03	136	1.36	7/21 10:00	132	2,346	0.55	15	100	12/21 24:00	132	687	100	100
	RB-S-West		124	1.24	7/21 17:00	141	2,402	0.55	14	100	12/21 24:00	141	638	100	100
		Resident Room 06	124	1.24	7/21 17:00	141	2,400	0.55	14	100	12/21 24:00	141	637	100	100
	RB-W-North		130	1.30	7/21 18:00	129	2,297	0.55	14	100	12/21 24:00	129	946	100	100
		Resident Room 10	130	1.30	7/21 18:00	129	2,296	0.55	14	100	12/21 24:00	129	945	100	100
	RB-W-South		380	3.80	10/21 14:00	410	8,516	0.55	42	100	12/21 24:00	410	2,459	100	100
		Resident Room 07	125	1.25	10/21 14:00	132	2,739	0.55	14	100	12/21 24:00	132	716	100	100
		Resident Room 08	126	1.26	10/21 14:00	137	2,844	0.55	14	100	12/21 24:00	137	754	100	100
		Resident Room 09	128	1.28	10/21 14:00	141	2,925	0.55	14	100	12/21 24:00	141	955	100	100
	Servery		228	4.56	7/21 17:00	107	2,401	1.65	75	100	12/21 24:00	107	1,012	100	100
		Servery	228	4.56	7/21 17:00	107	2,400	1.65	75	100	12/21 24:00	107	1,013	100	100
	SHWR-N		204	4.07	7/21 12:00	95	1,981	0.00	0	0	12/21 24:00	95	886	100	100
		Shower 7	103	2.06	7/21 12:00	49	1,013	0.00	0	0	12/21 24:00	49	436	100	100
		Shower 8	101	2.01	7/21 12:00	46	960	0.00	0	0	12/21 24:00	46	439	100	100
	SHWR-S		207	4.14	7/21 18:00	104	2,155	0.00	0	0	12/21 24:00	104	875	100	100
		Shower 3	104	2.08	7/21 18:00	52	1,073	0.00	0	0	12/21 24:00	52	430	100	100
		Shower 4	103	2.06	8/21 18:00	52	1,077	0.00	0	0	12/21 24:00	52	442	100	100
	SHWR-W		207	4.14	7/21 18:00	93	1,931	0.00	0	0	12/21 24:00	93	892	100	100
		Shower 5	104	2.07	7/21 18:00	47	980	0.00	0	0	12/21 24:00	47	453	100	100
		Shower 6	104	2.07	7/21 18:00	45	945	0.00	0	0	12/21 24:00	45	434	100	100
	Support		603	0.00	7/21 19:00	256	5,311	0.30	36	100	12/21 04:00	256	2,755	100	100
		Electric	191	0.00	9/21 15:00	87	1,803	0.30	11	100	12/21 04:00	87	1,026	100	100
		Emergency Electric	179	0.00	7/21 09:00	70	1,446	0.30	11	100	12/21 04:00	70	672	100	100
		Fire Room	79	0.00	8/21 09:00	47	970	0.30	5	100	12/21 04:00	47	518	100	100
		Mechanical	155	0.00	7/21 19:00	53	1,092	0.30	9	100	12/21 04:00	53	285	100	100

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	7.15	7/21 19:00	670	13,920	0.28	164	100	12/21 04:00	670	7,352	100	100
		Clean Supply	102	0.51	7/21 19:00	23	482	0.30	6	100	12/21 04:00	23	230	100	100
		Corridor 1	295	0.00	7/21 18:00	55	1,146	0.30	18	100	12/21 24:00	55	665	100	100
		Corridor 2	635	0.00	7/21 18:00	101	2,089	0.30	38	100	12/21 24:00	101	1,246	100	100
		Corridor 2.1	85	0.00	9/21 16:00	18	382	0.30	5	100	12/21 24:00	18	222	100	100
		General Storage	96	0.48	7/21 19:00	41	861	0.30	6	100	12/21 04:00	41	254	100	100
		Hskp	57	0.28	7/21 19:00	14	294	0.30	3	100	12/21 04:00	14	133	100	100
		IT	158	0.00	7/21 19:00	49	1,018	0.30	9	100	12/21 04:00	49	102	100	100
		Laundry	122	0.61	7/21 19:00	27	565	0.30	7	100	12/21 04:00	27	270	100	100
		Meds	129	0.65	7/21 19:00	29	608	0.30	8	100	12/21 04:00	29	296	100	100
		Soiled Supply	97	0.48	7/21 19:00	23	471	0.30	6	100	12/21 04:00	23	220	100	100
		Staff Corridor	893	0.00	9/21 16:00	199	4,121	0.30	54	100	12/21 07:00	199	2,360	100	100
		Stor.	15	0.07	7/21 19:00	8	164	0.30	1	100	12/21 04:00	8	78	100	100
		Storage	52	0.26	7/21 18:00	20	407	0.30	3	100	12/21 04:00	20	235	100	100
		Toilet 1	67	1.34	7/21 10:00	41	862	0.00	0	0	12/21 24:00	41	359	100	100
		Toilet 2	62	1.24	7/21 18:00	18	462	0.00	0	0	12/21 19:00	18	151	100	100
		Toilet 3	62	1.23	7/21 18:00	18	467	0.00	0	0	12/21 19:00	18	158	100	100

System Name: DOAS to Zone Level Equipment Dehum and Reheat

Location			Cooling							Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of	Supply	Sensible	Minimum	Minimum	Minimum	Time of	Supply	Sensible	Clg %	Htg %
					Peak Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Peak Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
DOAS to Zone Level Equipment Dehum and Reheat			0	111.06	7/21 15:00	1,550	71,733	0.00	1,550	100	12/21 04:00	N/A	36,362	100	100

Load/Airflow Report

ASHRAE 90.1-2010 Baseline

System Name: System 10 - 2010/2013

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	ACH	Airflow (cfm)	%	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
System 10 - 2010/2013			79	0.00		0	0	5.35	85	0	12/21 04:00	85	3,807	0	0
		Fire Room	79	0.00	9/21 14:00	85	1,762	5.35	85	100	12/21 04:00	85	857	0	0
		Fire Room	79	0.00	7/21 10:00	74	1,534	4.66	74	100	12/21 04:00	74	824	0	0

System Name: System 2 - 2007/2010/2013

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Attrium		1,267	6.33	7/21 16:00	568	11,794	2.27	568	100	12/21 24:00	568	7,245	0	0
		Attrium	622	3.11	7/21 17:00	199	4,134	1.29	199	100	12/21 19:00	199	2,782	0	0
		Attrium 2	645	3.23	9/21 15:00	367	7,626	3.80	367	100	12/21 19:00	367	4,704	0	0
	Corridor-N		409	0.00	7/21 09:00	175	3,633	2.14	175	100	12/21 24:00	175	2,392	14	14
		Corridor 3	409	0.00	7/21 18:00	118	2,444	1.44	118	100	12/21 24:00	118	2,421	21	21
	Corridor-S		414	0.00	7/21 17:00	220	4,568	2.66	220	100	12/21 24:00	220	2,406	11	11
		Corridor 5	414	0.00	10/21 13:00	176	3,652	2.12	176	100	12/21 19:00	176	2,365	14	14
	Corridor-W		324	0.00	7/21 18:00	108	2,234	1.66	108	100	12/21 24:00	108	2,166	18	18
		Corridor 4	324	0.00	7/21 17:00	209	4,336	3.22	209	100	12/21 19:00	209	2,147	9	9
	RB-N-Corner		130	1.30	7/21 12:00	96	2,000	3.69	96	100	12/21 24:00	96	1,349	15	15
		Resident Room 14	130	1.30	7/21 18:00	126	2,611	4.82	126	100	12/21 24:00	126	1,345	11	11
	RB-N-East		257	2.57	9/21 14:00	219	4,541	4.26	219	100	12/21 24:00	219	2,315	13	13
		Resident Room 15	130	1.30	7/21 10:00	102	2,119	3.92	102	100	12/21 24:00	102	1,351	14	14
		Resident Room 16	127	1.27	7/21 10:00	95	1,977	3.76	95	100	12/21 24:00	95	961	14	14
	RB-N-West		383	3.83	7/21 17:00	230	4,782	3.01	230	100	12/21 24:00	230	2,863	18	18
		Resident Room 11	129	1.29	7/21 18:00	111	2,311	4.31	111	100	12/21 24:00	111	941	13	13
		Resident Room 12	127	1.27	7/21 18:00	111	2,309	4.39	111	100	12/21 24:00	111	941	13	13
		Resident Room 13	127	1.27	7/21 18:00	112	2,326	4.42	112	100	12/21 24:00	112	968	13	13
	RB-S-Corner-N		129	1.29	9/21 16:00	124	2,564	4.79	124	100	12/21 24:00	124	1,324	11	11
		Resident Room 04	129	1.29	9/21 14:00	110	2,275	4.25	110	100	12/21 19:00	110	1,333	13	13
	RB-S-Corner-S		131	1.31	7/21 18:00	115	2,376	4.36	115	100	12/21 24:00	115	1,348	13	13
		Resident Room 05	131	1.31	9/21 16:00	136	2,817	5.17	136	100	12/21 19:00	136	1,351	11	11
	RB-S-East		372	3.72	9/21 14:00	284	5,890	3.82	284	100	12/21 24:00	284	2,654	14	14
		Resident Room 01	124	1.24	8/21 10:00	82	1,707	3.32	82	100	12/21 19:00	82	782	15	15
		Resident Room 02	112	1.12	7/21 10:00	87	1,797	3.88	87	100	12/21 19:00	87	844	15	15
		Resident Room 03	136	1.36	7/21 10:00	101	2,090	3.69	101	100	12/21 19:00	101	1,014	15	15
	RB-S-West		124	1.24	7/21 18:00	78	1,626	3.16	78	100	12/21 24:00	78	942	17	17
		Resident Room 06	124	1.24	7/21 17:00	109	2,265	4.40	109	100	12/21 19:00	109	940	12	12
	RB-W-North		130	1.30	7/21 10:00	114	2,365	4.39	114	100	12/21 24:00	114	1,439	13	13
		Resident Room 10	130	1.30	7/21 18:00	118	2,450	4.55	118	100	12/21 19:00	118	1,442	12	12

Location					Cooling					Heating			Percent OA		
			Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
System	Zone	Room													
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-W-South		380	3.80	7/21 17:00	401	8,318	5.28	401	100	12/21 24:00	401	3,604	10	10
		Resident Room 07	125	1.25	9/21 14:00	111	2,302	4.42	111	100	12/21 19:00	111	1,028	12	12
		Resident Room 08	126	1.26	10/21 14:00	115	2,379	4.54	115	100	12/21 19:00	115	1,085	12	12
		Resident Room 09	128	1.28	9/21 15:00	134	2,777	5.23	134	100	12/21 19:00	134	1,449	12	12
	SHWR-N		204	4.07	9/21 14:00	125	2,589	3.06	125	100	12/21 24:00	125	1,338	0	0
		Shower 7	103	2.06	7/21 11:00	61	1,266	2.96	61	100	12/21 24:00	61	661	0	0
		Shower 8	101	2.01	7/21 11:00	58	1,205	2.88	58	100	12/21 24:00	58	660	0	0
	SHWR-S		207	4.14	7/21 18:00	111	2,302	2.68	111	100	12/21 24:00	111	1,330	0	0
		Shower 3	104	2.08	7/21 18:00	70	1,446	3.35	70	100	12/21 19:00	70	656	0	0
		Shower 4	103	2.06	7/21 18:00	70	1,462	3.41	70	100	12/21 19:00	70	669	0	0
	SHWR-W		207	4.14	7/21 11:00	124	2,578	3.00	124	100	12/21 24:00	124	1,365	0	0
		Shower 5	104	2.07	7/21 18:00	57	1,192	2.77	57	100	12/21 19:00	57	688	0	0
		Shower 6	104	2.07	7/21 18:00	56	1,153	2.68	56	100	12/21 19:00	56	656	0	0

System Name: System 4 - 2007/2010/2013

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	3.59	7/21 18:00	118	2,450	3.29	118	100	12/21 24:00	118	1,638	32	32
	Noisy Activity 1		180	3.59	8/21 17:00	182	3,779	5.07	182	100	12/21 19:00	182	1,632	21	21
	ACT-Noisy-2		181	3.61	7/21 09:00	116	2,398	3.20	116	100	12/21 24:00	116	1,242	33	33
	Noisy Activity 2		181	3.61	7/21 18:00	105	2,177	2.90	105	100	12/21 19:00	105	1,229	36	36
	ACT-Noisy-3		182	3.64	7/21 15:00	113	2,336	3.09	113	100	12/21 24:00	113	1,564	34	34
	Noisy Activity 3		182	3.64	7/21 15:00	111	2,312	3.06	111	100	12/21 24:00	111	1,554	34	34
	ACT-Quiet-1		130	2.60	7/21 18:00	66	1,364	2.52	66	100	12/21 24:00	66	493	42	42
	Quiet Activity 1		130	2.60	7/21 17:00	63	1,316	2.43	63	100	12/21 19:00	63	484	43	43
	ACT-Quiet-2		131	2.61	7/21 17:00	92	1,903	3.51	92	100	12/21 24:00	92	768	30	30
	Quiet Activity 2		131	2.61	9/21 15:00	82	1,695	3.13	82	100	12/21 19:00	82	740	34	34
	ACT-Quiet-3		131	2.62	7/21 16:00	73	1,508	2.77	73	100	12/21 24:00	73	789	38	38
	Quiet Activity 3		131	2.62	7/21 18:00	90	1,871	3.44	90	100	12/21 24:00	90	785	31	31
	Admin		189	1.89	7/21 17:00	184	3,823	4.86	184	100	12/21 04:00	184	1,438	11	11
	Office 1		94	0.94	9/21 14:00	89	1,840	4.70	89	100	12/21 04:00	89	746	12	12
	Office 2		95	0.95	9/21 13:00	81	1,685	4.27	81	100	12/21 04:00	81	704	12	12
	Chart/Hotel		200	2.00	7/21 19:00	80	1,656	2.00	80	100	12/21 04:00	80	541	28	28
	Chart/Hotel		200	2.00	7/21 19:00	76	1,569	1.89	76	100	12/21 04:00	76	492	29	29
	Comfort/Consult		283	2.83	7/21 15:00	179	3,720	3.16	179	100	12/21 24:00	179	1,885	40	40
	Comfort Room 2		82	0.82	7/21 14:00	51	1,062	3.12	51	100	12/21 24:00	51	573	41	41
	Consult 1		100	1.00	7/21 15:00	61	1,274	3.07	61	100	12/21 24:00	61	647	41	41
	Consult 2		102	1.02	7/21 15:00	64	1,320	3.13	64	100	12/21 24:00	64	671	41	41
	Entry/Waiting		370	1.85	10/21 14:00	557	11,571	7.52	557	100	12/21 24:00	557	6,937	6	6
	Entry/Waiting		370	1.85	7/21 09:00	527	10,933	7.11	527	100	12/21 24:00	527	6,966	6	6
	Exam/Storage		224	1.73	7/21 15:00	97	2,021	2.18	97	100	12/21 04:00	97	645	38	38
	Exam Room		123	1.23	7/21 15:00	57	1,175	2.30	57	100	12/21 20:00	57	268	39	39
	Long Term Belongings Storage		101	0.50	7/21 15:00	39	807	1.93	39	100	12/21 04:00	39	340	39	39
	Group		276	5.52	7/21 15:00	186	3,867	3.37	186	100	12/21 24:00	186	2,115	49	49
	Group		276	5.52	7/21 15:00	181	3,762	3.28	181	100	12/21 24:00	181	2,117	50	50
	Hospitality		246	4.92	7/21 15:00	165	3,428	3.36	165	100	12/21 24:00	165	1,875	49	49
	Hospitality		246	4.92	7/21 15:00	164	3,412	3.34	164	100	12/21 24:00	164	1,865	49	49

Location				Cooling						Heating			Percent OA		
			Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Percent OA	
System	Zone	Room												Clg %	Htg %
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Intake-HR-A	470	3.96	7/21 17:00	333	6,906	3.54	333	100	12/21 24:00	333	3,139	21	21
		Intake Corridor	155	0.00	7/21 15:00	46	955	1.49	46	100	12/21 20:00	46	502	23	23
		Interview Room	158	1.58	9/21 15:00	111	2,302	3.51	111	100	12/21 24:00	111	1,290	23	23
		Sally Port	78	0.78	9/21 13:00	95	1,976	6.12	95	100	12/21 19:00	95	910	23	23
		Shower 1	80	1.60	7/21 15:00	50	1,036	3.12	50	100	12/21 24:00	50	515	23	23
		Intake-HR-B	165	1.24	7/21 15:00	79	1,641	2.40	79	100	12/21 04:00	79	618	33	33
		Ante Room	81	0.40	7/21 15:00	32	674	2.01	32	100	12/21 04:00	32	285	33	33
		Comfort Room 1	84	0.84	7/21 14:00	46	962	2.77	46	100	12/21 07:00	46	321	33	33
		Lounge	297	5.93	7/21 17:00	317	6,571	5.34	317	100	12/21 20:00	317	2,312	21	21
		Lounge	198	3.95	9/21 14:00	226	4,685	5.71	226	100	12/21 08:00	226	1,806	22	22
		Shower 2	99	1.98	9/21 15:00	77	1,598	3.89	77	100	12/21 08:00	77	483	22	22
		Multipurpose/Dining	485	9.70	7/21 15:00	315	6,533	3.24	315	100	12/21 24:00	315	3,475	51	51
		Multipurpose/Dining	485	9.70	7/21 15:00	307	6,376	3.16	307	100	12/21 24:00	307	3,485	52	52
		Servery	228	4.56	7/21 15:00	144	2,984	3.15	144	100	12/21 24:00	144	1,425	52	52
		Servery	228	4.56	7/21 15:00	141	2,927	3.09	141	100	12/21 24:00	141	1,414	53	53
		Support	524	0.00	9/21 15:00	385	7,994	3.67	385	100	12/21 04:00	385	3,358	8	8
		Electric	191	0.00	9/21 14:00	164	3,398	4.29	164	100	12/21 04:00	164	1,727	9	9
		Emergency Electric	179	0.00	7/21 10:00	107	2,213	2.98	107	100	12/21 04:00	107	1,111	9	9
		Mechanical	155	0.00	7/21 14:00	70	1,443	2.25	70	100	12/21 04:00	70	569	9	9

Location					Cooling					Heating			Percent OA			
			Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %	
System	Zone	Room														
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	7.15	7/21 16:00	1,060	22,001	1.81	1,060	100	12/21 04:00	1,060	11,000	15	15	
		Clean Supply	102	0.51	7/21 15:00	38	785	1.85	38	100	12/21 04:00	38	338	16	16	
		Corridor 1	295	0.00	7/21 15:00	87	1,814	1.48	87	100	12/21 24:00	87	993	16	16	
		Corridor 2	635	0.00	7/21 15:00	146	3,039	1.15	146	100	12/21 24:00	146	1,871	16	16	
		Corridor 2.1	85	0.00	7/21 18:00	19	402	1.13	19	100	12/21 19:00	19	324	16	16	
		General Storage	96	0.48	7/21 15:00	56	1,170	2.95	56	100	12/21 04:00	56	375	16	16	
		Hskp	57	0.28	7/21 15:00	23	486	2.06	23	100	12/21 04:00	23	205	16	16	
		IT	158	0.00	7/21 19:00	62	1,277	1.95	62	100	12/21 04:00	62	307	16	16	
		Laundry	122	0.61	7/21 15:00	44	918	1.82	44	100	12/21 04:00	44	396	16	16	
		Meds	129	0.65	7/21 15:00	48	987	1.84	48	100	12/21 04:00	48	432	16	16	
		Soiled Supply	97	0.48	7/21 15:00	37	760	1.89	37	100	12/21 04:00	37	323	16	16	
		Staff Corridor	893	0.00	9/21 14:00	328	6,818	1.84	328	100	12/21 07:00	328	3,603	16	16	
		Stor.	15	0.07	7/21 15:00	11	226	3.74	11	100	12/21 04:00	11	111	16	16	
		Storage	52	0.26	7/21 15:00	28	584	2.70	28	100	12/21 04:00	28	347	16	16	
		Toilet 1	67	1.34	7/21 15:00	45	932	3.36	45	100	12/21 24:00	45	472	16	16	
		Toilet 2	62	1.24	7/21 15:00	35	717	2.79	35	100	12/21 19:00	35	222	16	16	
		Toilet 3	62	1.23	7/21 15:00	35	727	2.84	35	100	12/21 19:00	35	230	16	16	

System Name: System 4 - 2007/2010/2013_Copy

Location			Cooling							Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
System 4 - 2007/2010/2013_Copy			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	13.10	7/21 16:00	2,793	57,959	20.37	2,793	100	12/21 04:00	2,793	55,106	8	8
		Kitchen	382	11.56	7/21 16:00	2,500	51,853	32.72	2,500	100	12/21 08:00	2,500	51,271	8	8
		Service	304	1.52	9/21 15:00	301	6,243	4.95	301	100	12/21 04:00	301	3,376	8	8

Zone Summary

Zone Summary										
Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
ACT-Noisy-1	180	Yes	2,156	174	16	50.06	1	0.5	0 	10.22
ACT-Noisy-2	181	Yes	2,170	92	0	50.06	1	0.5	0 	10.22
ACT-Noisy-3	182	Yes	2,186	161	8	50.06	1	0.5	0 	10.22
ACT-Quiet-1	130	Yes	1,564	0	0	50.06	1	0.5	0 	10.22
ACT-Quiet-2	131	Yes	1,568	48	8	50.06	1	0.5	0 	10.22
ACT-Quiet-3	131	Yes	1,573	128	0	50.06	1	0.5	0 	10.22
Admin	189	Yes	2,272	215	16	100.01	0.7	1	0 	10.22
Attrium	1,267	Yes	15,043	1,046	57	200.01	0.6	0	0 	10.22
Chart/Hotel	200	Yes	2,395	0	0	100.01	0.7	1	0 	10.22
Comfort/Consult	283	Yes	3,402	336	23	100.01	1.2	0.75	0 	10.22
Corridor-N	409	Yes	4,909	100	65	0	0.4	0	0 	10.22
Corridor-S	414	Yes	4,967	101	65	0	0.4	0	0 	10.22
Corridor-W	324	Yes	3,888	100	65	0	0.4	0	0 	10.22
Entry/Waiting	370	Yes	4,445	625	259	200.01	0.6	0	0 	10.22
Exam/Storage	224	Yes	2,685	0	0	129.07	0.88	0.52	0 	10.22
Group	276	Yes	3,317	295	16	50.06	0.75	0.5	0 	10.22
Hospitality	246	Yes	2,953	260	0	50.06	0.75	0.5	0 	10.22
Intake-HR-A	470	Yes	5,646	449	0	118.85	0.82	0.38	0 	10.22
Intake-HR-B	165	Yes	1,976	27	0	132.52	0.86	0.5	0 	10.22
Kitchen	686	Yes	8,226	607	0	52.32	0.58	9.58	0 	10.22
Lounge	297	Yes	3,561	250	16	50.06	0.67	0.33	0 	10.22
Multipurpose/Dining	485	Yes	5,825	322	23	50.06	0.75	0.5	0 	10.22

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 12

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
RB-N-Corner	130	Yes	1,565	288	10	100.01	1.2	2	0 	10.22
RB-N-East	257	Yes	3,084	412	20	100.01	1.2	2	0 	10.22
RB-N-West	383	Yes	4,590	374	30	100.01	1.2	2	0 	10.22
RB-S-Corner-N	129	Yes	1,549	286	10	100.01	1.2	2	0 	10.22
RB-S-Corner-S	131	Yes	1,575	289	10	100.01	1.2	2	0 	10.22
RB-S-East	372	Yes	4,463	328	30	100.01	1.2	2	0 	10.22
RB-S-West	124	Yes	1,488	122	10	100.01	1.2	2	0 	10.22
RB-W-North	130	Yes	1,557	288	18	100.01	1.2	2	0 	10.22
RB-W-South	380	Yes	4,554	534	53	100.01	1.2	2	0 	10.22
Servery	228	Yes	2,738	160	0	50.06	0.75	0.5	0 	10.22
SHWR-N	204	Yes	2,443	202	0	50.06	0.5	0	0 	10.22
SHWR-S	207	Yes	2,486	206	0	50.06	0.5	0	0 	10.22
SHWR-W	207	Yes	2,485	204	0	50.06	0.5	0	0 	10.22
Support	603	Yes	7,241	661	0	0	0.5	2	0 	10.22
Utility	2,926	Yes	35,118	109	0	409.28	0.43	0.17	0 	10.22
Room 00-80	4	No	46	362	0	0	0	0	0 	10.22
Room 00-81	3	No	40	151	0	50.06	0.75	0.5	0 	10.22
Room 01-00	634	No	2,007	51	0	0	0	0	0 	10.22
Room 01-01	748	No	2,384	57	0	0	0	0	0 	10.22
Room 01-03	1,001	No	3,162	55	0	0	0	0	0 	10.22
Room 01-04	959	No	2,991	51	0	0	0	0	0 	10.22
Room 01-06	1,009	No	3,156	60	0	0	0	0	0 	10.22
Room 01-08	1,572	No	4,817	648	0	0	0	0	0 	10.22
Room 01-10	769	No	2,563	56	0	0	0	0	0 	10.22

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
Room 01-12	675	No	2,044	340	0	0	0	0	0	10.22
Trash	76	No	915	96	0	200.01	0.5	0.25	0	10.22
Conditioned Total	13,652		163,664	9,802	827	110.02	0.7	1.06	0	10.22
Total	21,103		187,790	11,729	827	169.33	0.45	0.69	0	10.22
Unconditioned Total	7,451		24,127	1,927	0	16,614.43	0.01	0	0	10.22

Design Day: Zone Cooling (1%) and Heating (99%)

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
ACT-Noisy-1	Cooling	0.3 tons	0.3 tons	197	197	8/21 17:00	94	0	0	2.7
	Heating	1.2 Mbh	1.2 Mbh	197	197	12/21 24:00	32.1	0	0	11.0
ACT-Noisy-2	Cooling	0.2 tons	0.2 tons	102	102	7/21 18:00	91.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	102	102	12/21 24:00	32.1	0	0	11.0
ACT-Noisy-3	Cooling	0.2 tons	0.2 tons	106	106	7/21 15:00	98.8	0	0	2.7
	Heating	1.1 Mbh	1.1 Mbh	106	106	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-1	Cooling	0.1 tons	0.1 tons	59	59	9/21 14:00	98.4	0	0	2.7
	Heating	0.4 Mbh	0.4 Mbh	59	59	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-2	Cooling	0.1 tons	0.1 tons	87	87	9/21 14:00	98.4	0	0	2.7
	Heating	0.5 Mbh	0.5 Mbh	87	87	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-3	Cooling	0.1 tons	0.1 tons	78	78	7/21 18:00	91.4	0	0	2.7
	Heating	0.5 Mbh	0.5 Mbh	78	78	12/21 24:00	32.1	0	0	11.0
Admin	Cooling	0.2 tons	0.2 tons	121	121	10/21 13:00	88.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	121	121	12/21 04:00	32.1	0	0	11.0
Attrium	Cooling	0.7 tons	0.7 tons	375	375	7/21 17:00	94.5	0	0	2.7
	Heating	4.9 Mbh	4.9 Mbh	375	375	12/21 24:00	32.1	0	0	11.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
Chart/Hotel	Cooling	0.1 tons	0.1 tons	66	66	7/21 19:00	86.7	0	0	2.7
	Heating	0.4 Mbh	0.4 Mbh	66	66	12/21 04:00	32.1	0	0	11.0
Comfort/Consult	Cooling	0.3 tons	0.3 tons	148	148	7/21 17:00	94.5	0	0	2.7
	Heating	1.2 Mbh	1.2 Mbh	148	148	12/21 24:00	32.1	0	0	11.0
Corridor-N	Cooling	0.2 tons	0.2 tons	123	123	6/21 18:00	87.4	0	0	2.7
	Heating	1.7 Mbh	1.7 Mbh	123	123	12/21 24:00	32.1	0	0	11.0
Corridor-S	Cooling	0.4 tons	0.4 tons	244	244	10/21 13:00	88.4	0	0	2.7
	Heating	1.7 Mbh	1.7 Mbh	244	244	12/21 24:00	32.1	0	0	11.0
Corridor-W	Cooling	0.5 tons	0.5 tons	267	267	7/21 17:00	94.5	0	0	2.7
	Heating	1.5 Mbh	1.5 Mbh	267	267	12/21 24:00	32.1	0	0	11.0
Entry/Waiting	Cooling	1.2 tons	1.2 tons	706	706	7/21 09:00	81.8	0	0	2.7
	Heating	5.3 Mbh	5.3 Mbh	706	706	12/21 24:00	32.1	0	0	11.0
Exam/Storage	Cooling	0.1 tons	0.1 tons	76	76	7/21 19:00	86.7	0	0	2.7
	Heating	0.4 Mbh	0.4 Mbh	76	76	12/21 04:00	32.1	0	0	11.0
Group	Cooling	0.3 tons	0.3 tons	144	144	7/21 18:00	91.4	0	0	2.7
	Heating	1.5 Mbh	1.5 Mbh	144	144	12/21 24:00	32.1	0	0	11.0
Hospitality	Cooling	0.2 tons	0.2 tons	136	136	7/21 16:00	96.9	0	0	2.7
	Heating	1.3 Mbh	1.3 Mbh	136	136	12/21 24:00	32.1	0	0	11.0
Intake-HR-A	Cooling	0.3 tons	0.4 tons	197	220	9/21 14:00	98.4	0	0	2.7
	Heating	2 Mbh	2.2 Mbh	197	220	12/21 24:00	32.1	0	0	11.0
Intake-HR-B	Cooling	0.1 tons	0.1 tons	57	57	7/21 19:00	86.7	0	0	2.7
	Heating	0.4 Mbh	0.4 Mbh	57	57	12/21 04:00	32.1	0	0	11.0
Kitchen	Cooling	2.4 tons	2.4 tons	2,507	2,507	9/21 16:00	96.5	0	0	2.7
	Heating	3.5 Mbh	3.5 Mbh	680	680	12/21 04:00	32.1	0	0	11.0
Lounge	Cooling	0.4 tons	0.4 tons	237	237	10/21 14:00	89.8	0	0	2.7

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
	Heating	1.6 Mbh	1.6 Mbh	237	237	12/21 24:00	32.1	0	0	11.0
Multipurpose/Dining	Cooling	0.4 tons	0.4 tons	242	242	7/21 16:00	96.9	0	0	2.7
	Heating	2.6 Mbh	2.6 Mbh	242	242	12/21 24:00	32.1	0	0	11.0
RB-N-Corner	Cooling	0.2 tons	0.2 tons	155	155	7/21 18:00	91.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	155	155	12/21 24:00	32.1	0	0	11.0
RB-N-East	Cooling	0.4 tons	0.4 tons	256	256	7/21 10:00	87	0	0	2.7
	Heating	1.5 Mbh	1.5 Mbh	256	256	12/21 24:00	32.1	0	0	11.0
RB-N-West	Cooling	0.6 tons	0.6 tons	441	441	7/21 17:00	94.5	0	0	2.7
	Heating	2 Mbh	2 Mbh	381	381	12/21 24:00	32.1	0	0	11.0
RB-S-Corner-N	Cooling	0.2 tons	0.2 tons	127	127	7/21 10:00	87	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	127	127	12/21 24:00	32.1	0	0	11.0
RB-S-Corner-S	Cooling	0.2 tons	0.2 tons	136	136	9/21 17:00	94.1	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	136	136	12/21 24:00	32.1	0	0	11.0
RB-S-East	Cooling	0.5 tons	0.5 tons	360	360	7/21 10:00	87	0	0	2.7
	Heating	1.8 Mbh	1.8 Mbh	356	356	12/21 24:00	32.1	0	0	11.0
RB-S-West	Cooling	0.2 tons	0.2 tons	142	142	7/21 17:00	94.5	0	0	2.7
	Heating	0.6 Mbh	0.6 Mbh	125	125	12/21 24:00	32.1	0	0	11.0
RB-W-North	Cooling	0.2 tons	0.2 tons	129	129	7/21 18:00	91.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	129	129	12/21 24:00	32.1	0	0	11.0
RB-W-South	Cooling	0.7 tons	0.7 tons	409	409	10/21 14:00	89.8	0	0	2.7
	Heating	2.5 Mbh	2.5 Mbh	409	409	12/21 24:00	32.1	0	0	11.0
Servery	Cooling	0.2 tons	0.2 tons	108	108	7/21 17:00	94.5	0	0	2.7
	Heating	1 Mbh	1 Mbh	108	108	12/21 24:00	32.1	0	0	11.0
SHWR-N	Cooling	0.2 tons	0.2 tons	95	95	7/21 12:00	94.8	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	95	95	12/21 24:00	32.1	0	0	11.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Calculated Heating Load (Mbh)
									MinMax
SHWR-S	Cooling	0.2 tons	0.2 tons	104	104	7/21 18:00	91.4	0	0 2.7
	Heating	0.9 Mbh	0.9 Mbh	104	104	12/21 24:00	32.1	0	0 11.0
SHWR-W	Cooling	0.2 tons	0.2 tons	93	93	7/21 18:00	91.4	0	0 2.7
	Heating	0.9 Mbh	0.9 Mbh	93	93	12/21 24:00	32.1	0	0 11.0
Support	Cooling	0.4 tons	0.4 tons	233	256	7/21 19:00	86.7	0	0 2.7
	Heating	2.5 Mbh	2.8 Mbh	233	256	12/21 04:00	32.1	0	0 11.0
Utility	Cooling	1.2 tons	1.2 tons	670	670	7/21 19:00	86.7	0	0 2.7
	Heating	7.4 Mbh	7.4 Mbh	670	670	12/21 04:00	32.1	0	0 11.0

Zone Summary

Zone Summary										
Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
ACT-Noisy-1	180	Yes	2,156	174	16	50.06	0.73	0.5	0 	10.22
ACT-Noisy-2	181	Yes	2,170	92	0	50.06	0.73	0.5	0 	10.22
ACT-Noisy-3	182	Yes	2,186	161	8	50.06	0.73	0.5	0 	10.22
ACT-Quiet-1	130	Yes	1,564	0	0	50.06	0.73	0.5	0 	10.22
ACT-Quiet-2	131	Yes	1,568	48	8	50.06	0.73	0.5	0 	10.22
ACT-Quiet-3	131	Yes	1,573	128	0	50.06	0.73	0.5	0 	10.22
Admin	189	Yes	2,272	215	16	100.01	1.11	1	0 	10.22
Attrium	1,267	Yes	15,043	1,046	57	200.01	0.9	0	0 	10.22
Chart/Hotel	200	Yes	2,395	0	0	100.01	1.11	1	0 	10.22
Comfort/Consult	283	Yes	3,402	336	23	100.01	1.66	0.75	0 	10.22
Corridor-N	409	Yes	4,909	100	65	0	0.89	0	0 	10.22
Corridor-S	414	Yes	4,967	101	65	0	0.89	0	0 	10.22
Corridor-W	324	Yes	3,888	100	65	0	0.89	0	0 	10.22
Entry/Waiting	370	Yes	4,445	625	259	200.01	0.9	0	0 	10.22
Exam/Storage	224	Yes	2,685	0	0	129.07	1.2	0.52	0 	10.22
Fire Room	79	Yes	951	118	0	0	0.95	2	0 	10.22
Group	276	Yes	3,317	295	16	50.06	0.89	0.5	0 	10.22
Hospitality	246	Yes	2,953	260	0	50.06	0.89	0.5	0 	10.22
Intake-HR-A	470	Yes	5,646	449	0	118.85	1.29	0.38	0 	10.22
Intake-HR-B	165	Yes	1,976	27	0	132.52	1.15	0.5	0 	10.22
Kitchen	686	Yes	8,226	607	0	52.32	0.64	9.58	0 	10.22
Lounge	297	Yes	3,561	250	16	50.06	0.92	0.33	0 	10.22

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
Multipurpose/Dining	485	Yes	5,825	322	23	50.06	0.89	0.5	0 	10.22
RB-N-Corner	130	Yes	1,565	288	10	100.01	0.38	2	0 	10.22
RB-N-East	257	Yes	3,084	412	20	100.01	0.38	2	0 	10.22
RB-N-West	383	Yes	4,590	374	30	100.01	0.38	2	0 	10.22
RB-S-Corner-N	129	Yes	1,549	286	10	100.01	0.38	2	0 	10.22
RB-S-Corner-S	131	Yes	1,575	289	10	100.01	0.38	2	0 	10.22
RB-S-East	372	Yes	4,463	328	30	100.01	0.38	2	0 	10.22
RB-S-West	124	Yes	1,488	122	10	100.01	0.38	2	0 	10.22
RB-W-North	130	Yes	1,557	288	18	100.01	0.38	2	0 	10.22
RB-W-South	380	Yes	4,554	534	53	100.01	0.38	2	0 	10.22
Servery	228	Yes	2,738	160	0	50.06	0.89	0.5	0 	10.22
SHWR-N	204	Yes	2,443	202	0	50.06	0.98	0	0 	10.22
SHWR-S	207	Yes	2,486	206	0	50.06	0.98	0	0 	10.22
SHWR-W	207	Yes	2,485	204	0	50.06	0.98	0	0 	10.22
Support	524	Yes	6,290	543	0	0	0.95	2	0 	10.22
Utility	2,926	Yes	35,118	109	0	409.28	0.84	0.17	0 	10.22
Room 00-80	4	No	46	362	0	0	0	0	0 	10.22
Room 00-81	3	No	40	151	0	50.06	0.89	0.5	0 	10.22
Room 01-00	634	No	2,007	51	0	0	0	0	0 	10.22
Room 01-01	748	No	2,384	57	0	0	0	0	0 	10.22
Room 01-03	1,001	No	3,162	55	0	0	0	0	0 	10.22
Room 01-04	959	No	2,991	51	0	0	0	0	0 	10.22
Room 01-06	1,009	No	3,156	60	0	0	0	0	0 	10.22
Room 01-08	1,572	No	4,817	648	0	0	0	0	0 	10.22

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
Room 01-10	769	No	2,563	56	0	0	0	0	0	10.22
Room 01-12	675	No	2,044	340	0	0	0	0	0	10.22
Trash	76	No	915	96	0	200.01	0.63	0.25	0	10.22
Conditioned Total	13,652		163,664	9,802	827	110.02	0.83	1.06	0	10.22
Total	21,103		187,790	11,729	827	169.33	0.54	0.69	0	10.22
Unconditioned Total	7,451		24,127	1,927	0	16,614.43	0.01	0	0	10.22

Design Day: Zone Cooling (1%) and Heating (99%)

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
ACT-Noisy-1	Cooling	0.3 tons	0.3 tons	182	182	8/21 17:00	94	0	0	2.7
	Heating	1.6 Mbh	1.6 Mbh	81	81	12/21 24:00	32.1	0	0	11.0
ACT-Noisy-2	Cooling	0.2 tons	0.2 tons	106	106	7/21 18:00	91.4	0	0	2.7
	Heating	1.3 Mbh	1.3 Mbh	61	61	12/21 24:00	32.1	0	0	11.0
ACT-Noisy-3	Cooling	0.2 tons	0.2 tons	112	112	7/21 15:00	98.8	0	0	2.7
	Heating	1.6 Mbh	1.6 Mbh	76	76	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-1	Cooling	0.1 tons	0.1 tons	64	64	7/21 17:00	94.5	0	0	2.7
	Heating	0.5 Mbh	0.5 Mbh	23	28	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-2	Cooling	0.1 tons	0.1 tons	85	85	9/21 15:00	98.4	0	0	2.7
	Heating	0.8 Mbh	0.8 Mbh	38	38	12/21 24:00	32.1	0	0	11.0
ACT-Quiet-3	Cooling	0.2 tons	0.2 tons	91	91	7/21 18:00	91.4	0	0	2.7
	Heating	0.8 Mbh	0.8 Mbh	38	38	12/21 24:00	32.1	0	0	11.0
Admin	Cooling	0.3 tons	0.3 tons	165	165	9/21 14:00	98.4	0	0	2.7
	Heating	1.4 Mbh	1.4 Mbh	70	70	12/21 04:00	32.1	0	0	11.0
Attrium	Cooling	0.9 tons	1 tons	532	566	7/21 16:00	96.9	0	0	2.7

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 9 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
	Heating	7.2 Mbh	7.2 Mbh	354	354	12/21 24:00	32.1	0	0	11.0
Chart/Hotel	Cooling	0.1 tons	0.1 tons	78	78	7/21 19:00	86.7	0	0	2.7
	Heating	0.5 Mbh	0.5 Mbh	25	25	12/21 04:00	32.1	0	0	11.0
Comfort/Consult	Cooling	0.3 tons	0.3 tons	178	178	7/21 15:00	98.8	0	0	2.7
	Heating	1.9 Mbh	1.9 Mbh	93	93	12/21 24:00	32.1	0	0	11.0
Corridor-N	Cooling	0.2 tons	0.2 tons	119	119	7/21 18:00	91.4	0	0	2.7
	Heating	2.4 Mbh	2.4 Mbh	119	119	12/21 24:00	32.1	0	0	11.0
Corridor-S	Cooling	0.3 tons	0.3 tons	176	176	10/21 13:00	88.4	0	0	2.7
	Heating	2.4 Mbh	2.4 Mbh	117	117	12/21 24:00	32.1	0	0	11.0
Corridor-W	Cooling	0.4 tons	0.4 tons	210	210	7/21 17:00	94.5	0	0	2.7
	Heating	2.2 Mbh	2.2 Mbh	106	106	12/21 24:00	32.1	0	0	11.0
Entry/Waiting	Cooling	0.9 tons	0.9 tons	523	523	7/21 09:00	81.8	0	0	2.7
	Heating	7 Mbh	7 Mbh	339	339	12/21 24:00	32.1	0	0	11.0
Exam/Storage	Cooling	0.2 tons	0.2 tons	97	97	7/21 15:00	98.8	0	0	2.7
	Heating	0.6 Mbh	0.6 Mbh	32	38	12/21 04:00	32.1	0	0	11.0
Fire Room	Cooling	0.1 tons	0.1 tons	74	74	7/21 10:00	87	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	23	23	12/21 04:00	32.1	0	0	11.0
Group	Cooling	0.3 tons	0.3 tons	182	182	7/21 15:00	98.8	0	0	2.7
	Heating	2.1 Mbh	2.1 Mbh	104	104	12/21 24:00	32.1	0	0	11.0
Hospitality	Cooling	0.3 tons	0.3 tons	165	165	7/21 15:00	98.8	0	0	2.7
	Heating	1.9 Mbh	1.9 Mbh	91	91	12/21 24:00	32.1	0	0	11.0
Intake-HR-A	Cooling	0.5 tons	0.5 tons	278	303	9/21 14:00	98.4	0	0	2.7
	Heating	3.1 Mbh	3.1 Mbh	153	153	12/21 24:00	32.1	0	0	11.0
Intake-HR-B	Cooling	0.1 tons	0.1 tons	78	78	7/21 15:00	98.8	0	0	2.7
	Heating	0.6 Mbh	0.6 Mbh	30	30	12/21 04:00	32.1	0	0	11.0

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
Kitchen	Cooling	2.7 tons	4.8 tons	1,538	2,801	9/21 15:00	98.4	0	0	2.7
	Heating	5.2 Mbh	54.7 Mbh	252	2,666	12/21 04:00	32.1	0	0	11.0
Lounge	Cooling	0.5 tons	0.5 tons	292	292	9/21 14:00	98.4	0	0	2.7
	Heating	2.3 Mbh	2.3 Mbh	112	112	12/21 20:00	32.1	0	0	11.0
Multipurpose/Dining	Cooling	0.5 tons	0.5 tons	307	307	7/21 15:00	98.8	0	0	2.7
	Heating	3.5 Mbh	3.5 Mbh	170	170	12/21 24:00	32.1	0	0	11.0
RB-N-Corner	Cooling	0.2 tons	0.2 tons	125	125	7/21 18:00	91.4	0	0	2.7
	Heating	1.3 Mbh	1.3 Mbh	66	66	12/21 24:00	32.1	0	0	11.0
RB-N-East	Cooling	0.3 tons	0.3 tons	197	197	7/21 10:00	87	0	0	2.7
	Heating	2.3 Mbh	2.3 Mbh	112	112	12/21 24:00	32.1	0	0	11.0
RB-N-West	Cooling	0.6 tons	0.6 tons	335	335	7/21 18:00	91.4	0	0	2.7
	Heating	2.9 Mbh	2.9 Mbh	140	140	12/21 24:00	32.1	0	0	11.0
RB-S-Corner-N	Cooling	0.2 tons	0.2 tons	110	110	9/21 14:00	98.4	0	0	2.7
	Heating	1.3 Mbh	1.3 Mbh	66	66	12/21 24:00	32.1	0	0	11.0
RB-S-Corner-S	Cooling	0.2 tons	0.2 tons	136	136	9/21 16:00	96.5	0	0	2.7
	Heating	1.4 Mbh	1.4 Mbh	66	66	12/21 24:00	32.1	0	0	11.0
RB-S-East	Cooling	0.5 tons	0.5 tons	271	271	7/21 10:00	87	0	0	2.7
	Heating	2.7 Mbh	2.7 Mbh	129	129	12/21 24:00	32.1	0	0	11.0
RB-S-West	Cooling	0.2 tons	0.2 tons	110	110	7/21 17:00	94.5	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	47	47	12/21 24:00	32.1	0	0	11.0
RB-W-North	Cooling	0.2 tons	0.2 tons	119	119	7/21 18:00	91.4	0	0	2.7
	Heating	1.4 Mbh	1.4 Mbh	70	70	12/21 24:00	32.1	0	0	11.0
RB-W-South	Cooling	0.6 tons	0.6 tons	356	356	9/21 14:00	98.4	0	0	2.7
	Heating	3.6 Mbh	3.6 Mbh	176	176	12/21 24:00	32.1	0	0	11.0
Servery	Cooling	0.2 tons	0.2 tons	142	142	7/21 15:00	98.8	0	0	2.7

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Calculated Heating Load (Mbh)	Min	Max
	Heating	1.4 Mbh	1.4 Mbh	70	76	12/21 24:00	32.1	0	0		11.0
SHWR-N	Cooling	0.2 tons	0.2 tons	119	119	7/21 11:00	91.7	0	0		2.7
	Heating	1.3 Mbh	1.3 Mbh	66	66	12/21 24:00	32.1	0	0		11.0
SHWR-S	Cooling	0.2 tons	0.2 tons	140	140	7/21 18:00	91.4	0	0		2.7
	Heating	1.3 Mbh	1.3 Mbh	66	66	12/21 24:00	32.1	0	0		11.0
SHWR-W	Cooling	0.2 tons	0.2 tons	112	112	7/21 18:00	91.4	0	0		2.7
	Heating	1.4 Mbh	1.4 Mbh	66	66	12/21 24:00	32.1	0	0		11.0
Support	Cooling	0.5 tons	0.6 tons	314	339	9/21 14:00	98.4	0	0		2.7
	Heating	3.3 Mbh	3.3 Mbh	163	163	12/21 04:00	32.1	0	0		11.0
Utility	Cooling	1.8 tons	1.8 tons	1,032	1,032	7/21 15:00	98.8	0	0		2.7
	Heating	11 Mbh	11 Mbh	534	534	12/21 04:00	32.1	0	0		11.0

Peak Load Summary Report

Primary

System Name: Single Zone CV

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
Single Zone CV		N/A	N/A	N/A	N/A	N/A	2,507	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	680	N/A	N/A
	Kitchen	9/21 16:00	96.5	63.6	75.0	64.0	2,507	2,532	28,511	2,982	12/21 04:00	32.1	21.8	70.0	75.0	680	2,532	3,488
	Kitchen	7/21 18:00	91.4	64.4	75.0	64.1	2,500	2,500	28,257	2,847	12/21 19:00	32.1	21.8	70.0	75.0	2,500	2,500	12,818
	Service	9/21 16:00	96.5	63.6	75.0	64.1	358	359	4,061	213	12/21 04:00	32.1	21.8	70.0	76.3	358	359	2,320

System Name: Variable Refrigerant Flow

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)
				DB (°F)	WB (°F)								DB (°F)	WB (°F)					
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	7,272	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	7,191	N/A	N/A
		ACT-Noisy-1	8/21 17:00	94.0	63.5	75.0	57.1	197	196	3,650	647	12/21 24:00	32.1	21.8	70.0	75.7	197	196	1,152
		Noisy Activity 1	8/21 17:00	94.0	63.5	75.0	57.1	195	196	3,643	647	12/21 24:00	32.1	21.8	70.0	75.7	195	196	1,149
		ACT-Noisy-2	7/21 18:00	91.4	64.4	75.0	55.0	102	101	2,101	669	12/21 24:00	32.1	21.8	70.0	78.5	102	101	883
		Noisy Activity 2	7/21 18:00	91.4	64.4	75.0	55.0	100	100	2,075	669	12/21 24:00	32.1	21.8	70.0	78.5	100	100	867
		ACT-Noisy-3	7/21 15:00	98.8	66.7	75.0	55.0	106	105	2,184	676	12/21 24:00	32.1	21.8	70.0	80.4	106	105	1,124
		Noisy Activity 3	7/21 15:00	98.8	66.7	75.0	55.0	104	105	2,174	675	12/21 24:00	32.1	21.8	70.0	80.4	104	105	1,120
		ACT-Quiet-1	9/21 14:00	98.4	64.2	75.0	53.5	59	60	1,339	462	12/21 24:00	32.1	21.8	70.0	75.8	59	60	357
		Quiet Activity 1	9/21 14:00	98.4	64.2	75.0	53.4	59	60	1,332	462	12/21 24:00	32.1	21.8	70.0	75.7	59	60	351
		ACT-Quiet-2	9/21 14:00	98.4	64.2	75.0	55.0	87	86	1,796	463	12/21 24:00	32.1	21.8	70.0	76.2	87	86	547
		Quiet Activity 2	9/21 14:00	98.4	64.2	75.0	54.8	85	85	1,778	463	12/21 24:00	32.1	21.8	70.0	76.1	85	85	529
		ACT-Quiet-3	7/21 18:00	91.4	64.4	75.0	55.0	78	78	1,616	486	12/21 24:00	32.1	21.8	70.0	76.5	78	78	522
		Quiet Activity 3	7/21 18:00	91.4	64.4	75.0	55.0	78	77	1,609	486	12/21 24:00	32.1	21.8	70.0	76.5	78	77	518
		Admin	10/21 13:00	88.4	57.7	75.0	55.0	121	121	2,517	267	12/21 04:00	32.1	21.8	70.0	77.5	121	121	932
		Office 1	10/21 14:00	89.8	58.2	75.0	55.0	66	65	1,344	134	12/21 04:00	32.1	21.8	70.0	77.4	66	65	487
		Office 2	10/21 13:00	88.4	57.7	75.0	55.0	59	60	1,253	134	12/21 04:00	32.1	21.8	70.0	77.4	59	60	458
		Attrium	7/21 17:00	94.5	65.4	75.0	55.0	375	375	7,800	789	12/21 24:00	32.1	21.8	70.0	82.7	375	375	4,900
		Attrium	7/21 17:00	94.5	65.4	75.0	55.0	144	145	3,006	358	12/21 24:00	32.1	21.8	70.0	83.4	144	145	1,984
		Attrium 2	9/21 16:00	96.5	63.6	75.0	55.0	250	249	5,176	341	12/21 24:00	32.1	21.8	70.0	82.2	250	249	3,109
		Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	66	66	1,381	351	12/21 04:00	32.1	21.8	70.0	75.9	66	66	399
		Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	64	64	1,324	343	12/21 04:00	32.1	21.8	70.0	75.6	64	64	366
		Comfort/Consult	7/21 17:00	94.5	65.4	75.0	55.0	148	148	3,081	567	12/21 24:00	32.1	21.8	70.0	77.7	148	148	1,176
		Comfort Room 2	7/21 16:00	96.9	66.1	75.0	55.0	42	43	902	164	12/21 24:00	32.1	21.8	70.0	78.0	42	43	355
		Consult 1	7/21 17:00	94.5	65.4	75.0	55.0	51	51	1,063	200	12/21 24:00	32.1	21.8	70.0	77.6	51	51	397
		Consult 2	7/21 17:00	94.5	65.4	75.0	55.0	53	53	1,107	203	12/21 24:00	32.1	21.8	70.0	77.5	53	53	412
		Corridor-N	6/21 18:00	87.4	61.0	75.0	55.0	123	123	2,547	-34	12/21 24:00	32.1	21.8	70.0	83.6	123	123	1,712
		Corridor 3	6/21 18:00	87.4	61.0	75.0	55.0	123	122	2,542	-34	12/21 24:00	32.1	21.8	70.0	83.6	123	122	1,707
		Corridor-S	10/21 13:00	88.4	57.7	75.0	55.0	244	243	5,047	-93	12/21 24:00	32.1	21.8	70.0	76.7	244	243	1,674
		Corridor 5	10/21 13:00	88.4	57.7	75.0	55.0	244	243	5,045	-93	12/21 24:00	32.1	21.8	70.0	76.7	244	243	1,670
		Corridor-W	7/21 17:00	94.5	65.4	75.0	55.0	267	266	5,525	-1	12/21 24:00	32.1	21.8	70.0	75.6	267	266	1,534
		Corridor 4	7/21 17:00	94.5	65.4	75.0	55.0	265	265	5,499	-1	12/21 24:00	32.1	21.8	70.0	75.6	265	265	1,516

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 13

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load
				DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	7,272	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	7,191	N/A	N/A
		Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	706	706	14,656	268	12/21 24:00	32.1	21.8	70.0	77.3	706	706	5,258
		Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	710	710	14,737	268	12/21 24:00	32.1	21.8	70.0	77.3	710	710	5,278
		Exam/Storage	7/21 19:00	86.7	62.9	75.0	55.0	76	76	1,572	325	12/21 04:00	32.1	21.8	70.0	75.2	76	76	402
		Exam Room	7/21 19:00	86.7	62.9	75.0	55.0	49	49	1,016	246	12/21 19:00	32.1	21.8	70.0	75.0	32	49	143
		Long Term Belongings Storage	7/21 19:00	86.7	62.9	75.0	55.0	25	24	508	82	12/21 04:00	32.1	21.8	70.0	79.2	25	24	231
		Group	7/21 18:00	91.4	64.4	75.0	54.4	144	144	3,081	1,032	12/21 24:00	32.1	21.8	70.0	80.2	144	144	1,500
		Group	7/21 18:00	91.4	64.4	75.0	54.3	144	143	3,075	1,032	12/21 24:00	32.1	21.8	70.0	80.2	144	143	1,503
		Hospitality	7/21 16:00	96.9	66.1	75.0	54.8	136	135	2,830	919	12/21 24:00	32.1	21.8	70.0	79.6	136	135	1,324
		Hospitality	7/21 16:00	96.9	66.1	75.0	54.8	136	135	2,832	919	12/21 24:00	32.1	21.8	70.0	79.6	136	135	1,326
		Intake-HR-A	9/21 14:00	98.4	64.2	75.0	55.0	220	221	4,598	658	12/21 24:00	32.1	21.8	70.0	79.8	220	221	2,232
		Intake Corridor	7/21 18:00	91.4	64.4	75.0	55.0	28	28	573	-1	12/21 20:00	32.1	21.8	70.0	81.6	28	28	328
		Interview Room	9/21 16:00	96.5	63.6	75.0	55.0	87	87	1,805	316	12/21 24:00	32.1	21.8	70.0	78.7	87	87	778
		Sally Port	10/21 13:00	88.4	57.7	75.0	55.0	70	70	1,462	156	12/21 19:00	32.1	21.8	70.0	78.4	70	70	604
		Shower 1	7/21 17:00	94.5	65.4	75.0	55.0	36	36	757	223	12/21 24:00	32.1	21.8	70.0	79.8	36	36	366
		Intake-HR-B	7/21 19:00	86.7	62.9	75.0	55.0	57	58	1,203	232	12/21 04:00	32.1	21.8	70.0	76.4	57	58	378
		Ante Room	7/21 19:00	86.7	62.9	75.0	55.0	21	21	428	66	12/21 04:00	32.1	21.8	70.0	79.0	21	21	191
		Comfort Room 1	7/21 18:00	91.4	64.4	75.0	55.0	36	37	770	168	12/21 07:00	32.1	21.8	70.0	75.0	36	37	181
		Lounge	10/21 14:00	89.8	58.2	75.0	56.7	237	238	4,536	891	12/21 24:00	32.1	21.8	70.0	76.4	237	238	1,556
		Lounge	10/21 14:00	89.8	58.2	75.0	55.0	176	177	3,676	668	12/21 19:00	32.1	21.8	70.0	76.8	176	177	1,237
		Shower 2	9/21 17:00	94.1	62.8	75.0	55.0	55	55	1,139	262	12/21 19:00	32.1	21.8	70.0	75.7	55	55	321
		Multipurpose/Dining	7/21 16:00	96.9	66.1	75.0	54.0	242	242	5,270	1,813	12/21 24:00	32.1	21.8	70.0	80.3	242	242	2,555
		Multipurpose/Dining	7/21 16:00	96.9	66.1	75.0	53.9	242	241	5,262	1,813	12/21 24:00	32.1	21.8	70.0	80.4	242	241	2,555
		RB-N-Corner	7/21 18:00	91.4	64.4	75.0	58.5	155	155	2,667	324	12/21 24:00	32.1	21.8	70.0	75.4	155	155	867
		Resident Room 14	7/21 18:00	91.4	64.4	75.0	58.5	155	156	2,668	324	12/21 24:00	32.1	21.8	70.0	75.4	155	156	867
		RB-N-East	7/21 10:00	87.0	63.0	75.0	58.0	256	256	4,524	638	12/21 24:00	32.1	21.8	70.0	75.8	256	256	1,527
		Resident Room 15	7/21 10:00	87.0	63.0	75.0	58.0	131	131	2,319	324	12/21 24:00	32.1	21.8	70.0	76.5	131	131	873
		Resident Room 16	7/21 10:00	87.0	63.0	75.0	57.9	123	123	2,196	315	12/21 24:00	32.1	21.8	70.0	75.2	123	123	654
		RB-N-West	7/21 17:00	94.5	65.4	75.0	58.7	441	442	7,481	950	12/21 24:00	32.1	21.8	70.0	75.0	381	442	1,954
		Resident Room 11	7/21 17:00	94.5	65.4	75.0	58.7	144	145	2,463	321	12/21 24:00	32.1	21.8	70.0	75.0	125	145	639
		Resident Room 12	7/21 17:00	94.5	65.4	75.0	58.8	146	147	2,488	315	12/21 24:00	32.1	21.8	70.0	75.0	125	147	641
		Resident Room 13	7/21 17:00	94.5	65.4	75.0	58.8	148	148	2,500	315	12/21 24:00	32.1	21.8	70.0	75.0	129	148	658

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 13

Location			Cooling								Heating								
	System Zone	Room	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load
			(Mo/D/Hr)	DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	7,272	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	7,191	N/A	N/A
	RB-S-Corner-N		7/21 10:00	87.0	63.0	75.0	57.9	127	126	2,244	321	12/21 24:00	32.1	21.8	70.0	76.6	127	126	855
	Resident Room 04		7/21 10:00	87.0	63.0	75.0	57.9	127	127	2,248	321	12/21 24:00	32.1	21.8	70.0	76.6	127	127	858
	RB-S-Corner-S		9/21 17:00	94.1	62.8	75.0	55.0	136	135	2,804	314	12/21 24:00	32.1	21.8	70.0	76.3	136	135	871
	Resident Room 05		9/21 17:00	94.1	62.8	75.0	55.0	136	135	2,803	314	12/21 24:00	32.1	21.8	70.0	76.3	136	135	870
	RB-S-East		7/21 10:00	87.0	63.0	75.0	57.9	360	361	6,422	924	12/21 24:00	32.1	21.8	70.0	75.0	356	361	1,820
	Resident Room 01		8/21 10:00	86.6	61.1	75.0	58.0	114	114	2,027	291	12/21 24:00	32.1	21.8	70.0	75.0	106	114	545
	Resident Room 02		7/21 10:00	87.0	63.0	75.0	58.3	119	118	2,046	277	12/21 24:00	32.1	21.8	70.0	75.0	112	118	576
	Resident Room 03		7/21 10:00	87.0	63.0	75.0	57.9	131	132	2,346	339	12/21 24:00	32.1	21.8	70.0	75.1	131	132	687
	RB-S-West		7/21 17:00	94.5	65.4	75.0	58.7	142	141	2,402	308	12/21 24:00	32.1	21.8	70.0	75.0	125	141	638
	Resident Room 06		7/21 17:00	94.5	65.4	75.0	58.7	142	141	2,400	308	12/21 24:00	32.1	21.8	70.0	75.0	125	141	637
	RB-W-North		7/21 18:00	91.4	64.4	75.0	57.9	129	129	2,297	323	12/21 24:00	32.1	21.8	70.0	77.1	129	129	946
	Resident Room 10		7/21 18:00	91.4	64.4	75.0	57.9	129	129	2,296	323	12/21 24:00	32.1	21.8	70.0	77.1	129	129	945
	RB-W-South		10/21 14:00	89.8	58.2	75.0	55.0	409	410	8,516	823	12/21 24:00	32.1	21.8	70.0	75.9	409	410	2,459
	Resident Room 07		10/21 14:00	89.8	58.2	75.0	55.0	131	132	2,739	272	12/21 24:00	32.1	21.8	70.0	75.3	131	132	716
	Resident Room 08		10/21 14:00	89.8	58.2	75.0	55.0	138	137	2,844	274	12/21 24:00	32.1	21.8	70.0	75.4	138	137	754
	Resident Room 09		10/21 14:00	89.8	58.2	75.0	55.0	140	141	2,925	278	12/21 24:00	32.1	21.8	70.0	76.6	140	141	955
	Servery		7/21 17:00	94.5	65.4	75.0	53.5	108	107	2,401	852	12/21 24:00	32.1	21.8	70.0	79.2	108	107	1,012
	Servery		7/21 17:00	94.5	65.4	75.0	53.5	108	107	2,400	852	12/21 24:00	32.1	21.8	70.0	79.2	108	107	1,013
	SHWR-N		7/21 12:00	94.8	65.5	75.0	55.0	95	95	1,981	569	12/21 24:00	32.1	21.8	70.0	79.1	95	95	886
	Shower 7		7/21 12:00	94.8	65.5	75.0	55.0	49	49	1,013	288	12/21 24:00	32.1	21.8	70.0	78.7	49	49	436
	Shower 8		7/21 12:00	94.8	65.5	75.0	55.0	47	46	960	281	12/21 24:00	32.1	21.8	70.0	79.3	47	46	439
	SHWR-S		7/21 18:00	91.4	64.4	75.0	55.0	104	104	2,155	580	12/21 24:00	32.1	21.8	70.0	78.2	104	104	875
	Shower 3		7/21 18:00	91.4	64.4	75.0	55.0	51	52	1,073	291	12/21 24:00	32.1	21.8	70.0	78.1	51	52	430
	Shower 4		8/21 18:00	90.9	62.5	75.0	55.0	51	52	1,077	276	12/21 24:00	32.1	21.8	70.0	78.3	51	52	442
	SHWR-W		7/21 18:00	91.4	64.4	75.0	55.0	93	93	1,931	577	12/21 24:00	32.1	21.8	70.0	79.4	93	93	892
	Shower 5		7/21 18:00	91.4	64.4	75.0	55.0	47	47	980	289	12/21 24:00	32.1	21.8	70.0	79.4	47	47	453
	Shower 6		7/21 18:00	91.4	64.4	75.0	55.0	44	45	945	288	12/21 24:00	32.1	21.8	70.0	79.3	44	45	434

Location		Cooling								Heating								
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB (°F)	WB (°F)								DB (°F)	WB (°F)					
Variable Refrigerant Flow		N/A	N/A	N/A	N/A	N/A	7,272	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	7,191	N/A	N/A
Support		7/21 19:00	86.7	62.9	75.0	55.0	256	256	5,311	0	12/21 04:00	32.1	21.8	70.0	80.5	256	256	2,755
	Electric	9/21 15:00	98.4	64.2	75.0	55.0	87	87	1,803	0	12/21 04:00	32.1	21.8	70.0	81.5	87	87	1,026
	Emergency Electric	7/21 09:00	81.8	61.2	75.0	55.0	70	70	1,446	0	12/21 04:00	32.1	21.8	70.0	79.4	70	70	672
	Fire Room	8/21 09:00	81.4	59.2	75.0	55.0	47	47	970	0	12/21 04:00	32.1	21.8	70.0	80.8	47	47	518
	Mechanical	7/21 19:00	86.7	62.9	75.0	55.0	53	53	1,092	0	12/21 04:00	32.1	21.8	70.0	75.3	53	53	285
Utility		7/21 19:00	86.7	62.9	75.0	55.0	670	670	13,920	995	12/21 04:00	32.1	21.8	70.0	80.7	670	670	7,352
	Clean Supply	7/21 19:00	86.7	62.9	75.0	55.0	23	23	482	82	12/21 04:00	32.1	21.8	70.0	79.6	23	23	230
	Corridor 1	7/21 18:00	91.4	64.4	75.0	55.0	55	55	1,146	-1	12/21 24:00	32.1	21.8	70.0	81.8	55	55	665
	Corridor 2	7/21 18:00	91.4	64.4	75.0	55.0	102	101	2,089	-2	12/21 24:00	32.1	21.8	70.0	82.1	102	101	1,246
	Corridor 2.1	9/21 16:00	96.5	63.6	75.0	55.0	19	18	382	-8	12/21 24:00	32.1	21.8	70.0	81.8	19	18	222
	General Storage	7/21 19:00	86.7	62.9	75.0	55.0	42	41	861	81	12/21 04:00	32.1	21.8	70.0	76.0	42	41	254
	Hskp	7/21 19:00	86.7	62.9	75.0	55.0	15	14	294	46	12/21 04:00	32.1	21.8	70.0	79.2	15	14	133
	IT	7/21 19:00	86.7	62.9	75.0	55.0	49	49	1,018	0	12/21 04:00	32.1	21.8	70.0	75.0	19	49	102
	Laundry	7/21 19:00	86.7	62.9	75.0	55.0	28	27	565	98	12/21 04:00	32.1	21.8	70.0	79.7	28	27	270
	Meds	7/21 19:00	86.7	62.9	75.0	55.0	30	29	608	104	12/21 04:00	32.1	21.8	70.0	79.9	30	29	296
	Soiled Supply	7/21 19:00	86.7	62.9	75.0	55.0	23	23	471	78	12/21 04:00	32.1	21.8	70.0	79.5	23	23	220
	Staff Corridor	9/21 16:00	96.5	63.6	75.0	55.0	199	199	4,121	-88	12/21 07:00	32.1	21.8	70.0	81.6	199	199	2,360
	Stor.	7/21 19:00	86.7	62.9	75.0	55.0	8	8	164	12	12/21 04:00	32.1	21.8	70.0	79.6	8	8	78
	Storage	7/21 18:00	91.4	64.4	75.0	55.0	19	20	407	44	12/21 04:00	32.1	21.8	70.0	81.7	19	20	235
	Toilet 1	7/21 10:00	87.0	63.0	75.0	55.0	42	41	862	190	12/21 24:00	32.1	21.8	70.0	78.4	42	41	359
Toilet 2	7/21 18:00	91.4	64.4	75.0	50.4	19	18	462	175	12/21 19:00	32.1	21.8	70.0	78.1	19	18	151	
Toilet 3	7/21 18:00	91.4	64.4	75.0	50.6	19	18	467	175	12/21 19:00	32.1	21.8	70.0	78.3	19	18	158	

System Name: DOAS to Zone Level Equipment Dehum and Reheat

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
			(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
DOAS to Zone Level Equipment Dehum and Reheat		7/21 15:00	98.4	64.2	75.0	55.0	0	1,550	71,733	0	12/21 04:00	32.1	21.8	70.0	55.0	0	N/A	36,362

Peak Load Summary Report

ASHRAE 90.1-2010 Baseline

System Name: System 10 - 2010/2013

Location			Cooling								Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply Airflow	Sensible Load
			DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
System 10 - 2010/2013			32.0	32.0	32.0	55.0	85	0	0	0	12/21 04:00	32.1	21.8	70.0	105.0	23	85	3,807
	Fire Room	9/21 14:00	98.4	64.2	75.0	55.0	85	85	1,762	0	12/21 04:00	32.1	21.8	70.0	105.0	23	85	857
	Fire Room	7/21 10:00	87.0	63.0	75.0	55.0	74	74	1,534	0	12/21 04:00	32.1	21.8	70.0	105.0	23	74	824

System Name: System 2 - 2007/2010/2013

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
				DB (°F)	WB (°F)								DB (°F)	WB (°F)					
System 2 - 2007/2010/2013			N/A	N/A	N/A	N/A	N/A	3,091	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1,759	N/A	N/A
		Attrium	7/21 16:00	96.9	66.1	75.0	55.0	568	568	11,794	920	12/21 24:00	32.1	21.8	70.0	90.0	354	568	7,245
		Attrium	7/21 17:00	94.5	65.4	75.0	55.0	199	199	4,134	435	12/21 19:00	32.1	21.8	70.0	90.0	136	199	2,782
		Attrium 2	9/21 15:00	98.4	64.2	75.0	55.0	367	367	7,626	391	12/21 19:00	32.1	21.8	70.0	90.0	229	367	4,704
		Corridor-N	7/21 09:00	81.8	61.2	75.0	55.0	176	175	3,633	-2	12/21 24:00	32.1	21.8	70.0	90.0	117	175	2,392
		Corridor 3	7/21 18:00	91.4	64.4	75.0	55.0	119	118	2,444	-2	12/21 24:00	32.1	21.8	70.0	90.1	119	118	2,421
		Corridor-S	7/21 17:00	94.5	65.4	75.0	55.0	220	220	4,568	-2	12/21 24:00	32.1	21.8	70.0	90.0	117	220	2,406
		Corridor 5	10/21 13:00	88.4	57.7	75.0	55.0	176	176	3,652	-94	12/21 19:00	32.1	21.8	70.0	90.0	114	176	2,365
		Corridor-W	7/21 18:00	91.4	64.4	75.0	55.0	108	108	2,234	-1	12/21 24:00	32.1	21.8	70.0	90.0	106	108	2,166
		Corridor 4	7/21 17:00	94.5	65.4	75.0	55.0	210	209	4,336	-1	12/21 19:00	32.1	21.8	70.0	90.0	104	209	2,147
		RB-N-Corner	7/21 12:00	94.8	65.5	75.0	55.0	95	96	2,000	346	12/21 24:00	32.1	21.8	70.0	90.0	66	96	1,349
		Resident Room 14	7/21 18:00	91.4	64.4	75.0	55.0	125	126	2,611	349	12/21 24:00	32.1	21.8	70.0	90.0	66	126	1,345
		RB-N-East	9/21 14:00	98.4	64.2	75.0	55.0	218	219	4,541	637	12/21 24:00	32.1	21.8	70.0	90.0	112	219	2,315
		Resident Room 15	7/21 10:00	87.0	63.0	75.0	55.0	102	102	2,119	346	12/21 24:00	32.1	21.8	70.0	90.0	66	102	1,351
		Resident Room 16	7/21 10:00	87.0	63.0	75.0	55.0	95	95	1,977	336	12/21 24:00	32.1	21.8	70.0	90.0	47	95	961
		RB-N-West	7/21 17:00	94.5	65.4	75.0	55.0	231	230	4,782	1,008	12/21 24:00	32.1	21.8	70.0	90.0	140	230	2,863
		Resident Room 11	7/21 18:00	91.4	64.4	75.0	55.0	112	111	2,311	344	12/21 24:00	32.1	21.8	70.0	90.0	47	111	941
		Resident Room 12	7/21 18:00	91.4	64.4	75.0	55.0	112	111	2,309	338	12/21 24:00	32.1	21.8	70.0	90.0	47	111	941
		Resident Room 13	7/21 18:00	91.4	64.4	75.0	55.0	112	112	2,326	338	12/21 24:00	32.1	21.8	70.0	90.0	47	112	968
		RB-S-Corner-N	9/21 16:00	96.5	63.6	75.0	55.0	123	124	2,564	321	12/21 24:00	32.1	21.8	70.0	90.0	64	124	1,324
		Resident Room 04	9/21 14:00	98.4	64.2	75.0	55.0	110	110	2,275	320	12/21 19:00	32.1	21.8	70.0	90.0	66	110	1,333
		RB-S-Corner-S	7/21 18:00	91.4	64.4	75.0	55.0	114	115	2,376	350	12/21 24:00	32.1	21.8	70.0	90.0	66	115	1,348
		Resident Room 05	9/21 16:00	96.5	63.6	75.0	55.0	136	136	2,817	327	12/21 19:00	32.1	21.8	70.0	90.0	66	136	1,351
		RB-S-East	9/21 14:00	98.4	64.2	75.0	55.0	284	284	5,890	919	12/21 24:00	32.1	21.8	70.0	90.0	129	284	2,654
		Resident Room 01	8/21 10:00	86.6	61.1	75.0	55.0	83	82	1,707	311	12/21 19:00	32.1	21.8	70.0	90.0	38	82	782
		Resident Room 02	7/21 10:00	87.0	63.0	75.0	55.0	87	87	1,797	297	12/21 19:00	32.1	21.8	70.0	90.0	40	87	844
		Resident Room 03	7/21 10:00	87.0	63.0	75.0	55.0	102	101	2,090	362	12/21 19:00	32.1	21.8	70.0	90.0	49	101	1,014
		RB-S-West	7/21 18:00	91.4	64.4	75.0	55.0	78	78	1,626	327	12/21 24:00	32.1	21.8	70.0	90.0	47	78	942
		Resident Room 06	7/21 17:00	94.5	65.4	75.0	55.0	110	109	2,265	331	12/21 19:00	32.1	21.8	70.0	90.0	47	109	940
		RB-W-North	7/21 10:00	87.0	63.0	75.0	55.0	114	114	2,365	346	12/21 24:00	32.1	21.8	70.0	90.0	70	114	1,439
		Resident Room 10	7/21 18:00	91.4	64.4	75.0	55.0	119	118	2,450	346	12/21 19:00	32.1	21.8	70.0	90.0	70	118	1,442

Location			Cooling								Heating								
System	Zone	Room	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply Airflow	Sensible Load
			(Mo/D/Hr)	DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
			(°F)	(°F)								(°F)	(°F)						
System 2 - 2007/2010/2013			N/A	N/A	N/A	N/A	N/A	3,091	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1,759	N/A	N/A
	RB-W-South		7/21 17:00	94.5	65.4	75.0	55.0	400	401	8,318	1,017	12/21 24:00	32.1	21.8	70.0	90.0	176	401	3,604
	Resident Room 07		9/21 14:00	98.4	64.2	75.0	55.0	110	111	2,302	311	12/21 19:00	32.1	21.8	70.0	90.0	51	111	1,028
	Resident Room 08		10/21 14:00	89.8	58.2	75.0	55.0	114	115	2,379	285	12/21 19:00	32.1	21.8	70.0	90.0	53	115	1,085
	Resident Room 09		9/21 15:00	98.4	64.2	75.0	55.0	133	134	2,777	319	12/21 19:00	32.1	21.8	70.0	90.0	70	134	1,449
	SHWR-N		9/21 14:00	98.4	64.2	75.0	55.0	125	125	2,589	568	12/21 24:00	32.1	21.8	70.0	90.0	66	125	1,338
	Shower 7		7/21 11:00	91.7	64.5	75.0	55.0	61	61	1,266	306	12/21 24:00	32.1	21.8	70.0	90.0	32	61	661
	Shower 8		7/21 11:00	91.7	64.5	75.0	55.0	57	58	1,205	299	12/21 24:00	32.1	21.8	70.0	90.0	32	58	660
	SHWR-S		7/21 18:00	91.4	64.4	75.0	55.0	110	111	2,302	612	12/21 24:00	32.1	21.8	70.0	90.0	66	111	1,330
	Shower 3		7/21 18:00	91.4	64.4	75.0	55.0	70	70	1,446	310	12/21 19:00	32.1	21.8	70.0	90.0	32	70	656
	Shower 4		7/21 18:00	91.4	64.4	75.0	55.0	70	70	1,462	308	12/21 19:00	32.1	21.8	70.0	90.0	32	70	669
	SHWR-W		7/21 11:00	91.7	64.5	75.0	55.0	125	124	2,578	615	12/21 24:00	32.1	21.8	70.0	90.0	66	124	1,365
	Shower 5		7/21 18:00	91.4	64.4	75.0	55.0	57	57	1,192	307	12/21 19:00	32.1	21.8	70.0	90.0	34	57	688
	Shower 6		7/21 18:00	91.4	64.4	75.0	55.0	55	56	1,153	306	12/21 19:00	32.1	21.8	70.0	90.0	32	56	656

System Name: System 4 - 2007/2010/2013

Location			Cooling								Heating								
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	
			DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	
System 4 - 2007/2010/2013			N/A	N/A	N/A	N/A	N/A	4,659	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	2,320	N/A	N/A
	ACT-Noisy-1	7/21 18:00	91.4	64.4	75.0	55.0	119	118	2,450	691	12/21 24:00	32.1	21.8	70.0	90.0	81	118	1,638	
	Noisy Activity 1	8/21 17:00	94.0	63.5	75.0	55.0	182	182	3,779	677	12/21 19:00	32.1	21.8	70.0	90.0	81	182	1,632	
	ACT-Noisy-2	7/21 09:00	81.8	61.2	75.0	55.0	117	116	2,398	695	12/21 24:00	32.1	21.8	70.0	90.0	61	116	1,242	
	Noisy Activity 2	7/21 18:00	91.4	64.4	75.0	55.0	106	105	2,177	693	12/21 19:00	32.1	21.8	70.0	90.0	59	105	1,229	
	ACT-Noisy-3	7/21 15:00	98.8	66.7	75.0	55.0	112	113	2,336	700	12/21 24:00	32.1	21.8	70.0	90.0	76	113	1,564	
	Noisy Activity 3	7/21 15:00	98.8	66.7	75.0	55.0	112	111	2,312	699	12/21 24:00	32.1	21.8	70.0	90.0	76	111	1,554	
	ACT-Quiet-1	7/21 18:00	91.4	64.4	75.0	55.0	66	66	1,364	496	12/21 24:00	32.1	21.8	70.0	90.0	28	66	493	
	Quiet Activity 1	7/21 17:00	94.5	65.4	75.0	55.0	64	63	1,316	495	12/21 19:00	32.1	21.8	70.0	90.0	28	63	484	
	ACT-Quiet-2	7/21 17:00	94.5	65.4	75.0	55.0	91	92	1,903	504	12/21 24:00	32.1	21.8	70.0	90.0	38	92	768	
	Quiet Activity 2	9/21 15:00	98.4	64.2	75.0	55.0	83	82	1,695	478	12/21 19:00	32.1	21.8	70.0	90.0	36	82	740	
	ACT-Quiet-3	7/21 16:00	96.9	66.1	75.0	55.0	72	73	1,508	501	12/21 24:00	32.1	21.8	70.0	90.0	38	73	789	
	Quiet Activity 3	7/21 18:00	91.4	64.4	75.0	55.0	91	90	1,871	505	12/21 24:00	32.1	21.8	70.0	90.0	38	90	785	
	Admin	7/21 17:00	94.5	65.4	75.0	55.0	184	184	3,823	368	12/21 04:00	32.1	21.8	70.0	90.0	70	184	1,438	
	Office 1	9/21 14:00	98.4	64.2	75.0	55.0	89	89	1,840	165	12/21 04:00	32.1	21.8	70.0	90.0	36	89	746	
	Office 2	9/21 13:00	96.8	63.7	75.0	55.0	81	81	1,685	166	12/21 04:00	32.1	21.8	70.0	90.0	34	81	704	
	Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	81	80	1,656	374	12/21 04:00	32.1	21.8	70.0	90.0	25	80	541	
	Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	76	76	1,569	373	12/21 04:00	32.1	21.8	70.0	90.0	23	76	492	
	Comfort/Consult	7/21 15:00	98.8	66.7	75.0	55.0	180	179	3,720	567	12/21 24:00	32.1	21.8	70.0	90.0	91	179	1,885	
	Comfort Room 2	7/21 14:00	98.8	66.7	75.0	55.0	51	51	1,062	164	12/21 24:00	32.1	21.8	70.0	90.0	28	51	573	
	Consult 1	7/21 15:00	98.8	66.7	75.0	55.0	61	61	1,274	200	12/21 24:00	32.1	21.8	70.0	90.0	32	61	647	
	Consult 2	7/21 15:00	98.8	66.7	75.0	55.0	64	64	1,320	203	12/21 24:00	32.1	21.8	70.0	90.0	32	64	671	
	Entry/Waiting	10/21 14:00	89.8	58.2	75.0	55.0	557	557	11,571	124	12/21 24:00	32.1	21.8	70.0	90.0	339	557	6,937	
	Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	528	527	10,933	279	12/21 24:00	32.1	21.8	70.0	90.0	339	527	6,966	
	Exam/Storage	7/21 15:00	98.8	66.7	75.0	55.0	97	97	2,021	338	12/21 04:00	32.1	21.8	70.0	90.0	38	97	645	
	Exam Room	7/21 15:00	98.8	66.7	75.0	55.0	57	57	1,175	246	12/21 20:00	32.1	21.8	70.0	90.0	21	57	268	
	Long Term Belongings Storage	7/21 15:00	98.8	66.7	75.0	55.0	38	39	807	94	12/21 04:00	32.1	21.8	70.0	90.0	17	39	340	
	Group	7/21 15:00	98.8	66.7	75.0	55.0	186	186	3,867	1,065	12/21 24:00	32.1	21.8	70.0	90.0	104	186	2,115	
	Group	7/21 15:00	98.8	66.7	75.0	55.0	182	181	3,762	1,064	12/21 24:00	32.1	21.8	70.0	90.0	104	181	2,117	
	Hospitality	7/21 15:00	98.8	66.7	75.0	55.0	165	165	3,428	948	12/21 24:00	32.1	21.8	70.0	90.0	91	165	1,875	
	Hospitality	7/21 15:00	98.8	66.7	75.0	55.0	165	164	3,412	948	12/21 24:00	32.1	21.8	70.0	90.0	91	164	1,865	

Location			Cooling								Heating								
System	Zone	Room	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load
			(Mo/D/Hr)	DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
			(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
System 4 - 2007/2010/2013			N/A	N/A	N/A	N/A	N/A	4,659	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	2,320	N/A	N/A
		Intake-HR-A	7/21 17:00	94.5	65.4	75.0	55.0	333	333	6,906	709	12/21 24:00	32.1	21.8	70.0	90.0	153	333	3,139
		Intake Corridor	7/21 15:00	98.8	66.7	75.0	55.0	47	46	955	-1	12/21 20:00	32.1	21.8	70.0	90.0	25	46	502
		Interview Room	9/21 15:00	98.4	64.2	75.0	55.0	110	111	2,302	316	12/21 24:00	32.1	21.8	70.0	90.0	64	111	1,290
		Sally Port	9/21 13:00	96.8	63.7	75.0	55.0	95	95	1,976	156	12/21 19:00	32.1	21.8	70.0	90.0	44	95	910
		Shower 1	7/21 15:00	98.8	66.7	75.0	55.0	51	50	1,036	239	12/21 24:00	32.1	21.8	70.0	90.0	25	50	515
		Intake-HR-B	7/21 15:00	98.8	66.7	75.0	55.0	78	79	1,641	242	12/21 04:00	32.1	21.8	70.0	90.0	30	79	618
		Ante Room	7/21 15:00	98.8	66.7	75.0	55.0	32	32	674	76	12/21 04:00	32.1	21.8	70.0	90.0	15	32	285
		Comfort Room 1	7/21 14:00	98.8	66.7	75.0	55.0	47	46	962	168	12/21 07:00	32.1	21.8	70.0	90.0	15	46	321
		Lounge	7/21 17:00	94.5	65.4	75.0	55.0	316	317	6,571	1,071	12/21 20:00	32.1	21.8	70.0	90.0	112	317	2,312
		Lounge	9/21 14:00	98.4	64.2	75.0	55.0	227	226	4,685	736	12/21 08:00	32.1	21.8	70.0	90.0	89	226	1,806
		Shower 2	9/21 15:00	98.4	64.2	75.0	55.0	76	77	1,598	278	12/21 08:00	32.1	21.8	70.0	90.0	23	77	483
		Multipurpose/Dining	7/21 15:00	98.8	66.7	75.0	55.0	316	315	6,533	1,868	12/21 24:00	32.1	21.8	70.0	90.0	170	315	3,475
		Multipurpose/Dining	7/21 15:00	98.8	66.7	75.0	55.0	307	307	6,376	1,867	12/21 24:00	32.1	21.8	70.0	90.0	170	307	3,485
		Servery	7/21 15:00	98.8	66.7	75.0	55.0	144	144	2,984	877	12/21 24:00	32.1	21.8	70.0	90.0	76	144	1,425
		Servery	7/21 15:00	98.8	66.7	75.0	55.0	142	141	2,927	877	12/21 24:00	32.1	21.8	70.0	90.0	76	141	1,414
		Support	9/21 15:00	98.4	64.2	75.0	55.0	386	385	7,994	0	12/21 04:00	32.1	21.8	70.0	90.0	163	385	3,358
		Electric	9/21 14:00	98.4	64.2	75.0	55.0	163	164	3,398	0	12/21 04:00	32.1	21.8	70.0	90.0	85	164	1,727
		Emergency Electric	7/21 10:00	87.0	63.0	75.0	55.0	106	107	2,213	0	12/21 04:00	32.1	21.8	70.0	90.0	55	107	1,111
		Mechanical	7/21 14:00	98.8	66.7	75.0	55.0	70	70	1,443	0	12/21 04:00	32.1	21.8	70.0	90.0	28	70	569

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
			(°F)	(°F)								(°F)	(°F)					
System 4 - 2007/2010/2013		N/A	N/A	N/A	N/A	N/A	4,659	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	2,320	N/A	N/A
	Utility	7/21 16:00	96.9	66.1	75.0	55.0	1,059	1,060	22,001	1,194	12/21 04:00	32.1	21.8	70.0	90.0	536	1,060	11,000
	Clean Supply	7/21 15:00	98.8	66.7	75.0	55.0	38	38	785	95	12/21 04:00	32.1	21.8	70.0	90.0	17	38	338
	Corridor 1	7/21 15:00	98.8	66.7	75.0	55.0	87	87	1,814	-1	12/21 24:00	32.1	21.8	70.0	90.0	49	87	993
	Corridor 2	7/21 15:00	98.8	66.7	75.0	55.0	146	146	3,039	-2	12/21 24:00	32.1	21.8	70.0	90.0	91	146	1,871
	Corridor 2.1	7/21 18:00	91.4	64.4	75.0	55.0	19	19	402	0	12/21 19:00	32.1	21.8	70.0	90.0	15	19	324
	General Storage	7/21 15:00	98.8	66.7	75.0	55.0	57	56	1,170	91	12/21 04:00	32.1	21.8	70.0	90.0	19	56	375
	Hskp	7/21 15:00	98.8	66.7	75.0	55.0	23	23	486	53	12/21 04:00	32.1	21.8	70.0	90.0	11	23	205
	IT	7/21 19:00	86.7	62.9	75.0	55.0	61	62	1,277	0	12/21 04:00	32.1	21.8	70.0	90.0	15	62	307
	Laundry	7/21 15:00	98.8	66.7	75.0	55.0	44	44	918	113	12/21 04:00	32.1	21.8	70.0	90.0	19	44	396
	Meds	7/21 15:00	98.8	66.7	75.0	55.0	47	48	987	121	12/21 04:00	32.1	21.8	70.0	90.0	21	48	432
	Soiled Supply	7/21 15:00	98.8	66.7	75.0	55.0	36	37	760	90	12/21 04:00	32.1	21.8	70.0	90.0	15	37	323
	Staff Corridor	9/21 14:00	98.4	64.2	75.0	55.0	328	328	6,818	-93	12/21 07:00	32.1	21.8	70.0	90.0	176	328	3,603
	Stor.	7/21 15:00	98.8	66.7	75.0	55.0	11	11	226	14	12/21 04:00	32.1	21.8	70.0	90.0	6	11	111
	Storage	7/21 15:00	98.8	66.7	75.0	55.0	28	28	584	49	12/21 04:00	32.1	21.8	70.0	90.0	17	28	347
	Toilet 1	7/21 15:00	98.8	66.7	75.0	55.0	44	45	932	200	12/21 24:00	32.1	21.8	70.0	90.0	23	45	472
	Toilet 2	7/21 15:00	98.8	66.7	75.0	55.0	34	35	717	183	12/21 19:00	32.1	21.8	70.0	90.0	11	35	222
	Toilet 3	7/21 15:00	98.8	66.7	75.0	55.0	36	35	727	183	12/21 19:00	32.1	21.8	70.0	90.0	11	35	230

System Name: System 4 - 2007/2010/2013_Copy

Location			Cooling								Heating										
System	Zone	Room	Time of Peak		OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak		OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply Airflow	Sensible Load
			(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)		
																				DB	WB
System 4 - 2007/2010/2013_Copy			N/A	N/A	N/A	N/A	N/A	2,793	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	2,687	N/A	N/A
		Kitchen	7/21 16:00	96.9	66.1	75.0	55.0	2,793	2,793	57,959	3,158	12/21 04:00	32.1	21.8	70.0	90.0	2,687	2,793	55,106		
		Kitchen	7/21 16:00	96.9	66.1	75.0	55.0	2,500	2,500	51,853	2,870	12/21 08:00	32.1	21.8	70.0	90.0	2,500	2,500	51,271		
		Service	9/21 15:00	98.4	64.2	75.0	55.0	301	301	6,243	237	12/21 04:00	32.1	21.8	70.0	90.0	165	301	3,376		

Engineering Checks Report

Primary

System Name: Single Zone CV

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Kitchen	686	0	3.69	965	261	45.98	0	3.69	-5.14
		Kitchen	382	0	6.54	1,096	167	71.86	0	6.54	-3.18
		Service	304	0	1.18	1,008	852	14.08	0	1.18	-7.70

System Name: Variable Refrigerant Flow

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	100	1.09	548	502	23.90	100	1.09	-6.46
	Noisy Activity 1		180	100	1.09	548	503	23.86	100	1.09	-6.45
	ACT-Noisy-2		181	100	0.56	438	783	15.33	100	0.56	-4.93
	Noisy Activity 2		181	100	0.55	437	791	15.17	100	0.55	-4.85
	ACT-Noisy-3		182	100	0.58	441	764	15.71	100	0.58	-6.23
	Noisy Activity 3		182	100	0.57	441	767	15.65	100	0.57	-6.20
	ACT-Quiet-1		130	100	0.46	400	868	13.82	100	0.46	-2.79
	Quiet Activity 1		130	100	0.46	398	872	13.76	100	0.46	-2.74
	ACT-Quiet-2		131	100	0.66	459	694	17.29	100	0.66	-4.24
	Quiet Activity 2		131	100	0.65	454	700	17.14	100	0.65	-4.10
	ACT-Quiet-3		131	100	0.59	444	749	16.02	100	0.59	-4.03
	Quiet Activity 3		131	100	0.59	443	751	15.98	100	0.59	-4.01
	Admin		189	100	0.64	522	816	14.71	100	0.64	-4.98
	Office 1		94	100	0.69	525	765	15.69	100	0.69	-5.23
	Office 2		95	100	0.63	522	823	14.58	100	0.63	-4.86
	Attrium		1,267	100	0.30	524	1,770	6.78	100	0.30	-3.92
	Attrium		622	100	0.23	516	2,218	5.41	100	0.23	-3.25
	Attrium 2		645	100	0.39	542	1,403	8.55	100	0.39	-4.86
	Chart/Hotel		200	100	0.33	461	1,382	8.68	100	0.33	-2.05
	Chart/Hotel		200	100	0.32	458	1,436	8.36	100	0.32	-1.89
	Comfort/Consult		283	100	0.52	488	932	12.88	100	0.52	-4.15
	Comfort Room 2		82	100	0.53	489	923	13.00	100	0.53	-4.32
	Consult 1		100	100	0.51	486	949	12.64	100	0.51	-3.97
	Consult 2		102	100	0.53	488	930	12.90	100	0.53	-4.06
	Corridor-N		409	100	0.30	586	1,953	6.14	100	0.30	-4.21
	Corridor 3		409	100	0.30	586	1,957	6.13	100	0.30	-4.20
	Corridor-S		414	100	0.59	589	1,003	11.96	100	0.59	-4.07
	Corridor 5		414	100	0.59	589	1,003	11.96	100	0.59	-4.06
	Corridor-W		324	100	0.82	578	704	17.05	100	0.82	-4.76
	Corridor 4		324	100	0.82	578	707	16.97	100	0.82	-4.71
	Entry/Waiting		370	100	1.91	568	298	40.27	100	1.91	-14.25
	Entry/Waiting		370	100	1.92	568	296	40.54	100	1.92	-14.30

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 13

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Exam/Storage	224	100	0.34	478	1,415	8.48	100	0.34	-1.82
		Exam Room	123	100	0.40	465	1,170	10.26	100	0.40	-1.16
		Long Term Belongings Storage	101	100	0.24	497	2,049	5.86	100	0.24	-2.35
	Group		276	100	0.52	420	807	14.87	100	0.52	-5.48
		Group	276	100	0.52	419	808	14.85	100	0.52	-5.49
	Hospitality		246	100	0.55	432	788	15.23	100	0.55	-5.43
		Hospitality	246	100	0.55	432	787	15.25	100	0.55	-5.44
	Intake-HR-A		470	100	0.47	505	1,074	11.17	100	0.47	-4.76
		Intake Corridor	155	100	0.18	579	3,244	3.70	100	0.18	-2.15
		Interview Room	158	100	0.55	492	893	13.44	100	0.55	-4.93
		Sally Port	78	100	0.91	522	576	20.83	100	0.91	-7.77
		Shower 1	80	100	0.45	446	980	12.24	100	0.45	-4.62
	Intake-HR-B		165	100	0.35	484	1,377	8.71	100	0.35	-2.32
		Ante Room	81	100	0.25	500	1,963	6.11	100	0.25	-2.41
		Comfort Room 1	84	100	0.44	474	1,072	11.19	100	0.44	-2.16
	Lounge		297	100	0.80	526	656	18.29	100	0.80	-5.30
		Lounge	198	100	0.89	489	547	21.94	100	0.89	-6.31
		Shower 2	99	100	0.55	469	847	14.17	100	0.55	-3.30
	Multipurpose/Dining		485	100	0.50	409	822	14.60	100	0.50	-5.32
		Multipurpose/Dining	485	100	0.50	408	823	14.58	100	0.50	-5.32
	RB-N-Corner		130	100	1.19	624	523	22.94	100	1.19	-6.70
		Resident Room 14	130	100	1.19	624	523	22.94	100	1.19	-6.70
	RB-N-East		257	100	1.00	595	598	20.07	100	1.00	-6.00
		Resident Room 15	130	100	1.01	595	592	20.27	100	1.01	-6.75
		Resident Room 16	127	100	0.97	590	606	19.80	100	0.97	-5.21
	RB-N-West		383	100	1.15	629	545	22.02	100	1.15	-5.16
		Resident Room 11	129	100	1.12	626	556	21.58	100	1.12	-5.01
		Resident Room 12	127	100	1.16	630	542	22.14	100	1.16	-5.12
		Resident Room 13	127	100	1.17	632	540	22.22	100	1.17	-5.25
	RB-S-Corner-N		129	100	0.98	591	604	19.87	100	0.98	-6.68
		Resident Room 04	129	100	0.98	591	603	19.90	100	0.98	-6.70
	RB-S-Corner-S		131	100	1.03	519	505	23.76	100	1.03	-6.69
		Resident Room 05	131	100	1.03	519	505	23.76	100	1.03	-6.68

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-East		372	100	0.97	589	608	19.74	100	0.97	-4.95
		Resident Room 01	124	100	0.92	592	641	18.72	100	0.92	-4.45
		Resident Room 02	112	100	1.05	608	577	20.80	100	1.05	-5.21
		Resident Room 03	136	100	0.96	588	610	19.67	100	0.96	-5.09
	RB-S-West		124	100	1.14	625	549	21.86	100	1.14	-5.20
		Resident Room 06	124	100	1.14	625	550	21.82	100	1.14	-5.19
	RB-W-North		130	100	1.00	593	595	20.17	100	1.00	-7.34
		Resident Room 10	130	100	1.00	593	595	20.17	100	1.00	-7.33
	RB-W-South		380	100	1.08	527	488	24.59	100	1.08	-6.53
		Resident Room 07	125	100	1.05	525	500	24.00	100	1.05	-5.76
		Resident Room 08	126	100	1.08	527	486	24.69	100	1.08	-6.02
		Resident Room 09	128	100	1.10	527	479	25.05	100	1.10	-7.52
	Servery		228	100	0.47	396	842	14.25	100	0.47	-4.49
		Servery	228	100	0.47	396	842	14.25	100	0.47	-4.49
	SHWR-N		204	100	0.47	448	959	12.51	100	0.47	-4.40
		Shower 7	103	100	0.47	449	949	12.64	100	0.47	-4.29
		Shower 8	101	100	0.46	446	975	12.31	100	0.46	-4.41
	SHWR-S		207	100	0.50	455	909	13.20	100	0.50	-4.28
		Shower 3	104	100	0.50	454	914	13.13	100	0.50	-4.20
		Shower 4	103	100	0.50	460	916	13.10	100	0.50	-4.34
	SHWR-W		207	100	0.45	444	991	12.11	100	0.45	-4.36
		Shower 5	104	100	0.46	446	979	12.26	100	0.46	-4.43
		Shower 6	104	100	0.44	442	1,008	11.90	100	0.44	-4.24
	Support		603	100	0.42	578	1,363	8.80	100	0.42	-4.56
		Electric	191	100	0.46	578	1,268	9.46	100	0.46	-5.38
		Emergency Electric	179	100	0.39	578	1,485	8.08	100	0.39	-3.76
		Fire Room	79	100	0.59	578	981	12.23	100	0.59	-6.54
		Mechanical	155	100	0.34	578	1,700	7.06	100	0.34	-1.84

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	100	0.23	539	2,355	5.10	100	0.23	-2.55
		Clean Supply	102	100	0.23	493	2,169	5.53	100	0.23	-2.30
		Corridor 1	295	100	0.19	579	3,097	3.87	100	0.19	-2.28
		Corridor 2	635	100	0.16	579	3,651	3.29	100	0.16	-1.99
		Corridor 2.1	85	100	0.22	591	2,747	4.37	100	0.22	-2.63
		General Storage	96	100	0.43	528	1,217	9.86	100	0.43	-2.71
		Hskp	57	100	0.25	499	2,006	5.98	100	0.25	-2.39
		IT	158	100	0.31	578	1,863	6.44	100	0.31	-0.65
		Laundry	122	100	0.22	492	2,204	5.44	100	0.22	-2.27
		Meds	129	100	0.23	493	2,180	5.50	100	0.23	-2.34
		Soiled Supply	97	100	0.23	495	2,115	5.67	100	0.23	-2.32
		Staff Corridor	893	100	0.22	591	2,658	4.51	100	0.22	-2.67
		Stor.	15	100	0.54	537	987	12.16	100	0.54	-5.44
		Storage	52	100	0.38	521	1,385	8.66	100	0.38	-4.56
		Toilet 1	67	100	0.62	473	763	15.73	100	0.62	-5.42
		Toilet 2	62	100	0.29	341	1,165	10.30	100	0.29	-2.49
		Toilet 3	62	100	0.30	345	1,153	10.41	100	0.30	-2.61

System Name: DOAS to Zone Level Equipment Dehum and Reheat

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
DOAS to Zone Level Equipment Dehum and Reheat			0	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Engineering Checks Report

ASHRAE 90.1-2010 Baseline

System Name: System 10 - 2010/2013

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 10 - 2010/2013			79	0	1.07	0	0	0.00	0	0.30	-38.47
	Fire Room		79	0	1.07	578	540	22.22	0	1.07	-10.81
		Fire Room	79	0	0.93	578	620	19.35	0	0.93	-10.40

System Name: System 2 - 2007/2010/2013

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Attrium		1,267	0	0.45	536	1,196	10.03	0	0.45	-5.77
		Attrium	622	0	0.32	523	1,633	7.35	0	0.32	-4.54
		Attrium 2	645	0	0.57	550	966	12.42	0	0.57	-7.33
	Corridor-N		409	14	0.43	578	1,352	8.88	14	0.43	-5.88
		Corridor 3	409	21	0.29	579	2,010	5.97	21	0.29	-5.95
	Corridor-S		414	11	0.53	578	1,088	11.03	11	0.53	-5.84
		Corridor 5	414	14	0.42	593	1,396	8.60	14	0.42	-5.74
	Corridor-W		324	18	0.33	578	1,741	6.89	18	0.33	-6.71
		Corridor 4	324	9	0.64	578	897	13.38	9	0.64	-6.66
	RB-N-Corner		130	15	0.74	493	667	17.99	15	0.74	-10.40
		Resident Room 14	130	11	0.96	510	529	22.68	11	0.96	-10.36
	RB-N-East		257	13	0.85	507	596	20.13	13	0.85	-9.06
		Resident Room 15	130	14	0.78	497	634	18.93	14	0.78	-10.42
		Resident Room 16	127	14	0.75	494	657	18.26	14	0.75	-7.64
	RB-N-West		383	18	0.60	478	793	15.13	18	0.60	-7.54
		Resident Room 11	129	13	0.86	503	583	20.58	13	0.86	-7.34
		Resident Room 12	127	13	0.88	505	574	20.91	13	0.88	-7.48
		Resident Room 13	127	13	0.88	505	571	21.02	13	0.88	-7.69
	RB-S-Corner-N		129	11	0.96	514	537	22.35	11	0.96	-10.31
		Resident Room 04	129	13	0.85	507	597	20.10	13	0.85	-10.39
	RB-S-Corner-S		131	13	0.87	504	578	20.76	13	0.87	-10.32
		Resident Room 05	131	11	1.03	518	501	23.95	11	1.03	-10.35
	RB-S-East		372	14	0.76	500	655	18.32	14	0.76	-7.19
		Resident Room 01	124	15	0.66	489	737	16.28	15	0.66	-6.36
		Resident Room 02	112	15	0.78	496	640	18.75	15	0.78	-7.62
		Resident Room 03	136	15	0.74	493	668	17.96	15	0.74	-7.49
	RB-S-West		124	17	0.63	481	762	15.75	17	0.63	-7.65
		Resident Room 06	124	12	0.88	505	573	20.94	12	0.88	-7.63
	RB-W-North		130	13	0.88	505	575	20.87	13	0.88	-11.14
		Resident Room 10	130	12	0.91	507	557	21.54	12	0.91	-11.16
	RB-W-South		380	10	1.06	515	488	24.59	10	1.06	-9.55
		Resident Room 07	125	12	0.88	509	576	20.83	12	0.88	-8.25
		Resident Room 08	126	12	0.91	516	569	21.09	12	0.91	-8.65
		Resident Room 09	128	12	1.05	519	496	24.19	12	1.05	-11.38

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 2 - 2007/2010/2013			5,067	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	SHWR-N		204	0	0.61	474	774	15.50	0	0.61	-6.62
		Shower 7	103	0	0.59	466	786	15.27	0	0.59	-6.48
		Shower 8	101	0	0.58	463	804	14.93	0	0.58	-6.60
	SHWR-S		207	0	0.54	457	853	14.07	0	0.54	-6.47
		Shower 3	104	0	0.67	476	710	16.90	0	0.67	-6.36
		Shower 4	103	0	0.68	478	700	17.14	0	0.68	-6.53
	SHWR-W		207	0	0.60	467	778	15.42	0	0.60	-6.64
		Shower 5	104	0	0.55	460	829	14.48	0	0.55	-6.70
		Shower 6	104	0	0.54	457	852	14.08	0	0.54	-6.39

System Name: System 4 - 2007/2010/2013

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	32	0.66	451	686	17.49	32	0.66	-9.17
		Noisy Activity 1	180	21	1.01	491	484	24.79	21	1.01	-9.14
	ACT-Noisy-2		181	33	0.64	449	702	17.09	33	0.64	-6.92
		Noisy Activity 2	181	36	0.58	439	756	15.87	36	0.58	-6.85
	ACT-Noisy-3		182	34	0.62	445	720	16.67	34	0.62	-8.64
		Noisy Activity 3	182	34	0.61	444	726	16.53	34	0.61	-8.59
	ACT-Quiet-1		130	42	0.50	424	841	14.27	42	0.50	-3.83
		Quiet Activity 1	130	43	0.49	420	864	13.89	43	0.49	-3.76
	ACT-Quiet-2		131	30	0.70	457	652	18.40	30	0.70	-5.93
		Quiet Activity 2	131	34	0.62	451	722	16.62	34	0.62	-5.72
	ACT-Quiet-3		131	38	0.55	434	783	15.33	38	0.55	-6.07
		Quiet Activity 3	131	31	0.69	455	662	18.13	31	0.69	-6.04
	Admin		189	11	0.97	527	542	22.14	11	0.97	-7.65
		Office 1	94	12	0.94	531	564	21.28	12	0.94	-7.97
		Office 2	95	12	0.85	526	617	19.45	12	0.85	-7.45
	Chart/Hotel		200	28	0.40	472	1,180	10.17	28	0.40	-2.76
		Chart/Hotel	200	29	0.38	467	1,234	9.72	29	0.38	-2.51
	Comfort/Consult		283	40	0.63	502	793	15.13	40	0.63	-6.65
		Comfort Room 2	82	41	0.62	501	803	14.94	41	0.62	-6.99
		Consult 1	100	41	0.61	500	813	14.76	41	0.61	-6.48
		Consult 2	102	41	0.63	501	800	15.00	41	0.63	-6.61
	Entry/Waiting		370	6	1.50	572	380	31.58	6	1.50	-18.78
		Entry/Waiting	370	6	1.42	564	397	30.23	6	1.42	-18.86
	Exam/Storage		224	38	0.44	495	1,138	10.54	38	0.44	-2.91
		Exam Room	123	39	0.46	478	1,039	11.55	39	0.46	-2.18
		Long Term Belongings Storage	101	39	0.39	518	1,343	8.94	39	0.39	-3.43
	Group		276	49	0.67	453	672	17.86	49	0.67	-7.70
		Group	276	50	0.66	451	687	17.47	50	0.66	-7.71
	Hospitality		246	49	0.67	453	675	17.78	49	0.67	-7.67
		Hospitality	246	49	0.67	453	677	17.73	49	0.67	-7.63

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Intake-HR-A	470	21	0.71	524	741	16.19	21	0.71	-6.69
		Intake Corridor	155	23	0.30	578	1,947	6.16	23	0.30	-3.27
		Interview Room	158	23	0.70	509	723	16.60	23	0.70	-8.18
		Sally Port	78	23	1.23	536	438	27.40	23	1.23	-11.71
		Shower 1	80	23	0.62	470	754	15.92	23	0.62	-6.48
		Intake-HR-B	165	33	0.48	504	1,049	11.44	33	0.48	-3.78
		Ante Room	81	33	0.40	520	1,294	9.27	33	0.40	-3.57
		Comfort Room 1	84	33	0.55	492	890	13.48	33	0.55	-3.83
		Lounge	297	21	1.07	497	466	25.75	21	1.07	-7.84
		Lounge	198	22	1.14	500	438	27.40	22	1.14	-9.18
		Shower 2	99	22	0.78	493	633	18.96	22	0.78	-4.93
		Multipurpose/Dining	485	51	0.65	450	693	17.32	51	0.65	-7.21
		Multipurpose/Dining	485	52	0.63	447	707	16.97	52	0.63	-7.23
		Servery	228	52	0.63	447	709	16.93	52	0.63	-6.30
		Servery	228	53	0.62	445	720	16.67	53	0.62	-6.25
		Support	524	8	0.73	578	787	15.25	8	0.73	-6.41
		Electric	191	9	0.86	578	673	17.83	9	0.86	-9.06
		Emergency Electric	179	9	0.60	578	970	12.37	9	0.60	-6.21
		Mechanical	155	9	0.45	578	1,286	9.33	9	0.45	-3.68

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 4 - 2007/2010/2013			7,820	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	15	0.36	548	1,514	7.93	15	0.36	-3.79
		Clean Supply	102	16	0.37	516	1,392	8.62	16	0.37	-3.36
		Corridor 1	295	16	0.30	578	1,956	6.13	16	0.30	-3.39
		Corridor 2	635	16	0.23	579	2,509	4.78	16	0.23	-2.97
		Corridor 2.1	85	16	0.23	579	2,551	4.70	16	0.23	-3.81
		General Storage	96	16	0.59	536	909	13.20	16	0.59	-3.98
		Hskp	57	16	0.41	521	1,266	9.48	16	0.41	-3.66
		IT	158	16	0.39	578	1,485	8.08	16	0.39	-1.94
		Laundry	122	16	0.36	515	1,417	8.47	16	0.36	-3.30
		Meds	129	16	0.37	515	1,401	8.57	16	0.37	-3.39
		Soiled Supply	97	16	0.38	517	1,365	8.79	16	0.38	-3.39
		Staff Corridor	893	16	0.37	586	1,594	7.53	16	0.37	-4.06
		Stor.	15	16	0.75	544	727	16.51	16	0.75	-7.72
		Storage	52	16	0.54	533	985	12.18	16	0.54	-6.73
		Toilet 1	67	16	0.67	476	709	16.93	16	0.67	-7.12
		Toilet 2	62	16	0.56	461	825	14.55	16	0.56	-3.63
		Toilet 3	62	16	0.57	462	814	14.74	16	0.57	-3.78

System Name: System 4 - 2007/2010/2013_Copy

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
System 4 - 2007/2010/2013_Copy			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	8	4.07	549	135	88.89	8	4.07	-80.43
		Kitchen	382	8	6.54	1,045	160	75.00	8	6.54	-4.82
		Service	304	8	0.99	557	562	21.35	8	0.99	-11.18

Project Summary



Building Summary

Building Type	
Conditioned Floor Area	13,652 ft²
Total Building Area	21,103 ft²
Gross Wall Area	11,729 ft²
Window-Wall Ratio	7.05 %
Gross Roof Area	15,695 ft²
Skylight-Roof Ratio	0 %
Average Plug Load Density	0.69 W/ft²
Average Lighting Density	0.45 W/ft²
Peak Occupancy	125
Site Ventilation	1,550 cfm
Cooling Specific Air Flow	8,767 cfm
Heating Specific Air Flow	4,082 cfm
Site Peak Cooling Load	25 tons
Site Peak Heating Load	410 MBh


Weather Summary

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Summer Design Dry Bulb Temperature (1%)	98.8
Winter Design Dry Bulb Temperature (99%)	35.6
User Defined	
Summer Design Day Dry Bulb Temperature	98.8
Coincident Design Day Wet Bulb Temperature	66.6
Winter Design Day Dry Bulb Temperature	32.1

Project Information



Project Name Casa De Amparo_v4
 Building Owner
 Location
 Program User
 Company

Building Performance

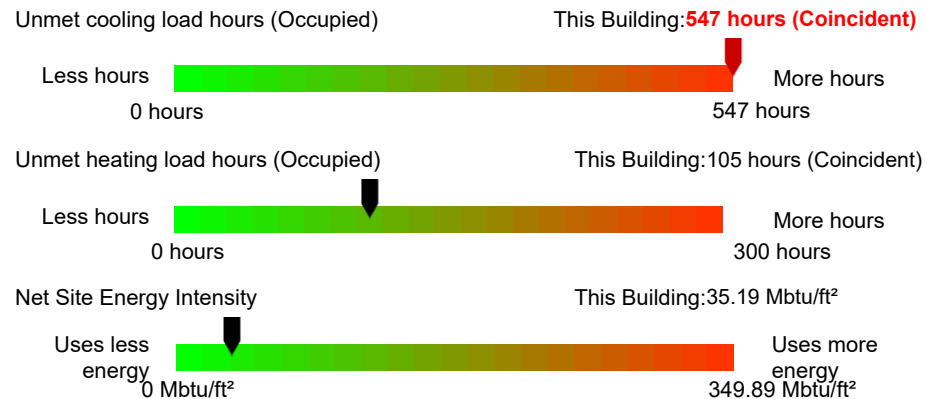

Site Performance

Net Source Energy Use Intensity (EUI)	111.5 Mbtu/ft²
Annual Electrical Consumption	217,714 kWh
Annual Peak Electrical Demand	53 kW
Annual Gas Consumption	0 MMBtu
Annual Water Consumption	0 gal

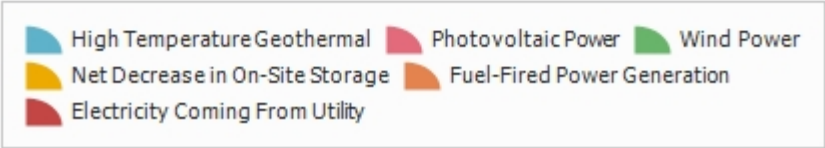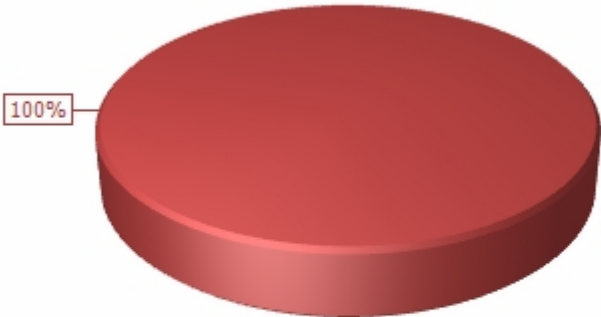

Fuel-Fired Power Generation	0 kWh
High Temperature Geothermal	0 kWh
Photovoltaic Power	0 kWh
Wind Power	0 kWh
Net Decrease in On-Site Storage	0 kWh
Sub-Total On Site Electricity	0 kWh
Electricity Coming From Utility	217,713 kWh
Surplus Electricity To Utility	0 kWh
Net Electricity From Utility	217,713 kWh
Total Electric Sources	217,713 kWh

Water-Side Heat Recovery	8 kWh
Air to Air Heat Recovery Cooling	0 kWh
Air to Air Heat Recover Heating	0 kWh
High-Temperature Geothermal	0 kWh
Solar Water Thermal	0 kWh
Solar Air Thermal	0 kWh
Total On-Site Thermal Sources	8 kWh

Project Summary




Building Summary		Weather Summary	
Building Type		Location	Climate Zone 10 CA USA
Conditioned Floor Area	13,652 ft²	Weather File	CZ10RV2
Total Building Area	21,103 ft²	Latitude	N 33° 52
Gross Wall Area	11,729 ft²	Longitude	W 117° 16
Window-Wall Ratio	7.05 %	Time Zone	GMT -8.0 Hours
Gross Roof Area	15,695 ft²	Summer Design Dry Bulb Temperature (1%)	98.8
Skylight-Roof Ratio	0 %	Winter Design Dry Bulb Temperature (99%)	35.6
Average Plug Load Density	0.69 W/ft²	User Defined	
Average Lighting Density	0.54 W/ft²	Summer Design Day Dry Bulb Temperature	98.8
Peak Occupancy	125	Coincident Design Day Wet Bulb Temperature	66.6
Site Ventilation	1,672 cfm	Winter Design Day Dry Bulb Temperature	32.1
Cooling Specific Air Flow	10,601 cfm		
Heating Specific Air Flow	10,601 cfm		
Site Peak Cooling Load	30 tons		
Site Peak Heating Load	786 MBh		



Project Information	Building Performance
---------------------	----------------------

Project Name Casa De Amparo_v4
Building Owner
Location
Program User
Company

Site Performance

Net Source Energy Use Intensity (EUI) 104 Mbtu/ft²
Annual Electrical Consumption 203,156 kWh
Annual Peak Electrical Demand 49 kW
Annual Gas Consumption 0 MMBtu
Annual Water Consumption 0 gal

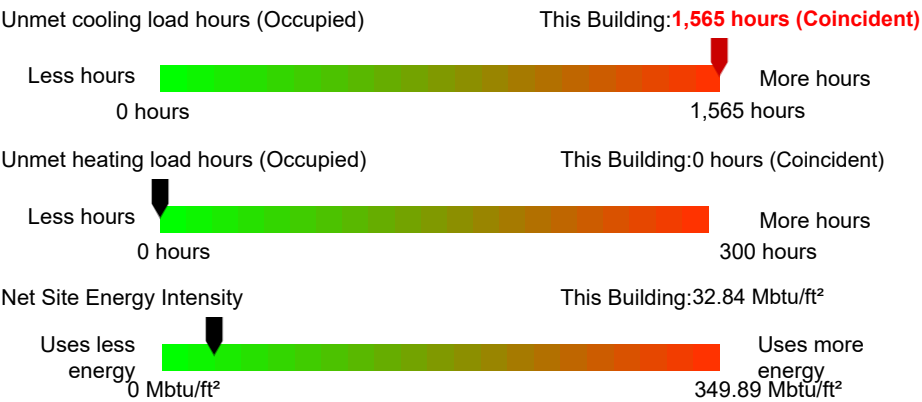


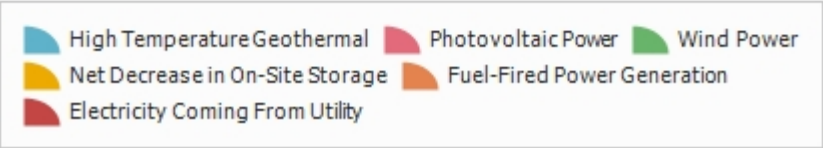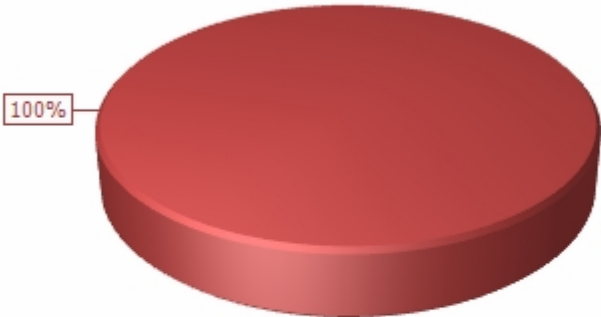

Fuel-Fired Power Generation	0 kWh
High Temperature Geothermal	0 kWh
Photovoltaic Power	0 kWh
Wind Power	0 kWh
Net Decrease in On-Site Storage	0 kWh
Sub-Total On Site Electricity	0 kWh
Electricity Coming From Utility	203,157 kWh
Surplus Electricity To Utility	0 kWh
Net Electricity From Utility	203,157 kWh
Total Electric Sources	203,157 kWh

Water-Side Heat Recovery	0 kWh
Air to Air Heat Recovery Cooling	0 kWh
Air to Air Heat Recover Heating	0 kWh
High-Temperature Geothermal	0 kWh
Solar Water Thermal	0 kWh
Solar Air Thermal	0 kWh
Total On-Site Thermal Sources	0 kWh

Alternative Annual Electricity End Use and Demand Comparison

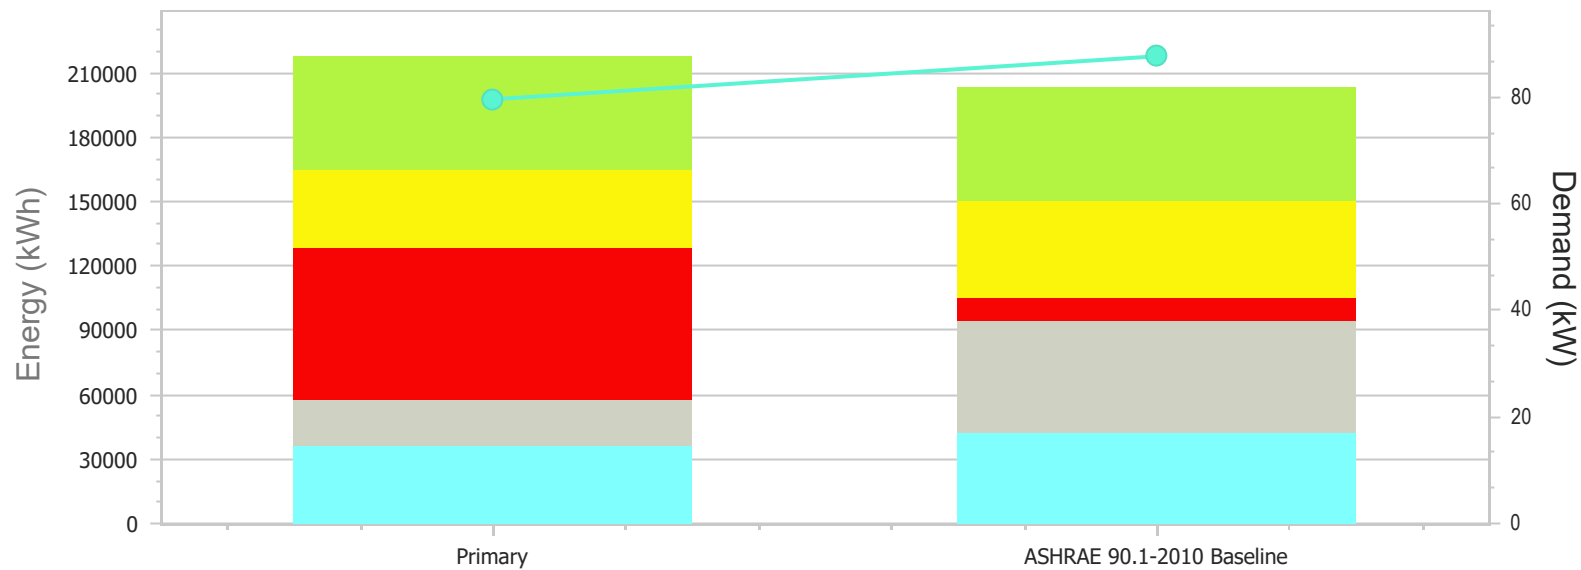

	Primary	
	Energy (kWh)	Demand (kW)
Cooling	36,227.67	19.41
Exterior Lighting	0.00	0.00
Exterior Receptacles	0.00	0.00
Fans	21,454.34	2.73
Heat Recovery	0.00	0.00
Heat Rejection	0.00	0.00
Heating	70,685.50	37.76
Humidification	0.00	0.00
Interior Lighting	36,568.19	8.76
Interior Receptacles	52,779.21	10.94
Pumps	0.00	0.00
Refrigeration	0.00	0.00
Service Water Heating	0.00	0.00
Grand Total	217,714.91	79.60



Cooling

Exterior Lighting

Exterior Receptacles

Fans

Heat Recovery

Heat Rejection

Heating

Humidification

Interior Lighting

Interior Receptacles

Pumps


Refrigeration

Service Water Heating

Total Demand

ASHRAE 90.1-2010 Baseline	
Energy (kWh)	Demand (kW)
42,524.45	30.27
0.00	0.00
0.00	0.00
51,912.73	6.89
0.00	0.00
0.00	0.00
10,990.92	29.13
0.00	0.00
44,951.00	10.44
52,779.21	10.94
0.00	0.00
0.00	0.00
0.00	0.00
203,158.31	87.67

Economic Alternative Comparison

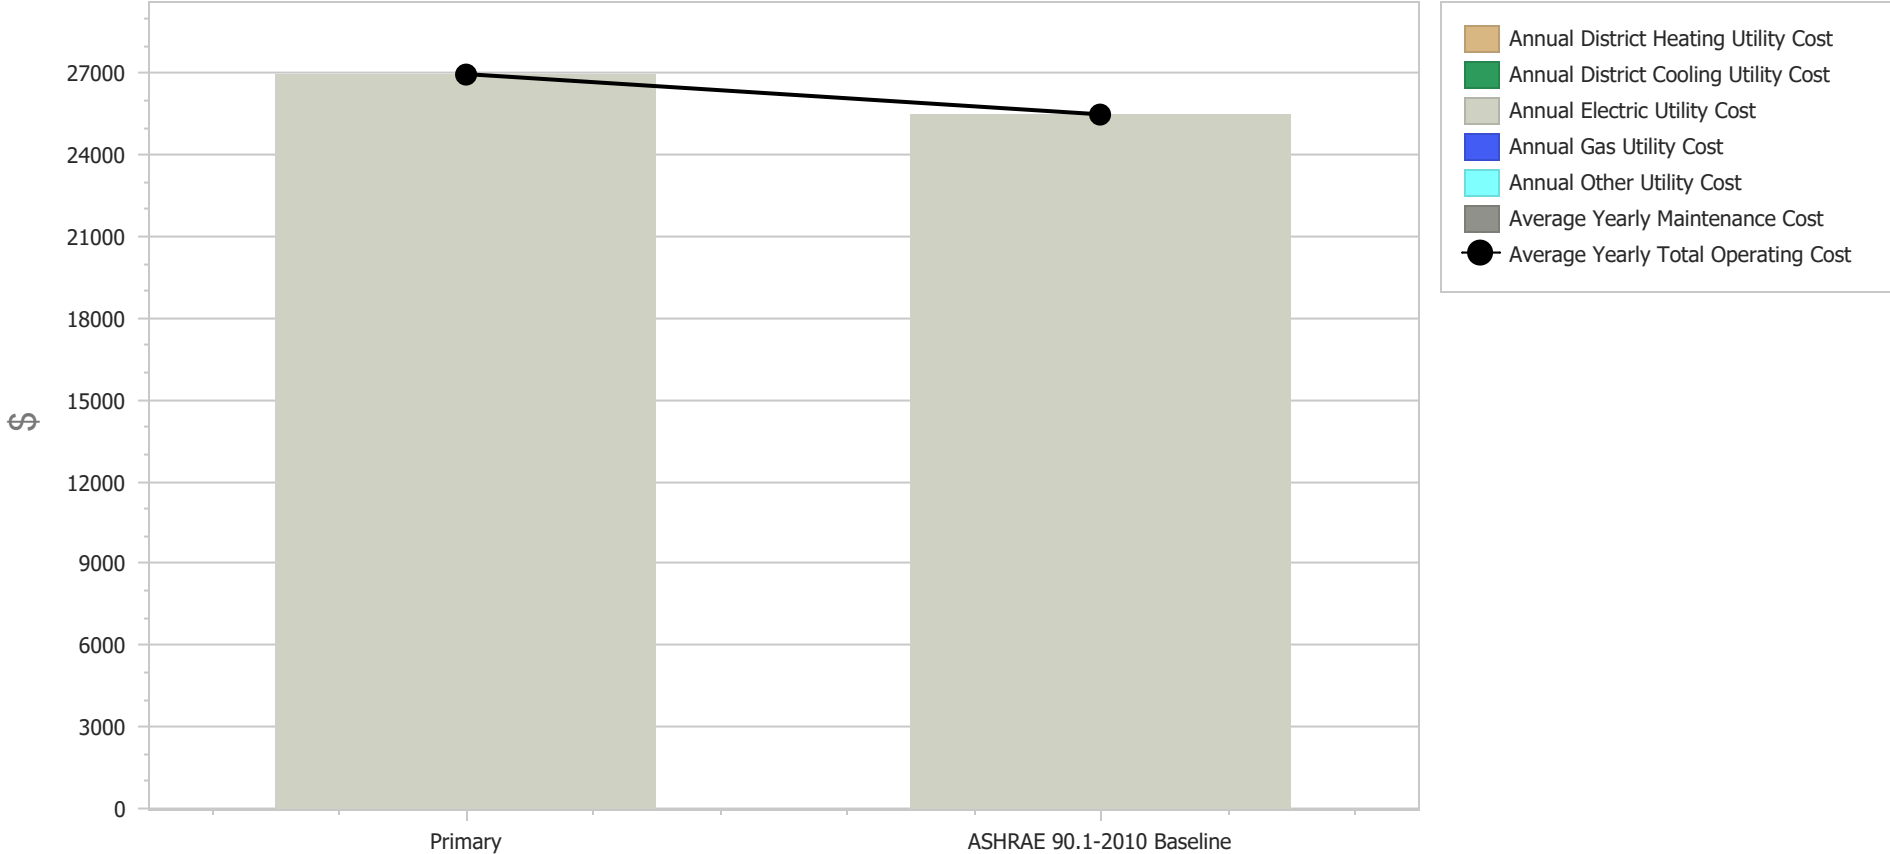

	Primary
Annual District Cooling Utility Cost	0
Annual District Heating Utility Cost	0
Annual Electric Utility Cost	26,968
Annual Gas Utility Cost	0
Annual Other Utility Cost	0
Average Yearly Maintenance Cost	0
Average Yearly Total Operating Cost	26,968

ASHRAE 90.1-2010 Baseline
0
0
25,487
0
0
0
25,487

Climatic Summary


Overview

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Weather File Source	CTZRV2
WMO Station	722860
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Elevation	1,539 ft
Standard Pressure	0.96 Bar
Heating Degree Days (base 65°F)	1,674
Cooling Degree Days (base 50°F)	5,022

Peaks

	Dry Bulb Temp. [F]	Dew Point Temp. [F]
Maximum	104.2	70
Date	Aug 13	Aug 7
Minimum	30.9	0.3
Date	Jan 3	Feb 22

— Daily Minimum DryBulb — Daily Maximum DryBulb - - - Summer Design - - - Winter Design

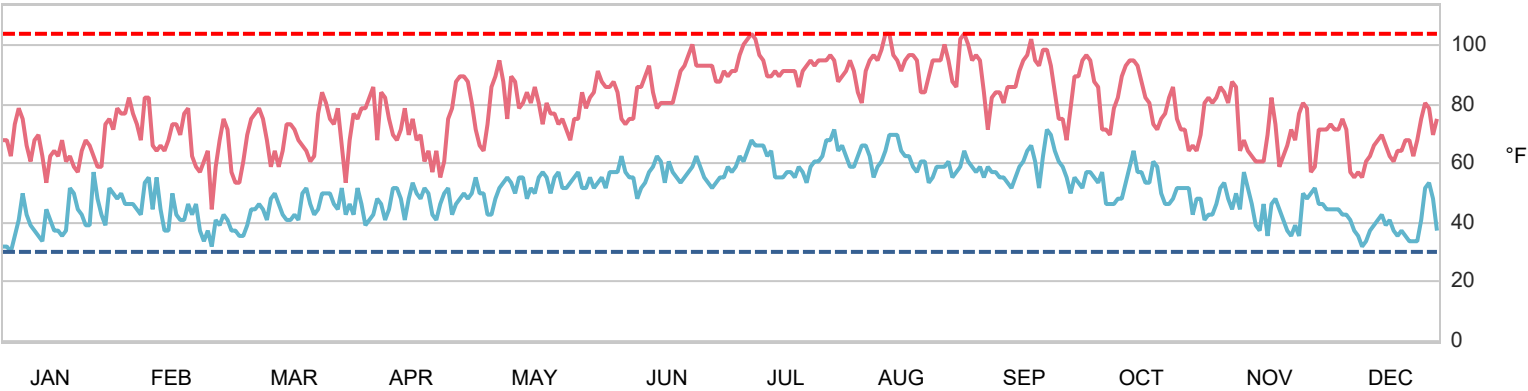

Design Day Data

	ASHRAE Design Conditions %	Design Temperature [F]	Daily Temperature Range [ΔF]	Humidity Value	Humidity Type	Wind Speed [mph]	Wind Direction deg.
Heating	99.6	32.1	0	23.2	Wetbulb[F]	23.6	300 °
Cooling	1	98.8	30.9	66.6	Wetbulb[F]	9.9	300 °

Climatic Summary


Overview

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Weather File Source	CTZRV2
WMO Station	722860
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Elevation	1,539 ft
Standard Pressure	0.96 Bar
Heating Degree Days (base 65°F)	1,674
Cooling Degree Days (base 50°F)	5,022

Peaks

	Dry Bulb Temp. [F]	Dew Point Temp. [F]
Maximum	104.2	70
Date	Aug 13	Aug 7
Minimum	30.9	0.3
Date	Jan 3	Feb 22

— Daily Minimum DryBulb — Daily Maximum DryBulb - - - Summer Design - - - Winter Design

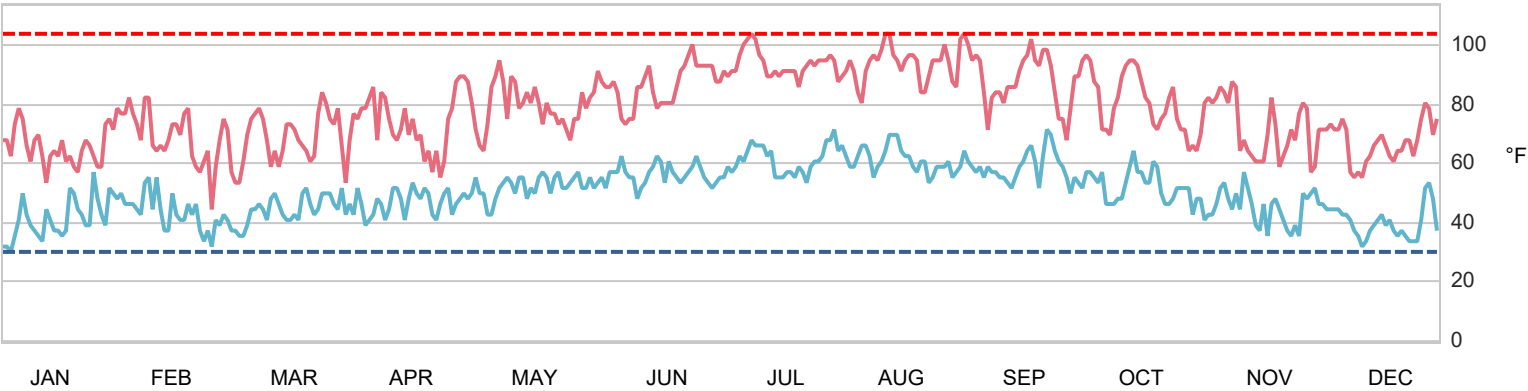


Design Day Data

	ASHRAE Design Conditions %	Design Temperature [F]	Daily Temperature Range [ΔF]	Humidity Value	Humidity Type	Wind Speed [mph]	Wind Direction deg.
Heating	99.6	32.1	0	23.2	Wetbulb[F]	23.6	300 °
Cooling	1	98.8	30.9	66.6	Wetbulb[F]	9.9	300 °

Lighting and Daylighting Summary

Total Site Energy Breakdown

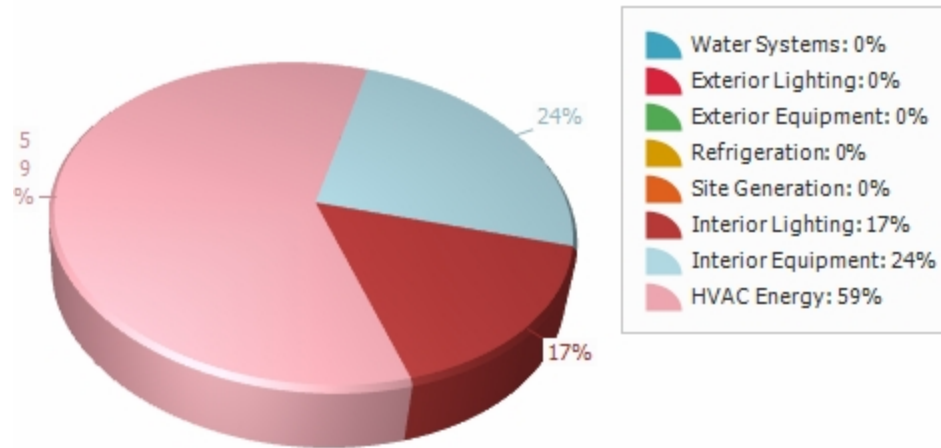

Window Area

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827

SkyLight Area

	Units	Total
Gross Roof Area	ft²	15,695
Skylight Area	ft²	0
Skylight-Roof Ratio	%	0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 10

Lighting

Component	Electricity (kWh)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)
Interior Lighting	36,567	124,771	5.91	395,149	18.72
Exterior Lighting	0	0	0	0	0

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Intake-HR-B	Ante Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	40	0.31	125	59.14
Attrium	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.29	373	0.31	3,267	167.98
Attrium	2 _Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.31	387	0.31	3,390	167.98
Chart/Hotel	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.7	140	0.31	431	59.14
Utility	Clean Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	51	0.31	157	59.14
Intake-HR-B	Comfort Room 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.61	101	0.31	310	59.14
Comfort/Consult	Comfort Room 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	98	0.31	304	59.14
Comfort/Consult	Consult 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.42	120	0.31	370	59.14
Comfort/Consult	Consult 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.43	122	0.31	375	59.14
Utility	Corridor 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.04	118	0.31	364	59.14
Utility	Corridor 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.09	254	0.31	783	59.14
Utility	Corridor 2.1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	34	0.31	105	59.14
Corridor-N	Corridor 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	164	0.31	505	59.14
Corridor-W	Corridor 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	130	0.31	400	59.14
Corridor-S	Corridor 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	166	0.31	511	59.14
Support	Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.16	95	0.31	294	59.14
Support	Emergency Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.15	89	0.31	276	59.14
Entry/Waiting	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.6	222	0.31	1,947	167.98

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Exam/Storage	Exam Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.66	148	0.31	455	59.14
Support	Fire Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.07	40	0.31	122	59.14
Utility	General Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	48	0.31	147	59.14
Group	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	207	0.31	639	59.14
Hospitality	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	185	0.31	569	59.14
Utility	Hskp _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	28	0.31	88	59.14
Intake-HR-A	Intake Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	62	0.31	191	59.14
Intake-HR-A	Interview Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	189	0.31	584	59.14
Utility	It _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	79	0.31	244	59.14
Kitchen	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.36	244	0.31	2,141	167.98
Utility	Laundry _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	61	0.31	188	59.14
Exam/Storage	Long Term Belongings Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.23	50	0.31	155	59.14
Lounge	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	148	0.31	457	59.14
Support	Mechanical _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	77	0.31	239	59.14
Utility	Meds _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	65	0.31	200	59.14
Multipurpose/Dining	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	364	0.31	1,123	59.14
ACT-Noisy-1	Noisy Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	180	0.31	554	59.14
ACT-Noisy-2	Noisy Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	181	0.31	558	59.14
ACT-Noisy-3	Noisy Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	182	0.31	562	59.14
Admin	Office 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	66	0.31	203	59.14
Admin	Office 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	67	0.31	205	59.14
ACT-Quiet-1	Quiet Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	130	0.31	402	59.14
ACT-Quiet-2	Quiet Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	131	0.31	403	59.14
ACT-Quiet-3	Quiet Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	131	0.31	404	59.14

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
RB-S-East	Resident Room 01 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	149	0.31	458	59.14
RB-S-East	Resident Room 02 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.36	134	0.31	413	59.14
RB-S-East	Resident Room 03 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.44	164	0.31	505	59.14
RB-S-Corner-N	Resident Room 04 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	155	0.31	478	59.14
RB-S-Corner-S	Resident Room 05 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	158	0.31	486	59.14
RB-S-West	Resident Room 06 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	149	0.31	459	59.14
RB-W-South	Resident Room 07 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	150	0.31	464	59.14
RB-W-South	Resident Room 08 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	467	59.14
RB-W-South	Resident Room 09 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	153	0.31	473	59.14
RB-W-North	Resident Room 10 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	156	0.31	480	59.14
RB-N-West	Resident Room 11 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	155	0.31	478	59.14
RB-N-West	Resident Room 12 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	469	59.14
RB-N-West	Resident Room 13 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	469	59.14
RB-N-Corner	Resident Room 14 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	156	0.31	483	59.14
RB-N-East	Resident Room 15 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.61	156	0.31	482	59.14
RB-N-East	Resident Room 16 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.59	152	0.31	469	59.14
Intake-HR-A	Sally Port _Light Load #001_Template	Lights - Small Hotel - Lighting	0.2	93	0.31	288	59.14
Servery	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	171	0.31	528	59.14
Kitchen	Service _Light Load #001_Template	Lights - Small Hotel - Lighting	0.22	152	0.31	468	59.14
Intake-HR-A	Shower 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.09	40	0.31	124	59.14
Lounge	Shower 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.17	49	0.31	153	59.14
SHWR-S	Shower 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14
SHWR-S	Shower 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	159	59.14
SHWR-W	Shower 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 10

Interior Lighting


Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
SHWR-W	Shower 6 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14
SHWR-N	Shower 7 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	51	0.31	159	59.14
SHWR-N	Shower 8 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	50	0.31	155	59.14
Utility	Soiled Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	48	0.31	149	59.14
Utility	Staff Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.12	357	0.31	1,102	59.14
Utility	Stor. _Light Load #001_Template	Lights - Small Hotel - Lighting	0	7	0.31	22	59.14
Utility	Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	26	0.31	80	59.14
Utility	Toilet 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	33	0.31	103	59.14
Utility	Toilet 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	31	0.31	95	59.14
Utility	Toilet 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	31	0.31	95	59.14
Unconditioned Room Room 00-81	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	3	0.31	8	59.14
Unconditioned Room Trash	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	38	0.31	118	59.14

Daylighting

Daylighting Reference Point	Zone Name	Control Type	Control Type	Fraction of Lighting Controlled	Installed Lighting Power (W)	Controlled Lighting Power (W)	Window Area (ft²)	Average Visible Transmittance
None					0	0	0	0

Lighting and Daylighting Summary

Total Site Energy Breakdown

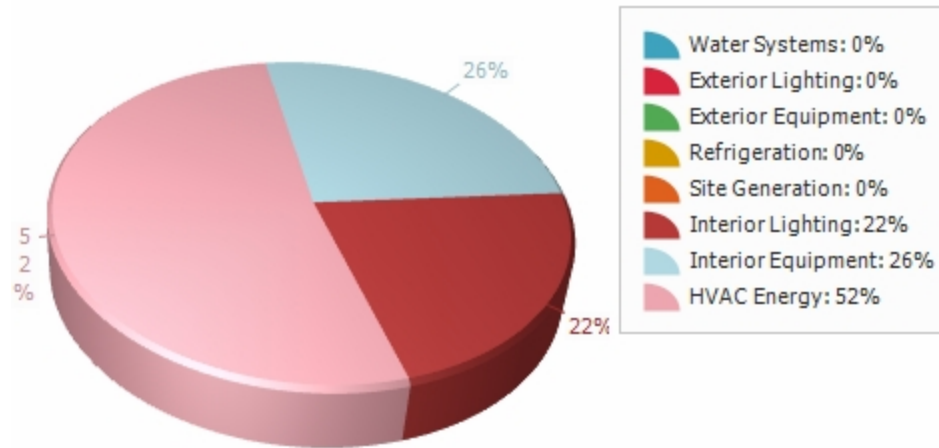

Window Area

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827

SkyLight Area

	Units	Total
Gross Roof Area	ft²	15,695
Skylight Area	ft²	0
Skylight-Roof Ratio	%	0

Lighting

Component	Electricity (kWh)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)
Interior Lighting	44,950	153,376	7.27	485,741	23.01
Exterior Lighting	0	0	0	0	0

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Intake-HR-B	Ante Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.31	51	0.31	157	59.14
Attrium	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.44	559	0.31	4,900	167.98
Attrium	2 _Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.46	581	0.31	5,085	167.98
Chart/Hotel	_Light Load #001_Template	Lights - Small Hotel - Lighting	1.11	222	0.31	683	59.14
Utility	Clean Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	64	0.31	198	59.14
Intake-HR-B	Comfort Room 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.84	139	0.78	429	59.14
Comfort/Consult	Comfort Room 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.48	136	0.78	420	59.14
Comfort/Consult	Consult 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.59	166	0.78	512	59.14
Comfort/Consult	Consult 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.59	168	0.78	519	59.14
Utility	Corridor 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.09	263	0.78	811	59.14
Utility	Corridor 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.19	565	0.78	1,743	59.14
Utility	Corridor 2.1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	76	0.78	235	59.14
Corridor-N	Corridor 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	364	0.78	1,123	59.14
Corridor-W	Corridor 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	288	0.78	889	59.14
Corridor-S	Corridor 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	368	0.78	1,136	59.14
Support	Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	181	0.31	558	59.14
Support	Emergency Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.32	170	0.31	524	59.14
Entry/Waiting	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.9	333	0.31	2,920	167.98

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Exam/Storage	Exam Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.91	204	0.78	630	59.14
Fire Room	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.95	75	0.31	232	59.14
Utility	General Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	60	0.31	186	59.14
Group	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	246	0.31	759	59.14
Hospitality	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	219	0.31	675	59.14
Utility	Hskp _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	36	0.31	110	59.14
Intake-HR-A	Intake Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.29	138	0.78	425	59.14
Intake-HR-A	Interview Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.56	262	0.78	808	59.14
Utility	It _Light Load #001_Template	Lights - Small Hotel - Lighting	0.05	150	0.31	463	59.14
Kitchen	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.36	244	0.31	2,141	167.98
Utility	Laundry _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	77	0.31	237	59.14
Exam/Storage	Long Term Belongings Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.28	63	0.31	196	59.14
Lounge	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.59	176	0.31	543	59.14
Support	Mechanical _Light Load #001_Template	Lights - Small Hotel - Lighting	0.28	147	0.31	453	59.14
Utility	Meds _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	82	0.31	251	59.14
Multipurpose/Dining	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	432	0.31	1,332	59.14
ACT-Noisy-1	Noisy Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	131	0.31	404	59.14
ACT-Noisy-2	Noisy Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	132	0.31	407	59.14
ACT-Noisy-3	Noisy Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	133	0.31	410	59.14
Admin	Office 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.55	105	0.31	322	59.14
Admin	Office 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.56	106	0.31	326	59.14
ACT-Quiet-1	Quiet Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	95	0.31	293	59.14
ACT-Quiet-2	Quiet Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	95	0.31	294	59.14
ACT-Quiet-3	Quiet Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	96	0.31	295	59.14

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 8 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
RB-S-East	Resident Room 01 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	47	0.78	145	59.14
RB-S-East	Resident Room 02 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.11	42	0.78	131	59.14
RB-S-East	Resident Room 03 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.14	52	0.78	160	59.14
RB-S-Corner-N	Resident Room 04 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	49	0.78	151	59.14
RB-S-Corner-S	Resident Room 05 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	50	0.78	154	59.14
RB-S-West	Resident Room 06 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	47	0.78	145	59.14
RB-W-South	Resident Room 07 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	48	0.78	147	59.14
RB-W-South	Resident Room 08 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	48	0.78	148	59.14
RB-W-South	Resident Room 09 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	49	0.78	150	59.14
RB-W-North	Resident Room 10 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	49	0.78	152	59.14
RB-N-West	Resident Room 11 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	49	0.78	151	59.14
RB-N-West	Resident Room 12 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	48	0.78	148	59.14
RB-N-West	Resident Room 13 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	48	0.78	148	59.14
RB-N-Corner	Resident Room 14 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	50	0.78	153	59.14
RB-N-East	Resident Room 15 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.19	50	0.78	153	59.14
RB-N-East	Resident Room 16 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.19	48	0.78	148	59.14
Intake-HR-A	Sally Port _Light Load #001_Template	Lights - Small Hotel - Lighting	0.27	129	0.78	398	59.14
Servery	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	203	0.31	626	59.14
Kitchen	Service _Light Load #001_Template	Lights - Small Hotel - Lighting	0.28	191	0.31	590	59.14
Intake-HR-A	Shower 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.17	79	0.31	242	59.14
Lounge	Shower 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.33	97	0.31	299	59.14
SHWR-S	Shower 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.49	102	0.31	314	59.14
SHWR-S	Shower 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.49	101	0.31	312	59.14
SHWR-W	Shower 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.49	101	0.31	313	59.14

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
SHWR-W	Shower 6 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.49	101	0.31	313	59.14
SHWR-N	Shower 7 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	101	0.31	311	59.14
SHWR-N	Shower 8 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.48	99	0.31	304	59.14
Utility	Soiled Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	61	0.31	188	59.14
Utility	Staff Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.27	795	0.78	2,452	59.14
Utility	Stor. _Light Load #001_Template	Lights - Small Hotel - Lighting	0	9	0.31	28	59.14
Utility	Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	33	0.31	101	59.14
Utility	Toilet 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	66	0.31	202	59.14
Utility	Toilet 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	61	0.31	187	59.14
Utility	Toilet 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	60	0.31	186	59.14
Unconditioned Room Room 00-81	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.89	3	0.31	9	59.14
Unconditioned Room Trash	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.63	48	0.31	148	59.14

Daylighting


Daylighting Reference Point	Zone Name	Control Type	Control Type	Fraction of Lighting Controlled	Installed Lighting Power (W)	Controlled Lighting Power (W)	Window Area (ft²)	Average Visible Transmittance
None					0	0	0	0

Site Consumption Summary


Energy Consumption

HVAC Energy Usage

(MMBtu)

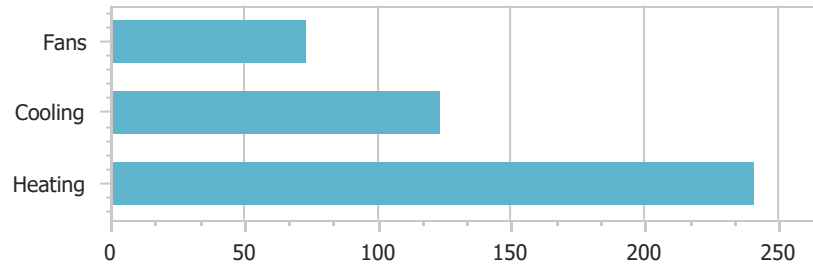

Total Site Energy Breakdown

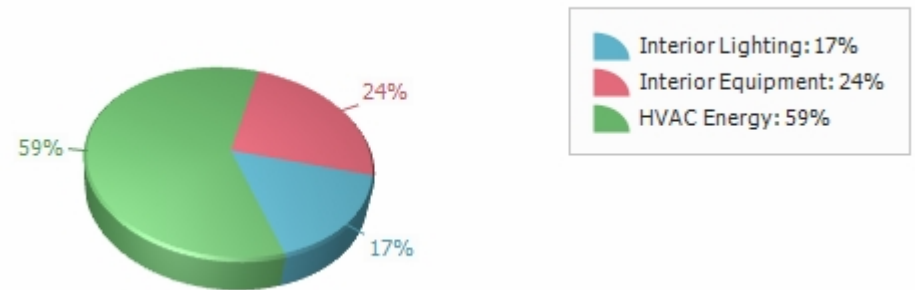

Component	Electricity (kWh)	Gas (MMBtu)	District Cooling (MMBtu)	District Heating Water (MMBtu)	Other Utilities (MMBtu)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)	Water (gal)
Heating	70,686	0	0	0	0	241,191	11.43	763,852	36.19	0
Cooling	36,228	0	0	0	0	123,614	5.86	391,487	18.55	0
Fans	21,456	0	0	0	0	73,209	3.47	231,854	10.98	0
Pumps	0	0	0	0	0	0	0	0	0	0
Heat Rejection	0	0	0	0	0	0	0	0	0	0
Humidification	0	0	0	0	0	0	0	0	0	0
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0
HVAC	128,369	0	0	0	0	438,015	20.75	1,387,193	65.72	0
Water Systems	0	0	0	0	0	0	0	0	0	0
Interior Lighting	36,567	0	0	0	0	124,771	5.91	395,149	18.72	0
Exterior Lighting	0	0	0	0	0	0	0	0	0	0
Interior Equipment	52,778	0	0	0	0	180,085	8.53	570,330	27.02	0
Exterior Equipment	0	0	0	0	0	0	0	0	0	0
Refrigeration	0	0	0	0	0	0	0	0	0	0
Non-HVAC	89,344	0	0	0	0	304,856	14.44	965,479	45.74	0
Generators	0	0	0	0	0	0	0	0	0	0
Site Generation	0	0	0	0	0	0	0	0	0	0
Grand Total	217,714	0	0	0	0	742,871	35.19	2,352,671	111.45	0

IT Equipment Energy

0

0

PUE N/A

Gross Floor Area: 21,103 ft²

Region:

Building Type: Office

CBECS Survey Year: 2012

Benchmark EUI: .0 Mbtu/ft²/yr

If the region reports as "All US" it means the data for the particular region was withheld because the Relative Standard Error was greater than 50 percent or fewer than 20 buildings were sampled.

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 4

Monthly Energy End Use

Electricity

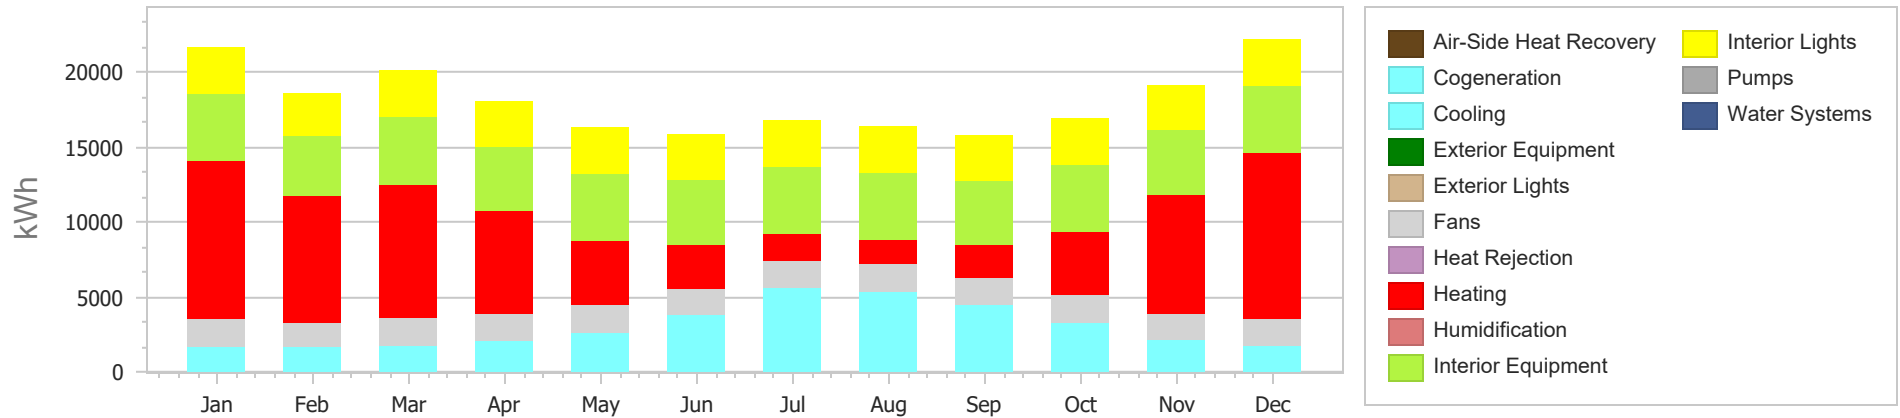


	January	February	March	April	May	June	July	August	September	October	November	December	Grand Total
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0	0	0	0
Cogeneration	0	0	0	0	0	0	0	0	0	0	0	0	0
Cooling	1,692	1,658	1,757	2,098	2,616	3,795	5,599	5,372	4,497	3,289	2,119	1,737	36,227
Exterior Equipment	0	0	0	0	0	0	0	0	0	0	0	0	0
Exterior Lights	0	0	0	0	0	0	0	0	0	0	0	0	0
Fans	1,811	1,644	1,822	1,758	1,825	1,754	1,825	1,830	1,766	1,827	1,770	1,822	21,454
Heat Rejection	0	0	0	0	0	0	0	0	0	0	0	0	0
Heating	10,578	8,410	8,904	6,839	4,312	2,922	1,799	1,586	2,177	4,202	7,901	11,055	70,685
Humidification	0	0	0	0	0	0	0	0	0	0	0	0	0
Interior Equipment	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
Interior Lights	3,100	2,805	3,112	3,006	3,108	3,011	3,103	3,112	3,006	3,104	2,999	3,103	36,568
Pumps	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Systems	0	0	0	0	0	0	0	0	0	0	0	0	0
Grand Total	21,660	18,565	20,085	18,036	16,347	15,826	16,803	16,390	15,780	16,905	19,122	22,194	217,713

Site Consumption Summary


Energy Consumption

HVAC Energy Usage

(MMBtu)

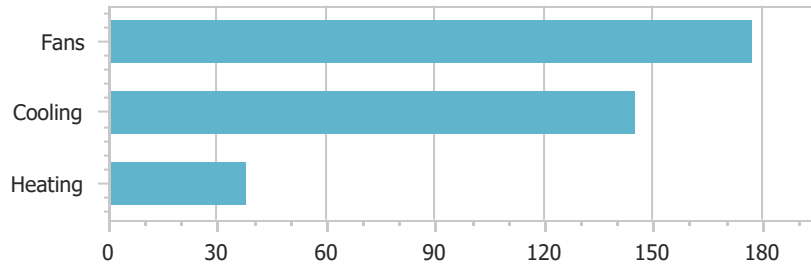

Total Site Energy Breakdown

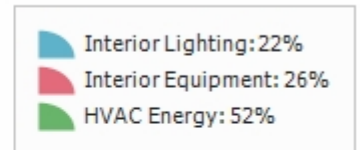

Component	Electricity (kWh)	Gas (MMBtu)	District Cooling (MMBtu)	District Heating Water (MMBtu)	Other Utilities (MMBtu)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)	Water (gal)
Heating	10,992	0	0	0	0	37,505	1.78	118,779	5.63	0
Cooling	42,525	0	0	0	0	145,101	6.87	459,536	21.77	0
Fans	51,911	0	0	0	0	177,128	8.39	560,965	26.57	0
Pumps	0	0	0	0	0	0	0	0	0	0
Heat Rejection	0	0	0	0	0	0	0	0	0	0
Humidification	0	0	0	0	0	0	0	0	0	0
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0
HVAC	105,428	0	0	0	0	359,735	17.04	1,139,279	53.97	0
Water Systems	0	0	0	0	0	0	0	0	0	0
Interior Lighting	44,950	0	0	0	0	153,376	7.27	485,741	23.01	0
Exterior Lighting	0	0	0	0	0	0	0	0	0	0
Interior Equipment	52,778	0	0	0	0	180,085	8.53	570,330	27.02	0
Exterior Equipment	0	0	0	0	0	0	0	0	0	0
Refrigeration	0	0	0	0	0	0	0	0	0	0
Non-HVAC	97,728	0	0	0	0	333,461	15.8	1,056,071	50.03	0
Generators	0	0	0	0	0	0	0	0	0	0
Site Generation	0	0	0	0	0	0	0	0	0	0
Grand Total	203,156	0	0	0	0	693,196	32.84	2,195,350	104	0

IT Equipment Energy

0

0

PUE N/A

Gross Floor Area: 21,103 ft²

Region:

Building Type: Office

CBECS Survey Year: 2012

Benchmark EUI: .0 Mbtu/ft²/yr

If the region reports as "All US" it means the data for the particular region was withheld because the Relative Standard Error was greater than 50 percent or fewer than 20 buildings were sampled.

Alternative: ASHRAE 90.1-2010 Baseline

Calculated at: Jun 11, 2026 - 10:54 PM

File: Casa De Amparo_v4.mdf


TRACE 3D Plus 7.00

214

Page 3 of 4


Monthly Energy End Use

Electricity

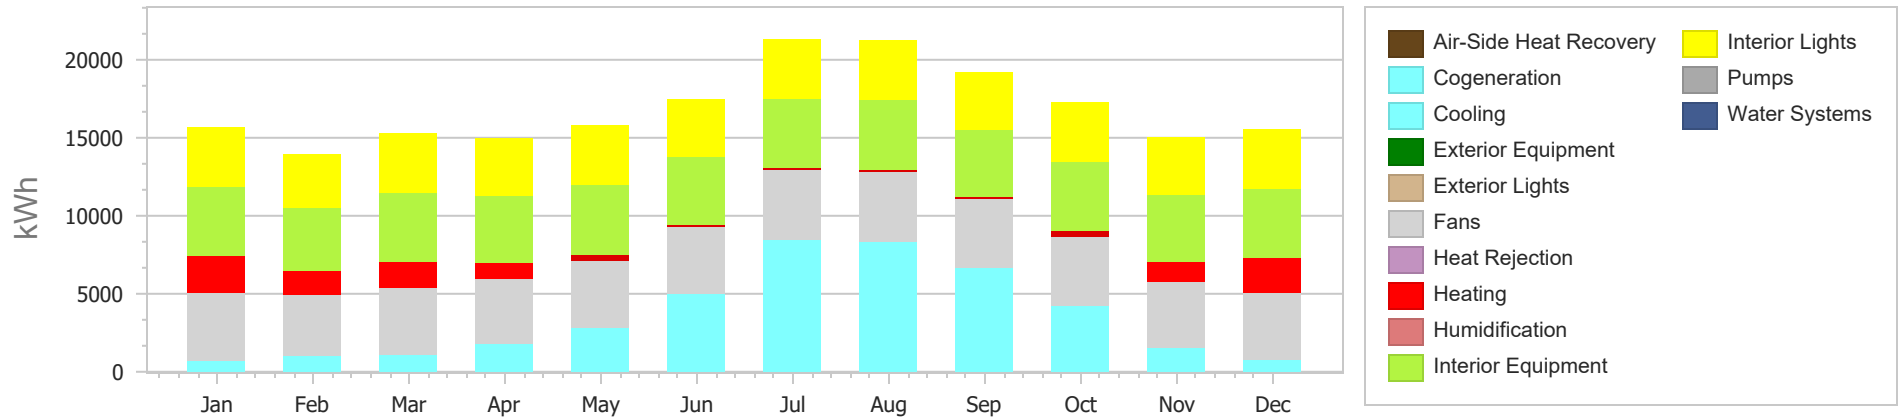


Site Load Profile

Site HVAC Load Profile

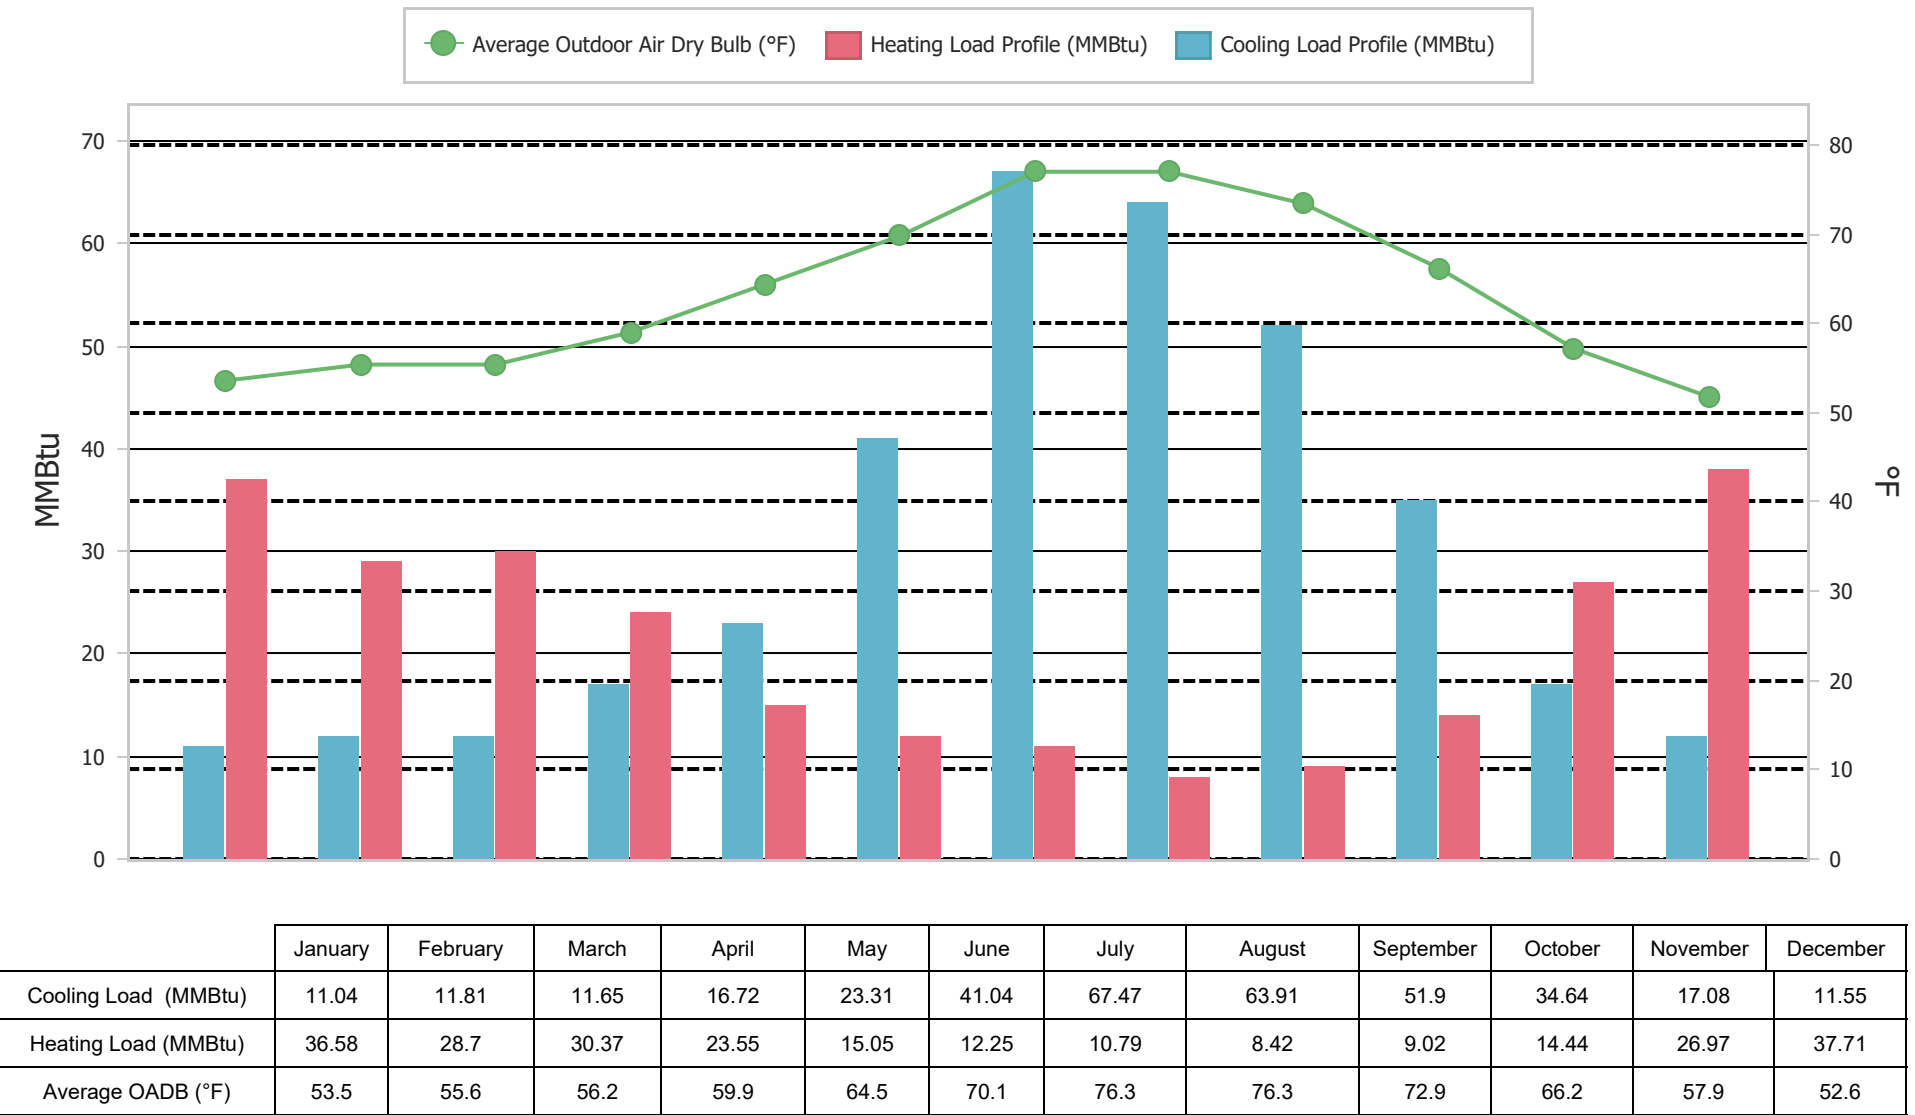

Site HVAC Hourly Load Distribution

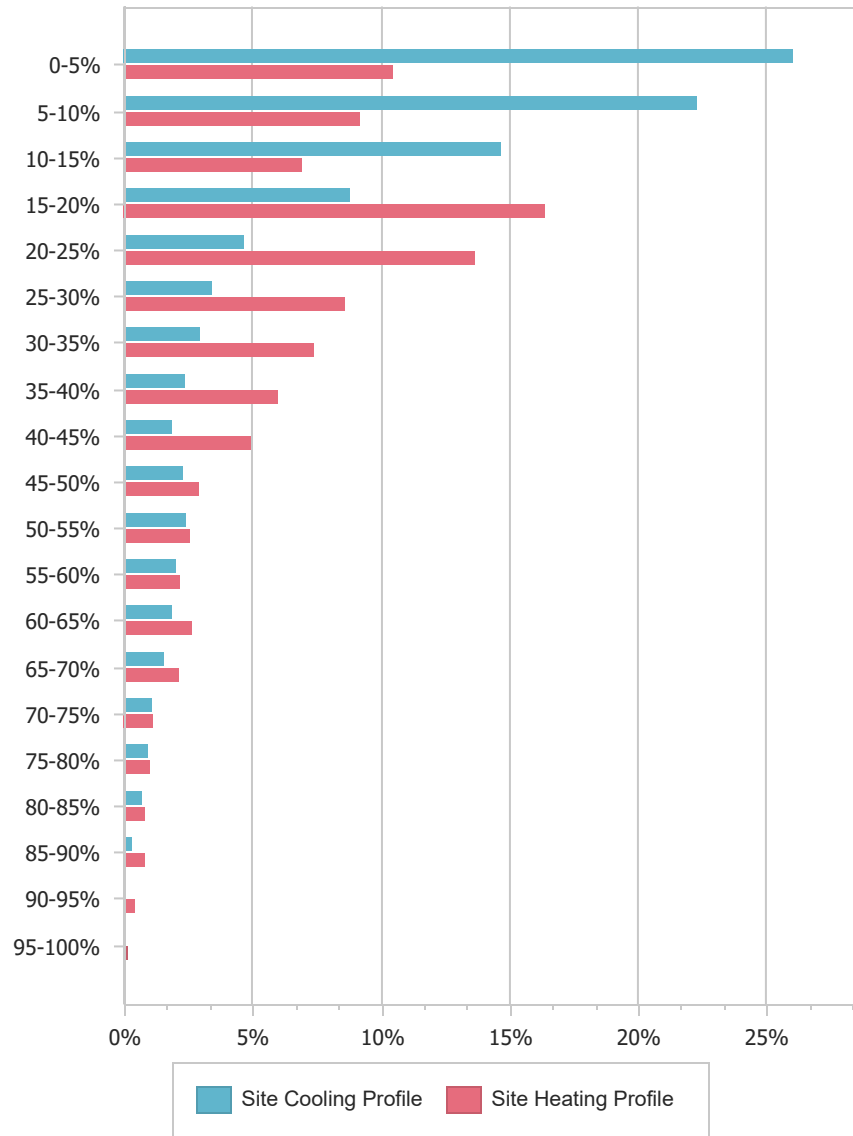


% Load	Cooling			Heating		
	Cutoff (tons)	% Hours	Hours	Cutoff (MBtuh)	% Hours	Hours
0-5	0.9	26.03%	2,280	6.3	10.46%	769
5-10	1.9	22.26%	1,950	12.7	9.16%	673
10-15	2.8	14.66%	1,284	19	6.9%	507
15-20	3.8	8.77%	768	25.3	16.38%	1,204
20-25	4.7	4.65%	407	31.7	13.63%	1,002
25-30	5.7	3.39%	297	38	8.6%	632
30-35	6.6	2.93%	257	44.3	7.37%	542
35-40	7.5	2.35%	206	50.7	5.99%	440
40-45	8.5	1.86%	163	57	4.92%	362
45-50	9.4	2.28%	200	63.3	2.91%	214
50-55	10.4	2.4%	210	69.7	2.54%	187
55-60	11.3	1.99%	174	76	2.16%	159
60-65	12.3	1.85%	162	82.3	2.63%	193
65-70	13.2	1.55%	136	88.7	2.11%	155
70-75	14.1	1.06%	93	95	1.13%	83
75-80	15.1	0.92%	81	101.3	0.99%	73
80-85	16	0.67%	59	107.7	0.79%	58
85-90	17	0.29%	25	114	0.82%	60
90-95	17.9	0.06%	5	120.3	0.39%	29
95-100	18.9	0.03%	3	126.7	0.12%	9

Cooling hours off: (0%) Heating hours off: 1,409 (16%)


Site Load Profile

Site HVAC Load Profile

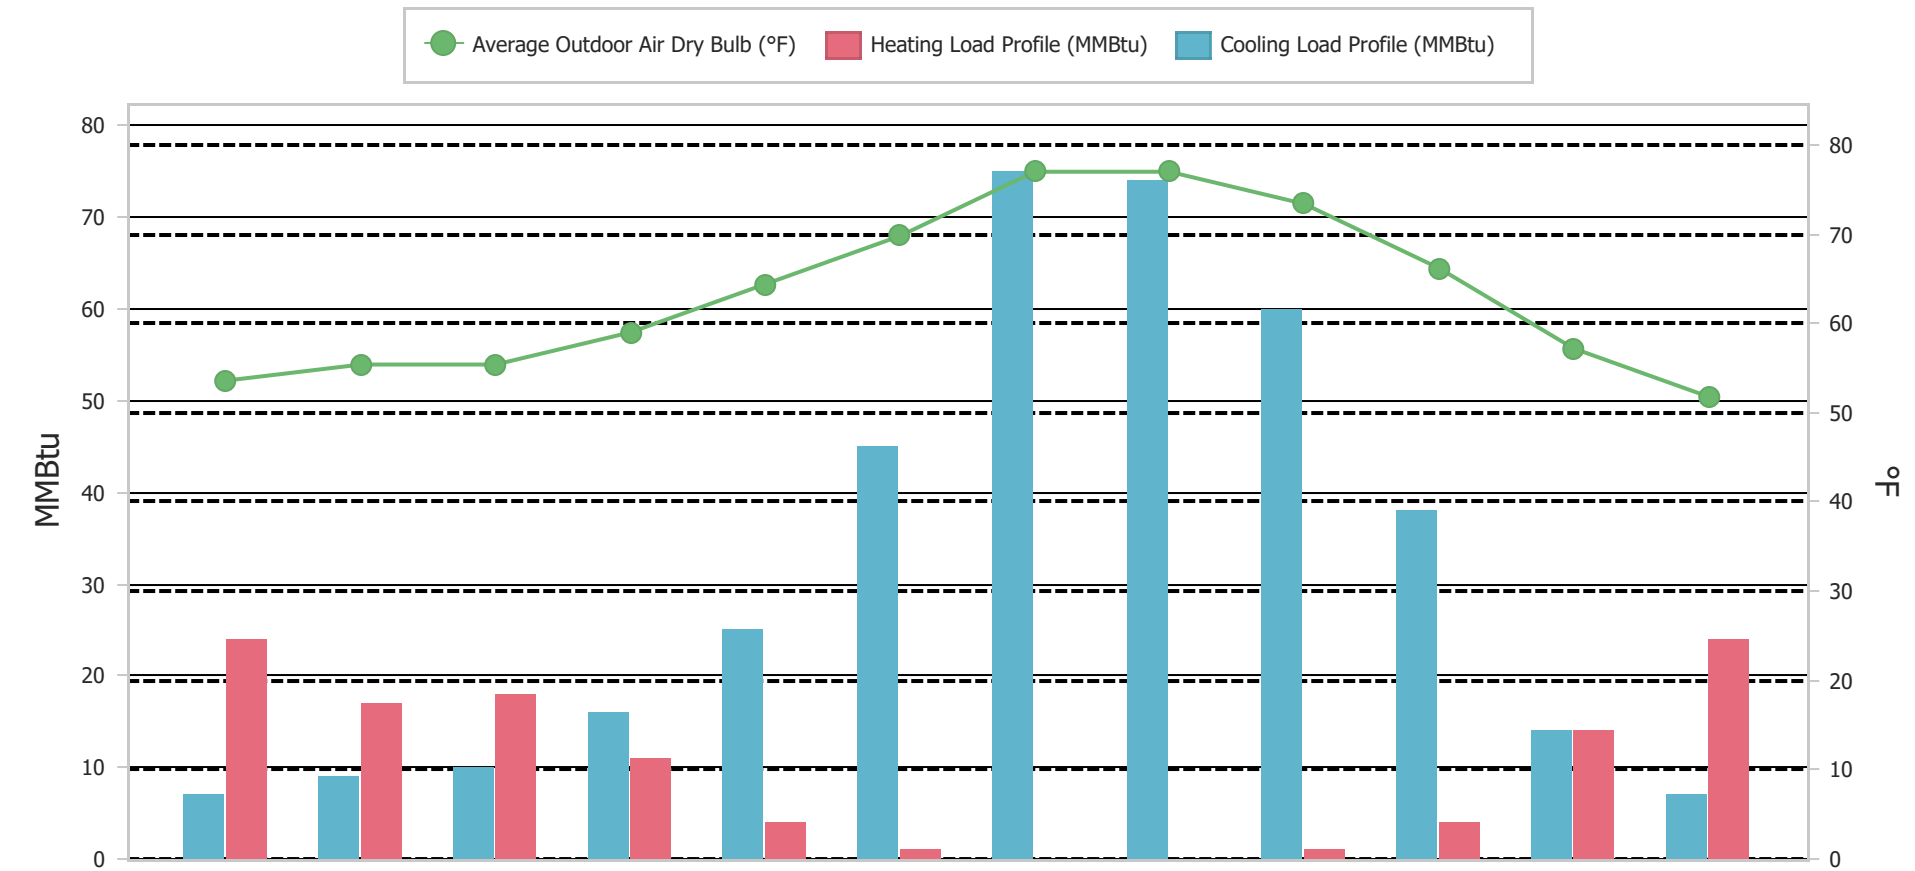

	January	February	March	April	May	June	July	August	September	October	November	December
Cooling Load (MMBtu)	6.64	9.37	9.88	16.16	25.1	44.64	75.24	74.3	59.75	37.77	14.08	6.93
Heating Load (MMBtu)	24.28	16.83	17.72	11.3	3.73	1.26	0.36	0.23	1.09	3.9	13.82	23.75
Average OADB (°F)	53.5	55.6	56.2	59.9	64.5	70.1	76.3	76.3	72.9	66.2	57.9	52.6

Site HVAC Hourly Load Distribution

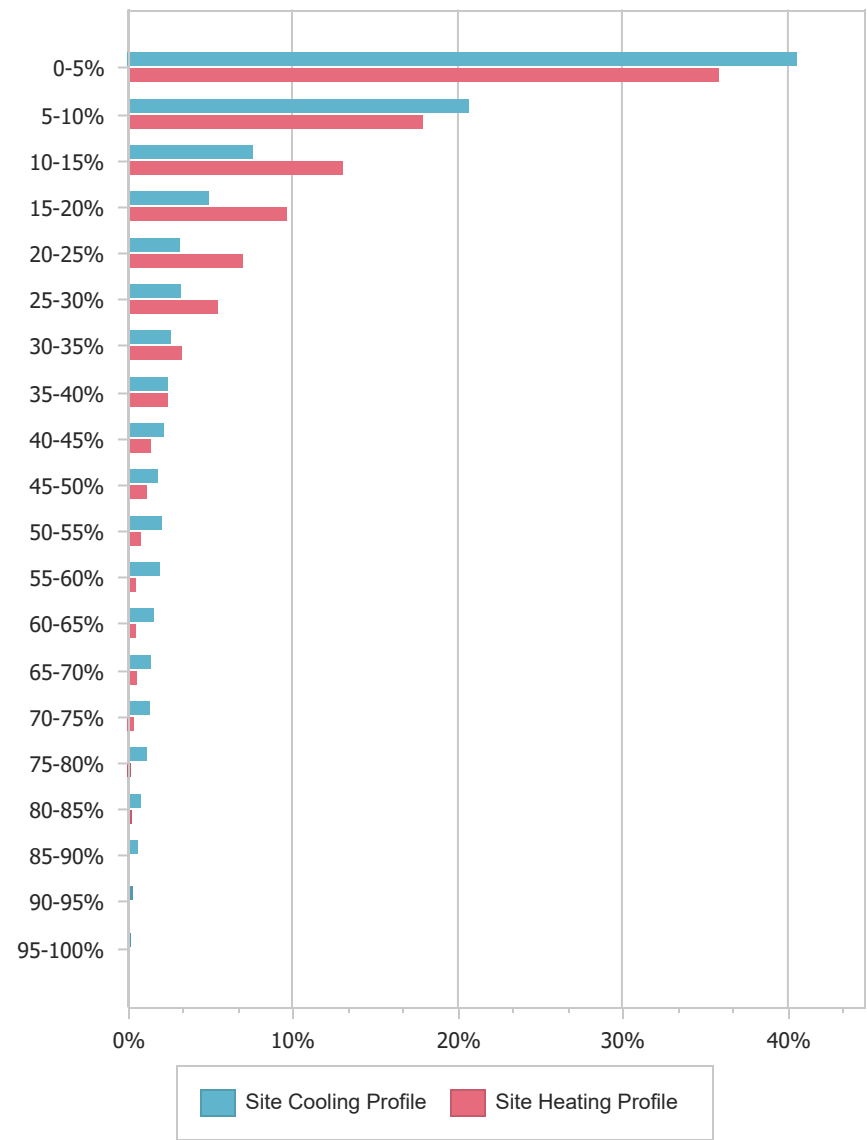


	Cooling			Heating		
% Load	Cutoff (tons)	% Hours	Hours	Cutoff (MBtuh)	% Hours	Hours
0-5	1.1	40.61%	3,485	9	35.86%	1,764
5-10	2.2	20.66%	1,773	17.9	17.89%	880
10-15	3.3	7.57%	650	26.9	13.01%	640
15-20	4.4	4.91%	421	35.9	9.62%	473
20-25	5.5	3.11%	267	44.8	6.95%	342
25-30	6.6	3.2%	275	53.8	5.45%	268
30-35	7.7	2.56%	220	62.8	3.25%	160
35-40	8.8	2.41%	207	71.7	2.42%	119
40-45	10	2.16%	185	80.7	1.36%	67
45-50	11.1	1.79%	154	89.7	1.1%	54
50-55	12.2	2.06%	177	98.6	0.73%	36
55-60	13.3	1.89%	162	107.6	0.47%	23
60-65	14.4	1.57%	135	116.5	0.45%	22
65-70	15.5	1.34%	115	125.5	0.51%	25
70-75	16.6	1.31%	112	134.5	0.37%	18
75-80	17.7	1.1%	94	143.4	0.18%	9
80-85	18.8	0.73%	63	152.4	0.2%	10
85-90	19.9	0.59%	51	161.4	0.08%	4
90-95	21	0.24%	21	170.3	0.08%	4
95-100	22.1	0.17%	15	179.3	0.02%	1

Cooling hours off: 178 (2%) Heating hours off: 3,841 (44%)

Setpoint Not Met Summary

Total Setpoint Not Met Summary

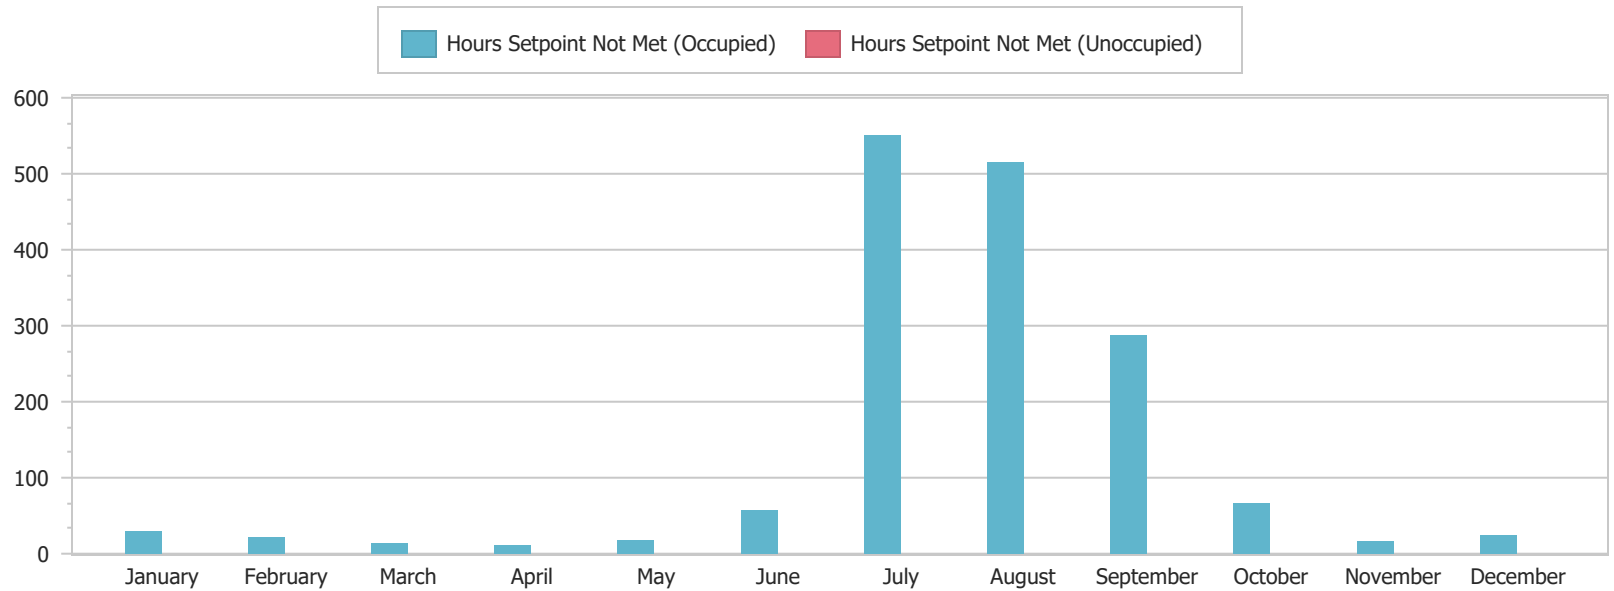

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp · (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp · (°F)
Single Zone CV																										
Zone Group 00																										
Kitchen	59.6	29	0	22	0	14	0	11	0	18	0	38	0	57	0	62	0	44	0	22	0	16	0	24	0	83.8
Total (Non-coincident)		29	0	22	0	14	0	11	0	18	0	38	0	57	0	62	0	44	0	22	0	16	0	24	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-1	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
ACT-Noisy-2	71.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max	
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)	
ACT-Noisy-3	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9	
ACT-Quiet-1	74.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4	
ACT-Quiet-2	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.1	
ACT-Quiet-3	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6	
Admin	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0	
Attrium	73.6	0	0	0	0	0	0	0	0	0	0	0	0	43	0	22	0	44	0	9	0	0	0	0	0	0	76.7
Chart/Hotel	74.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.6	
Comfort/Consult	71.9	0	0	0	0	0	0	0	0	0	0	8	0	84	0	75	0	37	0	8	0	0	0	0	0	0	76.9
Corridor-N	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4	
Corridor-S	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0	
Corridor-W	72.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0	
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0	
Exam/Storage	73.3	0	0	0	0	0	0	0	0	0	0	8	0	71	0	72	0	37	0	13	0	0	0	0	0	0	76.7
Group	68.9	0	0	0	0	0	0	0	0	0	0	0	0	36	0	36	0	4	0	0	0	0	0	0	0	0	79.4
Hospitality	69.3	0	0	0	0	0	0	0	0	0	0	0	0	73	0	62	0	37	0	0	0	0	0	0	0	0	80.0
Intake-HR-A	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0	
Intake-HR-B	73.2	0	0	0	0	0	0	0	0	0	0	3	0	75	0	70	0	43	0	13	0	0	0	0	0	0	76.6
Lounge	71.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0	
Multipurpose/Dining	68.5	0	0	0	0	0	0	0	0	0	0	0	0	52	0	51	0	12	0	0	0	0	0	0	0	0	79.8
RB-N-Corner	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.2	
RB-N-East	72.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0	
RB-N-West	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3	
RB-S-Corner-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7	
RB-S-Corner-S	73.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7	
RB-S-East	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.5	

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 19

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
RB-S-West	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
RB-W-North	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
RB-W-South	74.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.9
Servery	69.5	0	0	0	0	0	0	0	0	0	0	0	0	59	0	65	0	29	0	1	0	0	0	0	0	79.5
SHWR-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	74.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	74.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	71.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	19	0	493	0	453	0	243	0	44	0	0	0	0	0	
Unconditioned spaces																										
Room 00-80	50.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	49.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-01	71.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.7
Room 01-03	71.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-04	71.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-06	69.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-08	62.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	85.5
Room 01-10	69.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-12	63.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.7
Trash	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Cooling Setpoint Not Met Summary

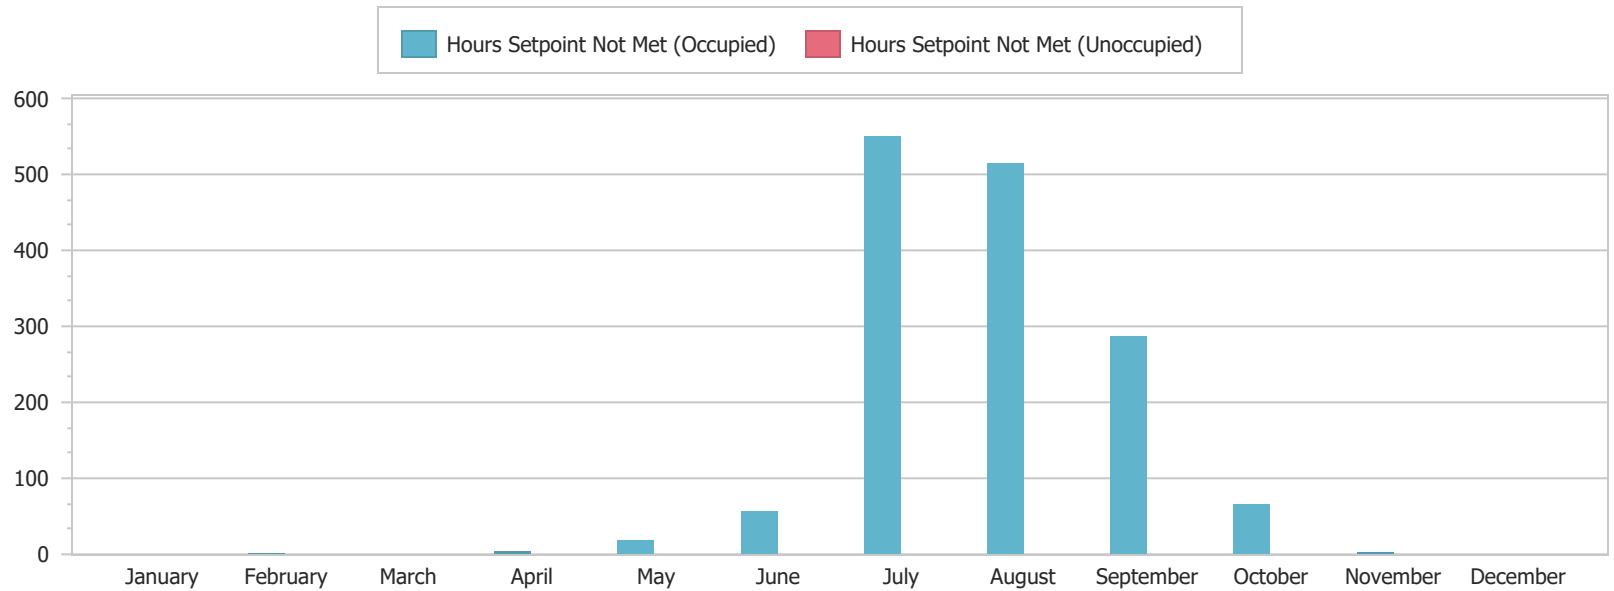

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Single Zone CV																										
Zone Group 00																										
Kitchen	59.6	1	0	2	0	1	0	4	0	18	0	38	0	57	0	62	0	44	0	22	0	3	0	0	0	83.8
Total (Non-coincident)		1	0	2	0	1	0	4	0	18	0	38	0	57	0	62	0	44	0	22	0	3	0	0	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-1	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
ACT-Noisy-2	71.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
ACT-Noisy-3	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 19

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Quiet-1	74.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
ACT-Quiet-2	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.1
ACT-Quiet-3	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Admin	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Attrium	73.6	0	0	0	0	0	0	0	0	0	0	0	0	43	0	22	0	44	0	9	0	0	0	0	0	76.7
Chart/Hotel	74.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.6
Comfort/Consult	71.9	0	0	0	0	0	0	0	0	0	0	8	0	84	0	75	0	37	0	8	0	0	0	0	0	76.9
Corridor-N	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Corridor-S	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Corridor-W	72.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	73.3	0	0	0	0	0	0	0	0	0	0	8	0	71	0	72	0	37	0	13	0	0	0	0	0	76.7
Group	68.9	0	0	0	0	0	0	0	0	0	0	0	0	36	0	36	0	4	0	0	0	0	0	0	0	79.4
Hospitality	69.3	0	0	0	0	0	0	0	0	0	0	0	0	73	0	62	0	37	0	0	0	0	0	0	0	80.0
Intake-HR-A	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	73.2	0	0	0	0	0	0	0	0	0	0	3	0	75	0	70	0	43	0	13	0	0	0	0	0	76.6
Lounge	71.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Multipurpose/Dining	68.5	0	0	0	0	0	0	0	0	0	0	0	0	52	0	51	0	12	0	0	0	0	0	0	0	79.8
RB-N-Corner	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.2
RB-N-East	72.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
RB-N-West	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
RB-S-Corner-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7
RB-S-Corner-S	73.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7
RB-S-East	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.5
RB-S-West	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 19

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
RB-W-North	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
RB-W-South	74.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.9
Servery	69.5	0	0	0	0	0	0	0	0	0	0	0	0	59	0	65	0	29	0	1	0	0	0	0	0	79.5
SHWR-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	74.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	74.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	71.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	19	0	493	0	453	0	243	0	44	0	0	0	0	0	
Unconditioned spaces																										
Room 00-80	50.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	49.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-01	71.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.7
Room 01-03	71.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-04	71.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-06	69.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-08	62.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	85.5
Room 01-10	69.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-12	63.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.7
Trash	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Heating Setpoint Not Met Summary

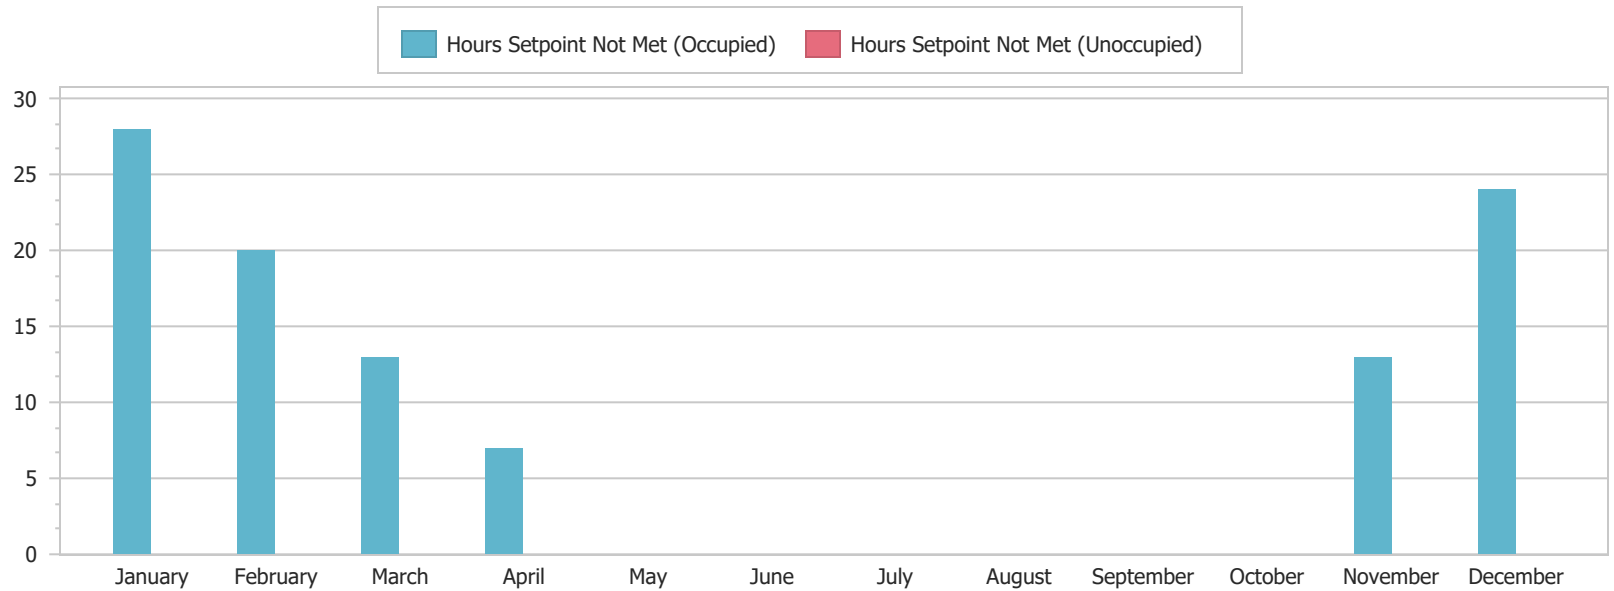

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Single Zone CV																										
Zone Group 00																										
Kitchen	59.6	28	0	20	0	13	0	7	0	0	0	0	0	0	0	0	0	0	0	0	0	13	0	24	0	83.8
Total (Non-coincident)		28	0	20	0	13	0	7	0	0	0	0	0	0	0	0	0	0	0	0	0	13	0	24	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-1	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
ACT-Noisy-2	71.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
ACT-Noisy-3	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 19

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Quiet-1	74.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
ACT-Quiet-2	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.1
ACT-Quiet-3	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Admin	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Attrium	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.7
Chart/Hotel	74.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.6
Comfort/Consult	71.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.9
Corridor-N	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Corridor-S	72.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Corridor-W	72.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	73.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.7
Group	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
Hospitality	69.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Intake-HR-A	72.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	73.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
Lounge	71.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Multipurpose/Dining	68.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-N-Corner	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.2
RB-N-East	72.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
RB-N-West	73.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
RB-S-Corner-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7
RB-S-Corner-S	73.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.7
RB-S-East	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.5
RB-S-West	74.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM


214

Page 8 of 19

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
RB-W-North	72.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
RB-W-South	74.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.9
Servery	69.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
SHWR-N	73.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	74.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	74.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	71.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Unconditioned spaces																										
Room 00-80	50.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	49.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	70.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-01	71.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.7
Room 01-03	71.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-04	71.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-06	69.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.1
Room 01-08	62.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	85.5
Room 01-10	69.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
Room 01-12	63.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.7
Trash	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Setpoint Not Met Summary

Total Setpoint Not Met Summary

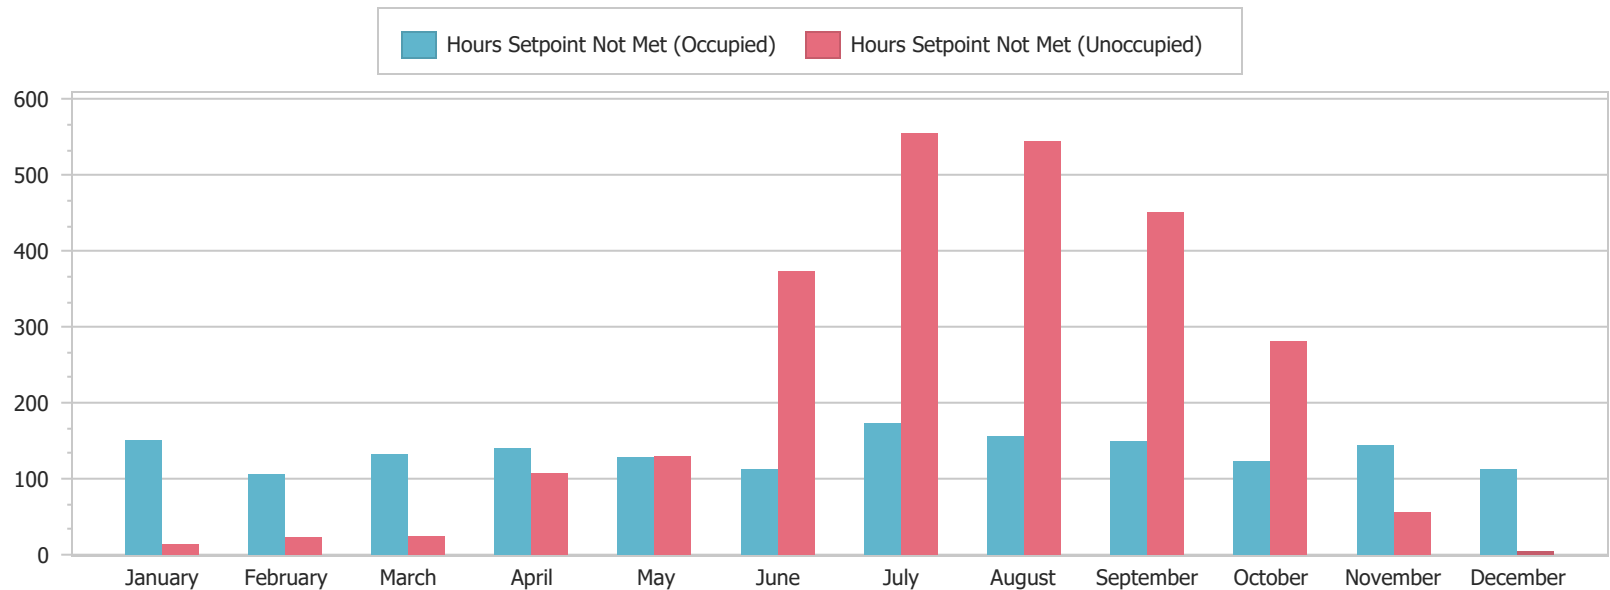

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp · (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp · (°F)
System 10 - 2010/2013																										
Zone Group 00																										
Fire Room	64.4	0	11	0	20	0	25	0	106	0	116	0	337	0	524	0	520	0	428	0	259	0	52	0	4	90.8
Total (Non-coincident)		0	11	0	20	0	25	0	106	0	116	0	337	0	524	0	520	0	428	0	259	0	52	0	4	
System 2 - 2007/2010/2013																										
Zone Group 00																										
Attrium	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Corridor-N	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
Corridor-S	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
Corridor-W	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
RB-N-Corner	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-N-East	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-N-West	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	79.4
RB-S-Corner-N	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-S-Corner-S	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-S-East	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-S-West	68.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
RB-W-North	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-W-South	67.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
SHWR-N	70.0	0	0	0	0	0	0	0	0	0	0	0	0	16	0	10	0	12	0	0	0	0	0	0	0	77.5
SHWR-S	70.0	0	0	0	0	0	0	0	0	0	0	0	0	14	0	9	0	9	0	0	0	0	0	0	0	77.5
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	9	0	8	0	2	0	0	0	0	0	0	0	76.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	39	0	27	0	23	1	0	0	0	0	0	0	
System 4 - 2007/2010/2013																										
Zone Group 00																										
ACT-Noisy-1	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
ACT-Noisy-2	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Noisy-3	66.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0
ACT-Quiet-1	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.5
ACT-Quiet-2	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Quiet-3	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
Admin	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Chart/Hotel	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
Comfort/Consult	70.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	71.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Exam/Storage	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	66.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Hospitality	66.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
Intake-HR-A	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Lounge	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Multipurpose/Dining	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Servery	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
Support	66.3	0	3	0	3	0	0	0	2	0	14	0	37	0	32	0	25	0	23	0	22	0	4	0	1	83.0
Utility	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	3	0	3	0	0	0	2	0	14	0	37	0	32	0	25	0	23	0	22	0	4	0	1	
System 4 - 2007/2010/2013_Copy																										
Zone Group 00																										
Kitchen	70.4	151	0	106	0	132	0	141	0	128	0	113	0	135	0	129	0	127	0	123	0	145	0	113	0	84.4
Total (Non-coincident)		151	0	106	0	132	0	141	0	128	0	113	0	135	0	129	0	127	0	123	0	145	0	113	0	
Unconditioned spaces																										
Room 00-80	45.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	99.5
Room 00-81	44.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	98.0
Room 01-00	62.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-01	63.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-03	63.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Room 01-04	63.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.6
Room 01-06	61.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 12 of 19

Unconditioned spaces																										
Room 01-08	57.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-10	61.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-12	58.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.7
Trash	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Cooling Setpoint Not Met Summary

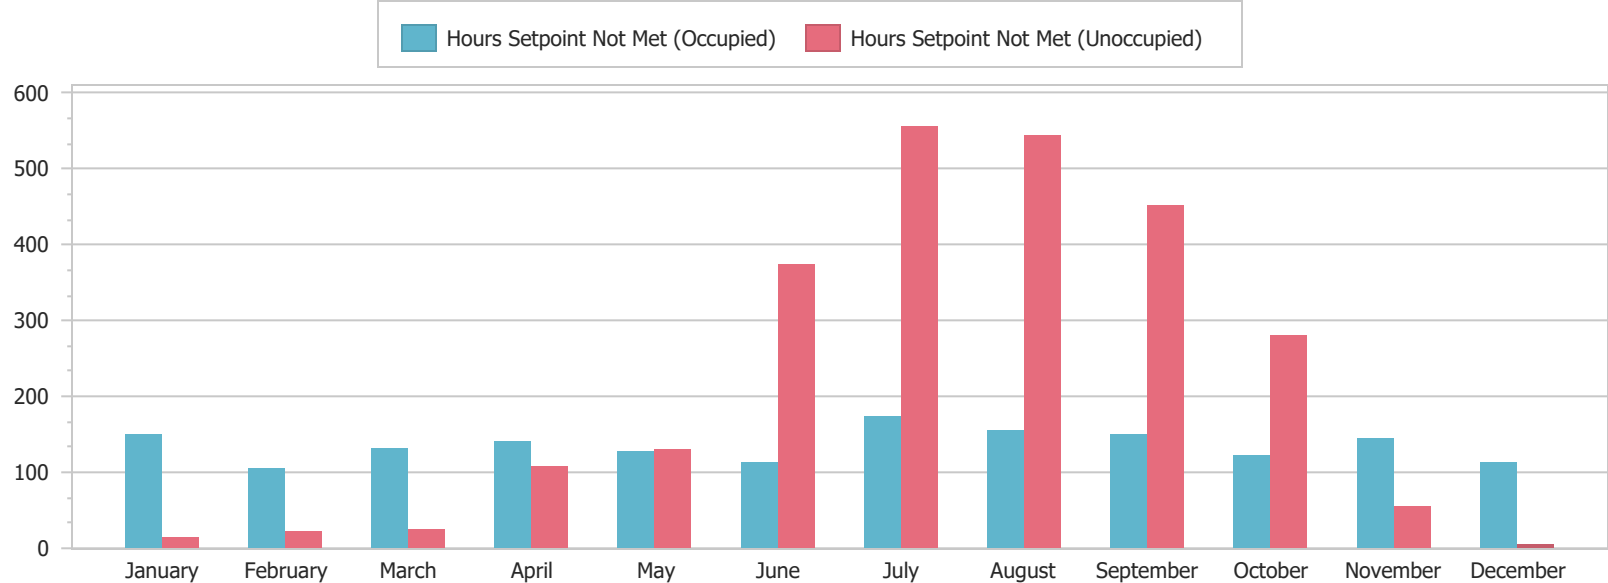


Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
System 10 - 2010/2013																										
Zone Group 00																										
Fire Room	64.4	0	11	0	20	0	25	0	106	0	116	0	337	0	524	0	520	0	428	0	259	0	52	0	4	90.8

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Total (Non-coincident)		0	11	0	20	0	25	0	106	0	116	0	337	0	524	0	520	0	428	0	259	0	52	0	4	
System 2 - 2007/2010/2013																										
Zone Group 00																										
Attrium	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Corridor-N	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7
Corridor-S	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
Corridor-W	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
RB-N-Corner	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-N-East	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-N-West	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	79.4
RB-S-Corner-N	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-S-Corner-S	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-S-East	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-S-West	68.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
RB-W-North	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-W-South	67.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
SHWR-N	70.0	0	0	0	0	0	0	0	0	0	0	0	0	16	0	10	0	12	0	0	0	0	0	0	0	77.5
SHWR-S	70.0	0	0	0	0	0	0	0	0	0	0	0	0	14	0	9	0	9	0	0	0	0	0	0	0	77.5
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	9	0	8	0	2	0	0	0	0	0	0	0	76.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	39	0	27	0	23	1	0	0	0	0	0	0	
System 4 - 2007/2010/2013																										
Zone Group 00																										
ACT-Noisy-1	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
ACT-Noisy-2	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Noisy-3	66.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Quiet-1	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.5
ACT-Quiet-2	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Quiet-3	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
Admin	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Chart/Hotel	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Comfort/Consult	70.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	71.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Exam/Storage	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	66.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Hospitality	66.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
Intake-HR-A	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Lounge	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Multipurpose/Dining	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Servery	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
Support	66.3	0	3	0	3	0	0	0	2	0	14	0	37	0	32	0	25	0	23	0	22	0	4	0	1	83.0
Utility	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	3	0	3	0	0	0	2	0	14	0	37	0	32	0	25	0	23	0	22	0	4	0	1	
System 4 - 2007/2010/2013_Copy																										
Zone Group 00																										
Kitchen	70.4	151	0	106	0	132	0	141	0	128	0	113	0	135	0	129	0	127	0	123	0	145	0	113	0	84.4
Total (Non-coincident)		151	0	106	0	132	0	141	0	128	0	113	0	135	0	129	0	127	0	123	0	145	0	113	0	
Unconditioned spaces																										
Room 00-80	45.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	99.5
Room 00-81	44.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	98.0

Unconditioned spaces																										
Room 01-00	62.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-01	63.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-03	63.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Room 01-04	63.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.6
Room 01-06	61.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-08	57.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-10	61.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-12	58.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.7
Trash	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Heating Setpoint Not Met Summary

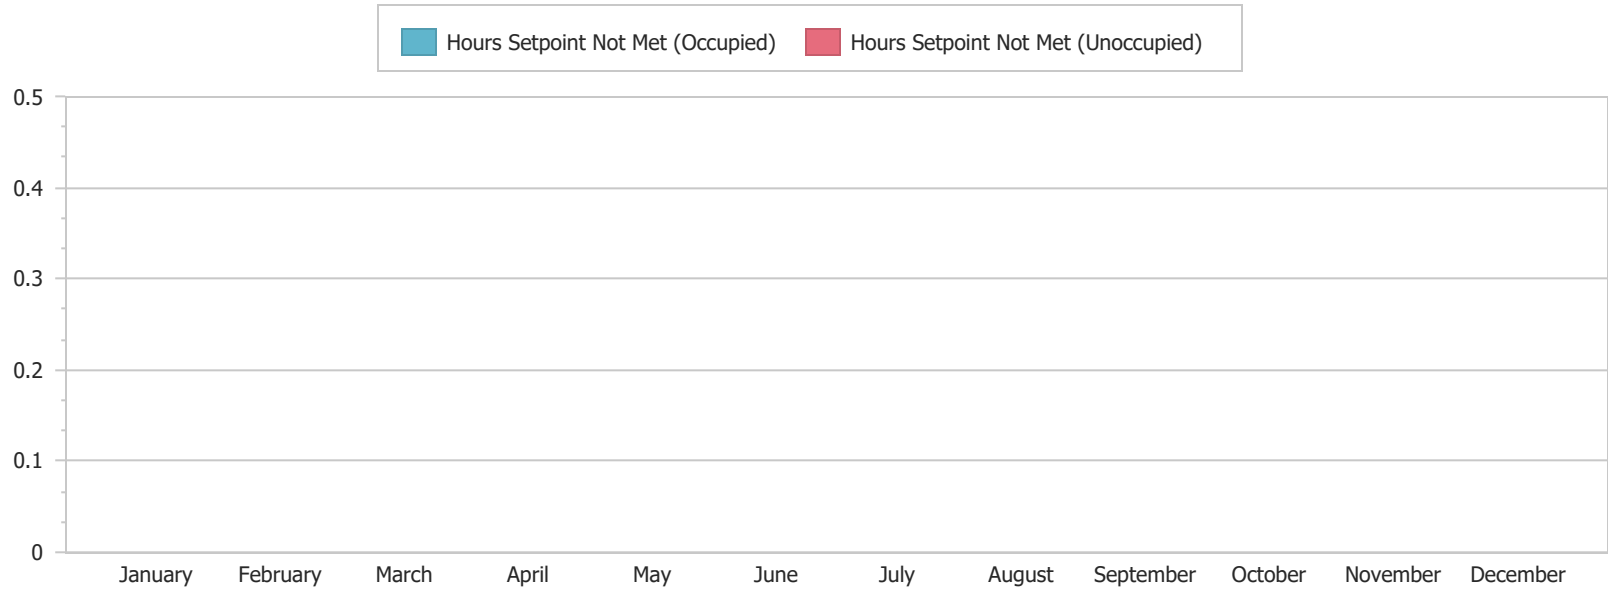

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
System 10 - 2010/2013																										
Zone Group 00																										
Fire Room	64.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	90.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
System 2 - 2007/2010/2013																										
Zone Group 00																										
Attrium	72.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Corridor-N	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7
Corridor-S	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
Corridor-W	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.0
RB-N-Corner	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-N-East	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-N-West	67.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
RB-S-Corner-N	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
RB-S-Corner-S	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-S-East	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.3
RB-S-West	68.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
RB-W-North	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-W-South	67.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
SHWR-N	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	77.5
SHWR-S	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	77.5
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.9
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
System 4 - 2007/2010/2013																										
Zone Group 00																										

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Noisy-1	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
ACT-Noisy-2	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Noisy-3	66.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0
ACT-Quiet-1	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.5
ACT-Quiet-2	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
ACT-Quiet-3	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.8
Admin	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Chart/Hotel	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Comfort/Consult	70.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	71.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Exam/Storage	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	66.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Hospitality	66.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.3
Intake-HR-A	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Lounge	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Multipurpose/Dining	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Servery	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
Support	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	83.0
Utility	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
System 4 - 2007/2010/2013_Copy																										
Zone Group 00																										
Kitchen	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.4
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Unconditioned spaces																											
Room 00-80	45.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	99.5
Room 00-81	44.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	98.0
Room 01-00	62.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-01	63.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-03	63.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Room 01-04	63.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.6
Room 01-06	61.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-08	57.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.9
Room 01-10	61.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	88.4
Room 01-12	58.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.7
Trash	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	91.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Site Temperature Profile

Zone Name	Time spent in each temperature range (°F)													Unmet Cooling Hours	Maximum Temperature (°F)	Mean Temperature (°F)
	Unmet Heating Hours	Minimum Temperature (°F)	< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	> 95°F			
				≤	≤	≤	≤	≤	≤	≤	≤					
				55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F				
Single Zone CV																
Zone Group 00																
Kitchen	105	59.6	0	0	1	16	627	6,538	1,500	78	0	0	0	252	83.8	72.9
Variable Refrigerant Flow																
Zone Group 00																
ACT-Noisy-1	0	72.1	0	0	0	0	0	1,157	7,595	8	0	0	0	0	80.3	75.6
ACT-Noisy-2	0	71.9	0	0	0	0	0	1,506	7,254	0	0	0	0	0	79.8	75.5
ACT-Noisy-3	0	70.2	0	0	0	0	0	2,922	5,838	0	0	0	0	0	79.9	75.0
ACT-Quiet-1	0	74.2	0	0	0	0	0	85	8,675	0	0	0	0	0	79.4	75.8
ACT-Quiet-2	0	73.5	0	0	0	0	0	291	8,468	1	0	0	0	0	80.1	75.8
ACT-Quiet-3	0	72.2	0	0	0	0	0	1,269	7,491	0	0	0	0	0	79.6	75.5
Admin	0	72.9	0	0	0	0	0	703	8,057	0	0	0	0	0	75	75.0
Attrium	0	73.6	0	0	0	0	0	191	8,569	0	0	0	0	118	76.7	75.1
Chart/Hotel	0	74.8	0	0	0	0	0	63	8,697	0	0	0	0	0	75.6	75.0
Comfort/Consult	0	71.9	0	0	0	0	0	1,873	6,887	0	0	0	0	212	76.9	74.9
Corridor-N	0	70.6	0	0	0	0	0	3,365	5,343	52	0	0	0	0	80.4	75.9
Corridor-S	0	72.9	0	0	0	0	0	364	7,109	1,287	0	0	0	0	81	78.0
Corridor-W	0	72.5	0	0	0	0	0	980	5,904	1,876	0	0	0	0	81	77.8
Entry/Waiting	0	70	0	0	0	0	42	2,411	6,307	0	0	0	0	0	75	74.6
Exam/Storage	0	73.3	0	0	0	0	0	832	7,928	0	0	0	0	201	76.7	75.0
Group	0	68.9	0	0	0	0	39	4,070	4,651	0	0	0	0	76	79.4	74.5
Hospitality	0	69.3	0	0	0	0	20	3,609	5,131	0	0	0	0	172	80	74.8
Intake-HR-A	0	72.2	0	0	0	0	0	1,679	7,081	0	0	0	0	0	75	74.9
Intake-HR-B	0	73.2	0	0	0	0	0	948	7,812	0	0	0	0	204	76.6	75.0
Lounge	0	71.5	0	0	0	0	0	2,209	6,551	0	0	0	0	0	75	74.8

			Time spent in each temperature range (°F)														
Zone Name	Unmet	Minimum													Unmet	Maximum	Mean
	Heating	Temperature	< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F		Cooling	Temperature	Temperature	
	Hours	(°F)		≤	≤	≤	≤	≤	≤	≤	≤	≤	>	Hours	(°F)	(°F)	
Multipurpose/Dining	0	68.5	0	0	0	0	57	4,052	4,651	0	0	0	0	115	79.8	74.5	
RB-N-Corner	0	72.4	0	0	0	0	0	626	8,123	11	0	0	0	0	80.2	75.6	
RB-N-East	0	72.7	0	0	0	0	0	530	8,230	0	0	0	0	0	80	75.6	
RB-N-West	0	73.5	0	0	0	0	0	207	8,545	8	0	0	0	0	80.3	75.8	
RB-S-Corner-N	0	73.6	0	0	0	0	0	173	8,574	13	0	0	0	0	80.7	75.7	
RB-S-Corner-S	0	73.7	0	0	0	0	0	155	8,581	24	0	0	0	0	80.7	75.8	
RB-S-East	0	74.7	0	0	0	0	0	19	8,733	8	0	0	0	0	80.5	75.8	
RB-S-West	0	74.7	0	0	0	0	0	23	8,731	6	0	0	0	0	80.4	75.9	
RB-W-North	0	72.1	0	0	0	0	0	781	7,979	0	0	0	0	0	80	75.5	
RB-W-South	0	74	0	0	0	0	0	81	8,636	43	0	0	0	0	80.9	75.8	
Servery	0	69.5	0	0	0	0	8	3,792	4,960	0	0	0	0	154	79.5	74.8	
SHWR-N	0	73.6	0	0	0	0	0	398	8,362	0	0	0	0	0	75	75.0	
SHWR-S	0	74.9	0	0	0	0	0	23	8,737	0	0	0	0	0	75	75.0	
SHWR-W	0	74.3	0	0	0	0	0	188	8,572	0	0	0	0	0	75	75.0	
Support	0	70.4	0	0	0	0	0	815	5,133	2,812	0	0	0	0	81	78.4	
Utility	0	71.8	0	0	0	0	0	2,799	5,961	0	0	0	0	0	75.2	74.8	
Unconditioned spaces																	
Room 00-80	0	50.1	0	117	633	1,421	1,983	1,732	1,305	1,054	468	47	0	0	92.4	71.3	
Room 00-81	0	49	11	301	1,016	1,642	1,687	1,366	1,070	1,072	527	68	0	0	93	70.1	
Room 01-00	0	70.2	0	0	0	0	0	3,418	4,752	590	0	0	0	0	82.1	76.0	
Room 01-01	0	71	0	0	0	0	0	2,115	5,545	1,100	0	0	0	0	82.7	76.9	
Room 01-03	0	71.1	0	0	0	0	0	2,352	5,719	689	0	0	0	0	82	76.6	
Room 01-04	0	71.4	0	0	0	0	0	2,100	5,873	787	0	0	0	0	82.1	76.7	
Room 01-06	0	69.5	0	0	0	0	31	3,707	4,446	576	0	0	0	0	82.1	75.8	
Room 01-08	0	62.4	0	0	0	339	2,298	2,615	2,076	1,416	16	0	0	0	85.5	73.6	
Room 01-10	0	69.4	0	0	0	0	47	3,821	4,377	515	0	0	0	0	82	75.6	

Unconditioned spaces

Room 01-12	0	63.7	0	0	0	43	1,593	2,702	2,403	1,865	154	0	0	0	87.7	75.3
Trash	0	68.2	0	0	0	0	70	2,370	4,349	1,932	39	0	0	0	86.9	77.2



Site Temperature Profile

Zone Name	Unmet Heating Hours	Minimum Temperature (°F)	Time spent in each temperature range (°F)												Unmet Cooling Hours	Maximum Temperature (°F)	Mean Temperature (°F)
			< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	> 95°F				
				≤	≤	≤	≤	≤	≤	≤	≤	≤					
				55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F					
System 10 - 2010/2013																	
Zone Group 00																	
Fire Room	0	64.4	0	0	0	6	495	1,737	2,997	2,267	1,242	16	0	2402	90.8	78.6	
System 2 - 2007/2010/2013																	
Zone Group 00																	
Attrium	0	72.4	0	0	0	0	0	600	8,160	0	0	0	0	0	75	74.9	
Corridor-N	0	66.3	0	0	0	0	1,014	3,303	3,931	512	0	0	0	0	81.7	74.9	
Corridor-S	0	68.4	0	0	0	0	62	2,322	5,267	1,109	0	0	0	0	81.8	76.7	
Corridor-W	0	67.6	0	0	0	0	293	2,987	4,098	1,382	0	0	0	0	82	76.2	
RB-N-Corner	0	66.3	0	0	0	0	906	3,073	4,781	0	0	0	0	0	79.6	73.8	
RB-N-East	0	66.7	0	0	0	0	800	3,248	4,712	0	0	0	0	0	79.3	73.9	
RB-N-West	0	67.6	0	0	0	0	467	3,006	5,287	0	0	0	0	1	79.4	74.3	
RB-S-Corner-N	0	67.4	0	0	0	0	224	2,921	5,615	0	0	0	0	0	79.6	74.5	
RB-S-Corner-S	0	67.4	0	0	0	0	257	2,920	5,583	0	0	0	0	0	79.7	74.5	
RB-S-East	0	68.9	0	0	0	0	45	2,682	6,033	0	0	0	0	0	79.3	74.8	
RB-S-West	0	68.7	0	0	0	0	98	3,093	5,569	0	0	0	0	0	79.4	74.6	
RB-W-North	0	66.3	0	0	0	0	1,025	3,281	4,454	0	0	0	0	0	79.5	73.6	
RB-W-South	0	67.8	0	0	0	0	138	2,685	5,937	0	0	0	0	0	79.7	74.7	
SHWR-N	0	70	0	0	0	0	3,431	3,063	2,266	0	0	0	0	38	77.5	72.2	
SHWR-S	0	70	0	0	0	0	3,311	3,168	2,281	0	0	0	0	32	77.5	72.2	
SHWR-W	0	70	0	0	0	0	3,293	3,133	2,334	0	0	0	0	19	76.9	72.2	
System 4 - 2007/2010/2013																	
Zone Group 00																	
ACT-Noisy-1	0	66.7	0	0	0	0	438	3,638	4,684	0	0	0	0	0	79.8	74.1	
ACT-Noisy-2	0	67.4	0	0	0	0	427	4,013	4,320	0	0	0	0	0	78.8	73.8	

			Time spent in each temperature range (°F)													
Zone Name	Unmet Heating	Minimum Temperature	< 50°F	50°F ≤ 55°F	55°F ≤ 60°F	60°F ≤ 65°F	65°F ≤ 70°F	70°F ≤ 75°F	75°F ≤ 80°F	80°F ≤ 85°F	85°F ≤ 90°F	90°F ≤ 95°F	> 95°F	Unmet Cooling	Maximum Temperature	Mean Temperature
	Hours	(°F)		55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F	95°F	Hours	(°F)	(°F)
ACT-Noisy-3	0	66	0	0	0	0	845	4,117	3,798	0	0	0	0	0	79	73.3
ACT-Quiet-1	0	70.3	0	0	0	0	0	3,104	5,656	0	0	0	0	0	78.5	74.8
ACT-Quiet-2	0	68.9	0	0	0	0	50	3,377	5,333	0	0	0	0	0	78.8	74.6
ACT-Quiet-3	0	67.4	0	0	0	0	409	3,738	4,613	0	0	0	0	0	78.8	74.0
Admin	0	70.8	0	0	0	0	0	2,796	5,964	0	0	0	0	0	75.1	74.4
Chart/Hotel	0	70.4	0	0	0	0	0	2,528	6,232	0	0	0	0	0	75	74.6
Comfort/Consult	0	70.5	0	0	0	0	0	5,107	3,653	0	0	0	0	0	75	73.4
Entry/Waiting	0	71.3	0	0	0	0	0	2,707	6,053	0	0	0	0	0	75.1	74.4
Exam/Storage	0	70.4	0	0	0	0	0	4,726	4,034	0	0	0	0	0	75	73.7
Group	0	66.4	0	0	0	0	554	4,638	3,568	0	0	0	0	0	80	73.4
Hospitality	0	66.8	0	0	0	0	395	4,515	3,837	13	0	0	0	0	80.3	73.6
Intake-HR-A	0	70.6	0	0	0	0	0	5,565	3,195	0	0	0	0	0	75	73.1
Intake-HR-B	0	70.4	0	0	0	0	0	4,421	4,339	0	0	0	0	0	75	73.8
Lounge	0	70.8	0	0	0	0	0	6,274	2,486	0	0	0	0	0	75.2	72.9
Multipurpose/Dining	0	66.3	0	0	0	0	558	4,569	3,619	14	0	0	0	0	80.4	73.4
Servery	0	67.2	0	0	0	0	336	4,639	3,785	0	0	0	0	0	79.8	73.6
Support	0	66.3	0	0	0	0	185	1,461	3,499	3,615	0	0	0	166	83	78.2
Utility	0	70.3	0	0	0	0	0	5,440	3,320	0	0	0	0	0	75	73.3
System 4 - 2007/2010/2013_Copy																
Zone Group 00																
Kitchen	0	70.4	0	0	0	0	0	2,675	5,927	158	0	0	0	1543	84.4	75.3
Unconditioned spaces																
Room 00-80	0	45.1	150	400	891	1,286	1,450	1,527	1,255	872	573	297	59	0	99.5	70.8
Room 00-81	0	44	242	488	1,119	1,399	1,437	1,356	1,075	771	585	257	31	0	98	69.5
Room 01-00	0	62	0	0	0	338	1,931	2,802	2,270	1,126	293	0	0	0	88.4	74.1
Room 01-01	0	63	0	0	0	127	1,357	2,797	2,639	1,354	486	0	0	0	88.9	75.4

Unconditioned spaces

Room 01-03	0	63.1	0	0	0	136	1,473	2,961	2,502	1,248	440	0	0	0	89	75.1
Room 01-04	0	63.5	0	0	0	67	1,228	3,027	2,707	1,330	401	0	0	0	88.6	75.5
Room 01-06	0	61	0	0	0	457	1,806	2,731	2,268	1,110	388	0	0	0	88.9	74.2
Room 01-08	0	57.9	0	0	173	1,344	1,984	1,820	1,759	1,246	434	0	0	0	88.9	72.7
Room 01-10	0	61.2	0	0	0	436	1,930	2,747	2,235	1,140	272	0	0	0	88.4	74.0
Room 01-12	0	58.9	0	0	43	892	1,907	2,021	1,899	1,252	705	41	0	0	91.7	74.1
Trash	0	67.2	0	0	0	0	266	2,346	3,270	2,184	685	9	0	0	91.1	77.9

0 Hours		100 - 4000 Hour	
1 - 100 Hours		4000+ Hours	

Site Humidity Profile

		Time spent in each humidity range														
Zone Name	Minimum %		30%	35%	40%	45%	50%	55%	60%	65%	70%	75%		Maximum %	Mean %	
	Relative	< 30%	≤	≤	≤	≤	≤	≤	≤	≤	≤	≤	> 80%	Relative	Relative	
	Humidity		35%	40%	45%	50%	55%	60%	65%	70%	75%	80%		Humidity	Humidity	
Single Zone CV																
Zone Group 00																
Kitchen	5.4	2,291	979	907	1,052	1,093	1,045	765	421	154	46	8	0	80.0	40	
Variable Refrigerant Flow																
Zone Group 00																
ACT-Noisy-1	12.1	1,884	1,095	1,152	1,268	1,516	1,180	576	70	17	3	0	0	74.3	39.7	
ACT-Noisy-2	10.8	1,932	1,063	1,147	1,328	1,623	1,213	415	36	3	0	0	0	67.4	39.2	
ACT-Noisy-3	11.2	1,808	1,026	1,133	1,297	1,596	1,315	523	59	3	0	0	0	68.9	40	
ACT-Quiet-1	10	2,107	1,017	1,153	1,402	1,489	1,103	460	26	3	0	0	0	66.1	38.6	
ACT-Quiet-2	10.6	2,040	1,056	1,163	1,329	1,522	1,123	478	45	3	0	0	0	68.0	38.9	
ACT-Quiet-3	10.9	1,948	1,064	1,153	1,337	1,596	1,159	462	39	3	0	0	0	67.6	39.2	
Admin	15.3	913	842	1,118	1,069	1,062	1,298	1,338	791	229	76	21	3	81.8	46.4	
Attrium	10.2	1,937	1,210	1,011	1,129	1,701	1,523	221	25	3	0	0	0	65.7	39.5	
Chart/Hotel	13.9	970	842	1,089	1,091	1,106	1,544	1,598	431	76	14	0	0	74.4	45.5	
Comfort/Consult	8.6	1,972	1,167	1,004	1,050	1,535	1,611	314	72	34	1	0	0	70.4	39.7	
Corridor-N	7.9	3,103	1,113	1,319	2,017	1,030	125	39	12	1	0	0	0	65.0	34	
Corridor-S	7.2	3,659	1,039	1,407	1,923	607	89	27	9	0	0	0	0	63.3	32.1	
Corridor-W	7.6	3,604	1,190	1,740	1,806	345	60	8	7	0	0	0	0	61.5	32	
Entry/Waiting	13	1,757	1,099	1,111	1,067	1,473	1,537	552	113	41	10	0	0	72.8	40.8	
Exam/Storage	9.1	1,862	1,167	999	1,049	1,407	1,772	395	80	29	0	0	0	69.3	40.2	
Group	8.6	2,441	1,050	1,036	1,388	1,735	875	181	40	14	0	0	0	69.6	37.2	
Hospitality	8.5	2,514	1,055	1,056	1,444	1,715	787	147	31	12	0	0	0	68.5	36.8	
Intake-HR-A	10.1	1,668	1,125	1,059	1,023	1,210	1,599	820	168	60	26	2	0	76.4	41.6	
Intake-HR-B	9.2	1,840	1,165	1,006	1,058	1,536	1,698	374	68	15	0	0	0	68.0	40.2	
Lounge	12	1,720	1,207	1,029	1,025	1,260	1,568	697	169	55	27	4	0	76.6	41	
Multipurpose/Dining	8.6	2,428	1,052	1,044	1,390	1,746	876	172	39	13	0	0	0	69.6	37.2	

[illegible]

Unconditioned spaces

Trash	42.4	0	0	0	17	133	354	528	701	814	1,049	1,266	3,899	100.0	78.1
-------	------	---	---	---	----	-----	-----	-----	-----	-----	-------	-------	-------	-------	------



Site Humidity Profile

		Time spent in each humidity range														
		Minimum %	30%	35%	40%	45%	50%	55%	60%	65%	70%	75%		Maximum %	Mean %	
		Relative	< 30%	≤	≤	≤	≤	≤	≤	≤	≤	≤	> 80%	Relative	Relative	
Zone Name		Humidity		35%	40%	45%	50%	55%	60%	65%	70%	75%	80%	Humidity	Humidity	
System 10 - 2010/2013																
Zone Group 00																
Fire Room		6.7	8,760	0	0	0	0	0	0	0	0	0	0	16.0	9.9	
System 2 - 2007/2010/2013																
Zone Group 00																
Atrium		43.2	0	0	0	8	166	725	1,493	2,082	2,215	1,773	286	11	83.2	63.8
Corridor-N		12.9	2,530	1,341	1,500	1,912	1,081	345	51	0	0	0	0	0	58.2	35.5
Corridor-S		10.9	3,083	1,355	1,381	1,737	877	301	26	0	0	0	0	0	58.0	33.7
Corridor-W		10.9	2,917	1,386	1,611	1,815	771	248	12	0	0	0	0	0	57.8	34
RB-N-Corner		12.2	1,317	1,030	1,050	1,130	1,352	1,430	876	378	166	27	6	0	76.6	43.1
RB-N-East		12.6	1,346	1,002	1,064	1,090	1,325	1,499	927	359	118	26	4	0	76.0	43
RB-N-West		11.8	1,422	1,045	1,105	1,122	1,377	1,281	845	366	171	22	4	0	76.2	42.6
RB-S-Corner-N		11.2	1,547	1,047	1,077	1,018	1,342	1,381	875	362	92	16	4	0	76.3	42.1
RB-S-Corner-S		11.5	1,555	1,035	1,083	1,033	1,351	1,321	847	368	140	22	6	0	76.8	42.2
RB-S-East		11.4	1,570	1,082	1,129	1,030	1,336	1,265	878	367	84	15	3	0	75.7	41.9
RB-S-West		11.3	1,529	1,051	1,125	1,042	1,361	1,271	836	378	141	21	4	0	76.2	42.2
RB-W-North		12.3	1,274	990	1,056	1,105	1,332	1,522	906	390	147	33	5	0	76.4	43.3
RB-W-South		11.4	1,592	1,036	1,127	1,000	1,349	1,287	837	375	133	20	5	0	76.3	42
SHWR-N		7.6	1,686	940	973	922	1,031	1,192	1,099	634	220	54	9	0	79.3	42.6
SHWR-S		7.3	1,762	980	941	944	1,045	1,173	1,030	612	209	57	7	1	80.2	42.1
SHWR-W		7.7	1,647	920	997	913	1,054	1,220	1,105	640	198	58	8	0	78.1	42.7
System 4 - 2007/2010/2013																
Zone Group 00																
ACT-Noisy-1		10.2	1,606	956	1,032	1,093	1,388	1,354	906	337	74	15	0	0	74.8	41.9
ACT-Noisy-2		10.9	1,536	921	996	1,111	1,414	1,413	981	324	53	13	0	0	74.6	42.2
ACT-Noisy-3		11	1,447	882	948	1,075	1,387	1,504	1,079	348	53	35	2	0	75.8	42.9

[illegible]


Unconditioned spaces

Room 01-04	7.1	8,760	0	0	0	0	0	0	0	0	0	0	0	16.6	11.1
Room 01-06	7.1	8,760	0	0	0	0	0	0	0	0	0	0	0	18.2	11.6
Room 01-08	7.1	8,760	0	0	0	0	0	0	0	0	0	0	0	20.3	12.4
Room 01-10	7.2	8,760	0	0	0	0	0	0	0	0	0	0	0	18.0	11.7
Room 01-12	6.5	8,760	0	0	0	0	0	0	0	0	0	0	0	19.6	11.7
Trash	36.5	0	0	29	155	305	527	615	695	868	996	999	3,571	100.0	73.8




Carbon Footprint and Renewable Energy Summary

Total Emissions

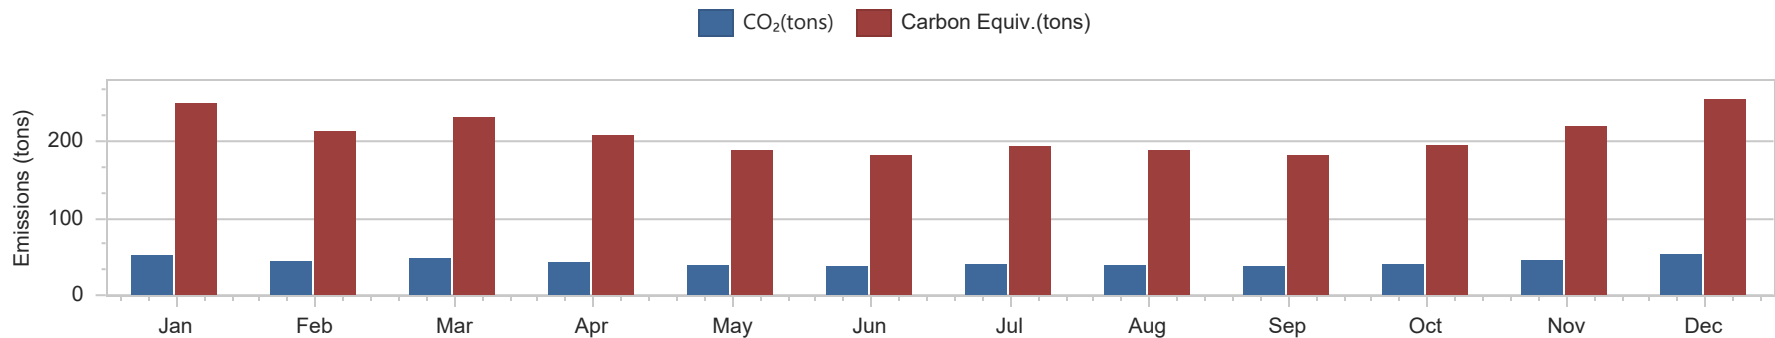


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	51.79	44.39	48.03	43.13	39.09	37.84	40.18	39.19	37.73	40.42	45.72	53.07	520.58
CH ₄	(tons CO ₂ e)	80.27	68.80	74.43	66.84	60.58	58.65	62.27	60.74	58.48	62.65	70.86	82.25	806.83
N ₂ O	(tons CO ₂ e)	117.14	100.40	108.62	97.53	88.40	85.58	90.87	88.63	85.33	91.42	103.41	120.02	1,177.36
Carbon	(tons CO ₂ e)	249.20	213.59	231.08	207.50	188.07	182.07	193.32	188.56	181.55	194.49	220.00	255.34	2,504.77
Equiv.														
NO _x	(lbs)	85.61	73.37	79.39	71.28	64.62	62.55	66.40	64.77	62.37	66.82	75.57	87.72	860.51
SO ₂	(lbs)	9.46	8.11	8.77	7.87	7.14	6.90	7.34	7.17	6.88	7.39	8.36	9.68	95.04
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Source Electricity Emissions

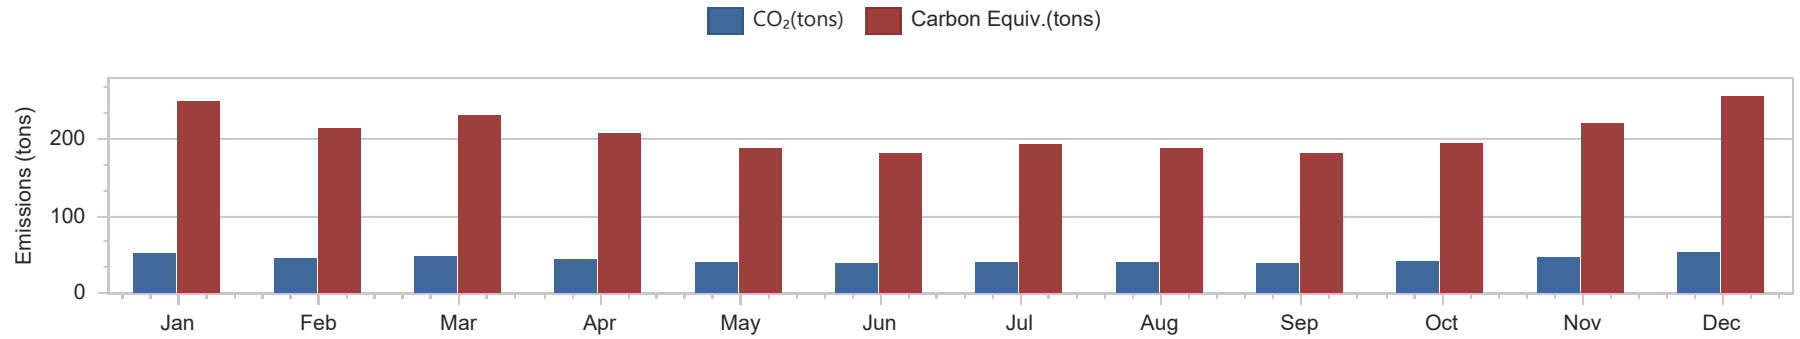

Emission Data for Source Electricity		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO2e)	51.79	44.39	48.03	43.13	39.09	37.84	40.18	39.19	37.73	40.42	45.72	53.07	520.58
CH ₄	(tons CO2e)	80.27	68.80	74.43	66.84	60.58	58.65	62.27	60.74	58.48	62.65	70.86	82.25	806.83
N ₂ O	(tons CO2e)	117.14	100.40	108.62	97.53	88.40	85.58	90.87	88.63	85.33	91.42	103.41	120.02	1,177.36
Carbon	(tons CO2e)	249.20	213.59	231.08	207.50	188.07	182.07	193.32	188.56	181.55	194.49	220.00	255.34	2,504.77
Equiv.														
NO _x	(lbs)	85.61	73.37	79.39	71.28	64.62	62.55	66.40	64.77	62.37	66.82	75.57	87.72	860.51
SO ₂	(lbs)	9.46	8.11	8.77	7.87	7.14	6.90	7.34	7.17	6.88	7.39	8.36	9.68	95.04
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Site Emissions

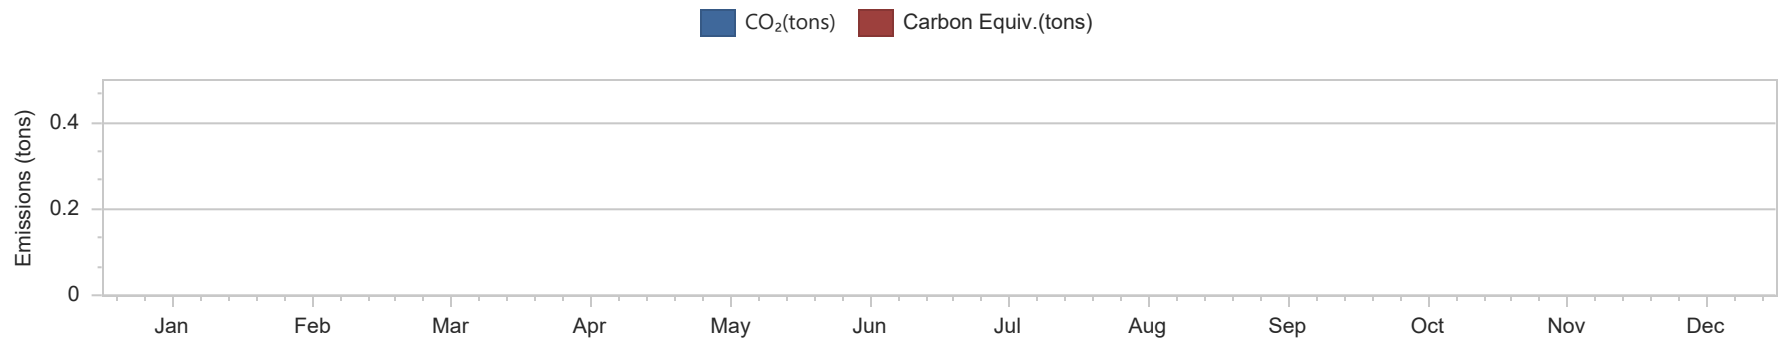


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO2e)	0	0	0	0	0	0	0	0	0	0	0	0	0
CH ₄	(tons CO2e)	0	0	0	0	0	0	0	0	0	0	0	0	0
N ₂ O	(tons CO2e)	0	0	0	0	0	0	0	0	0	0	0	0	0
Carbon Equiv.	(tons CO2e)	0	0	0	0	0	0	0	0	0	0	0	0	0
NO _x	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
SO ₂	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Greenhouse Gas Equivalence


Greenhouse Gas	Annual Total (kg)	Carbon Dioxide Equivalent (kg)	Percent of Total (%)
Carbon Dioxide (CO ₂)	472,266.91	472,266.91	0.07 %
Methane (CH ₄)	731,940.75	18,298,518.75	2.71 %
Nitrous Oxide (N ₂ O)	1,068,082.66	318,288,632.68	47.22 %

Total 337,059,418.34 * Conversion factors from US EPA

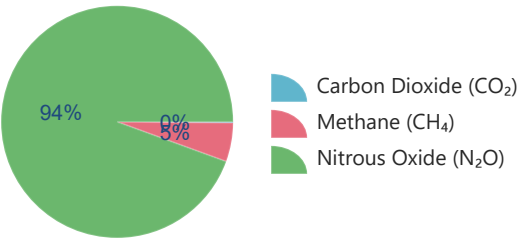

On-Site and Renewable Energy Contribution Summary


Electric Load Satisfied	Energy (kWh)	Percent Electricity (%)
Site Energy from Utility	217,778	100%
Site Power Generation	0	0%

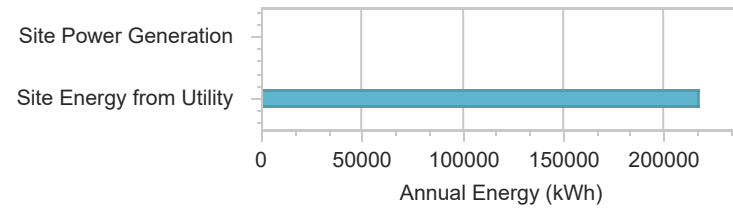

On-Site and Renewable Energy Systems

Electric Loads Satisfied	Electricity Used (kWh)	Percent Electricity (%)
Electricity Coming From Utility	217,778	100 %
Fuel-Fired Power Generation	0	0 %
Net Decrease in On-Site Storage	0	0 %
Net Electricity From Utility	217,778	100 %
Photovoltaic Power	0	0 %
Surplus Electricity Going To Utility	0	0 %
Total Electricity End Uses	217,778	100 %
Total On-Site and Utility Electric Sources	217,778	100 %
Total On-Site Electric Sources	0	0 %
Wind Power	0	0 %

Thermal Sources	Heat (Btu)	Percent Heat (%)
Air to Air Heat Recovery for Cooling	0	0 %
Air to Air Heat Recovery for Heating	0	0 %
Total Thermal Sources	28,442	100 %
Water-Side Heat Recovery	28,442	100 %

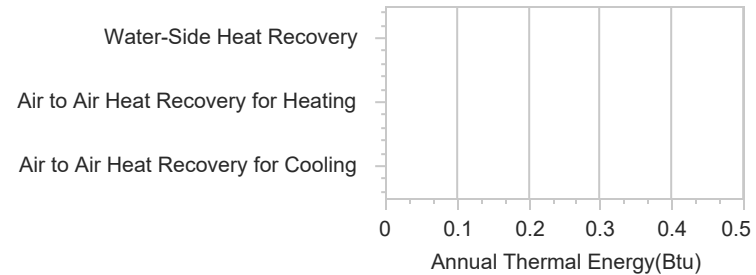


Monthly On-Site Generation

On-Site and Renewables (kWh)	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
Photovoltaics	0	0	0	0	0	0	0	0	0	0	0	0	0
Wind	0	0	0	0	0	0	0	0	0	0	0	0	0
Internal Combustion Engine	0	0	0	0	0	0	0	0	0	0	0	0	0
Combustion Turbine	0	0	0	0	0	0	0	0	0	0	0	0	0


Carbon Footprint and Renewable Energy Summary

Total Emissions

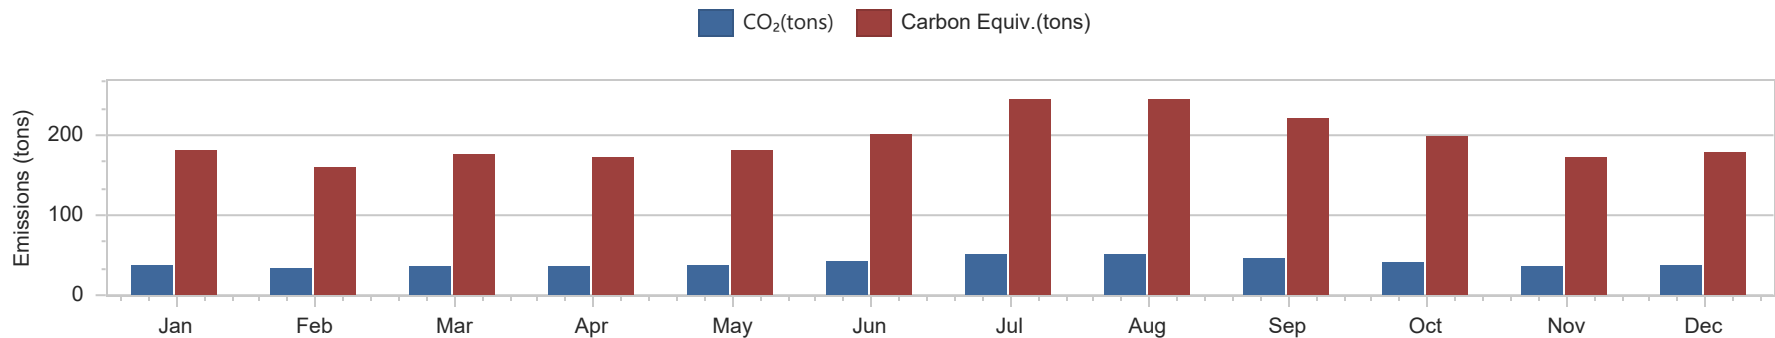


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	37.57	33.39	36.66	35.92	37.82	41.82	51.06	50.89	45.98	41.41	35.99	37.26	485.78
CH ₄	(tons CO ₂ e)	58.22	51.75	56.82	55.67	58.62	64.82	79.14	78.87	71.27	64.18	55.78	57.75	752.88
N ₂ O	(tons CO ₂ e)	84.96	75.51	82.91	81.23	85.54	94.59	115.48	115.09	103.99	93.66	81.39	84.28	1,098.64
Carbon Equiv.	(tons CO ₂ e)	180.75	160.65	176.40	172.82	181.97	201.23	245.68	244.85	221.24	199.26	173.16	179.29	2,337.30
NO _x	(lbs)	62.10	55.18	60.61	59.37	62.52	69.14	84.39	84.11	76.02	68.45	59.48	61.60	802.97
SO ₂	(lbs)	6.86	6.08	6.70	6.55	6.90	7.63	9.33	9.28	8.40	7.56	6.57	6.81	88.69
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Source Electricity Emissions

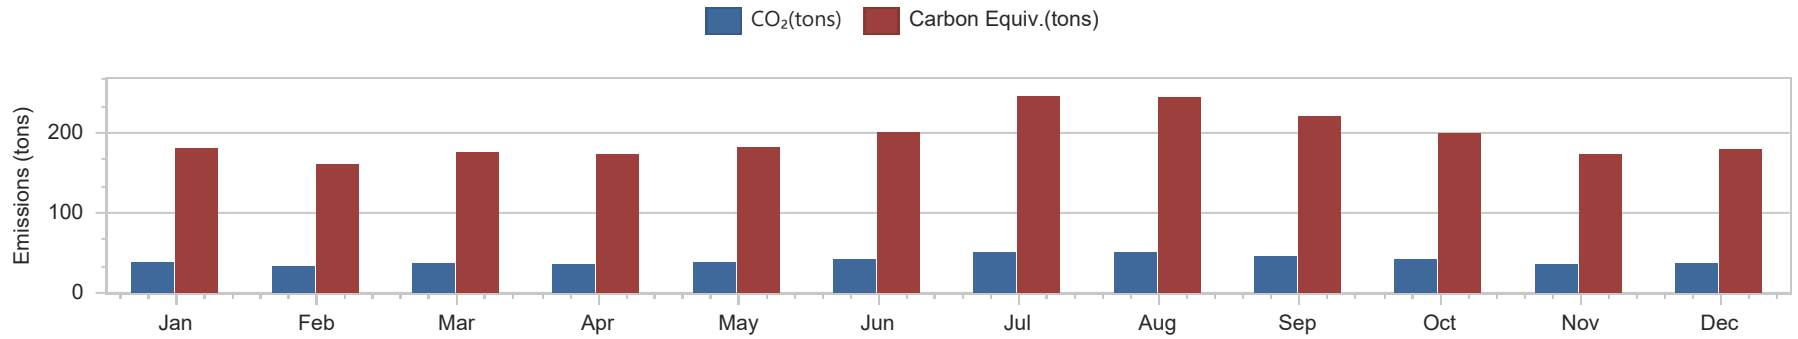

Emission Data for Source Electricity		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO2e)	37.57	33.39	36.66	35.92	37.82	41.82	51.06	50.89	45.98	41.41	35.99	37.26	485.78
CH ₄	(tons CO2e)	58.22	51.75	56.82	55.67	58.62	64.82	79.14	78.87	71.27	64.18	55.78	57.75	752.88
N ₂ O	(tons CO2e)	84.96	75.51	82.91	81.23	85.54	94.59	115.48	115.09	103.99	93.66	81.39	84.28	1,098.64
Carbon	(tons CO2e)	180.75	160.65	176.40	172.82	181.97	201.23	245.68	244.85	221.24	199.26	173.16	179.29	2,337.30
Equiv.														
NO _x	(lbs)	62.10	55.18	60.61	59.37	62.52	69.14	84.39	84.11	76.02	68.45	59.48	61.60	802.97
SO ₂	(lbs)	6.86	6.08	6.70	6.55	6.90	7.63	9.33	9.28	8.40	7.56	6.57	6.81	88.69
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Site Emissions

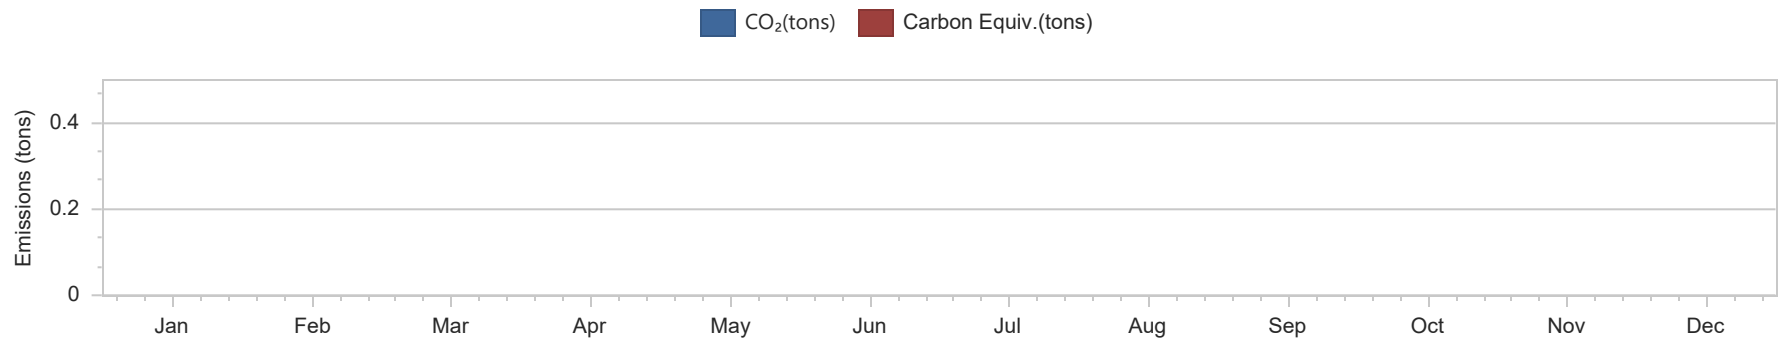


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
CH ₄	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
N ₂ O	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
Carbon Equiv.	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
NO _x	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
SO ₂	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Greenhouse Gas Equivalence


Greenhouse Gas	Annual Total (kg)	Carbon Dioxide Equivalent (kg)	Percent of Total (%)
Carbon Dioxide (CO ₂)	440,690.76	440,690.76	0.07 %
Methane (CH ₄)	683,002.75	17,075,068.75	2.71 %
Nitrous Oxide (N ₂ O)	996,669.94	297,007,642.12	47.22 %

Total 314,523,401.63 * Conversion factors from US EPA

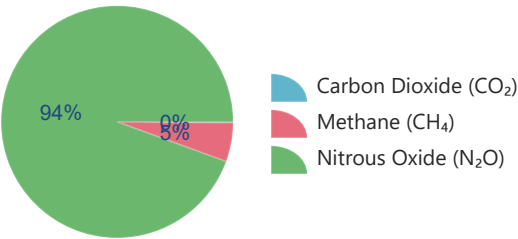

On-Site and Renewable Energy Contribution Summary

Electric Load Satisfied	Energy (kWh)	Percent Electricity (%)
Site Energy from Utility	203,056	100%
Site Power Generation	0	0%

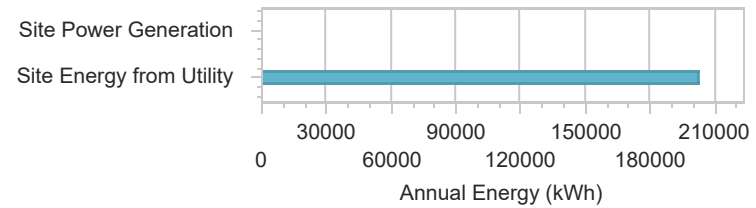

On-Site and Renewable Energy Systems


Electric Loads Satisfied	Electricity Used (kWh)	Percent Electricity (%)
Electricity Coming From Utility	203,056	100 %
Fuel-Fired Power Generation	0	0 %
Net Decrease in On-Site Storage	0	0 %
Net Electricity From Utility	203,056	100 %
Photovoltaic Power	0	0 %
Surplus Electricity Going To Utility	0	0 %
Total Electricity End Uses	203,056	100 %
Total On-Site and Utility Electric Sources	203,056	100 %
Total On-Site Electric Sources	0	0 %
Wind Power	0	0 %

Thermal Sources	Heat (Btu)	Percent Heat (%)
Air to Air Heat Recovery for Cooling	0	0 %
Air to Air Heat Recovery for Heating	0	0 %
Total Thermal Sources	0	0 %
Water-Side Heat Recovery	0	0 %

Monthly On-Site Generation

On-Site and Renewables (kWh)	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
Photovoltaics	0	0	0	0	0	0	0	0	0	0	0	0	0
Wind	0	0	0	0	0	0	0	0	0	0	0	0	0
Internal Combustion Engine	0	0	0	0	0	0	0	0	0	0	0	0	0
Combustion Turbine	0	0	0	0	0	0	0	0	0	0	0	0	0

Water Summary

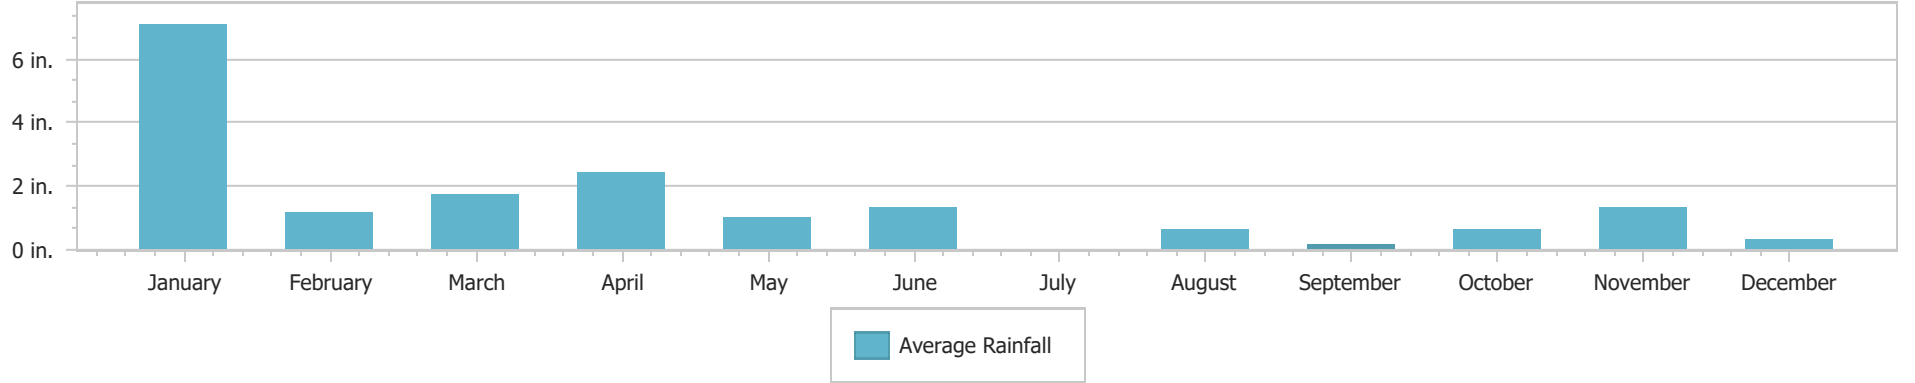


If the weather file contains erroneous or incomplete rainfall data, the data here will be erroneous or incomplete as well.

		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Average Rainfall	in.	7.09	1.18	1.73	2.44	1.02	1.34	0.00	0.63	0.16	0.63	1.34	0.31	17.87
Average Gallons of H2O	gal	69,332.65	11,555.44	16,947.98	23,881.25	10,014.72	13,096.17	0.00	6,162.90	1,540.73	6,162.90	13,096.17	3,081.45	174,872.35

Gross Roof Area: 15,695 ft²

	Water (gal)	Percent Water (%)
Change in Storage	0	0
Condensate Collection	0	0
Final Storage	0	0
Groundwater Well	0	0
Initial Storage	0	0
Rainwater Collection	0	0
Total On Site Water Sources	0	0
Total On Site, Change in Storage, and Utility Water Sources	0	0
Total Water End Uses	0	0
Water Supplied by Utility	0	0

Water Summary

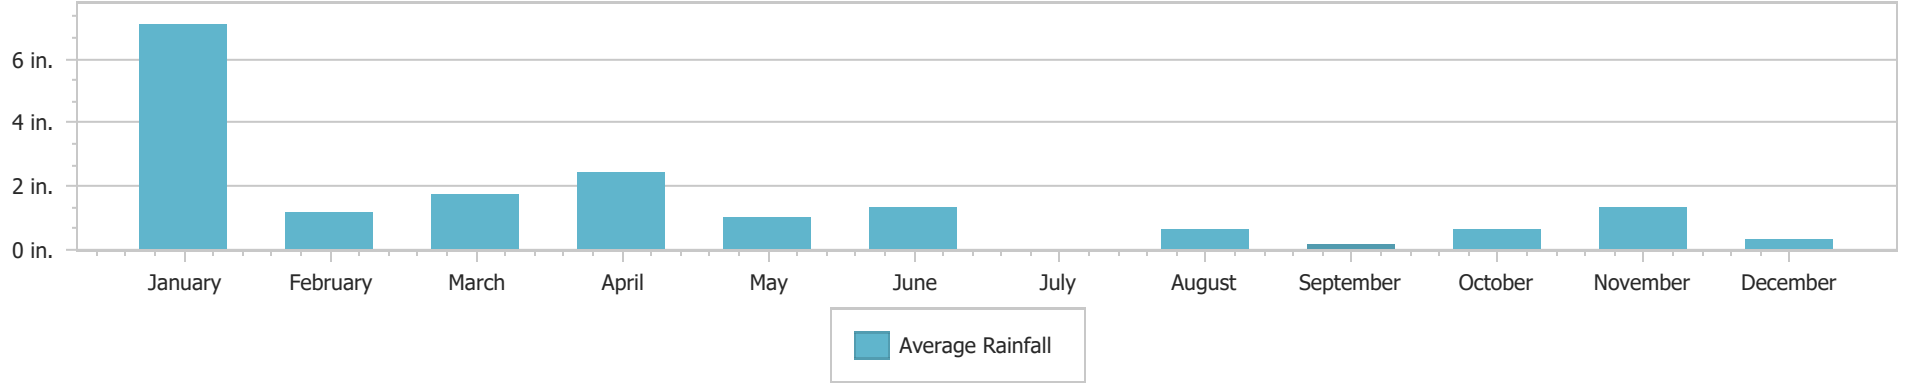

If the weather file contains erroneous or incomplete rainfall data, the data here will be erroneous or incomplete as well.


		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Average Rainfall	in.	7.09	1.18	1.73	2.44	1.02	1.34	0.00	0.63	0.16	0.63	1.34	0.31	17.87
Average Gallons of H2O	gal	69,332.65	11,555.44	16,947.98	23,881.25	10,014.72	13,096.17	0.00	6,162.90	1,540.73	6,162.90	13,096.17	3,081.45	174,872.35

Gross Roof Area: 15,695 ft²

	Water (gal)	Percent Water (%)
Change in Storage	0	0
Condensate Collection	0	0
Final Storage	0	0
Groundwater Well	0	0
Initial Storage	0	0
Rainwater Collection	0	0
Total On Site Water Sources	0	0
Total On Site, Change in Storage, and Utility Water Sources	0	0
Total Water End Uses	0	0
Water Supplied by Utility	0	0

Utility Peak Demand Summary


Electricity (kW)

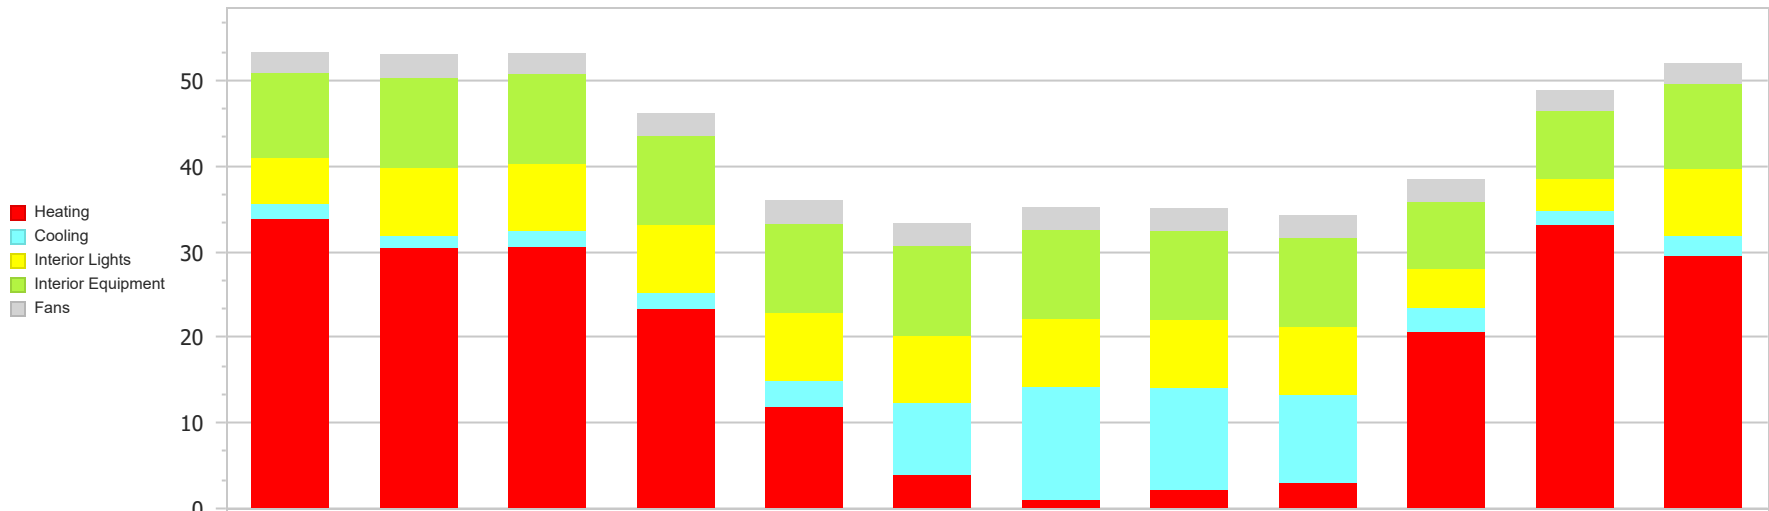

Peak Facility Demand	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Time of Peak (Day/Hour)	03/08:00	23/20:00	01/20:00	21/20:00	03/20:00	26/20:00	12/20:00	14/20:00	18/20:00	10/07:00	24/07:00	12/22:00
Heating	33.8	30.4	30.6	23.3	11.9	3.9	1	2.2	3	20.7	33.1	29.5
Cooling	1.8	1.5	1.8	1.9	3	8.4	13.2	11.9	10.3	2.7	1.7	2.3
Interior Lights	5.4	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	4.6	3.7	7.9
Interior Equipment	9.9	10.5	10.5	10.5	10.5	10.5	10.5	10.5	10.5	7.8	8	9.9
Fans	2.4	2.7	2.4	2.6	2.7	2.6	2.6	2.6	2.6	2.6	2.4	2.4

Utility Peak Demand Summary

Electricity (kW)

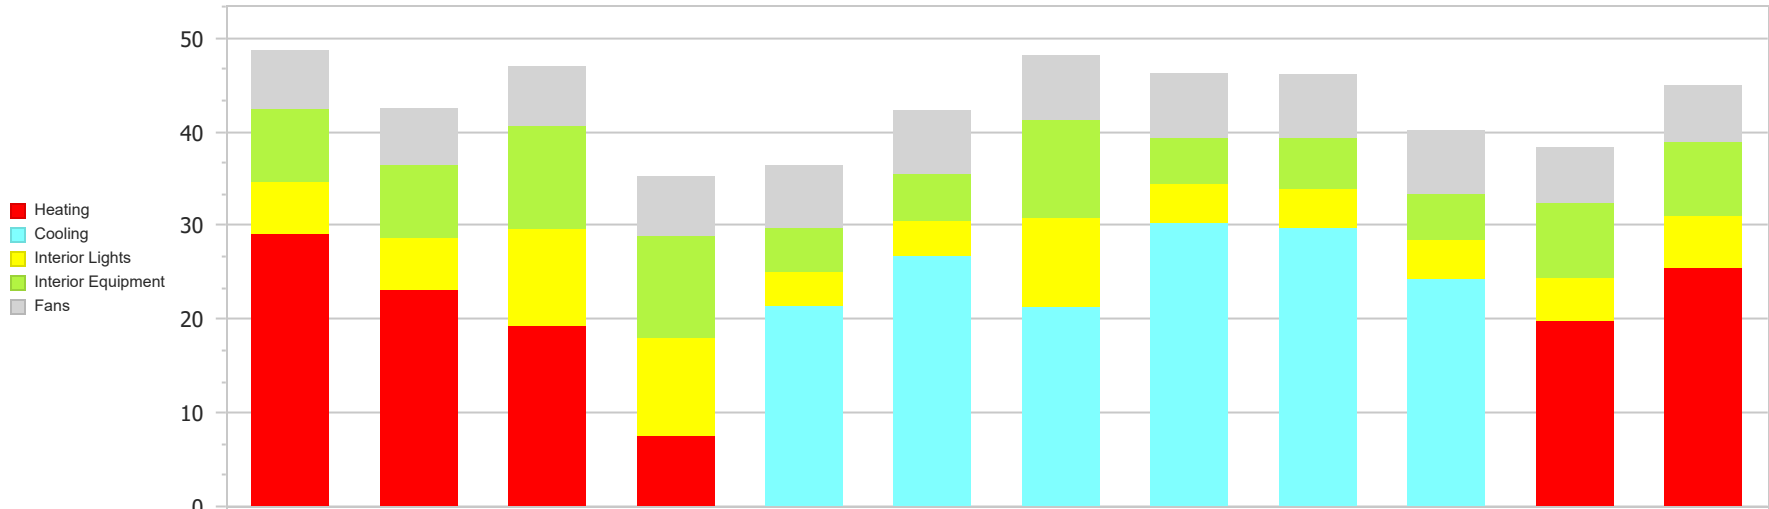

Peak Facility Demand
Time of Peak (Day/Hour)
Heating
Cooling
Interior Lights
Interior Equipment
Fans

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
48.7	42.6	47.2	35.4	36.4	42.3	48.1	46.3	46.2	40.3	38.3	45
03/07:00	22/07:00	01/21:00	20/21:00	07/15:00	25/14:00	10/20:00	14/14:00	02/14:00	03/14:00	24/07:00	26/07:00
29.1	23.1	19.3	7.6	0	0	0	0	0	0	19.8	25.5
0	0	0	0	21.4	26.8	21.3	30.3	29.8	24.3	0	0
5.6	5.6	10.4	10.4	3.7	3.7	9.5	4.1	4.1	4.1	4.6	5.6
7.8	7.8	10.9	10.9	4.6	5	10.5	5	5.5	5	8	7.8
6.2	6	6.4	6.4	6.7	6.8	6.9	6.9	6.8	6.8	5.9	6


Economic Summary

Economic Summary and Calculation Parameters

Life Cycle and Costing Parameters


Length of Study	25 years
Inflation Approach	ConstantDollar
Discounting Convention	BeginningOfYear
Real Discount Rate	3.00%
Nominal Discount Rate	-- N/A --
Inflation Rate	-- N/A --
Tax Rate	0.00%
Depreciation Method	None
Base Date	July 2019
Service Date	July 2019
Building Area	21,103 (ft²)
Net Conditioned Building Area	13,652 (ft²)
Initial Capital Investment Cost	\$0

Average Costs

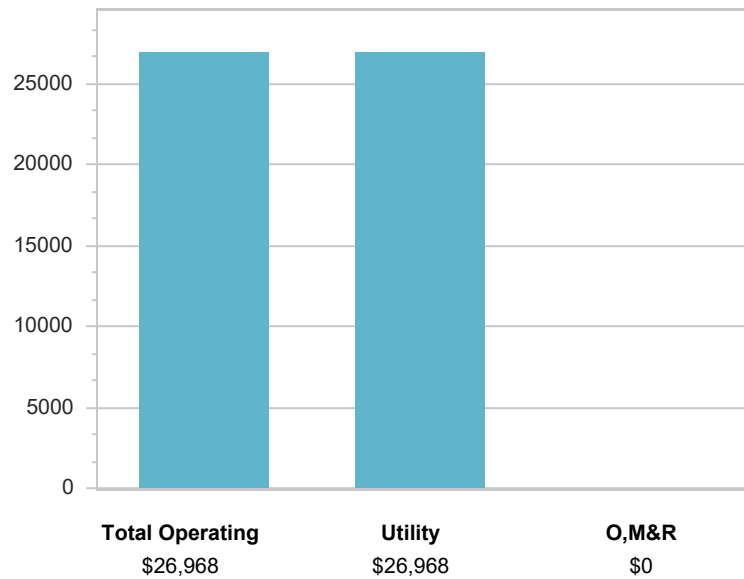


Energy Cost Summary

Name	Electricity	Gas	Other	Total
Energy Cost (Net)	\$26,968	\$0	\$0	\$26,968
Renewables Offset	\$0	\$0	\$0	\$0
Energy Cost (Total)	\$26,968	\$0	\$0	\$26,968
Cost per Building Area	\$1.28	\$0.00	\$0.00	\$1.28
Cost per Net Cond. Bldg Area	\$1.98	\$0.00	\$0.00	\$1.98

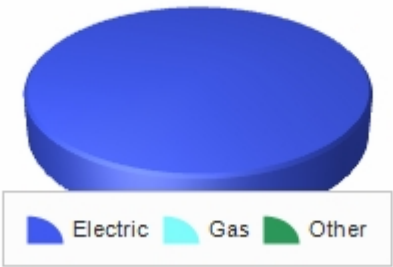


Monthly Utilities Cost Summary

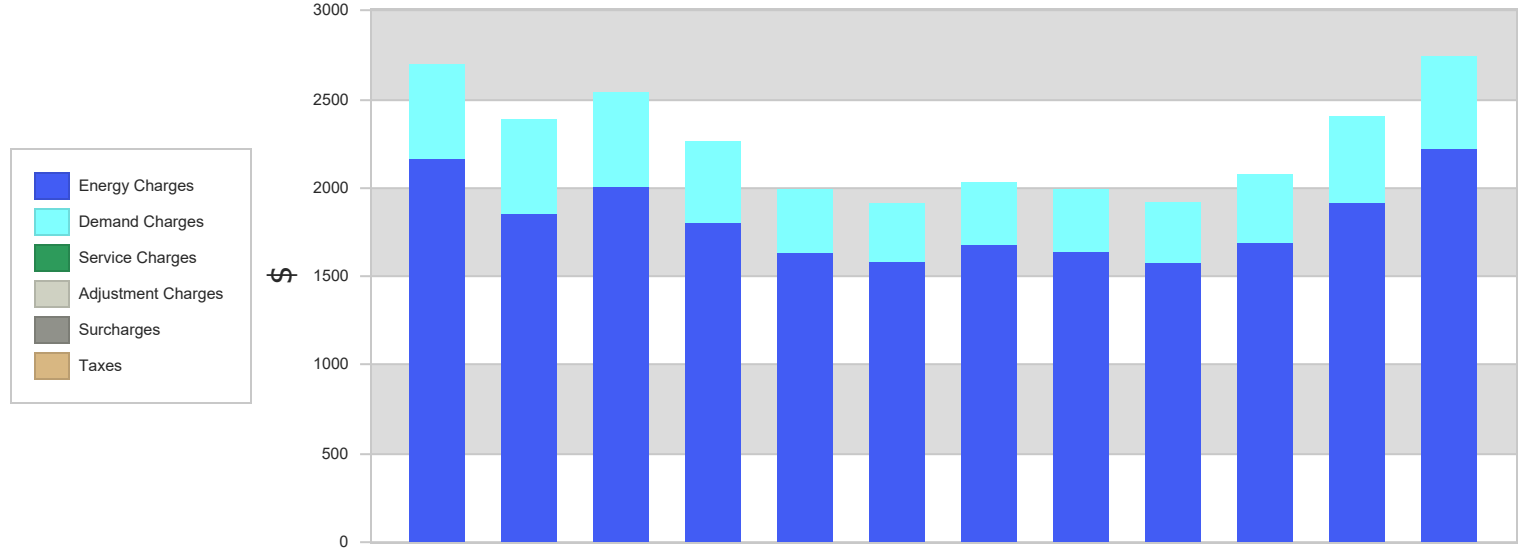

Tariff Catagory	Fuel Type	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)	Annual Total (\$)	% of Total
Consumption Charges	Electricity	2,166	1,857	2,009	1,804	1,635	1,583	1,680	1,639	1,578	1,691	1,912	2,220	21,773	80.74%
Demand Charges	Electricity	534	532	532	463	361	333	352	351	343	384	490	520	5,195	19.26%
Adjustment	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Basis	All	2,700	2,388	2,541	2,266	1,996	1,915	2,033	1,990	1,922	2,075	2,402	2,740	26,968	100.00%
ServiceCharges	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Subtotal	All	2,700	2,388	2,541	2,266	1,996	1,915	2,033	1,990	1,922	2,075	2,402	2,740	26,968	100.00%
Surcharge	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Taxes	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
	Total	2,700	2,388	2,541	2,266	1,996	1,915	2,033	1,990	1,922	2,075	2,402	2,740	26,968	

Monthly Utility Details

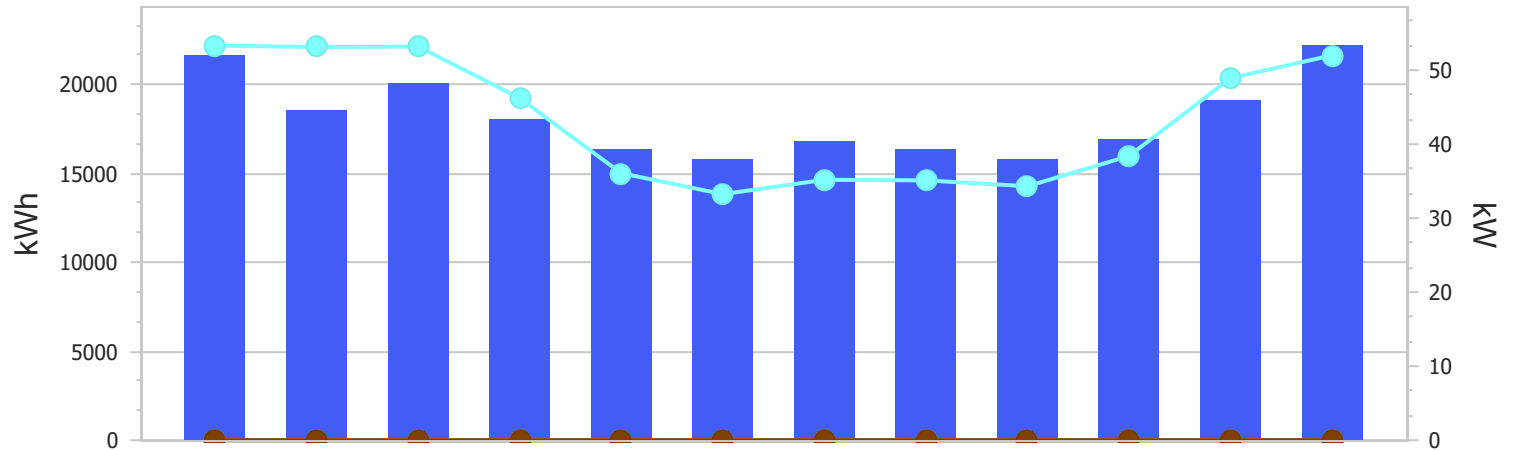

Electricity


On Peak Demand kW
On Peak Consumption kWh

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Annual Totals
53	53	53	46	36	33	35	35	34	38	49	52	53
21,662	18,567	20,087	18,037	16,348	15,827	16,805	16,391	15,781	16,907	19,123	22,196	217,731

Tariff Details

Tariff Name	Selected	Qualified	Meter Name	Buy or Sell	Group	Total Annual Cost
SAMPLE WITH ALL UTILITIES_ELEC	Yes	Yes	BUILDING ELECTRICITY	Buy	(none)	\$26,968

Life Cycle Operating Cash Flow (without escalation)

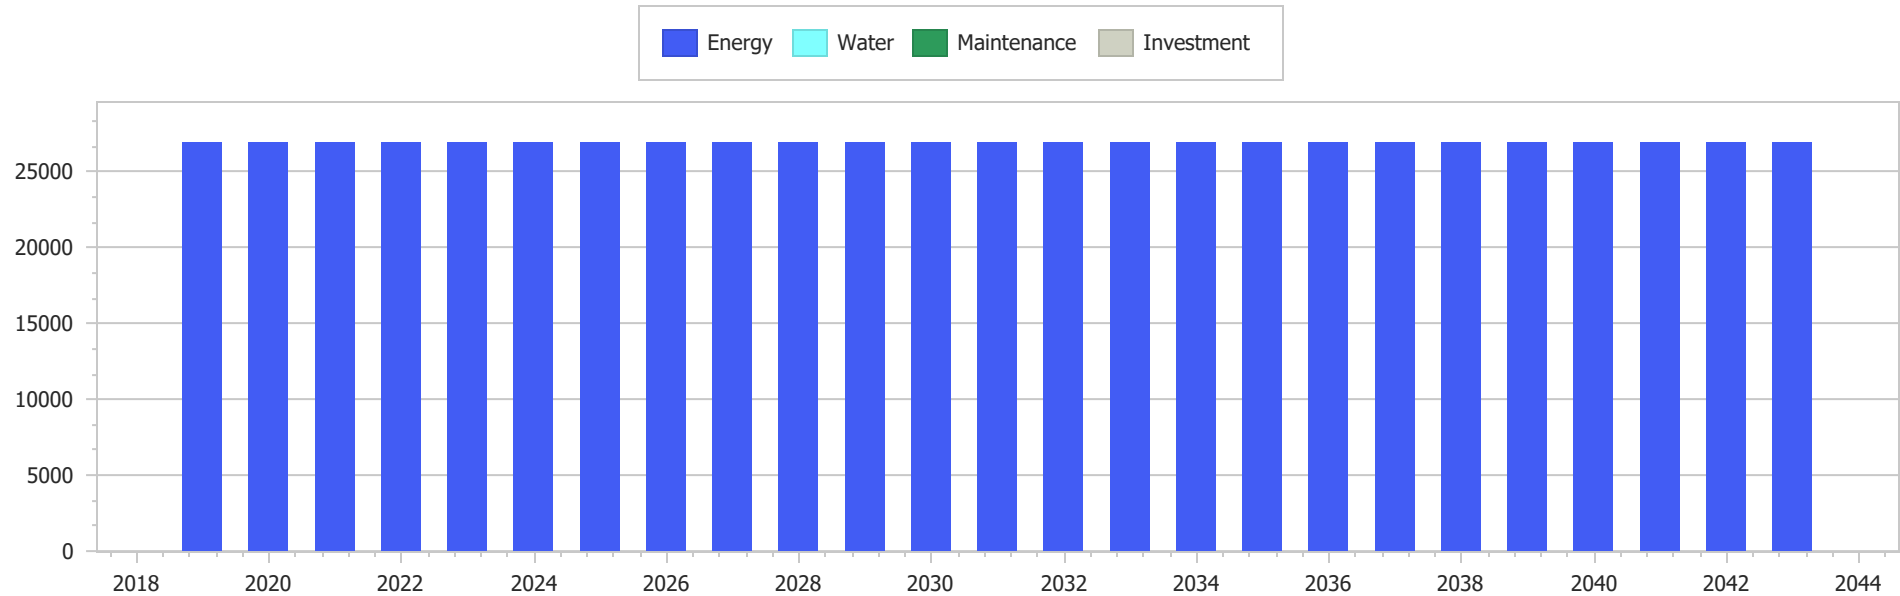

Year	Energy	Water	Maintenance	Investment	Total
2019	26,968	0	0	0	26,968
2020	26,968	0	0	0	26,968
2021	26,968	0	0	0	26,968
2022	26,968	0	0	0	26,968
2023	26,968	0	0	0	26,968
2024	26,968	0	0	0	26,968
2025	26,968	0	0	0	26,968
2026	26,968	0	0	0	26,968

Year	Energy	Water	Maintenance	Investment	Total
2027	26,968	0	0	0	26,968
2028	26,968	0	0	0	26,968
2029	26,968	0	0	0	26,968
2030	26,968	0	0	0	26,968
2031	26,968	0	0	0	26,968
2032	26,968	0	0	0	26,968
2033	26,968	0	0	0	26,968
2034	26,968	0	0	0	26,968
2035	26,968	0	0	0	26,968
2036	26,968	0	0	0	26,968
2037	26,968	0	0	0	26,968
2038	26,968	0	0	0	26,968
2039	26,968	0	0	0	26,968
2040	26,968	0	0	0	26,968
2041	26,968	0	0	0	26,968
2042	26,968	0	0	0	26,968
2043	26,968	0	0	0	26,968

Present Value Analysis (Without Escalation)

Present Value By Year

Year	Total Cost	Present Value
2019	26,967.79	26,967.79
2020	26,967.79	26,182.32
2021	26,967.79	25,419.72
2022	26,967.79	24,679.34
2023	26,967.79	23,960.53
2024	26,967.79	23,262.65
2025	26,967.79	22,585.10
2026	26,967.79	21,927.28
2027	26,967.79	21,288.62
2028	26,967.79	20,668.56
2029	26,967.79	20,066.56
2030	26,967.79	19,482.10
2031	26,967.79	18,914.66
2032	26,967.79	18,363.75
2033	26,967.79	17,828.88
2034	26,967.79	17,309.60
2035	26,967.79	16,805.43
2036	26,967.79	16,315.95
2037	26,967.79	15,840.73
2038	26,967.79	15,379.35
2039	26,967.79	14,931.41
2040	26,967.79	14,496.51
2041	26,967.79	14,074.28
2042	26,967.79	13,664.35
2043	26,967.79	13,266.36
Total Life Cycle Cost		483,681.83



Category	Present Value	
Construction	\$0.00	0%
Energy	\$483,681.80	100%
Grand Total	\$483,681.80	
Maintenance	\$0.00	0%
Operation	\$0.00	0%
Other Capital	\$0.00	0%
Other Operational	\$0.00	0%
Repair	\$0.00	0%
Replacement	\$0.00	0%
Salvage	\$0.00	0%
Total Capital	\$0.00	
Total Energy	\$483,681.80	
Total Operation	\$483,681.80	
Water	\$0.00	0%


Economic Summary

Economic Summary and Calculation Parameters

Life Cycle and Costing Parameters


Length of Study	25 years
Inflation Approach	ConstantDollar
Discounting Convention	BeginningOfYear
Real Discount Rate	3.00%
Nominal Discount Rate	-- N/A --
Inflation Rate	-- N/A --
Tax Rate	0.00%
Depreciation Method	None
Base Date	July 2019
Service Date	July 2019
Building Area	21,103 (ft²)
Net Conditioned Building Area	13,652 (ft²)
Initial Capital Investment Cost	\$0

Average Costs

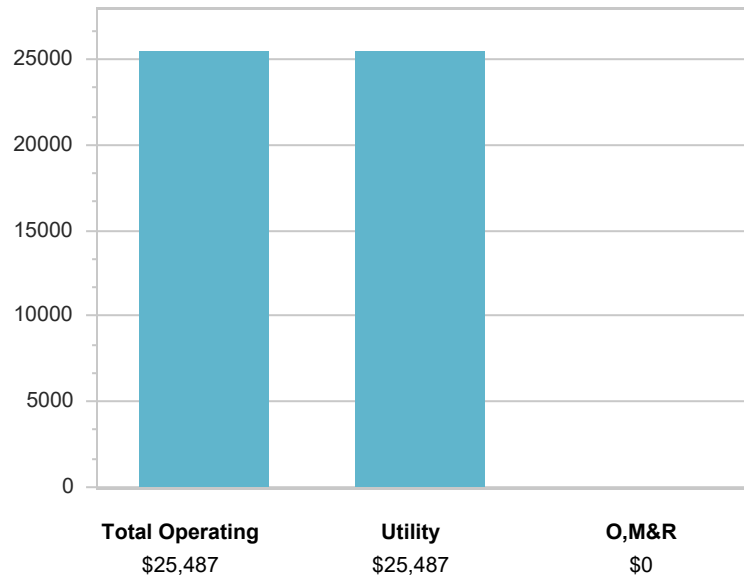


Energy Cost Summary

Name	Electricity	Gas	Other	Total
Energy Cost (Net)	\$25,487	\$0	\$0	\$25,487
Renewables Offset	\$0	\$0	\$0	\$0
Energy Cost (Total)	\$25,487	\$0	\$0	\$25,487
Cost per Building Area	\$1.21	\$0.00	\$0.00	\$1.21
Cost per Net Cond. Bldg Area	\$1.87	\$0.00	\$0.00	\$1.87

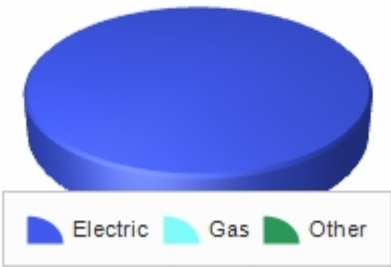


Monthly Utilities Cost Summary

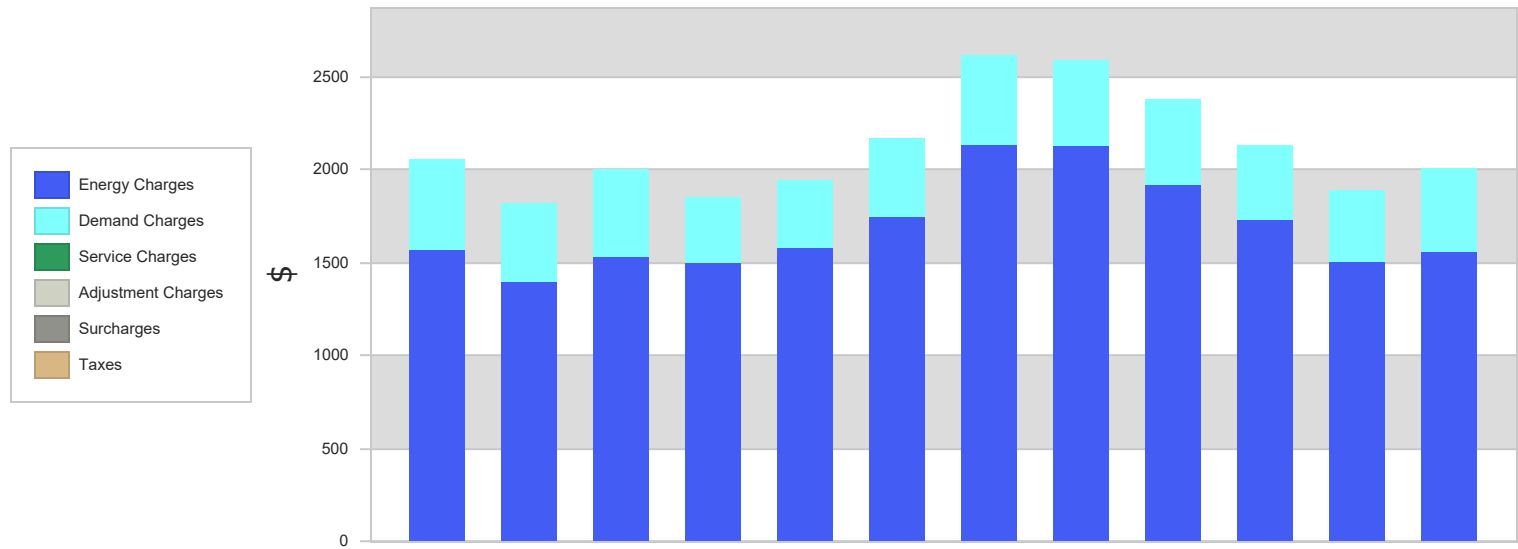

Tariff Catagory	Fuel Type	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)	Annual Total (\$)	% of Total
Consumption Charges	Electricity	1,571	1,396	1,533	1,502	1,582	1,749	2,136	2,128	1,923	1,732	1,505	1,559	20,317	79.72%
Demand Charges	Electricity	487	426	472	354	364	423	481	463	462	403	383	450	5,170	20.28%
Adjustment	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Basis	All	2,059	1,822	2,005	1,856	1,946	2,172	2,617	2,592	2,386	2,135	1,889	2,008	25,487	100.00%
ServiceCharges	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Subtotal	All	2,059	1,822	2,005	1,856	1,946	2,172	2,617	2,592	2,386	2,135	1,889	2,008	25,487	100.00%
Surcharge	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Taxes	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Total		2,059	1,822	2,005	1,856	1,946	2,172	2,617	2,592	2,386	2,135	1,889	2,008	25,487	

Monthly Utility Details

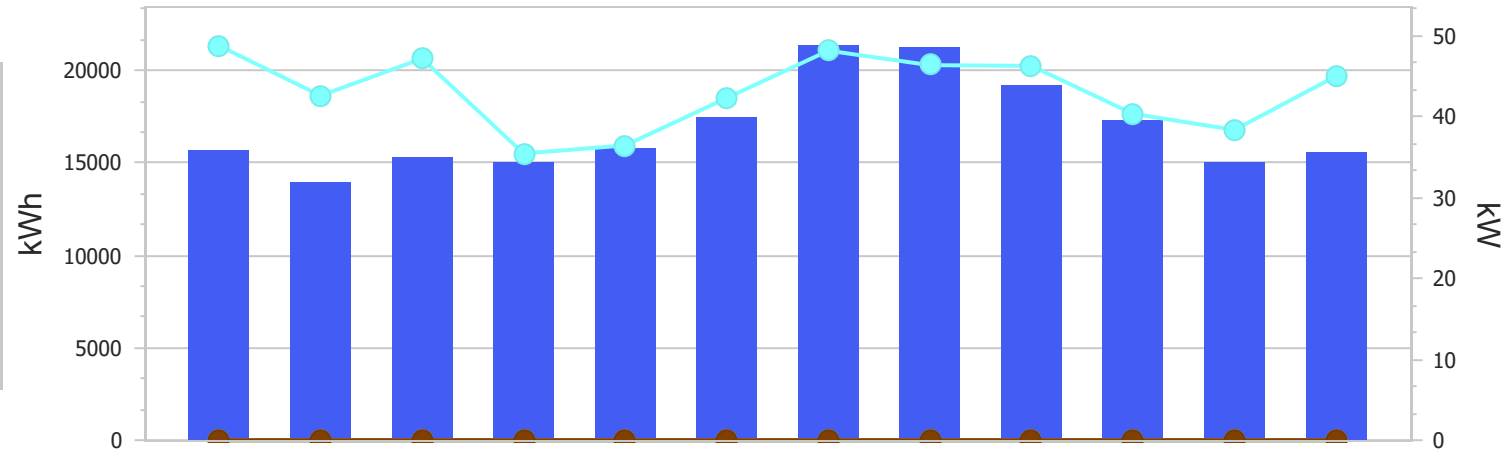

Electricity

On Peak Demand kW


On Peak Consumption kWh

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Annual Totals
49	43	47	35	36	42	48	46	46	40	38	45	49
15,712	13,964	15,334	15,022	15,818	17,492	21,356	21,284	19,232	17,321	15,052	15,585	203,173

Tariff Details

Tariff Name	Selected	Qualified	Meter Name	Buy or Sell	Group	Total Annual Cost
SAMPLE WITH ALL UTILITIES_ELEC	Yes	Yes	BUILDING ELECTRICITY	Buy	(none)	\$25,487

Life Cycle Operating Cash Flow (without escalation)

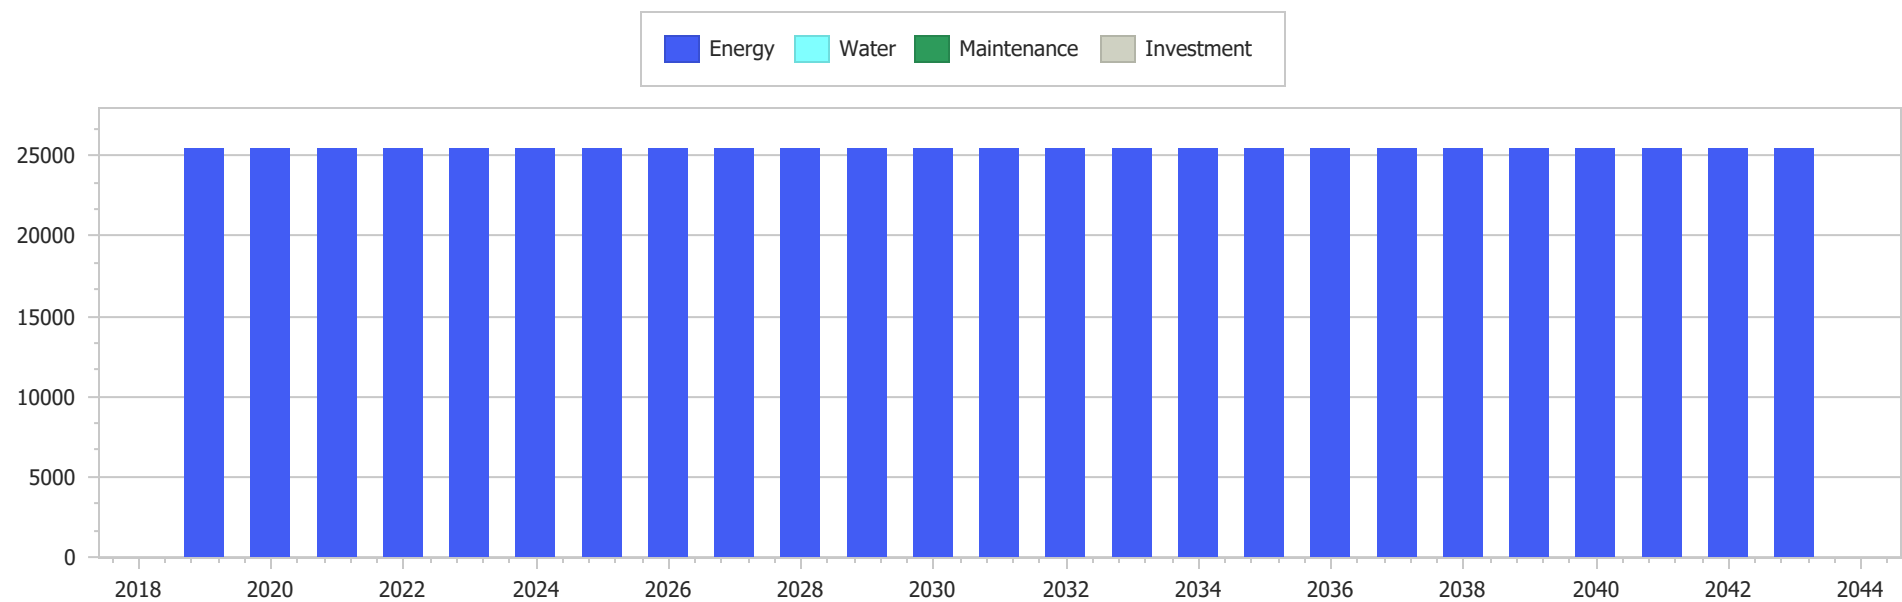

Year	Energy	Water	Maintenance	Investment	Total
2019	25,487	0	0	0	25,487
2020	25,487	0	0	0	25,487
2021	25,487	0	0	0	25,487
2022	25,487	0	0	0	25,487
2023	25,487	0	0	0	25,487
2024	25,487	0	0	0	25,487
2025	25,487	0	0	0	25,487
2026	25,487	0	0	0	25,487

Year	Energy	Water	Maintenance	Investment	Total
2027	25,487	0	0	0	25,487
2028	25,487	0	0	0	25,487
2029	25,487	0	0	0	25,487
2030	25,487	0	0	0	25,487
2031	25,487	0	0	0	25,487
2032	25,487	0	0	0	25,487
2033	25,487	0	0	0	25,487
2034	25,487	0	0	0	25,487
2035	25,487	0	0	0	25,487
2036	25,487	0	0	0	25,487
2037	25,487	0	0	0	25,487
2038	25,487	0	0	0	25,487
2039	25,487	0	0	0	25,487
2040	25,487	0	0	0	25,487
2041	25,487	0	0	0	25,487
2042	25,487	0	0	0	25,487
2043	25,487	0	0	0	25,487

Present Value Analysis (Without Escalation)

Present Value By Year

Year	Total Cost	Present Value
2019	25,487.04	25,487.04
2020	25,487.04	24,744.70
2021	25,487.04	24,023.98
2022	25,487.04	23,324.26
2023	25,487.04	22,644.91
2024	25,487.04	21,985.35
2025	25,487.04	21,345.00
2026	25,487.04	20,723.30
2027	25,487.04	20,119.71
2028	25,487.04	19,533.70
2029	25,487.04	18,964.75
2030	25,487.04	18,412.38
2031	25,487.04	17,876.10
2032	25,487.04	17,355.44
2033	25,487.04	16,849.94
2034	25,487.04	16,359.16
2035	25,487.04	15,882.68
2036	25,487.04	15,420.08
2037	25,487.04	14,970.95
2038	25,487.04	14,534.91
2039	25,487.04	14,111.56
2040	25,487.04	13,700.54
2041	25,487.04	13,301.50
2042	25,487.04	12,914.07
2043	25,487.04	12,537.94
Total Life Cycle Cost		457,123.95



Category	Present Value	
Construction	\$0.00	0%
Energy	\$457,123.90	100%
Grand Total	\$457,123.90	
Maintenance	\$0.00	0%
Operation	\$0.00	0%
Other Capital	\$0.00	0%
Other Operational	\$0.00	0%
Repair	\$0.00	0%
Replacement	\$0.00	0%
Salvage	\$0.00	0%
Total Capital	\$0.00	
Total Energy	\$457,123.90	
Total Operation	\$457,123.90	
Water	\$0.00	0%

Equipment Energy Consumption

Equipment-Utility

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Interior Lighting	Electric (kWh)	3,100	2,805	3,112	3,006	3,108	3,011	3,103	3,112	3,006	3,104	2,999	3,103	36,568
	Peak (kW)	5.4	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	4.6	3.7	7.9	7.9
Interior Equipment	Electric (kWh)	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
	Peak (kW)	9.9	10.5	10.5	10.5	10.5	10.5	10.5	10.5	10.5	7.8	8.0	9.9	10.5

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-1 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	21	19	21	21	21	21	21	21	21	21	21	21	253
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	11	10	11	11	11	11	11	11	11	11	11	11	130
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 1 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-3 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	11	10	11	11	11	11	11	11	11	11	11	11	135
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	7	6	7	6	7	6	7	7	6	7	6	7	77
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	9	9	9	9	9	9	9	9	9	9	9	9	111
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	8	8	8	8	8	8	8	8	8	8	8	8	100
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 2 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Admin _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	13	12	13	13	13	13	13	13	13	13	13	13	156
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	41	37	41	40	41	40	41	41	40	41	40	41	483
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Chart/Hotel _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	7	7	7	7	7	7	7	7	7	7	7	7	86
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	16	15	16	16	16	16	16	16	16	16	16	16	191
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Corridor-N _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	13	12	13	13	13	13	13	13	13	13	13	13	158
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	27	24	27	26	27	26	27	27	26	27	26	27	313
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	29	26	29	28	29	28	29	29	28	29	28	29	343
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DOAS to Zone Level Equipment Dehum and Reheat DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
DOAS to Zone Level Equipment Dehum and Reheat Electric Heating Coil Electricity	Electric (kWh)	4,665	3,822	4,140	3,358	2,532	2,058	1,433	1,294	1,516	2,395	3,736	4,855	35,803
DOAS to Zone Level Equipment Dehum and Reheat SCC-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DOAS to Zone Level Equipment Dehum and Reheat SCC-1 Cooling Coil Electricity	Electric (kWh)	89	24	19	108	145	600	1,111	891	598	228	60	7	3,881
	Peak (kW)	3.0	1.2	1.3	2.3	3.8	4.0	5.6	6.2	6.0	2.7	1.7	0.8	6.2
DOAS to Zone Level Equipment Dehum and Reheat SF-1 Fan Electricity	Electric (kWh)	314	293	329	314	332	306	318	319	311	332	323	321	3,813
	Peak (kW)	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
Entry/Waiting _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 4 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Entry/Waiting _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Entry/Waiting _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	77	70	77	75	77	75	77	77	75	77	75	77	909
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Exam/Storage _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	8	7	8	8	8	8	8	8	8	8	8	8	97
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	16	14	16	15	16	15	16	16	15	16	15	16	185
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	15	13	15	14	15	14	15	15	14	15	14	15	174
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 5 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Intake-HR-A _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	24	22	24	23	24	23	24	24	23	24	23	24	285
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	6	6	6	6	6	6	6	6	6	6	6	6	75
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _Single Zone CV DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Kitchen _Single Zone CV Electric Heating Coil Electricity	Electric (kWh)	5,902	4,579	4,759	3,481	1,780	864	366	292	661	1,807	4,165	6,195	34,852
Kitchen _Single Zone CV SCC-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _Single Zone CV SCC-1 Cooling Coil Electricity	Electric (kWh)	37	85	85	202	296	690	1,284	1,270	985	548	184	38	5,705
	Peak (kW)	1.8	2.5	2.6	3.9	5.0	6.6	8.1	8.1	8.1	5.5	3.3	2.0	8.1
Kitchen _Single Zone CV SF-1 Fan Electricity	Electric (kWh)	702	633	698	675	698	678	712	716	685	700	678	707	8,283
	Peak (kW)	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Lounge _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 6 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Lounge _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	26	23	26	25	26	25	26	26	25	26	25	26	306
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	26	24	26	26	26	26	26	26	26	26	26	26	311
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	17	15	17	16	17	16	17	17	16	17	16	17	200
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	28	25	28	27	28	27	28	28	27	28	27	28	330
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 7 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-N-West _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	48	44	48	47	48	47	48	48	47	48	47	48	569
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
RB-S-Corner-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	14	12	14	13	14	13	14	14	13	14	13	14	163
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	15	13	15	14	15	14	15	15	14	15	14	15	174
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	39	36	39	38	39	38	39	39	38	39	38	39	464
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 8 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-West_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	15	14	15	15	15	15	15	15	15	15	15	15	182
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	14	13	14	14	14	14	14	14	14	14	14	14	167
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	45	40	45	43	45	43	45	45	43	45	43	45	528
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Servery_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	12	11	12	11	12	11	12	12	11	12	11	12	138
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 9 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
SHWR-N _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	10	9	10	10	10	10	10	10	10	10	10	10	123
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	11	10	11	11	11	11	11	11	11	11	11	11	133
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _EXHAUST FAN Fan Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
SHWR-W _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	10	9	10	10	10	10	10	10	10	10	10	10	120
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 10 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Support _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	28	25	28	27	28	27	28	28	27	28	27	28	329
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	73	66	73	71	73	71	73	73	71	73	71	73	862
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

*** This report currently does not comprise the total energy consumption for some equipment selections.
VRF, primary boiler electricity, and ancillary energy consumptions are not displayed in the report.
Please contact cdshelp@trane.com for any additional questions***.

Equipment Energy Consumption

Equipment-Utility

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Interior Lighting	Electric (kWh)	3,812	3,448	3,825	3,695	3,820	3,700	3,814	3,825	3,695	3,816	3,687	3,814	44,951
	Peak (kW)	5.6	5.6	10.4	10.4	3.7	3.7	9.5	4.1	4.1	4.1	4.6	5.6	10.4
Interior Equipment	Electric (kWh)	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
	Peak (kW)	7.8	7.8	10.9	10.9	4.6	5.0	10.5	5.0	5.5	5.0	8.0	7.8	10.9

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-1 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	5	2	2	2	0	0	0	0	0	0	1	4	15
ACT-Noisy-1 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-1 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	6	12	14	24	43	67	112	110	91	55	16	6	555
	Peak (kW)	0.2	0.3	0.3	0.4	0.4	0.5	0.6	0.6	0.6	0.5	0.3	0.2	0.6
ACT-Noisy-1 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	64	56	61	59	62	63	71	70	67	65	61	64	762
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
ACT-Noisy-2 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	7	4	3	2	0	0	0	0	0	0	1	7	24
ACT-Noisy-2 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-2 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	3	2	9	23	46	83	80	62	35	7	1	350
	Peak (kW)	0.1	0.1	0.1	0.2	0.3	0.4	0.5	0.5	0.5	0.3	0.2	0.1	0.5
ACT-Noisy-2 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	37	32	35	34	37	37	42	41	39	38	35	37	445

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
ACT-Noisy-3 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	14	7	6	3	0	0	0	0	0	0	4	12	46
ACT-Noisy-3 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-3 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	2	1	7	18	44	85	81	61	32	5	0	337
	Peak (kW)	0.1	0.1	0.1	0.2	0.3	0.4	0.5	0.5	0.5	0.3	0.2	0.1	0.5
ACT-Noisy-3 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	42	36	38	36	37	39	43	43	40	39	37	42	474
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
ACT-Quiet-1 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	1	1	0	0	0	0	0	0	0	0	0	0	2
ACT-Quiet-1 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-1 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	4	3	8	16	30	53	52	44	29	9	3	253
	Peak (kW)	0.1	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.2	0.1	0.1	0.3
ACT-Quiet-1 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	21	20	21	21	23	23	25	25	24	24	22	22	271
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
ACT-Quiet-2 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	1	1	1	1	0	0	0	0	0	0	0	1	4
ACT-Quiet-2 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-2 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-2 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	6	5	11	21	37	63	63	53	35	10	4	310
	Peak (kW)	0.2	0.2	0.1	0.2	0.2	0.3	0.3	0.3	0.4	0.3	0.2	0.2	0.4
ACT-Quiet-2 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	28	25	27	27	30	30	33	33	32	31	28	28	351

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 13 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
ACT-Quiet-3 _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	6	3	2	1	0	0	0	0	0	0	1	5	17
ACT-Quiet-3 _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-3 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	2	2	8	22	38	65	63	49	28	5	1	285
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.3	0.2	0.1	0.1	0.3
ACT-Quiet-3 _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	32	28	30	29	31	32	35	35	34	33	30	32	380
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Admin _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	4	3	2	0	0	0	0	0	0	0	1	3	14
Admin _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Admin _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	27	33	31	37	53	77	119	122	109	82	41	32	763
	Peak (kW)	0.3	0.3	0.2	0.3	0.3	0.3	0.4	0.4	0.4	0.4	0.3	0.3	0.4
Admin _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	101	91	101	98	101	98	101	101	98	101	98	101	1,188
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Attrium _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Attrium _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Attrium _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	156	182	208	258	348	436	576	564	492	381	214	160	3,977
	Peak (kW)	1.0	1.0	0.9	1.1	1.1	1.3	1.4	1.5	1.5	1.2	0.9	0.8	1.5
Attrium _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	126	114	126	122	126	122	126	126	122	126	122	126	1,489

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 14 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Chart/Hotel _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Chart/Hotel _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Chart/Hotel _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	7	12	11	20	36	55	87	87	73	53	21	9	472
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
Chart/Hotel _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	48	43	48	47	48	47	48	48	47	48	47	48	567
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Comfort/Consult _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	45	31	31	15	1	0	0	0	0	1	19	46	189
Comfort/Consult _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Comfort/Consult _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	4	8	9	22	44	92	166	163	126	71	18	4	725
	Peak (kW)	0.2	0.2	0.2	0.3	0.4	0.5	0.6	0.6	0.6	0.5	0.3	0.2	0.6
Comfort/Consult _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	108	98	108	105	108	105	108	108	105	108	105	108	1,276
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Corridor-N _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-N _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	1	1	0	0	0	0	2
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.3	0.1	0.0	0.0	0.0	0.3
Corridor-N _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	0	1	1	0	0	0	0	1

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 15 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-S _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	2	5	11	4	0	0	21
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.4	0.3	0.3	0.0	0.0	0.4
Corridor-S _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	0	3	5	9	3	0	0	19
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.0	0.0	0.1
Corridor-W _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-W _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-W _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	3	18	18	11	2	0	0	52
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.3	0.3	0.3	0.3	0.2	0.0	0.0	0.3
Corridor-W _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	4	17	17	11	3	0	0	53
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1
Entry/Waiting _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	33	20	13	3	0	0	0	0	0	0	11	33	113
Entry/Waiting _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Entry/Waiting _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Entry/Waiting _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	44	75	85	130	179	289	432	414	340	220	84	46	2,339
	Peak (kW)	0.7	0.7	0.7	0.9	1.0	1.1	1.4	1.3	1.3	1.0	0.7	0.5	1.4
Entry/Waiting _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	319	288	319	309	319	309	319	319	309	319	309	319	3,760

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 16 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4
Exam/Storage _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	12	8	7	3	0	0	0	0	0	0	3	11	45
Exam/Storage _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Exam/Storage _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	5	5	12	27	51	89	88	71	44	12	3	409
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.3	0.2	0.2	0.1	0.3
Exam/Storage _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	59	54	59	58	59	58	59	59	58	59	58	59	700
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Group _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	38	24	26	13	2	0	0	0	0	2	15	36	157
Group _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Group _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	4	4	15	30	72	138	137	101	56	13	1	573
	Peak (kW)	0.1	0.2	0.2	0.3	0.4	0.5	0.6	0.6	0.6	0.5	0.3	0.1	0.6
Group _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	76	66	75	67	69	68	76	79	72	70	68	75	860
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Hospitality _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	30	18	20	10	1	0	0	0	0	1	12	29	122
Hospitality _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hospitality _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	5	5	16	30	70	133	131	97	54	12	1	555
	Peak (kW)	0.1	0.2	0.2	0.3	0.4	0.5	0.6	0.6	0.5	0.4	0.2	0.1	0.6
Hospitality _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	67	58	66	60	62	63	71	74	67	64	60	66	779

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 17 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Intake-HR-A _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	106	76	81	49	9	1	0	0	0	8	58	106	494
Intake-HR-A _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	2	0	0	0	0	0	0	0	0	0	0	0	2
Intake-HR-A _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	11	20	20	39	64	142	270	271	214	121	37	12	1,223
	Peak (kW)	0.4	0.5	0.5	0.7	0.7	0.9	1.1	1.1	1.1	0.9	0.6	0.4	1.1
Intake-HR-A _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	184	166	184	178	184	178	184	184	178	184	178	184	2,169
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Intake-HR-B _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	9	6	5	2	0	0	0	0	0	0	3	8	32
Intake-HR-B _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Intake-HR-B _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	5	6	12	24	46	81	80	64	40	11	3	375
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.3	0.3	0.2	0.1	0.1	0.3
Intake-HR-B _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	48	43	48	46	48	46	48	48	46	48	46	48	562
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Kitchen _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _System 4 - 2007/2010/2013_Copy DX Heating Coil Electricity	Electric (kWh)	988	708	772	567	257	100	31	21	93	271	691	933	5,431
Kitchen _System 4 - 2007/2010/2013_Copy Electric Heating Coil Electricity	Electric (kWh)	147	33	27	0	0	0	0	0	0	0	27	116	351
Kitchen _System 4 - 2007/2010/2013_Copy SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 18 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _System 4 - 2007/2010/2013_Copy SAAHP-1 Cooling Coil Electricity	Electric (kWh)	331	412	451	692	954	1,652	2,647	2,605	2,074	1,356	629	319	14,120
	Peak (kW)	3.6	4.7	4.8	6.6	7.9	9.4	9.6	9.6	9.6	8.4	5.9	3.7	9.6
Kitchen _System 4 - 2007/2010/2013_Copy SF-1 Fan Electricity	Electric (kWh)	1,603	1,447	1,608	1,560	1,611	1,561	1,611	1,612	1,559	1,613	1,554	1,595	18,936
	Peak (kW)	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
Lounge _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	161	122	133	98	45	17	5	2	9	38	111	164	904
Lounge _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	14	3	3	0	0	0	0	0	0	0	3	7	31
Lounge _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Peak (kW)	0.5	0.6	0.6	0.7	0.8	0.9	1.1	1.1	1.1	0.9	0.7	0.5	1.1
	Electric (kWh)	17	26	25	42	56	119	227	228	182	107	42	19	1,090
Lounge _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	179	162	179	173	179	173	179	179	173	179	173	179	2,106
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Multipurpose/Dining _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	65	41	45	23	3	0	0	0	0	4	27	62	271
Multipurpose/Dining _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Multipurpose/Dining _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	8	8	27	52	125	237	236	173	96	23	3	990
	Peak (kW)	0.2	0.4	0.3	0.5	0.7	0.9	1.1	1.1	1.0	0.8	0.5	0.2	1.1
Multipurpose/Dining _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	128	113	127	114	116	116	129	135	123	119	114	127	1,461
	Peak (kW)	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
RB-N-Corner _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	6	3	2	0	0	0	0	0	0	0	1	6	18

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 19 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-N-Corner _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-Corner _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	3	4	13	30	48	78	75	58	34	7	1	351
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.3	0.3	0.2	0.1	0.1	0.3
RB-N-Corner _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	21	18	19	18	19	19	22	22	20	20	19	20	238
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	8	4	3	0	0	0	0	0	0	0	1	8	25
RB-N-East _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-East _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	6	7	22	43	86	144	139	109	64	13	1	636
	Peak (kW)	0.1	0.2	0.1	0.3	0.3	0.4	0.6	0.5	0.5	0.4	0.2	0.1	0.6
RB-N-East _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	32	28	30	29	30	31	34	34	32	31	29	32	372
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
RB-N-West _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	6	3	2	0	0	0	0	0	0	0	0	5	16
RB-N-West _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-West _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	12	16	41	89	133	212	208	169	105	24	4	1,016
	Peak (kW)	0.2	0.2	0.3	0.4	0.4	0.6	0.7	0.7	0.7	0.5	0.3	0.2	0.7
RB-N-West _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	53	46	51	49	53	54	60	60	56	54	49	52	635
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
RB-S-Corner-N _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	1	1	1	0	0	0	0	0	0	0	0	0	3

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 20 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-Corner-N _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-Corner-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	9	16	13	19	26	47	78	78	68	47	19	12	431
	Peak (kW)	0.2	0.2	0.1	0.2	0.2	0.2	0.3	0.3	0.3	0.2	0.2	0.1	0.3
RB-S-Corner-N _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	17	15	17	16	16	17	19	19	18	17	16	17	203
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	1	1	1	0	0	0	0	0	0	0	0	1	3
RB-S-Corner-S _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-Corner-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	8	15	14	20	32	48	80	82	71	48	17	11	446
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.3	0.3	0.3	0.3	0.2	0.2	0.3
RB-S-Corner-S _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	21	19	20	20	21	21	24	24	22	22	20	21	253
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	1	0	0	0	0	0	0	0	0	0	0	2
RB-S-East _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-East _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	11	27	24	45	71	123	200	198	168	115	40	17	1,039
	Peak (kW)	0.3	0.3	0.3	0.4	0.5	0.5	0.8	0.7	0.7	0.5	0.4	0.2	0.8
RB-S-East _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	40	37	41	39	42	43	48	48	46	45	40	40	508
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
RB-S-West _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	1

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 21 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-West _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-West _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	7	7	14	26	41	68	68	57	36	10	4	342
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
RB-S-West _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	16	15	16	16	17	17	19	19	18	18	16	16	205
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	6	3	2	1	0	0	0	0	0	0	1	6	19
RB-W-North _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-North _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	2	3	10	25	45	75	73	56	31	5	1	327
	Peak (kW)	0.1	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.2	0.1	0.1	0.3
RB-W-North _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	19	17	18	17	18	18	20	20	19	18	18	19	222
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	1	1	1	0	0	0	0	0	0	0	0	1	4
RB-W-South _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-South _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-South _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	34	57	44	55	86	131	216	226	205	150	61	44	1,309
	Peak (kW)	0.5	0.6	0.4	0.5	0.5	0.6	0.8	0.8	0.9	0.8	0.6	0.5	0.9
RB-W-South _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	54	48	53	52	55	55	62	63	59	57	52	53	663
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Servery _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	27	16	19	9	1	0	0	0	0	1	10	26	109

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 22 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Servery _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Servery _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	4	3	12	24	58	111	111	82	46	10	1	463
	Peak (kW)	0.1	0.2	0.1	0.2	0.3	0.4	0.5	0.5	0.5	0.4	0.2	0.1	0.5
Servery _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	56	50	56	52	53	54	60	63	57	56	51	56	664
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
SHWR-N _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	95	69	72	43	9	1	0	0	0	10	55	98	452
SHWR-N _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	36	11	8	0	0	0	0	0	0	0	10	27	92
SHWR-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	2	1	10	16	56	130	124	88	40	7	0	473
	Peak (kW)	0.0	0.1	0.1	0.3	0.4	0.4	0.5	0.5	0.5	0.4	0.2	0.0	0.5
SHWR-N _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	27	24	27	26	27	26	27	27	26	27	26	27	314
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	97	70	75	50	12	2	0	0	1	12	60	100	478
SHWR-S _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	36	10	8	0	0	0	0	0	0	0	11	25	91
SHWR-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	3	3	12	21	61	139	136	99	48	10	1	534

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 23 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.2	0.2	0.3	0.4	0.5	0.5	0.5	0.5	0.5	0.3	0.1	0.5
SHWR-S _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	31	28	31	30	31	30	31	31	30	31	30	31	369
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _System 2 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	86	62	64	38	6	0	0	0	0	8	50	89	403
SHWR-W _System 2 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	30	9	6	0	0	0	0	0	0	0	9	21	75
SHWR-W _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _System 2 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Peak (kW)	0.0	0.1	0.1	0.3	0.3	0.4	0.4	0.4	0.4	0.4	0.2	0.0	0.4
	Electric (kWh)	0	1	1	8	16	53	124	119	83	38	6	0	449
SHWR-W _System 2 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	25	23	25	24	25	24	25	25	24	25	24	25	298
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Support _System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Support _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	6	11	9	21	32	81	148	149	127	82	21	8	694
	Peak (kW)	0.6	0.6	0.4	0.6	0.6	0.7	0.9	0.9	0.9	0.9	0.7	0.5	0.9
Support _System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	11	20	20	37	54	101	147	149	127	100	38	17	821
	Peak (kW)	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
System 10 - 2010/2013 DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
System 10 - 2010/2013 Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
System 10 - 2010/2013 SF-1 Fan Electricity	Electric (kWh)	10	9	10	10	11	12	14	14	13	11	10	10	132

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:54 PM

214

Page 24 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility_EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility_System 4 - 2007/2010/2013 DX Heating Coil Electricity	Electric (kWh)	239	158	164	71	4	0	0	0	0	0	80	219	936
Utility_System 4 - 2007/2010/2013 Electric Heating Coil Electricity	Electric (kWh)	1	0	0	0	0	0	0	0	0	0	0	0	1
Utility_System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility_System 4 - 2007/2010/2013 SAAHP-1 Cooling Coil Electricity	Electric (kWh)	20	41	41	110	230	518	967	971	769	443	106	22	4,237
	Peak (kW)	1.1	1.5	1.3	2.0	2.3	3.1	3.6	3.7	3.7	3.0	1.8	1.2	3.7
Utility_System 4 - 2007/2010/2013 SF-1 Fan Electricity	Electric (kWh)	629	568	629	609	629	609	629	629	609	629	609	629	7,404
	Peak (kW)	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8

***** This report currently does not comprise the total energy consumption for some equipment selections.
VRF, primary boiler electricity, and ancillary energy consumptions are not displayed in the report.
Please contact cdshep@trane.com for any additional questions***.**

LEED Energy Performance Summary Report

Section 1.1 - General Information

Simulation Program	TRACE® 3D Plus
Energy Code	LEED V4 / ASHRAE 90.1-2010
PRM Baseline Alternative	ASHRAE 90.1-2010 Baseline
Building Type	Non-Residential
New Construction Percent	100 %
Existing Renovation Percent	0 %
Quantity of Floors	1
Climate Zone	3 B-Dry
Principle Heating Source	Fossil/Electric Hybrid
ASHRAE Lighting Compliance	Space-By-Space Method
Construction Types	
Windows	Nonmetal Framing (All)
Skylights	With Curb, Glass, 0-2.0%
Doors	Swinging
Rotate 90.1 Baseline Building?	Yes
Total gross floor area	21102.5 ft²
Weather File	ASHRAE 90.1-2010 BASELINE ** Climate Zone 10 CA USA CTZRV2 WMO#=722860
Heating Degree Days	1674
Cooling Degree Days	5022
HDD and CDD data source	Weather File Stat

Section 1.2 - SpaceSummary

Table EAp2-1 - Space Usage Type

Space Name / Building Use (Occupancy Type)	Space Area (ft²)	Regularly Occupied Area (ft²)	Unconditioned Area (ft²)	Typical Hours in Operation per Week (hr/wk)
ACT-Noisy-1	179.6	179.6	0	88.4
ACT-Noisy-2	180.8	180.8	0	88.4
ACT-Noisy-3	182.1	182.1	0	88.4
ACT-Quiet-1	130.4	130.4	0	88.4
ACT-Quiet-2	130.7	130.7	0	88.4
ACT-Quiet-3	131.1	131.1	0	88.4
Admin	189.3	189.3	0	168
Attrium	1266.7	1266.7	0	168
Chart/Hotel	199.6	199.6	0	168
Comfort/Consult	283.4	283.4	0	168
Corridor-N	409	409	0	0
Corridor-S	414	414	0	0
Corridor-W	324	324	0	0
Entry/Waiting	370.5	370.5	0	168
Exam/Storage	223.7	223.7	0	168
Fire Room	79.2	79.2	0	0
Group	276.4	276.4	0	103.1
Hospitality	246.1	246.1	0	103.1
Intake-HR-A	470.5	470.5	0	168
Intake-HR-B	164.6	164.6	0	168
Kitchen	685.6	685.6	0	168
Lounge	296.8	296.8	0	168
Multipurpose/Dining	485.5	485.5	0	103.1
RB-N-Corner	130.5	130.5	0	112

Section 1.2 - SpaceSummary

Table EAp2-1 - Space Usage Type

Space Name / Building Use (Occupancy Type)	Space Area (ft²)	Regularly Occupied Area (ft²)	Unconditioned Area (ft²)	Typical Hours in Operation per Week (hr/wk)
RB-N-East	257	257	0	112
RB-N-West	382.5	382.5	0	112
RB-S-Corner-N	129.1	129.1	0	112
RB-S-Corner-S	131.2	131.2	0	112
RB-S-East	371.9	371.9	0	112
RB-S-West	124	124	0	112
RB-W-North	129.8	129.8	0	112
RB-W-South	379.5	379.5	0	112
Servery	228.2	228.2	0	103.1
SHWR-N	203.7	203.7	0	168
SHWR-S	207.2	207.2	0	168
SHWR-W	207.1	207.1	0	168
Support	524.2	524.2	0	0
Room 00-80	3.9	0	3.9	0
Room 00-81	3.3	0	3.3	103.1
Room 01-00	633.7	0	633.7	0
Room 01-01	748.1	0	748.1	0
Room 01-03	1000.7	0	1000.7	0
Room 01-04	959.3	0	959.3	0
Room 01-06	1009.2	0	1009.2	0
Room 01-08	1572.2	0	1572.2	0
Room 01-10	769.1	0	769.1	0
Room 01-12	675.1	0	675.1	0
Trash	76.2	0	76.2	168

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 11, 2026 - 10:50 PM

214

Page 3 of 17

Space Name / Building Use (Occupancy Type)	Space Area (ft²)	Regularly Occupied Area (ft²)	Unconditioned Area (ft²)	Typical Hours in Operation per Week (hr/wk)
Utility	2926.5	2926.5	0	168
Totals	21102.6	13651.9	7450.8	

Section 1.3 - Advisory Messages

Table EAp2-2 - Advisory Messages

	Baseline 0°	Proposed Design
Number of Unmet Cooling Hours	1565.00	547.00
Number of Unmet Heating Hours	0.00	105.00
Total	1565.00	652.00

Section 1.4 - Comparison of Proposed Design Versus Baseline Design Inputs

Input Parameter	Proposed Design Input	Baseline Design Input
Roof Construction	Casa - Roof - Single Ply over Tapered Insulation UFactor : 0.026 Btu/(hr·ft²·°F)	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3 UFactor : 0.047 Btu/(hr·ft²·°F) Reflectivity : 0.30
Above Grade Wall Construction	Casa - Ext Wall - Wood Framed UFactor : 0.046 Btu/(hr·ft²·°F)	90.1-10 Min Wall, Steel Framed Zone 3 UFactor : 0.084 Btu/(hr·ft²·°F)
Exposed Floor Constructions	90.1-13 Min Floors, Steel Joist Zone 5 UFactor : 0.038 Btu/(hr·ft²·°F)	90.1-10 Min Floors, Steel Joist Zone 3 UFactor : 0.053 Btu/(hr·ft²·°F)
Slab on Grade Floors	Casa - Slab on Grade	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5
Vertical Glazing Doors	Casa - Ext Door Swinging UFactor : 0.579 Btu/(hr·ft²·°F)	90.1-10 Min Swinging Nonres Zone 1-6 UFactor : 0.756 Btu/(hr·ft²·°F)
Vertical Glazing Windows	90.1-13 Window Zone 4-6 Metal Oper UFactor : 0.501 Btu/(hr·ft²·°F) SHGC : 0.401 Visual Light Transmittance : 0.442	90.1-10 Window Zone 3A/B Nonmetal Frame UFactor : 0.651 Btu/(hr·ft²·°F) SHGC : 0.252 Visual Light Transmittance : 0.319
Skylight to Roof Ratio	Total : 0 %	Total : 0 %
Vertical fenestration to wall ratio	Total : 7.05 %	Total : 7.05 %

Section 1.4 - Comparison of Proposed Design Versus Baseline Design Inputs

Input Parameter	Proposed Design Input	Baseline Design Input
Interior Lighting Power Density	Lighting Compliance: Space-By-Space Method Daylighting controls: No Building total: 0.46 w/ft ²	Lighting Compliance: Space-By-Space Method Daylighting controls: No Building total: 0.54 w/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Atrium Space Type: 90.1-13 Lobby - Hotel Space Type Area: 1637.1 ft ² Density: 0.6 W/ft ²	Room Type: PRTF – Atrium Space Type: 90.1-10 Lobby - All Other Lobbies Space Type Area: 1637.1 ft ² Density: 0.9 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Resident Activity Space Type: 90.1-13 Conference/Meeting Space Type Area: 934.75 ft ² Density: 1 W/ft ²	Room Type: PRTF – Office/Admin Space Type: 90.1-10 Office - Enclosed Space Type Area: 388.94 ft ² Density: 1.11 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – MEP Room Space Type: 90.1-13 Electrical/Mechanical Room Space Type Area: 761.38 ft ² Density: 0.5 W/ft ²	Room Type: PRTF – Utility/Storage Space Type: 90.1-10 Storage Space Type Area: 1230.26 ft ² Density: 0.63 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Corridor Space Type: 90.1-13 Corridor - All Other Corridors Space Type Area: 3211.07 ft ² Density: 0.4 W/ft ²	Room Type: PRTF – Resident Bedroom Space Type: 90.1-10 Dormitory - Living Quarters Space Type Area: 2035.41 ft ² Density: 0.38 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Toilet Room Space Type: 90.1-13 Restroom - All Other Restrooms Space Type Area: 987.3 ft ² Density: 0.5 W/ft ²	Room Type: PRTF – Resident Activity Space Type: 90.1-10 Lounge/Recreation Space Type Area: 934.75 ft ² Density: 0.73 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Resident Bedroom Space Type: 90.1-13 Dining Area - All Other Dining Space Type Area: 2035.41 ft ² Density: 1.2 W/ft ²	Room Type: PRTF – Corridor Space Type: 90.1-10 Hospital - Corridor/Transition Space Type Area: 3211.07 ft ² Density: 0.89 W/ft ²

Section 1.4 - Comparison of Proposed Design Versus Baseline Design Inputs

Input Parameter	Proposed Design Input	Baseline Design Input
Interior Lighting Power Density - Space Types	Room Type: PRTF – Kitchen Space Type: 90.1-13 Lobby - Elevator Space Type Area: 382 ft ² Density: 0.64 W/ft ²	Room Type: PRTF – Assembly/Dining Space Type: 90.1-10 Dining Area - Family Dining Space Type Area: 1437.25 ft ² Density: 0.89 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Utility/Storage Space Type: 90.1-13 Electrical/Mechanical Room Space Type Area: 1230.26 ft ² Density: 0.5 W/ft ²	Room Type: PRTF – MEP Room Space Type: 90.1-10 Electrical/Mechanical Space Type Area: 761.38 ft ² Density: 0.95 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Assembly/Dining Space Type: 90.1-13 Lounge/Breakroom - All Other Lounges/Breakrooms Space Type Area: 1437.25 ft ² Density: 0.75 W/ft ²	Room Type: PRTF – Toilet Room Space Type: 90.1-10 Restrooms Space Type Area: 987.3 ft ² Density: 0.98 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Exam/Treatment Space Type: 90.1-13 Electrical/Mechanical Room Space Type Area: 725.86 ft ² Density: 1.2 W/ft ²	Room Type: PRTF – Exam/Treatment Space Type: 90.1-10 Hospital - Exam/Treatment Space Type Area: 725.86 ft ² Density: 1.66 W/ft ²
Interior Lighting Power Density - Space Types	Room Type: PRTF – Office/Admin Space Type: 90.1-13 Electrical/Mechanical Room Space Type Area: 388.94 ft ² Density: 0.7 W/ft ²	Room Type: PRTF – Kitchen Space Type: 90.1-10 Food Preparation Space Type Area: 382 ft ² Density: 0.64 W/ft ²
Receptacle Equipment Total Power	Total Power: 14514.5 W	Total Power: 14514.5 W
Receptacle Equipment	Room Type: PRTF – Atrium Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 1637.1 ft ²	Room Type: PRTF – Atrium Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 1637.1 ft ²
Receptacle Equipment	Room Type: PRTF – Resident Activity Space Type: Small Hotel - Plug Loads (Whole Building)	Room Type: PRTF – Office/Admin Space Type: Casa - Office/Admin

Section 1.4 - Comparison of Proposed Design Versus Baseline Design Inputs

Input Parameter	Proposed Design Input	Baseline Design Input
	Space Type Area: 934.75 ft ² Density: 0.5 W/ft ²	Space Type Area: 388.94 ft ² Density: 1 W/ft ²
Receptacle Equipment	Room Type: PRTF – MEP Room Space Type: Casa - MEP Space Type Area: 761.38 ft ² Density: 2 W/ft ²	Room Type: PRTF – Utility/Storage Space Type: Casa - Office/Admin Space Type Area: 1230.26 ft ² Density: 0.25 W/ft ²
Receptacle Equipment	Room Type: PRTF – Toilet Room Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 987.3 ft ²	Room Type: PRTF – Resident Bedroom Space Type: Small Hotel Dining Elec - Plug Loads Space Type Area: 2035.41 ft ² Density: 2 W/ft ²
Receptacle Equipment	Room Type: PRTF – Resident Bedroom Space Type: Small Hotel Dining Elec - Plug Loads Space Type Area: 2035.41 ft ² Density: 2 W/ft ²	Room Type: PRTF – Resident Activity Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 934.75 ft ² Density: 0.5 W/ft ²
Receptacle Equipment	Room Type: PRTF – Kitchen Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 382 ft ² Density: 17 W/ft ²	Room Type: PRTF – Assembly/Dining Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 1437.25 ft ² Density: 0.5 W/ft ²
Receptacle Equipment	Room Type: PRTF – Utility/Storage Space Type: Casa - Office/Admin Space Type Area: 1230.26 ft ² Density: 0.25 W/ft ²	Room Type: PRTF – MEP Room Space Type: Casa - MEP Space Type Area: 761.38 ft ² Density: 2 W/ft ²
Receptacle Equipment	Room Type: PRTF – Assembly/Dining Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 1437.25 ft ² Density: 0.5 W/ft ²	Room Type: PRTF – Toilet Room Space Type: Small Hotel - Plug Loads (Whole Building) Space Type Area: 987.3 ft ²
Receptacle Equipment	Room Type: PRTF – Exam/Treatment Space Type: Small Hotel - Plug Loads (Whole Building)	Room Type: PRTF – Exam/Treatment Space Type: Small Hotel - Plug Loads (Whole Building)

Section 1.4 - Comparison of Proposed Design Versus Baseline Design Inputs

Input Parameter	Proposed Design Input	Baseline Design Input
	Space Type Area: 725.86 ft ² Density: 0.75 W/ft ²	Space Type Area: 725.86 ft ² Density: 0.75 W/ft ²
Receptacle Equipment	Room Type: PRTF – Office/Admin	Room Type: PRTF – Kitchen
	Space Type: Casa - Office/Admin	Space Type: Small Hotel - Plug Loads (Whole Building)
	Space Type Area: 388.94 ft ² Density: 1 W/ft ²	Space Type Area: 382 ft ² Density: 17 W/ft ²

Baseline PRM Fan Power		
Airside System	System Name: System 10 - 2010/2013 Allowed Fan Power :0.02 kW Zone: System 10 - 2010/2013 SF-1 Fan power: 0.02 kW Air Flow: 74.72 cfm	
Airside System	System Name: System 2 - 2007/2010/2013 Allowed Fan Power :0.96 kW Zone: Atrium _System 2 - 2007/2010/2013 SF-1 Fan power: 0.17 kW Air Flow: 566.55 cfm Zone: Corridor-N _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 118.10 cfm Zone: Corridor-S _System 2 - 2007/2010/2013 SF-1 Fan power: 0.05 kW Air Flow: 176.63 cfm Zone: Corridor-W _System 2 - 2007/2010/2013 SF-1 Fan power: 0.06 kW Air Flow: 210.48 cfm Zone: RB-N-Corner _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 125.77 cfm Zone: RB-N-East _System 2 - 2007/2010/2013 SF-1 Fan power: 0.06 kW Air Flow: 198.02 cfm Zone: RB-N-West _System 2 - 2007/2010/2013 SF-1 Fan power: 0.10 kW Air Flow: 335.69 cfm Zone: RB-S-Corner-N _System 2 - 2007/2010/2013 SF-1 Fan power: 0.03 kW Air Flow: 109.36 cfm Zone: RB-S-Corner-S _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 135.82 cfm Zone: RB-S-East _System 2 - 2007/2010/2013 SF-1 Fan power: 0.08 kW Air Flow: 270.42 cfm Zone: RB-S-West _System 2 - 2007/2010/2013 SF-1 Fan power: 0.03 kW Air Flow: 109.24 cfm Zone: RB-W-North _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 118.10 cfm Zone: RB-W-South _System 2 - 2007/2010/2013 SF-1 Fan power: 0.11 kW Air Flow: 355.15 cfm Zone: SHWR-N _EXHAUST FAN <z> Fan power: N/A Air Flow: 407.26 cfm Zone: SHWR-N _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 119.65 cfm Zone: SHWR-S _EXHAUST FAN <z> Fan power: N/A Air Flow: 414.35 cfm Zone: SHWR-S _System 2 - 2007/2010/2013 SF-1 Fan power: 0.04 kW Air Flow: 140.58 cfm Zone: SHWR-W _EXHAUST FAN <z> Fan power: N/A Air Flow: 414.17 cfm Zone: SHWR-W _System 2 - 2007/2010/2013 SF-1 Fan power: 0.03 kW Air Flow: 113.26 cfm	
Airside System	System Name: System 4 - 2007/2010/2013 Allowed Fan Power :3.71 kW Zone: ACT-Noisy-1 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.15 kW Air Flow: 182.95 cfm Zone: ACT-Noisy-2 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.09 kW Air Flow: 106.56 cfm Zone: ACT-Noisy-3 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.09 kW Air Flow: 112.14 cfm Zone: ACT-Quiet-1 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.05 kW Air Flow: 63.82 cfm Zone: ACT-Quiet-2 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.07 kW Air Flow: 83.80 cfm Zone: ACT-Quiet-3 _System 4 - 2007/2010/2013 SF-1 Fan power: 0.07 kW Air Flow: 90.59 cfm Zone: Admin _System 4 - 2007/2010/2013 SF-1 Fan power: 0.14 kW Air Flow: 165.33 cfm Zone: Chart/Hotel _System 4 - 2007/2010/2013 SF-1 Fan power: 0.06 kW Air Flow: 78.94 cfm Zone: Comfort/Consult _System 4 - 2007/2010/2013 SF-1 Fan power: 0.15 kW Air Flow: 177.68 cfm Zone: Entry/Waiting _System 4 - 2007/2010/2013 SF-1 Fan power: 0.43 kW Air Flow: 523.55 cfm Zone: Exam/Storage _System 4 - 2007/2010/2013 SF-1 Fan power: 0.08 kW Air Flow: 97.42 cfm Zone: Group _System 4 - 2007/2010/2013 SF-1 Fan power: 0.15 kW Air Flow: 182.24 cfm	

Baseline PRM Fan Power

	Zone: Hospitality _System 4 - 2007/2010/2013 SF-1 Fan power: 0.13 kW Air Flow: 164.29 cfm Zone: Intake-HR-A _EXHAUST FAN <z> Fan power: N/A Air Flow: 160.24 cfm Zone: Intake-HR-A _System 4 - 2007/2010/2013 SF-1 Fan power: 0.25 kW Air Flow: 302.04 cfm Zone: Intake-HR-B _System 4 - 2007/2010/2013 SF-1 Fan power: 0.06 kW Air Flow: 78.25 cfm Zone: Lounge _EXHAUST FAN <z> Fan power: N/A Air Flow: 197.86 cfm Zone: Lounge _System 4 - 2007/2010/2013 SF-1 Fan power: 0.24 kW Air Flow: 293.23 cfm Zone: Multipurpose/Dining _System 4 - 2007/2010/2013 SF-1 Fan power: 0.25 kW Air Flow: 307.91 cfm Zone: Servery _System 4 - 2007/2010/2013 SF-1 Fan power: 0.12 kW Air Flow: 141.31 cfm Zone: Support _System 4 - 2007/2010/2013 SF-1 Fan power: 0.28 kW Air Flow: 339.79 cfm Zone: Utility _EXHAUST FAN <z> Fan power: N/A Air Flow: 477.48 cfm Zone: Utility _System 4 - 2007/2010/2013 SF-1 Fan power: 0.85 kW Air Flow: 1,030.85 cfm
Airside System	System Name: System 4 - 2007/2010/2013_Copy Allowed Fan Power :2.19 kW Zone: Kitchen _EXHAUST FAN <z> Fan power: N/A Air Flow: 2,500.00 cfm Zone: Kitchen _System 4 - 2007/2010/2013_Copy SF-1 Fan power: 2.19 kW Air Flow: 2,800.78 cfm

Section 1.5 - Energy Type Summary

Table EAp2-3

Energy Type	Utility Rate Description	Baseline Virtual Rate (\$ per unit energy)	Proposed Virtual Rate (\$ per unit energy)	Units of Energy	Units of Demand
Electricity	Sample With All Utilities_Elec	0.125	0.124	kWh	kW
Natural Gas		0	0		
Other		0	0		

Section 1.6 - Performance Rating Method Compliance Report

Table EAp2-4 - Baseline Performance

End Use	Process?	Energy Type	Units of Annual Energy Use & Peak Demand		Baseline 0°	Baseline 90°	Baseline 180°	Baseline 270°	Baseline Building Results
Cooling -- General	No	Electricity	Use	kWh	42524	42508	41189	41285	41876
			Demand	kW	30.3	30.4	29.8	29.8	30.1
Fans -- General	No	Electricity	Use	kWh	51912	52560	50581	49866	51230
			Demand	kW	6.9	7	6.8	6.7	6.8
Heating -- General	No	Electricity	Use	kWh	10991	11139	11507	11307	11236
			Demand	kW	29.1	29.4	30.7	30.5	29.9
Interior Equipment -- General	Yes	Electricity	Use	kWh	52779	52779	52779	52779	52779
			Demand	kW	10.9	10.9	10.9	10.9	10.9
Interior Lighting -- General	No	Electricity	Use	kWh	44951	44951	44951	44951	44951
			Demand	kW	10.4	10.4	10.4	10.4	10.4
Total Energy Use (MMBtu/year)					693	696	686	683	689
Annual Process Energy (MMBtu/year)					180				

Table EAp2-5 - Performance Rating

		Baseline				Proposed					
End Use	Process?	Energy Type	Units of Annual Energy Use & Peak Demand		Building Results	Energy Type	Units of Annual Energy Use & Peak Demand		Building Results	Percent Savings	
Cooling -- General	No	Electricity	Use	kWh	41876	Electricity	Use	kWh	36227	13.5 %	
			Demand	kW	30.1		Demand	kW	19.4		
Fans -- General	No	Electricity	Use	kWh	51230	Electricity	Use	kWh	21454	58.1 %	
			Demand	kW	6.8		Demand	kW	2.7		
Heating -- General	No	Electricity	Use	kWh	11236	Electricity	Use	kWh	70685	-529.1 %	
			Demand	kW	29.9		Demand	kW	37.8		
Interior Equipment General	Yes	Electricity	Use	kWh	52779	Electricity	Use	kWh	52779	0 %	
			Demand	kW	10.9		Demand	kW	10.9		
Interior Lighting General	No	Electricity	Use	kWh	44951	Electricity	Use	kWh	36568	18.6 %	
			Demand	kW	10.4		Demand	kW	8.8		
Total Energy Use (MMBtu/year)					689					743	108 %
Annual Process Energy (MMBtu/year)					180						

Table EAp2-6 - Energy Use Summary

Energy Type	Units	Baseline		Proposed Energy Use	
		Process Subtotal Energy	Total Energy Use	Process Subtotal Energy	Total Energy Use
Electricity	kWh	52777.82	202071.69	52777.82	217714.07
Natural Gas	therm	0	0	0	0
Additional	kWh	0	0	0	0
Total	MMBtu	180.13	689.67	180.13	743.06

Table EAp2-7 - Energy Cost Summary

EnergyType	Baseline		Proposed Energy Cost
	Process Subtotal Cost	Total Energy Cost	Total Energy Cost
Electricity	6630.42	25385.3	26967.79
Natural Gas	0	0	0
Additional	0	0	0
Other	0	0	0
Total	6630.42	25385.3	26967.79

Proposed building economic cost improvement over baseline building: -6%

Section 1.9B - Reports and Metrics

Table EAp2-17 - Energy Use Intensity

		Baseline EUI	Proposed EUI
Electricity (kWh/ft²)	Fans (All)	2.43	1.02
	Interior Lighting (All)	2.13	1.73
	Miscellaneous (All)	9.57	10.31
	Receptacle Equipment	2.5	2.5
	Service Water Heating	0	0
	Space Cooling	1.98	1.72
	Space Heating	0.53	3.35
	Subtotal	9.57	10.31
Natural Gas (kWh/ft²)	Miscellaneous (All)	0	0
	Service Water Heating	0	0
	Space Heating	0	0
	Subtotal	0	0
Other (kWh/ft²)	Miscellaneous	0	0
	Subtotal	0	0

Table EAp2-18 - End Use Energy Percentage

	Baseline %	Proposed %	End Use Energy Saving %
Fans (All)	25.35	9.85	-190.36
Interior Lighting (All)	22.25	16.8	-53.59
Miscellaneous	0	0	0
Receptacle Equipment	26.12	24.24	0.01
Service Water Heating	0	0	0
Space Cooling	20.72	16.64	-36.12
Space Heating	5.56	32.47	380.05

Entered Values Envelope

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Attrium - Wall 756	Gypsum, Gypsum	☐	0.280		50.6	.0	N	☐
Attrium - Wall 757	Casa - Ext Wall - Wood Framed	☐	0.046		31.5	270.0	W	☐
Attrium - Wall 758	Casa - Ext Wall - Wood Framed	☐	0.046		25.1	270.0	W	☐
Attrium - Wall 759	Gypsum, Gypsum	☐	0.280		49.9	.0	N	☐
Attrium - Wall 760	Casa - Ext Wall - Wood Framed	☐	0.046		21.0	180.0	S	☐
Attrium - Wall 761	Casa - Ext Wall - Wood Framed	☐	0.046		39.0	180.0	S	☐
Attrium - Wall 762	Casa - Ext Wall - Wood Framed	☐	0.046		156.0	90.0	E	☐
Attrium - Wall 764	Casa - Ext Wall - Wood Framed	☐	0.046		23.8	.0	N	☐
Attrium - Wall 771	Casa - Ext Wall - Wood Framed	☐	0.046		35.3	.0	N	☐
Attrium 2 - Wall 726	Casa - Ext Wall - Wood Framed	☐	0.046		179.4	180.0	S	☐
Attrium 2 - Wall 727	Casa - Ext Wall - Wood Framed	☐	0.046		178.0	90.0	E	☐
Attrium 2 - Wall 728	Casa - Ext Wall - Wood Framed	☐	0.046		179.4	.0	N	☐
Attrium 2 - Wall 729	Casa - Ext Wall - Wood Framed	☐	0.046		178.0	270.0	W	☐
Comfort Room 1 - Wall 839	Casa - Ext Wall - Wood Framed	☐	0.046		26.9	90.0	E	☐
Comfort Room 2 - Wall 208	Casa - Ext Wall - Wood Framed	☐	0.046		103.5	.0	N	☐
Consult 1 - Wall 119	Casa - Ext Wall - Wood Framed	☐	0.046		115.5	.0	N	☐
Consult 2 - Wall 122	Casa - Ext Wall - Wood Framed	☐	0.046		117.1	.0	N	☐
Corridor 3 - Wall 424	Casa - Ext Wall - Wood Framed	☐	0.046		100.4	.0	N	☐
Corridor 4 - Wall 412	Casa - Ext Wall - Wood Framed	☐	0.046		99.6	270.0	W	☐
Corridor 5 - Wall 402	Casa - Ext Wall - Wood Framed	☐	0.046		101.2	180.0	S	☐
Electric - Wall 40	Casa - Ext Wall - Wood Framed	☐	0.046		229.9	180.0	S	☐
Electric - Wall 835	Casa - Ext Wall - Wood Framed	☐	0.046		128.5	90.0	E	☐
Emergency Electric - Wall 836	Casa - Ext Wall - Wood Framed	☐	0.046		121.0	90.0	E	☐
Entry/Waiting - Wall 311	Casa - Ext Wall - Wood Framed	☐	0.046		108.1	180.0	S	☐
Entry/Waiting - Wall 312	Casa - Ext Wall - Wood Framed	☐	0.046		381.1	90.0	E	☐
Entry/Waiting - Wall 313	Casa - Ext Wall - Wood Framed	☐	0.046		135.8	.0	N	☐
Fire Room - Wall 838	Casa - Ext Wall - Wood Framed	☐	0.046		117.7	90.0	E	☐
Group - Wall 111	Casa - Ext Wall - Wood Framed	☐	0.046		202.5	.0	N	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Group - Wall 112	Casa - Ext Wall - Wood Framed	☐	0.046		92.7	270.0	W	☐
Hospitality - Wall 13	Casa - Ext Wall - Wood Framed	☐	0.046		164.0	.0	N	☐
Hospitality - Wall 306	Casa - Ext Wall - Wood Framed	☐	0.046		96.0	90.0	E	☐
Interview Room - Wall 26	Casa - Ext Wall - Wood Framed	☐	0.046		182.7	90.0	E	☐
Interview Room - Wall 840	Casa - Ext Wall - Wood Framed	☐	0.046		130.3	180.0	S	☐
Kitchen - Wall 170	Casa - Ext Wall - Wood Framed	☐	0.046		217.8	270.0	W	☐
Lounge - Wall 155	Casa - Ext Wall - Wood Framed	☐	0.046		218.0	180.0	S	☐
Mechanical - Wall 837	Casa - Ext Wall - Wood Framed	☐	0.046		63.7	90.0	E	☐
Multipurpose/Dining - Wall 106	Casa - Ext Wall - Wood Framed	☐	0.046		322.5	.0	N	☐
Noisy Activity 1 - Wall 213	Casa - Ext Wall - Wood Framed	☐	0.046		174.4	270.0	W	☐
Noisy Activity 2 - Wall 260	Casa - Ext Wall - Wood Framed	☐	0.046		92.1	.0	N	☐
Noisy Activity 3 - Wall 301	Casa - Ext Wall - Wood Framed	☐	0.046		161.4	90.6	E	☐
Office 1 - Wall 151	Casa - Ext Wall - Wood Framed	☐	0.046		107.0	180.0	S	☐
Office 2 - Wall 147	Casa - Ext Wall - Wood Framed	☐	0.046		108.0	180.0	S	☐
Quiet Activity 2 - Wall 232	Casa - Ext Wall - Wood Framed	☐	0.046		48.0	180.0	S	☐
Quiet Activity 3 - Wall 265	Casa - Ext Wall - Wood Framed	☐	0.046		128.1	270.0	W	☐
Resident Room 01 - Wall 142	Casa - Ext Wall - Wood Framed	☐	0.046		80.0	90.0	E	☐
Resident Room 02 - Wall 195	Casa - Ext Wall - Wood Framed	☐	0.046		112.5	90.0	E	☐
Resident Room 03 - Wall 199	Casa - Ext Wall - Wood Framed	☐	0.046		136.0	90.0	E	☐
Resident Room 04 - Wall 202	Casa - Ext Wall - Wood Framed	☐	0.046		157.0	180.0	S	☐
Resident Room 04 - Wall 203	Casa - Ext Wall - Wood Framed	☐	0.046		129.0	90.0	E	☐
Resident Room 05 - Wall 227	Casa - Ext Wall - Wood Framed	☐	0.046		159.6	180.0	S	☐
Resident Room 05 - Wall 229	Casa - Ext Wall - Wood Framed	☐	0.046		129.0	270.0	W	☐
Resident Room 06 - Wall 225	Casa - Ext Wall - Wood Framed	☐	0.046		122.2	270.0	W	☐
Resident Room 07 - Wall 236	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	180.0	S	☐
Resident Room 08 - Wall 239	Casa - Ext Wall - Wood Framed	☐	0.046		124.9	180.0	S	☐
Resident Room 09 - Wall 242	Casa - Ext Wall - Wood Framed	☐	0.046		126.4	180.0	S	☐
Resident Room 09 - Wall 244	Casa - Ext Wall - Wood Framed	☐	0.046		158.9	270.0	W	☐
Resident Room 10 - Wall 247	Casa - Ext Wall - Wood Framed	☐	0.046		126.4	.0	N	☐
Resident Room 10 - Wall 248	Casa - Ext Wall - Wood Framed	☐	0.046		161.2	270.0	W	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Resident Room 11 - Wall 269	Casa - Ext Wall - Wood Framed	☐	0.046		126.2	270.0	W	☐
Resident Room 12 - Wall 273	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 13 - Wall 277	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 14 - Wall 280	Casa - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 14 - Wall 281	Casa - Ext Wall - Wood Framed	☐	0.046		127.5	270.0	W	☐
Resident Room 15 - Wall 283	Casa - Ext Wall - Wood Framed	☐	0.046		127.5	90.0	E	☐
Resident Room 15 - Wall 284	Casa - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 16 - Wall 288	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	90.0	E	☐
Room 00-80 - Wall 842	Casa - Ext Wall - Wood Framed	☐	0.046		126.8	180.0	S	☐
Room 00-80 - Wall 843	Casa - Ext Wall - Wood Framed	☐	0.046		57.9	90.0	E	☐
Room 00-80 - Wall 846	Casa - Ext Wall - Wood Framed	☐	0.046		111.6	359.5	N	☐
Room 00-80 - Wall 849	Casa - Ext Wall - Wood Framed	☐	0.046		14.8	.0	N	☐
Room 00-80 - Wall 850 - Copy	Casa - Ext Wall - Wood Framed	☐	0.046		50.6	270.4	W	☐
Room 00-81 - Wall 851	Casa - Ext Wall - Wood Framed	☐	0.046		27.6	180.0	S	☐
Room 00-81 - Wall 852	Casa - Ext Wall - Wood Framed	☐	0.046		16.4	270.4	W	☐
Room 00-81 - Wall 853	Casa - Ext Wall - Wood Framed	☐	0.046		18.7	180.0	S	☐
Room 00-81 - Wall 854	Casa - Ext Wall - Wood Framed	☐	0.046		29.1	90.0	E	☐
Room 00-81 - Wall 855	Casa - Ext Wall - Wood Framed	☐	0.046		45.9	.4	N	☐
Room 00-81 - Wall 856	Casa - Ext Wall - Wood Framed	☐	0.046		13.1	271.7	W	☐
Room 01-00 - Wall 566	Casa - Ext Wall - Wood Framed	☐	0.046		5.7	.0	N	☐
Room 01-00 - Wall 567	Casa - Ext Wall - Wood Framed	☐	0.046		44.8	270.0	W	☐
Room 01-00 - Wall 569	Gypsum, Gypsum	☐	0.280		244.1	.0	N	☐
Room 01-00 - Wall 733	Casa - Ext Wall - Wood Framed	☐	0.046		0.4	22.7	NE	☐
Room 01-01 - Wall 570	Casa - Ext Wall - Wood Framed	☐	0.046		0.0	180.0	S	☐
Room 01-01 - Wall 572	Casa - Ext Wall - Wood Framed	☐	0.046		57.0	270.0	W	☐
Room 01-03 - Wall 584	Casa - Ext Wall - Wood Framed	☐	0.046		53.8	180.0	S	☐
Room 01-03 - Wall 735	Gypsum, Gypsum	☐	0.280		6.6	.0	N	☐
Room 01-03 - Wall 736	Casa - Ext Wall - Wood Framed	☐	0.046		0.8	316.5	NW	☐
Room 01-03 - Wall 737	Gypsum, Gypsum	☐	0.280		2.8	.0	N	☐
Room 01-03 - Wall 738	Casa - Ext Wall - Wood Framed	☐	0.046		0.3	316.5	NW	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Room 01-04 - Wall 589	Casa - Ext Wall - Wood Framed	☐	0.046		50.6	180.0	S	☐
Room 01-04 - Wall 654	Casa - Ext Wall - Wood Framed	☐	0.046		0.8	.0	N	☐
Room 01-06 - Wall 612	Casa - Ext Wall - Wood Framed	☐	0.046		57.4	.0	N	☐
Room 01-06 - Wall 730	Casa - Ext Wall - Wood Framed	☐	0.046		0.1	202.7	SW	☐
Room 01-06 - Wall 731	Casa - Ext Wall - Wood Framed	☐	0.046		2.0	199.1	S	☐
Room 01-08 - Wall 773	Casa - Ext Wall - Wood Framed	☐	0.046		22.5	270.0	W	☐
Room 01-08 - Wall 777	Casa - Ext Wall - Wood Framed	☐	0.046		626.0	180.0	S	☐
Room 01-08 - Wall 792	Casa - Ext Wall - Wood Framed	☐	0.046		0.1	.0	N	☐
Room 01-10 - Wall 780	Casa - Ext Wall - Wood Framed	☐	0.046		0.9	179.6	S	☐
Room 01-10 - Wall 781	Casa - Ext Wall - Wood Framed	☐	0.046		3.6	90.0	E	☐
Room 01-10 - Wall 782	Casa - Ext Wall - Wood Framed	☐	0.046		3.9	180.0	S	☐
Room 01-10 - Wall 783	Casa - Ext Wall - Wood Framed	☐	0.046		47.6	.0	N	☐
Room 01-12 - Wall 799	Casa - Ext Wall - Wood Framed	☐	0.046		303.7	270.0	W	☐
Room 01-12 - Wall 800	Casa - Ext Wall - Wood Framed	☐	0.046		36.8	180.0	S	☐
Sally Port - Wall 841	Casa - Ext Wall - Wood Framed	☐	0.046		99.2	180.0	S	☐
Servery - Wall 101	Casa - Ext Wall - Wood Framed	☐	0.046		159.9	.0	N	☐
Service - Wall 172	Casa - Ext Wall - Wood Framed	☐	0.046		148.7	180.0	S	☐
Service - Wall 176	Casa - Ext Wall - Wood Framed	☐	0.046		240.5	270.0	W	☐
Shower 1 - Wall 20	Casa - Ext Wall - Wood Framed	☐	0.046		36.6	90.0	E	☐
Shower 2 - Wall 164	Casa - Ext Wall - Wood Framed	☐	0.046		32.1	180.0	S	☐
Shower 3 - Wall 221	Casa - Ext Wall - Wood Framed	☐	0.046		103.4	270.0	W	☐
Shower 4 - Wall 217	Casa - Ext Wall - Wood Framed	☐	0.046		102.8	270.0	W	☐
Shower 5 - Wall 252	Casa - Ext Wall - Wood Framed	☐	0.046		102.1	.0	N	☐
Shower 6 - Wall 256	Casa - Ext Wall - Wood Framed	☐	0.046		102.0	.0	N	☐
Shower 7 - Wall 292	Casa - Ext Wall - Wood Framed	☐	0.046		101.9	90.0	E	☐
Shower 8 - Wall 296	Casa - Ext Wall - Wood Framed	☐	0.046		99.8	90.0	E	☐
Staff Corridor - Wall 390	Casa - Ext Wall - Wood Framed	☐	0.046		77.0	180.0	S	☐
Storage - Wall 116	Casa - Ext Wall - Wood Framed	☐	0.046		32.1	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Trash - Wall 179	Casa - Ext Wall - Wood Framed	☐	0.046		96.0	180.0	S	☐

Above Grade Wall Areas

Total Area (ft ²)	North Facing Area (ft ²)	East Facing Area (ft ²)	South Facing Area (ft ²)	West Facing Area (ft ²)
12,083.5	3,073.6	2,650.9	3,382.2	2,975.2

Interior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Ante Room - Wall 60	Gypsum, Gypsum	☐	0.280	91.0	☐
Ante Room - Wall 65	Gypsum, Gypsum	☐	0.280	108.2	☐
Attrium - Wall 550	Gypsum, Gypsum	☐	0.280	179.9	☐
Attrium - Wall 556	Gypsum, Gypsum	☐	0.280	99.6	☐
Chart/Hotel - Wall 136	Gypsum, Gypsum	☐	0.280	157.0	☐
Chart/Hotel - Wall 520	Gypsum, Gypsum	☐	0.280	76.8	☐
Chart/Hotel - Wall 551	Gypsum, Gypsum	☐	0.280	119.5	☐
Chart/Hotel - Wall 552	Gypsum, Gypsum	☐	0.280	107.3	☐
Clean Supply - Wall 93	Gypsum, Gypsum	☐	0.280	154.2	☐
Comfort Room 1 - Wall 56	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 1 - Wall 61	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 2 - Wall 205	Gypsum, Gypsum	☐	0.280	137.5	☐
Comfort Room 2 - Wall 299	Gypsum, Gypsum	☐	0.280	15.2	☐
Comfort Room 2 - Wall 333	Gypsum, Gypsum	☐	0.280	65.7	☐
Comfort Room 2 - Wall 334	Gypsum, Gypsum	☐	0.280	57.0	☐
Comfort Room 2 - Wall 511	Gypsum, Gypsum	☐	0.280	75.8	☐
Consult 2 - Wall 120	Gypsum, Gypsum	☐	0.280	137.5	☐
Corridor 1 - Wall 315	Gypsum, Gypsum	☐	0.280	34.6	☐
Corridor 1 - Wall 317	Gypsum, Gypsum	☐	0.280	198.5	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Corridor 1 - Wall 322	Gypsum, Gypsum	☐	0.280	121.6	☐
Corridor 1 - Wall 323	Gypsum, Gypsum	☐	0.280	72.7	☐
Corridor 1 - Wall 324	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 325	Gypsum, Gypsum	☐	0.280	11.3	☐
Corridor 1 - Wall 326	Gypsum, Gypsum	☐	0.280	99.2	☐
Corridor 1 - Wall 327	Gypsum, Gypsum	☐	0.280	125.6	☐
Corridor 1 - Wall 328	Gypsum, Gypsum	☐	0.280	103.9	☐
Corridor 1 - Wall 330	Gypsum, Gypsum	☐	0.280	60.2	☐
Corridor 1 - Wall 350	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 369	Gypsum, Gypsum	☐	0.280	78.4	☐
Corridor 2 - Wall 336	Gypsum, Gypsum	☐	0.280	117.1	☐
Corridor 2 - Wall 337	Gypsum, Gypsum	☐	0.280	115.5	☐
Corridor 2 - Wall 344	Gypsum, Gypsum	☐	0.280	84.5	☐
Corridor 2 - Wall 345	Gypsum, Gypsum	☐	0.280	100.0	☐
Corridor 2 - Wall 346	Gypsum, Gypsum	☐	0.280	84.2	☐
Corridor 2 - Wall 347	Gypsum, Gypsum	☐	0.280	105.1	☐
Corridor 2 - Wall 348	Gypsum, Gypsum	☐	0.280	124.3	☐
Corridor 2 - Wall 351	Gypsum, Gypsum	☐	0.280	63.0	☐
Corridor 2 - Wall 352	Gypsum, Gypsum	☐	0.280	171.6	☐
Corridor 2 - Wall 353	Gypsum, Gypsum	☐	0.280	102.2	☐
Corridor 2 - Wall 358	Gypsum, Gypsum	☐	0.280	78.8	☐
Corridor 2 - Wall 507	Gypsum, Gypsum	☐	0.280	49.8	☐
Corridor 2 - Wall 512	Gypsum, Gypsum	☐	0.280	159.0	☐
Corridor 2 - Wall 515	Gypsum, Gypsum	☐	0.280	100.4	☐
Corridor 2 - Wall 516	Gypsum, Gypsum	☐	0.280	78.9	☐
Corridor 2 - Wall 517	Gypsum, Gypsum	☐	0.280	63.1	☐
Corridor 2 - Wall 554	Gypsum, Gypsum	☐	0.280	287.1	☐
Corridor 2 - Wall 555	Gypsum, Gypsum	☐	0.280	160.4	☐
Corridor 3 - Wall 418	Gypsum, Gypsum	☐	0.280	101.9	☐
Corridor 3 - Wall 421	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 422	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 3 - Wall 423	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 5 - Wall 394	Gypsum, Gypsum	☐	0.280	130.3	☐
Corridor 5 - Wall 395	Gypsum, Gypsum	☐	0.280	103.4	☐

Corridor 5 - Wall 398	Gypsum, Gypsum	☐	0.280	129.0	☐
Corridor 5 - Wall 399	Gypsum, Gypsum	☐	0.280	136.0	☐
Corridor 5 - Wall 400	Gypsum, Gypsum	☐	0.280	112.5	☐
Corridor 5 - Wall 401	Gypsum, Gypsum	☐	0.280	124.1	☐
Corridor 5 - Wall 518	Gypsum, Gypsum	☐	0.280	101.2	☐
Electric - Wall 386	Gypsum, Gypsum	☐	0.280	128.5	☐
Electric - Wall 44	Gypsum, Gypsum	☐	0.280	229.9	☐
Emergency Electric - Wall 387	Gypsum, Gypsum	☐	0.280	121.0	☐
Entry/Waiting - Wall 304	Gypsum, Gypsum	☐	0.280	91.3	☐
Entry/Waiting - Wall 305	Gypsum, Gypsum	☐	0.280	134.2	☐
Exam Room - Wall 68	Gypsum, Gypsum	☐	0.280	154.2	☐
Group - Wall 107	Gypsum, Gypsum	☐	0.280	230.2	☐
Group - Wall 113	Gypsum, Gypsum	☐	0.280	30.9	☐
Group - Wall 114	Gypsum, Gypsum	☐	0.280	137.5	☐
Hskp - Wall 385	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 72	Gypsum, Gypsum	☐	0.280	17.4	☐
Hskp - Wall 73	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 75	Gypsum, Gypsum	☐	0.280	103.9	☐
Hskp - Wall 78	Gypsum, Gypsum	☐	0.280	121.2	☐
Intake Corridor - Wall 33	Gypsum, Gypsum	☐	0.280	62.8	☐
Intake Corridor - Wall 64	Gypsum, Gypsum	☐	0.280	154.2	☐
IT - Wall 181	Gypsum, Gypsum	☐	0.280	121.2	☐
IT - Wall 389	Gypsum, Gypsum	☐	0.280	203.4	☐
IT - Wall 79	Gypsum, Gypsum	☐	0.280	42.9	☐
IT - Wall 80	Gypsum, Gypsum	☐	0.280	124.1	☐
IT - Wall 81	Gypsum, Gypsum	☐	0.280	36.4	☐
Kitchen - Wall 165	Gypsum, Gypsum	☐	0.280	87.5	☐
Kitchen - Wall 166	Gypsum, Gypsum	☐	0.280	29.4	☐
Kitchen - Wall 171	Gypsum, Gypsum	☐	0.280	244.7	☐
Kitchen - Wall 188	Gypsum, Gypsum	☐	0.280	157.2	☐
Kitchen - Wall 377	Gypsum, Gypsum	☐	0.280	247.2	☐
Laundry - Wall 90	Gypsum, Gypsum	☐	0.280	154.2	☐
Lounge - Wall 154	Gypsum, Gypsum	☐	0.280	140.4	☐
Lounge - Wall 158	Gypsum, Gypsum	☐	0.280	140.4	☐

Lounge - Wall 373	Gypsum, Gypsum	☐	0.280	218.0	☐
Mechanical - Wall 182	Gypsum, Gypsum	☐	0.280	108.2	☐
Mechanical - Wall 183	Gypsum, Gypsum	☐	0.280	81.2	☐
Mechanical - Wall 185	Gypsum, Gypsum	☐	0.280	229.9	☐
Mechanical - Wall 388	Gypsum, Gypsum	☐	0.280	144.9	☐
Meds - Wall 349	Gypsum, Gypsum	☐	0.280	97.2	☐
Meds - Wall 367	Gypsum, Gypsum	☐	0.280	131.8	☐
Meds - Wall 368	Gypsum, Gypsum	☐	0.280	154.2	☐
Meds - Wall 87	Gypsum, Gypsum	☐	0.280	154.2	☐
Multipurpose/Dining - Wall 102	Gypsum, Gypsum	☐	0.280	187.3	☐
Multipurpose/Dining - Wall 318	Gypsum, Gypsum	☐	0.280	43.2	☐
Multipurpose/Dining - Wall 319	Gypsum, Gypsum	☐	0.280	26.9	☐
Noisy Activity 1 - Wall 214	Gypsum, Gypsum	☐	0.280	159.6	☐
Noisy Activity 1 - Wall 231	Gypsum, Gypsum	☐	0.280	81.0	☐
Noisy Activity 1 - Wall 392	Gypsum, Gypsum	☐	0.280	174.4	☐
Noisy Activity 1 - Wall 519	Gypsum, Gypsum	☐	0.280	78.6	☐
Noisy Activity 2 - Wall 257	Gypsum, Gypsum	☐	0.280	161.2	☐
Noisy Activity 2 - Wall 405	Gypsum, Gypsum	☐	0.280	173.8	☐
Noisy Activity 2 - Wall 557	Gypsum, Gypsum	☐	0.280	98.1	☐
Noisy Activity 3 - Wall 414	Gypsum, Gypsum	☐	0.280	176.6	☐
Office 1 - Wall 150	Gypsum, Gypsum	☐	0.280	140.4	☐
Office 1 - Wall 372	Gypsum, Gypsum	☐	0.280	107.0	☐
Office 2 - Wall 144	Gypsum, Gypsum	☐	0.280	44.1	☐
Office 2 - Wall 145	Gypsum, Gypsum	☐	0.280	96.2	☐
Office 2 - Wall 370	Gypsum, Gypsum	☐	0.280	108.0	☐
Quiet Activity 2 - Wall 235	Gypsum, Gypsum	☐	0.280	158.9	☐
Quiet Activity 2 - Wall 404	Gypsum, Gypsum	☐	0.280	129.0	☐
Quiet Activity 2 - Wall 523	Gypsum, Gypsum	☐	0.280	76.8	☐
Quiet Activity 2 - Wall 553	Gypsum, Gypsum	☐	0.280	82.1	☐
Quiet Activity 3 - Wall 261	Gypsum, Gypsum	☐	0.280	81.7	☐
Quiet Activity 3 - Wall 415	Gypsum, Gypsum	☐	0.280	128.1	☐
Resident Room 01 - Wall 140	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 01 - Wall 193	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 02 - Wall 197	Gypsum, Gypsum	☐	0.280	157.0	☐

Resident Room 04 - Wall 201	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 05 - Wall 397	Gypsum, Gypsum	☐	0.280	129.0	☐
Resident Room 06 - Wall 222	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 226	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 396	Gypsum, Gypsum	☐	0.280	122.2	☐
Resident Room 07 - Wall 238	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 07 - Wall 406	Gypsum, Gypsum	☐	0.280	124.0	☐
Resident Room 08 - Wall 408	Gypsum, Gypsum	☐	0.280	124.9	☐
Resident Room 09 - Wall 241	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 09 - Wall 411	Gypsum, Gypsum	☐	0.280	126.4	☐
Resident Room 10 - Wall 410	Gypsum, Gypsum	☐	0.280	126.4	☐
Resident Room 11 - Wall 266	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 270	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 417	Gypsum, Gypsum	☐	0.280	126.2	☐
Resident Room 12 - Wall 274	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 12 - Wall 419	Gypsum, Gypsum	☐	0.280	124.0	☐
Resident Room 13 - Wall 278	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 286	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 290	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 420	Gypsum, Gypsum	☐	0.280	124.0	☐
Room 00-80 - Wall 848	Gypsum, Gypsum	☐	0.280	6.2	☐
Room 01-00 - Wall 563	Gypsum, Gypsum	☐	0.280	48.8	☐
Room 01-03 - Wall 734	Gypsum, Gypsum	☐	0.280	46.2	☐
Room 01-04 - Wall 587	Gypsum, Gypsum	☐	0.280	354.4	☐
Room 01-06 - Wall 604	Gypsum, Gypsum	☐	0.280	4.2	☐
Room 01-06 - Wall 605	Gypsum, Gypsum	☐	0.280	1.5	☐
Room 01-06 - Wall 732	Gypsum, Gypsum	☐	0.280	50.2	☐
Room 01-06 - Wall 775	Gypsum, Gypsum	☐	0.280	330.4	☐
Room 01-08 - Wall 776	Gypsum, Gypsum	☐	0.280	3.9	☐
Room 01-08 - Wall 779	Gypsum, Gypsum	☐	0.280	21.7	☐
Room 01-10 - Wall 774	Gypsum, Gypsum	☐	0.280	46.7	☐
Room 01-12 - Wall 795	Gypsum, Gypsum	☐	0.280	57.5	☐
Sally Port - Wall 30	Gypsum, Gypsum	☐	0.280	126.1	☐
Sally Port - Wall 35	Gypsum, Gypsum	☐	0.280	99.2	☐

Sally Port - Wall 54	Gypsum, Gypsum	☐	0.280	97.2	☐
Sally Port - Wall 59	Gypsum, Gypsum	☐	0.280	28.9	☐
Servery - Wall 320	Gypsum, Gypsum	☐	0.280	38.3	☐
Servery - Wall 321	Gypsum, Gypsum	☐	0.280	42.9	☐
Servery - Wall 97	Gypsum, Gypsum	☐	0.280	230.2	☐
Service - Wall 177	Gypsum, Gypsum	☐	0.280	127.4	☐
Service - Wall 178	Gypsum, Gypsum	☐	0.280	96.0	☐
Shower 1 - Wall 22	Gypsum, Gypsum	☐	0.280	130.3	☐
Shower 1 - Wall 307	Gypsum, Gypsum	☐	0.280	62.3	☐
Shower 1 - Wall 34	Gypsum, Gypsum	☐	0.280	98.8	☐
Shower 2 - Wall 187	Gypsum, Gypsum	☐	0.280	79.9	☐
Shower 2 - Wall 374	Gypsum, Gypsum	☐	0.280	33.0	☐
Shower 2 - Wall 375	Gypsum, Gypsum	☐	0.280	31.0	☐
Shower 2 - Wall 376	Gypsum, Gypsum	☐	0.280	86.6	☐
Shower 4 - Wall 218	Gypsum, Gypsum	☐	0.280	159.6	☐
Shower 4 - Wall 393	Gypsum, Gypsum	☐	0.280	102.8	☐
Shower 5 - Wall 249	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 253	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 409	Gypsum, Gypsum	☐	0.280	102.1	☐
Shower 6 - Wall 407	Gypsum, Gypsum	☐	0.280	102.0	☐
Shower 8 - Wall 294	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 298	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 416	Gypsum, Gypsum	☐	0.280	99.8	☐
Staff Corridor - Wall 359	Gypsum, Gypsum	☐	0.280	196.3	☐
Staff Corridor - Wall 360	Gypsum, Gypsum	☐	0.280	84.2	☐
Staff Corridor - Wall 361	Gypsum, Gypsum	☐	0.280	119.5	☐
Staff Corridor - Wall 362	Gypsum, Gypsum	☐	0.280	84.5	☐
Staff Corridor - Wall 363	Gypsum, Gypsum	☐	0.280	100.0	☐
Staff Corridor - Wall 364	Gypsum, Gypsum	☐	0.280	34.7	☐
Staff Corridor - Wall 365	Gypsum, Gypsum	☐	0.280	105.1	☐
Staff Corridor - Wall 366	Gypsum, Gypsum	☐	0.280	124.3	☐
Staff Corridor - Wall 371	Gypsum, Gypsum	☐	0.280	34.1	☐
Staff Corridor - Wall 378	Gypsum, Gypsum	☐	0.280	110.1	☐
Staff Corridor - Wall 379	Gypsum, Gypsum	☐	0.280	90.6	☐

Staff Corridor - Wall 380	Gypsum, Gypsum	☐	0.280	31.0	☐
Staff Corridor - Wall 381	Gypsum, Gypsum	☐	0.280	66.6	☐
Staff Corridor - Wall 382	Gypsum, Gypsum	☐	0.280	112.0	☐
Staff Corridor - Wall 383	Gypsum, Gypsum	☐	0.280	128.5	☐
Staff Corridor - Wall 384	Gypsum, Gypsum	☐	0.280	154.2	☐
Storage - Wall 117	Gypsum, Gypsum	☐	0.280	137.5	☐
Toilet 1 - Wall 18	Gypsum, Gypsum	☐	0.280	130.3	☐
Toilet 1 - Wall 308	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 1 - Wall 309	Gypsum, Gypsum	☐	0.280	119.0	☐
Toilet 1 - Wall 36	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 2 - Wall 124	Gypsum, Gypsum	☐	0.280	119.5	☐
Toilet 3 - Wall 128	Gypsum, Gypsum	☐	0.280	119.5	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Ante Room - Roof 111-11	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	90.1	0.00	☐
Attrium 2 - Roof 128-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	174.6	0.00	☐
Attrium 2 - Roof 129-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	177.3	0.00	☐
Attrium 2 - Roof 130-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	174.6	0.00	☐
Attrium 2 - Roof 131-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	177.3	0.00	☐
Chart/Hotel - Roof 110-28	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	20.7	0.00	☐
Clean Supply - Roof 105-18	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	112.6	0.00	☐
Comfort Room 1 - Roof 10-10	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	93.2	0.00	☐
Comfort Room 2 - Roof 124-43	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	80.3	0.00	☐
Consult 1 - Roof 122-24	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	98.0	0.00	☐
Consult 2 - Roof 123-25	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	99.4	0.00	☐
Corridor 1 - Roof 102-68	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	318.3	0.00	☐
Corridor 2 - Roof 109-70	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	515.6	0.00	☐
Electric - Roof 07-07	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	205.3	0.00	☐
Emergency Electric - Roof 08-08	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	193.2	0.00	☐
Entry/Waiting - Roof 115-67	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	56.1	0.00	☐
Exam Room - Roof 112-12	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	134.4	0.00	☐
Fire Room - Roof 09-09	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	88.4	0.00	☐
General Storage - Roof 95-39	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	106.5	0.00	☐
Group - Roof 120-22	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	145.6	0.00	☐
Hospitality - Roof 116-01	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	129.5	0.00	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Reflectivity	Adiabatic
Hskp - Roof 100-14	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	64.8	0.00	☐
Intake Corridor - Roof 113-06	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	168.9	0.00	☐
Interview Room - Roof 125-04	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	119.4	0.00	☐
IT - Roof 99-15	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	171.3	0.00	☐
Kitchen - Roof 96-35	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	402.3	0.00	☐
Laundry - Roof 104-17	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	133.1	0.00	☐
Long Term Belongings Storage - Roof 101-13	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	111.2	0.00	☐
Lounge - Roof 93-33	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	212.5	0.00	☐
Mechanical - Roof 38-38	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	170.1	0.00	☐
Meds - Roof 103-16	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	141.1	0.00	☐
Multipurpose/Dining - Roof 119-21	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	266.5	0.00	☐
Office 1 - Roof 92-32	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	104.3	0.00	☐
Office 2 - Roof 90-31	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	105.2	0.00	☐
Resident Room 15 - Roof 62-62	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.4	0.00	☐
Resident Room 16 - Roof 63-63	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.3	0.00	☐
Room 00-80 - Roof 137-80	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	6.2	0.00	☐
Room 00-81 - Roof 138-81	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	3.8	0.00	☐
Room 01-00 - Roof 80-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	701.7	0.00	☐
Room 01-01 - Roof 81-01	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	815.2	0.00	☐
Room 01-03 - Roof 83-03	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,094.5	0.00	☐
Room 01-04 - Roof 84-04	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,058.1	0.00	☐
Room 01-06 - Roof 86-06	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,095.7	0.00	☐
Room 01-10 - Roof 134-10	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	862.3	0.00	☐
Room 01-12 - Roof 136-12	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	792.1	0.00	☐
Sally Port - Roof 05-05	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	86.9	0.00	☐
Servery - Roof 117-20	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	124.3	0.00	☐
Service - Roof 97-36	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	323.5	0.00	☐
Shower 1 - Roof 126-03	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	62.5	0.00	☐
Shower 2 - Roof 94-34	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	109.5	0.00	☐
Shower 7 - Roof 64-64	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.1	0.00	☐
Shower 8 - Roof 65-65	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.1	0.00	☐
Soiled Supply - Roof 106-19	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	107.1	0.00	☐
Staff Corridor - Roof 91-71	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	968.1	0.00	☐
Stor. - Roof 118-69	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	18.7	0.00	☐
Storage - Roof 121-23	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	53.5	0.00	☐
Toilet 1 - Roof 114-02	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	52.8	0.00	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Toilet 2 - Roof 107-26	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	70.1	0.00	☐
Toilet 3 - Roof 108-27	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	69.9	0.00	☐
Trash - Roof 98-37	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	85.3	0.00	☐

Total Roof Area (ft²) 13,928.4

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Ante Room - Slab 11	Casa - Slab on Grade	☐		0.730	90.1	☐
Attrium - Slab 82	Casa - Slab on Grade	☐		0.730	469.1	☐
Chart/Hotel - Slab 28	Casa - Slab on Grade	☐		0.730	214.1	☐
Clean Supply - Slab 18	Casa - Slab on Grade	☐		0.730	112.6	☐
Comfort Room 1 - Slab 10	Casa - Slab on Grade	☐		0.730	93.2	☐
Comfort Room 2 - Slab 43	Casa - Slab on Grade	☐		0.730	91.3	☐
Consult 1 - Slab 24	Casa - Slab on Grade	☐		0.730	110.2	☐
Consult 2 - Slab 25	Casa - Slab on Grade	☐		0.730	111.8	☐
Corridor 1 - Slab 68	Casa - Slab on Grade	☐		0.730	318.3	☐
Corridor 2 - Slab 70	Casa - Slab on Grade	☐		0.730	685.5	☐
Corridor 2.1 - Slab 81	Casa - Slab on Grade	☐		0.730	96.0	☐
Corridor 3 - Slab 74	Casa - Slab on Grade	☐		0.730	439.2	☐
Corridor 4 - Slab 73	Casa - Slab on Grade	☐		0.730	348.9	☐
Corridor 5 - Slab 72	Casa - Slab on Grade	☐		0.730	444.2	☐
Electric - Slab 07	Casa - Slab on Grade	☐		0.730	205.3	☐
Emergency Electric - Slab 08	Casa - Slab on Grade	☐		0.730	193.2	☐
Entry/Waiting - Slab 67	Casa - Slab on Grade	☐		0.730	395.5	☐
Exam Room - Slab 12	Casa - Slab on Grade	☐		0.730	134.4	☐
Fire Room - Slab 09	Casa - Slab on Grade	☐		0.730	88.4	☐
General Storage - Slab 39	Casa - Slab on Grade	☐		0.730	106.5	☐
Group - Slab 22	Casa - Slab on Grade	☐		0.730	294.2	☐
Hospitality - Slab 01	Casa - Slab on Grade	☐		0.730	262.2	☐
Hskp - Slab 14	Casa - Slab on Grade	☐		0.730	64.8	☐
Intake Corridor - Slab 06	Casa - Slab on Grade	☐		0.730	168.9	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	F-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Adiabatic
Interview Room - Slab 04	Casa - Slab on Grade	☐		0.730	170.9	☐
IT - Slab 15	Casa - Slab on Grade	☐		0.730	171.3	☐
Kitchen - Slab 35	Casa - Slab on Grade	☐		0.730	402.3	☐
Laundry - Slab 17	Casa - Slab on Grade	☐		0.730	133.1	☐
Long Term Belongings Storage - Slab 13	Casa - Slab on Grade	☐		0.730	111.2	☐
Lounge - Slab 33	Casa - Slab on Grade	☐		0.730	212.5	☐
Mechanical - Slab 38	Casa - Slab on Grade	☐		0.730	170.1	☐
Meds - Slab 16	Casa - Slab on Grade	☐		0.730	141.1	☐
Multipurpose/Dining - Slab 21	Casa - Slab on Grade	☐		0.730	508.3	☐
Noisy Activity 1 - Slab 44	Casa - Slab on Grade	☐		0.730	193.3	☐
Noisy Activity 2 - Slab 56	Casa - Slab on Grade	☐		0.730	194.6	☐
Noisy Activity 3 - Slab 66	Casa - Slab on Grade	☐		0.730	195.9	☐
Office 1 - Slab 32	Casa - Slab on Grade	☐		0.730	104.3	☐
Office 2 - Slab 31	Casa - Slab on Grade	☐		0.730	105.2	☐
Quiet Activity 1 - Slab 29	Casa - Slab on Grade	☐		0.730	142.1	☐
Quiet Activity 2 - Slab 49	Casa - Slab on Grade	☐		0.730	142.4	☐
Quiet Activity 3 - Slab 57	Casa - Slab on Grade	☐		0.730	142.9	☐
Resident Room 01 - Slab 30	Casa - Slab on Grade	☐		0.730	135.3	☐
Resident Room 02 - Slab 40	Casa - Slab on Grade	☐		0.730	122.6	☐
Resident Room 03 - Slab 41	Casa - Slab on Grade	☐		0.730	148.3	☐
Resident Room 04 - Slab 42	Casa - Slab on Grade	☐		0.730	140.7	☐
Resident Room 05 - Slab 48	Casa - Slab on Grade	☐		0.730	143.0	☐
Resident Room 06 - Slab 47	Casa - Slab on Grade	☐		0.730	135.5	☐
Resident Room 07 - Slab 50	Casa - Slab on Grade	☐		0.730	136.9	☐
Resident Room 08 - Slab 51	Casa - Slab on Grade	☐		0.730	137.9	☐
Resident Room 09 - Slab 52	Casa - Slab on Grade	☐		0.730	139.5	☐
Resident Room 10 - Slab 53	Casa - Slab on Grade	☐		0.730	141.5	☐
Resident Room 11 - Slab 58	Casa - Slab on Grade	☐		0.730	140.8	☐
Resident Room 12 - Slab 59	Casa - Slab on Grade	☐		0.730	138.3	☐
Resident Room 13 - Slab 60	Casa - Slab on Grade	☐		0.730	138.3	☐
Resident Room 14 - Slab 61	Casa - Slab on Grade	☐		0.730	142.2	☐
Resident Room 15 - Slab 62	Casa - Slab on Grade	☐		0.730	142.1	☐
Resident Room 16 - Slab 63	Casa - Slab on Grade	☐		0.730	138.3	☐
Room 00-80 - Slab 187	Casa - Slab on Grade	☐		0.730	11.3	☐
Room 00-81 - Slab 190	Casa - Slab on Grade	☐		0.730	6.3	☐
Room 01-12 - Slab 182	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		13.0	☐

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Room 01-12 - Slab 185	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		161.7	☐
Room 01-12 - Slab 188	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		78.5	☐
Sally Port - Slab 05	Casa - Slab on Grade	☐		0.730	86.9	☐
Servery - Slab 20	Casa - Slab on Grade	☐		0.730	244.2	☐
Service - Slab 36	Casa - Slab on Grade	☐		0.730	323.5	☐
Shower 1 - Slab 03	Casa - Slab on Grade	☐		0.730	89.4	☐
Shower 2 - Slab 34	Casa - Slab on Grade	☐		0.730	109.5	☐
Shower 3 - Slab 46	Casa - Slab on Grade	☐		0.730	114.6	☐
Shower 4 - Slab 45	Casa - Slab on Grade	☐		0.730	114.0	☐
Shower 5 - Slab 54	Casa - Slab on Grade	☐		0.730	114.3	☐
Shower 6 - Slab 55	Casa - Slab on Grade	☐		0.730	114.2	☐
Shower 7 - Slab 64	Casa - Slab on Grade	☐		0.730	113.6	☐
Shower 8 - Slab 65	Casa - Slab on Grade	☐		0.730	111.3	☐
Soiled Supply - Slab 19	Casa - Slab on Grade	☐		0.730	107.1	☐
Staff Corridor - Slab 71	Casa - Slab on Grade	☐		0.730	968.1	☐
Stor. - Slab 69	Casa - Slab on Grade	☐		0.730	18.7	☐
Storage - Slab 23	Casa - Slab on Grade	☐		0.730	60.1	☐
Toilet 1 - Slab 02	Casa - Slab on Grade	☐		0.730	75.5	☐
Toilet 2 - Slab 26	Casa - Slab on Grade	☐		0.730	70.1	☐
Toilet 3 - Slab 27	Casa - Slab on Grade	☐		0.730	69.9	☐
Trash - Slab 37	Casa - Slab on Grade	☐		0.730	85.3	☐

* Interzone slabs are not included in the Exterior Slabs subsection. Exposed and Ground Contact Slabs will be shown.

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Electric - Wall 40 - Door 07	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	180.0	S
Emergency Electric - Wall 836 - Door 22	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.0	E
Entry/Waiting - Wall 311 - Door 12	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S
Fire Room - Wall 838 - Door 23	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.0	E
Lounge - Wall 155 - Door 11	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	180.0	S
Multipurpose/Dining - Wall 106 - Door 02	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	.0	N

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Doors

Name	Construction Type	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Area (ft²)	Azimuth	Cardinal Direction
Noisy Activity 1 - Wall 213 - Door 03	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	270.0	W
Noisy Activity 2 - Wall 260 - Door 00	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	.0	N
Noisy Activity 3 - Wall 301 - Door 01	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.6	E
Sally Port - Wall 841 - Door 24	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	25.7	180.0	S
Service - Wall 172 - Door 04	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	49.0	180.0	S
Staff Corridor - Wall 390 - Door 06	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S
Trash - Wall 179 - Door 05	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Area (ft²)	Azimuth	Cardinal Direction
Attrium 2 - Wall 726 - Window 41	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	180.0	S
Attrium 2 - Wall 726 - Window 42	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	180.0	S
Attrium 2 - Wall 727 - Window 43	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	90.0	E
Attrium 2 - Wall 727 - Window 44	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	90.0	E
Attrium 2 - Wall 728 - Window 45	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	.0	N
Attrium 2 - Wall 728 - Window 46	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	.0	N
Attrium 2 - Wall 729 - Window 39	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	270.0	W
Attrium 2 - Wall 729 - Window 40	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.1	270.0	W
Comfort Room 2 - Wall 208 - Window 66	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Consult 1 - Wall 119 - Window 68	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Consult 2 - Wall 122 - Window 67	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Corridor 3 - Wall 424 - Window 05	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.7	.0	N
Corridor 4 - Wall 412 - Window 00	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.8	270.0	W
Corridor 5 - Wall 402 - Window 06	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.7	180.0	S
Entry/Waiting - Wall 312 - Window 01	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 02	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 03	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.8	90.0	E
Entry/Waiting - Wall 313 - Window 04	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	64.7	.0	N
Group - Wall 111 - Window 69	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Group - Wall 111 - Window 70	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Lounge - Wall 155 - Window 49	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	180.0	S
Lounge - Wall 155 - Window 50	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	180.0	S

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Multipurpose/Dining - Wall 106 - Window 71	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 72	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 73	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	.0	N
Noisy Activity 1 - Wall 213 - Window 51	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	270.0	W
Noisy Activity 1 - Wall 213 - Window 52	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	270.0	W
Noisy Activity 3 - Wall 301 - Window 65	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	90.6	E
Office 1 - Wall 151 - Window 48	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	180.0	S
Office 2 - Wall 147 - Window 47	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	180.0	S
Quiet Activity 2 - Wall 232 - Window 53	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	7.8	180.0	S
Resident Room 01 - Wall 142 - Window 77	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E
Resident Room 02 - Wall 195 - Window 76	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E
Resident Room 03 - Wall 199 - Window 75	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E
Resident Room 04 - Wall 203 - Window 74	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E
Resident Room 05 - Wall 229 - Window 58	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 06 - Wall 225 - Window 57	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 07 - Wall 236 - Window 54	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	17.8	180.0	S
Resident Room 08 - Wall 239 - Window 55	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	17.8	180.0	S
Resident Room 09 - Wall 242 - Window 56	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	17.8	180.0	S
Resident Room 10 - Wall 247 - Window 07	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	17.8	.0	N
Resident Room 11 - Wall 269 - Window 59	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 12 - Wall 273 - Window 60	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 13 - Wall 277 - Window 61	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 14 - Wall 281 - Window 62	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	270.0	W
Resident Room 15 - Wall 283 - Window 63	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E
Resident Room 16 - Wall 288 - Window 64	90.1-13 Window Zone 4-6 Metal Oper	0.501	0.401	0.4417	☐	10.1	90.0	E

Vertical Glazing Areas

Total Area (ft²)
1,153.7

North Facing Area (ft²)
265.7

East Facing Area (ft²)
339.9

South Facing Area (ft²)
371.9

West Facing Area (ft²)
176.2

Entered Values Envelope

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Attrium - Wall 756	Gypsum, Gypsum	☐	0.280		50.6	.0	N	☐
Attrium - Wall 757	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		31.5	270.0	W	☐
Attrium - Wall 758	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		25.1	270.0	W	☐
Attrium - Wall 759	Gypsum, Gypsum	☐	0.280		49.9	.0	N	☐
Attrium - Wall 760	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		21.0	180.0	S	☐
Attrium - Wall 761	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		39.0	180.0	S	☐
Attrium - Wall 762	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		156.0	90.0	E	☐
Attrium - Wall 764	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		23.8	.0	N	☐
Attrium - Wall 771	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		35.3	.0	N	☐
Attrium 2 - Wall 726	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		179.4	180.0	S	☐
Attrium 2 - Wall 727	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		178.0	90.0	E	☐
Attrium 2 - Wall 728	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		179.4	.0	N	☐
Attrium 2 - Wall 729	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		178.0	270.0	W	☐
Comfort Room 1 - Wall 839	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		26.9	90.0	E	☐
Comfort Room 2 - Wall 208	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		103.5	.0	N	☐
Consult 1 - Wall 119	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		115.5	.0	N	☐
Consult 2 - Wall 122	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		117.1	.0	N	☐
Corridor 3 - Wall 424	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		100.4	.0	N	☐
Corridor 4 - Wall 412	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		99.6	270.0	W	☐
Corridor 5 - Wall 402	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		101.2	180.0	S	☐
Electric - Wall 40	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		229.9	180.0	S	☐
Electric - Wall 835	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		128.5	90.0	E	☐
Emergency Electric - Wall 836	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		121.0	90.0	E	☐
Entry/Waiting - Wall 311	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		108.1	180.0	S	☐
Entry/Waiting - Wall 312	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		381.1	90.0	E	☐
Entry/Waiting - Wall 313	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		135.8	.0	N	☐
Fire Room - Wall 838	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		117.7	90.0	E	☐
Group - Wall 111	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		202.5	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Group - Wall 112	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		92.7	270.0	W	☐
Hospitality - Wall 13	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		164.0	.0	N	☐
Hospitality - Wall 306	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		96.0	90.0	E	☐
Interview Room - Wall 26	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		182.7	90.0	E	☐
Interview Room - Wall 840	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		130.3	180.0	S	☐
Kitchen - Wall 170	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		217.8	270.0	W	☐
Lounge - Wall 155	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		218.0	180.0	S	☐
Mechanical - Wall 837	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		63.7	90.0	E	☐
Multipurpose/Dining - Wall 106	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		322.5	.0	N	☐
Noisy Activity 1 - Wall 213	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		174.4	270.0	W	☐
Noisy Activity 2 - Wall 260	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		92.1	.0	N	☐
Noisy Activity 3 - Wall 301	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		161.4	90.6	E	☐
Office 1 - Wall 151	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		107.0	180.0	S	☐
Office 2 - Wall 147	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		108.0	180.0	S	☐
Quiet Activity 2 - Wall 232	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		48.0	180.0	S	☐
Quiet Activity 3 - Wall 265	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		128.1	270.0	W	☐
Resident Room 01 - Wall 142	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		80.0	90.0	E	☐
Resident Room 02 - Wall 195	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		112.5	90.0	E	☐
Resident Room 03 - Wall 199	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		136.0	90.0	E	☐
Resident Room 04 - Wall 202	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		157.0	180.0	S	☐
Resident Room 04 - Wall 203	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		129.0	90.0	E	☐
Resident Room 05 - Wall 227	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		159.6	180.0	S	☐
Resident Room 05 - Wall 229	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		129.0	270.0	W	☐
Resident Room 06 - Wall 225	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		122.2	270.0	W	☐
Resident Room 07 - Wall 236	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		124.0	180.0	S	☐
Resident Room 08 - Wall 239	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		124.9	180.0	S	☐
Resident Room 09 - Wall 242	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		126.4	180.0	S	☐
Resident Room 09 - Wall 244	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		158.9	270.0	W	☐
Resident Room 10 - Wall 247	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		126.4	.0	N	☐
Resident Room 10 - Wall 248	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		161.2	270.0	W	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Resident Room 11 - Wall 269	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		126.2	270.0	W	☐
Resident Room 12 - Wall 273	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		124.0	270.0	W	☐
Resident Room 13 - Wall 277	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		124.0	270.0	W	☐
Resident Room 14 - Wall 280	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		160.6	.0	N	☐
Resident Room 14 - Wall 281	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		127.5	270.0	W	☐
Resident Room 15 - Wall 283	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		127.5	90.0	E	☐
Resident Room 15 - Wall 284	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		160.6	.0	N	☐
Resident Room 16 - Wall 288	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		124.0	90.0	E	☐
Room 00-80 - Wall 842	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		126.8	180.0	S	☐
Room 00-80 - Wall 843	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		57.9	90.0	E	☐
Room 00-80 - Wall 846	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		111.6	359.5	N	☐
Room 00-80 - Wall 849	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		14.8	.0	N	☐
Room 00-80 - Wall 850 - Copy	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		50.6	270.4	W	☐
Room 00-81 - Wall 851	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		27.6	180.0	S	☐
Room 00-81 - Wall 852	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		16.4	270.4	W	☐
Room 00-81 - Wall 853	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		18.7	180.0	S	☐
Room 00-81 - Wall 854	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		29.1	90.0	E	☐
Room 00-81 - Wall 855	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		45.9	.4	N	☐
Room 00-81 - Wall 856	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		13.1	271.7	W	☐
Room 01-00 - Wall 566	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		5.7	.0	N	☐
Room 01-00 - Wall 567	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		44.8	270.0	W	☐
Room 01-00 - Wall 569	Gypsum, Gypsum	☐	0.280		244.1	.0	N	☐
Room 01-00 - Wall 733	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.4	22.7	NE	☐
Room 01-01 - Wall 570	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.0	180.0	S	☐
Room 01-01 - Wall 572	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		57.0	270.0	W	☐
Room 01-03 - Wall 584	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		53.8	180.0	S	☐
Room 01-03 - Wall 735	Gypsum, Gypsum	☐	0.280		6.6	.0	N	☐
Room 01-03 - Wall 736	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.8	316.5	NW	☐
Room 01-03 - Wall 737	Gypsum, Gypsum	☐	0.280		2.8	.0	N	☐
Room 01-03 - Wall 738	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.3	316.5	NW	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Room 01-04 - Wall 589	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		50.6	180.0	S	☐
Room 01-04 - Wall 654	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.8	.0	N	☐
Room 01-06 - Wall 612	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		57.4	.0	N	☐
Room 01-06 - Wall 730	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.1	202.7	SW	☐
Room 01-06 - Wall 731	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		2.0	199.1	S	☐
Room 01-08 - Wall 773	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		22.5	270.0	W	☐
Room 01-08 - Wall 777	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		626.0	180.0	S	☐
Room 01-08 - Wall 792	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.1	.0	N	☐
Room 01-10 - Wall 780	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		0.9	179.6	S	☐
Room 01-10 - Wall 781	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		3.6	90.0	E	☐
Room 01-10 - Wall 782	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		3.9	180.0	S	☐
Room 01-10 - Wall 783	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		47.6	.0	N	☐
Room 01-12 - Wall 799	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		303.7	270.0	W	☐
Room 01-12 - Wall 800	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		36.8	180.0	S	☐
Sally Port - Wall 841	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		99.2	180.0	S	☐
Servery - Wall 101	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		159.9	.0	N	☐
Service - Wall 172	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		148.7	180.0	S	☐
Service - Wall 176	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		240.5	270.0	W	☐
Shower 1 - Wall 20	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		36.6	90.0	E	☐
Shower 2 - Wall 164	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		32.1	180.0	S	☐
Shower 3 - Wall 221	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		103.4	270.0	W	☐
Shower 4 - Wall 217	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		102.8	270.0	W	☐
Shower 5 - Wall 252	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		102.1	.0	N	☐
Shower 6 - Wall 256	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		102.0	.0	N	☐
Shower 7 - Wall 292	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		101.9	90.0	E	☐
Shower 8 - Wall 296	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		99.8	90.0	E	☐
Staff Corridor - Wall 390	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		77.0	180.0	S	☐
Storage - Wall 116	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		32.1	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Trash - Wall 179	90.1-10 Min Wall, Steel Framed Zone 3	☐	0.084		96.0	180.0	S	☐

Above Grade Wall Areas

Total Area (ft ²)	North Facing Area (ft ²)	East Facing Area (ft ²)	South Facing Area (ft ²)	West Facing Area (ft ²)
12,083.5	3,073.6	2,650.9	3,382.2	2,975.2

Interior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Ante Room - Wall 59	Gypsum, Gypsum	☐	0.280	28.9	☐
Ante Room - Wall 60	Gypsum, Gypsum	☐	0.280	91.0	☐
Ante Room - Wall 61	Gypsum, Gypsum	☐	0.280	108.2	☐
Ante Room - Wall 65	Gypsum, Gypsum	☐	0.280	108.2	☐
Attrium - Wall 554	Gypsum, Gypsum	☐	0.280	287.1	☐
Attrium - Wall 555	Gypsum, Gypsum	☐	0.280	160.4	☐
Attrium - Wall 557	Gypsum, Gypsum	☐	0.280	98.1	☐
Chart/Hotel - Wall 136	Gypsum, Gypsum	☐	0.280	157.0	☐
Chart/Hotel - Wall 359	Gypsum, Gypsum	☐	0.280	196.3	☐
Chart/Hotel - Wall 507	Gypsum, Gypsum	☐	0.280	49.8	☐
Chart/Hotel - Wall 520	Gypsum, Gypsum	☐	0.280	76.8	☐
Chart/Hotel - Wall 551	Gypsum, Gypsum	☐	0.280	119.5	☐
Chart/Hotel - Wall 552	Gypsum, Gypsum	☐	0.280	107.3	☐
Consult 1 - Wall 117	Gypsum, Gypsum	☐	0.280	137.5	☐
Consult 1 - Wall 337	Gypsum, Gypsum	☐	0.280	115.5	☐
Consult 2 - Wall 120	Gypsum, Gypsum	☐	0.280	137.5	☐
Consult 2 - Wall 205	Gypsum, Gypsum	☐	0.280	137.5	☐
Consult 2 - Wall 336	Gypsum, Gypsum	☐	0.280	117.1	☐
Corridor 1 - Wall 324	Gypsum, Gypsum	☐	0.280	101.2	☐

Corridor 1 - Wall 325	Gypsum, Gypsum	☐	0.280	11.3	☐
Corridor 1 - Wall 326	Gypsum, Gypsum	☐	0.280	99.2	☐
Corridor 1 - Wall 327	Gypsum, Gypsum	☐	0.280	125.6	☐
Corridor 1 - Wall 328	Gypsum, Gypsum	☐	0.280	103.9	☐
Corridor 1 - Wall 330	Gypsum, Gypsum	☐	0.280	60.2	☐
Corridor 1 - Wall 350	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 369	Gypsum, Gypsum	☐	0.280	78.4	☐
Corridor 2 - Wall 333	Gypsum, Gypsum	☐	0.280	65.7	☐
Corridor 2 - Wall 334	Gypsum, Gypsum	☐	0.280	57.0	☐
Corridor 2 - Wall 344	Gypsum, Gypsum	☐	0.280	84.5	☐
Corridor 2 - Wall 347	Gypsum, Gypsum	☐	0.280	105.1	☐
Corridor 2 - Wall 352	Gypsum, Gypsum	☐	0.280	171.6	☐
Corridor 2 - Wall 511	Gypsum, Gypsum	☐	0.280	75.8	☐
Corridor 2.1 - Wall 519	Gypsum, Gypsum	☐	0.280	78.6	☐
Corridor 2.1 - Wall 523	Gypsum, Gypsum	☐	0.280	76.8	☐
Corridor 2.1 - Wall 550	Gypsum, Gypsum	☐	0.280	179.9	☐
Corridor 3 - Wall 415	Gypsum, Gypsum	☐	0.280	128.1	☐
Corridor 3 - Wall 419	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 515	Gypsum, Gypsum	☐	0.280	100.4	☐
Corridor 4 - Wall 404	Gypsum, Gypsum	☐	0.280	129.0	☐
Corridor 4 - Wall 405	Gypsum, Gypsum	☐	0.280	173.8	☐
Corridor 4 - Wall 406	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 4 - Wall 407	Gypsum, Gypsum	☐	0.280	102.0	☐
Corridor 4 - Wall 409	Gypsum, Gypsum	☐	0.280	102.1	☐
Corridor 4 - Wall 410	Gypsum, Gypsum	☐	0.280	126.4	☐
Corridor 4 - Wall 411	Gypsum, Gypsum	☐	0.280	126.4	☐
Corridor 4 - Wall 556	Gypsum, Gypsum	☐	0.280	99.6	☐
Corridor 5 - Wall 392	Gypsum, Gypsum	☐	0.280	174.4	☐
Corridor 5 - Wall 393	Gypsum, Gypsum	☐	0.280	102.8	☐
Corridor 5 - Wall 394	Gypsum, Gypsum	☐	0.280	130.3	☐
Corridor 5 - Wall 395	Gypsum, Gypsum	☐	0.280	103.4	☐
Corridor 5 - Wall 396	Gypsum, Gypsum	☐	0.280	122.2	☐
Corridor 5 - Wall 397	Gypsum, Gypsum	☐	0.280	129.0	☐
Corridor 5 - Wall 398	Gypsum, Gypsum	☐	0.280	129.0	☐

Corridor 5 - Wall 400	Gypsum, Gypsum	☐	0.280	112.5	☐
Corridor 5 - Wall 518	Gypsum, Gypsum	☐	0.280	101.2	☐
Emergency Electric - Wall 185	Gypsum, Gypsum	☐	0.280	229.9	☐
Emergency Electric - Wall 44	Gypsum, Gypsum	☐	0.280	229.9	☐
Fire Room - Wall 182	Gypsum, Gypsum	☐	0.280	108.2	☐
Fire Room - Wall 183	Gypsum, Gypsum	☐	0.280	81.2	☐
Fire Room - Wall 56	Gypsum, Gypsum	☐	0.280	108.2	☐
Hospitality - Wall 304	Gypsum, Gypsum	☐	0.280	91.3	☐
Hospitality - Wall 305	Gypsum, Gypsum	☐	0.280	134.2	☐
Hospitality - Wall 323	Gypsum, Gypsum	☐	0.280	72.7	☐
Hskp - Wall 385	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 72	Gypsum, Gypsum	☐	0.280	17.4	☐
Hskp - Wall 73	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 75	Gypsum, Gypsum	☐	0.280	103.9	☐
Hskp - Wall 78	Gypsum, Gypsum	☐	0.280	121.2	☐
Intake Corridor - Wall 64	Gypsum, Gypsum	☐	0.280	154.2	☐
Interview Room - Wall 33	Gypsum, Gypsum	☐	0.280	62.8	☐
Interview Room - Wall 848	Gypsum, Gypsum	☐	0.280	6.2	☐
IT - Wall 181	Gypsum, Gypsum	☐	0.280	121.2	☐
IT - Wall 389	Gypsum, Gypsum	☐	0.280	203.4	☐
IT - Wall 79	Gypsum, Gypsum	☐	0.280	42.9	☐
IT - Wall 80	Gypsum, Gypsum	☐	0.280	124.1	☐
IT - Wall 81	Gypsum, Gypsum	☐	0.280	36.4	☐
Kitchen - Wall 171	Gypsum, Gypsum	☐	0.280	244.7	☐
Kitchen - Wall 188	Gypsum, Gypsum	☐	0.280	157.2	☐
Kitchen - Wall 377	Gypsum, Gypsum	☐	0.280	247.2	☐
Laundry - Wall 348	Gypsum, Gypsum	☐	0.280	124.3	☐
Laundry - Wall 366	Gypsum, Gypsum	☐	0.280	124.3	☐
Laundry - Wall 90	Gypsum, Gypsum	☐	0.280	154.2	☐
Long Term Belongings Storage - Wall 68	Gypsum, Gypsum	☐	0.280	154.2	☐
Lounge - Wall 158	Gypsum, Gypsum	☐	0.280	140.4	☐
Lounge - Wall 373	Gypsum, Gypsum	☐	0.280	218.0	☐
Meds - Wall 315	Gypsum, Gypsum	☐	0.280	34.6	☐
Meds - Wall 349	Gypsum, Gypsum	☐	0.280	97.2	☐

Meds - Wall 367	Gypsum, Gypsum	☐	0.280	131.8	☐
Meds - Wall 368	Gypsum, Gypsum	☐	0.280	154.2	☐
Meds - Wall 87	Gypsum, Gypsum	☐	0.280	154.2	☐
Multipurpose/Dining - Wall 107	Gypsum, Gypsum	☐	0.280	230.2	☐
Multipurpose/Dining - Wall 317	Gypsum, Gypsum	☐	0.280	198.5	☐
Multipurpose/Dining - Wall 318	Gypsum, Gypsum	☐	0.280	43.2	☐
Multipurpose/Dining - Wall 319	Gypsum, Gypsum	☐	0.280	26.9	☐
Multipurpose/Dining - Wall 353	Gypsum, Gypsum	☐	0.280	102.2	☐
Noisy Activity 1 - Wall 214	Gypsum, Gypsum	☐	0.280	159.6	☐
Noisy Activity 2 - Wall 257	Gypsum, Gypsum	☐	0.280	161.2	☐
Noisy Activity 2 - Wall 261	Gypsum, Gypsum	☐	0.280	81.7	☐
Noisy Activity 2 - Wall 517	Gypsum, Gypsum	☐	0.280	63.1	☐
Noisy Activity 3 - Wall 298	Gypsum, Gypsum	☐	0.280	160.6	☐
Noisy Activity 3 - Wall 299	Gypsum, Gypsum	☐	0.280	15.2	☐
Noisy Activity 3 - Wall 414	Gypsum, Gypsum	☐	0.280	176.6	☐
Noisy Activity 3 - Wall 512	Gypsum, Gypsum	☐	0.280	159.0	☐
Office 1 - Wall 150	Gypsum, Gypsum	☐	0.280	140.4	☐
Office 1 - Wall 154	Gypsum, Gypsum	☐	0.280	140.4	☐
Office 1 - Wall 372	Gypsum, Gypsum	☐	0.280	107.0	☐
Quiet Activity 1 - Wall 145	Gypsum, Gypsum	☐	0.280	96.2	☐
Quiet Activity 1 - Wall 371	Gypsum, Gypsum	☐	0.280	34.1	☐
Quiet Activity 2 - Wall 231	Gypsum, Gypsum	☐	0.280	81.0	☐
Quiet Activity 2 - Wall 235	Gypsum, Gypsum	☐	0.280	158.9	☐
Quiet Activity 2 - Wall 553	Gypsum, Gypsum	☐	0.280	82.1	☐
Quiet Activity 3 - Wall 516	Gypsum, Gypsum	☐	0.280	78.9	☐
Resident Room 01 - Wall 140	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 01 - Wall 144	Gypsum, Gypsum	☐	0.280	44.1	☐
Resident Room 01 - Wall 193	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 01 - Wall 401	Gypsum, Gypsum	☐	0.280	124.1	☐
Resident Room 03 - Wall 197	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 03 - Wall 201	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 03 - Wall 399	Gypsum, Gypsum	☐	0.280	136.0	☐
Resident Room 06 - Wall 222	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 226	Gypsum, Gypsum	☐	0.280	159.6	☐

Resident Room 08 - Wall 238	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 08 - Wall 241	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 08 - Wall 408	Gypsum, Gypsum	☐	0.280	124.9	☐
Resident Room 10 - Wall 249	Gypsum, Gypsum	☐	0.280	161.2	☐
Resident Room 11 - Wall 266	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 270	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 417	Gypsum, Gypsum	☐	0.280	126.2	☐
Resident Room 13 - Wall 274	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 13 - Wall 278	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 13 - Wall 421	Gypsum, Gypsum	☐	0.280	124.0	☐
Resident Room 14 - Wall 423	Gypsum, Gypsum	☐	0.280	127.5	☐
Resident Room 15 - Wall 286	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 15 - Wall 422	Gypsum, Gypsum	☐	0.280	127.5	☐
Resident Room 16 - Wall 290	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 420	Gypsum, Gypsum	☐	0.280	124.0	☐
Room 01-00 - Wall 563	Gypsum, Gypsum	☐	0.280	48.8	☐
Room 01-03 - Wall 587	Gypsum, Gypsum	☐	0.280	354.4	☐
Room 01-03 - Wall 734	Gypsum, Gypsum	☐	0.280	46.2	☐
Room 01-06 - Wall 604	Gypsum, Gypsum	☐	0.280	4.2	☐
Room 01-06 - Wall 605	Gypsum, Gypsum	☐	0.280	1.5	☐
Room 01-06 - Wall 732	Gypsum, Gypsum	☐	0.280	50.2	☐
Room 01-06 - Wall 775	Gypsum, Gypsum	☐	0.280	330.4	☐
Room 01-08 - Wall 776	Gypsum, Gypsum	☐	0.280	3.9	☐
Room 01-08 - Wall 779	Gypsum, Gypsum	☐	0.280	21.7	☐
Room 01-08 - Wall 795	Gypsum, Gypsum	☐	0.280	57.5	☐
Room 01-10 - Wall 774	Gypsum, Gypsum	☐	0.280	46.7	☐
Sally Port - Wall 30	Gypsum, Gypsum	☐	0.280	126.1	☐
Sally Port - Wall 35	Gypsum, Gypsum	☐	0.280	99.2	☐
Sally Port - Wall 54	Gypsum, Gypsum	☐	0.280	97.2	☐
Servery - Wall 102	Gypsum, Gypsum	☐	0.280	187.3	☐
Servery - Wall 320	Gypsum, Gypsum	☐	0.280	38.3	☐
Servery - Wall 321	Gypsum, Gypsum	☐	0.280	42.9	☐
Servery - Wall 322	Gypsum, Gypsum	☐	0.280	121.6	☐
Servery - Wall 97	Gypsum, Gypsum	☐	0.280	230.2	☐

Shower 1 - Wall 18	Gypsum, Gypsum	☐	0.280	130.3	☐
Shower 1 - Wall 22	Gypsum, Gypsum	☐	0.280	130.3	☐
Shower 1 - Wall 307	Gypsum, Gypsum	☐	0.280	62.3	☐
Shower 1 - Wall 34	Gypsum, Gypsum	☐	0.280	98.8	☐
Shower 2 - Wall 165	Gypsum, Gypsum	☐	0.280	87.5	☐
Shower 2 - Wall 166	Gypsum, Gypsum	☐	0.280	29.4	☐
Shower 2 - Wall 187	Gypsum, Gypsum	☐	0.280	79.9	☐
Shower 2 - Wall 374	Gypsum, Gypsum	☐	0.280	33.0	☐
Shower 2 - Wall 375	Gypsum, Gypsum	☐	0.280	31.0	☐
Shower 2 - Wall 376	Gypsum, Gypsum	☐	0.280	86.6	☐
Shower 4 - Wall 218	Gypsum, Gypsum	☐	0.280	159.6	☐
Shower 6 - Wall 253	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 7 - Wall 294	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 7 - Wall 418	Gypsum, Gypsum	☐	0.280	101.9	☐
Shower 8 - Wall 416	Gypsum, Gypsum	☐	0.280	99.8	☐
Soiled Supply - Wall 124	Gypsum, Gypsum	☐	0.280	119.5	☐
Soiled Supply - Wall 345	Gypsum, Gypsum	☐	0.280	100.0	☐
Soiled Supply - Wall 93	Gypsum, Gypsum	☐	0.280	154.2	☐
Staff Corridor - Wall 358	Gypsum, Gypsum	☐	0.280	78.8	☐
Staff Corridor - Wall 360	Gypsum, Gypsum	☐	0.280	84.2	☐
Staff Corridor - Wall 361	Gypsum, Gypsum	☐	0.280	119.5	☐
Staff Corridor - Wall 362	Gypsum, Gypsum	☐	0.280	84.5	☐
Staff Corridor - Wall 363	Gypsum, Gypsum	☐	0.280	100.0	☐
Staff Corridor - Wall 364	Gypsum, Gypsum	☐	0.280	34.7	☐
Staff Corridor - Wall 365	Gypsum, Gypsum	☐	0.280	105.1	☐
Staff Corridor - Wall 370	Gypsum, Gypsum	☐	0.280	108.0	☐
Staff Corridor - Wall 378	Gypsum, Gypsum	☐	0.280	110.1	☐
Staff Corridor - Wall 379	Gypsum, Gypsum	☐	0.280	90.6	☐
Staff Corridor - Wall 380	Gypsum, Gypsum	☐	0.280	31.0	☐
Staff Corridor - Wall 381	Gypsum, Gypsum	☐	0.280	66.6	☐
Staff Corridor - Wall 382	Gypsum, Gypsum	☐	0.280	112.0	☐
Staff Corridor - Wall 384	Gypsum, Gypsum	☐	0.280	154.2	☐
Staff Corridor - Wall 386	Gypsum, Gypsum	☐	0.280	128.5	☐
Staff Corridor - Wall 387	Gypsum, Gypsum	☐	0.280	121.0	☐

Staff Corridor - Wall 388	Gypsum, Gypsum	☐	0.280	144.9	☐
Storage - Wall 113	Gypsum, Gypsum	☐	0.280	30.9	☐
Storage - Wall 114	Gypsum, Gypsum	☐	0.280	137.5	☐
Storage - Wall 351	Gypsum, Gypsum	☐	0.280	63.0	☐
Toilet 1 - Wall 308	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 1 - Wall 309	Gypsum, Gypsum	☐	0.280	119.0	☐
Toilet 1 - Wall 36	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 3 - Wall 128	Gypsum, Gypsum	☐	0.280	119.5	☐
Toilet 3 - Wall 346	Gypsum, Gypsum	☐	0.280	84.2	☐
Trash - Wall 177	Gypsum, Gypsum	☐	0.280	127.4	☐
Trash - Wall 178	Gypsum, Gypsum	☐	0.280	96.0	☐
Trash - Wall 383	Gypsum, Gypsum	☐	0.280	128.5	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Ante Room - Roof 111-11	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	90.1	0.30	☐
Attrium 2 - Roof 128-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	174.6	0.30	☐
Attrium 2 - Roof 129-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	177.3	0.30	☐
Attrium 2 - Roof 130-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	174.6	0.30	☐
Attrium 2 - Roof 131-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	177.3	0.30	☐
Chart/Hotel - Roof 110-28	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	20.7	0.30	☐
Clean Supply - Roof 105-18	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	112.6	0.30	☐
Comfort Room 1 - Roof 10-10	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	93.2	0.30	☐
Comfort Room 2 - Roof 124-43	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	80.3	0.30	☐
Consult 1 - Roof 122-24	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	98.0	0.30	☐
Consult 2 - Roof 123-25	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	99.4	0.30	☐
Corridor 1 - Roof 102-68	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	318.3	0.30	☐
Corridor 2 - Roof 109-70	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	515.6	0.30	☐
Electric - Roof 07-07	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	205.3	0.30	☐
Emergency Electric - Roof 08-08	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	193.2	0.30	☐
Entry/Waiting - Roof 115-67	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	56.1	0.30	☐
Exam Room - Roof 112-12	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	134.4	0.30	☐
Fire Room - Roof 09-09	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	88.4	0.30	☐
General Storage - Roof 95-39	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	106.5	0.30	☐
Group - Roof 120-22	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	145.6	0.30	☐
Hospitality - Roof 116-01	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	129.5	0.30	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Hskp - Roof 100-14	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	64.8	0.30	☐
Intake Corridor - Roof 113-06	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	168.9	0.30	☐
Interview Room - Roof 125-04	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	119.4	0.30	☐
IT - Roof 99-15	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	171.3	0.30	☐
Kitchen - Roof 96-35	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	402.3	0.30	☐
Laundry - Roof 104-17	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	133.1	0.30	☐
Long Term Belongings Storage - Roof 101-13	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	111.2	0.30	☐
Lounge - Roof 93-33	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	212.5	0.30	☐
Mechanical - Roof 38-38	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	170.1	0.30	☐
Meds - Roof 103-16	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	141.1	0.30	☐
Multipurpose/Dining - Roof 119-21	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	266.5	0.30	☐
Office 1 - Roof 92-32	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	104.3	0.30	☐
Office 2 - Roof 90-31	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	105.2	0.30	☐
Resident Room 15 - Roof 62-62	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1.4	0.30	☐
Resident Room 16 - Roof 63-63	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1.3	0.30	☐
Room 00-80 - Roof 137-80	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	6.2	0.30	☐
Room 00-81 - Roof 138-81	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	3.8	0.30	☐
Room 01-00 - Roof 80-00	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	701.7	0.30	☐
Room 01-01 - Roof 81-01	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	815.2	0.30	☐
Room 01-03 - Roof 83-03	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1,094.5	0.30	☐
Room 01-04 - Roof 84-04	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1,058.1	0.30	☐
Room 01-06 - Roof 86-06	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1,095.7	0.30	☐
Room 01-10 - Roof 134-10	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	862.3	0.30	☐
Room 01-12 - Roof 136-12	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	792.1	0.30	☐
Sally Port - Roof 05-05	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	86.9	0.30	☐
Servery - Roof 117-20	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	124.3	0.30	☐
Service - Roof 97-36	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	323.5	0.30	☐
Shower 1 - Roof 126-03	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	62.5	0.30	☐
Shower 2 - Roof 94-34	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	109.5	0.30	☐
Shower 7 - Roof 64-64	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1.1	0.30	☐
Shower 8 - Roof 65-65	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	1.1	0.30	☐
Soiled Supply - Roof 106-19	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	107.1	0.30	☐
Staff Corridor - Roof 91-71	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	968.1	0.30	☐
Stor. - Roof 118-69	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	18.7	0.30	☐
Storage - Roof 121-23	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	53.5	0.30	☐
Toilet 1 - Roof 114-02	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	52.8	0.30	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Toilet 2 - Roof 107-26	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	70.1	0.30	☐
Toilet 3 - Roof 108-27	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	69.9	0.30	☐
Trash - Roof 98-37	90.1-10 Min Roof Insulation Entirely Above Deck Zone 3	☐	0.047	85.3	0.30	☐

Total Roof Area (ft²) 13,928.4

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Ante Room - Slab 11	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	90.1	☐
Attrium - Slab 82	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	469.1	☐
Chart/Hotel - Slab 28	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	214.1	☐
Clean Supply - Slab 18	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	112.6	☐
Comfort Room 1 - Slab 10	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	93.2	☐
Comfort Room 2 - Slab 43	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	91.3	☐
Consult 1 - Slab 24	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	110.2	☐
Consult 2 - Slab 25	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	111.8	☐
Corridor 1 - Slab 68	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	318.3	☐
Corridor 2 - Slab 70	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	685.5	☐
Corridor 2.1 - Slab 81	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	96.0	☐
Corridor 3 - Slab 74	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	439.2	☐
Corridor 4 - Slab 73	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	348.9	☐
Corridor 5 - Slab 72	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	444.2	☐
Electric - Slab 07	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	205.3	☐
Emergency Electric - Slab 08	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	193.2	☐
Entry/Waiting - Slab 67	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	395.5	☐
Exam Room - Slab 12	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	134.4	☐
Fire Room - Slab 09	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	88.4	☐
General Storage - Slab 39	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	106.5	☐
Group - Slab 22	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	294.2	☐
Hospitality - Slab 01	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	262.2	☐
Hskp - Slab 14	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	64.8	☐
Intake Corridor - Slab 06	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	168.9	☐

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Interview Room - Slab 04	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	170.9	☐
IT - Slab 15	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	171.3	☐
Kitchen - Slab 35	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	402.3	☐
Laundry - Slab 17	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	133.1	☐
Long Term Belongings Storage - Slab 13	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	111.2	☐
Lounge - Slab 33	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	212.5	☐
Mechanical - Slab 38	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	170.1	☐
Meds - Slab 16	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	141.1	☐
Multipurpose/Dining - Slab 21	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	508.3	☐
Noisy Activity 1 - Slab 44	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	193.3	☐
Noisy Activity 2 - Slab 56	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	194.6	☐
Noisy Activity 3 - Slab 66	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	195.9	☐
Office 1 - Slab 32	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	104.3	☐
Office 2 - Slab 31	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	105.2	☐
Quiet Activity 1 - Slab 29	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	142.1	☐
Quiet Activity 2 - Slab 49	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	142.4	☐
Quiet Activity 3 - Slab 57	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	142.9	☐
Resident Room 01 - Slab 30	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	135.3	☐
Resident Room 02 - Slab 40	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	122.6	☐
Resident Room 03 - Slab 41	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	148.3	☐
Resident Room 04 - Slab 42	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	140.7	☐
Resident Room 05 - Slab 48	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	143.0	☐
Resident Room 06 - Slab 47	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	135.5	☐
Resident Room 07 - Slab 50	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	136.9	☐
Resident Room 08 - Slab 51	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	137.9	☐
Resident Room 09 - Slab 52	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	139.5	☐
Resident Room 10 - Slab 53	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	141.5	☐
Resident Room 11 - Slab 58	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	140.8	☐
Resident Room 12 - Slab 59	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	138.3	☐
Resident Room 13 - Slab 60	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	138.3	☐
Resident Room 14 - Slab 61	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	142.2	☐
Resident Room 15 - Slab 62	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	142.1	☐
Resident Room 16 - Slab 63	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	138.3	☐
Room 00-80 - Slab 187	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	11.3	☐
Room 00-81 - Slab 190	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	6.3	☐
Room 01-12 - Slab 182	90.1-10 Min Floors, Steel Joist Zone 3	☐	0.053		13.0	☐

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Room 01-12 - Slab 185	90.1-10 Min Floors, Steel Joist Zone 3	☐	0.053		161.7	☐
Room 01-12 - Slab 188	90.1-10 Min Floors, Steel Joist Zone 3	☐	0.053		78.5	☐
Sally Port - Slab 05	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	86.9	☐
Servery - Slab 20	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	244.2	☐
Service - Slab 36	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	323.5	☐
Shower 1 - Slab 03	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	89.4	☐
Shower 2 - Slab 34	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	109.5	☐
Shower 3 - Slab 46	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	114.6	☐
Shower 4 - Slab 45	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	114.0	☐
Shower 5 - Slab 54	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	114.3	☐
Shower 6 - Slab 55	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	114.2	☐
Shower 7 - Slab 64	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	113.6	☐
Shower 8 - Slab 65	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	111.3	☐
Soiled Supply - Slab 19	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	107.1	☐
Staff Corridor - Slab 71	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	968.1	☐
Stor. - Slab 69	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	18.7	☐
Storage - Slab 23	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	60.1	☐
Toilet 1 - Slab 02	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	75.5	☐
Toilet 2 - Slab 26	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	70.1	☐
Toilet 3 - Slab 27	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	69.9	☐
Trash - Slab 37	90.1-10 Min Slab on Grade Unheated Floor, Zone 1-5	☐		0.730	85.3	☐

* Interzone slabs are not included in the Exterior Slabs subsection. Exposed and Ground Contact Slabs will be shown.

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Electric - Wall 40 - Door 07	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	180.0	S
Emergency Electric - Wall 836 - Door 22	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	90.0	E
Entry/Waiting - Wall 311 - Door 12	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	28.0	180.0	S
Fire Room - Wall 838 - Door 23	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	90.0	E
Lounge - Wall 155 - Door 11	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	180.0	S
Multipurpose/Dining - Wall 106 - Door 02	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	.0	N

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Noisy Activity 1 - Wall 213 - Door 03	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	270.0	W
Noisy Activity 2 - Wall 260 - Door 00	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	.0	N
Noisy Activity 3 - Wall 301 - Door 01	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	21.0	90.6	E
Sally Port - Wall 841 - Door 24	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	25.7	180.0	S
Service - Wall 172 - Door 04	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	49.0	180.0	S
Staff Corridor - Wall 390 - Door 06	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	28.0	180.0	S
Trash - Wall 179 - Door 05	90.1-10 Min Swinging Nonres Zone 1-6	0.756	0.000	0.0000	☐	28.0	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Attrium 2 - Wall 726 - Window 41	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	180.0	S
Attrium 2 - Wall 726 - Window 42	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	180.0	S
Attrium 2 - Wall 727 - Window 43	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	90.0	E
Attrium 2 - Wall 727 - Window 44	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	90.0	E
Attrium 2 - Wall 728 - Window 45	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	.0	N
Attrium 2 - Wall 728 - Window 46	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	.0	N
Attrium 2 - Wall 729 - Window 39	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	270.0	W
Attrium 2 - Wall 729 - Window 40	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.1	270.0	W
Comfort Room 2 - Wall 208 - Window 66	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Consult 1 - Wall 119 - Window 68	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Consult 2 - Wall 122 - Window 67	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Corridor 3 - Wall 424 - Window 05	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.7	.0	N
Corridor 4 - Wall 412 - Window 00	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.8	270.0	W
Corridor 5 - Wall 402 - Window 06	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.7	180.0	S
Entry/Waiting - Wall 312 - Window 01	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 02	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 03	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.8	90.0	E
Entry/Waiting - Wall 313 - Window 04	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	64.7	.0	N
Group - Wall 111 - Window 69	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Group - Wall 111 - Window 70	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Lounge - Wall 155 - Window 49	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	180.0	S
Lounge - Wall 155 - Window 50	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Multipurpose/Dining - Wall 106 - Window 71	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 72	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 73	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	.0	N
Noisy Activity 1 - Wall 213 - Window 51	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	270.0	W
Noisy Activity 1 - Wall 213 - Window 52	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	270.0	W
Noisy Activity 3 - Wall 301 - Window 65	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	90.6	E
Office 1 - Wall 151 - Window 48	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	180.0	S
Office 2 - Wall 147 - Window 47	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	180.0	S
Quiet Activity 2 - Wall 232 - Window 53	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	7.8	180.0	S
Resident Room 01 - Wall 142 - Window 77	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E
Resident Room 02 - Wall 195 - Window 76	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E
Resident Room 03 - Wall 199 - Window 75	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E
Resident Room 04 - Wall 203 - Window 74	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E
Resident Room 05 - Wall 229 - Window 58	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 06 - Wall 225 - Window 57	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 07 - Wall 236 - Window 54	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	17.8	180.0	S
Resident Room 08 - Wall 239 - Window 55	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	17.8	180.0	S
Resident Room 09 - Wall 242 - Window 56	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	17.8	180.0	S
Resident Room 10 - Wall 247 - Window 07	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	17.8	.0	N
Resident Room 11 - Wall 269 - Window 59	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 12 - Wall 273 - Window 60	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 13 - Wall 277 - Window 61	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 14 - Wall 281 - Window 62	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	270.0	W
Resident Room 15 - Wall 283 - Window 63	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E
Resident Room 16 - Wall 288 - Window 64	90.1-10 Window Zone 3A/B Nonmetal Frame	0.651	0.252	0.3187	☐	10.1	90.0	E

Vertical Glazing Areas

Total Area (ft²)
1,153.7

North Facing Area (ft²)
265.7

East Facing Area (ft²)
339.9

South Facing Area (ft²)
371.9

West Facing Area (ft²)
176.2

Room Information Entered Values

Room Type Templates

Room Type: Unconditioned Interstitial Space and Duct Chases

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Schedule: Available (100%)

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(9):

Room 00-80

Room 01-03

Room 01-08

Room 01-00

Room 01-04

Room 01-10

Room 01-01

Room 01-06

Room 01-12

Room Type: PRTF – Atrium

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.6

Number of Fixtures:

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1-19 Public Assembly Spaces - Lobbies

Standard: ASHRAE 62.1 and 170

Type: Lobby (Hotel)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-13 Lobby - Hotel

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Attrium

Attrium 2

Entry/Waiting

Room Type: PRTF – Resident Activity

People Load Name: People Load #001

Activity: Moderately Active Office Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Hotel/Motel/Resort/Dormitory - Multipurpose Assembly

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office - Conference Room

Schedule: Small Hotel Meeting Room - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Conference/Meeting

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Noisy Activity 1

Quiet Activity 1

Noisy Activity 2

Quiet Activity 2

Noisy Activity 3

Quiet Activity 3

Room Type: PRTF – MEP Room

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - MEP

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(5):

Electric

Emergency Electric

Fire Room

IT

Mechanical

Room Type: PRTF – Corridor

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 0

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.4

Ventilation Type: 62.1-16 General - Corridors

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.07 ACH

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-13 Corridor - All Other Corridors

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(8):

Corridor 1
Corridor 3
Intake Corridor

Corridor 2
Corridor 4
Staff Corridor

Corridor 2.1
Corridor 5

Room Type: PRTF – Toilet Room

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 2.0 cfm/ft²

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: General Restroom

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-13 Restroom - All Other Restrooms

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Shower 1
Shower 4
Shower 7
Toilet 2

Shower 2
Shower 5
Shower 8
Toilet 3

Shower 3
Shower 6
Toilet 1

Room Type: PRTF – Resident Bedroom

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 275

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.2

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1-07 Hotel/Motel/Resort/Dormitory - Bedroom/Living Room

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Cafeteria/FF Dining

Schedule: Small Hotel Dining Area - Occupancy

Latent Load (Btuh): 275

Sensible Radiant: 58%

Type: 90.1-13 Dining Area - All Other Dining

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel Dining Elec - Plug Loads

Schedule: Small Hotel Dining Area - Plug Loads

Radiant: 40%

Lost Heat: 20%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(16):

Resident Room 01

Resident Room 04

Resident Room 07

Resident Room 10

Resident Room 13

Resident Room 16

Resident Room 02

Resident Room 05

Resident Room 08

Resident Room 11

Resident Room 14

Resident Room 03

Resident Room 06

Resident Room 09

Resident Room 12

Resident Room 15

Room Type: PRTF – Kitchen

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 33

Light Load Name: Light Load #001

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-13 Lobby - Elevator

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.64

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 17

Ventilation Type: 62.1-19 Food and Beverage Service - Kitchen (cooking)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Utility/Storage

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.25

Ventilation Type: 62.1-13 Office Buildings - Occupiable Storage Rooms for Dry Materials

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Ante Room
Hskp
Meds
Storage

Clean Supply
Laundry
Service
Trash

General Storage
Long Term Belongings Storage
Stor.

Room Type: PRTF – Assembly/Dining

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.75

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Food and Beverage - Restaurant Dining Rooms

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Lobby (Hotel)

Schedule: Small Hotel Employee Lounge - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 60%

Type: 90.1-13 Lounge/Breakroom - All Other Lounges/Breakrooms

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Group
Multipurpose/Dining

Hospitality
Room 00-81

Lounge
Servery

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Room Type: PRTF – Exam/Treatment

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.2

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.75

Ventilation Type: 62.1-19 Outpatient Health Care Facilities - General examination room

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Cafeteria/FF Dining

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(7):

Comfort Room 1

Consult 2

Sally Port

Comfort Room 2

Exam Room

Consult 1

Interview Room

Room Type: PRTF – Office/Admin

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Alternative: Primary

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.7

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 1

Ventilation Type: 62.1-13 Office Buildings - Office Space

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Chart/Hotel

Office 1

Office 2

Modified Rooms

**** Only modified and disabled Loads / Airflows will be displayed.**

Room: Kitchen

Room Type: PRTF – Kitchen

Room Exhaust: Flow Rate: 2,500.0 cfm

Schedule: Casa Exhaust

Design Airflow: Cooling Supply Flow Rate: 2,500.0 cfm

Heating Design Flow Rate: 2,500.0 cfm

Room: Soiled Supply

Room Type: PRTF – Utility/Storage

Room Exhaust: Flow Rate: 1.0 cfm/ft²

Schedule: Available (100%)

Room Information Entered Values

Room Type Templates

Room Type: PRTF – Atrium

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.9

Number of Fixtures:

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Lobby (Hotel)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-10 Lobby - All Other Lobbies

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Area Based Rate:

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(2):

Atrium

Atrium 2

Room Type: Unconditioned Interstitial Space and Duct Chases

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.0 ACH

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Available (100%)

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(9):

Room 00-80
Room 01-03
Room 01-08

Room 01-00
Room 01-04
Room 01-10

Room 01-01
Room 01-06
Room 01-12

Room Type: PRTF – Office/Admin

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.11

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 1

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-10 Office - Enclosed

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Utility/Storage

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.63

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.25

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-10 Storage

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(1):

Trash

Room Type: PRTF – Resident Bedroom

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 275

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Downlights, Compact Fluorescent, TTR

Percent Floor Area: 100%

Heat into Return Air: 78%

Density (W/ft²): 0.38

Type: Cafeteria/FF Dining

Schedule: Small Hotel Dining Area - Occupancy

Latent Load (Btuh): 275

Sensible Radiant: 58%

Type: 90.1-10 Dormitory - Living Quarters

Schedule: Small Hotel - Lighting

Thermal Radiation: 9%

Visible Radiation: 13%

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Small Hotel Dining Elec - Plug Loads

Schedule: Small Hotel Dining Area - Plug Loads

Radiant: 40%

Lost Heat: 20%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Resident Activity

People Load Name: People Load #001

Activity: Moderately Active Office Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.73

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Type: Office - Conference Room

Schedule: Small Hotel Meeting Room - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-10 Lounge/Recreation

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Corridor

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 0

Light Load Name: Light Load #001

Configuration: Downlights, Compact Fluorescent, TTR

Percent Floor Area: 100%

Heat into Return Air: 78%

Density (W/ft²): 0.89

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.07 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-10 Hospital - Corridor/Transition

Schedule: Small Hotel - Lighting

Thermal Radiation: 9%

Visible Radiation 13%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Assembly/Dining

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Type: Lobby (Hotel)

Schedule: Small Hotel Employee Lounge - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 60%

Type: 90.1-10 Dining Area - Family Dining

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation 20%

Alternative: ASHRAE 90.1-2010 Baseline

File: Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Density (W/ft²): 0.89

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(1):

Room 00-81

Room Type: PRTF – MEP Room

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.95

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: 90.1-10 Electrical/Mechanical

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - MEP

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(1):

Room Type: PRTF – Toilet Room**People Load Name:** People Load #001**Activity:** Seated, Very Light Work**Percent Floor Area:** 100%**Sensible Load (Btuh):** 245**Density (ft²/person):** 50**Light Load Name:** Light Load #001**Configuration:** Recessed Fluorescent, Parabolic Louver, Non-Vented, T8**Percent Floor Area:** 100%**Heat into Return Air:** 31%**Density (W/ft²):** 0.98**Misc Eq Load Name:** Misc. Equipment #001**Modeling Method:** Load and Energy**Percent Floor Area:** 100%**Latent:** 0%**Utility Type:** Electric**Density (W/ft²):** 0**Ventilation Type:** None**Standard:** General**Infiltration: Flow Rate:** 0.13 ACH**Room Exhaust: Flow Rate:** 2.0 cfm/ft²**Design Airflow: Cooling Supply Flow Rate:** Auto-Sized**Type:** General Restroom**Schedule:** Small Hotel - Occupancy**Latent Load (Btuh):** 155**Sensible Radiant:** 60%**Type:** 90.1-10 Restrooms**Schedule:** Small Hotel - Lighting**Thermal Radiation:** 22%**Visible Radiation:** 20%**Type:** Small Hotel - Plug Loads (Whole Building)**Schedule:** Small Hotel - Plug Loads**Radiant:** 40%**Lost Heat:** 0%**Schedule:** Available (100%)**General Flow Rate:** 0.0 cfm/ft²**Schedule:** Small Hotel - Infiltration**Schedule:** Available (100%)**Heating Design Flow Rate:** Auto-Sized**Unmodified Rooms(0):****Room Type: PRTF – Exam/Treatment****People Load Name:** People Load #001**Activity:** Sedentary Work**Percent Floor Area:** 100%**Sensible Load (Btuh):** 250**Density (ft²/person):** 100**Light Load Name:** Light Load #001**Type:** Cafeteria/FF Dining**Schedule:** Small Hotel - Occupancy**Latent Load (Btuh):** 200**Sensible Radiant:** 58%**Type:** 90.1-10 Hospital - Exam/Treatment

Configuration: Downlights, Compact Fluorescent, TTR

Percent Floor Area: 100% **Heat into Return Air:** 78%

Density (W/ft²): 1.66

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100% **Latent:** 0%

Utility Type: Electric **Density (W/ft²):** 0.75

Ventilation Type: None

Standard: General

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Lighting

Thermal Radiation: 9%

Visible Radiation: 13%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Kitchen

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100% **Sensible Load (Btuh):** 250

Density (ft²/person): 33

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100% **Heat into Return Air:** 31%

Density (W/ft²): 0.64

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100% **Latent:** 0%

Utility Type: Electric **Density (W/ft²):** 17

Ventilation Type: 62.1-19 Food and Beverage Service - Kitchen (cooking)

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-10 Food Preparation

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

People Based Rate: 7.5 cfm/person

0.12 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Modified Rooms**** Only modified and disabled Loads / Airflows will be displayed.****Room: Office 1****Room Type: PRTF – Office/Admin****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.11001 cfm/ft²**Room: Resident Room 03****Room Type: PRTF – Resident Bedroom****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.11 cfm/ft²**Room: Meds****Room Type: PRTF – Utility/Storage****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.0561 cfm/ft²**Room: Noisy Activity 3****Room Type: PRTF – Resident Activity****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.21001 cfm/ft²**Room: Resident Room 08****Room Type: PRTF – Resident Bedroom****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.10999 cfm/ft²**Room: Resident Room 13****Room Type: PRTF – Resident Bedroom****Ventilation Type:** None**Schedule:** Available (100%)**Standard:** General**General Flow Rate:** 0.10999 cfm/ft²

Room: Resident Room 11**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10999 cfm/ft²

Room: Resident Room 14**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10996 cfm/ft²

Room: Resident Room 15**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10999 cfm/ft²

Room: Corridor 4**Room Type: PRTF – Corridor**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.06 cfm/ft²

Room: Hskp**Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²

Room: Servery**Room Type: PRTF – Assembly/Dining**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.33001 cfm/ft²

Room: IT**Room Type: PRTF – MEP Room**

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0561 cfm/ft²

Room: Laundry

Room Type: PRTF – Utility/Storage

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²

Room: Resident Room 01

Room Type: PRTF – Resident Bedroom

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.11 cfm/ft²

Room: Chart/Hotel

Room Type: PRTF – Office/Admin

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.11001 cfm/ft²

Room: Shower 1

Room Type: PRTF – Toilet Room

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.14743 cfm/ft²

Room: Lounge

Room Type: PRTF – Assembly/Dining

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.21994 cfm/ft²

Room: Corridor 5

Room Type: PRTF – Corridor

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.06 cfm/ft²

Room: Resident Room 09**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10999 cfm/ft²

Room: Corridor 2.1**Room Type: PRTF – Corridor**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²

Room: Consult 2**Room Type: PRTF – Exam/Treatment**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.25504 cfm/ft²

Room: Quiet Activity 2**Room Type: PRTF – Resident Activity**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.20994 cfm/ft²

Room: Resident Room 06**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10998 cfm/ft²

Room: Resident Room 16**Room Type: PRTF – Resident Bedroom**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.10999 cfm/ft²

Room: Noisy Activity 1**Room Type: PRTF – Resident Activity**

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.21 cfm/ft²

Room: Multipurpose/Dining

Room Type: PRTF – Assembly/Dining

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.32998 cfm/ft²

Room: Resident Room 10

Room Type: PRTF – Resident Bedroom

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.10997 cfm/ft²

Room: Shower 2

Room Type: PRTF – Toilet Room

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.21994 cfm/ft²

Room: Resident Room 05

Room Type: PRTF – Resident Bedroom

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.11004 cfm/ft²

Room: Quiet Activity 1

Room Type: PRTF – Resident Activity

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.21 cfm/ft²

Room: Hospitality

Room Type: PRTF – Assembly/Dining

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.32998 cfm/ft²

Room: Shower 7**Room Type: PRTF – Toilet Room****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.0 cfm/ft²**Room: Noisy Activity 2****Room Type: PRTF – Resident Activity****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.21003 cfm/ft²**Room: Kitchen****Room Type: PRTF – Kitchen****Ventilation Type:** 62.1-19 Food and Beverage Service - Kitchen (cooking)**Standard:** ASHRAE 62.1 and 170**Schedule:** Available (100%)**People Based Rate:** 7.5 cfm/person**Area Based Rate:** 0.12 cfm/ft²**Room Exhaust: Flow Rate:** 2,500.0 cfm**Schedule:** Casa Exhaust**Design Airflow: Cooling Supply Flow Rate:** 2,500.0 cfm**Heating Design Flow Rate:** 2,500.0 cfm**Room: Ante Room****Room Type: PRTF – Utility/Storage****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.1593 cfm/ft²**Room: Corridor 1****Room Type: PRTF – Corridor****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.0561 cfm/ft²**Room: Shower 8****Room Type: PRTF – Toilet Room****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.0 cfm/ft²

Room: Corridor 3**Room Type: PRTF – Corridor****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.06 cfm/ft²**Room: Staff Corridor****Room Type: PRTF – Corridor****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.0561 cfm/ft²**Room: Consult 1****Room Type: PRTF – Exam/Treatment****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.25504 cfm/ft²**Room: Sally Port****Room Type: PRTF – Exam/Treatment****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.14743 cfm/ft²**Room: Office 2****Room Type: PRTF – Office/Admin****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.11001 cfm/ft²**Room: Interview Room****Room Type: PRTF – Exam/Treatment****Ventilation Type:** None**Standard:** General**Schedule:** Available (100%)**General Flow Rate:** 0.14743 cfm/ft²**Room: Quiet Activity 3****Room Type: PRTF – Resident Activity****Ventilation Type:** None**Schedule:** Available (100%)

Standard: General

General Flow Rate: 0.21002 cfm/ft²

Room: Toilet 1

Room Type: PRTF – Toilet Room

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0561 cfm/ft²

Room: Soiled Supply

Room Type: PRTF – Utility/Storage

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0561 cfm/ft²

Room Exhaust: Flow Rate: 1.0 cfm/ft²

Schedule: Available (100%)

Room: Resident Room 07

Room Type: PRTF – Resident Bedroom

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.10999 cfm/ft²

Room: Emergency Electric

Room Type: PRTF – MEP Room

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.05999 cfm/ft²

Room: Shower 6

Room Type: PRTF – Toilet Room

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0 cfm/ft²

Room: Resident Room 04

Room Type: PRTF – Resident Bedroom

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.11 cfm/ft²

Room: Electric**Room Type: PRTF – MEP Room**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.05999 cfm/ft²

Room: Shower 4**Room Type: PRTF – Toilet Room**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²

Room: Storage**Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²

Room: Long Term Belongings Storage**Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.16727 cfm/ft²

Room: Stor.**Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²

Room: Comfort Room 1**Room Type: PRTF – Exam/Treatment**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.1593 cfm/ft²

Room: Toilet 3**Room Type: PRTF – Toilet Room**

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.0561 cfm/ft²

Room: Resident Room 02

Room Type: PRTF – Resident Bedroom

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.11 cfm/ft²

Room: Entry/Waiting

Room Type: PRTF – Atrium

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.08499 cfm/ft²

Room: Corridor 2

Room Type: PRTF – Corridor

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.0561 cfm/ft²

Room: Group

Room Type: PRTF – Assembly/Dining

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.33002 cfm/ft²

Room: Mechanical

Room Type: PRTF – MEP Room

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.05999 cfm/ft²

Room: Resident Room 12

Room Type: PRTF – Resident Bedroom

Ventilation Type: None
Standard: General

Schedule: Available (100%)
General Flow Rate: 0.10999 cfm/ft²

Room: Shower 5**Room Type: PRTF – Toilet Room**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0 cfm/ft²**Room: Toilet 2****Room Type: PRTF – Toilet Room**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²**Room: Comfort Room 2****Room Type: PRTF – Exam/Treatment**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.25504 cfm/ft²**Room: Intake Corridor****Room Type: PRTF – Corridor**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.14743 cfm/ft²**Room: Service****Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.33582 cfm/ft²**Room: General Storage****Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Standard: General

Schedule: Available (100%)

General Flow Rate: 0.0561 cfm/ft²**Room: Clean Supply****Room Type: PRTF – Utility/Storage**

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0561 cfm/ft²

Room: Shower 3

Room Type: PRTF – Toilet Room

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.0 cfm/ft²

Room: Exam Room

Room Type: PRTF – Exam/Treatment

Ventilation Type: None

Schedule: Available (100%)

Standard: General

General Flow Rate: 0.16727 cfm/ft²

Room Geometries Entered Values

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Ante Room	12.0	0.0	0.0	81	969.9	☐	☐
Atrium	18.0	0.0	0.0	622	9,249.7	☐	☐
Atrium 2	11.0	0.0	0.0	645	5,793.5	☐	☐
Chart/Hotel	12.0	0.0	0.0	200	2,395.0	☐	☐
Clean Supply	12.0	0.0	0.0	102	1,224.0	☐	☐
Comfort Room 1	12.0	0.0	0.0	84	1,005.5	☐	☐
Comfort Room 2	12.0	0.0	0.0	82	984.6	☐	☐
Consult 1	12.0	0.0	0.0	100	1,199.3	☐	☐
Consult 2	12.0	0.0	0.0	101	1,217.6	☐	☐
Corridor 1	12.0	0.0	0.0	295	3,545.7	☐	☐
Corridor 2	12.0	0.0	0.0	635	7,618.9	☐	☐
Corridor 2.1	12.0	0.0	0.0	86	1,026.1	☐	☐
Corridor 3	12.0	0.0	0.0	409	4,908.8	☐	☐
Corridor 4	12.0	0.0	0.0	324	3,887.8	☐	☐
Corridor 5	12.0	0.0	0.0	414	4,967.4	☐	☐
Electric	12.0	0.0	0.0	191	2,286.9	☐	☐
Emergency Electric	12.0	0.0	0.0	179	2,146.3	☐	☐
Entry/Waiting	12.0	0.0	0.0	370	4,445.3	☐	☐
Exam Room	12.0	0.0	0.0	123	1,476.3	☐	☐
Fire Room	12.0	0.0	0.0	79	950.9	☐	☐
General Storage	12.0	0.0	0.0	96	1,147.3	☐	☐
Group	12.0	0.0	0.0	276	3,317.2	☐	☐
Hospitality	12.0	0.0	0.0	246	2,952.5	☐	☐
Hskp	12.0	0.0	0.0	57	681.7	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Intake Corridor	12.0	0.0	0.0	155	1,858.0	☐	☐
Interview Room	12.0	0.0	0.0	158	1,893.9	☐	☐
IT	12.0	0.0	0.0	158	1,895.8	☐	☐
Kitchen	12.0	0.0	0.0	382	4,584.0	☐	☐
Laundry	12.0	0.0	0.0	122	1,461.1	☐	☐
Long Term Belongings Storage	12.0	0.0	0.0	101	1,208.4	☐	☐
Lounge	12.0	0.0	0.0	198	2,373.5	☐	☐
Mechanical	12.0	0.0	0.0	155	1,856.6	☐	☐
Meds	12.0	0.0	0.0	129	1,553.0	☐	☐
Multipurpose/Dining	12.0	0.0	0.0	485	5,825.0	☐	☐
Noisy Activity 1	12.0	0.0	0.0	180	2,155.9	☐	☐
Noisy Activity 2	12.0	0.0	0.0	181	2,170.4	☐	☐
Noisy Activity 3	12.0	0.0	0.0	182	2,185.6	☐	☐
Office 1	12.0	0.0	0.0	94	1,130.4	☐	☐
Office 2	12.0	0.0	0.0	95	1,141.8	☐	☐
Quiet Activity 1	12.0	0.0	0.0	130	1,564.2	☐	☐
Quiet Activity 2	12.0	0.0	0.0	131	1,567.6	☐	☐
Quiet Activity 3	12.0	0.0	0.0	131	1,573.4	☐	☐
Resident Room 01	12.0	0.0	0.0	124	1,486.4	☐	☐
Resident Room 02	12.0	0.0	0.0	112	1,339.9	☐	☐
Resident Room 03	12.0	0.0	0.0	136	1,636.2	☐	☐
Resident Room 04	12.0	0.0	0.0	129	1,548.6	☐	☐
Resident Room 05	12.0	0.0	0.0	131	1,575.1	☐	☐
Resident Room 06	12.0	0.0	0.0	124	1,487.7	☐	☐
Resident Room 07	12.0	0.0	0.0	125	1,504.4	☐	☐
Resident Room 08	12.0	0.0	0.0	126	1,515.3	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Resident Room 09	12.0	0.0	0.0	128	1,534.5	☐	☐
Resident Room 10	12.0	0.0	0.0	130	1,557.2	☐	☐
Resident Room 11	12.0	0.0	0.0	129	1,549.2	☐	☐
Resident Room 12	12.0	0.0	0.0	127	1,520.4	☐	☐
Resident Room 13	12.0	0.0	0.0	127	1,520.6	☐	☐
Resident Room 14	12.0	0.0	0.0	130	1,564.9	☐	☐
Resident Room 15	12.0	0.0	0.0	130	1,564.3	☐	☐
Resident Room 16	12.0	0.0	0.0	127	1,520.0	☐	☐
Room 00-80	12.0	0.0	0.0	4	46.4	☐	☐
Room 00-81	12.0	0.0	0.0	3	40.3	☐	☐
Room 01-00	6.0	0.0	0.0	634	2,007.4	☐	☐
Room 01-01	6.0	0.0	0.0	748	2,383.8	☐	☐
Room 01-03	6.0	0.0	0.0	1,001	3,162.5	☐	☐
Room 01-04	6.0	0.0	0.0	959	2,991.1	☐	☐
Room 01-06	6.0	0.0	0.0	1,009	3,156.0	☐	☐
Room 01-08	6.0	0.0	0.0	1,572	4,817.2	☐	☐
Room 01-10	6.0	0.0	0.0	769	2,562.8	☐	☐
Room 01-12	6.0	0.0	0.0	675	2,043.9	☐	☐
Sally Port	12.0	0.0	0.0	78	933.1	☐	☐
Servery	12.0	0.0	0.0	228	2,738.4	☐	☐
Service	12.0	0.0	0.0	304	3,642.3	☐	☐
Shower 1	12.0	0.0	0.0	80	961.4	☐	☐
Shower 2	12.0	0.0	0.0	99	1,187.2	☐	☐
Shower 3	12.0	0.0	0.0	104	1,246.9	☐	☐
Shower 4	12.0	0.0	0.0	103	1,239.3	☐	☐
Shower 5	12.0	0.0	0.0	104	1,242.8	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Shower 6	12.0	0.0	0.0	104	1,242.2	☐	☐
Shower 7	12.0	0.0	0.0	103	1,235.2	☐	☐
Shower 8	12.0	0.0	0.0	101	1,208.4	☐	☐
Soiled Supply	12.0	0.0	0.0	97	1,161.1	☐	☐
Staff Corridor	12.0	0.0	0.0	893	10,720.0	☐	☐
Stor.	12.0	0.0	0.0	15	174.6	☐	☐
Storage	12.0	0.0	0.0	52	624.5	☐	☐
Toilet 1	12.0	0.0	0.0	67	802.2	☐	☐
Toilet 2	12.0	0.0	0.0	62	742.3	☐	☐
Toilet 3	12.0	0.0	0.0	62	739.8	☐	☐
Trash	12.0	0.0	0.0	76	915.0	☐	☐

Room Geometries Entered Values

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Ante Room	12.0	0.0	0.0	81	969.9	☐	☐
Atrium	18.0	0.0	0.0	622	9,249.7	☐	☐
Atrium 2	11.0	0.0	0.0	645	5,793.5	☐	☐
Chart/Hotel	12.0	0.0	0.0	200	2,395.0	☐	☐
Clean Supply	12.0	0.0	0.0	102	1,224.0	☐	☐
Comfort Room 1	12.0	0.0	0.0	84	1,005.5	☐	☐
Comfort Room 2	12.0	0.0	0.0	82	984.6	☐	☐
Consult 1	12.0	0.0	0.0	100	1,199.3	☐	☐
Consult 2	12.0	0.0	0.0	101	1,217.6	☐	☐
Corridor 1	12.0	0.0	0.0	295	3,545.7	☐	☐
Corridor 2	12.0	0.0	0.0	635	7,618.9	☐	☐
Corridor 2.1	12.0	0.0	0.0	86	1,026.1	☐	☐
Corridor 3	12.0	0.0	0.0	409	4,908.8	☐	☐
Corridor 4	12.0	0.0	0.0	324	3,887.8	☐	☐
Corridor 5	12.0	0.0	0.0	414	4,967.4	☐	☐
Electric	12.0	0.0	0.0	191	2,286.9	☐	☐
Emergency Electric	12.0	0.0	0.0	179	2,146.3	☐	☐
Entry/Waiting	12.0	0.0	0.0	370	4,445.3	☐	☐
Exam Room	12.0	0.0	0.0	123	1,476.3	☐	☐
Fire Room	12.0	0.0	0.0	79	950.9	☐	☐
General Storage	12.0	0.0	0.0	96	1,147.3	☐	☐
Group	12.0	0.0	0.0	276	3,317.2	☐	☐
Hospitality	12.0	0.0	0.0	246	2,952.5	☐	☐
Hskp	12.0	0.0	0.0	57	681.7	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Intake Corridor	12.0	0.0	0.0	155	1,858.0	☐	☐
Interview Room	12.0	0.0	0.0	158	1,893.9	☐	☐
IT	12.0	0.0	0.0	158	1,895.8	☐	☐
Kitchen	12.0	0.0	0.0	382	4,584.0	☐	☐
Laundry	12.0	0.0	0.0	122	1,461.1	☐	☐
Long Term Belongings Storage	12.0	0.0	0.0	101	1,208.4	☐	☐
Lounge	12.0	0.0	0.0	198	2,373.5	☐	☐
Mechanical	12.0	0.0	0.0	155	1,856.6	☐	☐
Meds	12.0	0.0	0.0	129	1,553.0	☐	☐
Multipurpose/Dining	12.0	0.0	0.0	485	5,825.0	☐	☐
Noisy Activity 1	12.0	0.0	0.0	180	2,155.9	☐	☐
Noisy Activity 2	12.0	0.0	0.0	181	2,170.4	☐	☐
Noisy Activity 3	12.0	0.0	0.0	182	2,185.6	☐	☐
Office 1	12.0	0.0	0.0	94	1,130.4	☐	☐
Office 2	12.0	0.0	0.0	95	1,141.8	☐	☐
Quiet Activity 1	12.0	0.0	0.0	130	1,564.2	☐	☐
Quiet Activity 2	12.0	0.0	0.0	131	1,567.6	☐	☐
Quiet Activity 3	12.0	0.0	0.0	131	1,573.4	☐	☐
Resident Room 01	12.0	0.0	0.0	124	1,486.4	☐	☐
Resident Room 02	12.0	0.0	0.0	112	1,339.9	☐	☐
Resident Room 03	12.0	0.0	0.0	136	1,636.2	☐	☐
Resident Room 04	12.0	0.0	0.0	129	1,548.6	☐	☐
Resident Room 05	12.0	0.0	0.0	131	1,575.1	☐	☐
Resident Room 06	12.0	0.0	0.0	124	1,487.7	☐	☐
Resident Room 07	12.0	0.0	0.0	125	1,504.4	☐	☐
Resident Room 08	12.0	0.0	0.0	126	1,515.3	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Resident Room 09	12.0	0.0	0.0	128	1,534.5	☐	☐
Resident Room 10	12.0	0.0	0.0	130	1,557.2	☐	☐
Resident Room 11	12.0	0.0	0.0	129	1,549.2	☐	☐
Resident Room 12	12.0	0.0	0.0	127	1,520.4	☐	☐
Resident Room 13	12.0	0.0	0.0	127	1,520.6	☐	☐
Resident Room 14	12.0	0.0	0.0	130	1,564.9	☐	☐
Resident Room 15	12.0	0.0	0.0	130	1,564.3	☐	☐
Resident Room 16	12.0	0.0	0.0	127	1,520.0	☐	☐
Room 00-80	12.0	0.0	0.0	4	46.4	☐	☐
Room 00-81	12.0	0.0	0.0	3	40.3	☐	☐
Room 01-00	6.0	0.0	0.0	634	2,007.4	☐	☐
Room 01-01	6.0	0.0	0.0	748	2,383.8	☐	☐
Room 01-03	6.0	0.0	0.0	1,001	3,162.5	☐	☐
Room 01-04	6.0	0.0	0.0	959	2,991.1	☐	☐
Room 01-06	6.0	0.0	0.0	1,009	3,156.0	☐	☐
Room 01-08	6.0	0.0	0.0	1,572	4,817.2	☐	☐
Room 01-10	6.0	0.0	0.0	769	2,562.8	☐	☐
Room 01-12	6.0	0.0	0.0	675	2,043.9	☐	☐
Sally Port	12.0	0.0	0.0	78	933.1	☐	☐
Servery	12.0	0.0	0.0	228	2,738.4	☐	☐
Service	12.0	0.0	0.0	304	3,642.3	☐	☐
Shower 1	12.0	0.0	0.0	80	961.4	☐	☐
Shower 2	12.0	0.0	0.0	99	1,187.2	☐	☐
Shower 3	12.0	0.0	0.0	104	1,246.9	☐	☐
Shower 4	12.0	0.0	0.0	103	1,239.3	☐	☐
Shower 5	12.0	0.0	0.0	104	1,242.8	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Shower 6	12.0	0.0	0.0	104	1,242.2	☐	☐
Shower 7	12.0	0.0	0.0	103	1,235.2	☐	☐
Shower 8	12.0	0.0	0.0	101	1,208.4	☐	☐
Soiled Supply	12.0	0.0	0.0	97	1,161.1	☐	☐
Staff Corridor	12.0	0.0	0.0	893	10,720.0	☐	☐
Stor.	12.0	0.0	0.0	15	174.6	☐	☐
Storage	12.0	0.0	0.0	52	624.5	☐	☐
Toilet 1	12.0	0.0	0.0	67	802.2	☐	☐
Toilet 2	12.0	0.0	0.0	62	742.3	☐	☐
Toilet 3	12.0	0.0	0.0	62	739.8	☐	☐
Trash	12.0	0.0	0.0	76	915.0	☐	☐

Entered Values Zone Information

Zone Type Section

Zone Type: PRTF – Activity Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Admin Zone (Offices/Reception)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)****Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Kitchen Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Bedroom Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Shower Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff corridor core)**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zone Type: Small Hotel****Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zones Section****** Information for unmodified zones is in the Zone Type Section.****Zone Name:** ACT-Noisy-1**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 1

Zone Name: ACT-Noisy-2**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 2

Alternative: Primary**File:** Casa De Amparo_v4.mdf

TRACE 3D Plus 7.00

214

Zone Name: ACT-Noisy-3	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Noisy Activity 3		
Zone Name: ACT-Quiet-1	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 1		
Zone Name: ACT-Quiet-2	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 2		
Zone Name: ACT-Quiet-3	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 3		
Zone Name: Admin	Zone Type: Small Hotel	Modified: ☐
Assigned Rooms(2):		
Office 1Office 2		
Zone Name: Atrium	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Atrium 2Atrium		
Zone Name: Chart/Hotel	Zone Type: PRTF – Admin Zone (Offices/Reception)	Modified: ☐
Assigned Rooms(1):		
Chart/Hotel		
Zone Name: Comfort/Consult	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(3):		
Comfort Room 2Consult 1Consult 2		

Zone Name: Intake-HR-B	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(2): Comfort Room 1 Ante Room		
Zone Name: Kitchen	Zone Type: PRTF – Kitchen Zone	Modified: ☐
Assigned Rooms(2): Kitchen Service		
Zone Name: Lounge	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(2): Lounge Shower 2		
Zone Name: Multipurpose/Dining	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1): Multipurpose/Dining		
Zone Name: RB-N-Corner	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1): Resident Room 14		
Zone Name: RB-N-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(2): Resident Room 15 Resident Room 16		
Zone Name: RB-N-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3): Resident Room 11 Resident Room 12 Resident Room 13		
Zone Name: RB-S-Corner-N	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1): Resident Room 04		

Zone Name: RB-S-Corner-S	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 05		
Zone Name: RB-S-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 02	Resident Room 03	Resident Room 01
Zone Name: RB-S-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 06		
Zone Name: RB-W-North	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 10		
Zone Name: RB-W-South	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 07	Resident Room 08	Resident Room 09
Zone Name: Served	Zone Type: PRTF – Common Program Zone (Multipurpose/Served/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Served		
Zone Name: SHWR-N	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 7	Shower 8	
Zone Name: SHWR-S	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 3	Shower 4	

Zone Name: SHWR-W	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 5	Shower 6	
Zone Name: Support	Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)	Modified: ☐
Assigned Rooms(4):		
Fire Room Mechanical	Electric	Emergency Electric
Zone Name: Utility	Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff corridor core)	Modified: ☐
Assigned Rooms(16):		
Soiled Supply Laundry Storage Corridor 2 Toilet 3 Corridor 2.1	Clean Supply Meds Staff Corridor Toilet 1 IT	Hskp Stor. Corridor 1 Toilet 2 General Storage

Entered Values Zone Information

Zone Type Section

Zone Type: PRTF – Activity Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule: Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zones Section

**** Information for unmodified zones is in the Zone Type Section.**

Zone Name: ACT-Noisy-1

Zone Type: PRTF – Activity Zone

Modified: ☐

Assigned Rooms(1):

Noisy Activity 1

Zone Name: ACT-Noisy-2

Zone Type: PRTF – Activity Zone

Modified: ☐

Assigned Rooms(1):

Noisy Activity 2

Zone Name: ACT-Noisy-3

Zone Type: PRTF – Activity Zone

Modified: ☐

Assigned Rooms(1):

Noisy Activity 3

Zone Name: ACT-Quiet-1

Zone Type: PRTF – Activity Zone

Modified: ☐

Assigned Rooms(1):

Quiet Activity 1

Modified: ☐

Assigned Rooms(1):

Quiet Activity 2

Modified: ☐

Assigned Rooms(1):

Quiet Activity 3

Modified: ☐

Assigned Rooms(2):

Office 1

Office 2

Modified: ☐

Assigned Rooms(2):

Attrium

Attrium 2

Modified: ☐

Assigned Rooms(1):

Chart/Hotel

Modified: ☐

Assigned Rooms(3):

Comfort Room 2

Consult 1

Consult 2

Modified: ☐

Assigned Rooms(1):

Corridor 3

Modified: ☐

Assigned Rooms(1):

Corridor 5

Zone Name: Corridor-W	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Corridor 4		
Zone Name: Entry/Waiting	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Entry/Waiting		
Zone Name: Exam/Storage	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Exam Room Long Term Belongings Storage		
Zone Name: Fire Room	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Fire Room		
Zone Name: Group	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Group		
Zone Name: Hospitality	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Hospitality		
Zone Name: Intake-HR-A	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(4):		
Sally Port Interview Room Intake Corridor Shower 1		
Zone Name: Intake-HR-B	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Comfort Room 1 Ante Room		

Zone Name: Kitchen	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Kitchen	Service	
Zone Name: Lounge	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Lounge	Shower 2	
Zone Name: Multipurpose/Dining	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Multipurpose/Dining		
Zone Name: RB-N-Corner	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 14		
Zone Name: RB-N-East	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Resident Room 15	Resident Room 16	
Zone Name: RB-N-West	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 11	Resident Room 12	Resident Room 13
Zone Name: RB-S-Corner-N	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 04		
Zone Name: RB-S-Corner-S	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 05		

Zone Name: RB-S-East	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 02	Resident Room 03	Resident Room 01
Zone Name: RB-S-West	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 06		
Zone Name: RB-W-North	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 10		
Zone Name: RB-W-South	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 07	Resident Room 08	Resident Room 09
Zone Name: Servery	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Servery		
Zone Name: SHWR-N	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Shower 7	Shower 8	
Zone Name: SHWR-S	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Shower 3	Shower 4	
Zone Name: SHWR-W	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Shower 5	Shower 6	

Zone Name: Support	Zone Type: PRTF – Activity Zone	Modified: ☐
---------------------------	--	---

Assigned Rooms(3):

Electric	Emergency Electric	Mechanical
----------	--------------------	------------

Zone Name: Utility	Zone Type: PRTF – Activity Zone	Modified: ☐
---------------------------	--	---

Assigned Rooms(16):

Soiled Supply	Clean Supply	Hskp
Laundry	Meds	Stor.
Storage	Staff Corridor	Corridor 1
Corridor 2	Toilet 1	Toilet 2
Toilet 3	IT	General Storage
Corridor 2.1		