

Casa De Amparo_v5



Building Owner:

Location:

Created by:

File name: Casa De Amparo_v5.mdfz

Simulated by: TRACE 3D Plus 7.00

Room Cooling and Heating Loads by Component

ROOM_Ante Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	207	0	207	33.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	65	0	65	10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	45	0	-13	32	5.1
Envelope Subtotal	45	270	-13	302	-
People	42	58	81	181	29.0
Lights	36	55	0	91	14.5
Miscellaneous Loads	10	0	0	10	1.7
Internal Subtotal	89	113	81	282	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	133	381	68	583	100.0
RA Sensible (Lights)	41	0	0	41	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-124	0	-124	54.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-27	0	-27	11.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-92	40.0
Envelope Subtotal	-88	-141	0	-232	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-1.5
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-84	-141	0	-229	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	25
Cooling ACH	1.55
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.62
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	25
Heating ACH	1.55
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.62
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	90
Other Roof	90
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	456
Exterior Floor	0
Internal Floor	0
Slab	90
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	0.40
%OA	40	People per 1000 ft²	5
cfm/ft²	0.31	Volume (ft³)	970
cfm/ton	510		
ft²/ton	1,664		
Btu/h-ft²	7.21		

Engineering Checks For Heating

Heating Mbh	-0.23	No People(max)	0.40
%OA	40	People per 1000 ft²	5
cfm/ft²	0.31	Volume (ft³)	970
cfm/Mbh	-108		
ft²/Mbh	-353		
Btu/h-ft²	-2.83		

ROOM_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	532	0	532	13.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	433	0	433	11.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-20	0	-20	-0.5
Slab	0	-27	0	-27	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	381	0	-116	264	6.8
Envelope Subtotal	381	918	-116	1,182	-
People	305	480	482	1,266	32.7
Lights	338	552	0	890	23.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	642	1,032	482	2,157	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	148	0	148	3.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	1,023	2,093	365	3,481	100.0
RA Sensible (Lights)	388	0	0	388	-

Engineering Checks For Cooling

Cooling tons	0.29	No People(max)	3.11
%OA	27	People per 1000 ft²	5
cfm/ft²	0.24	Volume (ft³)	9,250
cfm/ton	517		
ft²/ton	2,143		
Btu/h-ft²	5.60		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-592	0	-592	28.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-417	0	-417	19.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	26	0	26	-1.2
Slab	0	62	0	62	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-835	0	0	-873	41.4
Envelope Subtotal	-835	-921	0	-1,794	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-314	0	-314	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.1
Grand Total	-835	-1,237	0	-2,111	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.11	No People(max)	3.11
%OA	27	People per 1000 ft²	5
cfm/ft²	0.24	Volume (ft³)	9,250
cfm/Mbh	-71		
ft²/Mbh	-295		
Btu/h-ft²	-3.39		

Cooling Airflows

Main Fan cfm	150
Cooling ACH	0.97
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	40
Calculated Ventilation ACH	0.26
Infiltration cfm	20
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	150
Heating ACH	0.97
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	40
Calculated Ventilation ACH	0.26
Infiltration cfm	20
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	671
Window	0
Door	0
Wall	332
Below-Grade Wall	0
Other Wall	332
Partition	1,426
Exterior Floor	0
Internal Floor	207
Slab	469
Other Floor	207

ROOM_Attrium 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,319	0	1,319	21.9
Other Roof	0	0	0	0	0.0
Glass	866	698	0	1,564	26.0
Door	0	0	0	0	0.0
Wall	0	1,214	0	1,214	20.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-583	0	-583	-9.7
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	262	0	-154	109	1.8
Envelope Subtotal	1,128	2,647	-154	3,621	-
People	316	409	500	1,224	20.3
Lights	351	466	0	817	13.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	667	875	500	2,041	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-41	0	-41	-0.7
Grand Total	1,795	3,481	346	5,622	100.0
RA Sensible (Lights)	403	0	0	403	-

Engineering Checks For Cooling

Cooling tons	0.47	No People(max)	3.23
%OA	27	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	5,793
cfm/ton	542		
ft²/ton	1,377		
Btu/h-ft²	8.71		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-932	0	-932	30.5
Other Roof	0	0	0	0	0.0
Glass	-749	0	0	-749	24.5
Door	0	0	0	0	0.0
Wall	0	-1,130	0	-1,130	37.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	314	0	314	-10.3
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	-524	0	0	-550	18.0
Envelope Subtotal	-1,272	-1,747	0	-3,046	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	0.4
Grand Total	-1,272	-1,759	0	-3,057	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.06	No People(max)	3.23
%OA	27	People per 1000 ft²	5
cfm/ft²	0.39	Volume (ft³)	5,793
cfm/Mbh	-83		
ft²/Mbh	-211		
Btu/h-ft²	-4.74		

Cooling Airflows

Main Fan cfm	254
Cooling ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	68
Calculated Ventilation ACH	0.70
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	254
Heating ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	68
Calculated Ventilation ACH	0.70
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	704
Other Roof	704
Ceiling	0
Window	57
Door	0
Wall	715
Below-Grade Wall	0
Other Wall	715
Partition	0
Exterior Floor	0
Internal Floor	671
Slab	0
Other Floor	671

ROOM_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 48.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	13	0	13	0.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-47	14	0.7
Envelope Subtotal	60	43	-47	57	-
People	210	286	399	895	47.8
Lights	134	206	0	341	18.2
Miscellaneous Loads	341	0	0	341	18.2
Internal Subtotal	684	492	399	1,576	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	87	0	87	4.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	745	619	352	1,716	100.0
RA Sensible (Lights)	154	0	0	154	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.00
%OA	31	People per 1000 ft²	10
cfm/ft²	0.34	Volume (ft³)	2,395
cfm/ton	468		
ft²/ton	1,396		
Btu/h-ft²	8.60		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-27	0	-27	6.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-82	0	-82	19.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-6.1
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-227	54.8
Envelope Subtotal	-216	-84	0	-311	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-8.2
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-136	0	-136	32.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-182	-221	0	-413	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.41	No People(max)	2.00
%OA	31	People per 1000 ft²	10
cfm/ft²	0.34	Volume (ft³)	2,395
cfm/Mbh	-162		
ft²/Mbh	-483		
Btu/h-ft²	-2.07		

Cooling Airflows

Main Fan cfm	67
Cooling ACH	1.68
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.53
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	67
Heating ACH	1.68
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.53
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

ROOM_Clean Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	258	0	258	35.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	18	0	18	2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	57	0	-4	52	7.1
Envelope Subtotal	57	273	-4	326	-
People	54	74	102	230	31.3
Lights	45	70	0	115	15.7
Miscellaneous Loads	13	0	0	13	1.8
Internal Subtotal	112	144	102	358	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	168	416	98	682	100.0
RA Sensible (Lights)	52	0	0	52	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.51
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,224
cfm/ton	496		
ft²/ton	1,796		
Btu/h-ft²	6.68		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-155	0	-155	56.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	7.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-110	0	0	-116	42.2
Envelope Subtotal	-110	-162	0	-278	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.6
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-106	-163	0	-274	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.27	No People(max)	0.51
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,224
cfm/Mbh	-103		
ft²/Mbh	-372		
Btu/h-ft²	-2.69		

Cooling Airflows

Main Fan cfm	28
Cooling ACH	1.37
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.25
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	28
Heating ACH	1.37
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.25
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	113
Other Roof	113
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	519
Exterior Floor	0
Internal Floor	0
Slab	113
Other Floor	0

ROOM_Comfort Room 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	189	0	189	16.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	46	0	46	4.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	52	0	52	4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	280	0	280	-
People	88	122	168	378	32.7
Lights	76	120	0	196	17.0
Miscellaneous Loads	129	86	0	215	18.6
Internal Subtotal	293	329	168	789	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	293	607	168	1,067	100.0
RA Sensible (Lights)	88	0	0	88	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.84
%OA	40	People per 1000 ft²	10
cfm/ft²	0.52	Volume (ft³)	1,005
cfm/ton	487		
ft²/ton	942		
Btu/h-ft²	12.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-128	0	-128	56.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-47	0	-47	21.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-63	0	-63	28.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	-5.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-225	0	-225	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	0	-225	0	-225	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.23	No People(max)	0.84
%OA	40	People per 1000 ft²	10
cfm/ft²	0.52	Volume (ft³)	1,005
cfm/Mbh	-192		
ft²/Mbh	-372		
Btu/h-ft²	-2.69		

Cooling Airflows

Main Fan cfm	43
Cooling ACH	2.57
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	17
Calculated Ventilation ACH	1.01
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	43
Heating ACH	2.57
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	17
Calculated Ventilation ACH	1.01
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	93
Other Roof	93
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	438
Exterior Floor	0
Internal Floor	0
Slab	93
Other Floor	0

ROOM_Comfort Room 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	173	0	173	14.7
Other Roof	0	0	0	0	0.0
Glass	83	37	0	120	10.2
Door	0	0	0	0	0.0
Wall	0	105	0	105	8.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-89	0	-89	-7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	83	214	0	298	-
People	86	127	164	378	32.1
Lights	75	124	0	199	17.0
Miscellaneous Loads	126	90	0	216	18.4
Internal Subtotal	287	341	164	792	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	5	0	5	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.5
Grand Total	370	554	164	1,088	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.82
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	985
cfm/ton	490		
ft²/ton	904		
Btu/h-ft²	13.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-105	0	-105	29.5
Other Roof	0	0	0	0	0.0
Glass	-93	0	0	-93	26.1
Door	0	0	0	0	0.0
Wall	0	-161	0	-161	45.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	32	0	32	-9.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-93	-221	0	-314	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-39	0	-39	11.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.6
Grand Total	-93	-262	0	-355	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	0.82
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	985
cfm/Mbh	-125		
ft²/Mbh	-231		
Btu/h-ft²	-4.33		

Cooling Airflows

Main Fan cfm	44
Cooling ACH	2.68
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	44
Heating ACH	2.68
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	80
Other Roof	80
Ceiling	11
Window	8
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	91
Other Floor	0

ROOM_Consult 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	234	0	234	16.6
Other Roof	0	0	0	0	0.0
Glass	74	32	0	106	7.5
Door	0	0	0	0	0.0
Wall	0	129	0	129	9.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-93	0	-93	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	74	292	0	366	-
People	105	145	200	450	31.9
Lights	91	142	0	233	16.5
Miscellaneous Loads	153	102	0	256	18.2
Internal Subtotal	350	389	200	939	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	6	0	6	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.5
Grand Total	423	681	200	1,304	100.0
RA Sensible (Lights)	105	0	0	105	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.00
%OA	47	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	1,199
cfm/ton	489		
ft²/ton	919		
Btu/h-ft²	13.06		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-130	0	-130	32.3
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	23.4
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	45.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	34	0	34	-8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-94	-262	0	-356	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-44	0	-44	10.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.6
Grand Total	-94	-308	0	-402	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.40	No People(max)	1.00
%OA	47	People per 1000 ft²	10
cfm/ft²	0.53	Volume (ft³)	1,199
cfm/Mbh	-132		
ft²/Mbh	-248		
Btu/h-ft²	-4.03		

Cooling Airflows

Main Fan cfm	53
Cooling ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	53
Heating ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	98
Other Roof	98
Ceiling	12
Window	8
Door	0
Wall	115
Below-Grade Wall	0
Other Wall	115
Partition	390
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

ROOM_Consult 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	234	0	234	16.1
Other Roof	0	0	0	0	0.0
Glass	74	33	0	107	7.4
Door	0	0	0	0	0.0
Wall	0	131	0	131	9.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-71	0	-71	-4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	74	317	0	391	-
People	107	149	203	458	31.5
Lights	93	145	0	238	16.4
Miscellaneous Loads	156	105	0	261	17.9
Internal Subtotal	355	399	203	957	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	6	0	6	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	-0.5
Grand Total	429	715	203	1,347	100.0
RA Sensible (Lights)	106	0	0	106	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.02
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	1,218
cfm/ton	490		
ft²/ton	905		
Btu/h-ft²	13.26		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-131	0	-131	31.5
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	22.6
Door	0	0	0	0	0.0
Wall	0	-184	0	-184	44.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	24	0	24	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-94	-275	0	-370	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-44	0	-44	10.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.6
Grand Total	-94	-322	0	-416	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.42	No People(max)	1.02
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	1,218
cfm/Mbh	-132		
ft²/Mbh	-244		
Btu/h-ft²	-4.10		

Cooling Airflows

Main Fan cfm	55
Cooling ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	55
Heating ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	99
Other Roof	99
Ceiling	12
Window	8
Door	0
Wall	117
Below-Grade Wall	0
Other Wall	117
Partition	392
Exterior Floor	0
Internal Floor	0
Slab	112
Other Floor	0

ROOM_Corridor 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	730	0	730	40.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	318	0	318	17.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	88	0	6	94	5.3
Envelope Subtotal	88	1,044	6	1,138	-
People	0	0	0	0	0.0
Lights	180	264	0	444	24.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	180	264	0	444	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	268	1,305	6	1,579	100.0
RA Sensible (Lights)	206	0	0	206	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.26	Volume (ft³)	3,546
cfm/ton	576		
ft²/ton	2,245		
Btu/h-ft²	5.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-434	0	-434	56.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-191	0	-191	24.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-172	0	0	-181	23.6
Envelope Subtotal	-172	-585	0	-766	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-172	-586	0	-766	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.77	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.26	Volume (ft³)	3,546
cfm/Mbh	-99		
ft²/Mbh	-386		
Btu/h-ft²	-2.59		

Cooling Airflows

Main Fan cfm	76
Cooling ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.24
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	76
Heating ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.24
Infiltration cfm	4
Min Stop/RH (%)	100

Areas ft²

Roof	318
Other Roof	318
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	318
Other Floor	0

ROOM_Corridor 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,154	0	1,154	35.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	505	0	505	15.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	205	0	13	218	6.7
Envelope Subtotal	205	1,645	13	1,863	-
People	0	0	0	0	0.0
Lights	386	571	0	957	29.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	386	571	0	957	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-22	0	-22	-0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	591	2,189	13	2,793	100.0
RA Sensible (Lights)	443	0	0	443	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.21	Volume (ft³)	7,619
cfm/ton	576		
ft²/ton	2,728		
Btu/h-ft²	4.40		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-702	0	-702	48.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-320	0	-320	22.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	83	0	83	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-370	0	0	-388	26.9
Envelope Subtotal	-370	-939	0	-1,327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-113	0	-113	7.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-370	-1,053	0	-1,442	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.44	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.21	Volume (ft³)	7,619
cfm/Mbh	-93		
ft²/Mbh	-440		
Btu/h-ft²	-2.27		

Cooling Airflows

Main Fan cfm	134
Cooling ACH	1.06
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.20
Infiltration cfm	9
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	134
Heating ACH	1.06
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.20
Infiltration cfm	9
Min Stop/RH (%)	100

Areas

ft²

Roof	516
Other Roof	516
Ceiling	170
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	2,442
Exterior Floor	0
Internal Floor	0
Slab	686
Other Floor	0

ROOM_Corridor 2.1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	174	0	174	36.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-5	0	-5	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	19	0	2	21	4.4
Envelope Subtotal	19	169	2	190	-
People	0	0	0	0	0.0
Lights	52	108	0	160	33.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	52	108	0	160	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	72	0	72	14.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	-0.1
Grand Total	71	349	2	422	100.0
RA Sensible (Lights)	60	0	0	60	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.24	Volume (ft³)	1,026
cfm/ton	576		
ft²/ton	2,432		
Btu/h-ft²	4.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-70	0	-70	28.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-50	0	0	-52	21.4
Envelope Subtotal	-50	-59	0	-111	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-133	0	-133	54.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-50	-192	0	-245	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.24	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.24	Volume (ft³)	1,026
cfm/Mbh	-83		
ft²/Mbh	-349		
Btu/h-ft²	-2.87		

Cooling Airflows

Main Fan cfm	20
Cooling ACH	1.17
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	4
Calculated Ventilation ACH	0.23
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	20
Heating ACH	1.17
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	4
Calculated Ventilation ACH	0.23
Infiltration cfm	1
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	96
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	513
Exterior Floor	0
Internal Floor	0
Slab	96
Other Floor	0

ROOM_Corridor 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	734	384	0	1,118	41.7
Door	0	0	0	0	0.0
Wall	0	42	0	42	1.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	308	0	308	11.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	10	0	10	0.4
Other Floor	0	0	0	0	0.0
Infiltration	92	0	-2	90	3.4
Envelope Subtotal	826	745	-2	1,569	-
People	0	0	0	0	0.0
Lights	249	426	0	674	25.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	249	426	0	674	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	166	0	166	6.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	1,075	1,320	-2	2,393	100.0
RA Sensible (Lights)	286	0	0	286	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	4,909
cfm/ton	578		
ft²/ton	2,051		
Btu/h-ft²	5.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-729	0	0	-729	45.8
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	4.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-36	0	-36	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	64	0	64	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	15.7
Envelope Subtotal	-967	-35	0	-1,015	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-562	0	-562	35.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.9
Grand Total	-967	-612	0	-1,591	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.59	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	4,909
cfm/Mbh	-73		
ft²/Mbh	-257		
Btu/h-ft²	-3.89		

Cooling Airflows

Main Fan cfm	115
Cooling ACH	1.41
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	24
Calculated Ventilation ACH	0.29
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	115
Heating ACH	1.41
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	24
Calculated Ventilation ACH	0.29
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

ROOM_Corridor 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,095	1,849	0	3,944	91.1
Door	0	0	0	0	0.0
Wall	0	101	0	101	2.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-401	0	-401	-9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	433	0	433	10.0
Other Floor	0	0	0	0	0.0
Infiltration	86	0	-2	85	2.0
Envelope Subtotal	2,182	1,982	-2	4,162	-
People	0	0	0	0	0.0
Lights	197	354	0	551	12.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	197	354	0	551	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-510	0	-510	-11.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-98	0	-98	-2.3
Grand Total	2,379	1,728	-2	4,105	100.0
RA Sensible (Lights)	226	0	0	226	-

Engineering Checks For Cooling

Cooling tons	0.34	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.61	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	947		
Btu/h-ft²	12.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.7 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-700	0	0	-700	51.2
Door	0	0	0	0	0.0
Wall	0	-61	0	-61	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-9	0	-9	0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-199	14.5
Envelope Subtotal	-889	-19	0	-918	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-438	0	-438	32.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	1.0
Grand Total	-889	-470	0	-1,369	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.37	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.61	Volume (ft³)	3,888
cfm/Mbh	-145		
ft²/Mbh	-237		
Btu/h-ft²	-4.22		

Cooling Airflows

Main Fan cfm	198
Cooling ACH	3.06
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	198
Heating ACH	3.06
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

ROOM_Corridor 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 22.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,829	1,953	0	3,783	93.8
Door	0	0	0	0	0.0
Wall	0	101	0	101	2.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-229	0	-229	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	64	0	64	1.6
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-16	61	1.5
Envelope Subtotal	1,906	1,889	-16	3,779	-
People	0	0	0	0	0.0
Lights	252	412	0	663	16.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	252	412	0	663	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-621	0	-621	-15.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-79	0	-79	-2.0
Grand Total	2,158	1,601	-16	3,743	100.0
RA Sensible (Lights)	289	0	0	289	-

Engineering Checks For Cooling

Cooling tons	0.31	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.44	Volume (ft³)	4,967
cfm/ton	584		
ft²/ton	1,327		
Btu/h-ft²	9.04		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-719	0	0	-719	45.9
Door	0	0	0	0	0.0
Wall	0	-66	0	-66	4.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-22	0	-22	1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	64	0	64	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-254	16.2
Envelope Subtotal	-961	-23	0	-996	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-556	0	-556	35.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.9
Grand Total	-961	-593	0	-1,567	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.57	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.44	Volume (ft³)	4,967
cfm/Mbh	-116		
ft²/Mbh	-264		
Btu/h-ft²	-3.79		

Cooling Airflows

Main Fan cfm	182
Cooling ACH	2.20
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	182
Heating ACH	2.20
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

ROOM_Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 33.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	291	0	291	9.0
Other Roof	0	0	0	0	0.0
Glass	1,036	1,139	0	2,175	67.2
Door	0	0	0	0	0.0
Wall	0	759	0	759	23.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-292	0	-292	-9.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-148	0	-148	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	1,036	1,749	0	2,786	-
People	0	0	0	0	0.0
Lights	88	128	0	216	6.7
Miscellaneous Loads	195	0	0	195	6.0
Internal Subtotal	283	128	0	411	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-62	0	-62	-1.9
Grand Total	1,319	1,816	0	3,135	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.79	Volume (ft³)	2,287
cfm/ton	579		
ft²/ton	730		
Btu/h-ft²	16.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-271	0	-271	23.0
Other Roof	0	0	0	0	0.0
Glass	-493	0	0	-493	41.8
Door	0	0	0	0	0.0
Wall	0	-591	0	-591	50.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	93	0	93	-7.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	37	0	37	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-493	-732	0	-1,225	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	65	0	0	65	-5.5
Internal Subtotal	65	0	0	65	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.6
Grand Total	-428	-751	0	-1,178	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.18	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.79	Volume (ft³)	2,287
cfm/Mbh	-128		
ft²/Mbh	-162		
Btu/h-ft²	-6.17		

Cooling Airflows

Main Fan cfm	151
Cooling ACH	3.96
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.34
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	151
Heating ACH	3.96
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.34
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	205
Other Roof	205
Ceiling	0
Window	21
Door	0
Wall	358
Below-Grade Wall	0
Other Wall	358
Partition	358
Exterior Floor	0
Internal Floor	0
Slab	205
Other Floor	0

ROOM_Emergency Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 33.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	5	0	5	0.2
Other Roof	0	0	0	0	0.0
Glass	1,090	1,181	0	2,272	86.6
Door	0	0	0	0	0.0
Wall	0	156	0	156	5.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-565	0	-565	-21.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-82	0	-82	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	1,090	694	0	1,785	-
People	0	0	0	0	0.0
Lights	82	123	0	206	7.8
Miscellaneous Loads	610	0	0	610	23.3
Internal Subtotal	693	123	0	816	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-71	0	-71	-2.7
Grand Total	1,783	747	0	2,530	100.0
RA Sensible (Lights)	95	0	0	95	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-259	0	-259	31.8
Other Roof	0	0	0	0	0.0
Glass	-496	0	0	-496	60.8
Door	0	0	0	0	0.0
Wall	0	-177	0	-177	21.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	43	0	43	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-496	-361	0	-857	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	61	0	0	61	-7.5
Internal Subtotal	61	0	0	61	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	2.3
Grand Total	-435	-380	0	-815	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	122
Cooling ACH	3.41
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	122
Heating ACH	3.41
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	193
Other Roof	193
Ceiling	0
Window	21
Door	0
Wall	121
Below-Grade Wall	0
Other Wall	121
Partition	581
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.68	Volume (ft³)	2,146
cfm/ton	579		
ft²/ton	849		
Btu/h-ft²	14.13		

Engineering Checks For Heating

Heating Mbh	-0.81	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.68	Volume (ft³)	2,146
cfm/Mbh	-150		
ft²/Mbh	-220		
Btu/h-ft²	-4.55		

ROOM_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-4	0	-4	0.0
Other Roof	0	0	0	0	0.0
Glass	5,406	6,060	0	11,466	106.4
Door	0	0	0	0	0.0
Wall	0	256	0	256	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,063	0	-1,063	-9.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	392	0	392	3.6
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-23	42	0.4
Envelope Subtotal	5,471	5,642	-23	11,090	-
People	182	238	287	707	6.6
Lights	201	268	0	470	4.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	383	506	287	1,176	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-1,496	0	-1,496	-13.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-224	0	-224	-2.1
Grand Total	5,854	4,428	264	10,547	100.0
RA Sensible (Lights)	231	0	0	231	-

Engineering Checks For Cooling

Cooling tons	0.88	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.34	Volume (ft³)	4,445
cfm/ton	563		
ft²/ton	422		
Btu/h-ft²	28.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-69	0	-69	1.5
Other Roof	0	0	0	0	0.0
Glass	-3,127	0	0	-3,127	68.1
Door	0	0	0	0	0.0
Wall	0	-544	0	-544	11.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	457	0	457	-9.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	97	0	97	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	9.2
Envelope Subtotal	-3,528	-59	0	-3,607	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-933	0	-933	20.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-54	0	-54	1.2
Grand Total	-3,528	-1,046	0	-4,595	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-4.60	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.34	Volume (ft³)	4,445
cfm/Mbh	-108		
ft²/Mbh	-81		
Btu/h-ft²	-12.35		

Cooling Airflows

Main Fan cfm	495
Cooling ACH	6.68
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	32
Calculated Ventilation ACH	0.43
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	495
Heating ACH	6.68
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	32
Calculated Ventilation ACH	0.43
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	287
Door	0
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

ROOM_Exam Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	320	0	320	21.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-114	0	-114	-7.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	194	0	194	-
People	129	177	246	553	37.5
Lights	112	174	0	286	19.4
Miscellaneous Loads	189	125	0	314	21.3
Internal Subtotal	430	476	246	1,153	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	430	667	246	1,344	100.0
RA Sensible (Lights)	129	0	0	129	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	1.23
%OA	44	People per 1000 ft²	10
cfm/ft²	0.43	Volume (ft³)	1,476
cfm/ton	472		
ft²/ton	1,099		
Btu/h-ft²	10.92		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-185	0	-185	98.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-8.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-187	0	-187	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	0	-188	0	-188	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.19	No People(max)	1.23
%OA	44	People per 1000 ft²	10
cfm/ft²	0.43	Volume (ft³)	1,476
cfm/Mbh	-282		
ft²/Mbh	-656		
Btu/h-ft²	-1.52		

Cooling Airflows

Main Fan cfm	53
Cooling ACH	2.15
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	23
Calculated Ventilation ACH	0.93
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	53
Heating ACH	2.15
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	23
Calculated Ventilation ACH	0.93
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	134
Other Roof	134
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	559
Exterior Floor	0
Internal Floor	0
Slab	134
Other Floor	0

ROOM_Fire Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 09:00:00
 Outside DB / WB / HR 81.4 °F / 59.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 33.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-23	0	-23	-1.1
Other Roof	0	0	0	0	0.0
Glass	1,084	1,222	0	2,306	110.8
Door	0	0	0	0	0.0
Wall	0	88	0	88	4.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-523	0	-523	-25.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-105	0	-105	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	1,084	659	0	1,744	-
People	0	0	0	0	0.0
Lights	37	59	0	95	4.6
Miscellaneous Loads	270	0	0	270	13.0
Internal Subtotal	307	59	0	366	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-70	0	-70	-3.3
Grand Total	1,391	649	0	2,040	100.0
RA Sensible (Lights)	42	0	0	42	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-117	0	-117	19.3
Other Roof	0	0	0	0	0.0
Glass	-473	0	0	-473	78.1
Door	0	0	0	0	0.0
Wall	0	-167	0	-167	27.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	125	0	125	-20.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-473	-143	0	-616	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	27	0	0	27	-4.5
Internal Subtotal	27	0	0	27	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	2.8
Grand Total	-446	-160	0	-606	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	98
Cooling ACH	6.18
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.50
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	98
Heating ACH	6.18
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.50
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

	ft²
Roof	88
Other Roof	88
Ceiling	0
Window	21
Door	0
Wall	118
Below-Grade Wall	0
Other Wall	118
Partition	334
Exterior Floor	0
Internal Floor	0
Slab	88
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	1.24	Volume (ft³)	951
cfm/ton	579		
ft²/ton	466		
Btu/h-ft²	25.75		

Engineering Checks For Heating

Heating Mbh	-0.61	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	1.24	Volume (ft³)	951
cfm/Mbh	-162		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

ROOM_General Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	240	0	240	21.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	448	0	448	39.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-1	52	4.6
Envelope Subtotal	53	684	-1	737	-
People	50	75	96	220	19.5
Lights	42	71	0	113	10.0
Miscellaneous Loads	12	0	0	12	1.1
Internal Subtotal	105	145	96	346	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.3
Grand Total	158	827	95	1,079	100.0
RA Sensible (Lights)	49	0	0	49	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.48
%OA	18	People per 1000 ft²	5
cfm/ft²	0.50	Volume (ft³)	1,147
cfm/ton	528		
ft²/ton	1,063		
Btu/h-ft²	11.29		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-147	0	-147	48.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-62	0	-62	20.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-104	0	0	-109	36.1
Envelope Subtotal	-104	-196	0	-305	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.4
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-99	-196	0	-301	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.30	No People(max)	0.48
%OA	18	People per 1000 ft²	5
cfm/ft²	0.50	Volume (ft³)	1,147
cfm/Mbh	-158		
ft²/Mbh	-318		
Btu/h-ft²	-3.14		

Cooling Airflows

Main Fan cfm	47
Cooling ACH	2.46
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.47
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	47
Heating ACH	2.46
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.47
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	535
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	358	0	358	8.2
Other Roof	0	0	0	0	0.0
Glass	142	71	0	212	4.9
Door	0	0	0	0	0.0
Wall	0	323	0	323	7.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-162	0	-162	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	153	0	-71	82	1.9
Envelope Subtotal	295	548	-71	772	-
People	553	801	1,106	2,460	56.4
Lights	166	260	0	425	9.7
Miscellaneous Loads	283	191	0	474	10.9
Internal Subtotal	1,001	1,252	1,106	3,359	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	64	0	64	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.5
Grand Total	1,297	1,843	1,035	4,174	100.0
RA Sensible (Lights)	190	0	0	190	-

Engineering Checks For Cooling

Cooling tons	0.35	No People(max)	5.52
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	3,317
cfm/ton	434		
ft²/ton	795		
Btu/h-ft²	15.09		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-190	0	-190	12.2
Other Roof	0	0	0	0	0.0
Glass	-195	0	0	-195	12.6
Door	0	0	0	0	0.0
Wall	0	-468	0	-468	30.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	88	0	88	-5.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	20.2
Envelope Subtotal	-495	-522	0	-1,032	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-518	0	-518	33.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.4
Grand Total	-495	-1,046	0	-1,556	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.56	No People(max)	5.52
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	3,317
cfm/Mbh	-97		
ft²/Mbh	-178		
Btu/h-ft²	-5.62		

Cooling Airflows

Main Fan cfm	151
Cooling ACH	2.73
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	151
Heating ACH	2.73
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas

ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

ROOM_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	315	0	315	7.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	306	0	306	7.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	74	0	74	1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-32	0	-32	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-64	73	1.8
Envelope Subtotal	137	664	-64	736	-
People	492	717	984	2,193	55.3
Lights	147	233	0	381	9.6
Miscellaneous Loads	252	171	0	423	10.7
Internal Subtotal	891	1,121	984	2,997	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	71	0	71	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	1,028	1,851	920	3,799	100.0
RA Sensible (Lights)	169	0	0	169	-

Engineering Checks For Cooling

Cooling tons	0.32	No People(max)	4.92
%OA	30	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,953
cfm/ton	866		
ft²/ton	777		
Btu/h-ft²	15.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-167	0	-167	12.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-439	0	-439	31.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-93	0	-93	6.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	44	0	44	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-280	20.1
Envelope Subtotal	-266	-656	0	-936	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-459	0	-459	32.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-266	-1,116	0	-1,396	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.40	No People(max)	4.92
%OA	30	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,953
cfm/Mbh	-196		
ft²/Mbh	-176		
Btu/h-ft²	-5.68		

Cooling Airflows

Main Fan cfm	274
Cooling ACH	5.57
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	274
Heating ACH	5.57
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

ROOM_Hskp

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	148	0	148	33.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	33	0	33	7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	32	0	-2	29	6.6
Envelope Subtotal	32	179	-2	208	-
People	30	45	57	132	29.8
Lights	25	43	0	68	15.4
Miscellaneous Loads	7	0	0	7	1.6
Internal Subtotal	62	88	57	207	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	94	266	55	414	100.0
RA Sensible (Lights)	29	0	0	29	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.28
%OA	18	People per 1000 ft²	5
cfm/ft²	0.30	Volume (ft³)	682
cfm/ton	502		
ft²/ton	1,647		
Btu/h-ft²	7.29		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-89	0	-89	54.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	12.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-62	0	0	-64	39.5
Envelope Subtotal	-62	-101	0	-165	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-1.5
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-59	-101	0	-163	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.16	No People(max)	0.28
%OA	18	People per 1000 ft²	5
cfm/ft²	0.30	Volume (ft³)	682
cfm/Mbh	-106		
ft²/Mbh	-348		
Btu/h-ft²	-2.87		

Cooling Airflows

Main Fan cfm	17
Cooling ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	17
Heating ACH	1.50
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	65
Other Roof	65
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	396
Exterior Floor	0
Internal Floor	0
Slab	65
Other Floor	0

ROOM_Intake Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	387	0	387	41.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	173	0	173	18.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	46	0	-1	46	4.9
Envelope Subtotal	46	559	-1	605	-
People	0	0	0	0	0.0
Lights	94	134	0	229	24.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	94	134	0	229	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	140	692	-1	832	100.0
RA Sensible (Lights)	108	0	0	108	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.00
%OA	22	People per 1000 ft²	0
cfm/ft²	0.26	Volume (ft³)	1,858
cfm/ton	578		
ft²/ton	2,233		
Btu/h-ft²	5.37		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-231	0	-231	59.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	21.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-90	0	0	-95	24.3
Envelope Subtotal	-90	-294	0	-389	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-90	-295	0	-389	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.39	No People(max)	0.00
%OA	22	People per 1000 ft²	0
cfm/ft²	0.26	Volume (ft³)	1,858
cfm/Mbh	-103		
ft²/Mbh	-397		
Btu/h-ft²	-2.52		

Cooling Airflows

Main Fan cfm	40
Cooling ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	40
Heating ACH	1.29
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	169
Other Roof	169
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	689
Exterior Floor	0
Internal Floor	0
Slab	169
Other Floor	0

ROOM_Interview Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	235	0	235	9.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	569	0	569	23.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1	0	-1	-0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	791	0	791	-
People	166	222	316	704	29.1
Lights	144	217	0	361	14.9
Miscellaneous Loads	242	157	0	399	16.5
Internal Subtotal	552	597	316	1,464	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	2	0	2	0.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	552	1,386	316	2,253	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.58
%OA	22	People per 1000 ft²	10
cfm/ft²	0.59	Volume (ft³)	1,894
cfm/ton	497		
ft²/ton	840		
Btu/h-ft²	14.29		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-155	0	-155	18.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-530	0	-530	63.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-672	0	-672	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-163	0	-163	19.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	0	-837	0	-837	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.84	No People(max)	1.58
%OA	22	People per 1000 ft²	10
cfm/ft²	0.59	Volume (ft³)	1,894
cfm/Mbh	-112		
ft²/Mbh	-189		
Btu/h-ft²	-5.29		

Cooling Airflows

Main Fan cfm	93
Cooling ACH	2.95
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.67
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	93
Heating ACH	2.95
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.67
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	119
Other Roof	119
Ceiling	51
Window	0
Door	0
Wall	313
Below-Grade Wall	0
Other Wall	313
Partition	325
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

ROOM_IT

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	233	0	233	20.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	135	0	135	11.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	3	0	3	0.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	370	0	370	-
People	0	0	0	0	0.0
Lights	73	101	0	174	14.9
Miscellaneous Loads	539	0	0	539	46.2
Internal Subtotal	612	101	0	713	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.0
Grand Total	612	471	0	1,083	100.0
RA Sensible (Lights)	84	0	0	84	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	1,896
cfm/ton	578		
ft²/ton	1,752		
Btu/h-ft²	6.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-234	0	-234	127.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	29.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	51	0	51	-27.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-238	0	-238	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	54	0	0	54	-29.3
Internal Subtotal	54	0	0	54	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.2
Grand Total	54	-238	0	-184	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.18	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	1,896
cfm/Mbh	-284		
ft²/Mbh	-859		
Btu/h-ft²	-1.16		

Cooling Airflows

Main Fan cfm	52
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	52
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	171
Other Roof	171
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	649
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

ROOM_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,356	0	1,356	4.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	531	0	531	1.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2,343	0	-2,343	-8.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-401	0	-401	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	189	0	-19	170	0.6
Envelope Subtotal	189	-857	-19	-687	-
People	1,215	1,664	2,894	5,774	20.1
Lights	426	657	0	1,083	3.8
Miscellaneous Loads	13,295	8,788	0	22,083	76.9
Internal Subtotal	14,937	11,109	2,894	28,940	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-0.1
Grand Total	15,126	10,213	2,875	28,213	100.0
RA Sensible (Lights)	489	0	0	489	-

Engineering Checks For Cooling

Cooling tons	2.35	No People(max)	11.56
%OA	6	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/ton	1,063		
ft²/ton	162		
Btu/h-ft²	74.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-546	0	-546	40.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-378	0	-378	27.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	57	0	57	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-435	31.9
Envelope Subtotal	-414	-924	0	-1,359	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-414	-926	0	-1,360	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.36	No People(max)	11.56
%OA	6	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/Mbh	-1,838		
ft²/Mbh	-281		
Btu/h-ft²	-3.56		

Cooling Airflows

Main Fan cfm	2,500
Cooling ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	156
Calculated Ventilation cfm	152
Calculated Ventilation ACH	1.99
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,500
Heating ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	156
Calculated Ventilation cfm	152
Calculated Ventilation ACH	1.99
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	402
Other Roof	402
Ceiling	0
Window	0
Door	0
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	766
Exterior Floor	0
Internal Floor	0
Slab	402
Other Floor	0

ROOM_Laundry

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	306	0	306	35.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	14	0	14	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	68	0	-6	62	7.2
Envelope Subtotal	68	317	-6	379	-
People	64	86	122	272	31.6
Lights	54	82	0	136	15.7
Miscellaneous Loads	16	0	0	16	1.8
Internal Subtotal	133	168	122	423	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	201	483	116	800	100.0
RA Sensible (Lights)	62	0	0	62	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.61
%OA	18	People per 1000 ft²	5
cfm/ft²	0.27	Volume (ft³)	1,461
cfm/ton	495		
ft²/ton	1,826		
Btu/h-ft²	6.57		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-184	0	-184	57.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-132	0	0	-138	42.9
Envelope Subtotal	-132	-189	0	-327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	5	0	0	5	-1.6
Internal Subtotal	5	0	0	5	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-127	-189	0	-322	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.32	No People(max)	0.61
%OA	18	People per 1000 ft²	5
cfm/ft²	0.27	Volume (ft³)	1,461
cfm/Mbh	-102		
ft²/Mbh	-378		
Btu/h-ft²	-2.65		

Cooling Airflows

Main Fan cfm	33
Cooling ACH	1.36
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.25
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	33
Heating ACH	1.36
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.25
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	133
Other Roof	133
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	557
Exterior Floor	0
Internal Floor	0
Slab	133
Other Floor	0

ROOM_Long Term Belongings Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	255	0	255	34.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	54	0	54	7.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	56	0	-16	40	5.3
Envelope Subtotal	56	306	-16	346	-
People	53	72	101	226	30.2
Lights	45	69	0	113	15.2
Miscellaneous Loads	13	0	0	13	1.7
Internal Subtotal	110	141	101	352	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	166	446	85	696	100.0
RA Sensible (Lights)	51	0	0	51	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.50
%OA	44	People per 1000 ft²	5
cfm/ft²	0.29	Volume (ft³)	1,208
cfm/ton	507		
ft²/ton	1,736		
Btu/h-ft²	6.91		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-153	0	-153	55.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-26	0	-26	9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	13	0	13	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	41.4
Envelope Subtotal	-109	-166	0	-280	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.6
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-105	-166	0	-276	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.28	No People(max)	0.50
%OA	44	People per 1000 ft²	5
cfm/ft²	0.29	Volume (ft³)	1,208
cfm/Mbh	-107		
ft²/Mbh	-365		
Btu/h-ft²	-2.74		

Cooling Airflows

Main Fan cfm	29
Cooling ACH	1.44
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.65
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	29
Heating ACH	1.44
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.65
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	111
Other Roof	111
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	516
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

ROOM_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	340	0	340	6.2
Other Roof	0	0	0	0	0.0
Glass	1,404	1,609	0	3,013	55.0
Door	0	0	0	0	0.0
Wall	0	505	0	505	9.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-570	0	-570	-10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-222	0	-222	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-76	-1	0.0
Envelope Subtotal	1,479	1,662	-76	3,065	-
People	396	560	791	1,746	31.9
Lights	118	173	0	291	5.3
Miscellaneous Loads	202	128	0	330	6.0
Internal Subtotal	716	860	791	2,368	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-92	0	-92	-1.7
Grand Total	2,196	2,430	716	5,341	100.0
RA Sensible (Lights)	136	0	0	136	-

Engineering Checks For Cooling

Cooling tons	0.45	No People(max)	3.95
%OA	23	People per 1000 ft²	20
cfm/ft²	1.13	Volume (ft³)	2,373
cfm/ton	502		
ft²/ton	445		
Btu/h-ft²	26.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-282	0	-282	21.3
Other Roof	0	0	0	0	0.0
Glass	-670	0	0	-670	50.5
Door	0	0	0	0	0.0
Wall	0	-315	0	-315	23.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	150	0	150	-11.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	36	0	36	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-214	0	0	-225	17.0
Envelope Subtotal	-884	-411	0	-1,306	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	1.6
Grand Total	-884	-432	0	-1,327	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.33	No People(max)	3.95
%OA	23	People per 1000 ft²	20
cfm/ft²	1.13	Volume (ft³)	2,373
cfm/Mbh	-168		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	223
Cooling ACH	5.64
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	50
Calculated Ventilation ACH	1.26
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	223
Heating ACH	5.64
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	50
Calculated Ventilation ACH	1.26
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	212
Other Roof	212
Ceiling	0
Window	37
Door	0
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	499
Exterior Floor	0
Internal Floor	0
Slab	212
Other Floor	0

ROOM_Mechanical

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 33.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	234	0	234	18.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	74	0	74	5.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	166	0	166	13.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	3	0	3	0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	476	0	476	-
People	0	0	0	0	0.0
Lights	71	107	0	178	14.1
Miscellaneous Loads	528	0	0	528	41.8
Internal Subtotal	599	107	0	706	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.0
Grand Total	599	583	0	1,182	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	1,856
cfm/ton	579		
ft²/ton	1,570		
Btu/h-ft²	7.64		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-232	0	-232	62.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-114	0	-114	30.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	28.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-7.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-427	0	-427	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	53	0	0	53	-14.1
Internal Subtotal	53	0	0	53	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	53	-427	0	-375	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.37	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	1,856
cfm/Mbh	-152		
ft²/Mbh	-413		
Btu/h-ft²	-2.42		

Cooling Airflows

Main Fan cfm	57
Cooling ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.16
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	57
Heating ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.16
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	170
Other Roof	170
Ceiling	0
Window	0
Door	0
Wall	64
Below-Grade Wall	0
Other Wall	64
Partition	685
Exterior Floor	0
Internal Floor	0
Slab	170
Other Floor	0

ROOM_Meds

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	324	0	324	34.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	36	0	36	3.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	72	0	-6	66	7.1
Envelope Subtotal	72	357	-6	423	-
People	68	91	129	289	30.9
Lights	57	87	0	144	15.4
Miscellaneous Loads	17	0	0	17	1.8
Internal Subtotal	142	178	129	449	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	214	532	124	870	100.0
RA Sensible (Lights)	66	0	0	66	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.65
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,553
cfm/ton	496		
ft²/ton	1,785		
Btu/h-ft²	6.72		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-194	0	-194	55.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-33	0	-33	9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	41.7
Envelope Subtotal	-140	-211	0	-358	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	6	0	0	6	-1.6
Internal Subtotal	6	0	0	6	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-135	-211	0	-352	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.35	No People(max)	0.65
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,553
cfm/Mbh	-102		
ft²/Mbh	-367		
Btu/h-ft²	-2.72		

Cooling Airflows

Main Fan cfm	36
Cooling ACH	1.39
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.27
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	36
Heating ACH	1.39
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.27
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	141
Other Roof	141
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	572
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ROOM_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	699	0	699	9.1
Other Roof	0	0	0	0	0.0
Glass	623	260	0	883	11.5
Door	0	0	0	0	0.0
Wall	0	301	0	301	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-355	0	-355	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-71	0	-71	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	291	0	-124	167	2.2
Envelope Subtotal	914	833	-124	1,623	-
People	971	1,317	1,942	4,229	54.9
Lights	291	433	0	723	9.4
Miscellaneous Loads	497	319	0	815	10.6
Internal Subtotal	1,758	2,068	1,942	5,768	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	33	0	33	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-57	0	-57	-0.7
Grand Total	2,672	2,877	1,818	7,367	100.0
RA Sensible (Lights)	334	0	0	334	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-345	0	-345	12.6
Other Roof	0	0	0	0	0.0
Glass	-807	0	0	-807	29.5
Door	0	0	0	0	0.0
Wall	0	-467	0	-467	17.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	205	0	205	-7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	91	0	91	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-552	20.2
Envelope Subtotal	-1,332	-517	0	-1,875	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-829	0	-829	30.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	1.0
Grand Total	-1,332	-1,373	0	-2,732	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	267
Cooling ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	267
Heating ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	44
Door	0
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.61	No People(max)	9.70
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	5,825
cfm/ton	435		
ft²/ton	791		
Btu/h-ft²	15.17		

Engineering Checks For Heating

Heating Mbh	-2.73	No People(max)	9.70
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	5,825
cfm/Mbh	-98		
ft²/Mbh	-178		
Btu/h-ft²	-5.62		

ROOM_Noisy Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,719	1,388	0	3,107	63.2
Door	0	0	0	0	0.0
Wall	0	378	0	378	7.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-635	0	-635	-12.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	210	0	210	4.3
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-55	31	0.6
Envelope Subtotal	1,806	1,341	-55	3,091	-
People	377	612	719	1,708	34.8
Lights	121	219	0	340	6.9
Miscellaneous Loads	184	144	0	328	6.7
Internal Subtotal	682	976	719	2,376	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-562	0	-562	-11.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-129	0	-129	-2.6
Grand Total	2,488	1,625	663	4,776	100.0
RA Sensible (Lights)	139	0	0	139	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-700	0	0	-700	57.9
Door	0	0	0	0	0.0
Wall	0	-236	0	-236	19.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	133	0	133	-11.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-205	16.9
Envelope Subtotal	-895	-70	0	-975	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-212	0	-212	17.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	1.9
Grand Total	-895	-306	0	-1,210	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	198
Cooling ACH	5.51
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	198
Heating ACH	5.51
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	37
Door	0
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.40	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.10	Volume (ft³)	2,156
cfm/ton	497		
ft²/ton	451		
Btu/h-ft²	26.61		

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.10	Volume (ft³)	2,156
cfm/Mbh	-164		
ft²/Mbh	-148		
Btu/h-ft²	-6.76		

ROOM_Noisy Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	402	187	0	589	20.1
Door	0	0	0	0	0.0
Wall	0	70	0	70	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-216	0	-216	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-52	24	0.8
Envelope Subtotal	478	10	-52	435	-
People	380	625	723	1,728	59.1
Lights	122	224	0	346	11.8
Miscellaneous Loads	185	147	0	332	11.4
Internal Subtotal	687	996	723	2,406	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-32	0	-32	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.9
Grand Total	1,164	948	672	2,784	100.0
RA Sensible (Lights)	140	0	0	140	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-507	0	0	-507	51.7
Door	0	0	0	0	0.0
Wall	0	-123	0	-123	12.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	79	0	79	-8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-206	21.0
Envelope Subtotal	-702	-13	0	-726	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-234	0	-234	23.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	2.0
Grand Total	-702	-267	0	-980	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	102
Cooling ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	102
Heating ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	21
Door	0
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.61
%OA	37	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	2,170
cfm/ton	438		
ft²/ton	780		
Btu/h-ft²	15.38		

Engineering Checks For Heating

Heating Mbh	-0.98	No People(max)	3.61
%OA	37	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	2,170
cfm/Mbh	-104		
ft²/Mbh	-185		
Btu/h-ft²	-5.41		

ROOM_Noisy Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	488	192	0	679	22.5
Door	0	0	0	0	0.0
Wall	0	135	0	135	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-287	0	-287	-9.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-73	0	-73	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-50	59	1.9
Envelope Subtotal	597	-33	-50	513	-
People	382	604	729	1,715	56.8
Lights	122	216	0	339	11.2
Miscellaneous Loads	186	142	0	329	10.9
Internal Subtotal	691	962	729	2,382	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	16	0	16	0.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-31	0	-31	-1.0
Grand Total	1,288	914	678	2,880	100.0
RA Sensible (Lights)	141	0	0	141	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,186
cfm/ton	441		
ft²/ton	759		
Btu/h-ft²	15.81		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-550	0	0	-550	45.6
Door	0	0	0	0	0.0
Wall	0	-218	0	-218	18.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	140	0	140	-11.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	17.2
Envelope Subtotal	-747	-45	0	-802	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-387	0	-387	32.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.5
Grand Total	-747	-450	0	-1,207	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	2,186
cfm/Mbh	-88		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	106
Cooling ACH	2.91
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	106
Heating ACH	2.91
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	29
Door	0
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ROOM_Office 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	143	0	143	9.1
Other Roof	0	0	0	0	0.0
Glass	195	279	0	474	30.0
Door	0	0	0	0	0.0
Wall	0	288	0	288	18.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	35	0	35	2.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-45	0	-45	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	36	0	-50	-14	-0.9
Envelope Subtotal	231	699	-50	880	-
People	99	137	188	425	26.9
Lights	63	99	0	162	10.3
Miscellaneous Loads	48	0	0	48	3.1
Internal Subtotal	210	236	188	635	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	-0.6
Grand Total	441	925	139	1,505	100.0
RA Sensible (Lights)	73	0	0	73	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	0.94
%OA	17	People per 1000 ft²	10
cfm/ft²	0.70	Volume (ft³)	1,130
cfm/ton	524		
ft²/ton	751		
Btu/h-ft²	15.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-141	0	-141	28.0
Other Roof	0	0	0	0	0.0
Glass	-96	0	0	-96	19.0
Door	0	0	0	0	0.0
Wall	0	-176	0	-176	35.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-12	0	-12	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-102	0	0	-107	21.3
Envelope Subtotal	-198	-313	0	-516	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-3.2
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.4
Grand Total	-181	-315	0	-502	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.50	No People(max)	0.94
%OA	17	People per 1000 ft²	10
cfm/ft²	0.70	Volume (ft³)	1,130
cfm/Mbh	-131		
ft²/Mbh	-188		
Btu/h-ft²	-5.32		

Cooling Airflows

Main Fan cfm	66
Cooling ACH	3.50
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.64
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	66
Heating ACH	3.50
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.64
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	104
Other Roof	104
Ceiling	0
Window	8
Door	0
Wall	107
Below-Grade Wall	0
Other Wall	107
Partition	388
Exterior Floor	0
Internal Floor	0
Slab	104
Other Floor	0

ROOM_Office 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	122	0	122	8.6
Other Roof	0	0	0	0	0.0
Glass	212	279	0	491	34.7
Door	0	0	0	0	0.0
Wall	0	253	0	253	17.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	33	0	-51	-18	-1.3
Envelope Subtotal	245	517	-51	710	-
People	100	140	190	430	30.4
Lights	64	101	0	165	11.6
Miscellaneous Loads	49	0	0	49	3.4
Internal Subtotal	213	240	190	643	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.8
Grand Total	457	746	139	1,343	100.0
RA Sensible (Lights)	73	0	0	73	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	0.95
%OA	17	People per 1000 ft²	10
cfm/ft²	0.61	Volume (ft³)	1,142
cfm/ton	518		
ft²/ton	850		
Btu/h-ft²	14.12		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-142	0	-142	30.3
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	20.1
Door	0	0	0	0	0.0
Wall	0	-176	0	-176	37.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	22	0	22	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-103	0	0	-108	23.1
Envelope Subtotal	-197	-281	0	-483	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-3.5
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.5
Grand Total	-181	-283	0	-469	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.47	No People(max)	0.95
%OA	17	People per 1000 ft²	10
cfm/ft²	0.61	Volume (ft³)	1,142
cfm/Mbh	-123		
ft²/Mbh	-203		
Btu/h-ft²	-4.93		

Cooling Airflows

Main Fan cfm	58
Cooling ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	58
Heating ACH	3.05
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	105
Other Roof	105
Ceiling	0
Window	8
Door	0
Wall	108
Below-Grade Wall	0
Other Wall	108
Partition	389
Exterior Floor	0
Internal Floor	0
Slab	105
Other Floor	0

ROOM_Quiet Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-51	0	-51	-2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-39	0	-39	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-53	24	1.3
Envelope Subtotal	77	-89	-53	-66	-
People	274	468	521	1,264	69.6
Lights	88	169	0	257	14.1
Miscellaneous Loads	133	110	0	244	13.4
Internal Subtotal	495	748	521	1,764	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	20	0	20	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	572	674	468	1,714	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.60
%OA	45	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/ton	420		
ft²/ton	913		
Btu/h-ft²	13.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	14.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	38.5
Envelope Subtotal	-141	-37	0	-185	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-199	0	-199	51.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-141	-237	0	-385	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.38	No People(max)	2.60
%OA	45	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/Mbh	-156		
ft²/Mbh	-339		
Btu/h-ft²	-2.95		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Quiet Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	167	136	0	303	14.2
Door	0	0	0	0	0.0
Wall	0	105	0	105	4.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	-2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-49	0	-49	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-51	26	1.2
Envelope Subtotal	244	138	-51	331	-
People	274	468	523	1,265	59.4
Lights	88	168	0	256	12.0
Miscellaneous Loads	134	110	0	244	11.5
Internal Subtotal	496	746	523	1,765	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-55	0	-55	-2.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-0.6
Grand Total	740	816	471	2,028	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.61
%OA	36	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	1,568
cfm/ton	444		
ft²/ton	773		
Btu/h-ft²	15.52		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-95	0	0	-95	17.8
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	13.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	8.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-149	27.9
Envelope Subtotal	-237	-97	0	-340	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-191	0	-191	35.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.4
Grand Total	-237	-290	0	-533	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.53	No People(max)	2.61
%OA	36	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	1,568
cfm/Mbh	-141		
ft²/Mbh	-245		
Btu/h-ft²	-4.08		

Cooling Airflows

Main Fan cfm	75
Cooling ACH	2.87
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	75
Heating ACH	2.87
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_ Quiet Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	396	0	396	18.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-105	0	-105	-4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-38	0	-38	-1.8
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-38	2	0.1
Envelope Subtotal	40	252	-38	254	-
People	275	472	524	1,272	59.8
Lights	88	170	0	258	12.2
Miscellaneous Loads	134	111	0	245	11.5
Internal Subtotal	498	753	524	1,775	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	1	0	1	0.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	537	1,001	487	2,025	100.0
RA Sensible (Lights)	101	0	0	101	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-224	0	-224	40.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	26.8
Envelope Subtotal	-142	-220	0	-369	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-186	0	-186	33.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-142	-406	0	-556	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	74
Cooling ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	74
Heating ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.62
%OA	37	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	1,573
cfm/ton	439		
ft²/ton	777		
Btu/h-ft²	15.44		

Engineering Checks For Heating

Heating Mbh	-0.56	No People(max)	2.62
%OA	37	People per 1000 ft²	20
cfm/ft²	0.56	Volume (ft³)	1,573
cfm/Mbh	-133		
ft²/Mbh	-236		
Btu/h-ft²	-4.24		

ROOM_Resident Room 01

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 10:00:00
 Outside DB / WB / HR 86.6 °F / 61.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	266	0	510	25.2
Door	0	0	0	0	0.0
Wall	0	141	0	141	7.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-117	0	-117	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-21	0	-21	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-49	-12	-0.6
Envelope Subtotal	282	269	-49	502	-
People	143	153	341	637	31.4
Lights	71	116	0	187	9.2
Miscellaneous Loads	338	358	0	696	34.3
Internal Subtotal	552	627	341	1,520	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-59	0	-59	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.8
Grand Total	834	821	292	1,947	100.0
RA Sensible (Lights)	81	0	0	81	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-123	0	0	-123	22.7
Door	0	0	0	0	0.0
Wall	0	-123	0	-123	22.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	4	0	4	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	26.0
Envelope Subtotal	-257	-100	0	-364	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-176	0	-176	32.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.5
Grand Total	-257	-279	0	-542	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	89
Cooling ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.52
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.52
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	80
Below-Grade Wall	0
Other Wall	80
Partition	482
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	1,486
cfm/ton	547		
ft²/ton	764		
Btu/h-ft²	15.71		

Engineering Checks For Heating

Heating Mbh	-0.54	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	1,486
cfm/Mbh	-164		
ft²/Mbh	-228		
Btu/h-ft²	-4.39		

ROOM_Resident Room 02

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	276	0	521	25.8
Door	0	0	0	0	0.0
Wall	0	238	0	238	11.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-83	0	-83	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	35	0	-28	7	0.3
Envelope Subtotal	280	403	-28	654	-
People	129	141	307	577	28.6
Lights	64	107	0	171	8.5
Miscellaneous Loads	305	329	0	634	31.4
Internal Subtotal	498	577	307	1,382	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-76	0	-76	-3.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.8
Grand Total	777	888	279	1,944	100.0
RA Sensible (Lights)	73	0	0	73	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.12
%OA	15	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	1,340
cfm/ton	552		
ft²/ton	689		
Btu/h-ft²	17.42		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	21.8
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	31.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	4	0	4	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-121	0	0	-127	22.4
Envelope Subtotal	-245	-160	0	-411	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-155	0	-155	27.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-245	-317	0	-568	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.57	No People(max)	1.12
%OA	15	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	1,340
cfm/Mbh	-157		
ft²/Mbh	-197		
Btu/h-ft²	-5.08		

Cooling Airflows

Main Fan cfm	89
Cooling ACH	3.99
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.58
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	3.99
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.58
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	123
Window	10
Door	0
Wall	112
Below-Grade Wall	0
Other Wall	112
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	123
Other Floor	0

ROOM_Resident Room 03

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	267	0	512	21.7
Door	0	0	0	0	0.0
Wall	0	297	0	297	12.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-80	0	-80	-3.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	42	0	-35	7	0.3
Envelope Subtotal	287	462	-35	715	-
People	157	165	375	697	29.5
Lights	78	126	0	204	8.6
Miscellaneous Loads	372	387	0	759	32.2
Internal Subtotal	608	678	375	1,660	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-87	0	-87	-3.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.7
Grand Total	894	1,036	340	2,271	100.0
RA Sensible (Lights)	89	0	0	89	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.36
%OA	15	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	1,636
cfm/ton	548		
ft²/ton	721		
Btu/h-ft²	16.64		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-125	0	0	-125	18.3
Door	0	0	0	0	0.0
Wall	0	-224	0	-224	32.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	2.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-148	0	0	-155	22.7
Envelope Subtotal	-273	-218	0	-498	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-184	0	-184	26.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-273	-404	0	-685	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.68	No People(max)	1.36
%OA	15	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	1,636
cfm/Mbh	-151		
ft²/Mbh	-199		
Btu/h-ft²	-5.03		

Cooling Airflows

Main Fan cfm	104
Cooling ACH	3.81
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	104
Heating ACH	3.81
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	148
Window	10
Door	0
Wall	136
Below-Grade Wall	0
Other Wall	136
Partition	450
Exterior Floor	0
Internal Floor	0
Slab	148
Other Floor	0

ROOM_Resident Room 04

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	97	111	0	208	8.8
Door	0	0	0	0	0.0
Wall	0	597	0	597	25.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-105	0	-105	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-84	0	-84	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-47	29	1.2
Envelope Subtotal	173	519	-47	645	-
People	149	212	355	716	30.4
Lights	74	144	0	217	9.2
Miscellaneous Loads	352	442	0	794	33.8
Internal Subtotal	575	798	355	1,728	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-93	0	-93	-3.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.5
Grand Total	748	1,213	308	2,268	100.0
RA Sensible (Lights)	85	0	0	85	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	14.5
Door	0	0	0	0	0.0
Wall	0	-488	0	-488	57.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	17.2
Envelope Subtotal	-264	-422	0	-693	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-160	0	-160	18.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-264	-584	0	-855	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	94
Cooling ACH	3.64
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	94
Heating ACH	3.64
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.29
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,549
cfm/ton	499		
ft²/ton	683		
Btu/h-ft²	17.57		

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	1.29
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,549
cfm/Mbh	-110		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

ROOM_Resident Room 05

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	280	292	0	573	20.6
Door	0	0	0	0	0.0
Wall	0	713	0	713	25.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-150	0	-150	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	1	0	1	0.0
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-46	17	0.6
Envelope Subtotal	344	856	-46	1,154	-
People	152	228	361	741	26.7
Lights	75	143	0	218	7.8
Miscellaneous Loads	358	440	0	798	28.7
Internal Subtotal	585	810	361	1,756	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-201	0	-201	-7.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.7
Grand Total	929	1,446	315	2,689	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/ton	510		
ft²/ton	586		
Btu/h-ft²	20.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-127	0	0	-127	14.7
Door	0	0	0	0	0.0
Wall	0	-491	0	-491	56.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	17.3
Envelope Subtotal	-269	-422	0	-699	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-163	0	-163	18.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-269	-588	0	-865	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/Mbh	-132		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	114
Cooling ACH	4.34
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	114
Heating ACH	4.34
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

ROOM_Resident Room 06

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	325	0	598	24.9
Door	0	0	0	0	0.0
Wall	0	353	0	353	14.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-191	0	-191	-8.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-32	20	0.8
Envelope Subtotal	325	466	-32	759	-
People	143	227	341	711	29.6
Lights	71	137	0	208	8.7
Miscellaneous Loads	338	423	0	761	31.7
Internal Subtotal	552	787	341	1,680	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-101	0	-101	-4.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	877	1,133	309	2,320	100.0
RA Sensible (Lights)	81	0	0	81	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	20.4
Door	0	0	0	0	0.0
Wall	0	-198	0	-198	31.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-11	0	-11	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	22.4
Envelope Subtotal	-263	-189	0	-459	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-169	0	-169	26.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-263	-361	0	-631	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	112
Cooling ACH	4.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	112
Heating ACH	4.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.90	Volume (ft³)	1,488
cfm/ton	580		
ft²/ton	642		
Btu/h-ft²	18.69		

Engineering Checks For Heating

Heating Mbh	-0.63	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.90	Volume (ft³)	1,488
cfm/Mbh	-178		
ft²/Mbh	-197		
Btu/h-ft²	-5.08		

ROOM_Resident Room 07

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	465	534	0	999	39.7
Door	0	0	0	0	0.0
Wall	0	295	0	295	11.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-177	0	-177	-7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	47	0	-63	-16	-0.6
Envelope Subtotal	512	597	-63	1,046	-
People	145	197	345	687	27.3
Lights	72	134	0	206	8.2
Miscellaneous Loads	342	414	0	756	30.1
Internal Subtotal	559	745	345	1,648	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-233	0	-233	-9.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	-1.2
Grand Total	1,071	1,079	282	2,432	100.0
RA Sensible (Lights)	82	0	0	82	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-207	0	0	-207	30.5
Door	0	0	0	0	0.0
Wall	0	-188	0	-188	27.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	16	0	16	-2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-136	0	0	-143	21.0
Envelope Subtotal	-343	-152	0	-502	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-173	0	-173	25.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.6
Grand Total	-343	-329	0	-679	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	104
Cooling ACH	4.15
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.52
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	104
Heating ACH	4.15
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	13
Calculated Ventilation ACH	0.52
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

	ft²
Roof	0
Other Roof	0
Ceiling	137
Window	18
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	442
Exterior Floor	0
Internal Floor	0
Slab	137
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.25
%OA	13	People per 1000 ft²	10
cfm/ft²	0.83	Volume (ft³)	1,504
cfm/ton	511		
ft²/ton	619		
Btu/h-ft²	19.39		

Engineering Checks For Heating

Heating Mbh	-0.68	No People(max)	1.25
%OA	13	People per 1000 ft²	10
cfm/ft²	0.83	Volume (ft³)	1,504
cfm/Mbh	-153		
ft²/Mbh	-185		
Btu/h-ft²	-5.41		

ROOM_Resident Room 08

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	464	568	0	1,032	39.8
Door	0	0	0	0	0.0
Wall	0	307	0	307	11.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-129	0	-129	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-78	0	-78	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-63	-15	-0.6
Envelope Subtotal	512	668	-63	1,117	-
People	146	198	347	692	26.7
Lights	72	135	0	207	8.0
Miscellaneous Loads	345	416	0	761	29.3
Internal Subtotal	563	749	347	1,659	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-238	0	-238	-9.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-29	0	-29	-1.1
Grand Total	1,075	1,150	284	2,509	100.0
RA Sensible (Lights)	83	0	0	83	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.26
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,515
cfm/ton	513		
ft²/ton	604		
Btu/h-ft²	19.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-209	0	0	-209	29.3
Door	0	0	0	0	0.0
Wall	0	-190	0	-190	26.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	2.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	20.1
Envelope Subtotal	-346	-185	0	-538	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-172	0	-172	24.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-346	-361	0	-714	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.71	No People(max)	1.26
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	1,515
cfm/Mbh	-150		
ft²/Mbh	-177		
Btu/h-ft²	-5.65		

Cooling Airflows

Main Fan cfm	107
Cooling ACH	4.24
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	4.24
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	138
Window	18
Door	0
Wall	125
Below-Grade Wall	0
Other Wall	125
Partition	443
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Resident Room 09

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 41.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	389	378	0	766	28.1
Door	0	0	0	0	0.0
Wall	0	561	0	561	20.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-114	0	-114	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-104	0	-104	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-34	41	1.5
Envelope Subtotal	464	720	-34	1,150	-
People	148	213	352	712	26.1
Lights	73	144	0	217	7.9
Miscellaneous Loads	349	443	0	792	29.0
Internal Subtotal	570	799	352	1,721	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-201	0	-201	-7.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	-0.9
Grand Total	1,034	1,293	317	2,644	100.0
RA Sensible (Lights)	84	0	0	84	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.28
%OA	13	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,534
cfm/ton	509		
ft²/ton	580		
Btu/h-ft²	20.69		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-207	0	0	-207	22.6
Door	0	0	0	0	0.0
Wall	0	-468	0	-468	51.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-138	0	0	-146	15.9
Envelope Subtotal	-346	-400	0	-753	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-159	0	-159	17.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.4
Grand Total	-346	-563	0	-916	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.92	No People(max)	1.28
%OA	13	People per 1000 ft²	10
cfm/ft²	0.88	Volume (ft³)	1,534
cfm/Mbh	-122		
ft²/Mbh	-140		
Btu/h-ft²	-7.14		

Cooling Airflows

Main Fan cfm	112
Cooling ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.59
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	112
Heating ACH	4.38
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.59
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	140
Window	18
Door	0
Wall	285
Below-Grade Wall	0
Other Wall	285
Partition	285
Exterior Floor	0
Internal Floor	0
Slab	140
Other Floor	0

ROOM_Resident Room 10

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	194	109	0	303	12.4
Door	0	0	0	0	0.0
Wall	0	593	0	593	24.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-134	0	-134	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-33	21	0.9
Envelope Subtotal	248	537	-33	753	-
People	150	233	357	740	30.2
Lights	74	141	0	215	8.8
Miscellaneous Loads	354	435	0	790	32.2
Internal Subtotal	578	810	357	1,745	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-114	0	-114	-4.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	827	1,215	324	2,365	100.0
RA Sensible (Lights)	85	0	0	85	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-211	0	0	-211	23.2
Door	0	0	0	0	0.0
Wall	0	-469	0	-469	51.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	59	0	59	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	16.2
Envelope Subtotal	-352	-387	0	-745	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-159	0	-159	17.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-352	-550	0	-909	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	113
Cooling ACH	4.35
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	113
Heating ACH	4.35
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

	ft²
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,557
cfm/ton	573		
ft²/ton	659		
Btu/h-ft²	18.21		

Engineering Checks For Heating

Heating Mbh	-0.91	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,557
cfm/Mbh	-124		
ft²/Mbh	-143		
Btu/h-ft²	-6.99		

ROOM_Resident Room 11

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	323	0	596	24.1
Door	0	0	0	0	0.0
Wall	0	364	0	364	14.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-200	0	-200	-8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-33	21	0.9
Envelope Subtotal	327	462	-33	756	-
People	149	237	355	741	30.0
Lights	74	143	0	217	8.8
Miscellaneous Loads	352	441	0	794	32.1
Internal Subtotal	575	822	355	1,752	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-103	0	-103	-4.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	902	1,161	322	2,385	100.0
RA Sensible (Lights)	85	0	0	85	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.29
%OA	12	People per 1000 ft²	10
cfm/ft²	0.89	Volume (ft³)	1,549
cfm/ton	579		
ft²/ton	649		
Btu/h-ft²	18.49		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-128	0	0	-128	20.2
Door	0	0	0	0	0.0
Wall	0	-204	0	-204	32.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	6	0	6	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	23.2
Envelope Subtotal	-268	-178	0	-453	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-178	0	-178	28.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-268	-359	0	-634	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.63	No People(max)	1.29
%OA	12	People per 1000 ft²	10
cfm/ft²	0.89	Volume (ft³)	1,549
cfm/Mbh	-182		
ft²/Mbh	-204		
Btu/h-ft²	-4.90		

Cooling Airflows

Main Fan cfm	115
Cooling ACH	4.45
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	115
Heating ACH	4.45
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	126
Below-Grade Wall	0
Other Wall	126
Partition	447
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ROOM_Resident Room 12

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	325	0	597	24.2
Door	0	0	0	0	0.0
Wall	0	357	0	357	14.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-157	0	-157	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-32	21	0.8
Envelope Subtotal	326	501	-32	795	-
People	146	233	348	727	29.5
Lights	72	141	0	213	8.6
Miscellaneous Loads	346	433	0	779	31.6
Internal Subtotal	565	807	348	1,720	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-109	0	-109	-4.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	890	1,180	316	2,386	100.0
RA Sensible (Lights)	83	0	0	83	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	20.3
Door	0	0	0	0	0.0
Wall	0	-201	0	-201	31.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2	0	-2	0.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	22.8
Envelope Subtotal	-266	-183	0	-456	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-174	0	-174	27.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-266	-360	0	-633	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	115
Cooling ACH	4.54
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	115
Heating ACH	4.54
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.27
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,520
cfm/ton	581		
ft²/ton	637		
Btu/h-ft²	18.84		

Engineering Checks For Heating

Heating Mbh	-0.63	No People(max)	1.27
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,520
cfm/Mbh	-183		
ft²/Mbh	-200		
Btu/h-ft²	-5.00		

ROOM_Resident Room 13

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	325	0	598	24.1
Door	0	0	0	0	0.0
Wall	0	358	0	358	14.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-145	0	-145	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-23	0	-23	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-32	21	0.8
Envelope Subtotal	326	515	-32	809	-
People	146	232	348	727	29.3
Lights	72	141	0	213	8.6
Miscellaneous Loads	346	433	0	779	31.4
Internal Subtotal	565	806	348	1,719	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-112	0	-112	-4.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	890	1,190	316	2,397	100.0
RA Sensible (Lights)	83	0	0	83	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	19.8
Door	0	0	0	0	0.0
Wall	0	-201	0	-201	30.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	22.2
Envelope Subtotal	-266	-201	0	-474	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-173	0	-173	26.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-266	-377	0	-650	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	116
Cooling ACH	4.58
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	116
Heating ACH	4.58
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.27
%OA	12	People per 1000 ft²	10
cfm/ft²	0.92	Volume (ft³)	1,521
cfm/ton	581		
ft²/ton	634		
Btu/h-ft²	18.93		

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.27
%OA	12	People per 1000 ft²	10
cfm/ft²	0.92	Volume (ft³)	1,521
cfm/Mbh	-179		
ft²/Mbh	-195		
Btu/h-ft²	-5.13		

ROOM_Resident Room 14

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	320	0	592	22.3
Door	0	0	0	0	0.0
Wall	0	524	0	524	19.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-145	0	-145	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-34	21	0.8
Envelope Subtotal	326	680	-34	973	-
People	151	236	359	745	28.0
Lights	74	143	0	217	8.2
Miscellaneous Loads	356	439	0	795	29.9
Internal Subtotal	581	817	359	1,757	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-139	0	-139	-5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.7
Grand Total	908	1,340	325	2,573	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	0.99	Volume (ft³)	1,565
cfm/ton	599		
ft²/ton	608		
Btu/h-ft²	19.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-127	0	0	-127	14.8
Door	0	0	0	0	0.0
Wall	0	-485	0	-485	56.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	43	0	43	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	17.2
Envelope Subtotal	-268	-419	0	-695	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-163	0	-163	18.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-268	-585	0	-860	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	0.99	Volume (ft³)	1,565
cfm/Mbh	-149		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	129
Cooling ACH	4.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	129
Heating ACH	4.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Resident Room 15

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1	0	1	0.1
Other Roof	0	0	0	0	0.0
Glass	246	280	0	526	22.6
Door	0	0	0	0	0.0
Wall	0	330	0	330	14.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-80	0	-80	-3.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-26	0	-26	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-33	7	0.3
Envelope Subtotal	286	505	-33	757	-
People	151	157	358	666	28.6
Lights	74	119	0	194	8.3
Miscellaneous Loads	356	367	0	723	31.1
Internal Subtotal	581	643	358	1,582	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-84	0	-84	-3.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.7
Grand Total	867	1,047	325	2,239	100.0
RA Sensible (Lights)	85	0	0	85	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.79	Volume (ft³)	1,564
cfm/ton	555		
ft²/ton	699		
Btu/h-ft²	17.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.2
Other Roof	0	0	0	0	0.0
Glass	-125	0	0	-125	14.3
Door	0	0	0	0	0.0
Wall	0	-487	0	-487	56.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	17.0
Envelope Subtotal	-266	-422	0	-695	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-173	0	-173	19.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-266	-597	0	-870	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.79	Volume (ft³)	1,564
cfm/Mbh	-119		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	103
Cooling ACH	3.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	103
Heating ACH	3.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	141
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ROOM_Resident Room 16

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1	0	1	0.1
Other Roof	0	0	0	0	0.0
Glass	246	284	0	530	23.9
Door	0	0	0	0	0.0
Wall	0	282	0	282	12.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-117	0	-117	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-32	7	0.3
Envelope Subtotal	285	421	-32	674	-
People	146	155	348	649	29.3
Lights	72	117	0	189	8.5
Miscellaneous Loads	346	361	0	706	31.9
Internal Subtotal	564	632	348	1,545	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-68	0	-68	-3.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.7
Grand Total	850	969	316	2,134	100.0
RA Sensible (Lights)	83	0	0	83	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.3
Other Roof	0	0	0	0	0.0
Glass	-126	0	0	-126	19.3
Door	0	0	0	0	0.0
Wall	0	-203	0	-203	31.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-144	22.1
Envelope Subtotal	-263	-195	0	-465	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-183	0	-183	28.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-263	-381	0	-651	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	98
Cooling ACH	3.87
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	98
Heating ACH	3.87
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	137
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.27
%OA	14	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,520
cfm/ton	553		
ft²/ton	712		
Btu/h-ft²	16.85		

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.27
%OA	14	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,520
cfm/Mbh	-151		
ft²/Mbh	-195		
Btu/h-ft²	-5.13		

ROOM_Sally Port

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 11/21 13:00:00
 Outside DB / WB / HR 79.6 °F / 53.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	60	0	60	1.9
Other Roof	0	0	0	0	0.0
Glass	1,335	1,833	0	3,168	103.0
Door	0	0	0	0	0.0
Wall	0	159	0	159	5.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-730	0	-730	-23.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-337	0	-337	-10.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	1,335	985	0	2,321	-
People	82	126	156	363	11.8
Lights	71	122	0	193	6.3
Miscellaneous Loads	119	89	0	208	6.8
Internal Subtotal	272	336	156	764	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-91	0	-91	-3.0
Grand Total	1,607	1,230	156	2,993	100.0
RA Sensible (Lights)	81	0	0	81	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	0.78
%OA	22	People per 1000 ft²	10
cfm/ft²	1.76	Volume (ft³)	933
cfm/ton	548		
ft²/ton	312		
Btu/h-ft²	38.46		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-114	0	-114	16.6
Other Roof	0	0	0	0	0.0
Glass	-564	0	0	-564	81.8
Door	0	0	0	0	0.0
Wall	0	-126	0	-126	18.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	119	0	119	-17.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-564	-106	0	-670	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	2.8
Grand Total	-564	-125	0	-689	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.69	No People(max)	0.78
%OA	22	People per 1000 ft²	10
cfm/ft²	1.76	Volume (ft³)	933
cfm/Mbh	-198		
ft²/Mbh	-113		
Btu/h-ft²	-8.85		

Cooling Airflows

Main Fan cfm	137
Cooling ACH	8.81
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	30
Calculated Ventilation ACH	1.93
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	137
Heating ACH	8.81
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	30
Calculated Ventilation ACH	1.93
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	87
Other Roof	87
Ceiling	0
Window	26
Door	0
Wall	99
Below-Grade Wall	0
Other Wall	99
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	87
Other Floor	0

ROOM_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	303	0	303	8.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	186	0	186	5.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-36	0	-36	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	127	0	-60	67	1.9
Envelope Subtotal	127	420	-60	487	-
People	456	678	913	2,047	58.4
Lights	137	220	0	357	10.2
Miscellaneous Loads	234	161	0	395	11.3
Internal Subtotal	827	1,059	913	2,798	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	71	0	71	2.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.2
Grand Total	953	1,542	853	3,348	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.28	No People(max)	4.56
%OA	63	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,738
cfm/ton	430		
ft²/ton	818		
Btu/h-ft²	14.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-164	0	-164	14.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-274	0	-274	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-17	0	-17	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	38	0	38	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	23.5
Envelope Subtotal	-247	-418	0	-677	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-426	0	-426	38.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-247	-846	0	-1,106	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.11	No People(max)	4.56
%OA	63	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,738
cfm/Mbh	-109		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	120
Cooling ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	120
Heating ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

ROOM_Service

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	440	0	440	5.7
Other Roof	0	0	0	0	0.0
Glass	2,387	2,740	0	5,127	66.7
Door	0	0	0	0	0.0
Wall	0	396	0	396	5.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1,047	0	1,047	13.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-404	0	-404	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	115	0	-131	-16	-0.2
Envelope Subtotal	2,502	4,219	-131	6,590	-
People	159	227	304	689	9.0
Lights	134	213	0	347	4.5
Miscellaneous Loads	39	0	0	39	0.5
Internal Subtotal	332	440	304	1,076	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-132	0	-132	-1.7
Grand Total	2,834	4,527	172	7,533	100.0
RA Sensible (Lights)	154	0	0	154	-

Engineering Checks For Cooling

Cooling tons	0.63	No People(max)	1.52
%OA	6	People per 1000 ft²	5
cfm/ft²	1.17	Volume (ft³)	3,642
cfm/ton	565		
ft²/ton	484		
Btu/h-ft²	24.79		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-420	0	-420	16.0
Other Roof	0	0	0	0	0.0
Glass	-1,111	0	0	-1,111	42.2
Door	0	0	0	0	0.0
Wall	0	-574	0	-574	21.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-222	0	-222	8.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	65	0	65	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-329	0	0	-346	13.1
Envelope Subtotal	-1,439	-1,151	0	-2,607	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.5
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-38	0	-38	1.5
Grand Total	-1,426	-1,189	0	-2,633	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.63	No People(max)	1.52
%OA	6	People per 1000 ft²	5
cfm/ft²	1.17	Volume (ft³)	3,642
cfm/Mbh	-135		
ft²/Mbh	-115		
Btu/h-ft²	-8.70		

Cooling Airflows

Main Fan cfm	355
Cooling ACH	5.85
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.36
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	355
Heating ACH	5.85
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.36
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	323
Other Roof	323
Ceiling	0
Window	49
Door	0
Wall	389
Below-Grade Wall	0
Other Wall	389
Partition	580
Exterior Floor	0
Internal Floor	0
Slab	323
Other Floor	0

ROOM_Shower 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	144	0	144	12.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	44	0	44	3.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	47	0	47	4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	44	0	-12	33	2.8
Envelope Subtotal	44	225	-12	257	-
People	157	256	248	661	57.2
Lights	55	94	0	149	12.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	212	350	248	810	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	27	0	27	2.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	257	598	237	1,092	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	1.60
%OA	22	People per 1000 ft²	20
cfm/ft²	0.51	Volume (ft³)	961
cfm/ton	453		
ft²/ton	880		
Btu/h-ft²	13.64		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-83	0	-83	21.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-61	0	-61	15.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-75	0	-75	19.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	12	0	12	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-87	0	0	-91	23.4
Envelope Subtotal	-87	-208	0	-299	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-90	0	-90	23.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-87	-298	0	-389	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.39	No People(max)	1.60
%OA	22	People per 1000 ft²	20
cfm/ft²	0.51	Volume (ft³)	961
cfm/Mbh	-106		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	41
Cooling ACH	2.56
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.56
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	41
Heating ACH	2.56
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.56
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	62
Other Roof	62
Ceiling	27
Window	0
Door	0
Wall	37
Below-Grade Wall	0
Other Wall	37
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	89
Other Floor	0

ROOM_Shower 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 37.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	220	0	220	12.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	84	0	84	4.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	344	0	344	19.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	58	0	-18	41	2.3
Envelope Subtotal	58	638	-18	679	-
People	194	304	307	804	46.3
Lights	68	111	0	179	10.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	262	415	307	984	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	321	1,049	289	1,659	100.0
RA Sensible (Lights)	78	0	0	78	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	1.98
%OA	23	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	1,187
cfm/ton	478		
ft²/ton	716		
Btu/h-ft²	16.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-150	0	-150	40.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-56	0	-56	15.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-64	0	-64	17.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	14	0	14	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-107	0	0	-113	30.5
Envelope Subtotal	-107	-256	0	-369	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-107	-257	0	-369	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.37	No People(max)	1.98
%OA	23	People per 1000 ft²	20
cfm/ft²	0.67	Volume (ft³)	1,187
cfm/Mbh	-179		
ft²/Mbh	-268		
Btu/h-ft²	-3.73		

Cooling Airflows

Main Fan cfm	66
Cooling ACH	3.34
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.76
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	66
Heating ACH	3.34
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.76
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	110
Other Roof	110
Ceiling	0
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	488
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

ROOM_Shower 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	327	0	327	22.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-31	0	-31	-2.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	31	0	-27	4	0.3
Envelope Subtotal	31	272	-27	276	-
People	204	386	322	912	61.2
Lights	72	141	0	213	14.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	275	527	322	1,125	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	10	0	10	0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	307	805	295	1,407	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.51	Volume (ft³)	1,247
cfm/ton	456		
ft²/ton	886		
Btu/h-ft²	13.54		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-184	0	-184	40.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-22	0	-22	4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-113	0	0	-118	25.8
Envelope Subtotal	-113	-190	0	-308	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-150	0	-150	32.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-113	-340	0	-458	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.46	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.51	Volume (ft³)	1,247
cfm/Mbh	-117		
ft²/Mbh	-227		
Btu/h-ft²	-4.41		

Cooling Airflows

Main Fan cfm	53
Cooling ACH	2.55
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	53
Heating ACH	2.55
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	115
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	115
Other Floor	0

ROOM_Shower 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	326	0	326	21.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	38	0	38	2.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-26	0	-26	-1.7
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-26	17	1.1
Envelope Subtotal	43	338	-26	355	-
People	202	388	320	910	59.1
Lights	71	142	0	213	13.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	274	530	320	1,124	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-17	0	-17	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	317	847	294	1,458	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	1,239
cfm/ton	461		
ft²/ton	849		
Btu/h-ft²	14.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	38.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	9.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-117	24.7
Envelope Subtotal	-112	-210	0	-327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-147	0	-147	31.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-112	-358	0	-475	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.48	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.54	Volume (ft³)	1,239
cfm/Mbh	-118		
ft²/Mbh	-217		
Btu/h-ft²	-4.61		

Cooling Airflows

Main Fan cfm	56
Cooling ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	56
Heating ACH	2.71
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	109	0	109	8.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	49	0	49	3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-25	0	-25	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-31	13	0.9
Envelope Subtotal	43	133	-31	146	-
People	203	388	321	912	66.5
Lights	72	142	0	213	15.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	275	529	321	1,125	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	21	0	21	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	318	681	290	1,289	100.0
RA Sensible (Lights)	82	0	0	82	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	37.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-46	0	-46	9.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	24.6
Envelope Subtotal	-112	-211	0	-329	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-149	0	-149	31.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-112	-361	0	-478	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	48
Cooling ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	48
Heating ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,243
cfm/ton	447		
ft²/ton	964		
Btu/h-ft²	12.45		

Engineering Checks For Heating

Heating Mbh	-0.48	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,243
cfm/Mbh	-100		
ft²/Mbh	-217		
Btu/h-ft²	-4.61		

ROOM_Shower 6

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	109	0	109	8.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-26	0	-26	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-31	13	0.9
Envelope Subtotal	43	108	-31	121	-
People	203	392	321	916	67.5
Lights	72	143	0	215	15.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	274	535	321	1,131	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	25	0	25	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	318	666	290	1,274	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,242
cfm/ton	446		
ft²/ton	976		
Btu/h-ft²	12.30		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-180	0	-180	38.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-35	0	-35	7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	25.2
Envelope Subtotal	-112	-199	0	-317	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-150	0	-150	32.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-112	-349	0	-467	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.47	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,242
cfm/Mbh	-101		
ft²/Mbh	-222		
Btu/h-ft²	-4.50		

Cooling Airflows

Main Fan cfm	47
Cooling ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	47
Heating ACH	2.27
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 7

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	2	0	2	0.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	265	0	265	18.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-16	0	-16	-1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-30	22	1.6
Envelope Subtotal	52	234	-30	256	-
People	202	348	319	869	62.0
Lights	71	127	0	198	14.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	273	476	319	1,068	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	325	707	289	1,321	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,235
cfm/ton	450		
ft²/ton	935		
Btu/h-ft²	12.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	39.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-22	0	-22	4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-111	0	0	-117	25.2
Envelope Subtotal	-111	-190	0	-307	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-157	0	-157	33.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-111	-347	0	-464	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.46	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,235
cfm/Mbh	-107		
ft²/Mbh	-222		
Btu/h-ft²	-4.50		

Cooling Airflows

Main Fan cfm	50
Cooling ACH	2.43
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	50
Heating ACH	2.43
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	1
Other Roof	1
Ceiling	113
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

ROOM_Shower 8

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 13:00:00
 Outside DB / WB / HR 97.3 °F / 66.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	2	0	2	0.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	210	0	210	15.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	-1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	57	0	-29	28	2.0
Envelope Subtotal	57	178	-29	206	-
People	197	358	312	868	63.7
Lights	70	131	0	200	14.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	267	489	312	1,068	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	12	0	12	0.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	324	676	283	1,283	100.0
RA Sensible (Lights)	80	0	0	80	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,208
cfm/ton	450		
ft²/ton	942		
Btu/h-ft²	12.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-176	0	-176	37.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-43	0	-43	9.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	15	0	15	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	24.2
Envelope Subtotal	-109	-205	0	-320	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-152	0	-152	32.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-109	-358	0	-473	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.47	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,208
cfm/Mbh	-102		
ft²/Mbh	-213		
Btu/h-ft²	-4.69		

Cooling Airflows

Main Fan cfm	48
Cooling ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	48
Heating ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	1
Other Roof	1
Ceiling	110
Window	0
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	421
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

ROOM_Soiled Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	246	0	246	34.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	34	0	34	4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-4	50	7.0
Envelope Subtotal	54	278	-4	327	-
People	51	70	97	217	30.5
Lights	43	66	0	109	15.3
Miscellaneous Loads	12	0	0	12	1.7
Internal Subtotal	106	136	97	339	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	160	412	93	665	100.0
RA Sensible (Lights)	49	0	0	49	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.48
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,161
cfm/ton	498		
ft²/ton	1,748		
Btu/h-ft²	6.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-148	0	-148	56.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	12	0	12	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-105	0	0	-110	41.8
Envelope Subtotal	-105	-156	0	-266	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.6
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-101	-157	0	-262	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.26	No People(max)	0.48
%OA	18	People per 1000 ft²	5
cfm/ft²	0.28	Volume (ft³)	1,161
cfm/Mbh	-105		
ft²/Mbh	-369		
Btu/h-ft²	-2.71		

Cooling Airflows

Main Fan cfm	28
Cooling ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.26
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	28
Heating ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.26
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	508
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

ROOM_Staff Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,838	0	1,838	24.3
Other Roof	0	0	0	0	0.0
Glass	1,341	1,143	0	2,484	32.9
Door	0	0	0	0	0.0
Wall	0	139	0	139	1.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1,135	0	1,135	15.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-142	0	-142	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	284	0	-71	213	2.8
Envelope Subtotal	1,624	4,112	-71	5,666	-
People	0	0	0	0	0.0
Lights	543	814	0	1,357	18.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	543	814	0	1,357	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-92	0	-92	-1.2
Grand Total	2,167	4,834	-71	6,930	100.0
RA Sensible (Lights)	624	0	0	624	-

Engineering Checks For Cooling

Cooling tons	0.58	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.38	Volume (ft³)	10,720
cfm/ton	584		
ft²/ton	1,547		
Btu/h-ft²	7.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 18:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,317	0	-1,317	46.3
Other Roof	0	0	0	0	0.0
Glass	-693	0	0	-693	24.4
Door	0	0	0	0	0.0
Wall	0	-89	0	-89	3.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-298	0	-298	10.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	130	0	130	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-521	0	0	-547	19.2
Envelope Subtotal	-1,214	-1,574	0	-2,814	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-31	0	-31	1.1
Grand Total	-1,214	-1,605	0	-2,845	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.85	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.38	Volume (ft³)	10,720
cfm/Mbh	-119		
ft²/Mbh	-314		
Btu/h-ft²	-3.18		

Cooling Airflows

Main Fan cfm	338
Cooling ACH	1.89
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	62
Calculated Ventilation ACH	0.35
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	338
Heating ACH	1.89
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	62
Calculated Ventilation ACH	0.35
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	968
Other Roof	968
Ceiling	0
Window	28
Door	0
Wall	77
Below-Grade Wall	0
Other Wall	77
Partition	3,525
Exterior Floor	0
Internal Floor	0
Slab	968
Other Floor	0

ROOM_Stor.

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	42	0	42	20.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	81	0	81	39.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	8	0	0	8	3.9
Envelope Subtotal	8	121	0	129	-
People	8	20	15	42	20.4
Lights	6	19	0	25	12.2
Miscellaneous Loads	2	0	0	2	0.9
Internal Subtotal	16	38	15	69	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	-0.1
Grand Total	24	159	15	198	100.0
RA Sensible (Lights)	7	0	0	7	-

Engineering Checks For Cooling

Cooling tons	0.02	No People(max)	0.07
%OA	18	People per 1000 ft²	5
cfm/ft²	0.61	Volume (ft³)	174
cfm/ton	536		
ft²/ton	881		
Btu/h-ft²	13.62		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.7 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-25	0	-25	28.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	55.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	2	0	2	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	-16	0	0	-17	18.7
Envelope Subtotal	-16	-72	0	-89	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	1	0	0	1	-0.7
Internal Subtotal	1	0	0	1	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-15	-73	0	-88	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.09	No People(max)	0.07
%OA	18	People per 1000 ft²	5
cfm/ft²	0.61	Volume (ft³)	174
cfm/Mbh	-100		
ft²/Mbh	-164		
Btu/h-ft²	-6.10		

Cooling Airflows

Main Fan cfm	9
Cooling ACH	3.09
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.69
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	9
Heating ACH	3.09
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	2
Calculated Ventilation ACH	0.69
Infiltration cfm	0
Min Stop/RH (%)	100

Areas ft²

Roof	19
Other Roof	19
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	212
Exterior Floor	0
Internal Floor	0
Slab	19
Other Floor	0

ROOM_Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	122	0	122	23.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	39	0	39	7.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	107	0	107	20.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	29	0	-1	28	5.4
Envelope Subtotal	29	266	-1	294	-
People	27	45	52	125	23.9
Lights	23	43	0	66	12.6
Miscellaneous Loads	7	0	0	7	1.3
Internal Subtotal	57	88	52	198	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	6	0	6	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	86	359	51	496	100.0
RA Sensible (Lights)	26	0	0	26	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-72	0	-72	28.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-54	0	-54	21.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-56	0	-56	22.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-56	0	0	-59	23.1
Envelope Subtotal	-56	-174	0	-234	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-0.9
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-24	0	-24	9.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-54	-199	0	-256	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	21
Cooling ACH	2.02
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	4
Calculated Ventilation ACH	0.38
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	21
Heating ACH	2.02
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	4
Calculated Ventilation ACH	0.38
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	53
Other Roof	53
Ceiling	7
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	369
Exterior Floor	0
Internal Floor	0
Slab	60
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.26
%OA	18	People per 1000 ft²	5
cfm/ft²	0.41	Volume (ft³)	624
cfm/ton	519		
ft²/ton	1,258		
Btu/h-ft²	9.54		

Engineering Checks For Heating

Heating Mbh	-0.26	No People(max)	0.26
%OA	18	People per 1000 ft²	5
cfm/ft²	0.41	Volume (ft³)	624
cfm/Mbh	-84		
ft²/Mbh	-203		
Btu/h-ft²	-4.93		

ROOM_Toilet 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 42.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	122	0	122	11.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	135	0	135	12.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-6	34	3.3
Envelope Subtotal	40	247	-6	282	-
People	131	230	207	568	54.0
Lights	46	84	0	130	12.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	177	314	207	699	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	21	0	21	2.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	217	580	201	999	100.0
RA Sensible (Lights)	53	0	0	53	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.34
%OA	18	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	802
cfm/ton	462		
ft²/ton	803		
Btu/h-ft²	14.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-70	0	-70	19.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-153	0	-153	41.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	10	0	10	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-72	0	0	-76	20.9
Envelope Subtotal	-72	-212	0	-288	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-76	0	-76	20.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-72	-288	0	-364	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	1.34
%OA	18	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	802
cfm/Mbh	-106		
ft²/Mbh	-184		
Btu/h-ft²	-5.43		

Cooling Airflows

Main Fan cfm	38
Cooling ACH	2.84
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.52
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	38
Heating ACH	2.84
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.52
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	53
Other Roof	53
Ceiling	23
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	76
Other Floor	0

ROOM_Toilet 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	164	0	164	20.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-48	0	-48	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	34	0	-7	27	3.3
Envelope Subtotal	34	108	-7	135	-
People	121	202	192	515	63.3
Lights	43	74	0	117	14.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	164	276	192	632	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	198	381	184	764	100.0
RA Sensible (Lights)	49	0	0	49	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	1.24
%OA	18	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	742
cfm/ton	439		
ft²/ton	972		
Btu/h-ft²	12.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-96	0	-96	53.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	11.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	39.0
Envelope Subtotal	-67	-110	0	-180	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-110	0	-180	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.18	No People(max)	1.24
%OA	18	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	742
cfm/Mbh	-155		
ft²/Mbh	-344		
Btu/h-ft²	-2.91		

Cooling Airflows

Main Fan cfm	28
Cooling ACH	2.26
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.40
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	28
Heating ACH	2.26
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.40
Infiltration cfm	2
Min Stop/RH (%)	100

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	408
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Toilet 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	167	0	167	20.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-42	0	-42	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-7	30	3.6
Envelope Subtotal	37	117	-7	147	-
People	121	204	191	516	62.4
Lights	43	74	0	117	14.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	163	278	191	633	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	200	393	184	777	100.0
RA Sensible (Lights)	49	0	0	49	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	1.23
%OA	18	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	740
cfm/ton	442		
ft²/ton	952		
Btu/h-ft²	12.61		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-96	0	-96	50.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-30	0	-30	16.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	8	0	8	-4.2
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	37.3
Envelope Subtotal	-67	-118	0	-188	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-118	0	-188	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.19	No People(max)	1.23
%OA	18	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	740
cfm/Mbh	-152		
ft²/Mbh	-328		
Btu/h-ft²	-3.05		

Cooling Airflows

Main Fan cfm	29
Cooling ACH	2.35
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.41
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	29
Heating ACH	2.35
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.41
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	407
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

Room Cooling and Heating Loads by Component

ROOM_Ante Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	130	0	130	31.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	49	0	49	11.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	24	0	-13	12	2.9
Envelope Subtotal	24	176	-13	188	-
People	42	57	81	180	44.3
Lights	37	57	0	94	23.0
Miscellaneous Loads	34	0	0	34	8.5
Internal Subtotal	114	114	81	309	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-101	0	-31	-131	-32.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	38	289	38	365	100.0
RA Sensible (Lights)	43	0	0	43	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 86.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-97	0	-97	35.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-26	0	-26	9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	14	0	14	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-91	32.6
Envelope Subtotal	-88	-109	0	-200	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-1.2
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-74	0	0	-81	29.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-159	-109	0	-278	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	16
Cooling ACH	0.99
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	16
Heating ACH	0.99
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	90
Other Roof	90
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	456
Exterior Floor	0
Internal Floor	0
Slab	90
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.40
%OA	31	People per 1000 ft²	5
cfm/ft²	0.19	Volume (ft³)	970
cfm/ton	518		
ft²/ton	2,659		
Btu/h-ft²	4.51		

Engineering Checks For Heating

Heating Mbh	-0.28	No People(max)	0.40
%OA	31	People per 1000 ft²	5
cfm/ft²	0.19	Volume (ft³)	970
cfm/Mbh	-57		
ft²/Mbh	-291		
Btu/h-ft²	-3.44		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 77 of 152

ROOM_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	542	0	542	23.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	227	0	227	9.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-19	0	-19	-0.8
Slab	0	-18	0	-18	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	381	0	-96	284	12.2
Envelope Subtotal	381	732	-96	1,017	-
People	305	446	482	1,233	53.0
Lights	344	522	0	866	37.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	648	968	482	2,098	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,096	0	-270	-1,366	-58.7
Ceiling	0	189	0	189	8.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	-67	1,885	115	1,933	100.0
RA Sensible (Lights)	395	0	0	395	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	3.11
%OA	60	People per 1000 ft²	5
cfm/ft²	0.14	Volume (ft³)	9,250
cfm/ton	543		
ft²/ton	3,860		
Btu/h-ft²	3.11		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 100.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-593	0	-593	20.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-326	0	-326	11.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	26	0	26	-0.9
Slab	0	84	0	84	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-835	0	0	-859	30.2
Envelope Subtotal	-835	-809	0	-1,667	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-811	0	0	-869	30.6
Ceiling	0	-301	0	-301	10.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.1
Grand Total	-1,646	-1,114	0	-2,842	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.84	No People(max)	3.11
%OA	60	People per 1000 ft²	5
cfm/ft²	0.14	Volume (ft³)	9,250
cfm/Mbh	-31		
ft²/Mbh	-219		
Btu/h-ft²	-4.57		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	0.56
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	53
Calculated Ventilation ACH	0.34
Infiltration cfm	20
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	0.56
Sec Fan cfm	0
Input Ventilation cfm	53
Calculated Ventilation cfm	53
Calculated Ventilation ACH	0.34
Infiltration cfm	20
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	671
Window	0
Door	0
Wall	332
Below-Grade Wall	0
Other Wall	332
Partition	1,426
Exterior Floor	0
Internal Floor	207
Slab	469
Other Floor	207

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 78 of 152

ROOM_Attrium 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	781	0	781	19.6
Other Roof	0	0	0	0	0.0
Glass	764	577	0	1,341	33.6
Door	0	0	0	0	0.0
Wall	0	1,093	0	1,093	27.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-394	0	-394	-9.9
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	238	0	-57	181	4.5
Envelope Subtotal	1,002	2,057	-57	3,002	-
People	316	393	500	1,208	30.3
Lights	357	455	0	812	20.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	673	848	500	2,020	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,137	0	-268	-1,405	-35.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-38	0	-38	-1.0
Grand Total	538	2,867	174	3,579	100.0
RA Sensible (Lights)	409	0	0	409	-

Engineering Checks For Cooling

Cooling tons	0.30	No People(max)	3.23
%OA	33	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	5,793
cfm/ton	549		
ft²/ton	2,163		
Btu/h-ft²	5.55		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 92.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-733	0	-733	19.3
Other Roof	0	0	0	0	0.0
Glass	-751	0	0	-751	19.8
Door	0	0	0	0	0.0
Wall	0	-1,134	0	-1,134	29.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	302	0	302	-8.0
Slab	0	0	0	0	0.0
Other Floor	0	0	0	0	0.0
Infiltration	-524	0	0	-543	14.3
Envelope Subtotal	-1,275	-1,565	0	-2,860	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-842	0	0	-921	24.3
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	0.3
Grand Total	-2,116	-1,579	0	-3,793	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.79	No People(max)	3.23
%OA	33	People per 1000 ft²	5
cfm/ft²	0.25	Volume (ft³)	5,793
cfm/Mbh	-43		
ft²/Mbh	-170		
Btu/h-ft²	-5.88		

Cooling Airflows

Main Fan cfm	164
Cooling ACH	1.70
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	55
Calculated Ventilation ACH	0.57
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	164
Heating ACH	1.70
Sec Fan cfm	0
Input Ventilation cfm	55
Calculated Ventilation cfm	55
Calculated Ventilation ACH	0.57
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	704
Other Roof	704
Ceiling	0
Window	57
Door	0
Wall	715
Below-Grade Wall	0
Other Wall	715
Partition	0
Exterior Floor	0
Internal Floor	671
Slab	0
Other Floor	671

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 79 of 152

ROOM_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 48.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	19	0	19	1.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	35	0	35	3.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-45	15	1.3
Envelope Subtotal	60	44	-45	59	-
People	210	272	399	881	76.1
Lights	129	188	0	317	27.4
Miscellaneous Loads	341	0	0	341	29.4
Internal Subtotal	679	460	399	1,538	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-455	0	-205	-660	-57.0
Ceiling	0	75	0	75	6.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	284	577	149	1,010	100.0
RA Sensible (Lights)	148	0	0	148	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	2.00
%OA	53	People per 1000 ft²	10
cfm/ft²	0.21	Volume (ft³)	2,395
cfm/ton	492		
ft²/ton	2,372		
Btu/h-ft²	5.06		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 86.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-21	0	-21	2.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-76	0	-76	10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	34	0	34	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-223	30.4
Envelope Subtotal	-216	-63	0	-286	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-4.6
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-337	0	0	-364	49.6
Ceiling	0	-117	0	-117	15.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-519	-181	0	-734	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.73	No People(max)	2.00
%OA	53	People per 1000 ft²	10
cfm/ft²	0.21	Volume (ft³)	2,395
cfm/Mbh	-56		
ft²/Mbh	-272		
Btu/h-ft²	-3.68		

Cooling Airflows

Main Fan cfm	41
Cooling ACH	1.03
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	41
Heating ACH	1.03
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 80 of 152

ROOM_Clean Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	162	0	162	35.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	5	0	5	1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	31	0	-17	14	3.1
Envelope Subtotal	31	164	-17	178	-
People	54	72	102	228	50.3
Lights	47	72	0	119	26.1
Miscellaneous Loads	44	0	0	44	9.6
Internal Subtotal	144	144	102	390	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-127	0	-41	-167	-36.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	48	307	45	400	100.0
RA Sensible (Lights)	54	0	0	54	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.51
%OA	36	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,224
cfm/ton	513		
ft²/ton	3,064		
Btu/h-ft²	3.92		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 88.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-122	0	-122	36.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-110	0	0	-114	34.1
Envelope Subtotal	-110	-123	0	-237	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-94	0	0	-102	30.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-200	-123	0	-335	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.34	No People(max)	0.51
%OA	36	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,224
cfm/Mbh	-51		
ft²/Mbh	-304		
Btu/h-ft²	-3.29		

Cooling Airflows

Main Fan cfm	17
Cooling ACH	0.83
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	17
Heating ACH	0.83
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	113
Other Roof	113
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	519
Exterior Floor	0
Internal Floor	0
Slab	113
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 81 of 152

ROOM_Comfort Room 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	144	0	144	30.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	31	0	31	6.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	-12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-1.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	107	0	107	-
People	88	123	168	378	80.6
Lights	93	146	0	238	50.8
Miscellaneous Loads	129	87	0	215	45.9
Internal Subtotal	309	355	168	832	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-443	0	-131	-575	-122.5
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.4
Grand Total	-134	460	36	363	100.0
RA Sensible (Lights)	106	0	0	106	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.84
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	1,005
cfm/ton	707		
ft²/ton	2,771		
Btu/h-ft²	4.33		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 101.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-100	0	-100	18.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-47	0	-47	8.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-55	0	-55	10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-185	0	-185	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-328	0	0	-346	65.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-328	-186	0	-532	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.53	No People(max)	0.84
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	1,005
cfm/Mbh	-40		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	21
Cooling ACH	1.25
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	21
Heating ACH	1.25
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	93
Other Roof	93
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	438
Exterior Floor	0
Internal Floor	0
Slab	93
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 82 of 152

ROOM_Comfort Room 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	104	0	104	17.9
Other Roof	0	0	0	0	0.0
Glass	64	29	0	93	15.9
Door	0	0	0	0	0.0
Wall	0	113	0	113	19.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	-16.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	64	140	0	203	-
People	86	125	164	375	64.5
Lights	91	148	0	239	41.0
Miscellaneous Loads	126	88	0	214	36.8
Internal Subtotal	303	362	164	829	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-434	0	-122	-556	-95.4
Ceiling	0	8	0	8	1.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-1.0
Grand Total	-67	504	42	478	100.0
RA Sensible (Lights)	104	0	0	104	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 99.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-82	0	-82	12.3
Other Roof	0	0	0	0	0.0
Glass	-93	0	0	-93	14.0
Door	0	0	0	0	0.0
Wall	0	-161	0	-161	24.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	34	0	34	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-93	-191	0	-284	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-321	0	0	-342	51.4
Ceiling	0	-36	0	-36	5.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-414	-230	0	-666	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	21
Cooling ACH	1.28
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	21
Heating ACH	1.28
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	80
Other Roof	80
Ceiling	11
Window	8
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	91
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.82
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	985
cfm/ton	527		
ft²/ton	2,058		
Btu/h-ft²	5.83		

Engineering Checks For Heating

Heating Mbh	-0.67	No People(max)	0.82
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	985
cfm/Mbh	-32		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 83 of 152

ROOM_Consult 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	141	0	141	20.7
Other Roof	0	0	0	0	0.0
Glass	62	27	0	90	13.2
Door	0	0	0	0	0.0
Wall	0	128	0	128	18.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-101	0	-101	-14.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	62	185	0	247	-
People	105	143	200	447	65.9
Lights	110	169	0	279	41.1
Miscellaneous Loads	153	101	0	254	37.4
Internal Subtotal	369	412	200	981	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-528	0	-150	-679	-100.0
Ceiling	0	9	0	9	1.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.9
Grand Total	-97	600	50	552	100.0
RA Sensible (Lights)	127	0	0	127	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.00
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	1,199
cfm/ton	554		
ft²/ton	2,172		
Btu/h-ft²	5.52		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 100.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-101	0	-101	13.0
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	12.1
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	23.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	35	0	35	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-94	-228	0	-322	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-391	0	0	-416	53.3
Ceiling	0	-40	0	-40	5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-486	-271	0	-782	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.78	No People(max)	1.00
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	1,199
cfm/Mbh	-33		
ft²/Mbh	-128		
Btu/h-ft²	-7.81		

Cooling Airflows

Main Fan cfm	25
Cooling ACH	1.25
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	25
Heating ACH	1.25
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	1.25
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	98
Other Roof	98
Ceiling	12
Window	8
Door	0
Wall	115
Below-Grade Wall	0
Other Wall	115
Partition	390
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 84 of 152

ROOM_Consult 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	142	0	142	19.9
Other Roof	0	0	0	0	0.0
Glass	62	28	0	90	12.6
Door	0	0	0	0	0.0
Wall	0	130	0	130	18.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-79	0	-79	-11.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	62	210	0	272	-
People	107	146	203	456	63.7
Lights	112	173	0	285	39.8
Miscellaneous Loads	156	103	0	259	36.2
Internal Subtotal	375	422	203	1,000	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-536	0	-151	-688	-96.1
Ceiling	0	8	0	8	1.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.8
Grand Total	-100	635	52	587	100.0
RA Sensible (Lights)	129	0	0	129	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.02
%OA	100	People per 1000 ft²	10
cfm/ft²	0.25	Volume (ft³)	1,218
cfm/ton	529		
ft²/ton	2,075		
Btu/h-ft²	5.78		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 99.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-102	0	-102	12.8
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	11.8
Door	0	0	0	0	0.0
Wall	0	-185	0	-185	23.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	-3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-94	-240	0	-335	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-397	0	0	-423	52.8
Ceiling	0	-41	0	-41	5.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-492	-284	0	-802	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.80	No People(max)	1.02
%OA	100	People per 1000 ft²	10
cfm/ft²	0.25	Volume (ft³)	1,218
cfm/Mbh	-32		
ft²/Mbh	-127		
Btu/h-ft²	-7.87		

Cooling Airflows

Main Fan cfm	26
Cooling ACH	1.28
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	26
Heating ACH	1.28
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	1.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	99
Other Roof	99
Ceiling	12
Window	8
Door	0
Wall	117
Below-Grade Wall	0
Other Wall	117
Partition	392
Exterior Floor	0
Internal Floor	0
Slab	112
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 85 of 152

ROOM_Corridor 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	445	0	445	51.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	341	0	341	39.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	67	0	1	67	7.7
Envelope Subtotal	67	783	1	850	-
People	0	0	0	0	0.0
Lights	109	154	0	263	30.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	109	154	0	263	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-368	0	2	-366	-41.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	-192	936	3	747	100.0
RA Sensible (Lights)	125	0	0	125	-

Engineering Checks For Cooling

Cooling tons	0.06	No People(max)	0.00
%OA	49	People per 1000 ft²	0
cfm/ft²	0.12	Volume (ft³)	3,546
cfm/ton	576		
ft²/ton	4,750		
Btu/h-ft²	2.53		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-341	0	-341	35.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-188	0	-188	19.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	54	0	54	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-172	0	0	-178	18.8
Envelope Subtotal	-172	-475	0	-653	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-272	0	0	-294	31.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-444	-476	0	-948	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	0.00
%OA	49	People per 1000 ft²	0
cfm/ft²	0.12	Volume (ft³)	3,546
cfm/Mbh	-38		
ft²/Mbh	-312		
Btu/h-ft²	-3.21		

Cooling Airflows

Main Fan cfm	36
Cooling ACH	0.61
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	18
Calculated Ventilation ACH	0.30
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	36
Heating ACH	0.61
Sec Fan cfm	0
Input Ventilation cfm	18
Calculated Ventilation cfm	18
Calculated Ventilation ACH	0.30
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	318
Other Roof	318
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	318
Other Floor	0

ROOM_Corridor 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	691	0	691	45.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	642	0	642	41.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	143	0	1	144	9.4
Envelope Subtotal	143	1,327	1	1,470	-
People	0	0	0	0	0.0
Lights	234	328	0	562	36.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	234	328	0	562	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-790	0	4	-786	-51.2
Ceiling	0	23	0	23	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.1
Grand Total	-413	1,676	5	1,268	100.0
RA Sensible (Lights)	269	0	0	269	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	0.00
%OA	63	People per 1000 ft²	0
cfm/ft²	0.10	Volume (ft³)	7,619
cfm/ton	576		
ft²/ton	6,011		
Btu/h-ft²	2.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 99.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-549	0	-549	29.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-317	0	-317	17.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	111	0	111	-6.0
Other Floor	0	0	0	0	0.0
Infiltration	-370	0	0	-381	20.4
Envelope Subtotal	-370	-755	0	-1,136	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-585	0	0	-628	33.7
Ceiling	0	-98	0	-98	5.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.1
Grand Total	-955	-855	0	-1,865	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.86	No People(max)	0.00
%OA	63	People per 1000 ft²	0
cfm/ft²	0.10	Volume (ft³)	7,619
cfm/Mbh	-33		
ft²/Mbh	-341		
Btu/h-ft²	-2.93		

Cooling Airflows

Main Fan cfm	61
Cooling ACH	0.48
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	0.30
Infiltration cfm	9
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	61
Heating ACH	0.48
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	0.30
Infiltration cfm	9
Min Stop/RH (%)	100

Areas

ft²	
Roof	516
Other Roof	516
Ceiling	170
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	2,442
Exterior Floor	0
Internal Floor	0
Slab	686
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 87 of 152

ROOM_Corridor 2.1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 31.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	193	0	193	70.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	25	0	-1	24	8.6
Envelope Subtotal	25	191	-1	215	-
People	0	0	0	0	0.0
Lights	32	60	0	91	33.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	32	60	0	91	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-106	0	-6	-112	-40.9
Ceiling	0	45	0	45	16.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.0
Grand Total	-49	295	-7	238	100.0
RA Sensible (Lights)	36	0	0	36	-

Engineering Checks For Cooling

Cooling tons	0.02	No People(max)	0.00
%OA	43	People per 1000 ft²	0
cfm/ft²	0.14	Volume (ft³)	1,026
cfm/ton	598		
ft²/ton	4,304		
Btu/h-ft²	2.79		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 94.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-67	0	-67	22.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-50	0	0	-52	17.1
Envelope Subtotal	-50	-51	0	-103	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-79	0	0	-86	28.4
Ceiling	0	-112	0	-112	37.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-129	-164	0	-301	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.30	No People(max)	0.00
%OA	43	People per 1000 ft²	0
cfm/ft²	0.14	Volume (ft³)	1,026
cfm/Mbh	-39		
ft²/Mbh	-284		
Btu/h-ft²	-3.52		

Cooling Airflows

Main Fan cfm	12
Cooling ACH	0.70
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	12
Heating ACH	0.70
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	96
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	513
Exterior Floor	0
Internal Floor	0
Slab	96
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 88 of 152

ROOM_Corridor 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	736	351	0	1,086	58.9
Door	0	0	0	0	0.0
Wall	0	44	0	44	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	433	0	433	23.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	1.7
Other Floor	0	0	0	0	0.0
Infiltration	92	0	1	93	5.1
Envelope Subtotal	828	858	1	1,687	-
People	0	0	0	0	0.0
Lights	151	234	0	385	20.9
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	151	234	0	385	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-509	0	4	-505	-27.4
Ceiling	0	118	0	118	6.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	-0.8
Grand Total	470	1,195	5	1,670	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	0.00
%OA	31	People per 1000 ft²	0
cfm/ft²	0.20	Volume (ft³)	4,909
cfm/ton	576		
ft²/ton	2,939		
Btu/h-ft²	4.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 92.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-731	0	0	-731	38.9
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	3.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-33	0	-33	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	88	0	88	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-248	13.2
Envelope Subtotal	-970	-9	0	-988	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-377	0	0	-413	22.0
Ceiling	0	-465	0	-465	24.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.8
Grand Total	-1,347	-489	0	-1,881	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.88	No People(max)	0.00
%OA	31	People per 1000 ft²	0
cfm/ft²	0.20	Volume (ft³)	4,909
cfm/Mbh	-43		
ft²/Mbh	-217		
Btu/h-ft²	-4.61		

Cooling Airflows

Main Fan cfm	80
Cooling ACH	0.98
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	80
Heating ACH	0.98
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

ROOM_Corridor 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,096	1,792	0	3,888	105.9
Door	0	0	0	0	0.0
Wall	0	103	0	103	2.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-303	0	-303	-8.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	471	0	471	12.8
Other Floor	0	0	0	0	0.0
Infiltration	86	0	1	87	2.4
Envelope Subtotal	2,183	2,062	1	4,246	-
People	0	0	0	0	0.0
Lights	119	193	0	312	8.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	119	193	0	312	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-403	0	5	-398	-10.8
Ceiling	0	-528	0	-528	-14.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-97	0	-97	-2.6
Grand Total	1,899	1,630	7	3,536	100.0
RA Sensible (Lights)	137	0	0	137	-

Engineering Checks For Cooling

Cooling tons	0.29	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.52	Volume (ft³)	3,888
cfm/ton	577		
ft²/ton	1,100		
Btu/h-ft²	10.91		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-703	0	0	-703	43.8
Door	0	0	0	0	0.0
Wall	0	-62	0	-62	3.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-5	0	-5	0.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-198	12.3
Envelope Subtotal	-892	5	0	-896	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-298	0	0	-333	20.8
Ceiling	0	-362	0	-362	22.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.9
Grand Total	-1,190	-371	0	-1,604	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.60	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.52	Volume (ft³)	3,888
cfm/Mbh	-106		
ft²/Mbh	-202		
Btu/h-ft²	-4.95		

Cooling Airflows

Main Fan cfm	170
Cooling ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	170
Heating ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 90 of 152

ROOM_Corridor 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 21.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,829	1,906	0	3,734	115.5
Door	0	0	0	0	0.0
Wall	0	101	0	101	3.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-128	0	-128	-4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	108	0	108	3.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-12	65	2.0
Envelope Subtotal	1,905	1,988	-12	3,881	-
People	0	0	0	0	0.0
Lights	153	230	0	383	11.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	153	230	0	383	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-512	0	-53	-565	-17.5
Ceiling	0	-563	0	-563	-17.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-76	0	-76	-2.4
Grand Total	1,546	1,579	-65	3,060	100.0
RA Sensible (Lights)	175	0	0	175	-

Engineering Checks For Cooling

Cooling tons	0.25	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	4,967
cfm/ton	594		
ft²/ton	1,624		
Btu/h-ft²	7.39		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-722	0	0	-722	38.7
Door	0	0	0	0	0.0
Wall	0	-66	0	-66	3.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	88	0	88	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-252	13.5
Envelope Subtotal	-963	3	0	-971	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-381	0	0	-423	22.7
Ceiling	0	-457	0	-457	24.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.8
Grand Total	-1,344	-469	0	-1,866	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.87	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	4,967
cfm/Mbh	-81		
ft²/Mbh	-222		
Btu/h-ft²	-4.50		

Cooling Airflows

Main Fan cfm	151
Cooling ACH	1.82
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	151
Heating ACH	1.82
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 91 of 152

ROOM_Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 31.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	59	0	59	3.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	700	0	700	42.5
Wall	0	813	0	813	49.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-149	0	-149	-9.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	1,420	0	1,420	-
People	0	0	0	0	0.0
Lights	88	125	0	213	12.9
Miscellaneous Loads	195	0	0	195	11.8
Internal Subtotal	283	125	0	408	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-236	0	-20	-257	-15.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-1.5
Grand Total	46	1,520	-20	1,546	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	0.00
%OA	15	People per 1000 ft²	0
cfm/ft²	0.40	Volume (ft³)	2,287
cfm/ton	587		
ft²/ton	1,479		
Btu/h-ft²	8.11		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 01:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 85.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-214	0	-214	17.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-412	0	-412	33.7
Wall	0	-595	0	-595	48.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	90	0	90	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-1,082	0	-1,082	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	65	0	0	65	-5.3
Internal Subtotal	65	0	0	65	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-176	0	0	-195	16.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	0.9
Grand Total	-110	-1,093	0	-1,223	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.22	No People(max)	0.00
%OA	15	People per 1000 ft²	0
cfm/ft²	0.40	Volume (ft³)	2,287
cfm/Mbh	-62		
ft²/Mbh	-156		
Btu/h-ft²	-6.41		

Cooling Airflows

Main Fan cfm	76
Cooling ACH	1.99
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	76
Heating ACH	1.99
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	205
Other Roof	205
Ceiling	0
Window	0
Door	21
Wall	358
Below-Grade Wall	0
Other Wall	358
Partition	358
Exterior Floor	0
Internal Floor	0
Slab	205
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 92 of 152

ROOM_Emergency Electric

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-118	0	-118	-8.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	822	0	822	62.3
Wall	0	180	0	180	13.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-202	0	-202	-15.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	674	0	674	-
People	0	0	0	0	0.0
Lights	82	114	0	196	14.9
Miscellaneous Loads	610	0	0	610	46.2
Internal Subtotal	693	114	0	806	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-223	0	2	-220	-16.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-35	0	-35	-2.6
Grand Total	470	753	2	1,225	100.0
RA Sensible (Lights)	95	0	0	95	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	2,146
cfm/ton	577		
ft²/ton	1,752		
Btu/h-ft²	6.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 01:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-204	0	-204	23.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-414	0	-414	48.0
Wall	0	-178	0	-178	20.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	28	0	28	-3.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-728	0	-728	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	61	0	0	61	-7.1
Internal Subtotal	61	0	0	61	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-165	0	0	-183	21.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	1.3
Grand Total	-104	-739	0	-861	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	0.00
%OA	18	People per 1000 ft²	0
cfm/ft²	0.33	Volume (ft³)	2,146
cfm/Mbh	-68		
ft²/Mbh	-208		
Btu/h-ft²	-4.81		

Cooling Airflows

Main Fan cfm	59
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.31
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	59
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	11
Calculated Ventilation cfm	11
Calculated Ventilation ACH	0.31
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²

Roof	193
Other Roof	193
Ceiling	0
Window	0
Door	21
Wall	121
Below-Grade Wall	0
Other Wall	121
Partition	581
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 93 of 152

ROOM_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 40.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-99	0	-99	-1.0
Other Roof	0	0	0	0	0.0
Glass	5,291	5,882	0	11,174	112.6
Door	0	65	0	65	0.7
Wall	0	267	0	267	2.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,026	0	-1,026	-10.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	472	0	472	4.8
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-22	43	0.4
Envelope Subtotal	5,357	5,562	-22	10,896	-
People	182	228	287	697	7.0
Lights	205	262	0	467	4.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	386	491	287	1,164	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-653	0	-75	-728	-7.3
Ceiling	0	-1,423	0	-1,423	-14.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-221	0	-221	-2.2
Grand Total	5,090	4,409	190	9,689	100.0
RA Sensible (Lights)	235	0	0	235	-

Engineering Checks For Cooling

Cooling tons	0.81	No People(max)	1.85
%OA	7	People per 1000 ft²	5
cfm/ft²	1.23	Volume (ft³)	4,445
cfm/ton	566		
ft²/ton	459		
Btu/h-ft²	26.14		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-54	0	-54	1.1
Other Roof	0	0	0	0	0.0
Glass	-2,567	0	0	-2,567	52.0
Door	0	-481	0	-481	9.8
Wall	0	-547	0	-547	11.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	447	0	447	-9.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	134	0	134	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-420	8.5
Envelope Subtotal	-2,968	-501	0	-3,469	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-483	0	0	-542	11.0
Ceiling	0	-857	0	-857	17.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-48	0	-48	1.0
Grand Total	-3,451	-1,406	0	-4,936	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-4.94	No People(max)	1.85
%OA	7	People per 1000 ft²	5
cfm/ft²	1.23	Volume (ft³)	4,445
cfm/Mbh	-93		
ft²/Mbh	-75		
Btu/h-ft²	-13.33		

Cooling Airflows

Main Fan cfm	457
Cooling ACH	6.17
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	457
Heating ACH	6.17
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 94 of 152

ROOM_Exam Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	210	0	210	37.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-146	0	-146	-25.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	50	0	50	-
People	129	177	246	552	98.0
Lights	136	210	0	346	61.4
Miscellaneous Loads	189	125	0	314	55.7
Internal Subtotal	454	512	246	1,212	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-650	0	-202	-853	-151.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.4
Grand Total	-196	560	44	407	100.0
RA Sensible (Lights)	156	0	0	156	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	1.23
%OA	100	People per 1000 ft²	10
cfm/ft²	0.25	Volume (ft³)	1,476
cfm/ton	925		
ft²/ton	3,628		
Btu/h-ft²	3.31		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 104.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-145	0	-145	22.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	2.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-142	0	-142	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-482	0	0	-504	77.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-482	-143	0	-648	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.65	No People(max)	1.23
%OA	100	People per 1000 ft²	10
cfm/ft²	0.25	Volume (ft³)	1,476
cfm/Mbh	-48		
ft²/Mbh	-190		
Btu/h-ft²	-5.26		

Cooling Airflows

Main Fan cfm	31
Cooling ACH	1.26
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	1.26
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	31
Heating ACH	1.26
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	1.26
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	134
Other Roof	134
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	559
Exterior Floor	0
Internal Floor	0
Slab	134
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 95 of 152

ROOM_Fire Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 09:00:00
 Outside DB / WB / HR 81.4 °F / 59.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 35.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-95	0	-95	-10.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	808	0	808	89.6
Wall	0	117	0	117	13.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-184	0	-184	-20.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-6	0	-6	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	640	0	640	-
People	0	0	0	0	0.0
Lights	37	55	0	92	10.2
Miscellaneous Loads	270	0	0	270	30.0
Internal Subtotal	307	55	0	362	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-98	0	-12	-110	-12.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-3.6
Grand Total	208	663	-12	859	100.0
RA Sensible (Lights)	42	0	0	42	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	951
cfm/ton	587		
ft²/ton	1,106		
Btu/h-ft²	10.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 01:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-93	0	-93	15.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-407	0	-407	67.2
Wall	0	-168	0	-168	27.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	107	0	107	-17.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-541	0	-541	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	27	0	0	27	-4.5
Internal Subtotal	27	0	0	27	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-73	0	0	-82	13.5
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	1.7
Grand Total	-46	-551	0	-606	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.61	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	951
cfm/Mbh	-69		
ft²/Mbh	-131		
Btu/h-ft²	-7.63		

Cooling Airflows

Main Fan cfm	42
Cooling ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	42
Heating ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	5
Calculated Ventilation cfm	5
Calculated Ventilation ACH	0.32
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	88
Other Roof	88
Ceiling	0
Window	0
Door	21
Wall	118
Below-Grade Wall	0
Other Wall	118
Partition	334
Exterior Floor	0
Internal Floor	0
Slab	88
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 96 of 152

ROOM_General Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	151	0	151	17.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	404	0	404	47.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	29	0	-13	16	1.9
Envelope Subtotal	29	551	-13	567	-
People	50	75	96	220	26.1
Lights	44	74	0	118	13.9
Miscellaneous Loads	41	0	0	41	4.8
Internal Subtotal	135	148	96	379	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-119	0	-30	-149	-17.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	45	697	53	794	100.0
RA Sensible (Lights)	51	0	0	51	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.48
%OA	16	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,147
cfm/ton	539		
ft²/ton	1,444		
Btu/h-ft²	8.31		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-115	0	-115	32.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-56	0	-56	15.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-104	0	0	-108	30.3
Envelope Subtotal	-104	-154	0	-262	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.1
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-88	0	0	-98	27.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-188	-154	0	-356	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	0.48
%OA	16	People per 1000 ft²	5
cfm/ft²	0.37	Volume (ft³)	1,147
cfm/Mbh	-100		
ft²/Mbh	-269		
Btu/h-ft²	-3.72		

Cooling Airflows

Main Fan cfm	36
Cooling ACH	1.88
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	36
Heating ACH	1.88
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	535
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 97 of 152

ROOM_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 50.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 61.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	237	0	237	17.6
Other Roof	0	0	0	0	0.0
Glass	135	66	0	201	15.0
Door	0	0	0	0	0.0
Wall	0	300	0	300	22.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-186	0	-186	-13.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	116	0	-76	40	3.0
Envelope Subtotal	251	387	-76	562	-
People	553	793	1,106	2,452	182.3
Lights	191	288	0	479	35.6
Miscellaneous Loads	283	183	0	466	34.6
Internal Subtotal	1,027	1,264	1,106	3,396	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,891	0	-1,015	-2,906	-216.0
Ceiling	0	94	0	94	7.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-1.6
Grand Total	-613	1,724	15	1,126	100.0
RA Sensible (Lights)	219	0	0	219	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	5.52
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	3,317
cfm/ton	972		
ft²/ton	2,947		
Btu/h-ft²	4.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 105.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-149	0	-149	5.1
Other Roof	0	0	0	0	0.0
Glass	-196	0	0	-196	6.7
Door	0	0	0	0	0.0
Wall	0	-470	0	-470	16.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	93	0	93	-3.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	68	0	68	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-306	10.5
Envelope Subtotal	-495	-458	0	-960	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,400	0	0	-1,482	50.6
Ceiling	0	-476	0	-476	16.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.3
Grand Total	-1,895	-942	0	-2,926	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.93	No People(max)	5.52
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	3,317
cfm/Mbh	-31		
ft²/Mbh	-94		
Btu/h-ft²	-10.64		

Cooling Airflows

Main Fan cfm	91
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	91
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas

ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 98 of 152

ROOM_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 60.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	186	0	186	13.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	309	0	309	23.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	50	0	50	3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-27	0	-27	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	122	0	-63	58	4.4
Envelope Subtotal	122	518	-63	576	-
People	492	698	984	2,174	163.1
Lights	170	258	0	428	32.1
Miscellaneous Loads	252	164	0	415	31.2
Internal Subtotal	914	1,119	984	3,017	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,683	0	-856	-2,539	-190.5
Ceiling	0	92	0	92	6.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.6
Grand Total	-647	1,720	65	1,138	100.0
RA Sensible (Lights)	195	0	0	195	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	4.92
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,953
cfm/ton	856		
ft²/ton	2,595		
Btu/h-ft²	4.62		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 104.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-130	0	-130	5.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-441	0	-441	16.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-89	0	-89	3.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-273	10.4
Envelope Subtotal	-266	-599	0	-871	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,246	0	0	-1,321	50.4
Ceiling	0	-422	0	-422	16.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.1
Grand Total	-1,513	-1,024	0	-2,618	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.62	No People(max)	4.92
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,953
cfm/Mbh	-31		
ft²/Mbh	-94		
Btu/h-ft²	-10.64		

Cooling Airflows

Main Fan cfm	81
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	81
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 99 of 152

ROOM_Hskp

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	92	0	92	33.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	18	0	18	6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	17	0	-9	8	3.0
Envelope Subtotal	17	108	-9	116	-
People	30	45	57	131	47.1
Lights	26	44	0	70	25.2
Miscellaneous Loads	24	0	0	24	8.7
Internal Subtotal	80	89	57	226	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-71	0	-22	-93	-33.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	27	196	26	249	100.0
RA Sensible (Lights)	30	0	0	30	-

Engineering Checks For Cooling

Cooling tons	0.02	No People(max)	0.28
%OA	32	People per 1000 ft²	5
cfm/ft²	0.19	Volume (ft³)	682
cfm/ton	517		
ft²/ton	2,739		
Btu/h-ft²	4.38		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-70	0	-70	35.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	9.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	10	0	10	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-62	0	0	-64	32.4
Envelope Subtotal	-62	-78	0	-142	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-1.2
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-52	0	0	-57	29.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-111	-78	0	-197	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.20	No People(max)	0.28
%OA	32	People per 1000 ft²	5
cfm/ft²	0.19	Volume (ft³)	682
cfm/Mbh	-55		
ft²/Mbh	-289		
Btu/h-ft²	-3.46		

Cooling Airflows

Main Fan cfm	11
Cooling ACH	0.97
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	11
Heating ACH	0.97
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.26
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	65
Other Roof	65
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	396
Exterior Floor	0
Internal Floor	0
Slab	65
Other Floor	0

ROOM_Intake Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	232	0	232	52.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	165	0	165	37.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	35	0	0	35	8.0
Envelope Subtotal	35	396	0	431	-
People	0	0	0	0	0.0
Lights	57	79	0	136	30.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	57	79	0	136	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-193	0	1	-192	-43.5
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	-101	474	1	375	100.0
RA Sensible (Lights)	66	0	0	66	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.00
%OA	52	People per 1000 ft²	0
cfm/ft²	0.12	Volume (ft³)	1,858
cfm/ton	576		
ft²/ton	4,955		
Btu/h-ft²	2.42		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-181	0	-181	37.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-81	0	-81	16.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-90	0	0	-93	19.3
Envelope Subtotal	-90	-235	0	-328	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-143	0	0	-154	31.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-233	-235	0	-483	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.48	No People(max)	0.00
%OA	52	People per 1000 ft²	0
cfm/ft²	0.12	Volume (ft³)	1,858
cfm/Mbh	-37		
ft²/Mbh	-321		
Btu/h-ft²	-3.12		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	0.58
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	0.58
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	169
Other Roof	169
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	689
Exterior Floor	0
Internal Floor	0
Slab	169
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 101 of 152

ROOM_Interview Room

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	87	0	87	7.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	564	0	564	48.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-59	0	-59	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	581	0	581	-
People	166	216	316	697	59.7
Lights	174	256	0	430	36.8
Miscellaneous Loads	242	152	0	395	33.8
Internal Subtotal	583	624	316	1,522	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-832	0	-313	-1,144	-98.0
Ceiling	0	13	0	13	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	-249	1,214	3	968	100.0
RA Sensible (Lights)	200	0	0	200	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.58
%OA	87	People per 1000 ft²	10
cfm/ft²	0.29	Volume (ft³)	1,894
cfm/ton	576		
ft²/ton	1,956		
Btu/h-ft²	6.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 99.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-121	0	-121	8.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-532	0	-532	37.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-6	0	-6	0.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	39	0	39	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-620	0	-620	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-618	0	0	-662	46.1
Ceiling	0	-151	0	-151	10.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.2
Grand Total	-618	-774	0	-1,436	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.44	No People(max)	1.58
%OA	87	People per 1000 ft²	10
cfm/ft²	0.29	Volume (ft³)	1,894
cfm/Mbh	-32		
ft²/Mbh	-110		
Btu/h-ft²	-9.09		

Cooling Airflows

Main Fan cfm	47
Cooling ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	40
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	47
Heating ACH	1.49
Sec Fan cfm	0
Input Ventilation cfm	40
Calculated Ventilation cfm	40
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	119
Other Roof	119
Ceiling	51
Window	0
Door	0
Wall	313
Below-Grade Wall	0
Other Wall	313
Partition	325
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 102 of 152

ROOM_IT

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	242	0	242	26.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	66	0	66	7.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	308	0	308	-
People	0	0	0	0	0.0
Lights	73	98	0	171	18.9
Miscellaneous Loads	539	0	0	539	59.5
Internal Subtotal	612	98	0	710	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-197	0	2	-195	-21.5
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	415	405	2	822	100.0
RA Sensible (Lights)	84	0	0	84	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.00
%OA	24	People per 1000 ft²	0
cfm/ft²	0.25	Volume (ft³)	1,896
cfm/ton	577		
ft²/ton	2,306		
Btu/h-ft²	5.20		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.9 °F

	Instant Sensible (Btu/h)	Time Delay Sensible (Btu/h)	Latent (Btu/h)	Total (Btu/h)	Percent of Total (%)
Roof	0	-180	0	-180	60.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-49	0	-49	16.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-13.3
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-189	0	-189	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	54	0	0	54	-18.1
Internal Subtotal	54	0	0	54	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-146	0	0	-161	54.3
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-92	-190	0	-297	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.30	No People(max)	0.00
%OA	24	People per 1000 ft²	0
cfm/ft²	0.25	Volume (ft³)	1,896
cfm/Mbh	-133		
ft²/Mbh	-532		
Btu/h-ft²	-1.88		

Cooling Airflows

Main Fan cfm	40
Cooling ACH	1.27
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	40
Heating ACH	1.27
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.28
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²

Roof	171
Other Roof	171
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	649
Exterior Floor	0
Internal Floor	0
Slab	171
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 103 of 152

ROOM_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,123	0	1,123	4.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	572	0	572	2.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-2,462	0	-2,462	-8.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-404	0	-404	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	160	0	-47	113	0.4
Envelope Subtotal	160	-1,171	-47	-1,058	-
People	1,215	1,671	2,894	5,780	20.9
Lights	225	349	0	574	2.1
Miscellaneous Loads	13,295	8,822	0	22,117	80.0
Internal Subtotal	14,736	10,841	2,894	28,471	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	-0.1
Grand Total	14,896	9,643	2,847	27,385	100.0
RA Sensible (Lights)	259	0	0	259	-

Engineering Checks For Cooling

Cooling tons	2.28	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/ton	1,095		
ft²/ton	167		
Btu/h-ft²	71.86		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-430	0	-430	35.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-380	0	-380	31.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	76	0	76	-6.3
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-434	35.8
Envelope Subtotal	-414	-778	0	-1,212	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-414	-779	0	-1,213	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	11.56
%OA	0	People per 1000 ft²	30
cfm/ft²	6.54	Volume (ft³)	4,584
cfm/Mbh	-2,061		
ft²/Mbh	-315		
Btu/h-ft²	-3.17		

Cooling Airflows

Main Fan cfm	2,500
Cooling ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,500
Heating ACH	32.72
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

	ft²
Roof	402
Other Roof	402
Ceiling	0
Window	0
Door	0
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	766
Exterior Floor	0
Internal Floor	0
Slab	402
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 104 of 152

ROOM_Laundry

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	192	0	192	36.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	0	0	0	0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-23	14	2.7
Envelope Subtotal	37	189	-23	203	-
People	64	84	122	270	51.8
Lights	56	83	0	139	26.7
Miscellaneous Loads	52	0	0	52	10.0
Internal Subtotal	172	168	122	461	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-151	0	-55	-206	-39.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	57	355	44	457	100.0
RA Sensible (Lights)	64	0	0	64	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.61
%OA	37	People per 1000 ft²	5
cfm/ft²	0.16	Volume (ft³)	1,461
cfm/ton	521		
ft²/ton	3,197		
Btu/h-ft²	3.75		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 88.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-144	0	-144	36.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-132	0	0	-136	34.4
Envelope Subtotal	-132	-143	0	-279	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	5	0	0	5	-1.3
Internal Subtotal	5	0	0	5	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-112	0	0	-122	30.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-239	-143	0	-396	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.40	No People(max)	0.61
%OA	37	People per 1000 ft²	5
cfm/ft²	0.16	Volume (ft³)	1,461
cfm/Mbh	-50		
ft²/Mbh	-307		
Btu/h-ft²	-3.26		

Cooling Airflows

Main Fan cfm	20
Cooling ACH	0.82
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	20
Heating ACH	0.82
Sec Fan cfm	0
Input Ventilation cfm	7
Calculated Ventilation cfm	7
Calculated Ventilation ACH	0.29
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	133
Other Roof	133
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	557
Exterior Floor	0
Internal Floor	0
Slab	133
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 105 of 152

ROOM_Long Term Belongings Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	160	0	160	33.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	36	0	36	7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	30	0	-16	14	3.0
Envelope Subtotal	30	194	-16	208	-
People	53	71	101	225	46.8
Lights	46	70	0	117	24.3
Miscellaneous Loads	43	0	0	43	8.9
Internal Subtotal	142	142	101	385	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-125	0	-39	-164	-34.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	47	334	46	427	100.0
RA Sensible (Lights)	53	0	0	53	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.50
%OA	33	People per 1000 ft²	5
cfm/ft²	0.18	Volume (ft³)	1,208
cfm/ton	516		
ft²/ton	2,829		
Btu/h-ft²	4.24		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-120	0	-120	35.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-24	0	-24	7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-113	33.5
Envelope Subtotal	-109	-127	0	-240	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-93	0	0	-101	30.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-197	-127	0	-337	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.34	No People(max)	0.50
%OA	33	People per 1000 ft²	5
cfm/ft²	0.18	Volume (ft³)	1,208
cfm/Mbh	-55		
ft²/Mbh	-299		
Btu/h-ft²	-3.34		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	0.89
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.30
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	0.89
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.30
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	111
Other Roof	111
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	516
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 106 of 152

ROOM_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 32.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-62	0	-62	-3.0
Other Roof	0	0	0	0	0.0
Glass	387	482	0	870	41.9
Door	0	794	0	794	38.3
Wall	0	516	0	516	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-398	0	-398	-19.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-53	0	-53	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-57	18	0.9
Envelope Subtotal	462	1,280	-57	1,685	-
People	396	540	791	1,726	83.2
Lights	137	197	0	334	16.1
Miscellaneous Loads	202	126	0	328	15.8
Internal Subtotal	735	863	791	2,388	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,344	0	-755	-2,098	-101.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-56	0	-56	-2.7
Grand Total	-147	2,086	-20	1,919	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	3.95
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,373
cfm/ton	586		
ft²/ton	1,238		
Btu/h-ft²	9.69		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 92.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-222	0	-222	9.8
Other Roof	0	0	0	0	0.0
Glass	-193	0	0	-193	8.5
Door	0	-399	0	-399	17.7
Wall	0	-318	0	-318	14.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	135	0	135	-6.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	48	0	48	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	-214	0	0	-221	9.8
Envelope Subtotal	-407	-756	0	-1,169	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,002	0	0	-1,078	47.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.7
Grand Total	-1,408	-771	0	-2,262	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.26	No People(max)	3.95
%OA	70	People per 1000 ft²	20
cfm/ft²	0.47	Volume (ft³)	2,373
cfm/Mbh	-41		
ft²/Mbh	-87		
Btu/h-ft²	-11.49		

Cooling Airflows

Main Fan cfm	94
Cooling ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.64
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	94
Heating ACH	2.38
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.64
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	212
Other Roof	212
Ceiling	0
Window	16
Door	21
Wall	218
Below-Grade Wall	0
Other Wall	218
Partition	499
Exterior Floor	0
Internal Floor	0
Slab	212
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 107 of 152

ROOM_Mechanical

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	248	0	248	25.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	67	0	67	6.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	75	0	75	7.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	389	0	389	-
People	0	0	0	0	0.0
Lights	71	105	0	176	17.9
Miscellaneous Loads	528	0	0	528	53.7
Internal Subtotal	599	105	0	704	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-193	0	2	-191	-19.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	407	493	2	901	100.0
RA Sensible (Lights)	82	0	0	82	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	1,856
cfm/ton	577		
ft²/ton	2,060		
Btu/h-ft²	5.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 01:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-186	0	-186	39.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-115	0	-115	24.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-88	0	-88	18.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-5.8
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-363	0	-363	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	53	0	0	53	-11.3
Internal Subtotal	53	0	0	53	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-142	0	0	-156	33.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-90	-364	0	-467	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.47	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	1,856
cfm/Mbh	-93		
ft²/Mbh	-331		
Btu/h-ft²	-3.02		

Cooling Airflows

Main Fan cfm	43
Cooling ACH	1.39
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	43
Heating ACH	1.39
Sec Fan cfm	0
Input Ventilation cfm	9
Calculated Ventilation cfm	9
Calculated Ventilation ACH	0.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	170
Other Roof	170
Ceiling	0
Window	0
Door	0
Wall	64
Below-Grade Wall	0
Other Wall	64
Partition	685
Exterior Floor	0
Internal Floor	0
Slab	170
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 108 of 152

ROOM_Meds

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	204	0	204	36.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	9	0	9	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-4	0	-4	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-24	15	2.7
Envelope Subtotal	39	209	-24	224	-
People	68	89	129	287	51.0
Lights	60	88	0	148	26.3
Miscellaneous Loads	55	0	0	55	9.8
Internal Subtotal	183	178	129	490	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-161	0	-58	-219	-39.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	61	385	47	493	100.0
RA Sensible (Lights)	68	0	0	68	-

Engineering Checks For Cooling

Cooling tons	0.04	No People(max)	0.65
%OA	36	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,553
cfm/ton	522		
ft²/ton	3,148		
Btu/h-ft²	3.81		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 88.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-153	0	-153	35.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-30	0	-30	7.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-145	33.7
Envelope Subtotal	-140	-161	0	-306	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	6	0	0	6	-1.3
Internal Subtotal	6	0	0	6	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-119	0	0	-130	30.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-254	-161	0	-430	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.43	No People(max)	0.65
%OA	36	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,553
cfm/Mbh	-50		
ft²/Mbh	-301		
Btu/h-ft²	-3.32		

Cooling Airflows

Main Fan cfm	21
Cooling ACH	0.81
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	21
Heating ACH	0.81
Sec Fan cfm	0
Input Ventilation cfm	8
Calculated Ventilation cfm	8
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	141
Other Roof	141
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	572
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 109 of 152

ROOM_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 48.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	451	0	451	17.5
Other Roof	0	0	0	0	0.0
Glass	199	96	0	296	11.5
Door	0	260	0	260	10.1
Wall	0	304	0	304	11.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-325	0	-325	-12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-51	0	-51	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	203	0	-110	93	3.6
Envelope Subtotal	403	734	-110	1,027	-
People	971	1,324	1,942	4,236	164.9
Lights	335	480	0	815	31.7
Miscellaneous Loads	497	305	0	802	31.2
Internal Subtotal	1,803	2,109	1,942	5,854	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-3,320	0	-1,475	-4,795	-186.6
Ceiling	0	138	0	138	5.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-40	0	-40	-1.6
Grand Total	-1,114	2,942	357	2,184	100.0
RA Sensible (Lights)	385	0	0	385	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	9.70
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	5,825
cfm/ton	880		
ft²/ton	2,667		
Btu/h-ft²	4.50		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 124.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-270	0	-270	5.4
Other Roof	0	0	0	0	0.0
Glass	-295	0	0	-295	5.9
Door	0	-416	0	-416	8.3
Wall	0	-471	0	-471	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	183	0	183	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	124	0	124	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-535	10.6
Envelope Subtotal	-821	-850	0	-1,680	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-2,458	0	0	-2,568	51.0
Ceiling	0	-766	0	-766	15.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-22	0	-22	0.4
Grand Total	-3,279	-1,638	0	-5,037	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-5.04	No People(max)	9.70
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	5,825
cfm/Mbh	-32		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	160
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	160
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 110 of 152

ROOM_Noisy Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	470	440	0	911	31.5
Door	0	930	0	930	32.1
Wall	0	390	0	390	13.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-428	0	-428	-14.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	51	0	51	1.8
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-50	37	1.3
Envelope Subtotal	557	1,382	-50	1,889	-
People	377	565	719	1,661	57.4
Lights	166	279	0	444	15.4
Miscellaneous Loads	184	133	0	317	11.0
Internal Subtotal	727	977	719	2,423	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-780	0	-430	-1,210	-41.8
Ceiling	0	-327	0	-327	-11.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-71	0	-71	-2.5
Grand Total	503	1,961	239	2,703	100.0
RA Sensible (Lights)	190	0	0	190	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/ton	527		
ft²/ton	798		
Btu/h-ft²	15.04		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-193	0	0	-193	11.3
Door	0	-418	0	-418	24.4
Wall	0	-238	0	-238	13.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	111	0	111	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-201	11.7
Envelope Subtotal	-388	-501	0	-895	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-579	0	0	-625	36.6
Ceiling	0	-175	0	-175	10.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.9
Grand Total	-967	-692	0	-1,711	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.71	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/Mbh	-69		
ft²/Mbh	-105		
Btu/h-ft²	-9.52		

Cooling Airflows

Main Fan cfm	119
Cooling ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	119
Heating ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²

Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 111 of 152

ROOM_Noisy Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	321	0	321	18.7
Wall	0	78	0	78	4.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-119	0	-119	-6.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-45	31	1.8
Envelope Subtotal	76	238	-45	268	-
People	380	568	723	1,671	97.4
Lights	167	281	0	447	26.1
Miscellaneous Loads	185	134	0	319	18.6
Internal Subtotal	732	982	723	2,437	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-787	0	-385	-1,172	-68.3
Ceiling	0	3	0	3	0.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.7
Grand Total	20	1,211	294	1,525	100.0
RA Sensible (Lights)	191	0	0	191	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	3.61
%OA	64	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,170
cfm/ton	466		
ft²/ton	1,423		
Btu/h-ft²	8.43		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 93.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-417	0	-417	28.0
Wall	0	-124	0	-124	8.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	53	0	53	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-202	13.6
Envelope Subtotal	-196	-448	0	-649	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-583	0	0	-628	42.2
Ceiling	0	-198	0	-198	13.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.8
Grand Total	-779	-657	0	-1,487	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.49	No People(max)	3.61
%OA	64	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,170
cfm/Mbh	-40		
ft²/Mbh	-122		
Btu/h-ft²	-8.20		

Cooling Airflows

Main Fan cfm	59
Cooling ACH	1.63
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	59
Heating ACH	1.63
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 112 of 152

ROOM_Noisy Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	81	36	0	118	6.4
Door	0	310	0	310	16.9
Wall	0	144	0	144	7.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-250	0	-250	-13.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-44	66	3.6
Envelope Subtotal	191	198	-44	345	-
People	382	559	729	1,670	91.2
Lights	168	276	0	444	24.2
Miscellaneous Loads	186	132	0	318	17.4
Internal Subtotal	737	967	729	2,432	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-793	0	-379	-1,172	-64.0
Ceiling	0	50	0	50	2.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.9
Grand Total	134	1,198	306	1,638	100.0
RA Sensible (Lights)	193	0	0	193	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-91	0	0	-91	5.3
Door	0	-385	0	-385	22.3
Wall	0	-220	0	-220	12.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	122	0	122	-7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-203	11.8
Envelope Subtotal	-289	-438	0	-733	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-587	0	0	-634	36.8
Ceiling	0	-344	0	-344	20.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.7
Grand Total	-876	-795	0	-1,723	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	64
Cooling ACH	1.76
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	64
Heating ACH	1.76
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	3.64
%OA	60	People per 1000 ft²	20
cfm/ft²	0.35	Volume (ft³)	2,186
cfm/ton	470		
ft²/ton	1,334		
Btu/h-ft²	9.00		

Engineering Checks For Heating

Heating Mbh	-1.72	No People(max)	3.64
%OA	60	People per 1000 ft²	20
cfm/ft²	0.35	Volume (ft³)	2,186
cfm/Mbh	-37		
ft²/Mbh	-106		
Btu/h-ft²	-9.43		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 113 of 152

ROOM_Office 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 37.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-16	0	-16	-1.6
Other Roof	0	0	0	0	0.0
Glass	196	261	0	458	47.2
Door	0	0	0	0	0.0
Wall	0	293	0	293	30.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-35	0	-35	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-35	0	-35	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	36	0	-38	-2	-0.2
Envelope Subtotal	232	468	-38	663	-
People	99	137	188	424	43.7
Lights	61	94	0	155	16.0
Miscellaneous Loads	48	0	0	48	5.0
Internal Subtotal	208	231	188	628	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-213	0	-166	-380	-39.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-10	0	-10	-1.0
Grand Total	226	690	-15	901	100.0
RA Sensible (Lights)	70	0	0	70	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	0.94
%OA	23	People per 1000 ft²	10
cfm/ft²	0.47	Volume (ft³)	1,130
cfm/ton	588		
ft²/ton	1,255		
Btu/h-ft²	9.56		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-110	0	-110	17.4
Other Roof	0	0	0	0	0.0
Glass	-96	0	0	-96	15.1
Door	0	0	0	0	0.0
Wall	0	-177	0	-177	27.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-4	0	-4	0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-102	0	0	-106	16.7
Envelope Subtotal	-198	-271	0	-473	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-2.5
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-159	0	0	-175	27.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.4
Grand Total	-341	-273	0	-634	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.63	No People(max)	0.94
%OA	23	People per 1000 ft²	10
cfm/ft²	0.47	Volume (ft³)	1,130
cfm/Mbh	-70		
ft²/Mbh	-148		
Btu/h-ft²	-6.76		

Cooling Airflows

Main Fan cfm	44
Cooling ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	44
Heating ACH	2.34
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	104
Other Roof	104
Ceiling	0
Window	8
Door	0
Wall	107
Below-Grade Wall	0
Other Wall	107
Partition	388
Exterior Floor	0
Internal Floor	0
Slab	104
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 114 of 152

ROOM_Office 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 36.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-41	0	-41	-4.6
Other Roof	0	0	0	0	0.0
Glass	213	259	0	473	53.3
Door	0	0	0	0	0.0
Wall	0	261	0	261	29.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-95	0	-95	-10.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.9
Other Floor	0	0	0	0	0.0
Infiltration	33	0	-37	-5	-0.5
Envelope Subtotal	246	367	-37	576	-
People	100	137	190	427	48.1
Lights	61	95	0	156	17.6
Miscellaneous Loads	49	0	0	49	5.5
Internal Subtotal	210	232	190	632	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-216	0	-164	-380	-42.8
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-1.2
Grand Total	241	588	-11	817	100.0
RA Sensible (Lights)	70	0	0	70	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	0.95
%OA	26	People per 1000 ft²	10
cfm/ft²	0.42	Volume (ft³)	1,142
cfm/ton	586		
ft²/ton	1,397		
Btu/h-ft²	8.59		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 84.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-111	0	-111	18.4
Other Roof	0	0	0	0	0.0
Glass	-94	0	0	-94	15.5
Door	0	0	0	0	0.0
Wall	0	-177	0	-177	29.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-103	0	0	-107	17.6
Envelope Subtotal	-197	-243	0	-444	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	16	0	0	16	-2.7
Internal Subtotal	16	0	0	16	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-161	0	0	-177	29.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.4
Grand Total	-342	-245	0	-607	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.61	No People(max)	0.95
%OA	26	People per 1000 ft²	10
cfm/ft²	0.42	Volume (ft³)	1,142
cfm/Mbh	-66		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	40
Cooling ACH	2.10
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	40
Heating ACH	2.10
Sec Fan cfm	0
Input Ventilation cfm	10
Calculated Ventilation cfm	10
Calculated Ventilation ACH	0.53
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	105
Other Roof	105
Ceiling	0
Window	8
Door	0
Wall	108
Below-Grade Wall	0
Other Wall	108
Partition	389
Exterior Floor	0
Internal Floor	0
Slab	105
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 115 of 152

ROOM_Quiet Activity 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-40	0	-40	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-45	32	3.3
Envelope Subtotal	77	-68	-45	-36	-
People	274	418	521	1,213	127.7
Lights	120	207	0	327	34.4
Miscellaneous Loads	133	98	0	232	24.4
Internal Subtotal	527	723	521	1,772	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-566	0	-389	-955	-100.5
Ceiling	0	35	0	35	3.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.4
Grand Total	38	686	87	812	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	2.60
%OA	78	People per 1000 ft²	20
cfm/ft²	0.27	Volume (ft³)	1,564
cfm/ton	516		
ft²/ton	1,927		
Btu/h-ft²	6.23		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 91.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-55	0	-55	6.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-145	18.3
Envelope Subtotal	-141	-31	0	-176	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-420	0	0	-450	56.6
Ceiling	0	-167	0	-167	21.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-561	-199	0	-794	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.79	No People(max)	2.60
%OA	78	People per 1000 ft²	20
cfm/ft²	0.27	Volume (ft³)	1,564
cfm/Mbh	-44		
ft²/Mbh	-164		
Btu/h-ft²	-6.10		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	1.34
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	1.34
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²

Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 116 of 152

ROOM_Quiet Activity 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	168	134	0	302	23.5
Door	0	0	0	0	0.0
Wall	0	107	0	107	8.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-44	33	2.6
Envelope Subtotal	245	139	-44	340	-
People	274	436	523	1,233	96.0
Lights	120	215	0	336	26.1
Miscellaneous Loads	134	103	0	236	18.4
Internal Subtotal	528	754	523	1,805	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-567	0	-377	-944	-73.5
Ceiling	0	-41	0	-41	-3.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-1.0
Grand Total	206	838	102	1,146	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.61
%OA	55	People per 1000 ft²	20
cfm/ft²	0.38	Volume (ft³)	1,568
cfm/ton	526		
ft²/ton	1,368		
Btu/h-ft²	8.77		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-95	0	0	-95	10.1
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	7.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-42	0	-42	4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-146	15.4
Envelope Subtotal	-237	-87	0	-329	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-421	0	0	-456	48.1
Ceiling	0	-160	0	-160	16.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-658	-250	0	-947	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	2.61
%OA	55	People per 1000 ft²	20
cfm/ft²	0.38	Volume (ft³)	1,568
cfm/Mbh	-53		
ft²/Mbh	-138		
Btu/h-ft²	-7.25		

Cooling Airflows

Main Fan cfm	50
Cooling ACH	1.91
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	50
Heating ACH	1.91
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 117 of 152

ROOM_Quiet Activity 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 48.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	403	0	403	29.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-97	0	-97	-7.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-32	0	-32	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-32	8	0.6
Envelope Subtotal	40	275	-32	283	-
People	275	436	524	1,236	90.2
Lights	121	215	0	336	24.6
Miscellaneous Loads	134	103	0	237	17.3
Internal Subtotal	530	754	524	1,809	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-571	0	-269	-840	-61.3
Ceiling	0	-16	0	-16	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.4
Grand Total	-1	1,008	224	1,231	100.0
RA Sensible (Lights)	139	0	0	139	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.62
%OA	57	People per 1000 ft²	20
cfm/ft²	0.37	Volume (ft³)	1,573
cfm/ton	472		
ft²/ton	1,279		
Btu/h-ft²	9.38		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 88.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-225	0	-225	23.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-11	0	-11	1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-147	15.1
Envelope Subtotal	-142	-209	0	-356	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-423	0	0	-457	47.2
Ceiling	0	-154	0	-154	16.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-565	-365	0	-968	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.97	No People(max)	2.62
%OA	57	People per 1000 ft²	20
cfm/ft²	0.37	Volume (ft³)	1,573
cfm/Mbh	-50		
ft²/Mbh	-135		
Btu/h-ft²	-7.41		

Cooling Airflows

Main Fan cfm	48
Cooling ACH	1.83
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	48
Heating ACH	1.83
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 118 of 152

ROOM_Resident Room 01

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 10:00:00
 Outside DB / WB / HR 86.6 °F / 61.1 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	263	0	508	27.7
Door	0	0	0	0	0.0
Wall	0	143	0	143	7.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-124	0	-124	-6.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-15	0	-15	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	37	0	-35	2	0.1
Envelope Subtotal	282	266	-35	513	-
People	143	149	341	633	34.5
Lights	137	210	0	347	18.9
Miscellaneous Loads	338	334	0	672	36.6
Internal Subtotal	618	693	341	1,651	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-282	0	-157	-439	-23.9
Ceiling	0	-34	0	-34	-1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.9
Grand Total	618	909	149	1,676	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	1.24
%OA	19	People per 1000 ft²	10
cfm/ft²	0.59	Volume (ft³)	1,486
cfm/ton	526		
ft²/ton	887		
Btu/h-ft²	13.53		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-123	0	0	-123	16.8
Door	0	0	0	0	0.0
Wall	0	-123	0	-123	16.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	5	0	5	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-140	19.0
Envelope Subtotal	-257	-93	0	-356	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-209	0	0	-232	31.5
Ceiling	0	-145	0	-145	19.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-467	-241	0	-736	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.74	No People(max)	1.24
%OA	19	People per 1000 ft²	10
cfm/ft²	0.59	Volume (ft³)	1,486
cfm/Mbh	-100		
ft²/Mbh	-168		
Btu/h-ft²	-5.95		

Cooling Airflows

Main Fan cfm	73
Cooling ACH	2.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.57
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	73
Heating ACH	2.95
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.57
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	80
Below-Grade Wall	0
Other Wall	80
Partition	482
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 119 of 152

ROOM_Resident Room 02

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	273	0	518	27.4
Door	0	0	0	0	0.0
Wall	0	240	0	240	12.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-81	0	-81	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	35	0	-21	13	0.7
Envelope Subtotal	280	409	-21	668	-
People	129	138	307	574	30.4
Lights	123	193	0	316	16.7
Miscellaneous Loads	305	307	0	611	32.4
Internal Subtotal	557	637	307	1,501	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-255	0	-97	-351	-18.6
Ceiling	0	-54	0	-54	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-16	0	-16	-0.9
Grand Total	582	976	189	1,747	100.0
RA Sensible (Lights)	142	0	0	142	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	1.12
%OA	16	People per 1000 ft²	10
cfm/ft²	0.67	Volume (ft³)	1,340
cfm/ton	515		
ft²/ton	767		
Btu/h-ft²	15.65		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	16.7
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	24.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	5	0	5	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-121	0	0	-126	17.0
Envelope Subtotal	-245	-153	0	-403	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-189	0	0	-209	28.2
Ceiling	0	-127	0	-127	17.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-434	-282	0	-742	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.74	No People(max)	1.12
%OA	16	People per 1000 ft²	10
cfm/ft²	0.67	Volume (ft³)	1,340
cfm/Mbh	-101		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	75
Cooling ACH	3.36
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	75
Heating ACH	3.36
Sec Fan cfm	0
Input Ventilation cfm	12
Calculated Ventilation cfm	12
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	123
Window	10
Door	0
Wall	112
Below-Grade Wall	0
Other Wall	112
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	123
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 120 of 152

ROOM_Resident Room 03

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 47.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	245	264	0	509	23.2
Door	0	0	0	0	0.0
Wall	0	300	0	300	13.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-80	0	-80	-3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	42	0	-26	16	0.7
Envelope Subtotal	287	468	-26	729	-
People	157	161	375	694	31.6
Lights	151	227	0	378	17.2
Miscellaneous Loads	372	362	0	734	33.4
Internal Subtotal	680	750	375	1,806	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-311	0	-120	-431	-19.6
Ceiling	0	-61	0	-61	-2.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.8
Grand Total	656	1,140	228	2,025	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.36
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,636
cfm/ton	512		
ft²/ton	808		
Btu/h-ft²	14.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-126	0	0	-126	14.0
Door	0	0	0	0	0.0
Wall	0	-224	0	-224	25.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-148	0	0	-154	17.1
Envelope Subtotal	-273	-210	0	-490	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-230	0	0	-255	28.4
Ceiling	0	-150	0	-150	16.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-504	-363	0	-898	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.90	No People(max)	1.36
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	1,636
cfm/Mbh	-96		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	86
Cooling ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	86
Heating ACH	3.15
Sec Fan cfm	0
Input Ventilation cfm	15
Calculated Ventilation cfm	15
Calculated Ventilation ACH	0.55
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	148
Window	10
Door	0
Wall	136
Below-Grade Wall	0
Other Wall	136
Partition	450
Exterior Floor	0
Internal Floor	0
Slab	148
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 121 of 152

ROOM_Resident Room 04

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	101	100	0	201	9.5
Door	0	0	0	0	0.0
Wall	0	627	0	627	29.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-89	0	-89	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-69	0	-69	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-41	35	1.6
Envelope Subtotal	177	570	-41	705	-
People	149	190	355	694	32.9
Lights	143	246	0	389	18.4
Miscellaneous Loads	352	392	0	744	35.3
Internal Subtotal	644	829	355	1,828	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-293	0	-187	-480	-22.8
Ceiling	0	-95	0	-95	-4.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-0.6
Grand Total	528	1,291	127	1,946	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.68	Volume (ft³)	1,549
cfm/ton	540		
ft²/ton	796		
Btu/h-ft²	15.08		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-125	0	0	-125	11.8
Door	0	0	0	0	0.0
Wall	0	-490	0	-490	46.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-146	13.8
Envelope Subtotal	-264	-413	0	-684	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-218	0	0	-242	22.9
Ceiling	0	-127	0	-127	12.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-482	-544	0	-1,056	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.06	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.68	Volume (ft³)	1,549
cfm/Mbh	-83		
ft²/Mbh	-122		
Btu/h-ft²	-8.20		

Cooling Airflows

Main Fan cfm	88
Cooling ACH	3.41
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	88
Heating ACH	3.41
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 122 of 152

ROOM_Resident Room 05

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	281	289	0	570	22.6
Door	0	0	0	0	0.0
Wall	0	725	0	725	28.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-151	0	-151	-6.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	6	0	6	0.2
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-42	22	0.9
Envelope Subtotal	344	870	-42	1,172	-
People	152	213	361	726	28.8
Lights	145	256	0	401	15.9
Miscellaneous Loads	358	407	0	766	30.4
Internal Subtotal	655	877	361	1,893	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-298	0	-187	-486	-19.3
Ceiling	0	-206	0	-206	-8.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.8
Grand Total	701	1,521	132	2,353	100.0
RA Sensible (Lights)	167	0	0	167	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.31
%OA	14	People per 1000 ft²	10
cfm/ft²	0.81	Volume (ft³)	1,575
cfm/ton	545		
ft²/ton	669		
Btu/h-ft²	17.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-128	0	0	-128	11.9
Door	0	0	0	0	0.0
Wall	0	-492	0	-492	46.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	47	0	47	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	13.9
Envelope Subtotal	-270	-414	0	-690	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-222	0	0	-247	23.1
Ceiling	0	-130	0	-130	12.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-491	-547	0	-1,070	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.07	No People(max)	1.31
%OA	14	People per 1000 ft²	10
cfm/ft²	0.81	Volume (ft³)	1,575
cfm/Mbh	-100		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Cooling Airflows

Main Fan cfm	107
Cooling ACH	4.08
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	4.08
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 123 of 152

ROOM_Resident Room 06

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	274	319	0	593	26.8
Door	0	0	0	0	0.0
Wall	0	359	0	359	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-195	0	-195	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-15	0	-15	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-23	29	1.3
Envelope Subtotal	325	468	-23	771	-
People	143	211	341	695	31.4
Lights	137	245	0	382	17.3
Miscellaneous Loads	338	390	0	729	32.9
Internal Subtotal	619	846	341	1,806	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-283	0	-103	-386	-17.4
Ceiling	0	-114	0	-114	-5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.9
Grand Total	661	1,180	215	2,057	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.71	Volume (ft³)	1,488
cfm/ton	517		
ft²/ton	724		
Btu/h-ft²	16.57		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	15.6
Door	0	0	0	0	0.0
Wall	0	-199	0	-199	24.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-140	17.0
Envelope Subtotal	-263	-182	0	-451	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-209	0	0	-233	28.2
Ceiling	0	-138	0	-138	16.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-473	-323	0	-825	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.83	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.71	Volume (ft³)	1,488
cfm/Mbh	-107		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	89
Cooling ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 124 of 152

ROOM_Resident Room 08

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	465	554	0	1,018	44.3
Door	0	0	0	0	0.0
Wall	0	310	0	310	13.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-124	0	-124	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-65	0	-65	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-58	-10	-0.4
Envelope Subtotal	513	675	-58	1,130	-
People	146	189	347	682	29.7
Lights	140	243	0	383	16.7
Miscellaneous Loads	345	388	0	733	31.9
Internal Subtotal	630	820	347	1,798	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-286	0	-257	-543	-23.6
Ceiling	0	-218	0	-218	-9.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	-1.3
Grand Total	857	1,247	33	2,137	100.0
RA Sensible (Lights)	160	0	0	160	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.26
%OA	14	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	1,515
cfm/ton	569		
ft²/ton	709		
Btu/h-ft²	16.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-210	0	0	-210	23.0
Door	0	0	0	0	0.0
Wall	0	-191	0	-191	20.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-15	0	-15	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-143	15.7
Envelope Subtotal	-347	-177	0	-530	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-213	0	0	-237	26.0
Ceiling	0	-141	0	-141	15.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-560	-323	0	-913	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.91	No People(max)	1.26
%OA	14	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	1,515
cfm/Mbh	-111		
ft²/Mbh	-138		
Btu/h-ft²	-7.25		

Cooling Airflows

Main Fan cfm	101
Cooling ACH	4.00
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	101
Heating ACH	4.00
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	18
Door	0
Wall	125
Below-Grade Wall	0
Other Wall	125
Partition	443
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 125 of 152

ROOM_Resident Room 09

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	389	359	0	748	30.1
Door	0	0	0	0	0.0
Wall	0	577	0	577	23.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-108	0	-108	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-87	0	-87	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	75	0	-40	35	1.4
Envelope Subtotal	464	741	-40	1,165	-
People	148	197	352	697	28.1
Lights	141	252	0	393	15.8
Miscellaneous Loads	349	401	0	750	30.2
Internal Subtotal	638	850	352	1,840	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-291	0	-182	-473	-19.0
Ceiling	0	-186	0	-186	-7.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	-1.0
Grand Total	812	1,379	129	2,320	100.0
RA Sensible (Lights)	162	0	0	162	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.28
%OA	13	People per 1000 ft²	10
cfm/ft²	0.82	Volume (ft³)	1,534
cfm/ton	545		
ft²/ton	662		
Btu/h-ft²	18.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-208	0	0	-208	18.6
Door	0	0	0	0	0.0
Wall	0	-469	0	-469	42.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-138	0	0	-145	13.0
Envelope Subtotal	-346	-392	0	-744	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-216	0	0	-240	21.5
Ceiling	0	-128	0	-128	11.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.4
Grand Total	-562	-524	0	-1,117	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.12	No People(max)	1.28
%OA	13	People per 1000 ft²	10
cfm/ft²	0.82	Volume (ft³)	1,534
cfm/Mbh	-94		
ft²/Mbh	-114		
Btu/h-ft²	-8.77		

Cooling Airflows

Main Fan cfm	105
Cooling ACH	4.11
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	105
Heating ACH	4.11
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	140
Window	18
Door	0
Wall	285
Below-Grade Wall	0
Other Wall	285
Partition	285
Exterior Floor	0
Internal Floor	0
Slab	140
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 126 of 152

ROOM_Resident Room 10

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	195	101	0	295	13.1
Door	0	0	0	0	0.0
Wall	0	611	0	611	27.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-141	0	-141	-6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-24	30	1.3
Envelope Subtotal	249	547	-24	772	-
People	150	214	357	721	32.0
Lights	143	248	0	392	17.4
Miscellaneous Loads	354	396	0	750	33.2
Internal Subtotal	648	858	357	1,863	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-296	0	-109	-405	-18.0
Ceiling	0	-119	0	-119	-5.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.9
Grand Total	601	1,267	223	2,091	100.0
RA Sensible (Lights)	165	0	0	165	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-212	0	0	-212	19.1
Door	0	0	0	0	0.0
Wall	0	-470	0	-470	42.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	60	0	60	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-147	13.2
Envelope Subtotal	-352	-378	0	-736	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-219	0	0	-243	21.9
Ceiling	0	-127	0	-127	11.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.4
Grand Total	-571	-510	0	-1,111	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	90
Cooling ACH	3.47
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	90
Heating ACH	3.47
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.30
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,557
cfm/ton	516		
ft²/ton	745		
Btu/h-ft²	16.11		

Engineering Checks For Heating

Heating Mbh	-1.11	No People(max)	1.30
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,557
cfm/Mbh	-81		
ft²/Mbh	-117		
Btu/h-ft²	-8.55		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 127 of 152

ROOM_Resident Room 11

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	317	0	590	25.8
Door	0	0	0	0	0.0
Wall	0	370	0	370	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-196	0	-196	-8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-18	0	-18	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-24	30	1.3
Envelope Subtotal	327	474	-24	777	-
People	149	220	355	724	31.7
Lights	143	256	0	399	17.4
Miscellaneous Loads	352	407	0	760	33.2
Internal Subtotal	644	883	355	1,883	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-294	0	-107	-402	-17.6
Ceiling	0	-115	0	-115	-5.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.9
Grand Total	677	1,222	224	2,122	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.71	Volume (ft³)	1,549
cfm/ton	516		
ft²/ton	730		
Btu/h-ft²	16.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	15.4
Door	0	0	0	0	0.0
Wall	0	-205	0	-205	24.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	7	0	7	-0.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-146	17.4
Envelope Subtotal	-268	-170	0	-445	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-218	0	0	-242	29.0
Ceiling	0	-147	0	-147	17.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-486	-320	0	-837	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.84	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.71	Volume (ft³)	1,549
cfm/Mbh	-109		
ft²/Mbh	-154		
Btu/h-ft²	-6.49		

Cooling Airflows

Main Fan cfm	91
Cooling ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	91
Heating ACH	3.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	126
Below-Grade Wall	0
Other Wall	126
Partition	447
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 128 of 152

ROOM_Resident Room 12

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	319	0	592	25.6
Door	0	0	0	0	0.0
Wall	0	363	0	363	15.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-147	0	-147	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-20	33	1.4
Envelope Subtotal	326	518	-20	824	-
People	146	216	348	711	30.7
Lights	140	251	0	391	16.9
Miscellaneous Loads	346	400	0	746	32.2
Internal Subtotal	632	867	348	1,848	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-289	0	-89	-378	-16.3
Ceiling	0	-121	0	-121	-5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	669	1,244	239	2,153	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.27
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,520
cfm/ton	513		
ft²/ton	706		
Btu/h-ft²	17.00		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	15.5
Door	0	0	0	0	0.0
Wall	0	-201	0	-201	24.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1	0	-1	0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-143	17.2
Envelope Subtotal	-266	-175	0	-447	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-214	0	0	-238	28.6
Ceiling	0	-143	0	-143	17.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-480	-322	0	-832	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.83	No People(max)	1.27
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,520
cfm/Mbh	-111		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	92
Cooling ACH	3.63
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	92
Heating ACH	3.63
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 129 of 152

ROOM_Resident Room 13

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	320	0	593	25.5
Door	0	0	0	0	0.0
Wall	0	363	0	363	15.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-134	0	-134	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	53	0	-20	33	1.4
Envelope Subtotal	326	532	-20	839	-
People	146	216	348	711	30.6
Lights	140	251	0	391	16.8
Miscellaneous Loads	346	399	0	745	32.0
Internal Subtotal	632	866	348	1,846	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-289	0	-89	-378	-16.3
Ceiling	0	-123	0	-123	-5.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	670	1,255	239	2,164	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	1.27
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,521
cfm/ton	514		
ft²/ton	703		
Btu/h-ft²	17.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	15.2
Door	0	0	0	0	0.0
Wall	0	-202	0	-202	23.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-143	16.9
Envelope Subtotal	-266	-194	0	-466	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-214	0	0	-238	28.0
Ceiling	0	-142	0	-142	16.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-480	-339	0	-849	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.85	No People(max)	1.27
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,521
cfm/Mbh	-109		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	93
Cooling ACH	3.67
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	93
Heating ACH	3.67
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	138
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

ROOM_Resident Room 14

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	314	0	587	23.5
Door	0	0	0	0	0.0
Wall	0	539	0	539	21.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-142	0	-142	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-20	34	1.4
Envelope Subtotal	327	699	-20	1,005	-
People	151	219	359	728	29.1
Lights	144	254	0	398	15.9
Miscellaneous Loads	356	405	0	761	30.4
Internal Subtotal	651	877	359	1,887	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-297	0	-90	-388	-15.5
Ceiling	0	-150	0	-150	-6.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	680	1,406	248	2,335	100.0
RA Sensible (Lights)	166	0	0	166	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.77	Volume (ft³)	1,565
cfm/ton	516		
ft²/ton	670		
Btu/h-ft²	17.91		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-128	0	0	-128	12.0
Door	0	0	0	0	0.0
Wall	0	-486	0	-486	45.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	13.9
Envelope Subtotal	-269	-411	0	-686	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-220	0	0	-245	23.0
Ceiling	0	-131	0	-131	12.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-489	-545	0	-1,065	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.06	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.77	Volume (ft³)	1,565
cfm/Mbh	-94		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Cooling Airflows

Main Fan cfm	100
Cooling ACH	3.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	100
Heating ACH	3.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 131 of 152

ROOM_Resident Room 15

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	246	276	0	522	24.1
Door	0	0	0	0	0.0
Wall	0	337	0	337	15.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-84	0	-84	-3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-20	0	-20	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-25	15	0.7
Envelope Subtotal	286	509	-25	770	-
People	151	153	358	662	30.6
Lights	144	215	0	359	16.6
Miscellaneous Loads	356	342	0	698	32.2
Internal Subtotal	651	710	358	1,719	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-297	0	-114	-411	-19.0
Ceiling	0	-60	0	-60	-2.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.8
Grand Total	639	1,142	220	2,001	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.30
%OA	17	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	1,564
cfm/ton	514		
ft²/ton	782		
Btu/h-ft²	15.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.1
Other Roof	0	0	0	0	0.0
Glass	-125	0	0	-125	11.7
Door	0	0	0	0	0.0
Wall	0	-489	0	-489	45.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	46	0	46	-4.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-147	13.7
Envelope Subtotal	-266	-413	0	-685	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-220	0	0	-244	22.8
Ceiling	0	-140	0	-140	13.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-486	-556	0	-1,073	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.07	No People(max)	1.30
%OA	17	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	1,564
cfm/Mbh	-80		
ft²/Mbh	-122		
Btu/h-ft²	-8.20		

Cooling Airflows

Main Fan cfm	86
Cooling ACH	3.30
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	86
Heating ACH	3.30
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	1
Other Roof	1
Ceiling	141
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 132 of 152

ROOM_Resident Room 16

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	246	280	0	526	25.6
Door	0	0	0	0	0.0
Wall	0	285	0	285	13.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-129	0	-129	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	39	0	-24	15	0.7
Envelope Subtotal	286	412	-24	673	-
People	146	152	348	646	31.5
Lights	140	212	0	352	17.2
Miscellaneous Loads	346	338	0	684	33.3
Internal Subtotal	632	702	348	1,682	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-289	0	-111	-400	-19.5
Ceiling	0	-45	0	-45	-2.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.8
Grand Total	629	1,051	213	1,893	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.27
%OA	17	People per 1000 ft²	10
cfm/ft²	0.64	Volume (ft³)	1,520
cfm/ton	512		
ft²/ton	803		
Btu/h-ft²	14.94		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.2
Other Roof	0	0	0	0	0.0
Glass	-126	0	0	-126	14.9
Door	0	0	0	0	0.0
Wall	0	-204	0	-204	24.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-137	0	0	-143	16.9
Envelope Subtotal	-263	-188	0	-457	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-214	0	0	-237	27.9
Ceiling	0	-152	0	-152	17.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-477	-342	0	-849	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.85	No People(max)	1.27
%OA	17	People per 1000 ft²	10
cfm/ft²	0.64	Volume (ft³)	1,520
cfm/Mbh	-95		
ft²/Mbh	-149		
Btu/h-ft²	-6.71		

Cooling Airflows

Main Fan cfm	81
Cooling ACH	3.20
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	81
Heating ACH	3.20
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.55
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	1
Other Roof	1
Ceiling	137
Window	10
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	445
Exterior Floor	0
Internal Floor	0
Slab	138
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 133 of 152

ROOM_Sally Port

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 28.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-61	0	-61	-5.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,040	0	1,040	91.0
Wall	0	185	0	185	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-273	0	-273	-23.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	880	0	880	-
People	82	117	156	354	31.0
Lights	86	138	0	224	19.6
Miscellaneous Loads	119	82	0	202	17.6
Internal Subtotal	287	337	156	780	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-408	0	-165	-573	-50.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-43	0	-43	-3.8
Grand Total	-121	1,175	-9	1,044	100.0
RA Sensible (Lights)	99	0	0	99	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	0.78
%OA	39	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	933
cfm/ton	585		
ft²/ton	893		
Btu/h-ft²	13.44		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 19:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-90	0	-90	9.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-492	0	-492	52.5
Wall	0	-127	0	-127	13.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	98	0	98	-10.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-592	0	-592	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-304	0	0	-333	35.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	1.3
Grand Total	-304	-604	0	-938	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.94	No People(max)	0.78
%OA	39	People per 1000 ft²	10
cfm/ft²	0.66	Volume (ft³)	933
cfm/Mbh	-54		
ft²/Mbh	-83		
Btu/h-ft²	-12.05		

Cooling Airflows

Main Fan cfm	51
Cooling ACH	3.28
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	20
Calculated Ventilation ACH	1.29
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	51
Heating ACH	3.28
Sec Fan cfm	0
Input Ventilation cfm	20
Calculated Ventilation cfm	20
Calculated Ventilation ACH	1.29
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	87
Other Roof	87
Ceiling	0
Window	0
Door	26
Wall	99
Below-Grade Wall	0
Other Wall	99
Partition	351
Exterior Floor	0
Internal Floor	0
Slab	87
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 134 of 152

ROOM_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 48.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	190	0	190	16.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	187	0	187	16.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-59	0	-59	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-29	0	-29	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	113	0	-52	61	5.2
Envelope Subtotal	113	289	-52	350	-
People	456	661	913	2,030	173.7
Lights	158	244	0	401	34.3
Miscellaneous Loads	234	155	0	388	33.2
Internal Subtotal	848	1,059	913	2,820	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,561	0	-699	-2,260	-193.4
Ceiling	0	86	0	86	7.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.7
Grand Total	-600	1,426	162	988	100.0
RA Sensible (Lights)	181	0	0	181	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	4.56
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,738
cfm/ton	915		
ft²/ton	2,773		
Btu/h-ft²	4.33		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 3.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 123.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-128	0	-128	5.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-276	0	-276	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-12	0	-12	0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-251	11.3
Envelope Subtotal	-247	-363	0	-615	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,156	0	0	-1,206	54.4
Ceiling	0	-393	0	-393	17.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.2
Grand Total	-1,403	-760	0	-2,217	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.22	No People(max)	4.56
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,738
cfm/Mbh	-34		
ft²/Mbh	-103		
Btu/h-ft²	-9.71		

Cooling Airflows

Main Fan cfm	75
Cooling ACH	1.64
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	75
Heating ACH	1.64
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 135 of 152

ROOM_Service

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	171	0	171	3.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,254	0	1,254	28.3
Wall	0	864	0	864	19.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	877	0	877	19.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	165	0	-91	75	1.7
Envelope Subtotal	165	3,153	-91	3,228	-
People	159	219	304	682	15.4
Lights	140	216	0	356	8.0
Miscellaneous Loads	39	0	0	39	0.9
Internal Subtotal	338	435	304	1,077	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-0.7
Grand Total	503	3,557	213	4,273	100.0
RA Sensible (Lights)	161	0	0	161	-

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	1.18	Volume (ft³)	3,642
cfm/ton	1,008		
ft²/ton	853		
Btu/h-ft²	14.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-332	0	-332	14.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-952	0	-952	40.7
Wall	0	-581	0	-581	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-202	0	-202	8.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	85	0	85	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	-329	0	0	-346	14.8
Envelope Subtotal	-329	-1,982	0	-2,327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.6
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	1.0
Grand Total	-316	-2,005	0	-2,337	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.34	No People(max)	1.52
%OA	0	People per 1000 ft²	5
cfm/ft²	1.18	Volume (ft³)	3,642
cfm/Mbh	-154		
ft²/Mbh	-130		
Btu/h-ft²	-7.69		

Cooling Airflows

Main Fan cfm	359
Cooling ACH	5.91
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	359
Heating ACH	5.91
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	323
Other Roof	323
Ceiling	0
Window	0
Door	49
Wall	389
Below-Grade Wall	0
Other Wall	389
Partition	580
Exterior Floor	0
Internal Floor	0
Slab	323
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 136 of 152

ROOM_Shower 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	76	0	76	7.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	44	0	44	4.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-8	0	-8	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-24	15	1.5
Envelope Subtotal	40	158	-24	173	-
People	157	248	248	653	65.6
Lights	37	60	0	97	9.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	194	308	248	751	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	32	0	32	3.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	234	496	224	953	100.0
RA Sensible (Lights)	42	0	0	42	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	961
cfm/ton	441		
ft²/ton	1,008		
Btu/h-ft²	11.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-65	0	-65	18.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-62	0	-62	17.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-72	0	-72	20.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-87	0	0	-91	25.5
Envelope Subtotal	-87	-182	0	-273	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-84	0	-84	23.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.2
Grand Total	-87	-266	0	-357	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.36	No People(max)	1.60
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	961
cfm/Mbh	-98		
ft²/Mbh	-224		
Btu/h-ft²	-4.46		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	2.18
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	2.18
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	62
Other Roof	62
Ceiling	27
Window	0
Door	0
Wall	37
Below-Grade Wall	0
Other Wall	37
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	89
Other Floor	0

ROOM_Shower 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	123	0	123	8.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	80	0	80	5.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	273	0	273	18.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	48	0	-43	4	0.3
Envelope Subtotal	48	467	-43	471	-
People	194	304	307	804	55.7
Lights	46	74	0	120	8.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	239	378	307	924	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	287	841	263	1,392	100.0
RA Sensible (Lights)	52	0	0	52	-

Engineering Checks For Cooling

Cooling tons	0.12	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,187
cfm/ton	468		
ft²/ton	853		
Btu/h-ft²	14.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-118	0	-118	36.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-57	0	-57	17.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-55	0	-55	17.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	18	0	18	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-107	0	0	-112	34.7
Envelope Subtotal	-107	-211	0	-324	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-107	-212	0	-324	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.32	No People(max)	1.98
%OA	0	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	1,187
cfm/Mbh	-167		
ft²/Mbh	-305		
Btu/h-ft²	-3.28		

Cooling Airflows

Main Fan cfm	54
Cooling ACH	2.73
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	54
Heating ACH	2.73
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	110
Other Roof	110
Ceiling	0
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	488
Exterior Floor	0
Internal Floor	0
Slab	110
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 138 of 152

ROOM_Shower 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	337	0	337	24.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	7	0	7	0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-30	13	0.9
Envelope Subtotal	43	327	-30	340	-
People	204	351	322	877	63.1
Lights	48	86	0	134	9.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	252	437	322	1,011	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-12	0	-12	-0.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	295	748	292	1,335	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,247
cfm/ton	451		
ft²/ton	934		
Btu/h-ft²	12.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-184	0	-184	43.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	4.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-5.0
Other Floor	0	0	0	0	0.0
Infiltration	-113	0	0	-118	27.7
Envelope Subtotal	-113	-184	0	-302	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-124	0	-124	29.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-113	-308	0	-426	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.43	No People(max)	2.08
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	1,247
cfm/Mbh	-118		
ft²/Mbh	-244		
Btu/h-ft²	-4.10		

Cooling Airflows

Main Fan cfm	50
Cooling ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	50
Heating ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	115
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	115
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 139 of 152

ROOM_Shower 4

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	335	0	335	24.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	18	0	18	1.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-17	0	-17	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-30	13	0.9
Envelope Subtotal	43	335	-30	348	-
People	202	353	320	876	62.8
Lights	48	86	0	134	9.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	250	439	320	1,009	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-13	0	-13	-1.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.3
Grand Total	293	757	290	1,340	100.0
RA Sensible (Lights)	55	0	0	55	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	1,239
cfm/ton	452		
ft²/ton	924		
Btu/h-ft²	12.99		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-182	0	-182	41.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-117	26.8
Envelope Subtotal	-112	-198	0	-316	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-122	0	-122	27.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-112	-320	0	-438	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	1,239
cfm/Mbh	-115		
ft²/Mbh	-236		
Btu/h-ft²	-4.24		

Cooling Airflows

Main Fan cfm	51
Cooling ACH	2.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	51
Heating ACH	2.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	103
Below-Grade Wall	0
Other Wall	103
Partition	422
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 140 of 152

ROOM_Shower 5

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	118	0	118	9.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	95	0	95	7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-32	12	0.9
Envelope Subtotal	43	197	-32	209	-
People	203	346	321	870	67.8
Lights	48	84	0	132	10.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	251	431	321	1,003	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	19	0	19	1.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	645	289	1,228	100.0
RA Sensible (Lights)	55	0	0	55	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	40.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	10.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	26.4
Envelope Subtotal	-112	-205	0	-322	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-123	0	-123	27.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-112	-329	0	-446	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	45
Cooling ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	45
Heating ACH	2.17
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	1,243
cfm/ton	441		
ft²/ton	1,012		
Btu/h-ft²	11.86		

Engineering Checks For Heating

Heating Mbh	-0.45	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.44	Volume (ft³)	1,243
cfm/Mbh	-101		
ft²/Mbh	-232		
Btu/h-ft²	-4.31		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 141 of 152

ROOM_Shower 6

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 52.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	118	0	118	9.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	56	0	56	4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-16	0	-16	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	43	0	-32	11	0.9
Envelope Subtotal	43	157	-32	169	-
People	203	350	321	874	69.7
Lights	48	85	0	133	10.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	251	436	321	1,007	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	25	0	25	2.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	616	289	1,199	100.0
RA Sensible (Lights)	55	0	0	55	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-181	0	-181	42.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-28	0	-28	6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-112	0	0	-118	27.3
Envelope Subtotal	-112	-187	0	-305	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-125	0	-125	29.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-112	-313	0	-430	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	44
Cooling ACH	2.13
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	44
Heating ACH	2.13
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	114
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	424
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.42	Volume (ft³)	1,242
cfm/ton	438		
ft²/ton	1,037		
Btu/h-ft²	11.57		

Engineering Checks For Heating

Heating Mbh	-0.43	No People(max)	2.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.42	Volume (ft³)	1,242
cfm/Mbh	-102		
ft²/Mbh	-241		
Btu/h-ft²	-4.15		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 142 of 152

ROOM_Shower 7

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	271	0	271	20.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	20	0	20	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-30	21	1.6
Envelope Subtotal	52	281	-30	302	-
People	202	318	319	839	62.8
Lights	47	77	0	125	9.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	249	395	319	964	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	18	0	18	1.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	301	691	289	1,281	100.0
RA Sensible (Lights)	54	0	0	54	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-183	0	-183	42.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-111	0	0	-117	27.1
Envelope Subtotal	-111	-183	0	-300	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-131	0	-131	30.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-111	-315	0	-432	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	48
Cooling ACH	2.33
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	48
Heating ACH	2.33
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	1
Other Roof	1
Ceiling	113
Window	0
Door	0
Wall	102
Below-Grade Wall	0
Other Wall	102
Partition	423
Exterior Floor	0
Internal Floor	0
Slab	114
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,235
cfm/ton	447		
ft²/ton	964		
Btu/h-ft²	12.45		

Engineering Checks For Heating

Heating Mbh	-0.43	No People(max)	2.06
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,235
cfm/Mbh	-110		
ft²/Mbh	-238		
Btu/h-ft²	-4.20		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 143 of 152

ROOM_Shower 8

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	251	0	251	19.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1	0	-1	-0.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-11	0	-11	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	51	0	-30	20	1.6
Envelope Subtotal	51	239	-30	260	-
People	197	316	312	825	64.3
Lights	46	77	0	123	9.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	244	392	312	948	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	24	0	24	1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	294	653	282	1,229	100.0
RA Sensible (Lights)	53	0	0	53	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	1,208
cfm/ton	445		
ft²/ton	984		
Btu/h-ft²	12.20		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1	0	-1	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-177	0	-177	40.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	21	0	21	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-114	26.2
Envelope Subtotal	-109	-194	0	-308	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-128	0	-128	29.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-109	-322	0	-436	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.01
%OA	0	People per 1000 ft²	20
cfm/ft²	0.45	Volume (ft³)	1,208
cfm/Mbh	-104		
ft²/Mbh	-231		
Btu/h-ft²	-4.33		

Cooling Airflows

Main Fan cfm	46
Cooling ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	46
Heating ACH	2.28
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	3
Min Stop/RH (%)	0

Areas ft²

Roof	1
Other Roof	1
Ceiling	110
Window	0
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	421
Exterior Floor	0
Internal Floor	0
Slab	111
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 144 of 152

ROOM_Soiled Supply

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	154	0	154	34.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	18	0	18	4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-3	0	-3	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	29	0	-16	14	3.1
Envelope Subtotal	29	169	-16	183	-
People	51	68	97	216	48.6
Lights	45	68	0	112	25.3
Miscellaneous Loads	41	0	0	41	9.3
Internal Subtotal	137	136	97	369	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-120	0	-38	-158	-35.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.2
Grand Total	46	304	43	393	100.0
RA Sensible (Lights)	51	0	0	51	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.48
%OA	35	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,161
cfm/ton	514		
ft²/ton	2,956		
Btu/h-ft²	4.06		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-116	0	-116	36.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	16	0	16	-5.1
Other Floor	0	0	0	0	0.0
Infiltration	-105	0	0	-108	33.8
Envelope Subtotal	-105	-119	0	-227	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-1.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-89	0	0	-97	30.3
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-190	-119	0	-320	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.32	No People(max)	0.48
%OA	35	People per 1000 ft²	5
cfm/ft²	0.17	Volume (ft³)	1,161
cfm/Mbh	-53		
ft²/Mbh	-302		
Btu/h-ft²	-3.31		

Cooling Airflows

Main Fan cfm	17
Cooling ACH	0.88
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	17
Heating ACH	0.88
Sec Fan cfm	0
Input Ventilation cfm	6
Calculated Ventilation cfm	6
Calculated Ventilation ACH	0.31
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	107
Other Roof	107
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	508
Exterior Floor	0
Internal Floor	0
Slab	107
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 145 of 152

ROOM_Staff Corridor

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 31.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	848	0	848	25.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	748	0	748	22.9
Wall	0	144	0	144	4.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	1,318	0	1,318	40.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.4
Other Floor	0	0	0	0	0.0
Infiltration	262	0	-14	248	7.6
Envelope Subtotal	262	3,044	-14	3,292	-
People	0	0	0	0	0.0
Lights	329	474	0	803	24.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	329	474	0	803	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-1,108	0	-64	-1,172	-35.8
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-27	0	-27	-0.8
Grand Total	-517	3,491	-78	2,896	100.0
RA Sensible (Lights)	378	0	0	378	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	0.00
%OA	37	People per 1000 ft²	0
cfm/ft²	0.16	Volume (ft³)	10,720
cfm/ton	595		
ft²/ton	3,701		
Btu/h-ft²	3.24		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 07:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 91.6 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-1,035	0	-1,035	31.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-564	0	-564	17.2
Wall	0	-89	0	-89	2.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-307	0	-307	9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	171	0	171	-5.2
Other Floor	0	0	0	0	0.0
Infiltration	-521	0	0	-540	16.5
Envelope Subtotal	-521	-1,824	0	-2,363	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-823	0	0	-897	27.4
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	0.6
Grand Total	-1,344	-1,843	0	-3,279	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.28	No People(max)	0.00
%OA	37	People per 1000 ft²	0
cfm/ft²	0.16	Volume (ft³)	10,720
cfm/Mbh	-44		
ft²/Mbh	-272		
Btu/h-ft²	-3.68		

Cooling Airflows

Main Fan cfm	144
Cooling ACH	0.81
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	54
Calculated Ventilation ACH	0.30
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	144
Heating ACH	0.81
Sec Fan cfm	0
Input Ventilation cfm	54
Calculated Ventilation cfm	54
Calculated Ventilation ACH	0.30
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	968
Other Roof	968
Ceiling	0
Window	0
Door	28
Wall	77
Below-Grade Wall	0
Other Wall	77
Partition	3,525
Exterior Floor	0
Internal Floor	0
Slab	968
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 146 of 152

ROOM_Stor.

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 43.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	26	0	26	16.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	74	0	74	46.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-1	0	-1	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	4	0	-2	3	1.6
Envelope Subtotal	4	99	-2	102	-
People	8	19	15	41	25.9
Lights	7	19	0	26	16.1
Miscellaneous Loads	6	0	0	6	3.9
Internal Subtotal	21	38	15	73	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-18	0	-4	-22	-14.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	-0.1
Grand Total	7	137	8	153	100.0
RA Sensible (Lights)	8	0	0	8	-

Engineering Checks For Cooling

Cooling tons	0.01	No People(max)	0.07
%OA	0	People per 1000 ft²	5
cfm/ft²	0.48	Volume (ft³)	174
cfm/ton	546		
ft²/ton	1,143		
Btu/h-ft²	10.50		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 82.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-20	0	-20	21.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	48.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	3	0	3	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-16	0	0	-16	17.8
Envelope Subtotal	-16	-62	0	-78	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	1	0	0	1	-0.7
Internal Subtotal	1	0	0	1	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-13	0	0	-15	16.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-29	-62	0	-93	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.09	No People(max)	0.07
%OA	0	People per 1000 ft²	5
cfm/ft²	0.48	Volume (ft³)	174
cfm/Mbh	-75		
ft²/Mbh	-157		
Btu/h-ft²	-6.37		

Cooling Airflows

Main Fan cfm	7
Cooling ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	7
Heating ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	1
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	0
Min Stop/RH (%)	0

Areas

ft²

Roof	19
Other Roof	19
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	212
Exterior Floor	0
Internal Floor	0
Slab	19
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 147 of 152

ROOM_Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 44.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	77	0	77	19.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	32	0	32	8.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	110	0	110	28.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-2	0	-2	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	16	0	-7	9	2.2
Envelope Subtotal	16	216	-7	225	-
People	27	44	52	124	31.6
Lights	24	44	0	68	17.3
Miscellaneous Loads	22	0	0	22	5.7
Internal Subtotal	73	88	52	213	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-65	0	-17	-82	-21.0
Ceiling	0	7	0	7	1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	-0.1
Grand Total	24	311	28	363	100.0
RA Sensible (Lights)	28	0	0	28	-

Engineering Checks For Cooling

Cooling tons	0.03	No People(max)	0.26
%OA	19	People per 1000 ft²	5
cfm/ft²	0.31	Volume (ft³)	624
cfm/ton	533		
ft²/ton	1,718		
Btu/h-ft²	6.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 4.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 86.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-56	0	-56	19.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-54	0	-54	19.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-54	0	-54	18.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-56	0	0	-59	20.6
Envelope Subtotal	-56	-153	0	-212	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	2	0	0	2	-0.8
Internal Subtotal	2	0	0	2	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-48	0	0	-53	18.5
Ceiling	0	-22	0	-22	7.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-102	-176	0	-285	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.29	No People(max)	0.26
%OA	19	People per 1000 ft²	5
cfm/ft²	0.31	Volume (ft³)	624
cfm/Mbh	-57		
ft²/Mbh	-182		
Btu/h-ft²	-5.49		

Cooling Airflows

Main Fan cfm	16
Cooling ACH	1.54
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	16
Heating ACH	1.54
Sec Fan cfm	0
Input Ventilation cfm	3
Calculated Ventilation cfm	3
Calculated Ventilation ACH	0.29
Infiltration cfm	1
Min Stop/RH (%)	100

Areas

ft²	
Roof	53
Other Roof	53
Ceiling	7
Window	0
Door	0
Wall	32
Below-Grade Wall	0
Other Wall	32
Partition	369
Exterior Floor	0
Internal Floor	0
Slab	60
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 148 of 152

ROOM_Toilet 1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 51.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-19	0	-19	-2.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	290	0	290	30.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-5	0	-5	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	21	0	-19	2	0.2
Envelope Subtotal	21	266	-19	268	-
People	131	206	207	544	57.4
Lights	31	50	0	81	8.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	162	256	207	625	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	22	0	22	2.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.3
Grand Total	183	542	188	913	100.0
RA Sensible (Lights)	35	0	0	35	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	802
cfm/ton	458		
ft²/ton	879		
Btu/h-ft²	13.65		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-55	0	-55	16.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-147	0	-147	44.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	14	0	14	-4.3
Other Floor	0	0	0	0	0.0
Infiltration	-72	0	0	-76	22.7
Envelope Subtotal	-72	-188	0	-264	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	-70	0	-70	21.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-72	-258	0	-334	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.33	No People(max)	1.34
%OA	0	People per 1000 ft²	20
cfm/ft²	0.52	Volume (ft³)	802
cfm/Mbh	-104		
ft²/Mbh	-200		
Btu/h-ft²	-5.00		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	2.62
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	53
Other Roof	53
Ceiling	23
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	427
Exterior Floor	0
Internal Floor	0
Slab	76
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 149 of 152

ROOM_Toilet 2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 50.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	104	0	104	15.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-57	0	-57	-8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	26	0	-16	10	1.5
Envelope Subtotal	26	40	-16	50	-
People	121	200	192	513	76.5
Lights	28	49	0	77	11.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	150	249	192	590	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	176	286	176	638	100.0
RA Sensible (Lights)	33	0	0	33	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	742
cfm/ton	344		
ft²/ton	1,164		
Btu/h-ft²	10.31		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-76	0	-76	49.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-19	0	-19	12.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-6.8
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	45.5
Envelope Subtotal	-67	-84	0	-154	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-84	0	-154	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.15	No People(max)	1.24
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	742
cfm/Mbh	-119		
ft²/Mbh	-402		
Btu/h-ft²	-2.49		

Cooling Airflows

Main Fan cfm	18
Cooling ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	18
Heating ACH	1.45
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	408
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Toilet 3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 49.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 50.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	98	0	98	14.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-48	0	-48	-7.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-7	0	-7	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	26	0	-15	10	1.5
Envelope Subtotal	26	43	-15	53	-
People	121	202	191	514	76.1
Lights	28	49	0	78	11.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	149	251	191	591	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	-0.3
Grand Total	175	292	176	642	100.0
RA Sensible (Lights)	33	0	0	33	-

Engineering Checks For Cooling

Cooling tons	0.05	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	740
cfm/ton	348		
ft²/ton	1,152		
Btu/h-ft²	10.42		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 20:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-75	0	-75	46.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-26	0	-26	16.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	-6.6
Other Floor	0	0	0	0	0.0
Infiltration	-67	0	0	-70	43.6
Envelope Subtotal	-67	-91	0	-161	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-67	-91	0	-161	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.16	No People(max)	1.23
%OA	0	People per 1000 ft²	20
cfm/ft²	0.30	Volume (ft³)	740
cfm/Mbh	-116		
ft²/Mbh	-384		
Btu/h-ft²	-2.60		

Cooling Airflows

Main Fan cfm	19
Cooling ACH	1.54
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	19
Heating ACH	1.54
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	2
Min Stop/RH (%)	0

Areas ft²

Roof	70
Other Roof	70
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	407
Exterior Floor	0
Internal Floor	0
Slab	70
Other Floor	0

ROOM_Resident Room 07

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Room DB / RH / HR 75.0 °F / 39.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	465	525	0	990	44.7
Door	0	0	0	0	0.0
Wall	0	298	0	298	13.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-179	0	-179	-8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-46	0	-46	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	47	0	-58	-10	-0.5
Envelope Subtotal	513	598	-58	1,053	-
People	145	188	345	677	30.6
Lights	139	242	0	381	17.2
Miscellaneous Loads	342	386	0	728	32.9
Internal Subtotal	626	816	345	1,786	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-284	0	-255	-539	-24.3
Ceiling	0	-214	0	-214	-9.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-30	0	-30	-1.4
Grand Total	854	1,170	32	2,056	100.0
RA Sensible (Lights)	159	0	0	159	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.25
%OA	14	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,504
cfm/ton	569		
ft²/ton	732		
Btu/h-ft²	16.39		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 23:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Room DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-208	0	0	-208	23.7
Door	0	0	0	0	0.0
Wall	0	-188	0	-188	21.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	17	0	17	-1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	28	0	28	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-136	0	0	-142	16.2
Envelope Subtotal	-344	-144	0	-493	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Room	-212	0	0	-236	26.9
Ceiling	0	-143	0	-143	16.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-555	-291	0	-876	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	1.25
%OA	14	People per 1000 ft²	10
cfm/ft²	0.78	Volume (ft³)	1,504
cfm/Mbh	-111		
ft²/Mbh	-143		
Btu/h-ft²	-6.99		

Cooling Airflows

Main Fan cfm	98
Cooling ACH	3.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	98
Heating ACH	3.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	137
Window	18
Door	0
Wall	124
Below-Grade Wall	0
Other Wall	124
Partition	442
Exterior Floor	0
Internal Floor	0
Slab	137
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 152 of 152

Zone Cooling and Heating Loads by Component

ZONE_RB-S-Corner-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	97	111	0	207	8.8
Door	0	0	0	0	0.0
Wall	0	598	0	598	25.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-109	0	-109	-4.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-84	0	-84	-3.6
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-47	29	1.2
Envelope Subtotal	173	516	-47	642	-
People	149	212	355	716	30.5
Lights	74	143	0	217	9.2
Miscellaneous Loads	352	441	0	793	33.8
Internal Subtotal	575	796	355	1,726	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-91	0	-91	-3.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	-0.5
Grand Total	748	1,209	308	2,265	100.0
RA Sensible (Lights)	85	0	0	85	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-124	0	0	-124	14.6
Door	0	0	0	0	0.0
Wall	0	-489	0	-489	57.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	49	0	49	-5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-147	17.2
Envelope Subtotal	-264	-417	0	-688	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-162	0	-162	19.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-264	-581	0	-852	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	94
Cooling ACH	3.64
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	94
Heating ACH	3.64
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.29
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,549
cfm/ton	499		
ft²/ton	684		
Btu/h-ft²	17.54		

Engineering Checks For Heating

Heating Mbh	-0.85	No People(max)	1.29
%OA	15	People per 1000 ft²	10
cfm/ft²	0.73	Volume (ft³)	1,549
cfm/Mbh	-111		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

ZONE_ACT-Noisy-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,719	1,405	0	3,124	63.4
Door	0	0	0	0	0.0
Wall	0	373	0	373	7.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-641	0	-641	-13.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	196	0	196	4.0
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-55	31	0.6
Envelope Subtotal	1,806	1,332	-55	3,083	-
People	377	635	719	1,731	35.1
Lights	121	227	0	348	7.1
Miscellaneous Loads	184	150	0	333	6.8
Internal Subtotal	682	1,012	719	2,413	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-577	0	-577	-11.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-130	0	-130	-2.6
Grand Total	2,488	1,638	663	4,789	100.0
RA Sensible (Lights)	139	0	0	139	-

Engineering Checks For Cooling

Cooling tons	0.40	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,156
cfm/ton	498		
ft²/ton	450		
Btu/h-ft²	26.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-700	0	0	-700	57.7
Door	0	0	0	0	0.0
Wall	0	-236	0	-236	19.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	131	0	131	-10.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-205	16.8
Envelope Subtotal	-895	-72	0	-977	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-214	0	-214	17.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	1.9
Grand Total	-895	-309	0	-1,214	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	3.59
%OA	19	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,156
cfm/Mbh	-164		
ft²/Mbh	-148		
Btu/h-ft²	-6.76		

Cooling Airflows

Main Fan cfm	199
Cooling ACH	5.54
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	199
Heating ACH	5.54
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	193
Window	37
Door	0
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ZONE_ACT-Noise-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	401	187	0	589	20.0
Door	0	0	0	0	0.0
Wall	0	70	0	70	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-190	0	-190	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-52	24	0.8
Envelope Subtotal	477	36	-52	462	-
People	380	626	723	1,730	58.6
Lights	122	225	0	346	11.7
Miscellaneous Loads	185	147	0	333	11.3
Internal Subtotal	687	999	723	2,409	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-35	0	-35	-1.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	-0.8
Grand Total	1,164	974	672	2,810	100.0
RA Sensible (Lights)	140	0	0	140	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.61
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	2,170
cfm/ton	439		
ft²/ton	772		
Btu/h-ft²	15.54		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-506	0	0	-506	50.9
Door	0	0	0	0	0.0
Wall	0	-123	0	-123	12.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	64	0	64	-6.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-206	20.7
Envelope Subtotal	-702	-28	0	-740	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-236	0	-236	23.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	2.0
Grand Total	-702	-283	0	-995	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.99	No People(max)	3.61
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	2,170
cfm/Mbh	-103		
ft²/Mbh	-182		
Btu/h-ft²	-5.49		

Cooling Airflows

Main Fan cfm	103
Cooling ACH	2.85
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	103
Heating ACH	2.85
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	195
Window	21
Door	0
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ZONE_ACT-Noisy-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	487	190	0	678	22.3
Door	0	0	0	0	0.0
Wall	0	136	0	136	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-267	0	-267	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-72	0	-72	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-50	59	1.9
Envelope Subtotal	597	-12	-50	534	-
People	382	599	729	1,710	56.4
Lights	122	215	0	337	11.1
Miscellaneous Loads	186	141	0	327	10.8
Internal Subtotal	691	955	729	2,375	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	15	0	15	0.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-31	0	-31	-1.0
Grand Total	1,288	927	678	2,893	100.0
RA Sensible (Lights)	141	0	0	141	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	2,186
cfm/ton	442		
ft²/ton	755		
Btu/h-ft²	15.89		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-550	0	0	-550	45.4
Door	0	0	0	0	0.0
Wall	0	-218	0	-218	18.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	137	0	137	-11.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	33	0	33	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-207	17.1
Envelope Subtotal	-747	-48	0	-805	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-388	0	-388	32.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	1.5
Grand Total	-747	-455	0	-1,212	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.21	No People(max)	3.64
%OA	36	People per 1000 ft²	20
cfm/ft²	0.59	Volume (ft³)	2,186
cfm/Mbh	-88		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	107
Cooling ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	2.94
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	196
Window	29
Door	0
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ZONE_ACT-Quiet-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 47.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-47	0	-47	-2.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-39	0	-39	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-53	24	1.3
Envelope Subtotal	77	-85	-53	-61	-
People	274	468	521	1,263	69.5
Lights	88	169	0	256	14.1
Miscellaneous Loads	133	110	0	243	13.4
Internal Subtotal	495	746	521	1,762	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	20	0	20	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	572	677	468	1,717	100.0
RA Sensible (Lights)	101	0	0	101	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.60
%OA	45	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/ton	421		
ft²/ton	911		
Btu/h-ft²	13.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-59	0	-59	15.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	17	0	17	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	37.9
Envelope Subtotal	-141	-42	0	-190	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-200	0	-200	51.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-141	-242	0	-390	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.39	No People(max)	2.60
%OA	45	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	1,564
cfm/Mbh	-154		
ft²/Mbh	-334		
Btu/h-ft²	-2.99		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	2.30
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_ACT-Quiet-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 47.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	167	140	0	307	14.2
Door	0	0	0	0	0.0
Wall	0	104	0	104	4.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-21	0	-21	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-51	0	-51	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-51	26	1.2
Envelope Subtotal	244	172	-51	365	-
People	274	471	523	1,268	58.7
Lights	88	170	0	258	11.9
Miscellaneous Loads	134	111	0	245	11.3
Internal Subtotal	496	752	523	1,770	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-63	0	-63	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-0.6
Grand Total	740	847	472	2,058	100.0
RA Sensible (Lights)	101	0	0	101	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-95	0	0	-95	17.2
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	12.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-64	0	-64	11.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	19	0	19	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-149	26.9
Envelope Subtotal	-236	-115	0	-359	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-191	0	-191	34.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.4
Grand Total	-236	-308	0	-552	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	76
Cooling ACH	2.91
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	76
Heating ACH	2.91
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.61
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	1,568
cfm/ton	446		
ft²/ton	762		
Btu/h-ft²	15.75		

Engineering Checks For Heating

Heating Mbh	-0.55	No People(max)	2.61
%OA	36	People per 1000 ft²	20
cfm/ft²	0.58	Volume (ft³)	1,568
cfm/Mbh	-138		
ft²/Mbh	-237		
Btu/h-ft²	-4.22		

ZONE_ACT-Quiet-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	396	0	396	18.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-38	0	-38	-1.8
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-38	2	0.1
Envelope Subtotal	40	263	-38	265	-
People	275	469	524	1,269	59.5
Lights	88	169	0	257	12.1
Miscellaneous Loads	134	110	0	245	11.5
Internal Subtotal	498	749	524	1,771	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	2	0	2	0.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.3
Grand Total	537	1,007	487	2,032	100.0
RA Sensible (Lights)	101	0	0	101	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-224	0	-224	40.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	3.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.5
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	26.7
Envelope Subtotal	-142	-222	0	-371	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-187	0	-187	33.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-142	-410	0	-559	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	74
Cooling ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	74
Heating ACH	2.82
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	2.62
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	1,573
cfm/ton	439		
ft²/ton	774		
Btu/h-ft²	15.50		

Engineering Checks For Heating

Heating Mbh	-0.56	No People(max)	2.62
%OA	37	People per 1000 ft²	20
cfm/ft²	0.57	Volume (ft³)	1,573
cfm/Mbh	-133		
ft²/Mbh	-235		
Btu/h-ft²	-4.26		

ZONE_Admin

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	405	0	405	13.8
Other Roof	0	0	0	0	0.0
Glass	328	372	0	700	23.8
Door	0	0	0	0	0.0
Wall	0	546	0	546	18.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-94	0	-94	-3.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-76	0	-76	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	112	0	-58	54	1.8
Envelope Subtotal	439	1,153	-58	1,534	-
People	199	276	379	854	29.0
Lights	127	199	0	326	11.1
Miscellaneous Loads	97	0	0	97	3.3
Internal Subtotal	423	475	379	1,277	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	863	1,611	321	2,794	100.0
RA Sensible (Lights)	146	0	0	146	-

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	1.89
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	2,272
cfm/ton	511		
ft²/ton	813		
Btu/h-ft²	14.76		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-283	0	-283	29.6
Other Roof	0	0	0	0	0.0
Glass	-194	0	0	-194	20.3
Door	0	0	0	0	0.0
Wall	0	-352	0	-352	36.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	32	0	32	-3.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-205	0	0	-215	22.6
Envelope Subtotal	-399	-573	0	-983	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	32	0	0	32	-3.4
Internal Subtotal	32	0	0	32	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.5
Grand Total	-367	-578	0	-955	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.89
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	2,272
cfm/Mbh	-125		
ft²/Mbh	-198		
Btu/h-ft²	-5.05		

Cooling Airflows

Main Fan cfm	119
Cooling ACH	3.14
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	119
Heating ACH	3.14
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

ZONE_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,546	0	1,546	15.5
Other Roof	0	0	0	0	0.0
Glass	822	594	0	1,416	14.2
Door	0	0	0	0	0.0
Wall	0	1,613	0	1,613	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	94	0	94	0.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-148	0	-148	-1.5
Slab	0	-1	0	-1	0.0
Other Floor	0	0	0	0	0.0
Infiltration	695	0	-179	516	5.2
Envelope Subtotal	1,517	3,697	-179	5,035	-
People	621	876	982	2,479	24.8
Lights	688	1,005	0	1,694	17.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	1,309	1,881	982	4,172	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-475	0	-475	-4.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	510	0	0	510	5.1
Time Delay Correction	0	-48	0	-48	-0.5
Grand Total	3,335	5,056	803	9,194	100.0
RA Sensible (Lights)	790	0	0	790	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 82.7 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			Total
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-952	0	-952	17.9
Other Roof	0	0	0	0	0.0
Glass	-769	0	0	-769	14.5
Door	0	0	0	0	0.0
Wall	0	-1,739	0	-1,739	32.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-216	0	-216	4.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	86	0	86	-1.6
Slab	0	71	0	71	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	-1,359	0	0	-1,424	26.8
Envelope Subtotal	-2,128	-2,750	0	-4,944	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-34	0	-34	0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-319	0	0	-319	6.0
Time Delay Correction	0	-17	0	-17	0.3
Grand Total	-2,447	-2,801	0	-5,313	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	404
Cooling ACH	1.61
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	404
Heating ACH	1.61
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100

Areas

	ft²
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Engineering Checks For Cooling

Cooling tons	0.77	No People(max)	6.33
%OA	27	People per 1000 ft²	5
cfm/ft²	0.32	Volume (ft³)	15,043
cfm/ton	527		
ft²/ton	1,653		
Btu/h-ft²	7.26		

Engineering Checks For Heating

Heating Mbh	-5.31	No People(max)	6.33
%OA	27	People per 1000 ft²	5
cfm/ft²	0.32	Volume (ft³)	15,043
cfm/Mbh	-76		
ft²/Mbh	-238		
Btu/h-ft²	-4.20		

ZONE_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	13	0	13	0.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	75	0	75	3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-14	0	-14	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-46	14	0.7
Envelope Subtotal	60	74	-46	88	-
People	210	289	399	898	46.8
Lights	134	209	0	343	17.9
Miscellaneous Loads	341	0	0	341	17.7
Internal Subtotal	684	498	399	1,582	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	98	0	98	5.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	745	667	353	1,765	100.0
RA Sensible (Lights)	154	0	0	154	-

Engineering Checks For Cooling

Cooling tons	0.15	No People(max)	2.00
%OA	31	People per 1000 ft²	10
cfm/ft²	0.35	Volume (ft³)	2,395
cfm/ton	474		
ft²/ton	1,357		
Btu/h-ft²	8.84		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-27	0	-27	6.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-99	0	-99	22.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	25	0	25	-5.7
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-227	51.1
Envelope Subtotal	-216	-100	0	-327	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-7.7
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-150	0	-150	33.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	0	0	0	0.1
Grand Total	-182	-251	0	-443	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.44	No People(max)	2.00
%OA	31	People per 1000 ft²	10
cfm/ft²	0.35	Volume (ft³)	2,395
cfm/Mbh	-157		
ft²/Mbh	-450		
Btu/h-ft²	-2.22		

Cooling Airflows

Main Fan cfm	70
Cooling ACH	1.75
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	70
Heating ACH	1.75
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Interior Floor	0
Slab	214
Other Floor	0

ZONE_Comfort/Consult

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	611	0	611	15.1
Other Roof	0	0	0	0	0.0
Glass	211	99	0	310	7.6
Door	0	0	0	0	0.0
Wall	0	376	0	376	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-184	0	-184	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	211	874	0	1,085	-
People	298	418	567	1,282	31.6
Lights	259	408	0	666	16.4
Miscellaneous Loads	435	295	0	730	18.0
Internal Subtotal	991	1,120	567	2,679	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	18	0	18	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.5
Grand Total	1,203	1,994	567	3,763	100.0
RA Sensible (Lights)	297	0	0	297	-

Engineering Checks For Cooling

Cooling tons	0.31	No People(max)	2.83
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	3,402
cfm/ton	490		
ft²/ton	904		
Btu/h-ft²	13.27		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-366	0	-366	30.7
Other Roof	0	0	0	0	0.0
Glass	-291	0	0	-291	24.4
Door	0	0	0	0	0.0
Wall	0	-525	0	-525	44.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	80	0	80	-6.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-3.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-291	-766	0	-1,057	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-127	0	-127	10.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-7	0	-7	0.6
Grand Total	-291	-900	0	-1,191	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.19	No People(max)	2.83
%OA	47	People per 1000 ft²	10
cfm/ft²	0.54	Volume (ft³)	3,402
cfm/Mbh	-129		
ft²/Mbh	-238		
Btu/h-ft²	-4.20		

Cooling Airflows

Main Fan cfm	154
Cooling ACH	2.72
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	154
Heating ACH	2.72
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

ZONE_Corridor-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	734	383	0	1,117	41.6
Door	0	0	0	0	0.0
Wall	0	42	0	42	1.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	314	0	314	11.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	11	0	11	0.4
Other Floor	0	0	0	0	0.0
Infiltration	92	0	-2	90	3.4
Envelope Subtotal	826	750	-2	1,574	-
People	0	0	0	0	0.0
Lights	249	424	0	673	25.1
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	249	424	0	673	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	169	0	169	6.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.6
Grand Total	1,075	1,327	-2	2,400	100.0
RA Sensible (Lights)	286	0	0	286	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	4,909
cfm/ton	578		
ft²/ton	2,045		
Btu/h-ft²	5.87		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 83.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-729	0	0	-729	45.7
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-37	0	-37	2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	64	0	64	-4.0
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-250	15.7
Envelope Subtotal	-967	-35	0	-1,014	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-567	0	-567	35.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.9
Grand Total	-967	-616	0	-1,596	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.60	No People(max)	0.00
%OA	21	People per 1000 ft²	0
cfm/ft²	0.28	Volume (ft³)	4,909
cfm/Mbh	-73		
ft²/Mbh	-256		
Btu/h-ft²	-3.91		

Cooling Airflows

Main Fan cfm	116
Cooling ACH	1.42
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	116
Heating ACH	1.42
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

ZONE_Corridor-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 22.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,829	1,963	0	3,792	93.8
Door	0	0	0	0	0.0
Wall	0	100	0	100	2.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-217	0	-217	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	58	0	58	1.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-16	61	1.5
Envelope Subtotal	1,906	1,904	-16	3,794	-
People	0	0	0	0	0.0
Lights	252	412	0	664	16.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	252	412	0	664	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-624	0	-624	-15.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-79	0	-79	-1.9
Grand Total	2,157	1,613	-16	3,755	100.0
RA Sensible (Lights)	289	0	0	289	-

Engineering Checks For Cooling

Cooling tons	0.31	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.44	Volume (ft³)	4,967
cfm/ton	584		
ft²/ton	1,323		
Btu/h-ft²	9.07		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-719	0	0	-719	45.8
Door	0	0	0	0	0.0
Wall	0	-66	0	-66	4.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	65	0	65	-4.1
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-254	16.1
Envelope Subtotal	-961	-24	0	-997	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-560	0	-560	35.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.9
Grand Total	-961	-599	0	-1,572	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.57	No People(max)	0.00
%OA	14	People per 1000 ft²	0
cfm/ft²	0.44	Volume (ft³)	4,967
cfm/Mbh	-116		
ft²/Mbh	-263		
Btu/h-ft²	-3.80		

Cooling Airflows

Main Fan cfm	183
Cooling ACH	2.21
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	183
Heating ACH	2.21
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

ZONE_Corridor-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,095	1,861	0	3,956	90.8
Door	0	0	0	0	0.0
Wall	0	101	0	101	2.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-382	0	-382	-8.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	426	0	426	9.8
Other Floor	0	0	0	0	0.0
Infiltration	86	0	-2	85	1.9
Envelope Subtotal	2,181	2,007	-2	4,186	-
People	0	0	0	0	0.0
Lights	197	356	0	553	12.7
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	197	356	0	553	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-512	0	-512	-11.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-98	0	-98	-2.3
Grand Total	2,378	1,752	-2	4,129	100.0
RA Sensible (Lights)	226	0	0	226	-

Engineering Checks For Cooling

Cooling tons	0.34	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.61	Volume (ft³)	3,888
cfm/ton	578		
ft²/ton	942		
Btu/h-ft²	12.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-700	0	0	-700	50.5
Door	0	0	0	0	0.0
Wall	0	-61	0	-61	4.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-23	0	-23	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-3.8
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-199	14.3
Envelope Subtotal	-889	-32	0	-931	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-441	0	-441	31.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	1.0
Grand Total	-889	-487	0	-1,386	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.39	No People(max)	0.00
%OA	10	People per 1000 ft²	0
cfm/ft²	0.61	Volume (ft³)	3,888
cfm/Mbh	-144		
ft²/Mbh	-234		
Btu/h-ft²	-4.27		

Cooling Airflows

Main Fan cfm	199
Cooling ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	199
Heating ACH	3.07
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

ZONE_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-4	0	-4	0.0
Other Roof	0	0	0	0	0.0
Glass	5,410	6,118	0	11,529	107.6
Door	0	0	0	0	0.0
Wall	0	253	0	253	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,155	0	-1,155	-10.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	356	0	356	3.3
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-23	42	0.4
Envelope Subtotal	5,476	5,568	-23	11,020	-
People	182	241	287	710	6.6
Lights	201	272	0	473	4.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	383	513	287	1,183	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-1,497	0	-1,497	-14.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-225	0	-225	-2.1
Grand Total	5,859	4,358	264	10,481	100.0
RA Sensible (Lights)	231	0	0	231	-

Engineering Checks For Cooling

Cooling tons	0.87	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.33	Volume (ft³)	4,445
cfm/ton	563		
ft²/ton	424		
Btu/h-ft²	28.30		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-69	0	-69	1.5
Other Roof	0	0	0	0	0.0
Glass	-3,128	0	0	-3,128	68.3
Door	0	0	0	0	0.0
Wall	0	-544	0	-544	11.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	469	0	469	-10.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	97	0	97	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-422	9.2
Envelope Subtotal	-3,529	-46	0	-3,596	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-932	0	-932	20.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-54	0	-54	1.2
Grand Total	-3,529	-1,033	0	-4,583	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-4.58	No People(max)	1.85
%OA	6	People per 1000 ft²	5
cfm/ft²	1.33	Volume (ft³)	4,445
cfm/Mbh	-107		
ft²/Mbh	-81		
Btu/h-ft²	-12.35		

Cooling Airflows

Main Fan cfm	492
Cooling ACH	6.64
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	492
Heating ACH	6.64
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	56
Other Roof	56
Ceiling	339
Window	287
Door	0
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

ZONE_Exam/Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	574	0	574	25.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-12	0	-12	-0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-0.6
Other Floor	0	0	0	0	0.0
Infiltration	56	0	-19	37	1.6
Envelope Subtotal	56	549	-19	586	-
People	182	248	347	777	34.4
Lights	157	241	0	397	17.6
Miscellaneous Loads	202	124	0	326	14.4
Internal Subtotal	541	613	347	1,500	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	596	1,157	328	2,082	100.0
RA Sensible (Lights)	180	0	0	180	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.73
%OA	44	People per 1000 ft²	8
cfm/ft²	0.38	Volume (ft³)	2,685
cfm/ton	486		
ft²/ton	1,290		
Btu/h-ft²	9.30		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-338	0	-338	68.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-72	0	-72	14.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	29	0	29	-5.9
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-115	23.3
Envelope Subtotal	-109	-381	0	-495	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-0.9
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-105	-381	0	-492	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.49	No People(max)	1.73
%OA	44	People per 1000 ft²	8
cfm/ft²	0.38	Volume (ft³)	2,685
cfm/Mbh	-172		
ft²/Mbh	-455		
Btu/h-ft²	-2.20		

Cooling Airflows

Main Fan cfm	84
Cooling ACH	1.88
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	84
Heating ACH	1.88
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

ZONE_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	358	0	358	8.2
Other Roof	0	0	0	0	0.0
Glass	142	71	0	213	4.9
Door	0	0	0	0	0.0
Wall	0	321	0	321	7.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-145	0	-145	-3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-43	0	-43	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	153	0	-71	83	1.9
Envelope Subtotal	295	562	-71	786	-
People	553	808	1,106	2,466	56.2
Lights	166	262	0	427	9.7
Miscellaneous Loads	283	192	0	475	10.8
Internal Subtotal	1,001	1,261	1,106	3,368	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	62	0	62	1.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-0.5
Grand Total	1,296	1,864	1,035	4,195	100.0
RA Sensible (Lights)	190	0	0	190	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-190	0	-190	12.2
Other Roof	0	0	0	0	0.0
Glass	-195	0	0	-195	12.6
Door	0	0	0	0	0.0
Wall	0	-468	0	-468	30.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	87	0	87	-5.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-314	20.2
Envelope Subtotal	-495	-522	0	-1,032	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-518	0	-518	33.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.4
Grand Total	-495	-1,046	0	-1,555	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	152
Cooling ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	152
Heating ACH	2.75
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.35	No People(max)	5.52
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	3,317
cfm/ton	435		
ft²/ton	791		
Btu/h-ft²	15.17		

Engineering Checks For Heating

Heating Mbh	-1.56	No People(max)	5.52
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	3,317
cfm/Mbh	-98		
ft²/Mbh	-178		
Btu/h-ft²	-5.62		

ZONE_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	315	0	315	7.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	307	0	307	7.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	73	0	73	1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-32	0	-32	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	137	0	-64	73	1.8
Envelope Subtotal	137	664	-64	736	-
People	492	716	984	2,192	55.3
Lights	147	233	0	380	9.6
Miscellaneous Loads	252	171	0	423	10.7
Internal Subtotal	891	1,119	984	2,995	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	71	0	71	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	1,028	1,849	920	3,797	100.0
RA Sensible (Lights)	169	0	0	169	-

Engineering Checks For Cooling

Cooling tons	0.32	No People(max)	4.92
%OA	30	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,953
cfm/ton	865		
ft²/ton	778		
Btu/h-ft²	15.42		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-167	0	-167	12.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-439	0	-439	31.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-92	0	-92	6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	44	0	44	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-280	20.1
Envelope Subtotal	-266	-654	0	-934	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-458	0	-458	32.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-266	-1,115	0	-1,395	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.39	No People(max)	4.92
%OA	30	People per 1000 ft²	20
cfm/ft²	1.11	Volume (ft³)	2,953
cfm/Mbh	-196		
ft²/Mbh	-176		
Btu/h-ft²	-5.68		

Cooling Airflows

Main Fan cfm	274
Cooling ACH	5.57
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	274
Heating ACH	5.57
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

ZONE_Intake-HR-A

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 13:00:00
 Outside DB / WB / HR 96.8 °F / 63.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	670	0	670	8.9
Other Roof	0	0	0	0	0.0
Glass	1,319	1,043	0	2,362	31.3
Door	0	0	0	0	0.0
Wall	0	648	0	648	8.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-437	0	-437	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-82	0	-82	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	90	0	-44	47	0.6
Envelope Subtotal	1,409	1,841	-44	3,207	-
People	404	574	720	1,698	22.5
Lights	364	562	0	927	12.3
Miscellaneous Loads	362	240	0	602	8.0
Internal Subtotal	1,131	1,376	720	3,226	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-37	0	-37	-0.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	839	0	0	839	11.1
Time Delay Correction	0	-96	0	-96	-1.3
Grand Total	3,379	3,084	676	7,139	100.0
RA Sensible (Lights)	418	0	0	418	-

Engineering Checks For Cooling

Cooling tons	0.59	No People(max)	3.96
%OA	22	People per 1000 ft²	8
cfm/ft²	0.66	Volume (ft³)	5,646
cfm/ton	523		
ft²/ton	791		
Btu/h-ft²	15.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-583	0	-583	22.6
Other Roof	0	0	0	0	0.0
Glass	-608	0	0	-608	23.6
Door	0	0	0	0	0.0
Wall	0	-725	0	-725	28.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	76	0	76	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-177	0	0	-186	7.2
Envelope Subtotal	-785	-1,188	0	-1,981	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-255	0	-255	9.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-317	0	0	-317	12.3
Time Delay Correction	0	-26	0	-26	1.0
Grand Total	-1,102	-1,469	0	-2,580	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.58	No People(max)	3.96
%OA	22	People per 1000 ft²	8
cfm/ft²	0.66	Volume (ft³)	5,646
cfm/Mbh	-121		
ft²/Mbh	-182		
Btu/h-ft²	-5.49		

Cooling Airflows

Main Fan cfm	311
Cooling ACH	3.30
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	311
Heating ACH	3.30
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	26
Door	0
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

ZONE_Intake-HR-B

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	426	0	426	24.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	40	0	40	2.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	47	0	47	2.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	45	0	-14	31	1.8
Envelope Subtotal	45	504	-14	535	-
People	130	183	248	562	32.3
Lights	112	177	0	289	16.7
Miscellaneous Loads	139	87	0	226	13.0
Internal Subtotal	382	447	248	1,077	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.2
Grand Total	426	948	234	1,608	100.0
RA Sensible (Lights)	129	0	0	129	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	1.24
%OA	40	People per 1000 ft²	8
cfm/ft²	0.40	Volume (ft³)	1,976
cfm/ton	493		
ft²/ton	1,228		
Btu/h-ft²	9.77		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-252	0	-252	55.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-47	0	-47	10.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-86	0	-86	19.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	22	0	22	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-92	20.4
Envelope Subtotal	-88	-363	0	-455	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-0.8
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-84	-363	0	-452	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.45	No People(max)	1.24
%OA	40	People per 1000 ft²	8
cfm/ft²	0.40	Volume (ft³)	1,976
cfm/Mbh	-146		
ft²/Mbh	-364		
Btu/h-ft²	-2.75		

Cooling Airflows

Main Fan cfm	66
Cooling ACH	2.00
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	66
Heating ACH	2.00
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

ZONE_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,495	0	1,495	2.4
Other Roof	0	0	0	0	0.0
Glass	2,392	2,696	0	5,087	8.1
Door	0	0	0	0	0.0
Wall	0	407	0	407	0.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,089	0	-1,089	-1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-777	0	-777	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	259	0	-341	-82	-0.1
Envelope Subtotal	2,651	2,733	-341	5,043	-
People	1,375	1,925	3,197	6,498	10.4
Lights	560	880	0	1,440	2.3
Miscellaneous Loads	13,334	8,988	0	22,322	35.6
Internal Subtotal	15,269	11,793	3,197	30,260	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	27,002	0	0	27,002	43.1
Time Delay Correction	0	-239	0	-239	-0.4
Grand Total	44,922	14,287	2,857	62,065	100.0
RA Sensible (Lights)	643	0	0	643	-

Engineering Checks For Cooling

Cooling tons	5.17	No People(max)	13.10
%OA	6	People per 1000 ft²	19
cfm/ft²	4.16	Volume (ft³)	8,226
cfm/ton	552		
ft²/ton	133		
Btu/h-ft²	90.23		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-964	0	-964	6.6
Other Roof	0	0	0	0	0.0
Glass	-1,162	0	0	-1,162	7.9
Door	0	0	0	0	0.0
Wall	0	-957	0	-957	6.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-221	0	-221	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	125	0	125	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	-742	0	0	-780	5.3
Envelope Subtotal	-1,905	-2,016	0	-3,959	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.1
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-10,682	0	0	-10,682	72.8
Time Delay Correction	0	-45	0	-45	0.3
Grand Total	-12,573	-2,061	0	-14,673	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-14.67	No People(max)	13.10
%OA	6	People per 1000 ft²	19
cfm/ft²	4.16	Volume (ft³)	8,226
cfm/Mbh	-194		
ft²/Mbh	-47		
Btu/h-ft²	-21.28		

Cooling Airflows

Main Fan cfm	2,853
Cooling ACH	20.81
Sec Fan cfm	0
Input Ventilation cfm	174
Calculated Ventilation cfm	174
Calculated Ventilation ACH	1.27
Infiltration cfm	18
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,853
Heating ACH	20.81
Sec Fan cfm	0
Input Ventilation cfm	174
Calculated Ventilation cfm	174
Calculated Ventilation ACH	1.27
Infiltration cfm	18
Min Stop/RH (%)	100

Areas

ft²

Roof	726
Other Roof	726
Ceiling	0
Window	49
Door	0
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

ZONE_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 36.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	484	0	484	6.7
Other Roof	0	0	0	0	0.0
Glass	1,410	1,629	0	3,039	42.3
Door	0	0	0	0	0.0
Wall	0	578	0	578	8.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-451	0	-451	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-236	0	-236	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	112	0	-116	-4	-0.1
Envelope Subtotal	1,523	2,003	-116	3,410	-
People	589	867	1,098	2,554	35.5
Lights	187	284	0	471	6.6
Miscellaneous Loads	202	133	0	335	4.7
Internal Subtotal	979	1,284	1,098	3,360	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	302	0	0	302	4.2
Time Delay Correction	0	-95	0	-95	-1.3
Grand Total	2,803	3,191	982	6,976	100.0
RA Sensible (Lights)	214	0	0	214	-

Engineering Checks For Cooling

Cooling tons	0.58	No People(max)	5.93
%OA	23	People per 1000 ft²	20
cfm/ft²	0.98	Volume (ft³)	3,561
cfm/ton	498		
ft²/ton	511		
Btu/h-ft²	23.48		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-432	0	-432	24.2
Other Roof	0	0	0	0	0.0
Glass	-684	0	0	-684	38.3
Door	0	0	0	0	0.0
Wall	0	-374	0	-374	21.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	105	0	105	-5.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	49	0	49	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-321	0	0	-338	18.9
Envelope Subtotal	-1,005	-652	0	-1,674	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-89	0	0	-89	5.0
Time Delay Correction	0	-22	0	-22	1.3
Grand Total	-1,094	-675	0	-1,786	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.79	No People(max)	5.93
%OA	23	People per 1000 ft²	20
cfm/ft²	0.98	Volume (ft³)	3,561
cfm/Mbh	-162		
ft²/Mbh	-166		
Btu/h-ft²	-6.02		

Cooling Airflows

Main Fan cfm	290
Cooling ACH	4.89
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	290
Heating ACH	4.89
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²

Roof	322
Other Roof	322
Ceiling	0
Window	37
Door	0
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

ZONE_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	699	0	699	9.1
Other Roof	0	0	0	0	0.0
Glass	623	260	0	883	11.4
Door	0	0	0	0	0.0
Wall	0	300	0	300	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-339	0	-339	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-71	0	-71	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	291	0	-124	168	2.2
Envelope Subtotal	914	849	-124	1,639	-
People	971	1,316	1,942	4,229	54.8
Lights	291	433	0	723	9.4
Miscellaneous Loads	497	318	0	815	10.6
Internal Subtotal	1,758	2,067	1,942	5,767	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	32	0	32	0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-57	0	-57	-0.7
Grand Total	2,672	2,891	1,818	7,382	100.0
RA Sensible (Lights)	334	0	0	334	-

Engineering Checks For Cooling

Cooling tons	0.62	No People(max)	9.70
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	5,825
cfm/ton	435		
ft²/ton	789		
Btu/h-ft²	15.21		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-345	0	-345	12.6
Other Roof	0	0	0	0	0.0
Glass	-807	0	0	-807	29.5
Door	0	0	0	0	0.0
Wall	0	-467	0	-467	17.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	201	0	201	-7.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	92	0	92	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-552	20.2
Envelope Subtotal	-1,332	-520	0	-1,878	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-828	0	-828	30.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-28	0	-28	1.0
Grand Total	-1,332	-1,376	0	-2,734	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.73	No People(max)	9.70
%OA	60	People per 1000 ft²	20
cfm/ft²	0.55	Volume (ft³)	5,825
cfm/Mbh	-98		
ft²/Mbh	-178		
Btu/h-ft²	-5.62		

Cooling Airflows

Main Fan cfm	268
Cooling ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	268
Heating ACH	2.76
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas ft²

Roof	266
Other Roof	266
Ceiling	242
Window	44
Door	0
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

ZONE_RB-N-Corner

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 58.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	320	0	592	22.3
Door	0	0	0	0	0.0
Wall	0	524	0	524	19.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-146	0	-146	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-19	0	-19	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-34	21	0.8
Envelope Subtotal	326	679	-34	972	-
People	151	236	359	745	28.0
Lights	74	142	0	217	8.2
Miscellaneous Loads	356	439	0	795	29.9
Internal Subtotal	581	817	359	1,756	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-137	0	-137	-5.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.7
Grand Total	908	1,340	325	2,573	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,565
cfm/ton	599		
ft²/ton	609		
Btu/h-ft²	19.70		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-127	0	0	-127	14.8
Door	0	0	0	0	0.0
Wall	0	-485	0	-485	56.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-5.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	17.3
Envelope Subtotal	-268	-417	0	-693	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-164	0	-164	19.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-268	-584	0	-860	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.86	No People(max)	1.30
%OA	11	People per 1000 ft²	10
cfm/ft²	0.98	Volume (ft³)	1,565
cfm/Mbh	-149		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	128
Cooling ACH	4.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	128
Heating ACH	4.91
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_RB-N-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	3	0	3	0.1
Other Roof	0	0	0	0	0.0
Glass	484	566	0	1,050	23.1
Door	0	0	0	0	0.0
Wall	0	610	0	610	13.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-198	0	-198	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-55	0	-55	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	80	0	-66	14	0.3
Envelope Subtotal	564	925	-66	1,424	-
People	297	312	707	1,316	28.9
Lights	147	235	0	382	8.4
Miscellaneous Loads	702	725	0	1,426	31.4
Internal Subtotal	1,145	1,272	707	3,124	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-136	0	-136	-3.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-32	0	-32	-0.7
Grand Total	1,709	2,029	641	4,379	100.0
RA Sensible (Lights)	169	0	0	169	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-4	0	-4	0.2
Other Roof	0	0	0	0	0.0
Glass	-257	0	0	-257	16.9
Door	0	0	0	0	0.0
Wall	0	-692	0	-692	45.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	42	0	42	-2.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-278	0	0	-292	19.2
Envelope Subtotal	-535	-610	0	-1,160	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-357	0	-357	23.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.4
Grand Total	-535	-973	0	-1,523	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	202
Cooling ACH	3.93
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	202
Heating ACH	3.93
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.36	No People(max)	2.57
%OA	14	People per 1000 ft²	10
cfm/ft²	0.79	Volume (ft³)	3,084
cfm/ton	554		
ft²/ton	704		
Btu/h-ft²	17.05		

Engineering Checks For Heating

Heating Mbh	-1.52	No People(max)	2.57
%OA	14	People per 1000 ft²	10
cfm/ft²	0.79	Volume (ft³)	3,084
cfm/Mbh	-133		
ft²/Mbh	-169		
Btu/h-ft²	-5.92		

ZONE_RB-N-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	802	977	0	1,779	23.9
Door	0	0	0	0	0.0
Wall	0	1,079	0	1,079	14.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-478	0	-478	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-67	0	-67	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	160	0	-97	63	0.8
Envelope Subtotal	962	1,510	-97	2,375	-
People	442	696	1,052	2,190	29.5
Lights	218	420	0	639	8.6
Miscellaneous Loads	1,044	1,295	0	2,339	31.5
Internal Subtotal	1,704	2,411	1,052	5,168	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-307	0	-307	-4.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-56	0	-56	-0.7
Grand Total	2,667	3,559	955	7,180	100.0
RA Sensible (Lights)	251	0	0	251	-

Engineering Checks For Cooling

Cooling tons	0.60	No People(max)	3.83
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	4,590
cfm/ton	581		
ft²/ton	639		
Btu/h-ft²	18.78		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-398	0	0	-398	20.6
Door	0	0	0	0	0.0
Wall	0	-605	0	-605	31.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	60	0	60	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-435	22.5
Envelope Subtotal	-813	-565	0	-1,398	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-525	0	-525	27.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.4
Grand Total	-813	-1,098	0	-1,932	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.93	No People(max)	3.83
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	4,590
cfm/Mbh	-180		
ft²/Mbh	-198		
Btu/h-ft²	-5.05		

Cooling Airflows

Main Fan cfm	348
Cooling ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	348
Heating ACH	4.55
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

ZONE_RB-S-Corner-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	280	292	0	573	20.6
Door	0	0	0	0	0.0
Wall	0	712	0	712	25.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-149	0	-149	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	1	0	1	0.0
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-46	17	0.6
Envelope Subtotal	344	857	-46	1,154	-
People	152	228	361	741	26.7
Lights	75	143	0	218	7.8
Miscellaneous Loads	358	440	0	798	28.7
Internal Subtotal	585	811	361	1,757	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-200	0	-200	-7.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.7
Grand Total	929	1,448	315	2,691	100.0
RA Sensible (Lights)	86	0	0	86	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/ton	510		
ft²/ton	585		
Btu/h-ft²	20.51		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-127	0	0	-127	14.7
Door	0	0	0	0	0.0
Wall	0	-491	0	-491	56.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	45	0	45	-5.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	17.2
Envelope Subtotal	-269	-422	0	-699	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-164	0	-164	18.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-269	-589	0	-866	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,575
cfm/Mbh	-132		
ft²/Mbh	-152		
Btu/h-ft²	-6.58		

Cooling Airflows

Main Fan cfm	114
Cooling ACH	4.34
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	114
Heating ACH	4.34
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Interior Floor	0
Slab	143
Other Floor	0

ZONE_RB-S-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	720	801	0	1,521	23.7
Door	0	0	0	0	0.0
Wall	0	659	0	659	10.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-282	0	-282	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-64	0	-64	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	115	0	-95	20	0.3
Envelope Subtotal	836	1,114	-95	1,855	-
People	430	461	1,023	1,913	29.8
Lights	212	347	0	560	8.7
Miscellaneous Loads	1,015	1,070	0	2,085	32.4
Internal Subtotal	1,657	1,878	1,023	4,557	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-184	0	-184	-2.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-47	0	-47	-0.7
Grand Total	2,493	2,761	928	6,181	100.0
RA Sensible (Lights)	244	0	0	244	-

Engineering Checks For Cooling

Cooling tons	0.52	No People(max)	3.72
%OA	15	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	4,463
cfm/ton	547		
ft²/ton	722		
Btu/h-ft²	16.62		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 76.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-386	0	0	-386	21.3
Door	0	0	0	0	0.0
Wall	0	-527	0	-527	29.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-8	0	-8	0.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	58	0	58	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-403	0	0	-423	23.4
Envelope Subtotal	-788	-477	0	-1,286	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-515	0	-515	28.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.5
Grand Total	-788	-1,000	0	-1,809	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.81	No People(max)	3.72
%OA	15	People per 1000 ft²	10
cfm/ft²	0.76	Volume (ft³)	4,463
cfm/Mbh	-156		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	282
Cooling ACH	3.79
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	282
Heating ACH	3.79
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

ZONE_RB-S-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	273	325	0	598	24.9
Door	0	0	0	0	0.0
Wall	0	353	0	353	14.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-188	0	-188	-7.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-22	0	-22	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-32	20	0.8
Envelope Subtotal	325	468	-32	762	-
People	143	227	341	711	29.6
Lights	71	137	0	208	8.7
Miscellaneous Loads	338	423	0	761	31.7
Internal Subtotal	552	787	341	1,681	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-100	0	-100	-4.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	877	1,136	309	2,323	100.0
RA Sensible (Lights)	81	0	0	81	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	20.3
Door	0	0	0	0	0.0
Wall	0	-198	0	-198	31.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-11	0	-11	1.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	20	0	20	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-141	22.3
Envelope Subtotal	-263	-189	0	-459	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-171	0	-171	27.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-263	-363	0	-632	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	112
Cooling ACH	4.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	112
Heating ACH	4.52
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,488
cfm/ton	580		
ft²/ton	641		
Btu/h-ft²	18.72		

Engineering Checks For Heating

Heating Mbh	-0.63	No People(max)	1.24
%OA	12	People per 1000 ft²	10
cfm/ft²	0.91	Volume (ft³)	1,488
cfm/Mbh	-178		
ft²/Mbh	-196		
Btu/h-ft²	-5.10		

ZONE_RB-W-North

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 57.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	194	110	0	304	12.4
Door	0	0	0	0	0.0
Wall	0	593	0	593	24.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-134	0	-134	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-32	0	-32	-1.3
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-33	21	0.9
Envelope Subtotal	248	537	-33	752	-
People	150	234	357	740	30.2
Lights	74	141	0	216	8.8
Miscellaneous Loads	354	436	0	790	32.2
Internal Subtotal	578	811	357	1,746	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-113	0	-113	-4.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	827	1,217	324	2,367	100.0
RA Sensible (Lights)	85	0	0	85	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,557
cfm/ton	573		
ft²/ton	658		
Btu/h-ft²	18.24		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-211	0	0	-211	23.2
Door	0	0	0	0	0.0
Wall	0	-469	0	-469	51.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	60	0	60	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	24	0	24	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-148	16.2
Envelope Subtotal	-352	-386	0	-745	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-161	0	-161	17.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.5
Grand Total	-352	-551	0	-910	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.91	No People(max)	1.30
%OA	13	People per 1000 ft²	10
cfm/ft²	0.87	Volume (ft³)	1,557
cfm/Mbh	-124		
ft²/Mbh	-143		
Btu/h-ft²	-6.99		

Cooling Airflows

Main Fan cfm	113
Cooling ACH	4.35
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	113
Heating ACH	4.35
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ZONE_RB-W-South

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 41.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,342	1,666	0	3,008	38.7
Door	0	0	0	0	0.0
Wall	0	1,017	0	1,017	13.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-418	0	-418	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-203	0	-203	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	143	0	-190	-47	-0.6
Envelope Subtotal	1,486	2,062	-190	3,358	-
People	438	590	1,044	2,072	26.6
Lights	217	400	0	617	7.9
Miscellaneous Loads	1,036	1,234	0	2,270	29.2
Internal Subtotal	1,691	2,225	1,044	4,960	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-705	0	-705	-9.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-84	0	-84	-1.1
Grand Total	3,177	3,498	854	7,528	100.0
RA Sensible (Lights)	249	0	0	249	-

Engineering Checks For Cooling

Cooling tons	0.63	No People(max)	3.80
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	4,554
cfm/ton	513		
ft²/ton	605		
Btu/h-ft²	19.83		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 77.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-665	0	0	-665	28.3
Door	0	0	0	0	0.0
Wall	0	-846	0	-846	36.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	49	0	49	-2.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	65	0	65	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-411	0	0	-432	18.4
Envelope Subtotal	-1,076	-732	0	-1,829	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-505	0	-505	21.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	0.6
Grand Total	-1,076	-1,250	0	-2,347	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.35	No People(max)	3.80
%OA	13	People per 1000 ft²	10
cfm/ft²	0.85	Volume (ft³)	4,554
cfm/Mbh	-137		
ft²/Mbh	-162		
Btu/h-ft²	-6.17		

Cooling Airflows

Main Fan cfm	322
Cooling ACH	4.24
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	322
Heating ACH	4.24
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

ZONE_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 50.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	303	0	303	8.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	185	0	185	5.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-35	0	-35	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-34	0	-34	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	127	0	-60	67	1.9
Envelope Subtotal	127	418	-60	485	-
People	456	682	913	2,052	58.5
Lights	137	221	0	358	10.2
Miscellaneous Loads	234	162	0	396	11.3
Internal Subtotal	827	1,066	913	2,806	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	70	0	70	2.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.2
Grand Total	953	1,547	853	3,353	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.28	No People(max)	4.56
%OA	63	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,738
cfm/ton	431		
ft²/ton	817		
Btu/h-ft²	14.69		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-164	0	-164	14.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-274	0	-274	24.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	1.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	38	0	38	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-259	23.5
Envelope Subtotal	-247	-418	0	-677	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-426	0	-426	38.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-2	0	-2	0.2
Grand Total	-247	-847	0	-1,106	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.11	No People(max)	4.56
%OA	63	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,738
cfm/Mbh	-109		
ft²/Mbh	-206		
Btu/h-ft²	-4.85		

Cooling Airflows

Main Fan cfm	120
Cooling ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	120
Heating ACH	2.63
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas ft²

Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

ZONE_SHWR-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	4	0	4	0.1
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	509	0	509	18.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-28	0	-28	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	102	0	-59	44	1.6
Envelope Subtotal	102	452	-59	495	-
People	399	690	631	1,720	62.0
Lights	141	252	0	393	14.2
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	540	942	631	2,113	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	9	0	9	0.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.2
Grand Total	642	1,396	573	2,611	100.0
RA Sensible (Lights)	162	0	0	162	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	2,443
cfm/ton	450		
ft²/ton	936		
Btu/h-ft²	12.82		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3	0	-3	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-358	0	-358	37.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-76	0	-76	8.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-220	0	0	-231	24.4
Envelope Subtotal	-220	-405	0	-637	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-309	0	-309	32.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-220	-716	0	-947	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.48	Volume (ft³)	2,443
cfm/Mbh	-103		
ft²/Mbh	-215		
Btu/h-ft²	-4.65		

Cooling Airflows

Main Fan cfm	98
Cooling ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	98
Heating ACH	2.41
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

ZONE_SHWR-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	654	0	654	21.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	14	0	14	0.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-50	0	-50	-1.6
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-53	34	1.1
Envelope Subtotal	87	617	-53	651	-
People	406	770	642	1,818	60.0
Lights	143	282	0	425	14.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	549	1,052	642	2,243	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-18	0	-18	-0.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.3
Grand Total	636	1,643	589	2,868	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.24	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,486
cfm/ton	459		
ft²/ton	867		
Btu/h-ft²	13.84		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-365	0	-365	39.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-68	0	-68	7.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-236	25.2
Envelope Subtotal	-224	-402	0	-637	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-298	0	-298	31.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-701	0	-936	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.94	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.53	Volume (ft³)	2,486
cfm/Mbh	-117		
ft²/Mbh	-221		
Btu/h-ft²	-4.52		

Cooling Airflows

Main Fan cfm	110
Cooling ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	110
Heating ACH	2.65
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ZONE_SHWR-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	219	0	219	8.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	80	0	80	2.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-50	0	-50	-1.8
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-61	25	0.9
Envelope Subtotal	87	249	-61	275	-
People	406	777	642	1,824	66.8
Lights	143	284	0	427	15.6
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	549	1,061	642	2,251	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	46	0	46	1.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	636	1,351	581	2,567	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	2,485
cfm/ton	446		
ft²/ton	968		
Btu/h-ft²	12.40		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-360	0	-360	37.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-85	0	-85	8.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	24.8
Envelope Subtotal	-224	-413	0	-649	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-300	0	-300	31.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-714	0	-950	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	2,485
cfm/Mbh	-101		
ft²/Mbh	-218		
Btu/h-ft²	-4.59		

Cooling Airflows

Main Fan cfm	96
Cooling ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	96
Heating ACH	2.32
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

ZONE_Support

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 10:00:00
 Outside DB / WB / HR 86.6 °F / 60.3 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 33.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	125	0	125	1.4
Other Roof	0	0	0	0	0.0
Glass	2,596	2,515	0	5,111	55.5
Door	0	0	0	0	0.0
Wall	0	757	0	757	8.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-780	0	-780	-8.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-239	0	-239	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	2,596	2,378	0	4,974	-
People	0	0	0	0	0.0
Lights	278	413	0	691	7.5
Miscellaneous Loads	1,441	0	0	1,441	15.7
Internal Subtotal	1,719	413	0	2,132	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	1,917	0	0	1,917	20.8
Time Delay Correction	0	-139	0	-139	-1.5
Grand Total	6,232	2,652	0	8,884	100.0
RA Sensible (Lights)	319	0	0	319	-

Engineering Checks For Cooling

Cooling tons	0.74	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.71	Volume (ft³)	7,241
cfm/ton	579		
ft²/ton	815		
Btu/h-ft²	14.72		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-878	0	-878	23.0
Other Roof	0	0	0	0	0.0
Glass	-1,511	0	0	-1,511	39.5
Door	0	0	0	0	0.0
Wall	0	-1,055	0	-1,055	27.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	191	0	191	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	105	0	105	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-1,511	-1,636	0	-3,148	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	206	0	0	206	-5.4
Internal Subtotal	206	0	0	206	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-826	0	0	-826	21.6
Time Delay Correction	0	-59	0	-59	1.5
Grand Total	-2,131	-1,696	0	-3,827	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.83	No People(max)	0.00
%OA	8	People per 1000 ft²	0
cfm/ft²	0.71	Volume (ft³)	7,241
cfm/Mbh	-112		
ft²/Mbh	-158		
Btu/h-ft²	-6.33		

Cooling Airflows

Main Fan cfm	429
Cooling ACH	3.55
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	429
Heating ACH	3.55
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	657
Other Roof	657
Ceiling	0
Window	63
Door	0
Wall	661
Below-Grade Wall	0
Other Wall	661
Partition	1,959
Exterior Floor	0
Internal Floor	0
Slab	657
Other Floor	0

ZONE_Utility

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 37.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	5,689	0	5,689	26.5
Other Roof	0	0	0	0	0.0
Glass	1,128	996	0	2,124	9.9
Door	0	0	0	0	0.0
Wall	0	183	0	183	0.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	3,652	0	3,652	17.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-243	0	-243	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	1,113	0	-332	781	3.6
Envelope Subtotal	2,241	10,277	-332	12,186	-
People	724	1,044	1,259	3,027	14.1
Lights	1,661	2,580	0	4,241	19.8
Miscellaneous Loads	247	0	0	247	1.2
Internal Subtotal	2,633	3,624	1,259	7,515	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-78	0	-78	-0.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-99	0	-99	-0.5
Grand Total	4,874	13,724	927	19,525	100.0
RA Sensible (Lights)	1,907	0	0	1,907	-

Engineering Checks For Cooling

Cooling tons	1.63	No People(max)	7.15
%OA	18	People per 1000 ft²	2
cfm/ft²	0.31	Volume (ft³)	35,118
cfm/ton	551		
ft²/ton	1,799		
Btu/h-ft²	6.67		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3,956	0	-3,956	46.1
Other Roof	0	0	0	0	0.0
Glass	-700	0	0	-700	8.2
Door	0	0	0	0	0.0
Wall	0	-144	0	-144	1.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,732	0	-1,732	20.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	403	0	403	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-2,044	0	0	-2,145	25.0
Envelope Subtotal	-2,744	-5,428	0	-8,274	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	82	0	0	82	-1.0
Internal Subtotal	82	0	0	82	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-356	0	-356	4.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-37	0	-37	0.4
Grand Total	-2,661	-5,821	0	-8,584	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-8.58	No People(max)	7.15
%OA	18	People per 1000 ft²	2
cfm/ft²	0.31	Volume (ft³)	35,118
cfm/Mbh	-104		
ft²/Mbh	-341		
Btu/h-ft²	-2.93		

Cooling Airflows

Main Fan cfm	897
Cooling ACH	1.53
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	897
Heating ACH	1.53
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100

Areas ft²

Roof	2,903
Other Roof	2,903
Ceiling	295
Window	28
Door	0
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

Zone Cooling and Heating Loads by Component

ZONE_ACT-Noisy-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 8/21 17:00:00
 Outside DB / WB / HR 94.0 °F / 63.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	470	444	0	914	31.5
Door	0	930	0	930	32.1
Wall	0	388	0	388	13.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-426	0	-426	-14.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	47	0	47	1.6
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-50	37	1.3
Envelope Subtotal	557	1,383	-50	1,890	-
People	377	570	719	1,666	57.5
Lights	166	281	0	447	15.4
Miscellaneous Loads	184	134	0	318	11.0
Internal Subtotal	727	985	719	2,431	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-780	0	-430	-1,210	-41.7
Ceiling	0	-330	0	-330	-11.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-71	0	-71	-2.5
Grand Total	503	1,967	239	2,710	100.0
RA Sensible (Lights)	190	0	0	190	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-193	0	0	-193	11.3
Door	0	-418	0	-418	24.4
Wall	0	-238	0	-238	13.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	110	0	110	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-195	0	0	-201	11.7
Envelope Subtotal	-388	-502	0	-896	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-579	0	0	-625	36.5
Ceiling	0	-177	0	-177	10.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.9
Grand Total	-967	-694	0	-1,714	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	119
Cooling ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	119
Heating ACH	3.31
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.06
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	16
Door	21
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.23	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/ton	527		
ft²/ton	796		
Btu/h-ft²	15.08		

Engineering Checks For Heating

Heating Mbh	-1.71	No People(max)	3.59
%OA	32	People per 1000 ft²	20
cfm/ft²	0.66	Volume (ft³)	2,156
cfm/Mbh	-69		
ft²/Mbh	-105		
Btu/h-ft²	-9.52		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 38 of 74

ZONE_ACT-Noisy-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	320	0	320	18.4
Wall	0	78	0	78	4.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-96	0	-96	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-42	0	-42	-2.4
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-45	31	1.8
Envelope Subtotal	76	260	-45	291	-
People	380	569	723	1,672	96.1
Lights	167	281	0	448	25.7
Miscellaneous Loads	185	134	0	319	18.3
Internal Subtotal	732	984	723	2,439	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-787	0	-383	-1,170	-67.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-11	0	-11	-0.7
Grand Total	20	1,234	296	1,550	100.0
RA Sensible (Lights)	191	0	0	191	-

Engineering Checks For Cooling

Cooling tons	0.13	No People(max)	3.61
%OA	63	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,170
cfm/ton	467		
ft²/ton	1,400		
Btu/h-ft²	8.57		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 93.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-416	0	-416	27.7
Wall	0	-123	0	-123	8.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-2.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-196	0	0	-202	13.4
Envelope Subtotal	-196	-461	0	-663	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-583	0	0	-628	41.8
Ceiling	0	-199	0	-199	13.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.8
Grand Total	-779	-672	0	-1,502	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.50	No People(max)	3.61
%OA	63	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,170
cfm/Mbh	-40		
ft²/Mbh	-120		
Btu/h-ft²	-8.33		

Cooling Airflows

Main Fan cfm	60
Cooling ACH	1.66
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	60
Heating ACH	1.66
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.05
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	0
Door	21
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 39 of 74

ZONE_ACT-Noisy-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 15:00:00
 Outside DB / WB / HR 98.8 °F / 66.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	81	36	0	117	6.4
Door	0	310	0	310	16.8
Wall	0	145	0	145	7.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-235	0	-235	-12.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-41	0	-41	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	109	0	-44	66	3.6
Envelope Subtotal	190	215	-44	362	-
People	382	555	729	1,666	90.5
Lights	168	274	0	442	24.0
Miscellaneous Loads	186	131	0	317	17.2
Internal Subtotal	737	960	729	2,425	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-793	0	-378	-1,171	-63.6
Ceiling	0	50	0	50	2.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-18	0	-18	-1.0
Grand Total	134	1,207	307	1,648	100.0
RA Sensible (Lights)	193	0	0	193	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	3.64
%OA	59	People per 1000 ft²	20
cfm/ft²	0.35	Volume (ft³)	2,186
cfm/ton	470		
ft²/ton	1,326		
Btu/h-ft²	9.05		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-91	0	0	-91	5.3
Door	0	-385	0	-385	22.3
Wall	0	-220	0	-220	12.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	119	0	119	-6.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	45	0	45	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	-197	0	0	-203	11.8
Envelope Subtotal	-288	-441	0	-736	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-587	0	0	-634	36.7
Ceiling	0	-345	0	-345	20.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-12	0	-12	0.7
Grand Total	-876	-799	0	-1,727	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.73	No People(max)	3.64
%OA	59	People per 1000 ft²	20
cfm/ft²	0.35	Volume (ft³)	2,186
cfm/Mbh	-37		
ft²/Mbh	-105		
Btu/h-ft²	-9.52		

Cooling Airflows

Main Fan cfm	65
Cooling ACH	1.78
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	65
Heating ACH	1.78
Sec Fan cfm	0
Input Ventilation cfm	38
Calculated Ventilation cfm	38
Calculated Ventilation ACH	1.04
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	8
Door	21
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ZONE_ACT-Quiet-1

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-48	0	-48	-5.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-45	32	3.3
Envelope Subtotal	77	-79	-45	-47	-
People	274	429	521	1,224	128.0
Lights	120	212	0	332	34.7
Miscellaneous Loads	133	101	0	234	24.5
Internal Subtotal	527	742	521	1,791	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-566	0	-389	-954	-99.8
Ceiling	0	33	0	33	3.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	-0.4
Grand Total	38	693	88	819	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	2.60
%OA	78	People per 1000 ft²	20
cfm/ft²	0.27	Volume (ft³)	1,564
cfm/ton	516		
ft²/ton	1,911		
Btu/h-ft²	6.28		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 91.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	7.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	23	0	23	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-145	18.1
Envelope Subtotal	-141	-36	0	-181	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-420	0	0	-450	56.2
Ceiling	0	-168	0	-168	21.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-561	-205	0	-800	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.80	No People(max)	2.60
%OA	78	People per 1000 ft²	20
cfm/ft²	0.27	Volume (ft³)	1,564
cfm/Mbh	-44		
ft²/Mbh	-163		
Btu/h-ft²	-6.13		

Cooling Airflows

Main Fan cfm	35
Cooling ACH	1.34
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	35
Heating ACH	1.34
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.04
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 41 of 74

ZONE_ACT-Quiet-2

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	167	136	0	304	23.3
Door	0	0	0	0	0.0
Wall	0	106	0	106	8.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-44	0	-44	-3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-44	0	-44	-3.4
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-44	33	2.6
Envelope Subtotal	244	156	-44	356	-
People	274	439	523	1,236	94.9
Lights	120	217	0	337	25.9
Miscellaneous Loads	134	103	0	237	18.2
Internal Subtotal	528	759	523	1,810	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-567	0	-376	-943	-72.4
Ceiling	0	-45	0	-45	-3.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-1.0
Grand Total	206	856	102	1,165	100.0
RA Sensible (Lights)	138	0	0	138	-

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.61
%OA	54	People per 1000 ft²	20
cfm/ft²	0.39	Volume (ft³)	1,568
cfm/ton	527		
ft²/ton	1,346		
Btu/h-ft²	8.92		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-95	0	0	-95	9.9
Door	0	0	0	0	0.0
Wall	0	-71	0	-71	7.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	6.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	26	0	26	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-146	15.1
Envelope Subtotal	-237	-104	0	-346	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-421	0	0	-456	47.3
Ceiling	0	-160	0	-160	16.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-658	-267	0	-964	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.96	No People(max)	2.61
%OA	54	People per 1000 ft²	20
cfm/ft²	0.39	Volume (ft³)	1,568
cfm/Mbh	-53		
ft²/Mbh	-136		
Btu/h-ft²	-7.35		

Cooling Airflows

Main Fan cfm	51
Cooling ACH	1.95
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	51
Heating ACH	1.95
Sec Fan cfm	0
Input Ventilation cfm	27
Calculated Ventilation cfm	27
Calculated Ventilation ACH	1.03
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 42 of 74

ZONE_ACT-Quiet-3

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	403	0	403	29.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-88	0	-88	-6.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-2.2
Other Floor	0	0	0	0	0.0
Infiltration	40	0	-32	8	0.6
Envelope Subtotal	40	285	-32	293	-
People	275	433	524	1,233	89.6
Lights	121	214	0	335	24.3
Miscellaneous Loads	134	102	0	236	17.2
Internal Subtotal	530	749	524	1,804	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-571	0	-269	-839	-61.0
Ceiling	0	-15	0	-15	-1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.4
Grand Total	-1	1,014	224	1,237	100.0
RA Sensible (Lights)	139	0	0	139	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 88.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-225	0	-225	23.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-14	0	-14	1.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-2.8
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-147	15.1
Envelope Subtotal	-142	-212	0	-358	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-423	0	0	-457	47.0
Ceiling	0	-156	0	-156	16.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-565	-368	0	-972	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	49
Cooling ACH	1.87
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	49
Heating ACH	1.87
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	1.07
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.10	No People(max)	2.62
%OA	56	People per 1000 ft²	20
cfm/ft²	0.37	Volume (ft³)	1,573
cfm/ton	473		
ft²/ton	1,272		
Btu/h-ft²	9.43		

Engineering Checks For Heating

Heating Mbh	-0.97	No People(max)	2.62
%OA	56	People per 1000 ft²	20
cfm/ft²	0.37	Volume (ft³)	1,573
cfm/Mbh	-50		
ft²/Mbh	-135		
Btu/h-ft²	-7.41		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 43 of 74

ZONE_Admin

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	60	0	60	3.2
Other Roof	0	0	0	0	0.0
Glass	330	346	0	676	36.1
Door	0	0	0	0	0.0
Wall	0	554	0	554	29.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-100	0	-100	-5.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-60	0	-60	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	112	0	-58	54	2.9
Envelope Subtotal	442	800	-58	1,184	-
People	199	271	379	849	45.3
Lights	122	187	0	309	16.5
Miscellaneous Loads	97	0	0	97	5.2
Internal Subtotal	418	458	379	1,255	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-431	0	-260	-691	-36.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.9
Grand Total	429	1,242	61	1,732	100.0
RA Sensible (Lights)	140	0	0	140	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	1.89
%OA	26	People per 1000 ft²	10
cfm/ft²	0.42	Volume (ft³)	2,272
cfm/ton	557		
ft²/ton	1,312		
Btu/h-ft²	9.15		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 84.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-222	0	-222	18.1
Other Roof	0	0	0	0	0.0
Glass	-195	0	0	-195	15.9
Door	0	0	0	0	0.0
Wall	0	-353	0	-353	28.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	39	0	39	-3.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	40	0	40	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-205	0	0	-213	17.3
Envelope Subtotal	-400	-496	0	-904	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	32	0	0	32	-2.6
Internal Subtotal	32	0	0	32	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-320	0	0	-352	28.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	0.4
Grand Total	-687	-501	0	-1,229	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.23	No People(max)	1.89
%OA	26	People per 1000 ft²	10
cfm/ft²	0.42	Volume (ft³)	2,272
cfm/Mbh	-65		
ft²/Mbh	-154		
Btu/h-ft²	-6.49		

Cooling Airflows

Main Fan cfm	80
Cooling ACH	2.11
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	80
Heating ACH	2.11
Sec Fan cfm	0
Input Ventilation cfm	21
Calculated Ventilation cfm	21
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 44 of 74

ZONE_Attrium

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	903	0	903	14.3
Other Roof	0	0	0	0	0.0
Glass	778	596	0	1,374	21.8
Door	0	0	0	0	0.0
Wall	0	1,669	0	1,669	26.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-45	0	-45	-0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	-93	0	-93	-1.5
Slab	0	9	0	9	0.1
Other Floor	0	0	0	0	0.0
Infiltration	619	0	-154	465	7.4
Envelope Subtotal	1,397	3,038	-154	4,282	-
People	621	821	982	2,423	38.4
Lights	700	957	0	1,658	26.3
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	1,321	1,779	982	4,081	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-2,233	0	-542	-2,775	-44.0
Ceiling	0	-306	0	-306	-4.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	271	0	0	271	4.3
Time Delay Correction	0	-44	0	-44	-0.7
Grand Total	757	4,466	286	5,508	100.0
RA Sensible (Lights)	804	0	0	804	-

Engineering Checks For Cooling

Cooling tons	0.46	No People(max)	6.33
%OA	43	People per 1000 ft²	5
cfm/ft²	0.20	Volume (ft³)	15,043
cfm/ton	547		
ft²/ton	2,760		
Btu/h-ft²	4.35		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 95.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-749	0	-749	11.0
Other Roof	0	0	0	0	0.0
Glass	-771	0	0	-771	11.3
Door	0	0	0	0	0.0
Wall	0	-1,744	0	-1,744	25.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-130	0	-130	1.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	83	0	83	-1.2
Slab	0	96	0	96	-1.4
Other Floor	0	0	0	0	0.0
Infiltration	-1,359	0	0	-1,403	20.6
Envelope Subtotal	-2,130	-2,444	0	-4,618	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,653	0	0	-1,790	26.3
Ceiling	0	-31	0	-31	0.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-344	0	0	-344	5.1
Time Delay Correction	0	-19	0	-19	0.3
Grand Total	-4,126	-2,494	0	-6,802	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-6.80	No People(max)	6.33
%OA	43	People per 1000 ft²	5
cfm/ft²	0.20	Volume (ft³)	15,043
cfm/Mbh	-37		
ft²/Mbh	-186		
Btu/h-ft²	-5.38		

Cooling Airflows

Main Fan cfm	251
Cooling ACH	1.00
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	251
Heating ACH	1.00
Sec Fan cfm	0
Input Ventilation cfm	108
Calculated Ventilation cfm	108
Calculated Ventilation ACH	0.43
Infiltration cfm	33
Min Stop/RH (%)	100

Areas

ft²	
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 45 of 74

ZONE_Chart/Hotel

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	19	0	19	1.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	69	0	69	5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-10	0	-10	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	60	0	-44	16	1.3
Envelope Subtotal	60	77	-44	93	-
People	210	275	399	884	73.2
Lights	129	190	0	319	26.4
Miscellaneous Loads	341	0	0	341	28.2
Internal Subtotal	679	466	399	1,544	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-455	0	-202	-657	-54.4
Ceiling	0	83	0	83	6.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	-0.2
Grand Total	284	623	153	1,060	100.0
RA Sensible (Lights)	148	0	0	148	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	2.00
%OA	50	People per 1000 ft²	10
cfm/ft²	0.22	Volume (ft³)	2,395
cfm/ton	494		
ft²/ton	2,259		
Btu/h-ft²	5.31		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 86.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-21	0	-21	2.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-92	0	-92	12.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	34	0	34	-4.5
Other Floor	0	0	0	0	0.0
Infiltration	-216	0	0	-223	29.2
Envelope Subtotal	-216	-79	0	-302	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	34	0	0	34	-4.5
Internal Subtotal	34	0	0	34	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-337	0	0	-364	47.8
Ceiling	0	-130	0	-130	17.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-519	-210	0	-763	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.76	No People(max)	2.00
%OA	50	People per 1000 ft²	10
cfm/ft²	0.22	Volume (ft³)	2,395
cfm/Mbh	-57		
ft²/Mbh	-262		
Btu/h-ft²	-3.82		

Cooling Airflows

Main Fan cfm	44
Cooling ACH	1.10
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	44
Heating ACH	1.10
Sec Fan cfm	0
Input Ventilation cfm	22
Calculated Ventilation cfm	22
Calculated Ventilation ACH	0.55
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Interior Floor	0
Slab	214
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 46 of 74

ZONE_Comfort/Consult

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	381	0	381	19.2
Other Roof	0	0	0	0	0.0
Glass	177	84	0	262	13.2
Door	0	0	0	0	0.0
Wall	0	372	0	372	18.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-246	0	-246	-12.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.5
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	177	561	0	738	-
People	298	411	567	1,276	64.3
Lights	313	487	0	800	40.3
Miscellaneous Loads	435	290	0	726	36.6
Internal Subtotal	1,046	1,188	567	2,801	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,499	0	-423	-1,922	-96.9
Ceiling	0	25	0	25	1.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-17	0	-17	-0.9
Grand Total	-275	1,756	144	1,625	100.0
RA Sensible (Lights)	360	0	0	360	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	2.83
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	3,402
cfm/ton	534		
ft²/ton	2,094		
Btu/h-ft²	5.73		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 100.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-285	0	-285	12.6
Other Roof	0	0	0	0	0.0
Glass	-291	0	0	-291	12.9
Door	0	0	0	0	0.0
Wall	0	-527	0	-527	23.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	88	0	88	-3.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	-291	-664	0	-955	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,109	0	0	-1,183	52.3
Ceiling	0	-117	0	-117	5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.4
Grand Total	-1,401	-789	0	-2,263	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.26	No People(max)	2.83
%OA	100	People per 1000 ft²	10
cfm/ft²	0.26	Volume (ft³)	3,402
cfm/Mbh	-32		
ft²/Mbh	-125		
Btu/h-ft²	-8.00		

Cooling Airflows

Main Fan cfm	72
Cooling ACH	1.27
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	72
Heating ACH	1.27
Sec Fan cfm	0
Input Ventilation cfm	72
Calculated Ventilation cfm	72
Calculated Ventilation ACH	1.27
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 47 of 74

ZONE_Corridor-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	736	350	0	1,085	58.7
Door	0	0	0	0	0.0
Wall	0	44	0	44	2.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	436	0	436	23.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	1.7
Other Floor	0	0	0	0	0.0
Infiltration	92	0	1	93	5.0
Envelope Subtotal	828	860	1	1,689	-
People	0	0	0	0	0.0
Lights	151	233	0	384	20.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	151	233	0	384	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-509	0	4	-505	-27.3
Ceiling	0	122	0	122	6.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	-0.8
Grand Total	469	1,200	5	1,675	100.0
RA Sensible (Lights)	173	0	0	173	-

Engineering Checks For Cooling

Cooling tons	0.14	No People(max)	0.00
%OA	31	People per 1000 ft²	0
cfm/ft²	0.20	Volume (ft³)	4,909
cfm/ton	576		
ft²/ton	2,931		
Btu/h-ft²	4.09		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 92.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-731	0	0	-731	38.8
Door	0	0	0	0	0.0
Wall	0	-63	0	-63	3.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-33	0	-33	1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	88	0	88	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-239	0	0	-248	13.1
Envelope Subtotal	-970	-9	0	-988	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-377	0	0	-413	21.9
Ceiling	0	-469	0	-469	24.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.8
Grand Total	-1,346	-493	0	-1,885	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.89	No People(max)	0.00
%OA	31	People per 1000 ft²	0
cfm/ft²	0.20	Volume (ft³)	4,909
cfm/Mbh	-43		
ft²/Mbh	-217		
Btu/h-ft²	-4.61		

Cooling Airflows

Main Fan cfm	80
Cooling ACH	0.98
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	80
Heating ACH	0.98
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.31
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 48 of 74

ZONE_Corridor-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 13:00:00
 Outside DB / WB / HR 88.4 °F / 57.7 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 21.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,828	1,915	0	3,743	115.7
Door	0	0	0	0	0.0
Wall	0	101	0	101	3.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-131	0	-131	-4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	103	0	103	3.2
Other Floor	0	0	0	0	0.0
Infiltration	77	0	-12	65	2.0
Envelope Subtotal	1,905	1,988	-12	3,881	-
People	0	0	0	0	0.0
Lights	153	231	0	383	11.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	153	231	0	383	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-512	0	-53	-565	-17.5
Ceiling	0	-562	0	-562	-17.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-76	0	-76	-2.4
Grand Total	1,546	1,581	-66	3,061	100.0
RA Sensible (Lights)	175	0	0	175	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	4,967
cfm/ton	594		
ft²/ton	1,623		
Btu/h-ft²	7.39		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-722	0	0	-722	38.6
Door	0	0	0	0	0.0
Wall	0	-66	0	-66	3.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-20	0	-20	1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	88	0	88	-4.7
Other Floor	0	0	0	0	0.0
Infiltration	-241	0	0	-252	13.5
Envelope Subtotal	-963	2	0	-971	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-381	0	0	-423	22.6
Ceiling	0	-461	0	-461	24.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-15	0	-15	0.8
Grand Total	-1,344	-473	0	-1,870	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.87	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.37	Volume (ft³)	4,967
cfm/Mbh	-81		
ft²/Mbh	-221		
Btu/h-ft²	-4.52		

Cooling Airflows

Main Fan cfm	152
Cooling ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	152
Heating ACH	1.84
Sec Fan cfm	0
Input Ventilation cfm	25
Calculated Ventilation cfm	25
Calculated Ventilation ACH	0.30
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

ZONE_Corridor-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	2,096	1,799	0	3,895	105.5
Door	0	0	0	0	0.0
Wall	0	103	0	103	2.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-286	0	-286	-7.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	466	0	466	12.6
Other Floor	0	0	0	0	0.0
Infiltration	86	0	1	87	2.4
Envelope Subtotal	2,182	2,082	1	4,266	-
People	0	0	0	0	0.0
Lights	119	193	0	313	8.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	119	193	0	313	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-403	0	5	-398	-10.8
Ceiling	0	-528	0	-528	-14.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-97	0	-97	-2.6
Grand Total	1,898	1,650	7	3,555	100.0
RA Sensible (Lights)	137	0	0	137	-

Engineering Checks For Cooling

Cooling tons	0.30	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	3,888
cfm/ton	577		
ft²/ton	1,094		
Btu/h-ft²	10.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-702	0	0	-702	43.3
Door	0	0	0	0	0.0
Wall	0	-62	0	-62	3.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-18	0	-18	1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	71	0	71	-4.4
Other Floor	0	0	0	0	0.0
Infiltration	-189	0	0	-198	12.2
Envelope Subtotal	-891	-9	0	-909	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-298	0	0	-333	20.6
Ceiling	0	-365	0	-365	22.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.8
Grand Total	-1,190	-388	0	-1,621	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.62	No People(max)	0.00
%OA	11	People per 1000 ft²	0
cfm/ft²	0.53	Volume (ft³)	3,888
cfm/Mbh	-106		
ft²/Mbh	-200		
Btu/h-ft²	-5.00		

Cooling Airflows

Main Fan cfm	171
Cooling ACH	2.64
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	171
Heating ACH	2.64
Sec Fan cfm	0
Input Ventilation cfm	19
Calculated Ventilation cfm	19
Calculated Ventilation ACH	0.29
Infiltration cfm	5
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 50 of 74

ZONE_Entry/Waiting

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 09:00:00
 Outside DB / WB / HR 81.8 °F / 61.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-99	0	-99	-1.0
Other Roof	0	0	0	0	0.0
Glass	5,296	5,935	0	11,231	113.9
Door	0	66	0	66	0.7
Wall	0	265	0	265	2.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,118	0	-1,118	-11.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	439	0	439	4.4
Other Floor	0	0	0	0	0.0
Infiltration	65	0	-22	43	0.4
Envelope Subtotal	5,361	5,488	-22	10,827	-
People	182	231	287	700	7.1
Lights	205	266	0	471	4.8
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	386	498	287	1,171	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-653	0	-75	-728	-7.4
Ceiling	0	-1,424	0	-1,424	-14.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-223	0	-223	-2.3
Grand Total	5,094	4,338	190	9,623	100.0
RA Sensible (Lights)	235	0	0	235	-

Engineering Checks For Cooling

Cooling tons	0.80	No People(max)	1.85
%OA	7	People per 1000 ft²	5
cfm/ft²	1.23	Volume (ft³)	4,445
cfm/ton	566		
ft²/ton	462		
Btu/h-ft²	25.97		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-54	0	-54	1.1
Other Roof	0	0	0	0	0.0
Glass	-2,568	0	0	-2,568	52.2
Door	0	-482	0	-482	9.8
Wall	0	-547	0	-547	11.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	462	0	462	-9.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	133	0	133	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-401	0	0	-420	8.5
Envelope Subtotal	-2,969	-486	0	-3,475	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-483	0	0	-542	11.0
Ceiling	0	-855	0	-855	17.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-48	0	-48	1.0
Grand Total	-3,452	-1,389	0	-4,920	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-4.92	No People(max)	1.85
%OA	7	People per 1000 ft²	5
cfm/ft²	1.23	Volume (ft³)	4,445
cfm/Mbh	-92		
ft²/Mbh	-75		
Btu/h-ft²	-13.33		

Cooling Airflows

Main Fan cfm	454
Cooling ACH	6.13
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	454
Heating ACH	6.13
Sec Fan cfm	0
Input Ventilation cfm	31
Calculated Ventilation cfm	31
Calculated Ventilation ACH	0.42
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	259
Door	28
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 51 of 74

ZONE_Exam/Storage

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	369	0	369	27.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-53	0	-53	-4.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-13	0	-13	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	30	0	-16	15	1.1
Envelope Subtotal	30	303	-16	317	-
People	182	244	347	773	57.9
Lights	182	276	0	458	34.3
Miscellaneous Loads	232	122	0	354	26.5
Internal Subtotal	596	643	347	1,586	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-776	0	-238	-1,014	-75.9
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	241	0	0	241	18.0
Time Delay Correction	0	-3	0	-3	-0.3
Grand Total	92	942	93	1,126	100.0
RA Sensible (Lights)	209	0	0	209	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	1.73
%OA	75	People per 1000 ft²	8
cfm/ft²	0.22	Volume (ft³)	2,685
cfm/ton	530		
ft²/ton	2,383		
Btu/h-ft²	5.04		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 94.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-265	0	-265	20.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	0	0	0	0.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-68	0	-68	5.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	38	0	38	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-109	0	0	-112	8.5
Envelope Subtotal	-109	-295	0	-407	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	4	0	0	4	-0.3
Internal Subtotal	4	0	0	4	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-574	0	0	-611	46.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-296	0	0	-296	22.6
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-975	-296	0	-1,311	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.31	No People(max)	1.73
%OA	75	People per 1000 ft²	8
cfm/ft²	0.22	Volume (ft³)	2,685
cfm/Mbh	-38		
ft²/Mbh	-171		
Btu/h-ft²	-5.85		

Cooling Airflows

Main Fan cfm	50
Cooling ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	50
Heating ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	37
Calculated Ventilation cfm	37
Calculated Ventilation ACH	0.83
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 52 of 74

ZONE_Group

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	237	0	237	15.3
Other Roof	0	0	0	0	0.0
Glass	135	67	0	202	13.0
Door	0	0	0	0	0.0
Wall	0	299	0	299	19.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-187	0	-187	-12.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-2.1
Other Floor	0	0	0	0	0.0
Infiltration	116	0	-62	54	3.5
Envelope Subtotal	251	382	-62	571	-
People	553	800	1,106	2,459	158.8
Lights	191	290	0	481	31.1
Miscellaneous Loads	283	185	0	468	30.2
Internal Subtotal	1,027	1,275	1,106	3,408	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,891	0	-831	-2,721	-175.7
Ceiling	0	93	0	93	6.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-21	0	-21	-1.4
Grand Total	-613	1,729	213	1,329	100.0
RA Sensible (Lights)	219	0	0	219	-

Engineering Checks For Cooling

Cooling tons	0.11	No People(max)	5.52
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	3,317
cfm/ton	823		
ft²/ton	2,495		
Btu/h-ft²	4.81		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 3.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 121.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-149	0	-149	5.1
Other Roof	0	0	0	0	0.0
Glass	-196	0	0	-196	6.7
Door	0	0	0	0	0.0
Wall	0	-470	0	-470	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	96	0	96	-3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	68	0	68	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-299	0	0	-305	10.5
Envelope Subtotal	-495	-455	0	-956	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,400	0	0	-1,465	50.4
Ceiling	0	-477	0	-477	16.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	0.3
Grand Total	-1,895	-940	0	-2,906	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.91	No People(max)	5.52
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	3,317
cfm/Mbh	-31		
ft²/Mbh	-95		
Btu/h-ft²	-10.53		

Cooling Airflows

Main Fan cfm	91
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	91
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	91
Calculated Ventilation cfm	91
Calculated Ventilation ACH	1.65
Infiltration cfm	7
Min Stop/RH (%)	100

Areas

ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 53 of 74

ZONE_Hospitality

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 49.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 60.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	186	0	186	13.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	310	0	310	23.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	50	0	50	3.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-26	0	-26	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	122	0	-63	58	4.4
Envelope Subtotal	122	519	-63	577	-
People	492	696	984	2,173	163.1
Lights	170	257	0	427	32.1
Miscellaneous Loads	252	163	0	415	31.2
Internal Subtotal	914	1,117	984	3,015	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,683	0	-856	-2,539	-190.6
Ceiling	0	92	0	92	6.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.6
Grand Total	-647	1,719	65	1,137	100.0
RA Sensible (Lights)	195	0	0	195	-

Engineering Checks For Cooling

Cooling tons	0.09	No People(max)	4.92
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,953
cfm/ton	857		
ft²/ton	2,598		
Btu/h-ft²	4.62		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 3.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 104.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-130	0	-130	5.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-441	0	-441	16.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-88	0	-88	3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	61	0	61	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-266	0	0	-273	10.4
Envelope Subtotal	-266	-598	0	-870	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,246	0	0	-1,321	50.5
Ceiling	0	-422	0	-422	16.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.1
Grand Total	-1,512	-1,023	0	-2,616	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.62	No People(max)	4.92
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,953
cfm/Mbh	-31		
ft²/Mbh	-94		
Btu/h-ft²	-10.64		

Cooling Airflows

Main Fan cfm	81
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	81
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	81
Calculated Ventilation cfm	81
Calculated Ventilation ACH	1.65
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

ZONE_Intake-HR-A

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 40.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	126	0	126	3.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	823	0	823	23.1
Wall	0	788	0	788	22.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-185	0	-185	-5.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-28	0	-28	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	96	0	-38	59	1.7
Envelope Subtotal	96	1,525	-38	1,584	-
People	404	557	720	1,681	47.2
Lights	354	532	0	887	24.9
Miscellaneous Loads	362	233	0	595	16.7
Internal Subtotal	1,121	1,323	720	3,163	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,434	0	-654	-2,088	-58.7
Ceiling	0	39	0	39	1.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	490	0	0	490	13.8
Time Delay Correction	0	-35	0	-35	-1.0
Grand Total	274	2,851	28	3,153	100.0
RA Sensible (Lights)	407	0	0	407	-

Engineering Checks For Cooling

Cooling tons	0.26	No People(max)	3.96
%OA	46	People per 1000 ft²	8
cfm/ft²	0.32	Volume (ft³)	5,646
cfm/ton	573		
ft²/ton	1,791		
Btu/h-ft²	6.70		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 93.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-457	0	-457	12.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-498	0	-498	13.4
Wall	0	-729	0	-729	19.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	37	0	37	-1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	101	0	101	-2.7
Other Floor	0	0	0	0	0.0
Infiltration	-177	0	0	-183	4.9
Envelope Subtotal	-177	-1,546	0	-1,729	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,065	0	0	-1,154	31.2
Ceiling	0	-238	0	-238	6.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-566	0	0	-566	15.3
Time Delay Correction	0	-17	0	-17	0.5
Grand Total	-1,808	-1,801	0	-3,704	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.70	No People(max)	3.96
%OA	46	People per 1000 ft²	8
cfm/ft²	0.32	Volume (ft³)	5,646
cfm/Mbh	-41		
ft²/Mbh	-127		
Btu/h-ft²	-7.87		

Cooling Airflows

Main Fan cfm	151
Cooling ACH	1.60
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	151
Heating ACH	1.60
Sec Fan cfm	0
Input Ventilation cfm	69
Calculated Ventilation cfm	69
Calculated Ventilation ACH	0.73
Infiltration cfm	4
Min Stop/RH (%)	100

Areas

ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	0
Door	26
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 55 of 74

ZONE_Intake-HR-B

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	273	0	273	27.5
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	27	0	27	2.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-5	0	-5	-0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-9	0	-9	-0.9
Other Floor	0	0	0	0	0.0
Infiltration	24	0	-12	12	1.2
Envelope Subtotal	24	285	-12	297	-
People	130	181	248	560	56.3
Lights	130	203	0	333	33.5
Miscellaneous Loads	163	86	0	249	25.1
Internal Subtotal	423	470	248	1,141	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-544	0	-163	-706	-71.1
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	115	0	0	115	11.5
Time Delay Correction	0	-2	0	-2	-0.2
Grand Total	19	752	73	845	100.0
RA Sensible (Lights)	149	0	0	149	-

Engineering Checks For Cooling

Cooling tons	0.07	No People(max)	1.24
%OA	71	People per 1000 ft²	8
cfm/ft²	0.23	Volume (ft³)	1,976
cfm/ton	527		
ft²/ton	2,339		
Btu/h-ft²	5.13		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 94.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-198	0	-198	20.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-48	0	-48	5.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-77	0	-77	8.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	30	0	30	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-88	0	0	-90	9.5
Envelope Subtotal	-88	-292	0	-382	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	3	0	0	3	-0.4
Internal Subtotal	3	0	0	3	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-402	0	0	-431	45.5
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-136	0	0	-136	14.4
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-623	-293	0	-947	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.95	No People(max)	1.24
%OA	71	People per 1000 ft²	8
cfm/ft²	0.23	Volume (ft³)	1,976
cfm/Mbh	-39		
ft²/Mbh	-174		
Btu/h-ft²	-5.75		

Cooling Airflows

Main Fan cfm	37
Cooling ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	37
Heating ACH	1.12
Sec Fan cfm	0
Input Ventilation cfm	26
Calculated Ventilation cfm	26
Calculated Ventilation ACH	0.79
Infiltration cfm	2
Min Stop/RH (%)	100

Areas

ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 56 of 74

ZONE_Kitchen

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 16:00:00
 Outside DB / WB / HR 96.5 °F / 63.6 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 64.1 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,093	0	1,093	3.4
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	1,174	0	1,174	3.7
Wall	0	1,236	0	1,236	3.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,408	0	-1,408	-4.4
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-380	0	-380	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	373	0	-215	159	0.5
Envelope Subtotal	373	1,716	-215	1,874	-
People	1,375	1,908	3,197	6,480	20.3
Lights	365	571	0	936	2.9
Miscellaneous Loads	13,334	8,907	0	22,241	69.7
Internal Subtotal	15,074	11,386	3,197	29,657	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-49	0	-49	-0.2
Grand Total	15,447	13,053	2,983	31,483	100.0
RA Sensible (Lights)	419	0	0	419	-

Engineering Checks For Cooling

Cooling tons	2.62	No People(max)	13.10
%OA	0	People per 1000 ft²	19
cfm/ft²	3.69	Volume (ft³)	8,226
cfm/ton	965		
ft²/ton	261		
Btu/h-ft²	45.98		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 75.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-760	0	-760	21.6
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-966	0	-966	27.4
Wall	0	-964	0	-964	27.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-201	0	-201	5.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	163	0	163	-4.6
Other Floor	0	0	0	0	0.0
Infiltration	-742	0	0	-780	22.2
Envelope Subtotal	-742	-2,729	0	-3,509	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	13	0	0	13	-0.4
Internal Subtotal	13	0	0	13	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-26	0	-26	0.7
Grand Total	-729	-2,755	0	-3,522	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.52	No People(max)	13.10
%OA	0	People per 1000 ft²	19
cfm/ft²	3.69	Volume (ft³)	8,226
cfm/Mbh	-719		
ft²/Mbh	-195		
Btu/h-ft²	-5.13		

Cooling Airflows

Main Fan cfm	2,532
Cooling ACH	18.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	18
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	2,532
Heating ACH	18.47
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	18
Min Stop/RH (%)	100

Areas

	ft²
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 57 of 74

ZONE_Lounge

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 15:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	198	0	198	5.7
Other Roof	0	0	0	0	0.0
Glass	323	316	0	639	18.5
Door	0	688	0	688	20.0
Wall	0	616	0	616	17.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-239	0	-239	-6.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-78	0	-78	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	175	0	-93	82	2.4
Envelope Subtotal	498	1,501	-93	1,906	-
People	589	844	1,098	2,531	73.5
Lights	182	274	0	456	13.2
Miscellaneous Loads	202	131	0	333	9.7
Internal Subtotal	974	1,248	1,098	3,320	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,349	0	-842	-2,191	-63.6
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	251	0	0	251	7.3
Time Delay Correction	0	-49	0	-49	-1.4
Grand Total	374	2,700	162	3,236	100.0
RA Sensible (Lights)	209	0	0	209	-

Engineering Checks For Cooling

Cooling tons	0.27	No People(max)	5.93
%OA	44	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	3,561
cfm/ton	549		
ft²/ton	1,101		
Btu/h-ft²	10.90		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 87.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-340	0	-340	12.1
Other Roof	0	0	0	0	0.0
Glass	-196	0	0	-196	7.0
Door	0	-403	0	-403	14.3
Wall	0	-376	0	-376	13.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	94	0	94	-3.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	65	0	65	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-321	0	0	-332	11.8
Envelope Subtotal	-518	-960	0	-1,489	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,002	0	0	-1,088	38.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-222	0	0	-222	7.9
Time Delay Correction	0	-16	0	-16	0.6
Grand Total	-1,741	-976	0	-2,815	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.81	No People(max)	5.93
%OA	44	People per 1000 ft²	20
cfm/ft²	0.50	Volume (ft³)	3,561
cfm/Mbh	-53		
ft²/Mbh	-105		
Btu/h-ft²	-9.52		

Cooling Airflows

Main Fan cfm	148
Cooling ACH	2.49
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	148
Heating ACH	2.49
Sec Fan cfm	0
Input Ventilation cfm	65
Calculated Ventilation cfm	65
Calculated Ventilation ACH	1.10
Infiltration cfm	8
Min Stop/RH (%)	100

Areas

ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	16
Door	21
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

ZONE_Multipurpose/Dining

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 16:00:00
 Outside DB / WB / HR 96.9 °F / 66.1 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	382	0	382	14.8
Other Roof	0	0	0	0	0.0
Glass	212	98	0	310	12.0
Door	0	276	0	276	10.7
Wall	0	333	0	333	12.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-310	0	-310	-12.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-52	0	-52	-2.0
Other Floor	0	0	0	0	0.0
Infiltration	269	0	-109	161	6.2
Envelope Subtotal	481	727	-109	1,100	-
People	971	1,281	1,942	4,194	162.8
Lights	335	480	0	815	31.6
Miscellaneous Loads	497	305	0	802	31.1
Internal Subtotal	1,803	2,066	1,942	5,811	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-3,320	0	-1,478	-4,798	-186.2
Ceiling	0	117	0	117	4.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-38	0	-38	-1.5
Grand Total	-1,035	2,872	355	2,191	100.0
RA Sensible (Lights)	385	0	0	385	-

Engineering Checks For Cooling

Cooling tons	0.18	No People(max)	9.70
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	5,825
cfm/ton	877		
ft²/ton	2,658		
Btu/h-ft²	4.51		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 3.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 124.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-270	0	-270	5.4
Other Roof	0	0	0	0	0.0
Glass	-295	0	0	-295	5.9
Door	0	-416	0	-416	8.3
Wall	0	-470	0	-470	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	182	0	182	-3.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	124	0	124	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	-526	0	0	-535	10.6
Envelope Subtotal	-821	-852	0	-1,682	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-2,458	0	0	-2,568	51.0
Ceiling	0	-766	0	-766	15.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-22	0	-22	0.4
Grand Total	-3,279	-1,639	0	-5,038	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-5.04	No People(max)	9.70
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	5,825
cfm/Mbh	-32		
ft²/Mbh	-96		
Btu/h-ft²	-10.42		

Cooling Airflows

Main Fan cfm	160
Cooling ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	160
Heating ACH	1.65
Sec Fan cfm	0
Input Ventilation cfm	160
Calculated Ventilation cfm	160
Calculated Ventilation ACH	1.65
Infiltration cfm	13
Min Stop/RH (%)	100

Areas

ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	23
Door	21
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 59 of 74

ZONE_RB-N-Corner

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	272	314	0	587	23.5
Door	0	0	0	0	0.0
Wall	0	539	0	539	21.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-144	0	-144	-5.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-12	0	-12	-0.5
Other Floor	0	0	0	0	0.0
Infiltration	55	0	-20	34	1.4
Envelope Subtotal	327	697	-20	1,004	-
People	151	219	359	728	29.1
Lights	144	254	0	398	15.9
Miscellaneous Loads	356	404	0	760	30.4
Internal Subtotal	651	877	359	1,886	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-297	0	-90	-388	-15.5
Ceiling	0	-149	0	-149	-5.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.8
Grand Total	680	1,406	248	2,335	100.0
RA Sensible (Lights)	166	0	0	166	-

Engineering Checks For Cooling

Cooling tons	0.19	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.77	Volume (ft³)	1,565
cfm/ton	516		
ft²/ton	671		
Btu/h-ft²	17.88		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-128	0	0	-128	12.0
Door	0	0	0	0	0.0
Wall	0	-486	0	-486	45.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	46	0	46	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-147	13.9
Envelope Subtotal	-269	-409	0	-684	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-220	0	0	-245	23.0
Ceiling	0	-132	0	-132	12.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-489	-544	0	-1,064	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.06	No People(max)	1.30
%OA	14	People per 1000 ft²	10
cfm/ft²	0.77	Volume (ft³)	1,565
cfm/Mbh	-94		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Cooling Airflows

Main Fan cfm	100
Cooling ACH	3.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	100
Heating ACH	3.83
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 60 of 74

ZONE_RB-N-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	484	558	0	1,042	24.7
Door	0	0	0	0	0.0
Wall	0	619	0	619	14.6
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-215	0	-215	-5.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-44	0	-44	-1.0
Other Floor	0	0	0	0	0.0
Infiltration	80	0	-49	31	0.7
Envelope Subtotal	564	918	-49	1,433	-
People	297	306	707	1,310	31.0
Lights	284	427	0	711	16.8
Miscellaneous Loads	702	679	0	1,381	32.7
Internal Subtotal	1,283	1,412	707	3,402	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-586	0	-223	-809	-19.1
Ceiling	0	-92	0	-92	-2.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-33	0	-33	-0.8
Grand Total	1,261	2,205	435	3,900	100.0
RA Sensible (Lights)	326	0	0	326	-

Engineering Checks For Cooling

Cooling tons	0.33	No People(max)	2.57
%OA	17	People per 1000 ft²	10
cfm/ft²	0.65	Volume (ft³)	3,084
cfm/ton	513		
ft²/ton	791		
Btu/h-ft²	15.17		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 80.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3	0	-3	0.1
Other Roof	0	0	0	0	0.0
Glass	-258	0	0	-258	13.4
Door	0	0	0	0	0.0
Wall	0	-693	0	-693	36.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	44	0	44	-2.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	59	0	59	-3.1
Other Floor	0	0	0	0	0.0
Infiltration	-278	0	0	-290	15.1
Envelope Subtotal	-536	-593	0	-1,141	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-434	0	0	-482	25.0
Ceiling	0	-294	0	-294	15.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	0.3
Grand Total	-970	-893	0	-1,923	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.92	No People(max)	2.57
%OA	17	People per 1000 ft²	10
cfm/ft²	0.65	Volume (ft³)	3,084
cfm/Mbh	-87		
ft²/Mbh	-134		
Btu/h-ft²	-7.46		

Cooling Airflows

Main Fan cfm	167
Cooling ACH	3.25
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	167
Heating ACH	3.25
Sec Fan cfm	0
Input Ventilation cfm	28
Calculated Ventilation cfm	28
Calculated Ventilation ACH	0.54
Infiltration cfm	7
Min Stop/RH (%)	100

Areas ft²

Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 61 of 74

ZONE_RB-N-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 45.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	804	960	0	1,763	25.3
Door	0	0	0	0	0.0
Wall	0	1,095	0	1,095	15.7
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-456	0	-456	-6.6
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-48	0	-48	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	160	0	-60	100	1.4
Envelope Subtotal	964	1,551	-60	2,455	-
People	442	647	1,052	2,141	30.8
Lights	423	752	0	1,175	16.9
Miscellaneous Loads	1,044	1,196	0	2,240	32.2
Internal Subtotal	1,909	2,595	1,052	5,555	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-872	0	-270	-1,142	-16.4
Ceiling	0	-337	0	-337	-4.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-57	0	-57	-0.8
Grand Total	2,000	3,751	722	6,473	100.0
RA Sensible (Lights)	486	0	0	486	-

Engineering Checks For Cooling

Cooling tons	0.54	No People(max)	3.83
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	4,590
cfm/ton	513		
ft²/ton	709		
Btu/h-ft²	16.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-399	0	0	-399	15.8
Door	0	0	0	0	0.0
Wall	0	-607	0	-607	23.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-17	0	-17	0.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	82	0	82	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-414	0	0	-432	17.1
Envelope Subtotal	-814	-542	0	-1,373	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-646	0	0	-718	28.3
Ceiling	0	-433	0	-433	17.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.4
Grand Total	-1,459	-983	0	-2,533	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.53	No People(max)	3.83
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	4,590
cfm/Mbh	-109		
ft²/Mbh	-151		
Btu/h-ft²	-6.62		

Cooling Airflows

Main Fan cfm	277
Cooling ACH	3.62
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	277
Heating ACH	3.62
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 62 of 74

ZONE_RB-S-Corner-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 14:00:00
 Outside DB / WB / HR 98.4 °F / 64.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 44.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	101	100	0	201	9.6
Door	0	0	0	0	0.0
Wall	0	627	0	627	29.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-94	0	-94	-4.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-68	0	-68	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	76	0	-41	35	1.7
Envelope Subtotal	177	565	-41	701	-
People	149	190	355	694	33.0
Lights	143	246	0	389	18.5
Miscellaneous Loads	352	391	0	744	35.3
Internal Subtotal	644	827	355	1,826	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-293	0	-187	-480	-22.8
Ceiling	0	-93	0	-93	-4.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-13	0	-13	-0.6
Grand Total	528	1,287	127	1,941	100.0
RA Sensible (Lights)	164	0	0	164	-

Engineering Checks For Cooling

Cooling tons	0.16	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.68	Volume (ft³)	1,549
cfm/ton	540		
ft²/ton	798		
Btu/h-ft²	15.04		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.4 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-125	0	0	-125	11.8
Door	0	0	0	0	0.0
Wall	0	-490	0	-490	46.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	50	0	50	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	31	0	31	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-140	0	0	-146	13.9
Envelope Subtotal	-264	-408	0	-679	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-218	0	0	-242	23.0
Ceiling	0	-129	0	-129	12.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-482	-541	0	-1,053	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.05	No People(max)	1.29
%OA	16	People per 1000 ft²	10
cfm/ft²	0.68	Volume (ft³)	1,549
cfm/Mbh	-83		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Cooling Airflows

Main Fan cfm	87
Cooling ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	87
Heating ACH	3.37
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 63 of 74

ZONE_RB-S-Corner-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 9/21 17:00:00
 Outside DB / WB / HR 94.1 °F / 62.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.8 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	281	290	0	570	22.6
Door	0	0	0	0	0.0
Wall	0	725	0	725	28.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-150	0	-150	-6.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	6	0	6	0.2
Other Floor	0	0	0	0	0.0
Infiltration	64	0	-42	22	0.9
Envelope Subtotal	344	870	-42	1,172	-
People	152	213	361	726	28.8
Lights	145	256	0	401	15.9
Miscellaneous Loads	358	407	0	765	30.4
Internal Subtotal	655	876	361	1,892	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-298	0	-187	-486	-19.3
Ceiling	0	-205	0	-205	-8.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-20	0	-20	-0.8
Grand Total	701	1,522	132	2,354	100.0
RA Sensible (Lights)	167	0	0	167	-

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-128	0	0	-128	11.9
Door	0	0	0	0	0.0
Wall	0	-492	0	-492	46.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	46	0	46	-4.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-142	0	0	-149	13.9
Envelope Subtotal	-270	-414	0	-690	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-222	0	0	-247	23.0
Ceiling	0	-131	0	-131	12.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.3
Grand Total	-491	-548	0	-1,071	100.0
RA Sensible (Lights)	0	0	0	0	-

Cooling Airflows

Main Fan cfm	107
Cooling ACH	4.08
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	107
Heating ACH	4.08
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.53
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.82	Volume (ft³)	1,575
cfm/ton	545		
ft²/ton	669		
Btu/h-ft²	17.94		

Engineering Checks For Heating

Heating Mbh	-1.07	No People(max)	1.31
%OA	13	People per 1000 ft²	10
cfm/ft²	0.82	Volume (ft³)	1,575
cfm/Mbh	-100		
ft²/Mbh	-123		
Btu/h-ft²	-8.13		

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 64 of 74

ZONE_RB-S-East

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 10:00:00
 Outside DB / WB / HR 87.0 °F / 63.0 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	720	793	0	1,513	25.3
Door	0	0	0	0	0.0
Wall	0	667	0	667	11.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-283	0	-283	-4.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-47	0	-47	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	115	0	-72	44	0.7
Envelope Subtotal	836	1,129	-72	1,893	-
People	430	450	1,023	1,902	31.8
Lights	411	624	0	1,035	17.3
Miscellaneous Loads	1,015	993	0	2,008	33.6
Internal Subtotal	1,856	2,067	1,023	4,946	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-848	0	-325	-1,174	-19.6
Ceiling	0	-109	0	-109	-1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-49	0	-49	-0.8
Grand Total	1,844	3,038	625	5,507	100.0
RA Sensible (Lights)	472	0	0	472	-

Engineering Checks For Cooling

Cooling tons	0.46	No People(max)	3.72
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	4,463
cfm/ton	512		
ft²/ton	810		
Btu/h-ft²	14.81		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.6 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-387	0	0	-387	16.2
Door	0	0	0	0	0.0
Wall	0	-528	0	-528	22.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-5	0	-5	0.2
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	78	0	78	-3.3
Other Floor	0	0	0	0	0.0
Infiltration	-403	0	0	-420	17.6
Envelope Subtotal	-789	-455	0	-1,261	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-628	0	0	-696	29.1
Ceiling	0	-423	0	-423	17.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-9	0	-9	0.4
Grand Total	-1,417	-886	0	-2,389	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.39	No People(max)	3.72
%OA	17	People per 1000 ft²	10
cfm/ft²	0.63	Volume (ft³)	4,463
cfm/Mbh	-98		
ft²/Mbh	-156		
Btu/h-ft²	-6.41		

Cooling Airflows

Main Fan cfm	235
Cooling ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	235
Heating ACH	3.16
Sec Fan cfm	0
Input Ventilation cfm	41
Calculated Ventilation cfm	41
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 65 of 74

ZONE_RB-S-West

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.5 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	274	319	0	593	26.8
Door	0	0	0	0	0.0
Wall	0	359	0	359	16.2
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-193	0	-193	-8.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-15	0	-15	-0.7
Other Floor	0	0	0	0	0.0
Infiltration	52	0	-23	29	1.3
Envelope Subtotal	325	470	-23	773	-
People	143	211	341	695	31.4
Lights	137	245	0	382	17.2
Miscellaneous Loads	338	390	0	728	32.9
Internal Subtotal	619	845	341	1,805	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-283	0	-103	-386	-17.4
Ceiling	0	-114	0	-114	-5.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.9
Grand Total	661	1,182	215	2,059	100.0
RA Sensible (Lights)	157	0	0	157	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	1,488
cfm/ton	517		
ft²/ton	723		
Btu/h-ft²	16.60		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.8 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-129	0	0	-129	15.6
Door	0	0	0	0	0.0
Wall	0	-199	0	-199	24.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-10	0	-10	1.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	27	0	27	-3.2
Other Floor	0	0	0	0	0.0
Infiltration	-134	0	0	-140	17.0
Envelope Subtotal	-263	-182	0	-451	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-209	0	0	-233	28.2
Ceiling	0	-140	0	-140	16.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.4
Grand Total	-473	-325	0	-826	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.83	No People(max)	1.24
%OA	15	People per 1000 ft²	10
cfm/ft²	0.72	Volume (ft³)	1,488
cfm/Mbh	-107		
ft²/Mbh	-150		
Btu/h-ft²	-6.67		

Cooling Airflows

Main Fan cfm	89
Cooling ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	3.59
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.56
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 66 of 74

ZONE_RB-W-North

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 46.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	195	101	0	295	13.1
Door	0	0	0	0	0.0
Wall	0	611	0	611	27.1
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-141	0	-141	-6.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-24	0	-24	-1.1
Other Floor	0	0	0	0	0.0
Infiltration	54	0	-24	30	1.3
Envelope Subtotal	249	547	-24	771	-
People	150	214	357	721	31.9
Lights	143	249	0	392	17.4
Miscellaneous Loads	354	396	0	750	33.2
Internal Subtotal	648	859	357	1,863	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-296	0	-109	-405	-18.0
Ceiling	0	-118	0	-118	-5.2
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-19	0	-19	-0.9
Grand Total	601	1,268	223	2,092	100.0
RA Sensible (Lights)	165	0	0	165	-

Engineering Checks For Cooling

Cooling tons	0.17	No People(max)	1.30
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,557
cfm/ton	516		
ft²/ton	745		
Btu/h-ft²	16.11		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 81.7 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-212	0	0	-212	19.0
Door	0	0	0	0	0.0
Wall	0	-470	0	-470	42.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	61	0	61	-5.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	32	0	32	-2.9
Other Floor	0	0	0	0	0.0
Infiltration	-141	0	0	-147	13.2
Envelope Subtotal	-352	-377	0	-735	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-219	0	0	-243	21.9
Ceiling	0	-129	0	-129	11.6
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-4	0	-4	0.4
Grand Total	-571	-511	0	-1,112	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-1.11	No People(max)	1.30
%OA	16	People per 1000 ft²	10
cfm/ft²	0.69	Volume (ft³)	1,557
cfm/Mbh	-81		
ft²/Mbh	-117		
Btu/h-ft²	-8.55		

Cooling Airflows

Main Fan cfm	90
Cooling ACH	3.47
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	90
Heating ACH	3.47
Sec Fan cfm	0
Input Ventilation cfm	14
Calculated Ventilation cfm	14
Calculated Ventilation ACH	0.54
Infiltration cfm	3
Min Stop/RH (%)	100

Areas

ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 67 of 74

ZONE_RB-W-South

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 10/21 14:00:00
 Outside DB / WB / HR 89.8 °F / 58.2 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 39.7 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	1,343	1,629	0	2,972	43.2
Door	0	0	0	0	0.0
Wall	0	1,033	0	1,033	15.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-418	0	-418	-6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-170	0	-170	-2.5
Other Floor	0	0	0	0	0.0
Infiltration	143	0	-174	-31	-0.4
Envelope Subtotal	1,487	2,075	-174	3,387	-
People	438	564	1,044	2,046	29.7
Lights	420	723	0	1,142	16.6
Miscellaneous Loads	1,036	1,152	0	2,188	31.8
Internal Subtotal	1,894	2,438	1,044	5,375	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-860	0	-772	-1,632	-23.7
Ceiling	0	-646	0	-646	-9.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-86	0	-86	-1.2
Grand Total	2,521	3,781	98	6,400	100.0
RA Sensible (Lights)	482	0	0	482	-

Engineering Checks For Cooling

Cooling tons	0.53	No People(max)	3.80
%OA	14	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	4,554
cfm/ton	569		
ft²/ton	712		
Btu/h-ft²	16.85		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	-667	0	0	-667	22.6
Door	0	0	0	0	0.0
Wall	0	-848	0	-848	28.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	53	0	53	-1.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	88	0	88	-3.0
Other Floor	0	0	0	0	0.0
Infiltration	-411	0	0	-429	14.6
Envelope Subtotal	-1,078	-707	0	-1,803	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-641	0	0	-713	24.2
Ceiling	0	-414	0	-414	14.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-14	0	-14	0.5
Grand Total	-1,718	-1,135	0	-2,944	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.94	No People(max)	3.80
%OA	14	People per 1000 ft²	10
cfm/ft²	0.80	Volume (ft³)	4,554
cfm/Mbh	-103		
ft²/Mbh	-129		
Btu/h-ft²	-7.75		

Cooling Airflows

Main Fan cfm	304
Cooling ACH	4.01
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	304
Heating ACH	4.01
Sec Fan cfm	0
Input Ventilation cfm	42
Calculated Ventilation cfm	42
Calculated Ventilation ACH	0.55
Infiltration cfm	10
Min Stop/RH (%)	100

Areas ft²

Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Interior Floor	0
Slab	414
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 68 of 74

ZONE_Servery

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 17:00:00
 Outside DB / WB / HR 94.5 °F / 65.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 48.4 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	190	0	190	16.2
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	186	0	186	15.9
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-62	0	-62	-5.3
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-30	0	-30	-2.6
Other Floor	0	0	0	0	0.0
Infiltration	113	0	-52	61	5.2
Envelope Subtotal	113	284	-52	345	-
People	456	665	913	2,035	173.8
Lights	158	245	0	403	34.4
Miscellaneous Loads	234	156	0	389	33.3
Internal Subtotal	848	1,066	913	2,827	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,561	0	-699	-2,260	-193.0
Ceiling	0	86	0	86	7.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.7
Grand Total	-600	1,428	162	990	100.0
RA Sensible (Lights)	181	0	0	181	-

Engineering Checks For Cooling

Cooling tons	0.08	No People(max)	4.56
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,738
cfm/ton	913		
ft²/ton	2,767		
Btu/h-ft²	4.34		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 3.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 122.9 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-128	0	-128	5.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-276	0	-276	12.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-12	0	-12	0.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	52	0	52	-2.3
Other Floor	0	0	0	0	0.0
Infiltration	-247	0	0	-251	11.3
Envelope Subtotal	-247	-363	0	-614	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-1,156	0	0	-1,206	54.4
Ceiling	0	-393	0	-393	17.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-3	0	-3	0.2
Grand Total	-1,403	-760	0	-2,217	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-2.22	No People(max)	4.56
%OA	100	People per 1000 ft²	20
cfm/ft²	0.33	Volume (ft³)	2,738
cfm/Mbh	-34		
ft²/Mbh	-103		
Btu/h-ft²	-9.71		

Cooling Airflows

Main Fan cfm	75
Cooling ACH	1.64
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	75
Heating ACH	1.64
Sec Fan cfm	0
Input Ventilation cfm	75
Calculated Ventilation cfm	75
Calculated Ventilation ACH	1.64
Infiltration cfm	6
Min Stop/RH (%)	100

Areas

ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 69 of 74

ZONE_SHWR-N

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 12:00:00
 Outside DB / WB / HR 94.8 °F / 65.5 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1	0	1	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	521	0	521	19.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	25	0	25	1.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-20	0	-20	-0.8
Other Floor	0	0	0	0	0.0
Infiltration	102	0	-60	42	1.6
Envelope Subtotal	102	527	-60	569	-
People	399	630	631	1,661	63.3
Lights	94	154	0	247	9.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	493	784	631	1,908	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	46	0	46	1.8
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-6	0	-6	-0.2
Grand Total	595	1,351	571	2,517	100.0
RA Sensible (Lights)	108	0	0	108	-

Engineering Checks For Cooling

Cooling tons	0.21	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	2,443
cfm/ton	446		
ft²/ton	971		
Btu/h-ft²	12.36		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-2	0	-2	0.3
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-359	0	-359	40.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-69	0	-69	7.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	42	0	42	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-220	0	0	-231	26.3
Envelope Subtotal	-220	-387	0	-619	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-259	0	-259	29.5
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-221	-648	0	-879	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	4.07
%OA	0	People per 1000 ft²	20
cfm/ft²	0.46	Volume (ft³)	2,443
cfm/Mbh	-106		
ft²/Mbh	-232		
Btu/h-ft²	-4.31		

Cooling Airflows

Main Fan cfm	94
Cooling ACH	2.31
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	94
Heating ACH	2.31
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 70 of 74

ZONE_SHWR-S

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.3 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	670	0	670	24.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	30	0	30	1.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-33	0	-33	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-60	26	0.9
Envelope Subtotal	87	667	-60	693	-
People	406	700	642	1,748	62.7
Lights	95	171	0	266	9.5
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	502	871	642	2,015	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-19	0	-19	-0.7
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-8	0	-8	-0.3
Grand Total	588	1,510	582	2,681	100.0
RA Sensible (Lights)	110	0	0	110	-

Engineering Checks For Cooling

Cooling tons	0.22	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	2,486
cfm/ton	452		
ft²/ton	928		
Btu/h-ft²	12.93		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 78.3 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-366	0	-366	42.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-60	0	-60	6.9
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	42	0	42	-4.9
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	27.2
Envelope Subtotal	-224	-384	0	-619	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-246	0	-246	28.4
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-631	0	-866	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.87	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.49	Volume (ft³)	2,486
cfm/Mbh	-117		
ft²/Mbh	-239		
Btu/h-ft²	-4.18		

Cooling Airflows

Main Fan cfm	101
Cooling ACH	2.44
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	101
Heating ACH	2.44
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 71 of 74

ZONE_SHWR-W

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 18:00:00
 Outside DB / WB / HR 91.4 °F / 64.4 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 51.9 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	236	0	236	9.3
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	155	0	155	6.1
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-31	0	-31	-1.2
Other Floor	0	0	0	0	0.0
Infiltration	87	0	-64	23	0.9
Envelope Subtotal	87	360	-64	383	-
People	406	693	642	1,741	68.5
Lights	95	169	0	264	10.4
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	501	862	642	2,006	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	48	0	48	1.9
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-5	0	-5	-0.2
Grand Total	588	1,265	578	2,431	100.0
RA Sensible (Lights)	110	0	0	110	-

Engineering Checks For Cooling

Cooling tons	0.20	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.43	Volume (ft³)	2,485
cfm/ton	440		
ft²/ton	1,022		
Btu/h-ft²	11.74		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 24:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.2 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 79.5 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	0	0	0	0.0
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	0	0	0	0.0
Wall	0	-361	0	-361	41.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-77	0	-77	8.7
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	43	0	43	-4.8
Other Floor	0	0	0	0	0.0
Infiltration	-224	0	0	-235	26.7
Envelope Subtotal	-224	-395	0	-630	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	0	0	0	0	0.0
Internal Subtotal	0	0	0	0	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	0	0	0	0	0.0
Ceiling	0	-250	0	-250	28.3
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-1	0	-1	0.1
Grand Total	-224	-646	0	-881	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-0.88	No People(max)	4.14
%OA	0	People per 1000 ft²	20
cfm/ft²	0.43	Volume (ft³)	2,485
cfm/Mbh	-101		
ft²/Mbh	-235		
Btu/h-ft²	-4.26		

Cooling Airflows

Main Fan cfm	89
Cooling ACH	2.15
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	89
Heating ACH	2.15
Sec Fan cfm	0
Input Ventilation cfm	0
Calculated Ventilation cfm	0
Calculated Ventilation ACH	0.00
Infiltration cfm	5
Min Stop/RH (%)	0

Areas ft²

Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 72 of 74

ZONE_Support

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 38.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	1,014	0	1,014	20.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	329	0	329	6.7
Wall	0	687	0	687	14.0
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	73	0	73	1.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	6	0	6	0.1
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	2,110	0	2,110	-
People	0	0	0	0	0.0
Lights	278	402	0	680	13.9
Miscellaneous Loads	2,059	0	0	2,059	42.1
Internal Subtotal	2,337	402	0	2,739	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-751	0	8	-743	-15.2
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	472	0	0	472	9.6
Time Delay Correction	0	-5	0	-5	-0.1
Grand Total	2,058	2,507	8	4,572	100.0
RA Sensible (Lights)	319	0	0	319	-

Engineering Checks For Cooling

Cooling tons	0.38	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.36	Volume (ft³)	7,241
cfm/ton	577		
ft²/ton	1,584		
Btu/h-ft²	7.58		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 5.0 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 85.2 °F

	Instant	Time Delay	Latent	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-693	0	-693	19.9
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-1,236	0	-1,236	35.4
Wall	0	-1,063	0	-1,063	30.5
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	169	0	169	-4.8
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	137	0	137	-3.9
Other Floor	0	0	0	0	0.0
Infiltration	0	0	0	0	0.0
Envelope Subtotal	0	-2,685	0	-2,685	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	206	0	0	206	-5.9
Internal Subtotal	206	0	0	206	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-556	0	0	-618	17.7
Ceiling	0	0	0	0	0.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	-355	0	0	-355	10.2
Time Delay Correction	0	-34	0	-34	1.0
Grand Total	-705	-2,719	0	-3,486	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-3.49	No People(max)	0.00
%OA	16	People per 1000 ft²	0
cfm/ft²	0.36	Volume (ft³)	7,241
cfm/Mbh	-63		
ft²/Mbh	-173		
Btu/h-ft²	-5.78		

Cooling Airflows

Main Fan cfm	220
Cooling ACH	1.82
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	220
Heating ACH	1.82
Sec Fan cfm	0
Input Ventilation cfm	36
Calculated Ventilation cfm	36
Calculated Ventilation ACH	0.30
Infiltration cfm	0
Min Stop/RH (%)	100

Areas

ft²	
Roof	657
Other Roof	657
Ceiling	0
Window	0
Door	63
Wall	661
Below-Grade Wall	0
Other Wall	661
Partition	1,959
Exterior Floor	0
Internal Floor	0
Slab	657
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 73 of 74

ZONE_Utility

Conditions at Time of Space Cooling Peak

Peak Time (Mo/D/H:M) 7/21 19:00:00
 Outside DB / WB / HR 86.7 °F / 62.9 °F / 0.0 gr/lb
 Zone DB / RH / HR 75.0 °F / 43.1 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 55.0 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	4,033	0	4,033	33.7
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	146	0	146	1.2
Wall	0	91	0	91	0.8
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	3,353	0	3,353	28.0
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	-38	0	-38	-0.3
Other Floor	0	0	0	0	0.0
Infiltration	571	0	-209	361	3.0
Envelope Subtotal	571	7,584	-209	7,946	-
People	724	1,002	1,259	2,985	24.9
Lights	1,172	1,749	0	2,921	24.4
Miscellaneous Loads	824	0	0	824	6.9
Internal Subtotal	2,721	2,751	1,259	6,731	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-3,405	0	-735	-4,139	-34.6
Ceiling	0	117	0	117	1.0
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-23	0	-23	-0.2
Grand Total	-113	10,430	315	10,632	100.0
RA Sensible (Lights)	1,346	0	0	1,346	-

Engineering Checks For Cooling

Cooling tons	0.89	No People(max)	7.15
%OA	33	People per 1000 ft²	2
cfm/ft²	0.17	Volume (ft³)	35,118
cfm/ton	560		
ft²/ton	3,303		
Btu/h-ft²	3.63		

Conditions at Time of Space Heating Peak

Peak Time (Mo/D/H:M) 12/21 04:00:00
 Outside DB / WB / HR 32.1 °F / 21.8 °F / 0.0 gr/lb
 Zone DB / RH / HR 70.0 °F / 4.6 % / 0.0 gr/lb
 Supply Air Dry Bulb Temp 89.2 °F

	Instant	Time Delay	Latent	Total	Percent of
	Sensible	Sensible			
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)
Roof	0	-3,105	0	-3,105	30.8
Other Roof	0	0	0	0	0.0
Glass	0	0	0	0	0.0
Door	0	-565	0	-565	5.6
Wall	0	-144	0	-144	1.4
Below-Grade Wall	0	0	0	0	0.0
Other Wall	0	0	0	0	0.0
Partition	0	-1,665	0	-1,665	16.5
Exterior Floor	0	0	0	0	0.0
Interior Floor	0	0	0	0	0.0
Slab	0	536	0	536	-5.3
Other Floor	0	0	0	0	0.0
Infiltration	-2,044	0	0	-2,118	21.0
Envelope Subtotal	-2,044	-4,943	0	-7,062	-
People	0	0	0	0	0.0
Lights	0	0	0	0	0.0
Miscellaneous Loads	82	0	0	82	-0.8
Internal Subtotal	82	0	0	82	-
RA (All Other)	0	0	0	0	0.0
DOA Direct to Zone	-2,520	0	0	-2,753	27.3
Ceiling	0	-313	0	-313	3.1
Refrigeration	0	0	0	0	0.0
Service Water	0	0	0	0	0.0
HVAC Equipment Losses	0	0	0	0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0
Sizing Factor Correction	0	0	0	0	0.0
Time Delay Correction	0	-25	0	-25	0.3
Grand Total	-4,481	-5,281	0	-10,070	100.0
RA Sensible (Lights)	0	0	0	0	-

Engineering Checks For Heating

Heating Mbh	-10.07	No People(max)	7.15
%OA	33	People per 1000 ft²	2
cfm/ft²	0.17	Volume (ft³)	35,118
cfm/Mbh	-49		
ft²/Mbh	-291		
Btu/h-ft²	-3.44		

Cooling Airflows

Main Fan cfm	496
Cooling ACH	0.85
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100
Ventilation Sizing Factor	1.00

Heating Airflows

Main Fan cfm	496
Heating ACH	0.85
Sec Fan cfm	0
Input Ventilation cfm	164
Calculated Ventilation cfm	164
Calculated Ventilation ACH	0.28
Infiltration cfm	49
Min Stop/RH (%)	100

Areas

	ft²
Roof	2,903
Other Roof	2,903
Ceiling	295
Window	0
Door	28
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Interior Floor	0
Slab	3,198
Other Floor	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 74 of 74

System Component Selection Summary

Title 24 - 2022 Baseline

System Name: PSZ-HP-Activity

System Type: Constant Volume (CV)
 Number of Zones 6
 Number of Rooms 6

Component	Quantity
Cooling Coils	6
Heating Coils	6
Fans	6

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow		Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)				(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)			
SAAHP-1	ACT-Noisy-1	DX	Peak		0.4	5.3	5.1	0.3	N/A	199	38	79.1	61.81	54.4	52.21	N/A	N/A	N/A
SAAHP-1	ACT-Noisy-2	DX	Peak		0.3	3.5	3.2	0.5	N/A	103	38	84.6	64.47	54.5	52.71	N/A	N/A	N/A
SAAHP-1	ACT-Noisy-3	DX	Peak		0.3	3.6	3.3	0.5	N/A	107	38	84.3	64.33	54.5	52.71	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-1	DX	Peak		0.2	2.3	2.0	0.4	N/A	60	27	86.7	64.40	54.4	51.15	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-2	DX	Peak		0.2	2.4	2.4	0.2	N/A	76	27	84.2	62.76	54.4	51.50	N/A	N/A	N/A
SAAHP-1	ACT-Quiet-3	DX	Peak		0.2	2.5	2.3	0.3	N/A	74	28	84.0	64.34	54.5	52.71	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	HEATING ACT-Noisy-1	DX	Peak	12/21 24:00	5.3	5.3	N/A	199	38	62.8	88.9	N/A	N/A	N/A
SAAHP-1	HEATING ACT-Noisy-2	DX	Peak	12/21 24:00	3.5	3.5	N/A	103	38	56.0	89.1	N/A	N/A	N/A
SAAHP-1	HEATING ACT-Noisy-3	DX	Peak	12/21 24:00	3.6	3.6	N/A	107	38	56.4	89.0	N/A	N/A	N/A
SAAHP-1	HEATING ACT-Quiet-1	DX	Peak	12/21 24:00	2.3	2.3	N/A	60	27	52.8	89.4	N/A	N/A	N/A
SAAHP-1	HEATING ACT-Quiet-2	DX	Peak	12/21 24:00	2.4	2.4	N/A	76	27	56.4	87.0	N/A	N/A	N/A
SAAHP-1	HEATING ACT-Quiet-3	DX	Peak	12/21 24:00	2.5	2.5	N/A	74	28	56.0	88.6	N/A	N/A	N/A

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 1 of 39

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak	Supply	Sensible	Minimum	SAT (°F)	Time of Peak	Supply	Sensible	Minimum	SAT (°F)
				Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow (cfm)		Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow (cfm)	
PSZ-HP-Activity			935	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	8/21 17:00	199	4,125	199	55.0	12/21 24:00	199	1,204	199	75.9
		Noisy Activity 1	180	8/21 17:00	198	4,113	198	55.0	12/21 24:00	198	1,200	198	75.9
	ACT-Noisy-2		181	7/21 18:00	103	2,138	103	55.0	12/21 24:00	103	985	103	79.3
		Noisy Activity 2	181	7/21 18:00	102	2,112	102	55.0	12/21 24:00	102	970	102	79.3
	ACT-Noisy-3		182	7/21 15:00	107	2,215	107	55.0	12/21 24:00	107	1,202	107	81.0
		Noisy Activity 3	182	7/21 15:00	106	2,202	106	55.0	12/21 24:00	106	1,197	106	81.0
	ACT-Quiet-1		130	9/21 15:00	60	1,249	60	55.0	12/21 24:00	60	383	60	76.2
		Quiet Activity 1	130	9/21 15:00	60	1,246	60	55.0	12/21 24:00	60	378	60	76.1
	ACT-Quiet-2		131	9/21 15:00	76	1,587	76	55.0	12/21 24:00	76	545	76	77.0
		Quiet Activity 2	131	9/21 15:00	75	1,557	75	55.0	12/21 24:00	75	526	75	76.8
	ACT-Quiet-3		131	7/21 19:00	74	1,545	74	55.0	12/21 24:00	74	552	74	77.2
		Quiet Activity 3	131	7/21 19:00	74	1,538	74	55.0	12/21 24:00	74	548	74	77.2

Fans

System	Zone	Type	Efficiency with PRM			Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM		Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)	Pressure (in. Wg)				Fan Override (kW)	Motor Heat in Air (%)	
ACT-Noisy-1	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	199	.03	N/A	100.00		
ACT-Noisy-2	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	103	.02	N/A	100.00		
ACT-Noisy-3	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	107	.02	N/A	100.00		
ACT-Quiet-1	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	60	.01	N/A	100.00		
ACT-Quiet-2	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	76	.01	N/A	100.00		
ACT-Quiet-3	PSZ-HP-Activity SF-1	System	87.00	N/A	1.25	74	.01	N/A	100.00		

System Name: PSZ-HP-Admin

System Type: Constant Volume (CV)

Number of Zones 3

Number of Rooms 4

Component	Quantity
Cooling Coils	3
Heating Coils	3
Fans	3

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow		Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)				(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)			
SAAHP-1 Admin		DX	Peak		0.3	3.2	3.2	0.2	N/A	119	21	80.1	61.39	54.4	51.50	N/A	N/A	N/A
SAAHP-1 Chart/Hotel		DX	Peak		0.2	2.3	2.1	0.3	N/A	70	22	84.2	64.14	55.0	52.58	N/A	N/A	N/A
SAAHP-1 Entry/Waiting		DX	Peak		0.9	11.1	10.9	0.1	N/A	492	31	75.9	59.87	54.4	51.50	N/A	N/A	N/A
*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.																		

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING Admin		DX	Peak	12/21 04:00	3.2	3.2	N/A	119	21	63.4	89.9	N/A	N/A	N/A
SAAHP-1HEATING Chart/Hotel		DX	Peak	12/21 04:00	2.3	2.3	N/A	70	22	58.1	90.4	N/A	N/A	N/A
SAAHP-1HEATING Entry/Waiting		DX	Peak	12/21 24:00	11.1	11.1	N/A	492	31	67.6	89.6	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-Admin			759	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Admin		189	9/21 14:00	119	2,473	119	55.0	12/21 04:00	119	945	119	77.7
		Office 1	94	10/21 14:00	66	1,366	66	55.0	12/21 04:00	66	497	66	77.4
		Office 2	95	10/21 13:00	58	1,204	58	55.0	12/21 04:00	58	464	58	77.8
	Chart/Hotel		200	7/21 19:00	70	1,411	70	55.5	12/21 04:00	70	433	70	76.1
		Chart/Hotel	200	7/21 19:00	67	1,364	67	55.4	12/21 04:00	67	403	67	75.9
	Entry/Waiting		370	7/21 09:00	492	10,216	492	55.0	12/21 24:00	492	4,562	492	79.0
		Entry/Waiting	370	7/21 09:00	495	10,282	495	55.0	12/21 24:00	495	4,574	495	79.0

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM		
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Fan Override (kW)	Motor Heat in Air (%)
Admin_PSZ-HP-Admin SF-1		System	87.00	N/A	1.25	119	.02	N/A	100.00
Chart/Hotel_PSZ-HP-Admin SF-1		System	87.00	N/A	1.25	70	.01	N/A	100.00
Entry/Waiting_PSZ-HP-Admin SF-1		System	87.00	N/A	1.25	492	.08	N/A	100.00

System Name: PSZ-HP-Atrium

System Type: Constant Volume (CV)
Number of Zones 1
Number of Rooms 2

Component	Quantity
Cooling Coils	1
Heating Coils	1
Fans	1

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Total capacity (MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	Atrium	DX	Peak		1.0	11.8	11.8	1.1	N/A	404	108	82.6	62.06	54.4	51.47	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING	Atrium	DX	Peak	12/21 24:00	11.8	11.8	N/A		404	108	59.9	88.5	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-Atrium			1,267	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Atrium		1,267	7/21 16:00	404	8,391	404	55.0	12/21 24:00	404	5,248	404	82.7
		Atrium	622	7/21 17:00	150	3,116	150	55.0	12/21 24:00	150	2,072	150	83.5
		Atrium 2	645	9/21 16:00	254	5,275	254	55.0	12/21 24:00	254	3,031	254	81.6

Fans

System	Zone	Type	Efficiency with PRM							Power with PRM Fan Override (kW)	Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)				
Attrium_PSZ-HP-Atrium SF-1		System	87.00	N/A	1.25	404	.07		N/A		100.00

System Name: PSZ-HP-Clinical

System Type: Constant Volume (CV)
 Number of Zones 6
 Number of Rooms 13

Component	Quantity
Cooling Coils	6
Heating Coils	6
Fans	7

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow (cfm)	Vent (cfm)	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)			(°F)	(°F)	(°F)	(°F)			
SAAHP-1	Comfort/Consult	DX	Peak		0.4	5.3	5.2	1.2	N/A	154	72	87.2	64.23	54.4	52.21	N/A	N/A	N/A
SAAHP-1	Exam/Storage	DX	Peak		0.2	2.9	2.8	0.6	N/A	84	37	86.7	64.18	54.4	52.21	N/A	N/A	N/A
SAAHP-1	Group	DX	Peak		0.5	5.7	5.6	1.3	N/A	152	91	89.7	65.14	54.4	52.21	N/A	N/A	N/A
SAAHP-1	Intake-HR-A	DX	Peak		0.7	8.7	8.7	0.9	N/A	311	69	81.2	61.18	54.4	50.94	N/A	N/A	N/A
SAAHP-1	Intake-HR-B	DX	Peak		0.2	2.2	2.1	0.5	N/A	66	26	85.6	63.85	54.4	52.21	N/A	N/A	N/A
SAAHP-1	RB-S-Corner-N	DX	Peak		0.2	2.5	2.4	0.1	N/A	94	14	79.3	61.84	54.4	52.21	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING	Comfort/Consult	DX	Peak	12/21 24:00	5.3	5.3	N/A	154	72	52.2	85.6	N/A	N/A	N/A
SAAHP-1HEATING	Exam/Storage	DX	Peak	12/21 04:00	2.9	2.9	N/A	84	37	53.2	86.5	N/A	N/A	N/A
SAAHP-1HEATING	Group	DX	Peak	12/21 24:00	5.7	5.7	N/A	152	91	47.3	83.6	N/A	N/A	N/A
SAAHP-1HEATING	Intake-HR-A	DX	Peak	12/21 24:00	8.7	8.7	N/A	311	69	61.6	88.8	N/A	N/A	N/A
SAAHP-1HEATING	Intake-HR-B	DX	Peak	12/21 04:00	2.2	2.2	N/A	66	26	55.0	87.2	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-Corner-N	DX	Peak	12/21 24:00	2.5	2.5	N/A	94	14	64.3	90.4	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
			Area (ft ²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
PSZ-HP-Clinical			1,548	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Comfort/Consult		283	7/21 16:00	154	3,196	154	55.0	12/21 24:00	154	1,191	154	77.5
		Comfort Room 2	82	7/21 15:00	44	924	44	55.0	12/21 24:00	44	355	44	77.8
		Consult 1	100	7/21 16:00	53	1,104	53	55.0	12/21 24:00	53	402	53	77.4
		Consult 2	102	7/21 16:00	55	1,144	55	55.0	12/21 24:00	55	416	55	77.4
	Exam/Storage		224	7/21 16:00	84	1,753	84	55.0	12/21 04:00	84	486	84	75.6
		Exam Room	123	7/21 16:00	53	1,098	53	55.0	12/21 19:00	53	188	53	75.0
		Long Term Belongings Storage	101	7/21 16:00	29	612	29	55.0	12/21 04:00	29	271	29	79.0
	Group		276	7/21 16:00	152	3,160	152	55.0	12/21 24:00	152	1,540	152	79.9
		Group	276	7/21 16:00	151	3,139	151	55.0	12/21 24:00	151	1,541	151	79.9
	Intake-HR-A		470	9/21 13:00	311	6,463	311	55.0	12/21 24:00	311	2,570	311	78.0
		Intake Corridor	155	7/21 16:00	40	832	40	55.0	12/21 20:00	40	385	40	79.4
		Interview Room	158	9/21 16:00	93	1,938	93	55.0	12/21 24:00	93	837	93	78.7
		Sally Port	78	11/21 13:00	137	2,837	137	55.0	12/21 19:00	137	689	137	75.0
		Shower 1	80	7/21 16:00	41	855	41	55.0	12/21 24:00	41	385	41	79.1
	Intake-HR-B		165	7/21 16:00	66	1,374	66	55.0	12/21 04:00	66	447	66	76.6
		Ante Room	81	7/21 16:00	25	515	25	55.0	12/21 04:00	25	225	25	78.9
		Comfort Room 1	84	9/21 14:00	43	900	43	55.0	12/21 07:00	43	225	43	75.1
	RB-S-Corner-N		129	9/21 15:00	94	1,956	94	55.0	12/21 24:00	94	845	94	78.8
		Resident Room 04	129	9/21 15:00	94	1,960	94	55.0	12/21 24:00	94	848	94	78.8

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM		Motor Heat in Air
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Fan Override (kW)	
Comfort/Consult_PSZ-HP-Clinical SF-1		System	87.00	N/A	1.25	154	.03	N/A	100.00
Exam/Storage_PSZ-HP-Clinical SF-1		System	87.00	N/A	1.25	84	.01	N/A	100.00
Group_PSZ-HP-Clinical SF-1		System	87.00	N/A	1.25	152	.03	N/A	100.00
Intake-HR-A_EXHAUST FAN		Zone	10.00	N/A	0.00	160	.00	N/A	100.00

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 8 of 39

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
Intake-HR-A	_PSZ-HP-Clinical SF-1	System	87.00	N/A	1.25	311	.05	N/A	100.00
Intake-HR-B	_PSZ-HP-Clinical SF-1	System	87.00	N/A	1.25	66	.01	N/A	100.00
RB-S-Corner-N	_PSZ-HP-Clinical SF-1	System	87.00	N/A	1.25	94	.02	N/A	100.00

System Name: PSZ-HP-Common

System Type: Constant Volume (CV)
Number of Zones 4
Number of Rooms 5

Component	Quantity
Cooling Coils	4
Heating Coils	4
Fans	5

Cooling Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design						Water Flow Conditions				
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow		Vent	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)	(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)				
SAAHP-1 Hospitality		DX	Peak		0.4	5.2	5.2	1.1	N/A	274	81	82.5	63.78	64.3	57.40	N/A	N/A	N/A	
SAAHP-1 Lounge		DX	Peak		0.7	8.6	7.9	1.1	N/A	290	65	80.8	60.01	54.4	48.72	N/A	N/A	N/A	
SAAHP-1 Multipurpose/Dining		DX	Peak		0.8	10.0	9.8	2.3	N/A	268	160	89.7	65.13	54.4	52.21	N/A	N/A	N/A	
SAAHP-1 Servery		DX	Peak		0.4	4.5	4.5	1.0	N/A	120	75	90.4	65.29	54.4	52.21	N/A	N/A	N/A	

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING Hospitality		DX	Peak	12/21 24:00	5.2	5.2	N/A	274	81	58.8	77.4	N/A	N/A	N/A
SAAHP-1HEATING Lounge		DX	Peak	12/21 24:00	8.6	8.6	N/A	290	65	61.5	90.5	N/A	N/A	N/A
SAAHP-1HEATING Multipurpose/Dining		DX	Peak	12/21 24:00	10.0	10.0	N/A	268	160	47.3	83.6	N/A	N/A	N/A
SAAHP-1HEATING Servery		DX	Peak	12/21 24:00	4.5	4.5	N/A	120	75	46.3	83.1	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-Common			1,256	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Hospitality		246	7/21 16:00	274	2,877	274	64.9	12/21 24:00	274	1,381	274	75.0
		Hospitality	246	7/21 16:00	274	2,878	274	64.9	12/21 24:00	274	1,383	274	75.0
	Lounge		297	10/21 14:00	290	5,994	290	55.0	12/21 24:00	290	1,769	290	76.0
		Lounge	198	10/21 14:00	223	4,625	223	55.0	12/21 19:00	223	1,316	223	75.7
		Shower 2	99	9/21 15:00	66	1,370	66	55.0	12/21 19:00	66	364	66	75.4
	Multipurpose/Dining		485	7/21 15:00	268	5,563	268	55.0	12/21 24:00	268	2,708	268	79.9
		Multipurpose/Dining	485	7/21 15:00	267	5,549	267	55.0	12/21 24:00	267	2,706	267	79.9
	Servery		228	7/21 16:00	120	2,500	120	55.0	12/21 24:00	120	1,094	120	78.9
		Servery	228	7/21 16:00	120	2,495	120	55.0	12/21 24:00	120	1,093	120	78.9

Fans

System	Zone	Type	Efficiency with PRM		Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)					
Hospitality _PSZ-HP-Common SF-1		System	87.00	N/A	1.25	274	.05	N/A	100.00
	Lounge _EXHAUST FAN	Zone	10.00	N/A	0.00	198	.00	N/A	100.00
Lounge _PSZ-HP-Common SF-1		System	87.00	N/A	1.25	290	.05	N/A	100.00
Multipurpose/Dining _PSZ-HP-Common SF-1		System	87.00	N/A	1.25	268	.05	N/A	100.00
Servery _PSZ-HP-Common SF-1		System	87.00	N/A	1.25	120	.02	N/A	100.00

System Name: PSZ-HP-Kitchen

System Type: Constant Volume (CV)
Number of Zones 1
Number of Rooms 2

Component	Quantity
Cooling Coils	1
Heating Coils	1
Fans	2

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1 Kitchen		DX	Peak		5.8	69.4	65.7	2.3	N/A	2,853	174	76.6	60.13	54.4	51.14	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING Kitchen		DX	Peak	12/21 04:00	69.4	69.4	N/A		2,853	174	67.7	91.4	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
PSZ-HP-Kitchen			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	10/21 14:00	2,853	59,206	2,853	55.0	12/21 04:00	2,853	14,634	2,853	75.0
		Kitchen	382	7/21 17:00	2,500	51,822	2,500	55.0	12/21 19:00	2,500	12,818	2,500	75.0
		Service	304	10/21 14:00	355	7,360	355	55.0	12/21 04:00	355	2,616	355	77.2

Fans

System	Zone	Type	Efficiency with PRM						
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
	Kitchen_EXHAUST FAN	Zone	10.00	N/A	0.00	2,500	.00	N/A	100.00
Kitchen_PSZ-HP-Kitchen SF-1		System	87.00	N/A	1.25	2,853	.48	N/A	100.00

System Name: PSZ-HP-ResBed-N

System Type: Constant Volume (CV)
Number of Zones 4
Number of Rooms 7

Component	Quantity
Cooling Coils	4
Heating Coils	4
Fans	4

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow		Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)	(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)			
SAAHP-1	Corridor-N	DX	Peak		0.3	3.3	3.3	0.6	N/A	116	25	82.0	61.35	54.4	50.86	N/A	N/A	N/A
SAAHP-1	RB-N-Corner	DX	Peak		0.2	2.9	2.7	0.1	N/A	128	14	77.7	62.79	57.6	55.06	N/A	N/A	N/A
SAAHP-1	RB-N-East	DX	Peak		0.4	4.8	4.5	0.2	N/A	202	28	78.0	62.73	56.7	54.39	N/A	N/A	N/A
SAAHP-1	RB-N-West	DX	Peak		0.7	8.1	7.5	0.4	N/A	348	42	78.0	62.81	57.2	54.78	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING	Corridor-N	DX	Peak	12/21 24:00	3.3	3.3	N/A	116	25	62.0	89.9	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-Corner	DX	Peak	12/21 24:00	2.9	2.9	N/A	128	14	65.8	87.6	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-East	DX	Peak	12/21 24:00	4.8	4.8	N/A	202	28	64.7	88.1	N/A	N/A	N/A
SAAHP-1HEATING	RB-N-West	DX	Peak	12/21 24:00	8.1	8.1	N/A	348	42	65.4	88.0	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-ResBed-N			1,179	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-N		409	7/21 18:00	116	2,402	116	55.0	12/21 24:00	116	1,584	116	83.3
		Corridor 3	409	7/21 18:00	115	2,395	115	55.0	12/21 24:00	115	1,579	115	83.3
	RB-N-Corner		130	7/21 18:00	128	2,247	128	58.2	12/21 24:00	128	853	128	76.5
		Resident Room 14	130	7/21 18:00	129	2,248	129	58.2	12/21 24:00	129	853	129	76.5
	RB-N-East		257	7/21 10:00	202	3,738	202	57.2	12/21 24:00	202	1,508	202	77.3
		Resident Room 15	130	7/21 10:00	103	1,913	103	57.2	12/21 24:00	103	863	103	78.1
		Resident Room 16	127	7/21 10:00	98	1,819	98	57.2	12/21 24:00	98	644	98	76.4
	RB-N-West		383	7/21 18:00	348	6,225	348	57.8	12/21 24:00	348	1,911	348	75.4
		Resident Room 11	129	7/21 18:00	115	2,063	115	57.8	12/21 24:00	115	627	115	75.3
		Resident Room 12	127	7/21 18:00	115	2,070	115	57.8	12/21 24:00	115	626	115	75.3
		Resident Room 13	127	7/21 18:00	116	2,081	116	57.8	12/21 24:00	116	643	116	75.4

Fans

System	Zone	Type	Efficiency with PRM		Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)					
Corridor-N _PSZ-HP-ResBed-N SF-1		System	87.00	N/A	1.25	116	.02	N/A	100.00
RB-N-Corner _PSZ-HP-ResBed-N SF-1		System	87.00	N/A	1.25	128	.02	N/A	100.00
RB-N-East _PSZ-HP-ResBed-N SF-1		System	87.00	N/A	1.25	202	.03	N/A	100.00
RB-N-West _PSZ-HP-ResBed-N SF-1		System	87.00	N/A	1.25	348	.06	N/A	100.00

System Name: PSZ-HP-ResBed-S

System Type: Constant Volume (CV)
Number of Zones 4
Number of Rooms 6

Component	Quantity
Cooling Coils	4
Heating Coils	4
Fans	4

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions			
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow		Vent	Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)	(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)				
SAAHP-1	Corridor-S	DX	Peak		0.4	4.9	4.7	0.8	N/A	183	25	79.6	55.85	54.4	44.74	N/A	N/A	N/A	
SAAHP-1	RB-S-Corner-S	DX	Peak		0.2	3.0	2.8	0.1	N/A	114	14	78.4	61.55	54.4	52.21	N/A	N/A	N/A	
SAAHP-1	RB-S-East	DX	Peak		0.6	6.9	6.3	0.3	N/A	282	41	78.1	62.75	56.5	54.29	N/A	N/A	N/A	
SAAHP-1	RB-S-West	DX	Peak		0.2	2.6	2.4	0.1	N/A	112	14	78.0	62.81	57.2	54.77	N/A	N/A	N/A	

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING	Corridor-S	DX	Peak	12/21 24:00	4.9	4.9	N/A	183	25	64.8	91.2	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-Corner-S	DX	Peak	12/21 24:00	3.0	3.0	N/A	114	14	65.2	90.5	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-East	DX	Peak	12/21 24:00	6.9	6.9	N/A	282	41	64.5	88.2	N/A	N/A	N/A
SAAHP-1HEATING	RB-S-West	DX	Peak	12/21 24:00	2.6	2.6	N/A	112	14	65.4	88.0	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-ResBed-S			1,041	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-S		414	10/21 13:00	183	3,771	183	55.0	12/21 24:00	183	1,560	183	78.3
		Corridor 5	414	10/21 13:00	182	3,758	182	55.0	12/21 24:00	182	1,554	182	78.3
	RB-S-Corner-S		131	9/21 17:00	114	2,376	114	55.0	12/21 24:00	114	859	114	77.3
		Resident Room 05	131	9/21 17:00	114	2,375	114	55.0	12/21 24:00	114	857	114	77.3
	RB-S-East		372	7/21 10:00	282	5,253	282	57.1	12/21 24:00	282	1,788	282	76.2
		Resident Room 01	124	8/21 10:00	89	1,655	89	57.1	12/21 24:00	89	536	89	75.9
		Resident Room 02	112	7/21 10:00	89	1,665	89	57.1	12/21 24:00	89	562	89	76.1
		Resident Room 03	136	7/21 10:00	104	1,931	104	57.1	12/21 24:00	104	677	104	76.4
	RB-S-West		124	7/21 18:00	112	2,014	112	57.8	12/21 24:00	112	626	112	75.4
		Resident Room 06	124	7/21 18:00	112	2,010	112	57.8	12/21 24:00	112	624	112	75.4

Fans

System	Zone	Type	Efficiency with PRM		Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)					
Corridor-S_PSZ-HP-ResBed-S SF-1		System	87.00	N/A	1.25	183	.03	N/A	100.00
RB-S-Corner-S_PSZ-HP-ResBed-S SF-1		System	87.00	N/A	1.25	114	.02	N/A	100.00
RB-S-East_PSZ-HP-ResBed-S SF-1		System	87.00	N/A	1.25	282	.05	N/A	100.00
RB-S-West_PSZ-HP-ResBed-S SF-1		System	87.00	N/A	1.25	112	.02	N/A	100.00

System Name: PSZ-HP-ResBed-W

System Type: Constant Volume (CV)
Number of Zones 3
Number of Rooms 5

Component	Quantity
Cooling Coils	3
Heating Coils	3
Fans	3

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow		Enter DB/WB		Leave DB/WB		Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
					(tons)	(MBh)				(cfm)	(cfm)	(°F)	(°F)	(°F)	(°F)			
SAAHP-1	Corridor-W	DX	Peak		0.4	4.8	4.8	0.4	N/A	199	19	77.9	59.94	54.4	50.90	N/A	N/A	N/A
SAAHP-1	RB-W-North	DX	Peak		0.2	2.6	2.4	0.1	N/A	113	14	77.7	62.68	57.1	54.66	N/A	N/A	N/A
SAAHP-1	RB-W-South	DX	Peak		0.7	8.6	8.1	0.5	N/A	322	42	78.7	60.72	54.4	50.87	N/A	N/A	N/A
*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.																		

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of	Total	Vent	Ov/undr	Airflow	Vent	Enter DB	Leave DB	Flow	Enter Temp	Leave Temp
				Peak	capacity	Load	sizing							
SAAHP-1HEATING	Corridor-W	DX	Peak	12/21 24:00	4.8	4.8	N/A	199	19	66.3	90.0	N/A	N/A	N/A
SAAHP-1HEATING	RB-W-North	DX	Peak	12/21 24:00	2.6	2.6	N/A	113	14	65.2	87.8	N/A	N/A	N/A
SAAHP-1HEATING	RB-W-South	DX	Peak	12/21 24:00	8.6	8.6	N/A	322	42	65.1	91.1	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-ResBed-W			833	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-W		324	7/21 17:00	199	4,130	199	55.0	12/21 24:00	199	1,376	199	76.7
		Corridor 4	324	7/21 17:00	198	4,106	198	55.0	12/21 24:00	198	1,359	198	76.7
	RB-W-North		130	7/21 18:00	113	2,043	113	57.6	12/21 24:00	113	903	113	77.8
		Resident Room 10	130	7/21 18:00	113	2,041	113	57.6	12/21 24:00	113	902	113	77.8
	RB-W-South		380	10/21 14:00	322	6,674	322	55.0	12/21 24:00	322	2,326	322	77.1
		Resident Room 07	125	10/21 14:00	104	2,150	104	55.0	12/21 24:00	104	672	104	76.3
		Resident Room 08	126	10/21 14:00	107	2,225	107	55.0	12/21 24:00	107	707	107	76.4
		Resident Room 09	128	9/21 15:00	112	2,327	112	55.0	12/21 24:00	112	909	112	77.9

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM Fan Override		
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Motor Heat in Air (%)	
Corridor-W _PSZ-HP-ResBed-W SF-1		System	87.00	N/A	1.25	199	.03	N/A	100.00
RB-W-North _PSZ-HP-ResBed-W SF-1		System	87.00	N/A	1.25	113	.02	N/A	100.00
RB-W-South _PSZ-HP-ResBed-W SF-1		System	87.00	N/A	1.25	322	.05	N/A	100.00

System Name: PSZ-HP-ResShwr

System Type: Constant Volume (CV)
Number of Zones 3
Number of Rooms 6

Component	Quantity
Cooling Coils	3
Heating Coils	3
Fans	6

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Total capacity (MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	SHWR-N	DX	Peak		0.2	2.8	2.3	0.0	N/A	98	0	76.6	63.17	54.5	53.06	N/A	N/A	N/A
SAAHP-1	SHWR-S	DX	Peak		0.3	3.1	2.5	0.0	N/A	110	0	76.4	62.72	54.5	52.71	N/A	N/A	N/A
SAAHP-1	SHWR-W	DX	Peak		0.2	2.8	2.2	0.0	N/A	96	0	76.6	63.26	54.5	53.06	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	HEATING SHWR-N	DX	Peak	12/21 24:00	2.8	2.8	N/A		98	0	70.0	98.2	N/A	N/A	N/A
SAAHP-1	HEATING SHWR-S	DX	Peak	12/21 24:00	3.1	3.1	N/A		110	0	70.0	97.7	N/A	N/A	N/A
SAAHP-1	HEATING SHWR-W	DX	Peak	12/21 24:00	2.8	2.8	N/A		96	0	70.0	98.5	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
PSZ-HP-ResShwr			618	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		SHWR-N	204	7/21 12:00	98	2,038	98	55.0	12/21 24:00	98	936	98	79.3
		Shower 7	103	7/21 12:00	50	1,031	50	55.0	12/21 24:00	50	459	50	79.0
		Shower 8	101	7/21 13:00	48	1,000	48	55.0	12/21 24:00	48	467	48	79.5
		SHWR-S	207	7/21 18:00	110	2,279	110	55.0	12/21 24:00	110	925	110	78.2
		Shower 3	104	7/21 19:00	53	1,112	53	55.0	12/21 24:00	53	453	53	78.3
		Shower 4	103	7/21 18:00	56	1,164	56	55.0	12/21 24:00	56	470	56	78.2
		SHWR-W	207	7/21 18:00	96	1,986	96	55.0	12/21 24:00	96	939	96	79.6
		Shower 5	104	7/21 18:00	48	998	48	55.0	12/21 24:00	48	473	48	79.6
		Shower 6	104	7/21 18:00	47	983	47	55.0	12/21 24:00	47	461	47	79.5

Fans

								Power with PRM Fan Override	Motor Heat in Air
			Efficiency	Efficiency with PRM Fan Override	Static Pressure	Flow Rate	Power		
System	Zone	Type	(%)	(%)	(in. Wg)	(cfm)	(kW)	(kW)	(%)
	SHWR-N_EXHAUST FAN	Zone	10.00	N/A	0.00	407	.00	N/A	100.00
SHWR-N_PSZ-HP-ResShwr SF-1		System	87.00	N/A	1.25	98	.02	N/A	100.00
	SHWR-S_EXHAUST FAN	Zone	10.00	N/A	0.00	414	.00	N/A	100.00
SHWR-S_PSZ-HP-ResShwr SF-1		System	87.00	N/A	1.25	110	.02	N/A	100.00
	SHWR-W_EXHAUST FAN	Zone	10.00	N/A	0.00	414	.00	N/A	100.00
SHWR-W_PSZ-HP-ResShwr SF-1		System	87.00	N/A	1.25	96	.02	N/A	100.00

System Name: PSZ-HP-Utility

System Type: Constant Volume (CV)
Number of Zones 2
Number of Rooms 20

Component	Quantity
Cooling Coils	2
Heating Coils	2
Fans	3

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Total capacity (MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1 Support		DX	Peak		0.8	9.9	9.9	0.3	N/A	429	36	76.6	57.72	54.4	48.79	N/A	N/A	N/A
SAAHP-1 Utility		DX	Peak		2.1	24.7	24.7	2.7	N/A	897	164	81.0	60.24	54.4	49.95	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1HEATING Support		DX	Peak	12/21 04:00	9.9	9.9	N/A		429	36	66.8	89.2	N/A	N/A	N/A
SAAHP-1HEATING Utility		DX	Peak	12/21 04:00	24.7	24.7	N/A		897	164	63.1	89.9	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating					
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	
PSZ-HP-Utility	Support		3,530	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	
			603	9/21 10:00	429	8,884	429	55.0	12/21 04:00	429	3,827	429	78.7	
			Electric	191	10/21 14:00	151	3,135	151	55.0	12/21 04:00	151	1,178	151	77.6
			Emergency Electric	179	7/21 09:00	122	2,530	122	55.0	12/21 04:00	122	815	122	76.5
			Fire Room	79	8/21 09:00	98	2,040	98	55.0	12/21 04:00	98	606	98	76.0
			Mechanical	155	7/21 19:00	57	1,182	57	55.0	12/21 04:00	57	375	57	76.4
	Utility		2,926	9/21 15:00	897	18,597	897	55.0	12/21 04:00	897	8,482	897	79.2	
			Clean Supply	102	7/21 16:00	28	584	28	55.0	12/21 04:00	28	269	28	79.3
			Corridor 1	295	7/21 16:00	76	1,573	76	55.0	12/21 24:00	76	758	76	79.7
			Corridor 2	635	7/21 15:00	134	2,780	134	55.0	12/21 24:00	134	1,424	134	80.4
			Corridor 2.1	85	7/21 18:00	20	420	20	55.0	12/21 24:00	20	242	20	81.7
			General Storage	96	7/21 16:00	47	985	47	55.0	12/21 04:00	47	296	47	76.1
			Hskp	57	7/21 16:00	17	359	17	55.0	12/21 04:00	17	160	17	79.0
			IT	158	7/21 19:00	52	1,083	52	55.0	12/21 04:00	52	184	52	75.0
			Laundry	122	7/21 16:00	33	684	33	55.0	12/21 04:00	33	316	33	79.3
			Meds	129	7/21 16:00	36	746	36	55.0	12/21 04:00	36	346	36	79.4
			Soiled Supply	97	7/21 16:00	28	572	28	55.0	12/21 04:00	28	257	28	79.1
			Staff Corridor	893	9/21 14:00	338	7,001	338	55.0	12/21 18:00	338	2,819	338	78.1
			Stor.	15	7/21 16:00	9	183	9	55.0	12/21 04:00	9	88	9	79.7
			Storage	52	7/21 16:00	21	445	21	55.0	12/21 04:00	21	253	21	81.5
			Toilet 1	67	7/21 15:00	38	798	38	55.0	12/21 24:00	38	360	38	79.1
			Toilet 2	62	7/21 16:00	28	580	28	55.0	12/21 19:00	28	177	28	76.2
			Toilet 3	62	7/21 15:00	29	593	29	55.0	12/21 19:00	29	185	29	76.3

Fans

System	Zone	Type	Efficiency with PRM				Power with PRM		Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Fan Override (kW)	
Support_PSZ-HP-Utility SF-1		System	87.00	N/A	1.25	429	.07	N/A	100.00

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
	Utility_EXHAUST FAN	Zone	10.00	N/A	0.00	477	.00	N/A	100.00
Utility_PSZ-HP-Utility SF-1		System	87.00	N/A	1.25	897	.15	N/A	100.00

System Component Selection Summary

Primary

System Name: DOAS to Zone Level Equipment Dehum and Reheat

System Type: Dedicated Outdoor Air System (DOAS)
Number of Zones 0
Number of Rooms 0

Component	Quantity
Cooling Coils	1
Heating Coils	1
Fans	1

Cooling Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design						Water Flow Conditions			
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity	Vent Load	Ov/undr sizing	Airflow		Vent	Enter DB/WB	Leave DB/WB	Flow (gpm)	Enter Temp	Leave Temp	
					(tons)	(MBh)	(MBh)	(MBh)	(MBh)	(cfm)	(cfm)	(°F)	(°F)	(°F)		(°F)	(°F)	(°F)
SCC-1		DX	Block		5.9	70.7	70.7	70.7	N/A	1,550	1,550	99.1	64.45	55.0	47.75	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB °F	Leave DB °F	Flow (gpm)	Enter Temp °F	Leave Temp °F
SCC-1	DESUPERHEATER	Desuperheater	Peak	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Load/Airflows

Location				Cooling				Heating					
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)					
System	Zone	Room							Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
DOAS to Zone Level Equipment Dehum and Reheat			0	7/21 15:00	1,550	70,661	1,550	55.0		N/A	0	1,550	55.0

Fans

System	Zone	Type	Efficiency (%)	Efficiency with PRM Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power with PRM Fan Override (kW)	Motor Heat in Air (%)
DOAS to Zone Level Equipment Dehum and Reheat SF-1		System	87.00	N/A	1.50	1,550	.31	N/A	100.00

System Name: Single Zone CV

System Type: Constant Volume (CV)
Number of Zones 1
Number of Rooms 2

Component	Quantity
Cooling Coils	1
Heating Coils	1
Fans	2

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	Total capacity (MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	Kitchen	DX	Block		7.9	94.8	94.8	49.4	N/A	2,532	2,500	100.1	67.12	64.1	54.68	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)		Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
SAAHP-1	HEATING Kitchen	DX	Block	12/21 04:00	94.8	94.8	N/A		2,532	2,500	32.1	68.6	N/A	N/A	N/A

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Kitchen	686	9/21 16:00	2,532	28,499	2,532	64.1	12/21 04:00	2,532	3,484	2,532	75.0
		Kitchen	382	7/21 18:00	2,500	28,254	2,500	64.1	12/21 20:00	2,500	12,818	2,500	75.0
		Service	304	9/21 16:00	359	4,060	359	64.1	12/21 04:00	359	2,320	359	76.3

Fans

System	Zone	Type	Efficiency with PRM						Power with PRM Fan Override (kW)	Motor Heat in Air (%)
			Efficiency (%)	Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)	Power (kW)		
	Kitchen_EXHAUST FAN	Zone	10.00	N/A	0.00	2,500	.00	N/A	100.00	
Kitchen_Single Zone	CV SF-1	System	87.00	N/A	3.00	2,532	1.03	N/A	100.00	

System Name: Variable Refrigerant Flow

System Type: Variable Air Volume (VAV)

Number of Zones 36

Number of Rooms 74

Component	Quantity
Cooling Coils	36
Heating Coils	72
Fans	36

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity		Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow Conditions at Design				Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)		
					(tons)	(MBh)				Airflow (cfm)	Vent (cfm)	Enter DB/WB (°F)	Leave DB/WB (°F)				Enter DB/WB (°F)	Leave DB/WB (°F)
	VRFHP-1 ACT-Noisy-1	DX	Peak		0.2	2.8	2.5	0.0	N/A	119	0	75.0	60.74	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 ACT-Noisy-2	DX	Peak		0.1	1.6	1.3	0.0	N/A	60	0	75.0	62.08	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 ACT-Noisy-3	DX	Peak		0.1	1.7	1.4	0.0	N/A	65	0	75.0	62.03	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-1	DX	Peak		0.1	0.8	0.7	0.0	N/A	35	0	75.0	60.87	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-2	DX	Peak		0.1	1.2	1.1	0.0	N/A	51	0	75.0	60.71	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 ACT-Quiet-3	DX	Peak		0.1	1.3	1.0	0.0	N/A	49	0	75.0	61.97	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 Admin	DX	Peak		0.1	1.8	1.7	0.0	N/A	80	0	75.0	60.31	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Atrium	DX	Peak		0.5	5.7	5.3	0.0	N/A	251	0	75.0	60.47	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	DX	Peak		0.1	1.1	0.9	0.0	N/A	44	0	75.0	61.80	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	DX	Peak		0.1	1.7	1.5	0.0	N/A	72	0	75.0	60.74	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Corridor-N	DX	Peak		0.1	1.7	1.7	0.0	N/A	80	0	75.0	58.73	54.5	50.68	N/A	N/A	N/A
	VRFHP-1 Corridor-S	DX	Peak		0.3	3.2	3.2	0.0	N/A	152	0	75.0	53.37	54.5	44.41	N/A	N/A	N/A
	VRFHP-1 Corridor-W	DX	Peak		0.3	3.6	3.6	0.0	N/A	171	0	75.0	58.70	54.5	50.66	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	DX	Peak		0.8	9.8	9.7	0.0	N/A	454	0	75.0	59.57	54.5	51.55	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	DX	Peak		0.1	1.2	1.1	0.0	N/A	50	0	75.0	60.89	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Group	DX	Peak		0.2	2.3	1.9	0.0	N/A	91	0	75.0	61.77	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 Hospitality	DX	Peak		0.1	1.3	1.3	0.0	N/A	81	0	75.0	62.23	60.2	56.65	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	DX	Peak		0.3	3.2	3.2	0.0	N/A	151	0	75.0	59.30	54.5	51.29	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	DX	Peak		0.1	0.9	0.8	0.0	N/A	37	0	75.0	60.84	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Lounge	DX	Peak		0.3	3.3	3.1	0.0	N/A	148	0	75.0	60.45	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	DX	Peak		0.3	4.1	3.4	0.0	N/A	160	0	75.0	61.82	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	DX	Peak		0.2	2.4	2.1	0.0	N/A	100	0	75.0	60.87	54.5	52.26	N/A	N/A	N/A

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 29 of 39

Cooling Coils

Coil Location			Coil Selection at Design							Airflow Conditions at Design						Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (tons)	capacity (MBh)	Sensible capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	WB (°F)	Leave DB (°F)	WB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 RB-N-East	DX	Peak		0.3	4.0	3.5	0.0	N/A	167	0	75.0	61.38	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 RB-N-West	DX	Peak		0.6	6.6	5.9	0.0	N/A	277	0	75.0	60.91	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	DX	Peak		0.2	2.0	1.9	0.0	N/A	87	0	75.0	60.53	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	DX	Peak		0.2	2.4	2.3	0.0	N/A	107	0	75.0	60.47	54.5	52.26	N/A	N/A	N/A
	VRFHP-1 RB-S-East	DX	Peak		0.5	5.7	5.0	0.0	N/A	235	0	75.0	61.40	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 RB-S-West	DX	Peak		0.2	2.1	1.9	0.0	N/A	89	0	75.0	61.28	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 RB-W-North	DX	Peak		0.2	2.1	1.9	0.0	N/A	90	0	75.0	61.32	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 RB-W-South	DX	Peak		0.5	6.6	6.5	0.0	N/A	304	0	75.0	59.22	54.5	51.16	N/A	N/A	N/A
	VRFHP-1 Servery	DX	Peak		0.2	1.9	1.6	0.0	N/A	75	0	75.0	61.83	54.5	52.76	N/A	N/A	N/A
	VRFHP-1 SHWR-N	DX	Peak		0.2	2.6	2.0	0.0	N/A	94	0	75.0	62.76	54.5	53.12	N/A	N/A	N/A
	VRFHP-1 SHWR-S	DX	Peak		0.2	2.7	2.1	0.0	N/A	101	0	75.0	62.67	54.5	53.12	N/A	N/A	N/A
	VRFHP-1 SHWR-W	DX	Peak		0.2	2.5	1.9	0.0	N/A	89	0	75.0	62.86	54.5	53.12	N/A	N/A	N/A
	VRFHP-1 Support	DX	Peak		0.4	4.7	4.7	0.0	N/A	220	0	75.0	58.71	54.5	50.67	N/A	N/A	N/A
	VRFHP-1 Utility	DX	Peak		0.9	10.9	10.6	0.0	N/A	496	0	75.0	60.28	54.5	52.26	N/A	N/A	N/A

*Values do not include effects of plenum loads, heat exchangers such as evaporative cooling devices and similar components.

Heating Coils

Coil Location			Coil Selection at Design						Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)	
	VRFHP-1 ACT-Noisy-1	DX	Peak	12/21 24:00	2.8	0.0	N/A	119	0	70.0	92.8	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-1	Electric	Peak	12/21 24:00	1.7	0.0	N/A	65	0	70.0	95.0	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-2	DX	Peak	12/21 24:00	1.6	0.0	N/A	60	0	70.0	95.6	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-2	Electric	Peak	12/21 24:00	1.5	0.0	N/A	60	0	70.0	93.5	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-3	DX	Peak	12/21 24:00	1.7	0.0	N/A	65	0	70.0	95.5	N/A	N/A	N/A	
	VRFHP-1 ACT-Noisy-3	Electric	Peak	12/21 24:00	1.7	0.0	N/A	65	0	70.0	95.3	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-1	DX	Peak	12/21 24:00	0.8	0.0	N/A	35	0	70.0	93.2	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-1	Electric	Peak	12/21 24:00	0.8	0.0	N/A	35	0	70.0	91.2	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-2	DX	Peak	12/21 24:00	1.2	0.0	N/A	51	0	70.0	92.7	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-2	Electric	Peak	12/21 24:00	0.9	0.0	N/A	51	0	70.0	87.6	N/A	N/A	N/A	
	VRFHP-1 ACT-Quiet-3	DX	Peak	12/21 24:00	1.3	0.0	N/A	49	0	70.0	95.3	N/A	N/A	N/A	

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 30 of 39

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 ACT-Quiet-3	Electric	Peak	12/21 24:00	0.9	0.0	N/A	49	0	70.0	88.7	N/A	N/A	N/A
	VRFHP-1 Admin	DX	Peak	12/21 04:00	1.8	0.0	N/A	80	0	70.0	91.5	N/A	N/A	N/A
	VRFHP-1 Admin	Electric	Peak	12/21 04:00	1.2	0.0	N/A	80	0	70.0	84.4	N/A	N/A	N/A
	VRFHP-1 Atrium	DX	Peak	12/21 24:00	5.7	0.0	N/A	251	0	70.0	92.0	N/A	N/A	N/A
	VRFHP-1 Atrium	Electric	Peak	12/21 24:00	6.6	0.0	N/A	251	0	70.0	95.7	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	DX	Peak	12/21 04:00	1.1	0.0	N/A	44	0	70.0	94.7	N/A	N/A	N/A
	VRFHP-1 Chart/Hotel	Electric	Peak	12/21 04:00	0.7	0.0	N/A	44	0	70.0	86.3	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	DX	Peak	12/21 24:00	1.7	0.0	N/A	72	0	70.0	92.8	N/A	N/A	N/A
	VRFHP-1 Comfort/Consult	Electric	Peak	12/21 24:00	2.2	0.0	N/A	72	0	70.0	100.0	N/A	N/A	N/A
	VRFHP-1 Corridor-N	DX	Peak	12/21 24:00	1.7	0.0	N/A	80	0	70.0	90.8	N/A	N/A	N/A
	VRFHP-1 Corridor-N	Electric	Peak	12/21 24:00	1.8	0.0	N/A	80	0	70.0	92.3	N/A	N/A	N/A
	VRFHP-1 Corridor-S	DX	Peak	12/21 24:00	3.2	0.0	N/A	152	0	70.0	90.6	N/A	N/A	N/A
	VRFHP-1 Corridor-S	Electric	Peak	12/21 24:00	1.8	0.0	N/A	152	0	70.0	81.7	N/A	N/A	N/A
	VRFHP-1 Corridor-W	DX	Peak	12/21 24:00	3.6	0.0	N/A	171	0	70.0	90.8	N/A	N/A	N/A
	VRFHP-1 Corridor-W	Electric	Peak	12/21 24:00	1.6	0.0	N/A	171	0	70.0	79.0	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	DX	Peak	12/21 24:00	9.8	0.0	N/A	454	0	70.0	91.1	N/A	N/A	N/A
	VRFHP-1 Entry/Waiting	Electric	Peak	12/21 24:00	4.8	0.0	N/A	454	0	70.0	80.4	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	DX	Peak	12/21 04:00	1.2	0.0	N/A	50	0	70.0	93.3	N/A	N/A	N/A
	VRFHP-1 Exam/Storage	Electric	Peak	12/21 04:00	1.3	0.0	N/A	50	0	70.0	94.9	N/A	N/A	N/A
	VRFHP-1 Group	DX	Peak	12/21 24:00	2.3	0.0	N/A	91	0	70.0	94.7	N/A	N/A	N/A
	VRFHP-1 Group	Electric	Peak	12/21 24:00	4.8	0.0	N/A	91	0	70.0	121.5	N/A	N/A	N/A
	VRFHP-1 Hospitality	DX	Peak	12/21 24:00	1.3	0.0	N/A	81	0	70.0	85.9	N/A	N/A	N/A
	VRFHP-1 Hospitality	Electric	Peak	12/21 24:00	2.9	0.0	N/A	81	0	70.0	104.4	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	DX	Peak	12/21 24:00	3.2	0.0	N/A	151	0	70.0	91.0	N/A	N/A	N/A
	VRFHP-1 Intake-HR-A	Electric	Peak	12/21 24:00	3.6	0.0	N/A	151	0	70.0	93.4	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	DX	Peak	12/21 04:00	0.9	0.0	N/A	37	0	70.0	93.1	N/A	N/A	N/A
	VRFHP-1 Intake-HR-B	Electric	Peak	12/21 04:00	0.9	0.0	N/A	37	0	70.0	94.1	N/A	N/A	N/A
	VRFHP-1 Lounge	DX	Peak	12/21 24:00	3.3	0.0	N/A	148	0	70.0	91.9	N/A	N/A	N/A
	VRFHP-1 Lounge	Electric	Peak	12/21 24:00	2.7	0.0	N/A	148	0	70.0	87.9	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	DX	Peak	12/21 24:00	4.1	0.0	N/A	160	0	70.0	94.8	N/A	N/A	N/A
	VRFHP-1 Multipurpose/Dining	Electric	Peak	12/21 24:00	8.9	0.0	N/A	160	0	70.0	124.3	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	DX	Peak	12/21 24:00	2.4	0.0	N/A	100	0	70.0	93.2	N/A	N/A	N/A
	VRFHP-1 RB-N-Corner	Electric	Peak	12/21 24:00	1.0	0.0	N/A	100	0	70.0	80.0	N/A	N/A	N/A
	VRFHP-1 RB-N-East	DX	Peak	12/21 24:00	4.0	0.0	N/A	167	0	70.0	93.5	N/A	N/A	N/A

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 31 of 39

Heating Coils

Coil Location			Coil Selection at Design					Airflow Conditions at Design				Water Flow Conditions		
System	Zone	Type	Sizing Method	Time of Peak Mo/D/Hr	Total capacity (MBh)	Vent Load (MBh)	Ov/undr sizing (MBh)	Airflow (cfm)	Vent (cfm)	Enter DB (°F)	Leave DB (°F)	Flow (gpm)	Enter Temp (°F)	Leave Temp (°F)
	VRFHP-1 RB-N-East	Electric	Peak	12/21 24:00	1.9	0.0	N/A	167	0	70.0	80.9	N/A	N/A	N/A
	VRFHP-1 RB-N-West	DX	Peak	12/21 24:00	6.6	0.0	N/A	277	0	70.0	93.3	N/A	N/A	N/A
	VRFHP-1 RB-N-West	Electric	Peak	12/21 24:00	2.4	0.0	N/A	277	0	70.0	78.6	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	DX	Peak	12/21 24:00	2.0	0.0	N/A	87	0	70.0	92.2	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-N	Electric	Peak	12/21 24:00	1.0	0.0	N/A	87	0	70.0	81.4	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	DX	Peak	12/21 24:00	2.4	0.0	N/A	107	0	70.0	92.0	N/A	N/A	N/A
	VRFHP-1 RB-S-Corner-S	Electric	Peak	12/21 24:00	1.0	0.0	N/A	107	0	70.0	79.5	N/A	N/A	N/A
	VRFHP-1 RB-S-East	DX	Peak	12/21 24:00	5.7	0.0	N/A	235	0	70.0	93.5	N/A	N/A	N/A
	VRFHP-1 RB-S-East	Electric	Peak	12/21 24:00	2.3	0.0	N/A	235	0	70.0	79.6	N/A	N/A	N/A
	VRFHP-1 RB-S-West	DX	Peak	12/21 24:00	2.1	0.0	N/A	89	0	70.0	93.1	N/A	N/A	N/A
	VRFHP-1 RB-S-West	Electric	Peak	12/21 24:00	0.8	0.0	N/A	89	0	70.0	78.8	N/A	N/A	N/A
	VRFHP-1 RB-W-North	DX	Peak	12/21 24:00	2.1	0.0	N/A	90	0	70.0	93.3	N/A	N/A	N/A
	VRFHP-1 RB-W-North	Electric	Peak	12/21 24:00	1.1	0.0	N/A	90	0	70.0	81.7	N/A	N/A	N/A
	VRFHP-1 RB-W-South	DX	Peak	12/21 24:00	6.6	0.0	N/A	304	0	70.0	91.0	N/A	N/A	N/A
	VRFHP-1 RB-W-South	Electric	Peak	12/21 24:00	2.9	0.0	N/A	304	0	70.0	79.2	N/A	N/A	N/A
	VRFHP-1 Servery	DX	Peak	12/21 24:00	1.9	0.0	N/A	75	0	70.0	94.9	N/A	N/A	N/A
	VRFHP-1 Servery	Electric	Peak	12/21 24:00	4.1	0.0	N/A	75	0	70.0	123.0	N/A	N/A	N/A
	VRFHP-1 SHWR-N	DX	Peak	12/21 24:00	2.6	0.0	N/A	94	0	70.0	96.8	N/A	N/A	N/A
	VRFHP-1 SHWR-N	Electric	Peak	12/21 24:00	0.9	0.0	N/A	94	0	70.0	79.0	N/A	N/A	N/A
	VRFHP-1 SHWR-S	DX	Peak	12/21 24:00	2.7	0.0	N/A	101	0	70.0	96.6	N/A	N/A	N/A
	VRFHP-1 SHWR-S	Electric	Peak	12/21 24:00	0.9	0.0	N/A	101	0	70.0	78.3	N/A	N/A	N/A
	VRFHP-1 SHWR-W	DX	Peak	12/21 24:00	2.5	0.0	N/A	89	0	70.0	97.1	N/A	N/A	N/A
	VRFHP-1 SHWR-W	Electric	Peak	12/21 24:00	0.9	0.0	N/A	89	0	70.0	79.5	N/A	N/A	N/A
	VRFHP-1 Support	DX	Peak	12/21 04:00	4.7	0.0	N/A	220	0	70.0	90.8	N/A	N/A	N/A
	VRFHP-1 Support	Electric	Peak	12/21 04:00	3.4	0.0	N/A	220	0	70.0	85.2	N/A	N/A	N/A
	VRFHP-1 Utility	DX	Peak	12/21 04:00	10.9	0.0	N/A	496	0	70.0	91.4	N/A	N/A	N/A
	VRFHP-1 Utility	Electric	Peak	12/21 04:00	9.8	0.0	N/A	496	0	70.0	89.2	N/A	N/A	N/A

Load/Airflows

Location			Cooling					Heating					
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	8/21 17:00	119	2,471	38	55.0	12/21 24:00	119	1,661	38	95.0
		Noisy Activity 1	180	8/21 17:00	119	2,464	38	55.0	12/21 23:00	119	1,658	38	95.0
	ACT-Noisy-2		181	7/21 18:00	60	1,254	38	55.0	12/21 24:00	60	1,451	38	93.5
		Noisy Activity 2	181	7/21 18:00	59	1,231	38	55.0	12/21 23:00	59	1,436	38	93.6
	ACT-Noisy-3		182	7/21 15:00	65	1,341	38	55.0	12/21 24:00	65	1,674	38	95.3
		Noisy Activity 3	182	7/21 15:00	64	1,332	38	55.0	12/21 23:00	64	1,671	38	95.4
	ACT-Quiet-1		130	9/21 15:00	35	731	27	55.0	12/21 24:00	35	766	27	91.2
		Quiet Activity 1	130	9/21 14:00	35	725	27	55.0	12/21 23:00	35	760	27	91.2
	ACT-Quiet-2		131	9/21 15:00	51	1,062	27	55.0	12/21 24:00	51	925	27	87.6
		Quiet Activity 2	131	9/21 15:00	50	1,044	27	55.0	12/21 23:00	50	907	27	87.6
	ACT-Quiet-3		131	7/21 19:00	49	1,013	28	55.0	12/21 24:00	49	933	28	88.7
		Quiet Activity 3	131	7/21 19:00	48	1,007	28	55.0	12/21 23:00	48	930	28	88.7
	Admin		189	9/21 14:00	80	1,671	21	55.0	12/21 04:00	80	1,188	21	84.4
		Office 1	94	10/21 14:00	44	916	10	55.0	12/21 04:00	44	614	10	83.6
		Office 2	95	10/21 13:00	40	828	10	55.0	12/21 04:00	40	587	10	84.3
	Attrium		1,267	7/21 17:00	251	5,223	108	55.0	12/21 24:00	251	6,620	108	95.7
		Attrium	622	7/21 17:00	87	1,818	53	55.0	12/21 23:00	87	2,760	53	100.8
		Attrium 2	645	7/21 17:00	164	3,405	55	55.0	12/21 23:00	164	3,695	55	92.0
	Chart/Hotel		200	7/21 19:00	44	907	22	55.0	12/21 04:00	44	729	22	86.3
		Chart/Hotel	200	7/21 19:00	41	861	22	55.0	12/21 04:00	41	700	22	86.5
	Comfort/Consult		283	7/21 17:00	72	1,481	72	55.0	12/21 24:00	72	2,190	72	100.0
		Comfort Room 2	82	7/21 17:00	21	436	21	55.0	12/21 23:00	21	644	21	99.9
		Consult 1	100	7/21 17:00	25	502	25	55.0	12/21 23:00	25	756	25	100.5
		Consult 2	102	7/21 17:00	26	535	26	55.0	12/21 23:00	26	776	26	99.4
	Corridor-N		409	7/21 18:00	80	1,670	25	55.0	12/21 24:00	80	1,840	25	92.3
		Corridor 3	409	7/21 18:00	80	1,665	25	55.0	12/21 23:00	80	1,836	25	92.3
	Corridor-S		414	10/21 13:00	152	3,127	25	55.0	12/21 24:00	152	1,818	25	81.7
		Corridor 5	414	10/21 13:00	151	3,125	25	55.0	12/21 23:00	151	1,813	25	81.7
	Corridor-W		324	7/21 17:00	171	3,549	19	55.0	12/21 24:00	171	1,577	19	79.0
		Corridor 4	324	7/21 17:00	170	3,529	19	55.0	12/21 23:00	170	1,561	19	79.0
	Entry/Waiting		370	7/21 09:00	454	9,432	31	55.0	12/21 24:00	454	4,841	31	80.4
		Entry/Waiting	370	7/21 09:00	457	9,498	31	55.0	12/21 24:00	457	4,857	31	80.4

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 33 of 39

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Exam/Storage		224	7/21 19:00	50	1,034	37	55.0	12/21 04:00	50	1,271	37	94.9
		Exam Room	123	7/21 19:00	31	363	31	55.0	12/21 19:00	31	625	31	104.8
		Long Term Belongings Storage	101	7/21 19:00	18	382	6	55.0	12/21 04:00	18	324	6	87.2
	Group		276	7/21 18:00	91	1,116	91	55.0	12/21 24:00	91	2,835	91	121.5
		Group	276	7/21 18:00	91	1,111	91	61.2	12/21 23:00	91	2,838	91	105.9
	Hospitality		246	7/21 17:00	81	1,072	81	60.7	12/21 24:00	81	2,535	81	104.4
		Hospitality	246	7/21 17:00	81	1,073	81	60.7	12/21 23:00	81	2,537	81	104.3
	Intake-HR-A		470	9/21 14:00	151	3,125	69	55.0	12/21 24:00	151	3,609	69	93.4
		Intake Corridor	155	7/21 18:00	18	374	9	55.0	12/21 23:00	18	468	9	95.4
		Interview Room	158	9/21 16:00	47	965	40	55.0	12/21 23:00	47	1,392	40	99.2
		Sally Port	78	10/21 13:00	51	1,053	20	55.0	12/21 19:00	51	909	20	87.4
		Shower 1	80	7/21 17:00	35	729	0	55.0	12/21 24:00	35	353	0	79.8
	Intake-HR-B		165	7/21 19:00	37	771	26	55.0	12/21 04:00	37	916	26	94.1
		Ante Room	81	7/21 19:00	16	327	5	55.0	12/21 04:00	16	268	5	86.6
		Comfort Room 1	84	7/21 18:00	21	327	21	55.0	12/21 07:00	21	514	21	101.9
	Lounge		297	9/21 15:00	148	3,074	65	55.0	12/21 24:00	148	2,717	65	87.9
		Lounge	198	10/21 14:00	94	1,939	65	55.0	12/21 19:00	94	2,180	65	92.7
		Shower 2	99	9/21 17:00	54	1,129	0	55.0	12/21 20:00	54	319	0	75.7
	Multipurpose/Dining		485	7/21 16:00	160	1,837	160	55.0	12/21 24:00	160	4,918	160	124.3
		Multipurpose/Dining	485	7/21 18:00	160	1,828	160	55.0	12/21 23:00	160	4,917	160	124.5
	RB-N-Corner		130	7/21 18:00	100	2,086	14	55.0	12/21 24:00	100	1,033	14	80.0
		Resident Room 14	130	7/21 18:00	100	2,087	14	55.0	12/21 23:00	100	1,033	14	80.0
	RB-N-East		257	7/21 10:00	167	3,466	28	55.0	12/21 24:00	167	1,863	28	80.9
		Resident Room 15	130	7/21 10:00	86	1,781	14	55.0	12/21 23:00	86	1,042	14	81.9
		Resident Room 16	127	7/21 10:00	81	1,680	14	55.0	12/21 23:00	81	820	14	79.9
	RB-N-West		383	7/21 18:00	277	5,751	42	55.0	12/21 24:00	277	2,443	42	78.6
		Resident Room 11	129	7/21 18:00	91	1,899	14	55.0	12/21 23:00	91	806	14	78.6
		Resident Room 12	127	7/21 18:00	92	1,914	14	55.0	12/21 23:00	92	802	14	78.5
		Resident Room 13	127	7/21 18:00	93	1,925	14	55.0	12/21 23:00	93	819	14	78.6
	RB-S-Corner-N		129	9/21 14:00	87	1,815	14	55.0	12/21 24:00	87	1,023	14	81.4
		Resident Room 04	129	9/21 14:00	88	1,819	14	55.0	12/21 23:00	88	1,026	14	81.4

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 34 of 39

Load/Airflows

Location				Cooling					Heating				
System	Zone	Room	Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-Corner-S		131	9/21 17:00	107	2,222	14	55.0	12/21 24:00	107	1,039	14	79.5
		Resident Room 05	131	9/21 17:00	107	2,221	14	55.0	12/21 23:00	107	1,038	14	79.5
	RB-S-East		372	7/21 10:00	235	4,882	41	55.0	12/21 24:00	235	2,303	41	79.6
		Resident Room 01	124	8/21 10:00	73	1,527	14	55.0	12/21 23:00	73	707	14	79.4
		Resident Room 02	112	7/21 10:00	75	1,558	12	55.0	12/21 23:00	75	716	12	79.3
		Resident Room 03	136	7/21 10:00	86	1,797	15	55.0	12/21 23:00	86	867	15	79.8
	RB-S-West		124	7/21 18:00	89	1,843	14	55.0	12/21 24:00	89	797	14	78.8
		Resident Room 06	124	7/21 18:00	89	1,842	14	55.0	12/21 23:00	89	796	14	78.8
	RB-W-North		130	7/21 18:00	90	1,869	14	55.0	12/21 24:00	90	1,082	14	81.7
		Resident Room 10	130	7/21 18:00	90	1,868	14	55.0	12/21 23:00	90	1,081	14	81.7
	RB-W-South		380	10/21 14:00	304	6,302	42	55.0	12/21 24:00	304	2,853	42	79.2
		Resident Room 07	125	10/21 14:00	98	2,025	14	55.0	12/21 23:00	98	846	14	78.5
		Resident Room 08	126	10/21 14:00	101	2,104	14	55.0	12/21 23:00	101	882	14	78.5
		Resident Room 09	128	9/21 15:00	105	2,190	14	55.0	12/21 23:00	105	1,086	14	80.0
	Servery		228	7/21 17:00	75	828	75	55.0	12/21 24:00	75	2,162	75	122.9
		Servery	228	7/21 17:00	75	826	75	55.0	12/21 23:00	75	2,163	75	123.1
	SHWR-N		204	7/21 12:00	94	1,946	0	55.0	12/21 24:00	94	868	0	79.0
		Shower 7	103	7/21 12:00	48	992	0	55.0	12/21 24:00	48	427	0	78.7
		Shower 8	101	7/21 12:00	46	947	0	55.0	12/21 24:00	46	431	0	79.2
	SHWR-S		207	7/21 18:00	101	2,099	0	55.0	12/21 24:00	101	855	0	78.3
		Shower 3	104	7/21 18:00	50	1,043	0	55.0	12/21 24:00	50	420	0	78.2
		Shower 4	103	7/21 18:00	51	1,050	0	55.0	12/21 24:00	51	432	0	78.3
	SHWR-W		207	7/21 18:00	89	1,853	0	55.0	12/21 24:00	89	870	0	79.5
		Shower 5	104	7/21 18:00	45	939	0	55.0	12/21 24:00	45	441	0	79.5
		Shower 6	104	7/21 18:00	44	910	0	55.0	12/21 24:00	44	425	0	79.5
	Support		603	7/21 19:00	220	4,564	36	55.0	12/21 04:00	220	3,423	36	85.2
		Electric	191	9/21 15:00	76	1,567	11	55.0	12/21 01:00	76	1,203	11	85.5
		Emergency Electric	179	7/21 09:00	59	1,223	11	55.0	12/21 01:00	59	843	11	83.9
		Fire Room	79	8/21 09:00	42	871	5	55.0	12/21 01:00	42	597	5	83.9
		Mechanical	155	7/21 19:00	43	899	9	55.0	12/21 01:00	43	454	9	80.2

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 35 of 39

Load/Airflows

Location				Cooling					Heating				
			Area (ft²)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow (cfm)	SAT (°F)
System	Zone	Room											
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	7/21 19:00	496	10,316	164	55.0	12/21 04:00	496	9,762	164	89.2
		Clean Supply	102	7/21 19:00	17	355	6	55.0	12/21 04:00	17	323	6	88.5
		Corridor 1	295	7/21 18:00	36	744	18	55.0	12/21 23:00	36	920	18	95.0
		Corridor 2	635	7/21 18:00	61	1,263	38	55.0	12/21 23:00	61	1,810	38	99.0
		Corridor 2.1	85	9/21 16:00	12	246	5	55.0	12/21 23:00	12	292	5	94.0
		General Storage	96	7/21 19:00	36	742	6	55.0	12/21 04:00	36	342	6	79.3
		Hskp	57	7/21 19:00	11	223	3	55.0	12/21 04:00	11	190	3	87.2
		IT	158	7/21 19:00	40	821	9	55.0	12/21 04:00	40	281	9	76.9
		Laundry	122	7/21 19:00	20	413	7	55.0	12/21 04:00	20	382	7	88.8
		Meds	129	7/21 19:00	21	446	8	55.0	12/21 04:00	21	415	8	88.9
		Soiled Supply	97	7/21 19:00	17	350	6	55.0	12/21 04:00	17	309	6	87.9
		Staff Corridor	893	9/21 16:00	144	2,974	54	55.0	12/21 07:00	144	3,186	54	91.6
		Stor.	15	7/21 19:00	7	144	0	55.0	12/21 04:00	7	90	0	82.7
		Storage	52	7/21 19:00	16	336	3	55.0	12/21 04:00	16	278	3	86.8
		Toilet 1	67	7/21 10:00	35	724	0	55.0	12/21 24:00	35	330	0	79.3
		Toilet 2	62	7/21 18:00	18	462	0	50.7	12/21 20:00	18	151	0	78.0
		Toilet 3	62	7/21 18:00	19	467	0	50.8	12/21 20:00	19	157	0	78.3

Fans

								Power with PRM Fan Override	Motor Heat in Air
			Efficiency (%)	Efficiency with PRM Fan Override (%)	Static Pressure (in. Wg)	Flow Rate (cfm)	Power (kW)		
System	Zone	Type	(%)	(%)	(in. Wg)	(cfm)	(kW)	(kW)	(%)
	ACT-Noisy-1_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	119	.02	N/A	100.00
	ACT-Noisy-2_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	60	.01	N/A	100.00
	ACT-Noisy-3_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	65	.01	N/A	100.00
	ACT-Quiet-1_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	35	.01	N/A	100.00

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 36 of 39

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat in Air
			(%)	Fan Override (%)	Pressure (in. Wg)			Fan Override (kW)	
	ACT-Quiet-2_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	51	.01	N/A	100.00
	ACT-Quiet-3_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	49	.01	N/A	100.00
	Admin_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	80	.01	N/A	100.00
	Attrium_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	251	.04	N/A	100.00
	Chart/Hotel_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	44	.01	N/A	100.00
	Comfort/Consult_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	72	.01	N/A	100.00
	Corridor-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	80	.01	N/A	100.00
	Corridor-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	152	.02	N/A	100.00
	Corridor-W_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	171	.03	N/A	100.00
	Entry/Waiting_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	454	.07	N/A	100.00
	Exam/Storage_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	50	.01	N/A	100.00
	Group_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	91	.01	N/A	100.00
	Hospitality_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	81	.01	N/A	100.00
	Intake-HR-A_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	151	.02	N/A	100.00
	Intake-HR-B_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	37	.01	N/A	100.00
	Lounge_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	148	.02	N/A	100.00
	Multipurpose/Dining_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	160	.02	N/A	100.00
	RB-N-Corner_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	100	.01	N/A	100.00
	RB-N-East_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	167	.02	N/A	100.00
	RB-N-West_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	277	.04	N/A	100.00
	RB-S-Corner-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	87	.01	N/A	100.00
	RB-S-Corner-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	107	.02	N/A	100.00

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 37 of 39

Fans

System	Zone	Type	Efficiency	Efficiency with PRM	Static	Flow Rate	Power	Power with PRM	Motor Heat
			(%)	Fan Override (%)	Pressure (in. Wg)		(kW)	Fan Override (kW)	in Air (%)
	RB-S-East_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	235	.03	N/A	100.00
	RB-S-West_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	89	.01	N/A	100.00
	RB-W-North_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	90	.01	N/A	100.00
	RB-W-South_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	304	.04	N/A	100.00
	Servery_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	75	.01	N/A	100.00
	SHWR-N_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	94	.01	N/A	100.00
	SHWR-S_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	101	.01	N/A	100.00
	SHWR-W_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	89	.01	N/A	100.00
	Support_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	220	.03	N/A	100.00
	Utility_VRFHP-1_SUPPLY FAN	Zone	60.00	N/A	0.75	496	.07	N/A	100.00

Loop Name: Air Source VRF
Loop Type: VRF Loop
Number of Assigned Coils: 0

Pumps

Name	Type	Contol	Head (psig)	Flow (gpm)	Power (W)	Power per Flow (W/gpm)
------	------	--------	-------------	------------	-----------	------------------------

Plant Equipment

Name	Type	Nominal Capacity (tons)	Efficiency (COP)
Air Source VRF OVRF-1	Condenser Loop	9.46	0.00

Psychrometric State Points

Simulation peak data is not available for this alternative because the simulation peak was not calculated. To view simulation peak data, go to the Load Design Parameters tab of Simulation Settings, set 'Perform special building block calculations during Design' to Yes and recalculate the alternative.

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-1 _PSZ-HP-Activity SAAHP-1

System Name :	ACT-Noisy-1 _PSZ-HP-Activity		
Time of Peak :	July 21 17:00	Percent Outdoor Air	19.00 %
Coil Air Flow :	199 (cfm)	Air Specific Heat	0.2437 (Btu/lb·°F)
Coil Capacity :	5 (MBh)	Air Density	0.0711 (lb/ft³)
Zone Space Sensible Loads	4.1 (MBh)	Air Density Specific Heat Factor	1.0396 Btuh/cfm-F
Outdoor Air Flow Rate	38 (cfm)	Latent Heat Factor	0.6557 Btuh/(cfm-gr/lb)
		Enthalpy Factor	4.2660 Btuh/(cfm-btu/lb)
		*Value has been adjusted for elevation	

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.3	46.3	
Return Air	75.7		63.0		
Outdoor Air	94.0	63.5	44.0		
Entering Coil	79.1	61.8	59.4		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-2 _PSZ-HP-Activity SAAHP-1

System Name : ACT-Noisy-2 _PSZ-HP-Activity
Time of Peak : July 21 15:00
Coil Air Flow : 103 (cfm)
Coil Capacity : 3 (MBh)
Zone Space Sensible Loads 2.1 (MBh)
Outdoor Air Flow Rate 38 (cfm)

Percent Outdoor Air 36.92 %
Air Specific Heat 0.2438 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0401 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.1	51.2	
Return Air	76.3		70.1		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	84.6	64.5	63.5		
Leaving Coil	54.5	52.7	59.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-3 _PSZ-HP-Activity SAAHP-1

System Name : ACT-Noisy-3 _PSZ-HP-Activity
Time of Peak : July 21 15:00
Coil Air Flow : 107 (cfm)
Coil Capacity : 4 (MBh)
Zone Space Sensible Loads 2.2 (MBh)
Outdoor Air Flow Rate 38 (cfm)

Percent Outdoor Air 35.89 %
Air Specific Heat 0.2438 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0401 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		69.4	50.7	
Return Air	76.3		69.4		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	84.3	64.3	63.2		
Leaving Coil	54.5	52.7	59.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-1 _PSZ-HP-Activity SAAHP-1**System Name :** ACT-Quiet-1 _PSZ-HP-Activity**Time of Peak :** July 21 15:00**Coil Air Flow :** 60 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.2 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air** 45.48 %**Air Specific Heat** 0.2434 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0383 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		66.2	48.4	
Return Air	76.6		66.2		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	86.7	64.4	59.8		
Leaving Coil	54.4	51.2	53.7		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-2 _PSZ-HP-Activity SAAHP-1**System Name :** ACT-Quiet-2 _PSZ-HP-Activity**Time of Peak :** July 21 15:00**Coil Air Flow :** 76 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.4 (MBh)**Outdoor Air Flow Rate** 27 (cfm)**Percent Outdoor Air** 35.89 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		65.8	48.2	
Return Air	76.3		64.4		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	84.2	62.8	55.8		
Leaving Coil	54.4	51.5	55.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-3 _PSZ-HP-Activity SAAHP-1**System Name :** ACT-Quiet-3 _PSZ-HP-Activity**Time of Peak :** July 21 16:00**Coil Air Flow :** 74 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.4 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 37.04 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.7	51.7	
Return Air	76.4		70.7		
Outdoor Air	96.9	66.1	52.3		
Entering Coil	84.0	64.3	63.9		
Leaving Coil	54.5	52.7	59.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Admin _PSZ-HP-Admin SAAHP-1**System Name :** Admin _PSZ-HP-Admin**Time of Peak :** September 21 14:00**Coil Air Flow :** 119 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 21 (cfm)**Percent Outdoor Air** 17.49 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.3	43.4	
Return Air	76.2		59.3		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	80.1	61.4	55.9		
Leaving Coil	54.4	51.5	55.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Attrium_PSZ-HP-Atrium SAAHP-1**System Name :** Attrium_PSZ-HP-Atrium**Time of Peak :** July 21 15:00**Coil Air Flow :** 404 (cfm)**Coil Capacity :** 12 (MBh)**Zone Space Sensible Loads** 7.7 (MBh)**Outdoor Air Flow Rate** 108 (cfm)**Percent Outdoor Air** 26.66 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.2	44.8	
Return Air	76.9		60.3		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	82.6	62.1	55.0		
Leaving Coil	54.4	51.5	55.0		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Chart/Hotel_PSZ-HP-Admin SAAHP-1**System Name :** Chart/Hotel_PSZ-HP-Admin**Time of Peak :** July 21 15:00**Coil Air Flow :** 70 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.2 (MBh)**Outdoor Air Flow Rate** 22 (cfm)**Percent Outdoor Air** 31.49 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.3	49.2	
Return Air	77.5		67.3		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	84.2	64.1	62.6		
Leaving Coil	55.0	52.6	58.4		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Comfort/Consult _PSZ-HP-Clinical SAAHP-1**System Name :** Comfort/Consult _PSZ-HP-Clinical**Time of Peak :** July 21 15:00**Coil Air Flow :** 154 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 3.2 (MBh)**Outdoor Air Flow Rate** 72 (cfm)**Percent Outdoor Air** 46.99 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.5	46.5	
Return Air	76.9		63.5		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	87.2	64.2	58.2		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Corridor-N _PSZ-HP-ResBed-N SAAHP-1**System Name :** Corridor-N _PSZ-HP-ResBed-N**Time of Peak :** July 21 15:00**Coil Air Flow :** 116 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 25 (cfm)**Percent Outdoor Air** 21.21 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.7	38.7	
Return Air	77.5		52.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	82.0	61.3	52.6		
Leaving Coil	54.4	50.9	52.6		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Corridor-S _PSZ-HP-ResBed-S SAAHP-1

System Name : Corridor-S _PSZ-HP-ResBed-S
Time of Peak : September 21 14:00
Coil Air Flow : 183 (cfm)
Coil Capacity : 5 (MBh)
Zone Space Sensible Loads 3.6 (MBh)
Outdoor Air Flow Rate 25 (cfm)

Percent Outdoor Air 13.59 %
Air Specific Heat 0.242 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0324 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		31.1	23.0	
Return Air	76.6		31.1		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	79.6	55.8	32.4		
Leaving Coil	54.4	44.7	30.9		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Corridor-W _PSZ-HP-ResBed-W SAAHP-1

System Name : Corridor-W _PSZ-HP-ResBed-W
Time of Peak : July 21 17:00
Coil Air Flow : 199 (cfm)
Coil Capacity : 5 (MBh)
Zone Space Sensible Loads 4.1 (MBh)
Outdoor Air Flow Rate 19 (cfm)

Percent Outdoor Air 9.77 %
Air Specific Heat 0.2433 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0379 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.8	38.7	
Return Air	76.1		52.8		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	77.9	59.9	52.8		
Leaving Coil	54.4	50.9	52.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Entry/Waiting _PSZ-HP-Admin SAAHP-1**System Name :** Entry/Waiting _PSZ-HP-Admin**Time of Peak :** July 21 09:00**Coil Air Flow :** 492 (cfm)**Coil Capacity :** 11 (MBh)**Zone Space Sensible Loads** 10.2 (MBh)**Outdoor Air Flow Rate** 31 (cfm)**Percent Outdoor Air** 6.40 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.9	41.0	
Return Air	75.5		55.9		
Outdoor Air	81.8	61.2	52.2		
Entering Coil	75.9	59.9	55.7		
Leaving Coil	54.4	51.5	55.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Exam/Storage _PSZ-HP-Clinical SAAHP-1**System Name :** Exam/Storage _PSZ-HP-Clinical**Time of Peak :** July 21 15:00**Coil Air Flow :** 84 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.7 (MBh)**Outdoor Air Flow Rate** 37 (cfm)**Percent Outdoor Air** 44.34 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.9	46.7	
Return Air	77.1		63.9		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	86.7	64.2	58.7		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Group_PSZ-HP-Clinical SAAHP-1**System Name :** Group_PSZ-HP-Clinical**Time of Peak :** July 21 15:00**Coil Air Flow :** 152 (cfm)**Coil Capacity :** 6 (MBh)**Zone Space Sensible Loads** 3.1 (MBh)**Outdoor Air Flow Rate** 91 (cfm)**Percent Outdoor Air** 59.96 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.3	49.9	
Return Air	76.2		68.3		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	89.7	65.1	58.7		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Hospitality_PSZ-HP-Common SAAHP-1**System Name :** Hospitality_PSZ-HP-Common**Time of Peak :** July 21 15:00**Coil Air Flow :** 274 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.9 (MBh)**Outdoor Air Flow Rate** 81 (cfm)**Percent Outdoor Air** 29.64 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.3	49.9	
Return Air	75.6		68.3		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	82.5	63.8	63.6		
Leaving Coil	64.3	57.4	63.2		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Intake-HR-A _PSZ-HP-Clinical SAAHP-1

System Name : Intake-HR-A _PSZ-HP-Clinical
Time of Peak : September 21 14:00
Coil Air Flow : 311 (cfm)
Coil Capacity : 9 (MBh)
Zone Space Sensible Loads 5.6 (MBh)
Outdoor Air Flow Rate 69 (cfm)

Percent Outdoor Air 22.27 %
Air Specific Heat 0.2434 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0383 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		56.7	41.6	
Return Air	76.3		56.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	81.2	61.2	53.1		
Leaving Coil	54.4	50.9	52.9		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Intake-HR-B _PSZ-HP-Clinical SAAHP-1

System Name : Intake-HR-B _PSZ-HP-Clinical
Time of Peak : July 21 15:00
Coil Air Flow : 66 (cfm)
Coil Capacity : 2 (MBh)
Zone Space Sensible Loads 1.4 (MBh)
Outdoor Air Flow Rate 26 (cfm)

Percent Outdoor Air 39.65 %
Air Specific Heat 0.2437 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0396 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.3	46.3	
Return Air	76.9		63.3		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	85.6	63.9	58.9		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Kitchen _PSZ-HP-Kitchen SAAHP-1

System Name : Kitchen _PSZ-HP-Kitchen
Time of Peak : September 21 14:00
Coil Air Flow : 2,853 (cfm)
Coil Capacity : 69 (MBh)
Zone Space Sensible Loads 32.1 (MBh)
Outdoor Air Flow Rate 174 (cfm)

Percent Outdoor Air 6.09 %
Air Specific Heat 0.2434 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0383 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		56.6	41.5	
Return Air	75.2		56.6		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	76.6	60.1	55.7		
Leaving Coil	54.4	51.1	53.7		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Lounge _PSZ-HP-Common SAAHP-1

System Name : Lounge _PSZ-HP-Common
Time of Peak : September 21 14:00
Coil Air Flow : 290 (cfm)
Coil Capacity : 9 (MBh)
Zone Space Sensible Loads 5.6 (MBh)
Outdoor Air Flow Rate 65 (cfm)

Percent Outdoor Air 22.54 %
Air Specific Heat 0.2428 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0358 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		50.7	37.2	
Return Air	75.7		50.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	80.8	60.0	48.4		
Leaving Coil	54.4	48.7	44.7		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Multipurpose/Dining _PSZ-HP-Common SAAHP-1**System Name :** Multipurpose/Dining _PSZ-HP-Common**Time of Peak :** July 21 15:00**Coil Air Flow :** 268 (cfm)**Coil Capacity :** 10 (MBh)**Zone Space Sensible Loads** 5.6 (MBh)**Outdoor Air Flow Rate** 160 (cfm)**Percent Outdoor Air** 59.80 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.1	49.8	
Return Air	76.2		68.1		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	89.7	65.1	58.7		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-N-Corner _PSZ-HP-ResBed-N SAAHP-1**System Name :** RB-N-Corner _PSZ-HP-ResBed-N**Time of Peak :** July 21 17:00**Coil Air Flow :** 128 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.2 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 11.16 %**Air Specific Heat** 0.2441 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0413 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.1	49.8	
Return Air	75.6		68.1		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	77.7	62.8	66.3		
Leaving Coil	57.6	55.1	64.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-N-East _PSZ-HP-ResBed-N SAAHP-1**System Name :** RB-N-East _PSZ-HP-ResBed-N**Time of Peak :** July 21 11:00**Coil Air Flow :** 202 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 3.7 (MBh)**Outdoor Air Flow Rate** 28 (cfm)**Percent Outdoor Air** 13.98 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.7	49.5	
Return Air	75.8		67.7		
Outdoor Air	91.7	64.5	52.2		
Entering Coil	78.0	62.7	65.6		
Leaving Coil	56.7	54.4	62.9		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-N-West _PSZ-HP-ResBed-N SAAHP-1**System Name :** RB-N-West _PSZ-HP-ResBed-N**Time of Peak :** July 21 17:00**Coil Air Flow :** 348 (cfm)**Coil Capacity :** 8 (MBh)**Zone Space Sensible Loads** 6.2 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air** 12.11 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.9	49.7	
Return Air	75.7		67.9		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	78.0	62.8	66.0		
Leaving Coil	57.2	54.8	63.6		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-N _PSZ-HP-Clinical SAAHP-1**System Name :** RB-S-Corner-N _PSZ-HP-Clinical**Time of Peak :** July 21 15:00**Coil Air Flow :** 94 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 1.9 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 15.08 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.4	46.4	
Return Air	75.9		62.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	79.3	61.8	59.4		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-S _PSZ-HP-ResBed-S SAAHP-1**System Name :** RB-S-Corner-S _PSZ-HP-ResBed-S**Time of Peak :** July 21 17:00**Coil Air Flow :** 114 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.63 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		62.6	45.8	
Return Air	75.7		62.2		
Outdoor Air	96.5	63.6	40.3		
Entering Coil	78.4	61.5	59.4		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-S-East _PSZ-HP-ResBed-S SAAHP-1**System Name :** RB-S-East _PSZ-HP-ResBed-S**Time of Peak :** July 21 11:00**Coil Air Flow :** 282 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 5.2 (MBh)**Outdoor Air Flow Rate** 41 (cfm)**Percent Outdoor Air** 14.50 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.7	49.5	
Return Air	75.8		67.7		
Outdoor Air	91.7	64.5	52.2		
Entering Coil	78.1	62.7	65.5		
Leaving Coil	56.5	54.3	62.7		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-S-West _PSZ-HP-ResBed-S SAAHP-1**System Name :** RB-S-West _PSZ-HP-ResBed-S**Time of Peak :** July 21 17:00**Coil Air Flow :** 112 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.14 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.9	49.7	
Return Air	75.7		67.9		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	78.0	62.8	66.0		
Leaving Coil	57.2	54.8	63.6		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-W-North _PSZ-HP-ResBed-W SAAHP-1**System Name :** RB-W-North _PSZ-HP-ResBed-W**Time of Peak :** July 21 18:00**Coil Air Flow :** 113 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 14 (cfm)**Percent Outdoor Air** 12.63 %**Air Specific Heat** 0.244 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0409 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.8	49.6	
Return Air	75.7		67.8		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	77.7	62.7	65.9		
Leaving Coil	57.1	54.7	63.4		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : RB-W-South _PSZ-HP-ResBed-W SAAHP-1**System Name :** RB-W-South _PSZ-HP-ResBed-W**Time of Peak :** September 21 14:00**Coil Air Flow :** 322 (cfm)**Coil Capacity :** 9 (MBh)**Zone Space Sensible Loads** 6.6 (MBh)**Outdoor Air Flow Rate** 42 (cfm)**Percent Outdoor Air** 12.98 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.2	41.9	
Return Air	75.7		57.2		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	78.7	60.7	55.0		
Leaving Coil	54.4	50.9	52.7		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Servery_PSZ-HP-Common SAAHP-1**System Name :** Servery_PSZ-HP-Common**Time of Peak :** July 21 15:00**Coil Air Flow :** 120 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 2.5 (MBh)**Outdoor Air Flow Rate** 75 (cfm)**Percent Outdoor Air** 62.56 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.7	50.2	
Return Air	76.2		68.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	90.4	65.3	58.4		
Leaving Coil	54.4	52.2	57.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : SHWR-N_PSZ-HP-ResShwr SAAHP-1**System Name :** SHWR-N_PSZ-HP-ResShwr**Time of Peak :** July 21 12:00**Coil Air Flow :** 98 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2439 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0405 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.0	51.2	
Return Air	76.6		70.0		
Outdoor Air	94.8	65.5	52.3		
Entering Coil	76.6	63.2	70.0		
Leaving Coil	54.5	53.1	61.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : SHWR-S_PSZ-HP-ResShwr SAAHP-1**System Name :** SHWR-S_PSZ-HP-ResShwr**Time of Peak :** July 21 18:00**Coil Air Flow :** 110 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.3 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.1	49.8	
Return Air	76.4		68.1		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	76.4	62.7	68.1		
Leaving Coil	54.5	52.7	59.8		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : SHWR-W_PSZ-HP-ResShwr SAAHP-1**System Name :** SHWR-W_PSZ-HP-ResShwr**Time of Peak :** July 21 18:00**Coil Air Flow :** 96 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 2.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2439 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0405 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.3	51.4	
Return Air	76.6		70.3		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	76.6	63.3	70.3		
Leaving Coil	54.5	53.1	61.1		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Support_PSZ-HP-Utility SAAHP-1**System Name :** Support_PSZ-HP-Utility**Time of Peak :** July 21 10:00**Coil Air Flow :** 429 (cfm)**Coil Capacity :** 10 (MBh)**Zone Space Sensible Loads** 6.8 (MBh)**Outdoor Air Flow Rate** 36 (cfm)**Percent Outdoor Air** 8.44 %**Air Specific Heat** 0.2429 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0362 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		45.4	33.3	
Return Air	75.7		45.4		
Outdoor Air	86.6	60.3	40.3		
Entering Coil	76.6	57.7	45.0		
Leaving Coil	54.4	48.8	45.0		
Supply Fan					0.6

Ideal Loads Peak : Cooling Coil Name : Utility_PSZ-HP-Utility SAAHP-1**System Name :** Utility_PSZ-HP-Utility**Time of Peak :** July 21 15:00**Coil Air Flow :** 897 (cfm)**Coil Capacity :** 25 (MBh)**Zone Space Sensible Loads** 18.2 (MBh)**Outdoor Air Flow Rate** 164 (cfm)**Percent Outdoor Air** 18.31 %**Air Specific Heat** 0.2431 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0371 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		51.9	38.1	
Return Air	77.1		51.2		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	81.0	60.2	49.2		
Leaving Coil	54.4	50.0	49.2		
Supply Fan					0.6

Psychrometric State Points

Simulation peak data is not available for this alternative because the simulation peak was not calculated. To view simulation peak data, go to the Load Design Parameters tab of Simulation Settings, set 'Perform special building block calculations during Design' to Yes and recalculate the alternative.

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-1_VRFHP-1_COOLING COIL

System Name :	ACT-Noisy-1_VRFHP-1		
Time of Peak :	unknown	Percent Outdoor Air	0.00 %
Coil Air Flow :	119 (cfm)	Air Specific Heat	0.2437 (Btu/lb·°F)
Coil Capacity :	3 (MBh)	Air Density	0.0711 (lb/ft³)
Zone Space Sensible Loads	2.5 (MBh)	Air Density Specific Heat Factor	1.0396 Btuh/cfm-F
Outdoor Air Flow Rate	0 (cfm)	Latent Heat Factor	0.6557 Btuh/(cfm-gr/lb)
		Enthalpy Factor	4.2660 Btuh/(cfm-btu/lb)
		*Value has been adjusted for elevation	

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.1	44.7	
Return Air	75.0		61.1		
Outdoor Air	94.0	63.5	44.0		
Entering Coil	75.0	60.7	61.1		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-2_VRFHP-1_COOLING COIL**System Name :** ACT-Noisy-2_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 60 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.3 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.3	49.2	
Return Air	75.0		67.3		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	62.1	67.3		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Noisy-3_VRFHP-1_COOLING COIL**System Name :** ACT-Noisy-3_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 65 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.3 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		67.1	49.1	
Return Air	75.0		67.1		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	75.0	62.0	67.1		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 21 of 39

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-1_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-1_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 35 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 0.7 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.7	45.1	
Return Air	75.0		61.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	60.9	61.7		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-2_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-2_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 51 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.1 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.9	44.6	
Return Air	75.0		60.9		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	60.7	60.9		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 22 of 39

Ideal Loads Peak : Cooling Coil Name : ACT-Quiet-3_VRFHP-1_COOLING COIL**System Name :** ACT-Quiet-3_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 49 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		66.8	48.9	
Return Air	75.0		66.8		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	62.0	66.8		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Admin_VRFHP-1_COOLING COIL**System Name :** Admin_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 80 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.7 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.1	43.3	
Return Air	75.0		59.1		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	60.3	59.1		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 23 of 39

Ideal Loads Peak : Cooling Coil Name : Attrium_VRFHP-1_COOLING COIL**System Name :** Attrium_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 251 (cfm)**Coil Capacity :** 6 (MBh)**Zone Space Sensible Loads** 5.2 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.8	43.8	
Return Air	75.0		59.8		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	75.0	60.5	59.8		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Chart/Hotel_VRFHP-1_COOLING COIL**System Name :** Chart/Hotel_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 44 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 0.9 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2438 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0401 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		66.0	48.3	
Return Air	75.0		66.0		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	61.8	66.0		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 24 of 39

Ideal Loads Peak : Cooling Coil Name : Comfort/Consult_VRFHP-1_COOLING COIL**System Name :** Comfort/Consult_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 72 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.5 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2437 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0396 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.0	44.7	
Return Air	75.0		61.0		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	75.0	60.7	61.0		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Corridor-N_VRFHP-1_COOLING COIL**System Name :** Corridor-N_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 80 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.7 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2433 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0379 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		52.0	38.1	
Return Air	75.0		52.0		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	58.7	52.0		
Leaving Coil	54.5	50.7	51.8		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 25 of 39

Ideal Loads Peak : Cooling Coil Name : Corridor-S_VRFHP-1_COOLING COIL**System Name :** Corridor-S_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 152 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 3.1 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2419 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0319 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		29.6	21.9	
Return Air	75.0		29.6		
Outdoor Air	88.4	57.7	26.4		
Entering Coil	75.0	53.4	29.6		
Leaving Coil	54.5	44.4	29.6		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Corridor-W_VRFHP-1_COOLING COIL**System Name :** Corridor-W_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 171 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 3.5 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		51.8	38.0	
Return Air	75.0		51.8		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	75.0	58.7	51.8		
Leaving Coil	54.5	50.7	51.8		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 26 of 39

Ideal Loads Peak : Cooling Coil Name : DOAS to Zone Level Equipment Dehum and Reheat SCC-1**System Name :** DOAS to Zone Level Equipment Dehum and Reheat**Time of Peak :** July 21 15:00**Coil Air Flow :** 1,550 (cfm)**Coil Capacity :** 71 (MBh)**Zone Space Sensible Loads** 82.9 (MBh)**Outdoor Air Flow Rate** 1,550 (cfm)**Percent Outdoor Air** 100.00 %**Air Specific Heat** 0.2426 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0349 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		57.4	42.1	
Return Air	77.2		57.4		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	99.1	64.4	40.4		
Leaving Coil	55.0	47.8	40.4		
Supply Fan					0.7

Ideal Loads Peak : Cooling Coil Name : Entry/Waiting_VRFHP-1_COOLING COIL**System Name :** Entry/Waiting_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 454 (cfm)**Coil Capacity :** 10 (MBh)**Zone Space Sensible Loads** 9.4 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air** 0.00 %**Air Specific Heat** 0.2435 (Btu/lb·°F)**Air Density** 0.0711 (lb/ft³)**Air Density Specific Heat Factor** 1.0388 Btuh/cfm-F**Latent Heat Factor** 0.6557 Btuh/(cfm-gr/lb)**Enthalpy Factor** 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		55.7	40.8	
Return Air	75.0		55.7		
Outdoor Air	81.8	61.2	52.2		
Entering Coil	75.0	59.6	55.7		
Leaving Coil	54.5	51.5	55.1		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 27 of 39

Ideal Loads Peak : Cooling Coil Name : Exam/Storage_VRFHP-1_COOLING COIL**System Name :** Exam/Storage_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 50 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 1.0 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.7	45.2	
Return Air	75.0		61.7		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	60.9	61.7		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Group_VRFHP-1_COOLING COIL**System Name :** Group_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 91 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.1 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		65.9	48.2	
Return Air	75.0		65.9		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	61.8	65.9		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 28 of 39

Ideal Loads Peak : Cooling Coil Name : Hospitality_VRFHP-1_COOLING COIL

System Name : Hospitality_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 81 (cfm)

Coil Capacity : 1 (MBh)

Zone Space Sensible Loads 1.1 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air 0.00 %

Air Specific Heat 0.2442 (Btu/lb·°F)

Air Density 0.0711 (lb/ft³)

Air Density Specific Heat Factor 1.0418 Btuh/cfm-F

Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		68.1	49.8	
Return Air	75.0		68.1		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	75.0	62.2	68.1		
Leaving Coil	60.2	56.7	66.7		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Intake-HR-A_VRFHP-1_COOLING COIL

System Name : Intake-HR-A_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 151 (cfm)

Coil Capacity : 3 (MBh)

Zone Space Sensible Loads 3.1 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air 0.00 %

Air Specific Heat 0.2434 (Btu/lb·°F)

Air Density 0.0711 (lb/ft³)

Air Density Specific Heat Factor 1.0383 Btuh/cfm-F

Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		54.5	40.0	
Return Air	75.0		54.5		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	59.3	54.5		
Leaving Coil	54.5	51.3	54.2		
Supply Fan					0.5

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 29 of 39

Ideal Loads Peak : Cooling Coil Name : Intake-HR-B_VRFHP-1_COOLING COIL**System Name :** Intake-HR-B_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 37 (cfm)**Coil Capacity :** 1 (MBh)**Zone Space Sensible Loads** 0.8 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.5	45.0	
Return Air	75.0		61.5		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	60.8	61.5		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Kitchen_Single Zone CV SAAHP-1**System Name :** Kitchen_Single Zone CV**Time of Peak :** July 21 15:00**Coil Air Flow :** 2,532 (cfm)**Coil Capacity :** 95 (MBh)**Zone Space Sensible Loads** 27.7 (MBh)**Outdoor Air Flow Rate** 2,500 (cfm)**Percent Outdoor Air**

98.75 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.7	43.7	
Return Air	75.2		59.7		
Outdoor Air	98.8	66.7	52.3		
Entering Coil	100.1	67.1	52.3		
Leaving Coil	64.1	54.7	52.3		
Supply Fan					1.3

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 30 of 39

Ideal Loads Peak : Cooling Coil Name : Lounge_VRFHP-1_COOLING COIL**System Name :** Lounge_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 148 (cfm)**Coil Capacity :** 3 (MBh)**Zone Space Sensible Loads** 3.1 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.7	43.7	
Return Air	75.0		59.7		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	60.4	59.7		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Multipurpose/Dining_VRFHP-1_COOLING COIL**System Name :** Multipurpose/Dining_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 160 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 1.8 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		66.1	48.3	
Return Air	75.0		66.1		
Outdoor Air	96.9	66.1	52.3		
Entering Coil	75.0	61.8	66.1		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 31 of 39

Ideal Loads Peak : Cooling Coil Name : RB-N-Corner_VRFHP-1_COOLING COIL**System Name :** RB-N-Corner_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 100 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 2.1 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.7	45.1	
Return Air	75.0		61.7		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	60.9	61.7		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-N-East_VRFHP-1_COOLING COIL**System Name :** RB-N-East_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 167 (cfm)**Coil Capacity :** 4 (MBh)**Zone Space Sensible Loads** 3.5 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.0	46.8	
Return Air	75.0		64.0		
Outdoor Air	87.0	63.0	52.2		
Entering Coil	75.0	61.4	64.0		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 32 of 39

Ideal Loads Peak : Cooling Coil Name : RB-N-West_VRFHP-1_COOLING COIL**System Name :** RB-N-West_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 277 (cfm)**Coil Capacity :** 7 (MBh)**Zone Space Sensible Loads** 5.8 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		61.9	45.3	
Return Air	75.0		61.9		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	60.9	61.9		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-N_VRFHP-1_COOLING COIL**System Name :** RB-S-Corner-N_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 87 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.8 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		60.1	44.0	
Return Air	75.0		60.1		
Outdoor Air	98.4	64.2	40.4		
Entering Coil	75.0	60.5	60.1		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 33 of 39

Ideal Loads Peak : Cooling Coil Name : RB-S-Corner-S_VRFHP-1_COOLING COIL

System Name : RB-S-Corner-S_VRFHP-1
Time of Peak : unknown
Coil Air Flow : 107 (cfm)
Coil Capacity : 2 (MBh)
Zone Space Sensible Loads 2.2 (MBh)
Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air 0.00 %
Air Specific Heat 0.2437 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0396 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		59.8	43.8	
Return Air	75.0		59.8		
Outdoor Air	94.1	62.8	40.3		
Entering Coil	75.0	60.5	59.8		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-S-East_VRFHP-1_COOLING COIL

System Name : RB-S-East_VRFHP-1
Time of Peak : unknown
Coil Air Flow : 235 (cfm)
Coil Capacity : 6 (MBh)
Zone Space Sensible Loads 4.9 (MBh)
Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air 0.00 %
Air Specific Heat 0.2438 (Btu/lb·°F)
Air Density 0.0711 (lb/ft³)
Air Density Specific Heat Factor 1.0401 Btuh/cfm-F
Latent Heat Factor 0.6557 Btuh/(cfm-gr/lb)
Enthalpy Factor 4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		64.1	46.9	
Return Air	75.0		64.1		
Outdoor Air	87.0	63.0	52.2		
Entering Coil	75.0	61.4	64.1		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 34 of 39

Ideal Loads Peak : Cooling Coil Name : RB-S-West_VRFHP-1_COOLING COIL**System Name :** RB-S-West_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 89 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.8 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.5	46.5	
Return Air	75.0		63.5		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	61.3	63.5		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : RB-W-North_VRFHP-1_COOLING COIL**System Name :** RB-W-North_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 90 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.9 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		63.7	46.6	
Return Air	75.0		63.7		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	61.3	63.7		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 35 of 39

Ideal Loads Peak : Cooling Coil Name : RB-W-South_VRFHP-1_COOLING COIL

System Name : RB-W-South_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 304 (cfm)

Coil Capacity : 7 (MBh)

Zone Space Sensible Loads 6.3 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air

0.00 %

Air Specific Heat

0.2434 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0383 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		54.1	39.7	
Return Air	75.0		54.1		
Outdoor Air	89.8	58.2	26.4		
Entering Coil	75.0	59.2	54.1		
Leaving Coil	54.5	51.2	53.7		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Servery_VRFHP-1_COOLING COIL

System Name : Servery_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 75 (cfm)

Coil Capacity : 2 (MBh)

Zone Space Sensible Loads 0.8 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air

0.00 %

Air Specific Heat

0.2438 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0401 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		66.2	48.4	
Return Air	75.0		66.2		
Outdoor Air	94.5	65.4	52.2		
Entering Coil	75.0	61.8	66.2		
Leaving Coil	54.5	52.8	59.9		
Supply Fan					0.5

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 36 of 39

Ideal Loads Peak : Cooling Coil Name : SHWR-N_VRFHP-1_COOLING COIL

System Name : SHWR-N_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 94 (cfm)

Coil Capacity : 3 (MBh)

Zone Space Sensible Loads 1.9 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air

0.00 %

Air Specific Heat

0.2439 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0405 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.6	51.6	
Return Air	75.0		70.6		
Outdoor Air	94.8	65.5	52.3		
Entering Coil	75.0	62.8	70.6		
Leaving Coil	54.5	53.1	61.3		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : SHWR-S_VRFHP-1_COOLING COIL

System Name : SHWR-S_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 101 (cfm)

Coil Capacity : 3 (MBh)

Zone Space Sensible Loads 2.1 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air

0.00 %

Air Specific Heat

0.2439 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0405 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		70.2	51.3	
Return Air	75.0		70.2		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	62.7	70.2		
Leaving Coil	54.5	53.1	61.3		
Supply Fan					0.5

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 37 of 39

Ideal Loads Peak : Cooling Coil Name : SHWR-W_VRFHP-1_COOLING COIL**System Name :** SHWR-W_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 89 (cfm)**Coil Capacity :** 2 (MBh)**Zone Space Sensible Loads** 1.9 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2439 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0405 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		71.1	51.9	
Return Air	75.0		71.1		
Outdoor Air	91.4	64.4	52.2		
Entering Coil	75.0	62.9	71.1		
Leaving Coil	54.5	53.1	61.3		
Supply Fan					0.5

Ideal Loads Peak : Cooling Coil Name : Support_VRFHP-1_COOLING COIL**System Name :** Support_VRFHP-1**Time of Peak :** unknown**Coil Air Flow :** 220 (cfm)**Coil Capacity :** 5 (MBh)**Zone Space Sensible Loads** 4.6 (MBh)**Outdoor Air Flow Rate** 0 (cfm)**Percent Outdoor Air**

0.00 %

Air Specific Heat

0.2433 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0379 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		51.9	38.0	
Return Air	75.0		51.9		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	58.7	51.9		
Leaving Coil	54.5	50.7	51.8		
Supply Fan					0.5

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 38 of 39

Ideal Loads Peak : Cooling Coil Name : Utility_VRFHP-1_COOLING COIL

System Name : Utility_VRFHP-1

Time of Peak : unknown

Coil Air Flow : 496 (cfm)

Coil Capacity : 11 (MBh)

Zone Space Sensible Loads 10.3 (MBh)

Outdoor Air Flow Rate 0 (cfm)

Percent Outdoor Air

0.00 %

Air Specific Heat

0.2437 (Btu/lb·°F)

Air Density

0.0711 (lb/ft³)

Air Density Specific Heat Factor

1.0396 Btuh/cfm-F

Latent Heat Factor

0.6557 Btuh/(cfm-gr/lb)

Enthalpy Factor

4.2660 Btuh/(cfm-btu/lb)

*Value has been adjusted for elevation

	DryBulb (°F)	Wet Bulb (°F)	Humidity Ratio (gr/lb)	Relative Humidit %	Temperature Difference (°F)
Zone	75.0		58.9	43.1	
Return Air	75.0		58.9		
Outdoor Air	86.7	62.9	52.2		
Entering Coil	75.0	60.3	58.9		
Leaving Coil	54.5	52.3	57.9		
Supply Fan					0.5

Outside Air / ASHRAE Standard 62.1 Summary

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	P _s People	ΣP_z People	D P _s / ΣP_z	V _{ou} (cfm)	V _{ps} (cfm)	X _s	E _v	V _{ot} (cfm)	%OA V _{ot} / V _{ps}
ACT-Noisy-1 _PSZ-HP-Activity	Cooling	199	0	4	1	38	199	1	1	38	19.0%
	Heating	199	0	4	1	38	199	0.19	1	38	19.0%
ACT-Noisy-2 _PSZ-HP-Activity	Cooling	103	0	4	1	38	103	1	1	38	36.9%
	Heating	103	0	4	1	38	103	0.369	1	38	36.9%
ACT-Noisy-3 _PSZ-HP-Activity	Cooling	107	0	4	1	38	107	1	1	38	35.9%
	Heating	107	0	4	1	38	107	0.359	1	38	35.9%
ACT-Quiet-1 _PSZ-HP-Activity	Cooling	60	0	3	1	27	60	1	1	27	45.5%
	Heating	60	0	3	1	27	60	0.455	1	27	45.5%
ACT-Quiet-2 _PSZ-HP-Activity	Cooling	76	0	3	1	27	76	1	1	27	35.9%
	Heating	76	0	3	1	27	76	0.359	1	27	35.9%
ACT-Quiet-3 _PSZ-HP-Activity	Cooling	74	0	3	1	28	74	1	1	28	37.0%
	Heating	74	0	3	1	28	74	0.37	1	28	37.0%
Admin _PSZ-HP-Admin	Cooling	119	0	2	1	21	119	1	1	21	17.5%
	Heating	119	0	2	1	21	119	0.175	1	21	17.5%
Atrium _PSZ-HP-Atrium	Cooling	404	0	6	1	108	404	1	1	108	26.7%
	Heating	404	0	6	1	108	404	0.267	1	108	26.7%
Chart/Hotel _PSZ-HP-Admin	Cooling	70	0	2	1	22	70	1	1	22	31.5%
	Heating	70	0	2	1	22	70	0.315	1	22	31.5%
Comfort/Consult _PSZ-HP-Clinical	Cooling	154	0	3	1	72	154	1	1	72	47.0%
	Heating	154	0	3	1	72	154	0.47	1	72	47.0%
Corridor-N _PSZ-HP-ResBed-N	Cooling	116	0	0	1	25	116	1	1	25	21.2%
	Heating	116	0	0	1	25	116	0.212	1	25	21.2%
Corridor-S _PSZ-HP-ResBed-S	Cooling	183	0	0	1	25	183	1	1	25	13.6%
	Heating	183	0	0	1	25	183	0.136	1	25	13.6%
Corridor-W _PSZ-HP-ResBed-W	Cooling	199	0	0	1	19	199	1	1	19	9.8%
	Heating	199	0	0	1	19	199	0.098	1	19	9.8%
Entry/Waiting _PSZ-HP-Admin	Cooling	492	0	2	1	31	492	1	1	31	6.4%
	Heating	492	0	2	1	31	492	0.064	1	31	6.4%

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 1 of 29

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	Ps People	ΣPz People	D Ps / ΣPz	Vou (cfm)	Vps (cfm)	Xs	Ev	Vot (cfm)	%OA Vot / Vps
Exam/Storage_PSZ-HP-Clinical	Cooling	84	0	2	1	37	84	1	1	37	44.3%
	Heating	84	0	2	1	37	84	0.443	1	37	44.3%
Group_PSZ-HP-Clinical	Cooling	152	0	6	1	91	152	1	1	91	60.0%
	Heating	152	0	6	1	91	152	0.6	1	91	60.0%
Hospitality_PSZ-HP-Common	Cooling	274	0	5	1	81	274	1	1	81	29.6%
	Heating	274	0	5	1	81	274	0.301	1	81	29.6%
Intake-HR-A_PSZ-HP-Clinical	Cooling	311	0	4	1	69	311	1	1	69	22.3%
	Heating	311	0	4	1	69	311	0.223	1	69	22.3%
Intake-HR-B_PSZ-HP-Clinical	Cooling	66	0	1	1	26	66	1	1	26	39.7%
	Heating	66	0	1	1	26	66	0.397	1	26	39.7%
Kitchen_PSZ-HP-Kitchen	Cooling	2,853	0	13	1	174	2,853	1	1	174	6.1%
	Heating	2,853	0	13	1	174	2,853	0.061	1	174	6.1%
Lounge_PSZ-HP-Common	Cooling	290	0	6	1	65	290	1	1	65	22.5%
	Heating	290	0	6	1	65	290	0.225	1	65	22.5%
Multipurpose/Dining_PSZ-HP-Common	Cooling	268	0	10	1	160	268	1	1	160	59.8%
	Heating	268	0	10	1	160	268	0.598	1	160	59.8%
RB-N-Corner_PSZ-HP-ResBed-N	Cooling	128	0	1	1	14	128	1	1	14	11.2%
	Heating	128	0	1	1	14	128	0.112	1	14	11.2%
RB-N-East_PSZ-HP-ResBed-N	Cooling	202	0	3	1	28	202	1	1	28	14.0%
	Heating	202	0	3	1	28	202	0.14	1	28	14.0%
RB-N-West_PSZ-HP-ResBed-N	Cooling	348	0	4	1	42	348	1	1	42	12.1%
	Heating	348	0	4	1	42	348	0.121	1	42	12.1%
RB-S-Corner-N_PSZ-HP-Clinical	Cooling	94	0	1	1	14	94	1	1	14	15.1%
	Heating	94	0	1	1	14	94	0.151	1	14	15.1%
RB-S-Corner-S_PSZ-HP-ResBed-S	Cooling	114	0	1	1	14	114	1	1	14	12.6%
	Heating	114	0	1	1	14	114	0.126	1	14	12.6%
RB-S-East_PSZ-HP-ResBed-S	Cooling	282	0	4	1	41	282	1	1	41	14.5%
	Heating	282	0	4	1	41	282	0.145	1	41	14.5%
	Cooling	112	0	1	1	14	112	1	1	14	12.1%

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 2 of 29

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	P _s People	ΣP_z People	D P _s / ΣP_z	V _{ou} (cfm)	V _{ps} (cfm)	X _s	Ev	V _{ot} (cfm)	%OA V _{ot} / V _{ps}
RB-S-West _PSZ-HP-ResBed-S	Heating	112	0	1	1	14	112	0.121	1	14	12.1%
	Cooling	113	0	1	1	14	113	1	1	14	12.6%
RB-W-North _PSZ-HP-ResBed-W	Heating	113	0	1	1	14	113	0.126	1	14	12.6%
	Cooling	322	0	4	1	42	322	1	1	42	13.0%
RB-W-South _PSZ-HP-ResBed-W	Heating	322	0	4	1	42	322	0.13	1	42	13.0%
	Cooling	120	0	5	1	75	120	1	1	75	62.6%
Servery _PSZ-HP-Common	Heating	120	0	5	1	75	120	0.626	1	75	62.6%
	Cooling	98	0	4	1	0	98	1	1	0	0.0%
SHWR-N _PSZ-HP-ResShwr	Heating	98	0	4	1	0	98	0	1	0	0.0%
	Cooling	110	0	4	1	0	110	1	1	0	0.0%
SHWR-S _PSZ-HP-ResShwr	Heating	110	0	4	1	0	110	0	1	0	0.0%
	Cooling	96	0	4	1	0	96	1	1	0	0.0%
SHWR-W _PSZ-HP-ResShwr	Heating	96	0	4	1	0	96	0	1	0	0.0%
	Cooling	429	0	0	1	36	429	1	1	36	8.4%
Support _PSZ-HP-Utility	Heating	429	0	0	1	36	429	0.084	1	36	8.4%
	Cooling	897	0	7	1	164	897	1	1	164	18.3%
Utility _PSZ-HP-Utility	Heating	897	0	7	1	164	897	0.183	1	164	18.3%

Ventilation Parameters

System Zone	R _p cfm/person	P _z People	R _a cfm/ft ²	A _z (ft ²)	V _{bz} (cfm)	Cooling		Heating	
						E _z	V _{oz} (cfm)	E _z	V _{oz} (cfm)
ACT-Noisy-1 _PSZ-HP-Activity	7.50	3.59	0.06	180	38		38		38
ACT-Noisy-1	7.50	3.59	0.06	180	38	1.00	38	1.00	38
ACT-Noisy-2 _PSZ-HP-Activity	7.50	3.62	0.06	181	38		38		38
ACT-Noisy-2	7.50	3.62	0.06	181	38	1.00	38	1.00	38
ACT-Noisy-3 _PSZ-HP-Activity	7.50	3.64	0.06	182	38		38		38
ACT-Noisy-3	7.50	3.64	0.06	182	38	1.00	38	1.00	38
ACT-Quiet-1 _PSZ-HP-Activity	7.50	2.61	0.06	130	27		27		27

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
ACT-Quiet-1	7.50	2.61	0.06	130	27	1.00	27	1.00	27
ACT-Quiet-2_PSZ-HP-Activity	7.50	2.61	0.06	131	27		27		27
ACT-Quiet-2	7.50	2.61	0.06	131	27	1.00	27	1.00	27
ACT-Quiet-3_PSZ-HP-Activity	7.50	2.62	0.06	131	28		28		28
ACT-Quiet-3	7.50	2.62	0.06	131	28	1.00	28	1.00	28
Admin_PSZ-HP-Admin	5.00	1.89	0.06	189	21		21		21
Admin	5.00	1.89	0.06	189	21	1.00	21	1.00	21
Attrium_PSZ-HP-Attrium	5.00	6.33	0.06	1,267	108		108		108
Attrium	5.00	6.33	0.06	1,267	108	1.00	108	1.00	108
Chart/Hotel_PSZ-HP-Admin	5.00	2.00	0.06	200	22		22		22
Chart/Hotel	5.00	2.00	0.06	200	22	1.00	22	1.00	22
Comfort/Consult_PSZ-HP-Clinical	7.50	2.83	0.18	283	72		72		72
Comfort/Consult	7.50	2.83	0.18	283	72	1.00	72	1.00	72
Corridor-N_PSZ-HP-ResBed-N	0.00	0.00	0.06	409	25		25		25
Corridor-N	0.00	0.00	0.06	409	25	1.00	25	1.00	25
Corridor-S_PSZ-HP-ResBed-S	0.00	0.00	0.06	414	25		25		25
Corridor-S	0.00	0.00	0.06	414	25	1.00	25	1.00	25
Corridor-W_PSZ-HP-ResBed-W	0.00	0.00	0.06	324	19		19		19
Corridor-W	0.00	0.00	0.06	324	19	1.00	19	1.00	19
Entry/Waiting_PSZ-HP-Admin	5.00	1.85	0.06	370	32		31		31
Entry/Waiting	5.00	1.85	0.06	370	31	1.00	31	1.00	31
Exam/Storage_PSZ-HP-Clinical	5.32	1.73	0.13	224	38		37		37
Exam/Storage	5.32	1.73	0.13	224	37	1.00	37	1.00	37
Group_PSZ-HP-Clinical	7.50	5.53	0.18	276	91		91		91
Group	7.50	5.53	0.18	276	91	1.00	91	1.00	91
Hospitality_PSZ-HP-Common	7.50	4.92	0.18	246	81		81		81
Hospitality	7.50	4.92	0.18	246	81	1.00	81	1.00	81
Intake-HR-A_PSZ-HP-Clinical	4.46	3.96	0.11	471	69		69		69
Intake-HR-A	4.46	3.96	0.11	471	69	1.00	69	1.00	69
	5.06	1.24	0.12	165	26		26		26

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
Intake-HR-B_PSZ-HP-Clinical									
Intake-HR-B	5.06	1.24	0.12	165	26	1.00	26	1.00	26
Kitchen_PSZ-HP-Kitchen	6.63	13.09	0.13	686	174		174		174
Kitchen	6.63	13.09	0.13	686	174	1.00	174	1.00	174
Lounge_PSZ-HP-Common	5.00	5.93	0.12	297	65		65		65
Lounge	5.00	5.93	0.12	297	65	1.00	65	1.00	65
Multipurpose/Dining_PSZ-HP-Common	7.50	9.71	0.18	485	160		160		160
Multipurpose/Dining	7.50	9.71	0.18	485	160	1.00	160	1.00	160
RB-N-Corner_PSZ-HP-ResBed-N	5.00	1.30	0.06	130	14		14		14
RB-N-Corner	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-N-East_PSZ-HP-ResBed-N	5.00	2.57	0.06	257	28		28		28
RB-N-East	5.00	2.57	0.06	257	28	1.00	28	1.00	28
RB-N-West_PSZ-HP-ResBed-N	5.00	3.83	0.06	383	42		42		42
RB-N-West	5.00	3.83	0.06	383	42	1.00	42	1.00	42
RB-S-Corner-N_PSZ-HP-Clinical	5.00	1.29	0.06	129	14		14		14
RB-S-Corner-N	5.00	1.29	0.06	129	14	1.00	14	1.00	14
RB-S-Corner-S_PSZ-HP-ResBed-S	5.00	1.31	0.06	131	14		14		14
RB-S-Corner-S	5.00	1.31	0.06	131	14	1.00	14	1.00	14
RB-S-East_PSZ-HP-ResBed-S	5.00	3.72	0.06	372	41		41		41
RB-S-East	5.00	3.72	0.06	372	41	1.00	41	1.00	41
RB-S-West_PSZ-HP-ResBed-S	5.00	1.24	0.06	124	14		14		14
RB-S-West	5.00	1.24	0.06	124	14	1.00	14	1.00	14
RB-W-North_PSZ-HP-ResBed-W	5.00	1.30	0.06	130	14		14		14
RB-W-North	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-W-South_PSZ-HP-ResBed-W	5.00	3.80	0.06	380	42		42		42
RB-W-South	5.00	3.80	0.06	380	42	1.00	42	1.00	42
Servery_PSZ-HP-Common	7.50	4.56	0.18	228	75		75		75
Servery	7.50	4.56	0.18	228	75	1.00	75	1.00	75
SHWR-N_PSZ-HP-ResShwr	0.00	4.07	0.00	204	0		0		0

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
SHWR-N	0.00	4.07	0.00	204	0	1.00	0	1.00	0
SHWR-S_PSZ-HP-ResShwr	0.00	4.14	0.00	207	0		0		0
SHWR-S	0.00	4.14	0.00	207	0	1.00	0	1.00	0
SHWR-W_PSZ-HP-ResShwr	0.00	4.14	0.00	207	0		0		0
SHWR-W	0.00	4.14	0.00	207	0	1.00	0	1.00	0
Support_PSZ-HP-Utility	0.00	0.00	0.06	603	36		36		36
Support	0.00	0.00	0.06	603	36	1.00	36	1.00	36
Utility_PSZ-HP-Utility	0.00	7.15	0.06	2,927	164		164		164
Utility	0.00	7.15	0.06	2,927	164	1.00	164	1.00	164

*Ventilation Sizing Factor: 1.00

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
ACT-Noisy-1_PSZ-HP-Activity		199	199	199	38							
ACT-Noisy-1	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	199	199	199	37.73	0.190	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2_PSZ-HP-Activity		103	103	103	38							
ACT-Noisy-2	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	103	103	103	37.98	0.369	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3_PSZ-HP-Activity		107	107	107	38							
ACT-Noisy-3	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	107	107	107	38.25	0.359	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1_PSZ-HP-Activity		60	60	60	27							
ACT-Quiet-1	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	60	60	60	27.37	0.455	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2_PSZ-HP-Activity		76	76	76	27							
ACT-Quiet-2	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	76	76	76	27.43	0.359	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3_PSZ-HP-Activity		74	74	74	28							
ACT-Quiet-3	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	74	74	74	27.53	0.370	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Admin_PSZ-HP-Admin		119	119	119	21							
Admin	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	119	119	119	20.83	0.175	1.00	0.00	0.00	0.00	0.00	1.000
Attrium_PSZ-HP-Attrium		404	404	404	108							
Attrium	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	404	404	404	107.67	0.267	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel_PSZ-HP-Admin		70	70	70	22							
Chart/Hotel	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	70	70	70	21.95	0.315	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult_PSZ-HP-Clinical		154	154	154	72							
Comfort/Consult	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	154	154	154	72.28	0.470	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N_PSZ-HP-ResBed-N		116	116	116	25							
Corridor-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	116	116	116	24.54	0.212	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S_PSZ-HP-ResBed-S		183	183	183	25							
Corridor-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	183	183	183	24.84	0.136	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W_PSZ-HP-ResBed-W		199	199	199	19							
Corridor-W	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	199	199	199	19.44	0.098	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting_PSZ-HP-Admin		492	492	492	31							
Entry/Waiting	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	492	492	492	31.49	0.064	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage_PSZ-HP-Clinical		84	84	84	37							
Exam/Storage	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	84	84	84	37.41	0.443	1.00	0.00	0.00	0.00	0.00	1.000
Group_PSZ-HP-Clinical		152	152	152	91							
Group	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	152	152	152	91.22	0.600	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality_PSZ-HP-Common		274	274	274	81							
Hospitality	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	274	274	274	81.20	0.296	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A_PSZ-HP-Clinical		311	311	311	69							

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Intake-HR-A	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	311	311	311	69.37	0.223	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B_PSZ-HP-Clinical		66	66	66	26							
Intake-HR-B	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	66	66	66	26.22	0.397	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen_PSZ-HP-Kitchen		2,853	2,853	2,853	174							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	2,853	2,853	2,853	173.79	0.061	1.00	0.00	0.00	0.00	0.00	1.000
Lounge_PSZ-HP-Common		290	290	290	65							
Lounge	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	290	290	290	65.27	0.225	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining_PSZ-HP-Common		268	268	268	160							
Multipurpose/Dining	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	268	268	268	160.19	0.598	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner_PSZ-HP-ResBed-N		128	128	128	14							
RB-N-Corner	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	128	128	128	14.34	0.112	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East_PSZ-HP-ResBed-N		202	202	202	28							
RB-N-East	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	202	202	202	28.27	0.140	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West_PSZ-HP-ResBed-N		348	348	348	42							
RB-N-West	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	348	348	348	42.08	0.121	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N_PSZ-HP-Clinical		94	94	94	14							
RB-S-Corner-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	94	94	94	14.20	0.151	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S_PSZ-HP-ResBed-S		114	114	114	14							
RB-S-Corner-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	114	114	114	14.44	0.126	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East_PSZ-HP-ResBed-S		282	282	282	41							
RB-S-East	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	282	282	282	40.91	0.145	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West_PSZ-HP-ResBed-S		112	112	112	14							
RB-S-West	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	112	112	112	13.64	0.121	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
RB-W-North _PSZ-HP-ResBed-W		113	113	113	14							
RB-W-North	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	113	113	113	14.27	0.126	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South _PSZ-HP-ResBed-W		322	322	322	42							
RB-W-South	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	322	322	322	41.75	0.130	1.00	0.00	0.00	0.00	0.00	1.000
Servery _PSZ-HP-Common		120	120	120	75							
Servery	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	120	120	120	75.31	0.626	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N _PSZ-HP-ResShwr		98	98	98	0							
SHWR-N	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	98	98	98	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S _PSZ-HP-ResShwr		110	110	110	0							
SHWR-S	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	110	110	110	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W _PSZ-HP-ResShwr		96	96	96	0							
SHWR-W	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	96	96	96	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support _PSZ-HP-Utility		429	429	429	36							
Support	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	429	429	429	36.20	0.084	1.00	0.00	0.00	0.00	0.00	1.000
Utility _PSZ-HP-Utility		897	897	897	164							
Utility	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	897	897	897	164.17	0.183	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
ACT-Noisy-1 _PSZ-HP-Activity		199	199	199	38							
ACT-Noisy-1	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	199	199	199	37.73	0.190	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2 _PSZ-HP-Activity		103	103	103	38							
ACT-Noisy-2	AIRTERMINAL:SINGLEDUCT:CONSTANTV OLUME:NOREHEAT	103	103	103	37.98	0.369	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3 _PSZ-HP-Activity		107	107	107	38							

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 9 of 29

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
ACT-Noisy-3	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	107	107	107	38.25	0.359	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1_PSZ-HP-Activity		60	60	60	27							
ACT-Quiet-1	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	60	60	60	27.37	0.455	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2_PSZ-HP-Activity		76	76	76	27							
ACT-Quiet-2	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	76	76	76	27.43	0.359	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3_PSZ-HP-Activity		74	74	74	28							
ACT-Quiet-3	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	74	74	74	27.53	0.370	1.00	0.00	0.00	0.00	0.00	1.000
Admin_PSZ-HP-Admin		119	119	119	21							
Admin	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	119	119	119	20.83	0.175	1.00	0.00	0.00	0.00	0.00	1.000
Attrium_PSZ-HP-Attrium		404	404	404	108							
Attrium	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	404	404	404	107.67	0.267	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel_PSZ-HP-Admin		70	70	70	22							
Chart/Hotel	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	70	70	70	21.95	0.315	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult_PSZ-HP-Clinical		154	154	154	72							
Comfort/Consult	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	154	154	154	72.28	0.470	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N_PSZ-HP-ResBed-N		116	116	116	25							
Corridor-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	116	116	116	24.54	0.212	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S_PSZ-HP-ResBed-S		183	183	183	25							
Corridor-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	183	183	183	24.84	0.136	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W_PSZ-HP-ResBed-W		199	199	199	19							
Corridor-W	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	199	199	199	19.44	0.098	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting_PSZ-HP-Admin		492	492	492	31							
Entry/Waiting	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	492	492	492	31.49	0.064	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage_PSZ-HP-Clinical		84	84	84	37							
Exam/Storage	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	84	84	84	37.41	0.443	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 10 of 29

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Group_PSZ-HP-Clinical	VOLUME:NOREHEAT	152	152	152	91							
Group	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	152	152	152	91.22	0.600	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality_PSZ-HP-Common	VOLUME:NOREHEAT	274	274	274	81							
Hospitality	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	274	274	274	81.20	0.296	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A_PSZ-HP-Clinical	VOLUME:NOREHEAT	311	311	311	69							
Intake-HR-A	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	311	311	311	69.37	0.223	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B_PSZ-HP-Clinical	VOLUME:NOREHEAT	66	66	66	26							
Intake-HR-B	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	66	66	66	26.22	0.397	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen_PSZ-HP-Kitchen	VOLUME:NOREHEAT	2,853	2,853	2,853	174							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	2,853	2,853	2,853	173.79	0.061	1.00	0.00	0.00	0.00	0.00	1.000
Lounge_PSZ-HP-Common	VOLUME:NOREHEAT	290	290	290	65							
Lounge	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	290	290	290	65.27	0.225	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining_PSZ-HP-Common	VOLUME:NOREHEAT	268	268	268	160							
Multipurpose/Dining	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	268	268	268	160.19	0.598	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner_PSZ-HP-ResBed-N	VOLUME:NOREHEAT	128	128	128	14							
RB-N-Corner	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	128	128	128	14.34	0.112	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East_PSZ-HP-ResBed-N	VOLUME:NOREHEAT	202	202	202	28							
RB-N-East	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	202	202	202	28.27	0.140	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West_PSZ-HP-ResBed-N	VOLUME:NOREHEAT	348	348	348	42							
RB-N-West	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	348	348	348	42.08	0.121	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N_PSZ-HP-Clinical	VOLUME:NOREHEAT	94	94	94	14							
RB-S-Corner-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	94	94	94	14.20	0.151	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S_PSZ-HP-ResBed-S	VOLUME:NOREHEAT	114	114	114	14							
RB-S-Corner-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	114	114	114	14.44	0.126	1.00	0.00	0.00	0.00	0.00	1.000

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
RB-S-East _PSZ-HP-ResBed-S		282	282	282	41							
RB-S-East	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	282	282	282	40.91	0.145	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West _PSZ-HP-ResBed-S		112	112	112	14							
RB-S-West	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	112	112	112	13.64	0.121	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North _PSZ-HP-ResBed-W		113	113	113	14							
RB-W-North	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	113	113	113	14.27	0.126	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South _PSZ-HP-ResBed-W		322	322	322	42							
RB-W-South	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	322	322	322	41.75	0.130	1.00	0.00	0.00	0.00	0.00	1.000
Servery _PSZ-HP-Common		120	120	120	75							
Servery	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	120	120	120	75.31	0.626	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N _PSZ-HP-ResShwr		98	98	98	0							
SHWR-N	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	98	98	98	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S _PSZ-HP-ResShwr		110	110	110	0							
SHWR-S	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	110	110	110	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W _PSZ-HP-ResShwr		96	96	96	0							
SHWR-W	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	96	96	96	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support _PSZ-HP-Utility		429	429	429	36							
Support	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	429	429	429	36.20	0.084	1.00	0.00	0.00	0.00	0.00	1.000
Utility _PSZ-HP-Utility		897	897	897	164							
Utility	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	897	897	897	164.17	0.183	1.00	0.00	0.00	0.00	0.00	1.000

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
PSZ-HP-Activity	N/A	N/A	N/A
ACT-Noisy-1	0	38	0.00%
Noisy Activity 1	0	38	N/A
ACT-Noisy-2	0	38	0.00%
Noisy Activity 2	0	38	N/A
ACT-Noisy-3	0	38	0.00%
Noisy Activity 3	0	38	N/A
ACT-Quiet-1	0	28	0.00%
Quiet Activity 1	0	28	N/A
ACT-Quiet-2	0	28	0.00%
Quiet Activity 2	0	28	N/A
ACT-Quiet-3	0	28	0.00%
Quiet Activity 3	0	28	N/A
PSZ-HP-Admin	N/A	N/A	N/A
Admin	0	21	0.00%
Office 1	0	11	N/A
Office 2	0	11	N/A
Chart/Hotel	0	21	0.00%
Chart/Hotel	0	21	N/A
Entry/Waiting	0	32	0.00%
Entry/Waiting	0	32	N/A
PSZ-HP-Atrium	N/A	N/A	N/A
Atrium	0	108	0.00%
Atrium	0	53	N/A
Atrium 2	0	55	N/A

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
PSZ-HP-Clinical	N/A	N/A	N/A
Comfort/Consult	0	72	0.00%
Comfort Room 2	0	21	N/A
Consult 1	0	25	N/A
Consult 2	0	25	N/A
Exam/Storage	0	38	0.00%
Exam Room	0	32	N/A
Long Term Belongings Storage	0	6	N/A
Group	0	91	0.00%
Group	0	91	N/A
Intake-HR-A	0	70	0.00%
Intake Corridor	0	8	N/A
Interview Room	0	40	N/A
Sally Port	0	19	N/A
Shower 1	0	0	N/A
Intake-HR-B	0	25	0.00%
Ante Room	0	4	N/A
Comfort Room 1	0	21	N/A
RB-S-Corner-N	0	15	0.00%
Resident Room 04	0	15	N/A
PSZ-HP-Common	N/A	N/A	N/A
Hospitality	0	81	0.00%
Hospitality	0	81	N/A
Lounge	0	66	0.00%
Lounge	0	66	N/A
Shower 2	0	0	N/A
Multipurpose/Dining	0	161	0.00%
Multipurpose/Dining	0	161	N/A
Serving	0	76	0.00%
Serving	0	76	N/A
PSZ-HP-Kitchen	N/A	N/A	N/A
Kitchen	0	174	0.00%
Kitchen	0	155	N/A
Service	0	19	N/A

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
PSZ-HP-ResBed-N	N/A	N/A	N/A
Corridor-N	0	25	0.00%
Corridor 3	0	25	N/A
RB-N-Corner	0	15	0.00%
Resident Room 14	0	15	N/A
RB-N-East	0	28	0.00%
Resident Room 15	0	15	N/A
Resident Room 16	0	15	N/A
RB-N-West	0	42	0.00%
Resident Room 11	0	15	N/A
Resident Room 12	0	15	N/A
Resident Room 13	0	15	N/A
PSZ-HP-ResBed-S	N/A	N/A	N/A
Corridor-S	0	25	0.00%
Corridor 5	0	25	N/A
RB-S-Corner-S	0	15	0.00%
Resident Room 05	0	15	N/A
RB-S-East	0	40	0.00%
Resident Room 01	0	13	N/A
Resident Room 02	0	13	N/A
Resident Room 03	0	15	N/A
RB-S-West	0	13	0.00%
Resident Room 06	0	13	N/A
PSZ-HP-ResBed-W	N/A	N/A	N/A
Corridor-W	0	19	0.00%
Corridor 4	0	19	N/A
RB-W-North	0	15	0.00%
Resident Room 10	0	15	N/A
RB-W-South	0	42	0.00%
Resident Room 07	0	15	N/A
Resident Room 08	0	15	N/A
Resident Room 09	0	15	N/A

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
PSZ-HP-ResShwr	N/A	N/A	N/A
SHWR-N	0	0	0.00%
Shower 7	0	0	N/A
Shower 8	0	0	N/A
SHWR-S	0	0	0.00%
Shower 3	0	0	N/A
Shower 4	0	0	N/A
SHWR-W	0	0	0.00%
Shower 5	0	0	N/A
Shower 6	0	0	N/A
PSZ-HP-Utility	N/A	N/A	N/A
Support	0	36	0.00%
Electric	0	11	N/A
Emergency Electric	0	11	N/A
Fire Room	0	4	N/A
Mechanical	0	8	N/A
Utility	0	163	0.00%
Clean Supply	0	6	N/A
Corridor 1	0	17	N/A
Corridor 2	0	38	N/A
Corridor 2.1	0	4	N/A
General Storage	0	6	N/A
Hskp	0	4	N/A
IT	0	8	N/A
Laundry	0	6	N/A
Meds	0	8	N/A
Soiled Supply	0	6	N/A
Staff Corridor	0	53	N/A
Stor.	0	0	N/A
Storage	0	2	N/A
Toilet 1	0	0	N/A
Toilet 2	0	0	N/A
Toilet 3	0	0	N/A

Outside Air / ASHRAE Standard 62.1 Summary

System Ventilation Requirements

System	Mode	ΣV_{pz} (cfm)	P_s People	ΣP_z People	D $P_s / \Sigma P_z$	V_{ou} (cfm)	V_{ps} (cfm)	X_s	E_v	V_{ot} (cfm)	%OA V_{ot} / V_{ps}
DOAS to Zone Level Equipment Dehum and Reheat	Cooling	1,550	0	111	1	1,550	1,550	1	1	1,550	100.0%
	Heating	1,550	0	111	1	1,550	1,550	0.318	1	1,550	100.0%
Kitchen_Single Zone CV	Cooling	2,532	0	0	1	0	2,532	0	1	0	0.0%
	Heating	2,532	0	0	1	0	2,532	0	1	0	0.0%

Ventilation Parameters

System Zone	R_p cfm/person	P_z People	R_a cfm/ft ²	A_z (ft ²)	V_{bz} (cfm)	Cooling		Heating	
						E_z	V_{oz} (cfm)	E_z	V_{oz} (cfm)
DOAS to Zone Level Equipment Dehum and Reheat	5.15	111.06	0.08	12,966	1,550		1,550		1,550
ACT-Noisy-1	7.50	3.59	0.06	180	38	1.00	38	1.00	38
ACT-Noisy-2	7.50	3.62	0.06	181	38	1.00	38	1.00	38
ACT-Noisy-3	7.50	3.64	0.06	182	38	1.00	38	1.00	38
ACT-Quiet-1	7.50	2.61	0.06	130	27	1.00	27	1.00	27
ACT-Quiet-2	7.50	2.61	0.06	131	27	1.00	27	1.00	27
ACT-Quiet-3	7.50	2.62	0.06	131	28	1.00	28	1.00	28
Admin	5.00	1.89	0.06	189	21	1.00	21	1.00	21
Attrium	5.00	6.33	0.06	1,267	108	1.00	108	1.00	108
Chart/Hotel	5.00	2.00	0.06	200	22	1.00	22	1.00	22
Comfort/Consult	7.50	2.83	0.18	283	72	1.00	72	1.00	72
Corridor-N	0.00	0.00	0.06	409	25	1.00	25	1.00	25
Corridor-S	0.00	0.00	0.06	414	25	1.00	25	1.00	25
Corridor-W	0.00	0.00	0.06	324	19	1.00	19	1.00	19
Entry/Waiting	5.00	1.85	0.06	370	31	1.00	31	1.00	31
Exam/Storage	5.32	1.73	0.13	224	37	1.00	37	1.00	37
Group	7.50	5.53	0.18	276	91	1.00	91	1.00	91
Hospitality	7.50	4.92	0.18	246	81	1.00	81	1.00	81
Intake-HR-A	4.46	3.96	0.11	471	69	1.00	69	1.00	69
Intake-HR-B	5.06	1.24	0.12	165	26	1.00	26	1.00	26
Lounge	5.00	5.93	0.12	297	65	1.00	65	1.00	65

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 17 of 29

Ventilation Parameters

System Zone	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
						Ez	Voz (cfm)	Ez	Voz (cfm)
Multipurpose/Dining	7.50	9.71	0.18	485	160	1.00	160	1.00	160
RB-N-Corner	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-N-East	5.00	2.57	0.06	257	28	1.00	28	1.00	28
RB-N-West	5.00	3.83	0.06	383	42	1.00	42	1.00	42
RB-S-Corner-N	5.00	1.29	0.06	129	14	1.00	14	1.00	14
RB-S-Corner-S	5.00	1.31	0.06	131	14	1.00	14	1.00	14
RB-S-East	5.00	3.72	0.06	372	41	1.00	41	1.00	41
RB-S-West	5.00	1.24	0.06	124	14	1.00	14	1.00	14
RB-W-North	5.00	1.30	0.06	130	14	1.00	14	1.00	14
RB-W-South	5.00	3.80	0.06	380	42	1.00	42	1.00	42
Servery	7.50	4.56	0.18	228	75	1.00	75	1.00	75
SHWR-N	0.00	4.07	0.00	204	0	1.00	0	1.00	0
SHWR-S	0.00	4.14	0.00	207	0	1.00	0	1.00	0
SHWR-W	0.00	4.14	0.00	207	0	1.00	0	1.00	0
Support	0.00	0.00	0.06	603	36	1.00	36	1.00	36
Utility	0.00	7.15	0.06	2,927	164	1.00	164	1.00	164
Kitchen_Single Zone CV	0.00	0.00	0.13	686	0		0		0
Kitchen	6.63	13.09	0.13	686	0	1.00	0	1.00	0

*Ventilation Sizing Factor: 1.00

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
DOAS to Zone Level Equipment Dehum and Reheat		1,550	1,550	1,550	1,550							
ACT-Noisy-1	Single Duct VAV No Reheat	38	38	38	37.73	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2	Single Duct VAV No Reheat	38	38	38	37.98	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3	Single Duct VAV No Reheat	38	38	38	38.25	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1	Single Duct VAV No Reheat	27	27	27	27.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2	Single Duct VAV No Reheat	27	27	27	27.43	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3	Single Duct VAV No Reheat	28	28	28	27.53	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Admin	Single Duct VAV No Reheat	21	21	21	20.83	1.000	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 18 of 29

Ventilation Calculations for Cooling Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-clg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
Attrium	Single Duct VAV No Reheat	108	108	108	107.67	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel	Single Duct VAV No Reheat	22	22	22	21.95	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult	Single Duct VAV No Reheat	72	72	72	72.28	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N	Single Duct VAV No Reheat	25	25	25	24.54	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S	Single Duct VAV No Reheat	25	25	25	24.84	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W	Single Duct VAV No Reheat	19	19	19	19.44	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting	Single Duct VAV No Reheat	31	31	31	31.49	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage	Single Duct VAV No Reheat	37	37	37	37.41	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Group	Single Duct VAV No Reheat	91	91	91	91.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality	Single Duct VAV No Reheat	81	81	81	81.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A	Single Duct VAV No Reheat	69	69	69	69.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B	Single Duct VAV No Reheat	26	26	26	26.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Lounge	Single Duct VAV No Reheat	65	65	65	65.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining	Single Duct VAV No Reheat	160	160	160	160.19	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner	Single Duct VAV No Reheat	14	14	14	14.34	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East	Single Duct VAV No Reheat	28	28	28	28.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West	Single Duct VAV No Reheat	42	42	42	42.08	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N	Single Duct VAV No Reheat	14	14	14	14.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S	Single Duct VAV No Reheat	14	14	14	14.44	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East	Single Duct VAV No Reheat	41	41	41	40.91	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West	Single Duct VAV No Reheat	14	14	14	13.64	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North	Single Duct VAV No Reheat	14	14	14	14.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South	Single Duct VAV No Reheat	42	42	42	41.75	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Servery	Single Duct VAV No Reheat	75	75	75	75.31	1.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-S	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support	Single Duct VAV No Reheat	36	36	36	36.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Utility	Single Duct VAV No Reheat	164	164	164	164.17	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen_Single Zone CV		2,532	2,532	2,532	0							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANT VOLUME:NOREHEAT	2,532	2,532	2,532	0.00	0.000	.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 19 of 29

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
DOAS to Zone Level Equipment Dehum and Reheat		1,550	1,550	1,550	1,550							
ACT-Noisy-1	Single Duct VAV No Reheat	38	38	38	37.73	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-2	Single Duct VAV No Reheat	38	38	38	37.98	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Noisy-3	Single Duct VAV No Reheat	38	38	38	38.25	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-1	Single Duct VAV No Reheat	27	27	27	27.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-2	Single Duct VAV No Reheat	27	27	27	27.43	1.000	1.00	0.00	0.00	0.00	0.00	1.000
ACT-Quiet-3	Single Duct VAV No Reheat	28	28	28	27.53	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Admin	Single Duct VAV No Reheat	21	21	21	20.83	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Attrium	Single Duct VAV No Reheat	108	108	108	107.67	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Chart/Hotel	Single Duct VAV No Reheat	22	22	22	21.95	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Comfort/Consult	Single Duct VAV No Reheat	72	72	72	72.28	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-N	Single Duct VAV No Reheat	25	25	25	24.54	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-S	Single Duct VAV No Reheat	25	25	25	24.84	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Corridor-W	Single Duct VAV No Reheat	19	19	19	19.44	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Entry/Waiting	Single Duct VAV No Reheat	31	31	31	31.49	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Exam/Storage	Single Duct VAV No Reheat	37	37	37	37.41	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Group	Single Duct VAV No Reheat	91	91	91	91.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Hospitality	Single Duct VAV No Reheat	81	81	81	81.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-A	Single Duct VAV No Reheat	69	69	69	69.37	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Intake-HR-B	Single Duct VAV No Reheat	26	26	26	26.22	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Lounge	Single Duct VAV No Reheat	65	65	65	65.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Multipurpose/Dining	Single Duct VAV No Reheat	160	160	160	160.19	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-Corner	Single Duct VAV No Reheat	14	14	14	14.34	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-East	Single Duct VAV No Reheat	28	28	28	28.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-N-West	Single Duct VAV No Reheat	42	42	42	42.08	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-N	Single Duct VAV No Reheat	14	14	14	14.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-Corner-S	Single Duct VAV No Reheat	14	14	14	14.44	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-East	Single Duct VAV No Reheat	41	41	41	40.91	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-S-West	Single Duct VAV No Reheat	14	14	14	13.64	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-North	Single Duct VAV No Reheat	14	14	14	14.27	1.000	1.00	0.00	0.00	0.00	0.00	1.000
RB-W-South	Single Duct VAV No Reheat	42	42	42	41.75	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Servery	Single Duct VAV No Reheat	75	75	75	75.31	1.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-N	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 20 of 29

Ventilation Calculations for Heating Design

System Zone	Box Type	Vpz (cfm)	Vdz (cfm)	Vpz-min (cfm)	Voz-htg (cfm)	Zpz	Ep	Er	Fa	Fb	Fc	Evz
SHWR-S	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
SHWR-W	Single Duct VAV No Reheat	0	0	0	0.00	0.000	1.00	0.00	0.00	0.00	0.00	1.000
Support	Single Duct VAV No Reheat	36	36	36	36.20	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Utility	Single Duct VAV No Reheat	164	164	164	164.17	1.000	1.00	0.00	0.00	0.00	0.00	1.000
Kitchen_Single Zone CV		2,532	2,532	2,532	0							
Kitchen	AIRTERMINAL:SINGLEDUCT:CONSTANTVOLUME:NOREHEAT	2,532	2,532	2,532	0.00	0.000	0.00	0.00	0.00	0.00	0.00	1.000

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
ACT-Noisy-1		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 1	7.50	3.59	0.06	180	0	100.00	0	100.00	0
ACT-Noisy-2		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 2	7.50	3.61	0.06	181	0	100.00	0	100.00	0
ACT-Noisy-3		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Noisy Activity 3	7.50	3.64	0.06	182	0	100.00	0	100.00	0
ACT-Quiet-1		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 1	7.50	2.60	0.06	130	0	100.00	0	100.00	0
ACT-Quiet-2		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 2	7.50	2.61	0.06	131	0	100.00	0	100.00	0
ACT-Quiet-3		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Quiet Activity 3	7.50	2.62	0.06	131	0	100.00	0	100.00	0
Admin		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Office 1	5.00	0.94	0.06	94	0	100.00	0	100.00	0
	Office 2	5.00	0.95	0.06	95	0	100.00	0	100.00	0
Atrium		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Atrium 2	5.00	3.23	0.06	645	0	100.00	0	100.00	0
	Atrium	5.00	3.11	0.06	622	0	100.00	0	100.00	0
Chart/Hotel		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Chart/Hotel	5.00	2.00	0.06	200	0	100.00	0	100.00	0
Comfort/Consult		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Comfort Room 2	7.50	0.82	0.18	82	0	100.00	0	100.00	0
	Consult 1	7.50	1.00	0.18	100	0	100.00	0	100.00	0
	Consult 2	7.50	1.02	0.18	102	0	100.00	0	100.00	0
Corridor-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 3	0.00	0.00	0.06	409	0	100.00	0	100.00	0
Corridor-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 5	0.00	0.00	0.06	414	0	100.00	0	100.00	0
Corridor-W		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Corridor 4	0.00	0.00	0.06	324	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 22 of 29

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
Entry/Waiting		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Entry/Waiting	5.00	1.85	0.06	370	0	100.00	0	100.00	0
Exam/Storage		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Exam Room	7.50	1.23	0.18	123	0	100.00	0	100.00	0
	Long Term Belongings Storage	0.00	0.50	0.06	101	0	100.00	0	100.00	0
Group		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Group	7.50	5.52	0.18	276	0	100.00	0	100.00	0
Hospitality		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Hospitality	7.50	4.92	0.18	246	0	100.00	0	100.00	0
Intake-HR-A		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Sally Port	7.50	0.78	0.18	78	0	100.00	0	100.00	0
	Interview Room	7.50	1.58	0.18	158	0	100.00	0	100.00	0
	Intake Corridor	0.00	0.00	0.06	155	0	100.00	0	100.00	0
	Shower 1	0.00	1.60	0.00	80	0	100.00	0	100.00	0
		0.00	1.60	0.00	80	0	100.00	0	100.00	0
Intake-HR-B		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Comfort Room 1	7.50	0.84	0.18	84	0	100.00	0	100.00	0
	Ante Room	0.00	0.40	0.06	81	0	100.00	0	100.00	0
Lounge		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Lounge	7.50	3.95	0.18	198	0	100.00	0	100.00	0
	Shower 2	0.00	1.98	0.00	99	0	100.00	0	100.00	0
Multipurpose/Dining		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Multipurpose/Dining	7.50	9.70	0.18	485	0	100.00	0	100.00	0
RB-N-Corner		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 14	5.00	1.30	0.06	130	0	100.00	0	100.00	0
RB-N-East		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 15	5.00	1.30	0.06	130	0	100.00	0	100.00	0
	Resident Room 16	5.00	1.27	0.06	127	0	100.00	0	100.00	0
RB-N-West		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 11	5.00	1.29	0.06	129	0	100.00	0	100.00	0
	Resident Room 12	5.00	1.27	0.06	127	0	100.00	0	100.00	0
	Resident Room 13	5.00	1.27	0.06	127	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 23 of 29

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
RB-S-Corner-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 04	5.00	1.29	0.06	129	0	100.00	0	100.00	0
RB-S-Corner-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 05	5.00	1.31	0.06	131	0	100.00	0	100.00	0
RB-S-East		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 02	5.00	1.12	0.06	112	0	100.00	0	100.00	0
	Resident Room 03	5.00	1.36	0.06	136	0	100.00	0	100.00	0
	Resident Room 01	5.00	1.24	0.06	124	0	100.00	0	100.00	0
RB-S-West		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 06	5.00	1.24	0.06	124	0	100.00	0	100.00	0
RB-W-North		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 10	5.00	1.30	0.06	130	0	100.00	0	100.00	0
RB-W-South		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Resident Room 07	5.00	1.25	0.06	125	0	100.00	0	100.00	0
	Resident Room 08	5.00	1.26	0.06	126	0	100.00	0	100.00	0
	Resident Room 09	5.00	1.28	0.06	128	0	100.00	0	100.00	0
Serving		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Serving	7.50	4.56	0.18	228	0	100.00	0	100.00	0
SHWR-N		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 7	0.00	2.06	0.00	103	0	100.00	0	100.00	0
	Shower 8	0.00	2.01	0.00	101	0	100.00	0	100.00	0
SHWR-S		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 3	0.00	2.08	0.00	104	0	100.00	0	100.00	0
	Shower 4	0.00	2.06	0.00	103	0	100.00	0	100.00	0
SHWR-W		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Shower 5	0.00	2.07	0.00	104	0	100.00	0	100.00	0
	Shower 6	0.00	2.07	0.00	104	0	100.00	0	100.00	0
Support		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Fire Room	0.00	0.00	0.06	79	0	100.00	0	100.00	0
	Electric	0.00	0.00	0.06	191	0	100.00	0	100.00	0
	Emergency Electric	0.00	0.00	0.06	179	0	100.00	0	100.00	0
	Mechanical	0.00	0.00	0.06	155	0	100.00	0	100.00	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 24 of 29

Single-Zone System Calculations

Zone	Room	Rp cfm/person	Pz People	Ra cfm/ft²	Az (ft²)	Vbz (cfm)	Cooling		Heating	
							Ez	Voz (cfm)	Ez	Voz (cfm)
Utility		N/A	N/A	N/A	N/A	0	100.00	0	100.00	0
	Soiled Supply	0.00	0.48	0.06	97	0	100.00	0	100.00	0
	Clean Supply	0.00	0.51	0.06	102	0	100.00	0	100.00	0
	Hskp	0.00	0.28	0.06	57	0	100.00	0	100.00	0
	Laundry	0.00	0.61	0.06	122	0	100.00	0	100.00	0
	Meds	0.00	0.65	0.06	129	0	100.00	0	100.00	0
	Stor.	0.00	0.07	0.06	15	0	100.00	0	100.00	0
	Storage	0.00	0.26	0.06	52	0	100.00	0	100.00	0
	Staff Corridor	0.00	0.00	0.06	893	0	100.00	0	100.00	0
	Corridor 1	0.00	0.00	0.06	295	0	100.00	0	100.00	0
	Corridor 2	0.00	0.00	0.06	635	0	100.00	0	100.00	0
	Toilet 1	0.00	1.34	0.00	67	0	100.00	0	100.00	0
	Toilet 2	0.00	1.24	0.00	62	0	100.00	0	100.00	0
	Toilet 3	0.00	1.23	0.00	62	0	100.00	0	100.00	0
	IT	0.00	0.00	0.06	158	0	100.00	0	100.00	0
	General Storage	0.00	0.48	0.06	96	0	100.00	0	100.00	0
	Corridor 2.1	0.00	0.00	0.06	85	0	100.00	0	100.00	0

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Single Zone CV	N/A	N/A	N/A
Kitchen	0	174	0.00%
Kitchen	0	155	N/A
Service	0	19	N/A
Variable Refrigerant Flow	N/A	N/A	N/A
ACT-Noisy-1	119	0	0.00%
Noisy Activity 1	119	0	N/A
ACT-Noisy-2	60	0	0.00%
Noisy Activity 2	59	0	N/A
ACT-Noisy-3	65	0	0.00%
Noisy Activity 3	64	0	N/A
ACT-Quiet-1	35	0	0.00%
Quiet Activity 1	35	0	N/A
ACT-Quiet-2	51	0	0.00%
Quiet Activity 2	50	0	N/A
ACT-Quiet-3	49	0	0.00%
Quiet Activity 3	48	0	N/A
Admin	80	0	0.00%
Office 1	44	0	N/A
Office 2	40	0	N/A
Atrium	251	0	0.00%
Atrium	87	0	N/A
Atrium 2	164	0	N/A
Chart/Hotel	44	0	0.00%
Chart/Hotel	41	0	N/A
Comfort/Consult	72	0	0.00%
Comfort Room 2	21	0	N/A
Consult 1	25	0	N/A
Consult 2	26	0	N/A
Corridor-N	80	0	0.00%
Corridor 3	80	0	N/A
Corridor-S	152	0	0.00%

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 26 of 29

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Corridor 5	151	0	N/A
Corridor-W	171	0	0.00%
Corridor 4	170	0	N/A
Entry/Waiting	454	0	0.00%
Entry/Waiting	457	0	N/A
Exam/Storage	50	0	0.00%
Exam Room	31	0	N/A
Long Term Belongings Storage	18	0	N/A
Group	91	0	0.00%
Group	91	0	N/A
Hospitality	81	0	0.00%
Hospitality	81	0	N/A
Intake-HR-A	151	0	0.00%
Intake Corridor	18	0	N/A
Interview Room	47	0	N/A
Sally Port	51	0	N/A
Shower 1	35	0	N/A
Intake-HR-B	37	0	0.00%
Ante Room	16	0	N/A
Comfort Room 1	21	0	N/A
Lounge	148	0	0.00%
Lounge	94	0	N/A
Shower 2	54	0	N/A
Multipurpose/Dining	160	0	0.00%
Multipurpose/Dining	160	0	N/A
RB-N-Corner	100	0	0.00%
Resident Room 14	100	0	N/A
RB-N-East	167	0	0.00%
Resident Room 15	86	0	N/A
Resident Room 16	81	0	N/A
RB-N-West	277	0	0.00%
Resident Room 11	91	0	N/A
Resident Room 12	92	0	N/A

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 27 of 29

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Resident Room 13	93	0	N/A
RB-S-Corner-N	87	0	0.00%
Resident Room 04	88	0	N/A
RB-S-Corner-S	107	0	0.00%
Resident Room 05	107	0	N/A
RB-S-East	235	0	0.00%
Resident Room 01	73	0	N/A
Resident Room 02	75	0	N/A
Resident Room 03	86	0	N/A
RB-S-West	89	0	0.00%
Resident Room 06	89	0	N/A
RB-W-North	90	0	0.00%
Resident Room 10	90	0	N/A
RB-W-South	304	0	0.00%
Resident Room 07	98	0	N/A
Resident Room 08	101	0	N/A
Resident Room 09	105	0	N/A
Servery	75	0	0.00%
Servery	75	0	N/A
SHWR-N	94	0	0.00%
Shower 7	48	0	N/A
Shower 8	46	0	N/A
SHWR-S	101	0	0.00%
Shower 3	50	0	N/A
Shower 4	51	0	N/A
SHWR-W	89	0	0.00%
Shower 5	45	0	N/A
Shower 6	44	0	N/A
Support	220	0	0.00%
Electric	76	0	N/A
Emergency Electric	59	0	N/A
Fire Room	42	0	N/A
Mechanical	43	0	N/A
Utility	496	0	0.00%

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 28 of 29

Sum of Outdoor Air Calculations

System Zone Room	Supply (cfm)	Outdoor (cfm)	Outdoor (%)
Clean Supply	17	0	N/A
Corridor 1	36	0	N/A
Corridor 2	61	0	N/A
Corridor 2.1	12	0	N/A
General Storage	36	0	N/A
Hskp	11	0	N/A
IT	40	0	N/A
Laundry	20	0	N/A
Meds	21	0	N/A
Soiled Supply	17	0	N/A
Staff Corridor	144	0	N/A
Stor.	7	0	N/A
Storage	16	0	N/A
Toilet 1	35	0	N/A
Toilet 2	18	0	N/A
Toilet 3	19	0	N/A

Plant Summary

This alternative does not include any cooling, heating, or VRF plants.

Plant Summary

Variable Refrigerant Flow Plant Summary

	Sizing Method	Cooling Peak Time Mo./Day/Time	Cooling Capacity (tons)	Heating Peak Time Mo./Day/Time	Heating Capacity (MBh)	Cond Flow Rate (gpm)
Air Source VRF OVRF-1	Peak	Sum of Peaks	9.46	Sum of Peaks	113.49	0

System Cooling Checksums

Admin_PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent				
	Instant	Delay	Latent	Total	of	Btu/h
	Sensible	Sensible			Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	405	0	405	12.6	1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	328	372	0	700	21.7	45.0
Door	0	0	0	0	0.0	0.0
Wall	0	546	0	546	16.9	2.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-94	0	-94	-2.9	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-76	0	-76	-2.4	-0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	112	0	-58	54	1.7	0.3
Envelope Subtotal	439	1,153	-58	1,534	47.6	-
People	199	276	379	854	26.5	4.5
Lights	127	199	0	326	10.1	2.5
RA Sensible (Lights)	121	0	0	121	3.7	0.0
Miscellaneous Loads	97	0	0	97	3.0	0.5
Internal Subtotal	544	475	379	1,398	43.3	-
Ventilation	506	0	-264	242	7.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	69	0	-	69	2.1	-
Time Delay Correction	0	-17	-	-17	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,559	1,610	57	3,226	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/14:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
Roof	0	405	405	16.4	210
Other Roof	0	0	0	0.0	210
Glass	328	372	700	28.3	16
Door	0	0	0	0.0	0
Wall	0	546	546	22.1	215
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	215
Partition	0	-94	-94	-3.8	776
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-76	-76	-3.1	210
Other Floor	0	0	0	0.0	0
Infiltration	112	0	112	4.5	215
439	1,153	1,592	64.4	-	
199	276	475	19.2	189	
127	199	326	13.2	189	
-	-	-	-	-	
97	0	97	3.9	189	
423	475	898	36.3	-	
-	-	-	-	-	
0	0	0	0.0	0	
		0	0.0	189	
		0	0.0	0	
0	0	0	0.0	0	
-	-	-	-	-	
0	-17	-17	-0.7	-	
0	-	0	0.0	-	
1	-	1	0.0	-	
863	1,610	2,474	100.0		

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	80.1
Fan Heat TD	0.6

Airflows cfm	
Main Fan	119
Ventilation	21
Infiltration	5
Min Stop / Reheat	119

Engineering Checks	
% OA	17.49
cfm/ft²	.63
Btu/h-ft²	17.05
cfm/ton	443.05
ft²/ton	704.26
People	2
ft²/person	100.19

Areas ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Chart/Hotel_PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	28	0	28	1.2	1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	86	0	86	3.7	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-15	0	-15	-0.6	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	120	0	-48	71	3.0	0.0
Envelope Subtotal	120	99	-48	171	7.3	-
People	210	289	399	898	38.3	4.5
Lights	134	209	0	343	14.6	2.5
RA Sensible (Lights)	98	0	0	98	4.2	0.0
Miscellaneous Loads	102	0	0	102	4.4	0.5
Internal Subtotal	544	498	399	1,442	61.4	-
Ventilation	543	0	-221	322	13.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	58	0	58	2.5	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	40	0	-	40	1.7	-
Time Delay Correction	0	-3	-	-3	-0.1	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	194	0	123	317	13.5	-
Grand Total	1,441	653	253	2,347	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/19:00					
Outside Air (DB/WB/HR): 86.7 / 62.9 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
	0	13	13	0.9	21
	0	0	0	0.0	21
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	75	75	5.3	707
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-14	-14	-1.0	214
	0	0	0	0.0	0
	60	0	60	4.3	0
	60	74	134	9.5	-
	210	289	499	35.3	200
	134	209	343	24.3	200
	-	-	-	-	-
	340	0	340	24.1	200
	684	498	1,182	83.7	-
	-	-	-	-	-
	0	98	98	7.0	193
			0	0.0	200
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.2	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	745	667	1,412	100.0	

Temperatures °F	
Supply	55.5
Return	77.5
Mixed Air	84.2
Fan Heat TD	0.6

Airflows cfm	
Main Fan	70
Ventilation	22
Infiltration	5
Min Stop / Reheat	70

Engineering Checks	
% OA	31.49
cfm/ft²	.35
Btu/h-ft²	11.77
cfm/ton	356.59
ft²/ton	1,020.58
People	2
ft²/person	99.79

Areas ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Entry/Waiting _PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/09:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent				
	Instant	Delay	Latent	Total	of	Btu/h
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-4	0	-4	0.0	-0.1
Other Roof	0	0	0	0	0.0	0.0
Glass	5,410	6,118	0	11,528	103.6	40.2
Door	0	0	0	0	0.0	0.0
Wall	0	253	0	253	2.3	0.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,155	0	-1,155	-10.4	-2.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	356	0	356	3.2	0.9
Other Floor	0	0	0	0	0.0	0.0
Infiltration	65	0	-23	42	0.4	0.1
Envelope Subtotal	5,476	5,567	-23	11,020	99.1	-
People	182	241	287	710	6.4	1.9
Lights	201	272	0	473	4.3	1.9
RA Sensible (Lights)	216	0	0	216	1.9	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	599	513	287	1,399	12.6	-
Ventilation	222	0	-79	143	1.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-1,497	0	-1,497	-13.5	-4.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	284	0	-	284	2.5	-
Time Delay Correction	0	-225	-	-225	-2.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	2	0	0	2	0.0	-
Grand Total	6,582	4,358	185	11,125	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/09:00		
Outside Air (DB/WB/HR):		81.8 / 61.2 / 0.0		
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
Roof	0	-4	-4	0.0
Other Roof	0	0	0	0.0
Glass	5,410	6,118	11,528	112.8
Door	0	0	0	0.0
Wall	0	253	253	2.5
Below-Grade Wall	0	0	0	0.0
Other Wall	0	0	0	0.0
Partition	0	-1,155	-1,155	-11.3
Exterior Floor	0	0	0	0.0
Interior Floor	0	0	0	0.0
Slab	0	356	356	3.5
Other Floor	0	0	0	0.0
Infiltration	65	0	65	0.6
Envelope Subtotal	5,476	5,567	11,043	108.1
People	182	241	423	4.1
Lights	201	272	473	4.6
RA Sensible (Lights)	-	-	-	-
Miscellaneous Loads	0	0	0	0.0
Internal Subtotal	383	513	896	8.8
Ventilation	-	-	-	-
DOAS Direct to Zone	0	-1,497	-1,497	-14.6
Ceiling			0	0.0
Refrigeration			0	0.0
Service Water			0	0.0
HVAC Equipment Losses			0	0.0
Adj Air Transfer Heat	0	0	0	0.0
Supply Fan Heat	-	-	-	-
Time Delay Correction	0	-225	-225	-2.2
Sizing Factor Correction	0	-	0	0.0
Over/Undersizing	2	-	2	0.0
Grand Total	5,860	4,358	10,218	100.0

Temperatures °F	
Supply	55.0
Return	75.5
Mixed Air	75.9
Fan Heat TD	0.6

Airflows cfm	
Main Fan	492
Ventilation	31
Infiltration	9
Min Stop / Reheat	492

Engineering Checks	
% OA	6.40
cfm/ft²	1.33
Btu/h-ft²	30.05
cfm/ton	530.71
ft²/ton	399.55
People	2
ft²/person	200.24

Areas ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	287
Door	0
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Hospitality_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
Roof	0	320	0	320	6.1	2.5
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	289	0	289	5.5	1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	84	0	84	1.6	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-31	0	-31	-0.6	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	148	0	-64	84	1.6	0.3
Envelope Subtotal	148	663	-64	747	14.3	-
People	492	702	984	2,179	41.7	8.9
Lights	147	233	0	380	7.3	2.2
RA Sensible (Lights)	119	0	0	119	2.3	0.0
Miscellaneous Loads	252	171	0	423	8.1	1.7
Internal Subtotal	1,010	1,106	984	3,100	59.3	-
Ventilation	2,011	0	-874	1,137	21.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	60	0	60	1.1	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	158	0	-	158	3.0	-
Time Delay Correction	0	-5	-	-5	-0.1	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	17	0	14	30	0.6	-
Grand Total	3,343	1,824	60	5,227	100.0	-

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/16:00					
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	315	315	11.0	129
	0	0	0	0.0	129
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	307	307	10.7	260
	0	0	0	0.0	0
	0	0	0	0.0	260
	0	73	73	2.6	528
	0	0	0	0.0	0
	0	-32	-32	-1.1	262
	0	0	0	0.0	0
	137	0	137	4.7	260
	137	664	800	27.8	-
	492	716	1,208	41.9	246
	147	233	380	13.2	246
	-	-	-	-	-
	252	171	423	14.7	246
	891	1,119	2,010	69.8	-
	-	-	-	-	-
	0	71	71	2.5	133
			0	0.0	246
			0	0.0	246
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-5	-5	-0.2	-
	0	-	0	0.0	-
	2	-	2	0.1	-
	1,030	1,849	2,879	100.0	-

Temperatures °F	
Supply	64.9
Return	75.6
Mixed Air	82.5
Fan Heat TD	0.6

Airflows cfm	
Main Fan	274
Ventilation	81
Infiltration	6
Min Stop / Reheat	274

Engineering Checks	
% OA	29.64
cfm/ft²	1.11
Btu/h-ft²	21.26
cfm/ton	628.94
ft²/ton	564.88
People	5
ft²/person	50.01

Areas ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Lounge_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	652	0	652	7.6	2.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,366	1,242	0	2,608	30.5	71.4
Door	0	0	0	0	0.0	0.0
Wall	0	554	0	554	6.5	2.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-409	0	-409	-4.8	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-192	0	-192	-2.2	-0.6
Other Floor	0	0	0	0	0.0	0.0
Infiltration	175	0	-49	126	1.5	0.5
Envelope Subtotal	1,541	1,847	-49	3,339	39.0	-
People	589	867	1,098	2,554	29.8	8.6
Lights	187	284	0	471	5.5	2.3
RA Sensible (Lights)	165	0	0	165	1.9	0.0
Miscellaneous Loads	202	133	0	335	3.9	1.1
Internal Subtotal	1,143	1,284	1,098	3,525	41.2	-
Ventilation	1,583	0	-452	1,132	13.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	167	0	-	167	1.9	-
Time Delay Correction	0	-92	-	-92	-1.1	-
Sizing Factor Correction	294	-	-	294	3.4	-
Over/Undersizing	139	0	61	200	2.3	-
Grand Total	4,868	3,038	658	8,564	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		10/21/14:00			
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0			
	Time	Percent		Related	
	Instant	Delay		Area	
	Sensible	Sensible	Total		
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	484	484	8.1	322
	0	0	0	0.0	322
	1,410	1,629	3,039	50.7	37
	0	0	0	0.0	0
	0	578	578	9.6	250
	0	0	0	0.0	0
	0	0	0	0.0	250
	0	-451	-451	-7.5	987
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-236	-236	-3.9	322
	0	0	0	0.0	0
	112	0	112	1.9	250
	1,523	2,003	3,526	58.8	-
	589	867	1,456	24.3	297
	187	284	471	7.9	297
	-	-	-	-	-
	202	133	335	5.6	297
	979	1,284	2,262	37.8	-
	-	-	-	-	-
	0	0	0	0.0	0
	0	0	0	0.0	0
			0	0.0	297
			0	0.0	297
	0	0	0	0.0	0
	-	-	-	-	-
	0	-95	-95	-1.6	-
	302	-	302	5.0	-
	-2	-	-2	0.0	-
	2,801	3,191	5,992	100.0	

Temperatures °F	
Supply	55.0
Return	75.7
Mixed Air	80.8
Fan Heat TD	0.6

Airflows cfm	
Main Fan	290
Ventilation	65
Infiltration	7
Min Stop / Reheat	290

Engineering Checks	
% OA	22.54
cfm/ft²	.98
Btu/h-ft²	28.88
cfm/ton	405.72
ft²/ton	415.73
People	6
ft²/person	50.04

Areas ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	37
Door	0
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

Multipurpose/Dining_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	699	0	699	7.0	2.6
Other Roof	0	0	0	0	0.0	0.0
Glass	623	260	0	883	8.9	19.9
Door	0	0	0	0	0.0	0.0
Wall	0	300	0	300	3.0	0.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-339	0	-339	-3.4	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-71	0	-71	-0.7	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	291	0	-124	168	1.7	0.5
Envelope Subtotal	914	849	-124	1,639	16.5	-
People	971	1,316	1,942	4,229	42.6	8.7
Lights	291	433	0	723	7.3	2.2
RA Sensible (Lights)	133	0	0	133	1.3	0.0
Miscellaneous Loads	497	318	0	815	8.2	1.7
Internal Subtotal	1,891	2,067	1,942	5,900	59.4	-
Ventilation	3,965	0	-1,701	2,264	22.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	32	0	32	0.3	0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	154	0	-	154	1.6	-
Time Delay Correction	0	-57	-	-57	-0.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	-1	-2	0.0	-
Grand Total	6,923	2,891	116	9,931	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	699	699	12.6	266
Other Roof	0	0	0	0.0	266
Glass	623	260	883	15.9	44
Door	0	0	0	0.0	0
Wall	0	300	300	5.4	322
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	322
Partition	0	-339	-339	-6.1	788
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-71	-71	-1.3	508
Other Floor	0	0	0	0.0	0
Infiltration	291	0	291	5.2	322
Envelope Subtotal	914	849	1,763	31.7	-
People	971	1,316	2,287	41.1	485
Lights	291	433	723	13.0	485
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	497	318	815	14.7	485
Internal Subtotal	1,758	2,067	3,826	68.8	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	32	32	0.6	242
Ceiling			0	0.0	485
Refrigeration			0	0.0	485
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-57	-57	-1.0	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	-1	-	-1	0.0	-
Over/Undersizing	2,671	2,891	5,563	100.0	

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	89.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	268
Ventilation	160
Infiltration	12
Min Stop / Reheat	268

Engineering Checks	
% OA	59.80
cfm/ft²	.55
Btu/h-ft²	20.47
cfm/ton	323.73
ft²/ton	586.55
People	10
ft²/person	49.99

Areas ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	44
Door	0
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Servery_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	312	0	312	6.9	2.5
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	173	0	173	3.8	1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-39	0	-39	-0.9	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-33	0	-33	-0.7	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	137	0	-60	77	1.7	0.5
Envelope Subtotal	137	413	-60	490	10.8	-
People	456	671	913	2,040	45.0	8.9
Lights	137	221	0	358	7.9	2.3
RA Sensible (Lights)	58	0	0	58	1.3	0.0
Miscellaneous Loads	234	162	0	396	8.7	1.7
Internal Subtotal	885	1,055	913	2,852	63.0	-
Ventilation	1,864	0	-828	1,036	22.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	61	0	61	1.4	0.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	69	0	-	69	1.5	-
Time Delay Correction	0	-9	-	-9	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	16	0	13	30	0.7	-
Grand Total	2,971	1,520	38	4,530	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time	Percent		Related	
	Instant	Delay	Total	of	Area
	Sensible	Sensible	Sensible	Total	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	303	303	12.1	124
	0	0	0	0.0	124
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	185	185	7.4	160
	0	0	0	0.0	0
	0	0	0	0.0	160
	0	-35	-35	-1.4	620
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-34	-34	-1.4	244
	0	0	0	0.0	0
	127	0	127	5.1	160
	127	418	545	21.8	-
	456	682	1,139	45.6	228
	137	221	358	14.3	228
	-	-	-	-	-
	234	162	396	15.8	228
	827	1,066	1,893	75.7	-
	-	-	-	-	-
	0	70	70	2.8	120
			0	0.0	228
			0	0.0	228
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-8	-8	-0.3	-
	0	-	0	0.0	-
	-1	-	-1	0.0	-
	953	1,547	2,500	100.0	

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	90.4
Fan Heat TD	0.6

Airflows cfm	
Main Fan	120
Ventilation	75
Infiltration	6
Min Stop / Reheat	120

Engineering Checks	
% OA	62.56
cfm/ft²	.53
Btu/h-ft²	19.86
cfm/ton	318.94
ft²/ton	604.55
People	5
ft²/person	50.04

Areas ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Attrium_PSZ-HP-Atrium

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	1,590	0	1,590	14.2	2.3
Other Roof	0	0	0	0	0.0	0.0
Glass	855	523	0	1,378	12.3	24.2
Door	0	0	0	0	0.0	0.0
Wall	0	1,500	0	1,500	13.4	1.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	22	0	22	0.2	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	-162	0	-162	-1.4	-0.2
Slab	0	-7	0	-7	-0.1	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	751	0	-179	571	5.1	0.5
Envelope Subtotal	1,606	3,466	-179	4,893	43.8	-
People	621	876	982	2,479	22.2	2.0
Lights	688	1,005	0	1,693	15.2	2.0
RA Sensible (Lights)	577	0	0	577	5.2	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	1,886	1,881	982	4,749	42.5	-
Ventilation	2,617	0	-1,510	1,107	9.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-497	0	-497	-4.4	-0.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	233	0	-	233	2.1	-
Time Delay Correction	0	-48	-	-48	-0.4	-
Sizing Factor Correction	499	-	-	499	4.5	-
Over/Undersizing	169	0	69	238	2.1	-
Grand Total	7,009	4,803	-638	11,174	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	1,546	1,546	18.4	704
Other Roof	0	0	0	0.0	704
Glass	822	594	1,416	16.9	57
Door	0	0	0	0.0	0
Wall	0	1,613	1,613	19.2	1,046
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	1,046
Partition	0	94	94	1.1	1,426
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	-148	-148	-1.8	878
Slab	0	-1	-1	0.0	469
Other Floor	0	0	0	0.0	878
Infiltration	694	0	694	8.3	1,046
Envelope Subtotal	1,516	3,697	5,213	62.2	-
People	621	876	1,497	17.9	1,267
Lights	688	1,005	1,693	20.2	1,267
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	0	0	0	0.0	1,267
Internal Subtotal	1,309	1,881	3,190	38.0	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	-475	-475	-5.7	671
Ceiling			0	0.0	1,267
Refrigeration			0	0.0	1,267
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-48	-48	-0.6	-
Time Delay Correction	510	-	510	6.1	-
Sizing Factor Correction	-5	-	-5	-0.1	-
Over/Undersizing	3,331	5,055	8,386	100.0	

Temperatures °F	
Supply	55.0
Return	76.9
Mixed Air	82.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	404
Ventilation	108
Infiltration	30
Min Stop / Reheat	404

Engineering Checks	
% OA	26.66
cfm/ft²	.32
Btu/h-ft²	8.83
cfm/ton	433.67
ft²/ton	1,360.19
People	6
ft²/person	200.10

Areas ft²	
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Support_PSZ-HP-Utility

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/10:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	375	0	375	3.8	0.6
Other Roof	0	0	0	0	0.0	0.0
Glass	2,258	2,300	0	4,558	46.7	72.4
Door	0	0	0	0	0.0	0.0
Wall	0	801	0	801	8.2	1.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-655	0	-655	-6.7	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-310	0	-310	-3.2	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	2,258	2,511	00	4,770	48.9	-
People	0	0	0	0	0.0	0.0
Lights	278	413	0	691	7.1	1.7
RA Sensible (Lights)	292	0	0	292	3.0	0.0
Miscellaneous Loads	1,441	0	0	1,441	14.8	2.4
Internal Subtotal	2,011	413	0	2,424	24.8	-
Ventilation	435	0	-124	312	3.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	247	0	-	247	2.5	-
Time Delay Correction	0	-121	-	-121	-1.2	-
Sizing Factor Correction	1,866	-	-	1,866	19.1	-
Over/Undersizing	237	0	26	263	2.7	-
Grand Total	7,055	2,803	-98	9,760	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 9/21/10:00					
Outside Air (DB/WB/HR): 86.6 / 60.3 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	125	125	1.4	657
Other Roof	0	0	0	0.0	657
Glass	2,596	2,515	5,110	57.5	63
Door	0	0	0	0.0	0
Wall	0	757	757	8.5	661
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	661
Partition	0	-780	-780	-8.8	1,959
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-239	-239	-2.7	657
Other Floor	0	0	0	0.0	0
Infiltration	0	0	0	0.0	661
Envelope Subtotal	2,596	2,378	4,974	56.0	-
People	0	0	0	0.0	603
Lights	278	413	691	7.8	603
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	1,441	0	1,441	16.2	603
Internal Subtotal	1,719	413	2,132	24.0	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	-	-	0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration	-	-	0	0.0	603
Service Water	-	-	0	0.0	603
HVAC Equipment Losses	-	-	0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-139	-139	-1.6	-
Sizing Factor Correction	1,917	-	1,917	21.6	-
Over/Undersizing	0	-	0	0.0	-
Grand Total	6,231	2,652	8,883	100.0	

Temperatures °F	
Supply	55.0
Return	75.7
Mixed Air	76.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	429
Ventilation	36
Infiltration	0
Min Stop / Reheat	429

Engineering Checks	
% OA	8.44
cfm/ft²	.71
Btu/h-ft²	16.19
cfm/ton	527.30
ft²/ton	741.82
People	
ft²/person	.00

Areas ft²	
Roof	657
Other Roof	657
Ceiling	0
Window	63
Door	0
Wall	661
Below-Grade Wall	0
Other Wall	661
Partition	1,959
Exterior Floor	0
Internal Floor	0
Slab	657
Other Floor	0

Utility_PSZ-HP-Utility

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	6,726	0	6,726	27.1	2.3
Other Roof	0	0	0	0	0.0	0.0
Glass	626	386	0	1,012	4.1	36.2
Door	0	0	0	0	0.0	0.0
Wall	0	132	0	132	0.5	1.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	3,144	0	3,144	12.7	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-153	0	-153	-0.6	0.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	1,132	0	14	1,146	4.6	10.5
Envelope Subtotal	1,758	10,236	14	12,007	48.4	-
People	724	1,044	1,259	3,027	12.2	1.0
Lights	1,661	2,580	0	4,241	17.1	2.1
RA Sensible (Lights)	1,558	0	0	1,558	6.3	0.0
Miscellaneous Loads	247	0	0	247	1.0	0.1
Internal Subtotal	4,190	3,623	1,259	9,073	36.6	-
Ventilation	3,984	0	-1,272	2,711	10.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-26	0	-26	-0.1	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	517	0	-	517	2.1	-
Time Delay Correction	0	-66	-	-66	-0.3	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	440	0	143	583	2.4	-
Grand Total	10,889	13,767	144	24,800	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/15:00		
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0		
	Time	Percent		Related Area (ft²)
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	5,689	5,689	30.6
	0	0	0	0.0
	1,128	996	2,124	11.4
	0	0	0	0.0
	0	183	183	1.0
	0	0	0	0.0
	0	0	0	0.0
	0	3,652	3,652	19.6
	0	0	0	0.0
	0	0	0	0.0
	0	-243	-243	-1.3
	0	0	0	0.0
	1,113	0	1,113	6.0
	2,241	10,277	12,518	67.3
	724	1,044	1,768	9.5
	1,661	2,580	4,241	22.8
	-	-	-	-
	247	0	247	1.3
	2,633	3,623	6,256	33.6
	-	-	-	-
	0	-78	-78	-0.4
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-99	-99	-0.5
	0	-	0	0.0
	1	-	1	0.0
	4,874	13,724	18,598	100.0

Temperatures °F	
Supply	55.0
Return	77.1
Mixed Air	81.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	897
Ventilation	164
Infiltration	46
Min Stop / Reheat	897

Engineering Checks	
% OA	18.31
cfm/ft²	.31
Btu/h-ft²	8.48
cfm/ton	433.99
ft²/ton	1,416.03
People	7
ft²/person	409.31

Areas ft²	
Roof	2,903
Other Roof	2,903
Ceiling	295
Window	28
Door	0
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

SHWR-N_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/12:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	4	0	4	0.1	1.8
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	509	0	509	18.0	2.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-28	0	-28	-1.0	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-33	0	-33	-1.2	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	102	0	-59	44	1.5	0.2
Envelope Subtotal	102	452	-59	495	17.5	-
People	399	690	631	1,720	60.8	8.5
Lights	141	252	0	393	13.9	2.7
RA Sensible (Lights)	162	0	0	162	5.7	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	701	942	631	2,274	80.4	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	9	0	9	0.3	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	56	0	-	56	2.0	-
Time Delay Correction	0	-6	-	-6	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	861	1,396	573	2,830	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/12:00					
Outside Air (DB/WB/HR): 94.8 / 65.5 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
	0	4	4	0.2	2
	0	0	0	0.0	2
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	509	509	25.0	202
	0	0	0	0.0	0
	0	0	0	0.0	202
	0	-28	-28	-1.4	844
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-33	-33	-1.6	225
	0	0	0	0.0	0
	102	0	102	5.0	202
	102	452	554	27.2	-
	399	690	1,089	53.4	204
	141	252	393	19.3	204
	-	-	-	-	-
	0	0	0	0.0	204
	540	942	1,482	72.7	-
	-	-	-	-	-
	0	9	9	0.4	223
			0	0.0	204
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-6	-6	-0.3	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	643	1,396	2,039	100.0	

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	76.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	98
Ventilation	0
Infiltration	5
Min Stop / Reheat	98

Engineering Checks	
% OA	.00
cfm/ft²	.48
Btu/h-ft²	13.91
cfm/ton	415.68
ft²/ton	863.52
People	4
ft²/person	50.03

Areas ft²	
Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

SHWR-S_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/18:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	653	0	653	21.1	3.2
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	14	0	14	0.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-50	0	-50	-1.6	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	87	0	-53	34	1.1	0.2
Envelope Subtotal	87	617	-53	651	21.0	-
People	406	770	642	1,818	58.8	8.8
Lights	143	281	0	425	13.7	2.8
RA Sensible (Lights)	164	0	0	164	5.3	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	714	1,051	642	2,407	77.8	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-18	0	-18	-0.6	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	63	0	-	63	2.0	-
Time Delay Correction	0	-8	-	-8	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	862	1,643	589	3,094	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/18:00	
Outside Air (DB/WB/HR):			91.4 / 64.4 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
0	0	0	0.0	0
0	0	0	0.0	0
0	653	653	28.7	206
0	0	0	0.0	0
0	0	0	0.0	206
0	14	14	0.6	845
0	0	0	0.0	0
0	0	0	0.0	0
0	-50	-50	-2.2	229
0	0	0	0.0	0
87	0	87	3.8	206
87	617	704	30.9	-
406	770	1,176	51.6	207
143	281	425	18.6	207
-	-	-	-	-
0	0	0	0.0	207
549	1,051	1,601	70.3	-
-	-	-	-	-
		0	0.0	0
0	-18	-18	-0.8	229
		0	0.0	207
		0	0.0	207
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-8	-8	-0.3	-
0	-	0	0.0	-
-1	-	-1	0.0	-
635	1,643	2,278	100.0	

Temperatures °F	
Supply	55.0
Return	76.4
Mixed Air	76.4
Fan Heat TD	0.6

Airflows cfm	
Main Fan	110
Ventilation	0
Infiltration	5
Min Stop / Reheat	110

Engineering Checks	
% OA	.00
cfm/ft²	.53
Btu/h-ft²	14.95
cfm/ton	425.27
ft²/ton	803.37
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

SHWR-W_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/18:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	219	0	219	7.9	1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	80	0	80	2.9	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-50	0	-50	-1.8	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	87	0	-61	25	0.9	0.1
Envelope Subtotal	87	249	-61	275	9.9	-
People	406	777	642	1,824	65.5	8.8
Lights	143	284	0	427	15.3	2.9
RA Sensible (Lights)	164	0	0	164	5.9	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	713	1,060	642	2,416	86.7	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	46	0	46	1.7	0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	55	0	-	55	2.0	-
Time Delay Correction	0	-5	-	-5	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	854	1,351	580	2,785	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	219	219	11.0	204
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	204
Partition	0	80	80	4.0	849
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-50	-50	-2.5	229
Other Floor	0	0	0	0.0	0
Infiltration	87	0	87	4.4	204
Envelope Subtotal	87	249	336	16.9	-
People	406	777	1,182	59.6	207
Lights	143	284	427	21.5	207
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	0	0	0	0.0	207
Internal Subtotal	549	1,060	1,609	81.1	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone	0	46	46	2.3	229
Ceiling			0	0.0	207
Refrigeration			0	0.0	207
Service Water			0	0.0	0
HVAC Equipment Losses	0	0	0	0.0	0
Adj Air Transfer Heat	-	-	-	-	-
Supply Fan Heat	0	-5	-5	-0.3	-
Time Delay Correction	0	-	0	0.0	-
Sizing Factor Correction	-1	-	-1	0.0	-
Over/Undersizing	635	1,351	1,986	100.0	

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	76.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	96
Ventilation	0
Infiltration	5
Min Stop / Reheat	96

Engineering Checks	
% OA	.00
cfm/ft²	.46
Btu/h-ft²	13.46
cfm/ton	411.66
ft²/ton	892.18
People	4
ft²/person	50.02

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Kitchen _PSZ-HP-Kitchen

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	1,866	0	1,866	2.8	2.6
Other Roof	0	0	0	0	0.0	0.0
Glass	2,302	2,077	0	4,379	6.6	89.4
Door	0	0	0	0	0.0	0.0
Wall	0	558	0	558	0.8	0.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,201	0	-1,201	-1.8	-0.9
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-694	0	-694	-1.0	-1.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	404	0	-181	223	0.3	0.4
Envelope Subtotal	2,707	2,605	-181	5,131	7.7	-
People	1,375	1,925	3,197	6,497	9.7	9.5
Lights	560	880	0	1,440	2.2	3.0
RA Sensible (Lights)	604	0	0	604	0.9	0.0
Miscellaneous Loads	13,333	8,987	0	22,321	33.4	32.6
Internal Subtotal	15,872	11,793	3,197	30,862	46.2	-
Ventilation	4,225	0	-1,902	2,323	3.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	1,645	0	-	1,645	2.5	-
Time Delay Correction	0	-234	-	-234	-0.3	-
Sizing Factor Correction	26,946	-	-	26,946	40.3	-
Over/Undersizing	102	0	18	119	0.2	-
Grand Total	51,497	14,164	1,131	66,793	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		10/21/14:00			
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0			
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,495	1,495	2.5	726
	0	0	0	0.0	726
	2,391	2,696	5,087	8.6	49
	0	0	0	0.0	0
	0	407	407	0.7	607
	0	0	0	0.0	0
	0	0	0	0.0	607
	0	-1,089	-1,089	-1.8	1,346
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-777	-777	-1.3	726
	0	0	0	0.0	0
	259	0	259	0.4	607
	2,651	2,733	5,383	9.1	-
	1,375	1,925	3,300	5.6	686
	560	880	1,440	2.4	686
	-	-	-	-	-
	13,333	8,987	22,321	37.7	686
	15,268	11,793	27,061	45.7	-
	-	-	-	-	-
	0	0	0	0.0	0
	0	0	0	0.0	686
	0	0	0	0.0	686
	0	0	0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-239	-239	-0.4	-
	27,001	-	27,001	45.6	-
	-19	-	-19	0.0	-
	44,902	14,286	59,187	100.0	

Temperatures °F	
Supply	55.0
Return	75.2
Mixed Air	76.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	2,853
Ventilation	174
Infiltration	17
Min Stop / Reheat	2,853

Engineering Checks	
% OA	6.09
cfm/ft²	4.16
Btu/h-ft²	97.50
cfm/ton	512.68
ft²/ton	123.16
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	49
Door	0
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Comfort/Consult _PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	652	0	652	12.4	2.3
Other Roof	0	0	0	0	0.0	0.0
Glass	236	106	0	342	6.5	14.7
Door	0	0	0	0	0.0	0.0
Wall	0	340	0	340	6.5	1.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-223	0	-223	-4.2	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-30	0	-30	-0.6	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	236	845	00	1,081	20.5	-
People	298	418	567	1,282	24.4	4.5
Lights	259	408	0	666	12.7	3.4
RA Sensible (Lights)	158	0	0	158	3.0	0.0
Miscellaneous Loads	435	295	0	730	13.9	2.6
Internal Subtotal	1,149	1,120	567	2,836	53.9	-
Ventilation	1,788	0	-545	1,243	23.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	12	0	12	0.2	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	89	0	-	89	1.7	-
Time Delay Correction	0	-20	-	-20	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	13	0	8	21	0.4	-
Grand Total	3,274	1,958	30	5,261	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	of	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	611	611	19.1	278
	0	0	0	0.0	278
	211	99	310	9.7	23
	0	0	0	0.0	0
	0	376	376	11.8	336
	0	0	0	0.0	0
	0	0	0	0.0	336
	0	-184	-184	-5.8	1,134
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-28	-28	-0.9	313
	0	0	0	0.0	0
	0	0	0	0.0	336
	211	874	1,085	33.9	-
	298	418	715	22.4	283
	259	408	666	20.8	283
	-	-	-	-	-
	435	295	730	22.8	283
	991	1,120	2,112	66.0	-
	-	-	-	-	-
	0	18	18	0.6	36
			0	0.0	283
			0	0.0	283
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-19	-19	-0.6	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	1,204	1,994	3,197	100.0	

Temperatures °F	
Supply	55.0
Return	76.9
Mixed Air	87.2
Fan Heat TD	0.6

Airflows cfm	
Main Fan	154
Ventilation	72
Infiltration	0
Min Stop / Reheat	154

Engineering Checks	
% OA	46.99
cfm/ft²	.54
Btu/h-ft²	18.58
cfm/ton	350.91
ft²/ton	646.45
People	3
ft²/person	100.16

Areas ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Exam/Storage_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	588	0	588	20.5	2.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-38	0	-38	-1.3	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-14	0	-14	-0.5	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	60	0	-19	42	1.5	0.0
Envelope Subtotal	60	535	-19	577	20.1	-
People	182	248	347	777	27.1	3.5
Lights	157	241	0	397	13.8	2.6
RA Sensible (Lights)	100	0	0	100	3.5	0.0
Miscellaneous Loads	202	124	0	326	11.4	1.5
Internal Subtotal	641	613	347	1,600	55.7	-
Ventilation	925	0	-291	634	22.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	49	0	-	49	1.7	-
Time Delay Correction	0	-5	-	-5	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	10	0	6	16	0.6	-
Grand Total	1,685	1,143	43	2,871	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/16:00				
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(%)
	0	574	574	32.7
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-12	-12	-0.7
	0	0	0	0.0
	0	0	0	0.0
	0	-13	-13	-0.7
	0	0	0	0.0
	56	0	56	3.2
	56	549	605	34.5
	182	248	430	24.5
	157	241	397	22.7
	-	-	-	-
	202	124	326	18.6
	541	613	1,153	65.8
	-	-	-	-
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-5	-5	-0.3
	0	-	0	0.0
	1	-	1	0.0
	597	1,157	1,754	100.0

Temperatures °F	
Supply	55.0
Return	77.1
Mixed Air	86.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	84
Ventilation	37
Infiltration	2
Min Stop / Reheat	84

Engineering Checks	
% OA	44.34
cfm/ft²	.38
Btu/h-ft²	12.84
cfm/ton	352.74
ft²/ton	935.02
People	2
ft²/person	129.32

Areas ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

Group_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent			
	Instant	Delay	Latent	Total	Total	Btu/h
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	per
	(Btu/h)	(Btu/h)				ft²
Roof	0	368	0	368	6.5	2.5
Other Roof	0	0	0	0	0.0	0.0
Glass	158	74	0	232	4.1	14.9
Door	0	0	0	0	0.0	0.0
Wall	0	297	0	297	5.3	1.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-149	0	-149	-2.6	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-42	0	-42	-0.7	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	166	0	-71	95	1.7	0.3
Envelope Subtotal	324	548	-71	802	14.2	-
People	553	794	1,106	2,452	43.4	8.9
Lights	166	262	0	427	7.6	2.2
RA Sensible (Lights)	76	0	0	76	1.3	0.0
Miscellaneous Loads	283	192	0	475	8.4	1.7
Internal Subtotal	1,077	1,247	1,106	3,430	60.7	-
Ventilation	2,258	0	-976	1,282	22.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	46	0	46	0.8	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	88	0	-	88	1.6	-
Time Delay Correction	0	-22	-	-22	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	15	0	12	26	0.5	-
Grand Total	3,761	1,819	70	5,651	100.0	

Fan Peak						
Peak Time (Mo/D/H:M): 7/21/16:00						
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0						
	Time		Percent			
	Instant	Delay	Total	of	Related	
	Sensible	Sensible	Sensible	Total	Area	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)	
	0	358	358	11.3	146	
	0	0	0	0.0	146	
	142	71	213	6.7	16	
	0	0	0	0.0	0	
	0	321	321	10.2	295	
	0	0	0	0.0	0	
	0	0	0	0.0	295	
	0	-145	-145	-4.6	570	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	0	-43	-43	-1.4	294	
	0	0	0	0.0	0	
	153	0	153	4.9	295	
	295	562	857	27.1	-	
	553	808	1,360	43.1	276	
	166	262	427	13.5	276	
	-	-	-	-	-	
	283	192	475	15.0	276	
	1,001	1,261	2,262	71.6	-	
	-	-	-	-	-	
	0	62	62	1.9	149	
			0	0.0	276	
			0	0.0	276	
			0	0.0	0	
	0	0	0	0.0	0	
	-	-	-	-	-	
	0	-21	-21	-0.7	-	
	0	-	0	0.0	-	
	-1	-	-1	0.0	-	
	1,296	1,864	3,159	100.0		

Temperatures °F	
Supply	55.0
Return	76.2
Mixed Air	89.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	152
Ventilation	91
Infiltration	7
Min Stop / Reheat	152

Engineering Checks	
% OA	59.96
cfm/ft²	.55
Btu/h-ft²	20.46
cfm/ton	323.12
ft²/ton	587.01
People	6
ft²/person	49.99

Areas ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Intake-HR-A_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 9/21/14:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent			
	Instant	Delay	Latent	Total	of	Btu/h
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	849	0	849	9.9	1.9
Other Roof	0	0	0	0	0.0	0.0
Glass	954	907	0	1,861	21.7	72.6
Door	0	0	0	0	0.0	0.0
Wall	0	781	0	781	9.1	1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-252	0	-252	-2.9	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-211	0	-211	-2.5	-0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	96	0	-43	53	0.6	0.1
Envelope Subtotal	1,050	2,075	-43	3,082	35.9	-
People	404	578	720	1,701	19.8	3.6
Lights	364	566	0	930	10.8	2.9
RA Sensible (Lights)	325	0	0	325	3.8	0.0
Miscellaneous Loads	362	241	0	603	7.0	1.3
Internal Subtotal	1,455	1,385	720	3,560	41.4	-
Ventilation	1,685	0	-763	922	10.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-19	0	-19	-0.2	-0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	179	0	-	179	2.1	-
Time Delay Correction	0	-60	-	-60	-0.7	-
Sizing Factor Correction	830	-	-	830	9.7	-
Over/Undersizing	73	0	25	99	1.1	-
Grand Total	5,273	3,381	-62	8,592	100.0	-

Fan Peak						
Peak Time (Mo/D/H:M): 9/21/13:00						
Outside Air (DB/WB/HR): 96.8 / 63.7 / 0.0						
	Time		Percent			
	Instant	Delay	Total	of	Related	
	Sensible	Sensible	Sensible	Total	Area	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)	
Roof	0	670	670	10.4	438	
Other Roof	0	0	0	0.0	438	
Glass	1,319	1,042	2,362	36.5	26	
Door	0	0	0	0.0	0	
Wall	0	648	648	10.0	449	
Below-Grade Wall	0	0	0	0.0	0	
Other Wall	0	0	0	0.0	449	
Partition	0	-437	-437	-6.8	1,787	
Exterior Floor	0	0	0	0.0	0	
Interior Floor	0	0	0	0.0	0	
Slab	0	-82	-82	-1.3	516	
Other Floor	0	0	0	0.0	0	
Infiltration	90	0	90	1.4	449	
Envelope Subtotal	1,409	1,841	3,250	50.3	-	
People	404	574	978	15.1	471	
Lights	364	562	927	14.3	471	
RA Sensible (Lights)	-	-	-	-	-	
Miscellaneous Loads	362	240	602	9.3	471	
Internal Subtotal	1,130	1,376	2,506	38.8	-	
Ventilation	-	-	-	-	-	
DOAS Direct to Zone	0	-37	-37	-0.6	78	
Ceiling			0	0.0	471	
Refrigeration			0	0.0	471	
Service Water			0	0.0	0	
HVAC Equipment Losses	0	0	0	0.0	0	
Adj Air Transfer Heat	-	-	-	-	-	
Supply Fan Heat	0	-96	-96	-1.5	-	
Time Delay Correction	839	-	839	13.0	-	
Sizing Factor Correction	2	-	2	0.0	-	
Over/Undersizing	3,381	3,084	6,465	100.0	-	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	81.2
Fan Heat TD	0.6

Airflows cfm	
Main Fan	311
Ventilation	69
Infiltration	4
Min Stop / Reheat	311

Engineering Checks	
% OA	25.60
cfm/ft²	.58
Btu/h-ft²	18.27
cfm/ton	378.52
ft²/ton	657.14
People	4
ft²/person	118.82

Areas ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	26
Door	0
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Interior Floor	0
Slab	516
Other Floor	0

Intake-HR-B_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	437	0	437	20.0	2.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	43	0	43	2.0	1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	30	0	30	1.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-10	0	-10	-0.5	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	48	0	-14	34	1.6	1.3
Envelope Subtotal	48	499	-14	533	24.5	-
People	130	183	248	562	25.8	3.4
Lights	112	177	0	289	13.3	2.5
RA Sensible (Lights)	78	0	0	78	3.6	0.0
Miscellaneous Loads	139	87	0	226	10.4	1.4
Internal Subtotal	459	447	248	1,155	53.0	-
Ventilation	648	0	-194	455	20.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	38	0	-	38	1.7	-
Time Delay Correction	0	-4	-	-4	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	2	0	1	3	0.1	-
Grand Total	1,196	942	42	2,180	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/16:00					
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	
	(Btu/h)	(Btu/h)	(Btu/h)		
Roof	0	426	426	31.0	183
Other Roof	0	0	0	0.0	183
Glass	0	0	0	0.0	0
Door	0	0	0	0.0	0
Wall	0	40	40	2.9	27
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	27
Partition	0	47	47	3.4	894
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	-9	-9	-0.6	183
Other Floor	0	0	0	0.0	0
Infiltration	45	0	45	3.3	27
	45	504	549	39.9	-
People	130	183	313	22.8	165
Lights	112	177	289	21.1	165
RA Sensible (Lights)	-	-	-	-	-
Miscellaneous Loads	139	87	226	16.5	165
	382	447	829	60.3	-
Ventilation	-	-	-	-	-
DOAS Direct to Zone			0	0.0	0
Ceiling	0	0	0	0.0	0
Refrigeration			0	0.0	165
Service Water			0	0.0	165
HVAC Equipment Losses			0	0.0	0
Adj Air Transfer Heat	0	0	0	0.0	0
Supply Fan Heat	-	-	-	-	-
Time Delay Correction	0	-4	-4	-0.3	-
Sizing Factor Correction	0	-	0	0.0	-
Over/Undersizing	0	-	0	0.0	-
Grand Total	427	947	1,374	100.0	

Temperatures °F	
Supply	55.0
Return	76.9
Mixed Air	85.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	66
Ventilation	26
Infiltration	2
Min Stop / Reheat	66

Engineering Checks	
% OA	39.65
cfm/ft²	.40
Btu/h-ft²	13.25
cfm/ton	363.99
ft²/ton	906.08
People	1
ft²/person	132.76

Areas ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

RB-S-Corner-N_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	105	124	0	229	8.9	22.6
Door	0	0	0	0	0.0	0.0
Wall	0	447	0	447	17.4	1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-120	0	-120	-4.7	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-88	0	-88	-3.4	-0.6
Other Floor	0	0	0	0	0.0	0.0
Infiltration	77	0	-23	54	2.1	0.2
Envelope Subtotal	183	362	-23	522	20.3	-
People	149	212	355	716	27.9	5.6
Lights	74	143	0	217	8.4	2.3
RA Sensible (Lights)	72	0	0	72	2.8	0.0
Miscellaneous Loads	352	441	0	793	30.9	6.2
Internal Subtotal	647	796	355	1,798	70.0	-
Ventilation	345	0	-219	126	4.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-38	0	-38	-1.5	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	54	0	-	54	2.1	-
Time Delay Correction	0	-12	-	-12	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	91	0	26	118	4.6	-
Grand Total	1,320	1,108	139	2,567	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 9/21/15:00					
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	of	
	Sensible	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	97	111	207	10.6	10
	0	0	0	0.0	0
	0	598	598	30.6	286
	0	0	0	0.0	0
	0	0	0	0.0	286
	0	-109	-109	-5.6	286
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-84	-84	-4.3	141
	0	0	0	0.0	0
	76	0	76	3.9	286
	173	516	689	35.2	-
	149	212	361	18.5	129
	74	143	217	11.1	129
	-	-	-	-	-
	352	441	793	40.5	129
	575	796	1,371	70.1	-
	-	-	-	-	-
	0	-91	-91	-4.7	141
			0	0.0	129
			0	0.0	129
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-12	-12	-0.6	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	748	1,209	1,957	100.0	

Temperatures °F	
Supply	55.0
Return	75.9
Mixed Air	79.3
Fan Heat TD	0.6

Airflows cfm	
Main Fan	94
Ventilation	14
Infiltration	3
Min Stop / Reheat	94

Engineering Checks	
% OA	15.08
cfm/ft²	.73
Btu/h-ft²	19.91
cfm/ton	440.19
ft²/ton	603.17
People	1
ft²/person	100.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ACT-Noisy-1_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,730	1,371	0	3,101	58.5	84.9
Door	0	0	0	0	0.0	0.0
Wall	0	366	0	366	6.9	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-648	0	-648	-12.2	-1.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	193	0	193	3.6	1.0
Other Floor	0	0	0	0	0.0	0.0
Infiltration	89	0	-32	57	1.1	0.3
Envelope Subtotal	1,819	1,281	-32	3,069	57.9	-
People	377	635	719	1,731	32.7	9.6
Lights	121	227	0	348	6.6	2.7
RA Sensible (Lights)	112	0	0	112	2.1	0.0
Miscellaneous Loads	184	149	0	333	6.3	1.9
Internal Subtotal	794	1,012	719	2,525	47.6	-
Ventilation	745	0	-488	258	4.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-557	0	-557	-10.5	-2.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	114	0	-	114	2.2	-
Time Delay Correction	0	-133	-	-133	-2.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	20	0	6	25	0.5	-
Grand Total	3,493	1,603	205	5,301	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 8/21/17:00				
Outside Air (DB/WB/HR): 94.0 / 63.5 / 0.0				
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	1,719	1,405	3,124	75.7
	0	0	0	0.0
	0	373	373	9.0
	0	0	0	0.0
	0	0	0	0.0
	0	-641	-641	-15.5
	0	0	0	0.0
	0	0	0	0.0
	0	196	196	4.7
	0	0	0	0.0
	87	0	87	2.1
	1,806	1,332	3,138	76.1
	377	635	1,013	24.6
	121	227	348	8.4
	-	-	-	-
	184	149	333	8.1
	682	1,012	1,694	41.1
	-	-	-	-
	0	-577	-577	-14.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-130	-130	-3.1
	0	-	0	0.0
	-1	-	-1	0.0
	2,487	1,638	4,124	100.0

Temperatures °F	
Supply	55.0
Return	75.7
Mixed Air	79.1
Fan Heat TD	0.6

Airflows cfm	
Main Fan	199
Ventilation	38
Infiltration	4
Min Stop / Reheat	199

Engineering Checks	
% OA	19.00
cfm/ft²	1.11
Btu/h-ft²	29.53
cfm/ton	449.67
ft²/ton	406.70
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	37
Door	0
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ACT-Noisy-2 _PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	404	146	0	550	15.7	26.2
Door	0	0	0	0	0.0	0.0
Wall	0	66	0	66	1.9	0.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-206	0	-206	-5.9	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-61	0	-61	-1.7	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	108	0	-52	57	1.6	0.6
Envelope Subtotal	512	-55	-52	406	11.6	-
People	380	626	723	1,730	49.5	9.6
Lights	122	225	0	346	9.9	2.7
RA Sensible (Lights)	86	0	0	86	2.5	0.0
Miscellaneous Loads	185	147	0	333	9.5	1.8
Internal Subtotal	773	999	723	2,495	71.4	-
Ventilation	941	0	-452	488	14.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-58	0	-58	-1.7	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	59	0	-	59	1.7	-
Time Delay Correction	0	-25	-	-25	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	78	0	49	127	3.6	-
Grand Total	2,363	861	268	3,492	100.0	

Fan Peak						
Peak Time (Mo/D/H:M): 7/21/18:00						
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Total	Total	Related	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	Area	
					(ft²)	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	401	187	589	27.5	21	
	0	0	0	0.0	0	
	0	70	70	3.3	92	
	0	0	0	0.0	0	
	0	0	0	0.0	92	
	0	-190	-190	-8.9	578	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	0	-31	-31	-1.5	195	
	0	0	0	0.0	0	
	76	0	76	3.5	92	
	477	36	513	24.0	-	
	380	626	1,006	47.1	181	
	122	225	346	16.2	181	
	-	-	-	-	-	
	185	147	333	15.6	181	
	687	999	1,685	78.8	-	
	-	-	-	-	-	
	0	-35	-35	-1.7	195	
			0	0.0	181	
			0	0.0	0	
	0	0	0	0.0	0	
	-	-	-	-	-	
	0	-25	-25	-1.2	-	
	0	-	0	0.0	-	
	0	-	0	0.0	-	
	1,163	974	2,138	100.0		

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	84.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	103
Ventilation	38
Infiltration	4
Min Stop / Reheat	103

Engineering Checks	
% OA	36.92
cfm/ft²	.57
Btu/h-ft²	19.32
cfm/ton	353.60
ft²/ton	621.49
People	4
ft²/person	49.96

Areas ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	21
Door	0
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ACT-Noisy-3_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	487	190	0	677	19.1	23.6
Door	0	0	0	0	0.0	0.0
Wall	0	136	0	136	3.8	0.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-267	0	-267	-7.5	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-72	0	-72	-2.0	-0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	109	0	-50	59	1.7	0.4
Envelope Subtotal	597	-12	-50	534	15.0	-
People	382	599	729	1,710	48.1	9.4
Lights	122	215	0	337	9.5	2.6
RA Sensible (Lights)	90	0	0	90	2.5	0.0
Miscellaneous Loads	186	141	0	327	9.2	1.8
Internal Subtotal	781	955	729	2,464	69.4	-
Ventilation	947	0	-438	509	14.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	15	0	15	0.4	0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	61	0	-	61	1.7	-
Time Delay Correction	0	-31	-	-31	-0.9	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	2,386	927	240	3,553	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/15:00					
Outside Air (DB/WB/HR): 98.8 / 66.7 / 0.0					
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	of	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	487	190	677	30.6	29
	0	0	0	0.0	0
	0	136	136	6.1	161
	0	0	0	0.0	0
	0	0	0	0.0	161
	0	-267	-267	-12.0	511
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-72	-72	-3.2	196
	0	0	0	0.0	0
	109	0	109	4.9	161
	597	-12	585	26.4	-
	382	599	982	44.3	182
	122	215	337	15.2	182
	-	-	-	-	-
	186	141	327	14.8	182
	691	955	1,646	74.3	-
	-	-	-	-	-
	0	15	15	0.7	196
			0	0.0	182
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-31	-31	-1.4	-
	0	-	0	0.0	-
	-1	-	-1	0.0	-
	1,287	927	2,214	100.0	

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	84.3
Fan Heat TD	0.6

Airflows cfm	
Main Fan	107
Ventilation	38
Infiltration	4
Min Stop / Reheat	107

Engineering Checks	
% OA	35.89
cfm/ft²	.59
Btu/h-ft²	19.52
cfm/ton	360.04
ft²/ton	615.19
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	29
Door	0
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ACT-Quiet-2_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)			(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	97	53	0	151	6.1	19.4
Door	0	0	0	0	0.0	0.0
Wall	0	67	0	67	2.7	1.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-25	0	-25	-1.0	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-46	0	-46	-1.9	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	78	0	-28	50	2.0	1.0
Envelope Subtotal	176	49	-28	196	8.0	-
People	274	471	523	1,268	51.6	9.7
Lights	88	170	0	258	10.5	2.7
RA Sensible (Lights)	64	0	0	64	2.6	0.0
Miscellaneous Loads	134	111	0	245	10.0	1.9
Internal Subtotal	560	752	523	1,835	74.7	-
Ventilation	667	0	-469	199	8.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-12	0	-12	-0.5	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	44	0	-	44	1.8	-
Time Delay Correction	0	-11	-	-11	-0.4	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	136	0	70	206	8.4	-
Grand Total	1,584	778	95	2,457	100.0	

Fan Peak						
Peak Time (Mo/D/H:M): 9/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Related	
	Instant	Delay	Total	of	Area	
	Sensible	Sensible	Sensible	Total	(ft²)	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)		
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	167	139	307	19.3	8	
	0	0	0	0.0	0	
	0	104	104	6.6	48	
	0	0	0	0.0	0	
	0	0	0	0.0	48	
	0	-21	-21	-1.3	528	
	0	0	0	0.0	0	
	0	0	0	0.0	0	
	0	-51	-51	-3.2	142	
	0	0	0	0.0	0	
	77	0	77	4.9	48	
	244	172	416	26.2	-	
	274	471	746	47.0	131	
	88	170	258	16.2	131	
	-	-	-	-	-	
	134	111	245	15.4	131	
	496	752	1,248	78.7	-	
	-	-	-	-	-	
	0	-63	-63	-4.0	142	
			0	0.0	131	
			0	0.0	0	
	0	0	0	0.0	0	
	-	-	-	-	-	
	0	-13	-13	-0.8	-	
	0	-	0	0.0	-	
	0	-	0	0.0	-	
	740	847	1,586	100.0		

Temperatures °F	
Supply	55.0
Return	76.3
Mixed Air	84.2
Fan Heat TD	0.6

Airflows cfm	
Main Fan	76
Ventilation	27
Infiltration	3
Min Stop / Reheat	76

Engineering Checks	
% OA	35.89
cfm/ft²	.59
Btu/h-ft²	18.82
cfm/ton	373.36
ft²/ton	638.01
People	3
ft²/person	50.05

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-3_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/16:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	272	0	272	11.0	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-89	0	-89	-3.6	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-40	0	-40	-1.6	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	73	0	-39	34	1.4	0.3
Envelope Subtotal	73	143	-39	177	7.1	-
People	275	469	524	1,269	51.0	9.7
Lights	88	169	0	257	10.4	2.7
RA Sensible (Lights)	61	0	0	61	2.5	0.0
Miscellaneous Loads	134	110	0	245	9.8	1.9
Internal Subtotal	559	748	524	1,832	73.7	-
Ventilation	629	0	-340	289	11.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-17	0	-17	-0.7	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	43	0	-	43	1.7	-
Time Delay Correction	0	-5	-	-5	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	103	0	63	167	6.7	-
Grand Total	1,407	870	209	2,486	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/19:00		
Outside Air (DB/WB/HR):		86.7 / 62.9 / 0.0		
	Time	Percent		Related Area
	Instant	Delay		
	Sensible	Sensible	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	396	396	25.7
	0	0	0	0.0
	0	0	0	0.0
	0	-96	-96	-6.2
	0	0	0	0.0
	0	-38	-38	-2.4
	0	0	0	0.0
	40	0	40	2.6
	40	263	303	19.6
	275	469	744	48.2
	88	169	257	16.7
	-	-	-	-
	134	110	245	15.8
	498	748	1,246	80.7
	-	-	-	-
	0	2	2	0.1
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-6	-6	-0.4
	0	-	0	0.0
	0	-	0	0.0
	537	1,007	1,544	100.0

Temperatures °F	
Supply	55.0
Return	76.4
Mixed Air	84.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	74
Ventilation	28
Infiltration	3
Min Stop / Reheat	74

Engineering Checks	
% OA	37.04
cfm/ft²	.57
Btu/h-ft²	18.98
cfm/ton	358.80
ft²/ton	632.81
People	3
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Corridor-W_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	2,095	1,861	0	3,956	81.9	61.1
Door	0	0	0	0	0.0	0.0
Wall	0	101	0	101	2.1	1.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-382	0	-382	-7.9	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	426	0	426	8.8	1.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	86	0	-2	85	1.7	0.8
Envelope Subtotal	2,181	2,007	-02	4,186	86.6	-
People	0	0	0	0	0.0	0.0
Lights	197	356	0	553	11.4	2.4
RA Sensible (Lights)	204	0	0	204	4.2	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	401	356	0	757	15.7	-
Ventilation	393	0	-8	385	8.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-512	0	-512	-10.6	-1.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	115	0	-	115	2.4	-
Time Delay Correction	0	-98	-	-98	-2.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	3,090	1,752	-9	4,833	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	2,095	1,861	3,956	95.8
	0	0	0	0.0
	0	101	101	2.5
	0	0	0	0.0
	0	0	0	0.0
	0	-382	-382	-9.2
	0	0	0	0.0
	0	0	0	0.0
	0	426	426	10.3
	0	0	0	0.0
	86	0	86	2.1
	2,181	2,007	4,188	101.4
	0	0	0	0.0
	197	356	553	13.4
	-	-	-	-
	0	0	0	0.0
	197	356	553	13.4
	-	-	-	-
	0	-512	-512	-12.4
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-98	-98	-2.4
	0	-	0	0.0
	0	-	0	0.0
	2,378	1,752	4,130	100.0

Temperatures °F	
Supply	55.0
Return	76.1
Mixed Air	77.9
Fan Heat TD	0.6

Airflows cfm	
Main Fan	199
Ventilation	19
Infiltration	4
Min Stop / Reheat	199

Engineering Checks	
% OA	9.77
cfm/ft²	.61
Btu/h-ft²	14.93
cfm/ton	494.15
ft²/ton	804.44
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

RB-W-North_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/18:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	194	110	0	304	11.7	17.1
Door	0	0	0	0	0.0	0.0
Wall	0	593	0	593	22.8	2.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-134	0	-134	-5.2	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-32	0	-32	-1.2	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	54	0	-33	21	0.8	0.1
Envelope Subtotal	248	537	-33	752	28.9	-
People	150	234	357	740	28.5	5.7
Lights	74	141	0	216	8.3	2.3
RA Sensible (Lights)	74	0	0	74	2.9	0.0
Miscellaneous Loads	354	436	0	790	30.4	6.1
Internal Subtotal	653	811	357	1,821	70.0	-
Ventilation	243	0	-149	94	3.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-113	0	-113	-4.3	-0.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	65	0	-	65	2.5	-
Time Delay Correction	0	-19	-	-19	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	1,210	1,217	175	2,602	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/18:00	
Outside Air (DB/WB/HR):			91.4 / 64.4 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
194	110	304	14.9	18
0	0	0	0.0	0
0	593	593	29.0	288
0	0	0	0.0	0
0	0	0	0.0	288
0	-134	-134	-6.6	288
0	0	0	0.0	0
0	0	0	0.0	0
0	-32	-32	-1.5	142
0	0	0	0.0	0
54	0	54	2.7	288
248	537	785	38.4	-
150	234	384	18.8	130
74	141	216	10.5	130
-	-	-	-	-
354	436	790	38.7	130
578	811	1,389	68.0	-
-	-	-	-	-
		0	0.0	0
0	-113	-113	-5.5	142
		0	0.0	130
		0	0.0	130
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-19	-19	-0.9	-
0	-	0	0.0	-
1	-	1	0.0	-
827	1,217	2,044	100.0	

Temperatures °F	
Supply	57.6
Return	75.7
Mixed Air	77.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	113
Ventilation	14
Infiltration	3
Min Stop / Reheat	113

Engineering Checks	
% OA	12.63
cfm/ft²	.87
Btu/h-ft²	20.06
cfm/ton	521.34
ft²/ton	598.53
People	1
ft²/person	99.82

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-W-South_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,317	1,226	0	2,542	29.6	47.7
Door	0	0	0	0	0.0	0.0
Wall	0	1,033	0	1,033	12.0	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-379	0	-379	-4.4	-0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-172	0	-172	-2.0	-0.4
Other Floor	0	0	0	0	0.0	0.0
Infiltration	224	0	-103	120	1.4	0.2
Envelope Subtotal	1,540	1,708	-103	3,145	36.6	-
People	438	590	1,044	2,072	24.1	5.5
Lights	217	400	0	617	7.2	2.3
RA Sensible (Lights)	217	0	0	217	2.5	0.0
Miscellaneous Loads	1,036	1,234	0	2,270	26.4	6.0
Internal Subtotal	1,908	2,225	1,044	5,176	60.3	-
Ventilation	1,014	0	-472	542	6.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-498	0	-498	-5.8	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	185	0	-	185	2.2	-
Time Delay Correction	0	-82	-	-82	-1.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	92	0	26	119	1.4	-
Grand Total	4,740	3,353	494	8,587	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/14:00		
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0		
	Time		Percent	
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	1,342	1,666	3,008	45.1
	0	0	0	0.0
	0	1,017	1,017	15.2
	0	0	0	0.0
	0	0	0	0.0
	0	-418	-418	-6.3
	0	0	0	0.0
	0	0	0	0.0
	0	-203	-203	-3.0
	0	0	0	0.0
	143	0	143	2.1
	1,486	2,062	3,548	53.1
	438	590	1,029	15.4
	217	400	617	9.2
	-	-	-	-
	1,036	1,234	2,270	34.0
	1,691	2,225	3,916	58.7
	-	-	-	-
	0	-705	-705	-10.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-84	-84	-1.3
	0	-	0	0.0
	2	-	2	0.0
	3,179	3,497	6,676	100.0

Temperatures °F	
Supply	55.0
Return	75.7
Mixed Air	78.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	322
Ventilation	42
Infiltration	9
Min Stop / Reheat	322

Engineering Checks	
% OA	12.98
cfm/ft²	.85
Btu/h-ft²	22.64
cfm/ton	449.55
ft²/ton	530.34
People	4
ft²/person	99.87

Areas ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

Corridor-N_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	737	333	0	1,070	32.1	16.5
Door	0	0	0	0	0.0	0.0
Wall	0	40	0	40	1.2	0.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	328	0	328	9.9	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-38	0	-38	-1.1	-0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	132	0	-2	130	3.9	1.3
Envelope Subtotal	869	663	-02	1,531	46.0	-
People	0	0	0	0	0.0	0.0
Lights	249	424	0	673	20.2	2.3
RA Sensible (Lights)	222	0	0	222	6.7	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	471	424	0	895	26.9	-
Ventilation	606	0	-8	599	18.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	103	0	103	3.1	0.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	67	0	-	67	2.0	-
Time Delay Correction	0	-17	-	-17	-0.5	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	110	0	42	151	4.5	-
Grand Total	2,123	1,174	32	3,329	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/18:00			
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0			
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0.0	0
Other Roof	0	0	0	0.0	0
Glass	734	383	1,117	46.5	65
Door	0	0	0	0.0	0
Wall	0	42	42	1.8	100
Below-Grade Wall	0	0	0	0.0	0
Other Wall	0	0	0	0.0	100
Partition	0	313	313	13.1	1,360
Exterior Floor	0	0	0	0.0	0
Interior Floor	0	0	0	0.0	0
Slab	0	11	11	0.4	439
Other Floor	0	0	0	0.0	0
Infiltration	92	0	92	3.8	100
	826	750	1,576	65.6	-
	0	0	0	0.0	409
	249	424	673	28.0	409
	-	-	-	-	-
	0	0	0	0.0	409
	249	424	673	28.0	-
	-	-	-	-	-
	0	169	169	7.0	439
			0	0.0	409
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-17	-17	-0.7	-
	0	-	0	0.0	-
	0	-	0	0.0	-
	1,075	1,327	2,402	100.0	

Temperatures °F	
Supply	55.0
Return	77.5
Mixed Air	82.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	116
Ventilation	25
Infiltration	5
Min Stop / Reheat	116

Engineering Checks	
% OA	21.21
cfm/ft²	.28
Btu/h-ft²	8.14
cfm/ton	417.11
ft²/ton	1,474.36
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

RB-N-Corner_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/17:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time	Percent				
	Instant	Delay	of			Btu/h
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	321	305	0	627	21.8	62.0
Door	0	0	0	0	0.0	0.0
Wall	0	467	0	467	16.3	1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-156	0	-156	-5.4	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	19	0	19	0.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	64	0	-33	31	1.1	0.1
Envelope Subtotal	386	635	-33	988	34.4	-
People	151	228	359	737	25.7	5.7
Lights	74	142	0	217	7.6	2.3
RA Sensible (Lights)	76	0	0	76	2.7	0.0
Miscellaneous Loads	356	439	0	795	27.7	6.1
Internal Subtotal	657	809	359	1,825	63.6	-
Ventilation	291	0	-153	138	4.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-162	0	-162	-5.7	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	74	0	-	74	2.6	-
Time Delay Correction	0	-21	-	-21	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	21	0	6	27	0.9	-
Grand Total	1,429	1,261	179	2,868	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	272	320	592	26.3
	0	0	0	0.0
	0	524	524	23.3
	0	0	0	0.0
	0	0	0	0.0
	0	-146	-146	-6.5
	0	0	0	0.0
	0	0	0	0.0
	0	-19	-19	-0.9
	0	0	0	0.0
	55	0	55	2.4
	326	679	1,005	44.7
	151	236	386	17.2
	74	142	217	9.6
	-	-	-	-
	356	439	795	35.3
	581	817	1,398	62.2
	-	-	-	-
	0	-137	-137	-6.1
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-19	-19	-0.8
	0	-	0	0.0
	1	-	1	0.0
	909	1,340	2,248	100.0

Temperatures °F	
Supply	58.2
Return	75.6
Mixed Air	77.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	128
Ventilation	14
Infiltration	3
Min Stop / Reheat	128

Engineering Checks	
% OA	11.16
cfm/ft²	.99
Btu/h-ft²	22.01
cfm/ton	537.66
ft²/ton	545.61
People	1
ft²/person	100.31

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-N-East_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/11:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	4	0	4	0.1	1.5
Other Roof	0	0	0	0	0.0	0.0
Glass	386	453	0	838	17.3	41.5
Door	0	0	0	0	0.0	0.0
Wall	0	710	0	710	14.6	1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-178	0	-178	-3.7	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-144	0	-144	-3.0	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	109	0	-65	44	0.9	0.1
Envelope Subtotal	495	845	-65	1,275	26.3	-
People	297	337	707	1,340	27.6	5.2
Lights	147	246	0	392	8.1	2.2
RA Sensible (Lights)	145	0	0	145	3.0	0.0
Miscellaneous Loads	702	756	0	1,458	30.0	5.7
Internal Subtotal	1,290	1,338	707	3,335	68.7	-
Ventilation	491	0	-293	198	4.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-102	0	-102	-2.1	-0.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	117	0	-	117	2.4	-
Time Delay Correction	0	-28	-	-28	-0.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	45	0	13	59	1.2	-
Grand Total	2,438	2,054	362	4,854	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/10:00				
Outside Air (DB/WB/HR): 87.0 / 63.0 / 0.0				
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	3	3	0.1
	0	0	0	0.0
	484	566	1,050	28.1
	0	0	0	0.0
	0	610	610	16.3
	0	0	0	0.0
	0	0	0	0.0
	0	-198	-198	-5.3
	0	0	0	0.0
	0	0	0	0.0
	0	-55	-55	-1.5
	0	0	0	0.0
	80	0	80	2.1
	564	925	1,489	39.8
	297	312	609	16.3
	147	235	382	10.2
	-	-	-	-
	702	724	1,426	38.1
	1,145	1,272	2,417	64.6
	-	-	-	-
	0	-136	-136	-3.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-32	-32	-0.9
	0	-	0	0.0
	2		2	0.0
	1,711	2,029	3,740	100.0

Temperatures °F	
Supply	57.2
Return	75.8
Mixed Air	78.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	202
Ventilation	28
Infiltration	6
Min Stop / Reheat	202

Engineering Checks	
% OA	13.98
cfm/ft²	.79
Btu/h-ft²	18.90
cfm/ton	500.16
ft²/ton	635.43
People	3
ft²/person	100.01

Areas ft²	
Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

RB-N-West_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	949	936	0	1,885	23.5	62.2
Door	0	0	0	0	0.0	0.0
Wall	0	944	0	944	11.8	2.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-532	0	-532	-6.6	-0.4
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	43	0	43	0.5	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	189	0	-97	92	1.2	0.2
Envelope Subtotal	1,138	1,390	-97	2,432	30.3	-
People	442	673	1,052	2,167	27.0	5.7
Lights	218	420	0	639	8.0	2.3
RA Sensible (Lights)	221	0	0	221	2.8	0.0
Miscellaneous Loads	1,044	1,295	0	2,339	29.1	6.1
Internal Subtotal	1,925	2,388	1,052	5,366	66.8	-
Ventilation	853	0	-443	410	5.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-372	0	-372	-4.6	-0.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	200	0	-	200	2.5	-
Time Delay Correction	0	-64	-	-64	-0.8	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	43	0	13	56	0.7	-
Grand Total	4,160	3,343	525	8,027	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	802	976	1,779	28.6	30
	0	0	0	0.0	0
	0	1,079	1,079	17.3	374
	0	0	0	0.0	0
	0	0	0	0.0	374
	0	-478	-478	-7.7	1,338
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-67	-67	-1.1	417
	0	0	0	0.0	0
	160	0	160	2.6	374
	962	1,510	2,472	39.7	-
	442	696	1,138	18.3	383
	218	420	639	10.3	383
	-	-	-	-	-
	1,044	1,295	2,339	37.6	383
	1,704	2,411	4,115	66.1	-
	-	-	-	-	-
	0	-307	-307	-4.9	417
			0	0.0	383
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-56	-56	-0.9	-
	0	-	0	0.0	-
	3	-	3	0.0	-
	2,670	3,559	6,228	100.0	

Temperatures °F	
Supply	57.8
Return	75.7
Mixed Air	78.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	348
Ventilation	42
Infiltration	9
Min Stop / Reheat	348

Engineering Checks	
% OA	12.11
cfm/ft²	.91
Btu/h-ft²	21.00
cfm/ton	519.62
ft²/ton	571.81
People	4
ft²/person	99.88

Areas ft²	
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

Corridor-S_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		9/21/14:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	of	
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	1,667	1,435	0	3,102	62.4	47.9
Door	0	0	0	0	0.0	0.0
Wall	0	107	0	107	2.1	1.1
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1	0	-1	0.0	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-73	0	-73	-1.5	-0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	131	0	33	165	3.3	1.6
Envelope Subtotal	1,799	1,467	33	3,299	66.4	-
People	0	0	0	0	0.0	0.0
Lights	252	426	0	677	13.6	2.3
RA Sensible (Lights)	247	0	0	247	5.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	499	426	0	925	18.6	-
Ventilation	600	0	154	754	15.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-305	0	-305	-6.1	-0.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	105	0	-	105	2.1	-
Time Delay Correction	0	-64	-	-64	-1.3	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	197	0	60	258	5.2	-
Grand Total	3,200	1,523	248	4,971	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/13:00		
Outside Air (DB/WB/HR):		88.4 / 57.7 / 0.0		
	Time		Percent	
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	1,829	1,963	3,792	100.6
	0	0	0	0.0
	0	100	100	2.7
	0	0	0	0.0
	0	0	0	0.0
	0	-217	-217	-5.8
	0	0	0	0.0
	0	0	0	0.0
	0	58	58	1.5
	0	0	0	0.0
	77	0	77	2.0
	1,906	1,904	3,809	101.0
	0	0	0	0.0
	252	412	664	17.6
	-	-	-	-
	0	0	0	0.0
	252	412	664	17.6
	-	-	-	-
	0	-624	-624	-16.6
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-79	-79	-2.1
	0	-	0	0.0
	0	-	0	0.0
	2,158	1,613	3,771	100.0

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	79.6
Fan Heat TD	0.6

Airflows cfm	
Main Fan	183
Ventilation	25
Infiltration	6
Min Stop / Reheat	183

Engineering Checks	
% OA	13.59
cfm/ft²	.44
Btu/h-ft²	12.02
cfm/ton	441.08
ft²/ton	999.17
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

RB-S-Corner-S_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/17:00				
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	321	304	0	626	21.0	61.9
Door	0	0	0	0	0.0	0.0
Wall	0	551	0	551	18.5	1.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-159	0	-159	-5.3	-0.6
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	21	0	21	0.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	65	0	-22	43	1.4	0.1
Envelope Subtotal	386	717	-22	1,082	36.3	-
People	152	228	361	741	24.9	5.6
Lights	75	143	0	218	7.3	2.3
RA Sensible (Lights)	75	0	0	75	2.5	0.0
Miscellaneous Loads	358	440	0	798	26.8	6.1
Internal Subtotal	660	811	361	1,832	61.5	-
Ventilation	323	0	-215	108	3.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-173	0	-173	-5.8	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	66	0	-	66	2.2	-
Time Delay Correction	0	-22	-	-22	-0.7	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	70	0	17	88	2.9	-
Grand Total	1,506	1,333	141	2,980	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/17:00			
Outside Air (DB/WB/HR):		94.1 / 62.8 / 0.0			
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	280	292	573	24.1	10
	0	0	0	0.0	0
	0	712	712	30.0	289
	0	0	0	0.0	0
	0	0	0	0.0	289
	0	-149	-149	-6.3	289
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	1	1	0.0	143
	0	0	0	0.0	0
	64	0	64	2.7	289
	344	856	1,200	50.5	-
	152	228	380	16.0	131
	75	143	218	9.2	131
	-	-	-	-	-
	358	440	798	33.6	131
	585	811	1,396	58.8	-
	-	-	-	-	-
	0	-200	-200	-8.4	143
			0	0.0	131
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-20	-20	-0.8	-
	0	-	0	0.0	-
	-1	-	-1	-0.1	-
	927	1,448	2,375	100.0	

Temperatures	
	°F
Supply	55.0
Return	75.7
Mixed Air	78.3
Fan Heat TD	0.6

Airflows	
	cfm
Main Fan	114
Ventilation	14
Infiltration	3
Min Stop / Reheat	114

Engineering Checks	
% OA	12.63
cfm/ft²	.87
Btu/h-ft²	22.72
cfm/ton	460.54
ft²/ton	528.51
People	1
ft²/person	100.20

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

RB-S-East_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/11:00				
Outside Air (DB/WB/HR):		91.7 / 64.5 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	575	634	0	1,209	17.6	39.9
Door	0	0	0	0	0.0	0.0
Wall	0	779	0	779	11.3	2.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-229	0	-229	-3.3	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-198	0	-198	-2.9	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	158	0	-95	64	0.9	0.2
Envelope Subtotal	733	986	-95	1,624	23.7	-
People	430	497	1,023	1,949	28.4	5.2
Lights	212	363	0	575	8.4	2.2
RA Sensible (Lights)	209	0	0	209	3.0	0.0
Miscellaneous Loads	1,015	1,117	0	2,132	31.1	5.7
Internal Subtotal	1,866	1,976	1,023	4,864	70.9	-
Ventilation	710	0	-424	286	4.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-133	0	-133	-1.9	-0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	163	0	-	163	2.4	-
Time Delay Correction	0	-41	-	-41	-0.6	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	77	0	23	101	1.5	-
Grand Total	3,549	2,788	527	6,864	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/10:00			
Outside Air (DB/WB/HR):		87.0 / 63.0 / 0.0			
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	720	801	1,521	28.9	30
	0	0	0	0.0	0
	0	659	659	12.5	328
	0	0	0	0.0	0
	0	0	0	0.0	328
	0	-282	-282	-5.4	1,359
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-64	-64	-1.2	406
	0	0	0	0.0	0
	115	0	115	2.2	328
	836	1,114	1,950	37.1	-
	430	461	890	16.9	372
	212	347	560	10.6	372
	-	-	-	-	-
	1,015	1,070	2,085	39.7	372
	1,657	1,878	3,535	67.3	-
	-	-	-	-	-
	0	-184	-184	-3.5	406
			0	0.0	372
			0	0.0	372
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-47	-47	-0.9	-
	0	-	0	0.0	-
	2	-	2	0.0	-
	2,495	2,761	5,255	100.0	

Temperatures °F	
Supply	57.1
Return	75.8
Mixed Air	78.1
Fan Heat TD	0.6

Airflows cfm	
Main Fan	282
Ventilation	41
Infiltration	9
Min Stop / Reheat	282

Engineering Checks	
% OA	14.50
cfm/ft²	.76
Btu/h-ft²	18.47
cfm/ton	493.12
ft²/ton	650.10
People	4
ft²/person	99.97

Areas ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

RB-S-West_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/17:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay	Latent	Total	Total	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	ft²
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	322	310	0	633	24.4	62.6
Door	0	0	0	0	0.0	0.0
Wall	0	310	0	310	11.9	2.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-200	0	-200	-7.7	-0.5
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	16	0	16	0.6	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	61	0	-31	30	1.2	0.2
Envelope Subtotal	384	436	-31	788	30.4	-
People	143	219	341	704	27.1	5.7
Lights	71	137	0	208	8.0	2.3
RA Sensible (Lights)	72	0	0	72	2.8	0.0
Miscellaneous Loads	338	423	0	761	29.3	6.1
Internal Subtotal	624	780	341	1,745	67.2	-
Ventilation	276	0	-143	133	5.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-126	0	-126	-4.8	-0.9
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	65	0	-	65	2.5	-
Time Delay Correction	0	-22	-	-22	-0.8	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	10	0	3	13	0.5	-
Grand Total	1,359	1,068	169	2,596	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/18:00					
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0					
	Time		Percent		Related Area
	Instant	Delay	Total	Total	
	Sensible	Sensible	Sensible	(%)	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)		
	0	0	0	0.0	0
	0	0	0	0.0	0
	273	325	598	29.7	10
	0	0	0	0.0	0
	0	353	353	17.5	122
	0	0	0	0.0	0
	0	0	0	0.0	122
	0	-188	-188	-9.4	441
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-22	-22	-1.1	135
	0	0	0	0.0	0
	52	0	52	2.6	122
	325	468	793	39.4	-
	143	227	370	18.4	124
	71	137	208	10.3	124
	-	-	-	-	-
	338	423	761	37.8	124
	552	787	1,340	66.5	-
	-	-	-	-	-
	0	-100	-100	-5.0	135
			0	0.0	124
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-19	-19	-0.9	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	878	1,136	2,014	100.0	

Temperatures °F	
Supply	57.8
Return	75.7
Mixed Air	78.0
Fan Heat TD	0.6

Airflows cfm	
Main Fan	112
Ventilation	14
Infiltration	3
Min Stop / Reheat	112

Engineering Checks	
% OA	12.14
cfm/ft²	.91
Btu/h-ft²	20.96
cfm/ton	519.34
ft²/ton	572.96
People	1
ft²/person	99.98

Areas ft²	
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

ACT-Quiet-1_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 7/21/15:00						
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0						
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-83	0	-83	-3.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-39	0	-39	-1.7	-0.3
Other Floor	0	0	0	0	0.0	0.0
Infiltration	78	0	-29	49	2.2	0.0
Envelope Subtotal	78	-122	-29	-73	-3.2	-
People	274	468	521	1,263	55.9	9.7
Lights	88	169	0	256	11.3	2.7
RA Sensible (Lights)	55	0	0	55	2.4	0.0
Miscellaneous Loads	133	110	0	243	10.8	1.9
Internal Subtotal	549	746	521	1,817	80.5	-
Ventilation	677	0	-254	423	18.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	49	0	49	2.2	0.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	35	0	-	35	1.5	-
Time Delay Correction	0	-4	-	-4	-0.2	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	6	0	5	12	0.5	-
Grand Total	1,346	669	244	2,258	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 9/21/15:00					
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0					
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-47	-47	-3.7	575
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-39	-39	-3.1	142
	0	0	0	0.0	0
	77	0	77	6.2	0
	77	-85	-8	-0.7	-
	274	468	741	59.4	130
	88	169	256	20.5	130
	-	-	-	-	-
	133	110	243	19.5	130
	495	746	1,241	99.4	-
	-	-	-	-	-
	0	20	20	1.6	142
			0	0.0	130
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.3	-
	0	-	0	0.0	-
	0	-	0	0.0	-
	571	677	1,249	100.0	

Temperatures °F	
Supply	55.0
Return	76.6
Mixed Air	86.7
Fan Heat TD	0.6

Airflows cfm	
Main Fan	60
Ventilation	27
Infiltration	3
Min Stop / Reheat	60

Engineering Checks	
% OA	45.48
cfm/ft²	.46
Btu/h-ft²	17.34
cfm/ton	319.87
ft²/ton	692.58
People	3
ft²/person	49.94

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

System Cooling Checksums

Kitchen_Single Zone CV

Coil Peak						
Peak Time (Mo/D/H:M):		7/21/15:00				
Outside Air (DB/WB/HR):		96.5 / 63.6 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	1,107	0	1,107	1.3	1.5
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	950	0	950	1.1	19.4
Wall	0	785	0	785	0.9	1.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,582	0	-1,582	-1.8	-1.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	-386	0	-386	-0.4	-0.5
Other Floor	0	0	0	0	0.0	0.0
Infiltration	411	0	-83	329	0.4	0.5
Envelope Subtotal	411	875	-83	1,203	1.4	-
People	1,375	1,908	3,197	6,480	7.4	9.5
Lights	365	571	0	936	1.1	2.0
RA Sensible (Lights)	-48	0	0	-48	-0.1	0.0
Miscellaneous Loads	13,333	8,907	0	22,240	25.6	32.5
Internal Subtotal	15,025	11,385	3,197	29,608	34.0	-
Ventilation	61,788	0	-12,416	49,372	56.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	3,502	0	-	3,502	4.0	-
Time Delay Correction	0	-41	-	-41	0.0	-
Sizing Factor Correction	0	-	-	0	0.0	-
Over/Undersizing	1,012	0	2,329	3,341	3.8	-
Grand Total	81,739	12,219	-6,972	86,986	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/16:00		
Outside Air (DB/WB/HR):		96.5 / 63.6 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	1,093	1,093	3.8
	0	0	0	0.0
	0	0	0	0.0
	0	1,174	1,174	4.1
	0	1,236	1,236	4.3
	0	0	0	0.0
	0	0	0	0.0
	0	-1,408	-1,408	-4.9
	0	0	0	0.0
	0	0	0	0.0
	0	-380	-380	-1.3
	0	0	0	0.0
	373	0	373	1.3
	373	1,716	2,089	7.3
	1,375	1,908	3,283	11.4
	365	571	936	3.3
	-	-	-	-
	13,333	8,907	22,240	77.5
	15,073	11,385	26,459	92.1
	-	-	-	-
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-49	-49	-0.2
	0	-	0	0.0
	216	-	216	0.8
	15,663	13,052	28,715	100.0

Temperatures °F	
Supply	64.1
Return	75.2
Mixed Air	98.5
Fan Heat TD	1.3

Airflows cfm	
Main Fan	2,532
Ventilation	2,500
Infiltration	17
Min Stop / Reheat	2,532

Engineering Checks	
% OA	98.75
cfm/ft²	3.69
Btu/h-ft²	126.98
cfm/ton	349.29
ft²/ton	94.57
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

System Heating Checksums

Admin_PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-283	0	-283	16.1	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	-194	0	0	-194	11.1	-12.5
Door	0	0	0	0	0.0	0.0
Wall	0	-352	0	-352	20.1	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	32	0	32	-1.8	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	30	0	30	-1.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-205	0	0	-205	11.7	-1.0
Envelope Subtotal	-399	-573	0	-972	55.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	32	0	0	32	-1.8	0.2
Internal Subtotal	32	0	0	32	-1.8	-
Ventilation	-809	0	0	-809	46.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-5	0	-5	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,176	-578	0	-1,754	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/14:00		
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	405	405	16.4
	0	0	0	0.0
	328	372	700	28.3
	0	0	0	0.0
	0	546	546	22.1
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-94	-94	-3.8
	0	0	0	0.0
	0	0	0	0.0
	0	-76	-76	-3.1
	0	0	0	0.0
	112	0	112	4.5
	439	1,153	1,592	64.4
	199	276	475	19.2
	127	199	326	13.2
	-	-	-	-
	97	0	97	3.9
	423	475	898	36.3
	-	-	-	-
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-17	-17	-0.7
	0	-	0	0.0
	1	-	1	0.0
	863	1,610	2,474	100.0

Temperatures °F	
Supply	77.7
Return	70.0
Mixed Air	63.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	119
Ventilation	21
Infiltration	5
Min Stop / Reheat	119

Engineering Checks	
% OA	17.49
cfm/ft²	.63
Btu/h-ft²	-9.27
cfm/ton	-815.07
ft²/ton	-1,295.61
People	2
ft²/person	100.19

Areas ft²	
Roof	210
Other Roof	210
Ceiling	0
Window	16
Door	0
Wall	215
Below-Grade Wall	0
Other Wall	215
Partition	776
Exterior Floor	0
Internal Floor	0
Slab	210
Other Floor	0

Chart/Hotel_PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-27	0	-27	2.1	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-99	0	-99	7.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	25	0	25	-2.0	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-216	0	0	-216	16.8	0.0
Envelope Subtotal	-216	-100	0	-317	24.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	34	0	0	34	-2.6	0.2
Internal Subtotal	34	0	0	34	-2.6	-
Ventilation	-853	0	0	-853	66.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-150	0	-150	11.7	-0.8
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	0	0	0	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,035	-251	0	-1,286	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/19:00		
Outside Air (DB/WB/HR):		86.7 / 62.9 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	13	13	0.9
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	75	75	5.3
	0	0	0	0.0
	0	0	0	0.0
	0	-14	-14	-1.0
	0	0	0	0.0
	60	0	60	4.3
	60	74	134	9.5
	210	289	499	35.3
	134	209	343	24.3
	-	-	-	-
	340	0	340	24.1
	684	498	1,182	83.7
	-	-	-	-
	0	98	98	7.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-4	-4	-0.2
	0	-	0	0.0
	1	-	1	0.0
	745	667	1,412	100.0

Temperatures °F	
Supply	76.1
Return	70.0
Mixed Air	58.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	70
Ventilation	22
Infiltration	6
Min Stop / Reheat	70

Engineering Checks	
% OA	31.49
cfm/ft²	.35
Btu/h-ft²	-6.45
cfm/ton	-650.87
ft²/ton	-1,862.94
People	2
ft²/person	99.79

Areas ft²	
Roof	21
Other Roof	21
Ceiling	193
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	707
Exterior Floor	0
Internal Floor	0
Slab	214
Other Floor	0

Entry/Waiting_PSZ-HP-Admin

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-69	0	-69	1.2	-1.2
Other Roof	0	0	0	0	0.0	0.0
Glass	-3,128	0	0	-3,128	54.1	-10.9
Door	0	0	0	0	0.0	0.0
Wall	0	-544	0	-544	9.4	-0.9
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	469	0	469	-8.1	0.8
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	97	0	97	-1.7	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-401	0	0	-401	6.9	-0.7
Envelope Subtotal	-3,529	-46	0	-3,575	61.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,223	0	0	-1,223	21.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-932	0	-932	16.1	-2.7
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-54	0	-54	0.9	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	-4,753	-1,033	0	-5,786	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/09:00		
Outside Air (DB/WB/HR):		81.8 / 61.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	-4	-4	0.0
	0	0	0	0.0
	5,410	6,118	11,528	112.8
	0	0	0	0.0
	0	253	253	2.5
	0	0	0	0.0
	0	0	0	0.0
	0	-1,155	-1,155	-11.3
	0	0	0	0.0
	0	0	0	0.0
	0	356	356	3.5
	0	0	0	0.0
	65	0	65	0.6
	5,476	5,567	11,043	108.1
	182	241	423	4.1
	201	272	473	4.6
	-	-	-	-
	0	0	0	0.0
	383	513	896	8.8
	-	-	-	-
			0	0.0
	0	-1,497	-1,497	-14.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-225	-225	-2.2
	0	-	0	0.0
	2	-	2	0.0
	5,860	4,358	10,218	100.0

Temperatures °F	
Supply	79.0
Return	70.0
Mixed Air	67.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	492
Ventilation	31
Infiltration	10
Min Stop / Reheat	492

Engineering Checks	
% OA	6.40
cfm/ft²	1.33
Btu/h-ft²	-15.63
cfm/ton	-1,020.54
ft²/ton	-768.32
People	2
ft²/person	200.24

Areas ft²	
Roof	56
Other Roof	56
Ceiling	339
Window	287
Door	0
Wall	625
Below-Grade Wall	0
Other Wall	625
Partition	591
Exterior Floor	0
Internal Floor	0
Slab	396
Other Floor	0

Hospitality_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-167	0	-167	3.7	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-439	0	-439	9.6	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-92	0	-92	2.0	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	44	0	44	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-266	0	0	-266	5.8	-1.1
Envelope Subtotal	-266	-654	0	-921	20.2	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-3,154	0	0	-3,154	69.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-458	0	-458	10.1	-3.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-2	0	-2	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-23	0	0	-23	0.5	-
Grand Total	-3,443	-1,115	0	-4,558	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	315	315	11.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	307	307	10.7
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	73	73	2.6
	0	0	0	0.0
	0	-32	-32	-1.1
	0	0	0	0.0
	137	0	137	4.7
	137	664	800	27.8
	492	716	1,208	41.9
	147	233	380	13.2
	-	-	-	-
	252	171	423	14.7
	891	1,119	2,010	69.8
	-	-	-	-
	0	71	71	2.5
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-5	-5	-0.2
	0	-	0	0.0
	2	-	2	0.1
	1,030	1,849	2,879	100.0

Temperatures °F	
Supply	75.0
Return	70.0
Mixed Air	58.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	274
Ventilation	81
Infiltration	7
Min Stop / Reheat	274

Engineering Checks	
% OA	30.14
cfm/ft²	1.09
Btu/h-ft²	-18.54
cfm/ton	-709.36
ft²/ton	-647.73
People	5
ft²/person	50.01

Areas ft²	
Roof	129
Other Roof	129
Ceiling	133
Window	0
Door	0
Wall	260
Below-Grade Wall	0
Other Wall	260
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	262
Other Floor	0

Lounge_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-432	0	-432	10.0	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-684	0	0	-684	15.9	-18.7
Door	0	0	0	0	0.0	0.0
Wall	0	-374	0	-374	8.7	-1.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	105	0	105	-2.4	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	49	0	49	-1.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-321	0	0	-321	7.5	-1.4
Envelope Subtotal	-1,005	-652	0	-1,658	38.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,535	0	0	-2,535	58.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-22	0	-22	0.5	-
Sizing Factor Correction	-89	-	0	-89	2.1	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-3,630	-675	0	-4,305	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			10/21/14:00	
Outside Air (DB/WB/HR):			89.8 / 58.2 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	484	484	8.1	322
0	0	0	0.0	322
1,410	1,629	3,039	50.7	37
0	0	0	0.0	0
0	578	578	9.6	250
0	0	0	0.0	0
0	0	0	0.0	250
0	-451	-451	-7.5	987
0	0	0	0.0	0
0	0	0	0.0	0
0	-236	-236	-3.9	322
0	0	0	0.0	0
112	0	112	1.9	250
1,523	2,003	3,526	58.8	-
589	867	1,456	24.3	297
187	284	471	7.9	297
-	-	-	-	-
202	133	335	5.6	297
979	1,284	2,262	37.8	-
-	-	-	-	-
		0	0.0	0
0	0	0	0.0	0
		0	0.0	297
		0	0.0	297
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-95	-95	-1.6	-
302	-	302	5.0	-
-2	-	-2	0.0	-
2,801	3,191	5,992	100.0	

Temperatures °F	
Supply	76.0
Return	70.0
Mixed Air	61.5
Fan Heat TD	0.0

Airflows cfm	
Main Fan	290
Ventilation	65
Infiltration	8
Min Stop / Reheat	290

Engineering Checks	
% OA	23.74
cfm/ft²	.93
Btu/h-ft²	-14.52
cfm/ton	-766.63
ft²/ton	-827.14
People	6
ft²/person	50.04

Areas ft²	
Roof	322
Other Roof	322
Ceiling	0
Window	37
Door	0
Wall	250
Below-Grade Wall	0
Other Wall	250
Partition	987
Exterior Floor	0
Internal Floor	0
Slab	322
Other Floor	0

Multipurpose/Dining_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-345	0	-345	3.9	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-807	0	0	-807	9.0	-18.2
Door	0	0	0	0	0.0	0.0
Wall	0	-467	0	-467	5.2	-1.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	201	0	201	-2.3	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	92	0	92	-1.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-526	0	0	-526	5.9	-1.7
Envelope Subtotal	-1,332	-520	0	-1,852	20.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-6,220	0	0	-6,220	69.7	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-828	0	-828	9.3	-3.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-28	0	-28	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	-7,552	-1,376	0	-8,927	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	699	699	12.6
	0	0	0	0.0
	623	260	883	15.9
	0	0	0	0.0
	0	300	300	5.4
	0	0	0	0.0
	0	0	0	0.0
	0	-339	-339	-6.1
	0	0	0	0.0
	0	0	0	0.0
	0	-71	-71	-1.3
	0	0	0	0.0
	291	0	291	5.2
	914	849	1,763	31.7
	971	1,316	2,287	41.1
	291	433	723	13.0
	-	-	-	-
	497	318	815	14.7
	1,758	2,067	3,826	68.8
	-	-	-	-
	0	32	32	0.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-57	-57	-1.0
	0	-	0	0.0
	-1	-	-1	0.0
	2,671	2,891	5,563	100.0

Temperatures °F	
Supply	79.9
Return	70.0
Mixed Air	47.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	268
Ventilation	160
Infiltration	14
Min Stop / Reheat	268

Engineering Checks	
% OA	59.80
cfm/ft²	.55
Btu/h-ft²	-18.40
cfm/ton	-360.11
ft²/ton	-652.46
People	10
ft²/person	49.99

Areas ft²	
Roof	266
Other Roof	266
Ceiling	242
Window	44
Door	0
Wall	322
Below-Grade Wall	0
Other Wall	322
Partition	788
Exterior Floor	0
Internal Floor	0
Slab	508
Other Floor	0

Servery_PSZ-HP-Common

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	-164	0	-164	4.1	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-274	0	-274	6.8	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-18	0	-18	0.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	38	0	38	-0.9	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-247	0	0	-247	6.2	-1.6
Envelope Subtotal	-247	-418	0	-665	16.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,924	0	0	-2,924	72.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-426	0	-426	10.6	-3.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-2	0	-2	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-3,171	-847	0	-4,018	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	303	303	12.1
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	185	185	7.4
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-35	-35	-1.4
	0	0	0	0.0
	0	0	0	0.0
	0	-34	-34	-1.4
	0	0	0	0.0
	127	0	127	5.1
	127	418	545	21.8
	456	682	1,139	45.6
	137	221	358	14.3
	-	-	-	-
	234	162	396	15.8
	827	1,066	1,893	75.7
	-	-	-	-
	0	70	70	2.8
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-8	-8	-0.3
	0	-	0	0.0
	-1	-	-1	0.0
	953	1,547	2,500	100.0

Temperatures °F	
Supply	78.9
Return	70.0
Mixed Air	46.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	120
Ventilation	75
Infiltration	6
Min Stop / Reheat	120

Engineering Checks	
% OA	62.57
cfm/ft²	.53
Btu/h-ft²	-17.62
cfm/ton	-359.57
ft²/ton	-681.59
People	5
ft²/person	50.04

Areas ft²	
Roof	124
Other Roof	124
Ceiling	120
Window	0
Door	0
Wall	160
Below-Grade Wall	0
Other Wall	160
Partition	620
Exterior Floor	0
Internal Floor	0
Slab	244
Other Floor	0

Attrium_PSZ-HP-Atrium

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time		Percent			
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-952	0	-952	10.1	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	-769	0	0	-769	8.2	-13.5
Door	0	0	0	0	0.0	0.0
Wall	0	-1,738	0	-1,738	18.4	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-216	0	-216	2.3	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	86	0	86	-0.9	0.1
Slab	0	71	0	71	-0.8	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-1,359	0	0	-1,359	14.4	-1.4
Envelope Subtotal	-2,128	-2,750	0	-4,878	51.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-4,182	0	0	-4,182	44.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-34	0	-34	0.4	-0.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-17	0	-17	0.2	-
Sizing Factor Correction	-319	-	0	-319	3.4	-
Over/Undersizing	1	0	0	1	0.0	-
Grand Total	-6,628	-2,801	0	-9,429	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time		Percent		
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,546	1,546	18.4	704
	0	0	0	0.0	704
	822	594	1,416	16.9	57
	0	0	0	0.0	0
	0	1,613	1,613	19.2	1,046
	0	0	0	0.0	0
	0	0	0	0.0	1,046
	0	94	94	1.1	1,426
	0	0	0	0.0	0
	0	-148	-148	-1.8	878
	0	-1	-1	0.0	469
	0	0	0	0.0	878
	694	0	694	8.3	1,046
	1,516	3,697	5,213	62.2	-
	621	876	1,497	17.9	1,267
	688	1,005	1,693	20.2	1,267
	-	-	-	-	-
	0	0	0	0.0	1,267
	1,309	1,881	3,190	38.0	-
	-	-	-	-	-
			0	0.0	0
	0	-475	-475	-5.7	671
			0	0.0	1,267
			0	0.0	1,267
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-48	-48	-0.6	-
	510	-	510	6.1	-
	-5	-	-5	-0.1	-
	3,331	5,055	8,386	100.0	

Temperatures	
	°F
Supply	82.7
Return	70.0
Mixed Air	59.9
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	404
Ventilation	108
Infiltration	35
Min Stop / Reheat	404

Engineering Checks	
% OA	28.39
cfm/ft²	.30
Btu/h-ft²	-7.45
cfm/ton	-482.71
ft²/ton	-1,611.97
People	6
ft²/person	200.10

Areas	
	ft²
Roof	704
Other Roof	704
Ceiling	671
Window	57
Door	0
Wall	1,046
Below-Grade Wall	0
Other Wall	1,046
Partition	1,426
Exterior Floor	0
Internal Floor	878
Slab	469
Other Floor	878

Support_PSZ-HP-Utility

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-878	0	-878	16.8	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,511	0	0	-1,511	28.9	-24.0
Door	0	0	0	0	0.0	0.0
Wall	0	-1,055	0	-1,055	20.1	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	191	0	191	-3.7	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	105	0	105	-2.0	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	-1,511	-1,636	0	-3,148	60.1	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	206	0	0	206	-3.9	0.3
Internal Subtotal	206	0	0	206	-3.9	-
Ventilation	-1,406	0	0	-1,406	26.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-59	0	-59	1.1	-
Sizing Factor Correction	-826	-	0	-826	15.8	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	-3,538	-1,695	0	-5,234	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			9/21/10:00	
Outside Air (DB/WB/HR):			86.6 / 60.3 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	125	125	1.4	657
0	0	0	0.0	657
2,596	2,515	5,110	57.5	63
0	0	0	0.0	0
0	757	757	8.5	661
0	0	0	0.0	0
0	0	0	0.0	661
0	-780	-780	-8.8	1,959
0	0	0	0.0	0
0	0	0	0.0	0
0	-239	-239	-2.7	657
0	0	0	0.0	0
0	0	0	0.0	661
2,596	2,378	4,974	56.0	-
0	0	0	0.0	603
278	413	691	7.8	603
-	-	-	-	-
1,441	0	1,441	16.2	603
1,719	413	2,132	24.0	-
-	-	-	-	-
		0	0.0	0
0	0	0	0.0	0
		0	0.0	603
		0	0.0	603
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-139	-139	-1.6	-
1,917	-	1,917	21.6	-
0	-	0	0.0	-
6,231	2,652	8,883	100.0	

Temperatures °F	
Supply	78.7
Return	70.0
Mixed Air	66.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	429
Ventilation	36
Infiltration	0
Min Stop / Reheat	429

Engineering Checks	
% OA	10.77
cfm/ft²	.56
Btu/h-ft²	-8.68
cfm/ton	-771.10
ft²/ton	-1,383.35
People	
ft²/person	.00

Areas ft²	
Roof	657
Other Roof	657
Ceiling	0
Window	63
Door	0
Wall	661
Below-Grade Wall	0
Other Wall	661
Partition	1,959
Exterior Floor	0
Internal Floor	0
Slab	657
Other Floor	0

Utility_PSZ-HP-Utility

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-3,956	0	-3,956	26.6	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	-700	0	0	-700	4.7	-25.0
Door	0	0	0	0	0.0	0.0
Wall	0	-144	0	-144	1.0	-1.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-1,732	0	-1,732	11.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	403	0	403	-2.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-2,044	0	0	-2,044	13.8	-19.7
Envelope Subtotal	-2,744	-5,428	0	-8,172	55.0	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	82	0	0	82	-0.6	0.0
Internal Subtotal	82	0	0	82	-0.6	-
Ventilation	-6,377	0	0	-6,377	42.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-356	0	-356	2.4	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-37	0	-37	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-9,038	-5,821	0	-14,859	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/15:00			
Outside Air (DB/WB/HR):		98.4 / 64.2 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	5,689	5,689	30.6	2,903
	0	0	0	0.0	2,903
	1,128	996	2,124	11.4	28
	0	0	0	0.0	0
	0	183	183	1.0	109
	0	0	0	0.0	0
	0	0	0	0.0	109
	0	3,652	3,652	19.6	13,149
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-243	-243	-1.3	3,198
	0	0	0	0.0	0
	1,113	0	1,113	6.0	109
	2,241	10,277	12,518	67.3	-
	724	1,044	1,768	9.5	2,927
	1,661	2,580	4,241	22.8	2,927
	-	-	-	-	-
	247	0	247	1.3	2,927
	2,633	3,623	6,256	33.6	-
	-	-	-	-	-
	0	-78	-78	-0.4	295
			0	0.0	2,927
			0	0.0	2,927
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-99	-99	-0.5	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	4,874	13,724	18,598	100.0	

Temperatures °F	
Supply	79.2
Return	70.0
Mixed Air	63.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	897
Ventilation	164
Infiltration	53
Min Stop / Reheat	897

Engineering Checks	
% OA	18.31
cfm/ft²	.31
Btu/h-ft²	-5.08
cfm/ton	-724.33
ft²/ton	-2,363.34
People	7
ft²/person	409.31

Areas ft²	
Roof	2,903
Other Roof	2,903
Ceiling	295
Window	28
Door	0
Wall	109
Below-Grade Wall	0
Other Wall	109
Partition	13,149
Exterior Floor	0
Internal Floor	0
Slab	3,198
Other Floor	0

SHWR-N_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	-3	0	-3	0.3	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-358	0	-358	38.2	-1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-76	0	-76	8.1	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	31	0	31	-3.3	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-220	0	0	-220	23.5	-1.1
Envelope Subtotal	-220	-405	0	-626	66.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-309	0	-309	33.0	-1.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-221	-716	0	-937	100.0	-

Fan Peak					
Peak Time (Mo/D/H:M): 7/21/12:00					
Outside Air (DB/WB/HR): 94.8 / 65.5 / 0.0					
	Instant	Time Delay	Total	Percent of Total	Related Area
	Sensible	Sensible	Sensible	Total	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	4	4	0.2	2
	0	0	0	0.0	2
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	509	509	25.0	202
	0	0	0	0.0	0
	0	0	0	0.0	202
	0	-28	-28	-1.4	844
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-33	-33	-1.6	225
	0	0	0	0.0	0
	102	0	102	5.0	202
	102	452	554	27.2	-
	399	690	1,089	53.4	204
	141	252	393	19.3	204
	-	-	-	-	-
	0	0	0	0.0	204
	540	942	1,482	72.7	-
	-	-	-	-	-
	0	9	9	0.4	223
			0	0.0	204
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-6	-6	-0.3	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	643	1,396	2,039	100.0	-

Temperatures °F	
Supply	79.3
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	98
Ventilation	0
Infiltration	6
Min Stop / Reheat	98

Engineering Checks	
% OA	.00
cfm/ft²	.48
Btu/h-ft²	-4.60
cfm/ton	-1,255.88
ft²/ton	-2,608.95
People	4
ft²/person	50.03

Areas ft²	
Roof	2
Other Roof	2
Ceiling	223
Window	0
Door	0
Wall	202
Below-Grade Wall	0
Other Wall	202
Partition	844
Exterior Floor	0
Internal Floor	0
Slab	225
Other Floor	0

SHWR-S_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-365	0	-365	39.5	-1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-68	0	-68	7.3	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	31	0	31	-3.4	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-224	0	0	-224	24.2	-1.1
Envelope Subtotal	-224	-402	0	-626	67.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-298	0	-298	32.2	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-224	-701	0	-925	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	653	653	28.7
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	14	14	0.6
	0	0	0	0.0
	0	-50	-50	-2.2
	0	0	0	0.0
	87	0	87	3.8
	87	617	704	30.9
	406	770	1,176	51.6
	143	281	425	18.6
	-	-	-	-
	0	0	0	0.0
	549	1,051	1,601	70.3
	-	-	-	-
	0	-18	-18	-0.8
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-8	-8	-0.3
	0	-	0	0.0
	-1	-	-1	0.0
	635	1,643	2,278	100.0

Temperatures °F	
Supply	78.2
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	110
Ventilation	0
Infiltration	6
Min Stop / Reheat	110

Engineering Checks	
% OA	.00
cfm/ft²	.53
Btu/h-ft²	-4.47
cfm/ton	-1,422.47
ft²/ton	-2,687.16
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	206
Below-Grade Wall	0
Other Wall	206
Partition	845
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

SHWR-W_PSZ-HP-ResShwr

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-360	0	-360	38.4	-1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-85	0	-85	9.0	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	31	0	31	-3.3	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-224	0	0	-224	23.9	-1.2
Envelope Subtotal	-224	-413	0	-638	67.9	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	0	0	0	0	0.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-300	0	-300	32.0	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-224	-714	0	-939	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	219	219	11.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	80	80	4.0
	0	0	0	0.0
	0	-50	-50	-2.5
	0	0	0	0.0
	87	0	87	4.4
	87	249	336	16.9
	406	777	1,182	59.6
	143	284	427	21.5
	-	-	-	-
	0	0	0	0.0
	549	1,060	1,609	81.1
	-	-	-	-
	0	46	46	2.3
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-5	-5	-0.3
	0	-	0	0.0
	-1	-	-1	0.0
	635	1,351	1,986	100.0

Temperatures °F	
Supply	79.6
Return	70.0
Mixed Air	70.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	96
Ventilation	0
Infiltration	6
Min Stop / Reheat	96

Engineering Checks	
% OA	.00
cfm/ft²	.46
Btu/h-ft²	-4.54
cfm/ton	-1,221.41
ft²/ton	-2,647.16
People	4
ft²/person	50.02

Areas ft²	
Roof	0
Other Roof	0
Ceiling	229
Window	0
Door	0
Wall	204
Below-Grade Wall	0
Other Wall	204
Partition	849
Exterior Floor	0
Internal Floor	0
Slab	229
Other Floor	0

Kitchen _PSZ-HP-Kitchen

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-964	0	-964	4.5	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-1,162	0	0	-1,162	5.4	-23.7
Door	0	0	0	0	0.0	0.0
Wall	0	-957	0	-957	4.5	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-221	0	-221	1.0	-0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	125	0	125	-0.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-742	0	0	-742	3.5	-1.3
Envelope Subtotal	-1,904	-2,016	0	-3,921	18.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	13	0	0	13	-0.1	0.0
Internal Subtotal	13	0	0	13	-0.1	-
Ventilation	-6,752	0	0	-6,752	31.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-45	0	-45	0.2	-
Sizing Factor Correction	-10,681	-	0	-10,681	49.9	-
Over/Undersizing	-4	0	0	-4	0.0	-
Grand Total	-19,329	-2,061	0	-21,390	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/14:00		
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	1,495	1,495	2.5
	0	0	0	0.0
	2,391	2,696	5,087	8.6
	0	0	0	0.0
	0	407	407	0.7
	0	0	0	0.0
	0	0	0	0.0
	0	-1,089	-1,089	-1.8
	0	0	0	0.0
	0	0	0	0.0
	0	-777	-777	-1.3
	0	0	0	0.0
	259	0	259	0.4
	2,651	2,733	5,383	9.1
	1,375	1,925	3,300	5.6
	560	880	1,440	2.4
	-	-	-	-
	13,333	8,987	22,321	37.7
	15,268	11,793	27,061	45.7
	-	-	-	-
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-239	-239	-0.4
	27,001	-	27,001	45.6
	-19	-	-19	0.0
	44,902	14,286	59,187	100.0

Temperatures °F	
Supply	75.0
Return	70.0
Mixed Air	67.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	2,853
Ventilation	174
Infiltration	19
Min Stop / Reheat	2,853

Engineering Checks	
% OA	22.55
cfm/ft²	1.12
Btu/h-ft²	-31.22
cfm/ton	-432.43
ft²/ton	-384.58
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	49
Door	0
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Comfort/Consult _PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-366	0	-366	9.1	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-290	0	0	-290	7.3	-12.5
Door	0	0	0	0	0.0	0.0
Wall	0	-525	0	-525	13.1	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	80	0	80	-2.0	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	45	0	45	-1.1	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	0	0	0	0	0.0	0.0
Envelope Subtotal	-290	-766	0	-1,057	26.4	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,807	0	0	-2,807	70.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-127	0	-127	3.2	-3.6
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-7	0	-7	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-3,097	-900	0	-3,998	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		7/21/16:00			
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0			
	Time	Percent		Related	
	Instant	Delay			
	Sensible	Sensible	Total	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	611	611	19.1	278
	0	0	0	0.0	278
	211	99	310	9.7	23
	0	0	0	0.0	0
	0	376	376	11.8	336
	0	0	0	0.0	0
	0	0	0	0.0	336
	0	-184	-184	-5.8	1,134
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-28	-28	-0.9	313
	0	0	0	0.0	0
	0	0	0	0.0	336
	211	874	1,085	33.9	-
	298	418	715	22.4	283
	259	408	666	20.8	283
	-	-	-	-	-
	435	295	730	22.8	283
	991	1,120	2,112	66.0	-
	-	-	-	-	-
	0	18	18	0.6	36
			0	0.0	283
			0	0.0	283
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-19	-19	-0.6	-
	0	-	0	0.0	-
	1	-	1	0.0	-
	1,204	1,994	3,197	100.0	

Temperatures °F	
Supply	77.5
Return	70.0
Mixed Air	52.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	154
Ventilation	72
Infiltration	0
Min Stop / Reheat	154

Engineering Checks	
% OA	46.99
cfm/ft²	.54
Btu/h-ft²	-14.11
cfm/ton	-461.82
ft²/ton	-850.78
People	3
ft²/person	100.16

Areas ft²	
Roof	278
Other Roof	278
Ceiling	36
Window	23
Door	0
Wall	336
Below-Grade Wall	0
Other Wall	336
Partition	1,134
Exterior Floor	0
Internal Floor	0
Slab	313
Other Floor	0

Exam/Storage_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/04:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	-338	0	-338	17.4	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-72	0	-72	3.7	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	29	0	29	-1.5	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-109	0	0	-109	5.6	0.0
Envelope Subtotal	-109	-381	0	-490	25.3	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	4	0	0	4	-0.2	0.0
Internal Subtotal	4	0	0	4	-0.2	-
Ventilation	-1,453	0	0	-1,453	74.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,558	-381	0	-1,939	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/16:00				
Outside Air (DB/WB/HR): 96.9 / 66.1 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	574	574	32.7
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-12	-12	-0.7
	0	0	0	0.0
	0	0	0	0.0
	0	-13	-13	-0.7
	0	0	0	0.0
	56	0	56	3.2
	56	549	605	34.5
	182	248	430	24.5
	157	241	397	22.7
	-	-	-	-
	202	124	326	18.6
	541	613	1,153	65.8
	-	-	-	-
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-5	-5	-0.3
	0	-	0	0.0
	1	-	1	0.0
	597	1,157	1,754	100.0

Temperatures °F	
Supply	75.6
Return	70.0
Mixed Air	53.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	84
Ventilation	37
Infiltration	3
Min Stop / Reheat	84

Engineering Checks	
% OA	44.34
cfm/ft²	.38
Btu/h-ft²	-8.67
cfm/ton	-522.31
ft²/ton	-1,384.54
People	2
ft²/person	129.32

Areas ft²	
Roof	246
Other Roof	246
Ceiling	0
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	1,076
Exterior Floor	0
Internal Floor	0
Slab	246
Other Floor	0

Group_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-190	0	-190	2.6	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-195	0	0	-195	2.6	-12.6
Door	0	0	0	0	0.0	0.0
Wall	0	-468	0	-468	6.3	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	87	0	87	-1.2	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	49	0	49	-0.7	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-299	0	0	-299	4.0	-1.1
Envelope Subtotal	-495	-522	0	-1,017	13.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-3,542	0	0	-3,542	47.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-518	0	-518	7.0	-3.5
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-6	0	-6	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-2,358	0	0	-2,358	31.7	-
Grand Total	-6,395	-1,046	0	-7,441	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time	Percent		Related Area (ft²)
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	358	358	11.3
	0	0	0	0.0
	142	71	213	6.7
	0	0	0	0.0
	0	321	321	10.2
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-145	-145	-4.6
	0	0	0	0.0
	0	0	0	0.0
	0	-43	-43	-1.4
	0	0	0	0.0
	153	0	153	4.9
	295	562	857	27.1
	553	808	1,360	43.1
	166	262	427	13.5
	-	-	-	-
	283	192	475	15.0
	1,001	1,261	2,262	71.6
	-	-	-	-
	0	62	62	1.9
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-21	-21	-0.7
	0	-	0	0.0
	-1	-	-1	0.0
	1,296	1,864	3,159	100.0

Temperatures °F	
Supply	95.0
Return	70.0
Mixed Air	47.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	152
Ventilation	91
Infiltration	8
Min Stop / Reheat	152

Engineering Checks	
% OA	59.96
cfm/ft²	.55
Btu/h-ft²	-26.94
cfm/ton	-245.40
ft²/ton	-445.81
People	6
ft²/person	49.99

Areas ft²	
Roof	146
Other Roof	146
Ceiling	149
Window	16
Door	0
Wall	295
Below-Grade Wall	0
Other Wall	295
Partition	570
Exterior Floor	0
Internal Floor	0
Slab	294
Other Floor	0

Intake-HR-A_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	-583	0	-583	11.1	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-608	0	0	-608	11.5	-23.7
Door	0	0	0	0	0.0	0.0
Wall	0	-725	0	-725	13.8	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	44	0	44	-0.8	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	76	0	76	-1.4	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-177	0	0	-177	3.4	-0.4
Envelope Subtotal	-785	-1,188	0	-1,972	37.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-2,694	0	0	-2,694	51.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-255	0	-255	4.8	-3.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-26	0	-26	0.5	-
Sizing Factor Correction	-317	-	0	-317	6.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-3,796	-1,469	0	-5,265	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 9/21/13:00					
Outside Air (DB/WB/HR): 96.8 / 63.7 / 0.0					
	Instant	Time Delay	Total	Percent of Total	Related Area
	Sensible	Sensible	Sensible	Total	(ft²)
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	670	670	10.4	438
	0	0	0	0.0	438
	1,319	1,042	2,362	36.5	26
	0	0	0	0.0	0
	0	648	648	10.0	449
	0	0	0	0.0	0
	0	0	0	0.0	449
	0	-437	-437	-6.8	1,787
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-82	-82	-1.3	516
	0	0	0	0.0	0
	90	0	90	1.4	449
	1,409	1,841	3,250	50.3	-
	404	574	978	15.1	471
	364	562	927	14.3	471
	-	-	-	-	-
	362	240	602	9.3	471
	1,130	1,376	2,506	38.8	-
	-	-	-	-	-
	0	-37	-37	-0.6	78
			0	0.0	471
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-96	-96	-1.5	-
	839	-	839	13.0	-
	2	-	2	0.0	-
	3,381	3,084	6,465	100.0	

Temperatures °F	
Supply	78.0
Return	70.0
Mixed Air	61.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	311
Ventilation	69
Infiltration	5
Min Stop / Reheat	311

Engineering Checks	
% OA	25.41
cfm/ft²	.58
Btu/h-ft²	-11.20
cfm/ton	-622.41
ft²/ton	-1,072.45
People	4
ft²/person	118.82

Areas ft²	
Roof	438
Other Roof	438
Ceiling	78
Window	26
Door	0
Wall	449
Below-Grade Wall	0
Other Wall	449
Partition	1,787
Exterior Floor	0
Internal Floor	0
Slab	516
Other Floor	0

Intake-HR-B_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-252	0	-252	17.2	-1.4
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-47	0	-47	3.2	-1.8
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-86	0	-86	5.8	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	22	0	22	-1.5	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-88	0	0	-88	6.0	-3.4
Envelope Subtotal	-88	-363	0	-450	30.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	3	0	0	3	-0.2	0.0
Internal Subtotal	3	0	0	3	-0.2	-
Ventilation	-1,018	0	0	-1,018	69.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,102	-363	0	-1,465	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/16:00		
Outside Air (DB/WB/HR):		96.9 / 66.1 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	426	426	31.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	40	40	2.9
	0	0	0	0.0
	0	0	0	0.0
	0	47	47	3.4
	0	0	0	0.0
	0	0	0	0.0
	0	-9	-9	-0.6
	0	0	0	0.0
	45	0	45	3.3
	45	504	549	39.9
	130	183	313	22.8
	112	177	289	21.1
	-	-	-	-
	139	87	226	16.5
	382	447	829	60.3
	-	-	-	-
			0	0.0
	0	0	0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-4	-4	-0.3
	0	-	0	0.0
	0	-	0	0.0
	427	947	1,374	100.0

Temperatures °F	
Supply	76.6
Return	70.0
Mixed Air	55.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	66
Ventilation	26
Infiltration	2
Min Stop / Reheat	66

Engineering Checks	
% OA	39.65
cfm/ft²	.40
Btu/h-ft²	-8.91
cfm/ton	-541.52
ft²/ton	-1,348.00
People	1
ft²/person	132.76

Areas ft²	
Roof	183
Other Roof	183
Ceiling	0
Window	0
Door	0
Wall	27
Below-Grade Wall	0
Other Wall	27
Partition	894
Exterior Floor	0
Internal Floor	0
Slab	183
Other Floor	0

RB-S-Corner-N_PSZ-HP-Clinical

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-124	0	0	-124	8.9	-12.3
Door	0	0	0	0	0.0	0.0
Wall	0	-489	0	-489	35.0	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	49	0	49	-3.5	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	23	0	23	-1.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-140	0	0	-140	10.0	-0.5
Envelope Subtotal	-264	-417	0	-681	48.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-551	0	0	-551	39.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-161	0	-161	11.6	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-815	-581	0	-1,396	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 9/21/15:00				
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0				
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	97	111	207	10.6
	0	0	0	0.0
	0	598	598	30.6
	0	0	0	0.0
	0	0	0	0.0
	0	-109	-109	-5.6
	0	0	0	0.0
	0	0	0	0.0
	0	-84	-84	-4.3
	0	0	0	0.0
	76	0	76	3.9
	173	516	689	35.2
	149	212	361	18.5
	74	143	217	11.1
	-	-	-	-
	352	441	793	40.5
	575	796	1,371	70.1
	-	-	-	-
	0	-91	-91	-4.7
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-12	-12	-0.6
	0	-	0	0.0
	1	-	1	0.0
	748	1,209	1,957	100.0

Temperatures °F	
Supply	78.8
Return	70.0
Mixed Air	64.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	94
Ventilation	14
Infiltration	4
Min Stop / Reheat	94

Engineering Checks	
% OA	15.08
cfm/ft²	.73
Btu/h-ft²	-10.83
cfm/ton	-809.27
ft²/ton	-1,108.91
People	1
ft²/person	100.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	141
Window	10
Door	0
Wall	286
Below-Grade Wall	0
Other Wall	286
Partition	286
Exterior Floor	0
Internal Floor	0
Slab	141
Other Floor	0

ACT-Noisy-1_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-700	0	0	-700	26.2	-19.2
Door	0	0	0	0	0.0	0.0
Wall	0	-236	0	-236	8.8	-1.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	131	0	131	-4.9	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	33	0	33	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-195	0	0	-195	7.3	-1.2
Envelope Subtotal	-895	-72	0	-967	36.2	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,466	0	0	-1,466	54.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-214	0	-214	8.0	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-23	0	-23	0.9	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-2,360	-309	0	-2,669	100.0	-

Fan Peak				
Peak Time (Mo/D/H:M):		8/21/17:00		
Outside Air (DB/WB/HR):		94.0 / 63.5 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	1,719	1,405	3,124	75.7
	0	0	0	0.0
	0	373	373	9.0
	0	0	0	0.0
	0	0	0	0.0
	0	-641	-641	-15.5
	0	0	0	0.0
	0	0	0	0.0
	0	196	196	4.7
	0	0	0	0.0
	87	0	87	2.1
	1,806	1,332	3,138	76.1
	377	635	1,013	24.6
	121	227	348	8.4
	-	-	-	-
	184	149	333	8.1
	682	1,012	1,694	41.1
	-	-	-	-
	0	-577	-577	-14.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-130	-130	-3.1
	0	-	0	0.0
	-1	-	-1	0.0
	2,487	1,638	4,124	100.0

Temperatures °F	
Supply	75.9
Return	70.0
Mixed Air	62.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	199
Ventilation	38
Infiltration	5
Min Stop / Reheat	199

Engineering Checks	
% OA	19.00
cfm/ft²	1.11
Btu/h-ft²	-14.87
cfm/ton	-892.90
ft²/ton	-807.57
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	193
Window	37
Door	0
Wall	174
Below-Grade Wall	0
Other Wall	174
Partition	494
Exterior Floor	0
Internal Floor	0
Slab	193
Other Floor	0

ACT-Noisy-2_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-506	0	0	-506	20.6	-24.1
Door	0	0	0	0	0.0	0.0
Wall	0	-123	0	-123	5.0	-1.3
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	64	0	64	-2.6	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	30	0	30	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-196	0	0	-196	8.0	-2.2
Envelope Subtotal	-702	-28	0	-730	29.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,475	0	0	-1,475	60.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-236	0	-236	9.6	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-20	0	-20	0.8	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-2,177	-283	0	-2,460	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/18:00				
Outside Air (DB/WB/HR): 91.4 / 64.4 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	401	187	589	27.5
	0	0	0	0.0
	0	70	70	3.3
	0	0	0	0.0
	0	0	0	0.0
	0	-190	-190	-8.9
	0	0	0	0.0
	0	0	0	0.0
	0	-31	-31	-1.5
	0	0	0	0.0
	76	0	76	3.5
	477	36	513	24.0
	380	626	1,006	47.1
	122	225	346	16.2
	-	-	-	-
	185	147	333	15.6
	687	999	1,685	78.8
	-	-	-	-
	0	-35	-35	-1.7
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-25	-25	-1.2
	0	-	0	0.0
	0	-	0	0.0
	1,163	974	2,138	100.0

Temperatures °F	
Supply	79.3
Return	70.0
Mixed Air	56.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	103
Ventilation	38
Infiltration	5
Min Stop / Reheat	103

Engineering Checks	
% OA	36.92
cfm/ft²	.57
Btu/h-ft²	-13.61
cfm/ton	-501.97
ft²/ton	-882.27
People	4
ft²/person	49.96

Areas ft²	
Roof	0
Other Roof	0
Ceiling	195
Window	21
Door	0
Wall	92
Below-Grade Wall	0
Other Wall	92
Partition	578
Exterior Floor	0
Internal Floor	0
Slab	195
Other Floor	0

ACT-Noisy-3 _PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-550	0	0	-550	20.5	-19.1
Door	0	0	0	0	0.0	0.0
Wall	0	-218	0	-218	8.1	-1.4
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	137	0	137	-5.1	0.3
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	33	0	33	-1.2	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-197	0	0	-197	7.3	-1.3
Envelope Subtotal	-747	-48	0	-795	29.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,486	0	0	-1,486	55.3	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-388	0	-388	14.4	-2.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-18	0	-18	0.7	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-2,232	-455	0	-2,687	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/15:00		
Outside Air (DB/WB/HR):		98.8 / 66.7 / 0.0		
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	487	190	677	30.6
	0	0	0	0.0
	0	136	136	6.1
	0	0	0	0.0
	0	0	0	0.0
	0	-267	-267	-12.0
	0	0	0	0.0
	0	0	0	0.0
	0	-72	-72	-3.2
	0	0	0	0.0
	109	0	109	4.9
	597	-12	585	26.4
	382	599	982	44.3
	122	215	337	15.2
	-	-	-	-
	186	141	327	14.8
	691	955	1,646	74.3
	-	-	-	-
	0	15	15	0.7
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-31	-31	-1.4
	0	-	0	0.0
	-1	-	-1	0.0
	1,287	927	2,214	100.0

Temperatures °F	
Supply	81.0
Return	70.0
Mixed Air	56.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	107
Ventilation	38
Infiltration	5
Min Stop / Reheat	107

Engineering Checks	
% OA	35.89
cfm/ft²	.59
Btu/h-ft²	-14.76
cfm/ton	-476.05
ft²/ton	-813.37
People	4
ft²/person	50.04

Areas ft²	
Roof	0
Other Roof	0
Ceiling	196
Window	29
Door	0
Wall	161
Below-Grade Wall	0
Other Wall	161
Partition	511
Exterior Floor	0
Internal Floor	0
Slab	196
Other Floor	0

ACT-Quiet-1_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Time		Percent		Btu/h	
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	0	0	0	0.0	0.0
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-59	0	-59	4.1	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	17	0	17	-1.2	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	9.8	0.0
Envelope Subtotal	-141	-42	0	-183	12.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,063	0	0	-1,063	73.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-200	0	-200	13.8	-1.4
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	0	0	0	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,204	-242	0	-1,446	100.0	

Fan Peak					
Peak Time (Mo/D/H:M): 9/21/15:00					
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0					
	Time		Percent		Related Area (ft²)
	Instant	Delay		of	
	Sensible	Sensible	Total	Total	
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-47	-47	-3.7	575
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-39	-39	-3.1	142
	0	0	0	0.0	0
	77	0	77	6.2	0
	77	-85	-8	-0.7	-
	274	468	741	59.4	130
	88	169	256	20.5	130
	-	-	-	-	-
	133	110	243	19.5	130
	495	746	1,241	99.4	-
	-	-	-	-	-
	0	20	20	1.6	142
			0	0.0	130
			0	0.0	0
	0	0	0	0.0	0
	-	-	-	-	-
	0	-4	-4	-0.3	-
	0	-	0	0.0	-
	0	-	0	0.0	-
	571	677	1,249	100.0	

Temperatures °F	
Supply	76.2
Return	70.0
Mixed Air	52.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	60
Ventilation	27
Infiltration	4
Min Stop / Reheat	60

Engineering Checks	
% OA	45.48
cfm/ft²	.46
Btu/h-ft²	-11.10
cfm/ton	-499.42
ft²/ton	-1,081.34
People	3
ft²/person	49.94

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	0
Door	0
Wall	0
Below-Grade Wall	0
Other Wall	0
Partition	575
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-2_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-95	0	0	-95	5.9	-12.2
Door	0	0	0	0	0.0	0.0
Wall	0	-71	0	-71	4.4	-1.5
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-64	0	-64	4.0	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	19	0	19	-1.2	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	8.8	-3.1
Envelope Subtotal	-236	-115	0	-352	21.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,065	0	0	-1,065	66.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-191	0	-191	11.9	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-2	0	-2	0.1	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,302	-308	0	-1,610	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 9/21/15:00				
Outside Air (DB/WB/HR): 98.4 / 64.2 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	(%)
	(Btu/h)	(Btu/h)	(Btu/h)	
	0	0	0	0.0
	0	0	0	0.0
	167	139	307	19.3
	0	0	0	0.0
	0	104	104	6.6
	0	0	0	0.0
	0	0	0	0.0
	0	-21	-21	-1.3
	0	0	0	0.0
	0	-51	-51	-3.2
	0	0	0	0.0
	77	0	77	4.9
	244	172	416	26.2
	274	471	746	47.0
	88	170	258	16.2
	-	-	-	-
	134	111	245	15.4
	496	752	1,248	78.7
	-	-	-	-
	0	-63	-63	-4.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-13	-13	-0.8
	0	-	0	0.0
	0	-	0	0.0
	740	847	1,586	100.0

Temperatures °F	
Supply	77.0
Return	70.0
Mixed Air	56.4
Fan Heat TD	0.0

Airflows cfm	
Main Fan	76
Ventilation	27
Infiltration	4
Min Stop / Reheat	76

Engineering Checks	
% OA	35.89
cfm/ft²	.59
Btu/h-ft²	-12.34
cfm/ton	-569.64
ft²/ton	-973.42
People	3
ft²/person	50.05

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	8
Door	0
Wall	48
Below-Grade Wall	0
Other Wall	48
Partition	528
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

ACT-Quiet-3_PSZ-HP-Activity

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	of	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	Total	ft²
					(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	0	0	0	0.0	0.0
Wall	0	-224	0	-224	13.8	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-18	0	-18	1.1	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	20	0	20	-1.2	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-142	0	0	-142	8.8	-1.2
Envelope Subtotal	-142	-222	0	-364	22.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,069	0	0	-1,069	66.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-187	0	-187	11.5	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-1	0	-1	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,211	-410	0	-1,621	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/19:00		
Outside Air (DB/WB/HR):		86.7 / 62.9 / 0.0		
	Time	Percent		Related
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	396	396	25.7
	0	0	0	0.0
	0	0	0	0.0
	0	-96	-96	-6.2
	0	0	0	0.0
	0	-38	-38	-2.4
	0	0	0	0.0
	40	0	40	2.6
	40	263	303	19.6
	275	469	744	48.2
	88	169	257	16.7
	-	-	-	-
	134	110	245	15.8
	498	748	1,246	80.7
	-	-	-	-
	0	2	2	0.1
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-6	-6	-0.4
	0	-	0	0.0
	0	-	0	0.0
	537	1,007	1,544	100.0

Temperatures	
	°F
Supply	77.2
Return	70.0
Mixed Air	56.0
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	74
Ventilation	28
Infiltration	4
Min Stop / Reheat	74

Engineering Checks	
% OA	37.04
cfm/ft²	.57
Btu/h-ft²	-12.37
cfm/ton	-550.20
ft²/ton	-970.40
People	3
ft²/person	50.04

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	143
Window	0
Door	0
Wall	128
Below-Grade Wall	0
Other Wall	128
Partition	449
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

Corridor-W_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-700	0	0	-700	32.8	-10.8
Door	0	0	0	0	0.0	0.0
Wall	0	-61	0	-61	2.9	-0.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-23	0	-23	1.1	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	52	0	52	-2.5	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-189	0	0	-189	8.9	-2.0
Envelope Subtotal	-889	-32	0	-921	43.2	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-755	0	0	-755	35.4	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-441	0	-441	20.7	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-13	0	-13	0.6	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,644	-487	0	-2,131	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/17:00				
Outside Air (DB/WB/HR): 94.5 / 65.4 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	2,095	1,861	3,956	95.8
	0	0	0	0.0
	0	101	101	2.5
	0	0	0	0.0
	0	0	0	0.0
	0	-382	-382	-9.2
	0	0	0	0.0
	0	0	0	0.0
	0	426	426	10.3
	0	0	0	0.0
	86	0	86	2.1
	2,181	2,007	4,188	101.4
	0	0	0	0.0
	197	356	553	13.4
	-	-	-	-
	0	0	0	0.0
	197	356	553	13.4
	-	-	-	-
	0	-512	-512	-12.4
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-98	-98	-2.4
	0	-	0	0.0
	0	-	0	0.0
	2,378	1,752	4,130	100.0

Temperatures °F	
Supply	76.7
Return	70.0
Mixed Air	66.3
Fan Heat TD	0.0

Airflows cfm	
Main Fan	199
Ventilation	19
Infiltration	5
Min Stop / Reheat	199

Engineering Checks	
% OA	9.77
cfm/ft²	.61
Btu/h-ft²	-6.58
cfm/ton	-1,120.44
ft²/ton	-1,824.02
People ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	349
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,108
Exterior Floor	0
Internal Floor	0
Slab	349
Other Floor	0

RB-W-North_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay	of			Btu/h
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-211	0	0	-211	14.5	-11.9
Door	0	0	0	0	0.0	0.0
Wall	0	-469	0	-469	32.2	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	60	0	60	-4.1	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	24	0	24	-1.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	9.6	-0.5
Envelope Subtotal	-352	-386	0	-737	50.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-555	0	0	-555	38.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-161	0	-161	11.1	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-4	0	-4	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-906	-551	0	-1,457	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		
	Instant	Delay	Total	Related
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	194	110	304	14.9
	0	0	0	0.0
	0	593	593	29.0
	0	0	0	0.0
	0	0	0	0.0
	0	-134	-134	-6.6
	0	0	0	0.0
	0	0	0	0.0
	0	-32	-32	-1.5
	0	0	0	0.0
	54	0	54	2.7
	248	537	785	38.4
	150	234	384	18.8
	74	141	216	10.5
	-	-	-	-
	354	436	790	38.7
	578	811	1,389	68.0
	-	-	-	-
	0	-113	-113	-5.5
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-19	-19	-0.9
	0	-	0	0.0
	1	-	1	0.0
	827	1,217	2,044	100.0

Temperatures	
	°F
Supply	77.8
Return	70.0
Mixed Air	65.2
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	113
Ventilation	14
Infiltration	4
Min Stop / Reheat	113

Engineering Checks	
% OA	12.63
cfm/ft²	.87
Btu/h-ft²	-11.24
cfm/ton	-930.57
ft²/ton	-1,068.43
People	1
ft²/person	99.82

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	142
Window	18
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-W-South_PSZ-HP-ResBed-W

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-665	0	0	-665	16.8	-12.5
Door	0	0	0	0	0.0	0.0
Wall	0	-846	0	-846	21.4	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	49	0	49	-1.3	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	65	0	65	-1.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-411	0	0	-411	10.4	-0.8
Envelope Subtotal	-1,076	-732	0	-1,808	45.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,622	0	0	-1,622	41.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-505	0	-505	12.8	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-13	0	-13	0.3	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-2,698	-1,250	0	-3,948	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/14:00		
Outside Air (DB/WB/HR):		89.8 / 58.2 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	1,342	1,666	3,008	45.1
	0	0	0	0.0
	0	1,017	1,017	15.2
	0	0	0	0.0
	0	0	0	0.0
	0	-418	-418	-6.3
	0	0	0	0.0
	0	0	0	0.0
	0	-203	-203	-3.0
	0	0	0	0.0
	143	0	143	2.1
	1,486	2,062	3,548	53.1
	438	590	1,029	15.4
	217	400	617	9.2
	-	-	-	-
	1,036	1,234	2,270	34.0
	1,691	2,225	3,916	58.7
	-	-	-	-
	0	-705	-705	-10.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-84	-84	-1.3
	0	-	0	0.0
	2	-	2	0.0
	3,179	3,497	6,676	100.0

Temperatures °F	
Supply	77.1
Return	70.0
Mixed Air	65.1
Fan Heat TD	0.0

Airflows cfm	
Main Fan	322
Ventilation	42
Infiltration	11
Min Stop / Reheat	322

Engineering Checks	
% OA	12.98
cfm/ft²	.85
Btu/h-ft²	-10.41
cfm/ton	-977.72
ft²/ton	-1,153.42
People	4
ft²/person	99.87

Areas ft²	
Roof	0
Other Roof	0
Ceiling	414
Window	53
Door	0
Wall	534
Below-Grade Wall	0
Other Wall	534
Partition	1,170
Exterior Floor	0
Internal Floor	0
Slab	414
Other Floor	0

Corridor-N_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-729	0	0	-729	28.7	-11.3
Door	0	0	0	0	0.0	0.0
Wall	0	-63	0	-63	2.5	-0.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-37	0	-37	1.4	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	64	0	64	-2.5	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-239	0	0	-239	9.4	-2.5
Envelope Subtotal	-967	-35	0	-1,002	39.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-953	0	0	-953	37.6	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-567	0	-567	22.3	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-15	0	-15	0.6	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,921	-616	0	-2,537	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	734	383	1,117	46.5
	0	0	0	0.0
	0	42	42	1.8
	0	0	0	0.0
	0	0	0	0.0
	0	313	313	13.1
	0	0	0	0.0
	0	11	11	0.4
	0	0	0	0.0
	92	0	92	3.8
	826	750	1,576	65.6
	0	0	0	0.0
	249	424	673	28.0
	-	-	-	-
	0	0	0	0.0
	249	424	673	28.0
	-	-	-	-
	0	169	169	7.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-17	-17	-0.7
	0	-	0	0.0
	0	-	0	0.0
	1,075	1,327	2,402	100.0

Temperatures °F	
Supply	83.3
Return	70.0
Mixed Air	62.0
Fan Heat TD	0.0

Airflows cfm	
Main Fan	116
Ventilation	25
Infiltration	6
Min Stop / Reheat	116

Engineering Checks	
% OA	21.21
cfm/ft²	.28
Btu/h-ft²	-6.21
cfm/ton	-547.35
ft²/ton	-1,934.84
People	
ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	439
Window	65
Door	0
Wall	100
Below-Grade Wall	0
Other Wall	100
Partition	1,360
Exterior Floor	0
Internal Floor	0
Slab	439
Other Floor	0

RB-N-Corner_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	of	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	Total	ft²
					(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-127	0	0	-127	9.0	-12.6
Door	0	0	0	0	0.0	0.0
Wall	0	-485	0	-485	34.4	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	45	0	45	-3.2	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	23	0	23	-1.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-141	0	0	-141	10.0	-0.5
Envelope Subtotal	-268	-417	0	-686	48.6	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-557	0	0	-557	39.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-164	0	-164	11.6	-1.2
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-826	-584	0	-1,410	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):			7/21/18:00	
Outside Air (DB/WB/HR):			91.4 / 64.4 / 0.0	
Time			Percent	
Instant	Delay	Total	of	Related
Sensible	Sensible	Sensible	Total	Area
(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
0	0	0	0.0	0
0	0	0	0.0	0
272	320	592	26.3	10
0	0	0	0.0	0
0	524	524	23.3	288
0	0	0	0.0	0
0	0	0	0.0	288
0	-146	-146	-6.5	288
0	0	0	0.0	0
0	0	0	0.0	0
0	-19	-19	-0.9	142
0	0	0	0.0	0
55	0	55	2.4	288
326	679	1,005	44.7	-
151	236	386	17.2	130
74	142	217	9.6	130
-	-	-	-	-
356	439	795	35.3	130
581	817	1,398	62.2	-
-	-	-	-	-
		0	0.0	0
0	-137	-137	-6.1	142
		0	0.0	130
		0	0.0	130
		0	0.0	0
0	0	0	0.0	0
-	-	-	-	-
0	-19	-19	-0.8	-
0	-	0	0.0	-
1	-	1	0.0	-
909	1,340	2,248	100.0	

Temperatures °F	
Supply	76.5
Return	70.0
Mixed Air	65.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	128
Ventilation	14
Infiltration	4
Min Stop / Reheat	128

Engineering Checks	
% OA	11.17
cfm/ft²	.99
Btu/h-ft²	-10.82
cfm/ton	-1,093.37
ft²/ton	-1,109.63
People	1
ft²/person	100.31

Areas ft²	
Roof	0
Other Roof	0
Ceiling	142
Window	10
Door	0
Wall	288
Below-Grade Wall	0
Other Wall	288
Partition	288
Exterior Floor	0
Internal Floor	0
Slab	142
Other Floor	0

RB-N-East_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M): 12/21/24:00						
Outside Air (DB/WB/HR): 32.1 / 21.8 / 0.0						
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible	Sensible	(Btu/h)	(Btu/h)	(%)	
	(Btu/h)	(Btu/h)				
Roof	0	-4	0	-4	0.1	-1.3
Other Roof	0	0	0	0	0.0	0.0
Glass	-257	0	0	-257	9.9	-12.7
Door	0	0	0	0	0.0	0.0
Wall	0	-692	0	-692	26.5	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	42	0	42	-1.6	0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	43	0	43	-1.7	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-278	0	0	-278	10.7	-0.7
Envelope Subtotal	-535	-610	0	-1,145	43.9	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,098	0	0	-1,098	42.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-357	0	-357	13.7	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-6	0	-6	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,634	-973	0	-2,607	100.0	

Fan Peak				
Peak Time (Mo/D/H:M): 7/21/10:00				
Outside Air (DB/WB/HR): 87.0 / 63.0 / 0.0				
	Instant	Time Delay	Total	Percent of Total
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	3	3	0.1
	0	0	0	0.0
	484	566	1,050	28.1
	0	0	0	0.0
	0	610	610	16.3
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-198	-198	-5.3
	0	0	0	0.0
	0	0	0	0.0
	0	-55	-55	-1.5
	0	0	0	0.0
	80	0	80	2.1
	564	925	1,489	39.8
	297	312	609	16.3
	147	235	382	10.2
	-	-	-	-
	702	724	1,426	38.1
	1,145	1,272	2,417	64.6
	-	-	-	-
	0	-136	-136	-3.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-32	-32	-0.9
	0	-	0	0.0
	2		2	0.0
	1,711	2,029	3,740	100.0

Temperatures °F	
Supply	77.3
Return	70.0
Mixed Air	64.7
Fan Heat TD	0.0

Airflows cfm	
Main Fan	202
Ventilation	28
Infiltration	7
Min Stop / Reheat	202

Engineering Checks	
% OA	13.98
cfm/ft²	.79
Btu/h-ft²	-10.15
cfm/ton	-931.07
ft²/ton	-1,183.01
People	3
ft²/person	100.01

Areas ft²	
Roof	3
Other Roof	3
Ceiling	278
Window	20
Door	0
Wall	412
Below-Grade Wall	0
Other Wall	412
Partition	733
Exterior Floor	0
Internal Floor	0
Slab	280
Other Floor	0

RB-N-West_PSZ-HP-ResBed-N

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	of	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	Total	ft²
					(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-398	0	0	-398	11.2	-13.1
Door	0	0	0	0	0.0	0.0
Wall	0	-605	0	-605	17.1	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-20	0	-20	0.6	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	60	0	60	-1.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-414	0	0	-414	11.7	-1.2
Envelope Subtotal	-813	-565	0	-1,377	38.8	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,635	0	0	-1,635	46.1	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-525	0	-525	14.8	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-9	0	-9	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-1	0	0	-1	0.0	-
Grand Total	-2,448	-1,098	0	-3,546	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		Related
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	802	976	1,779	28.6
	0	0	0	0.0
	0	1,079	1,079	17.3
	0	0	0	0.0
	0	0	0	0.0
	0	0	0	0.0
	0	-478	-478	-7.7
	0	0	0	0.0
	0	0	0	0.0
	0	-67	-67	-1.1
	0	0	0	0.0
	160	0	160	2.6
	962	1,510	2,472	39.7
	442	696	1,138	18.3
	218	420	639	10.3
	-	-	-	-
	1,044	1,295	2,339	37.6
	1,704	2,411	4,115	66.1
	-	-	-	-
	0	-307	-307	-4.9
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-56	-56	-0.9
	0	-	0	0.0
	3	-	3	0.0
	2,670	3,559	6,228	100.0

Temperatures	
	°F
Supply	75.4
Return	70.0
Mixed Air	65.4
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	348
Ventilation	42
Infiltration	11
Min Stop / Reheat	348

Engineering Checks	
% OA	12.11
cfm/ft²	.91
Btu/h-ft²	-9.28
cfm/ton	-1,176.16
ft²/ton	-1,294.39
People	4
ft²/person	99.88

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	417
Window	30
Door	0
Wall	374
Below-Grade Wall	0
Other Wall	374
Partition	1,338
Exterior Floor	0
Internal Floor	0
Slab	417
Other Floor	0

Corridor-S_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Instant	Time Delay	Latent	Total	Percent of Total	Btu/h per ft²
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-719	0	0	-719	28.5	-11.1
Door	0	0	0	0	0.0	0.0
Wall	0	-66	0	-66	2.6	-0.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-23	0	-23	0.9	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	65	0	65	-2.6	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-241	0	0	-241	9.6	-2.5
Envelope Subtotal	-961	-24	0	-985	39.0	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-965	0	0	-965	38.2	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-560	0	-560	22.2	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-14	0	-14	0.6	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-1,926	-599	0	-2,525	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		10/21/13:00		
Outside Air (DB/WB/HR):		88.4 / 57.7 / 0.0		
	Instant	Time Delay	Total	Percent of Total
	Sensible (Btu/h)	Sensible (Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	1,829	1,963	3,792	100.6
	0	0	0	0.0
	0	100	100	2.7
	0	0	0	0.0
	0	0	0	0.0
	0	-217	-217	-5.8
	0	0	0	0.0
	0	0	0	0.0
	0	58	58	1.5
	0	0	0	0.0
	77	0	77	2.0
	1,906	1,904	3,809	101.0
	0	0	0	0.0
	252	412	664	17.6
	-	-	-	-
	0	0	0	0.0
	252	412	664	17.6
	-	-	-	-
	0	-624	-624	-16.6
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-79	-79	-2.1
	0	-	0	0.0
	0	-	0	0.0
	2,158	1,613	3,771	100.0

Temperatures °F	
Supply	78.3
Return	70.0
Mixed Air	64.8
Fan Heat TD	0.0

Airflows cfm	
Main Fan	183
Ventilation	25
Infiltration	6
Min Stop / Reheat	183

Engineering Checks	
% OA	13.59
cfm/ft²	.44
Btu/h-ft²	-6.10
cfm/ton	-868.48
ft²/ton	-1,967.41
People ft²/person	.00

Areas ft²	
Roof	0
Other Roof	0
Ceiling	444
Window	65
Door	0
Wall	101
Below-Grade Wall	0
Other Wall	101
Partition	1,365
Exterior Floor	0
Internal Floor	0
Slab	444
Other Floor	0

RB-S-Corner-S_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay		of		
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-127	0	0	-127	9.0	-12.6
Door	0	0	0	0	0.0	0.0
Wall	0	-491	0	-491	34.6	-1.7
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	45	0	45	-3.2	0.2
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	23	0	23	-1.6	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-142	0	0	-142	10.0	-0.5
Envelope Subtotal	-269	-422	0	-692	48.7	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-561	0	0	-561	39.5	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-164	0	-164	11.6	-1.1
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-830	-589	0	-1,420	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		9/21/17:00		
Outside Air (DB/WB/HR):		94.1 / 62.8 / 0.0		
	Time	Percent		Related
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(ft²)
	0	0	0	0.0
	0	0	0	0.0
	280	292	573	24.1
	0	0	0	0.0
	0	712	712	30.0
	0	0	0	0.0
	0	0	0	0.0
	0	-149	-149	-6.3
	0	0	0	0.0
	0	0	0	0.0
	0	1	1	0.0
	0	0	0	0.0
	64	0	64	2.7
	344	856	1,200	50.5
	152	228	380	16.0
	75	143	218	9.2
	-	-	-	-
	358	440	798	33.6
	585	811	1,396	58.8
	-	-	-	-
	0	-200	-200	-8.4
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-20	-20	-0.8
	0	-	0	0.0
	-1	-	-1	-0.1
	927	1,448	2,375	100.0

Temperatures °F	
Supply	77.3
Return	70.0
Mixed Air	65.2
Fan Heat TD	0.0

Airflows cfm	
Main Fan	114
Ventilation	14
Infiltration	4
Min Stop / Reheat	114

Engineering Checks	
% OA	12.63
cfm/ft²	.87
Btu/h-ft²	-10.82
cfm/ton	-966.79
ft²/ton	-1,109.46
People	1
ft²/person	100.20

Areas ft²	
Roof	0
Other Roof	0
Ceiling	143
Window	10
Door	0
Wall	289
Below-Grade Wall	0
Other Wall	289
Partition	289
Exterior Floor	0
Internal Floor	0
Slab	143
Other Floor	0

RB-S-East_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent		Btu/h		
	Instant	Delay				
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-386	0	0	-386	11.4	-12.7
Door	0	0	0	0	0.0	0.0
Wall	0	-527	0	-527	15.6	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-8	0	-8	0.2	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	58	0	58	-1.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-403	0	0	-403	11.9	-1.3
Envelope Subtotal	-788	-477	0	-1,265	37.5	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-1,589	0	0	-1,589	47.0	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-515	0	-515	15.2	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-8	0	-8	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-2,378	-1,000	0	-3,378	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/10:00		
Outside Air (DB/WB/HR):		87.0 / 63.0 / 0.0		
	Time	Percent		Related Area
	Instant	Delay	Total	
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	720	801	1,521	28.9
	0	0	0	0.0
	0	659	659	12.5
	0	0	0	0.0
	0	0	0	0.0
	0	-282	-282	-5.4
	0	0	0	0.0
	0	0	0	0.0
	0	-64	-64	-1.2
	0	0	0	0.0
	115	0	115	2.2
	836	1,114	1,950	37.1
	430	461	890	16.9
	212	347	560	10.6
	-	-	-	-
	1,015	1,070	2,085	39.7
	1,657	1,878	3,535	67.3
	-	-	-	-
	0	-184	-184	-3.5
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-47	-47	-0.9
	0	-	0	0.0
	2	-	2	0.0
	2,495	2,761	5,255	100.0

Temperatures °F	
Supply	76.2
Return	70.0
Mixed Air	64.5
Fan Heat TD	0.0

Airflows cfm	
Main Fan	282
Ventilation	41
Infiltration	10
Min Stop / Reheat	282

Engineering Checks	
% OA	14.51
cfm/ft²	.76
Btu/h-ft²	-9.09
cfm/ton	-1,002.06
ft²/ton	-1,321.19
People	4
ft²/person	99.97

Areas ft²	
Roof	0
Other Roof	0
Ceiling	406
Window	30
Door	0
Wall	328
Below-Grade Wall	0
Other Wall	328
Partition	1,359
Exterior Floor	0
Internal Floor	0
Slab	406
Other Floor	0

RB-S-West_PSZ-HP-ResBed-S

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/24:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent			Btu/h	
	Instant	Delay	Latent	Total	of	per
	Sensible	Sensible	(Btu/h)	(Btu/h)	Total	ft²
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	
Roof	0	0	0	0	0.0	0.0
Other Roof	0	0	0	0	0.0	0.0
Glass	-129	0	0	-129	11.1	-12.7
Door	0	0	0	0	0.0	0.0
Wall	0	-198	0	-198	17.1	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-11	0	-11	1.0	0.0
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	20	0	20	-1.7	0.1
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-134	0	0	-134	11.6	-1.2
Envelope Subtotal	-263	-189	0	-452	39.1	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	0	0	0	0	0.0	0.0
Internal Subtotal	0	0	0	0	0.0	-
Ventilation	-530	0	0	-530	45.8	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	-171	0	-171	14.8	-1.3
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-3	0	-3	0.2	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	0	0	0	0	0.0	-
Grand Total	-793	-363	0	-1,156	100.0	

Fan Peak				
Peak Time (Mo/D/H:M):		7/21/18:00		
Outside Air (DB/WB/HR):		91.4 / 64.4 / 0.0		
	Time	Percent		
	Instant	Delay	Total	of
	Sensible	Sensible	Sensible	Total
	(Btu/h)	(Btu/h)	(Btu/h)	(%)
	0	0	0	0.0
	0	0	0	0.0
	273	325	598	29.7
	0	0	0	0.0
	0	353	353	17.5
	0	0	0	0.0
	0	0	0	0.0
	0	-188	-188	-9.4
	0	0	0	0.0
	0	-22	-22	-1.1
	0	0	0	0.0
	52	0	52	2.6
	325	468	793	39.4
	143	227	370	18.4
	71	137	208	10.3
	-	-	-	-
	338	423	761	37.8
	552	787	1,340	66.5
	-	-	-	-
	0	-100	-100	-5.0
			0	0.0
			0	0.0
			0	0.0
	0	0	0	0.0
	-	-	-	-
	0	-19	-19	-0.9
	0	-	0	0.0
	1	-	1	0.0
	878	1,136	2,014	100.0

Temperatures	
	°F
Supply	75.4
Return	70.0
Mixed Air	65.4
Fan Heat TD	0.0

Airflows	
	cfm
Main Fan	112
Ventilation	14
Infiltration	3
Min Stop / Reheat	112

Engineering Checks	
% OA	12.14
cfm/ft²	.91
Btu/h-ft²	-9.33
cfm/ton	-1,166.91
ft²/ton	-1,287.45
People	1
ft²/person	99.98

Areas	
	ft²
Roof	0
Other Roof	0
Ceiling	135
Window	10
Door	0
Wall	122
Below-Grade Wall	0
Other Wall	122
Partition	441
Exterior Floor	0
Internal Floor	0
Slab	135
Other Floor	0

System Heating Checksums

Kitchen_Single Zone CV

Coil Peak						
Peak Time (Mo/D/H:M):		12/21/04:00				
Outside Air (DB/WB/HR):		32.1 / 21.8 / 0.0				
	Time	Percent				
	Instant	Delay		of	Btu/h	
	Sensible	Sensible	Latent	Total	Total	per
	(Btu/h)	(Btu/h)	(Btu/h)	(Btu/h)	(%)	ft²
Roof	0	-760	0	-760	0.5	-1.0
Other Roof	0	0	0	0	0.0	0.0
Glass	0	0	0	0	0.0	0.0
Door	0	-966	0	-966	0.6	-19.7
Wall	0	-964	0	-964	0.6	-1.6
Below-Grade Wall	0	0	0	0	0.0	0.0
Other Wall	0	0	0	0	0.0	0.0
Partition	0	-201	0	-201	0.1	-0.1
Exterior Floor	0	0	0	0	0.0	0.0
Interior Floor	0	0	0	0	0.0	0.0
Slab	0	163	0	163	-0.1	0.2
Other Floor	0	0	0	0	0.0	0.0
Infiltration	-742	0	0	-742	0.5	-1.3
Envelope Subtotal	-742	-2,729	0	-3,471	2.1	-
People	0	0	0	0	0.0	0.0
Lights	0	0	0	0	0.0	0.0
RA Sensible (Lights)	0	0	0	0	0.0	0.0
Miscellaneous Loads	13	0	0	13	0.0	0.0
Internal Subtotal	13	0	0	13	0.0	-
Ventilation	-97,049	0	0	-97,049	59.9	-
DOAS Direct to Zone	0	0	0	0	0.0	-
Ceiling	0	0	0	0	0.0	0.0
Refrigeration	0	0	0	0	0.0	0.0
Service Water	0	0	0	0	0.0	0.0
HVAC Equipment Losses	0	0	0	0	0.0	0.0
Adj Air Transfer Heat	0	0	0	0	0.0	0.0
Supply Fan Heat	0	0	0	0	0.0	-
Time Delay Correction	0	-26	0	-26	0.0	-
Sizing Factor Correction	0	-	0	0	0.0	-
Over/Undersizing	-61,363	0	0	-61,363	37.9	-
Grand Total	-159,142	-2,755	0	-161,897	100.0	

Fan Peak					
Peak Time (Mo/D/H:M):		9/21/16:00			
Outside Air (DB/WB/HR):		96.5 / 63.6 / 0.0			
	Time	Percent			
	Instant	Delay	Total	of	Related
	Sensible	Sensible	Sensible	Total	Area
	(Btu/h)	(Btu/h)	(Btu/h)	(%)	(ft²)
	0	1,093	1,093	3.8	726
	0	0	0	0.0	726
	0	0	0	0.0	0
	0	1,174	1,174	4.1	49
	0	1,236	1,236	4.3	607
	0	0	0	0.0	0
	0	0	0	0.0	607
	0	-1,408	-1,408	-4.9	1,346
	0	0	0	0.0	0
	0	0	0	0.0	0
	0	-380	-380	-1.3	726
	0	0	0	0.0	0
	373	0	373	1.3	607
	373	1,716	2,089	7.3	-
	1,375	1,908	3,283	11.4	686
	365	571	936	3.3	686
	-	-	-	-	-
	13,333	8,907	22,240	77.5	686
	15,073	11,385	26,459	92.1	-
	-	-	-	-	-
	0	0	0	0.0	0
			0	0.0	686
			0	0.0	686
	0	0	0	0.0	0
	-	-	-	-	-
	0	-49	-49	-0.2	-
	0	-	0	0.0	-
	216	-	216	0.8	-
	15,663	13,052	28,715	100.0	


Temperatures °F	
Supply	95.0
Return	70.0
Mixed Air	32.6
Fan Heat TD	0.0

Airflows cfm	
Main Fan	2,532
Ventilation	2,500
Infiltration	19
Min Stop / Reheat	2,532

Engineering Checks	
% OA	98.75
cfm/ft²	3.69
Btu/h-ft²	-236.33
cfm/ton	-187.67
ft²/ton	-50.81
People	13
ft²/person	52.37

Areas ft²	
Roof	726
Other Roof	726
Ceiling	0
Window	0
Door	49
Wall	607
Below-Grade Wall	0
Other Wall	607
Partition	1,346
Exterior Floor	0
Internal Floor	0
Slab	726
Other Floor	0

Envelope Summary

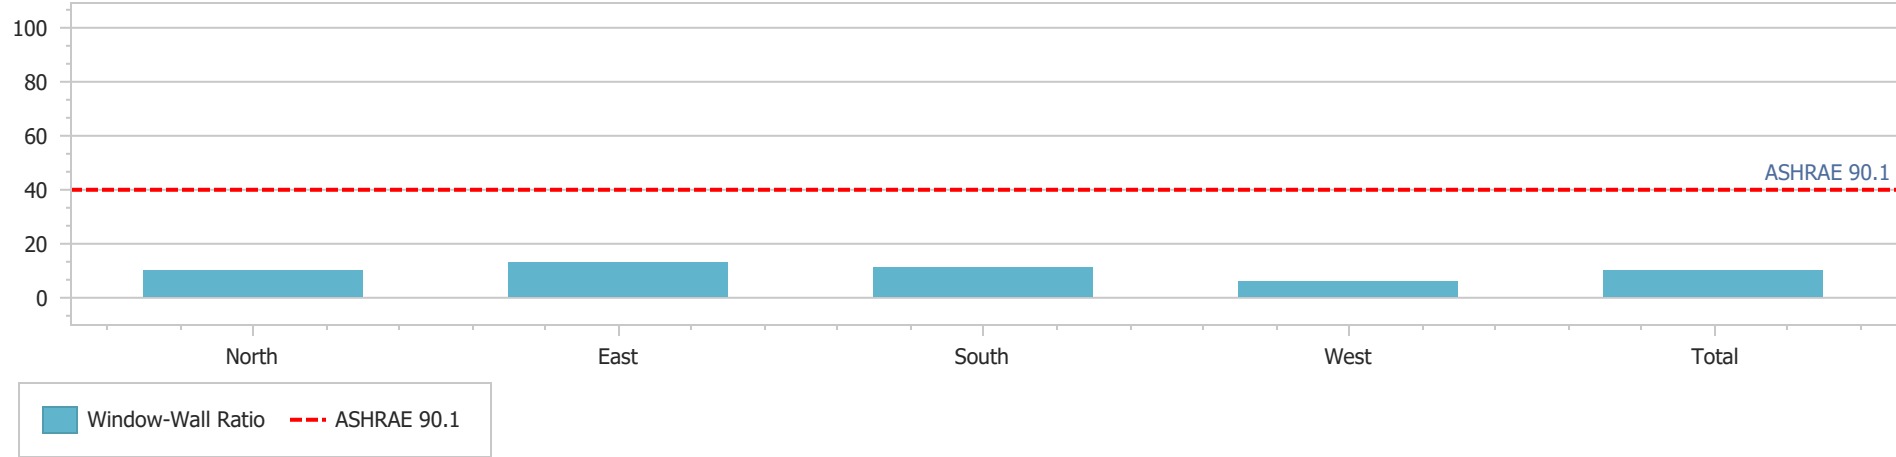

	North	East	South	West	Total
Gross Window-Wall Ratio	9.77	12.82	10.99	5.92	9.84

Ratios

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	9.77	12.82	10.99	5.92	9.84
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	9.77	12.82	10.99	5.92	9.84
Window Opening Area	ft²	266	340	372	176	1,154
Gross Roof Area	ft²	0	0	0	0	15,695
Skylight Area	ft²	0	0	0	0	0
Skylight-Roof Ratio	%	0	0	0	0	0

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 05-05	T24-2022 Cz10 Roof	0.3	87	0.034	0.035	180°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 07-07	T24-2022 Cz10 Roof	0.3	205	0.034	0.035	180°	0 °	
Roof 08-08	T24-2022 Cz10 Roof	0.3	193	0.034	0.035	180°	0 °	
Roof 09-09	T24-2022 Cz10 Roof	0.3	88	0.034	0.035	180°	0 °	
Roof 100-14	T24-2022 Cz10 Roof	0.3	65	0.034	0.035	180°	0 °	
Roof 10-10	T24-2022 Cz10 Roof	0.3	93	0.034	0.035	180°	0 °	
Roof 101-13	T24-2022 Cz10 Roof	0.3	111	0.034	0.035	180°	0 °	
Roof 102-68	T24-2022 Cz10 Roof	0.3	318	0.034	0.035	180°	0 °	
Roof 103-16	T24-2022 Cz10 Roof	0.3	141	0.034	0.035	180°	0 °	
Roof 104-17	T24-2022 Cz10 Roof	0.3	133	0.034	0.035	180°	0 °	
Roof 105-18	T24-2022 Cz10 Roof	0.3	113	0.034	0.035	180°	0 °	
Roof 106-19	T24-2022 Cz10 Roof	0.3	107	0.034	0.035	180°	0 °	
Roof 107-26	T24-2022 Cz10 Roof	0.3	70	0.034	0.035	180°	0 °	
Roof 108-27	T24-2022 Cz10 Roof	0.3	70	0.034	0.035	180°	0 °	
Roof 109-70	T24-2022 Cz10 Roof	0.3	516	0.034	0.035	180°	0 °	
Roof 110-28	T24-2022 Cz10 Roof	0.3	21	0.034	0.035	180°	0 °	
Roof 111-11	T24-2022 Cz10 Roof	0.3	90	0.034	0.035	180°	0 °	
Roof 112-12	T24-2022 Cz10 Roof	0.3	134	0.034	0.035	180°	0 °	
Roof 113-06	T24-2022 Cz10 Roof	0.3	169	0.034	0.035	180°	0 °	
Roof 114-02	T24-2022 Cz10 Roof	0.3	53	0.034	0.035	180°	0 °	
Roof 115-67	T24-2022 Cz10 Roof	0.3	56	0.034	0.035	180°	0 °	
Roof 116-01	T24-2022 Cz10 Roof	0.3	129	0.034	0.035	270°	0 °	
Roof 117-20	T24-2022 Cz10 Roof	0.3	124	0.034	0.035	270°	0 °	
Roof 118-69	T24-2022 Cz10 Roof	0.3	19	0.034	0.035	263.33°	0 °	
Roof 119-21	T24-2022 Cz10 Roof	0.3	266	0.034	0.035	180°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 120-22	T24-2022 Cz10 Roof	0.3	146	0.034	0.035	180°	0 °	
Roof 121-23	T24-2022 Cz10 Roof	0.3	53	0.034	0.035	180°	0 °	
Roof 122-24	T24-2022 Cz10 Roof	0.3	98	0.034	0.035	180°	0 °	
Roof 123-25	T24-2022 Cz10 Roof	0.3	99	0.034	0.035	270°	0 °	
Roof 124-43	T24-2022 Cz10 Roof	0.3	80	0.034	0.035	224.96°	0 °	
Roof 125-04	T24-2022 Cz10 Roof	0.3	119	0.034	0.035	180°	0 °	
Roof 126-03	T24-2022 Cz10 Roof	0.3	62	0.034	0.035	180°	0 °	
Roof 128-00	T24-2022 Cz10 Roof	0.3	175	0.034	0.035	90°	18 °	
Roof 129-00	T24-2022 Cz10 Roof	0.3	177	0.034	0.035	0°	18 °	
Roof 130-00	T24-2022 Cz10 Roof	0.3	175	0.034	0.035	270°	18 °	
Roof 131-00	T24-2022 Cz10 Roof	0.3	177	0.034	0.035	180°	18 °	
Roof 134-10	T24-2022 Cz10 Roof	0.3	862	0.034	0.035	90°	21 °	
Roof 136-12	T24-2022 Cz10 Roof	0.3	792	0.034	0.035	90°	26 °	
Roof 137-80	T24-2022 Cz10 Roof	0.3	6	0.034	0.035	270°	0 °	
Roof 138-81	T24-2022 Cz10 Roof	0.3	4	0.034	0.035	180°	0 °	
Roof 38-38	T24-2022 Cz10 Roof	0.3	170	0.034	0.035	180°	0 °	
Roof 62-62	T24-2022 Cz10 Roof	0.3	1	0.034	0.035	270°	0 °	
Roof 63-63	T24-2022 Cz10 Roof	0.3	1	0.034	0.035	180°	0 °	
Roof 64-64	T24-2022 Cz10 Roof	0.3	1	0.034	0.035	180°	0 °	
Roof 65-65	T24-2022 Cz10 Roof	0.3	1	0.034	0.035	180°	0 °	
Roof 80-00	T24-2022 Cz10 Roof	0.3	702	0.034	0.035	358.52°	19 °	
Roof 81-01	T24-2022 Cz10 Roof	0.3	815	0.034	0.035	180°	18 °	
Roof 83-03	T24-2022 Cz10 Roof	0.3	1,095	0.034	0.035	270°	18 °	
Roof 84-04	T24-2022 Cz10 Roof	0.3	1,058	0.034	0.035	90°	20 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 86-06	T24-2022 Cz10 Roof	0.3	1,096	0.034	0.035	270°	17 °	
Roof 88-08	T24-2022 Cz10 Roof	0.3	1,766	0.034	0.035	360°	22 °	
Roof 90-31	T24-2022 Cz10 Roof	0.3	105	0.034	0.035	180°	0 °	
Roof 91-71	T24-2022 Cz10 Roof	0.3	968	0.034	0.035	180°	0 °	
Roof 92-32	T24-2022 Cz10 Roof	0.3	104	0.034	0.035	180°	0 °	
Roof 93-33	T24-2022 Cz10 Roof	0.3	212	0.034	0.035	180°	0 °	
Roof 94-34	T24-2022 Cz10 Roof	0.3	110	0.034	0.035	180°	0 °	
Roof 95-39	T24-2022 Cz10 Roof	0.3	107	0.034	0.035	180°	0 °	
Roof 96-35	T24-2022 Cz10 Roof	0.3	402	0.034	0.035	180°	0 °	
Roof 97-36	T24-2022 Cz10 Roof	0.3	323	0.034	0.035	180°	0 °	
Roof 98-37	T24-2022 Cz10 Roof	0.3	85	0.034	0.035	180°	0 °	
Roof 99-15	T24-2022 Cz10 Roof	0.3	171	0.034	0.035	180°	0 °	
SLAB 01_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	262	0.029	0.03		180 °	
SLAB 02_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	76	0.029	0.03		180 °	
SLAB 03_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	89	0.029	0.03		180 °	
SLAB 04_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	171	0.029	0.03		180 °	
SLAB 05_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	87	0.029	0.03		180 °	
SLAB 06_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	169	0.029	0.03		180 °	
SLAB 07_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	205	0.029	0.03		180 °	
SLAB 08_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	193	0.029	0.03		180 °	
SLAB 09_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	88	0.029	0.03		180 °	
SLAB 10_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	93	0.029	0.03		180 °	
SLAB 11_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	90	0.029	0.03		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 12_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	134	0.029	0.03		180 °	
SLAB 128_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	893	0.038	0.04		180 °	
SLAB 13_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	111	0.029	0.03		180 °	
SLAB 14_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	65	0.029	0.03		180 °	
SLAB 15_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	171	0.029	0.03		180 °	
SLAB 16_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	141	0.029	0.03		180 °	
SLAB 17_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	133	0.029	0.03		180 °	
SLAB 18_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	113	0.029	0.03		180 °	
SLAB 182_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	13	0.038	0.04		180 °	
SLAB 185_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	162	0.038	0.04		180 °	
SLAB 187_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	11	0.029	0.03		180 °	
SLAB 188_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	79	0.038	0.04		180 °	
SLAB 19_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	107	0.029	0.03		180 °	
SLAB 190_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	6	0.029	0.03		180 °	
SLAB 20_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	244	0.029	0.03		180 °	
SLAB 21_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	508	0.029	0.03		180 °	
SLAB 22_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	294	0.029	0.03		180 °	
SLAB 23_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	60	0.029	0.03		180 °	
SLAB 24_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	110	0.029	0.03		180 °	
SLAB 25_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	112	0.029	0.03		180 °	
SLAB 26_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	70	0.029	0.03		180 °	
SLAB 27_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	70	0.029	0.03		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 28_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	214	0.029	0.03		180 °	
SLAB 29_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	142	0.029	0.03		180 °	
SLAB 30_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	135	0.029	0.03		180 °	
SLAB 31_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	105	0.029	0.03		180 °	
SLAB 32_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	104	0.029	0.03		180 °	
SLAB 33_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	212	0.029	0.03		180 °	
SLAB 34_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	110	0.029	0.03		180 °	
SLAB 35_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	402	0.029	0.03		180 °	
SLAB 36_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	323	0.029	0.03		180 °	
SLAB 37_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	85	0.029	0.03		180 °	
SLAB 38_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	170	0.029	0.03		180 °	
SLAB 39_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	107	0.029	0.03		180 °	
SLAB 40_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	123	0.029	0.03		180 °	
SLAB 41_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	148	0.029	0.03		180 °	
SLAB 42_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	141	0.029	0.03		180 °	
SLAB 43_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	91	0.029	0.03		180 °	
SLAB 44_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	193	0.029	0.03		180 °	
SLAB 45_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	114	0.029	0.03		180 °	
SLAB 46_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	115	0.029	0.03		180 °	
SLAB 47_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	135	0.029	0.03		180 °	
SLAB 48_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	143	0.029	0.03		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 49_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	142	0.029	0.03		180 °	
SLAB 50_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	137	0.029	0.03		180 °	
SLAB 51_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	138	0.029	0.03		180 °	
SLAB 52_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	140	0.029	0.03		180 °	
SLAB 53_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	142	0.029	0.03		180 °	
SLAB 54_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	114	0.029	0.03		180 °	
SLAB 55_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	114	0.029	0.03		180 °	
SLAB 56_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	195	0.029	0.03		180 °	
SLAB 57_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	143	0.029	0.03		180 °	
SLAB 58_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	141	0.029	0.03		180 °	
SLAB 59_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	138	0.029	0.03		180 °	
SLAB 60_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	138	0.029	0.03		180 °	
SLAB 61_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	142	0.029	0.03		180 °	
SLAB 62_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	142	0.029	0.03		180 °	
SLAB 63_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	138	0.029	0.03		180 °	
SLAB 64_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	114	0.029	0.03		180 °	
SLAB 65_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	111	0.029	0.03		180 °	
SLAB 66_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	196	0.029	0.03		180 °	
SLAB 67_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	396	0.029	0.03		180 °	
SLAB 68_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	318	0.029	0.03		180 °	
SLAB 69_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	19	0.029	0.03		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 70_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	686	0.029	0.03		180 °	
SLAB 71_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	968	0.029	0.03		180 °	
SLAB 72_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	444	0.029	0.03		180 °	
SLAB 73_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	349	0.029	0.03		180 °	
SLAB 74_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	439	0.029	0.03		180 °	
SLAB 81_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	96	0.029	0.03		180 °	
SLAB 82_0	90.1-13 Min Slab On Grade Unheated Floor, R-15 For 24 In., Zone 4-5_0	1	469	0.029	0.03		180 °	
WALL 101-Servery_0	T24 2022 - Ext Wall - Wood Framed	0.3	160	0.046	0.048	0°	90 °	N
WALL 106-Multipurpose/Dining_0	T24 2022 - Ext Wall - Wood Framed	0.3	322	0.046	0.048	0°	90 °	N
WALL 111-Group_0	T24 2022 - Ext Wall - Wood Framed	0.3	202	0.046	0.048	0°	90 °	N
WALL 112-Group_0	T24 2022 - Ext Wall - Wood Framed	0.3	93	0.046	0.048	270°	90 °	W
WALL 116-Storage_0	T24 2022 - Ext Wall - Wood Framed	0.3	32	0.046	0.048	0°	90 °	N
WALL 119-Consult 1_0	T24 2022 - Ext Wall - Wood Framed	0.3	115	0.046	0.048	0°	90 °	N
WALL 122-Consult 2_0	T24 2022 - Ext Wall - Wood Framed	0.3	117	0.046	0.048	0°	90 °	N
WALL 13-Hospitality_0	T24 2022 - Ext Wall - Wood Framed	0.3	164	0.046	0.048	0°	90 °	N
WALL 142-Resident Room 01_0	T24 2022 - Ext Wall - Wood Framed	0.3	80	0.046	0.048	90°	90 °	E
WALL 147-Office 2_0	T24 2022 - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 151-Office 1_0	T24 2022 - Ext Wall - Wood Framed	0.3	107	0.046	0.048	180°	90 °	S
WALL 155-Lounge_0	T24 2022 - Ext Wall - Wood Framed	0.3	218	0.046	0.048	180°	90 °	S
WALL 164-Shower 2_0	T24 2022 - Ext Wall - Wood Framed	0.3	32	0.046	0.048	180°	90 °	S
WALL 170-Kitchen_0	T24 2022 - Ext Wall - Wood Framed	0.3	218	0.046	0.048	270°	90 °	W
WALL 172-Service_0	T24 2022 - Ext Wall - Wood Framed	0.3	149	0.046	0.048	180°	90 °	S
WALL 176-Service_0	T24 2022 - Ext Wall - Wood Framed	0.3	241	0.046	0.048	270°	90 °	W

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 179-Unconditioned Room Trash _0	T24 2022 - Ext Wall - Wood Framed	0.3	96	0.046	0.048	180°	90 °	S
WALL 195-Resident Room 02 _0	T24 2022 - Ext Wall - Wood Framed	0.3	112	0.046	0.048	90°	90 °	E
WALL 199-Resident Room 03 _0	T24 2022 - Ext Wall - Wood Framed	0.3	136	0.046	0.048	90°	90 °	E
WALL 202-Resident Room 04 _0	T24 2022 - Ext Wall - Wood Framed	0.3	157	0.046	0.048	180°	90 °	S
WALL 203-Resident Room 04 _0	T24 2022 - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 208-Comfort Room 2 _0	T24 2022 - Ext Wall - Wood Framed	0.3	103	0.046	0.048	0°	90 °	N
WALL 20-Shower 1 _0	T24 2022 - Ext Wall - Wood Framed	0.3	37	0.046	0.048	90°	90 °	E
WALL 213-Noisy Activity 1 _0	T24 2022 - Ext Wall - Wood Framed	0.3	174	0.046	0.048	270°	90 °	W
WALL 217-Shower 4 _0	T24 2022 - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 221-Shower 3 _0	T24 2022 - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 225-Resident Room 06 _0	T24 2022 - Ext Wall - Wood Framed	0.3	122	0.046	0.048	270°	90 °	W
WALL 227-Resident Room 05 _0	T24 2022 - Ext Wall - Wood Framed	0.3	160	0.046	0.048	180°	90 °	S
WALL 229-Resident Room 05 _0	T24 2022 - Ext Wall - Wood Framed	0.3	129	0.046	0.048	270°	90 °	W
WALL 232-Quiet Activity 2 _0	T24 2022 - Ext Wall - Wood Framed	0.3	48	0.046	0.048	180°	90 °	S
WALL 236-Resident Room 07 _0	T24 2022 - Ext Wall - Wood Framed	0.3	124	0.046	0.048	180°	90 °	S
WALL 239-Resident Room 08 _0	T24 2022 - Ext Wall - Wood Framed	0.3	125	0.046	0.048	180°	90 °	S
WALL 242-Resident Room 09 _0	T24 2022 - Ext Wall - Wood Framed	0.3	126	0.046	0.048	180°	90 °	S
WALL 244-Resident Room 09 _0	T24 2022 - Ext Wall - Wood Framed	0.3	159	0.046	0.048	270°	90 °	W
WALL 247-Resident Room 10 _0	T24 2022 - Ext Wall - Wood Framed	0.3	126	0.046	0.048	0°	90 °	N
WALL 248-Resident Room 10 _0	T24 2022 - Ext Wall - Wood Framed	0.3	161	0.046	0.048	270°	90 °	W
WALL 252-Shower 5 _0	T24 2022 - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 256-Shower 6 _0	T24 2022 - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 260-Noisy Activity 2 _0	T24 2022 - Ext Wall - Wood Framed	0.3	92	0.046	0.048	0°	90 °	N
WALL 265-Quiet Activity 3 _0	T24 2022 - Ext Wall - Wood Framed	0.3	128	0.046	0.048	270°	90 °	W

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 269-Resident Room 11 _0	T24 2022 - Ext Wall - Wood Framed	0.3	126	0.046	0.048	270°	90 °	W
WALL 26-Interview Room _0	T24 2022 - Ext Wall - Wood Framed	0.3	183	0.046	0.048	90°	90 °	E
WALL 273-Resident Room 12 _0	T24 2022 - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 277-Resident Room 13 _0	T24 2022 - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 280-Resident Room 14 _0	T24 2022 - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 281-Resident Room 14 _0	T24 2022 - Ext Wall - Wood Framed	0.3	127	0.046	0.048	270°	90 °	W
WALL 283-Resident Room 15 _0	T24 2022 - Ext Wall - Wood Framed	0.3	127	0.046	0.048	90°	90 °	E
WALL 284-Resident Room 15 _0	T24 2022 - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 288-Resident Room 16 _0	T24 2022 - Ext Wall - Wood Framed	0.3	124	0.046	0.048	90°	90 °	E
WALL 292-Shower 7 _0	T24 2022 - Ext Wall - Wood Framed	0.3	102	0.046	0.048	90°	90 °	E
WALL 296-Shower 8 _0	T24 2022 - Ext Wall - Wood Framed	0.3	100	0.046	0.048	90°	90 °	E
WALL 301-Noisy Activity 3 _0	T24 2022 - Ext Wall - Wood Framed	0.3	161	0.046	0.048	90.55°	90 °	E
WALL 306-Hospitality _0	T24 2022 - Ext Wall - Wood Framed	0.3	96	0.046	0.048	90°	90 °	E
WALL 311-Entry/Waiting _0	T24 2022 - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 312-Entry/Waiting _0	T24 2022 - Ext Wall - Wood Framed	0.3	381	0.046	0.048	90°	90 °	E
WALL 313-Entry/Waiting _0	T24 2022 - Ext Wall - Wood Framed	0.3	136	0.046	0.048	0°	90 °	N
WALL 390-Staff Corridor _0	T24 2022 - Ext Wall - Wood Framed	0.3	77	0.046	0.048	180°	90 °	S
WALL 402-Corridor 5 _0	T24 2022 - Ext Wall - Wood Framed	0.3	101	0.046	0.048	180°	90 °	S
WALL 40-Electric _0	T24 2022 - Ext Wall - Wood Framed	0.3	230	0.046	0.048	180°	90 °	S
WALL 412-Corridor 4 _0	T24 2022 - Ext Wall - Wood Framed	0.3	100	0.046	0.048	270°	90 °	W
WALL 424-Corridor 3 _0	T24 2022 - Ext Wall - Wood Framed	0.3	100	0.046	0.048	0°	90 °	N
WALL 566-Unconditioned Room Room 01-00 _12	T24 2022 - Ext Wall - Wood Framed	0.3	6	0.046	0.048	0°	90 °	N
WALL 567-Unconditioned Room Room 01-00 _12	T24 2022 - Ext Wall - Wood Framed	0.3	45	0.046	0.048	270°	90 °	W
WALL 572-Unconditioned Room Room 01-01 _12	T24 2022 - Ext Wall - Wood Framed	0.3	57	0.046	0.048	270°	90 °	W

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 584-Unconditioned Room Room 01-03 _12	T24 2022 - Ext Wall - Wood Framed	0.3	54	0.046	0.048	180°	90 °	S
WALL 589-Unconditioned Room Room 01-04 _12	T24 2022 - Ext Wall - Wood Framed	0.3	51	0.046	0.048	180°	90 °	S
WALL 612-Unconditioned Room Room 01-06 _12	T24 2022 - Ext Wall - Wood Framed	0.3	57	0.046	0.048	0°	90 °	N
WALL 654-Unconditioned Room Room 01-04 _12	T24 2022 - Ext Wall - Wood Framed	0.3	1	0.046	0.048	0°	90 °	N
WALL 726-Attrium 2 _18	T24 2022 - Ext Wall - Wood Framed	0.3	179	0.046	0.048	180°	90 °	S
WALL 727-Attrium 2 _18	T24 2022 - Ext Wall - Wood Framed	0.3	178	0.046	0.048	90°	90 °	E
WALL 728-Attrium 2 _18	T24 2022 - Ext Wall - Wood Framed	0.3	179	0.046	0.048	0°	90 °	N
WALL 729-Attrium 2 _18	T24 2022 - Ext Wall - Wood Framed	0.3	178	0.046	0.048	270°	90 °	W
WALL 730-Unconditioned Room Room 01-06 _12.6420052252	T24 2022 - Ext Wall - Wood Framed	0.3	0	0.046	0.048	202.72°	90 °	S
WALL 731-Unconditioned Room Room 01-06 _12.7919128827	T24 2022 - Ext Wall - Wood Framed	0.3	2	0.046	0.048	199.12°	90 °	S
WALL 733-Unconditioned Room Room 01-00 _12	T24 2022 - Ext Wall - Wood Framed	0.3	0	0.046	0.048	22.72°	90 °	N
WALL 736-Unconditioned Room Room 01-03 _13.108842849	T24 2022 - Ext Wall - Wood Framed	0.3	1	0.046	0.048	316.46°	90 °	N
WALL 738-Unconditioned Room Room 01-03 _12	T24 2022 - Ext Wall - Wood Framed	0.3	0	0.046	0.048	316.54°	90 °	N
WALL 757-Attrium _13.2899728863	T24 2022 - Ext Wall - Wood Framed	0.3	32	0.046	0.048	270°	90 °	W
WALL 758-Attrium _14.0210136804	T24 2022 - Ext Wall - Wood Framed	0.3	25	0.046	0.048	270°	90 °	W
WALL 760-Attrium _14.2564019478	T24 2022 - Ext Wall - Wood Framed	0.3	21	0.046	0.048	180°	90 °	S
WALL 761-Attrium _12.7378807681	T24 2022 - Ext Wall - Wood Framed	0.3	39	0.046	0.048	180°	90 °	S
WALL 762-Attrium _12	T24 2022 - Ext Wall - Wood Framed	0.3	156	0.046	0.048	90°	90 °	E
WALL 764-Attrium _14.1335978361	T24 2022 - Ext Wall - Wood Framed	0.3	24	0.046	0.048	0°	90 °	N
WALL 771-Attrium _12.8311965203	T24 2022 - Ext Wall - Wood Framed	0.3	35	0.046	0.048	0°	90 °	N
WALL 773-Unconditioned Room Room 01-08 _13.7195611268	T24 2022 - Ext Wall - Wood Framed	0.3	22	0.046	0.048	270°	90 °	W
WALL 777-Unconditioned Room Room 01-08 _12	T24 2022 - Ext Wall - Wood Framed	0.3	626	0.046	0.048	180°	90 °	S
WALL 780-Unconditioned Room Room 01-10 _12	T24 2022 - Ext Wall - Wood Framed	0.3	1	0.046	0.048	179.55°	90 °	S
WALL 781-Unconditioned Room Room 01-10 _12	T24 2022 - Ext Wall - Wood Framed	0.3	4	0.046	0.048	90°	90 °	E

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 782-Unconditioned Room Room 01-10 _12	T24 2022 - Ext Wall - Wood Framed	0.3	4	0.046	0.048	180°	90 °	S
WALL 783-Unconditioned Room Room 01-10 _12	T24 2022 - Ext Wall - Wood Framed	0.3	48	0.046	0.048	0°	90 °	N
WALL 799-Unconditioned Room Room 01-12 _12	T24 2022 - Ext Wall - Wood Framed	0.3	304	0.046	0.048	270°	90 °	W
WALL 800-Unconditioned Room Room 01-12 _12	T24 2022 - Ext Wall - Wood Framed	0.3	37	0.046	0.048	180°	90 °	S
WALL 835-Electric _0	T24 2022 - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 836-Emergency Electric _0	T24 2022 - Ext Wall - Wood Framed	0.3	121	0.046	0.048	90°	90 °	E
WALL 837-Mechanical _0	T24 2022 - Ext Wall - Wood Framed	0.3	64	0.046	0.048	90°	90 °	E
WALL 838-Fire Room _0	T24 2022 - Ext Wall - Wood Framed	0.3	118	0.046	0.048	90°	90 °	E
WALL 839-Comfort Room 1 _0	T24 2022 - Ext Wall - Wood Framed	0.3	27	0.046	0.048	90°	90 °	E
WALL 840-Interview Room _0	T24 2022 - Ext Wall - Wood Framed	0.3	130	0.046	0.048	180°	90 °	S
WALL 841-Sally Port _0	T24 2022 - Ext Wall - Wood Framed	0.3	99	0.046	0.048	180°	90 °	S
WALL 842-Unconditioned Room Room 00-80 _0	T24 2022 - Ext Wall - Wood Framed	0.3	127	0.046	0.048	180°	90 °	S
WALL 843-Unconditioned Room Room 00-80 _0	T24 2022 - Ext Wall - Wood Framed	0.3	58	0.046	0.048	90°	90 °	E
WALL 846-Unconditioned Room Room 00-80 _0	T24 2022 - Ext Wall - Wood Framed	0.3	112	0.046	0.048	359.48°	90 °	N
WALL 849-Unconditioned Room Room 00-80 _0	T24 2022 - Ext Wall - Wood Framed	0.3	15	0.046	0.048	0°	90 °	N
WALL 850 - COPY-Unconditioned Room Room 00-80 _0	T24 2022 - Ext Wall - Wood Framed	0.3	51	0.046	0.048	270.44°	90 °	W
WALL 851-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	28	0.046	0.048	180°	90 °	S
WALL 852-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	16	0.046	0.048	270.44°	90 °	W
WALL 853-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	19	0.046	0.048	180°	90 °	S
WALL 854-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	29	0.046	0.048	90°	90 °	E
WALL 855-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	46	0.046	0.048	0.44°	90 °	N
WALL 856-Unconditioned Room Room 00-81 _0	T24 2022 - Ext Wall - Wood Framed	0.3	13	0.046	0.048	271.72°	90 °	W

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 102-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	187	0.28	0.452
WALL 107-Group _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 113-Group _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 114-Group _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 117-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 120-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 124-Soiled Supply _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 128-Toilet 2 _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 136-Chart/Hotel _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 140-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 144-Office 2 _0	Gypsum, Gypsum	0.3	44	0.28	0.452
WALL 368-Meds _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 369-Corridor 1 _0	Gypsum, Gypsum	0.3	78	0.28	0.452
WALL 36-Intake Corridor _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 370-Office 2 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 371-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	34	0.28	0.452
WALL 372-Office 1 _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 373-Lounge _0	Gypsum, Gypsum	0.3	218	0.28	0.452
WALL 374-Shower 2 _0	Gypsum, Gypsum	0.3	33	0.28	0.452
WALL 375-Shower 2 _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 376-Shower 2 _0	Gypsum, Gypsum	0.3	87	0.28	0.452
WALL 145-Office 2 _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 377-Kitchen _0	Gypsum, Gypsum	0.3	247	0.28	0.452
WALL 378-General Storage _0	Gypsum, Gypsum	0.3	110	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 379-General Storage _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 380-General Storage _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 381-General Storage _0	Gypsum, Gypsum	0.3	67	0.28	0.452
WALL 382-Service _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 383-Staff Corridor _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 384-Long Term Belongings Storage _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 385-Hskp _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 386-Electric _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 150-Office 1 _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 387-Emergency Electric _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 388-Mechanical _0	Gypsum, Gypsum	0.3	145	0.28	0.452
WALL 389-IT _0	Gypsum, Gypsum	0.3	203	0.28	0.452
WALL 392-Corridor 5 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 393-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 394-Corridor 5 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 395-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 396-Corridor 5 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 397-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 398-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 154-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 399-Corridor 5 _0	Gypsum, Gypsum	0.3	136	0.28	0.452
WALL 400-Corridor 5 _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 401-Corridor 5 _0	Gypsum, Gypsum	0.3	124	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 404-Corridor 4 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 405-Corridor 4 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 406-Corridor 4 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 407-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 408-Corridor 4 _0	Gypsum, Gypsum	0.3	125	0.28	0.452
WALL 409-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 410-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 158-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 411-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 414-Corridor 3 _0	Gypsum, Gypsum	0.3	177	0.28	0.452
WALL 415-Corridor 3 _0	Gypsum, Gypsum	0.3	128	0.28	0.452
WALL 416-Corridor 3 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 417-Corridor 3 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 418-Corridor 3 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 419-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 420-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 421-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 422-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 165-Kitchen _0	Gypsum, Gypsum	0.3	88	0.28	0.452
WALL 423-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 44-Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 507-Chart/Hotel _0	Gypsum, Gypsum	0.3	50	0.28	0.452
WALL 511-Comfort Room 2 _0	Gypsum, Gypsum	0.3	76	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 512-Corridor 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 515-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 516-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 517-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 518-Corridor 2.1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 519-Corridor 2.1 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 166-Kitchen _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 520-Chart/Hotel _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 523-Corridor 2.1 _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 54-Comfort Room 1 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 550-Attrium _0	Gypsum, Gypsum	0.3	180	0.28	0.452
WALL 551-Attrium _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 552-Attrium _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 553-Attrium _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 554-Attrium _0	Gypsum, Gypsum	0.3	287	0.28	0.452
WALL 555-Attrium _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 556-Attrium _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 171-Kitchen _0	Gypsum, Gypsum	0.3	245	0.28	0.452
WALL 557-Attrium _0	Gypsum, Gypsum	0.3	98	0.28	0.452
WALL 56-Comfort Room 1 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 59-Ante Room _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 60-Ante Room _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 61-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 64-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 65-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 68-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 72-Exam Room _0	Gypsum, Gypsum	0.3	17	0.28	0.452
WALL 73-Ante Room _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 177-Service _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 75-Hskp _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 78-Hskp _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 79-Ante Room _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 80-Comfort Room 1 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 81-Fire Room _0	Gypsum, Gypsum	0.3	36	0.28	0.452
WALL 848-Interview Room _0	Gypsum, Gypsum	0.3	6	0.28	0.452
WALL 87-Laundry _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 90-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 93-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 97-Hospitality _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 178-Service _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 181-IT _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 182-Fire Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 183-Fire Room _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 185-Emergency Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 187-General Storage _0	Gypsum, Gypsum	0.3	80	0.28	0.452
WALL 188-General Storage _0	Gypsum, Gypsum	0.3	157	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 18-Shower 1 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 193-Resident Room 01 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 197-Resident Room 02 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 201-Resident Room 03 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 205-Comfort Room 2 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 214-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 218-Shower 3 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 222-Resident Room 06 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 226-Resident Room 05 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 22-Interview Room _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 231-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 235-Quiet Activity 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 238-Resident Room 07 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 241-Resident Room 08 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 249-Resident Room 10 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 253-Shower 5 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 257-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 261-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 266-Quiet Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 270-Resident Room 11 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 274-Resident Room 12 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 278-Resident Room 13 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 286-Resident Room 15 _0	Gypsum, Gypsum	0.3	161	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 290-Resident Room 16 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 294-Shower 7 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 298-Noisy Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 299-Comfort Room 2 _0	Gypsum, Gypsum	0.3	15	0.28	0.452
WALL 304-Entry/Waiting _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 305-Entry/Waiting _0	Gypsum, Gypsum	0.3	134	0.28	0.452
WALL 307-Entry/Waiting _0	Gypsum, Gypsum	0.3	62	0.28	0.452
WALL 308-Entry/Waiting _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 309-Entry/Waiting _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 30-Interview Room _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 315-Corridor 1 _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 317-Corridor 1 _0	Gypsum, Gypsum	0.3	198	0.28	0.452
WALL 318-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 319-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	27	0.28	0.452
WALL 320-Servery _0	Gypsum, Gypsum	0.3	38	0.28	0.452
WALL 321-Servery _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 322-Corridor 1 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 323-Corridor 1 _0	Gypsum, Gypsum	0.3	73	0.28	0.452
WALL 324-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 325-Corridor 1 _0	Gypsum, Gypsum	0.3	11	0.28	0.452
WALL 326-Corridor 1 _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 327-Corridor 1 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 328-Corridor 1 _0	Gypsum, Gypsum	0.3	104	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 330-Corridor 1 _0	Gypsum, Gypsum	0.3	60	0.28	0.452
WALL 333-Comfort Room 2 _0	Gypsum, Gypsum	0.3	66	0.28	0.452
WALL 334-Comfort Room 2 _0	Gypsum, Gypsum	0.3	57	0.28	0.452
WALL 336-Consult 2 _0	Gypsum, Gypsum	0.3	117	0.28	0.452
WALL 337-Consult 1 _0	Gypsum, Gypsum	0.3	115	0.28	0.452
WALL 33-Intake Corridor _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 344-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 345-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 346-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 347-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 348-Corridor 2 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 349-Corridor 2 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 34-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 350-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 351-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 352-Corridor 2 _0	Gypsum, Gypsum	0.3	172	0.28	0.452
WALL 353-Corridor 2 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 358-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 359-Chart/Hotel _0	Gypsum, Gypsum	0.3	196	0.28	0.452
WALL 35-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 360-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 361-Staff Corridor _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 362-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 363-Soiled Supply _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 364-Soiled Supply _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 365-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 366-Laundry _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 367-Meds _0	Gypsum, Gypsum	0.3	132	0.28	0.452

Opaque Exterior Door

	Construction	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Gross Area (ft²)	Parent Surface
None		0	0	0	

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
DOOR 03_D - WALL 213-Noisy Activity 1 _0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 213-Noisy Activity 1 _0	270°	W
WINDOW 00_W - WALL 412-Corridor 4 _0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 412-Corridor 4 _0	270°	W
WINDOW 39_W - WALL 729-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 729-Attrium 2 _18	270°	W
WINDOW 40_W - WALL 729-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 729-Attrium 2 _18	270°	W
WINDOW 51_W - WALL 213-Noisy Activity 1 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 213-Noisy Activity 1 _0	270°	W
WINDOW 52_W - WALL 213-Noisy Activity 1 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 213-Noisy Activity 1 _0	270°	W
WINDOW 57_W - WALL 225-Resident Room 06 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 225-Resident Room 06 _0	270°	W
WINDOW 58_W - WALL 229-Resident Room 05 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 229-Resident Room 05 _0	270°	W
WINDOW 59_W - WALL 269-Resident Room 11 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 269-Resident Room 11 _0	270°	W
WINDOW 60_W - WALL 273-Resident Room 12 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 273-Resident Room 12 _0	270°	W
WINDOW 61_W - WALL 277-Resident Room 13 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 277-Resident Room 13 _0	270°	W
WINDOW 62_W - WALL 281-Resident Room 14 _0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 281-Resident Room 14 _0	270°	W
DOOR 04_D - WALL 172-Service _0	90.1-13 Metal Frame Ent. Door Zone 4-6	49	49	0.77	0.407	0.442	No	WALL 172-Service _0	180°	S
DOOR 05_D - WALL 179-Unconditioned Room Trash _0	90.1-13 Metal Frame Ent. Door Zone 4-6	28	28	0.77	0.407	0.442	No	WALL 179-Unconditioned Room Trash _0	180°	S
DOOR 06_D - WALL 390-Staff Corridor _0	90.1-13 Metal Frame Ent. Door Zone 4-6	28	28	0.77	0.407	0.442	No	WALL 390-Staff Corridor _0	180°	S
DOOR 07_D - WALL 40-Electric _0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 40-Electric _0	180°	S
DOOR 11_D - WALL 155-Lounge _0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 155-Lounge _0	180°	S
DOOR 12_D - WALL 311-Entry/Waiting _0	90.1-13 Metal Frame Ent. Door Zone 4-6	28	28	0.77	0.407	0.442	No	WALL 311-Entry/Waiting _0	180°	S
DOOR 24_D - WALL 841-Sally Port _0	90.1-13 Metal Frame Ent. Door Zone 4-6	25.7	25.7	0.77	0.407	0.442	No	WALL 841-Sally Port _0	180°	S
WINDOW 06_W - WALL 402-Corridor 5 _0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 402-Corridor 5 _0	180°	S
WINDOW 41_W - WALL 726-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 726-Attrium 2 _18	180°	S

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 42_W - WALL 726-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 726-Attrium 2 _18	180°	S
WINDOW 47_W - WALL 147-Office 2 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 147-Office 2 _0	180°	S
WINDOW 48_W - WALL 151-Office 1 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 151-Office 1 _0	180°	S
WINDOW 49_W - WALL 155-Lounge _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 155-Lounge _0	180°	S
WINDOW 50_W - WALL 155-Lounge _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 155-Lounge _0	180°	S
WINDOW 53_W - WALL 232-Quiet Activity 2 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 232-Quiet Activity 2 _0	180°	S
WINDOW 54_W - WALL 236-Resident Room 07 _0	T24-2022 Cz10 Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 236-Resident Room 07 _0	180°	S
WINDOW 55_W - WALL 239-Resident Room 08 _0	T24-2022 Cz10 Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 239-Resident Room 08 _0	180°	S
WINDOW 56_W - WALL 242-Resident Room 09 _0	T24-2022 Cz10 Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 242-Resident Room 09 _0	180°	S
DOOR 00_D - WALL 260-Noisy Activity 2 _0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 260-Noisy Activity 2 _0	0°	N
DOOR 02_D - WALL 106-Multipurpose/Dining _0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 106-Multipurpose/Dining _0	0°	N
WINDOW 04_W - WALL 313-Entry/Waiting _0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 313-Entry/Waiting _0	0°	N
WINDOW 05_W - WALL 424-Corridor 3 _0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 424-Corridor 3 _0	0°	N
WINDOW 07_W - WALL 247-Resident Room 10 _0	T24-2022 Cz10 Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 247-Resident Room 10 _0	0°	N
WINDOW 45_W - WALL 728-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 728-Attrium 2 _18	0°	N
WINDOW 46_W - WALL 728-Attrium 2 _18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 728-Attrium 2 _18	0°	N
WINDOW 66_W - WALL 208-Comfort Room 2 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 208-Comfort Room 2 _0	0°	N
WINDOW 67_W - WALL 122-Consult 2 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 122-Consult 2 _0	0°	N
WINDOW 68_W - WALL 119-Consult 1 _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 119-Consult 1 _0	0°	N
WINDOW 69_W - WALL 111-Group _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 111-Group _0	0°	N
WINDOW 70_W - WALL 111-Group _0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 111-Group _0	0°	N

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 71_W - WALL 106-Multipurpose/Dining_0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 72_W - WALL 106-Multipurpose/Dining_0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 73_W - WALL 106-Multipurpose/Dining_0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
DOOR 01_D - WALL 301-Noisy Activity 3_0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 301-Noisy Activity 3_0	90.55°	E
DOOR 22_D - WALL 836-Emergency Electric_0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 836-Emergency Electric_0	90°	E
DOOR 23_D - WALL 838-Fire Room_0	90.1-13 Metal Frame Ent. Door Zone 4-6	21	21	0.77	0.407	0.442	No	WALL 838-Fire Room_0	90°	E
WINDOW 01_W - WALL 312-Entry/Waiting_0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 02_W - WALL 312-Entry/Waiting_0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 03_W - WALL 312-Entry/Waiting_0	T24-2022 Cz10 Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 43_W - WALL 727-Attrium 2_18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 727-Attrium 2_18	90°	E
WINDOW 44_W - WALL 727-Attrium 2_18	T24-2022 Cz10 Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 727-Attrium 2_18	90°	E
WINDOW 63_W - WALL 283-Resident Room 15_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 283-Resident Room 15_0	90°	E
WINDOW 64_W - WALL 288-Resident Room 16_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 288-Resident Room 16_0	90°	E
WINDOW 65_W - WALL 301-Noisy Activity 3_0	T24-2022 Cz10 Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 301-Noisy Activity 3_0	90.55°	E
WINDOW 74_W - WALL 203-Resident Room 04_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 203-Resident Room 04_0	90°	E
WINDOW 75_W - WALL 199-Resident Room 03_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 199-Resident Room 03_0	90°	E
WINDOW 76_W - WALL 195-Resident Room 02_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 195-Resident Room 02_0	90°	E
WINDOW 77_W - WALL 142-Resident Room 01_0	T24-2022 Cz10 Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 142-Resident Room 01_0	90°	E
Total or Average		0	1,153.7	0.476	0.295	0.427			0°	
North Total or Average		0	265.7	0.425	0.275	0.424			0°	
Non-North Total or Average		0	888	0.492	0.301	0.428			0°	

Sunlit Fraction


* Sunlit Fraction is available for calculation timesteps of 15 minutes or less.

	March 21 9am	March 21 Noon	March 21 3pm	June 21 9am	June 21 Noon	June 21 3pm	December 21 9am	December 21 Noon	December 21 3pm
None	0	0	0	0	0	0	0	0	0

Window Controls

	Control Name	Type	Shaded	Control	Glare Control
None					

Envelope Summary

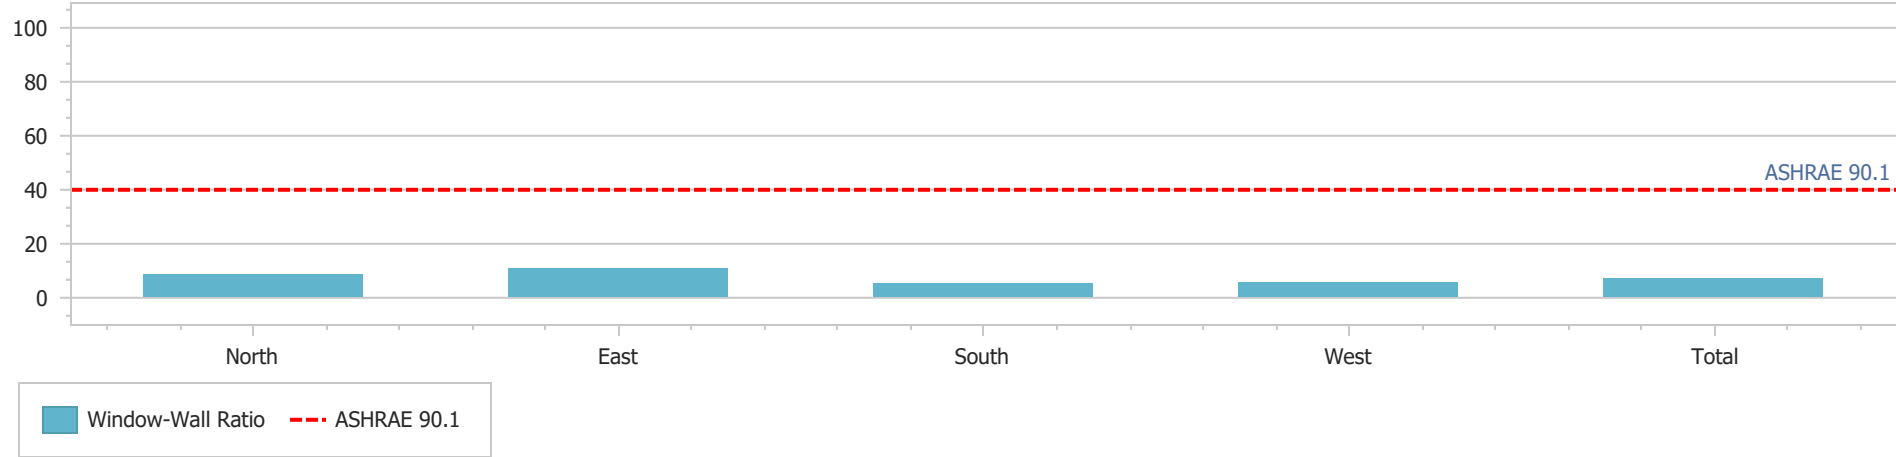

	North	East	South	West	Total
Gross Window-Wall Ratio	8.22	10.45	5.06	5.22	7.05

Ratios

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827
Gross Roof Area	ft²	0	0	0	0	15,695
Skylight Area	ft²	0	0	0	0	0
Skylight-Roof Ratio	%	0	0	0	0	0

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 05-05	Casa - Roof - Single Ply Over Tapered Insulation	0.3	87	0.026	0.027	180°	0 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 07-07	Casa - Roof - Single Ply Over Tapered Insulation	0.3	205	0.026	0.027	180°	0 °	
Roof 08-08	Casa - Roof - Single Ply Over Tapered Insulation	0.3	193	0.026	0.027	180°	0 °	
Roof 09-09	Casa - Roof - Single Ply Over Tapered Insulation	0.3	88	0.026	0.027	180°	0 °	
Roof 100-14	Casa - Roof - Single Ply Over Tapered Insulation	0.3	65	0.026	0.027	180°	0 °	
Roof 10-10	Casa - Roof - Single Ply Over Tapered Insulation	0.3	93	0.026	0.027	180°	0 °	
Roof 101-13	Casa - Roof - Single Ply Over Tapered Insulation	0.3	111	0.026	0.027	180°	0 °	
Roof 102-68	Casa - Roof - Single Ply Over Tapered Insulation	0.3	318	0.026	0.027	180°	0 °	
Roof 103-16	Casa - Roof - Single Ply Over Tapered Insulation	0.3	141	0.026	0.027	180°	0 °	
Roof 104-17	Casa - Roof - Single Ply Over Tapered Insulation	0.3	133	0.026	0.027	180°	0 °	
Roof 105-18	Casa - Roof - Single Ply Over Tapered Insulation	0.3	113	0.026	0.027	180°	0 °	
Roof 106-19	Casa - Roof - Single Ply Over Tapered Insulation	0.3	107	0.026	0.027	180°	0 °	
Roof 107-26	Casa - Roof - Single Ply Over Tapered Insulation	0.3	70	0.026	0.027	180°	0 °	
Roof 108-27	Casa - Roof - Single Ply Over Tapered Insulation	0.3	70	0.026	0.027	180°	0 °	
Roof 109-70	Casa - Roof - Single Ply Over Tapered Insulation	0.3	516	0.026	0.027	180°	0 °	
Roof 110-28	Casa - Roof - Single Ply Over Tapered Insulation	0.3	21	0.026	0.027	180°	0 °	
Roof 111-11	Casa - Roof - Single Ply Over Tapered Insulation	0.3	90	0.026	0.027	180°	0 °	
Roof 112-12	Casa - Roof - Single Ply Over Tapered Insulation	0.3	134	0.026	0.027	180°	0 °	
Roof 113-06	Casa - Roof - Single Ply Over Tapered Insulation	0.3	169	0.026	0.027	180°	0 °	
Roof 114-02	Casa - Roof - Single Ply Over Tapered Insulation	0.3	53	0.026	0.027	180°	0 °	
Roof 115-67	Casa - Roof - Single Ply Over Tapered Insulation	0.3	56	0.026	0.027	180°	0 °	
Roof 116-01	Casa - Roof - Single Ply Over Tapered Insulation	0.3	129	0.026	0.027	270°	0 °	

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 27 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 117-20	Casa - Roof - Single Ply Over Tapered Insulation	0.3	124	0.026	0.027	270°	0 °	
Roof 118-69	Casa - Roof - Single Ply Over Tapered Insulation	0.3	19	0.026	0.027	263.33°	0 °	
Roof 119-21	Casa - Roof - Single Ply Over Tapered Insulation	0.3	266	0.026	0.027	180°	0 °	
Roof 120-22	Casa - Roof - Single Ply Over Tapered Insulation	0.3	146	0.026	0.027	180°	0 °	
Roof 121-23	Casa - Roof - Single Ply Over Tapered Insulation	0.3	53	0.026	0.027	180°	0 °	
Roof 122-24	Casa - Roof - Single Ply Over Tapered Insulation	0.3	98	0.026	0.027	180°	0 °	
Roof 123-25	Casa - Roof - Single Ply Over Tapered Insulation	0.3	99	0.026	0.027	270°	0 °	
Roof 124-43	Casa - Roof - Single Ply Over Tapered Insulation	0.3	80	0.026	0.027	224.96°	0 °	
Roof 125-04	Casa - Roof - Single Ply Over Tapered Insulation	0.3	119	0.026	0.027	180°	0 °	
Roof 126-03	Casa - Roof - Single Ply Over Tapered Insulation	0.3	62	0.026	0.027	180°	0 °	
Roof 128-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	175	0.026	0.027	90°	18 °	
Roof 129-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	177	0.026	0.027	0°	18 °	
Roof 130-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	175	0.026	0.027	270°	18 °	
Roof 131-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	177	0.026	0.027	180°	18 °	
Roof 134-10	Casa - Roof - Single Ply Over Tapered Insulation	0.3	862	0.026	0.027	90°	21 °	
Roof 136-12	Casa - Roof - Single Ply Over Tapered Insulation	0.3	792	0.026	0.027	90°	26 °	
Roof 137-80	Casa - Roof - Single Ply Over Tapered Insulation	0.3	6	0.026	0.027	270°	0 °	
Roof 138-81	Casa - Roof - Single Ply Over Tapered Insulation	0.3	4	0.026	0.027	180°	0 °	
Roof 38-38	Casa - Roof - Single Ply Over Tapered Insulation	0.3	170	0.026	0.027	180°	0 °	
Roof 62-62	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	270°	0 °	
Roof 63-63	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 28 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
Roof 64-64	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	
Roof 65-65	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1	0.026	0.027	180°	0 °	
Roof 80-00	Casa - Roof - Single Ply Over Tapered Insulation	0.3	702	0.026	0.027	358.52°	19 °	
Roof 81-01	Casa - Roof - Single Ply Over Tapered Insulation	0.3	815	0.026	0.027	180°	18 °	
Roof 83-03	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,095	0.026	0.027	270°	18 °	
Roof 84-04	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,058	0.026	0.027	90°	20 °	
Roof 86-06	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,096	0.026	0.027	270°	17 °	
Roof 88-08	Casa - Roof - Single Ply Over Tapered Insulation	0.3	1,766	0.026	0.027	360°	22 °	
Roof 90-31	Casa - Roof - Single Ply Over Tapered Insulation	0.3	105	0.026	0.027	180°	0 °	
Roof 91-71	Casa - Roof - Single Ply Over Tapered Insulation	0.3	968	0.026	0.027	180°	0 °	
Roof 92-32	Casa - Roof - Single Ply Over Tapered Insulation	0.3	104	0.026	0.027	180°	0 °	
Roof 93-33	Casa - Roof - Single Ply Over Tapered Insulation	0.3	212	0.026	0.027	180°	0 °	
Roof 94-34	Casa - Roof - Single Ply Over Tapered Insulation	0.3	110	0.026	0.027	180°	0 °	
Roof 95-39	Casa - Roof - Single Ply Over Tapered Insulation	0.3	107	0.026	0.027	180°	0 °	
Roof 96-35	Casa - Roof - Single Ply Over Tapered Insulation	0.3	402	0.026	0.027	180°	0 °	
Roof 97-36	Casa - Roof - Single Ply Over Tapered Insulation	0.3	323	0.026	0.027	180°	0 °	
Roof 98-37	Casa - Roof - Single Ply Over Tapered Insulation	0.3	85	0.026	0.027	180°	0 °	
Roof 99-15	Casa - Roof - Single Ply Over Tapered Insulation	0.3	171	0.026	0.027	180°	0 °	
SLAB 01_0	Casa - Slab On Grade_0	1	262	0.041	0.042		180 °	
SLAB 02_0	Casa - Slab On Grade_0	1	76	0.041	0.042		180 °	
SLAB 03_0	Casa - Slab On Grade_0	1	89	0.041	0.042		180 °	
SLAB 04_0	Casa - Slab On Grade_0	1	171	0.041	0.042		180 °	

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 29 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 05_0	Casa - Slab On Grade_0	1	87	0.041	0.042		180 °	
SLAB 06_0	Casa - Slab On Grade_0	1	169	0.041	0.042		180 °	
SLAB 07_0	Casa - Slab On Grade_0	1	205	0.041	0.042		180 °	
SLAB 08_0	Casa - Slab On Grade_0	1	193	0.041	0.042		180 °	
SLAB 09_0	Casa - Slab On Grade_0	1	88	0.041	0.042		180 °	
SLAB 10_0	Casa - Slab On Grade_0	1	93	0.041	0.042		180 °	
SLAB 11_0	Casa - Slab On Grade_0	1	90	0.041	0.042		180 °	
SLAB 12_0	Casa - Slab On Grade_0	1	134	0.041	0.042		180 °	
SLAB 128_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	893	0.038	0.04		180 °	
SLAB 13_0	Casa - Slab On Grade_0	1	111	0.041	0.042		180 °	
SLAB 14_0	Casa - Slab On Grade_0	1	65	0.041	0.042		180 °	
SLAB 15_0	Casa - Slab On Grade_0	1	171	0.041	0.042		180 °	
SLAB 16_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 17_0	Casa - Slab On Grade_0	1	133	0.041	0.042		180 °	
SLAB 18_0	Casa - Slab On Grade_0	1	113	0.041	0.042		180 °	
SLAB 182_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	13	0.038	0.04		180 °	
SLAB 185_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	162	0.038	0.04		180 °	
SLAB 187_0	Casa - Slab On Grade_0	1	11	0.041	0.042		180 °	
SLAB 188_0	90.1-13 Min Floors, Steel Joist Zone 5	0.3	79	0.038	0.04		180 °	
SLAB 19_0	Casa - Slab On Grade_0	1	107	0.041	0.042		180 °	
SLAB 190_0	Casa - Slab On Grade_0	1	6	0.041	0.042		180 °	
SLAB 20_0	Casa - Slab On Grade_0	1	244	0.041	0.042		180 °	
SLAB 21_0	Casa - Slab On Grade_0	1	508	0.041	0.042		180 °	
SLAB 22_0	Casa - Slab On Grade_0	1	294	0.041	0.042		180 °	

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 30 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 23_0	Casa - Slab On Grade_0	1	60	0.041	0.042		180 °	
SLAB 24_0	Casa - Slab On Grade_0	1	110	0.041	0.042		180 °	
SLAB 25_0	Casa - Slab On Grade_0	1	112	0.041	0.042		180 °	
SLAB 26_0	Casa - Slab On Grade_0	1	70	0.041	0.042		180 °	
SLAB 27_0	Casa - Slab On Grade_0	1	70	0.041	0.042		180 °	
SLAB 28_0	Casa - Slab On Grade_0	1	214	0.041	0.042		180 °	
SLAB 29_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 30_0	Casa - Slab On Grade_0	1	135	0.041	0.042		180 °	
SLAB 31_0	Casa - Slab On Grade_0	1	105	0.041	0.042		180 °	
SLAB 32_0	Casa - Slab On Grade_0	1	104	0.041	0.042		180 °	
SLAB 33_0	Casa - Slab On Grade_0	1	212	0.041	0.042		180 °	
SLAB 34_0	Casa - Slab On Grade_0	1	110	0.041	0.042		180 °	
SLAB 35_0	Casa - Slab On Grade_0	1	402	0.041	0.042		180 °	
SLAB 36_0	Casa - Slab On Grade_0	1	323	0.041	0.042		180 °	
SLAB 37_0	Casa - Slab On Grade_0	1	85	0.041	0.042		180 °	
SLAB 38_0	Casa - Slab On Grade_0	1	170	0.041	0.042		180 °	
SLAB 39_0	Casa - Slab On Grade_0	1	107	0.041	0.042		180 °	
SLAB 40_0	Casa - Slab On Grade_0	1	123	0.041	0.042		180 °	
SLAB 41_0	Casa - Slab On Grade_0	1	148	0.041	0.042		180 °	
SLAB 42_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 43_0	Casa - Slab On Grade_0	1	91	0.041	0.042		180 °	
SLAB 44_0	Casa - Slab On Grade_0	1	193	0.041	0.042		180 °	
SLAB 45_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 46_0	Casa - Slab On Grade_0	1	115	0.041	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 47_0	Casa - Slab On Grade_0	1	135	0.041	0.042		180 °	
SLAB 48_0	Casa - Slab On Grade_0	1	143	0.041	0.042		180 °	
SLAB 49_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 50_0	Casa - Slab On Grade_0	1	137	0.041	0.042		180 °	
SLAB 51_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 52_0	Casa - Slab On Grade_0	1	140	0.041	0.042		180 °	
SLAB 53_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 54_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 55_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 56_0	Casa - Slab On Grade_0	1	195	0.041	0.042		180 °	
SLAB 57_0	Casa - Slab On Grade_0	1	143	0.041	0.042		180 °	
SLAB 58_0	Casa - Slab On Grade_0	1	141	0.041	0.042		180 °	
SLAB 59_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 60_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 61_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 62_0	Casa - Slab On Grade_0	1	142	0.041	0.042		180 °	
SLAB 63_0	Casa - Slab On Grade_0	1	138	0.041	0.042		180 °	
SLAB 64_0	Casa - Slab On Grade_0	1	114	0.041	0.042		180 °	
SLAB 65_0	Casa - Slab On Grade_0	1	111	0.041	0.042		180 °	
SLAB 66_0	Casa - Slab On Grade_0	1	196	0.041	0.042		180 °	
SLAB 67_0	Casa - Slab On Grade_0	1	396	0.041	0.042		180 °	
SLAB 68_0	Casa - Slab On Grade_0	1	318	0.041	0.042		180 °	
SLAB 69_0	Casa - Slab On Grade_0	1	19	0.041	0.042		180 °	
SLAB 70_0	Casa - Slab On Grade_0	1	686	0.041	0.042		180 °	

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
SLAB 71_0	Casa - Slab On Grade_0	1	968	0.041	0.042		180 °	
SLAB 72_0	Casa - Slab On Grade_0	1	444	0.041	0.042		180 °	
SLAB 73_0	Casa - Slab On Grade_0	1	349	0.041	0.042		180 °	
SLAB 74_0	Casa - Slab On Grade_0	1	439	0.041	0.042		180 °	
SLAB 81_0	Casa - Slab On Grade_0	1	96	0.041	0.042		180 °	
SLAB 82_0	Casa - Slab On Grade_0	1	469	0.041	0.042		180 °	
WALL 101-Servery _0	Casa - Ext Wall - Wood Framed	0.3	160	0.046	0.048	0°	90 °	N
WALL 106-Multipurpose/Dining _0	Casa - Ext Wall - Wood Framed	0.3	322	0.046	0.048	0°	90 °	N
WALL 111-Group _0	Casa - Ext Wall - Wood Framed	0.3	202	0.046	0.048	0°	90 °	N
WALL 112-Group _0	Casa - Ext Wall - Wood Framed	0.3	93	0.046	0.048	270°	90 °	W
WALL 116-Storage _0	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	0°	90 °	N
WALL 119-Consult 1 _0	Casa - Ext Wall - Wood Framed	0.3	115	0.046	0.048	0°	90 °	N
WALL 122-Consult 2 _0	Casa - Ext Wall - Wood Framed	0.3	117	0.046	0.048	0°	90 °	N
WALL 13-Hospitality _0	Casa - Ext Wall - Wood Framed	0.3	164	0.046	0.048	0°	90 °	N
WALL 142-Resident Room 01 _0	Casa - Ext Wall - Wood Framed	0.3	80	0.046	0.048	90°	90 °	E
WALL 147-Office 2 _0	Casa - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 151-Office 1 _0	Casa - Ext Wall - Wood Framed	0.3	107	0.046	0.048	180°	90 °	S
WALL 155-Lounge _0	Casa - Ext Wall - Wood Framed	0.3	218	0.046	0.048	180°	90 °	S
WALL 164-Shower 2 _0	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	180°	90 °	S
WALL 170-Kitchen _0	Casa - Ext Wall - Wood Framed	0.3	218	0.046	0.048	270°	90 °	W
WALL 172-Service _0	Casa - Ext Wall - Wood Framed	0.3	149	0.046	0.048	180°	90 °	S
WALL 176-Service _0	Casa - Ext Wall - Wood Framed	0.3	241	0.046	0.048	270°	90 °	W
WALL 179-Unconditioned Room Trash _0	Casa - Ext Wall - Wood Framed	0.3	96	0.046	0.048	180°	90 °	S
WALL 195-Resident Room 02 _0	Casa - Ext Wall - Wood Framed	0.3	112	0.046	0.048	90°	90 °	E

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 199-Resident Room 03 _0	Casa - Ext Wall - Wood Framed	0.3	136	0.046	0.048	90°	90 °	E
WALL 202-Resident Room 04 _0	Casa - Ext Wall - Wood Framed	0.3	157	0.046	0.048	180°	90 °	S
WALL 203-Resident Room 04 _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 208-Comfort Room 2 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	0°	90 °	N
WALL 20-Shower 1 _0	Casa - Ext Wall - Wood Framed	0.3	37	0.046	0.048	90°	90 °	E
WALL 213-Noisy Activity 1 _0	Casa - Ext Wall - Wood Framed	0.3	174	0.046	0.048	270°	90 °	W
WALL 217-Shower 4 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 221-Shower 3 _0	Casa - Ext Wall - Wood Framed	0.3	103	0.046	0.048	270°	90 °	W
WALL 225-Resident Room 06 _0	Casa - Ext Wall - Wood Framed	0.3	122	0.046	0.048	270°	90 °	W
WALL 227-Resident Room 05 _0	Casa - Ext Wall - Wood Framed	0.3	160	0.046	0.048	180°	90 °	S
WALL 229-Resident Room 05 _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	270°	90 °	W
WALL 232-Quiet Activity 2 _0	Casa - Ext Wall - Wood Framed	0.3	48	0.046	0.048	180°	90 °	S
WALL 236-Resident Room 07 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	180°	90 °	S
WALL 239-Resident Room 08 _0	Casa - Ext Wall - Wood Framed	0.3	125	0.046	0.048	180°	90 °	S
WALL 242-Resident Room 09 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	180°	90 °	S
WALL 244-Resident Room 09 _0	Casa - Ext Wall - Wood Framed	0.3	159	0.046	0.048	270°	90 °	W
WALL 247-Resident Room 10 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	0°	90 °	N
WALL 248-Resident Room 10 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	270°	90 °	W
WALL 252-Shower 5 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 256-Shower 6 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	0°	90 °	N
WALL 260-Noisy Activity 2 _0	Casa - Ext Wall - Wood Framed	0.3	92	0.046	0.048	0°	90 °	N
WALL 265-Quiet Activity 3 _0	Casa - Ext Wall - Wood Framed	0.3	128	0.046	0.048	270°	90 °	W
WALL 269-Resident Room 11 _0	Casa - Ext Wall - Wood Framed	0.3	126	0.046	0.048	270°	90 °	W
WALL 26-Interview Room _0	Casa - Ext Wall - Wood Framed	0.3	183	0.046	0.048	90°	90 °	E

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 34 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 273-Resident Room 12 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 277-Resident Room 13 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	270°	90 °	W
WALL 280-Resident Room 14 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 281-Resident Room 14 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	270°	90 °	W
WALL 283-Resident Room 15 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	90°	90 °	E
WALL 284-Resident Room 15 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	0°	90 °	N
WALL 288-Resident Room 16 _0	Casa - Ext Wall - Wood Framed	0.3	124	0.046	0.048	90°	90 °	E
WALL 292-Shower 7 _0	Casa - Ext Wall - Wood Framed	0.3	102	0.046	0.048	90°	90 °	E
WALL 296-Shower 8 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	90°	90 °	E
WALL 301-Noisy Activity 3 _0	Casa - Ext Wall - Wood Framed	0.3	161	0.046	0.048	90.55°	90 °	E
WALL 306-Hospitality _0	Casa - Ext Wall - Wood Framed	0.3	96	0.046	0.048	90°	90 °	E
WALL 311-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	108	0.046	0.048	180°	90 °	S
WALL 312-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	381	0.046	0.048	90°	90 °	E
WALL 313-Entry/Waiting _0	Casa - Ext Wall - Wood Framed	0.3	136	0.046	0.048	0°	90 °	N
WALL 390-Staff Corridor _0	Casa - Ext Wall - Wood Framed	0.3	77	0.046	0.048	180°	90 °	S
WALL 402-Corridor 5 _0	Casa - Ext Wall - Wood Framed	0.3	101	0.046	0.048	180°	90 °	S
WALL 40-Electric _0	Casa - Ext Wall - Wood Framed	0.3	230	0.046	0.048	180°	90 °	S
WALL 412-Corridor 4 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	270°	90 °	W
WALL 424-Corridor 3 _0	Casa - Ext Wall - Wood Framed	0.3	100	0.046	0.048	0°	90 °	N
WALL 566-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	6	0.046	0.048	0°	90 °	N
WALL 567-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	45	0.046	0.048	270°	90 °	W
WALL 572-Unconditioned Room Room 01-01 _12	Casa - Ext Wall - Wood Framed	0.3	57	0.046	0.048	270°	90 °	W
WALL 584-Unconditioned Room Room 01-03 _12	Casa - Ext Wall - Wood Framed	0.3	54	0.046	0.048	180°	90 °	S
WALL 589-Unconditioned Room Room 01-04 _12	Casa - Ext Wall - Wood Framed	0.3	51	0.046	0.048	180°	90 °	S

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 612-Unconditioned Room Room 01-06 _12	Casa - Ext Wall - Wood Framed	0.3	57	0.046	0.048	0°	90 °	N
WALL 654-Unconditioned Room Room 01-04 _12	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	0°	90 °	N
WALL 726-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	179	0.046	0.048	180°	90 °	S
WALL 727-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	178	0.046	0.048	90°	90 °	E
WALL 728-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	179	0.046	0.048	0°	90 °	N
WALL 729-Attrium 2 _18	Casa - Ext Wall - Wood Framed	0.3	178	0.046	0.048	270°	90 °	W
WALL 730-Unconditioned Room Room 01-06 _12.6420052252	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	202.72°	90 °	S
WALL 731-Unconditioned Room Room 01-06 _12.7919128827	Casa - Ext Wall - Wood Framed	0.3	2	0.046	0.048	199.12°	90 °	S
WALL 733-Unconditioned Room Room 01-00 _12	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	22.72°	90 °	N
WALL 736-Unconditioned Room Room 01-03 _13.108842849	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	316.46°	90 °	N
WALL 738-Unconditioned Room Room 01-03 _12	Casa - Ext Wall - Wood Framed	0.3	0	0.046	0.048	316.54°	90 °	N
WALL 757-Attrium _13.2899728863	Casa - Ext Wall - Wood Framed	0.3	32	0.046	0.048	270°	90 °	W
WALL 758-Attrium _14.0210136804	Casa - Ext Wall - Wood Framed	0.3	25	0.046	0.048	270°	90 °	W
WALL 760-Attrium _14.2564019478	Casa - Ext Wall - Wood Framed	0.3	21	0.046	0.048	180°	90 °	S
WALL 761-Attrium _12.7378807681	Casa - Ext Wall - Wood Framed	0.3	39	0.046	0.048	180°	90 °	S
WALL 762-Attrium _12	Casa - Ext Wall - Wood Framed	0.3	156	0.046	0.048	90°	90 °	E
WALL 764-Attrium _14.1335978361	Casa - Ext Wall - Wood Framed	0.3	24	0.046	0.048	0°	90 °	N
WALL 771-Attrium _12.8311965203	Casa - Ext Wall - Wood Framed	0.3	35	0.046	0.048	0°	90 °	N
WALL 773-Unconditioned Room Room 01-08 _13.7195611268	Casa - Ext Wall - Wood Framed	0.3	22	0.046	0.048	270°	90 °	W
WALL 777-Unconditioned Room Room 01-08 _12	Casa - Ext Wall - Wood Framed	0.3	626	0.046	0.048	180°	90 °	S
WALL 780-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	1	0.046	0.048	179.55°	90 °	S
WALL 781-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	4	0.046	0.048	90°	90 °	E
WALL 782-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	4	0.046	0.048	180°	90 °	S
WALL 783-Unconditioned Room Room 01-10 _12	Casa - Ext Wall - Wood Framed	0.3	48	0.046	0.048	0°	90 °	N

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 36 of 49

Opaque Exterior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Azimuth	Tilt	Cardinal Direction
WALL 799-Unconditioned Room Room 01-12 _12	Casa - Ext Wall - Wood Framed	0.3	304	0.046	0.048	270°	90 °	W
WALL 800-Unconditioned Room Room 01-12 _12	Casa - Ext Wall - Wood Framed	0.3	37	0.046	0.048	180°	90 °	S
WALL 835-Electric _0	Casa - Ext Wall - Wood Framed	0.3	129	0.046	0.048	90°	90 °	E
WALL 836-Emergency Electric _0	Casa - Ext Wall - Wood Framed	0.3	121	0.046	0.048	90°	90 °	E
WALL 837-Mechanical _0	Casa - Ext Wall - Wood Framed	0.3	64	0.046	0.048	90°	90 °	E
WALL 838-Fire Room _0	Casa - Ext Wall - Wood Framed	0.3	118	0.046	0.048	90°	90 °	E
WALL 839-Comfort Room 1 _0	Casa - Ext Wall - Wood Framed	0.3	27	0.046	0.048	90°	90 °	E
WALL 840-Interview Room _0	Casa - Ext Wall - Wood Framed	0.3	130	0.046	0.048	180°	90 °	S
WALL 841-Sally Port _0	Casa - Ext Wall - Wood Framed	0.3	99	0.046	0.048	180°	90 °	S
WALL 842-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	127	0.046	0.048	180°	90 °	S
WALL 843-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	58	0.046	0.048	90°	90 °	E
WALL 846-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	112	0.046	0.048	359.48°	90 °	N
WALL 849-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	15	0.046	0.048	0°	90 °	N
WALL 850 - COPY-Unconditioned Room Room 00-80 _0	Casa - Ext Wall - Wood Framed	0.3	51	0.046	0.048	270.44°	90 °	W
WALL 851-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	28	0.046	0.048	180°	90 °	S
WALL 852-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	16	0.046	0.048	270.44°	90 °	W
WALL 853-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	19	0.046	0.048	180°	90 °	S
WALL 854-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	29	0.046	0.048	90°	90 °	E
WALL 855-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	46	0.046	0.048	0.44°	90 °	N
WALL 856-Unconditioned Room Room 00-81 _0	Casa - Ext Wall - Wood Framed	0.3	13	0.046	0.048	271.72°	90 °	W

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 102-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	187	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 37 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 107-Group _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 113-Group _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 114-Group _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 117-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 120-Consult 1 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 124-Soiled Supply _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 128-Toilet 2 _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 136-Chart/Hotel _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 140-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 144-Office 2 _0	Gypsum, Gypsum	0.3	44	0.28	0.452
WALL 368-Meds _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 369-Corridor 1 _0	Gypsum, Gypsum	0.3	78	0.28	0.452
WALL 36-Intake Corridor _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 370-Office 2 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 371-Quiet Activity 1 _0	Gypsum, Gypsum	0.3	34	0.28	0.452
WALL 372-Office 1 _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 373-Lounge _0	Gypsum, Gypsum	0.3	218	0.28	0.452
WALL 374-Shower 2 _0	Gypsum, Gypsum	0.3	33	0.28	0.452
WALL 375-Shower 2 _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 376-Shower 2 _0	Gypsum, Gypsum	0.3	87	0.28	0.452
WALL 145-Office 2 _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 377-Kitchen _0	Gypsum, Gypsum	0.3	247	0.28	0.452
WALL 378-General Storage _0	Gypsum, Gypsum	0.3	110	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 38 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 379-General Storage _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 380-General Storage _0	Gypsum, Gypsum	0.3	31	0.28	0.452
WALL 381-General Storage _0	Gypsum, Gypsum	0.3	67	0.28	0.452
WALL 382-Service _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 383-Staff Corridor _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 384-Long Term Belongings Storage _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 385-Hskp _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 386-Electric _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 150-Office 1 _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 387-Emergency Electric _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 388-Mechanical _0	Gypsum, Gypsum	0.3	145	0.28	0.452
WALL 389-IT _0	Gypsum, Gypsum	0.3	203	0.28	0.452
WALL 392-Corridor 5 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 393-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 394-Corridor 5 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 395-Corridor 5 _0	Gypsum, Gypsum	0.3	103	0.28	0.452
WALL 396-Corridor 5 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 553-Attrium _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 555-Attrium _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 557-Attrium _0	Gypsum, Gypsum	0.3	98	0.28	0.452
WALL 56-Comfort Room 1 _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 59-Ante Room _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 60-Ante Room _0	Gypsum, Gypsum	0.3	91	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 39 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 61-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 64-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 65-Ante Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 68-Exam Room _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 72-Exam Room _0	Gypsum, Gypsum	0.3	17	0.28	0.452
WALL 73-Ante Room _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 177-Service _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 75-Hskp _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 78-Hskp _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 79-Ante Room _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 80-Comfort Room 1 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 81-Fire Room _0	Gypsum, Gypsum	0.3	36	0.28	0.452
WALL 848-Interview Room _0	Gypsum, Gypsum	0.3	6	0.28	0.452
WALL 87-Laundry _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 90-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 93-Clean Supply _0	Gypsum, Gypsum	0.3	154	0.28	0.452
WALL 97-Hospitality _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 178-Service _0	Gypsum, Gypsum	0.3	96	0.28	0.452
WALL 181-IT _0	Gypsum, Gypsum	0.3	121	0.28	0.452
WALL 182-Fire Room _0	Gypsum, Gypsum	0.3	108	0.28	0.452
WALL 183-Fire Room _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 185-Emergency Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 187-General Storage _0	Gypsum, Gypsum	0.3	80	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 188-General Storage _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 18-Shower 1 _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 193-Resident Room 01 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 197-Resident Room 02 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 201-Resident Room 03 _0	Gypsum, Gypsum	0.3	157	0.28	0.452
WALL 205-Comfort Room 2 _0	Gypsum, Gypsum	0.3	137	0.28	0.452
WALL 214-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 218-Shower 3 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 222-Resident Room 06 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 226-Resident Room 05 _0	Gypsum, Gypsum	0.3	160	0.28	0.452
WALL 22-Interview Room _0	Gypsum, Gypsum	0.3	130	0.28	0.452
WALL 231-Noisy Activity 1 _0	Gypsum, Gypsum	0.3	81	0.28	0.452
WALL 235-Quiet Activity 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 238-Resident Room 07 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 241-Resident Room 08 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 249-Resident Room 10 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 253-Shower 5 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 257-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 261-Noisy Activity 2 _0	Gypsum, Gypsum	0.3	82	0.28	0.452
WALL 266-Quiet Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 270-Resident Room 11 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 274-Resident Room 12 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 278-Resident Room 13 _0	Gypsum, Gypsum	0.3	161	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 41 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 286-Resident Room 15 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 290-Resident Room 16 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 294-Shower 7 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 298-Noisy Activity 3 _0	Gypsum, Gypsum	0.3	161	0.28	0.452
WALL 299-Comfort Room 2 _0	Gypsum, Gypsum	0.3	15	0.28	0.452
WALL 304-Entry/Waiting _0	Gypsum, Gypsum	0.3	91	0.28	0.452
WALL 305-Entry/Waiting _0	Gypsum, Gypsum	0.3	134	0.28	0.452
WALL 307-Entry/Waiting _0	Gypsum, Gypsum	0.3	62	0.28	0.452
WALL 308-Entry/Waiting _0	Gypsum, Gypsum	0.3	83	0.28	0.452
WALL 309-Entry/Waiting _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 30-Interview Room _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 315-Corridor 1 _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 317-Corridor 1 _0	Gypsum, Gypsum	0.3	198	0.28	0.452
WALL 318-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 319-Multipurpose/Dining _0	Gypsum, Gypsum	0.3	27	0.28	0.452
WALL 320-Servery _0	Gypsum, Gypsum	0.3	38	0.28	0.452
WALL 321-Servery _0	Gypsum, Gypsum	0.3	43	0.28	0.452
WALL 322-Corridor 1 _0	Gypsum, Gypsum	0.3	122	0.28	0.452
WALL 323-Corridor 1 _0	Gypsum, Gypsum	0.3	73	0.28	0.452
WALL 324-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 171-Kitchen _0	Gypsum, Gypsum	0.3	245	0.28	0.452
WALL 325-Corridor 1 _0	Gypsum, Gypsum	0.3	11	0.28	0.452
WALL 326-Corridor 1 _0	Gypsum, Gypsum	0.3	99	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 327-Corridor 1 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 328-Corridor 1 _0	Gypsum, Gypsum	0.3	104	0.28	0.452
WALL 330-Corridor 1 _0	Gypsum, Gypsum	0.3	60	0.28	0.452
WALL 333-Comfort Room 2 _0	Gypsum, Gypsum	0.3	66	0.28	0.452
WALL 334-Comfort Room 2 _0	Gypsum, Gypsum	0.3	57	0.28	0.452
WALL 336-Consult 2 _0	Gypsum, Gypsum	0.3	117	0.28	0.452
WALL 337-Consult 1 _0	Gypsum, Gypsum	0.3	115	0.28	0.452
WALL 33-Intake Corridor _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 344-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 345-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 346-Corridor 2 _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 347-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 348-Corridor 2 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 349-Corridor 2 _0	Gypsum, Gypsum	0.3	97	0.28	0.452
WALL 34-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 350-Corridor 1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 351-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 352-Corridor 2 _0	Gypsum, Gypsum	0.3	172	0.28	0.452
WALL 353-Corridor 2 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 358-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 359-Chart/Hotel _0	Gypsum, Gypsum	0.3	196	0.28	0.452
WALL 35-Intake Corridor _0	Gypsum, Gypsum	0.3	99	0.28	0.452
WALL 360-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 361-Staff Corridor _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 362-Staff Corridor _0	Gypsum, Gypsum	0.3	84	0.28	0.452
WALL 363-Soiled Supply _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 364-Soiled Supply _0	Gypsum, Gypsum	0.3	35	0.28	0.452
WALL 365-Clean Supply _0	Gypsum, Gypsum	0.3	105	0.28	0.452
WALL 366-Laundry _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 367-Meds _0	Gypsum, Gypsum	0.3	132	0.28	0.452
WALL 397-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 398-Corridor 5 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 154-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 399-Corridor 5 _0	Gypsum, Gypsum	0.3	136	0.28	0.452
WALL 400-Corridor 5 _0	Gypsum, Gypsum	0.3	112	0.28	0.452
WALL 401-Corridor 5 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 404-Corridor 4 _0	Gypsum, Gypsum	0.3	129	0.28	0.452
WALL 405-Corridor 4 _0	Gypsum, Gypsum	0.3	174	0.28	0.452
WALL 406-Corridor 4 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 407-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 408-Corridor 4 _0	Gypsum, Gypsum	0.3	125	0.28	0.452
WALL 409-Corridor 4 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 410-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 158-Lounge _0	Gypsum, Gypsum	0.3	140	0.28	0.452
WALL 411-Corridor 4 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 414-Corridor 3 _0	Gypsum, Gypsum	0.3	177	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 44 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 415-Corridor 3 _0	Gypsum, Gypsum	0.3	128	0.28	0.452
WALL 416-Corridor 3 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 417-Corridor 3 _0	Gypsum, Gypsum	0.3	126	0.28	0.452
WALL 418-Corridor 3 _0	Gypsum, Gypsum	0.3	102	0.28	0.452
WALL 419-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 420-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 421-Corridor 3 _0	Gypsum, Gypsum	0.3	124	0.28	0.452
WALL 422-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 165-Kitchen _0	Gypsum, Gypsum	0.3	88	0.28	0.452
WALL 423-Corridor 3 _0	Gypsum, Gypsum	0.3	127	0.28	0.452
WALL 44-Electric _0	Gypsum, Gypsum	0.3	230	0.28	0.452
WALL 507-Chart/Hotel _0	Gypsum, Gypsum	0.3	50	0.28	0.452
WALL 511-Comfort Room 2 _0	Gypsum, Gypsum	0.3	76	0.28	0.452
WALL 512-Corridor 2 _0	Gypsum, Gypsum	0.3	159	0.28	0.452
WALL 515-Corridor 2 _0	Gypsum, Gypsum	0.3	100	0.28	0.452
WALL 516-Corridor 2 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 517-Corridor 2 _0	Gypsum, Gypsum	0.3	63	0.28	0.452
WALL 518-Corridor 2.1 _0	Gypsum, Gypsum	0.3	101	0.28	0.452
WALL 519-Corridor 2.1 _0	Gypsum, Gypsum	0.3	79	0.28	0.452
WALL 166-Kitchen _0	Gypsum, Gypsum	0.3	29	0.28	0.452
WALL 520-Chart/Hotel _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 523-Corridor 2.1 _0	Gypsum, Gypsum	0.3	77	0.28	0.452
WALL 54-Comfort Room 1 _0	Gypsum, Gypsum	0.3	97	0.28	0.452

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 45 of 49

Opaque Interior

	Construction	Exterior Reflectance	Gross Area (ft²)	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)
WALL 550-Attrium _0	Gypsum, Gypsum	0.3	180	0.28	0.452
WALL 551-Attrium _0	Gypsum, Gypsum	0.3	119	0.28	0.452
WALL 552-Attrium _0	Gypsum, Gypsum	0.3	107	0.28	0.452
WALL 554-Attrium _0	Gypsum, Gypsum	0.3	287	0.28	0.452
WALL 556-Attrium _0	Gypsum, Gypsum	0.3	100	0.28	0.452

Opaque Exterior Door

	Construction	U-Factor With Film (BTU/h--ft²--°F)	U-Factor No Film (BTU/h--ft²--°F)	Gross Area (ft²)	Parent Surface
DOOR 00_D - WALL 260-Noisy Activity 2 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 260-Noisy Activity 2 _0
DOOR 01_D - WALL 301-Noisy Activity 3 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 301-Noisy Activity 3 _0
DOOR 02_D - WALL 106-Multipurpose/Dining _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 106-Multipurpose/Dining _0
DOOR 03_D - WALL 213-Noisy Activity 1 _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 213-Noisy Activity 1 _0
DOOR 04_D - WALL 172-Service _0	CASA - EXT DOOR SWINGING	0.579	1.14	49	WALL 172-Service _0
DOOR 05_D - WALL 179-Unconditioned Room Trash _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 179-Unconditioned Room Trash _0
DOOR 06_D - WALL 390-Staff Corridor _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 390-Staff Corridor _0
DOOR 07_D - WALL 40-Electric _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 40-Electric _0
DOOR 11_D - WALL 155-Lounge _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 155-Lounge _0
DOOR 12_D - WALL 311-Entry/Waiting _0	CASA - EXT DOOR SWINGING	0.579	1.14	28	WALL 311-Entry/Waiting _0
DOOR 22_D - WALL 836-Emergency Electric _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 836-Emergency Electric _0
DOOR 23_D - WALL 838-Fire Room _0	CASA - EXT DOOR SWINGING	0.579	1.14	21	WALL 838-Fire Room _0
DOOR 24_D - WALL 841-Sally Port _0	CASA - EXT DOOR SWINGING	0.579	1.14	26	WALL 841-Sally Port _0

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 00_W - WALL 412-Corridor 4_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 412-Corridor 4_0	270°	W
WINDOW 39_W - WALL 729-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 729-Attrium 2_18	270°	W
WINDOW 40_W - WALL 729-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 729-Attrium 2_18	270°	W
WINDOW 51_W - WALL 213-Noisy Activity 1_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 52_W - WALL 213-Noisy Activity 1_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 213-Noisy Activity 1_0	270°	W
WINDOW 57_W - WALL 225-Resident Room 06_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 225-Resident Room 06_0	270°	W
WINDOW 58_W - WALL 229-Resident Room 05_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 229-Resident Room 05_0	270°	W
WINDOW 59_W - WALL 269-Resident Room 11_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 269-Resident Room 11_0	270°	W
WINDOW 60_W - WALL 273-Resident Room 12_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 273-Resident Room 12_0	270°	W
WINDOW 61_W - WALL 277-Resident Room 13_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 277-Resident Room 13_0	270°	W
WINDOW 62_W - WALL 281-Resident Room 14_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 281-Resident Room 14_0	270°	W
WINDOW 06_W - WALL 402-Corridor 5_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 402-Corridor 5_0	180°	S
WINDOW 41_W - WALL 726-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 726-Attrium 2_18	180°	S
WINDOW 42_W - WALL 726-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 726-Attrium 2_18	180°	S
WINDOW 47_W - WALL 147-Office 2_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 147-Office 2_0	180°	S
WINDOW 48_W - WALL 151-Office 1_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 151-Office 1_0	180°	S
WINDOW 49_W - WALL 155-Lounge_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 155-Lounge_0	180°	S
WINDOW 50_W - WALL 155-Lounge_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 155-Lounge_0	180°	S
WINDOW 53_W - WALL 232-Quiet Activity 2_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 232-Quiet Activity 2_0	180°	S
WINDOW 54_W - WALL 236-Resident Room 07_0	Casa - Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 236-Resident Room 07_0	180°	S
WINDOW 55_W - WALL 239-Resident Room 08_0	Casa - Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 239-Resident Room 08_0	180°	S

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 47 of 49

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 56_W - WALL 242-Resident Room 09_0	Casa - Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 242-Resident Room 09_0	180°	S
WINDOW 04_W - WALL 313-Entry/Waiting_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 313-Entry/Waiting_0	0°	N
WINDOW 05_W - WALL 424-Corridor 3_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 424-Corridor 3_0	0°	N
WINDOW 07_W - WALL 247-Resident Room 10_0	Casa - Fixed Window	17.8	17.8	0.36	0.25	0.421	No	WALL 247-Resident Room 10_0	0°	N
WINDOW 45_W - WALL 728-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 728-Attrium 2_18	0°	N
WINDOW 46_W - WALL 728-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 728-Attrium 2_18	0°	N
WINDOW 66_W - WALL 208-Comfort Room 2_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 208-Comfort Room 2_0	0°	N
WINDOW 67_W - WALL 122-Consult 2_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 122-Consult 2_0	0°	N
WINDOW 68_W - WALL 119-Consult 1_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 119-Consult 1_0	0°	N
WINDOW 69_W - WALL 111-Group_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 111-Group_0	0°	N
WINDOW 70_W - WALL 111-Group_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 111-Group_0	0°	N
WINDOW 71_W - WALL 106-Multipurpose/Dining_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 72_W - WALL 106-Multipurpose/Dining_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 73_W - WALL 106-Multipurpose/Dining_0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 106-Multipurpose/Dining_0	0°	N
WINDOW 01_W - WALL 312-Entry/Waiting_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 02_W - WALL 312-Entry/Waiting_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 03_W - WALL 312-Entry/Waiting_0	Casa - Fixed Window	64.8	64.8	0.36	0.25	0.421	No	WALL 312-Entry/Waiting_0	90°	E
WINDOW 43_W - WALL 727-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 727-Attrium 2_18	90°	E
WINDOW 44_W - WALL 727-Attrium 2_18	Casa - Fixed Window	7.1	7.1	0.36	0.25	0.421	No	WALL 727-Attrium 2_18	90°	E
WINDOW 63_W - WALL 283-Resident Room 15_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 283-Resident Room 15_0	90°	E
WINDOW 64_W - WALL 288-Resident Room 16_0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 288-Resident Room 16_0	90°	E

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 48 of 49

Fenestration

	Construction	Area of One Opening (ft²)	Area of Openings (ft²)	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Parent Surface	Azimuth	Cardinal Direction
WINDOW 65_W - WALL 301- Noisy Activity 3 _0	Casa - Fixed Window	7.8	7.8	0.36	0.25	0.421	No	WALL 301-Noisy Activity 3 _0	90.55°	E
WINDOW 74_W - WALL 203- Resident Room 04 _0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 203-Resident Room 04 _0	90°	E
WINDOW 75_W - WALL 199- Resident Room 03 _0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 199-Resident Room 03 _0	90°	E
WINDOW 76_W - WALL 195- Resident Room 02 _0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 195-Resident Room 02 _0	90°	E
WINDOW 77_W - WALL 142- Resident Room 01 _0	Casa - Fixed Window	10.1	10.1	0.36	0.25	0.421	No	WALL 142-Resident Room 01 _0	90°	E
Total or Average		0	827	0.36	0.25	0.421			0°	
North Total or Average		0	223.7	0.36	0.25	0.421			0°	
Non-North Total or Average		0	603.3	0.36	0.25	0.421			0°	

Sunlit Fraction

* Sunlit Fraction is available for calculation timesteps of 15 minutes or less.

	March 21 9am	March 21 Noon	March 21 3pm	June 21 9am	June 21 Noon	June 21 3pm	December 21 9am	December 21 Noon	December 21 3pm
None	0	0	0	0	0	0	0	0	0

Window Controls

	Control Name	Type	Shaded	Control	Glare Control
None					

Load/Airflow Report

Title 24 - 2022 Baseline

System Name: PSZ-HP-Admin

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Admin			759	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Admin		189	1.89	9/21 14:00	119	2,473	3.14	119	100	12/21 04:00	119	945	17	17
		Office 1	94	0.94	10/21 14:00	66	1,366	3.49	66	100	12/21 04:00	66	497	17	17
		Office 2	95	0.95	10/21 13:00	58	1,204	3.05	58	100	12/21 04:00	58	464	17	17
	Chart/Hotel		200	2.00	7/21 19:00	70	1,411	1.75	70	100	12/21 04:00	70	433	31	31
		Chart/Hotel	200	2.00	7/21 19:00	67	1,364	1.68	67	100	12/21 04:00	67	403	33	33
	Entry/Waiting		370	1.85	7/21 09:00	492	10,216	6.64	492	100	12/21 24:00	492	4,562	6	6
		Entry/Waiting	370	1.85	7/21 09:00	495	10,282	6.68	495	100	12/21 24:00	495	4,574	6	6

System Name: PSZ-HP-Atrium

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Atrium			1,267	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Attrium		1,267	6.33	7/21 16:00	404	8,391	1.61	404	100	12/21 24:00	404	5,248	27	27
		Attrium	622	3.11	7/21 17:00	150	3,116	0.97	150	100	12/21 24:00	150	2,072	27	27
		Attrium 2	645	3.23	9/21 16:00	254	5,275	2.63	254	100	12/21 24:00	254	3,031	27	27

System Name: PSZ-HP-Utility

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Percent OA	
														Clg %	Htg %
PSZ-HP-Utility			3,530	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Support		603	0.00	9/21 10:00	429	8,884	3.55	429	100	12/21 04:00	429	3,827	8	8
		Electric	191	0.00	10/21 14:00	151	3,135	3.97	151	100	12/21 04:00	151	1,178	8	8
		Emergency Electric	179	0.00	7/21 09:00	122	2,530	3.41	122	100	12/21 04:00	122	815	8	8
		Fire Room	79	0.00	8/21 09:00	98	2,040	6.21	98	100	12/21 04:00	98	606	8	8
		Mechanical	155	0.00	7/21 19:00	57	1,182	1.84	57	100	12/21 04:00	57	375	8	8
	Utility		2,926	7.15	9/21 15:00	897	18,597	1.53	897	100	12/21 04:00	897	8,482	18	18
		Clean Supply	102	0.51	7/21 16:00	28	584	1.38	28	100	12/21 04:00	28	269	18	18
		Corridor 1	295	0.00	7/21 16:00	76	1,573	1.28	76	100	12/21 24:00	76	758	18	18
		Corridor 2	635	0.00	7/21 15:00	134	2,780	1.06	134	100	12/21 24:00	134	1,424	18	18
		Corridor 2.1	85	0.00	7/21 18:00	20	420	1.18	20	100	12/21 24:00	20	242	18	18
		General Storage	96	0.48	7/21 16:00	47	985	2.48	47	100	12/21 04:00	47	296	18	18
		Hskp	57	0.28	7/21 16:00	17	359	1.53	17	100	12/21 04:00	17	160	18	18
		IT	158	0.00	7/21 19:00	52	1,083	1.65	52	100	12/21 04:00	52	184	18	18
		Laundry	122	0.61	7/21 16:00	33	684	1.35	33	100	12/21 04:00	33	316	18	18
		Meds	129	0.65	7/21 16:00	36	746	1.39	36	100	12/21 04:00	36	346	18	18
		Soiled Supply	97	0.48	7/21 16:00	28	572	1.42	28	100	12/21 04:00	28	257	18	18
		Staff Corridor	893	0.00	9/21 14:00	338	7,001	1.89	338	100	12/21 18:00	338	2,819	18	18
		Stor.	15	0.07	7/21 16:00	9	183	3.04	9	100	12/21 04:00	9	88	18	18
		Storage	52	0.26	7/21 16:00	21	445	2.06	21	100	12/21 04:00	21	253	18	18
		Toilet 1	67	1.34	7/21 15:00	38	798	2.88	38	100	12/21 24:00	38	360	18	18
	Toilet 2	62	1.24	7/21 16:00	28	580	2.26	28	100	12/21 19:00	28	177	18	18	
	Toilet 3	62	1.23	7/21 15:00	29	593	2.32	29	100	12/21 19:00	29	185	18	18	

System Name: PSZ-HP-ResShwr

Location					Cooling					Heating			Percent OA		
			Area	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible		
System	Zone	Room	(ft²)		Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	%	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Clg %	Htg %
PSZ-HP-ResShwr			618	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	SHWR-N		204	4.07	7/21 12:00	98	2,038	2.41	98	100	12/21 24:00	98	936	0	0
		Shower 7	103	2.06	7/21 12:00	50	1,031	2.41	50	100	12/21 24:00	50	459	0	0
		Shower 8	101	2.01	7/21 13:00	48	1,000	2.39	48	100	12/21 24:00	48	467	0	0
	SHWR-S		207	4.14	7/21 18:00	110	2,279	2.65	110	100	12/21 24:00	110	925	0	0
		Shower 3	104	2.08	7/21 19:00	53	1,112	2.57	53	100	12/21 24:00	53	453	0	0
		Shower 4	103	2.06	7/21 18:00	56	1,164	2.71	56	100	12/21 24:00	56	470	0	0
	SHWR-W		207	4.14	7/21 18:00	96	1,986	2.31	96	100	12/21 24:00	96	939	0	0
		Shower 5	104	2.07	7/21 18:00	48	998	2.32	48	100	12/21 24:00	48	473	0	0
		Shower 6	104	2.07	7/21 18:00	47	983	2.28	47	100	12/21 24:00	47	461	0	0

System Name: PSZ-HP-Kitchen

Location				Cooling						Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of	Supply	Sensible	Minimum	Minimum	Minimum	Time of	Supply	Sensible	Clg %	Htg %
					Peak Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Peak Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Kitchen			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	13.10	10/21 14:00	2,853	59,206	20.81	2,853	100	12/21 04:00	2,853	14,634	6	6
		Kitchen	382	11.56	7/21 17:00	2,500	51,822	32.72	2,500	100	12/21 19:00	2,500	12,818	6	6
		Service	304	1.52	10/21 14:00	355	7,360	5.84	355	100	12/21 04:00	355	2,616	6	6

System Name: PSZ-HP-Clinical

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Clinical			1,548	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Comfort/Consult		283	2.83	7/21 16:00	154	3,196	2.71	154	100	12/21 24:00	154	1,191	47	47
	Comfort Room 2		82	0.82	7/21 15:00	44	924	2.71	44	100	12/21 24:00	44	355	47	47
	Consult 1		100	1.00	7/21 16:00	53	1,104	2.66	53	100	12/21 24:00	53	402	47	47
	Consult 2		102	1.02	7/21 16:00	55	1,144	2.71	55	100	12/21 24:00	55	416	47	47
	Exam/Storage		224	1.73	7/21 16:00	84	1,753	1.89	84	100	12/21 04:00	84	486	44	44
	Exam Room		123	1.23	7/21 16:00	53	1,098	2.15	53	100	12/21 19:00	53	188	45	45
	Long Term Belongings Storage		101	0.50	7/21 16:00	29	612	1.46	29	100	12/21 04:00	29	271	45	45
	Group		276	5.52	7/21 16:00	152	3,160	2.75	152	100	12/21 24:00	152	1,540	60	60
	Group		276	5.52	7/21 16:00	151	3,139	2.73	151	100	12/21 24:00	151	1,541	60	60
	Intake-HR-A		470	3.96	9/21 13:00	311	6,463	3.31	311	100	12/21 24:00	311	2,570	22	22
	Intake Corridor		155	0.00	7/21 16:00	40	832	1.30	40	100	12/21 20:00	40	385	22	22
	Interview Room		158	1.58	9/21 16:00	93	1,938	2.96	93	100	12/21 24:00	93	837	22	22
	Sally Port		78	0.78	11/21 13:00	137	2,837	8.79	137	100	12/21 19:00	137	689	22	22
	Shower 1		80	1.60	7/21 16:00	41	855	2.57	41	100	12/21 24:00	41	385	22	22
	Intake-HR-B		165	1.24	7/21 16:00	66	1,374	2.01	66	100	12/21 04:00	66	447	40	40
	Ante Room		81	0.40	7/21 16:00	25	515	1.53	25	100	12/21 04:00	25	225	39	39
	Comfort Room 1		84	0.84	9/21 14:00	43	900	2.58	43	100	12/21 07:00	43	225	39	39
	RB-S-Corner-N		129	1.29	9/21 15:00	94	1,956	3.65	94	100	12/21 24:00	94	845	15	15
	Resident Room 04		129	1.29	9/21 15:00	94	1,960	3.66	94	100	12/21 24:00	94	848	15	15

System Name: PSZ-HP-Activity

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Activity			935	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	3.59	8/21 17:00	199	4,125	5.53	199	100	12/21 24:00	199	1,204	19	19
		Noisy Activity 1	180	3.59	8/21 17:00	198	4,113	5.51	198	100	12/21 24:00	198	1,200	19	19
	ACT-Noisy-2		181	3.61	7/21 18:00	103	2,138	2.84	103	100	12/21 24:00	103	985	37	37
		Noisy Activity 2	181	3.61	7/21 18:00	102	2,112	2.81	102	100	12/21 24:00	102	970	37	37
	ACT-Noisy-3		182	3.64	7/21 15:00	107	2,215	2.93	107	100	12/21 24:00	107	1,202	36	36
		Noisy Activity 3	182	3.64	7/21 15:00	106	2,202	2.91	106	100	12/21 24:00	106	1,197	36	36
	ACT-Quiet-1		130	2.60	9/21 15:00	60	1,249	2.31	60	100	12/21 24:00	60	383	45	45
		Quiet Activity 1	130	2.60	9/21 15:00	60	1,246	2.30	60	100	12/21 24:00	60	378	46	46
	ACT-Quiet-2		131	2.61	9/21 15:00	76	1,587	2.93	76	100	12/21 24:00	76	545	36	36
		Quiet Activity 2	131	2.61	9/21 15:00	75	1,557	2.87	75	100	12/21 24:00	75	526	37	37
	ACT-Quiet-3		131	2.62	7/21 19:00	74	1,545	2.83	74	100	12/21 24:00	74	552	37	37
		Quiet Activity 3	131	2.62	7/21 19:00	74	1,538	2.82	74	100	12/21 24:00	74	548	37	37

System Name: PSZ-HP-ResBed-W

Location					Cooling					Heating			Percent OA		
			Area	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg	Htg
System	Zone	Room	(ft²)		Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	%	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	%	%
PSZ-HP-ResBed-W			833	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-W		324	0.00	7/21 17:00	199	4,130	3.07	199	100	12/21 24:00	199	1,376	10	10
		Corridor 4	324	0.00	7/21 17:00	198	4,106	3.05	198	100	12/21 24:00	198	1,359	10	10
	RB-W-North		130	1.30	7/21 18:00	113	2,043	4.35	113	100	12/21 24:00	113	903	13	13
		Resident Room 10	130	1.30	7/21 18:00	113	2,041	4.35	113	100	12/21 24:00	113	902	13	13
	RB-W-South		380	3.80	10/21 14:00	322	6,674	4.24	322	100	12/21 24:00	322	2,326	13	13
		Resident Room 07	125	1.25	10/21 14:00	104	2,150	4.13	104	100	12/21 24:00	104	672	13	13
		Resident Room 08	126	1.26	10/21 14:00	107	2,225	4.25	107	100	12/21 24:00	107	707	13	13
		Resident Room 09	128	1.28	9/21 15:00	112	2,327	4.38	112	100	12/21 24:00	112	909	13	13

System Name: PSZ-HP-ResBed-N

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-ResBed-N			1,179	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-N		409	0.00	7/21 18:00	116	2,402	1.41	116	100	12/21 24:00	116	1,584	21	21
		Corridor 3	409	0.00	7/21 18:00	115	2,395	1.41	115	100	12/21 24:00	115	1,579	21	21
	RB-N-Corner		130	1.30	7/21 18:00	128	2,247	4.93	128	100	12/21 24:00	128	853	11	11
		Resident Room 14	130	1.30	7/21 18:00	129	2,248	4.93	129	100	12/21 24:00	129	853	11	11
	RB-N-East		257	2.57	7/21 10:00	202	3,738	3.93	202	100	12/21 24:00	202	1,508	14	14
		Resident Room 15	130	1.30	7/21 10:00	103	1,913	3.97	103	100	12/21 24:00	103	863	14	14
		Resident Room 16	127	1.27	7/21 10:00	98	1,819	3.88	98	100	12/21 24:00	98	644	14	14
	RB-N-West		383	3.83	7/21 18:00	348	6,225	4.54	348	100	12/21 24:00	348	1,911	12	12
		Resident Room 11	129	1.29	7/21 18:00	115	2,063	4.46	115	100	12/21 24:00	115	627	12	12
		Resident Room 12	127	1.27	7/21 18:00	115	2,070	4.56	115	100	12/21 24:00	115	626	12	12
		Resident Room 13	127	1.27	7/21 18:00	116	2,081	4.58	116	100	12/21 24:00	116	643	12	12

System Name: PSZ-HP-ResBed-S

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-ResBed-S			1,041	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-S		414	0.00	10/21 13:00	183	3,771	2.21	183	100	12/21 24:00	183	1,560	14	14
		Corridor 5	414	0.00	10/21 13:00	182	3,758	2.20	182	100	12/21 24:00	182	1,554	14	14
	RB-S-Corner-S		131	1.31	9/21 17:00	114	2,376	4.36	114	100	12/21 24:00	114	859	13	13
		Resident Room 05	131	1.31	9/21 17:00	114	2,375	4.35	114	100	12/21 24:00	114	857	13	13
	RB-S-East		372	3.72	7/21 10:00	282	5,253	3.79	282	100	12/21 24:00	282	1,788	15	15
		Resident Room 01	124	1.24	8/21 10:00	89	1,655	3.59	89	100	12/21 24:00	89	536	15	15
		Resident Room 02	112	1.12	7/21 10:00	89	1,665	4.00	89	100	12/21 24:00	89	562	15	15
		Resident Room 03	136	1.36	7/21 10:00	104	1,931	3.80	104	100	12/21 24:00	104	677	15	15
	RB-S-West		124	1.24	7/21 18:00	112	2,014	4.53	112	100	12/21 24:00	112	626	12	12
		Resident Room 06	124	1.24	7/21 18:00	112	2,010	4.52	112	100	12/21 24:00	112	624	12	12

System Name: PSZ-HP-Common

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Clg %	Htg %
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)		
PSZ-HP-Common			1,256	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Hospitality		246	4.92	7/21 16:00	274	2,877	5.57	274	100	12/21 24:00	274	1,381	30	30
		Hospitality	246	4.92	7/21 16:00	274	2,878	5.57	274	100	12/21 24:00	274	1,383	30	30
	Lounge		297	5.93	10/21 14:00	290	5,994	4.88	290	100	12/21 24:00	290	1,769	23	23
		Lounge	198	3.95	10/21 14:00	223	4,625	5.65	223	100	12/21 19:00	223	1,316	23	23
		Shower 2	99	1.98	9/21 15:00	66	1,370	3.34	66	100	12/21 19:00	66	364	23	23
	Multipurpose/Dining		485	9.70	7/21 15:00	268	5,563	2.76	268	100	12/21 24:00	268	2,708	60	60
		Multipurpose/Dining	485	9.70	7/21 15:00	267	5,549	2.75	267	100	12/21 24:00	267	2,706	60	60
	Servery		228	4.56	7/21 16:00	120	2,500	2.64	120	100	12/21 24:00	120	1,094	63	63
		Servery	228	4.56	7/21 16:00	120	2,495	2.63	120	100	12/21 24:00	120	1,093	63	63

Load/Airflow Report

Primary

System Name: Single Zone CV

Location				Cooling						Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Kitchen	686	13.10	9/21 16:00	2,532	28,499	18.46	2,532	100	12/21 04:00	2,532	3,484	0	0
		Kitchen	382	11.56	7/21 18:00	2,500	28,254	32.72	2,500	100	12/21 20:00	2,500	12,818	0	0
		Service	304	1.52	9/21 16:00	359	4,060	5.91	359	100	12/21 04:00	359	2,320	0	0

System Name: Variable Refrigerant Flow

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak	Supply	Sensible	Minimum	Minimum	Minimum	Time of Peak	Supply	Sensible	Percent OA	
					Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Airflow ACH	Airflow (cfm)	Airflow %	Mo/D/Hr	Airflow (cfm)	Load (Btu/h)	Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	3.59	8/21 17:00	119	2,471	1.05	38	100	12/21 24:00	119	1,661	100	100
	Noisy Activity 1		180	3.59	8/21 17:00	119	2,464	1.05	38	100	12/21 23:00	119	1,658	100	100
	ACT-Noisy-2		181	3.61	7/21 18:00	60	1,254	1.05	38	100	12/21 24:00	60	1,451	100	100
	Noisy Activity 2		181	3.61	7/21 18:00	59	1,231	1.05	38	100	12/21 23:00	59	1,436	100	100
	ACT-Noisy-3		182	3.64	7/21 15:00	65	1,341	1.05	38	100	12/21 24:00	65	1,674	100	100
	Noisy Activity 3		182	3.64	7/21 15:00	64	1,332	1.05	38	100	12/21 23:00	64	1,671	100	100
	ACT-Quiet-1		130	2.60	9/21 15:00	35	731	1.05	27	100	12/21 24:00	35	766	100	100
	Quiet Activity 1		130	2.60	9/21 14:00	35	725	1.05	27	100	12/21 23:00	35	760	100	100
	ACT-Quiet-2		131	2.61	9/21 15:00	51	1,062	1.05	27	100	12/21 24:00	51	925	100	100
	Quiet Activity 2		131	2.61	9/21 15:00	50	1,044	1.05	27	100	12/21 23:00	50	907	100	100
	ACT-Quiet-3		131	2.62	7/21 19:00	49	1,013	1.05	28	100	12/21 24:00	49	933	100	100
	Quiet Activity 3		131	2.62	7/21 19:00	48	1,007	1.05	28	100	12/21 23:00	48	930	100	100
	Admin		189	1.89	9/21 14:00	80	1,671	0.55	21	100	12/21 04:00	80	1,188	100	100
	Office 1		94	0.94	10/21 14:00	44	916	0.55	10	100	12/21 04:00	44	614	100	100
	Office 2		95	0.95	10/21 13:00	40	828	0.55	10	100	12/21 04:00	40	587	100	100
	Attrium		1,267	6.33	7/21 17:00	251	5,223	0.43	108	100	12/21 24:00	251	6,620	100	100
	Attrium		622	3.11	7/21 17:00	87	1,818	0.34	53	100	12/21 23:00	87	2,760	100	100
	Attrium 2		645	3.23	7/21 17:00	164	3,405	0.57	55	100	12/21 23:00	164	3,695	100	100
	Chart/Hotel		200	2.00	7/21 19:00	44	907	0.55	22	100	12/21 04:00	44	729	100	100
	Chart/Hotel		200	2.00	7/21 19:00	41	861	0.55	22	100	12/21 04:00	41	700	100	100
	Comfort/Consult		283	2.83	7/21 17:00	72	1,481	1.27	72	100	12/21 24:00	72	2,190	100	100
	Comfort Room 2		82	0.82	7/21 17:00	21	436	1.27	21	100	12/21 23:00	21	644	100	100
	Consult 1		100	1.00	7/21 17:00	25	502	1.27	25	100	12/21 23:00	25	756	100	100
	Consult 2		102	1.02	7/21 17:00	26	535	1.27	26	100	12/21 23:00	26	776	100	100
	Corridor-N		409	0.00	7/21 18:00	80	1,670	0.30	25	100	12/21 24:00	80	1,840	100	100
	Corridor 3		409	0.00	7/21 18:00	80	1,665	0.30	25	100	12/21 23:00	80	1,836	100	100
	Corridor-S		414	0.00	10/21 13:00	152	3,127	0.30	25	100	12/21 24:00	152	1,818	100	100
	Corridor 5		414	0.00	10/21 13:00	151	3,125	0.30	25	100	12/21 23:00	151	1,813	100	100
	Corridor-W		324	0.00	7/21 17:00	171	3,549	0.30	19	100	12/21 24:00	171	1,577	100	100
	Corridor 4		324	0.00	7/21 17:00	170	3,529	0.30	19	100	12/21 23:00	170	1,561	100	100
	Entry/Waiting		370	1.85	7/21 09:00	454	9,432	0.43	31	100	12/21 24:00	454	4,841	100	100
	Entry/Waiting		370	1.85	7/21 09:00	457	9,498	0.43	31	100	12/21 24:00	457	4,857	100	100

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 13 of 17

Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Exam/Storage	224	1.73	7/21 19:00	50	1,034	0.84	37	100	12/21 04:00	50	1,271	100	100
		Exam Room	123	1.23	7/21 19:00	31	363	1.28	31	100	12/21 19:00	31	625	100	100
		Long Term Belongings Storage	101	0.50	7/21 19:00	18	382	0.30	6	100	12/21 04:00	18	324	100	100
	Group		276	5.52	7/21 18:00	91	1,116	1.65	91	100	12/21 24:00	91	2,835	100	100
		Group	276	5.52	7/21 18:00	91	1,111	1.65	91	100	12/21 23:00	91	2,838	100	100
	Hospitality		246	4.92	7/21 17:00	81	1,072	1.65	81	100	12/21 24:00	81	2,535	100	100
		Hospitality	246	4.92	7/21 17:00	81	1,073	1.65	81	100	12/21 23:00	81	2,537	100	100
	Intake-HR-A		470	3.96	9/21 14:00	151	3,125	0.74	69	100	12/21 24:00	151	3,609	100	100
		Intake Corridor	155	0.00	7/21 18:00	18	374	0.30	9	100	12/21 23:00	18	468	100	100
		Interview Room	158	1.58	9/21 16:00	47	965	1.28	40	100	12/21 23:00	47	1,392	100	100
		Sally Port	78	0.78	10/21 13:00	51	1,053	1.28	20	100	12/21 19:00	51	909	100	100
		Shower 1	80	1.60	7/21 17:00	35	729	0.00	0	0	12/21 24:00	35	353	100	100
	Intake-HR-B		165	1.24	7/21 19:00	37	771	0.80	26	100	12/21 04:00	37	916	100	100
		Ante Room	81	0.40	7/21 19:00	16	327	0.30	5	100	12/21 04:00	16	268	100	100
		Comfort Room 1	84	0.84	7/21 18:00	21	327	1.28	21	100	12/21 07:00	21	514	100	100
	Lounge		297	5.93	9/21 15:00	148	3,074	1.10	65	100	12/21 24:00	148	2,717	100	100
		Lounge	198	3.95	10/21 14:00	94	1,939	1.65	65	100	12/21 19:00	94	2,180	100	100
		Shower 2	99	1.98	9/21 17:00	54	1,129	0.00	0	0	12/21 20:00	54	319	100	100
	Multipurpose/Dining		485	9.70	7/21 16:00	160	1,837	1.65	160	100	12/21 24:00	160	4,918	100	100
		Multipurpose/Dining	485	9.70	7/21 18:00	160	1,828	1.65	160	100	12/21 23:00	160	4,917	100	100
	RB-N-Corner		130	1.30	7/21 18:00	100	2,086	0.55	14	100	12/21 24:00	100	1,033	100	100
		Resident Room 14	130	1.30	7/21 18:00	100	2,087	0.55	14	100	12/21 23:00	100	1,033	100	100
	RB-N-East		257	2.57	7/21 10:00	167	3,466	0.55	28	100	12/21 24:00	167	1,863	100	100
		Resident Room 15	130	1.30	7/21 10:00	86	1,781	0.55	14	100	12/21 23:00	86	1,042	100	100
		Resident Room 16	127	1.27	7/21 10:00	81	1,680	0.55	14	100	12/21 23:00	81	820	100	100
	RB-N-West		383	3.83	7/21 18:00	277	5,751	0.55	42	100	12/21 24:00	277	2,443	100	100
		Resident Room 11	129	1.29	7/21 18:00	91	1,899	0.55	14	100	12/21 23:00	91	806	100	100
		Resident Room 12	127	1.27	7/21 18:00	92	1,914	0.55	14	100	12/21 23:00	92	802	100	100
		Resident Room 13	127	1.27	7/21 18:00	93	1,925	0.55	14	100	12/21 23:00	93	819	100	100
	RB-S-Corner-N		129	1.29	9/21 14:00	87	1,815	0.55	14	100	12/21 24:00	87	1,023	100	100
		Resident Room 04	129	1.29	9/21 14:00	88	1,819	0.55	14	100	12/21 23:00	88	1,026	100	100
	RB-S-Corner-S		131	1.31	9/21 17:00	107	2,222	0.55	14	100	12/21 24:00	107	1,039	100	100
		Resident Room 05	131	1.31	9/21 17:00	107	2,221	0.55	14	100	12/21 23:00	107	1,038	100	100

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 14 of 17

Location				Cooling						Heating			Percent OA		
			Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Percent OA	
System	Zone	Room												Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-East		372	3.72	7/21 10:00	235	4,882	0.55	41	100	12/21 24:00	235	2,303	100	100
		Resident Room 01	124	1.24	8/21 10:00	73	1,527	0.55	14	100	12/21 23:00	73	707	100	100
		Resident Room 02	112	1.12	7/21 10:00	75	1,558	0.55	12	100	12/21 23:00	75	716	100	100
		Resident Room 03	136	1.36	7/21 10:00	86	1,797	0.55	15	100	12/21 23:00	86	867	100	100
	RB-S-West		124	1.24	7/21 18:00	89	1,843	0.55	14	100	12/21 24:00	89	797	100	100
		Resident Room 06	124	1.24	7/21 18:00	89	1,842	0.55	14	100	12/21 23:00	89	796	100	100
	RB-W-North		130	1.30	7/21 18:00	90	1,869	0.55	14	100	12/21 24:00	90	1,082	100	100
		Resident Room 10	130	1.30	7/21 18:00	90	1,868	0.55	14	100	12/21 23:00	90	1,081	100	100
	RB-W-South		380	3.80	10/21 14:00	304	6,302	0.55	42	100	12/21 24:00	304	2,853	100	100
		Resident Room 07	125	1.25	10/21 14:00	98	2,025	0.55	14	100	12/21 23:00	98	846	100	100
		Resident Room 08	126	1.26	10/21 14:00	101	2,104	0.55	14	100	12/21 23:00	101	882	100	100
		Resident Room 09	128	1.28	9/21 15:00	105	2,190	0.55	14	100	12/21 23:00	105	1,086	100	100
	Servery		228	4.56	7/21 17:00	75	828	1.65	75	100	12/21 24:00	75	2,162	100	100
		Servery	228	4.56	7/21 17:00	75	826	1.65	75	100	12/21 23:00	75	2,163	100	100
	SHWR-N		204	4.07	7/21 12:00	94	1,946	0.00	0	0	12/21 24:00	94	868	100	100
		Shower 7	103	2.06	7/21 12:00	48	992	0.00	0	0	12/21 24:00	48	427	100	100
		Shower 8	101	2.01	7/21 12:00	46	947	0.00	0	0	12/21 24:00	46	431	100	100
	SHWR-S		207	4.14	7/21 18:00	101	2,099	0.00	0	0	12/21 24:00	101	855	100	100
		Shower 3	104	2.08	7/21 18:00	50	1,043	0.00	0	0	12/21 24:00	50	420	100	100
		Shower 4	103	2.06	7/21 18:00	51	1,050	0.00	0	0	12/21 24:00	51	432	100	100
	SHWR-W		207	4.14	7/21 18:00	89	1,853	0.00	0	0	12/21 24:00	89	870	100	100
		Shower 5	104	2.07	7/21 18:00	45	939	0.00	0	0	12/21 24:00	45	441	100	100
		Shower 6	104	2.07	7/21 18:00	44	910	0.00	0	0	12/21 24:00	44	425	100	100
	Support		603	0.00	7/21 19:00	220	4,564	0.30	36	100	12/21 04:00	220	3,423	100	100
		Electric	191	0.00	9/21 15:00	76	1,567	0.30	11	100	12/21 01:00	76	1,203	100	100
		Emergency Electric	179	0.00	7/21 09:00	59	1,223	0.30	11	100	12/21 01:00	59	843	100	100
		Fire Room	79	0.00	8/21 09:00	42	871	0.30	5	100	12/21 01:00	42	597	100	100
		Mechanical	155	0.00	7/21 19:00	43	899	0.30	9	100	12/21 01:00	43	454	100	100


Location					Cooling					Heating			Percent OA		
System	Zone	Room	Area (ft²)	People	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Minimum Airflow ACH	Minimum Airflow (cfm)	Minimum Airflow %	Time of Peak Mo/D/Hr	Supply Airflow (cfm)	Sensible Load (Btu/h)	Percent OA	
														Clg %	Htg %
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	7.15	7/21 19:00	496	10,316	0.28	164	100	12/21 04:00	496	9,762	100	100
		Clean Supply	102	0.51	7/21 19:00	17	355	0.30	6	100	12/21 04:00	17	323	100	100
		Corridor 1	295	0.00	7/21 18:00	36	744	0.30	18	100	12/21 23:00	36	920	100	100
		Corridor 2	635	0.00	7/21 18:00	61	1,263	0.30	38	100	12/21 23:00	61	1,810	100	100
		Corridor 2.1	85	0.00	9/21 16:00	12	246	0.30	5	100	12/21 23:00	12	292	100	100
		General Storage	96	0.48	7/21 19:00	36	742	0.30	6	100	12/21 04:00	36	342	100	100
		Hskp	57	0.28	7/21 19:00	11	223	0.30	3	100	12/21 04:00	11	190	100	100
		IT	158	0.00	7/21 19:00	40	821	0.30	9	100	12/21 04:00	40	281	100	100
		Laundry	122	0.61	7/21 19:00	20	413	0.30	7	100	12/21 04:00	20	382	100	100
		Meds	129	0.65	7/21 19:00	21	446	0.30	8	100	12/21 04:00	21	415	100	100
		Soiled Supply	97	0.48	7/21 19:00	17	350	0.30	6	100	12/21 04:00	17	309	100	100
		Staff Corridor	893	0.00	9/21 16:00	144	2,974	0.30	54	100	12/21 07:00	144	3,186	100	100
		Stor.	15	0.07	7/21 19:00	7	144	0.00	0	0	12/21 04:00	7	90	100	100
		Storage	52	0.26	7/21 19:00	16	336	0.30	3	100	12/21 04:00	16	278	100	100
		Toilet 1	67	1.34	7/21 10:00	35	724	0.00	0	0	12/21 24:00	35	330	100	100
		Toilet 2	62	1.24	7/21 18:00	18	462	0.00	0	0	12/21 20:00	18	151	100	100
		Toilet 3	62	1.23	7/21 18:00	19	467	0.00	0	0	12/21 20:00	19	157	100	100

System Name: DOAS to Zone Level Equipment Dehum and Reheat

Location			Cooling							Heating			Percent OA		
System	Zone	Room	Area	People	Time of Peak	Supply Airflow	Sensible Load	Minimum Airflow	Minimum Airflow	Minimum Airflow	Time of Peak	Supply Airflow	Sensible Load	Clg	Htg
			(ft²)		Mo/D/Hr	(cfm)	(Btu/h)	ACH	(cfm)	%	Mo/D/Hr	(cfm)	(Btu/h)	%	%
DOAS to Zone Level Equipment Dehum and Reheat			0	111.06	7/21 15:00	1,550	70,661	0.00	1,550	100		N/A	0	100	100

Zone Summary

Zone Summary										
Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
ACT-Noisy-1	180	Yes	2,156	174	37	50.06	0.73	0.5	0 	10.47
ACT-Noisy-2	181	Yes	2,170	92	21	50.06	0.73	0.5	0 	10.47
ACT-Noisy-3	182	Yes	2,186	161	29	50.06	0.73	0.5	0 	10.47
ACT-Quiet-1	130	Yes	1,564	0	0	50.06	0.73	0.5	0 	10.47
ACT-Quiet-2	131	Yes	1,568	48	8	50.06	0.73	0.5	0 	10.47
ACT-Quiet-3	131	Yes	1,573	128	0	50.06	0.73	0.5	0 	10.47
Admin	189	Yes	2,272	215	16	100.01	0.73	1	0 	10.47
Attrium	1,267	Yes	15,043	1,046	57	200.01	0.59	0	0 	10.47
Chart/Hotel	200	Yes	2,395	0	0	100.01	0.73	1	0 	10.47
Comfort/Consult	283	Yes	3,402	336	23	100.01	0.99	0.75	0 	10.47
Corridor-N	409	Yes	4,909	100	65	0	0.66	0	0 	10.47
Corridor-S	414	Yes	4,967	101	65	0	0.66	0	0 	10.47
Corridor-W	324	Yes	3,888	100	65	0	0.66	0	0 	10.47
Entry/Waiting	370	Yes	4,445	625	287	200.01	0.59	0	0 	10.47
Exam/Storage	224	Yes	2,685	0	0	129.07	0.76	0.52	0 	10.47
Group	276	Yes	3,317	295	16	50.06	0.65	0.5	0 	10.47
Hospitality	246	Yes	2,953	260	0	50.06	0.65	0.5	0 	10.47
Intake-HR-A	470	Yes	5,646	449	26	118.85	0.84	0.38	0 	10.47
Intake-HR-B	165	Yes	1,976	27	0	132.52	0.74	0.5	0 	10.47
Kitchen	686	Yes	8,226	607	49	52.32	0.89	9.58	0 	10.47
Lounge	297	Yes	3,561	250	37	50.06	0.68	0.33	0 	10.47
Multipurpose/Dining	485	Yes	5,825	322	44	50.06	0.65	0.5	0 	10.47

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
RB-N-Corner	130	Yes	1,565	288	10	100.01	0.62	2	0 	10.47
RB-N-East	257	Yes	3,084	412	20	100.01	0.62	2	0 	10.47
RB-N-West	383	Yes	4,590	374	30	100.01	0.62	2	0 	10.47
RB-S-Corner-N	129	Yes	1,549	286	10	100.01	0.62	2	0 	10.47
RB-S-Corner-S	131	Yes	1,575	289	10	100.01	0.62	2	0 	10.47
RB-S-East	372	Yes	4,463	328	30	100.01	0.62	2	0 	10.47
RB-S-West	124	Yes	1,488	122	10	100.01	0.62	2	0 	10.47
RB-W-North	130	Yes	1,557	288	18	100.01	0.62	2	0 	10.47
RB-W-South	380	Yes	4,554	534	53	100.01	0.62	2	0 	10.47
Servery	228	Yes	2,738	160	0	50.06	0.65	0.5	0 	10.47
SHWR-N	204	Yes	2,443	202	0	50.06	0.75	0	0 	10.47
SHWR-S	207	Yes	2,486	206	0	50.06	0.75	0	0 	10.47
SHWR-W	207	Yes	2,485	204	0	50.06	0.75	0	0 	10.47
Support	603	Yes	7,241	661	63	0	0.5	2	0 	10.47
Utility	2,926	Yes	35,118	109	28	409.28	0.62	0.17	0 	10.47
Room 00-80	4	No	46	362	0	0	0	0	0 	10.47
Room 00-81	3	No	40	151	0	50.06	0.65	0.5	0 	10.47
Room 01-00	634	No	2,007	51	0	0	0	0	0 	10.47
Room 01-01	748	No	2,384	57	0	0	0	0	0 	10.47
Room 01-03	1,001	No	3,162	55	0	0	0	0	0 	10.47
Room 01-04	959	No	2,991	51	0	0	0	0	0 	10.47
Room 01-06	1,009	No	3,156	60	0	0	0	0	0 	10.47
Room 01-08	1,572	No	4,817	648	0	0	0	0	0 	10.47
Room 01-10	769	No	2,563	56	0	0	0	0	0 	10.47

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
Room 01-12	675	No	2,044	340	0	0	0	0	0	10.47
Trash	76	No	915	96	28	200.01	0.48	0.25	0	10.47
Conditioned Total	13,652		163,664	9,802	1,126	110.02	0.67	1.06	0	10.47
Total	21,103		187,790	11,729	1,154	169.33	0.43	0.69	0	10.47
Unconditioned Total	7,451		24,127	1,927	28	16,614.43	0.01	0	0	10.47

Design Day: Zone Cooling (1%) and Heating (99%)

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
ACT-Noisy-1	Cooling	0.3 tons	0.3 tons	199	199	8/21 17:00	94	0	0	2.7
	Heating	1.2 Mbh	1.2 Mbh	199	199	12/21 24:00	32.1	0	0	9.8
ACT-Noisy-2	Cooling	0.2 tons	0.2 tons	104	104	7/21 18:00	91.4	0	0	2.7
	Heating	1 Mbh	1 Mbh	104	104	12/21 24:00	32.1	0	0	9.8
ACT-Noisy-3	Cooling	0.2 tons	0.2 tons	106	106	7/21 15:00	98.8	0	0	2.7
	Heating	1.2 Mbh	1.2 Mbh	106	106	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-1	Cooling	0.1 tons	0.1 tons	59	59	9/21 15:00	98.4	0	0	2.7
	Heating	0.4 Mbh	0.4 Mbh	59	59	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-2	Cooling	0.1 tons	0.1 tons	76	76	9/21 15:00	98.4	0	0	2.7
	Heating	0.5 Mbh	0.5 Mbh	76	76	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-3	Cooling	0.1 tons	0.1 tons	74	74	7/21 19:00	86.7	0	0	2.7
	Heating	0.6 Mbh	0.6 Mbh	74	74	12/21 24:00	32.1	0	0	9.8
Admin	Cooling	0.2 tons	0.2 tons	119	119	9/21 14:00	98.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	119	119	12/21 04:00	32.1	0	0	9.8
Attrium	Cooling	0.7 tons	0.7 tons	379	405	7/21 16:00	96.9	0	0	2.7
	Heating	4.9 Mbh	5.2 Mbh	379	405	12/21 24:00	32.1	0	0	9.8

Alternative: Title 24 - 2022 Baseline


File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 3 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min Max	Calculated Heating Load (Mbh) Min Max
Chart/Hotel	Cooling	0.1 tons	0.1 tons	70	70	7/21 19:00	86.7	0	0 	2.7
	Heating	0.4 Mbh	0.4 Mbh	70	70	12/21 04:00	32.1	0	0 	9.8
Comfort/Consult	Cooling	0.3 tons	0.3 tons	155	155	7/21 16:00	96.9	0	0 	2.7
	Heating	1.2 Mbh	1.2 Mbh	155	155	12/21 24:00	32.1	0	0 	9.8
Corridor-N	Cooling	0.2 tons	0.2 tons	117	117	7/21 18:00	91.4	0	0 	2.7
	Heating	1.6 Mbh	1.6 Mbh	117	117	12/21 24:00	32.1	0	0 	9.8
Corridor-S	Cooling	0.3 tons	0.3 tons	182	182	10/21 13:00	88.4	0	0 	2.7
	Heating	1.6 Mbh	1.6 Mbh	182	182	12/21 24:00	32.1	0	0 	9.8
Corridor-W	Cooling	0.3 tons	0.3 tons	199	199	7/21 17:00	94.5	0	0 	2.7
	Heating	1.4 Mbh	1.4 Mbh	199	199	12/21 24:00	32.1	0	0 	9.8
Entry/Waiting	Cooling	0.9 tons	0.9 tons	492	492	7/21 09:00	81.8	0	0 	2.7
	Heating	4.6 Mbh	4.6 Mbh	492	492	12/21 24:00	32.1	0	0 	9.8
Exam/Storage	Cooling	0.1 tons	0.1 tons	85	85	7/21 16:00	96.9	0	0 	2.7
	Heating	0.5 Mbh	0.5 Mbh	85	85	12/21 04:00	32.1	0	0 	9.8
Group	Cooling	0.3 tons	0.3 tons	153	153	7/21 16:00	96.9	0	0 	2.7
	Heating	1.5 Mbh	1.5 Mbh	153	153	12/21 24:00	32.1	0	0 	9.8
Hospitality	Cooling	0.2 tons	0.2 tons	273	273	7/21 16:00	96.9	0	0 	2.7
	Heating	1.4 Mbh	1.4 Mbh	269	269	12/21 24:00	32.1	0	0 	9.8
Intake-HR-A	Cooling	0.5 tons	0.5 tons	271	311	9/21 13:00	96.8	0	0 	2.7
	Heating	2.3 Mbh	2.6 Mbh	273	311	12/21 24:00	32.1	0	0 	9.8
Intake-HR-B	Cooling	0.1 tons	0.1 tons	66	66	7/21 16:00	96.9	0	0 	2.7
	Heating	0.4 Mbh	0.4 Mbh	66	66	12/21 04:00	32.1	0	0 	9.8
Kitchen	Cooling	2.7 tons	4.9 tons	1,551	2,854	10/21 14:00	89.8	0	0 	2.7
	Heating	4 Mbh	14.6 Mbh	771	2,854	12/21 04:00	32.1	0	0 	9.8
Lounge	Cooling	0.5 tons	0.5 tons	275	290	10/21 14:00	89.8	0	0 	2.7

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min Max	Calculated Heating Load (Mbh) Min Max
	Heating	1.7 Mbh	1.8 Mbh	275	290	12/21 24:00	32.1	0	0	9.8
Multipurpose/Dining	Cooling	0.5 tons	0.5 tons	267	267	7/21 15:00	98.8	0	0	2.7
	Heating	2.7 Mbh	2.7 Mbh	267	267	12/21 24:00	32.1	0	0	9.8
RB-N-Corner	Cooling	0.2 tons	0.2 tons	129	129	7/21 18:00	91.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	129	129	12/21 24:00	32.1	0	0	9.8
RB-N-East	Cooling	0.3 tons	0.3 tons	201	201	7/21 10:00	87	0	0	2.7
	Heating	1.5 Mbh	1.5 Mbh	201	201	12/21 24:00	32.1	0	0	9.8
RB-N-West	Cooling	0.5 tons	0.5 tons	347	347	7/21 18:00	91.4	0	0	2.7
	Heating	1.9 Mbh	1.9 Mbh	347	347	12/21 24:00	32.1	0	0	9.8
RB-S-Corner-N	Cooling	0.2 tons	0.2 tons	93	93	9/21 15:00	98.4	0	0	2.7
	Heating	0.8 Mbh	0.8 Mbh	93	93	12/21 24:00	32.1	0	0	9.8
RB-S-Corner-S	Cooling	0.2 tons	0.2 tons	114	114	9/21 17:00	94.1	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	114	114	12/21 24:00	32.1	0	0	9.8
RB-S-East	Cooling	0.4 tons	0.4 tons	282	282	7/21 10:00	87	0	0	2.7
	Heating	1.8 Mbh	1.8 Mbh	282	282	12/21 24:00	32.1	0	0	9.8
RB-S-West	Cooling	0.2 tons	0.2 tons	112	112	7/21 18:00	91.4	0	0	2.7
	Heating	0.6 Mbh	0.6 Mbh	112	112	12/21 24:00	32.1	0	0	9.8
RB-W-North	Cooling	0.2 tons	0.2 tons	112	112	7/21 18:00	91.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	112	112	12/21 24:00	32.1	0	0	9.8
RB-W-South	Cooling	0.6 tons	0.6 tons	322	322	10/21 14:00	89.8	0	0	2.7
	Heating	2.3 Mbh	2.3 Mbh	322	322	12/21 24:00	32.1	0	0	9.8
Servery	Cooling	0.2 tons	0.2 tons	121	121	7/21 16:00	96.9	0	0	2.7
	Heating	1.1 Mbh	1.1 Mbh	121	121	12/21 24:00	32.1	0	0	9.8
SHWR-N	Cooling	0.2 tons	0.2 tons	97	97	7/21 12:00	94.8	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	97	97	12/21 24:00	32.1	0	0	9.8

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Calculated Heating Load (Mbh)	Min	Max
SHWR-S	Cooling	0.2 tons	0.2 tons	110	110	7/21 18:00	91.4	0	0		2.7
	Heating	0.9 Mbh	0.9 Mbh	110	110	12/21 24:00	32.1	0	0		9.8
SHWR-W	Cooling	0.2 tons	0.2 tons	95	95	7/21 18:00	91.4	0	0		2.7
	Heating	0.9 Mbh	0.9 Mbh	95	95	12/21 24:00	32.1	0	0		9.8
Support	Cooling	0.6 tons	0.7 tons	337	428	9/21 10:00	86.6	0	0		2.7
	Heating	3 Mbh	3.8 Mbh	337	428	12/21 04:00	32.1	0	0		9.8
Utility	Cooling	1.5 tons	1.5 tons	896	896	9/21 15:00	98.4	0	0		2.7
	Heating	8.5 Mbh	8.5 Mbh	896	896	12/21 04:00	32.1	0	0		9.8

Zone Summary

Zone Summary										
Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
ACT-Noisy-1	180	Yes	2,156	174	16	50.06	1	0.5	0 	10.47
ACT-Noisy-2	181	Yes	2,170	92	0	50.06	1	0.5	0 	10.47
ACT-Noisy-3	182	Yes	2,186	161	8	50.06	1	0.5	0 	10.47
ACT-Quiet-1	130	Yes	1,564	0	0	50.06	1	0.5	0 	10.47
ACT-Quiet-2	131	Yes	1,568	48	8	50.06	1	0.5	0 	10.47
ACT-Quiet-3	131	Yes	1,573	128	0	50.06	1	0.5	0 	10.47
Admin	189	Yes	2,272	215	16	100.01	0.7	1	0 	10.47
Attrium	1,267	Yes	15,043	1,046	57	200.01	0.6	0	0 	10.47
Chart/Hotel	200	Yes	2,395	0	0	100.01	0.7	1	0 	10.47
Comfort/Consult	283	Yes	3,402	336	23	100.01	1.2	0.75	0 	10.47
Corridor-N	409	Yes	4,909	100	65	0	0.4	0	0 	10.47
Corridor-S	414	Yes	4,967	101	65	0	0.4	0	0 	10.47
Corridor-W	324	Yes	3,888	100	65	0	0.4	0	0 	10.47
Entry/Waiting	370	Yes	4,445	625	259	200.01	0.6	0	0 	10.47
Exam/Storage	224	Yes	2,685	0	0	129.07	0.88	0.52	0 	10.47
Group	276	Yes	3,317	295	16	50.06	0.75	0.5	0 	10.47
Hospitality	246	Yes	2,953	260	0	50.06	0.75	0.5	0 	10.47
Intake-HR-A	470	Yes	5,646	449	0	118.85	0.82	0.38	0 	10.47
Intake-HR-B	165	Yes	1,976	27	0	132.52	0.86	0.5	0 	10.47
Kitchen	686	Yes	8,226	607	0	52.32	0.58	9.58	0 	10.47
Lounge	297	Yes	3,561	250	16	50.06	0.67	0.33	0 	10.47
Multipurpose/Dining	485	Yes	5,825	322	23	50.06	0.75	0.5	0 	10.47

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 7 of 12

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
RB-N-Corner	130	Yes	1,565	288	10	100.01	1.2	2	0 	10.47
RB-N-East	257	Yes	3,084	412	20	100.01	1.2	2	0 	10.47
RB-N-West	383	Yes	4,590	374	30	100.01	1.2	2	0 	10.47
RB-S-Corner-N	129	Yes	1,549	286	10	100.01	1.2	2	0 	10.47
RB-S-Corner-S	131	Yes	1,575	289	10	100.01	1.2	2	0 	10.47
RB-S-East	372	Yes	4,463	328	30	100.01	1.2	2	0 	10.47
RB-S-West	124	Yes	1,488	122	10	100.01	1.2	2	0 	10.47
RB-W-North	130	Yes	1,557	288	18	100.01	1.2	2	0 	10.47
RB-W-South	380	Yes	4,554	534	53	100.01	1.2	2	0 	10.47
Servery	228	Yes	2,738	160	0	50.06	0.75	0.5	0 	10.47
SHWR-N	204	Yes	2,443	202	0	50.06	0.5	0	0 	10.47
SHWR-S	207	Yes	2,486	206	0	50.06	0.5	0	0 	10.47
SHWR-W	207	Yes	2,485	204	0	50.06	0.5	0	0 	10.47
Support	603	Yes	7,241	661	0	0	0.5	2	0 	10.47
Utility	2,926	Yes	35,118	109	0	409.28	0.43	0.17	0 	10.47
Room 00-80	4	No	46	362	0	0	0	0	0 	10.47
Room 00-81	3	No	40	151	0	50.06	0.75	0.5	0 	10.47
Room 01-00	634	No	2,007	51	0	0	0	0	0 	10.47
Room 01-01	748	No	2,384	57	0	0	0	0	0 	10.47
Room 01-03	1,001	No	3,162	55	0	0	0	0	0 	10.47
Room 01-04	959	No	2,991	51	0	0	0	0	0 	10.47
Room 01-06	1,009	No	3,156	60	0	0	0	0	0 	10.47
Room 01-08	1,572	No	4,817	648	0	0	0	0	0 	10.47
Room 01-10	769	No	2,563	56	0	0	0	0	0 	10.47

Zone Names	Area (ft²)	Conditioned	Volume (ft³)	Gross Wall Area (ft²)	Window Glass (ft²)	People Density (ft²/person)	Lighting (W/ft²)	Plug and Process (W/ft²)	Lighting (W/ft²) Min	Plug and Process (W/ft²) Max
Room 01-12	675	No	2,044	340	0	0	0	0	0	10.47
Trash	76	No	915	96	0	200.01	0.5	0.25	0	10.47
Conditioned Total	13,652		163,664	9,802	827	110.02	0.7	1.06	0	10.47
Total	21,103		187,790	11,729	827	169.33	0.45	0.69	0	10.47
Unconditioned Total	7,451		24,127	1,927	0	16,614.43	0.01	0	0	10.47

Design Day: Zone Cooling (1%) and Heating (99%)

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
ACT-Noisy-1	Cooling	0.2 tons	0.2 tons	119	119	8/21 17:00	94	0	0	2.7
	Heating	1.7 Mbh	1.7 Mbh	66	66	12/21 24:00	32.1	0	0	9.8
ACT-Noisy-2	Cooling	0.1 tons	0.1 tons	59	59	7/21 18:00	91.4	0	0	2.7
	Heating	1.5 Mbh	1.5 Mbh	59	59	12/21 24:00	32.1	0	0	9.8
ACT-Noisy-3	Cooling	0.1 tons	0.1 tons	64	64	7/21 15:00	98.8	0	0	2.7
	Heating	1.7 Mbh	1.7 Mbh	64	64	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-1	Cooling	0.1 tons	0.1 tons	36	36	9/21 15:00	98.4	0	0	2.7
	Heating	0.8 Mbh	0.8 Mbh	36	36	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-2	Cooling	0.1 tons	0.1 tons	51	51	9/21 15:00	98.4	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	51	51	12/21 24:00	32.1	0	0	9.8
ACT-Quiet-3	Cooling	0.1 tons	0.1 tons	49	49	7/21 19:00	86.7	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	49	49	12/21 24:00	32.1	0	0	9.8
Admin	Cooling	0.1 tons	0.1 tons	81	81	9/21 14:00	98.4	0	0	2.7
	Heating	1.2 Mbh	1.2 Mbh	81	81	12/21 04:00	32.1	0	0	9.8
Attrium	Cooling	0.4 tons	0.4 tons	237	252	7/21 17:00	94.5	0	0	2.7
	Heating	6.3 Mbh	6.6 Mbh	237	252	12/21 24:00	32.1	0	0	9.8

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 9 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
Chart/Hotel	Cooling	0.1 tons	0.1 tons	44	44	7/21 19:00	86.7	0	0	2.7
	Heating	0.7 Mbh	0.7 Mbh	44	44	12/21 04:00	32.1	0	0	9.8
Comfort/Consult	Cooling	0.1 tons	0.1 tons	72	72	7/21 17:00	94.5	0	0	2.7
	Heating	2.2 Mbh	2.2 Mbh	72	72	12/21 24:00	32.1	0	0	9.8
Corridor-N	Cooling	0.1 tons	0.1 tons	81	81	7/21 18:00	91.4	0	0	2.7
	Heating	1.8 Mbh	1.8 Mbh	81	81	12/21 24:00	32.1	0	0	9.8
Corridor-S	Cooling	0.3 tons	0.3 tons	153	153	10/21 13:00	88.4	0	0	2.7
	Heating	1.8 Mbh	1.8 Mbh	153	153	12/21 24:00	32.1	0	0	9.8
Corridor-W	Cooling	0.3 tons	0.3 tons	172	172	7/21 17:00	94.5	0	0	2.7
	Heating	1.6 Mbh	1.6 Mbh	172	172	12/21 24:00	32.1	0	0	9.8
Entry/Waiting	Cooling	0.8 tons	0.8 tons	453	453	7/21 09:00	81.8	0	0	2.7
	Heating	4.8 Mbh	4.8 Mbh	453	453	12/21 24:00	32.1	0	0	9.8
Exam/Storage	Cooling	0.1 tons	0.1 tons	38	49	7/21 19:00	86.7	0	0	2.7
	Heating	1 Mbh	1.3 Mbh	38	49	12/21 04:00	32.1	0	0	9.8
Group	Cooling	0.1 tons	0.1 tons	53	91	7/21 18:00	91.4	0	0	2.7
	Heating	2.8 Mbh	2.8 Mbh	53	91	12/21 24:00	32.1	0	0	9.8
Hospitality	Cooling	0.1 tons	0.1 tons	72	81	7/21 17:00	94.5	0	0	2.7
	Heating	2.5 Mbh	2.5 Mbh	72	81	12/21 24:00	32.1	0	0	9.8
Intake-HR-A	Cooling	0.2 tons	0.3 tons	127	150	9/21 14:00	98.4	0	0	2.7
	Heating	3 Mbh	3.6 Mbh	127	150	12/21 24:00	32.1	0	0	9.8
Intake-HR-B	Cooling	0.1 tons	0.1 tons	32	38	7/21 19:00	86.7	0	0	2.7
	Heating	0.8 Mbh	0.9 Mbh	32	38	12/21 04:00	32.1	0	0	9.8
Kitchen	Cooling	2.4 tons	2.4 tons	2,507	2,507	9/21 16:00	96.5	0	0	2.7
	Heating	3.5 Mbh	3.5 Mbh	680	680	12/21 04:00	32.1	0	0	9.8
Lounge	Cooling	0.2 tons	0.3 tons	136	148	9/21 15:00	98.4	0	0	2.7

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 10 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Min	Calculated Heating Load (Mbh) Max
	Heating	2.5 Mbh	2.7 Mbh	136	148	12/21 24:00	32.1	0	0	9.8
Multipurpose/Dining	Cooling	0.2 tons	0.2 tons	89	161	7/21 16:00	96.9	0	0	2.7
	Heating	4.9 Mbh	4.9 Mbh	89	161	12/21 24:00	32.1	0	0	9.8
RB-N-Corner	Cooling	0.2 tons	0.2 tons	100	100	7/21 18:00	91.4	0	0	2.7
	Heating	1 Mbh	1 Mbh	100	100	12/21 24:00	32.1	0	0	9.8
RB-N-East	Cooling	0.3 tons	0.3 tons	167	167	7/21 10:00	87	0	0	2.7
	Heating	1.9 Mbh	1.9 Mbh	167	167	12/21 24:00	32.1	0	0	9.8
RB-N-West	Cooling	0.5 tons	0.5 tons	278	278	7/21 18:00	91.4	0	0	2.7
	Heating	2.4 Mbh	2.4 Mbh	278	278	12/21 24:00	32.1	0	0	9.8
RB-S-Corner-N	Cooling	0.2 tons	0.2 tons	87	87	9/21 14:00	98.4	0	0	2.7
	Heating	1 Mbh	1 Mbh	87	87	12/21 24:00	32.1	0	0	9.8
RB-S-Corner-S	Cooling	0.2 tons	0.2 tons	106	106	9/21 17:00	94.1	0	0	2.7
	Heating	1 Mbh	1 Mbh	106	106	12/21 24:00	32.1	0	0	9.8
RB-S-East	Cooling	0.4 tons	0.4 tons	235	235	7/21 10:00	87	0	0	2.7
	Heating	2.3 Mbh	2.3 Mbh	235	235	12/21 24:00	32.1	0	0	9.8
RB-S-West	Cooling	0.2 tons	0.2 tons	89	89	7/21 18:00	91.4	0	0	2.7
	Heating	0.8 Mbh	0.8 Mbh	89	89	12/21 24:00	32.1	0	0	9.8
RB-W-North	Cooling	0.2 tons	0.2 tons	89	89	7/21 18:00	91.4	0	0	2.7
	Heating	1.1 Mbh	1.1 Mbh	89	89	12/21 24:00	32.1	0	0	9.8
RB-W-South	Cooling	0.5 tons	0.5 tons	303	303	10/21 14:00	89.8	0	0	2.7
	Heating	2.9 Mbh	2.9 Mbh	303	303	12/21 24:00	32.1	0	0	9.8
Servery	Cooling	0.1 tons	0.1 tons	40	76	7/21 17:00	94.5	0	0	2.7
	Heating	2.2 Mbh	2.2 Mbh	40	76	12/21 24:00	32.1	0	0	9.8
SHWR-N	Cooling	0.2 tons	0.2 tons	93	93	7/21 12:00	94.8	0	0	2.7
	Heating	0.9 Mbh	0.9 Mbh	93	93	12/21 24:00	32.1	0	0	9.8

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 11 of 12

Zone Names		Calculated Design Sensible Load	User Design Sensible Load	Calculated Design Air Flow (cfm)	User Design Air Flow (cfm)	Date of Peak	External Temperature at Peak (°F)	Humidity Ratio at Peak (gr/lb)	Calculated Cooling Load (tons) Calculated Heating Load (Mbh)	Min	Max
SHWR-S	Cooling	0.2 tons	0.2 tons	102	102	7/21 18:00	91.4	0	0		2.7
	Heating	0.9 Mbh	0.9 Mbh	102	102	12/21 24:00	32.1	0	0		9.8
SHWR-W	Cooling	0.2 tons	0.2 tons	89	89	7/21 18:00	91.4	0	0		2.7
	Heating	0.9 Mbh	0.9 Mbh	89	89	12/21 24:00	32.1	0	0		9.8
Support	Cooling	0.3 tons	0.4 tons	197	220	7/21 19:00	86.7	0	0		2.7
	Heating	3.1 Mbh	3.4 Mbh	197	220	12/21 04:00	32.1	0	0		9.8
Utility	Cooling	0.9 tons	0.9 tons	496	496	7/21 19:00	86.7	0	0		2.7
	Heating	9.8 Mbh	9.8 Mbh	496	496	12/21 04:00	32.1	0	0		9.8

Peak Load Summary Report

Title 24 - 2022 Baseline

System Name: PSZ-HP-Admin

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply Airflow	Sensible Load
			DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
PSZ-HP-Admin		N/A	N/A	N/A	N/A	N/A	680	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	680	N/A	N/A
	Admin	9/21 14:00	98.4	64.2	75.0	55.0	119	119	2,473	321	12/21 04:00	32.1	21.8	70.0	77.7	119	119	945
	Office 1	10/21 14:00	89.8	58.2	75.0	55.0	66	66	1,366	139	12/21 04:00	32.1	21.8	70.0	77.4	66	66	497
	Office 2	10/21 13:00	88.4	57.7	75.0	55.0	57	58	1,204	139	12/21 04:00	32.1	21.8	70.0	77.8	57	58	464
	Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.5	70	70	1,411	353	12/21 04:00	32.1	21.8	70.0	76.1	70	70	433
	Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.4	68	67	1,364	352	12/21 04:00	32.1	21.8	70.0	75.9	68	67	403
	Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	492	492	10,216	264	12/21 24:00	32.1	21.8	70.0	79.0	492	492	4,562
	Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	496	495	10,282	264	12/21 24:00	32.1	21.8	70.0	79.0	496	495	4,574

System Name: PSZ-HP-Atrium

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-Atrium		N/A	N/A	N/A	N/A	N/A	405	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	405	N/A	N/A
	Attrium	7/21 16:00	96.9	66.1	75.0	55.0	405	404	8,391	803	12/21 24:00	32.1	21.8	70.0	82.7	405	404	5,248
	Attrium	7/21 17:00	94.5	65.4	75.0	55.0	150	150	3,116	365	12/21 24:00	32.1	21.8	70.0	83.5	150	150	2,072
	Attrium 2	9/21 16:00	96.5	63.6	75.0	55.0	254	254	5,275	346	12/21 24:00	32.1	21.8	70.0	81.6	254	254	3,031

System Name: PSZ-HP-Utility

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-Utility		N/A	N/A	N/A	N/A	N/A	1,324	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1,324	N/A	N/A
	Support	9/21 10:00	86.6	60.3	75.0	55.0	428	429	8,884	0	12/21 04:00	32.1	21.8	70.0	78.7	428	429	3,827
	Electric	10/21 14:00	89.8	58.2	75.0	55.0	150	151	3,135	0	12/21 04:00	32.1	21.8	70.0	77.6	150	151	1,178
	Emergency Electric	7/21 09:00	81.8	61.2	75.0	55.0	123	122	2,530	0	12/21 04:00	32.1	21.8	70.0	76.5	123	122	815
	Fire Room	8/21 09:00	81.4	59.2	75.0	55.0	97	98	2,040	0	12/21 04:00	32.1	21.8	70.0	76.0	97	98	606
	Mechanical	7/21 19:00	86.7	62.9	75.0	55.0	57	57	1,182	0	12/21 04:00	32.1	21.8	70.0	76.4	57	57	375
	Utility	9/21 15:00	98.4	64.2	75.0	55.0	896	897	18,597	927	12/21 04:00	32.1	21.8	70.0	79.2	896	897	8,482
	Clean Supply	7/21 16:00	96.9	66.1	75.0	55.0	28	28	584	98	12/21 04:00	32.1	21.8	70.0	79.3	28	28	269
	Corridor 1	7/21 16:00	96.9	66.1	75.0	55.0	76	76	1,573	6	12/21 24:00	32.1	21.8	70.0	79.7	76	76	758
	Corridor 2	7/21 15:00	98.8	66.7	75.0	55.0	133	134	2,780	13	12/21 24:00	32.1	21.8	70.0	80.4	133	134	1,424
	Corridor 2.1	7/21 18:00	91.4	64.4	75.0	55.0	21	20	420	2	12/21 24:00	32.1	21.8	70.0	81.7	21	20	242
	General Storage	7/21 16:00	96.9	66.1	75.0	55.0	47	47	985	95	12/21 04:00	32.1	21.8	70.0	76.1	47	47	296
	Hskp	7/21 16:00	96.9	66.1	75.0	55.0	17	17	359	55	12/21 04:00	32.1	21.8	70.0	79.0	17	17	160
	IT	7/21 19:00	86.7	62.9	75.0	55.0	53	52	1,083	0	12/21 04:00	32.1	21.8	70.0	75.0	36	52	184
	Laundry	7/21 16:00	96.9	66.1	75.0	55.0	34	33	684	116	12/21 04:00	32.1	21.8	70.0	79.3	34	33	316
	Meds	7/21 16:00	96.9	66.1	75.0	55.0	36	36	746	124	12/21 04:00	32.1	21.8	70.0	79.4	36	36	346
	Soiled Supply	7/21 16:00	96.9	66.1	75.0	55.0	28	28	572	93	12/21 04:00	32.1	21.8	70.0	79.1	28	28	257
	Staff Corridor	9/21 14:00	98.4	64.2	75.0	55.0	337	338	7,001	-71	12/21 18:00	32.1	21.8	70.0	78.1	337	338	2,819
	Stor.	7/21 16:00	96.9	66.1	75.0	55.0	8	9	183	15	12/21 04:00	32.1	21.8	70.0	79.7	8	9	88
	Storage	7/21 16:00	96.9	66.1	75.0	55.0	21	21	445	51	12/21 04:00	32.1	21.8	70.0	81.5	21	21	253
	Toilet 1	7/21 15:00	98.8	66.7	75.0	55.0	38	38	798	201	12/21 24:00	32.1	21.8	70.0	79.1	38	38	360
	Toilet 2	7/21 16:00	96.9	66.1	75.0	55.0	28	28	580	184	12/21 19:00	32.1	21.8	70.0	76.2	28	28	177
	Toilet 3	7/21 15:00	98.8	66.7	75.0	55.0	30	29	593	184	12/21 19:00	32.1	21.8	70.0	76.3	30	29	185

System Name: PSZ-HP-ResShwr

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-ResShwr		N/A	N/A	N/A	N/A	N/A	303	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	303	N/A	N/A
	SHWR-N	7/21 12:00	94.8	65.5	75.0	55.0	97	98	2,038	573	12/21 24:00	32.1	21.8	70.0	79.3	97	98	936
	Shower 7	7/21 12:00	94.8	65.5	75.0	55.0	49	50	1,031	289	12/21 24:00	32.1	21.8	70.0	79.0	49	50	459
	Shower 8	7/21 13:00	97.3	66.2	75.0	55.0	49	48	1,000	283	12/21 24:00	32.1	21.8	70.0	79.5	49	48	467
	SHWR-S	7/21 18:00	91.4	64.4	75.0	55.0	110	110	2,279	589	12/21 24:00	32.1	21.8	70.0	78.2	110	110	925
	Shower 3	7/21 19:00	86.7	62.9	75.0	55.0	53	53	1,112	295	12/21 24:00	32.1	21.8	70.0	78.3	53	53	453
	Shower 4	7/21 18:00	91.4	64.4	75.0	55.0	55	56	1,164	294	12/21 24:00	32.1	21.8	70.0	78.2	55	56	470
	SHWR-W	7/21 18:00	91.4	64.4	75.0	55.0	95	96	1,986	581	12/21 24:00	32.1	21.8	70.0	79.6	95	96	939
	Shower 5	7/21 18:00	91.4	64.4	75.0	55.0	49	48	998	290	12/21 24:00	32.1	21.8	70.0	79.6	49	48	473
	Shower 6	7/21 18:00	91.4	64.4	75.0	55.0	47	47	983	290	12/21 24:00	32.1	21.8	70.0	79.5	47	47	461

System Name: PSZ-HP-Kitchen

Location			Cooling								Heating								
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply Airflow	Sensible Load	
			DB	WB	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	
			(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	
PSZ-HP-Kitchen			N/A	N/A	N/A	N/A	N/A	2,854	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	2,854	N/A	N/A
	Kitchen	10/21 14:00	89.8	58.2	75.0	55.0	2,854	2,853	59,206	2,856	12/21 04:00	32.1	21.8	70.0	75.0	2,854	2,853	14,634	
	Kitchen	7/21 17:00	94.5	65.4	75.0	55.0	2,500	2,500	51,822	2,875	12/21 19:00	32.1	21.8	70.0	75.0	2,500	2,500	12,818	
	Service	10/21 14:00	89.8	58.2	75.0	55.0	354	355	7,360	172	12/21 04:00	32.1	21.8	70.0	77.2	354	355	2,616	

System Name: PSZ-HP-Clinical

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-Clinical		N/A	N/A	N/A	N/A	N/A	862	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	862	N/A	N/A
	Comfort/Consult	7/21 16:00	96.9	66.1	75.0	55.0	155	154	3,196	567	12/21 24:00	32.1	21.8	70.0	77.5	155	154	1,191
	Comfort Room 2	7/21 15:00	98.8	66.7	75.0	55.0	44	44	924	164	12/21 24:00	32.1	21.8	70.0	77.8	44	44	355
	Consult 1	7/21 16:00	96.9	66.1	75.0	55.0	53	53	1,104	200	12/21 24:00	32.1	21.8	70.0	77.4	53	53	402
	Consult 2	7/21 16:00	96.9	66.1	75.0	55.0	55	55	1,144	203	12/21 24:00	32.1	21.8	70.0	77.4	55	55	416
	Exam/Storage	7/21 16:00	96.9	66.1	75.0	55.0	85	84	1,753	328	12/21 04:00	32.1	21.8	70.0	75.6	85	84	486
	Exam Room	7/21 16:00	96.9	66.1	75.0	55.0	53	53	1,098	246	12/21 19:00	32.1	21.8	70.0	75.0	36	53	188
	Long Term Belongings Storage	7/21 16:00	96.9	66.1	75.0	55.0	30	29	612	85	12/21 04:00	32.1	21.8	70.0	79.0	30	29	271
	Group	7/21 16:00	96.9	66.1	75.0	55.0	153	152	3,160	1,035	12/21 24:00	32.1	21.8	70.0	79.9	153	152	1,540
	Group	7/21 16:00	96.9	66.1	75.0	55.0	150	151	3,139	1,035	12/21 24:00	32.1	21.8	70.0	79.9	150	151	1,541
	Intake-HR-A	9/21 13:00	96.8	63.7	75.0	55.0	311	311	6,463	676	12/21 24:00	32.1	21.8	70.0	78.0	311	311	2,570
	Intake Corridor	7/21 16:00	96.9	66.1	75.0	55.0	40	40	832	-1	12/21 20:00	32.1	21.8	70.0	79.4	40	40	385
	Interview Room	9/21 16:00	96.5	63.6	75.0	55.0	93	93	1,938	316	12/21 24:00	32.1	21.8	70.0	78.7	93	93	837
	Sally Port	11/21 13:00	79.6	53.0	75.0	55.0	138	137	2,837	156	12/21 19:00	32.1	21.8	70.0	75.0	133	137	689
	Shower 1	7/21 16:00	96.9	66.1	75.0	55.0	40	41	855	237	12/21 24:00	32.1	21.8	70.0	79.1	40	41	385
	Intake-HR-B	7/21 16:00	96.9	66.1	75.0	55.0	66	66	1,374	234	12/21 04:00	32.1	21.8	70.0	76.6	66	66	447
	Ante Room	7/21 16:00	96.9	66.1	75.0	55.0	25	25	515	68	12/21 04:00	32.1	21.8	70.0	78.9	25	25	225
	Comfort Room 1	9/21 14:00	98.4	64.2	75.0	55.0	42	43	900	168	12/21 07:00	32.1	21.8	70.0	75.1	42	43	225
	RB-S-Corner-N	9/21 15:00	98.4	64.2	75.0	55.0	93	94	1,956	308	12/21 24:00	32.1	21.8	70.0	78.8	93	94	845
	Resident Room 04	9/21 15:00	98.4	64.2	75.0	55.0	95	94	1,960	308	12/21 24:00	32.1	21.8	70.0	78.8	95	94	848

System Name: PSZ-HP-Activity

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
				DB (°F)	WB (°F)								DB (°F)	WB (°F)					
PSZ-HP-Activity			N/A	N/A	N/A	N/A	N/A	619	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	619	N/A	N/A
		ACT-Noisy-1	8/21 17:00	94.0	63.5	75.0	55.0	199	199	4,125	663	12/21 24:00	32.1	21.8	70.0	75.9	199	199	1,204
		Noisy Activity 1	8/21 17:00	94.0	63.5	75.0	55.0	197	198	4,113	663	12/21 24:00	32.1	21.8	70.0	75.9	197	198	1,200
		ACT-Noisy-2	7/21 18:00	91.4	64.4	75.0	55.0	104	103	2,138	672	12/21 24:00	32.1	21.8	70.0	79.3	104	103	985
		Noisy Activity 2	7/21 18:00	91.4	64.4	75.0	55.0	102	102	2,112	672	12/21 24:00	32.1	21.8	70.0	79.3	102	102	970
		ACT-Noisy-3	7/21 15:00	98.8	66.7	75.0	55.0	106	107	2,215	678	12/21 24:00	32.1	21.8	70.0	81.0	106	107	1,202
		Noisy Activity 3	7/21 15:00	98.8	66.7	75.0	55.0	106	106	2,202	678	12/21 24:00	32.1	21.8	70.0	81.0	106	106	1,197
		ACT-Quiet-1	9/21 15:00	98.4	64.2	75.0	55.0	59	60	1,249	468	12/21 24:00	32.1	21.8	70.0	76.2	59	60	383
		Quiet Activity 1	9/21 15:00	98.4	64.2	75.0	55.0	59	60	1,246	468	12/21 24:00	32.1	21.8	70.0	76.1	59	60	378
		ACT-Quiet-2	9/21 15:00	98.4	64.2	75.0	55.0	76	76	1,587	472	12/21 24:00	32.1	21.8	70.0	77.0	76	76	545
		Quiet Activity 2	9/21 15:00	98.4	64.2	75.0	55.0	74	75	1,557	471	12/21 24:00	32.1	21.8	70.0	76.8	74	75	526
		ACT-Quiet-3	7/21 19:00	86.7	62.9	75.0	55.0	74	74	1,545	487	12/21 24:00	32.1	21.8	70.0	77.2	74	74	552
		Quiet Activity 3	7/21 19:00	86.7	62.9	75.0	55.0	74	74	1,538	487	12/21 24:00	32.1	21.8	70.0	77.2	74	74	548

System Name: PSZ-HP-ResBed-W

Location			Cooling								Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-ResBed-W		N/A	N/A	N/A	N/A	N/A	634	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	634	N/A	N/A
	Corridor-W	7/21 17:00	94.5	65.4	75.0	55.0	199	199	4,130	-2	12/21 24:00	32.1	21.8	70.0	76.7	199	199	1,376
	Corridor 4	7/21 17:00	94.5	65.4	75.0	55.0	197	198	4,106	-2	12/21 24:00	32.1	21.8	70.0	76.7	197	198	1,359
	RB-W-North	7/21 18:00	91.4	64.4	75.0	57.6	112	113	2,043	324	12/21 24:00	32.1	21.8	70.0	77.8	112	113	903
	Resident Room 10	7/21 18:00	91.4	64.4	75.0	57.6	112	113	2,041	324	12/21 24:00	32.1	21.8	70.0	77.8	112	113	902
	RB-W-South	10/21 14:00	89.8	58.2	75.0	55.0	322	322	6,674	854	12/21 24:00	32.1	21.8	70.0	77.1	322	322	2,326
	Resident Room 07	10/21 14:00	89.8	58.2	75.0	55.0	104	104	2,150	282	12/21 24:00	32.1	21.8	70.0	76.3	104	104	672
	Resident Room 08	10/21 14:00	89.8	58.2	75.0	55.0	108	107	2,225	284	12/21 24:00	32.1	21.8	70.0	76.4	108	107	707
	Resident Room 09	9/21 15:00	98.4	64.2	75.0	55.0	112	112	2,327	317	12/21 24:00	32.1	21.8	70.0	77.9	112	112	909

System Name: PSZ-HP-ResBed-N

Location			Cooling								Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-ResBed-N		N/A	N/A	N/A	N/A	N/A	795	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	795	N/A	N/A
	Corridor-N	7/21 18:00	91.4	64.4	75.0	55.0	117	116	2,402	-2	12/21 24:00	32.1	21.8	70.0	83.3	117	116	1,584
	Corridor 3	7/21 18:00	91.4	64.4	75.0	55.0	114	115	2,395	-2	12/21 24:00	32.1	21.8	70.0	83.3	114	115	1,579
	RB-N-Corner	7/21 18:00	91.4	64.4	75.0	58.2	129	128	2,247	325	12/21 24:00	32.1	21.8	70.0	76.5	129	128	853
	Resident Room 14	7/21 18:00	91.4	64.4	75.0	58.2	129	129	2,248	325	12/21 24:00	32.1	21.8	70.0	76.5	129	129	853
	RB-N-East	7/21 10:00	87.0	63.0	75.0	57.2	201	202	3,738	641	12/21 24:00	32.1	21.8	70.0	77.3	201	202	1,508
	Resident Room 15	7/21 10:00	87.0	63.0	75.0	57.2	104	103	1,913	325	12/21 24:00	32.1	21.8	70.0	78.1	104	103	863
	Resident Room 16	7/21 10:00	87.0	63.0	75.0	57.2	97	98	1,819	316	12/21 24:00	32.1	21.8	70.0	76.4	97	98	644
	RB-N-West	7/21 18:00	91.4	64.4	75.0	57.8	347	348	6,225	955	12/21 24:00	32.1	21.8	70.0	75.4	347	348	1,911
	Resident Room 11	7/21 18:00	91.4	64.4	75.0	57.8	114	115	2,063	322	12/21 24:00	32.1	21.8	70.0	75.3	114	115	627
	Resident Room 12	7/21 18:00	91.4	64.4	75.0	57.8	117	115	2,070	316	12/21 24:00	32.1	21.8	70.0	75.3	114	115	626
	Resident Room 13	7/21 18:00	91.4	64.4	75.0	57.8	117	116	2,081	316	12/21 24:00	32.1	21.8	70.0	75.4	117	116	643

System Name: PSZ-HP-ResBed-S

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
				DB (°F)	WB (°F)								DB (°F)	WB (°F)					
PSZ-HP-ResBed-S			N/A	N/A	N/A	N/A	N/A	691	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	691	N/A	N/A
		Corridor-S	10/21 13:00	88.4	57.7	75.0	55.0	182	183	3,771	-16	12/21 24:00	32.1	21.8	70.0	78.3	182	183	1,560
		Corridor 5	10/21 13:00	88.4	57.7	75.0	55.0	182	182	3,758	-16	12/21 24:00	32.1	21.8	70.0	78.3	182	182	1,554
		RB-S-Corner-S	9/21 17:00	94.1	62.8	75.0	55.0	114	114	2,376	315	12/21 24:00	32.1	21.8	70.0	77.3	114	114	859
		Resident Room 05	9/21 17:00	94.1	62.8	75.0	55.0	114	114	2,375	314	12/21 24:00	32.1	21.8	70.0	77.3	114	114	857
		RB-S-East	7/21 10:00	87.0	63.0	75.0	57.1	282	282	5,253	928	12/21 24:00	32.1	21.8	70.0	76.2	282	282	1,788
		Resident Room 01	8/21 10:00	86.6	61.1	75.0	57.1	89	89	1,655	292	12/21 24:00	32.1	21.8	70.0	75.9	89	89	536
		Resident Room 02	7/21 10:00	87.0	63.0	75.0	57.1	89	89	1,665	279	12/21 24:00	32.1	21.8	70.0	76.1	89	89	562
		Resident Room 03	7/21 10:00	87.0	63.0	75.0	57.1	104	104	1,931	340	12/21 24:00	32.1	21.8	70.0	76.4	104	104	677
		RB-S-West	7/21 18:00	91.4	64.4	75.0	57.8	112	112	2,014	309	12/21 24:00	32.1	21.8	70.0	75.4	112	112	626
		Resident Room 06	7/21 18:00	91.4	64.4	75.0	57.8	112	112	2,010	309	12/21 24:00	32.1	21.8	70.0	75.4	112	112	624

System Name: PSZ-HP-Common

Location		Cooling								Heating								
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
PSZ-HP-Common		N/A	N/A	N/A	N/A	N/A	951	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	947	N/A	N/A
	Hospitality	7/21 16:00	96.9	66.1	75.0	64.9	273	274	2,877	920	12/21 24:00	32.1	21.8	70.0	75.0	269	274	1,381
	Hospitality	7/21 16:00	96.9	66.1	75.0	64.9	273	274	2,878	920	12/21 24:00	32.1	21.8	70.0	75.0	269	274	1,383
	Lounge	10/21 14:00	89.8	58.2	75.0	55.0	290	290	5,994	982	12/21 24:00	32.1	21.8	70.0	76.0	290	290	1,769
	Lounge	10/21 14:00	89.8	58.2	75.0	55.0	222	223	4,625	716	12/21 19:00	32.1	21.8	70.0	75.7	222	223	1,316
	Shower 2	9/21 15:00	98.4	64.2	75.0	55.0	66	66	1,370	289	12/21 19:00	32.1	21.8	70.0	75.4	66	66	364
	Multipurpose/Dining	7/21 15:00	98.8	66.7	75.0	55.0	267	268	5,563	1,818	12/21 24:00	32.1	21.8	70.0	79.9	267	268	2,708
	Multipurpose/Dining	7/21 15:00	98.8	66.7	75.0	55.0	267	267	5,549	1,818	12/21 24:00	32.1	21.8	70.0	79.9	267	267	2,706
	Servery	7/21 16:00	96.9	66.1	75.0	55.0	121	120	2,500	853	12/21 24:00	32.1	21.8	70.0	78.9	121	120	1,094
	Servery	7/21 16:00	96.9	66.1	75.0	55.0	121	120	2,495	853	12/21 24:00	32.1	21.8	70.0	78.9	121	120	1,093

Peak Load Summary Report

Primary

System Name: Single Zone CV

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
Single Zone CV		N/A	N/A	N/A	N/A	N/A	2,507	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	680	N/A	N/A
	Kitchen	9/21 16:00	96.5	63.6	75.0	64.1	2,507	2,532	28,499	2,982	12/21 04:00	32.1	21.8	70.0	75.0	680	2,532	3,484
	Kitchen	7/21 18:00	91.4	64.4	75.0	64.1	2,500	2,500	28,254	2,847	12/21 20:00	32.1	21.8	70.0	75.0	2,500	2,500	12,818
	Service	9/21 16:00	96.5	63.6	75.0	64.1	358	359	4,060	213	12/21 04:00	32.1	21.8	70.0	76.3	358	359	2,320

System Name: Variable Refrigerant Flow

Location			Cooling								Heating								
System	Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
				DB (°F)	WB (°F)								DB (°F)	WB (°F)					
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	4,933	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	4,880	N/A	N/A
		ACT-Noisy-1	8/21 17:00	94.0	63.5	75.0	55.0	119	119	2,471	239	12/21 24:00	32.1	21.8	70.0	95.0	66	119	1,661
		Noisy Activity 1	8/21 17:00	94.0	63.5	75.0	55.0	119	119	2,464	239	12/21 23:00	32.1	21.8	70.0	95.0	66	119	1,658
		ACT-Noisy-2	7/21 18:00	91.4	64.4	75.0	55.0	59	60	1,254	296	12/21 24:00	32.1	21.8	70.0	93.5	59	60	1,451
		Noisy Activity 2	7/21 18:00	91.4	64.4	75.0	55.0	59	59	1,231	294	12/21 23:00	32.1	21.8	70.0	93.6	59	59	1,436
		ACT-Noisy-3	7/21 15:00	98.8	66.7	75.0	55.0	64	65	1,341	307	12/21 24:00	32.1	21.8	70.0	95.3	64	65	1,674
		Noisy Activity 3	7/21 15:00	98.8	66.7	75.0	55.0	64	64	1,332	306	12/21 23:00	32.1	21.8	70.0	95.4	64	64	1,671
		ACT-Quiet-1	9/21 15:00	98.4	64.2	75.0	55.0	36	35	731	88	12/21 24:00	32.1	21.8	70.0	91.2	36	35	766
		Quiet Activity 1	9/21 14:00	98.4	64.2	75.0	55.0	34	35	725	87	12/21 23:00	32.1	21.8	70.0	91.2	34	35	760
		ACT-Quiet-2	9/21 15:00	98.4	64.2	75.0	55.0	51	51	1,062	102	12/21 24:00	32.1	21.8	70.0	87.6	51	51	925
		Quiet Activity 2	9/21 15:00	98.4	64.2	75.0	55.0	51	50	1,044	102	12/21 23:00	32.1	21.8	70.0	87.6	51	50	907
		ACT-Quiet-3	7/21 19:00	86.7	62.9	75.0	55.0	49	49	1,013	224	12/21 24:00	32.1	21.8	70.0	88.7	49	49	933
		Quiet Activity 3	7/21 19:00	86.7	62.9	75.0	55.0	49	48	1,007	224	12/21 23:00	32.1	21.8	70.0	88.7	49	48	930
		Admin	9/21 14:00	98.4	64.2	75.0	55.0	81	80	1,671	61	12/21 04:00	32.1	21.8	70.0	84.4	81	80	1,188
		Office 1	10/21 14:00	89.8	58.2	75.0	55.0	44	44	916	-15	12/21 04:00	32.1	21.8	70.0	83.6	44	44	614
		Office 2	10/21 13:00	88.4	57.7	75.0	55.0	40	40	828	-11	12/21 04:00	32.1	21.8	70.0	84.3	40	40	587
		Attrium	7/21 17:00	94.5	65.4	75.0	55.0	252	251	5,223	286	12/21 24:00	32.1	21.8	70.0	95.7	252	251	6,620
		Attrium	7/21 17:00	94.5	65.4	75.0	55.0	87	87	1,818	115	12/21 23:00	32.1	21.8	70.0	100.8	87	87	2,760
		Attrium 2	7/21 17:00	94.5	65.4	75.0	55.0	163	164	3,405	174	12/21 23:00	32.1	21.8	70.0	92.0	163	164	3,695
		Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	44	44	907	153	12/21 04:00	32.1	21.8	70.0	86.3	44	44	729
		Chart/Hotel	7/21 19:00	86.7	62.9	75.0	55.0	42	41	861	149	12/21 04:00	32.1	21.8	70.0	86.5	42	41	700
		Comfort/Consult	7/21 17:00	94.5	65.4	75.0	55.0	72	72	1,481	144	12/21 24:00	32.1	21.8	70.0	100.0	72	72	2,190
		Comfort Room 2	7/21 17:00	94.5	65.4	75.0	55.0	21	21	436	42	12/21 23:00	32.1	21.8	70.0	99.9	21	21	644
		Consult 1	7/21 17:00	94.5	65.4	75.0	55.0	25	25	502	50	12/21 23:00	32.1	21.8	70.0	100.5	25	25	756
		Consult 2	7/21 17:00	94.5	65.4	75.0	55.0	25	26	535	52	12/21 23:00	32.1	21.8	70.0	99.4	25	26	776
		Corridor-N	7/21 18:00	91.4	64.4	75.0	55.0	81	80	1,670	5	12/21 24:00	32.1	21.8	70.0	92.3	81	80	1,840
		Corridor 3	7/21 18:00	91.4	64.4	75.0	55.0	81	80	1,665	5	12/21 23:00	32.1	21.8	70.0	92.3	81	80	1,836
		Corridor-S	10/21 13:00	88.4	57.7	75.0	55.0	153	152	3,127	-66	12/21 24:00	32.1	21.8	70.0	81.7	153	152	1,818
		Corridor 5	10/21 13:00	88.4	57.7	75.0	55.0	150	151	3,125	-65	12/21 23:00	32.1	21.8	70.0	81.7	150	151	1,813
		Corridor-W	7/21 17:00	94.5	65.4	75.0	55.0	172	171	3,549	7	12/21 24:00	32.1	21.8	70.0	79.0	172	171	1,577
		Corridor 4	7/21 17:00	94.5	65.4	75.0	55.0	170	170	3,529	7	12/21 23:00	32.1	21.8	70.0	79.0	170	170	1,561

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 13 of 17

Location			Cooling								Heating								
System	Zone	Room	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load
			(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	4,933	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	4,880	N/A	N/A
		Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	453	454	9,432	190	12/21 24:00	32.1	21.8	70.0	80.4	453	454	4,841
		Entry/Waiting	7/21 09:00	81.8	61.2	75.0	55.0	458	457	9,498	190	12/21 24:00	32.1	21.8	70.0	80.4	458	457	4,857
		Exam/Storage	7/21 19:00	86.7	62.9	75.0	55.0	49	50	1,034	93	12/21 04:00	32.1	21.8	70.0	94.9	49	50	1,271
		Exam Room	7/21 19:00	86.7	62.9	75.0	55.0	32	31	363	44	12/21 19:00	32.1	21.8	70.0	104.8	32	31	625
		Long Term Belongings Storage	7/21 19:00	86.7	62.9	75.0	55.0	19	18	382	46	12/21 04:00	32.1	21.8	70.0	87.2	19	18	324
	Group		7/21 18:00	91.4	64.4	75.0	55.0	91	91	1,116	213	12/21 24:00	32.1	21.8	70.0	121.5	91	91	2,835
	Group		7/21 18:00	91.4	64.4	75.0	61.2	91	91	1,111	15	12/21 23:00	32.1	21.8	70.0	105.9	91	91	2,838
	Hospitality		7/21 17:00	94.5	65.4	75.0	60.7	81	81	1,072	65	12/21 24:00	32.1	21.8	70.0	104.4	81	81	2,535
	Hospitality		7/21 17:00	94.5	65.4	75.0	60.7	81	81	1,073	65	12/21 23:00	32.1	21.8	70.0	104.3	81	81	2,537
	Intake-HR-A		9/21 14:00	98.4	64.2	75.0	55.0	150	151	3,125	28	12/21 24:00	32.1	21.8	70.0	93.4	150	151	3,609
		Intake Corridor	7/21 18:00	91.4	64.4	75.0	55.0	17	18	374	1	12/21 23:00	32.1	21.8	70.0	95.4	17	18	468
		Interview Room	9/21 16:00	96.5	63.6	75.0	55.0	47	47	965	3	12/21 23:00	32.1	21.8	70.0	99.2	47	47	1,392
		Sally Port	10/21 13:00	88.4	57.7	75.0	55.0	51	51	1,053	-9	12/21 19:00	32.1	21.8	70.0	87.4	51	51	909
		Shower 1	7/21 17:00	94.5	65.4	75.0	55.0	36	35	729	224	12/21 24:00	32.1	21.8	70.0	79.8	36	35	353
	Intake-HR-B		7/21 19:00	86.7	62.9	75.0	55.0	38	37	771	73	12/21 04:00	32.1	21.8	70.0	94.1	38	37	916
		Ante Room	7/21 19:00	86.7	62.9	75.0	55.0	15	16	327	38	12/21 04:00	32.1	21.8	70.0	86.6	15	16	268
		Comfort Room 1	7/21 18:00	91.4	64.4	75.0	55.0	21	21	327	36	12/21 07:00	32.1	21.8	70.0	101.9	21	21	514
	Lounge		9/21 15:00	98.4	64.2	75.0	55.0	148	148	3,074	162	12/21 24:00	32.1	21.8	70.0	87.9	148	148	2,717
		Lounge	10/21 14:00	89.8	58.2	75.0	55.0	93	94	1,939	-20	12/21 19:00	32.1	21.8	70.0	92.7	93	94	2,180
		Shower 2	9/21 17:00	94.1	62.8	75.0	55.0	55	54	1,129	263	12/21 20:00	32.1	21.8	70.0	75.7	55	54	319
	Multipurpose/Dining		7/21 16:00	96.9	66.1	75.0	55.0	161	160	1,837	355	12/21 24:00	32.1	21.8	70.0	124.3	161	160	4,918
		Multipurpose/Dining	7/21 18:00	91.4	64.4	75.0	55.0	161	160	1,828	357	12/21 23:00	32.1	21.8	70.0	124.5	161	160	4,917
	RB-N-Corner		7/21 18:00	91.4	64.4	75.0	55.0	100	100	2,086	248	12/21 24:00	32.1	21.8	70.0	80.0	100	100	1,033
		Resident Room 14	7/21 18:00	91.4	64.4	75.0	55.0	100	100	2,087	248	12/21 23:00	32.1	21.8	70.0	80.0	100	100	1,033
	RB-N-East		7/21 10:00	87.0	63.0	75.0	55.0	167	167	3,466	435	12/21 24:00	32.1	21.8	70.0	80.9	167	167	1,863
		Resident Room 15	7/21 10:00	87.0	63.0	75.0	55.0	85	86	1,781	220	12/21 23:00	32.1	21.8	70.0	81.9	85	86	1,042
		Resident Room 16	7/21 10:00	87.0	63.0	75.0	55.0	81	81	1,680	213	12/21 23:00	32.1	21.8	70.0	79.9	81	81	820
	RB-N-West		7/21 18:00	91.4	64.4	75.0	55.0	278	277	5,751	722	12/21 24:00	32.1	21.8	70.0	78.6	278	277	2,443
		Resident Room 11	7/21 18:00	91.4	64.4	75.0	55.0	91	91	1,899	224	12/21 23:00	32.1	21.8	70.0	78.6	91	91	806
		Resident Room 12	7/21 18:00	91.4	64.4	75.0	55.0	91	92	1,914	239	12/21 23:00	32.1	21.8	70.0	78.5	91	92	802
		Resident Room 13	7/21 18:00	91.4	64.4	75.0	55.0	93	93	1,925	239	12/21 23:00	32.1	21.8	70.0	78.6	93	93	819

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 14 of 17

Location			Cooling								Heating								
System	Zone	Room	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load
			(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)	(Mo/D/Hr)	(°F)	(°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	4,933	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	4,880	N/A	N/A
	RB-S-Corner-N		9/21 14:00	98.4	64.2	75.0	55.0	87	87	1,815	127	12/21 24:00	32.1	21.8	70.0	81.4	87	87	1,023
	Resident Room 04		9/21 14:00	98.4	64.2	75.0	55.0	87	88	1,819	127	12/21 23:00	32.1	21.8	70.0	81.4	87	88	1,026
	RB-S-Corner-S		9/21 17:00	94.1	62.8	75.0	55.0	106	107	2,222	132	12/21 24:00	32.1	21.8	70.0	79.5	106	107	1,039
	Resident Room 05		9/21 17:00	94.1	62.8	75.0	55.0	106	107	2,221	132	12/21 23:00	32.1	21.8	70.0	79.5	106	107	1,038
	RB-S-East		7/21 10:00	87.0	63.0	75.0	55.0	235	235	4,882	625	12/21 24:00	32.1	21.8	70.0	79.6	235	235	2,303
	Resident Room 01		8/21 10:00	86.6	61.1	75.0	55.0	74	73	1,527	149	12/21 23:00	32.1	21.8	70.0	79.4	74	73	707
	Resident Room 02		7/21 10:00	87.0	63.0	75.0	55.0	74	75	1,558	189	12/21 23:00	32.1	21.8	70.0	79.3	74	75	716
	Resident Room 03		7/21 10:00	87.0	63.0	75.0	55.0	87	86	1,797	228	12/21 23:00	32.1	21.8	70.0	79.8	87	86	867
	RB-S-West		7/21 18:00	91.4	64.4	75.0	55.0	89	89	1,843	215	12/21 24:00	32.1	21.8	70.0	78.8	89	89	797
	Resident Room 06		7/21 18:00	91.4	64.4	75.0	55.0	89	89	1,842	215	12/21 23:00	32.1	21.8	70.0	78.8	89	89	796
	RB-W-North		7/21 18:00	91.4	64.4	75.0	55.0	89	90	1,869	223	12/21 24:00	32.1	21.8	70.0	81.7	89	90	1,082
	Resident Room 10		7/21 18:00	91.4	64.4	75.0	55.0	89	90	1,868	223	12/21 23:00	32.1	21.8	70.0	81.7	89	90	1,081
	RB-W-South		10/21 14:00	89.8	58.2	75.0	55.0	303	304	6,302	98	12/21 24:00	32.1	21.8	70.0	79.2	303	304	2,853
	Resident Room 07		10/21 14:00	89.8	58.2	75.0	55.0	97	98	2,025	32	12/21 23:00	32.1	21.8	70.0	78.5	97	98	846
	Resident Room 08		10/21 14:00	89.8	58.2	75.0	55.0	102	101	2,104	33	12/21 23:00	32.1	21.8	70.0	78.5	102	101	882
	Resident Room 09		9/21 15:00	98.4	64.2	75.0	55.0	106	105	2,190	129	12/21 23:00	32.1	21.8	70.0	80.0	106	105	1,086
	Servery		7/21 17:00	94.5	65.4	75.0	55.0	76	75	828	162	12/21 24:00	32.1	21.8	70.0	122.9	76	75	2,162
	Servery		7/21 17:00	94.5	65.4	75.0	55.0	76	75	826	162	12/21 23:00	32.1	21.8	70.0	123.1	76	75	2,163
	SHWR-N		7/21 12:00	94.8	65.5	75.0	55.0	93	94	1,946	571	12/21 24:00	32.1	21.8	70.0	79.0	93	94	868
	Shower 7		7/21 12:00	94.8	65.5	75.0	55.0	49	48	992	289	12/21 24:00	32.1	21.8	70.0	78.7	49	48	427
	Shower 8		7/21 12:00	94.8	65.5	75.0	55.0	44	46	947	282	12/21 24:00	32.1	21.8	70.0	79.2	44	46	431
	SHWR-S		7/21 18:00	91.4	64.4	75.0	55.0	102	101	2,099	582	12/21 24:00	32.1	21.8	70.0	78.3	102	101	855
	Shower 3		7/21 18:00	91.4	64.4	75.0	55.0	51	50	1,043	292	12/21 24:00	32.1	21.8	70.0	78.2	51	50	420
	Shower 4		7/21 18:00	91.4	64.4	75.0	55.0	51	51	1,050	290	12/21 24:00	32.1	21.8	70.0	78.3	51	51	432
	SHWR-W		7/21 18:00	91.4	64.4	75.0	55.0	89	89	1,853	578	12/21 24:00	32.1	21.8	70.0	79.5	89	89	870
	Shower 5		7/21 18:00	91.4	64.4	75.0	55.0	44	45	939	289	12/21 24:00	32.1	21.8	70.0	79.5	44	45	441
	Shower 6		7/21 18:00	91.4	64.4	75.0	55.0	44	44	910	289	12/21 24:00	32.1	21.8	70.0	79.5	44	44	425

Location			Cooling								Heating								
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	Latent Load	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb	Supply Dry Bulb	Zone Airflow	System Supply AirFlow	Sensible Load	
			DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	(Btu/h)		DB (°F)	WB (°F)	(°F)	(°F)	(cfm)	(cfm)	(Btu/h)	
Variable Refrigerant Flow			N/A	N/A	N/A	N/A	N/A	4,933	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	4,880	N/A	N/A
Support		7/21 19:00	86.7	62.9	75.0	55.0	220	220	4,564	8	12/21 04:00	32.1	21.8	70.0	85.2	220	220	3,423	
	Electric	9/21 15:00	98.4	64.2	75.0	55.0	76	76	1,567	-20	12/21 01:00	32.1	21.8	70.0	85.5	76	76	1,203	
	Emergency Electric	7/21 09:00	81.8	61.2	75.0	55.0	59	59	1,223	2	12/21 01:00	32.1	21.8	70.0	83.9	59	59	843	
	Fire Room	8/21 09:00	81.4	59.2	75.0	55.0	42	42	871	-12	12/21 01:00	32.1	21.8	70.0	83.9	42	42	597	
	Mechanical	7/21 19:00	86.7	62.9	75.0	55.0	42	43	899	2	12/21 01:00	32.1	21.8	70.0	80.2	42	43	454	
Utility		7/21 19:00	86.7	62.9	75.0	55.0	496	496	10,316	315	12/21 04:00	32.1	21.8	70.0	89.2	496	496	9,762	
	Clean Supply	7/21 19:00	86.7	62.9	75.0	55.0	17	17	355	45	12/21 04:00	32.1	21.8	70.0	88.5	17	17	323	
	Corridor 1	7/21 18:00	91.4	64.4	75.0	55.0	36	36	744	3	12/21 23:00	32.1	21.8	70.0	95.0	36	36	920	
	Corridor 2	7/21 18:00	91.4	64.4	75.0	55.0	61	61	1,263	5	12/21 23:00	32.1	21.8	70.0	99.0	61	61	1,810	
	Corridor 2.1	9/21 16:00	96.5	63.6	75.0	55.0	13	12	246	-7	12/21 23:00	32.1	21.8	70.0	94.0	13	12	292	
	General Storage	7/21 19:00	86.7	62.9	75.0	55.0	36	36	742	53	12/21 04:00	32.1	21.8	70.0	79.3	36	36	342	
	Hskp	7/21 19:00	86.7	62.9	75.0	55.0	11	11	223	26	12/21 04:00	32.1	21.8	70.0	87.2	11	11	190	
	IT	7/21 19:00	86.7	62.9	75.0	55.0	40	40	821	2	12/21 04:00	32.1	21.8	70.0	76.9	40	40	281	
	Laundry	7/21 19:00	86.7	62.9	75.0	55.0	19	20	413	44	12/21 04:00	32.1	21.8	70.0	88.8	19	20	382	
	Meds	7/21 19:00	86.7	62.9	75.0	55.0	21	21	446	47	12/21 04:00	32.1	21.8	70.0	88.9	21	21	415	
	Soiled Supply	7/21 19:00	86.7	62.9	75.0	55.0	17	17	350	43	12/21 04:00	32.1	21.8	70.0	87.9	17	17	309	
	Staff Corridor	9/21 16:00	96.5	63.6	75.0	55.0	144	144	2,974	-78	12/21 07:00	32.1	21.8	70.0	91.6	144	144	3,186	
	Stor.	7/21 19:00	86.7	62.9	75.0	55.0	6	7	144	8	12/21 04:00	32.1	21.8	70.0	82.7	6	7	90	
	Storage	7/21 19:00	86.7	62.9	75.0	55.0	17	16	336	28	12/21 04:00	32.1	21.8	70.0	86.8	17	16	278	
	Toilet 1	7/21 10:00	87.0	63.0	75.0	55.0	34	35	724	188	12/21 24:00	32.1	21.8	70.0	79.3	34	35	330	
	Toilet 2	7/21 18:00	91.4	64.4	75.0	50.7	19	18	462	176	12/21 20:00	32.1	21.8	70.0	78.0	19	18	151	
	Toilet 3	7/21 18:00	91.4	64.4	75.0	50.8	19	19	467	176	12/21 20:00	32.1	21.8	70.0	78.3	19	19	157	

System Name: DOAS to Zone Level Equipment Dehum
and Reheat

Location		Cooling									Heating							
System Zone	Room	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply AirFlow (cfm)	Sensible Load (Btu/h)	Latent Load (Btu/h)	Time of Peak (Mo/D/Hr)	OA Conditions		Room Dry Bulb (°F)	Supply Dry Bulb (°F)	Zone Airflow (cfm)	System Supply Airflow (cfm)	Sensible Load (Btu/h)
			DB	WB								DB	WB					
DOAS to Zone Level Equipment Dehum and Reheat		7/21 15:00	98.4	64.2	75.0	55.0	0	1,550	70,661	0		32.0	32.0	32.0	55.0	0	N/A	0

Engineering Checks Report

Title 24 - 2022 Baseline

System Name: PSZ-HP-Admin

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Admin			759	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Admin		189	17	0.63	512	813	14.76	17	0.63	-5.04
		Office 1	94	17	0.70	525	751	15.98	17	0.70	-5.33
		Office 2	95	17	0.61	518	850	14.12	17	0.61	-4.93
	Chart/Hotel		200	31	0.35	474	1,357	8.84	31	0.35	-2.22
		Chart/Hotel	200	33	0.34	468	1,396	8.60	33	0.34	-2.07
	Entry/Waiting		370	6	1.33	563	424	28.30	6	1.33	-12.37
		Entry/Waiting	370	6	1.34	563	422	28.44	6	1.34	-12.40

System Name: PSZ-HP-Atrium

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Atrium			1,267	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Atrium		1,267	27	0.32	527	1,653	7.26	27	0.32	-4.19
		Atrium	622	27	0.24	517	2,143	5.60	27	0.24	-3.40
		Atrium 2	645	27	0.39	542	1,377	8.71	27	0.39	-4.74

System Name: PSZ-HP-Utility

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Utility			3,530	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Support		603	8	0.71	579	815	14.72	8	0.71	-6.34
		Electric	191	8	0.79	579	730	16.44	8	0.79	-6.18
		Emergency Electric	179	8	0.68	579	849	14.13	8	0.68	-4.55
		Fire Room	79	8	1.24	579	466	25.75	8	1.24	-7.65
		Mechanical	155	8	0.37	579	1,570	7.64	8	0.37	-2.42
	Utility		2,926	18	0.31	551	1,799	6.67	18	0.31	-2.93
		Clean Supply	102	18	0.28	496	1,796	6.68	18	0.28	-2.69
		Corridor 1	295	18	0.26	576	2,245	5.35	18	0.26	-2.59
		Corridor 2	635	18	0.21	576	2,728	4.40	18	0.21	-2.27
		Corridor 2.1	85	18	0.24	576	2,432	4.93	18	0.24	-2.86
		General Storage	96	18	0.50	528	1,063	11.29	18	0.50	-3.15
		Hskp	57	18	0.30	502	1,647	7.29	18	0.30	-2.87
		IT	158	18	0.33	579	1,752	6.85	18	0.33	-1.16
		Laundry	122	18	0.27	495	1,826	6.57	18	0.27	-2.65
		Meds	129	18	0.28	496	1,785	6.72	18	0.28	-2.72
		Soiled Supply	97	18	0.28	498	1,748	6.86	18	0.28	-2.71
		Staff Corridor	893	18	0.38	585	1,547	7.76	18	0.38	-3.18
		Stor.	15	18	0.61	536	881	13.62	18	0.61	-6.09
		Storage	52	18	0.41	519	1,258	9.54	18	0.41	-4.92
		Toilet 1	67	18	0.58	462	803	14.94	18	0.58	-5.45
		Toilet 2	62	18	0.45	439	972	12.35	18	0.45	-2.91
		Toilet 3	62	18	0.46	442	952	12.61	18	0.46	-3.05

System Name: PSZ-HP-ResShwr

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-ResShwr			618	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		SHWR-N	204	0	0.48	451	936	12.82	0	0.48	-4.65
		Shower 7	103	0	0.48	451	935	12.83	0	0.48	-4.51
		Shower 8	101	0	0.48	450	942	12.74	0	0.48	-4.69
		SHWR-S	207	0	0.53	459	867	13.84	0	0.53	-4.52
		Shower 3	104	0	0.51	456	886	13.54	0	0.51	-4.41
		Shower 4	103	0	0.54	461	849	14.13	0	0.54	-4.60
		SHWR-W	207	0	0.46	447	968	12.40	0	0.46	-4.59
		Shower 5	104	0	0.46	447	964	12.45	0	0.46	-4.62
		Shower 6	104	0	0.46	446	976	12.30	0	0.46	-4.51

System Name: PSZ-HP-Kitchen

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Kitchen			686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Kitchen		686	6	4.16	552	133	90.23	6	4.16	-21.40
		Kitchen	382	6	6.54	1,064	162	74.07	6	6.54	-3.56
		Service	304	6	1.17	565	484	24.79	6	1.17	-8.67

System Name: PSZ-HP-Clinical

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Clinical			1,548	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Comfort/Consult		283	47	0.54	491	904	13.27	47	0.54	-4.20
		Comfort Room 2	82	47	0.54	491	904	13.27	47	0.54	-4.33
		Consult 1	100	47	0.53	489	919	13.06	47	0.53	-4.02
		Consult 2	102	47	0.54	491	905	13.26	47	0.54	-4.10
	Exam/Storage		224	44	0.38	487	1,290	9.30	44	0.38	-2.20
		Exam Room	123	45	0.43	472	1,099	10.92	45	0.43	-1.52
		Long Term Belongings Storage	101	45	0.29	507	1,736	6.91	45	0.29	-2.74
	Group		276	60	0.55	435	791	15.17	60	0.55	-5.63
		Group	276	60	0.55	435	795	15.09	60	0.55	-5.63
	Intake-HR-A		470	22	0.66	524	791	15.17	22	0.66	-5.48
		Intake Corridor	155	22	0.26	579	2,233	5.37	22	0.26	-2.52
		Interview Room	158	22	0.59	497	840	14.29	22	0.59	-5.30
		Sally Port	78	22	1.76	548	312	38.46	22	1.76	-8.87
		Shower 1	80	22	0.51	453	880	13.64	22	0.51	-4.86
	Intake-HR-B		165	40	0.40	493	1,228	9.77	40	0.40	-2.74
		Ante Room	81	39	0.31	510	1,664	7.21	39	0.31	-2.83
		Comfort Room 1	84	39	0.52	487	942	12.74	39	0.52	-2.69
	RB-S-Corner-N		129	15	0.73	499	684	17.54	15	0.73	-6.60
		Resident Room 04	129	15	0.73	499	683	17.57	15	0.73	-6.63

System Name: PSZ-HP-Activity

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Activity			935	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	19	1.11	498	450	26.67	19	1.11	-6.76
		Noisy Activity 1	180	19	1.10	498	451	26.61	19	1.10	-6.74
	ACT-Noisy-2		181	37	0.57	439	772	15.54	37	0.57	-5.50
		Noisy Activity 2	181	37	0.56	438	780	15.38	37	0.56	-5.42
	ACT-Noisy-3		182	36	0.59	442	755	15.89	36	0.59	-6.65
		Noisy Activity 3	182	36	0.58	442	759	15.81	36	0.58	-6.63
	ACT-Quiet-1		130	45	0.46	421	911	13.17	45	0.46	-3.00
		Quiet Activity 1	130	46	0.46	420	913	13.14	46	0.46	-2.95
	ACT-Quiet-2		131	36	0.58	446	762	15.75	36	0.58	-4.22
		Quiet Activity 2	131	37	0.57	444	773	15.52	37	0.57	-4.08
	ACT-Quiet-3		131	37	0.57	439	774	15.50	37	0.57	-4.26
		Quiet Activity 3	131	37	0.56	439	777	15.44	37	0.56	-4.24

System Name: PSZ-HP-ResBed-W

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-ResBed-W			833	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-W		324	10	0.61	578	942	12.74	10	0.61	-4.28
		Corridor 4	324	10	0.61	578	947	12.67	10	0.61	-4.22
	RB-W-North		130	13	0.87	573	658	18.24	13	0.87	-7.01
		Resident Room 10	130	13	0.87	573	659	18.21	13	0.87	-7.00
	RB-W-South		380	13	0.85	513	605	19.83	13	0.85	-6.18
		Resident Room 07	125	13	0.83	511	619	19.39	13	0.83	-5.41
		Resident Room 08	126	13	0.85	513	604	19.87	13	0.85	-5.65
		Resident Room 09	128	13	0.88	509	580	20.69	13	0.88	-7.17

System Name: PSZ-HP-ResBed-N

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-ResBed-N			1,179	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-N		409	21	0.28	579	2,045	5.87	21	0.28	-3.90
		Corridor 3	409	21	0.28	579	2,051	5.85	21	0.28	-3.89
	RB-N-Corner		130	11	0.98	599	609	19.70	11	0.98	-6.59
		Resident Room 14	130	11	0.99	600	608	19.74	11	0.99	-6.60
	RB-N-East		257	14	0.79	554	704	17.05	14	0.79	-5.92
		Resident Room 15	130	14	0.79	555	699	17.17	14	0.79	-6.67
		Resident Room 16	127	14	0.78	553	712	16.85	14	0.78	-5.14
	RB-N-West		383	12	0.91	581	639	18.78	12	0.91	-5.05
		Resident Room 11	129	12	0.89	579	649	18.49	12	0.89	-4.91
		Resident Room 12	127	12	0.91	581	637	18.84	12	0.91	-4.99
		Resident Room 13	127	12	0.92	581	634	18.93	12	0.92	-5.13

System Name: PSZ-HP-ResBed-S

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-ResBed-S			1,041	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Corridor-S		414	14	0.44	584	1,323	9.07	14	0.44	-3.80
		Corridor 5	414	14	0.44	584	1,327	9.04	14	0.44	-3.78
	RB-S-Corner-S		131	13	0.87	510	585	20.51	13	0.87	-6.60
		Resident Room 05	131	13	0.87	510	586	20.48	13	0.87	-6.59
	RB-S-East		372	15	0.76	548	722	16.62	15	0.76	-4.86
		Resident Room 01	124	15	0.72	548	764	15.71	15	0.72	-4.38
		Resident Room 02	112	15	0.80	552	689	17.42	15	0.80	-5.09
		Resident Room 03	136	15	0.76	548	721	16.64	15	0.76	-5.02
	RB-S-West		124	12	0.91	580	641	18.72	12	0.91	-5.10
		Resident Room 06	124	12	0.90	580	642	18.69	12	0.90	-5.09

System Name: PSZ-HP-Common

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
PSZ-HP-Common			1,256	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Hospitality		246	30	1.11	866	778	15.42	30	1.11	-5.67
		Hospitality	246	30	1.11	866	777	15.44	30	1.11	-5.67
	Lounge		297	23	0.98	498	511	23.48	23	0.98	-6.02
		Lounge	198	23	1.13	502	445	26.97	23	1.13	-6.71
		Shower 2	99	23	0.67	479	716	16.76	23	0.67	-3.73
	Multipurpose/Dining		485	60	0.55	436	789	15.21	60	0.55	-5.63
		Multipurpose/Dining	485	60	0.55	435	791	15.17	60	0.55	-5.63
	Servery		228	63	0.53	431	817	14.69	63	0.53	-4.85
		Servery	228	63	0.53	431	818	14.67	63	0.53	-4.85

Engineering Checks Report

Primary

System Name: Single Zone CV

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Single Zone	CV		686	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Kitchen	686	0	3.69	965	261	45.98	0	3.69	-5.14
		Kitchen	382	0	6.54	1,096	167	71.86	0	6.54	-3.18
		Service	304	0	1.18	1,008	853	14.07	0	1.18	-7.70

System Name: Variable Refrigerant Flow

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	ACT-Noisy-1		180	100	0.66	527	796	15.08	100	0.66	-9.54
		Noisy Activity 1	180	100	0.66	527	798	15.04	100	0.66	-9.52
	ACT-Noisy-2		181	100	0.33	467	1,400	8.57	100	0.33	-8.31
		Noisy Activity 2	181	100	0.33	466	1,423	8.43	100	0.33	-8.22
	ACT-Noisy-3		182	100	0.35	470	1,326	9.05	100	0.35	-9.48
		Noisy Activity 3	182	100	0.35	470	1,334	9.00	100	0.35	-9.46
	ACT-Quiet-1		130	100	0.27	516	1,911	6.28	100	0.27	-6.14
		Quiet Activity 1	130	100	0.27	516	1,927	6.23	100	0.27	-6.09
	ACT-Quiet-2		131	100	0.39	527	1,346	8.92	100	0.39	-7.38
		Quiet Activity 2	131	100	0.38	526	1,368	8.77	100	0.38	-7.24
	ACT-Quiet-3		131	100	0.37	473	1,272	9.43	100	0.37	-7.41
		Quiet Activity 3	131	100	0.37	473	1,279	9.38	100	0.37	-7.39
	Admin		189	100	0.42	557	1,312	9.15	100	0.42	-6.49
		Office 1	94	100	0.47	588	1,255	9.56	100	0.47	-6.74
		Office 2	95	100	0.42	587	1,397	8.59	100	0.42	-6.38
	Attrium		1,267	100	0.20	548	2,760	4.35	100	0.20	-5.37
		Attrium	622	100	0.14	543	3,860	3.11	100	0.14	-4.57
		Attrium 2	645	100	0.25	549	2,163	5.55	100	0.25	-5.88
	Chart/Hotel		200	100	0.22	494	2,259	5.31	100	0.22	-3.82
		Chart/Hotel	200	100	0.21	492	2,372	5.06	100	0.21	-3.68
	Comfort/Consult		283	100	0.26	534	2,094	5.73	100	0.26	-7.98
		Comfort Room 2	82	100	0.26	527	2,058	5.83	100	0.26	-8.12
		Consult 1	100	100	0.26	554	2,172	5.52	100	0.26	-7.82
		Consult 2	102	100	0.25	529	2,075	5.78	100	0.25	-7.90
	Corridor-N		409	100	0.20	577	2,931	4.09	100	0.20	-4.61
		Corridor 3	409	100	0.20	576	2,939	4.08	100	0.20	-4.60
	Corridor-S		414	100	0.37	594	1,623	7.39	100	0.37	-4.52
		Corridor 5	414	100	0.37	594	1,624	7.39	100	0.37	-4.51
	Corridor-W		324	100	0.53	577	1,094	10.97	100	0.53	-5.00
		Corridor 4	324	100	0.52	577	1,100	10.91	100	0.52	-4.95
	Entry/Waiting		370	100	1.23	567	462	25.97	100	1.23	-13.28
		Entry/Waiting	370	100	1.23	567	459	26.14	100	1.23	-13.32

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 13 of 17

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
		Exam/Storage	224	100	0.22	530	2,383	5.04	100	0.22	-5.86
		Exam Room	123	100	0.25	925	3,628	3.31	100	0.25	-5.26
		Long Term Belongings Storage	101	100	0.18	516	2,829	4.24	100	0.18	-3.34
	Group		276	100	0.33	824	2,495	4.81	100	0.33	-10.51
		Group	276	100	0.33	973	2,947	4.07	100	0.33	-10.58
	Hospitality		246	100	0.33	857	2,598	4.62	100	0.33	-10.63
		Hospitality	246	100	0.33	857	2,595	4.62	100	0.33	-10.64
	Intake-HR-A		470	100	0.32	573	1,791	6.70	100	0.32	-7.87
		Intake Corridor	155	100	0.12	576	4,955	2.42	100	0.12	-3.12
		Interview Room	158	100	0.29	577	1,956	6.13	100	0.29	-9.10
		Sally Port	78	100	0.66	586	893	13.44	100	0.66	-12.07
		Shower 1	80	100	0.44	442	1,008	11.90	100	0.44	-4.46
	Intake-HR-B		165	100	0.23	527	2,339	5.13	100	0.23	-5.75
		Ante Room	81	100	0.19	518	2,659	4.51	100	0.19	-3.44
		Comfort Room 1	84	100	0.26	707	2,771	4.33	100	0.26	-6.36
	Lounge		297	100	0.50	549	1,101	10.90	100	0.50	-9.48
		Lounge	198	100	0.47	586	1,238	9.69	100	0.47	-11.43
		Shower 2	99	100	0.55	468	853	14.07	100	0.55	-3.28
	Multipurpose/Dining		485	100	0.33	877	2,658	4.51	100	0.33	-10.38
		Multipurpose/Dining	485	100	0.33	880	2,667	4.50	100	0.33	-10.37
	RB-N-Corner		130	100	0.77	516	671	17.88	100	0.77	-8.16
		Resident Room 14	130	100	0.77	516	670	17.91	100	0.77	-8.16
	RB-N-East		257	100	0.65	513	791	15.17	100	0.65	-7.48
		Resident Room 15	130	100	0.66	514	782	15.35	100	0.66	-8.23
		Resident Room 16	127	100	0.64	513	803	14.94	100	0.64	-6.70
	RB-N-West		383	100	0.72	513	709	16.93	100	0.72	-6.62
		Resident Room 11	129	100	0.71	517	730	16.44	100	0.71	-6.48
		Resident Room 12	127	100	0.73	513	706	17.00	100	0.73	-6.56
		Resident Room 13	127	100	0.73	514	703	17.07	100	0.73	-6.70
	RB-S-Corner-N		129	100	0.68	540	798	15.04	100	0.68	-8.16
		Resident Room 04	129	100	0.68	540	796	15.08	100	0.68	-8.18
	RB-S-Corner-S		131	100	0.82	545	669	17.94	100	0.82	-8.16
		Resident Room 05	131	100	0.81	545	669	17.94	100	0.81	-8.15

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	RB-S-East		372	100	0.63	512	810	14.81	100	0.63	-6.42
		Resident Room 01	124	100	0.59	526	887	13.53	100	0.59	-5.94
		Resident Room 02	112	100	0.67	515	767	15.65	100	0.67	-6.64
		Resident Room 03	136	100	0.63	512	808	14.85	100	0.63	-6.58
	RB-S-West		124	100	0.72	517	723	16.60	100	0.72	-6.66
		Resident Room 06	124	100	0.71	517	724	16.57	100	0.71	-6.65
	RB-W-North		130	100	0.69	516	745	16.11	100	0.69	-8.57
		Resident Room 10	130	100	0.69	516	745	16.11	100	0.69	-8.56
	RB-W-South		380	100	0.80	569	712	16.85	100	0.80	-7.76
		Resident Room 07	125	100	0.78	569	732	16.39	100	0.78	-6.99
		Resident Room 08	126	100	0.80	569	709	16.93	100	0.80	-7.23
		Resident Room 09	128	100	0.82	545	662	18.13	100	0.82	-8.74
	Servery		228	100	0.33	913	2,767	4.34	100	0.33	-9.71
		Servery	228	100	0.33	915	2,773	4.33	100	0.33	-9.72
	SHWR-N		204	100	0.46	446	971	12.36	100	0.46	-4.32
		Shower 7	103	100	0.46	447	964	12.45	100	0.46	-4.20
		Shower 8	101	100	0.45	445	984	12.20	100	0.45	-4.33
	SHWR-S		207	100	0.49	452	928	12.93	100	0.49	-4.18
		Shower 3	104	100	0.48	451	934	12.85	100	0.48	-4.10
		Shower 4	103	100	0.49	452	924	12.99	100	0.49	-4.24
	SHWR-W		207	100	0.43	440	1,022	11.74	100	0.43	-4.25
		Shower 5	104	100	0.44	441	1,012	11.86	100	0.44	-4.31
		Shower 6	104	100	0.42	438	1,037	11.57	100	0.42	-4.15
	Support		603	100	0.36	577	1,584	7.58	100	0.36	-5.78
		Electric	191	100	0.40	587	1,479	8.11	100	0.40	-6.41
		Emergency Electric	179	100	0.33	577	1,752	6.85	100	0.33	-4.81
		Fire Room	79	100	0.53	587	1,106	10.85	100	0.53	-7.65
		Mechanical	155	100	0.28	578	2,060	5.83	100	0.28	-3.02

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
Variable Refrigerant Flow			12,966	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Utility		2,926	100	0.17	560	3,303	3.63	100	0.17	-3.44
		Clean Supply	102	100	0.17	513	3,064	3.92	100	0.17	-3.29
		Corridor 1	295	100	0.12	576	4,750	2.53	100	0.12	-3.21
		Corridor 2	635	100	0.10	576	6,011	2.00	100	0.10	-2.94
		Corridor 2.1	85	100	0.14	598	4,304	2.79	100	0.14	-3.52
		General Storage	96	100	0.37	539	1,444	8.31	100	0.37	-3.72
		Hskp	57	100	0.19	517	2,739	4.38	100	0.19	-3.46
		IT	158	100	0.25	578	2,306	5.20	100	0.25	-1.88
		Laundry	122	100	0.16	521	3,197	3.75	100	0.16	-3.26
		Meds	129	100	0.17	522	3,148	3.81	100	0.17	-3.32
		Soiled Supply	97	100	0.17	514	2,956	4.06	100	0.17	-3.31
		Staff Corridor	893	100	0.16	595	3,701	3.24	100	0.16	-3.67
		Stor.	15	100	0.48	546	1,143	10.50	100	0.48	-6.37
		Storage	52	100	0.31	534	1,718	6.98	100	0.31	-5.48
		Toilet 1	67	100	0.52	458	879	13.65	100	0.52	-5.00
		Toilet 2	62	100	0.30	344	1,164	10.31	100	0.30	-2.49
		Toilet 3	62	100	0.30	348	1,152	10.42	100	0.30	-2.60

System Name: DOAS to Zone Level Equipment Dehum and Reheat

Location			Cooling					Heating			
System	Zone	Room	Area (ft²)	% OA	cfm/ft²	cfm/ton	ft²/ton	Btu/h-ft²	% OA	cfm/ft²	Btu/h-ft²
DOAS to Zone Level Equipment Dehum and Reheat			0	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Project Summary



Building Summary

Building Type	
Conditioned Floor Area	13,652 ft²
Total Building Area	21,103 ft²
Gross Wall Area	11,729 ft²
Window-Wall Ratio	9.84 %
Gross Roof Area	15,695 ft²
Skylight-Roof Ratio	0 %
Average Plug Load Density	0.69 W/ft²
Average Lighting Density	0.43 W/ft²
Peak Occupancy	125
Site Ventilation	1,724 cfm
Cooling Specific Air Flow	10,118 cfm
Heating Specific Air Flow	10,118 cfm
Site Peak Cooling Load	22 tons
Site Peak Heating Load	269 MBh


Weather Summary

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Summer Design Dry Bulb Temperature (1%)	98.8
Winter Design Dry Bulb Temperature (99%)	35.6
User Defined	
Summer Design Day Dry Bulb Temperature	98.8
Coincident Design Day Wet Bulb Temperature	66.6
Winter Design Day Dry Bulb Temperature	32.1

Project Information



Project Name Casa De Amparo_v5
 Building Owner
 Location
 Program User
 Company

Building Performance

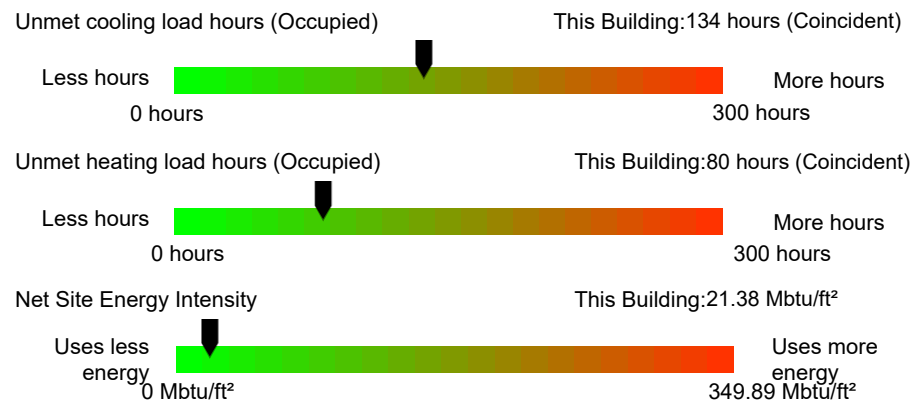

Site Performance

Net Source Energy Use Intensity (EUI) 67.7 Mbtu/ft²
 Annual Electrical Consumption 132,261 kWh
 Annual Peak Electrical Demand 34 kW
 Annual Gas Consumption 0 MMBtu
 Annual Water Consumption 0 gal

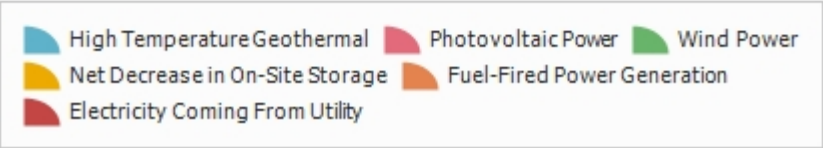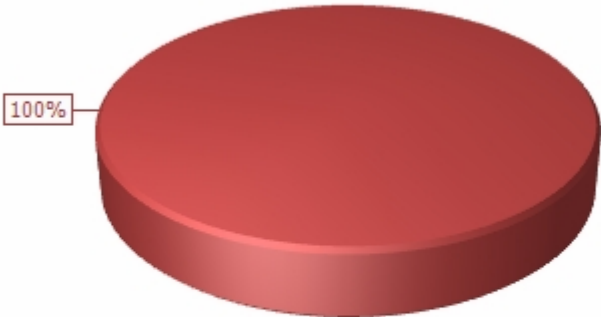

Fuel-Fired Power Generation	0 kWh
High Temperature Geothermal	0 kWh
Photovoltaic Power	0 kWh
Wind Power	0 kWh
Net Decrease in On-Site Storage	0 kWh
Sub-Total On Site Electricity	0 kWh
Electricity Coming From Utility	132,260 kWh
Surplus Electricity To Utility	0 kWh
Net Electricity From Utility	132,260 kWh
Total Electric Sources	132,260 kWh

Water-Side Heat Recovery	0 kWh
Air to Air Heat Recovery Cooling	0 kWh
Air to Air Heat Recover Heating	0 kWh
High-Temperature Geothermal	0 kWh
Solar Water Thermal	0 kWh
Solar Air Thermal	0 kWh
Total On-Site Thermal Sources	0 kWh

Project Summary



Building Summary

Building Type	
Conditioned Floor Area	13,652 ft²
Total Building Area	21,103 ft²
Gross Wall Area	11,729 ft²
Window-Wall Ratio	7.05 %
Gross Roof Area	15,695 ft²
Skylight-Roof Ratio	0 %
Average Plug Load Density	0.69 W/ft²
Average Lighting Density	0.45 W/ft²
Peak Occupancy	125
Site Ventilation	1,550 cfm
Cooling Specific Air Flow	6,796 cfm
Heating Specific Air Flow	4,081 cfm
Site Peak Cooling Load	23 tons
Site Peak Heating Load	293 MBh


Weather Summary

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Summer Design Dry Bulb Temperature (1%)	98.8
Winter Design Dry Bulb Temperature (99%)	35.6
User Defined	
Summer Design Day Dry Bulb Temperature	98.8
Coincident Design Day Wet Bulb Temperature	66.6
Winter Design Day Dry Bulb Temperature	32.1

Project Information



Project Name Casa De Amparo_v5
 Building Owner
 Location
 Program User
 Company

Building Performance

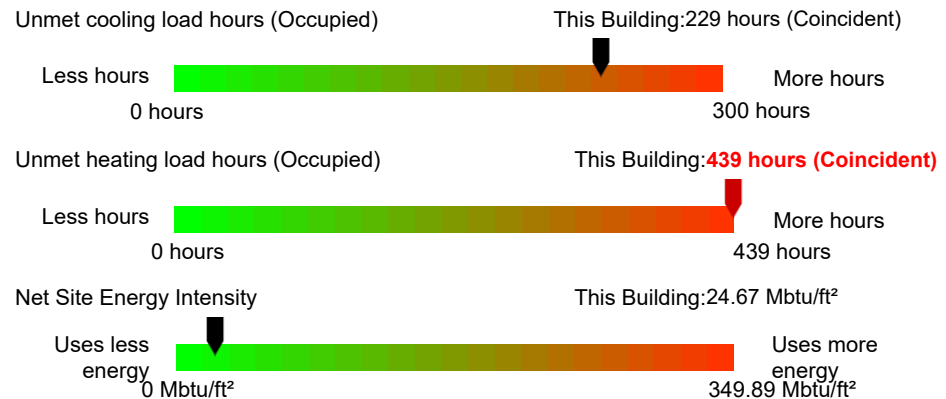

Site Performance


Net Source Energy Use Intensity (EUI) 78.1 Mbtu/ft²
 Annual Electrical Consumption 152,600 kWh
 Annual Peak Electrical Demand 37 kW
 Annual Gas Consumption 0 MMBtu
 Annual Water Consumption 0 gal

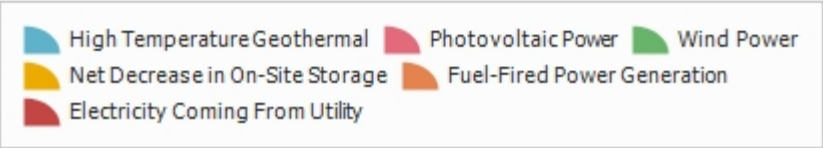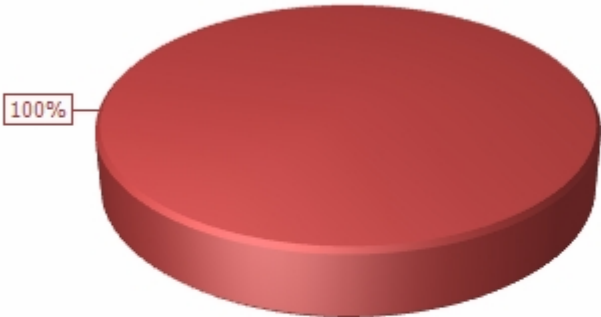

Fuel-Fired Power Generation	0 kWh
High Temperature Geothermal	0 kWh
Photovoltaic Power	0 kWh
Wind Power	0 kWh
Net Decrease in On-Site Storage	0 kWh
Sub-Total On Site Electricity	0 kWh
Electricity Coming From Utility	152,600 kWh
Surplus Electricity To Utility	0 kWh
Net Electricity From Utility	152,600 kWh
Total Electric Sources	152,600 kWh


Water-Side Heat Recovery	569 kWh
Air to Air Heat Recovery Cooling	0 kWh
Air to Air Heat Recover Heating	0 kWh
High-Temperature Geothermal	0 kWh
Solar Water Thermal	0 kWh
Solar Air Thermal	0 kWh
Total On-Site Thermal Sources	569 kWh

Alternative Annual Electricity End Use and Demand Comparison

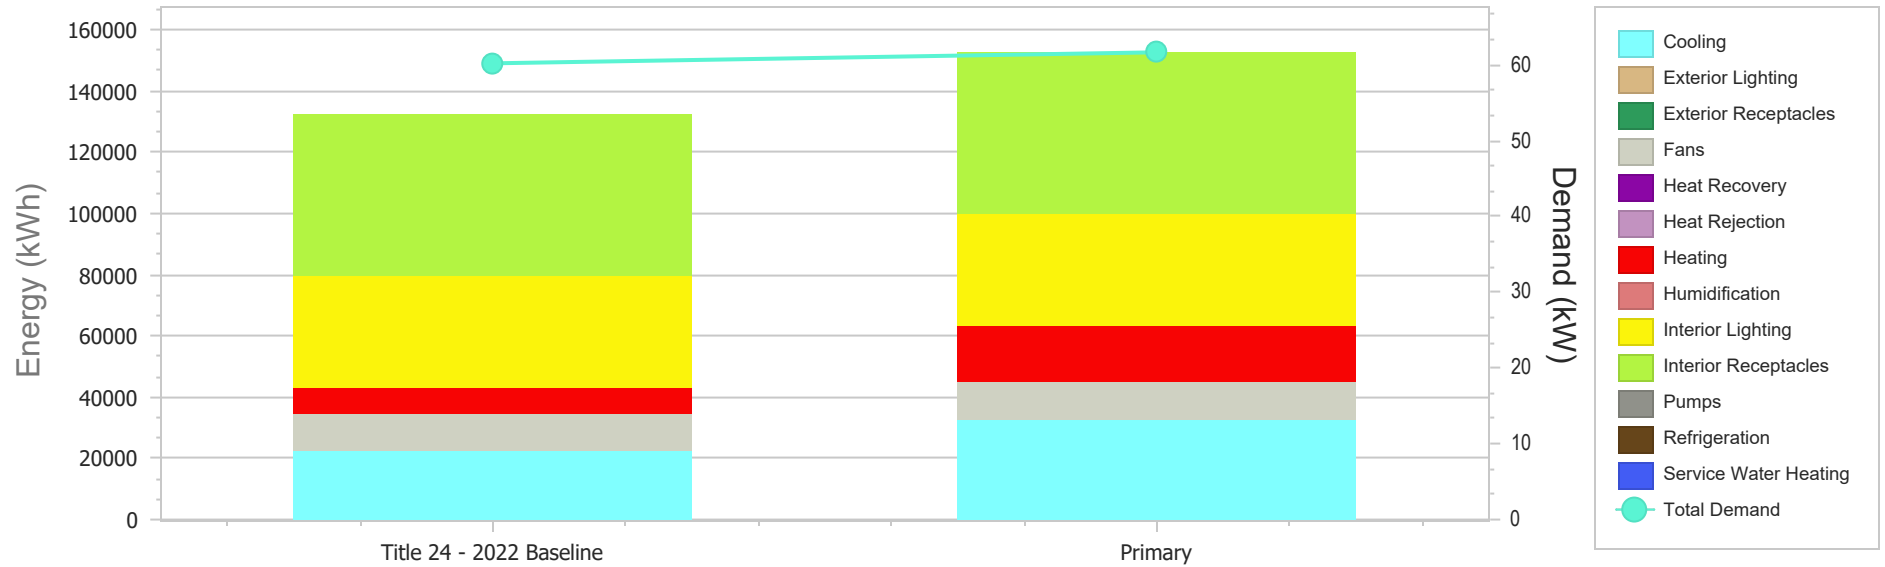

	Title 24 - 2022 Baseline		Primary	
	Energy (kWh)	Demand (kW)	Energy (kWh)	Demand (kW)
Cooling	22,281.95	22.77	32,632.17	21.62
Exterior Lighting	0.00	0.00	0.00	0.00
Exterior Receptacles	0.00	0.00	0.00	0.00
Fans	12,364.89	1.69	12,514.33	1.83
Heat Recovery	0.00	0.00	0.00	0.00
Heat Rejection	0.00	0.00	0.00	0.00
Heating	8,539.57	16.44	18,106.91	18.51
Humidification	0.00	0.00	0.00	0.00
Interior Lighting	36,295.70	8.37	36,568.19	8.76
Interior Receptacles	52,779.21	10.94	52,779.21	10.94
Pumps	0.00	0.00	0.00	0.00
Refrigeration	0.00	0.00	0.00	0.00
Service Water Heating	0.00	0.00	0.00	0.00
Grand Total	132,261.32	60.21	152,600.81	61.66

Economic Alternative Comparison

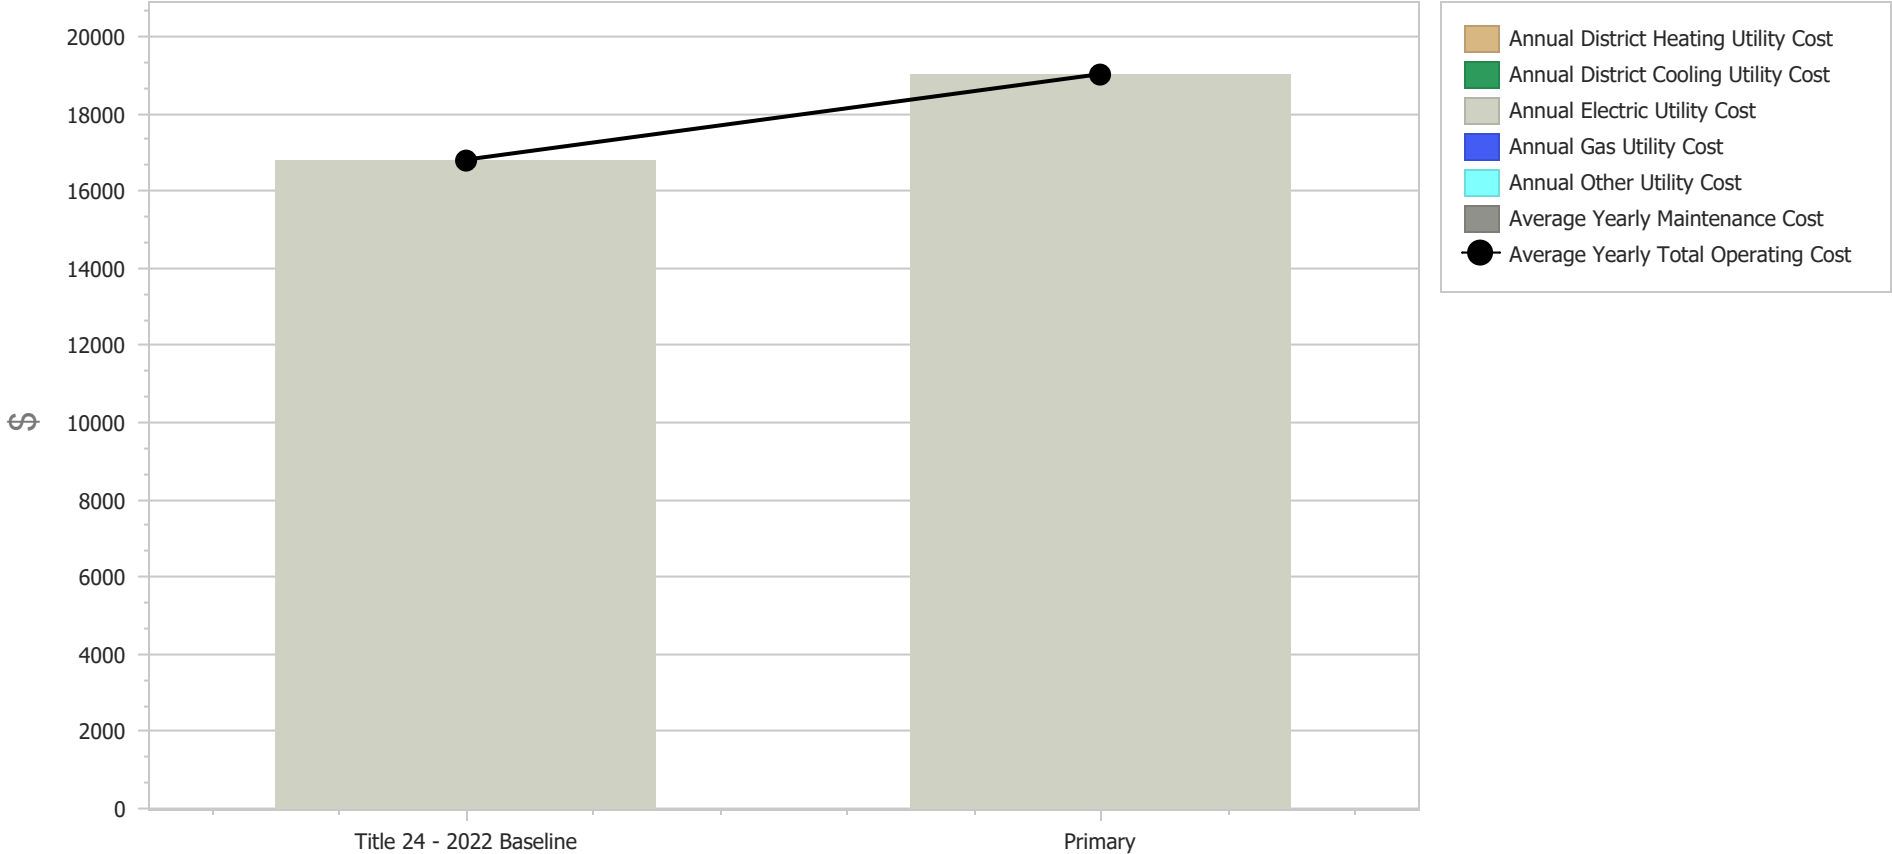

	Title 24 - 2022 Baseline	Primary
Annual District Cooling Utility Cost	0	0
Annual District Heating Utility Cost	0	0
Annual Electric Utility Cost	16,808	19,027
Annual Gas Utility Cost	0	0
Annual Other Utility Cost	0	0
Average Yearly Maintenance Cost	0	0
Average Yearly Total Operating Cost	16,808	19,027

Climatic Summary


Overview

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Weather File Source	CTZRV2
WMO Station	722860
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Elevation	1,539 ft
Standard Pressure	0.96 Bar
Heating Degree Days (base 65°F)	1,674
Cooling Degree Days (base 50°F)	5,022

Peaks

	Dry Bulb Temp. [F]	Dew Point Temp. [F]
Maximum	104.2	70
Date	Aug 13	Aug 7
Minimum	30.9	0.3
Date	Jan 3	Feb 22

— Daily Minimum DryBulb — Daily Maximum DryBulb - - - Summer Design - - - Winter Design

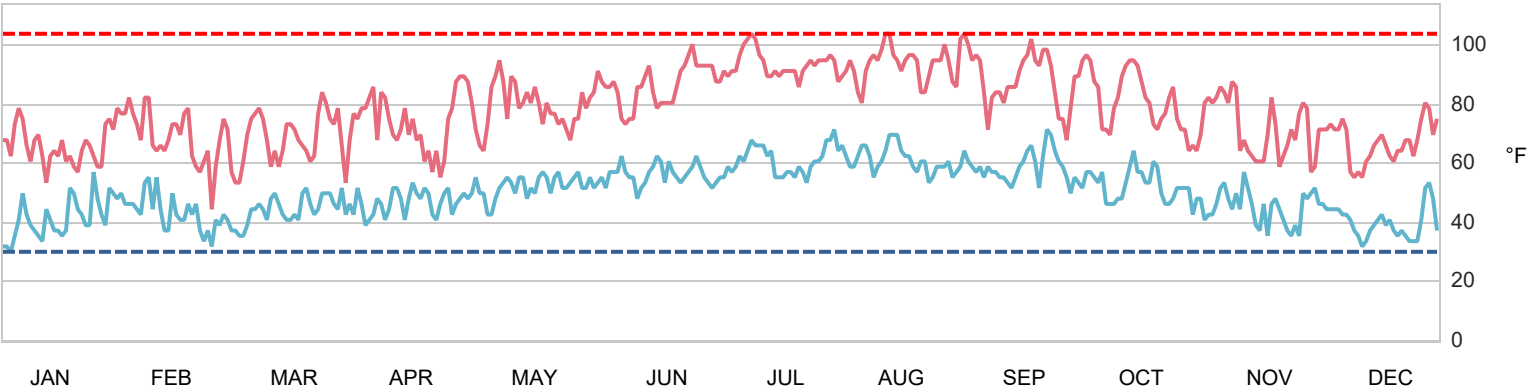

Design Day Data

	ASHRAE Design Conditions %	Design Temperature [F]	Daily Temperature Range [ΔF]	Humidity Value	Humidity Type	Wind Speed [mph]	Wind Direction deg.
Heating	99.6	32.1	0	23.2	Wetbulb[F]	23.6	300 °
Cooling	1	98.8	30.9	66.6	Wetbulb[F]	9.9	300 °

Climatic Summary


Overview

Location	Climate Zone 10 CA USA
Weather File	CZ10RV2
Weather File Source	CTZRV2
WMO Station	722860
Latitude	N 33° 52
Longitude	W 117° 16
Time Zone	GMT -8.0 Hours
Elevation	1,539 ft
Standard Pressure	0.96 Bar
Heating Degree Days (base 65°F)	1,674
Cooling Degree Days (base 50°F)	5,022

Peaks

	Dry Bulb Temp. [F]	Dew Point Temp. [F]
Maximum	104.2	70
Date	Aug 13	Aug 7
Minimum	30.9	0.3
Date	Jan 3	Feb 22


— Daily Minimum DryBulb — Daily Maximum DryBulb - - - Summer Design - - - Winter Design

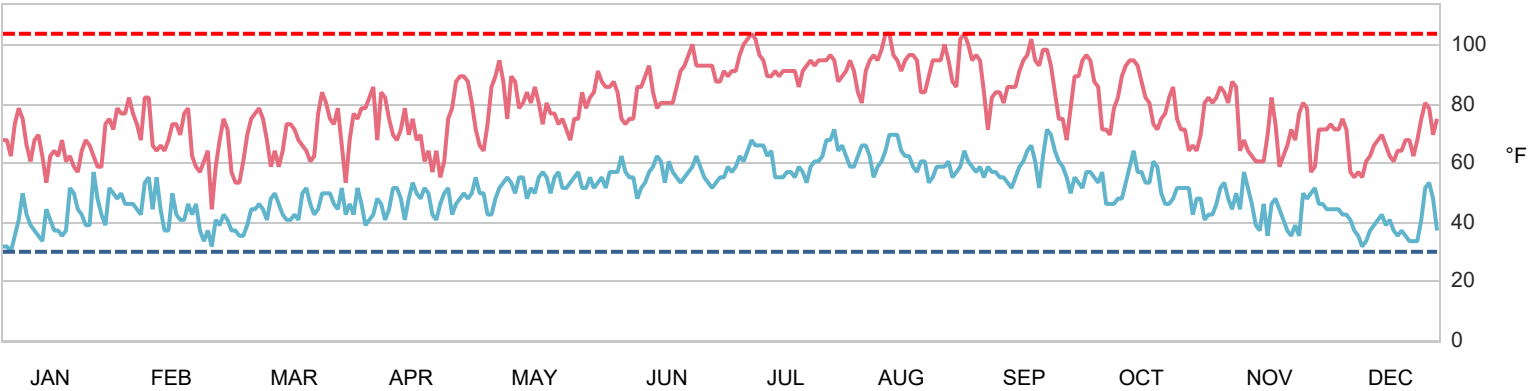

Design Day Data

	ASHRAE Design Conditions %	Design Temperature [F]	Daily Temperature Range [ΔF]	Humidity Value	Humidity Type	Wind Speed [mph]	Wind Direction deg.
Heating	99.6	32.1	0	23.2	Wetbulb[F]	23.6	300 °
Cooling	1	98.8	30.9	66.6	Wetbulb[F]	9.9	300 °

Lighting and Daylighting Summary

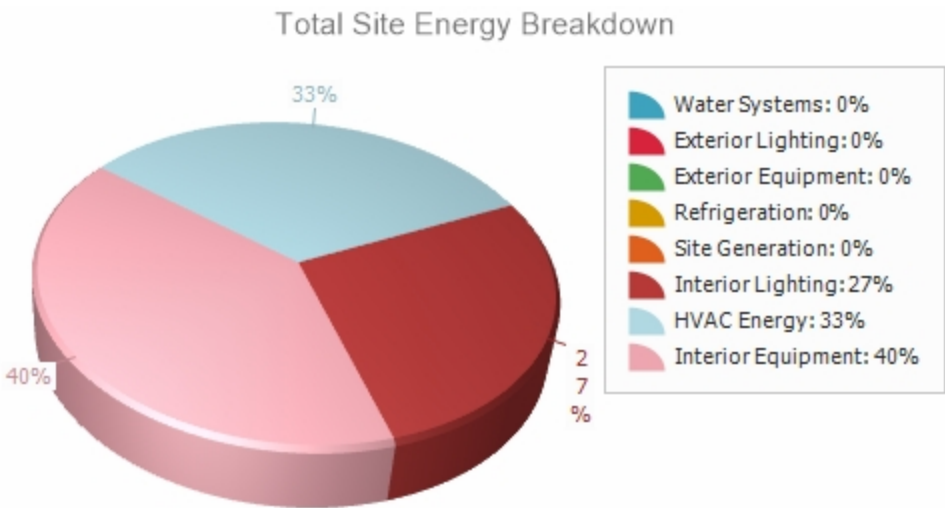

Window Area

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	9.77	12.82	10.99	5.92	9.84
Gross Window-Wall Ratio	%	9.77	12.82	10.99	5.92	9.84
Window Opening Area	ft²	266	340	372	176	1,154
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729

SkyLight Area

	Units	Total
Gross Roof Area	ft²	15,695
Skylight Area	ft²	0
Skylight-Roof Ratio	%	0

Lighting

Component	Electricity (kWh)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)
Interior Lighting	36,294	123,842	5.87	392,207	18.58
Exterior Lighting	0	0	0	0	0

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Intake-HR-B	Ante Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.24	39	0.31	120	59.14
Attrium	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.29	367	0.31	3,212	167.98
Attrium	2 _Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.3	381	0.31	3,333	167.98
Chart/Hotel	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	146	0.31	449	59.14
Utility	Clean Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	49	0.31	151	59.14
Intake-HR-B	Comfort Room 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	83	0.31	256	59.14
Comfort/Consult	Comfort Room 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.29	81	0.31	250	59.14
Comfort/Consult	Consult 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	99	0.31	305	59.14
Comfort/Consult	Consult 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	100	0.31	310	59.14
Utility	Corridor 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.07	195	0.31	601	59.14
Utility	Corridor 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.14	419	0.31	1,292	59.14
Utility	Corridor 2.1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	56	0.31	174	59.14
Corridor-N	Corridor 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.66	270	0.31	833	59.14
Corridor-W	Corridor 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.66	214	0.31	659	59.14
Corridor-S	Corridor 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.66	273	0.31	843	59.14
Support	Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.16	95	0.31	294	59.14
Support	Emergency Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.15	89	0.31	276	59.14
Entry/Waiting	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.59	219	0.31	1,914	167.98

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Exam/Storage	Exam Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.54	122	0.31	376	59.14
Support	Fire Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.07	40	0.31	122	59.14
Utility	General Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	46	0.31	142	59.14
Group	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.65	180	0.31	554	59.14
Hospitality	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.65	160	0.31	493	59.14
Utility	Hskp _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	27	0.31	84	59.14
Intake-HR-A	Intake Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.22	102	0.31	315	59.14
Intake-HR-A	Interview Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.33	156	0.31	482	59.14
Utility	It _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	79	0.31	244	59.14
Kitchen	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.67	462	0.31	4,049	167.98
Utility	Laundry _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	58	0.31	180	59.14
Exam/Storage	Long Term Belongings Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.22	48	0.31	149	59.14
Lounge	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.43	129	0.31	396	59.14
Support	Mechanical _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	77	0.31	239	59.14
Utility	Meds _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	62	0.31	192	59.14
Multipurpose/Dining	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.65	316	0.31	973	59.14
ACT-Noisy-1	Noisy Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	131	0.31	404	59.14
ACT-Noisy-2	Noisy Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	132	0.31	407	59.14
ACT-Noisy-3	Noisy Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	133	0.31	410	59.14
Admin	Office 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.36	69	0.31	212	59.14
Admin	Office 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.37	69	0.31	214	59.14
ACT-Quiet-1	Quiet Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	95	0.31	293	59.14
ACT-Quiet-2	Quiet Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	95	0.31	294	59.14
ACT-Quiet-3	Quiet Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.73	96	0.31	295	59.14

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 3 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
RB-S-East	Resident Room 01 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	77	0.31	237	59.14
RB-S-East	Resident Room 02 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.19	69	0.31	213	59.14
RB-S-East	Resident Room 03 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.23	85	0.31	261	59.14
RB-S-Corner-N	Resident Room 04 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.62	80	0.31	247	59.14
RB-S-Corner-S	Resident Room 05 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.62	81	0.31	251	59.14
RB-S-West	Resident Room 06 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.62	77	0.31	237	59.14
RB-W-South	Resident Room 07 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.2	78	0.31	240	59.14
RB-W-South	Resident Room 08 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	78	0.31	241	59.14
RB-W-South	Resident Room 09 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	79	0.31	244	59.14
RB-W-North	Resident Room 10 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.62	80	0.31	248	59.14
RB-N-West	Resident Room 11 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	80	0.31	247	59.14
RB-N-West	Resident Room 12 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	79	0.31	242	59.14
RB-N-West	Resident Room 13 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	79	0.31	242	59.14
RB-N-Corner	Resident Room 14 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.62	81	0.31	249	59.14
RB-N-East	Resident Room 15 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.31	81	0.31	249	59.14
RB-N-East	Resident Room 16 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.31	79	0.31	242	59.14
Intake-HR-A	Sally Port _Light Load #001_Template	Lights - Small Hotel - Lighting	0.16	77	0.31	237	59.14
Servery	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.65	148	0.31	457	59.14
Kitchen	Service _Light Load #001_Template	Lights - Small Hotel - Lighting	0.21	146	0.31	449	59.14
Intake-HR-A	Shower 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	60	0.31	185	59.14
Lounge	Shower 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	74	0.31	229	59.14
SHWR-S	Shower 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	78	0.31	240	59.14
SHWR-S	Shower 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.37	77	0.31	239	59.14
SHWR-W	Shower 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	78	0.31	240	59.14


Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
SHWR-W	Shower 6 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.37	78	0.31	239	59.14
SHWR-N	Shower 7 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.38	77	0.31	238	59.14
SHWR-N	Shower 8 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.37	76	0.31	233	59.14
Utility	Soiled Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	46	0.31	143	59.14
Utility	Staff Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.2	590	0.31	1,818	59.14
Utility	Stor. _Light Load #001_Template	Lights - Small Hotel - Lighting	0	7	0.31	22	59.14
Utility	Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	25	0.31	77	59.14
Utility	Toilet 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	50	0.31	155	59.14
Utility	Toilet 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	46	0.31	143	59.14
Utility	Toilet 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	46	0.31	143	59.14
Unconditioned Room Room 00-81	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.65	2	0.31	7	59.14
Unconditioned Room Trash	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.48	37	0.31	113	59.14

Daylighting

Daylighting Reference Point	Zone Name	Control Type	Control Type	Fraction of Lighting Controlled	Installed Lighting Power (W)	Controlled Lighting Power (W)	Window Area (ft²)	Average Visible Transmittance
None					0	0	0	0

Lighting and Daylighting Summary

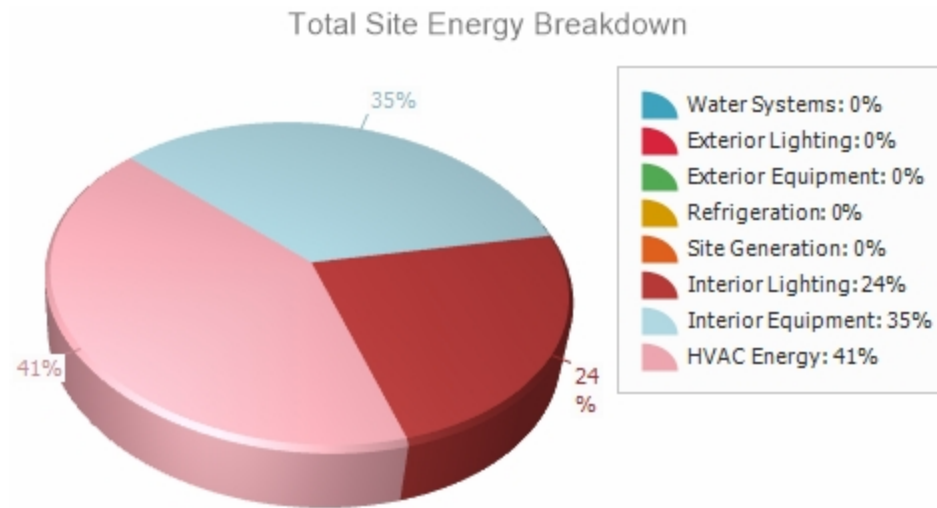

Window Area

	Units	North	East	South	West	Total
Above Ground Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Above Ground Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Gross Wall Area	ft²	2,721	2,651	3,382	2,975	11,729
Gross Window-Wall Ratio	%	8.22	10.45	5.06	5.22	7.05
Window Opening Area	ft²	224	277	171	155	827

SkyLight Area

	Units	Total
Gross Roof Area	ft²	15,695
Skylight Area	ft²	0
Skylight-Roof Ratio	%	0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 6 of 10

Lighting

Component	Electricity (kWh)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)
Interior Lighting	36,567	124,771	5.91	395,149	18.72
Exterior Lighting	0	0	0	0	0

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Intake-HR-B	Ante Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	40	0.31	125	59.14
Attrium	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.29	373	0.31	3,267	167.98
Attrium	2 _Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.31	387	0.31	3,390	167.98
Chart/Hotel	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.7	140	0.31	431	59.14
Utility	Clean Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	51	0.31	157	59.14
Intake-HR-B	Comfort Room 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.61	101	0.31	310	59.14
Comfort/Consult	Comfort Room 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	98	0.31	304	59.14
Comfort/Consult	Consult 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.42	120	0.31	370	59.14
Comfort/Consult	Consult 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.43	122	0.31	375	59.14
Utility	Corridor 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.04	118	0.31	364	59.14
Utility	Corridor 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.09	254	0.31	783	59.14
Utility	Corridor 2.1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	34	0.31	105	59.14
Corridor-N	Corridor 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	164	0.31	505	59.14
Corridor-W	Corridor 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	130	0.31	400	59.14
Corridor-S	Corridor 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	166	0.31	511	59.14
Support	Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.16	95	0.31	294	59.14
Support	Emergency Electric _Light Load #001_Template	Lights - Small Hotel - Lighting	0.15	89	0.31	276	59.14
Entry/Waiting	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.6	222	0.31	1,947	167.98

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 7 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
Exam/Storage	Exam Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.66	148	0.31	455	59.14
Support	Fire Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.07	40	0.31	122	59.14
Utility	General Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	48	0.31	147	59.14
Group	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	207	0.31	639	59.14
Hospitality	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	185	0.31	569	59.14
Utility	Hskp _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	28	0.31	88	59.14
Intake-HR-A	Intake Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	62	0.31	191	59.14
Intake-HR-A	Interview Room _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	189	0.31	584	59.14
Utility	It _Light Load #001_Template	Lights - Small Hotel - Lighting	0.03	79	0.31	244	59.14
Kitchen	_Light Load #001_Template	Lights - Cooling Only Design - Lighting	0.36	244	0.31	2,141	167.98
Utility	Laundry _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	61	0.31	188	59.14
Exam/Storage	Long Term Belongings Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.23	50	0.31	155	59.14
Lounge	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	148	0.31	457	59.14
Support	Mechanical _Light Load #001_Template	Lights - Small Hotel - Lighting	0.13	77	0.31	239	59.14
Utility	Meds _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	65	0.31	200	59.14
Multipurpose/Dining	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	364	0.31	1,123	59.14
ACT-Noisy-1	Noisy Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	180	0.31	554	59.14
ACT-Noisy-2	Noisy Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	181	0.31	558	59.14
ACT-Noisy-3	Noisy Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	182	0.31	562	59.14
Admin	Office 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	66	0.31	203	59.14
Admin	Office 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.35	67	0.31	205	59.14
ACT-Quiet-1	Quiet Activity 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	130	0.31	402	59.14
ACT-Quiet-2	Quiet Activity 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	131	0.31	403	59.14
ACT-Quiet-3	Quiet Activity 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	1	131	0.31	404	59.14

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 8 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
RB-S-East	Resident Room 01 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	149	0.31	458	59.14
RB-S-East	Resident Room 02 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.36	134	0.31	413	59.14
RB-S-East	Resident Room 03 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.44	164	0.31	505	59.14
RB-S-Corner-N	Resident Room 04 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	155	0.31	478	59.14
RB-S-Corner-S	Resident Room 05 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	158	0.31	486	59.14
RB-S-West	Resident Room 06 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	149	0.31	459	59.14
RB-W-South	Resident Room 07 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	150	0.31	464	59.14
RB-W-South	Resident Room 08 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	467	59.14
RB-W-South	Resident Room 09 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	153	0.31	473	59.14
RB-W-North	Resident Room 10 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	156	0.31	480	59.14
RB-N-West	Resident Room 11 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	155	0.31	478	59.14
RB-N-West	Resident Room 12 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	469	59.14
RB-N-West	Resident Room 13 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.4	152	0.31	469	59.14
RB-N-Corner	Resident Room 14 _Light Load #001_Template	Lights - Small Hotel - Lighting	1.2	156	0.31	483	59.14
RB-N-East	Resident Room 15 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.61	156	0.31	482	59.14
RB-N-East	Resident Room 16 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.59	152	0.31	469	59.14
Intake-HR-A	Sally Port _Light Load #001_Template	Lights - Small Hotel - Lighting	0.2	93	0.31	288	59.14
Servery	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	171	0.31	528	59.14
Kitchen	Service _Light Load #001_Template	Lights - Small Hotel - Lighting	0.22	152	0.31	468	59.14
Intake-HR-A	Shower 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.09	40	0.31	124	59.14
Lounge	Shower 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.17	49	0.31	153	59.14
SHWR-S	Shower 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14
SHWR-S	Shower 4 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	159	59.14
SHWR-W	Shower 5 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 9 of 10

Interior Lighting

Zone Name	Zone Lighting Library Entry (Libraries>InternalLoads>Lights)	Schedules (Libraries>Schedules>Lighting)	Lighting Power Density (W/ft²)	Installed Lighting Power (W)	Fraction of Lighting Energy to Return Air	Lighting Consumption (kWh)	Full Load Hours per Week
SHWR-W	Shower 6 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	52	0.31	160	59.14
SHWR-N	Shower 7 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	51	0.31	159	59.14
SHWR-N	Shower 8 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.25	50	0.31	155	59.14
Utility	Soiled Supply _Light Load #001_Template	Lights - Small Hotel - Lighting	0.02	48	0.31	149	59.14
Utility	Staff Corridor _Light Load #001_Template	Lights - Small Hotel - Lighting	0.12	357	0.31	1,102	59.14
Utility	Stor. _Light Load #001_Template	Lights - Small Hotel - Lighting	0	7	0.31	22	59.14
Utility	Storage _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	26	0.31	80	59.14
Utility	Toilet 1 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	33	0.31	103	59.14
Utility	Toilet 2 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	31	0.31	95	59.14
Utility	Toilet 3 _Light Load #001_Template	Lights - Small Hotel - Lighting	0.01	31	0.31	95	59.14
Unconditioned Room Room 00-81	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.75	3	0.31	8	59.14
Unconditioned Room Trash	_Light Load #001_Template	Lights - Small Hotel - Lighting	0.5	38	0.31	118	59.14

Daylighting


Daylighting Reference Point	Zone Name	Control Type	Control Type	Fraction of Lighting Controlled	Installed Lighting Power (W)	Controlled Lighting Power (W)	Window Area (ft²)	Average Visible Transmittance
None					0	0	0	0

Site Consumption Summary


Energy Consumption

HVAC Energy Usage

(MMBtu)

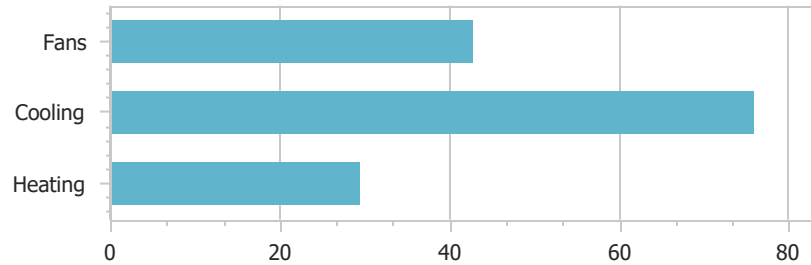

Total Site Energy Breakdown

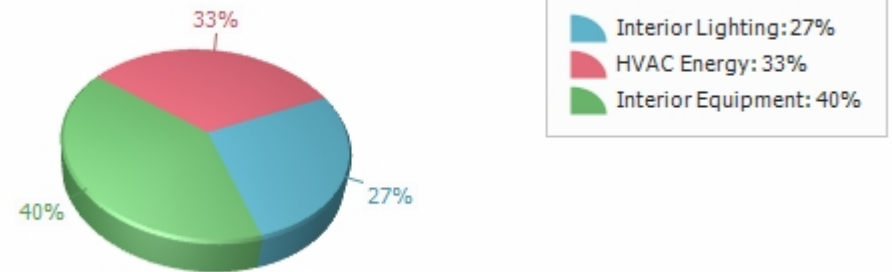

Component	Electricity (kWh)	Gas (MMBtu)	District Cooling (MMBtu)	District Heating Water (MMBtu)	Other Utilities (MMBtu)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)	Water (gal)
Heating	8,539	0	0	0	0	29,136	1.38	92,273	4.37	0
Cooling	22,281	0	0	0	0	76,024	3.6	240,769	11.41	0
Fans	12,364	0	0	0	0	42,187	2	133,607	6.33	0
Pumps	0	0	0	0	0	0	0	0	0	0
Heat Rejection	0	0	0	0	0	0	0	0	0	0
Humidification	0	0	0	0	0	0	0	0	0	0
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0
HVAC	43,183	0	0	0	0	147,348	6.98	466,650	22.11	0
Water Systems	0	0	0	0	0	0	0	0	0	0
Interior Lighting	36,294	0	0	0	0	123,842	5.87	392,207	18.58	0
Exterior Lighting	0	0	0	0	0	0	0	0	0	0
Interior Equipment	52,778	0	0	0	0	180,085	8.53	570,330	27.02	0
Exterior Equipment	0	0	0	0	0	0	0	0	0	0
Refrigeration	0	0	0	0	0	0	0	0	0	0
Non-HVAC	89,072	0	0	0	0	303,927	14.4	962,537	45.6	0
Generators	0	0	0	0	0	0	0	0	0	0
Site Generation	0	0	0	0	0	0	0	0	0	0
Grand Total	132,256	0	0	0	0	451,275	21.38	1,429,187	67.71	0

IT Equipment Energy

0

0

PUE N/A

Gross Floor Area: 21,103 ft²

Region:

Building Type: Office

CBECS Survey Year: 2012

Benchmark EUI: .0 Mbtu/ft²/yr

If the region reports as "All US" it means the data for the particular region was withheld because the Relative Standard Error was greater than 50 percent or fewer than 20 buildings were sampled.

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 1 of 4

Monthly Energy End Use

Electricity

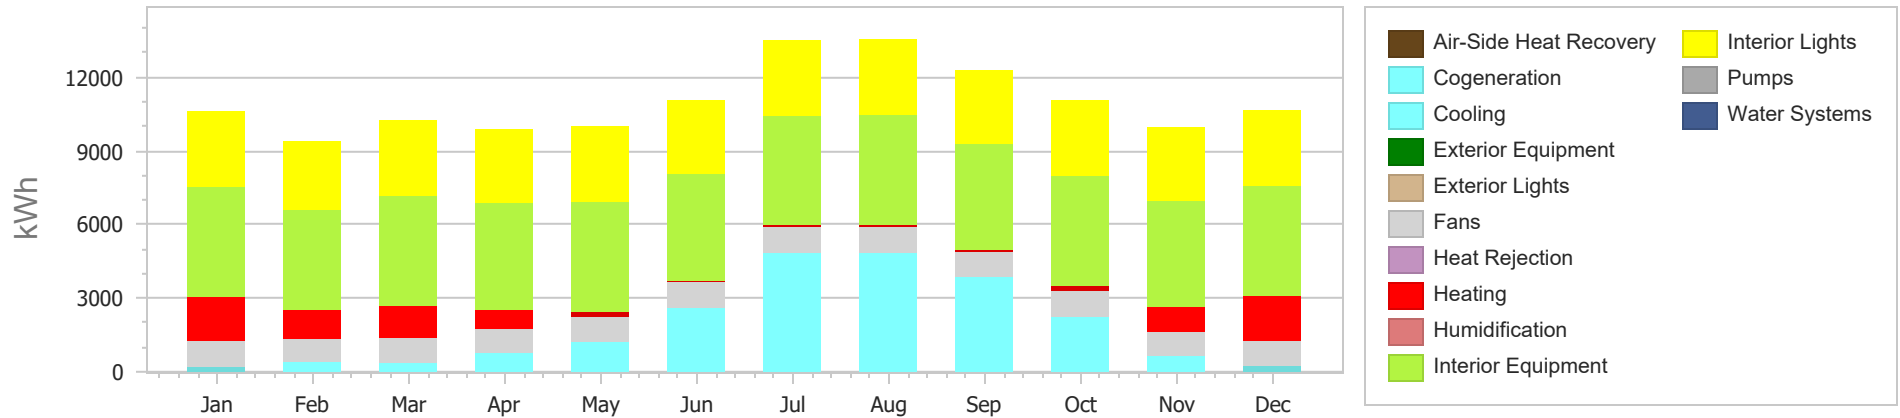


	January	February	March	April	May	June	July	August	September	October	November	December	Grand Total
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0	0	0	0
Cogeneration	0	0	0	0	0	0	0	0	0	0	0	0	0
Cooling	219	398	377	763	1,204	2,624	4,846	4,864	3,861	2,235	655	236	22,282
Exterior Equipment	0	0	0	0	0	0	0	0	0	0	0	0	0
Exterior Lights	0	0	0	0	0	0	0	0	0	0	0	0	0
Fans	1,019	926	1,021	994	1,039	1,033	1,100	1,103	1,057	1,063	992	1,019	12,365
Heat Rejection	0	0	0	0	0	0	0	0	0	0	0	0	0
Heating	1,831	1,218	1,286	784	208	64	19	13	58	223	988	1,847	8,540
Humidification	0	0	0	0	0	0	0	0	0	0	0	0	0
Interior Equipment	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
Interior Lights	3,078	2,784	3,088	2,983	3,085	2,988	3,080	3,088	2,983	3,081	2,977	3,080	36,295
Pumps	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Systems	0	0	0	0	0	0	0	0	0	0	0	0	0
Grand Total	10,626	9,374	10,262	9,858	10,022	11,053	13,522	13,559	12,293	11,086	9,946	10,659	132,260

Site Consumption Summary


Energy Consumption

HVAC Energy Usage

(MMBtu)

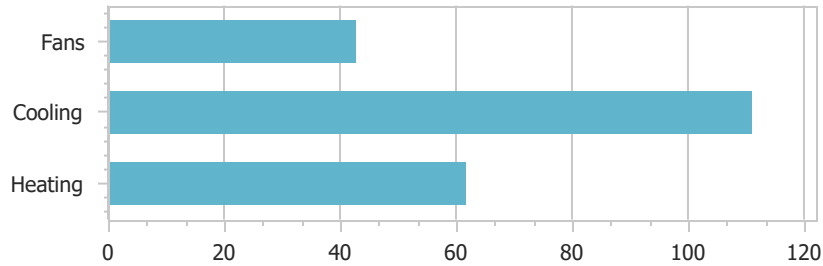

Total Site Energy Breakdown

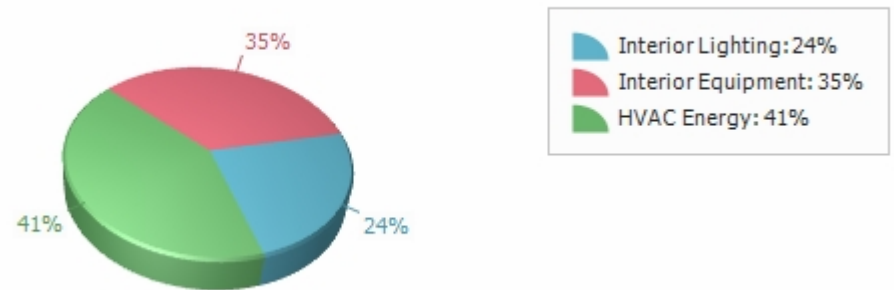

Component	Electricity (kWh)	Gas (MMBtu)	District Cooling (MMBtu)	District Heating Water (MMBtu)	Other Utilities (MMBtu)	Site Energy (Mbtu)	Site Energy Use Intensity (Mbtu/ft²)	Source Energy (Mbtu)	Source Energy Use Intensity (Mbtu/ft²)	Water (gal)
Heating	18,106	0	0	0	0	61,779	2.93	195,653	9.27	0
Cooling	32,631	0	0	0	0	111,340	5.27	352,614	16.7	0
Fans	12,514	0	0	0	0	42,699	2.02	135,228	6.41	0
Pumps	0	0	0	0	0	0	0	0	0	0
Heat Rejection	0	0	0	0	0	0	0	0	0	0
Humidification	0	0	0	0	0	0	0	0	0	0
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0
HVAC	63,250	0	0	0	0	215,818	10.22	683,496	32.38	0
Water Systems	0	0	0	0	0	0	0	0	0	0
Interior Lighting	36,567	0	0	0	0	124,771	5.91	395,149	18.72	0
Exterior Lighting	0	0	0	0	0	0	0	0	0	0
Interior Equipment	52,778	0	0	0	0	180,085	8.53	570,330	27.02	0
Exterior Equipment	0	0	0	0	0	0	0	0	0	0
Refrigeration	0	0	0	0	0	0	0	0	0	0
Non-HVAC	89,344	0	0	0	0	304,856	14.44	965,479	45.74	0
Generators	0	0	0	0	0	0	0	0	0	0
Site Generation	0	0	0	0	0	0	0	0	0	0
Grand Total	152,594	0	0	0	0	520,674	24.67	1,648,974	78.12	0

IT Equipment Energy

0

0

PUE N/A

Gross Floor Area: 21,103 ft²

Region:

Building Type: Office

CBECS Survey Year: 2012

Benchmark EUI: .0 Mbtu/ft²/yr

If the region reports as "All US" it means the data for the particular region was withheld because the Relative Standard Error was greater than 50 percent or fewer than 20 buildings were sampled.

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 3 of 4

Monthly Energy End Use


Electricity

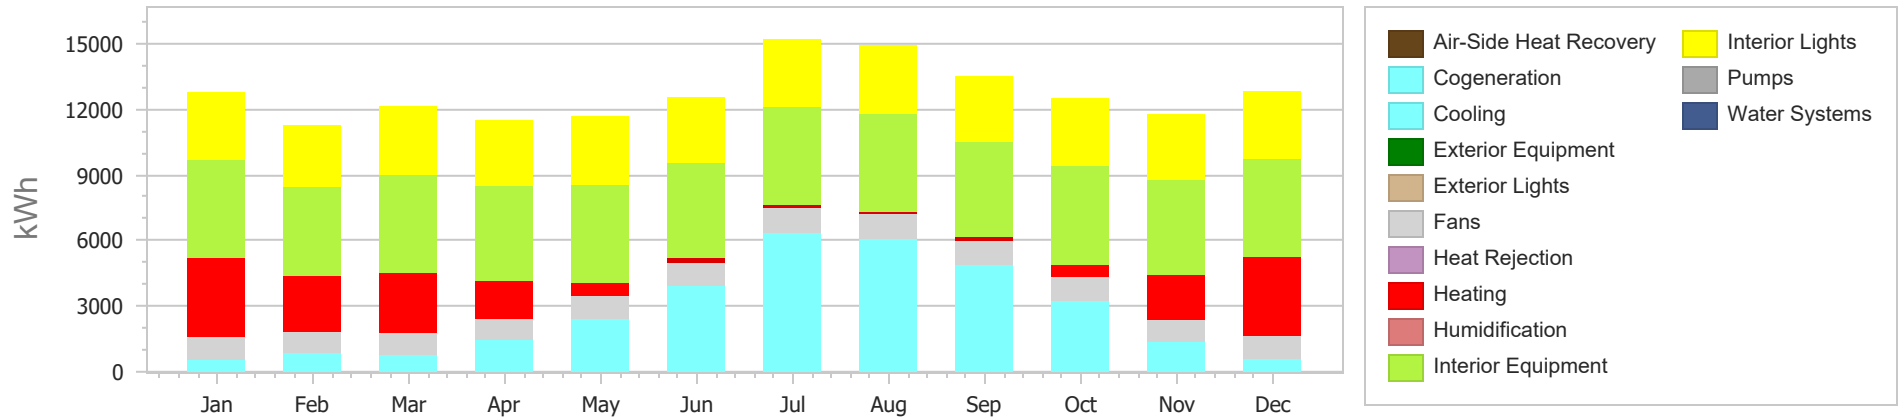

	January	February	March	April	May	June	July	August	September	October	November	December	Grand Total
Air-Side Heat Recovery	0	0	0	0	0	0	0	0	0	0	0	0	0
Cogeneration	0	0	0	0	0	0	0	0	0	0	0	0	0
Cooling	554	890	789	1,470	2,444	3,928	6,372	6,066	4,886	3,258	1,384	592	32,632
Exterior Equipment	0	0	0	0	0	0	0	0	0	0	0	0	0
Exterior Lights	0	0	0	0	0	0	0	0	0	0	0	0	0
Fans	1,029	932	1,017	976	1,017	1,027	1,146	1,156	1,100	1,083	990	1,041	12,514
Heat Rejection	0	0	0	0	0	0	0	0	0	0	0	0	0
Heating	3,640	2,574	2,711	1,709	612	262	104	78	189	570	2,061	3,597	18,107
Humidification	0	0	0	0	0	0	0	0	0	0	0	0	0
Interior Equipment	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
Interior Lights	3,100	2,805	3,112	3,006	3,108	3,011	3,103	3,112	3,006	3,104	2,999	3,103	36,568
Pumps	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Systems	0	0	0	0	0	0	0	0	0	0	0	0	0
Grand Total	12,802	11,249	12,120	11,495	11,668	12,573	15,201	14,902	13,515	12,498	11,767	12,810	152,600


Site Load Profile

Site HVAC Load Profile

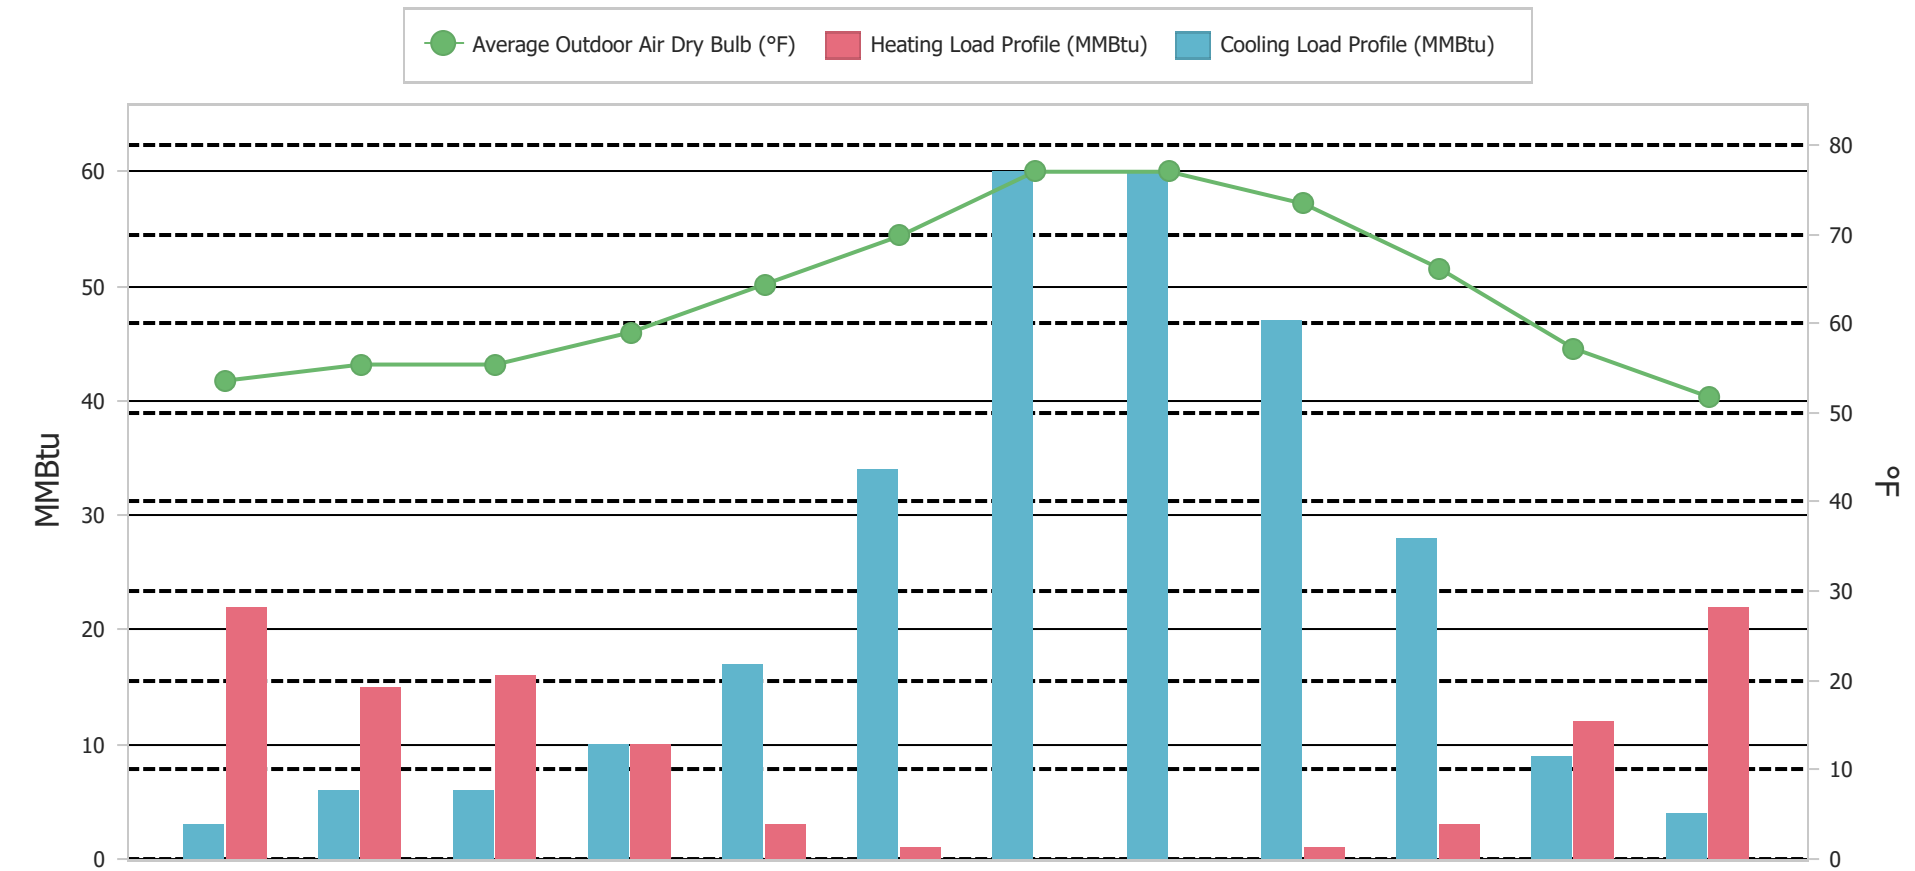

	January	February	March	April	May	June	July	August	September	October	November	December
Cooling Load (MMBtu)	3.36	5.91	5.62	10.37	16.61	33.64	60.34	59.71	47.16	28.45	9.17	3.68
Heating Load (MMBtu)	21.82	14.79	15.95	9.92	2.72	0.86	0.25	0.17	0.77	2.9	12.24	21.99
Average OADB (°F)	53.5	55.6	56.2	59.9	64.5	70.1	76.3	76.3	72.9	66.2	57.9	52.6

Site HVAC Hourly Load Distribution

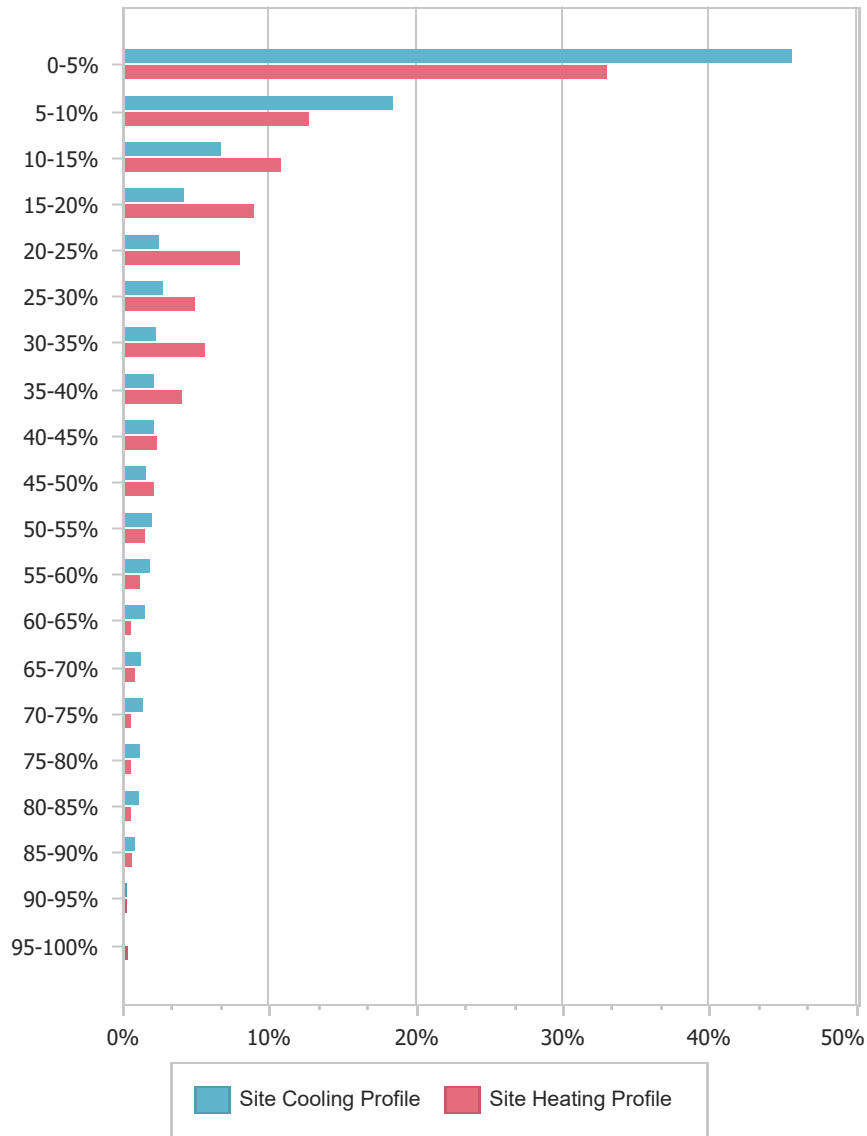


% Load	Cooling			Heating		
	Cutoff (tons)	% Hours	Hours	Cutoff (MBtuh)	% Hours	Hours
0-5	0.9	45.63%	3,712	6.2	33.02%	1,543
5-10	1.8	18.48%	1,503	12.4	12.73%	595
10-15	2.7	6.72%	547	18.6	10.79%	504
15-20	3.6	4.18%	340	24.8	8.99%	420
20-25	4.5	2.51%	204	31	8%	374
25-30	5.4	2.73%	222	37.2	4.96%	232
30-35	6.3	2.29%	186	43.4	5.63%	263
35-40	7.2	2.14%	174	49.7	4.04%	189
40-45	8.1	2.13%	173	55.9	2.38%	111
45-50	9	1.63%	133	62.1	2.16%	101
50-55	9.9	1.98%	161	68.3	1.56%	73
55-60	10.8	1.88%	153	74.5	1.22%	57
60-65	11.7	1.52%	124	80.7	0.6%	28
65-70	12.6	1.25%	102	86.9	0.88%	41
70-75	13.4	1.36%	111	93.1	0.6%	28
75-80	14.3	1.22%	99	99.3	0.56%	26
80-85	15.2	1.14%	93	105.5	0.56%	26
85-90	16.1	0.82%	67	111.7	0.66%	31
90-95	17	0.32%	26	117.9	0.32%	15
95-100	17.9	0.06%	5	124.1	0.34%	16

Cooling hours off: 625 (7%)

Heating hours off: 4,087 (47%)


Site Load Profile

Site HVAC Load Profile

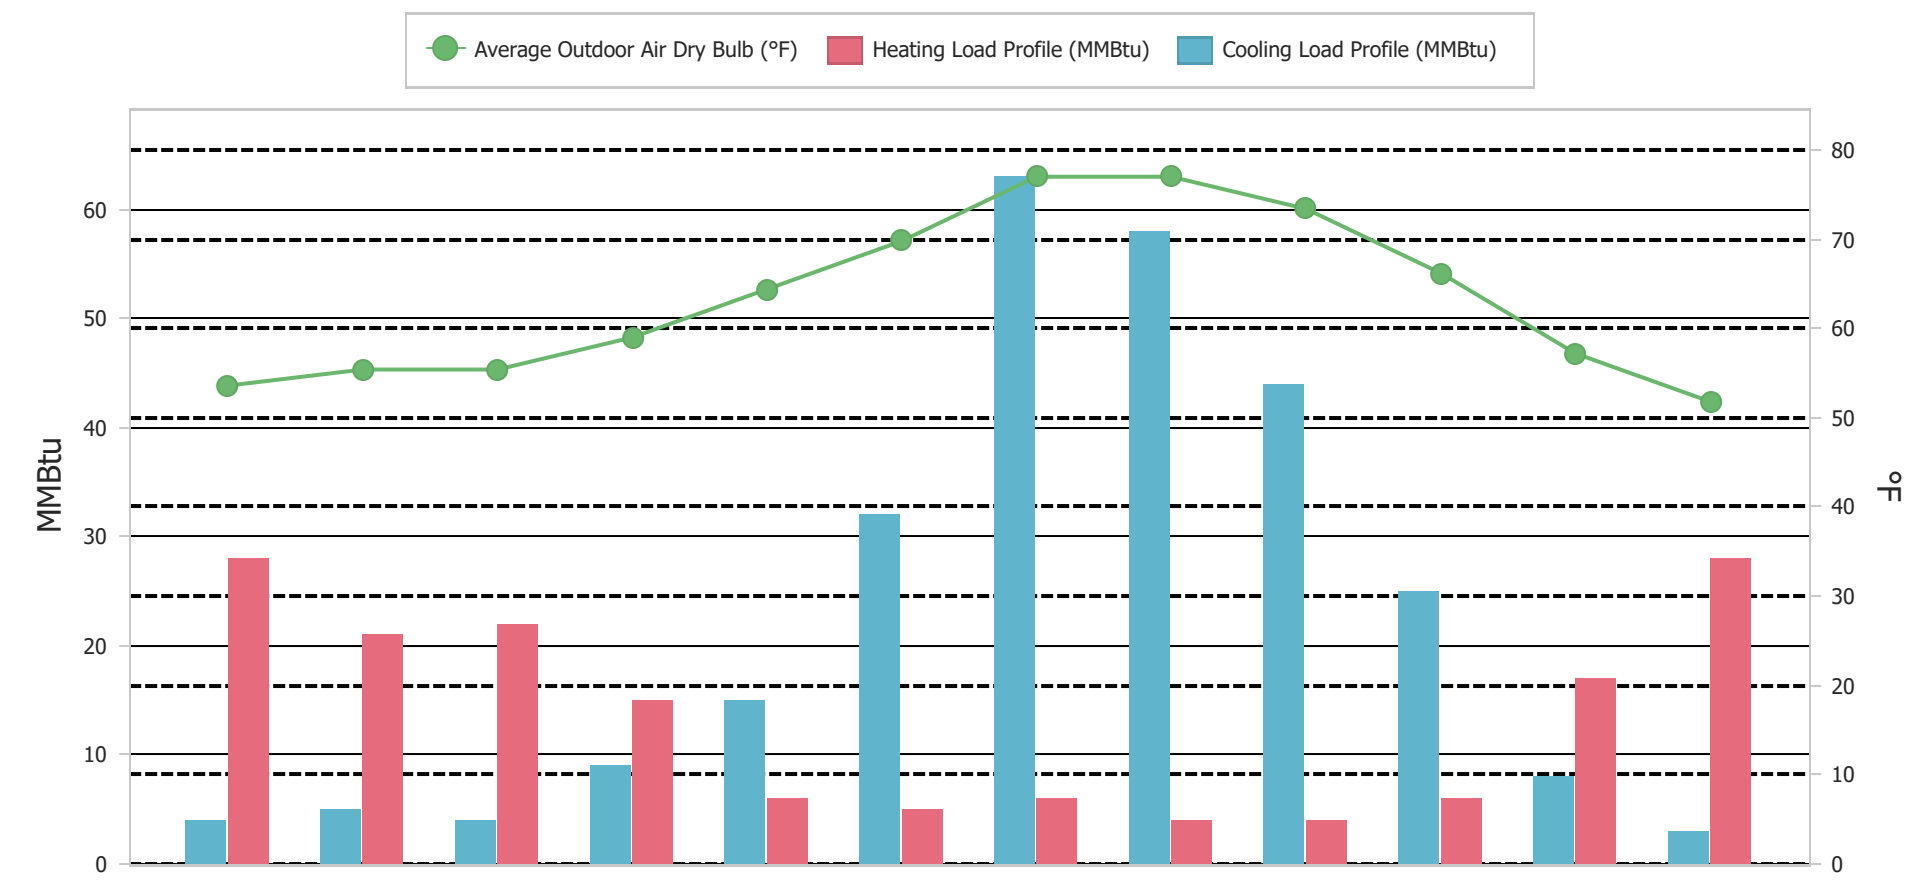

	January	February	March	April	May	June	July	August	September	October	November	December
Cooling Load (MMBtu)	3.57	4.52	4.06	8.97	14.79	32.1	62.8	58.15	44.43	25.23	8.13	2.7
Heating Load (MMBtu)	27.87	20.72	21.7	14.51	6.32	4.96	6.41	4.14	3.58	6	16.63	28.39
Average OADB (°F)	53.5	55.6	56.2	59.9	64.5	70.1	76.3	76.3	72.9	66.2	57.9	52.6

Site HVAC Hourly Load Distribution

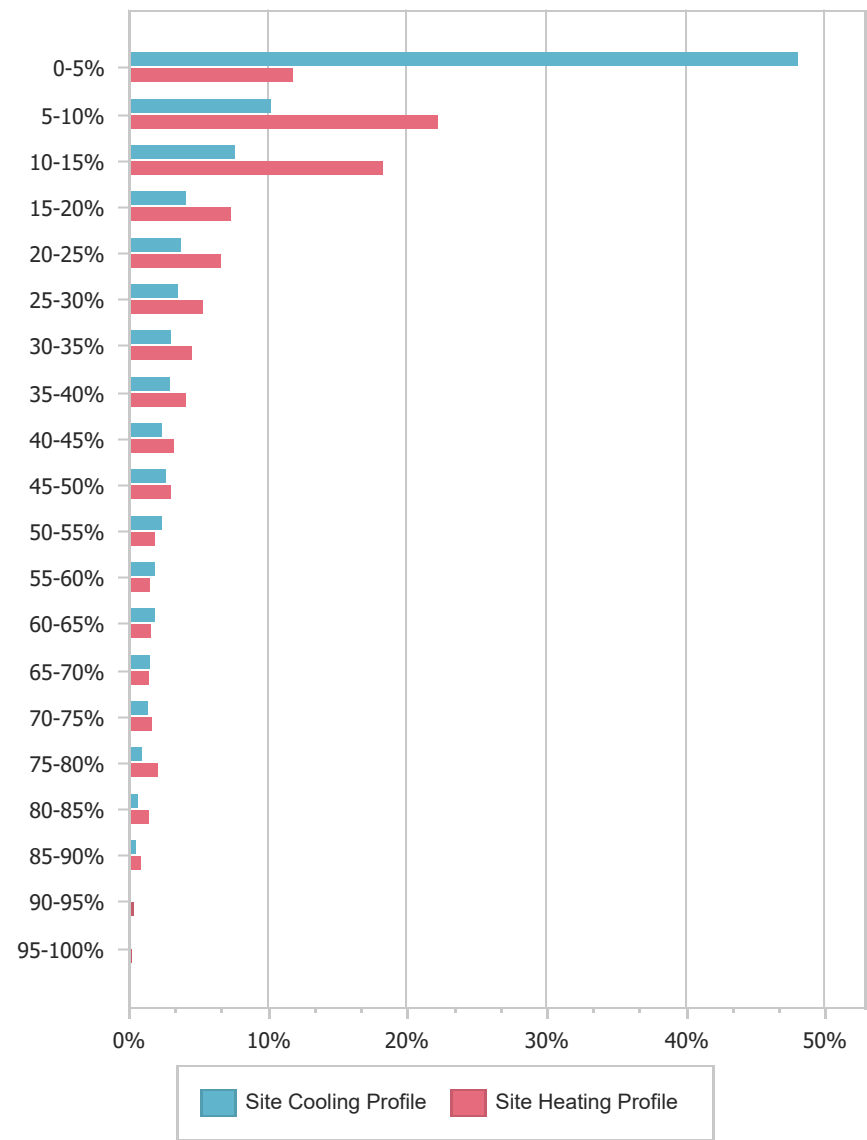


% Load	Cooling			Heating		
	Cutoff (tons)	% Hours	Hours	Cutoff (MBtuh)	% Hours	Hours
0-5	0.9	48.01%	3,709	5.5	11.83%	729
5-10	1.7	10.21%	789	11.1	22.2%	1,368
10-15	2.6	7.68%	593	16.6	18.29%	1,127
15-20	3.4	4.09%	316	22.1	7.35%	453
20-25	4.3	3.79%	293	27.6	6.62%	408
25-30	5.2	3.56%	275	33.2	5.34%	329
30-35	6	3.02%	233	38.7	4.56%	281
35-40	6.9	2.95%	228	44.2	4.14%	255
40-45	7.7	2.42%	187	49.8	3.23%	199
45-50	8.6	2.68%	207	55.3	3.05%	188
50-55	9.5	2.42%	187	60.8	1.9%	117
55-60	10.3	1.9%	147	66.3	1.53%	94
60-65	11.2	1.9%	147	71.9	1.64%	101
65-70	12	1.53%	118	77.4	1.48%	91
70-75	12.9	1.4%	108	82.9	1.7%	105
75-80	13.8	0.97%	75	88.4	2.14%	132
80-85	14.6	0.7%	54	94	1.48%	91
85-90	15.5	0.52%	40	99.5	0.93%	57
90-95	16.3	0.16%	12	105	0.37%	23
95-100	17.2	0.09%	7	110.6	0.23%	14

Cooling hours off: 1,035 (12%) Heating hours off: 2,598 (30%)

Setpoint Not Met Summary

Total Setpoint Not Met Summary

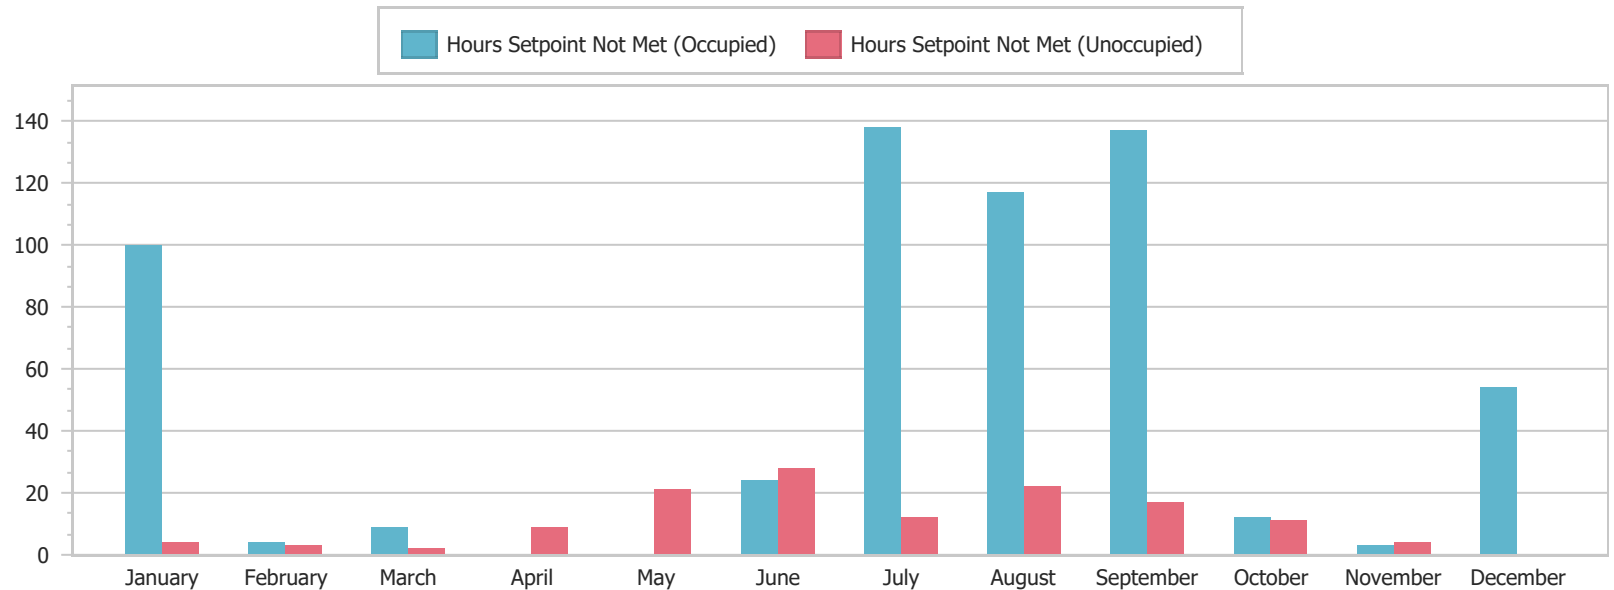


Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp · (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp · (°F)
PSZ-HP-Activity																										
Zone Group 00																										
ACT-Noisy-1	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	79.5
ACT-Noisy-2	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0
ACT-Noisy-3	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.1
ACT-Quiet-1	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	2	0	0	78.4
ACT-Quiet-2	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	78.7
ACT-Quiet-3	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	3	0	0	
PSZ-HP-Admin																										
Zone Group 00																										
Admin	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Chart/Hotel	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Atrium																										
Zone Group 00																										
Attrium	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Clinical																										
Zone Group 00																										
Comfort/Consult	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	67.4	2	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
Intake-HR-A	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.5
Intake-HR-B	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
RB-S-Corner-N	70.3	0	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	79.7
Total (Non-coincident)		2	1	0	1	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Common																										
Zone Group 00																										
Hospitality	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9
Lounge	66.2	6	0	0	0	0	0	0	0	0	0	0	1	0	1	0	4	0	0	0	0	0	3	0	0	76.8
Multipurpose/Dining	67.0	2	0	0	1	0	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
Servery	68.0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4
Total (Non-coincident)		9	0	0	1	0	1	0	1	0	0	0	0	1	0	1	0	4	0	0	0	0	0	3	0	
PSZ-HP-Kitchen																										
Zone Group 00																										
Kitchen	58.8	2	0	0	0	0	0	0	0	0	0	6	0	30	0	30	0	33	0	10	0	0	0	0	0	83.7
Total (Non-coincident)		2	0	0	0	0	0	0	0	0	0	6	0	30	0	30	0	33	0	10	0	0	0	0	0	
PSZ-HP-ResBed-N																										
Zone Group 00																										
Corridor-N	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.8
RB-N-Corner	68.9	0	0	0	0	0	0	0	0	0	2	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-N-East	69.1	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-N-West	70.0	0	0	0	0	0	0	0	1	0	4	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	0	0	0	0	0	0	1	0	6	0	5	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-ResBed-S																										
Zone Group 00																										
Corridor-S	71.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
RB-S-Corner-S	70.4	0	1	0	0	0	0	0	1	0	3	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-S-East	71.0	0	1	0	1	0	0	0	1	0	1	0	2	0	0	0	0	0	0	0	3	0	1	0	0	79.5
RB-S-West	70.6	0	0	0	0	0	0	0	1	0	2	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	2	0	1	0	0	0	3	0	6	0	6	0	0	0	0	0	0	0	3	0	1	0	0	
PSZ-HP-ResBed-W																										
Zone Group 00																										
Corridor-W	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
RB-W-North	68.7	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-W-South	70.8	0	1	0	0	0	1	0	1	0	3	0	2	0	0	0	0	0	0	0	1	0	0	0	0	79.8

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
Total (Non-coincident)		0	1	0	0	0	1	0	1	0	3	0	4	0	0	0	0	0	0	1	0	0	0	0	0	
PSZ-HP-ResShwr																										
Zone Group 00																										
SHWR-N	64.9	40	0	4	0	6	0	0	0	0	0	6	0	38	0	33	0	35	0	0	0	0	0	30	0	79.5
SHWR-S	65.8	16	0	0	0	0	0	0	0	0	0	6	0	35	0	27	0	37	0	2	0	0	0	5	0	79.4
SHWR-W	65.4	31	0	0	0	3	0	0	0	0	0	6	0	34	0	26	0	27	0	0	0	0	0	16	0	79.1
Total (Non-coincident)		87	0	4	0	9	0	0	0	0	0	18	0	107	0	86	0	99	0	2	0	0	0	51	0	
PSZ-HP-Utility																										
Zone Group 00																										
Support	69.1	0	0	0	0	0	0	0	2	0	6	0	12	0	12	0	22	0	17	0	7	0	0	0	0	82.9
Utility	69.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	76.0
Total (Non-coincident)		0	0	0	0	0	0	0	2	0	6	0	12	0	12	0	22	1	17	0	7	0	0	0	0	
Unconditioned spaces																										
Room 00-80	49.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.7
Room 00-81	48.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.5
Room 01-00	65.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-01	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-03	66.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-04	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-06	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.7
Room 01-08	58.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.5
Room 01-10	64.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-12	60.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Trash	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	94.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Cooling Setpoint Not Met Summary

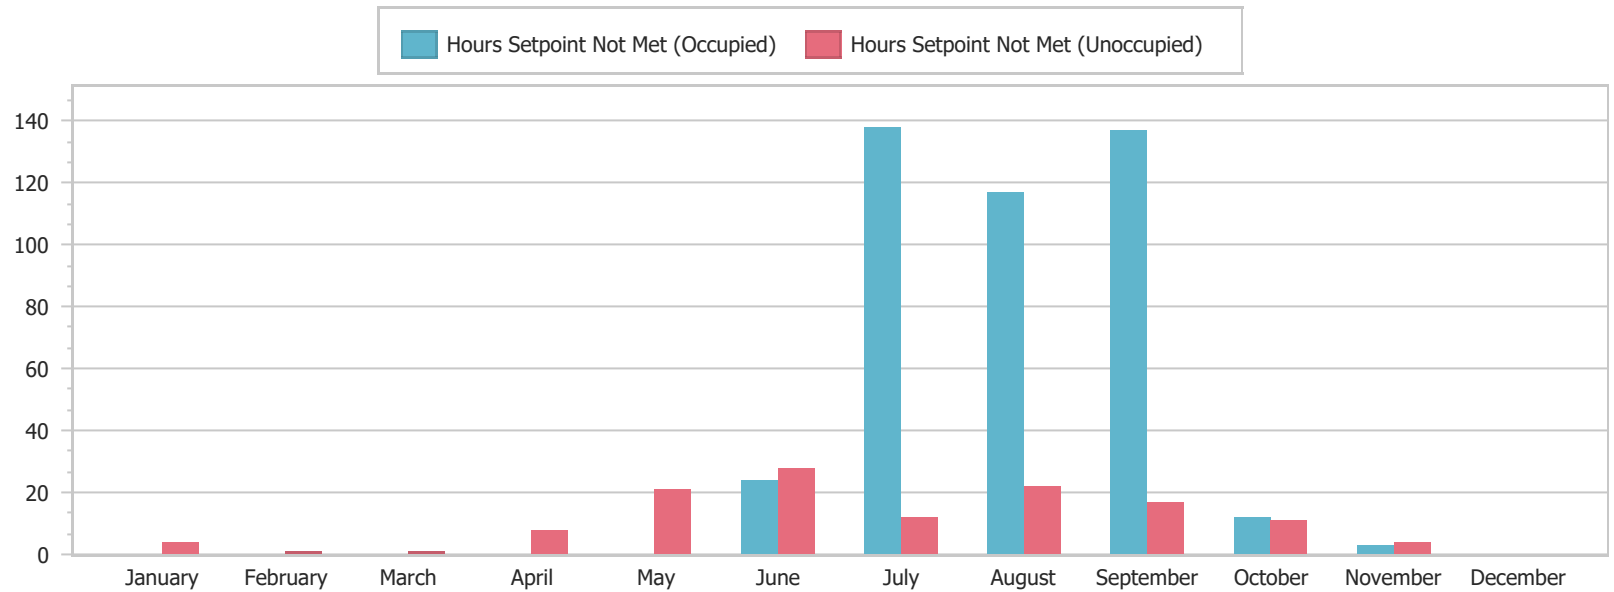


Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-Activity																										
Zone Group 00																										
ACT-Noisy-1	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	79.5
ACT-Noisy-2	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0
ACT-Noisy-3	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.1
ACT-Quiet-1	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	2	0	0	78.4
ACT-Quiet-2	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	78.7
ACT-Quiet-3	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	3	0	0	

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-Admin																										
Zone Group 00																										
Admin	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Chart/Hotel	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Atrium																										
Zone Group 00																										
Attrium	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Clinical																										
Zone Group 00																										
Comfort/Consult	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
Intake-HR-A	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.5
Intake-HR-B	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
RB-S-Corner-N	70.3	0	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	79.7
Total (Non-coincident)		0	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Common																										
Zone Group 00																										
Hospitality	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9
Lounge	66.2	0	0	0	0	0	0	0	0	0	0	0	0	1	0	1	0	4	0	0	0	0	0	0	0	76.8
Multipurpose/Dining	67.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Servery	68.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	1	0	1	0	4	0	0	0	0	0	0	0	
PSZ-HP-Kitchen																										
Zone Group 00																										
Kitchen	58.8	0	0	0	0	0	0	0	0	0	0	6	0	30	0	30	0	33	0	10	0	0	0	0	0	83.7
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	6	0	30	0	30	0	33	0	10	0	0	0	0	0	
PSZ-HP-ResBed-N																										
Zone Group 00																										
Corridor-N	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.8
RB-N-Corner	68.9	0	0	0	0	0	0	0	0	0	2	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-N-East	69.1	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-N-West	70.0	0	0	0	0	0	0	0	1	0	4	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	0	0	0	0	0	0	1	0	6	0	5	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-ResBed-S																										
Zone Group 00																										
Corridor-S	71.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
RB-S-Corner-S	70.4	0	1	0	0	0	0	0	1	0	3	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-S-East	71.0	0	1	0	1	0	0	0	1	0	1	0	2	0	0	0	0	0	0	0	3	0	1	0	0	79.5
RB-S-West	70.6	0	0	0	0	0	0	0	1	0	2	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	2	0	1	0	0	0	3	0	6	0	6	0	0	0	0	0	0	0	3	0	1	0	0	
PSZ-HP-ResBed-W																										
Zone Group 00																										
Corridor-W	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
RB-W-North	68.7	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-W-South	70.8	0	1	0	0	0	1	0	1	0	3	0	2	0	0	0	0	0	0	0	1	0	0	0	0	79.8
Total (Non-coincident)		0	1	0	0	0	1	0	1	0	3	0	4	0	0	0	0	0	0	0	1	0	0	0	0	

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-ResShwr																										
Zone Group 00																										
SHWR-N	64.9	0	0	0	0	0	0	0	0	0	0	6	0	38	0	33	0	35	0	0	0	0	0	0	0	79.5
SHWR-S	65.8	0	0	0	0	0	0	0	0	0	0	6	0	35	0	27	0	37	0	2	0	0	0	0	0	79.4
SHWR-W	65.4	0	0	0	0	0	0	0	0	0	0	6	0	34	0	26	0	27	0	0	0	0	0	0	0	79.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	18	0	107	0	86	0	99	0	2	0	0	0	0	0	
PSZ-HP-Utility																										
Zone Group 00																										
Support	69.1	0	0	0	0	0	0	0	2	0	6	0	12	0	12	0	22	0	17	0	7	0	0	0	0	82.9
Utility	69.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	76.0
Total (Non-coincident)		0	0	0	0	0	0	0	2	0	6	0	12	0	12	0	22	1	17	0	7	0	0	0	0	
Unconditioned spaces																										
Room 00-80	49.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.7
Room 00-81	48.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.5
Room 01-00	65.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-01	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-03	66.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-04	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-06	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.7
Room 01-08	58.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.5
Room 01-10	64.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-12	60.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Trash	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	94.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Heating Setpoint Not Met Summary

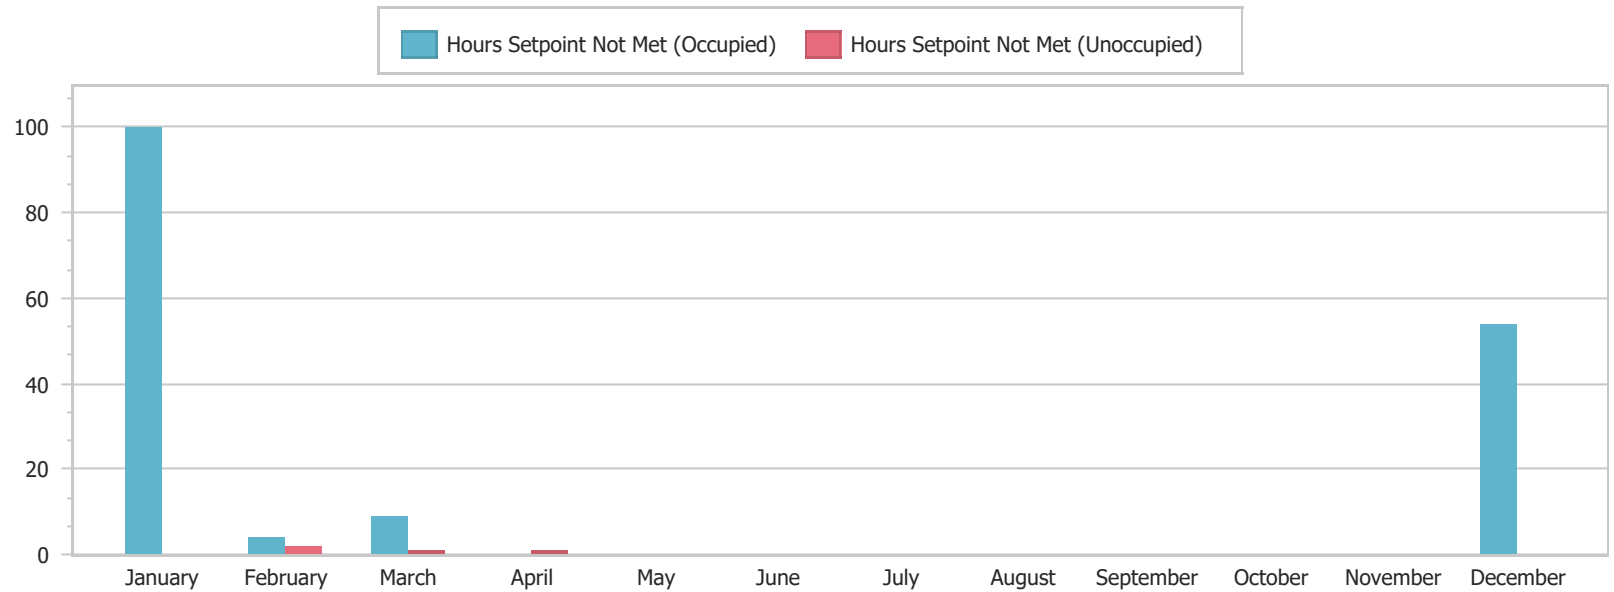

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-Activity																										
Zone Group 00																										
ACT-Noisy-1	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
ACT-Noisy-2	68.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.0
ACT-Noisy-3	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.1
ACT-Quiet-1	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.4
ACT-Quiet-2	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
ACT-Quiet-3	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	


Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-Admin																										
Zone Group 00																										
Admin	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Chart/Hotel	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Entry/Waiting	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.1
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Atrium																										
Zone Group 00																										
Attrium	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Clinical																										
Zone Group 00																										
Comfort/Consult	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	67.4	2	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
Intake-HR-A	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.5
Intake-HR-B	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
RB-S-Corner-N	70.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
Total (Non-coincident)		2	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-Common																										
Zone Group 00																										
Hospitality	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.9
Lounge	66.2	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	0	76.8
Multipurpose/Dining	67.0	2	0	0	1	0	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.0
Servery	68.0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.4

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Total (Non-coincident)		9	0	0	1	0	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	0	
PSZ-HP-Kitchen																										
Zone Group 00																										
Kitchen	58.8	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	83.7
Total (Non-coincident)		2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-ResBed-N																										
Zone Group 00																										
Corridor-N	68.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.8
RB-N-Corner	68.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.7
RB-N-East	69.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-N-West	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-ResBed-S																										
Zone Group 00																										
Corridor-S	71.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
RB-S-Corner-S	70.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-S-East	71.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.5
RB-S-West	70.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.6
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
PSZ-HP-ResBed-W																										
Zone Group 00																										
Corridor-W	70.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.8
RB-W-North	68.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
RB-W-South	70.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	79.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
PSZ-HP-ResShwr																										
Zone Group 00																										
SHWR-N	64.9	40	0	4	0	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	30	0	79.5
SHWR-S	65.8	16	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	5	0	79.4
SHWR-W	65.4	31	0	0	0	3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	16	0	79.1
Total (Non-coincident)		87	0	4	0	9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	51	0	
PSZ-HP-Utility																										
Zone Group 00																										
Support	69.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	82.9
Utility	69.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.0
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Unconditioned spaces																										
Room 00-80	49.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.7
Room 00-81	48.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.5
Room 01-00	65.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-01	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-03	66.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.8
Room 01-04	67.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-06	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.7
Room 01-08	58.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	87.5
Room 01-10	64.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.6
Room 01-12	60.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	89.0
Trash	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	94.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Setpoint Not Met Summary

Total Setpoint Not Met Summary

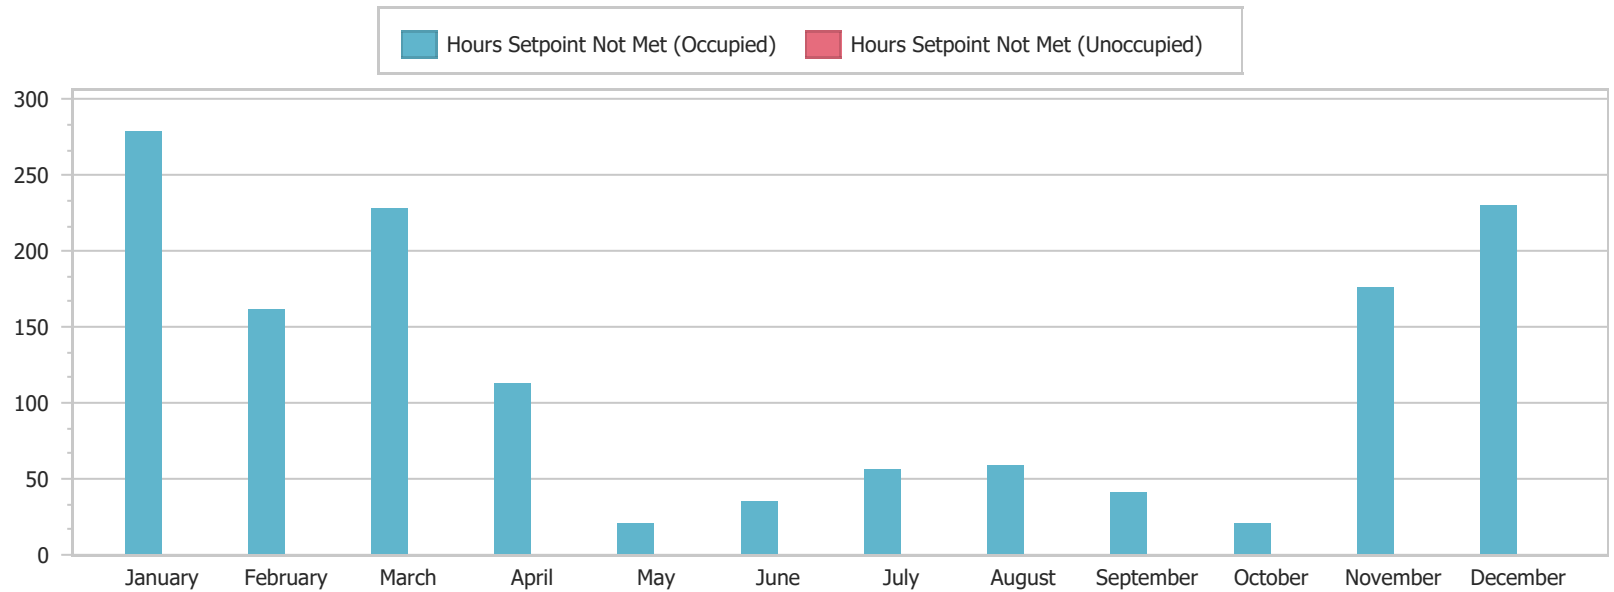

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp · (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp · (°F)
Single Zone CV																										
Zone Group 00																										
Kitchen	56.9	30	0	12	0	13	0	7	0	14	0	35	0	56	0	59	0	41	0	21	0	9	0	15	0	83.8
Total (Non-coincident)		30	0	12	0	13	0	7	0	14	0	35	0	56	0	59	0	41	0	21	0	9	0	15	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-2	64.1	3	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
ACT-Noisy-3	64.1	8	0	3	0	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	76.6

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
ACT-Quiet-1	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.4
ACT-Quiet-2	64.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.8
ACT-Quiet-3	64.1	6	0	1	0	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
Admin	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Attrium	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.7
Chart/Hotel	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Comfort/Consult	69.0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.4
Corridor-N	64.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
Corridor-S	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Corridor-W	66.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	64.0	58	0	34	0	52	0	32	0	2	0	0	0	0	0	0	0	0	0	0	0	42	0	49	0	75.5
Hospitality	64.0	49	0	30	0	31	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	37	0	54	0	75.8
Intake-HR-A	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Lounge	69.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Multipurpose/Dining	64.0	61	0	41	0	54	0	33	0	2	0	0	0	0	0	0	0	0	0	0	0	43	0	54	0	75.4
RB-N-Corner	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-N-East	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-N-West	65.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-Corner-N	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-S-Corner-S	66.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
RB-S-East	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-West	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.4

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 14 of 21

Zone Name	Min.	January		February		March		April		May		June		July		August		September		October		November		December		Max
	Temp (°F)	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Temp (°F)
RB-W-North	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-W-South	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
Servery	64.0	61	0	41	0	65	0	39	0	3	0	0	0	0	0	0	0	0	0	0	0	45	0	54	0	75.4
SHWR-N	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	71.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Zone Group 01																										
ACT-Noisy-1	64.0	2	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	77.2
Total (Non-coincident)		249	0	150	0	215	0	106	0	7	0	0	0	0	0	0	0	0	0	0	0	167	0	215	0	
Unconditioned spaces																										
Room 00-80	49.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	48.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.4
Room 01-01	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7
Room 01-03	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.1
Room 01-04	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-06	65.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-08	60.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.4
Room 01-10	65.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
Room 01-12	62.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Trash	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Cooling Setpoint Not Met Summary

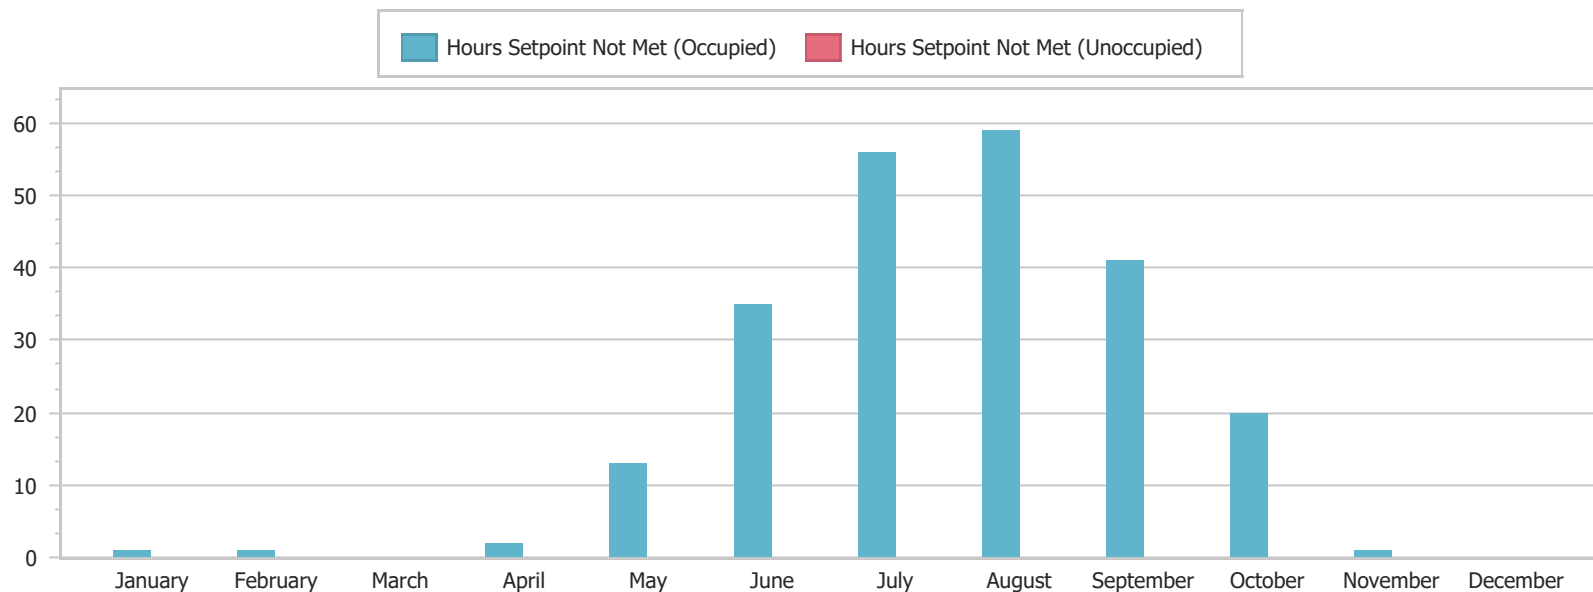

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Single Zone CV																										
Zone Group 00																										
Kitchen	56.9	1	0	1	0	0	0	2	0	13	0	35	0	56	0	59	0	41	0	20	0	1	0	0	0	83.8
Total (Non-coincident)		1	0	1	0	0	0	2	0	13	0	35	0	56	0	59	0	41	0	20	0	1	0	0	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-2	64.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
ACT-Noisy-3	64.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
ACT-Quiet-1	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.4

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 16 of 21

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Quiet-2	64.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.8
ACT-Quiet-3	64.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
Admin	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Attrium	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.7
Chart/Hotel	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Comfort/Consult	69.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.4
Corridor-N	64.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
Corridor-S	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Corridor-W	66.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	64.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.5
Hospitality	64.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.8
Intake-HR-A	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Lounge	69.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Multipurpose/Dining	64.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.4
RB-N-Corner	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-N-East	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-N-West	65.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-Corner-N	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-S-Corner-S	66.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
RB-S-East	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-West	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.4
RB-W-North	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00


Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 17 of 21

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
RB-W-South	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
Servery	64.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.4
SHWR-N	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	71.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Zone Group 01																										
ACT-Noisy-1	64.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	77.2
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Unconditioned spaces																										
Room 00-80	49.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	48.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.4
Room 01-01	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7
Room 01-03	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.1
Room 01-04	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-06	65.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-08	60.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.4
Room 01-10	65.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
Room 01-12	62.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Trash	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Heating Setpoint Not Met Summary

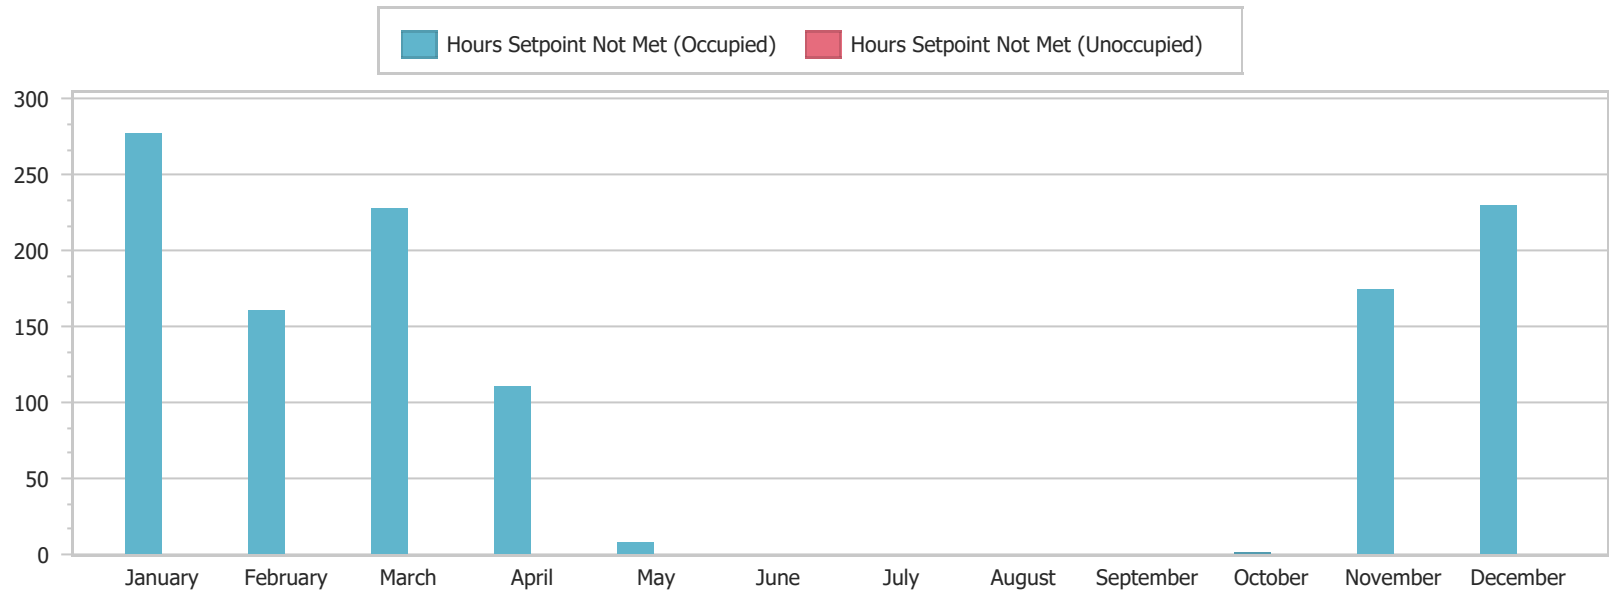

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
Single Zone CV																										
Zone Group 00																										
Kitchen	56.9	29	0	11	0	13	0	5	0	1	0	0	0	0	0	0	0	0	0	1	0	8	0	15	0	83.8
Total (Non-coincident)		29	0	11	0	13	0	5	0	1	0	0	0	0	0	0	0	0	0	1	0	8	0	15	0	
Variable Refrigerant Flow																										
Zone Group 00																										
ACT-Noisy-2	64.1	3	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
ACT-Noisy-3	64.1	8	0	3	0	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	76.6
ACT-Quiet-1	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.4

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 19 of 21

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
ACT-Quiet-2	64.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.8
ACT-Quiet-3	64.1	6	0	1	0	4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	76.6
Admin	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Attrium	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.7
Chart/Hotel	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Comfort/Consult	69.0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.4
Corridor-N	64.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
Corridor-S	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	80.4
Corridor-W	66.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Entry/Waiting	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Exam/Storage	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Group	64.0	58	0	34	0	52	0	32	0	2	0	0	0	0	0	0	0	0	0	0	0	42	0	49	0	75.5
Hospitality	64.0	49	0	30	0	31	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	37	0	54	0	75.8
Intake-HR-A	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Intake-HR-B	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.2
Lounge	69.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Multipurpose/Dining	64.0	61	0	41	0	54	0	33	0	2	0	0	0	0	0	0	0	0	0	0	0	43	0	54	0	75.4
RB-N-Corner	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-N-East	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-N-West	65.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-Corner-N	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6
RB-S-Corner-S	66.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
RB-S-East	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.3
RB-S-West	67.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.4
RB-W-North	65.2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.6

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 20 of 21

Zone Name	Min. Temp (°F)	January		February		March		April		May		June		July		August		September		October		November		December		Max Temp (°F)
		Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	Occ	Un	
RB-W-South	67.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	78.7
Servery	64.0	61	0	41	0	65	0	39	0	3	0	0	0	0	0	0	0	0	0	0	0	45	0	54	0	75.4
SHWR-N	69.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-S	71.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
SHWR-W	70.0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Support	64.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.0
Utility	69.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	75.0
Zone Group 01																										
ACT-Noisy-1	64.0	2	0	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	77.2
Total (Non-coincident)		249	0	150	0	215	0	106	0	7	0	0	0	0	0	0	0	0	0	0	0	167	0	215	0	
Unconditioned spaces																										
Room 00-80	49.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	92.4
Room 00-81	48.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	93.0
Room 01-00	66.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.4
Room 01-01	67.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.7
Room 01-03	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.1
Room 01-04	67.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-06	65.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.2
Room 01-08	60.1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	84.4
Room 01-10	65.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	81.3
Room 01-12	62.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Trash	66.7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	86.8
Total (Non-coincident)		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Site Temperature Profile

Zone Name		Time spent in each temperature range (°F)												Unmet Heating Hours			Maximum Temperature (°F)			Mean Temperature (°F)					
		Unmet Heating Hours	Minimum Temperature (°F)	< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F										> 95°F		
					≤	≤	≤	≤	≤	≤	≤	≤	≤											≤	
					55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F												
PSZ-HP-Activity																									
Zone Group 00																									
ACT-Noisy-1		0	69	0	0	0	0	100	3,519	5,141	0	0	0	0	1	79.5	74.5								
ACT-Noisy-2		0	68.4	0	0	0	0	204	4,114	4,442	0	0	0	0	0	79	74.0								
ACT-Noisy-3		0	67.2	0	0	0	0	529	4,385	3,846	0	0	0	0	0	79.1	73.5								
ACT-Quiet-1		0	70.1	0	0	0	0	0	3,308	5,452	0	0	0	0	3	78.4	74.8								
ACT-Quiet-2		0	70.1	0	0	0	0	0	3,304	5,456	0	0	0	0	2	78.7	74.8								
ACT-Quiet-3		0	69	0	0	0	0	70	4,025	4,665	0	0	0	0	0	78.7	74.2								
PSZ-HP-Admin																									
Zone Group 00																									
Admin		0	70.1	0	0	0	0	0	4,249	4,511	0	0	0	0	0	75	73.9								
Chart/Hotel		0	70.1	0	0	0	0	0	4,075	4,685	0	0	0	0	0	75	74.0								
Entry/Waiting		0	70.3	0	0	0	0	0	3,720	5,040	0	0	0	0	0	75.1	74.0								
PSZ-HP-Atrium																									
Zone Group 00																									
Atrium		0	70.1	0	0	0	0	0	4,013	4,747	0	0	0	0	0	75	73.9								
PSZ-HP-Clinical																									
Zone Group 00																									
Comfort/Consult		0	70.1	0	0	0	0	0	5,991	2,769	0	0	0	0	0	75	72.8								
Exam/Storage		0	70.1	0	0	0	0	0	5,838	2,922	0	0	0	0	0	75	73.0								
Group		3	67.4	0	0	0	0	436	5,110	3,214	0	0	0	0	0	79.5	73.1								
Intake-HR-A		0	69	0	0	0	0	5	6,360	2,395	0	0	0	0	0	75.5	72.5								
Intake-HR-B		0	70.1	0	0	0	0	0	5,491	3,269	0	0	0	0	0	75	73.2								
RB-S-Corner-N		0	70.3	0	0	0	0	0	1,599	7,161	0	0	0	0	3	79.7	75.3								
PSZ-HP-Common																									
Zone Group 00																									

Time spent in each temperature range (°F)																
Zone Name	Unmet	Minimum												Unmet	Maximum	Mean
	Heating	Temperature	< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F		Cooling	Temperature	Temperature
	Hours	(°F)		≤	≤	≤	≤	≤	≤	≤	≤	≤	>	Hours	(°F)	(°F)
			55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F	95°F				
Hospitality	0	67.9	0	0	0	0	292	4,940	3,528	0	0	0	0	0	79.9	73.5
Lounge	9	66.2	0	0	0	0	24	6,765	1,971	0	0	0	0	6	76.8	72.1
Multipurpose/Dining	5	67	0	0	0	0	498	5,007	3,254	1	0	0	0	0	80	73.1
Servery	1	68	0	0	0	0	281	5,140	3,339	0	0	0	0	0	79.4	73.3
PSZ-HP-Kitchen																
Zone Group 00																
Kitchen	2	58.8	0	0	2	6	56	6,071	2,600	25	0	0	0	109	83.7	73.8
PSZ-HP-ResBed-N																
Zone Group 00																
Corridor-N	0	68.2	0	0	0	0	202	3,566	4,846	146	0	0	0	0	80.8	75.5
RB-N-Corner	0	68.9	0	0	0	0	45	2,707	6,008	0	0	0	0	4	79.7	74.8
RB-N-East	0	69.1	0	0	0	0	38	2,978	5,744	0	0	0	0	1	79.5	74.7
RB-N-West	0	70	0	0	0	0	0	2,346	6,414	0	0	0	0	7	79.6	75.0
PSZ-HP-ResBed-S																
Zone Group 00																
Corridor-S	0	71.2	0	0	0	0	0	1,370	6,544	846	0	0	0	0	81.3	77.2
RB-S-Corner-S	0	70.4	0	0	0	0	0	1,788	6,972	0	0	0	0	7	79.8	75.2
RB-S-East	0	71	0	0	0	0	0	1,410	7,350	0	0	0	0	10	79.5	75.3
RB-S-West	0	70.6	0	0	0	0	0	1,979	6,781	0	0	0	0	5	79.6	75.2
PSZ-HP-ResBed-W																
Zone Group 00																
Corridor-W	0	70.1	0	0	0	0	0	2,563	4,807	1,390	0	0	0	0	81.8	76.9
RB-W-North	0	68.7	0	0	0	0	76	3,253	5,431	0	0	0	0	2	79.8	74.5
RB-W-South	0	70.8	0	0	0	0	0	1,332	7,428	0	0	0	0	9	79.8	75.3
PSZ-HP-ResShwr																
Zone Group 00																

Time spent in each temperature range (°F)																
Zone Name	Unmet	Minimum												Unmet	Maximum	Mean
	Heating	Temperature	< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	>	Cooling	Temperature	Temperature
	Hours	(°F)		≤ 55°F	≤ 60°F	≤ 65°F	≤ 70°F	≤ 75°F	≤ 80°F	≤ 85°F	≤ 90°F	≤ 95°F	95°F	Hours	(°F)	(°F)
SHWR-N	80	64.9	0	0	0	2	248	6,127	2,383	0	0	0	0	112	79.5	72.4
SHWR-S	21	65.8	0	0	0	0	165	6,142	2,453	0	0	0	0	107	79.4	72.5
SHWR-W	50	65.4	0	0	0	0	203	6,090	2,467	0	0	0	0	93	79.1	72.5
PSZ-HP-Utility																
Zone Group 00																
Support	0	69.1	0	0	0	0	6	987	3,865	3,902	0	0	0	78	82.9	78.8
Utility	0	69.1	0	0	0	0	7	6,243	2,510	0	0	0	0	1	76	72.8
Unconditioned spaces																
Room 00-80	0	49.6	3	156	690	1,459	1,920	1,671	1,281	1,037	480	63	0	0	92.7	71.1
Room 00-81	0	48.5	15	346	1,050	1,601	1,677	1,332	1,061	1,048	554	76	0	0	93.5	70.0
Room 01-00	0	65	0	0	0	0	1,291	3,312	3,213	944	0	0	0	0	84.6	74.6
Room 01-01	0	66.7	0	0	0	0	550	3,075	3,831	1,304	0	0	0	0	84.8	75.8
Room 01-03	0	66.6	0	0	0	0	653	3,395	3,581	1,131	0	0	0	0	84.8	75.4
Room 01-04	0	67.2	0	0	0	0	440	3,337	3,824	1,159	0	0	0	0	84.6	75.7
Room 01-06	0	64.6	0	0	0	14	1,160	3,340	3,232	1,014	0	0	0	0	84.7	74.8
Room 01-08	0	58.7	0	0	49	1,155	2,184	2,093	1,836	1,341	102	0	0	0	87.5	72.6
Room 01-10	0	64.4	0	0	0	21	1,417	3,331	3,037	954	0	0	0	0	84.6	74.4
Room 01-12	0	60.6	0	0	0	487	1,911	2,386	2,142	1,519	315	0	0	0	89	74.4
Trash	0	69.7	0	0	0	0	11	1,082	3,397	2,726	1,268	276	0	0	94.8	80.3

0 Hours

1 - 100 Hours

100 - 4000 Hour

4000+ Hours

Site Temperature Profile

Zone Name	Unmet Heating Hours	Minimum Temperature (°F)	Time spent in each temperature range (°F)												Unmet Cooling Hours	Maximum Temperature (°F)	Mean Temperature (°F)
			< 50°F	50°F	55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	> 95°F				
				≤	≤	≤	≤	≤	≤	≤	≤	≤					
				55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F					
Single Zone CV																	
Zone Group 00																	
Kitchen	83	56.9	0	0	8	164	2,314	4,977	1,219	78	0	0	0	229	83.8	72.1	
Variable Refrigerant Flow																	
Zone Group 00																	
ACT-Noisy-2	4	64.1	0	0	0	127	1,681	5,056	1,896	0	0	0	0	0	76.6	72.1	
ACT-Noisy-3	19	64.1	0	0	0	252	2,102	4,762	1,644	0	0	0	0	0	76.6	71.6	
ACT-Quiet-1	0	65.2	0	0	0	0	1,104	5,577	2,079	0	0	0	0	0	76.4	72.7	
ACT-Quiet-2	0	64.5	0	0	0	15	1,212	5,090	2,443	0	0	0	0	0	76.8	72.7	
ACT-Quiet-3	11	64.1	0	0	0	153	1,806	4,888	1,913	0	0	0	0	0	76.6	72.0	
Admin	0	70	0	0	0	0	3	4,925	3,832	0	0	0	0	0	75	73.7	
Attrium	0	70	0	0	0	0	0	4,135	4,625	0	0	0	0	0	75.7	73.9	
Chart/Hotel	0	70	0	0	0	0	1	5,090	3,669	0	0	0	0	0	75	73.7	
Comfort/Consult	1	69	0	0	0	0	344	6,626	1,790	0	0	0	0	0	75.4	72.6	
Corridor-N	0	64.7	0	0	0	10	1,943	3,956	2,851	0	0	0	0	0	78.3	72.9	
Corridor-S	0	67.3	0	0	0	0	394	4,324	4,027	15	0	0	0	0	80.4	74.5	
Corridor-W	0	66.5	0	0	0	0	813	3,817	3,987	143	0	0	0	0	81	74.4	
Entry/Waiting	0	70	0	0	0	0	529	3,798	4,433	0	0	0	0	0	75	73.6	
Exam/Storage	0	69.9	0	0	0	0	48	6,784	1,928	0	0	0	0	0	75	72.8	
Group	269	64	0	0	0	485	3,599	4,574	102	0	0	0	0	0	75.5	70.2	
Hospitality	203	64	0	0	0	661	3,071	4,768	260	0	0	0	0	0	75.8	70.4	
Intake-HR-A	0	69.9	0	0	0	0	18	6,260	2,482	0	0	0	0	0	75	73.0	
Intake-HR-B	0	69.9	0	0	0	0	48	6,189	2,523	0	0	0	0	0	75.2	72.9	
Lounge	0	69.8	0	0	0	0	46	6,963	1,751	0	0	0	0	0	75	72.8	
Multipurpose/Dining	288	64	0	0	0	555	3,706	4,449	50	0	0	0	0	0	75.4	70.0	

			Time spent in each temperature range (°F)													
Zone Name	Unmet Heating	Minimum Temperature (°F)	< 50°F	50°F ≤ 55°F	55°F ≤ 60°F	60°F ≤ 65°F	65°F ≤ 70°F	70°F ≤ 75°F	75°F ≤ 80°F	80°F ≤ 85°F	85°F ≤ 90°F	90°F ≤ 95°F	> 95°F	Unmet Cooling	Maximum Temperature (°F)	Mean Temperature (°F)
	Hours			55°F	60°F	65°F	70°F	75°F	80°F	85°F	90°F	95°F	95°F	Hours		
RB-N-Corner	0	64.6	0	0	0	4	614	3,650	4,492	0	0	0	0	0	78.6	73.7
RB-N-East	0	65.2	0	0	0	0	517	3,655	4,588	0	0	0	0	0	78.3	73.9
RB-N-West	0	65.4	0	0	0	0	484	3,589	4,687	0	0	0	0	0	78.3	73.9
RB-S-Corner-N	0	66.7	0	0	0	0	256	3,118	5,386	0	0	0	0	0	78.6	74.4
RB-S-Corner-S	0	66.9	0	0	0	0	242	3,075	5,443	0	0	0	0	0	78.7	74.4
RB-S-East	0	67.4	0	0	0	0	197	3,286	5,277	0	0	0	0	0	78.3	74.4
RB-S-West	0	67.9	0	0	0	0	131	3,123	5,506	0	0	0	0	0	78.4	74.5
RB-W-North	0	65.2	0	0	0	0	490	3,617	4,653	0	0	0	0	0	78.6	73.9
RB-W-South	0	67.3	0	0	0	0	184	2,902	5,674	0	0	0	0	0	78.7	74.5
Servery	308	64	0	0	0	450	3,689	4,577	44	0	0	0	0	0	75.4	70.1
SHWR-N	0	69.9	0	0	0	0	15	3,117	5,628	0	0	0	0	0	75	74.3
SHWR-S	0	71.6	0	0	0	0	0	1,644	7,116	0	0	0	0	0	75	74.8
SHWR-W	0	70	0	0	0	0	0	2,705	6,055	0	0	0	0	0	75	74.5
Support	0	64.6	0	0	0	4	817	3,137	3,201	1,601	0	0	0	0	81	75.5
Utility	0	69.7	0	0	0	0	228	6,106	2,426	0	0	0	0	0	75	72.8
Zone Group 01																
ACT-Noisy-1	6	64	0	0	0	93	1,506	4,777	2,384	0	0	0	0	0	77.2	72.4
Unconditioned spaces																
Room 00-80	0	49.8	2	139	681	1,473	1,953	1,690	1,273	1,037	466	46	0	0	92.4	71.0
Room 00-81	0	48.8	12	316	1,041	1,636	1,678	1,358	1,061	1,077	517	64	0	0	93	70.0
Room 01-00	0	66.3	0	0	0	0	1,197	3,509	3,895	159	0	0	0	0	81.4	74.3
Room 01-01	0	67.4	0	0	0	0	531	3,657	4,133	439	0	0	0	0	81.7	75.1
Room 01-03	0	67.7	0	0	0	0	454	3,998	4,100	208	0	0	0	0	81.1	74.9
Room 01-04	0	67.7	0	0	0	0	401	3,950	4,139	270	0	0	0	0	81.2	75.0
Room 01-06	0	65.3	0	0	0	0	1,564	3,351	3,696	149	0	0	0	0	81.2	73.9
Room 01-08	0	60.1	0	0	0	1,353	2,654	2,083	1,782	888	0	0	0	0	84.4	71.5

Unconditioned spaces

Room 01-10	0	65.5	0	0	0	0	1,510	3,528	3,561	161	0	0	0	0	81.3	73.9
Room 01-12	0	62.3	0	0	0	321	2,221	2,492	2,075	1,593	58	0	0	0	86.8	74.0
Trash	0	66.7	0	0	0	0	402	2,976	3,811	1,542	29	0	0	0	86.8	76.2



Site Humidity Profile

		Time spent in each humidity range														
		Minimum %	30%	35%	40%	45%	50%	55%	60%	65%	70%	75%		Maximum %	Mean %	
		Relative	< 30%	≤	≤	≤	≤	≤	≤	≤	≤	≤	> 80%	Relative	Relative	
Zone Name		Humidity	35%	40%	45%	50%	55%	60%	65%	70%	75%	80%		Humidity	Humidity	
Hospitality		9.6	1,868	988	1,002	1,150	1,466	1,258	608	260	110	44	3	3	80.6	40.6
Lounge		6.9	2,073	1,038	850	916	1,091	1,106	914	490	200	71	8	4	82.9	40.8
Multipurpose/Dining		8.6	1,768	985	950	1,149	1,395	1,317	715	318	120	35	8	0	79.3	41.1
Servery		8.6	1,803	993	970	1,137	1,394	1,295	697	314	116	32	9	0	78.7	40.9
PSZ-HP-Kitchen																
Zone Group 00																
Kitchen		5.7	2,038	955	931	1,073	1,030	1,114	821	448	246	94	9	1	81.4	40.6
PSZ-HP-ResBed-N																
Zone Group 00																
Corridor-N		12.6	2,748	1,440	1,374	1,854	990	314	40	0	0	0	0	0	57.8	34.8
RB-N-Corner		12.4	1,596	1,100	1,154	1,045	1,392	1,149	786	383	137	18	1	0	75.1	41.9
RB-N-East		12.7	1,555	1,087	1,149	1,047	1,389	1,188	858	402	71	14	0	0	74.7	42
RB-N-West		12.1	1,676	1,115	1,136	1,037	1,343	1,131	789	392	124	19	0	0	74.9	41.7
PSZ-HP-ResBed-S																
Zone Group 00																
Corridor-S		10.8	3,241	1,403	1,337	1,691	787	272	28	0	0	0	0	0	57.6	33.1
RB-S-Corner-S		11.8	1,745	1,142	1,061	1,034	1,331	1,144	819	382	84	20	0	0	74.6	41.4
RB-S-East		11.7	1,776	1,159	1,062	1,012	1,297	1,146	870	387	40	11	0	0	74.6	41.3
RB-S-West		11.9	1,741	1,120	1,097	1,021	1,334	1,133	808	371	118	19	0	0	74.9	41.5
PSZ-HP-ResBed-W																
Zone Group 00																
Corridor-W		10.9	3,128	1,432	1,640	1,660	682	208	11	0	0	0	0	0	57.1	33.3
RB-W-North		12.7	1,529	1,047	1,141	1,072	1,423	1,204	807	421	99	18	0	0	74.3	42.2
RB-W-South		11.8	1,791	1,142	1,047	1,024	1,308	1,144	842	377	72	12	0	0	73.8	41.3
PSZ-HP-ResShwr																
Zone Group 00																

		Time spent in each humidity range														
		Minimum %	30%	35%	40%	45%	50%	55%	60%	65%	70%	75%		Maximum %	Mean %	
		Relative	< 30%	≤	≤	≤	≤	≤	≤	≤	≤	≤	> 80%	Relative	Relative	
Zone Name	Humidity		35%	40%	45%	50%	55%	60%	65%	70%	75%	80%		Humidity	Humidity	
	SHWR-N	7.9	1,590	879	1,030	923	1,052	1,249	1,144	652	185	52	3	0	76.9	42.6
	SHWR-S	7.7	1,669	923	1,004	922	1,062	1,261	1,094	604	172	45	5	0	77.1	42.2
	SHWR-W	7.9	1,568	870	1,033	939	1,075	1,277	1,141	659	147	49	3	0	75.4	42.6
PSZ-HP-Utility																
Zone Group 00																
	Support	7.1	8,760	0	0	0	0	0	0	0	0	0	0	0	13.1	9
	Utility	7.5	2,087	1,060	901	1,011	1,300	1,258	681	310	114	36	3	0	76.9	39.8
Unconditioned spaces																
	Room 00-80	6.3	8,760	0	0	0	0	0	0	0	0	0	0	0	27.3	13.1
	Room 00-81	42.4	0	0	0	39	104	146	233	367	528	552	716	6,075	100.0	84.5
	Room 01-00	8.1	8,760	0	0	0	0	0	0	0	0	0	0	0	15.8	11.4
	Room 01-01	8	8,760	0	0	0	0	0	0	0	0	0	0	0	14.8	10.9
	Room 01-03	8	8,760	0	0	0	0	0	0	0	0	0	0	0	14.9	11
	Room 01-04	8.1	8,760	0	0	0	0	0	0	0	0	0	0	0	14.6	10.9
	Room 01-06	8.1	8,760	0	0	0	0	0	0	0	0	0	0	0	16.1	11.3
	Room 01-08	7.4	8,760	0	0	0	0	0	0	0	0	0	0	0	19.6	12.3
	Room 01-10	8.1	8,760	0	0	0	0	0	0	0	0	0	0	0	16.2	11.4
	Room 01-12	7	8,760	0	0	0	0	0	0	0	0	0	0	0	18.4	11.5
	Trash	31	0	37	187	358	498	626	687	797	983	1,051	955	2,581	100.0	68.1


Site Humidity Profile

		Time spent in each humidity range													
		Minimum %	30%	35%	40%	45%	50%	55%	60%	65%	70%	75%		Maximum %	Mean %
		Relative	< 30%	≤	≤	≤	≤	≤	≤	≤	≤	≤	> 80%	Relative	Relative
Zone Name		Humidity	35%	40%	45%	50%	55%	60%	65%	70%	75%	80%		Humidity	Humidity
Single Zone CV															
Zone Group 00															
Kitchen		5.8	2,101	985	915	1,025	1,095	1,108	822	434	201	60	12	2	40.6
Variable Refrigerant Flow															
Zone Group 00															
ACT-Noisy-2		9.7	1,723	988	928	1,049	1,494	1,907	581	77	9	2	3	1	40.9
ACT-Noisy-3		9.9	1,623	944	951	994	1,381	2,004	728	114	16	2	4	0	41.6
ACT-Quiet-1		9.1	1,925	997	917	1,053	1,512	1,775	527	48	3	4	1	0	40.1
ACT-Quiet-2		9	1,903	1,011	923	1,073	1,580	1,727	493	43	2	2	3	0	40
ACT-Quiet-3		9.8	1,695	995	949	1,046	1,519	1,878	576	84	12	2	3	1	40.9
Admin		11.5	928	702	839	1,027	1,041	1,418	1,511	990	272	32	0	0	47.3
Attrium		9.4	1,614	953	1,116	1,045	1,637	1,786	564	42	3	0	0	0	41.2
Chart/Hotel		12.4	893	684	859	1,035	1,112	1,453	1,643	881	172	29	0	0	47.2
Comfort/Consult		8.8	1,437	857	1,071	957	1,099	1,869	1,264	182	18	4	1	0	43
Corridor-N		8.3	2,310	1,070	1,102	1,460	2,219	498	83	12	6	0	0	0	37.2
Corridor-S		7.2	2,815	1,052	1,021	1,504	1,964	386	13	6	0	0	0	0	35.4
Corridor-W		7.1	2,701	1,128	1,204	1,719	1,772	182	47	6	2	0	0	0	35.4
Entry/Waiting		9.6	1,482	968	1,107	1,034	1,474	1,758	847	77	13	2	0	0	41.9
Exam/Storage		9.6	1,349	854	1,016	984	1,102	1,755	1,467	201	27	5	0	0	43.6
Group		8.5	1,587	919	976	826	1,014	1,729	1,359	306	37	4	4	0	42.6
Hospitality		8.5	1,601	923	999	855	1,070	1,853	1,200	229	24	4	4	0	42.3
Intake-HR-A		10.3	1,283	815	993	1,021	1,069	1,709	1,517	305	43	5	1	0	44.2
Intake-HR-B		10.1	1,344	851	1,032	987	1,137	1,892	1,314	170	27	5	0	0	43.4
Lounge		10.2	1,565	1,031	983	887	1,096	1,663	1,411	106	12	2	5	0	42.1
Multipurpose/Dining		8.5	1,569	912	985	800	978	1,613	1,480	370	46	5	4	0	42.9
RB-N-Corner		9.5	1,668	1,105	1,099	1,222	1,753	1,297	581	26	5	4	0	0	40

[illegible]


Unconditioned spaces

Room 01-12	7.6	8,760	0	0	0	0	0	0	0	0	0	0	0	17.3	12
Trash	43.9	0	0	0	2	63	283	424	659	786	990	1,203	4,351	100.0	79.9




Carbon Footprint and Renewable Energy Summary

Total Emissions

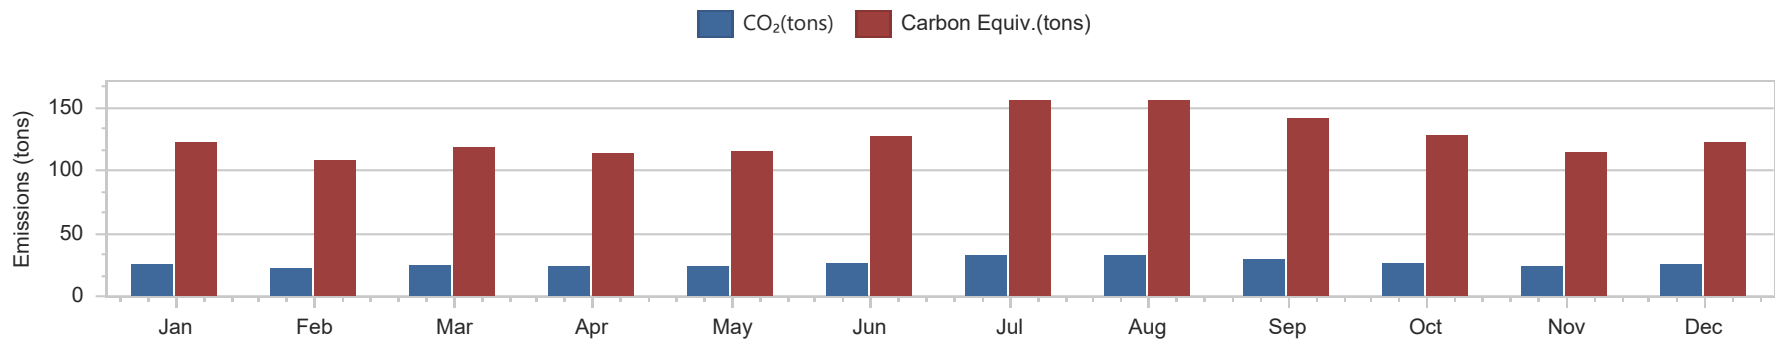


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	25.41	22.42	24.54	23.57	23.97	26.43	32.33	32.42	29.40	26.51	23.78	25.49	316.25
CH ₄	(tons CO ₂ e)	39.38	34.74	38.03	36.53	37.14	40.96	50.11	50.25	45.56	41.08	36.86	39.50	490.14
N ₂ O	(tons CO ₂ e)	57.46	50.70	55.49	53.31	54.20	59.78	73.12	73.33	66.48	59.95	53.78	57.64	715.24
Carbon Equiv.	(tons CO ₂ e)	122.25	107.85	118.06	113.42	115.31	127.17	155.56	155.99	141.43	127.54	114.42	122.63	1,521.64
NO _x	(lbs)	42.00	37.06	40.57	38.96	39.62	43.70	53.44	53.59	48.59	43.81	39.31	42.13	522.76
SO ₂	(lbs)	4.63	4.10	4.48	4.30	4.37	4.83	5.91	5.91	5.36	4.83	4.34	4.65	57.74
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Source Electricity Emissions

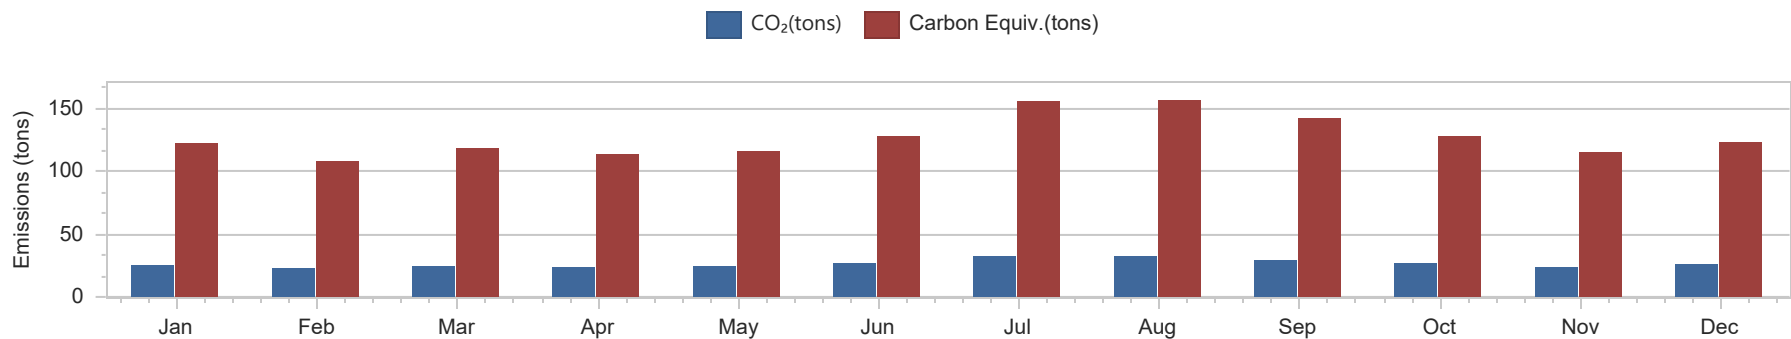

Emission Data for Source Electricity		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO2e)	25.41	22.42	24.54	23.57	23.97	26.43	32.33	32.42	29.40	26.51	23.78	25.49	316.25
CH ₄	(tons CO2e)	39.38	34.74	38.03	36.53	37.14	40.96	50.11	50.25	45.56	41.08	36.86	39.50	490.14
N ₂ O	(tons CO2e)	57.46	50.70	55.49	53.31	54.20	59.78	73.12	73.33	66.48	59.95	53.78	57.64	715.24
Carbon Equiv.	(tons CO2e)	122.25	107.85	118.06	113.42	115.31	127.17	155.56	155.99	141.43	127.54	114.42	122.63	1,521.64
NO _x	(lbs)	42.00	37.06	40.57	38.96	39.62	43.70	53.44	53.59	48.59	43.81	39.31	42.13	522.76
SO ₂	(lbs)	4.63	4.10	4.48	4.30	4.37	4.83	5.91	5.91	5.36	4.83	4.34	4.65	57.74
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Site Emissions

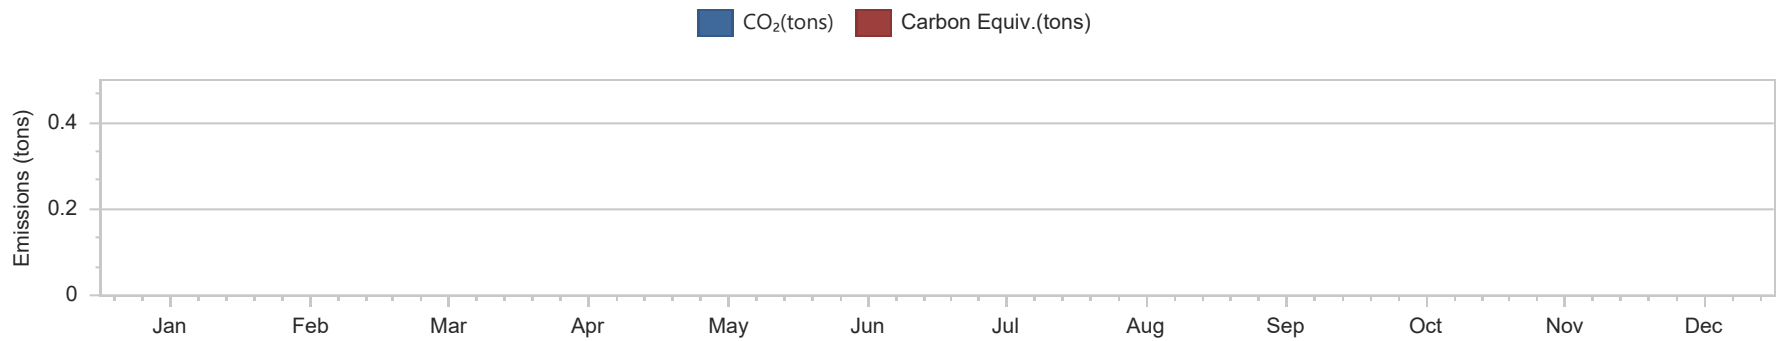


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
CH ₄	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
N ₂ O	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
Carbon Equiv.	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
NO _x	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
SO ₂	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Greenhouse Gas Equivalence


Greenhouse Gas	Annual Total (kg)	Carbon Dioxide Equivalent (kg)	Percent of Total (%)
Carbon Dioxide (CO ₂)	286,901.08	286,901.08	0.07 %
Methane (CH ₄)	444,652.50	11,116,312.50	2.71 %
Nitrous Oxide (N ₂ O)	648,856.26	193,359,165.48	47.22 %

Total 204,762,379.06 * Conversion factors from US EPA

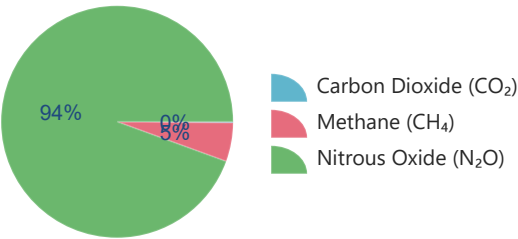

On-Site and Renewable Energy Contribution Summary

Electric Load Satisfied	Energy (kWh)	Percent Electricity (%)
Site Energy from Utility	132,222	100%
Site Power Generation	0	0%

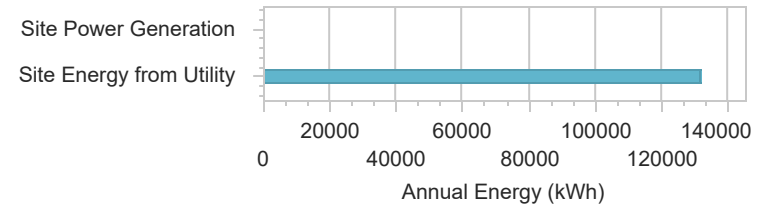

On-Site and Renewable Energy Systems

Electric Loads Satisfied	Electricity Used (kWh)	Percent Electricity (%)
Electricity Coming From Utility	132,222	100 %
Fuel-Fired Power Generation	0	0 %
Net Decrease in On-Site Storage	0	0 %
Net Electricity From Utility	132,222	100 %
Photovoltaic Power	0	0 %
Surplus Electricity Going To Utility	0	0 %
Total Electricity End Uses	132,222	100 %
Total On-Site and Utility Electric Sources	132,222	100 %
Total On-Site Electric Sources	0	0 %
Wind Power	0	0 %


Thermal Sources	Heat (Btu)	Percent Heat (%)
Air to Air Heat Recovery for Cooling	0	0 %
Air to Air Heat Recovery for Heating	0	0 %
Total Thermal Sources	0	0 %
Water-Side Heat Recovery	0	0 %

Monthly On-Site Generation

On-Site and Renewables (kWh)	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
Photovoltaics	0	0	0	0	0	0	0	0	0	0	0	0	0
Wind	0	0	0	0	0	0	0	0	0	0	0	0	0
Internal Combustion Engine	0	0	0	0	0	0	0	0	0	0	0	0	0
Combustion Turbine	0	0	0	0	0	0	0	0	0	0	0	0	0


Carbon Footprint and Renewable Energy Summary

Total Emissions

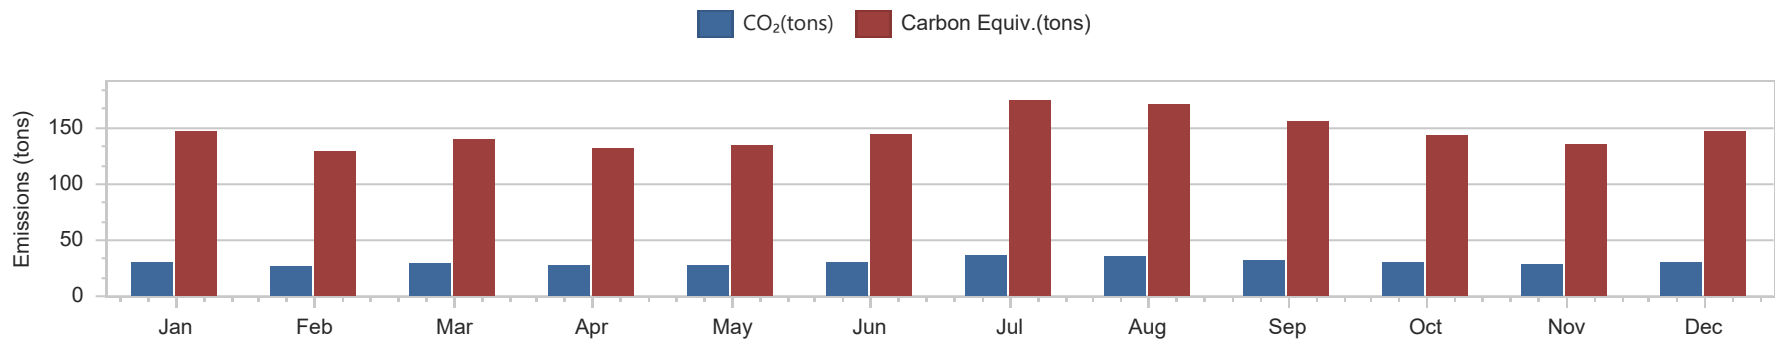


Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	30.61	26.90	28.98	27.49	27.90	30.06	36.35	35.63	32.32	29.88	28.14	30.63	364.89
CH ₄	(tons CO ₂ e)	47.44	41.69	44.91	42.60	43.24	46.59	56.33	55.22	50.08	46.32	43.61	47.47	565.52
N ₂ O	(tons CO ₂ e)	69.23	60.83	65.54	62.17	63.10	67.99	82.20	80.59	73.09	67.59	63.63	69.27	825.24
Carbon Equiv.	(tons CO ₂ e)	147.29	129.42	139.44	132.25	134.24	144.65	174.89	171.45	155.49	143.79	135.38	147.37	1,755.64
NO _x	(lbs)	50.60	44.47	47.91	45.44	46.12	49.69	60.08	58.91	53.42	49.41	46.52	50.62	603.14
SO ₂	(lbs)	5.58	4.92	5.29	5.03	5.09	5.49	6.64	6.50	5.91	5.45	5.14	5.60	66.60
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0

Source Electricity Emissions

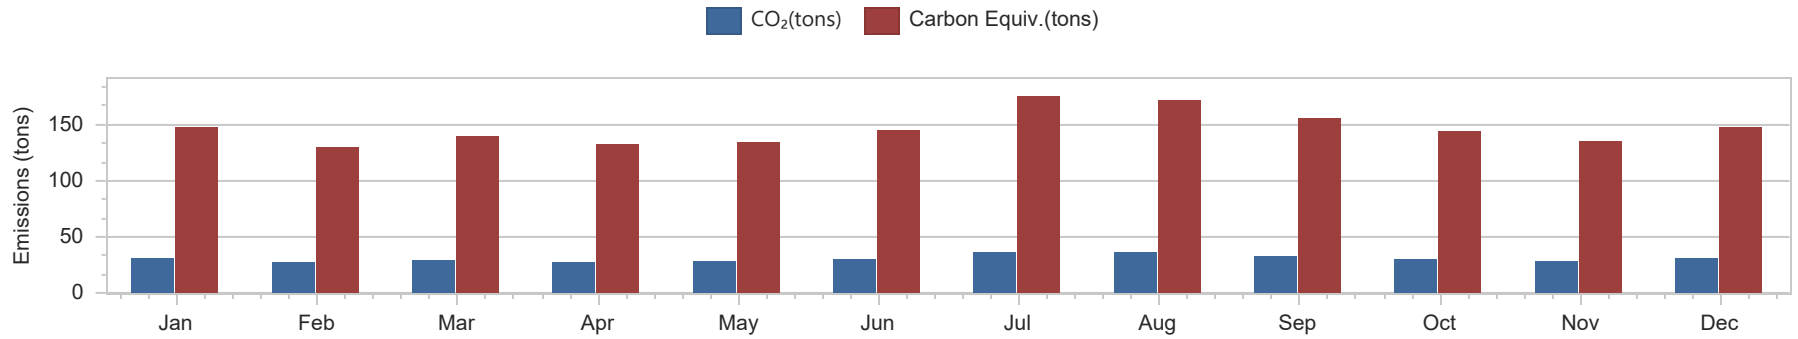

Emission Data for Source Electricity		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO2e)	30.61	26.90	28.98	27.49	27.90	30.06	36.35	35.63	32.32	29.88	28.14	30.63	364.89
CH ₄	(tons CO2e)	47.44	41.69	44.91	42.60	43.24	46.59	56.33	55.22	50.08	46.32	43.61	47.47	565.52
N ₂ O	(tons CO2e)	69.23	60.83	65.54	62.17	63.10	67.99	82.20	80.59	73.09	67.59	63.63	69.27	825.24
Carbon Equiv.	(tons CO2e)	147.29	129.42	139.44	132.25	134.24	144.65	174.89	171.45	155.49	143.79	135.38	147.37	1,755.64
NO _x	(lbs)	50.60	44.47	47.91	45.44	46.12	49.69	60.08	58.91	53.42	49.41	46.52	50.62	603.14
SO ₂	(lbs)	5.58	4.92	5.29	5.03	5.09	5.49	6.64	6.50	5.91	5.45	5.14	5.60	66.60
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0


Site Emissions

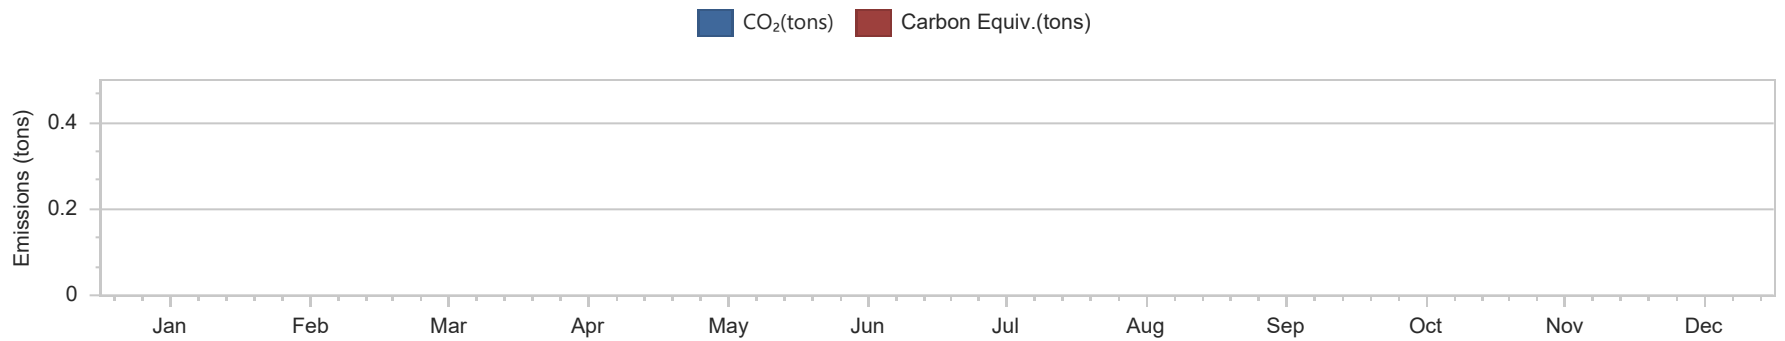

Emissions Data of Total Emissions		Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
CO ₂	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
CH ₄	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
N ₂ O	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
Carbon Equiv.	(tons CO ₂ e)	0	0	0	0	0	0	0	0	0	0	0	0	0
NO _x	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
SO ₂	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hg	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
PM	(lbs)	0	0	0	0	0	0	0	0	0	0	0	0	0
Water Consum.	(gal)	0	0	0	0	0	0	0	0	0	0	0	0	0


Greenhouse Gas Equivalence

Greenhouse Gas	Annual Total (kg)	Carbon Dioxide Equivalent (kg)	Percent of Total (%)
Carbon Dioxide (CO ₂)	331,021.49	331,021.49	0.07 %
Methane (CH ₄)	513,032.25	12,825,806.25	2.71 %
Nitrous Oxide (N ₂ O)	748,641.56	223,095,184.88	47.22 %
Total		236,252,012.62	* Conversion factors from US EPA

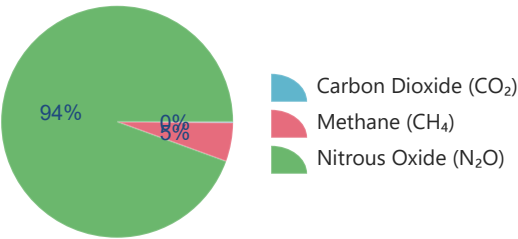

On-Site and Renewable Energy Contribution Summary


Electric Load Satisfied	Energy (kWh)	Percent Electricity (%)
Site Energy from Utility	152,500	100%
Site Power Generation	0	0%

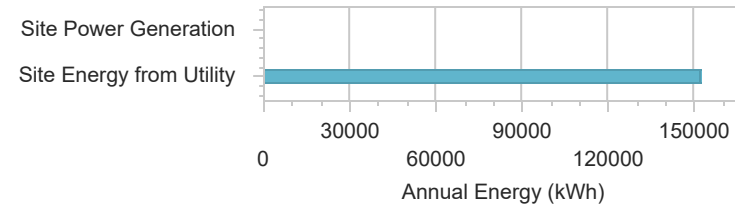

On-Site and Renewable Energy Systems

Electric Loads Satisfied	Electricity Used (kWh)	Percent Electricity (%)
Electricity Coming From Utility	152,500	100 %
Fuel-Fired Power Generation	0	0 %
Net Decrease in On-Site Storage	0	0 %
Net Electricity From Utility	152,500	100 %
Photovoltaic Power	0	0 %
Surplus Electricity Going To Utility	0	0 %
Total Electricity End Uses	152,500	100 %
Total On-Site and Utility Electric Sources	152,500	100 %
Total On-Site Electric Sources	0	0 %
Wind Power	0	0 %


Thermal Sources	Heat (Btu)	Percent Heat (%)
Air to Air Heat Recovery for Cooling	0	0 %
Air to Air Heat Recovery for Heating	0	0 %
Total Thermal Sources	1,943,518	100 %
Water-Side Heat Recovery	1,943,518	100 %

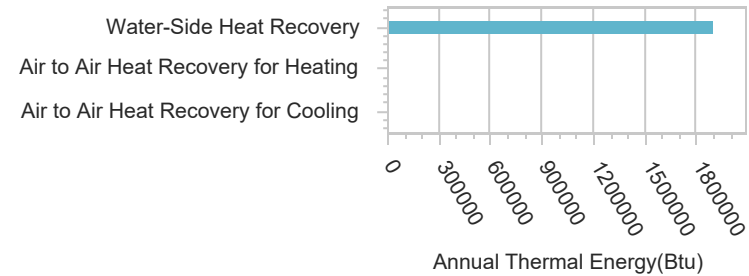

Monthly On-Site Generation

On-Site and Renewables (kWh)	Jan	Feb	Mar	Apr	May	June	July	Aug	Sept	Oct	Nov	Dec	Total
Photovoltaics	0	0	0	0	0	0	0	0	0	0	0	0	0
Wind	0	0	0	0	0	0	0	0	0	0	0	0	0
Internal Combustion Engine	0	0	0	0	0	0	0	0	0	0	0	0	0
Combustion Turbine	0	0	0	0	0	0	0	0	0	0	0	0	0

Water Summary

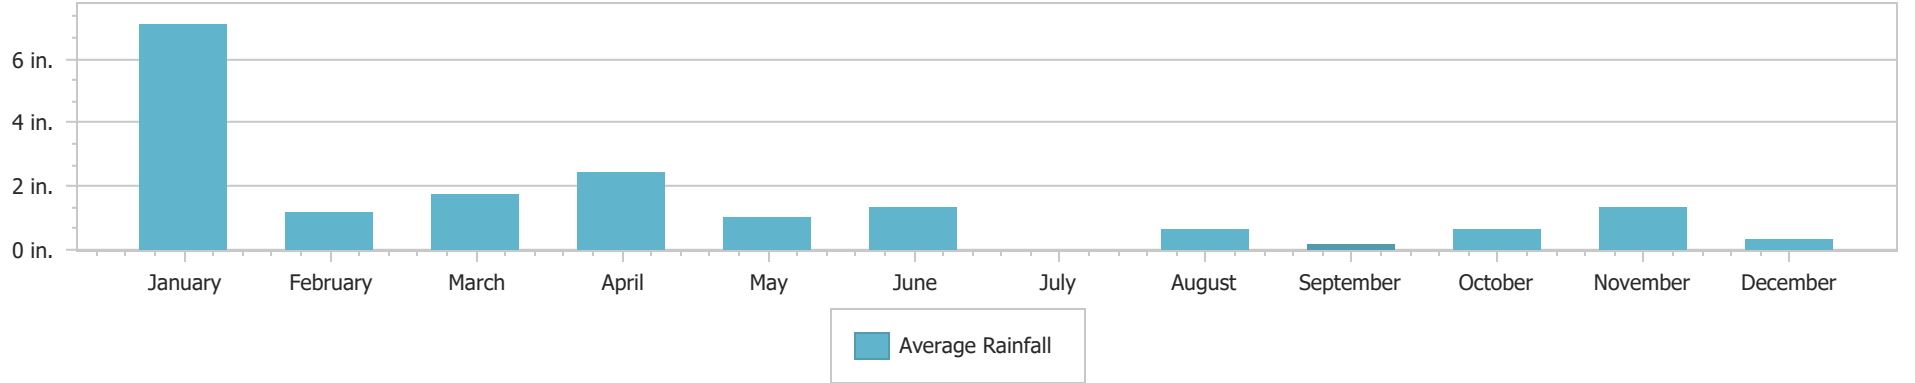


If the weather file contains erroneous or incomplete rainfall data, the data here will be erroneous or incomplete as well.

		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Average Rainfall	in.	7.09	1.18	1.73	2.44	1.02	1.34	0.00	0.63	0.16	0.63	1.34	0.31	17.87
Average Gallons of H2O	gal	69,332.65	11,555.44	16,947.98	23,881.25	10,014.72	13,096.17	0.00	6,162.90	1,540.73	6,162.90	13,096.17	3,081.45	174,872.35

Gross Roof Area: 15,695 ft²

	Water (gal)	Percent Water (%)
Change in Storage	0	0
Condensate Collection	0	0
Final Storage	0	0
Groundwater Well	0	0
Initial Storage	0	0
Rainwater Collection	0	0
Total On Site Water Sources	0	0
Total On Site, Change in Storage, and Utility Water Sources	0	0
Total Water End Uses	0	0
Water Supplied by Utility	0	0

Water Summary

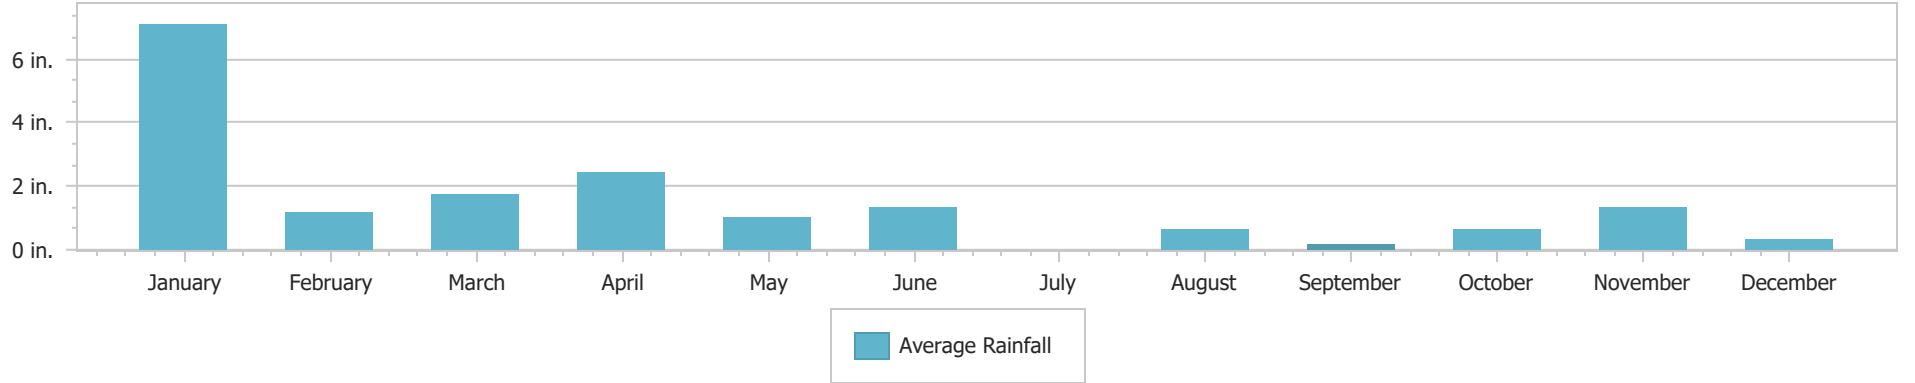

If the weather file contains erroneous or incomplete rainfall data, the data here will be erroneous or incomplete as well.


		Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Average Rainfall	in.	7.09	1.18	1.73	2.44	1.02	1.34	0.00	0.63	0.16	0.63	1.34	0.31	17.87
Average Gallons of H2O	gal	69,332.65	11,555.44	16,947.98	23,881.25	10,014.72	13,096.17	0.00	6,162.90	1,540.73	6,162.90	13,096.17	3,081.45	174,872.35

Gross Roof Area: 15,695 ft²

	Water (gal)	Percent Water (%)
Change in Storage	0	0
Condensate Collection	0	0
Final Storage	0	0
Groundwater Well	0	0
Initial Storage	0	0
Rainwater Collection	0	0
Total On Site Water Sources	0	0
Total On Site, Change in Storage, and Utility Water Sources	0	0
Total Water End Uses	0	0
Water Supplied by Utility	0	0

Utility Peak Demand Summary

Electricity (kW)

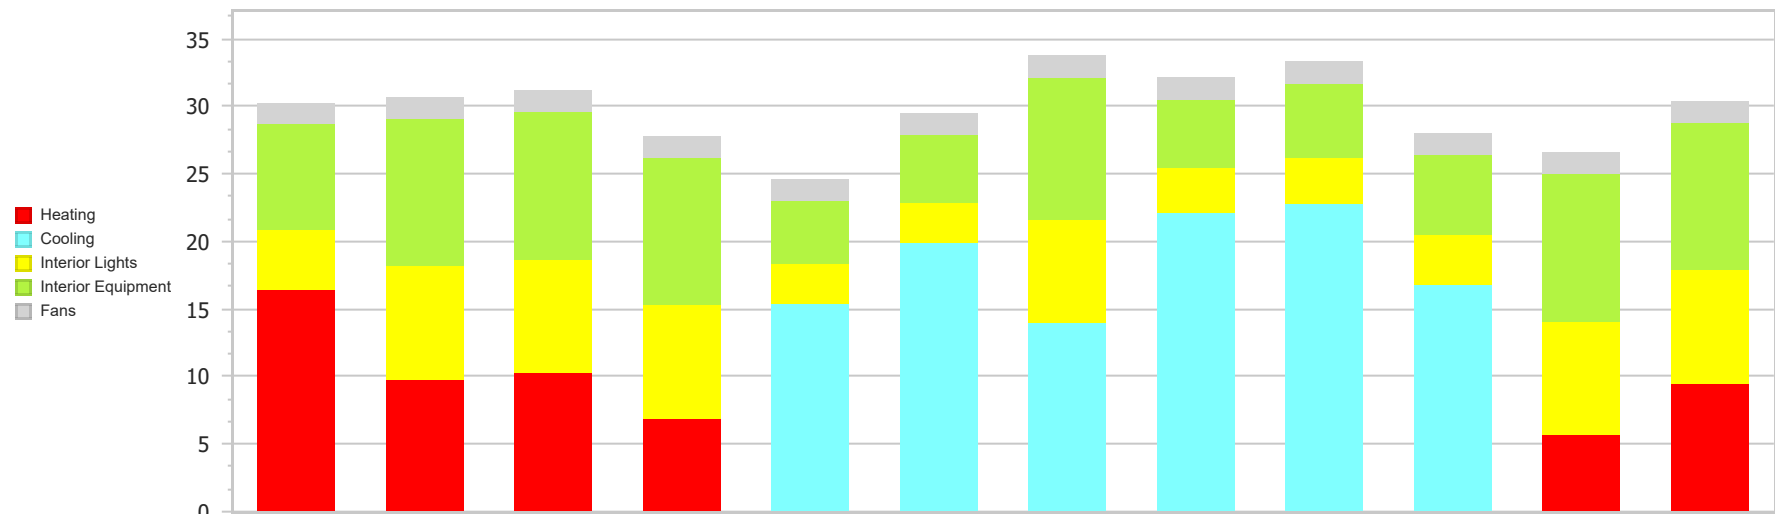


Peak Facility Demand
Time of Peak (Day/Hour)
Heating
Cooling
Interior Lights
Interior Equipment
Fans

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
03/07:00	23/21:00	01/21:00	20/21:00	07/15:00	25/14:00	10/20:00	14/14:00	02/14:00	15/13:00	17/21:00	12/21:00
16.4	9.8	10.3	6.9	0	0	0	0	0	0	5.7	9.5
0	0	0	0	15.4	19.9	14	22.1	22.8	16.8	0	0
4.5	8.4	8.4	8.4	3	3	7.6	3.4	3.4	3.7	8.4	8.4
7.8	10.9	10.9	10.9	4.6	5	10.5	5	5.5	5.9	10.9	10.9
1.5	1.6	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.6	1.6	1.6

Utility Peak Demand Summary

Electricity (kW)

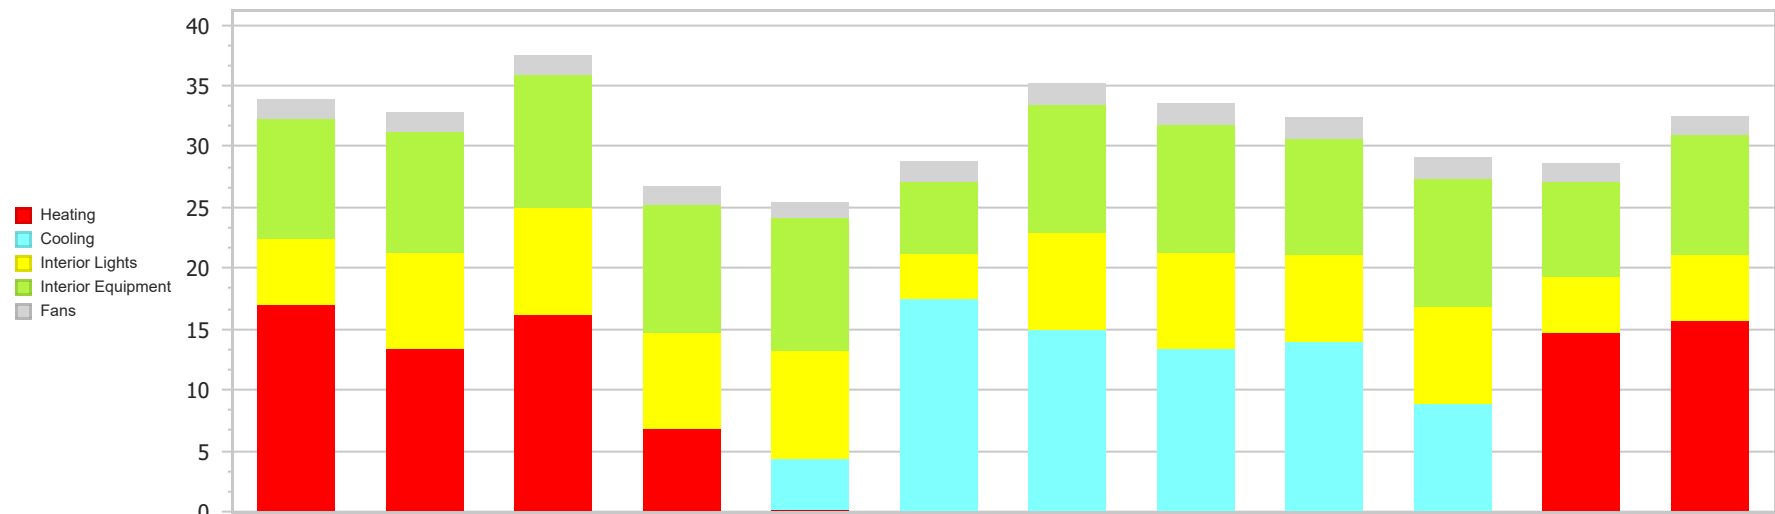

Peak Facility Demand
Time of Peak (Day/Hour)
Heating
Cooling
Interior Lights
Interior Equipment
Fans

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
33.9	32.7	37.5	26.7	25.3	28.8	35.3	33.7	32.4	29.1	28.6	32.6
17/08:00	23/22:00	01/21:00	20/20:00	11/21:00	25/13:00	12/20:00	14/20:00	02/20:00	03/20:00	16/07:00	21/08:00
17	13.4	16.2	6.8	0.2	0	0	0	0	0	14.7	15.7
0	0	0	0	4.2	17.5	15	13.4	14	8.9	0	0
5.4	7.9	8.8	7.9	8.8	3.7	7.9	7.9	7.1	7.9	4.6	5.4
9.9	9.9	10.9	10.5	10.9	5.9	10.5	10.5	9.5	10.5	7.8	9.9
1.6	1.6	1.6	1.5	1.3	1.7	1.8	1.8	1.8	1.8	1.5	1.5


Economic Summary

Economic Summary and Calculation Parameters

Life Cycle and Costing Parameters


Length of Study	25 years
Inflation Approach	ConstantDollar
Discounting Convention	BeginningOfYear
Real Discount Rate	3.00%
Nominal Discount Rate	-- N/A --
Inflation Rate	-- N/A --
Tax Rate	0.00%
Depreciation Method	None
Base Date	July 2019
Service Date	July 2019
Building Area	21,103 (ft²)
Net Conditioned Building Area	13,652 (ft²)
Initial Capital Investment Cost	\$0

Average Costs

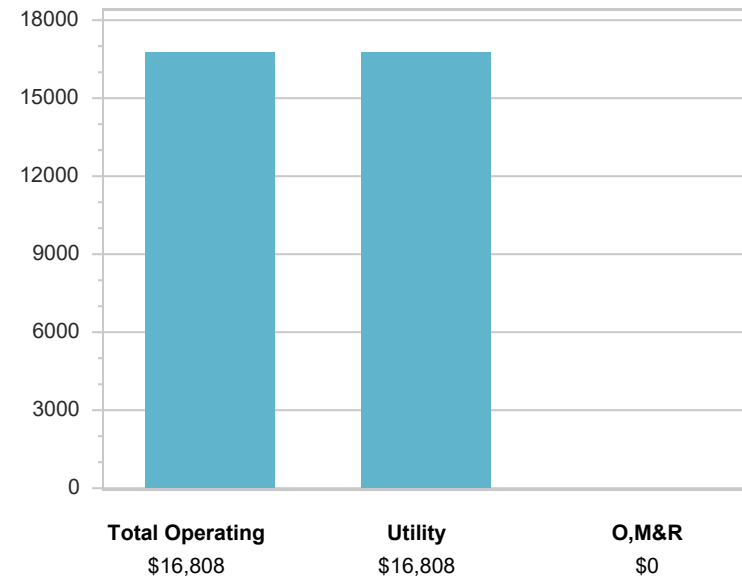


Energy Cost Summary

Name	Electricity	Gas	Other	Total
Energy Cost (Net)	\$16,808	\$0	\$0	\$16,808
Renewables Offset	\$0	\$0	\$0	\$0
Energy Cost (Total)	\$16,808	\$0	\$0	\$16,808
Cost per Building Area	\$0.80	\$0.00	\$0.00	\$0.80
Cost per Net Cond. Bldg Area	\$1.23	\$0.00	\$0.00	\$1.23

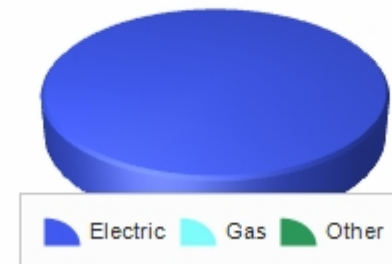


Monthly Utilities Cost Summary

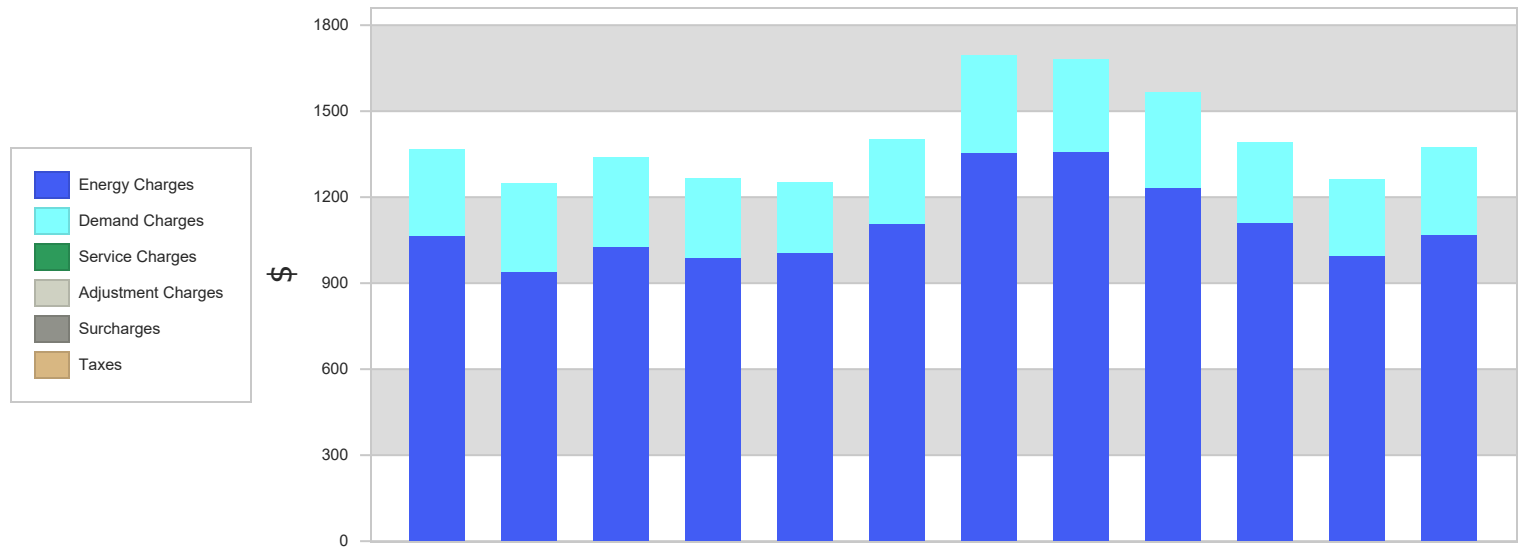

Tariff Catagory	Fuel Type	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)	Annual Total (\$)	% of Total
Consumption Charges	Electricity	1,063	938	1,026	986	1,002	1,105	1,352	1,356	1,229	1,109	995	1,066	13,227	78.69%
Demand Charges	Electricity	303	307	312	277	246	295	338	322	333	279	265	304	3,581	21.31%
Adjustment	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Basis	All	1,365	1,244	1,338	1,263	1,249	1,400	1,690	1,678	1,562	1,388	1,260	1,370	16,808	100.00%
ServiceCharges	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Subtotal	All	1,365	1,244	1,338	1,263	1,249	1,400	1,690	1,678	1,562	1,388	1,260	1,370	16,808	100.00%
Surcharge	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Taxes	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Total		1,365	1,244	1,338	1,263	1,249	1,400	1,690	1,678	1,562	1,388	1,260	1,370	16,808	

Monthly Utility Details

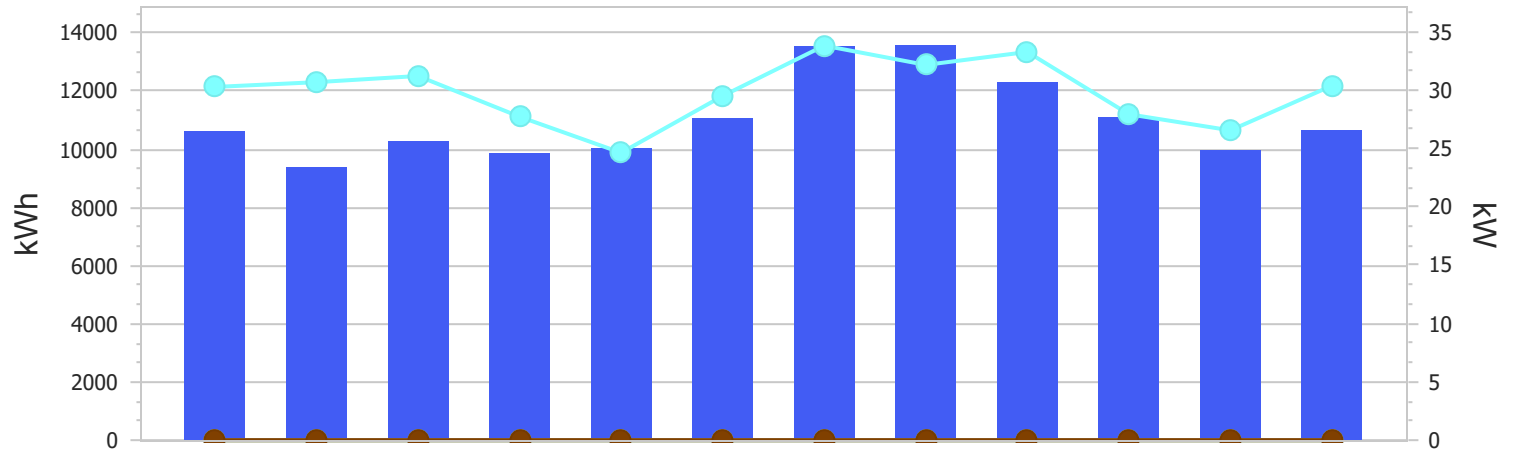

Electricity


On Peak Demand kW
On Peak Consumption kWh

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Annual Totals
30	31	31	28	25	30	34	32	33	28	27	30	34
10,627	9,375	10,263	9,859	10,023	11,054	13,523	13,560	12,294	11,086	9,946	10,660	132,271

Tariff Details

Tariff Name	Selected	Qualified	Meter Name	Buy or Sell	Group	Total Annual Cost
SAMPLE WITH ALL UTILITIES_ELEC	Yes	Yes	BUILDING ELECTRICITY	Buy	(none)	\$16,808

Life Cycle Operating Cash Flow (without escalation)

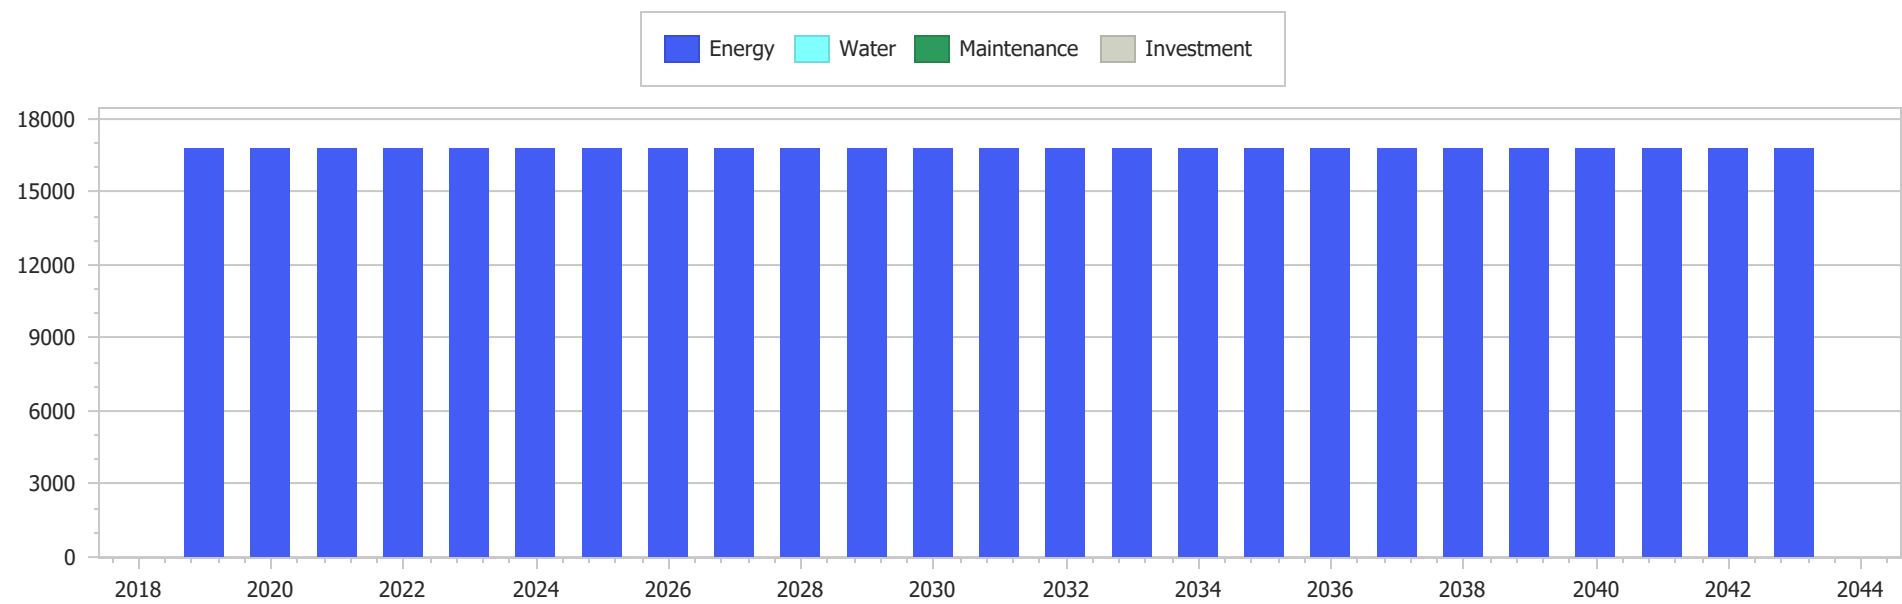

Year	Energy	Water	Maintenance	Investment	Total
2019	16,808	0	0	0	16,808
2020	16,808	0	0	0	16,808
2021	16,808	0	0	0	16,808
2022	16,808	0	0	0	16,808
2023	16,808	0	0	0	16,808
2024	16,808	0	0	0	16,808
2025	16,808	0	0	0	16,808
2026	16,808	0	0	0	16,808

Year	Energy	Water	Maintenance	Investment	Total
2027	16,808	0	0	0	16,808
2028	16,808	0	0	0	16,808
2029	16,808	0	0	0	16,808
2030	16,808	0	0	0	16,808
2031	16,808	0	0	0	16,808
2032	16,808	0	0	0	16,808
2033	16,808	0	0	0	16,808
2034	16,808	0	0	0	16,808
2035	16,808	0	0	0	16,808
2036	16,808	0	0	0	16,808
2037	16,808	0	0	0	16,808
2038	16,808	0	0	0	16,808
2039	16,808	0	0	0	16,808
2040	16,808	0	0	0	16,808
2041	16,808	0	0	0	16,808
2042	16,808	0	0	0	16,808
2043	16,808	0	0	0	16,808

Present Value Analysis (Without Escalation)

Present Value By Year

Year	Total Cost	Present Value
2019	16,808.08	16,808.08
2020	16,808.08	16,318.52
2021	16,808.08	15,843.23
2022	16,808.08	15,381.77
2023	16,808.08	14,933.76
2024	16,808.08	14,498.80
2025	16,808.08	14,076.50
2026	16,808.08	13,666.51
2027	16,808.08	13,268.45
2028	16,808.08	12,881.99
2029	16,808.08	12,506.79
2030	16,808.08	12,142.51
2031	16,808.08	11,788.85
2032	16,808.08	11,445.48
2033	16,808.08	11,112.12
2034	16,808.08	10,788.47
2035	16,808.08	10,474.24
2036	16,808.08	10,169.16
2037	16,808.08	9,872.97
2038	16,808.08	9,585.41
2039	16,808.08	9,306.23
2040	16,808.08	9,035.17
2041	16,808.08	8,772.01
2042	16,808.08	8,516.51
2043	16,808.08	8,268.46
Total Life Cycle Cost		301,461.99



Category	Present Value	
Construction	\$0.00	0%
Energy	\$301,462.00	100%
Grand Total	\$301,462.00	
Maintenance	\$0.00	0%
Operation	\$0.00	0%
Other Capital	\$0.00	0%
Other Operational	\$0.00	0%
Repair	\$0.00	0%
Replacement	\$0.00	0%
Salvage	\$0.00	0%
Total Capital	\$0.00	
Total Energy	\$301,462.00	
Total Operation	\$301,462.00	
Water	\$0.00	0%


Economic Summary

Economic Summary and Calculation Parameters

Life Cycle and Costing Parameters


Length of Study	25 years
Inflation Approach	ConstantDollar
Discounting Convention	BeginningOfYear
Real Discount Rate	3.00%
Nominal Discount Rate	-- N/A --
Inflation Rate	-- N/A --
Tax Rate	0.00%
Depreciation Method	None
Base Date	July 2019
Service Date	July 2019
Building Area	21,103 (ft²)
Net Conditioned Building Area	13,652 (ft²)
Initial Capital Investment Cost	\$0

Average Costs

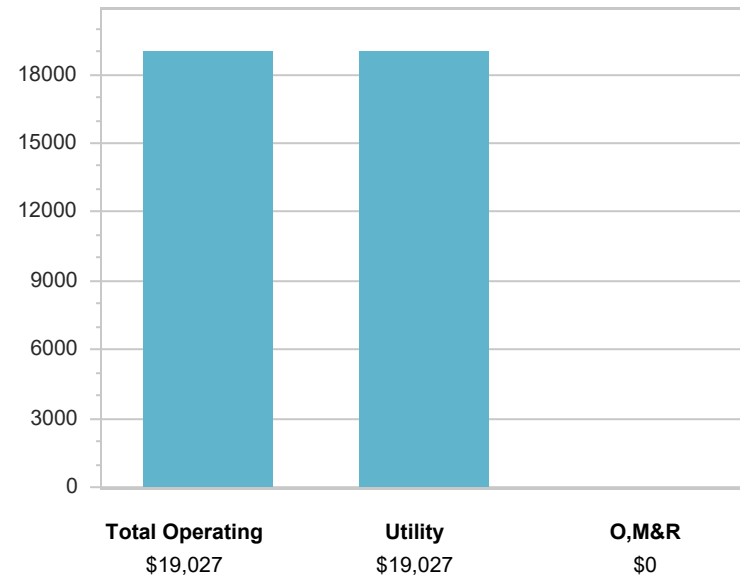


Energy Cost Summary

Name	Electricity	Gas	Other	Total
Energy Cost (Net)	\$19,027	\$0	\$0	\$19,027
Renewables Offset	\$0	\$0	\$0	\$0
Energy Cost (Total)	\$19,027	\$0	\$0	\$19,027
Cost per Building Area	\$0.90	\$0.00	\$0.00	\$0.90
Cost per Net Cond. Bldg Area	\$1.39	\$0.00	\$0.00	\$1.39

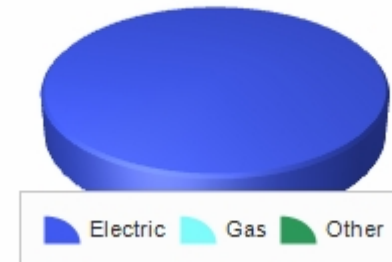


Monthly Utilities Cost Summary

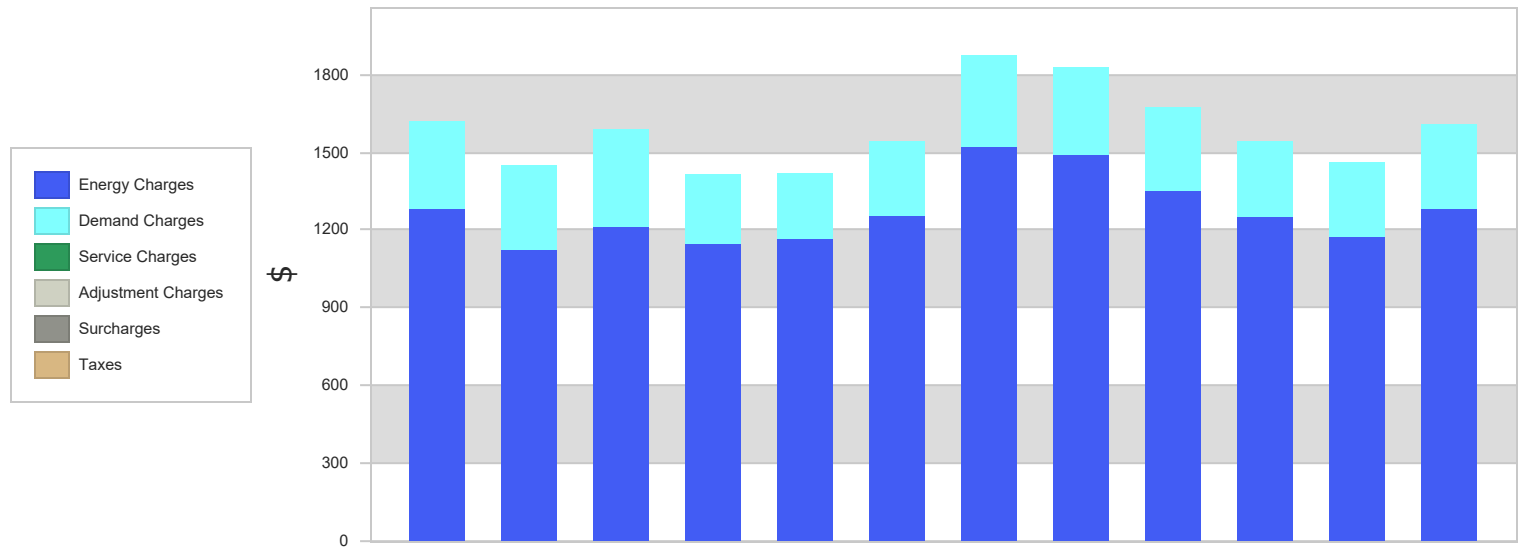

Tariff Catagory	Fuel Type	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)	Annual Total (\$)	% of Total
Consumption Charges	Electricity	1,280	1,125	1,212	1,150	1,167	1,257	1,520	1,490	1,352	1,250	1,177	1,281	15,261	80.21%
Demand Charges	Electricity	339	327	375	267	253	288	353	337	324	291	286	326	3,766	19.79%
Adjustment	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Basis	All	1,619	1,452	1,587	1,417	1,420	1,545	1,873	1,827	1,675	1,541	1,463	1,607	19,027	100.00%
ServiceCharges	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Subtotal	All	1,619	1,452	1,587	1,417	1,420	1,545	1,873	1,827	1,675	1,541	1,463	1,607	19,027	100.00%
Surcharge	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Taxes	All	0	0	0	0	0	0	0	0	0	0	0	0	0	0.00%
Total		1,619	1,452	1,587	1,417	1,420	1,545	1,873	1,827	1,675	1,541	1,463	1,607	19,027	

Monthly Utility Details

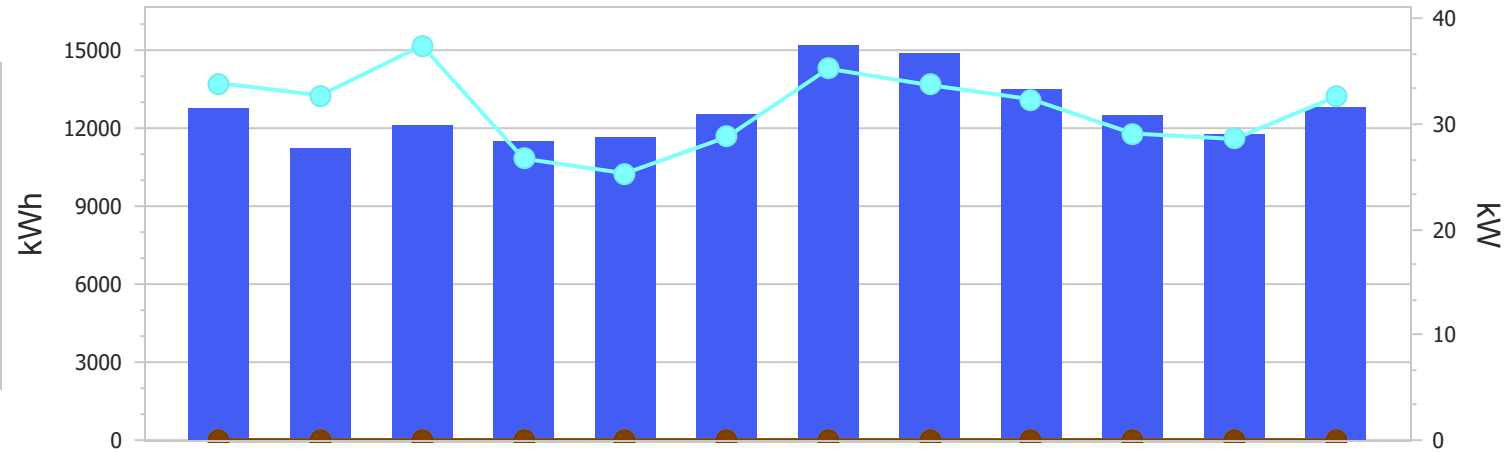

Electricity

On Peak Demand kW


On Peak Consumption kWh

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Annual Totals
34	33	37	27	25	29	35	34	32	29	29	33	37
12,803	11,250	12,121	11,496	11,669	12,574	15,202	14,903	13,516	12,499	11,768	12,811	152,612

Tariff Details

Tariff Name	Selected	Qualified	Meter Name	Buy or Sell	Group	Total Annual Cost
SAMPLE WITH ALL UTILITIES_ELEC	Yes	Yes	BUILDING ELECTRICITY	Buy	(none)	\$19,027

Life Cycle Operating Cash Flow (without escalation)

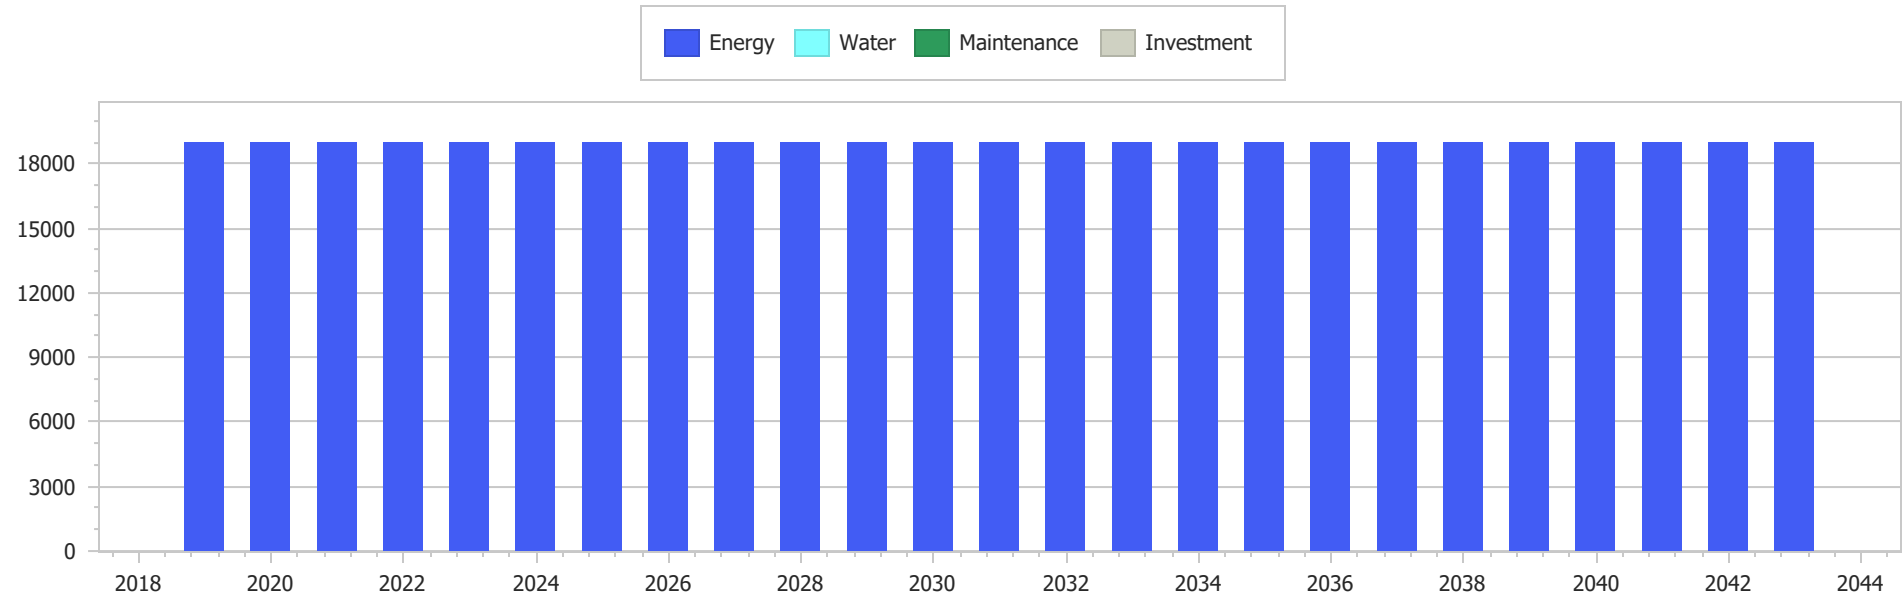

Year	Energy	Water	Maintenance	Investment	Total
2019	19,027	0	0	0	19,027
2020	19,027	0	0	0	19,027
2021	19,027	0	0	0	19,027
2022	19,027	0	0	0	19,027
2023	19,027	0	0	0	19,027
2024	19,027	0	0	0	19,027
2025	19,027	0	0	0	19,027
2026	19,027	0	0	0	19,027

Year	Energy	Water	Maintenance	Investment	Total
2027	19,027	0	0	0	19,027
2028	19,027	0	0	0	19,027
2029	19,027	0	0	0	19,027
2030	19,027	0	0	0	19,027
2031	19,027	0	0	0	19,027
2032	19,027	0	0	0	19,027
2033	19,027	0	0	0	19,027
2034	19,027	0	0	0	19,027
2035	19,027	0	0	0	19,027
2036	19,027	0	0	0	19,027
2037	19,027	0	0	0	19,027
2038	19,027	0	0	0	19,027
2039	19,027	0	0	0	19,027
2040	19,027	0	0	0	19,027
2041	19,027	0	0	0	19,027
2042	19,027	0	0	0	19,027
2043	19,027	0	0	0	19,027

Present Value Analysis (Without Escalation)

Present Value By Year

Year	Total Cost	Present Value
2019	19,027.34	19,027.34
2020	19,027.34	18,473.15
2021	19,027.34	17,935.10
2022	19,027.34	17,412.71
2023	19,027.34	16,905.55
2024	19,027.34	16,413.15
2025	19,027.34	15,935.10
2026	19,027.34	15,470.97
2027	19,027.34	15,020.36
2028	19,027.34	14,582.87
2029	19,027.34	14,158.13
2030	19,027.34	13,745.76
2031	19,027.34	13,345.40
2032	19,027.34	12,956.69
2033	19,027.34	12,579.32
2034	19,027.34	12,212.93
2035	19,027.34	11,857.21
2036	19,027.34	11,511.86
2037	19,027.34	11,176.56
2038	19,027.34	10,851.03
2039	19,027.34	10,534.98
2040	19,027.34	10,228.13
2041	19,027.34	9,930.23
2042	19,027.34	9,641.00
2043	19,027.34	9,360.19
Total Life Cycle Cost		341,265.72



Category	Present Value	
Construction	\$0.00	0%
Energy	\$341,265.70	100%
Grand Total	\$341,265.70	
Maintenance	\$0.00	0%
Operation	\$0.00	0%
Other Capital	\$0.00	0%
Other Operational	\$0.00	0%
Repair	\$0.00	0%
Replacement	\$0.00	0%
Salvage	\$0.00	0%
Total Capital	\$0.00	
Total Energy	\$341,265.70	
Total Operation	\$341,265.70	
Water	\$0.00	0%

Equipment Energy Consumption

Equipment-Utility

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Interior Lighting	Electric (kWh)	3,078	2,784	3,088	2,983	3,085	2,988	3,080	3,088	2,983	3,081	2,977	3,080	36,295
	Peak (kW)	4.5	8.4	8.4	8.4	3.0	3.0	7.6	3.4	3.4	3.7	8.4	8.4	8.4
Interior Equipment	Electric (kWh)	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
	Peak (kW)	7.8	10.9	10.9	10.9	4.6	5.0	10.5	5.0	5.5	5.9	10.9	10.9	10.9

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-1 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	3	1	1	1	0	0	0	0	0	0	0	2	8
ACT-Noisy-1 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-1 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	6	7	13	23	38	68	68	56	31	7	2	321
	Peak (kW)	0.1	0.2	0.2	0.2	0.3	0.4	0.5	0.5	0.5	0.3	0.2	0.1	0.5
ACT-Noisy-1 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	14	12	14	14	15	15	16	16	16	15	13	14	173
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	6	3	2	1	0	0	0	0	0	0	1	5	18
ACT-Noisy-2 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-2 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	4	12	27	50	49	38	20	3	0	205
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.3	0.4	0.4	0.4	0.3	0.1	0.0	0.4
ACT-Noisy-2 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	7	6	7	7	8	8	8	8	8	8	7	7	89

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	10	5	4	2	0	0	0	0	0	0	3	9	32
ACT-Noisy-3 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Noisy-3 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	0	3	8	25	50	49	36	18	2	0	192
	Peak (kW)	0.0	0.1	0.1	0.2	0.2	0.3	0.4	0.4	0.4	0.3	0.1	0.0	0.4
ACT-Noisy-3 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	8	7	7	7	7	8	9	8	8	8	7	8	92
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	1
ACT-Quiet-1 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-1 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	2	1	3	7	16	31	31	26	16	4	1	139
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
ACT-Quiet-1 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	4	4	4	4	5	5	5	5	5	5	4	4	53
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	1	0	0	0	0	0	0	0	0	0	0	0	2
ACT-Quiet-2 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-2 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	3	2	5	10	20	36	37	31	18	4	1	168
	Peak (kW)	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
ACT-Quiet-2 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	5	5	5	5	6	6	6	6	6	6	5	5	68

Alternative: Title 24 - 2022 Baseline

Calculated at: Jun 29, 2026 - 02:32 PM

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Page 2 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _PSZ-HP-Activity DX Heating Coil Electricity	Electric (kWh)	3	1	1	0	0	0	0	0	0	0	0	3	9
ACT-Quiet-3 _PSZ-HP-Activity Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
ACT-Quiet-3 _PSZ-HP-Activity SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _PSZ-HP-Activity SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	3	9	19	35	34	26	14	2	0	144
	Peak (kW)	0.0	0.1	0.0	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.0	0.2
ACT-Quiet-3 _PSZ-HP-Activity SF-1 Fan Electricity	Electric (kWh)	5	5	5	5	6	6	6	6	6	6	5	5	65
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _PSZ-HP-Admin DX Heating Coil Electricity	Electric (kWh)	4	2	2	1	0	0	0	0	0	0	1	3	12
Admin _PSZ-HP-Admin Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Admin _PSZ-HP-Admin SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _PSZ-HP-Admin SAAHP-1 Cooling Coil Electricity	Electric (kWh)	4	7	5	8	13	27	50	53	46	30	10	5	257
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.2	0.1	0.1	0.3
Admin _PSZ-HP-Admin SF-1 Fan Electricity	Electric (kWh)	15	14	15	14	15	14	15	15	14	15	14	15	176
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _PSZ-HP-Atrium DX Heating Coil Electricity	Electric (kWh)	25	11	8	2	0	0	0	0	0	0	6	24	77
Attrium _PSZ-HP-Atrium Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Attrium _PSZ-HP-Atrium SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _PSZ-HP-Atrium SAAHP-1 Cooling Coil Electricity	Electric (kWh)	9	20	20	44	82	159	278	273	219	126	31	10	1,271
	Peak (kW)	0.3	0.4	0.4	0.6	0.7	1.0	1.2	1.2	1.2	0.9	0.5	0.3	1.2
Attrium _PSZ-HP-Atrium SF-1 Fan Electricity	Electric (kWh)	51	46	51	49	51	49	51	51	49	51	49	51	598

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Chart/Hotel _PSZ-HP-Admin DX Heating Coil Electricity	Electric (kWh)	2	1	1	0	0	0	0	0	0	0	0	1	4
Chart/Hotel _PSZ-HP-Admin Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Chart/Hotel _PSZ-HP-Admin SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _PSZ-HP-Admin SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	2	1	4	11	23	42	43	35	21	5	1	191
	Peak (kW)	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.1	0.2	0.1	0.1	0.0	0.2
Chart/Hotel _PSZ-HP-Admin SF-1 Fan Electricity	Electric (kWh)	9	8	9	8	9	8	9	9	8	9	8	9	103
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	45	29	30	15	1	0	0	0	0	1	20	45	187
Comfort/Consult _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Comfort/Consult _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	5	12	39	83	82	62	30	5	0	320
	Peak (kW)	0.0	0.1	0.1	0.2	0.2	0.4	0.5	0.4	0.4	0.3	0.1	0.0	0.5
Comfort/Consult _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	19	17	19	19	19	19	19	19	19	19	19	19	228
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _PSZ-HP-ResBed-N DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-N _PSZ-HP-ResBed-N Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-N _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _PSZ-HP-ResBed-N SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 4 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _PSZ-HP-ResBed-S DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-S _PSZ-HP-ResBed-S Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-S _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	3	1	0	0	4
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.0	0.0	0.1
Corridor-S _PSZ-HP-ResBed-S SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	3	1	0	0	4
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _PSZ-HP-ResBed-W DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-W _PSZ-HP-ResBed-W Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Corridor-W _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	1	6	6	3	0	0	0	16
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.2	0.2	0.1	0.0	0.0	0.2
Corridor-W _PSZ-HP-ResBed-W SF-1 Fan Electricity	Electric (kWh)	0	0	0	0	0	1	6	6	4	1	0	0	17
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Entry/Waiting _PSZ-HP-Admin DX Heating Coil Electricity	Electric (kWh)	22	10	7	2	0	0	0	0	0	0	8	21	70
Entry/Waiting _PSZ-HP-Admin Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Entry/Waiting _PSZ-HP-Admin SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Entry/Waiting _PSZ-HP-Admin SAAHP-1 Cooling Coil Electricity	Electric (kWh)	10	24	26	48	64	131	217	206	166	93	25	10	1,021
	Peak (kW)	0.3	0.4	0.3	0.5	0.6	0.8	0.9	0.8	0.8	0.6	0.4	0.2	0.9
Entry/Waiting _PSZ-HP-Admin SF-1 Fan Electricity	Electric (kWh)	62	56	62	60	62	60	62	62	60	62	60	62	728

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 5 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Exam/Storage _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	17	10	10	4	0	0	0	0	0	0	5	15	61
Exam/Storage _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Exam/Storage _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	0	3	6	20	44	44	34	17	3	0	173
	Peak (kW)	0.0	0.0	0.0	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.0	0.2
Exam/Storage _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	11	10	11	10	11	10	11	11	10	11	10	11	125
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	38	24	27	14	2	0	0	0	0	2	17	38	162
Group _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Group _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	5	10	35	76	76	55	27	4	0	291
	Peak (kW)	0.0	0.1	0.1	0.2	0.3	0.4	0.5	0.5	0.5	0.3	0.1	0.0	0.5
Group _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	12	11	12	12	12	12	13	14	13	12	11	12	147
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _PSZ-HP-Common DX Heating Coil Electricity	Electric (kWh)	28	16	18	9	1	0	0	0	0	1	11	27	111
Hospitality _PSZ-HP-Common Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Hospitality _PSZ-HP-Common SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _PSZ-HP-Common SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	2	1	7	12	38	76	76	56	29	5	0	302
	Peak (kW)	0.0	0.1	0.1	0.2	0.2	0.4	0.5	0.5	0.5	0.3	0.1	0.0	0.5
Hospitality _PSZ-HP-Common SF-1 Fan Electricity	Electric (kWh)	22	20	22	21	22	22	25	25	23	22	20	22	267

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 6 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	110	75	82	52	11	1	0	0	0	9	61	110	511
Intake-HR-A _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Intake-HR-A _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	6	4	13	19	62	140	145	115	58	13	2	578
	Peak (kW)	0.2	0.3	0.2	0.4	0.5	0.7	0.9	0.9	0.9	0.7	0.3	0.2	0.9
Intake-HR-A _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	39	35	39	38	39	38	39	39	38	39	38	39	461
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Intake-HR-B _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	10	5	5	2	0	0	0	0	0	0	3	8	33
Intake-HR-B _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Intake-HR-B _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	3	6	18	38	39	30	16	3	0	156
	Peak (kW)	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1	0.0	0.2
Intake-HR-B _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	8	8	8	8	8	8	8	8	8	8	8	8	98
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _PSZ-HP-Kitchen DX Heating Coil Electricity	Electric (kWh)	766	546	577	383	131	48	15	11	49	156	492	799	3,974
Kitchen _PSZ-HP-Kitchen Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Kitchen _PSZ-HP-Kitchen SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 7 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _PSZ-HP-Kitchen SAAHP-1 Cooling Coil Electricity	Electric (kWh)	121	176	178	327	454	947	1,633	1,647	1,293	792	296	118	7,981
	Peak (kW)	2.0	3.1	3.0	4.8	6.3	6.7	7.0	7.1	7.0	6.4	4.1	2.1	7.1
Kitchen _PSZ-HP-Kitchen SF-1 Fan Electricity	Electric (kWh)	359	324	359	347	359	347	359	359	347	359	347	359	4,222
	Peak (kW)	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Lounge _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _PSZ-HP-Common DX Heating Coil Electricity	Electric (kWh)	163	120	129	93	41	14	3	2	8	35	108	168	885
Lounge _PSZ-HP-Common Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Lounge _PSZ-HP-Common SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _PSZ-HP-Common SAAHP-1 Cooling Coil Electricity	Electric (kWh)	5	9	8	18	22	61	129	133	108	59	18	5	575
	Peak (kW)	0.2	0.4	0.3	0.4	0.5	0.8	0.9	0.9	0.9	0.7	0.4	0.2	0.9
Lounge _PSZ-HP-Common SF-1 Fan Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	36	33	36	35	36	35	36	36	35	36	35	36	428
Multipurpose/Dining _PSZ-HP-Common DX Heating Coil Electricity	Electric (kWh)	67	43	47	25	4	0	0	0	0	5	30	67	288
Multipurpose/Dining _PSZ-HP-Common Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Multipurpose/Dining _PSZ-HP-Common SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _PSZ-HP-Common SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	2	2	11	20	64	135	134	98	49	8	0	523
	Peak (kW)	0.1	0.2	0.1	0.3	0.5	0.7	0.9	0.9	0.9	0.6	0.3	0.1	0.9
Multipurpose/Dining _PSZ-HP-Common SF-1 Fan Electricity	Electric (kWh)	22	20	22	20	21	21	24	25	22	22	20	22	261
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _PSZ-HP-ResBed-N DX Heating Coil Electricity	Electric (kWh)	1	0	0	0	0	0	0	0	0	0	0	0	1

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 8 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-N-Corner _PSZ-HP-ResBed-N Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-Corner _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	4	4	10	20	31	49	48	39	24	6	1	236
	Peak (kW)	0.0	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.1	0.1	0.0	0.2
RB-N-Corner _PSZ-HP-ResBed-N SF-1 Fan Electricity	Electric (kWh)	11	10	11	11	12	12	13	13	12	12	11	11	138
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _PSZ-HP-ResBed-N DX Heating Coil Electricity	Electric (kWh)	1	1	0	0	0	0	0	0	0	0	0	1	2
RB-N-East _PSZ-HP-ResBed-N Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-East _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	6	6	17	31	57	93	91	73	45	12	2	434
	Peak (kW)	0.1	0.1	0.1	0.2	0.2	0.3	0.4	0.4	0.4	0.3	0.1	0.1	0.4
RB-N-East _PSZ-HP-ResBed-N SF-1 Fan Electricity	Electric (kWh)	17	15	17	17	18	19	20	20	19	19	17	17	216
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _PSZ-HP-ResBed-N DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	1
RB-N-West _PSZ-HP-ResBed-N Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-N-West _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _PSZ-HP-ResBed-N SAAHP-1 Cooling Coil Electricity	Electric (kWh)	4	13	15	32	59	87	137	136	112	73	21	5	693
	Peak (kW)	0.1	0.2	0.2	0.3	0.3	0.4	0.5	0.5	0.5	0.4	0.2	0.1	0.5
RB-N-West _PSZ-HP-ResBed-N SF-1 Fan Electricity	Electric (kWh)	29	27	29	30	32	33	35	36	34	33	29	29	376
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
RB-S-Corner-N _PSZ-HP-Clinical DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0

Alternative: Title 24 - 2022 Baseline

Calculated at: Jun 29, 2026 - 02:32 PM

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Page 9 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-Corner-N _PSZ-HP-Clinical Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-Corner-N _PSZ-HP-Clinical SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _PSZ-HP-Clinical SAAHP-1 Cooling Coil Electricity	Electric (kWh)	6	10	8	13	18	30	49	50	44	30	12	7	277
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
RB-S-Corner-N _PSZ-HP-Clinical SF-1 Fan Electricity	Electric (kWh)	8	7	8	8	9	9	10	10	9	9	8	8	102
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _PSZ-HP-ResBed-S DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-Corner-S _PSZ-HP-ResBed-S Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-Corner-S _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Electricity	Electric (kWh)	5	10	9	13	20	30	50	51	44	30	11	6	279
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.2
RB-S-Corner-S _PSZ-HP-ResBed-S SF-1 Fan Electricity	Electric (kWh)	10	9	10	10	11	11	12	12	11	11	10	10	124
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _PSZ-HP-ResBed-S DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-East _PSZ-HP-ResBed-S Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-East _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Electricity	Electric (kWh)	11	23	21	34	51	82	132	132	114	79	32	16	727
	Peak (kW)	0.2	0.2	0.2	0.3	0.3	0.4	0.5	0.5	0.5	0.4	0.2	0.2	0.5
RB-S-East _PSZ-HP-ResBed-S SF-1 Fan Electricity	Electric (kWh)	24	23	25	24	26	26	28	29	28	27	24	24	309
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West _PSZ-HP-ResBed-S DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 10 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-West _PSZ-HP-ResBed-S Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-S-West _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West _PSZ-HP-ResBed-S SAAHP-1 Cooling Coil Electricity	Electric (kWh)	2	6	6	10	18	27	44	45	38	25	8	3	232
	Peak (kW)	0.0	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.1	0.1	0.0	0.2
RB-S-West _PSZ-HP-ResBed-S SF-1 Fan Electricity	Electric (kWh)	9	9	10	10	10	10	11	12	11	11	9	10	122
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North _PSZ-HP-ResBed-W DX Heating Coil Electricity	Electric (kWh)	1	0	0	0	0	0	0	0	0	0	0	1	2
RB-W-North _PSZ-HP-ResBed-W Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-North _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Electricity	Electric (kWh)	1	2	3	8	17	29	48	47	37	22	5	1	219
	Peak (kW)	0.0	0.1	0.0	0.1	0.1	0.2	0.2	0.2	0.2	0.1	0.1	0.0	0.2
RB-W-North _PSZ-HP-ResBed-W SF-1 Fan Electricity	Electric (kWh)	10	9	10	9	10	10	11	11	11	10	9	10	120
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South _PSZ-HP-ResBed-W DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-South _PSZ-HP-ResBed-W Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-South _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Crankcase Heater Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
RB-W-South _PSZ-HP-ResBed-W SAAHP-1 Cooling Coil Electricity	Electric (kWh)	24	40	32	40	60	87	141	148	135	99	43	30	881
	Peak (kW)	0.3	0.4	0.3	0.3	0.4	0.5	0.6	0.6	0.7	0.5	0.4	0.3	0.7
RB-W-South _PSZ-HP-ResBed-W SF-1 Fan Electricity	Electric (kWh)	27	26	28	27	30	30	33	33	32	31	28	28	352
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Servery _PSZ-HP-Common DX Heating Coil Electricity	Electric (kWh)	29	18	20	11	1	0	0	0	0	1	12	29	122

Alternative: Title 24 - 2022 Baseline

Calculated at: Jun 29, 2026 - 02:32 PM

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Page 11 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Servery _PSZ-HP-Common Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Servery _PSZ-HP-Common SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery _PSZ-HP-Common SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	4	8	29	61	62	45	23	3	0	237
	Peak (kW)	0.0	0.1	0.0	0.1	0.2	0.3	0.4	0.4	0.4	0.3	0.1	0.0	0.4
Servery _PSZ-HP-Common SF-1 Fan Electricity	Electric (kWh)	10	9	10	9	9	10	11	11	10	10	9	10	116
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _PSZ-HP-ResShwr DX Heating Coil Electricity	Electric (kWh)	73	47	48	25	3	0	0	0	0	4	36	74	310
SHWR-N _PSZ-HP-ResShwr Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
SHWR-N _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	5	9	34	79	76	54	25	4	0	287
	Peak (kW)	0.0	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.3	0.3	0.1	0.0	0.3
SHWR-N _PSZ-HP-ResShwr SF-1 Fan Electricity	Electric (kWh)	12	11	12	12	12	12	12	12	12	12	12	12	145
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _PSZ-HP-ResShwr DX Heating Coil Electricity	Electric (kWh)	67	42	44	26	3	0	0	0	0	4	35	68	291
SHWR-S _PSZ-HP-ResShwr Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
SHWR-S _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	2	1	6	11	36	84	83	61	29	5	0	319

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:32 PM

214

Page 12 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
	Peak (kW)	0.0	0.1	0.1	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.2	0.0	0.3
SHWR-S _PSZ-HP-ResShwr SF-1 Fan Electricity	Electric (kWh)	14	12	14	13	14	13	14	14	13	14	13	14	162
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _PSZ-HP-ResShwr DX Heating Coil Electricity	Electric (kWh)	67	42	42	21	2	0	0	0	0	3	33	68	278
SHWR-W _PSZ-HP-ResShwr Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
SHWR-W _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _PSZ-HP-ResShwr SAAHP-1 Cooling Coil Electricity	Electric (kWh)	0	1	1	5	10	34	80	77	54	25	4	0	289
	Peak (kW)	0.0	0.1	0.1	0.2	0.2	0.3	0.3	0.3	0.3	0.3	0.1	0.0	0.3
SHWR-W _PSZ-HP-ResShwr SF-1 Fan Electricity	Electric (kWh)	12	11	12	12	12	12	12	12	12	12	12	12	141
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _PSZ-HP-Utility DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Support _PSZ-HP-Utility Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Support _PSZ-HP-Utility SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _PSZ-HP-Utility SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	6	4	10	11	39	81	82	72	41	9	3	361
	Peak (kW)	0.3	0.3	0.2	0.3	0.4	0.5	0.7	0.7	0.7	0.6	0.3	0.2	0.7
Support _PSZ-HP-Utility SF-1 Fan Electricity	Electric (kWh)	4	8	6	10	12	26	38	37	33	25	9	5	212
	Peak (kW)	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Utility _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _PSZ-HP-Utility DX Heating Coil Electricity	Electric (kWh)	272	166	183	92	7	0	0	0	0	2	106	259	1,087

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Utility_PSZ-HP-Utility Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Utility_PSZ-HP-Utility SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility_PSZ-HP-Utility SAAHP-1 Cooling Coil Electricity	Electric (kWh)	3	9	5	30	61	223	502	515	402	201	31	3	1,983
	Peak (kW)	0.3	0.7	0.5	1.1	1.5	2.3	2.5	2.5	2.5	2.1	0.9	0.4	2.5
Utility_PSZ-HP-Utility SF-1 Fan Electricity	Electric (kWh)	113	102	113	109	113	109	113	113	109	113	109	113	1,327
	Peak (kW)	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2

***** This report currently does not comprise the total energy consumption for some equipment selections.
VRF, primary boiler electricity, and ancillary energy consumptions are not displayed in the report.
Please contact cdshelp@trane.com for any additional questions***.**

Equipment Energy Consumption

Equipment-Utility

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Interior Lighting	Electric (kWh)	3,100	2,805	3,112	3,006	3,108	3,011	3,103	3,112	3,006	3,104	2,999	3,103	36,568
	Peak (kW)	5.4	7.9	8.8	7.9	8.8	3.7	7.9	7.9	7.1	7.9	4.6	5.4	8.8
Interior Equipment	Electric (kWh)	4,479	4,048	4,491	4,335	4,487	4,345	4,477	4,491	4,335	4,483	4,333	4,477	52,779
	Peak (kW)	9.9	9.9	10.9	10.5	10.9	5.9	10.5	10.5	9.5	10.5	7.8	9.9	10.9

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-1 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-1 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	0	0	1	1	2	3	4	3	2	0	1	18
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-2 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	0	0	0	0	1	2	2	1	1	0	1	9
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Noisy-3 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 15 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
ACT-Noisy-3 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	1	1	0	0	1	2	2	1	1	0	1	11
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-1 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	1	1	1	1	0	0	5
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-2 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	1	2	2	2	1	0	0	8
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ACT-Quiet-3 _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	0	0	0	0	1	1	1	1	1	0	1	7
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Admin _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 16 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Admin _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	1	0	0	1	2	4	5	4	4	1	1	24
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Attrium _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	3	3	2	3	9	15	21	21	19	14	4	3	117
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Chart/Hotel _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	1	1	3	3	3	2	1	0	14
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Comfort/Consult _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	3	3	3	2	0	1	3	3	2	1	2	3	26
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 17 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Corridor-N_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-S_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Corridor-W_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DOAS to Zone Level Equipment Dehum and Reheat DX Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
DOAS to Zone Level Equipment Dehum and Reheat Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
DOAS to Zone Level Equipment Dehum and Reheat SCC-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DOAS to Zone Level Equipment Dehum and Reheat SCC-1 Cooling Coil Electricity	Electric (kWh)	156	130	137	268	381	890	1,797	1,496	1,047	518	206	87	7,114
	Peak (kW)	3.6	2.1	2.2	3.1	4.0	4.8	5.7	6.1	5.9	4.1	2.7	1.8	6.1
DOAS to Zone Level Equipment Dehum and Reheat SF-1 Fan Electricity	Peak (kW)	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
	Electric (kWh)	234	212	234	227	234	227	234	234	227	234	227	234	2,761
Entry/Waiting_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 18 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Entry/Waiting _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Entry/Waiting _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	5	5	7	10	18	27	26	22	15	5	4	147
	Peak (kW)	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.1
Exam/Storage _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Exam/Storage _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	1	1	1	0	1	2	2	2	1	0	1	13
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Group _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	3	3	2	1	0	0	0	0	0	2	4	21
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Hospitality _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	5	3	3	2	1	0	0	0	0	0	3	5	23
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 19 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Intake-HR-A _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-A _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	2	3	1	0	2	7	8	6	4	2	3	42
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Intake-HR-B _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	1	1	0	0	1	2	2	2	1	0	1	12
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _Single Zone CV DX Heating Coil Electricity	Electric (kWh)	1,660	1,293	1,340	945	480	237	104	77	180	487	1,172	1,764	9,739
Kitchen _Single Zone CV Electric Heating Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
Kitchen _Single Zone CV SAAHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Kitchen _Single Zone CV SAAHP-1 Cooling Coil Electricity	Electric (kWh)	53	122	120	303	446	1,059	1,988	1,947	1,483	822	269	52	8,664
	Peak (kW)	2.7	3.9	3.9	5.8	7.3	8.8	10.0	10.1	10.0	7.7	5.1	2.8	10.1
Kitchen _Single Zone CV SF-1 Fan Electricity	Electric (kWh)	730	657	724	688	699	679	717	717	690	709	698	738	8,447
	Peak (kW)	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Lounge _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 20 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Lounge _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Lounge _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	3	3	2	0	1	4	4	4	3	2	4	35
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Multipurpose/Dining _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	8	6	6	4	1	0	0	0	0	1	5	8	39
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-Corner _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	1	3	3	4	4	4	3	1	0	26
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-East _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	1	1	2	5	6	8	8	7	6	2	0	46
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 21 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-N-West _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-N-West _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	1	1	4	8	9	12	12	11	9	3	1	72
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-N _VRFHP-1_SUPPLY FAN Fan Electricity	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Electric (kWh)	1	2	1	2	3	3	4	4	4	4	2	1	30
RB-S-Corner-S _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-Corner-S _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	2	1	2	3	4	5	5	5	4	2	1	34
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-East _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	3	2	4	7	8	11	11	10	10	5	2	74
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 22 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
RB-S-West_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-S-West_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	1	1	2	3	3	4	4	4	3	2	1	28
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-North_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	1	0	1	3	3	4	4	4	3	1	0	25
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RB-W-South_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	7	5	6	9	11	14	14	14	13	7	5	108
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery_VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery_VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Servery_VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	4	3	3	2	0	0	0	0	0	0	2	4	17
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 23 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
SHWR-N _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-N _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	1	0	2	5	6	7	7	6	6	2	0	42
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-S _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	1	3	2	3	5	6	7	7	7	6	4	2	55
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
SHWR-W _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	1	1	3	5	5	7	7	6	6	3	1	44
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

Calculated at: Jun 29, 2026 - 02:25 PM

214

Page 24 of 25

System Equipment

		Jan	Feb	Mar	Apr	May	June	Jul	Aug	Sep	Oct	Nov	Dec	Total
Support _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Support _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	3	4	4	1	0	0	13
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _EXHAUST FAN Fan Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1 Cooling Coil Crankcase Heater Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1 Cooling Coil Electricity	Electric (kWh)	0	0	0	0	0	0	0	0	0	0	0	0	0
	Peak (kW)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Utility _VRFHP-1_SUPPLY FAN Fan Electricity	Electric (kWh)	8	5	6	3	0	6	22	27	23	14	2	6	121
	Peak (kW)	0.1	0.1	0.1	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.1	0.1

***** This report currently does not comprise the total energy consumption for some equipment selections.
VRF, primary boiler electricity, and ancillary energy consumptions are not displayed in the report.
Please contact cdshelp@trane.com for any additional questions***.**

Entered Values Envelope

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Attrium - Wall 756	Gypsum, Gypsum	☐	0.280		50.6	.0	N	☐
Attrium - Wall 757	T24 2022 - Ext Wall - Wood Framed	☐	0.046		31.5	270.0	W	☐
Attrium - Wall 758	T24 2022 - Ext Wall - Wood Framed	☐	0.046		25.1	270.0	W	☐
Attrium - Wall 759	Gypsum, Gypsum	☐	0.280		49.9	.0	N	☐
Attrium - Wall 760	T24 2022 - Ext Wall - Wood Framed	☐	0.046		21.0	180.0	S	☐
Attrium - Wall 761	T24 2022 - Ext Wall - Wood Framed	☐	0.046		39.0	180.0	S	☐
Attrium - Wall 762	T24 2022 - Ext Wall - Wood Framed	☐	0.046		156.0	90.0	E	☐
Attrium - Wall 764	T24 2022 - Ext Wall - Wood Framed	☐	0.046		23.8	.0	N	☐
Attrium - Wall 771	T24 2022 - Ext Wall - Wood Framed	☐	0.046		35.3	.0	N	☐
Attrium 2 - Wall 726	T24 2022 - Ext Wall - Wood Framed	☐	0.046		179.4	180.0	S	☐
Attrium 2 - Wall 727	T24 2022 - Ext Wall - Wood Framed	☐	0.046		178.0	90.0	E	☐
Attrium 2 - Wall 728	T24 2022 - Ext Wall - Wood Framed	☐	0.046		179.4	.0	N	☐
Attrium 2 - Wall 729	T24 2022 - Ext Wall - Wood Framed	☐	0.046		178.0	270.0	W	☐
Comfort Room 1 - Wall 839	T24 2022 - Ext Wall - Wood Framed	☐	0.046		26.9	90.0	E	☐
Comfort Room 2 - Wall 208	T24 2022 - Ext Wall - Wood Framed	☐	0.046		103.5	.0	N	☐
Consult 1 - Wall 119	T24 2022 - Ext Wall - Wood Framed	☐	0.046		115.5	.0	N	☐
Consult 2 - Wall 122	T24 2022 - Ext Wall - Wood Framed	☐	0.046		117.1	.0	N	☐
Corridor 3 - Wall 424	T24 2022 - Ext Wall - Wood Framed	☐	0.046		100.4	.0	N	☐
Corridor 4 - Wall 412	T24 2022 - Ext Wall - Wood Framed	☐	0.046		99.6	270.0	W	☐
Corridor 5 - Wall 402	T24 2022 - Ext Wall - Wood Framed	☐	0.046		101.2	180.0	S	☐
Electric - Wall 40	T24 2022 - Ext Wall - Wood Framed	☐	0.046		229.9	180.0	S	☐
Electric - Wall 835	T24 2022 - Ext Wall - Wood Framed	☐	0.046		128.5	90.0	E	☐
Emergency Electric - Wall 836	T24 2022 - Ext Wall - Wood Framed	☐	0.046		121.0	90.0	E	☐
Entry/Waiting - Wall 311	T24 2022 - Ext Wall - Wood Framed	☐	0.046		108.1	180.0	S	☐
Entry/Waiting - Wall 312	T24 2022 - Ext Wall - Wood Framed	☐	0.046		381.1	90.0	E	☐
Entry/Waiting - Wall 313	T24 2022 - Ext Wall - Wood Framed	☐	0.046		135.8	.0	N	☐
Fire Room - Wall 838	T24 2022 - Ext Wall - Wood Framed	☐	0.046		117.7	90.0	E	☐
Group - Wall 111	T24 2022 - Ext Wall - Wood Framed	☐	0.046		202.5	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Group - Wall 112	T24 2022 - Ext Wall - Wood Framed	☐	0.046		92.7	270.0	W	☐
Hospitality - Wall 13	T24 2022 - Ext Wall - Wood Framed	☐	0.046		164.0	.0	N	☐
Hospitality - Wall 306	T24 2022 - Ext Wall - Wood Framed	☐	0.046		96.0	90.0	E	☐
Interview Room - Wall 26	T24 2022 - Ext Wall - Wood Framed	☐	0.046		182.7	90.0	E	☐
Interview Room - Wall 840	T24 2022 - Ext Wall - Wood Framed	☐	0.046		130.3	180.0	S	☐
Kitchen - Wall 170	T24 2022 - Ext Wall - Wood Framed	☐	0.046		217.8	270.0	W	☐
Lounge - Wall 155	T24 2022 - Ext Wall - Wood Framed	☐	0.046		218.0	180.0	S	☐
Mechanical - Wall 837	T24 2022 - Ext Wall - Wood Framed	☐	0.046		63.7	90.0	E	☐
Multipurpose/Dining - Wall 106	T24 2022 - Ext Wall - Wood Framed	☐	0.046		322.5	.0	N	☐
Noisy Activity 1 - Wall 213	T24 2022 - Ext Wall - Wood Framed	☐	0.046		174.4	270.0	W	☐
Noisy Activity 2 - Wall 260	T24 2022 - Ext Wall - Wood Framed	☐	0.046		92.1	.0	N	☐
Noisy Activity 3 - Wall 301	T24 2022 - Ext Wall - Wood Framed	☐	0.046		161.4	90.6	E	☐
Office 1 - Wall 151	T24 2022 - Ext Wall - Wood Framed	☐	0.046		107.0	180.0	S	☐
Office 2 - Wall 147	T24 2022 - Ext Wall - Wood Framed	☐	0.046		108.0	180.0	S	☐
Quiet Activity 2 - Wall 232	T24 2022 - Ext Wall - Wood Framed	☐	0.046		48.0	180.0	S	☐
Quiet Activity 3 - Wall 265	T24 2022 - Ext Wall - Wood Framed	☐	0.046		128.1	270.0	W	☐
Resident Room 01 - Wall 142	T24 2022 - Ext Wall - Wood Framed	☐	0.046		80.0	90.0	E	☐
Resident Room 02 - Wall 195	T24 2022 - Ext Wall - Wood Framed	☐	0.046		112.5	90.0	E	☐
Resident Room 03 - Wall 199	T24 2022 - Ext Wall - Wood Framed	☐	0.046		136.0	90.0	E	☐
Resident Room 04 - Wall 202	T24 2022 - Ext Wall - Wood Framed	☐	0.046		157.0	180.0	S	☐
Resident Room 04 - Wall 203	T24 2022 - Ext Wall - Wood Framed	☐	0.046		129.0	90.0	E	☐
Resident Room 05 - Wall 227	T24 2022 - Ext Wall - Wood Framed	☐	0.046		159.6	180.0	S	☐
Resident Room 05 - Wall 229	T24 2022 - Ext Wall - Wood Framed	☐	0.046		129.0	270.0	W	☐
Resident Room 06 - Wall 225	T24 2022 - Ext Wall - Wood Framed	☐	0.046		122.2	270.0	W	☐
Resident Room 07 - Wall 236	T24 2022 - Ext Wall - Wood Framed	☐	0.046		124.0	180.0	S	☐
Resident Room 08 - Wall 239	T24 2022 - Ext Wall - Wood Framed	☐	0.046		124.9	180.0	S	☐
Resident Room 09 - Wall 242	T24 2022 - Ext Wall - Wood Framed	☐	0.046		126.4	180.0	S	☐
Resident Room 09 - Wall 244	T24 2022 - Ext Wall - Wood Framed	☐	0.046		158.9	270.0	W	☐
Resident Room 10 - Wall 247	T24 2022 - Ext Wall - Wood Framed	☐	0.046		126.4	.0	N	☐
Resident Room 10 - Wall 248	T24 2022 - Ext Wall - Wood Framed	☐	0.046		161.2	270.0	W	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Resident Room 11 - Wall 269	T24 2022 - Ext Wall - Wood Framed	☐	0.046		126.2	270.0	W	☐
Resident Room 12 - Wall 273	T24 2022 - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 13 - Wall 277	T24 2022 - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 14 - Wall 280	T24 2022 - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 14 - Wall 281	T24 2022 - Ext Wall - Wood Framed	☐	0.046		127.5	270.0	W	☐
Resident Room 15 - Wall 283	T24 2022 - Ext Wall - Wood Framed	☐	0.046		127.5	90.0	E	☐
Resident Room 15 - Wall 284	T24 2022 - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 16 - Wall 288	T24 2022 - Ext Wall - Wood Framed	☐	0.046		124.0	90.0	E	☐
Room 00-80 - Wall 842	T24 2022 - Ext Wall - Wood Framed	☐	0.046		126.8	180.0	S	☐
Room 00-80 - Wall 843	T24 2022 - Ext Wall - Wood Framed	☐	0.046		57.9	90.0	E	☐
Room 00-80 - Wall 846	T24 2022 - Ext Wall - Wood Framed	☐	0.046		111.6	359.5	N	☐
Room 00-80 - Wall 849	T24 2022 - Ext Wall - Wood Framed	☐	0.046		14.8	.0	N	☐
Room 00-80 - Wall 850 - Copy	T24 2022 - Ext Wall - Wood Framed	☐	0.046		50.6	270.4	W	☐
Room 00-81 - Wall 851	T24 2022 - Ext Wall - Wood Framed	☐	0.046		27.6	180.0	S	☐
Room 00-81 - Wall 852	T24 2022 - Ext Wall - Wood Framed	☐	0.046		16.4	270.4	W	☐
Room 00-81 - Wall 853	T24 2022 - Ext Wall - Wood Framed	☐	0.046		18.7	180.0	S	☐
Room 00-81 - Wall 854	T24 2022 - Ext Wall - Wood Framed	☐	0.046		29.1	90.0	E	☐
Room 00-81 - Wall 855	T24 2022 - Ext Wall - Wood Framed	☐	0.046		45.9	.4	N	☐
Room 00-81 - Wall 856	T24 2022 - Ext Wall - Wood Framed	☐	0.046		13.1	271.7	W	☐
Room 01-00 - Wall 566	T24 2022 - Ext Wall - Wood Framed	☐	0.046		5.7	.0	N	☐
Room 01-00 - Wall 567	T24 2022 - Ext Wall - Wood Framed	☐	0.046		44.8	270.0	W	☐
Room 01-00 - Wall 569	Gypsum, Gypsum	☐	0.280		244.1	.0	N	☐
Room 01-00 - Wall 733	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.4	22.7	NE	☐
Room 01-01 - Wall 570	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.0	180.0	S	☐
Room 01-01 - Wall 572	T24 2022 - Ext Wall - Wood Framed	☐	0.046		57.0	270.0	W	☐
Room 01-03 - Wall 584	T24 2022 - Ext Wall - Wood Framed	☐	0.046		53.8	180.0	S	☐
Room 01-03 - Wall 735	Gypsum, Gypsum	☐	0.280		6.6	.0	N	☐
Room 01-03 - Wall 736	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.8	316.5	NW	☐
Room 01-03 - Wall 737	Gypsum, Gypsum	☐	0.280		2.8	.0	N	☐
Room 01-03 - Wall 738	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.3	316.5	NW	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Room 01-04 - Wall 589	T24 2022 - Ext Wall - Wood Framed	☐	0.046		50.6	180.0	S	☐
Room 01-04 - Wall 654	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.8	.0	N	☐
Room 01-06 - Wall 612	T24 2022 - Ext Wall - Wood Framed	☐	0.046		57.4	.0	N	☐
Room 01-06 - Wall 730	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.1	202.7	SW	☐
Room 01-06 - Wall 731	T24 2022 - Ext Wall - Wood Framed	☐	0.046		2.0	199.1	S	☐
Room 01-08 - Wall 773	T24 2022 - Ext Wall - Wood Framed	☐	0.046		22.5	270.0	W	☐
Room 01-08 - Wall 777	T24 2022 - Ext Wall - Wood Framed	☐	0.046		626.0	180.0	S	☐
Room 01-08 - Wall 792	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.1	.0	N	☐
Room 01-10 - Wall 780	T24 2022 - Ext Wall - Wood Framed	☐	0.046		0.9	179.6	S	☐
Room 01-10 - Wall 781	T24 2022 - Ext Wall - Wood Framed	☐	0.046		3.6	90.0	E	☐
Room 01-10 - Wall 782	T24 2022 - Ext Wall - Wood Framed	☐	0.046		3.9	180.0	S	☐
Room 01-10 - Wall 783	T24 2022 - Ext Wall - Wood Framed	☐	0.046		47.6	.0	N	☐
Room 01-12 - Wall 799	T24 2022 - Ext Wall - Wood Framed	☐	0.046		303.7	270.0	W	☐
Room 01-12 - Wall 800	T24 2022 - Ext Wall - Wood Framed	☐	0.046		36.8	180.0	S	☐
Sally Port - Wall 841	T24 2022 - Ext Wall - Wood Framed	☐	0.046		99.2	180.0	S	☐
Servery - Wall 101	T24 2022 - Ext Wall - Wood Framed	☐	0.046		159.9	.0	N	☐
Service - Wall 172	T24 2022 - Ext Wall - Wood Framed	☐	0.046		148.7	180.0	S	☐
Service - Wall 176	T24 2022 - Ext Wall - Wood Framed	☐	0.046		240.5	270.0	W	☐
Shower 1 - Wall 20	T24 2022 - Ext Wall - Wood Framed	☐	0.046		36.6	90.0	E	☐
Shower 2 - Wall 164	T24 2022 - Ext Wall - Wood Framed	☐	0.046		32.1	180.0	S	☐
Shower 3 - Wall 221	T24 2022 - Ext Wall - Wood Framed	☐	0.046		103.4	270.0	W	☐
Shower 4 - Wall 217	T24 2022 - Ext Wall - Wood Framed	☐	0.046		102.8	270.0	W	☐
Shower 5 - Wall 252	T24 2022 - Ext Wall - Wood Framed	☐	0.046		102.1	.0	N	☐
Shower 6 - Wall 256	T24 2022 - Ext Wall - Wood Framed	☐	0.046		102.0	.0	N	☐
Shower 7 - Wall 292	T24 2022 - Ext Wall - Wood Framed	☐	0.046		101.9	90.0	E	☐
Shower 8 - Wall 296	T24 2022 - Ext Wall - Wood Framed	☐	0.046		99.8	90.0	E	☐
Staff Corridor - Wall 390	T24 2022 - Ext Wall - Wood Framed	☐	0.046		77.0	180.0	S	☐
Storage - Wall 116	T24 2022 - Ext Wall - Wood Framed	☐	0.046		32.1	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	C-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Azimuth	Cardinal Direction	Adiabatic
Trash - Wall 179	T24 2022 - Ext Wall - Wood Framed	☐	0.046		96.0	180.0	S	☐

Above Grade Wall Areas

Total Area (ft²)	North Facing Area (ft²)	East Facing Area (ft²)	South Facing Area (ft²)	West Facing Area (ft²)
12,083.5	3,073.6	2,650.9	3,382.2	2,975.2

Interior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Adiabatic
Ante Room - Wall 65	Gypsum, Gypsum	☐	0.280	108.2	☐
Ante Room - Wall 73	Gypsum, Gypsum	☐	0.280	77.0	☐
Attrium - Wall 550	Gypsum, Gypsum	☐	0.280	179.9	☐
Attrium - Wall 557	Gypsum, Gypsum	☐	0.280	98.1	☐
Chart/Hotel - Wall 136	Gypsum, Gypsum	☐	0.280	157.0	☐
Chart/Hotel - Wall 359	Gypsum, Gypsum	☐	0.280	196.3	☐
Chart/Hotel - Wall 507	Gypsum, Gypsum	☐	0.280	49.8	☐
Chart/Hotel - Wall 520	Gypsum, Gypsum	☐	0.280	76.8	☐
Chart/Hotel - Wall 551	Gypsum, Gypsum	☐	0.280	119.5	☐
Chart/Hotel - Wall 552	Gypsum, Gypsum	☐	0.280	107.3	☐
Clean Supply - Wall 347	Gypsum, Gypsum	☐	0.280	105.1	☐
Clean Supply - Wall 365	Gypsum, Gypsum	☐	0.280	105.1	☐
Clean Supply - Wall 90	Gypsum, Gypsum	☐	0.280	154.2	☐
Comfort Room 1 - Wall 54	Gypsum, Gypsum	☐	0.280	97.2	☐
Comfort Room 1 - Wall 56	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 1 - Wall 61	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 2 - Wall 205	Gypsum, Gypsum	☐	0.280	137.5	☐
Consult 1 - Wall 117	Gypsum, Gypsum	☐	0.280	137.5	☐
Consult 2 - Wall 120	Gypsum, Gypsum	☐	0.280	137.5	☐

Corridor 1 - Wall 315	Gypsum, Gypsum	☐	0.280	34.6	☐
Corridor 1 - Wall 317	Gypsum, Gypsum	☐	0.280	198.5	☐
Corridor 1 - Wall 322	Gypsum, Gypsum	☐	0.280	121.6	☐
Corridor 1 - Wall 323	Gypsum, Gypsum	☐	0.280	72.7	☐
Corridor 1 - Wall 324	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 325	Gypsum, Gypsum	☐	0.280	11.3	☐
Corridor 1 - Wall 327	Gypsum, Gypsum	☐	0.280	125.6	☐
Corridor 1 - Wall 369	Gypsum, Gypsum	☐	0.280	78.4	☐
Corridor 2 - Wall 333	Gypsum, Gypsum	☐	0.280	65.7	☐
Corridor 2 - Wall 334	Gypsum, Gypsum	☐	0.280	57.0	☐
Corridor 2 - Wall 336	Gypsum, Gypsum	☐	0.280	117.1	☐
Corridor 2 - Wall 337	Gypsum, Gypsum	☐	0.280	115.5	☐
Corridor 2 - Wall 346	Gypsum, Gypsum	☐	0.280	84.2	☐
Corridor 2 - Wall 348	Gypsum, Gypsum	☐	0.280	124.3	☐
Corridor 2 - Wall 349	Gypsum, Gypsum	☐	0.280	97.2	☐
Corridor 2 - Wall 350	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 2 - Wall 351	Gypsum, Gypsum	☐	0.280	63.0	☐
Corridor 2 - Wall 353	Gypsum, Gypsum	☐	0.280	102.2	☐
Corridor 2 - Wall 358	Gypsum, Gypsum	☐	0.280	78.8	☐
Corridor 2 - Wall 511	Gypsum, Gypsum	☐	0.280	75.8	☐
Corridor 2 - Wall 517	Gypsum, Gypsum	☐	0.280	63.1	☐
Corridor 2 - Wall 554	Gypsum, Gypsum	☐	0.280	287.1	☐
Corridor 2 - Wall 555	Gypsum, Gypsum	☐	0.280	160.4	☐
Corridor 3 - Wall 415	Gypsum, Gypsum	☐	0.280	128.1	☐
Corridor 3 - Wall 418	Gypsum, Gypsum	☐	0.280	101.9	☐
Corridor 3 - Wall 419	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 420	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 421	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 422	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 3 - Wall 423	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 3 - Wall 515	Gypsum, Gypsum	☐	0.280	100.4	☐
Corridor 4 - Wall 405	Gypsum, Gypsum	☐	0.280	173.8	☐
Corridor 4 - Wall 406	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 4 - Wall 407	Gypsum, Gypsum	☐	0.280	102.0	☐

Corridor 4 - Wall 408	Gypsum, Gypsum	☐	0.280	124.9	☐
Corridor 4 - Wall 410	Gypsum, Gypsum	☐	0.280	126.4	☐
Corridor 4 - Wall 556	Gypsum, Gypsum	☐	0.280	99.6	☐
Corridor 5 - Wall 392	Gypsum, Gypsum	☐	0.280	174.4	☐
Corridor 5 - Wall 393	Gypsum, Gypsum	☐	0.280	102.8	☐
Corridor 5 - Wall 394	Gypsum, Gypsum	☐	0.280	130.3	☐
Corridor 5 - Wall 395	Gypsum, Gypsum	☐	0.280	103.4	☐
Corridor 5 - Wall 396	Gypsum, Gypsum	☐	0.280	122.2	☐
Corridor 5 - Wall 397	Gypsum, Gypsum	☐	0.280	129.0	☐
Corridor 5 - Wall 399	Gypsum, Gypsum	☐	0.280	136.0	☐
Corridor 5 - Wall 400	Gypsum, Gypsum	☐	0.280	112.5	☐
Corridor 5 - Wall 401	Gypsum, Gypsum	☐	0.280	124.1	☐
Corridor 5 - Wall 518	Gypsum, Gypsum	☐	0.280	101.2	☐
Electric - Wall 44	Gypsum, Gypsum	☐	0.280	229.9	☐
Entry/Waiting - Wall 304	Gypsum, Gypsum	☐	0.280	91.3	☐
Entry/Waiting - Wall 305	Gypsum, Gypsum	☐	0.280	134.2	☐
Entry/Waiting - Wall 308	Gypsum, Gypsum	☐	0.280	83.5	☐
Entry/Waiting - Wall 309	Gypsum, Gypsum	☐	0.280	119.0	☐
Fire Room - Wall 182	Gypsum, Gypsum	☐	0.280	108.2	☐
Fire Room - Wall 183	Gypsum, Gypsum	☐	0.280	81.2	☐
General Storage - Wall 188	Gypsum, Gypsum	☐	0.280	157.2	☐
General Storage - Wall 378	Gypsum, Gypsum	☐	0.280	110.1	☐
General Storage - Wall 379	Gypsum, Gypsum	☐	0.280	90.6	☐
General Storage - Wall 380	Gypsum, Gypsum	☐	0.280	31.0	☐
General Storage - Wall 381	Gypsum, Gypsum	☐	0.280	66.6	☐
Group - Wall 107	Gypsum, Gypsum	☐	0.280	230.2	☐
Group - Wall 113	Gypsum, Gypsum	☐	0.280	30.9	☐
Group - Wall 114	Gypsum, Gypsum	☐	0.280	137.5	☐
Group - Wall 352	Gypsum, Gypsum	☐	0.280	171.6	☐
Hskp - Wall 385	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 72	Gypsum, Gypsum	☐	0.280	17.4	☐
Intake Corridor - Wall 326	Gypsum, Gypsum	☐	0.280	99.2	☐
Intake Corridor - Wall 33	Gypsum, Gypsum	☐	0.280	62.8	☐
Intake Corridor - Wall 34	Gypsum, Gypsum	☐	0.280	98.8	☐

Intake Corridor - Wall 35	Gypsum, Gypsum	☐	0.280	99.2	☐
Intake Corridor - Wall 36	Gypsum, Gypsum	☐	0.280	83.5	☐
Intake Corridor - Wall 60	Gypsum, Gypsum	☐	0.280	91.0	☐
Intake Corridor - Wall 64	Gypsum, Gypsum	☐	0.280	154.2	☐
Interview Room - Wall 22	Gypsum, Gypsum	☐	0.280	130.3	☐
Interview Room - Wall 30	Gypsum, Gypsum	☐	0.280	126.1	☐
Interview Room - Wall 848	Gypsum, Gypsum	☐	0.280	6.2	☐
IT - Wall 181	Gypsum, Gypsum	☐	0.280	121.2	☐
IT - Wall 389	Gypsum, Gypsum	☐	0.280	203.4	☐
IT - Wall 78	Gypsum, Gypsum	☐	0.280	121.2	☐
IT - Wall 79	Gypsum, Gypsum	☐	0.280	42.9	☐
IT - Wall 80	Gypsum, Gypsum	☐	0.280	124.1	☐
IT - Wall 81	Gypsum, Gypsum	☐	0.280	36.4	☐
Kitchen - Wall 377	Gypsum, Gypsum	☐	0.280	247.2	☐
Laundry - Wall 366	Gypsum, Gypsum	☐	0.280	124.3	☐
Laundry - Wall 87	Gypsum, Gypsum	☐	0.280	154.2	☐
Long Term Belongings Storage - Wall 328	Gypsum, Gypsum	☐	0.280	103.9	☐
Long Term Belongings Storage - Wall 384	Gypsum, Gypsum	☐	0.280	154.2	☐
Long Term Belongings Storage - Wall 68	Gypsum, Gypsum	☐	0.280	154.2	☐
Long Term Belongings Storage - Wall 75	Gypsum, Gypsum	☐	0.280	103.9	☐
Lounge - Wall 154	Gypsum, Gypsum	☐	0.280	140.4	☐
Lounge - Wall 373	Gypsum, Gypsum	☐	0.280	218.0	☐
Mechanical - Wall 185	Gypsum, Gypsum	☐	0.280	229.9	☐
Mechanical - Wall 388	Gypsum, Gypsum	☐	0.280	144.9	☐
Meds - Wall 367	Gypsum, Gypsum	☐	0.280	131.8	☐
Meds - Wall 368	Gypsum, Gypsum	☐	0.280	154.2	☐
Multipurpose/Dining - Wall 102	Gypsum, Gypsum	☐	0.280	187.3	☐
Noisy Activity 1 - Wall 214	Gypsum, Gypsum	☐	0.280	159.6	☐
Noisy Activity 1 - Wall 231	Gypsum, Gypsum	☐	0.280	81.0	☐
Noisy Activity 1 - Wall 519	Gypsum, Gypsum	☐	0.280	78.6	☐
Noisy Activity 2 - Wall 257	Gypsum, Gypsum	☐	0.280	161.2	☐
Noisy Activity 3 - Wall 299	Gypsum, Gypsum	☐	0.280	15.2	☐
Noisy Activity 3 - Wall 414	Gypsum, Gypsum	☐	0.280	176.6	☐
Noisy Activity 3 - Wall 512	Gypsum, Gypsum	☐	0.280	159.0	☐

Office 1 - Wall 150	Gypsum, Gypsum	☐	0.280	140.4	☐
Office 1 - Wall 372	Gypsum, Gypsum	☐	0.280	107.0	☐
Office 2 - Wall 145	Gypsum, Gypsum	☐	0.280	96.2	☐
Office 2 - Wall 370	Gypsum, Gypsum	☐	0.280	108.0	☐
Quiet Activity 1 - Wall 371	Gypsum, Gypsum	☐	0.280	34.1	☐
Quiet Activity 2 - Wall 235	Gypsum, Gypsum	☐	0.280	158.9	☐
Quiet Activity 2 - Wall 404	Gypsum, Gypsum	☐	0.280	129.0	☐
Quiet Activity 2 - Wall 523	Gypsum, Gypsum	☐	0.280	76.8	☐
Quiet Activity 2 - Wall 553	Gypsum, Gypsum	☐	0.280	82.1	☐
Quiet Activity 3 - Wall 261	Gypsum, Gypsum	☐	0.280	81.7	☐
Quiet Activity 3 - Wall 516	Gypsum, Gypsum	☐	0.280	78.9	☐
Resident Room 01 - Wall 140	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 01 - Wall 144	Gypsum, Gypsum	☐	0.280	44.1	☐
Resident Room 01 - Wall 193	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 02 - Wall 197	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 04 - Wall 201	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 04 - Wall 398	Gypsum, Gypsum	☐	0.280	129.0	☐
Resident Room 06 - Wall 222	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 226	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 08 - Wall 238	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 09 - Wall 241	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 09 - Wall 411	Gypsum, Gypsum	☐	0.280	126.4	☐
Resident Room 11 - Wall 266	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 270	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 417	Gypsum, Gypsum	☐	0.280	126.2	☐
Resident Room 13 - Wall 274	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 13 - Wall 278	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 15 - Wall 286	Gypsum, Gypsum	☐	0.280	160.6	☐
Room 01-00 - Wall 563	Gypsum, Gypsum	☐	0.280	48.8	☐
Room 01-03 - Wall 587	Gypsum, Gypsum	☐	0.280	354.4	☐
Room 01-03 - Wall 734	Gypsum, Gypsum	☐	0.280	46.2	☐
Room 01-06 - Wall 604	Gypsum, Gypsum	☐	0.280	4.2	☐
Room 01-06 - Wall 605	Gypsum, Gypsum	☐	0.280	1.5	☐
Room 01-06 - Wall 732	Gypsum, Gypsum	☐	0.280	50.2	☐

Room 01-06 - Wall 775	Gypsum, Gypsum	☐	0.280	330.4	☐
Room 01-08 - Wall 776	Gypsum, Gypsum	☐	0.280	3.9	☐
Room 01-08 - Wall 779	Gypsum, Gypsum	☐	0.280	21.7	☐
Room 01-08 - Wall 795	Gypsum, Gypsum	☐	0.280	57.5	☐
Room 01-10 - Wall 774	Gypsum, Gypsum	☐	0.280	46.7	☐
Sally Port - Wall 59	Gypsum, Gypsum	☐	0.280	28.9	☐
Servery - Wall 97	Gypsum, Gypsum	☐	0.280	230.2	☐
Service - Wall 171	Gypsum, Gypsum	☐	0.280	244.7	☐
Service - Wall 177	Gypsum, Gypsum	☐	0.280	127.4	☐
Service - Wall 178	Gypsum, Gypsum	☐	0.280	96.0	☐
Service - Wall 382	Gypsum, Gypsum	☐	0.280	112.0	☐
Shower 1 - Wall 18	Gypsum, Gypsum	☐	0.280	130.3	☐
Shower 1 - Wall 307	Gypsum, Gypsum	☐	0.280	62.3	☐
Shower 2 - Wall 158	Gypsum, Gypsum	☐	0.280	140.4	☐
Shower 2 - Wall 165	Gypsum, Gypsum	☐	0.280	87.5	☐
Shower 2 - Wall 166	Gypsum, Gypsum	☐	0.280	29.4	☐
Shower 2 - Wall 187	Gypsum, Gypsum	☐	0.280	79.9	☐
Shower 2 - Wall 374	Gypsum, Gypsum	☐	0.280	33.0	☐
Shower 2 - Wall 375	Gypsum, Gypsum	☐	0.280	31.0	☐
Shower 2 - Wall 376	Gypsum, Gypsum	☐	0.280	86.6	☐
Shower 3 - Wall 218	Gypsum, Gypsum	☐	0.280	159.6	☐
Shower 5 - Wall 249	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 253	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 409	Gypsum, Gypsum	☐	0.280	102.1	☐
Shower 7 - Wall 290	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 294	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 298	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 416	Gypsum, Gypsum	☐	0.280	99.8	☐
Soiled Supply - Wall 345	Gypsum, Gypsum	☐	0.280	100.0	☐
Soiled Supply - Wall 363	Gypsum, Gypsum	☐	0.280	100.0	☐
Soiled Supply - Wall 364	Gypsum, Gypsum	☐	0.280	34.7	☐
Soiled Supply - Wall 93	Gypsum, Gypsum	☐	0.280	154.2	☐
Staff Corridor - Wall 386	Gypsum, Gypsum	☐	0.280	128.5	☐
Staff Corridor - Wall 387	Gypsum, Gypsum	☐	0.280	121.0	☐

Stor. - Wall 318	Gypsum, Gypsum	☐	0.280	43.2	☐
Stor. - Wall 319	Gypsum, Gypsum	☐	0.280	26.9	☐
Stor. - Wall 320	Gypsum, Gypsum	☐	0.280	38.3	☐
Stor. - Wall 321	Gypsum, Gypsum	☐	0.280	42.9	☐
Stor. - Wall 330	Gypsum, Gypsum	☐	0.280	60.2	☐
Toilet 2 - Wall 124	Gypsum, Gypsum	☐	0.280	119.5	☐
Toilet 2 - Wall 128	Gypsum, Gypsum	☐	0.280	119.5	☐
Toilet 2 - Wall 344	Gypsum, Gypsum	☐	0.280	84.5	☐
Toilet 2 - Wall 362	Gypsum, Gypsum	☐	0.280	84.5	☐
Toilet 3 - Wall 360	Gypsum, Gypsum	☐	0.280	84.2	☐
Toilet 3 - Wall 361	Gypsum, Gypsum	☐	0.280	119.5	☐
Trash - Wall 383	Gypsum, Gypsum	☐	0.280	128.5	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Ante Room - Roof 111-11	T24-2022 CZ10 Roof	☐	0.034	90.1	0.30	☐
Attrium 2 - Roof 128-00	T24-2022 CZ10 Roof	☐	0.034	174.6	0.30	☐
Attrium 2 - Roof 129-00	T24-2022 CZ10 Roof	☐	0.034	177.3	0.30	☐
Attrium 2 - Roof 130-00	T24-2022 CZ10 Roof	☐	0.034	174.6	0.30	☐
Attrium 2 - Roof 131-00	T24-2022 CZ10 Roof	☐	0.034	177.3	0.30	☐
Chart/Hotel - Roof 110-28	T24-2022 CZ10 Roof	☐	0.034	20.7	0.30	☐
Clean Supply - Roof 105-18	T24-2022 CZ10 Roof	☐	0.034	112.6	0.30	☐
Comfort Room 1 - Roof 10-10	T24-2022 CZ10 Roof	☐	0.034	93.2	0.30	☐
Comfort Room 2 - Roof 124-43	T24-2022 CZ10 Roof	☐	0.034	80.3	0.30	☐
Consult 1 - Roof 122-24	T24-2022 CZ10 Roof	☐	0.034	98.0	0.30	☐
Consult 2 - Roof 123-25	T24-2022 CZ10 Roof	☐	0.034	99.4	0.30	☐
Corridor 1 - Roof 102-68	T24-2022 CZ10 Roof	☐	0.034	318.3	0.30	☐
Corridor 2 - Roof 109-70	T24-2022 CZ10 Roof	☐	0.034	515.6	0.30	☐
Electric - Roof 07-07	T24-2022 CZ10 Roof	☐	0.034	205.3	0.30	☐
Emergency Electric - Roof 08-08	T24-2022 CZ10 Roof	☐	0.034	193.2	0.30	☐
Entry/Waiting - Roof 115-67	T24-2022 CZ10 Roof	☐	0.034	56.1	0.30	☐
Exam Room - Roof 112-12	T24-2022 CZ10 Roof	☐	0.034	134.4	0.30	☐
Fire Room - Roof 09-09	T24-2022 CZ10 Roof	☐	0.034	88.4	0.30	☐
General Storage - Roof 95-39	T24-2022 CZ10 Roof	☐	0.034	106.5	0.30	☐
Group - Roof 120-22	T24-2022 CZ10 Roof	☐	0.034	145.6	0.30	☐
Hospitality - Roof 116-01	T24-2022 CZ10 Roof	☐	0.034	129.5	0.30	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Hskp - Roof 100-14	T24-2022 CZ10 Roof	☐	0.034	64.8	0.30	☐
Intake Corridor - Roof 113-06	T24-2022 CZ10 Roof	☐	0.034	168.9	0.30	☐
Interview Room - Roof 125-04	T24-2022 CZ10 Roof	☐	0.034	119.4	0.30	☐
IT - Roof 99-15	T24-2022 CZ10 Roof	☐	0.034	171.3	0.30	☐
Kitchen - Roof 96-35	T24-2022 CZ10 Roof	☐	0.034	402.3	0.30	☐
Laundry - Roof 104-17	T24-2022 CZ10 Roof	☐	0.034	133.1	0.30	☐
Long Term Belongings Storage - Roof 101-13	T24-2022 CZ10 Roof	☐	0.034	111.2	0.30	☐
Lounge - Roof 93-33	T24-2022 CZ10 Roof	☐	0.034	212.5	0.30	☐
Mechanical - Roof 38-38	T24-2022 CZ10 Roof	☐	0.034	170.1	0.30	☐
Meds - Roof 103-16	T24-2022 CZ10 Roof	☐	0.034	141.1	0.30	☐
Multipurpose/Dining - Roof 119-21	T24-2022 CZ10 Roof	☐	0.034	266.5	0.30	☐
Office 1 - Roof 92-32	T24-2022 CZ10 Roof	☐	0.034	104.3	0.30	☐
Office 2 - Roof 90-31	T24-2022 CZ10 Roof	☐	0.034	105.2	0.30	☐
Resident Room 15 - Roof 62-62	T24-2022 CZ10 Roof	☐	0.034	1.4	0.30	☐
Resident Room 16 - Roof 63-63	T24-2022 CZ10 Roof	☐	0.034	1.3	0.30	☐
Room 00-80 - Roof 137-80	T24-2022 CZ10 Roof	☐	0.034	6.2	0.30	☐
Room 00-81 - Roof 138-81	T24-2022 CZ10 Roof	☐	0.034	3.8	0.30	☐
Room 01-00 - Roof 80-00	T24-2022 CZ10 Roof	☐	0.034	701.7	0.30	☐
Room 01-01 - Roof 81-01	T24-2022 CZ10 Roof	☐	0.034	815.2	0.30	☐
Room 01-03 - Roof 83-03	T24-2022 CZ10 Roof	☐	0.034	1,094.5	0.30	☐
Room 01-04 - Roof 84-04	T24-2022 CZ10 Roof	☐	0.034	1,058.1	0.30	☐
Room 01-06 - Roof 86-06	T24-2022 CZ10 Roof	☐	0.034	1,095.7	0.30	☐
Room 01-08 - Roof 88-08	T24-2022 CZ10 Roof	☐	0.034	1,766.5	0.30	☐
Room 01-10 - Roof 134-10	T24-2022 CZ10 Roof	☐	0.034	862.3	0.30	☐
Room 01-12 - Roof 136-12	T24-2022 CZ10 Roof	☐	0.034	792.1	0.30	☐
Sally Port - Roof 05-05	T24-2022 CZ10 Roof	☐	0.034	86.9	0.30	☐
Servery - Roof 117-20	T24-2022 CZ10 Roof	☐	0.034	124.3	0.30	☐
Service - Roof 97-36	T24-2022 CZ10 Roof	☐	0.034	323.5	0.30	☐
Shower 1 - Roof 126-03	T24-2022 CZ10 Roof	☐	0.034	62.5	0.30	☐
Shower 2 - Roof 94-34	T24-2022 CZ10 Roof	☐	0.034	109.5	0.30	☐
Shower 7 - Roof 64-64	T24-2022 CZ10 Roof	☐	0.034	1.1	0.30	☐
Shower 8 - Roof 65-65	T24-2022 CZ10 Roof	☐	0.034	1.1	0.30	☐
Soiled Supply - Roof 106-19	T24-2022 CZ10 Roof	☐	0.034	107.1	0.30	☐
Staff Corridor - Roof 91-71	T24-2022 CZ10 Roof	☐	0.034	968.1	0.30	☐
Stor. - Roof 118-69	T24-2022 CZ10 Roof	☐	0.034	18.7	0.30	☐
Storage - Roof 121-23	T24-2022 CZ10 Roof	☐	0.034	53.5	0.30	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Reflectivity	Adiabatic
Toilet 1 - Roof 114-02	T24-2022 CZ10 Roof	☐	0.034	52.8	0.30	☐
Toilet 2 - Roof 107-26	T24-2022 CZ10 Roof	☐	0.034	70.1	0.30	☐
Toilet 3 - Roof 108-27	T24-2022 CZ10 Roof	☐	0.034	69.9	0.30	☐
Trash - Roof 98-37	T24-2022 CZ10 Roof	☐	0.034	85.3	0.30	☐

Total Roof Area (ft²) 15,694.9

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	F-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Adiabatic
Ante Room - Slab 11	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	90.1	☐
Attrium - Slab 82	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	469.1	☐
Chart/Hotel - Slab 28	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	214.1	☐
Clean Supply - Slab 18	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	112.6	☐
Comfort Room 1 - Slab 10	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	93.2	☐
Comfort Room 2 - Slab 43	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	91.3	☐
Consult 1 - Slab 24	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	110.2	☐
Consult 2 - Slab 25	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	111.8	☐
Corridor 1 - Slab 68	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	318.3	☐
Corridor 2 - Slab 70	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	685.5	☐
Corridor 2.1 - Slab 81	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	96.0	☐
Corridor 3 - Slab 74	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	439.2	☐
Corridor 4 - Slab 73	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	348.9	☐
Corridor 5 - Slab 72	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	444.2	☐
Electric - Slab 07	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	205.3	☐
Emergency Electric - Slab 08	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	193.2	☐
Entry/Waiting - Slab 67	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	395.5	☐
Exam Room - Slab 12	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	134.4	☐
Fire Room - Slab 09	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	88.4	☐
General Storage - Slab 39	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	106.5	☐
Group - Slab 22	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	294.2	☐
Hospitality - Slab 01	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	262.2	☐
Hskp - Slab 14	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	64.8	☐

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Intake Corridor - Slab 06	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	168.9	☐
Interview Room - Slab 04	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	170.9	☐
IT - Slab 15	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	171.3	☐
Kitchen - Slab 35	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	402.3	☐
Laundry - Slab 17	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	133.1	☐
Long Term Belongings Storage - Slab 13	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	111.2	☐
Lounge - Slab 33	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	212.5	☐
Mechanical - Slab 38	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	170.1	☐
Meds - Slab 16	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	141.1	☐
Multipurpose/Dining - Slab 21	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	508.3	☐
Noisy Activity 1 - Slab 44	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	193.3	☐
Noisy Activity 2 - Slab 56	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	194.6	☐
Noisy Activity 3 - Slab 66	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	195.9	☐
Office 1 - Slab 32	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	104.3	☐
Office 2 - Slab 31	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	105.2	☐
Quiet Activity 1 - Slab 29	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	142.1	☐
Quiet Activity 2 - Slab 49	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	142.4	☐
Quiet Activity 3 - Slab 57	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	142.9	☐
Resident Room 01 - Slab 30	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	135.3	☐
Resident Room 02 - Slab 40	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	122.6	☐
Resident Room 03 - Slab 41	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	148.3	☐
Resident Room 04 - Slab 42	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	140.7	☐
Resident Room 05 - Slab 48	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	143.0	☐
Resident Room 06 - Slab 47	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	135.5	☐
Resident Room 07 - Slab 50	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	136.9	☐
Resident Room 08 - Slab 51	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	137.9	☐
Resident Room 09 - Slab 52	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	139.5	☐
Resident Room 10 - Slab 53	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	141.5	☐
Resident Room 11 - Slab 58	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	140.8	☐
Resident Room 12 - Slab 59	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	138.3	☐
Resident Room 13 - Slab 60	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	138.3	☐
Resident Room 14 - Slab 61	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	142.2	☐
Resident Room 15 - Slab 62	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	142.1	☐
Resident Room 16 - Slab 63	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	138.3	☐
Room 00-80 - Slab 187	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	11.3	☐
Room 00-81 - Slab 190	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	6.3	☐

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Room 01-12 - Slab 182	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		13.0	☐
Room 01-12 - Slab 185	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		161.7	☐
Room 01-12 - Slab 188	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		78.5	☐
Sally Port - Slab 05	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	86.9	☐
Servery - Slab 20	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	244.2	☐
Service - Slab 36	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	323.5	☐
Shower 1 - Slab 03	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	89.4	☐
Shower 2 - Slab 34	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	109.5	☐
Shower 3 - Slab 46	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	114.6	☐
Shower 4 - Slab 45	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	114.0	☐
Shower 5 - Slab 54	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	114.3	☐
Shower 6 - Slab 55	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	114.2	☐
Shower 7 - Slab 64	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	113.6	☐
Shower 8 - Slab 65	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	111.3	☐
Soiled Supply - Slab 19	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	107.1	☐
Staff Corridor - Slab 71	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	968.1	☐
Stor. - Slab 69	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	18.7	☐
Storage - Slab 23	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	60.1	☐
Toilet 1 - Slab 02	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	75.5	☐
Toilet 2 - Slab 26	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	70.1	☐
Toilet 3 - Slab 27	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	69.9	☐
Trash - Slab 37	90.1-13 Min Slab on Grade Unheated Floor, R-15 for 24 in., Zone 4-5	☐		0.520	85.3	☐

* Interzone slabs are not included in the Exterior Slabs subsection. Exposed and Ground Contact Slabs will be shown.

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Electric - Wall 40 - Door 07	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	180.0	S
Emergency Electric - Wall 836 - Door 22	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	90.0	E
Entry/Waiting - Wall 311 - Door 12	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	28.0	180.0	S
Fire Room - Wall 838 - Door 23	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	90.0	E
Lounge - Wall 155 - Door 11	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	180.0	S

Alternative: Title 24 - 2022 Baseline

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Page 15 of 34

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Multipurpose/Dining - Wall 106 - Door 02	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	.0	N
Noisy Activity 1 - Wall 213 - Door 03	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	270.0	W
Noisy Activity 2 - Wall 260 - Door 00	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	.0	N
Noisy Activity 3 - Wall 301 - Door 01	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	21.0	90.6	E
Sally Port - Wall 841 - Door 24	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	25.7	180.0	S
Service - Wall 172 - Door 04	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	49.0	180.0	S
Staff Corridor - Wall 390 - Door 06	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	28.0	180.0	S
Trash - Wall 179 - Door 05	90.1-13 Metal Frame Ent. Door Zone 4-6	0.771	0.407	0.4417	☐	28.0	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Attrium 2 - Wall 726 - Window 41	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	180.0	S
Attrium 2 - Wall 726 - Window 42	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	180.0	S
Attrium 2 - Wall 727 - Window 43	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	90.0	E
Attrium 2 - Wall 727 - Window 44	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	90.0	E
Attrium 2 - Wall 728 - Window 45	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	.0	N
Attrium 2 - Wall 728 - Window 46	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	.0	N
Attrium 2 - Wall 729 - Window 39	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	270.0	W
Attrium 2 - Wall 729 - Window 40	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.1	270.0	W
Comfort Room 2 - Wall 208 - Window 66	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Consult 1 - Wall 119 - Window 68	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Consult 2 - Wall 122 - Window 67	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Corridor 3 - Wall 424 - Window 05	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.7	.0	N
Corridor 4 - Wall 412 - Window 00	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.8	270.0	W
Corridor 5 - Wall 402 - Window 06	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.7	180.0	S
Entry/Waiting - Wall 312 - Window 01	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 02	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 03	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 313 - Window 04	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	64.7	.0	N
Group - Wall 111 - Window 69	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Group - Wall 111 - Window 70	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Lounge - Wall 155 - Window 49	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Lounge - Wall 155 - Window 50	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Multipurpose/Dining - Wall 106 - Window 71	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 72	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 73	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Noisy Activity 1 - Wall 213 - Window 51	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	270.0	W
Noisy Activity 1 - Wall 213 - Window 52	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	270.0	W
Noisy Activity 3 - Wall 301 - Window 65	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	90.6	E
Office 1 - Wall 151 - Window 48	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Office 2 - Wall 147 - Window 47	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Quiet Activity 2 - Wall 232 - Window 53	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Resident Room 01 - Wall 142 - Window 77	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 02 - Wall 195 - Window 76	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 03 - Wall 199 - Window 75	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 04 - Wall 203 - Window 74	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 05 - Wall 229 - Window 58	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 06 - Wall 225 - Window 57	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 07 - Wall 236 - Window 54	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 08 - Wall 239 - Window 55	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 09 - Wall 242 - Window 56	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 10 - Wall 247 - Window 07	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	17.8	.0	N
Resident Room 11 - Wall 269 - Window 59	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 12 - Wall 273 - Window 60	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 13 - Wall 277 - Window 61	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 14 - Wall 281 - Window 62	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 15 - Wall 283 - Window 63	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 16 - Wall 288 - Window 64	T24-2022 CZ10 Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E

Vertical Glazing Areas

Total Area (ft ²)	North Facing Area (ft ²)	East Facing Area (ft ²)	South Facing Area (ft ²)	West Facing Area (ft ²)
1,153.7	265.7	339.9	371.9	176.2

Entered Values Envelope

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Attrium - Wall 756	Gypsum, Gypsum	☐	0.280		50.6	.0	N	☐
Attrium - Wall 757	Casa - Ext Wall - Wood Framed	☐	0.046		31.5	270.0	W	☐
Attrium - Wall 758	Casa - Ext Wall - Wood Framed	☐	0.046		25.1	270.0	W	☐
Attrium - Wall 759	Gypsum, Gypsum	☐	0.280		49.9	.0	N	☐
Attrium - Wall 760	Casa - Ext Wall - Wood Framed	☐	0.046		21.0	180.0	S	☐
Attrium - Wall 761	Casa - Ext Wall - Wood Framed	☐	0.046		39.0	180.0	S	☐
Attrium - Wall 762	Casa - Ext Wall - Wood Framed	☐	0.046		156.0	90.0	E	☐
Attrium - Wall 764	Casa - Ext Wall - Wood Framed	☐	0.046		23.8	.0	N	☐
Attrium - Wall 771	Casa - Ext Wall - Wood Framed	☐	0.046		35.3	.0	N	☐
Attrium 2 - Wall 726	Casa - Ext Wall - Wood Framed	☐	0.046		179.4	180.0	S	☐
Attrium 2 - Wall 727	Casa - Ext Wall - Wood Framed	☐	0.046		178.0	90.0	E	☐
Attrium 2 - Wall 728	Casa - Ext Wall - Wood Framed	☐	0.046		179.4	.0	N	☐
Attrium 2 - Wall 729	Casa - Ext Wall - Wood Framed	☐	0.046		178.0	270.0	W	☐
Comfort Room 1 - Wall 839	Casa - Ext Wall - Wood Framed	☐	0.046		26.9	90.0	E	☐
Comfort Room 2 - Wall 208	Casa - Ext Wall - Wood Framed	☐	0.046		103.5	.0	N	☐
Consult 1 - Wall 119	Casa - Ext Wall - Wood Framed	☐	0.046		115.5	.0	N	☐
Consult 2 - Wall 122	Casa - Ext Wall - Wood Framed	☐	0.046		117.1	.0	N	☐
Corridor 3 - Wall 424	Casa - Ext Wall - Wood Framed	☐	0.046		100.4	.0	N	☐
Corridor 4 - Wall 412	Casa - Ext Wall - Wood Framed	☐	0.046		99.6	270.0	W	☐
Corridor 5 - Wall 402	Casa - Ext Wall - Wood Framed	☐	0.046		101.2	180.0	S	☐
Electric - Wall 40	Casa - Ext Wall - Wood Framed	☐	0.046		229.9	180.0	S	☐
Electric - Wall 835	Casa - Ext Wall - Wood Framed	☐	0.046		128.5	90.0	E	☐
Emergency Electric - Wall 836	Casa - Ext Wall - Wood Framed	☐	0.046		121.0	90.0	E	☐
Entry/Waiting - Wall 311	Casa - Ext Wall - Wood Framed	☐	0.046		108.1	180.0	S	☐
Entry/Waiting - Wall 312	Casa - Ext Wall - Wood Framed	☐	0.046		381.1	90.0	E	☐
Entry/Waiting - Wall 313	Casa - Ext Wall - Wood Framed	☐	0.046		135.8	.0	N	☐
Fire Room - Wall 838	Casa - Ext Wall - Wood Framed	☐	0.046		117.7	90.0	E	☐
Group - Wall 111	Casa - Ext Wall - Wood Framed	☐	0.046		202.5	.0	N	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Group - Wall 112	Casa - Ext Wall - Wood Framed	☐	0.046		92.7	270.0	W	☐
Hospitality - Wall 13	Casa - Ext Wall - Wood Framed	☐	0.046		164.0	.0	N	☐
Hospitality - Wall 306	Casa - Ext Wall - Wood Framed	☐	0.046		96.0	90.0	E	☐
Interview Room - Wall 26	Casa - Ext Wall - Wood Framed	☐	0.046		182.7	90.0	E	☐
Interview Room - Wall 840	Casa - Ext Wall - Wood Framed	☐	0.046		130.3	180.0	S	☐
Kitchen - Wall 170	Casa - Ext Wall - Wood Framed	☐	0.046		217.8	270.0	W	☐
Lounge - Wall 155	Casa - Ext Wall - Wood Framed	☐	0.046		218.0	180.0	S	☐
Mechanical - Wall 837	Casa - Ext Wall - Wood Framed	☐	0.046		63.7	90.0	E	☐
Multipurpose/Dining - Wall 106	Casa - Ext Wall - Wood Framed	☐	0.046		322.5	.0	N	☐
Noisy Activity 1 - Wall 213	Casa - Ext Wall - Wood Framed	☐	0.046		174.4	270.0	W	☐
Noisy Activity 2 - Wall 260	Casa - Ext Wall - Wood Framed	☐	0.046		92.1	.0	N	☐
Noisy Activity 3 - Wall 301	Casa - Ext Wall - Wood Framed	☐	0.046		161.4	90.6	E	☐
Office 1 - Wall 151	Casa - Ext Wall - Wood Framed	☐	0.046		107.0	180.0	S	☐
Office 2 - Wall 147	Casa - Ext Wall - Wood Framed	☐	0.046		108.0	180.0	S	☐
Quiet Activity 2 - Wall 232	Casa - Ext Wall - Wood Framed	☐	0.046		48.0	180.0	S	☐
Quiet Activity 3 - Wall 265	Casa - Ext Wall - Wood Framed	☐	0.046		128.1	270.0	W	☐
Resident Room 01 - Wall 142	Casa - Ext Wall - Wood Framed	☐	0.046		80.0	90.0	E	☐
Resident Room 02 - Wall 195	Casa - Ext Wall - Wood Framed	☐	0.046		112.5	90.0	E	☐
Resident Room 03 - Wall 199	Casa - Ext Wall - Wood Framed	☐	0.046		136.0	90.0	E	☐
Resident Room 04 - Wall 202	Casa - Ext Wall - Wood Framed	☐	0.046		157.0	180.0	S	☐
Resident Room 04 - Wall 203	Casa - Ext Wall - Wood Framed	☐	0.046		129.0	90.0	E	☐
Resident Room 05 - Wall 227	Casa - Ext Wall - Wood Framed	☐	0.046		159.6	180.0	S	☐
Resident Room 05 - Wall 229	Casa - Ext Wall - Wood Framed	☐	0.046		129.0	270.0	W	☐
Resident Room 06 - Wall 225	Casa - Ext Wall - Wood Framed	☐	0.046		122.2	270.0	W	☐
Resident Room 07 - Wall 236	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	180.0	S	☐
Resident Room 08 - Wall 239	Casa - Ext Wall - Wood Framed	☐	0.046		124.9	180.0	S	☐
Resident Room 09 - Wall 242	Casa - Ext Wall - Wood Framed	☐	0.046		126.4	180.0	S	☐
Resident Room 09 - Wall 244	Casa - Ext Wall - Wood Framed	☐	0.046		158.9	270.0	W	☐
Resident Room 10 - Wall 247	Casa - Ext Wall - Wood Framed	☐	0.046		126.4	.0	N	☐
Resident Room 10 - Wall 248	Casa - Ext Wall - Wood Framed	☐	0.046		161.2	270.0	W	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Resident Room 11 - Wall 269	Casa - Ext Wall - Wood Framed	☐	0.046		126.2	270.0	W	☐
Resident Room 12 - Wall 273	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 13 - Wall 277	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	270.0	W	☐
Resident Room 14 - Wall 280	Casa - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 14 - Wall 281	Casa - Ext Wall - Wood Framed	☐	0.046		127.5	270.0	W	☐
Resident Room 15 - Wall 283	Casa - Ext Wall - Wood Framed	☐	0.046		127.5	90.0	E	☐
Resident Room 15 - Wall 284	Casa - Ext Wall - Wood Framed	☐	0.046		160.6	.0	N	☐
Resident Room 16 - Wall 288	Casa - Ext Wall - Wood Framed	☐	0.046		124.0	90.0	E	☐
Room 00-80 - Wall 842	Casa - Ext Wall - Wood Framed	☐	0.046		126.8	180.0	S	☐
Room 00-80 - Wall 843	Casa - Ext Wall - Wood Framed	☐	0.046		57.9	90.0	E	☐
Room 00-80 - Wall 846	Casa - Ext Wall - Wood Framed	☐	0.046		111.6	359.5	N	☐
Room 00-80 - Wall 849	Casa - Ext Wall - Wood Framed	☐	0.046		14.8	.0	N	☐
Room 00-80 - Wall 850 - Copy	Casa - Ext Wall - Wood Framed	☐	0.046		50.6	270.4	W	☐
Room 00-81 - Wall 851	Casa - Ext Wall - Wood Framed	☐	0.046		27.6	180.0	S	☐
Room 00-81 - Wall 852	Casa - Ext Wall - Wood Framed	☐	0.046		16.4	270.4	W	☐
Room 00-81 - Wall 853	Casa - Ext Wall - Wood Framed	☐	0.046		18.7	180.0	S	☐
Room 00-81 - Wall 854	Casa - Ext Wall - Wood Framed	☐	0.046		29.1	90.0	E	☐
Room 00-81 - Wall 855	Casa - Ext Wall - Wood Framed	☐	0.046		45.9	.4	N	☐
Room 00-81 - Wall 856	Casa - Ext Wall - Wood Framed	☐	0.046		13.1	271.7	W	☐
Room 01-00 - Wall 566	Casa - Ext Wall - Wood Framed	☐	0.046		5.7	.0	N	☐
Room 01-00 - Wall 567	Casa - Ext Wall - Wood Framed	☐	0.046		44.8	270.0	W	☐
Room 01-00 - Wall 569	Gypsum, Gypsum	☐	0.280		244.1	.0	N	☐
Room 01-00 - Wall 733	Casa - Ext Wall - Wood Framed	☐	0.046		0.4	22.7	NE	☐
Room 01-01 - Wall 570	Casa - Ext Wall - Wood Framed	☐	0.046		0.0	180.0	S	☐
Room 01-01 - Wall 572	Casa - Ext Wall - Wood Framed	☐	0.046		57.0	270.0	W	☐
Room 01-03 - Wall 584	Casa - Ext Wall - Wood Framed	☐	0.046		53.8	180.0	S	☐
Room 01-03 - Wall 735	Gypsum, Gypsum	☐	0.280		6.6	.0	N	☐
Room 01-03 - Wall 736	Casa - Ext Wall - Wood Framed	☐	0.046		0.8	316.5	NW	☐
Room 01-03 - Wall 737	Gypsum, Gypsum	☐	0.280		2.8	.0	N	☐
Room 01-03 - Wall 738	Casa - Ext Wall - Wood Framed	☐	0.046		0.3	316.5	NW	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	C-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Azimuth	Cardinal Direction	Adiabatic
Room 01-04 - Wall 589	Casa - Ext Wall - Wood Framed	☐	0.046		50.6	180.0	S	☐
Room 01-04 - Wall 654	Casa - Ext Wall - Wood Framed	☐	0.046		0.8	.0	N	☐
Room 01-06 - Wall 612	Casa - Ext Wall - Wood Framed	☐	0.046		57.4	.0	N	☐
Room 01-06 - Wall 730	Casa - Ext Wall - Wood Framed	☐	0.046		0.1	202.7	SW	☐
Room 01-06 - Wall 731	Casa - Ext Wall - Wood Framed	☐	0.046		2.0	199.1	S	☐
Room 01-08 - Wall 773	Casa - Ext Wall - Wood Framed	☐	0.046		22.5	270.0	W	☐
Room 01-08 - Wall 777	Casa - Ext Wall - Wood Framed	☐	0.046		626.0	180.0	S	☐
Room 01-08 - Wall 792	Casa - Ext Wall - Wood Framed	☐	0.046		0.1	.0	N	☐
Room 01-10 - Wall 780	Casa - Ext Wall - Wood Framed	☐	0.046		0.9	179.6	S	☐
Room 01-10 - Wall 781	Casa - Ext Wall - Wood Framed	☐	0.046		3.6	90.0	E	☐
Room 01-10 - Wall 782	Casa - Ext Wall - Wood Framed	☐	0.046		3.9	180.0	S	☐
Room 01-10 - Wall 783	Casa - Ext Wall - Wood Framed	☐	0.046		47.6	.0	N	☐
Room 01-12 - Wall 799	Casa - Ext Wall - Wood Framed	☐	0.046		303.7	270.0	W	☐
Room 01-12 - Wall 800	Casa - Ext Wall - Wood Framed	☐	0.046		36.8	180.0	S	☐
Sally Port - Wall 841	Casa - Ext Wall - Wood Framed	☐	0.046		99.2	180.0	S	☐
Servery - Wall 101	Casa - Ext Wall - Wood Framed	☐	0.046		159.9	.0	N	☐
Service - Wall 172	Casa - Ext Wall - Wood Framed	☐	0.046		148.7	180.0	S	☐
Service - Wall 176	Casa - Ext Wall - Wood Framed	☐	0.046		240.5	270.0	W	☐
Shower 1 - Wall 20	Casa - Ext Wall - Wood Framed	☐	0.046		36.6	90.0	E	☐
Shower 2 - Wall 164	Casa - Ext Wall - Wood Framed	☐	0.046		32.1	180.0	S	☐
Shower 3 - Wall 221	Casa - Ext Wall - Wood Framed	☐	0.046		103.4	270.0	W	☐
Shower 4 - Wall 217	Casa - Ext Wall - Wood Framed	☐	0.046		102.8	270.0	W	☐
Shower 5 - Wall 252	Casa - Ext Wall - Wood Framed	☐	0.046		102.1	.0	N	☐
Shower 6 - Wall 256	Casa - Ext Wall - Wood Framed	☐	0.046		102.0	.0	N	☐
Shower 7 - Wall 292	Casa - Ext Wall - Wood Framed	☐	0.046		101.9	90.0	E	☐
Shower 8 - Wall 296	Casa - Ext Wall - Wood Framed	☐	0.046		99.8	90.0	E	☐
Staff Corridor - Wall 390	Casa - Ext Wall - Wood Framed	☐	0.046		77.0	180.0	S	☐
Storage - Wall 116	Casa - Ext Wall - Wood Framed	☐	0.046		32.1	.0	N	☐

Exterior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	C-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Azimuth	Cardinal Direction	Adiabatic
Trash - Wall 179	Casa - Ext Wall - Wood Framed	☐	0.046		96.0	180.0	S	☐

Above Grade Wall Areas

Total Area (ft²)	North Facing Area (ft²)	East Facing Area (ft²)	South Facing Area (ft²)	West Facing Area (ft²)
12,083.5	3,073.6	2,650.9	3,382.2	2,975.2

Interior Walls

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Adiabatic
Ante Room - Wall 60	Gypsum, Gypsum	☐	0.280	91.0	☐
Ante Room - Wall 65	Gypsum, Gypsum	☐	0.280	108.2	☐
Attrium - Wall 550	Gypsum, Gypsum	☐	0.280	179.9	☐
Attrium - Wall 556	Gypsum, Gypsum	☐	0.280	99.6	☐
Chart/Hotel - Wall 136	Gypsum, Gypsum	☐	0.280	157.0	☐
Chart/Hotel - Wall 520	Gypsum, Gypsum	☐	0.280	76.8	☐
Chart/Hotel - Wall 551	Gypsum, Gypsum	☐	0.280	119.5	☐
Chart/Hotel - Wall 552	Gypsum, Gypsum	☐	0.280	107.3	☐
Clean Supply - Wall 93	Gypsum, Gypsum	☐	0.280	154.2	☐
Comfort Room 1 - Wall 56	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 1 - Wall 61	Gypsum, Gypsum	☐	0.280	108.2	☐
Comfort Room 2 - Wall 205	Gypsum, Gypsum	☐	0.280	137.5	☐
Comfort Room 2 - Wall 299	Gypsum, Gypsum	☐	0.280	15.2	☐
Comfort Room 2 - Wall 333	Gypsum, Gypsum	☐	0.280	65.7	☐
Comfort Room 2 - Wall 334	Gypsum, Gypsum	☐	0.280	57.0	☐
Comfort Room 2 - Wall 511	Gypsum, Gypsum	☐	0.280	75.8	☐
Consult 2 - Wall 120	Gypsum, Gypsum	☐	0.280	137.5	☐
Corridor 1 - Wall 315	Gypsum, Gypsum	☐	0.280	34.6	☐
Corridor 1 - Wall 317	Gypsum, Gypsum	☐	0.280	198.5	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Corridor 1 - Wall 322	Gypsum, Gypsum	☐	0.280	121.6	☐
Corridor 1 - Wall 323	Gypsum, Gypsum	☐	0.280	72.7	☐
Corridor 1 - Wall 324	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 325	Gypsum, Gypsum	☐	0.280	11.3	☐
Corridor 1 - Wall 326	Gypsum, Gypsum	☐	0.280	99.2	☐
Corridor 1 - Wall 327	Gypsum, Gypsum	☐	0.280	125.6	☐
Corridor 1 - Wall 328	Gypsum, Gypsum	☐	0.280	103.9	☐
Corridor 1 - Wall 330	Gypsum, Gypsum	☐	0.280	60.2	☐
Corridor 1 - Wall 350	Gypsum, Gypsum	☐	0.280	101.2	☐
Corridor 1 - Wall 369	Gypsum, Gypsum	☐	0.280	78.4	☐
Corridor 2 - Wall 336	Gypsum, Gypsum	☐	0.280	117.1	☐
Corridor 2 - Wall 337	Gypsum, Gypsum	☐	0.280	115.5	☐
Corridor 2 - Wall 344	Gypsum, Gypsum	☐	0.280	84.5	☐
Corridor 2 - Wall 345	Gypsum, Gypsum	☐	0.280	100.0	☐
Corridor 2 - Wall 346	Gypsum, Gypsum	☐	0.280	84.2	☐
Corridor 2 - Wall 347	Gypsum, Gypsum	☐	0.280	105.1	☐
Corridor 2 - Wall 348	Gypsum, Gypsum	☐	0.280	124.3	☐
Corridor 2 - Wall 351	Gypsum, Gypsum	☐	0.280	63.0	☐
Corridor 2 - Wall 352	Gypsum, Gypsum	☐	0.280	171.6	☐
Corridor 2 - Wall 353	Gypsum, Gypsum	☐	0.280	102.2	☐
Corridor 2 - Wall 358	Gypsum, Gypsum	☐	0.280	78.8	☐
Corridor 2 - Wall 507	Gypsum, Gypsum	☐	0.280	49.8	☐
Corridor 2 - Wall 512	Gypsum, Gypsum	☐	0.280	159.0	☐
Corridor 2 - Wall 515	Gypsum, Gypsum	☐	0.280	100.4	☐
Corridor 2 - Wall 516	Gypsum, Gypsum	☐	0.280	78.9	☐
Corridor 2 - Wall 517	Gypsum, Gypsum	☐	0.280	63.1	☐
Corridor 2 - Wall 554	Gypsum, Gypsum	☐	0.280	287.1	☐
Corridor 2 - Wall 555	Gypsum, Gypsum	☐	0.280	160.4	☐
Corridor 3 - Wall 418	Gypsum, Gypsum	☐	0.280	101.9	☐
Corridor 3 - Wall 421	Gypsum, Gypsum	☐	0.280	124.0	☐
Corridor 3 - Wall 422	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 3 - Wall 423	Gypsum, Gypsum	☐	0.280	127.5	☐
Corridor 5 - Wall 394	Gypsum, Gypsum	☐	0.280	130.3	☐
Corridor 5 - Wall 395	Gypsum, Gypsum	☐	0.280	103.4	☐

Corridor 5 - Wall 398	Gypsum, Gypsum	☐	0.280	129.0	☐
Corridor 5 - Wall 399	Gypsum, Gypsum	☐	0.280	136.0	☐
Corridor 5 - Wall 400	Gypsum, Gypsum	☐	0.280	112.5	☐
Corridor 5 - Wall 401	Gypsum, Gypsum	☐	0.280	124.1	☐
Corridor 5 - Wall 518	Gypsum, Gypsum	☐	0.280	101.2	☐
Electric - Wall 386	Gypsum, Gypsum	☐	0.280	128.5	☐
Electric - Wall 44	Gypsum, Gypsum	☐	0.280	229.9	☐
Emergency Electric - Wall 387	Gypsum, Gypsum	☐	0.280	121.0	☐
Entry/Waiting - Wall 304	Gypsum, Gypsum	☐	0.280	91.3	☐
Entry/Waiting - Wall 305	Gypsum, Gypsum	☐	0.280	134.2	☐
Exam Room - Wall 68	Gypsum, Gypsum	☐	0.280	154.2	☐
Group - Wall 107	Gypsum, Gypsum	☐	0.280	230.2	☐
Group - Wall 113	Gypsum, Gypsum	☐	0.280	30.9	☐
Group - Wall 114	Gypsum, Gypsum	☐	0.280	137.5	☐
Hskp - Wall 385	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 72	Gypsum, Gypsum	☐	0.280	17.4	☐
Hskp - Wall 73	Gypsum, Gypsum	☐	0.280	77.0	☐
Hskp - Wall 75	Gypsum, Gypsum	☐	0.280	103.9	☐
Hskp - Wall 78	Gypsum, Gypsum	☐	0.280	121.2	☐
Intake Corridor - Wall 33	Gypsum, Gypsum	☐	0.280	62.8	☐
Intake Corridor - Wall 64	Gypsum, Gypsum	☐	0.280	154.2	☐
IT - Wall 181	Gypsum, Gypsum	☐	0.280	121.2	☐
IT - Wall 389	Gypsum, Gypsum	☐	0.280	203.4	☐
IT - Wall 79	Gypsum, Gypsum	☐	0.280	42.9	☐
IT - Wall 80	Gypsum, Gypsum	☐	0.280	124.1	☐
IT - Wall 81	Gypsum, Gypsum	☐	0.280	36.4	☐
Kitchen - Wall 165	Gypsum, Gypsum	☐	0.280	87.5	☐
Kitchen - Wall 166	Gypsum, Gypsum	☐	0.280	29.4	☐
Kitchen - Wall 171	Gypsum, Gypsum	☐	0.280	244.7	☐
Kitchen - Wall 188	Gypsum, Gypsum	☐	0.280	157.2	☐
Kitchen - Wall 377	Gypsum, Gypsum	☐	0.280	247.2	☐
Laundry - Wall 90	Gypsum, Gypsum	☐	0.280	154.2	☐
Lounge - Wall 154	Gypsum, Gypsum	☐	0.280	140.4	☐
Lounge - Wall 158	Gypsum, Gypsum	☐	0.280	140.4	☐

Lounge - Wall 373	Gypsum, Gypsum	☐	0.280	218.0	☐
Mechanical - Wall 182	Gypsum, Gypsum	☐	0.280	108.2	☐
Mechanical - Wall 183	Gypsum, Gypsum	☐	0.280	81.2	☐
Mechanical - Wall 185	Gypsum, Gypsum	☐	0.280	229.9	☐
Mechanical - Wall 388	Gypsum, Gypsum	☐	0.280	144.9	☐
Meds - Wall 349	Gypsum, Gypsum	☐	0.280	97.2	☐
Meds - Wall 367	Gypsum, Gypsum	☐	0.280	131.8	☐
Meds - Wall 368	Gypsum, Gypsum	☐	0.280	154.2	☐
Meds - Wall 87	Gypsum, Gypsum	☐	0.280	154.2	☐
Multipurpose/Dining - Wall 102	Gypsum, Gypsum	☐	0.280	187.3	☐
Multipurpose/Dining - Wall 318	Gypsum, Gypsum	☐	0.280	43.2	☐
Multipurpose/Dining - Wall 319	Gypsum, Gypsum	☐	0.280	26.9	☐
Noisy Activity 1 - Wall 214	Gypsum, Gypsum	☐	0.280	159.6	☐
Noisy Activity 1 - Wall 231	Gypsum, Gypsum	☐	0.280	81.0	☐
Noisy Activity 1 - Wall 392	Gypsum, Gypsum	☐	0.280	174.4	☐
Noisy Activity 1 - Wall 519	Gypsum, Gypsum	☐	0.280	78.6	☐
Noisy Activity 2 - Wall 257	Gypsum, Gypsum	☐	0.280	161.2	☐
Noisy Activity 2 - Wall 405	Gypsum, Gypsum	☐	0.280	173.8	☐
Noisy Activity 2 - Wall 557	Gypsum, Gypsum	☐	0.280	98.1	☐
Noisy Activity 3 - Wall 414	Gypsum, Gypsum	☐	0.280	176.6	☐
Office 1 - Wall 150	Gypsum, Gypsum	☐	0.280	140.4	☐
Office 1 - Wall 372	Gypsum, Gypsum	☐	0.280	107.0	☐
Office 2 - Wall 144	Gypsum, Gypsum	☐	0.280	44.1	☐
Office 2 - Wall 145	Gypsum, Gypsum	☐	0.280	96.2	☐
Office 2 - Wall 370	Gypsum, Gypsum	☐	0.280	108.0	☐
Quiet Activity 2 - Wall 235	Gypsum, Gypsum	☐	0.280	158.9	☐
Quiet Activity 2 - Wall 404	Gypsum, Gypsum	☐	0.280	129.0	☐
Quiet Activity 2 - Wall 523	Gypsum, Gypsum	☐	0.280	76.8	☐
Quiet Activity 2 - Wall 553	Gypsum, Gypsum	☐	0.280	82.1	☐
Quiet Activity 3 - Wall 261	Gypsum, Gypsum	☐	0.280	81.7	☐
Quiet Activity 3 - Wall 415	Gypsum, Gypsum	☐	0.280	128.1	☐
Resident Room 01 - Wall 140	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 01 - Wall 193	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 02 - Wall 197	Gypsum, Gypsum	☐	0.280	157.0	☐

Resident Room 04 - Wall 201	Gypsum, Gypsum	☐	0.280	157.0	☐
Resident Room 05 - Wall 397	Gypsum, Gypsum	☐	0.280	129.0	☐
Resident Room 06 - Wall 222	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 226	Gypsum, Gypsum	☐	0.280	159.6	☐
Resident Room 06 - Wall 396	Gypsum, Gypsum	☐	0.280	122.2	☐
Resident Room 07 - Wall 238	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 07 - Wall 406	Gypsum, Gypsum	☐	0.280	124.0	☐
Resident Room 08 - Wall 408	Gypsum, Gypsum	☐	0.280	124.9	☐
Resident Room 09 - Wall 241	Gypsum, Gypsum	☐	0.280	158.9	☐
Resident Room 09 - Wall 411	Gypsum, Gypsum	☐	0.280	126.4	☐
Resident Room 10 - Wall 410	Gypsum, Gypsum	☐	0.280	126.4	☐
Resident Room 11 - Wall 266	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 270	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 11 - Wall 417	Gypsum, Gypsum	☐	0.280	126.2	☐
Resident Room 12 - Wall 274	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 12 - Wall 419	Gypsum, Gypsum	☐	0.280	124.0	☐
Resident Room 13 - Wall 278	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 286	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 290	Gypsum, Gypsum	☐	0.280	160.6	☐
Resident Room 16 - Wall 420	Gypsum, Gypsum	☐	0.280	124.0	☐
Room 00-80 - Wall 848	Gypsum, Gypsum	☐	0.280	6.2	☐
Room 01-00 - Wall 563	Gypsum, Gypsum	☐	0.280	48.8	☐
Room 01-03 - Wall 734	Gypsum, Gypsum	☐	0.280	46.2	☐
Room 01-04 - Wall 587	Gypsum, Gypsum	☐	0.280	354.4	☐
Room 01-06 - Wall 604	Gypsum, Gypsum	☐	0.280	4.2	☐
Room 01-06 - Wall 605	Gypsum, Gypsum	☐	0.280	1.5	☐
Room 01-06 - Wall 732	Gypsum, Gypsum	☐	0.280	50.2	☐
Room 01-06 - Wall 775	Gypsum, Gypsum	☐	0.280	330.4	☐
Room 01-08 - Wall 776	Gypsum, Gypsum	☐	0.280	3.9	☐
Room 01-08 - Wall 779	Gypsum, Gypsum	☐	0.280	21.7	☐
Room 01-10 - Wall 774	Gypsum, Gypsum	☐	0.280	46.7	☐
Room 01-12 - Wall 795	Gypsum, Gypsum	☐	0.280	57.5	☐
Sally Port - Wall 30	Gypsum, Gypsum	☐	0.280	126.1	☐
Sally Port - Wall 35	Gypsum, Gypsum	☐	0.280	99.2	☐

Sally Port - Wall 54	Gypsum, Gypsum	☐	0.280	97.2	☐
Sally Port - Wall 59	Gypsum, Gypsum	☐	0.280	28.9	☐
Servery - Wall 320	Gypsum, Gypsum	☐	0.280	38.3	☐
Servery - Wall 321	Gypsum, Gypsum	☐	0.280	42.9	☐
Servery - Wall 97	Gypsum, Gypsum	☐	0.280	230.2	☐
Service - Wall 177	Gypsum, Gypsum	☐	0.280	127.4	☐
Service - Wall 178	Gypsum, Gypsum	☐	0.280	96.0	☐
Shower 1 - Wall 22	Gypsum, Gypsum	☐	0.280	130.3	☐
Shower 1 - Wall 307	Gypsum, Gypsum	☐	0.280	62.3	☐
Shower 1 - Wall 34	Gypsum, Gypsum	☐	0.280	98.8	☐
Shower 2 - Wall 187	Gypsum, Gypsum	☐	0.280	79.9	☐
Shower 2 - Wall 374	Gypsum, Gypsum	☐	0.280	33.0	☐
Shower 2 - Wall 375	Gypsum, Gypsum	☐	0.280	31.0	☐
Shower 2 - Wall 376	Gypsum, Gypsum	☐	0.280	86.6	☐
Shower 4 - Wall 218	Gypsum, Gypsum	☐	0.280	159.6	☐
Shower 4 - Wall 393	Gypsum, Gypsum	☐	0.280	102.8	☐
Shower 5 - Wall 249	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 253	Gypsum, Gypsum	☐	0.280	161.2	☐
Shower 5 - Wall 409	Gypsum, Gypsum	☐	0.280	102.1	☐
Shower 6 - Wall 407	Gypsum, Gypsum	☐	0.280	102.0	☐
Shower 8 - Wall 294	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 298	Gypsum, Gypsum	☐	0.280	160.6	☐
Shower 8 - Wall 416	Gypsum, Gypsum	☐	0.280	99.8	☐
Staff Corridor - Wall 359	Gypsum, Gypsum	☐	0.280	196.3	☐
Staff Corridor - Wall 360	Gypsum, Gypsum	☐	0.280	84.2	☐
Staff Corridor - Wall 361	Gypsum, Gypsum	☐	0.280	119.5	☐
Staff Corridor - Wall 362	Gypsum, Gypsum	☐	0.280	84.5	☐
Staff Corridor - Wall 363	Gypsum, Gypsum	☐	0.280	100.0	☐
Staff Corridor - Wall 364	Gypsum, Gypsum	☐	0.280	34.7	☐
Staff Corridor - Wall 365	Gypsum, Gypsum	☐	0.280	105.1	☐
Staff Corridor - Wall 366	Gypsum, Gypsum	☐	0.280	124.3	☐
Staff Corridor - Wall 371	Gypsum, Gypsum	☐	0.280	34.1	☐
Staff Corridor - Wall 378	Gypsum, Gypsum	☐	0.280	110.1	☐
Staff Corridor - Wall 379	Gypsum, Gypsum	☐	0.280	90.6	☐

Staff Corridor - Wall 380	Gypsum, Gypsum	☐	0.280	31.0	☐
Staff Corridor - Wall 381	Gypsum, Gypsum	☐	0.280	66.6	☐
Staff Corridor - Wall 382	Gypsum, Gypsum	☐	0.280	112.0	☐
Staff Corridor - Wall 383	Gypsum, Gypsum	☐	0.280	128.5	☐
Staff Corridor - Wall 384	Gypsum, Gypsum	☐	0.280	154.2	☐
Storage - Wall 117	Gypsum, Gypsum	☐	0.280	137.5	☐
Toilet 1 - Wall 18	Gypsum, Gypsum	☐	0.280	130.3	☐
Toilet 1 - Wall 308	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 1 - Wall 309	Gypsum, Gypsum	☐	0.280	119.0	☐
Toilet 1 - Wall 36	Gypsum, Gypsum	☐	0.280	83.5	☐
Toilet 2 - Wall 124	Gypsum, Gypsum	☐	0.280	119.5	☐
Toilet 3 - Wall 128	Gypsum, Gypsum	☐	0.280	119.5	☐

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Ante Room - Roof 111-11	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	90.1	0.00	☐
Attrium 2 - Roof 128-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	174.6	0.00	☐
Attrium 2 - Roof 129-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	177.3	0.00	☐
Attrium 2 - Roof 130-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	174.6	0.00	☐
Attrium 2 - Roof 131-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	177.3	0.00	☐
Chart/Hotel - Roof 110-28	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	20.7	0.00	☐
Clean Supply - Roof 105-18	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	112.6	0.00	☐
Comfort Room 1 - Roof 10-10	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	93.2	0.00	☐
Comfort Room 2 - Roof 124-43	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	80.3	0.00	☐
Consult 1 - Roof 122-24	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	98.0	0.00	☐
Consult 2 - Roof 123-25	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	99.4	0.00	☐
Corridor 1 - Roof 102-68	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	318.3	0.00	☐
Corridor 2 - Roof 109-70	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	515.6	0.00	☐
Electric - Roof 07-07	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	205.3	0.00	☐
Emergency Electric - Roof 08-08	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	193.2	0.00	☐
Entry/Waiting - Roof 115-67	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	56.1	0.00	☐
Exam Room - Roof 112-12	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	134.4	0.00	☐
Fire Room - Roof 09-09	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	88.4	0.00	☐
General Storage - Roof 95-39	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	106.5	0.00	☐
Group - Roof 120-22	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	145.6	0.00	☐
Hospitality - Roof 116-01	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	129.5	0.00	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Hskp - Roof 100-14	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	64.8	0.00	☐
Intake Corridor - Roof 113-06	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	168.9	0.00	☐
Interview Room - Roof 125-04	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	119.4	0.00	☐
IT - Roof 99-15	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	171.3	0.00	☐
Kitchen - Roof 96-35	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	402.3	0.00	☐
Laundry - Roof 104-17	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	133.1	0.00	☐
Long Term Belongings Storage - Roof 101-13	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	111.2	0.00	☐
Lounge - Roof 93-33	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	212.5	0.00	☐
Mechanical - Roof 38-38	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	170.1	0.00	☐
Meds - Roof 103-16	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	141.1	0.00	☐
Multipurpose/Dining - Roof 119-21	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	266.5	0.00	☐
Office 1 - Roof 92-32	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	104.3	0.00	☐
Office 2 - Roof 90-31	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	105.2	0.00	☐
Resident Room 15 - Roof 62-62	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.4	0.00	☐
Resident Room 16 - Roof 63-63	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.3	0.00	☐
Room 00-80 - Roof 137-80	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	6.2	0.00	☐
Room 00-81 - Roof 138-81	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	3.8	0.00	☐
Room 01-00 - Roof 80-00	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	701.7	0.00	☐
Room 01-01 - Roof 81-01	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	815.2	0.00	☐
Room 01-03 - Roof 83-03	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,094.5	0.00	☐
Room 01-04 - Roof 84-04	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,058.1	0.00	☐
Room 01-06 - Roof 86-06	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1,095.7	0.00	☐
Room 01-10 - Roof 134-10	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	862.3	0.00	☐
Room 01-12 - Roof 136-12	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	792.1	0.00	☐
Sally Port - Roof 05-05	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	86.9	0.00	☐
Servery - Roof 117-20	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	124.3	0.00	☐
Service - Roof 97-36	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	323.5	0.00	☐
Shower 1 - Roof 126-03	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	62.5	0.00	☐
Shower 2 - Roof 94-34	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	109.5	0.00	☐
Shower 7 - Roof 64-64	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.1	0.00	☐
Shower 8 - Roof 65-65	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	1.1	0.00	☐
Soiled Supply - Roof 106-19	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	107.1	0.00	☐
Staff Corridor - Roof 91-71	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	968.1	0.00	☐
Stor. - Roof 118-69	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	18.7	0.00	☐
Storage - Roof 121-23	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	53.5	0.00	☐
Toilet 1 - Roof 114-02	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	52.8	0.00	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Roofs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Reflectivity	Adiabatic
Toilet 2 - Roof 107-26	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	70.1	0.00	☐
Toilet 3 - Roof 108-27	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	69.9	0.00	☐
Trash - Roof 98-37	Casa - Roof - Single Ply over Tapered Insulation	☐	0.026	85.3	0.00	☐

Total Roof Area (ft²) 13,928.4

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Ante Room - Slab 11	Casa - Slab on Grade	☐		0.730	90.1	☐
Attrium - Slab 82	Casa - Slab on Grade	☐		0.730	469.1	☐
Chart/Hotel - Slab 28	Casa - Slab on Grade	☐		0.730	214.1	☐
Clean Supply - Slab 18	Casa - Slab on Grade	☐		0.730	112.6	☐
Comfort Room 1 - Slab 10	Casa - Slab on Grade	☐		0.730	93.2	☐
Comfort Room 2 - Slab 43	Casa - Slab on Grade	☐		0.730	91.3	☐
Consult 1 - Slab 24	Casa - Slab on Grade	☐		0.730	110.2	☐
Consult 2 - Slab 25	Casa - Slab on Grade	☐		0.730	111.8	☐
Corridor 1 - Slab 68	Casa - Slab on Grade	☐		0.730	318.3	☐
Corridor 2 - Slab 70	Casa - Slab on Grade	☐		0.730	685.5	☐
Corridor 2.1 - Slab 81	Casa - Slab on Grade	☐		0.730	96.0	☐
Corridor 3 - Slab 74	Casa - Slab on Grade	☐		0.730	439.2	☐
Corridor 4 - Slab 73	Casa - Slab on Grade	☐		0.730	348.9	☐
Corridor 5 - Slab 72	Casa - Slab on Grade	☐		0.730	444.2	☐
Electric - Slab 07	Casa - Slab on Grade	☐		0.730	205.3	☐
Emergency Electric - Slab 08	Casa - Slab on Grade	☐		0.730	193.2	☐
Entry/Waiting - Slab 67	Casa - Slab on Grade	☐		0.730	395.5	☐
Exam Room - Slab 12	Casa - Slab on Grade	☐		0.730	134.4	☐
Fire Room - Slab 09	Casa - Slab on Grade	☐		0.730	88.4	☐
General Storage - Slab 39	Casa - Slab on Grade	☐		0.730	106.5	☐
Group - Slab 22	Casa - Slab on Grade	☐		0.730	294.2	☐
Hospitality - Slab 01	Casa - Slab on Grade	☐		0.730	262.2	☐
Hskp - Slab 14	Casa - Slab on Grade	☐		0.730	64.8	☐
Intake Corridor - Slab 06	Casa - Slab on Grade	☐		0.730	168.9	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft²--°F)	F-Factor (BTU/h--ft²--°F)	Gross Area (ft²)	Adiabatic
Interview Room - Slab 04	Casa - Slab on Grade	☐		0.730	170.9	☐
IT - Slab 15	Casa - Slab on Grade	☐		0.730	171.3	☐
Kitchen - Slab 35	Casa - Slab on Grade	☐		0.730	402.3	☐
Laundry - Slab 17	Casa - Slab on Grade	☐		0.730	133.1	☐
Long Term Belongings Storage - Slab 13	Casa - Slab on Grade	☐		0.730	111.2	☐
Lounge - Slab 33	Casa - Slab on Grade	☐		0.730	212.5	☐
Mechanical - Slab 38	Casa - Slab on Grade	☐		0.730	170.1	☐
Meds - Slab 16	Casa - Slab on Grade	☐		0.730	141.1	☐
Multipurpose/Dining - Slab 21	Casa - Slab on Grade	☐		0.730	508.3	☐
Noisy Activity 1 - Slab 44	Casa - Slab on Grade	☐		0.730	193.3	☐
Noisy Activity 2 - Slab 56	Casa - Slab on Grade	☐		0.730	194.6	☐
Noisy Activity 3 - Slab 66	Casa - Slab on Grade	☐		0.730	195.9	☐
Office 1 - Slab 32	Casa - Slab on Grade	☐		0.730	104.3	☐
Office 2 - Slab 31	Casa - Slab on Grade	☐		0.730	105.2	☐
Quiet Activity 1 - Slab 29	Casa - Slab on Grade	☐		0.730	142.1	☐
Quiet Activity 2 - Slab 49	Casa - Slab on Grade	☐		0.730	142.4	☐
Quiet Activity 3 - Slab 57	Casa - Slab on Grade	☐		0.730	142.9	☐
Resident Room 01 - Slab 30	Casa - Slab on Grade	☐		0.730	135.3	☐
Resident Room 02 - Slab 40	Casa - Slab on Grade	☐		0.730	122.6	☐
Resident Room 03 - Slab 41	Casa - Slab on Grade	☐		0.730	148.3	☐
Resident Room 04 - Slab 42	Casa - Slab on Grade	☐		0.730	140.7	☐
Resident Room 05 - Slab 48	Casa - Slab on Grade	☐		0.730	143.0	☐
Resident Room 06 - Slab 47	Casa - Slab on Grade	☐		0.730	135.5	☐
Resident Room 07 - Slab 50	Casa - Slab on Grade	☐		0.730	136.9	☐
Resident Room 08 - Slab 51	Casa - Slab on Grade	☐		0.730	137.9	☐
Resident Room 09 - Slab 52	Casa - Slab on Grade	☐		0.730	139.5	☐
Resident Room 10 - Slab 53	Casa - Slab on Grade	☐		0.730	141.5	☐
Resident Room 11 - Slab 58	Casa - Slab on Grade	☐		0.730	140.8	☐
Resident Room 12 - Slab 59	Casa - Slab on Grade	☐		0.730	138.3	☐
Resident Room 13 - Slab 60	Casa - Slab on Grade	☐		0.730	138.3	☐
Resident Room 14 - Slab 61	Casa - Slab on Grade	☐		0.730	142.2	☐
Resident Room 15 - Slab 62	Casa - Slab on Grade	☐		0.730	142.1	☐
Resident Room 16 - Slab 63	Casa - Slab on Grade	☐		0.730	138.3	☐
Room 00-80 - Slab 187	Casa - Slab on Grade	☐		0.730	11.3	☐
Room 00-81 - Slab 190	Casa - Slab on Grade	☐		0.730	6.3	☐
Room 01-12 - Slab 182	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		13.0	☐

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Slabs

Name	Construction Type	Below Grade	U-Factor (BTU/h--ft ² --°F)	F-Factor (BTU/h--ft ² --°F)	Gross Area (ft ²)	Adiabatic
Room 01-12 - Slab 185	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		161.7	☐
Room 01-12 - Slab 188	90.1-13 Min Floors, Steel Joist Zone 5	☐	0.038		78.5	☐
Sally Port - Slab 05	Casa - Slab on Grade	☐		0.730	86.9	☐
Servery - Slab 20	Casa - Slab on Grade	☐		0.730	244.2	☐
Service - Slab 36	Casa - Slab on Grade	☐		0.730	323.5	☐
Shower 1 - Slab 03	Casa - Slab on Grade	☐		0.730	89.4	☐
Shower 2 - Slab 34	Casa - Slab on Grade	☐		0.730	109.5	☐
Shower 3 - Slab 46	Casa - Slab on Grade	☐		0.730	114.6	☐
Shower 4 - Slab 45	Casa - Slab on Grade	☐		0.730	114.0	☐
Shower 5 - Slab 54	Casa - Slab on Grade	☐		0.730	114.3	☐
Shower 6 - Slab 55	Casa - Slab on Grade	☐		0.730	114.2	☐
Shower 7 - Slab 64	Casa - Slab on Grade	☐		0.730	113.6	☐
Shower 8 - Slab 65	Casa - Slab on Grade	☐		0.730	111.3	☐
Soiled Supply - Slab 19	Casa - Slab on Grade	☐		0.730	107.1	☐
Staff Corridor - Slab 71	Casa - Slab on Grade	☐		0.730	968.1	☐
Stor. - Slab 69	Casa - Slab on Grade	☐		0.730	18.7	☐
Storage - Slab 23	Casa - Slab on Grade	☐		0.730	60.1	☐
Toilet 1 - Slab 02	Casa - Slab on Grade	☐		0.730	75.5	☐
Toilet 2 - Slab 26	Casa - Slab on Grade	☐		0.730	70.1	☐
Toilet 3 - Slab 27	Casa - Slab on Grade	☐		0.730	69.9	☐
Trash - Slab 37	Casa - Slab on Grade	☐		0.730	85.3	☐

* Interzone slabs are not included in the Exterior Slabs subsection. Exposed and Ground Contact Slabs will be shown.

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Electric - Wall 40 - Door 07	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	180.0	S
Emergency Electric - Wall 836 - Door 22	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.0	E
Entry/Waiting - Wall 311 - Door 12	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S
Fire Room - Wall 838 - Door 23	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.0	E
Lounge - Wall 155 - Door 11	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	180.0	S
Multipurpose/Dining - Wall 106 - Door 02	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	.0	N

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Doors

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Noisy Activity 1 - Wall 213 - Door 03	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	270.0	W
Noisy Activity 2 - Wall 260 - Door 00	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	.0	N
Noisy Activity 3 - Wall 301 - Door 01	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	21.0	90.6	E
Sally Port - Wall 841 - Door 24	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	25.7	180.0	S
Service - Wall 172 - Door 04	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	49.0	180.0	S
Staff Corridor - Wall 390 - Door 06	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S
Trash - Wall 179 - Door 05	Casa - Ext Door Swinging	0.579	0.000	0.0000	☐	28.0	180.0	S

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft ² --°F)	SHGC	Visible Transmittance	Shade Control	Area (ft ²)	Azimuth	Cardinal Direction
Attrium 2 - Wall 726 - Window 41	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	180.0	S
Attrium 2 - Wall 726 - Window 42	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	180.0	S
Attrium 2 - Wall 727 - Window 43	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	90.0	E
Attrium 2 - Wall 727 - Window 44	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	90.0	E
Attrium 2 - Wall 728 - Window 45	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	.0	N
Attrium 2 - Wall 728 - Window 46	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	.0	N
Attrium 2 - Wall 729 - Window 39	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	270.0	W
Attrium 2 - Wall 729 - Window 40	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.1	270.0	W
Comfort Room 2 - Wall 208 - Window 66	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Consult 1 - Wall 119 - Window 68	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Consult 2 - Wall 122 - Window 67	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Corridor 3 - Wall 424 - Window 05	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.7	.0	N
Corridor 4 - Wall 412 - Window 00	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.8	270.0	W
Corridor 5 - Wall 402 - Window 06	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.7	180.0	S
Entry/Waiting - Wall 312 - Window 01	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 02	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 312 - Window 03	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.8	90.0	E
Entry/Waiting - Wall 313 - Window 04	Casa - Fixed Window	0.360	0.250	0.4213	☐	64.7	.0	N
Group - Wall 111 - Window 69	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Group - Wall 111 - Window 70	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Lounge - Wall 155 - Window 49	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Lounge - Wall 155 - Window 50	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Exterior Windows

Name	Construction Type	U-Factor (BTU/h--ft²--°F)	SHGC	Visible Transmittance	Shade Control	Area (ft²)	Azimuth	Cardinal Direction
Multipurpose/Dining - Wall 106 - Window 71	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 72	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Multipurpose/Dining - Wall 106 - Window 73	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	.0	N
Noisy Activity 1 - Wall 213 - Window 51	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	270.0	W
Noisy Activity 1 - Wall 213 - Window 52	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	270.0	W
Noisy Activity 3 - Wall 301 - Window 65	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	90.6	E
Office 1 - Wall 151 - Window 48	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Office 2 - Wall 147 - Window 47	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Quiet Activity 2 - Wall 232 - Window 53	Casa - Fixed Window	0.360	0.250	0.4213	☐	7.8	180.0	S
Resident Room 01 - Wall 142 - Window 77	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 02 - Wall 195 - Window 76	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 03 - Wall 199 - Window 75	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 04 - Wall 203 - Window 74	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 05 - Wall 229 - Window 58	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 06 - Wall 225 - Window 57	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 07 - Wall 236 - Window 54	Casa - Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 08 - Wall 239 - Window 55	Casa - Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 09 - Wall 242 - Window 56	Casa - Fixed Window	0.360	0.250	0.4213	☐	17.8	180.0	S
Resident Room 10 - Wall 247 - Window 07	Casa - Fixed Window	0.360	0.250	0.4213	☐	17.8	.0	N
Resident Room 11 - Wall 269 - Window 59	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 12 - Wall 273 - Window 60	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 13 - Wall 277 - Window 61	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 14 - Wall 281 - Window 62	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	270.0	W
Resident Room 15 - Wall 283 - Window 63	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E
Resident Room 16 - Wall 288 - Window 64	Casa - Fixed Window	0.360	0.250	0.4213	☐	10.1	90.0	E

Vertical Glazing Areas

Total Area (ft²)	North Facing Area (ft²)	East Facing Area (ft²)	South Facing Area (ft²)	West Facing Area (ft²)
1,153.7	265.7	339.9	371.9	176.2

Room Information Entered Values

Room Type Templates

Room Type: Unconditioned Interstitial Space and Duct Chases

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Schedule: Available (100%)

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(9):

Room 00-80

Room 01-03

Room 01-08

Room 01-00

Room 01-04

Room 01-10

Room 01-01

Room 01-06

Room 01-12

Room Type: T24 - PRTF – Atrium

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.59

Number of Fixtures:

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1-19 Public Assembly Spaces - Lobbies

Standard: ASHRAE 62.1 and 170

Type: Lobby (Hotel)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-13 Lobby - Hotel

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Attrium

Attrium 2

Entry/Waiting

Room Type: T24 - PRTF – Resident Bedroom

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 275

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.62

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1-07 Hotel/Motel/Resort/Dormitory - Bedroom/Living Room

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Cafeteria/FF Dining

Schedule: Small Hotel Dining Area - Occupancy

Latent Load (Btuh): 275

Sensible Radiant: 58%

Type: 90.1-13 Dining Area - All Other Dining

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel Dining Elec - Plug Loads

Schedule: Small Hotel Dining Area - Plug Loads

Radiant: 40%

Lost Heat: 20%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(16):

Resident Room 01

Resident Room 04

Resident Room 07

Resident Room 10

Resident Room 13

Resident Room 02

Resident Room 05

Resident Room 08

Resident Room 11

Resident Room 14

Resident Room 03

Resident Room 06

Resident Room 09

Resident Room 12

Resident Room 15

Room Type: T24 - PRTF – Corridor**People Load Name:** People Load #001**Activity:** Walking, Standing**Percent Floor Area:** 100%**Sensible Load (Btuh):** 250**Density (ft²/person):** 0**Light Load Name:** Light Load #001**Configuration:** Recessed Fluorescent, Parabolic Louver, Non-Vented, T8**Percent Floor Area:** 100%**Heat into Return Air:** 31%**Density (W/ft²):** 0.66**Ventilation Type:** 62.1-16 General - Corridors**Standard:** ASHRAE 62.1 and 170**Infiltration: Flow Rate:** 0.07 ACH**Room Exhaust: Flow Rate:** 0.0 cfm**Design Airflow: Cooling Supply Flow Rate:** Auto-Sized**Type:** Corridor (Public Spaces)**Schedule:** Small Hotel - Occupancy**Latent Load (Btuh):** 250**Sensible Radiant:** 58%**Type:** 90.1-13 Corridor - All Other Corridors**Schedule:** Small Hotel - Lighting**Thermal Radiation:** 22%**Visible Radiation** 20%**Schedule:** Available (100%)**People Based Rate:** 0.0 cfm/person**Area Based Rate:** 0.06 cfm/ft²**Schedule:** Small Hotel - Infiltration**Schedule:** Available (100%)**Heating Design Flow Rate:** Auto-Sized**Unmodified Rooms(8):**

Corridor 1

Corridor 2

Corridor 2.1

Corridor 3

Corridor 4

Corridor 5

Intake Corridor

Staff Corridor

Room Type: T24 - PRTF – Toilet Room**People Load Name:** People Load #001**Activity:** Seated, Very Light Work**Percent Floor Area:** 100%**Sensible Load (Btuh):** 245**Density (ft²/person):** 50**Light Load Name:** Light Load #001**Configuration:** Recessed Fluorescent, Parabolic Louver, Non-Vented, T8**Percent Floor Area:** 100%**Heat into Return Air:** 31%**Density (W/ft²):** 0.75**Misc Eq Load Name:** Misc. Equipment #001**Type:** General Restroom**Schedule:** Small Hotel - Occupancy**Latent Load (Btuh):** 155**Sensible Radiant:** 60%**Type:** 90.1-13 Restroom - All Other Restrooms**Schedule:** Small Hotel - Lighting**Thermal Radiation:** 22%**Visible Radiation** 20%**Type:** Small Hotel - Plug Loads (Whole Building)

Modeling Method: Load and Energy

Schedule: Small Hotel - Plug Loads

Percent Floor Area: 100%

Latent: 0%

Radiant: 40%

Lost Heat: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1 None

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Infiltration: Flow Rate: 0.13 ACH

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 2.0 cfm/ft²

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Shower 1
Shower 4
Shower 7
Toilet 2

Shower 2
Shower 5
Shower 8
Toilet 3

Shower 3
Shower 6
Toilet 1

Room Type: T24 - PRTF – MEP Room

Light Load Name: Light Load #001

Type: 90.1-13 Electrical/Mechanical Room

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Schedule: Small Hotel - Lighting

Percent Floor Area: 100%

Heat into Return Air: 31%

Thermal Radiation: 22%

Visible Radiation: 20%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Type: Casa - MEP

Modeling Method: Load and Energy

Schedule: Small Hotel - Elevators

Percent Floor Area: 100%

Latent: 0%

Radiant: 0%

Lost Heat: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1 None

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Infiltration: Flow Rate: 0.0 ACH

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(5):

Electric

Emergency Electric

Fire Room

Room Type: T24 - PRTF – Utility/Storage

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.48

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.25

Ventilation Type: 62.1-13 Office Buildings - Occupiable Storage Rooms for Dry Materials

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Ante Room
Hskp
Meds
Storage

Clean Supply
Laundry
Service
Trash

General Storage
Long Term Belongings Storage
Stor.

Room Type: T24 - PRTF – Assembly/Dining

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Type: Lobby (Hotel)

Schedule: Small Hotel Employee Lounge - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 60%

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.65

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Food and Beverage - Restaurant Dining Rooms

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: 90.1-13 Lounge/Breakroom - All Other Lounges/Breakrooms

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Group
Multipurpose/Dining

Hospitality
Room 00-81

Lounge
Servery

Room Type: T24 - PRTF – Exam/Treatment

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.99

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.75

Type: Cafeteria/FF Dining

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Ventilation Type: 62.1-19 Outpatient Health Care Facilities - General examination room

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Infiltration: Flow Rate: 0.0 ACH

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(7):

Comfort Room 1
Consult 2
Sally Port

Comfort Room 2
Exam Room

Consult 1
Interview Room

Room Type: T24 - PRTF – Office/Admin

People Load Name: People Load #001

Type: Office

Activity: Seated at Theater

Schedule: Small Hotel - Occupancy

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Latent Load (Btuh): 200

Sensible Radiant: 58%

Density (ft²/person): 100

Light Load Name: Light Load #001

Type: 90.1-13 Electrical/Mechanical Room

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Schedule: Small Hotel - Lighting

Percent Floor Area: 100%

Heat into Return Air: 31%

Thermal Radiation: 22%

Visible Radiation: 20%

Density (W/ft²): 0.73

Misc Eq Load Name: Misc. Equipment #001

Type: Casa - Office/Admin

Modeling Method: Load and Energy

Schedule: Small Hotel - Elevators

Percent Floor Area: 100%

Latent: 0%

Radiant: 0%

Lost Heat: 0%

Utility Type: Electric

Density (W/ft²): 1

Ventilation Type: 62.1-13 Office Buildings - Office Space

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Infiltration: Flow Rate: 0.13 ACH

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Chart/Hotel

Office 1

Office 2

Room Type: T24 - PRTF – Resident Activity

People Load Name: People Load #001

Activity: Moderately Active Office Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.73

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Hotel/Motel/Resort/Dormitory - Multipurpose Assembly

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office - Conference Room

Schedule: Small Hotel Meeting Room - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Conference/Meeting

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Noisy Activity 1

Quiet Activity 1

Noisy Activity 2

Quiet Activity 2

Noisy Activity 3

Quiet Activity 3

Room Type: T24 - PRTF – Kitchen

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 33

Light Load Name: Light Load #001

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-13 Lobby - Elevator

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.21

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 17

Ventilation Type: 62.1-19 Food and Beverage Service - Kitchen (cooking)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room: Soiled Supply

Room Type: T24 - PRTF – Utility/Storage

Room Exhaust: Flow Rate: 1.0 cfm/ft²

Schedule: Available (100%)

Room: Kitchen

Room Type: T24 - PRTF – Kitchen

Room Exhaust: Flow Rate: 2,500.0 cfm

Schedule: Casa Exhaust

Design Airflow: Cooling Supply Flow Rate: 2,500.0 cfm

Heating Design Flow Rate: 2,500.0 cfm

Room Information Entered Values

Room Type Templates

Room Type: Unconditioned Interstitial Space and Duct Chases

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Schedule: Available (100%)

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(9):

Room 00-80

Room 01-03

Room 01-08

Room 01-00

Room 01-04

Room 01-10

Room 01-01

Room 01-06

Room 01-12

Room Type: PRTF – Atrium

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.6

Number of Fixtures:

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1-19 Public Assembly Spaces - Lobbies

Standard: ASHRAE 62.1 and 170

Type: Lobby (Hotel)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-13 Lobby - Hotel

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Attrium

Attrium 2

Entry/Waiting

Room Type: PRTF – Resident Activity

People Load Name: People Load #001

Activity: Moderately Active Office Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Hotel/Motel/Resort/Dormitory - Multipurpose Assembly

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Office - Conference Room

Schedule: Small Hotel Meeting Room - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Conference/Meeting

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Noisy Activity 1

Quiet Activity 1

Noisy Activity 2

Quiet Activity 2

Noisy Activity 3

Quiet Activity 3

Room Type: PRTF – MEP Room

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - MEP

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(5):

Electric

Emergency Electric

Fire Room

IT

Mechanical

Room Type: PRTF – Corridor

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 0

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.4

Ventilation Type: 62.1-16 General - Corridors

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.07 ACH

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-13 Corridor - All Other Corridors

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Room Exhaust: Flow Rate: 0.0 cfm

Schedule: Available (100%)

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(8):

Corridor 1
Corridor 3
Intake Corridor

Corridor 2
Corridor 4
Staff Corridor

Corridor 2.1
Corridor 5

Room Type: PRTF – Toilet Room

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 245

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0

Ventilation Type: 62.1 None

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 2.0 cfm/ft²

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: General Restroom

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 155

Sensible Radiant: 60%

Type: 90.1-13 Restroom - All Other Restrooms

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.0 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Shower 1
Shower 4
Shower 7
Toilet 2

Shower 2
Shower 5
Shower 8
Toilet 3

Shower 3
Shower 6
Toilet 1

Room Type: PRTF – Resident Bedroom

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 275

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.2

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 2

Ventilation Type: 62.1-07 Hotel/Motel/Resort/Dormitory - Bedroom/Living Room

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Cafeteria/FF Dining

Schedule: Small Hotel Dining Area - Occupancy

Latent Load (Btuh): 275

Sensible Radiant: 58%

Type: 90.1-13 Dining Area - All Other Dining

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel Dining Elec - Plug Loads

Schedule: Small Hotel Dining Area - Plug Loads

Radiant: 40%

Lost Heat: 20%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(16):

Resident Room 01
Resident Room 04
Resident Room 07
Resident Room 10
Resident Room 13
Resident Room 16

Resident Room 02
Resident Room 05
Resident Room 08
Resident Room 11
Resident Room 14

Resident Room 03
Resident Room 06
Resident Room 09
Resident Room 12
Resident Room 15

Room Type: PRTF – Kitchen

People Load Name: People Load #001

Activity: Walking, Standing

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 33

Light Load Name: Light Load #001

Type: Corridor (Public Spaces)

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 250

Sensible Radiant: 58%

Type: 90.1-13 Lobby - Elevator

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.64

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 17

Ventilation Type: 62.1-19 Food and Beverage Service - Kitchen (cooking)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Cooling Only Design - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(0):

Room Type: PRTF – Utility/Storage

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 200

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.5

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.25

Ventilation Type: 62.1-13 Office Buildings - Occupiable Storage Rooms for Dry Materials

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

People Based Rate: 0.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(11):

Ante Room
Hskp
Meds
Storage

Clean Supply
Laundry
Service
Trash

General Storage
Long Term Belongings Storage
Stor.

Room Type: PRTF – Assembly/Dining

People Load Name: People Load #001

Activity: Seated, Very Light Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 50

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.75

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.5

Ventilation Type: 62.1-13 Food and Beverage - Restaurant Dining Rooms

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Lobby (Hotel)

Schedule: Small Hotel Employee Lounge - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 60%

Type: 90.1-13 Lounge/Breakroom - All Other Lounges/Breakrooms

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(6):

Group
Multipurpose/Dining

Hospitality
Room 00-81

Lounge
Servery

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Room Type: PRTF – Exam/Treatment

People Load Name: People Load #001

Activity: Sedentary Work

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 1.2

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 0.75

Ventilation Type: 62.1-19 Outpatient Health Care Facilities - General examination room

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.0 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Type: Cafeteria/FF Dining

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Small Hotel - Plug Loads (Whole Building)

Schedule: Small Hotel - Plug Loads

Radiant: 40%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 7.5 cfm/person

Area Based Rate: 0.18 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(7):

Comfort Room 1

Consult 2

Sally Port

Comfort Room 2

Exam Room

Consult 1

Interview Room

Room Type: PRTF – Office/Admin

People Load Name: People Load #001

Activity: Seated at Theater

Percent Floor Area: 100%

Sensible Load (Btuh): 250

Density (ft²/person): 100

Light Load Name: Light Load #001

Type: Office

Schedule: Small Hotel - Occupancy

Latent Load (Btuh): 200

Sensible Radiant: 58%

Type: 90.1-13 Electrical/Mechanical Room

Alternative: Primary

File: Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Configuration: Recessed Fluorescent, Parabolic Louver, Non-Vented, T8

Percent Floor Area: 100%

Heat into Return Air: 31%

Density (W/ft²): 0.7

Misc Eq Load Name: Misc. Equipment #001

Modeling Method: Load and Energy

Percent Floor Area: 100%

Latent: 0%

Utility Type: Electric

Density (W/ft²): 1

Ventilation Type: 62.1-13 Office Buildings - Office Space

Standard: ASHRAE 62.1 and 170

Infiltration: Flow Rate: 0.13 ACH

Room Exhaust: Flow Rate: 0.0 cfm

Design Airflow: Cooling Supply Flow Rate: Auto-Sized

Schedule: Small Hotel - Lighting

Thermal Radiation: 22%

Visible Radiation: 20%

Type: Casa - Office/Admin

Schedule: Small Hotel - Elevators

Radiant: 0%

Lost Heat: 0%

Schedule: Available (100%)

People Based Rate: 5.0 cfm/person

Area Based Rate: 0.06 cfm/ft²

Schedule: Small Hotel - Infiltration

Schedule: Available (100%)

Heating Design Flow Rate: Auto-Sized

Unmodified Rooms(3):

Chart/Hotel

Office 1

Office 2

Room: Kitchen	Room Type: PRTF – Kitchen
Room Exhaust: Flow Rate: 2,500.0 cfm	Schedule: Casa Exhaust
Design Airflow: Cooling Supply Flow Rate: 2,500.0 cfm	Heating Design Flow Rate: 2,500.0 cfm
Room: Soiled Supply	Room Type: PRTF – Utility/Storage
Room Exhaust: Flow Rate: 1.0 cfm/ft²	Schedule: Available (100%)

Room Geometries Entered Values

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Ante Room	12.0	0.0	0.0	81	969.9	☐	☐
Attrium	18.0	0.0	0.0	622	9,249.7	☐	☐
Attrium 2	11.0	0.0	0.0	645	5,793.5	☐	☐
Chart/Hotel	12.0	0.0	0.0	200	2,395.0	☐	☐
Clean Supply	12.0	0.0	0.0	102	1,224.0	☐	☐
Comfort Room 1	12.0	0.0	0.0	84	1,005.5	☐	☐
Comfort Room 2	12.0	0.0	0.0	82	984.6	☐	☐
Consult 1	12.0	0.0	0.0	100	1,199.3	☐	☐
Consult 2	12.0	0.0	0.0	101	1,217.6	☐	☐
Corridor 1	12.0	0.0	0.0	295	3,545.7	☐	☐
Corridor 2	12.0	0.0	0.0	635	7,618.9	☐	☐
Corridor 2.1	12.0	0.0	0.0	86	1,026.1	☐	☐
Corridor 3	12.0	0.0	0.0	409	4,908.8	☐	☐
Corridor 4	12.0	0.0	0.0	324	3,887.8	☐	☐
Corridor 5	12.0	0.0	0.0	414	4,967.4	☐	☐
Electric	12.0	0.0	0.0	191	2,286.9	☐	☐
Emergency Electric	12.0	0.0	0.0	179	2,146.3	☐	☐
Entry/Waiting	12.0	0.0	0.0	370	4,445.3	☐	☐
Exam Room	12.0	0.0	0.0	123	1,476.3	☐	☐
Fire Room	12.0	0.0	0.0	79	950.9	☐	☐
General Storage	12.0	0.0	0.0	96	1,147.3	☐	☐
Group	12.0	0.0	0.0	276	3,317.2	☐	☐
Hospitality	12.0	0.0	0.0	246	2,952.5	☐	☐
Hskp	12.0	0.0	0.0	57	681.7	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Intake Corridor	12.0	0.0	0.0	155	1,858.0	☐	☐
Interview Room	12.0	0.0	0.0	158	1,893.9	☐	☐
IT	12.0	0.0	0.0	158	1,895.8	☐	☐
Kitchen	12.0	0.0	0.0	382	4,584.0	☐	☐
Laundry	12.0	0.0	0.0	122	1,461.1	☐	☐
Long Term Belongings Storage	12.0	0.0	0.0	101	1,208.4	☐	☐
Lounge	12.0	0.0	0.0	198	2,373.5	☐	☐
Mechanical	12.0	0.0	0.0	155	1,856.6	☐	☐
Meds	12.0	0.0	0.0	129	1,553.0	☐	☐
Multipurpose/Dining	12.0	0.0	0.0	485	5,825.0	☐	☐
Noisy Activity 1	12.0	0.0	0.0	180	2,155.9	☐	☐
Noisy Activity 2	12.0	0.0	0.0	181	2,170.4	☐	☐
Noisy Activity 3	12.0	0.0	0.0	182	2,185.6	☐	☐
Office 1	12.0	0.0	0.0	94	1,130.4	☐	☐
Office 2	12.0	0.0	0.0	95	1,141.8	☐	☐
Quiet Activity 1	12.0	0.0	0.0	130	1,564.2	☐	☐
Quiet Activity 2	12.0	0.0	0.0	131	1,567.6	☐	☐
Quiet Activity 3	12.0	0.0	0.0	131	1,573.4	☐	☐
Resident Room 01	12.0	0.0	0.0	124	1,486.4	☐	☐
Resident Room 02	12.0	0.0	0.0	112	1,339.9	☐	☐
Resident Room 03	12.0	0.0	0.0	136	1,636.2	☐	☐
Resident Room 04	12.0	0.0	0.0	129	1,548.6	☐	☐
Resident Room 05	12.0	0.0	0.0	131	1,575.1	☐	☐
Resident Room 06	12.0	0.0	0.0	124	1,487.7	☐	☐
Resident Room 07	12.0	0.0	0.0	125	1,504.4	☐	☐
Resident Room 08	12.0	0.0	0.0	126	1,515.3	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Resident Room 09	12.0	0.0	0.0	128	1,534.5	☐	☐
Resident Room 10	12.0	0.0	0.0	130	1,557.2	☐	☐
Resident Room 11	12.0	0.0	0.0	129	1,549.2	☐	☐
Resident Room 12	12.0	0.0	0.0	127	1,520.4	☐	☐
Resident Room 13	12.0	0.0	0.0	127	1,520.6	☐	☐
Resident Room 14	12.0	0.0	0.0	130	1,564.9	☐	☐
Resident Room 15	12.0	0.0	0.0	130	1,564.3	☐	☐
Resident Room 16	12.0	0.0	0.0	127	1,520.0	☐	☐
Room 00-80	12.0	0.0	0.0	4	46.4	☐	☐
Room 00-81	12.0	0.0	0.0	3	40.3	☐	☐
Room 01-00	6.0	0.0	0.0	634	2,007.4	☐	☐
Room 01-01	6.0	0.0	0.0	748	2,383.8	☐	☐
Room 01-03	6.0	0.0	0.0	1,001	3,162.5	☐	☐
Room 01-04	6.0	0.0	0.0	959	2,991.1	☐	☐
Room 01-06	6.0	0.0	0.0	1,009	3,156.0	☐	☐
Room 01-08	6.0	0.0	0.0	1,572	4,817.2	☐	☐
Room 01-10	6.0	0.0	0.0	769	2,562.8	☐	☐
Room 01-12	6.0	0.0	0.0	675	2,043.9	☐	☐
Sally Port	12.0	0.0	0.0	78	933.1	☐	☐
Servery	12.0	0.0	0.0	228	2,738.4	☐	☐
Service	12.0	0.0	0.0	304	3,642.3	☐	☐
Shower 1	12.0	0.0	0.0	80	961.4	☐	☐
Shower 2	12.0	0.0	0.0	99	1,187.2	☐	☐
Shower 3	12.0	0.0	0.0	104	1,246.9	☐	☐
Shower 4	12.0	0.0	0.0	103	1,239.3	☐	☐
Shower 5	12.0	0.0	0.0	104	1,242.8	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Shower 6	12.0	0.0	0.0	104	1,242.2	☐	☐
Shower 7	12.0	0.0	0.0	103	1,235.2	☐	☐
Shower 8	12.0	0.0	0.0	101	1,208.4	☐	☐
Soiled Supply	12.0	0.0	0.0	97	1,161.1	☐	☐
Staff Corridor	12.0	0.0	0.0	893	10,720.0	☐	☐
Stor.	12.0	0.0	0.0	15	174.6	☐	☐
Storage	12.0	0.0	0.0	52	624.5	☐	☐
Toilet 1	12.0	0.0	0.0	67	802.2	☐	☐
Toilet 2	12.0	0.0	0.0	62	742.3	☐	☐
Toilet 3	12.0	0.0	0.0	62	739.8	☐	☐
Trash	12.0	0.0	0.0	76	915.0	☐	☐

Room Geometries Entered Values

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Ante Room	12.0	0.0	0.0	81	969.9	☐	☐
Atrium	18.0	0.0	0.0	622	9,249.7	☐	☐
Atrium 2	11.0	0.0	0.0	645	5,793.5	☐	☐
Chart/Hotel	12.0	0.0	0.0	200	2,395.0	☐	☐
Clean Supply	12.0	0.0	0.0	102	1,224.0	☐	☐
Comfort Room 1	12.0	0.0	0.0	84	1,005.5	☐	☐
Comfort Room 2	12.0	0.0	0.0	82	984.6	☐	☐
Consult 1	12.0	0.0	0.0	100	1,199.3	☐	☐
Consult 2	12.0	0.0	0.0	101	1,217.6	☐	☐
Corridor 1	12.0	0.0	0.0	295	3,545.7	☐	☐
Corridor 2	12.0	0.0	0.0	635	7,618.9	☐	☐
Corridor 2.1	12.0	0.0	0.0	86	1,026.1	☐	☐
Corridor 3	12.0	0.0	0.0	409	4,908.8	☐	☐
Corridor 4	12.0	0.0	0.0	324	3,887.8	☐	☐
Corridor 5	12.0	0.0	0.0	414	4,967.4	☐	☐
Electric	12.0	0.0	0.0	191	2,286.9	☐	☐
Emergency Electric	12.0	0.0	0.0	179	2,146.3	☐	☐
Entry/Waiting	12.0	0.0	0.0	370	4,445.3	☐	☐
Exam Room	12.0	0.0	0.0	123	1,476.3	☐	☐
Fire Room	12.0	0.0	0.0	79	950.9	☐	☐
General Storage	12.0	0.0	0.0	96	1,147.3	☐	☐
Group	12.0	0.0	0.0	276	3,317.2	☐	☐
Hospitality	12.0	0.0	0.0	246	2,952.5	☐	☐
Hskp	12.0	0.0	0.0	57	681.7	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Intake Corridor	12.0	0.0	0.0	155	1,858.0	☐	☐
Interview Room	12.0	0.0	0.0	158	1,893.9	☐	☐
IT	12.0	0.0	0.0	158	1,895.8	☐	☐
Kitchen	12.0	0.0	0.0	382	4,584.0	☐	☐
Laundry	12.0	0.0	0.0	122	1,461.1	☐	☐
Long Term Belongings Storage	12.0	0.0	0.0	101	1,208.4	☐	☐
Lounge	12.0	0.0	0.0	198	2,373.5	☐	☐
Mechanical	12.0	0.0	0.0	155	1,856.6	☐	☐
Meds	12.0	0.0	0.0	129	1,553.0	☐	☐
Multipurpose/Dining	12.0	0.0	0.0	485	5,825.0	☐	☐
Noisy Activity 1	12.0	0.0	0.0	180	2,155.9	☐	☐
Noisy Activity 2	12.0	0.0	0.0	181	2,170.4	☐	☐
Noisy Activity 3	12.0	0.0	0.0	182	2,185.6	☐	☐
Office 1	12.0	0.0	0.0	94	1,130.4	☐	☐
Office 2	12.0	0.0	0.0	95	1,141.8	☐	☐
Quiet Activity 1	12.0	0.0	0.0	130	1,564.2	☐	☐
Quiet Activity 2	12.0	0.0	0.0	131	1,567.6	☐	☐
Quiet Activity 3	12.0	0.0	0.0	131	1,573.4	☐	☐
Resident Room 01	12.0	0.0	0.0	124	1,486.4	☐	☐
Resident Room 02	12.0	0.0	0.0	112	1,339.9	☐	☐
Resident Room 03	12.0	0.0	0.0	136	1,636.2	☐	☐
Resident Room 04	12.0	0.0	0.0	129	1,548.6	☐	☐
Resident Room 05	12.0	0.0	0.0	131	1,575.1	☐	☐
Resident Room 06	12.0	0.0	0.0	124	1,487.7	☐	☐
Resident Room 07	12.0	0.0	0.0	125	1,504.4	☐	☐
Resident Room 08	12.0	0.0	0.0	126	1,515.3	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Resident Room 09	12.0	0.0	0.0	128	1,534.5	☐	☐
Resident Room 10	12.0	0.0	0.0	130	1,557.2	☐	☐
Resident Room 11	12.0	0.0	0.0	129	1,549.2	☐	☐
Resident Room 12	12.0	0.0	0.0	127	1,520.4	☐	☐
Resident Room 13	12.0	0.0	0.0	127	1,520.6	☐	☐
Resident Room 14	12.0	0.0	0.0	130	1,564.9	☐	☐
Resident Room 15	12.0	0.0	0.0	130	1,564.3	☐	☐
Resident Room 16	12.0	0.0	0.0	127	1,520.0	☐	☐
Room 00-80	12.0	0.0	0.0	4	46.4	☐	☐
Room 00-81	12.0	0.0	0.0	3	40.3	☐	☐
Room 01-00	6.0	0.0	0.0	634	2,007.4	☐	☐
Room 01-01	6.0	0.0	0.0	748	2,383.8	☐	☐
Room 01-03	6.0	0.0	0.0	1,001	3,162.5	☐	☐
Room 01-04	6.0	0.0	0.0	959	2,991.1	☐	☐
Room 01-06	6.0	0.0	0.0	1,009	3,156.0	☐	☐
Room 01-08	6.0	0.0	0.0	1,572	4,817.2	☐	☐
Room 01-10	6.0	0.0	0.0	769	2,562.8	☐	☐
Room 01-12	6.0	0.0	0.0	675	2,043.9	☐	☐
Sally Port	12.0	0.0	0.0	78	933.1	☐	☐
Servery	12.0	0.0	0.0	228	2,738.4	☐	☐
Service	12.0	0.0	0.0	304	3,642.3	☐	☐
Shower 1	12.0	0.0	0.0	80	961.4	☐	☐
Shower 2	12.0	0.0	0.0	99	1,187.2	☐	☐
Shower 3	12.0	0.0	0.0	104	1,246.9	☐	☐
Shower 4	12.0	0.0	0.0	103	1,239.3	☐	☐
Shower 5	12.0	0.0	0.0	104	1,242.8	☐	☐

Room Name	Flr to Flr Height (ft)	Top of Flr Elevation (ft)	Ceiling Elevation (ft)	Occupied		Dropped Ceiling	Raised Floor
				Floor Area (ft²)	Internal Volume (ft³)		
Shower 6	12.0	0.0	0.0	104	1,242.2	☐	☐
Shower 7	12.0	0.0	0.0	103	1,235.2	☐	☐
Shower 8	12.0	0.0	0.0	101	1,208.4	☐	☐
Soiled Supply	12.0	0.0	0.0	97	1,161.1	☐	☐
Staff Corridor	12.0	0.0	0.0	893	10,720.0	☐	☐
Stor.	12.0	0.0	0.0	15	174.6	☐	☐
Storage	12.0	0.0	0.0	52	624.5	☐	☐
Toilet 1	12.0	0.0	0.0	67	802.2	☐	☐
Toilet 2	12.0	0.0	0.0	62	742.3	☐	☐
Toilet 3	12.0	0.0	0.0	62	739.8	☐	☐
Trash	12.0	0.0	0.0	76	915.0	☐	☐

Entered Values Zone Information

Zone Type Section

Zone Type: PRTF – Activity Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Admin Zone (Offices/Reception)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Atrium Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Kitchen Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Bedroom Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Shower Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff corridor core)****Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: Small Hotel**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zones Section****** Information for unmodified zones is in the Zone Type Section.****Zone Name:** ACT-Noisy-1**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 1

Zone Name: ACT-Noisy-2**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 2

Zone Name: ACT-Noisy-3**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 3

Zone Name: ACT-Quiet-1**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Quiet Activity 1

Zone Name: ACT-Quiet-2**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Quiet Activity 2

Zone Name: ACT-Quiet-3	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 3		
Zone Name: Admin	Zone Type: Small Hotel	Modified: ☐
Assigned Rooms(2):		
Office 1 Office 2		
Zone Name: Atrium	Zone Type: PRTF – Atrium Zone	Modified: ☐
Assigned Rooms(2):		
Atrium 2 Atrium		
Zone Name: Chart/Hotel	Zone Type: PRTF – Admin Zone (Offices/Reception)	Modified: ☐
Assigned Rooms(1):		
Chart/Hotel		
Zone Name: Comfort/Consult	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(3):		
Comfort Room 2 Consult 1 Consult 2		
Zone Name: Corridor-N	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Corridor 3		
Zone Name: Corridor-S	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Corridor 5		
Zone Name: Corridor-W	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Corridor 4		

Zone Name: Entry/Waiting	Zone Type: PRTF – Admin Zone (Offices/Reception)	Modified: ☐
Assigned Rooms(1):		
Entry/Waiting		
Zone Name: Exam/Storage	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(2):		
Exam Room Long Term Belongings Storage		
Zone Name: Group	Zone Type: Small Hotel	Modified: ☐
Assigned Rooms(1):		
Group		
Zone Name: Hospitality	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Hospitality		
Zone Name: Intake-HR-A	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(4):		
Sally Port Interview Room Intake Corridor Shower 1		
Zone Name: Intake-HR-B	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(2):		
Comfort Room 1 Ante Room		
Zone Name: Kitchen	Zone Type: PRTF – Kitchen Zone	Modified: ☐
Assigned Rooms(2):		
Kitchen Service		

Zone Name: Lounge	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(2):		
Lounge	Shower 2	
Zone Name: Multipurpose/Dining	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Multipurpose/Dining		
Zone Name: RB-N-Corner	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 14		
Zone Name: RB-N-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(2):		
Resident Room 15	Resident Room 16	
Zone Name: RB-N-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 11	Resident Room 12	Resident Room 13
Zone Name: RB-S-Corner-N	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 04		
Zone Name: RB-S-Corner-S	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 05		
Zone Name: RB-S-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 02	Resident Room 03	Resident Room 01

Zone Name: RB-S-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 06		
Zone Name: RB-W-North	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 10		
Zone Name: RB-W-South	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 07	Resident Room 08	Resident Room 09
Zone Name: Served	Zone Type: PRTF – Common Program Zone (Multipurpose/Served/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Served		
Zone Name: SHWR-N	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 7	Shower 8	
Zone Name: SHWR-S	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 3	Shower 4	
Zone Name: SHWR-W	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 5	Shower 6	
Zone Name: Support	Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)	Modified: ☐
Assigned Rooms(4):		
Fire Room Mechanical	Electric	Emergency Electric

Zone Name: Utility

Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff
corridor core)

Modified: ☐

Assigned Rooms(16):

Soiled Supply
Laundry
Storage
Corridor 2
Toilet 3
Corridor 2.1

Clean Supply
Meds
Staff Corridor
Toilet 1
IT

Hskp
Stor.
Corridor 1
Toilet 2
General Storage

Entered Values Zone Information

Zone Type Section

Zone Type: PRTF – Activity Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Admin Zone (Offices/Reception)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)****Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Kitchen Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Bedroom Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Resident Shower Zone

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)

Supply Path: RoomDirect

Return Path: RoomDirect

Cstat Schedule: Based On Occupancy

Cooling Dry Bulb: 75 °F

Cooling Drift Point: 81 °F

Hstat Schedule Based On Occupancy

Heating Dry Bulb: 70 °F

Heating Drift Point: 64 °F

Humidifying Schedule: Based On Occupancy

Humidifying Set Point: 40 %

Humidifying Drift Point: 35 %

Dehumidifying Schedule: Based On Occupancy

Dehumidifying Set Point: 50 %

Dehumidifying Drift Point: 55 %

Cooling Ez: Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type

Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff corridor core)**Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zone Type: Small Hotel****Supply Path:** RoomDirect**Return Path:** RoomDirect**Cstat Schedule:** Based On Occupancy**Cooling Dry Bulb:** 75 °F**Cooling Drift Point:** 81 °F**Hstat Schedule** Based On Occupancy**Heating Dry Bulb:** 70 °F**Heating Drift Point:** 64 °F**Humidifying Schedule:** Based On Occupancy**Humidifying Set Point:** 40 %**Humidifying Drift Point:** 35 %**Dehumidifying Schedule:** Based On Occupancy**Dehumidifying Set Point:** 50 %**Dehumidifying Drift Point:** 55 %**Cooling Ez:** Ceiling supply, ceiling return

100 %

Heating Ez: Ceiling supply < trm+15° (8°C), ceiling return, high velocity

100 %

Er: Default based on system type**Zones Section****** Information for unmodified zones is in the Zone Type Section.****Zone Name:** ACT-Noisy-1**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 1

Zone Name: ACT-Noisy-2**Zone Type:** PRTF – Activity Zone**Modified:** ☐**Assigned Rooms(1):**

Noisy Activity 2

Alternative: Primary**File:** Casa De Amparo_v5.mdf

TRACE 3D Plus 7.00

214

Zone Name: ACT-Noisy-3	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Noisy Activity 3		
Zone Name: ACT-Quiet-1	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 1		
Zone Name: ACT-Quiet-2	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 2		
Zone Name: ACT-Quiet-3	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(1):		
Quiet Activity 3		
Zone Name: Admin	Zone Type: Small Hotel	Modified: ☐
Assigned Rooms(2):		
Office 1Office 2		
Zone Name: Atrium	Zone Type: PRTF – Activity Zone	Modified: ☐
Assigned Rooms(2):		
Atrium 2Atrium		
Zone Name: Chart/Hotel	Zone Type: PRTF – Admin Zone (Offices/Reception)	Modified: ☐
Assigned Rooms(1):		
Chart/Hotel		
Zone Name: Comfort/Consult	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(3):		
Comfort Room 2Consult 1Consult 2		

Zone Name: Intake-HR-B	Zone Type: PRTF – Clinical Zone (Comfort/Consult/Group/Interview/Exam)	Modified: ☐
Assigned Rooms(2):		
Comfort Room 1	Ante Room	
Zone Name: Kitchen	Zone Type: PRTF – Kitchen Zone	Modified: ☐
Assigned Rooms(2):		
Kitchen	Service	
Zone Name: Lounge	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(2):		
Lounge	Shower 2	
Zone Name: Multipurpose/Dining	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Multipurpose/Dining		
Zone Name: RB-N-Corner	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 14		
Zone Name: RB-N-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(2):		
Resident Room 15	Resident Room 16	
Zone Name: RB-N-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 11	Resident Room 12	Resident Room 13
Zone Name: RB-S-Corner-N	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 04		

Zone Name: RB-S-Corner-S	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 05		
Zone Name: RB-S-East	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 02	Resident Room 03	Resident Room 01
Zone Name: RB-S-West	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 06		
Zone Name: RB-W-North	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(1):		
Resident Room 10		
Zone Name: RB-W-South	Zone Type: PRTF – Resident Bedroom Zone	Modified: ☐
Assigned Rooms(3):		
Resident Room 07	Resident Room 08	Resident Room 09
Zone Name: Servery	Zone Type: PRTF – Common Program Zone (Multipurpose/Servery/Hospitality/Lounge)	Modified: ☐
Assigned Rooms(1):		
Servery		
Zone Name: SHWR-N	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 7	Shower 8	
Zone Name: SHWR-S	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 3	Shower 4	

Zone Name: SHWR-W	Zone Type: PRTF – Resident Shower Zone	Modified: ☐
Assigned Rooms(2):		
Shower 5	Shower 6	
Zone Name: Support	Zone Type: PRTF – Support Zone (Mech/Elec/Telecom cassette units)	Modified: ☐
Assigned Rooms(4):		
Fire Room Mechanical	Electric	Emergency Electric
Zone Name: Utility	Zone Type: PRTF – Utility Core Zone (Clean/Soiled/staff corridor core)	Modified: ☐
Assigned Rooms(16):		
Soiled Supply Laundry Storage Corridor 2 Toilet 3 Corridor 2.1	Clean Supply Meds Staff Corridor Toilet 1 IT	Hskp Stor. Corridor 1 Toilet 2 General Storage

Economic Comparison

Project Information Summary

Alternatives

Baseline Title 24 - 2022 Baseline
Comparison 1 Primary


Life Cycle Cost Parameters

Length of Study 25 years
Real Discount Rate 0.0300
Nominal Discount Rate -- N/A --
Inflation Rate -- N/A --

Tax Rate 0.00%
Base Date July 2019
Service Date July 2019
Inflation Approach ConstantDollar
Depreciation Method None
Discounting Convention BeginningOfYear

Comparison	Initial Investment Cost Difference (\$)	First Year Utility Savings (\$)	Simple Payback Period	Life Cycle Payback Period	Internal Rate of Return (IRR)
Comparison 1 vs Baseline	0.00	-2,219.26	N/A	N/A	N/A


Economic Alternative Comparison

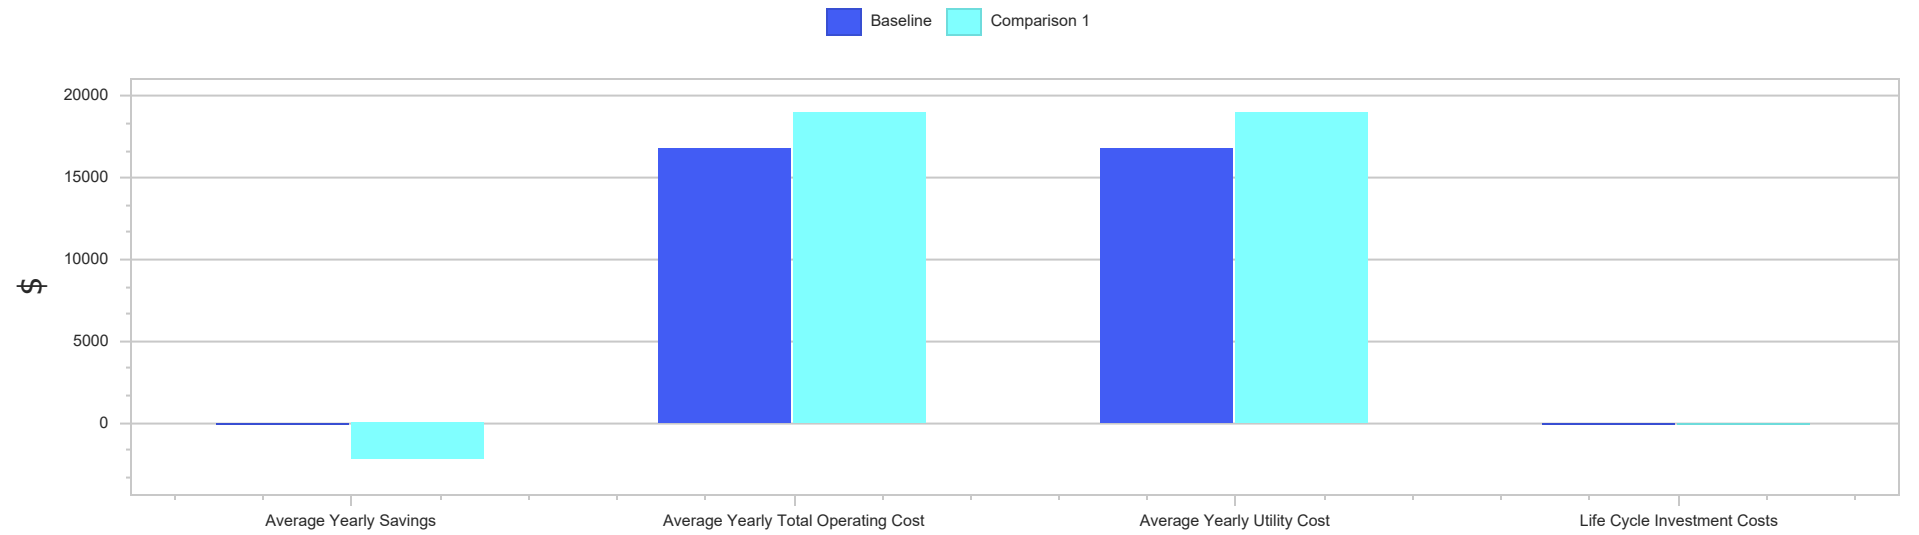

		Average Yearly			Life Cycle Investment Cost
		Savings vs Baseline (\$)	Total Operating Cost (\$)	Utility Cost (\$)	USD (\$)
Baseline	Title 24 - 2022 Baseline	0.00	16,808.08	16,808.08	0.00
Comparison 1	Primary	-2,219.26	19,027.34	19,027.34	0.00


Monthly Utility Comparison

Total Utility Cost

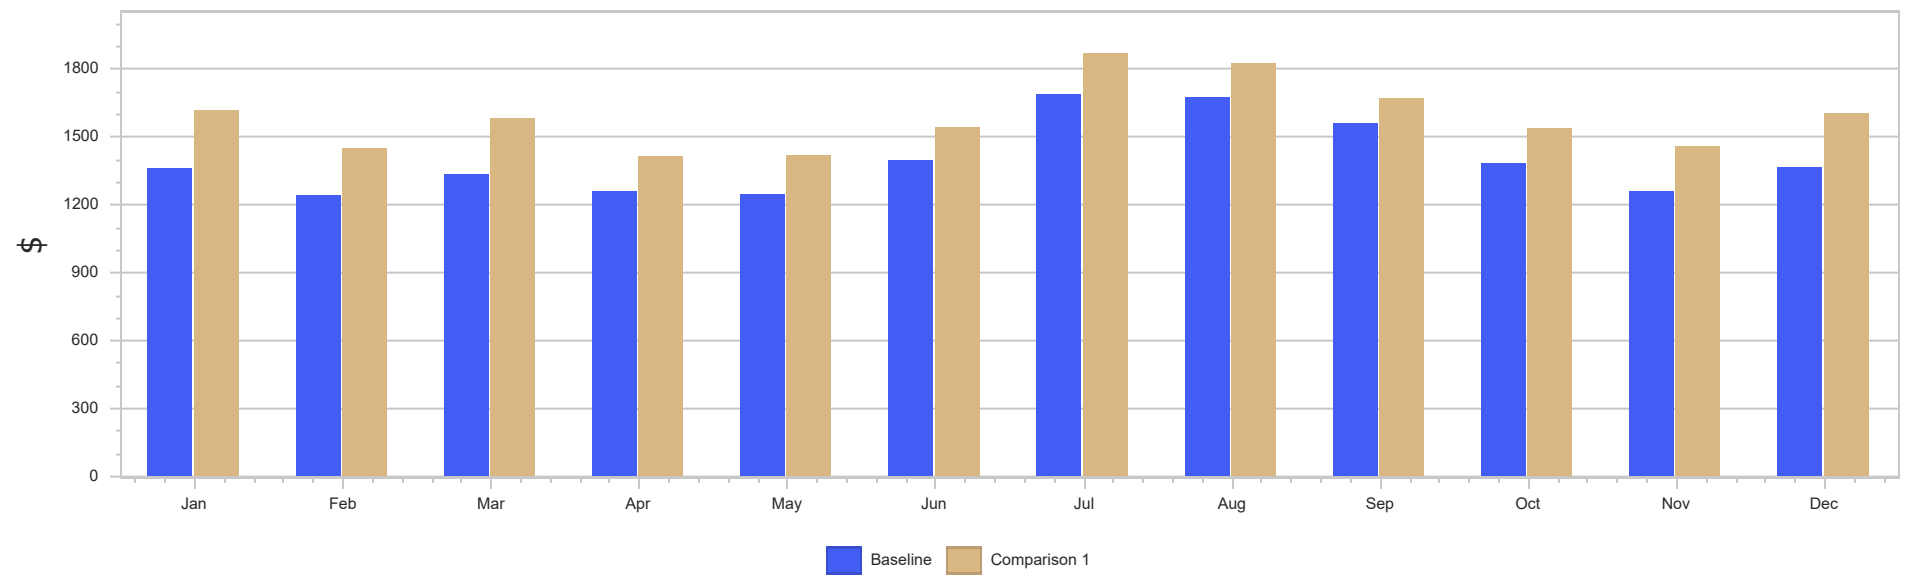

	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)
Baseline	1,365	1,244	1,338	1,263	1,249	1,400	1,690	1,678	1,562	1,388	1,260	1,370
Comparison 1	1,619	1,452	1,587	1,417	1,420	1,545	1,873	1,827	1,675	1,541	1,463	1,607

Electricity

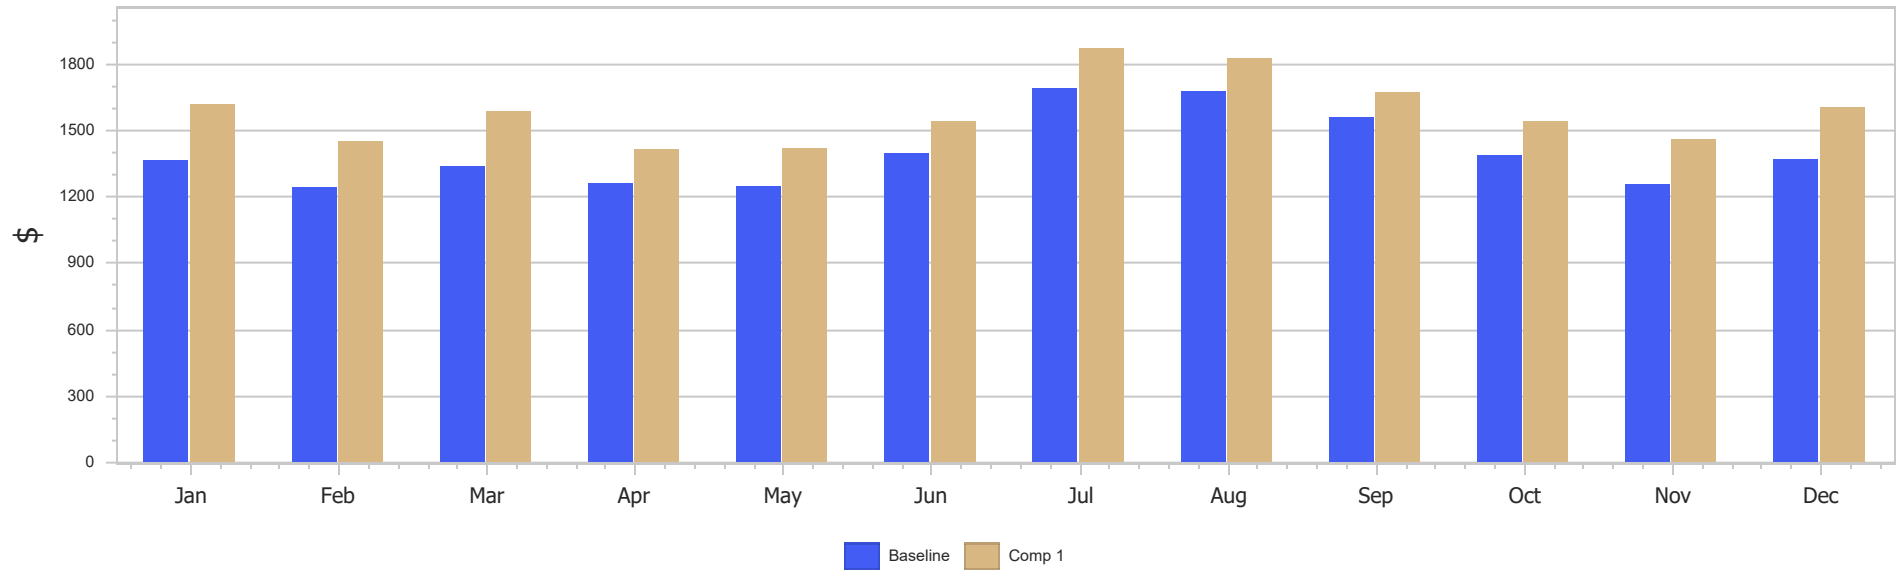

	Jan (\$)	Feb (\$)	Mar (\$)	Apr (\$)	May (\$)	Jun (\$)	Jul (\$)	Aug (\$)	Sep (\$)	Oct (\$)	Nov (\$)	Dec (\$)
Baseline	1,365	1,244	1,338	1,263	1,249	1,400	1,690	1,678	1,562	1,388	1,260	1,370
Comparison 1	1,619	1,452	1,587	1,417	1,420	1,545	1,873	1,827	1,675	1,541	1,463	1,607

Alternative Cash Flow Comparison

Comparison 1 vs Baseline

Year	Present Value Of Difference (\$)	Net Present Value (\$)
1	-2,219.26	-2,219.26
2	-2,154.63	-4,373.89
3	-2,091.87	-6,465.76
4	-2,030.94	-8,496.70
5	-1,971.79	-10,468.49
6	-1,914.35	-12,382.84
7	-1,858.60	-14,241.44
8	-1,804.46	-16,045.90
9	-1,751.91	-17,797.81
10	-1,700.88	-19,498.69
11	-1,651.34	-21,150.03
12	-1,603.25	-22,753.28
13	-1,556.55	-24,309.83
14	-1,511.21	-25,821.04
15	-1,467.20	-27,288.24
16	-1,424.46	-28,712.70
17	-1,382.97	-30,095.67
18	-1,342.70	-31,438.37
19	-1,303.59	-32,741.96
20	-1,265.62	-34,007.58
21	-1,228.75	-35,236.33
22	-1,192.96	-36,429.29
23	-1,158.22	-37,587.51
24	-1,124.49	-38,712.00
25	-1,091.73	-39,803.73

Life Cycle Cost Difference \$-39,803.73


Alternative Comparison

Energy End Use Comparison

		Baseline		Comparison 1	
		Title 24 - 2022 Baseline		Primary	
		Energy (Mbtu)	% of Total	Energy (Mbtu)	% Improve
Heating	Electricity	29,136	6%	61,779	-112%
Cooling	Electricity	76,024	17%	111,340	-46%
Interior Lighting	Electricity	123,842	27%	124,771	-1%
Exterior Lighting	-	-	-	-	-
Interior Equipment	Electricity	180,085	40%	180,085	0%
Exterior Equipment	-	-	-	-	-
Fans	Electricity	42,187	9%	42,699	-1%
Pumps	-	-	-	-	-
Heat Rejection	-	-	-	-	-
Humidification	-	-	-	-	-
Air-Side Heat Recovery	-	-	-	-	-
Refrigeration	-	-	-	-	-
Generators	-	-	-	-	-
Summary	Electricity	451,275	100%	520,674	-15%
Total		451,275	100%	520,674	-15%


Monthly Utility Use Comparison

Electricity Consumption

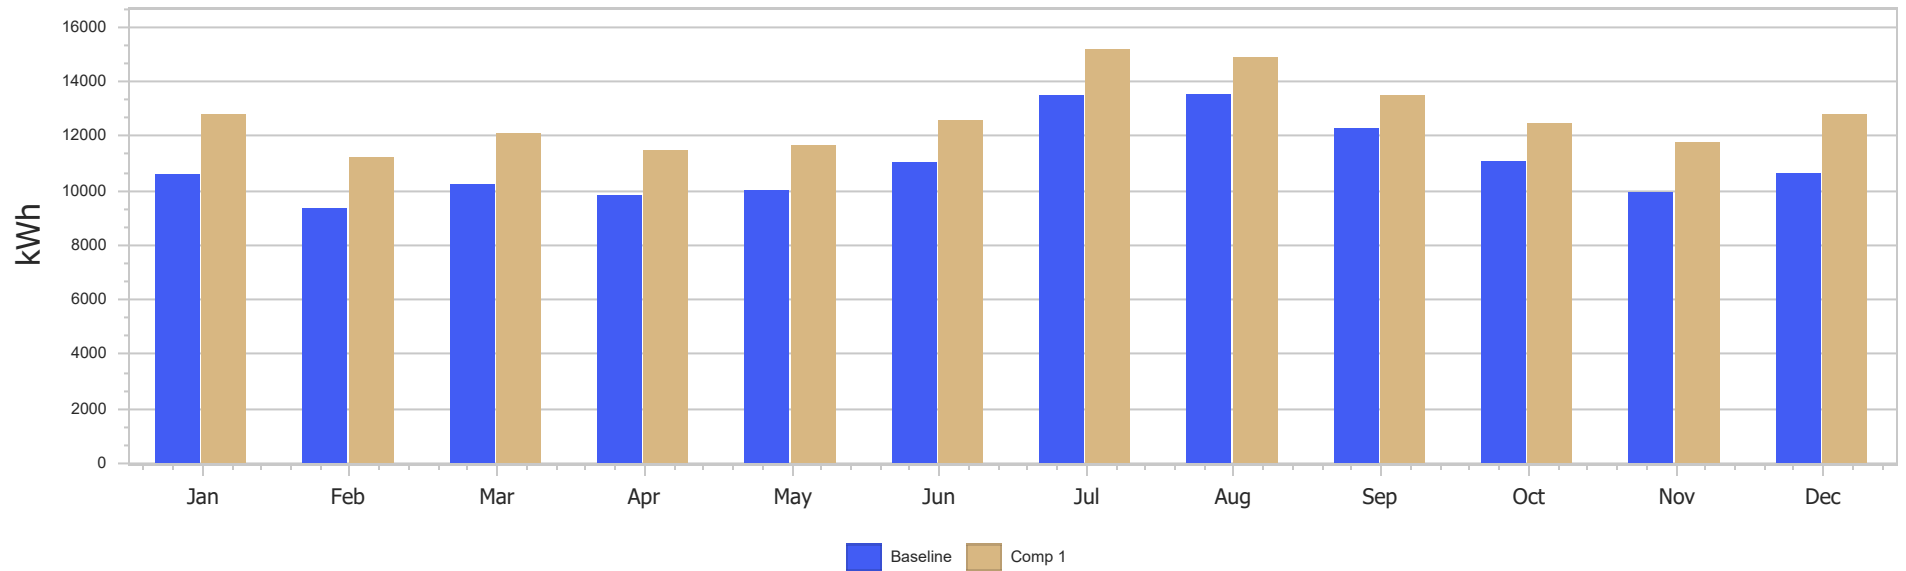


	Jan (kWh)	Feb (kWh)	Mar (kWh)	Apr (kWh)	May (kWh)	Jun (kWh)	Jul (kWh)	Aug (kWh)	Sep (kWh)	Oct (kWh)	Nov (kWh)	Dec (kWh)
Baseline	10,626	9,374	10,262	9,858	10,023	11,053	13,522	13,559	12,293	11,086	9,946	10,659
Comparison 1	12,802	11,249	12,120	11,495	11,668	12,573	15,201	14,902	13,515	12,498	11,767	12,810

Electricity Demand

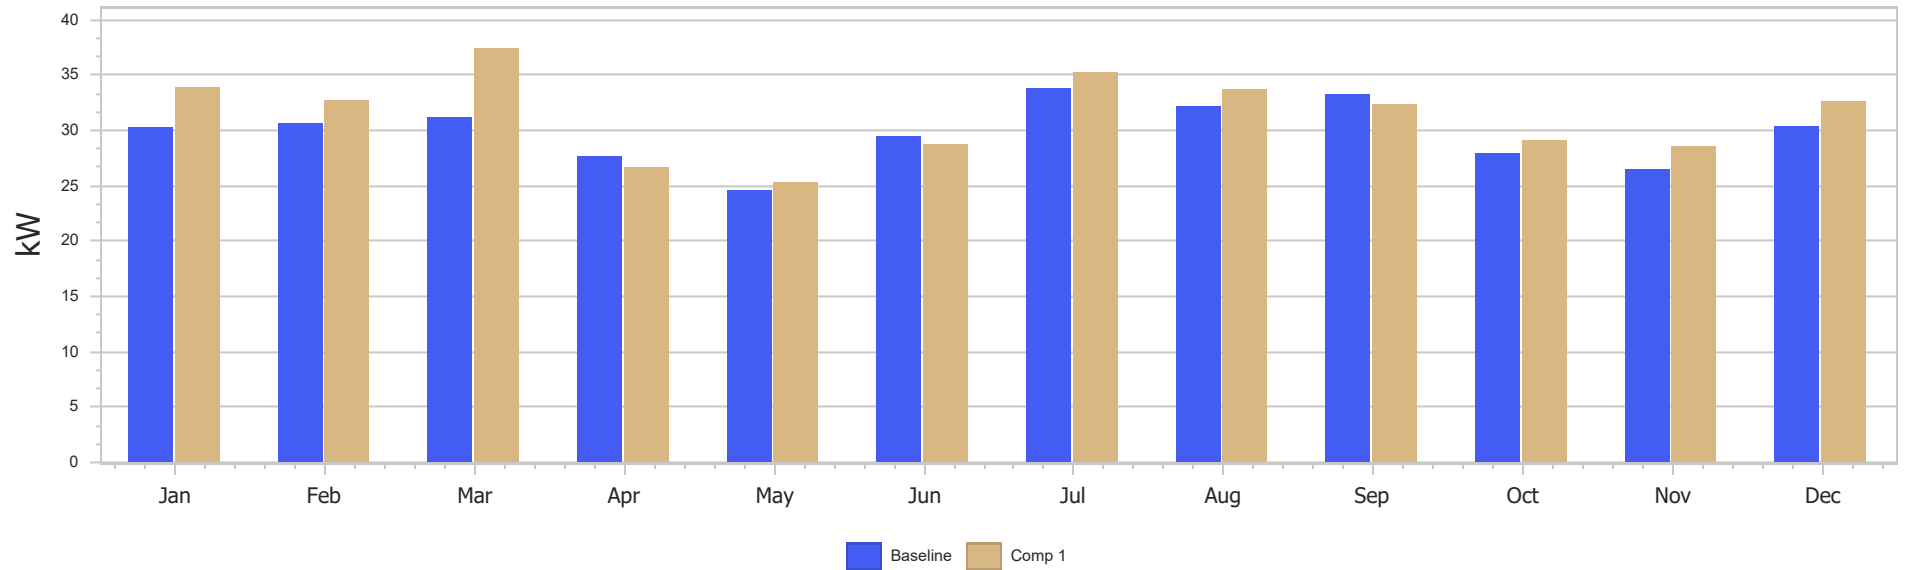


	Jan (kW)	Feb (kW)	Mar (kW)	Apr (kW)	May (kW)	Jun (kW)	Jul (kW)	Aug (kW)	Sep (kW)	Oct (kW)	Nov (kW)	Dec (kW)
Baseline	30	31	31	28	25	30	34	32	33	28	27	30
Comparison 1	34	33	37	27	25	29	35	34	32	29	29	33

Energy Intensity Comparison

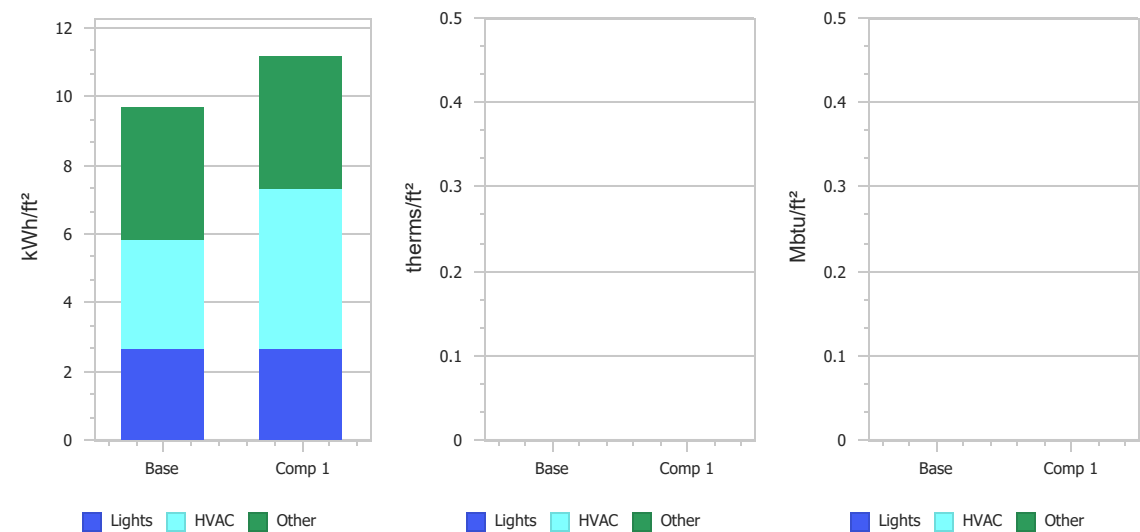


		Electricity Intensity (kWh/ft²)	Natural Gas Intensity (therms/ft²)	Additional Fuel Intensity (Mbtu/ft²)
Baseline Title 24 - 2022 Baseline	Lighting	2.66	-	-
	HVAC	3.16	-	-
	Other	3.86	-	-
Comparison 1 Primary	Lighting	2.68	-	-
	HVAC	4.63	-	-
	Other	3.86	-	-

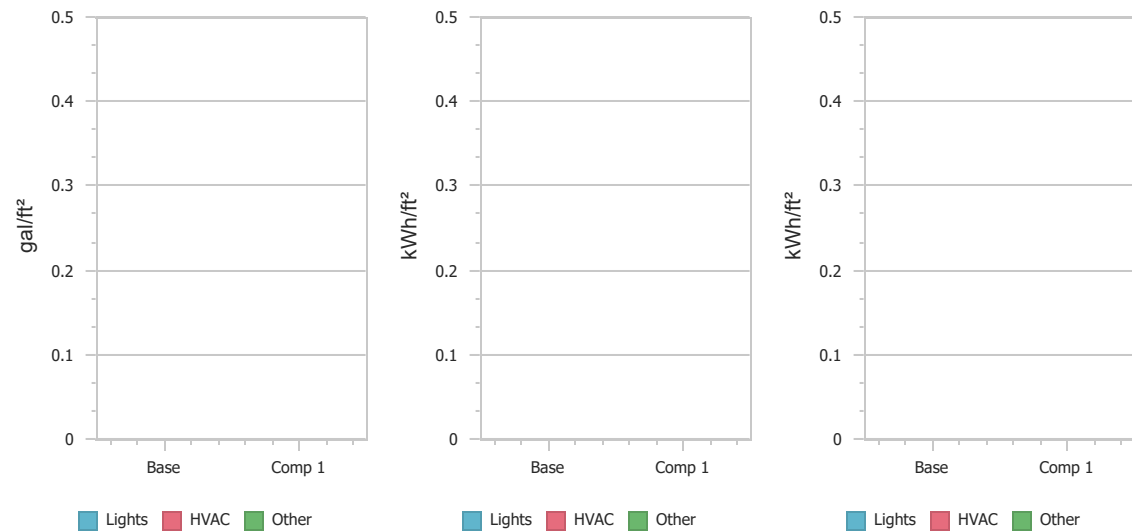

		Water Intesity (gal/ft²)	District Cooling Intensity (kWh/ft²)	District Heating Water Intensity (kWh/ft²)
Baseline Title 24 - 2022 Baseline	<i>Lighting</i>	-	-	-
	<i>HVAC</i>	-	-	-
	<i>Other</i>	-	-	-
Comparison 1 Primary	<i>Lighting</i>	-	-	-
	<i>HVAC</i>	-	-	-
	<i>Other</i>	-	-	-

Overall Annual Energy Consumption

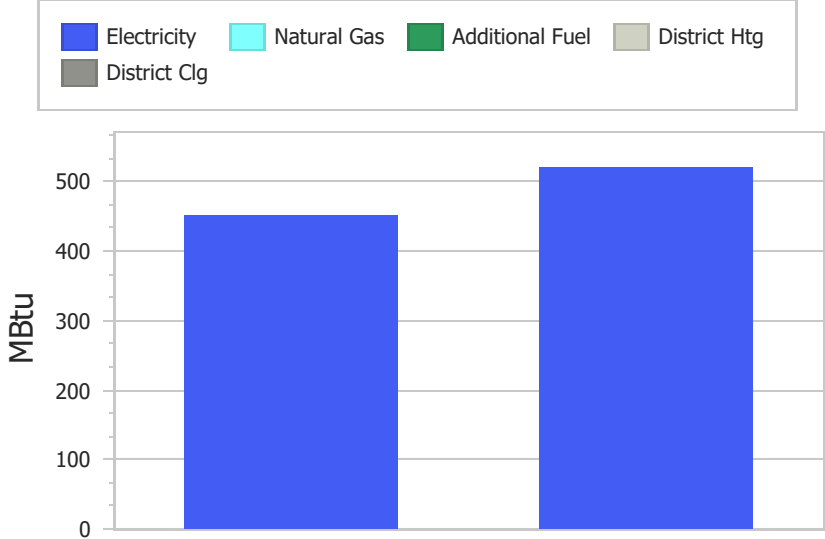

	Baseline: Title 24 - 2022 Baseline	Comparison 1: Primary
Electricity (MBtu)	451	521
Natural Gas (MBtu)	0	0
Additional Fuel (MBtu)	0	0
District Cooling (MBtu)	0	0
District Heating Water (MBtu)	0	0
Water (kGal)	0	0

Alternative Carbon Comparison

Carbon End Use Comparison

		Baseline		Comparison 1	
		Title 24 - 2022 Baseline		Primary	
		Carbon Equiv. (Tons)	% of Total	Carbon Equiv. (Tons)	% Improve
Heating	Electricity	98	6%	208	-112%
Cooling	Electricity	256	17%	375	-46%
Interior Lighting	Electricity	418	27%	421	-1%
Exterior Lighting	-	-	-	-	-
Interior Equipment	Electricity	607	40%	607	0%
Exterior Equipment	-	-	-	-	-
Fans	Electricity	142	9%	144	-1%
Pumps	-	-	-	-	-
Heat Rejection	-	-	-	-	-
Humidification	-	-	-	-	-
Air-Side Heat Recovery	-	-	-	-	-
Refrigeration	-	-	-	-	-
Generators	-	-	-	-	-
Summary	Electricity	1,522	100%	1,756	-15%
Total		1,522	100%	1,756	-15%