


## OpeX Industries — Feedwater Loop P&ID (Sheet 1 of 1)

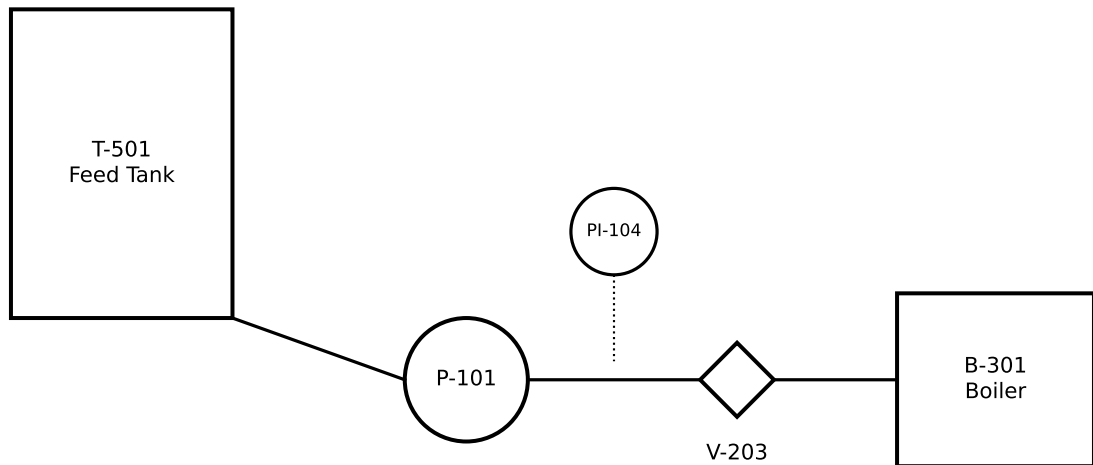

### Legend:

- Circle = pump/instrument
- Rectangle = tank/vessel
- Diamond = control valve

Caption: Feedwater is drawn from tank T-501 by pump P-101, passed through control valve V-203, and delivered to boiler B-301. Discharge pressure is monitored at gauge PI-104, with a normal operating range of 8 to 11 bar. Valve V-203 is a fail-closed control valve and closes automatically on loss of instrument air.