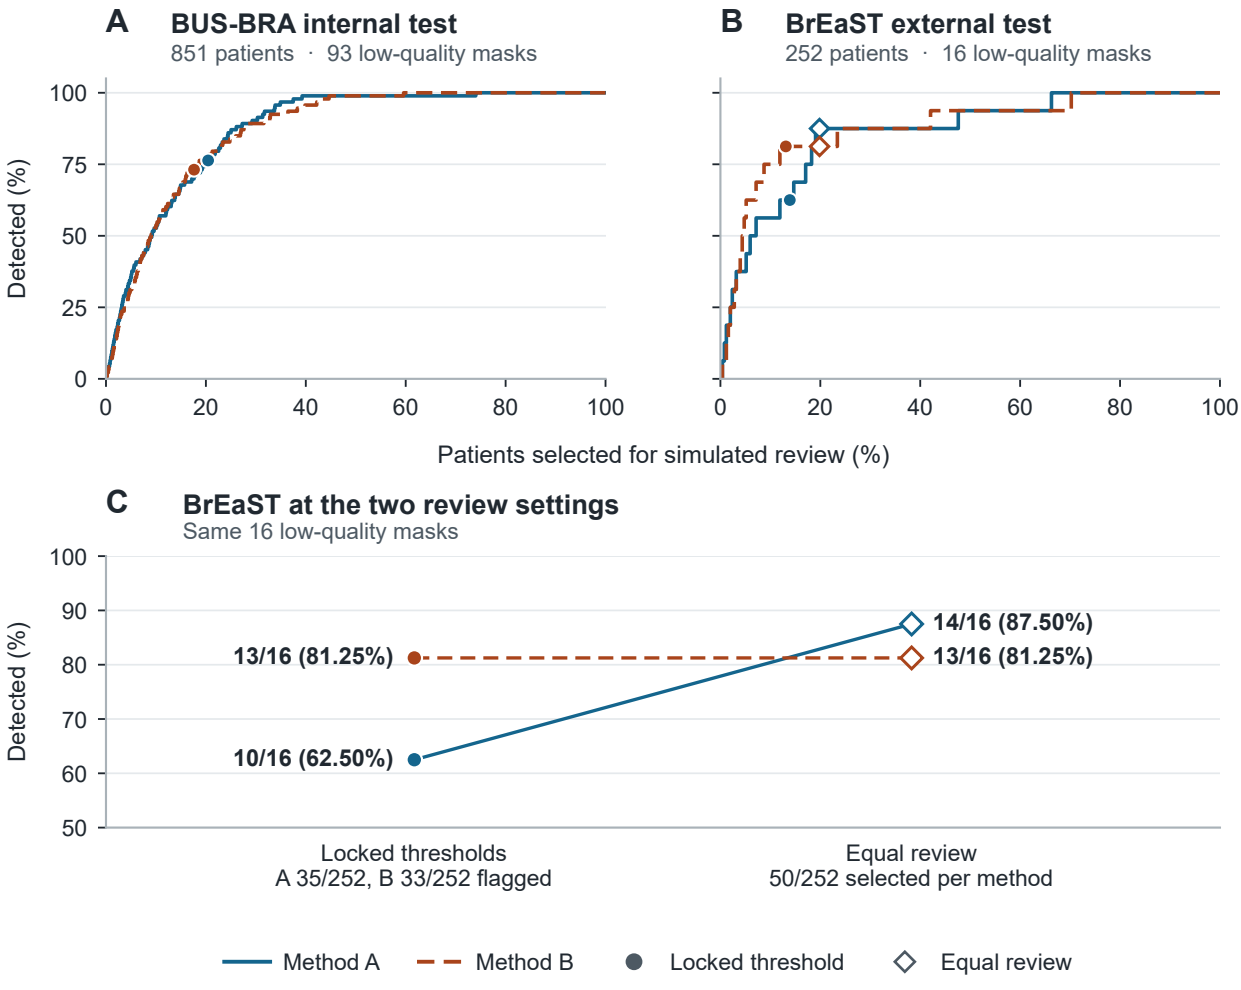

A
BUS-BRA internal test
851 patients · 93 low-quality masks
B
BrEaST external test
252 patients · 16 low-quality masks
Detected (%)
100
75
50
25
0
0
20
40
60
80
100
Patients selected for simulated review (%)
C
BrEaST at the two review settings
Same 16 low-quality masks
Detected (%)
100
90
80
70
60
50
13/16 (81.25%)
10/16 (62.50%)
14/16 (87.50%)
13/16 (81.25%)
Locked thresholds
A 35/252, B 33/252 flagged
Equal review
50/252 selected per method
Method A
Method B
Locked threshold
Equal review