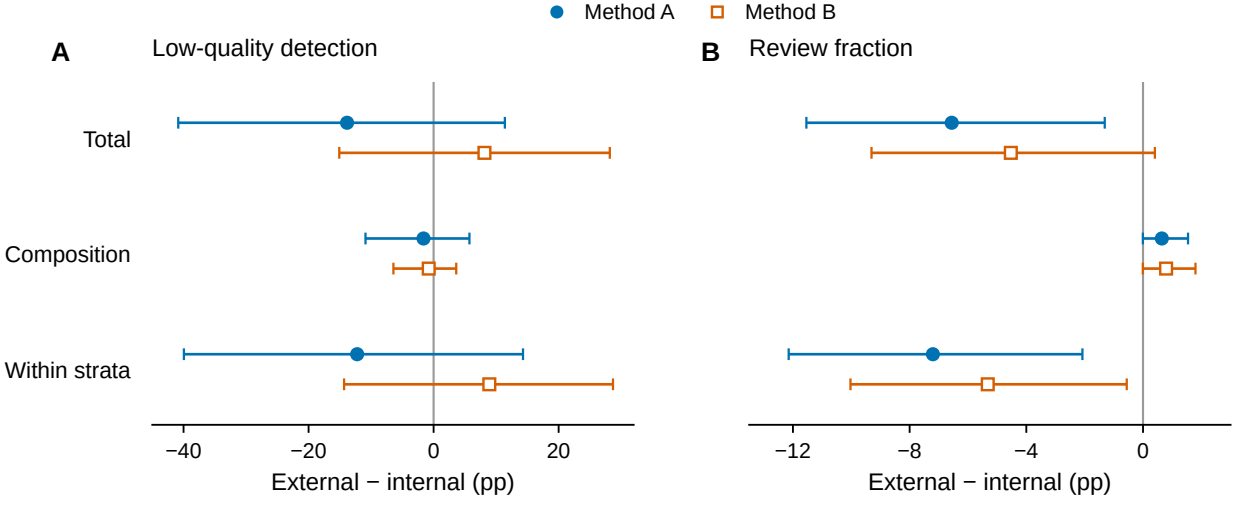
Method A
Method B
A
Low-quality detection
Total
Composition
Within strata
−40
−20
0
20
External − internal (pp)
B
Review fraction
−12
−8
−4
0
External − internal (pp)