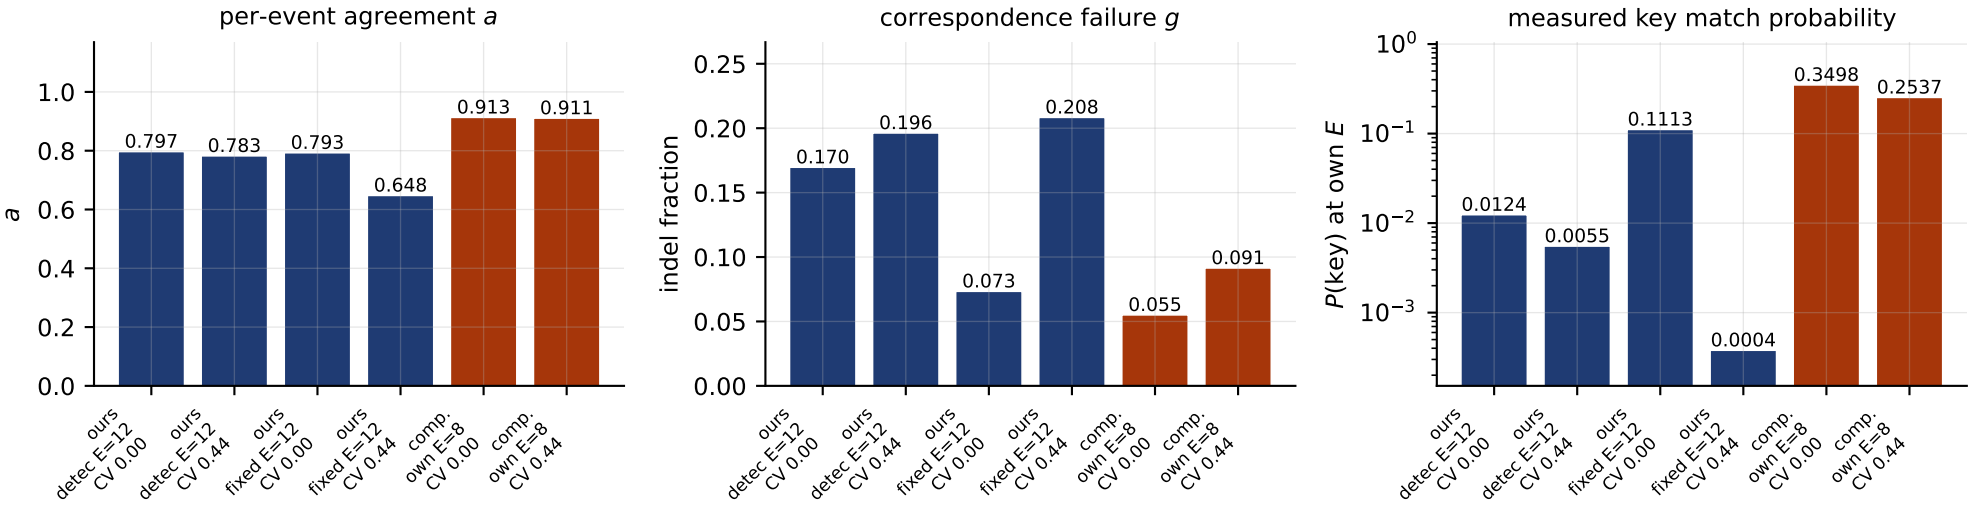Figure 7.2 Both systems under one estimator, identical input (§7.4.5)
a 31-fold difference in anchor supply accounts for 18.8% against 92.4% accuracy