PROTECTA® FR ACRYLIC

INSTALLATION INSTRUCTIONS

CONTENTS

Solutions in rigid floors ..... pages 2-15
Solutions in flexible and rigid floors ..... pages 15-22
Solutions in timber floors ..... pages 22-24
Solutions in rigid walls ..... pages 24-31
Solutions in flexible and rigid walls ..... pages 31-46
Solutions in panel walls ..... pages 46-54
Solutions in timber walls ..... pages 54-57
INDEX for detailed drawings ..... pages 58-60

Please refer to Protecta® FR Damper for guidance on fire sealing ventilation ducts. Please also refer to the Technical Data Sheet.

GENERAL GUIDE

Minimum separations and limitations: Minimum separation between services and the edge of the seal within each aperture should be 10mm to allow for correct fitting of backing and seal depth, however, less width will sustain fire resistance if correct fitting of the fire seal is achieved. Minimum separation between apertures is not required, except where the required fire classification is equal to, or above EI 180, which requires a minimum separation of 30mm.

Protecta® FR Acrylic seals which involve services penetrating both sides of a flexible wall or floor, may also be used in the situation where the services penetrate one side of the wall or floor only, and the remaining side of the wall or floor is not penetrated at the same point (i.e. the services continue on the inside of the construction).

Supporting constructions: Flexible walls must have a minimum thickness of 75mm and comprise steel or timber studs lined on both faces with minimum 1 layer of 12.5mm thick boards. Flexible wall solutions may also be used in rigid walls with a minimum density of 350 kg/m^3. Panel walls must have a minimum thickness of 100mm and comprise steel sheets, minimum 0.5mm thick, on both sides of a mineral fibre core, with a minimum density of 115 kg/m^3. Timber walls must have a minimum thickness of 100mm and comprise solid wood or cross-laminated timber. Rigid walls must have a minimum thickness of 75mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m^3. Rigid floors must have a minimum thickness of 150mm (except composite floors) and comprise aerated concrete or concrete with a minimum density of 650 kg/m^3. Flexible floors must have a minimum thickness of 228mm and comprise timber joists with minimum 1 layer of 18.0mm thick boards at top face, and 12.5mm at soffit face. Flexible floor solutions may also be used in rigid floors with a minimum density of 350 kg/m^3. Timber floors must have a minimum thickness of 150mm and comprise solid wood or cross-laminated timber. Where single sided top face seals are described in the solutions, these can also be used in composite floors (e.g., concrete filled, steel trapezoidal decking).

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period. Services shall be supported at maximum 350mm away from both faces of the wall constructions and 550mm from the upper face of floor constructions. Where cable trays are discontinued on both sides of the penetration seal, the maximum distance to the trays should be 150 mm. There is no minimum distance required for the fixings of the cable trays, but it is suggested such fixings and the cable trays are constructed so they provide support for the duration of the required fire classification.

Services: Metallic pipes through the system Protecta® FR Acrylic may be used in all angles between 90° and 45° in all directions. Where steel pipes are mentioned, this includes iron pipes. Where PP pipes are mentioned, this includes PP-MV, PP-H, PP-R and similar. Where PE pipes are mentioned, this includes PE-LD, PE-MD, PE-HD, PE-X and similar.



INSTALLATION

1. Where Protecta® FR Acrylic is to be installed against surfaces that cannot tolerate direct contact; appropriate surface preparation should be made (contact Polyseam for guidance in these cases). For paints sensitive to sealing compounds, priming with a PVA primer is recommended.
2. As Protecta® FR Acrylic is water based, in cases where corrosion protection is a problem; some metals may require a barrier between the sealant and the metal surface prior to this installation.
3. When installing Protecta® FR Acrylic in hollow floor slabs, top side seals should be completed double sided without reduction of the seal depth on either side. There must be sufficient thickness of concrete below and above the void for the depth of the fire seal. Where this is not the case, tubular voids should be plugged with stone wool backing material before sealing the aperture.
4. An aperture with or without penetrating services, can include a steel or plastic sleeve casted or friction fitted within rigid constructions. Plastic sleeves should have a maximum wall thickness of 14.6 mm.
5. Before installing Protecta® FR Acrylic, ensure that the surface of all service penetrations and surrounding construction is free from all loose contaminants, dust and grease.
6. In gypsum boards and other loose particle boards, the exposed edges of the board should be wetted with water, or Protecta® FR Acrylic diluted with water to prime the surfaces, helping adhesion and preventing excessive joint shrinkage.
7. Find the required sealant depth and backing material in the detailed drawings on pages 2 to 57. If installation does not have to meet any specific fire specification, it is recommended that a width to depth ratio of 2:1 is utilized, with a minimum depth of 12mm of sealant.
8. Use the required backing material and cut this slightly oversize and insert into the gap ensuring a tight friction fit. If no backing material is required, mineral wool or foam backer rod is ideal. Ensure same sealant depth is used within the entire seal.
9. Fill the gap or joint with Protecta® FR Acrylic to the required depth. Apply the sealant generously to prevent air bubbles. Finish the bead with a moist spatula, pallet knife or brush.
10. Protecta® FR Acrylic can be over-painted with most emulsion or alkyd (gloss) paints.


As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 23/0257, ETA 22/0735, UKTA 22/0031 & UKTA 22/0032

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
1 (60) 2026 5 14

LINEAR SEALS FIRE RESISTANCE EI 180 (E 180)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

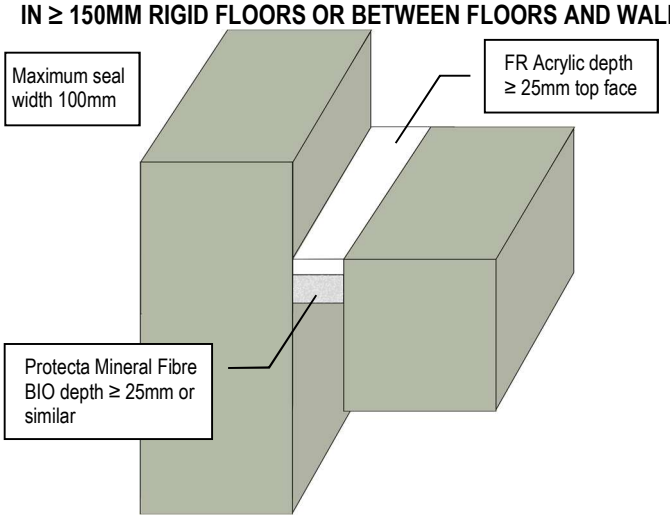

23/0257-A.4.1-2

LINEAR SEALS FIRE RESISTANCE EI 240 (E 240)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

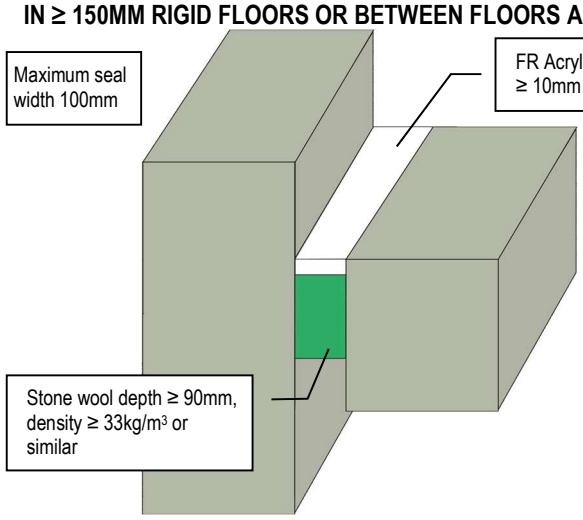

23/0257-A.4.1-6

LINEAR SEALS FIRE RESISTANCE EI 60 (E 120)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

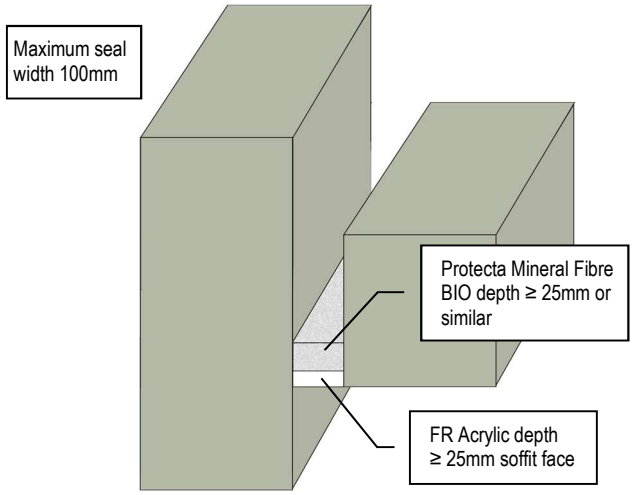

23/0257-A.4.1-1

LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

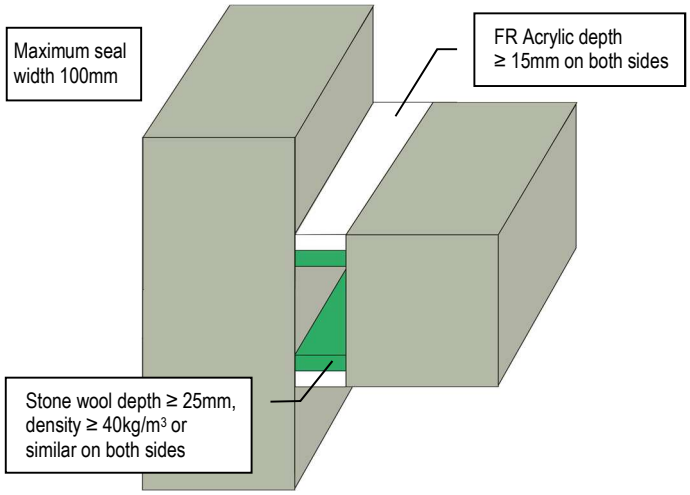

23/0257-A.4.1-3

LINEAR SEALS FIRE RESISTANCE EI 180 (E 180)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

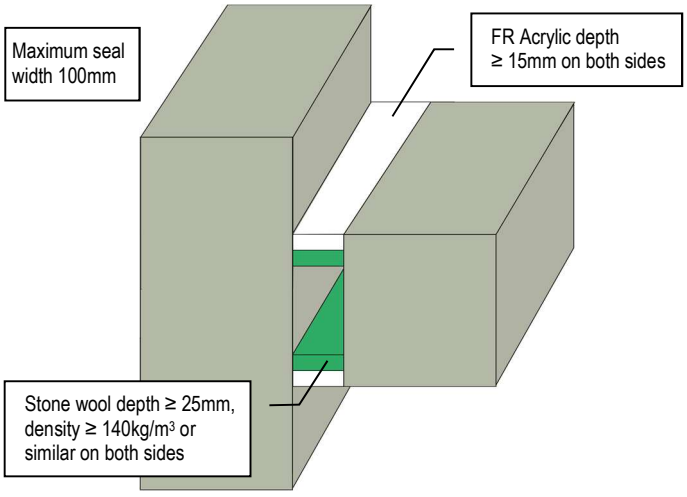

23/0257-A.4.1-4

LINEAR SEALS FIRE RESISTANCE EI 240 (E 240)

IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

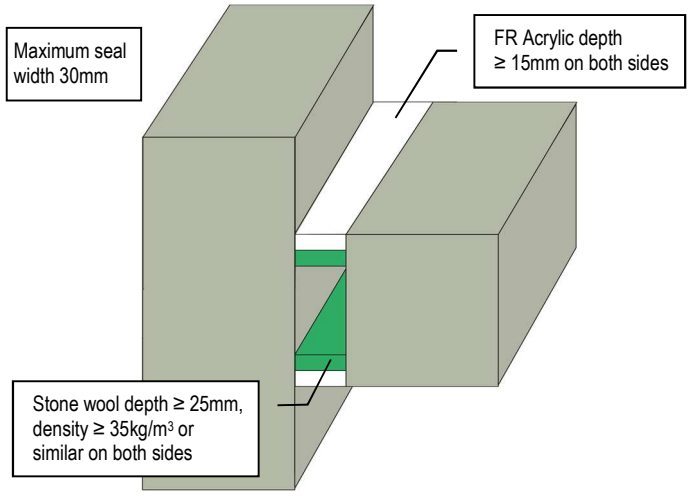


23/0257-A.4.1-5

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

LINEAR SEALS FIRE RESISTANCE EI 30 (E 240)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

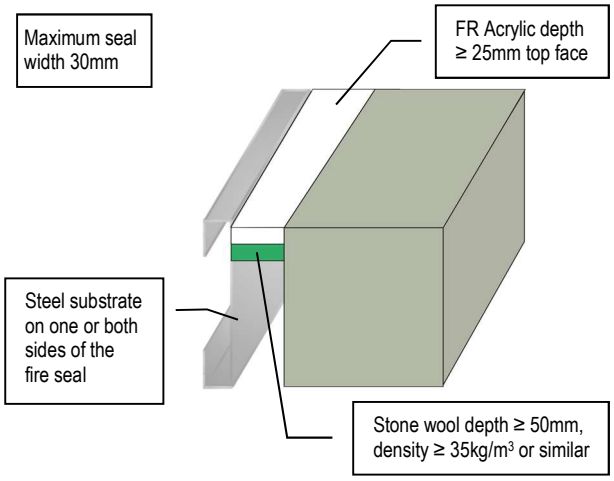

23/0257-A.4.2-1

LINEAR SEALS FIRE RESISTANCE EI 60 (E 240)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

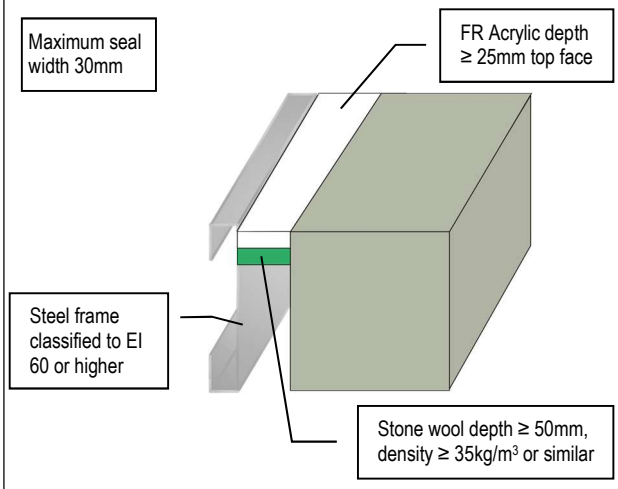

23/0257-A.4.2-4

LINEAR SEALS FIRE RESISTANCE EI 45 (E 240)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

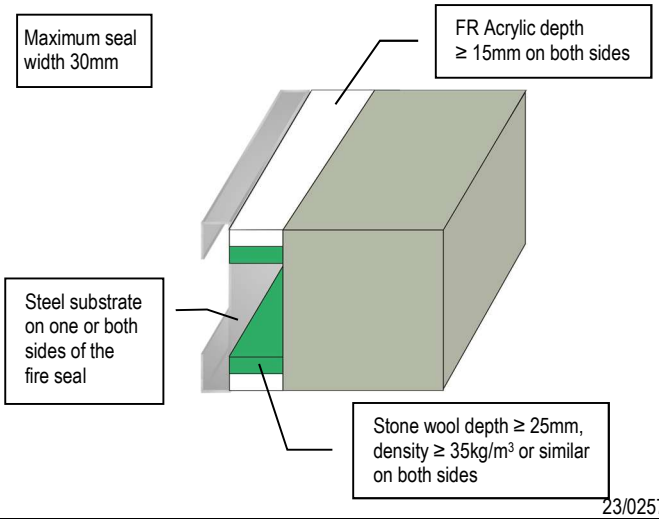

23/0257-A.4.2-2

LINEAR SEALS FIRE RESISTANCE EI 120 (E 240)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

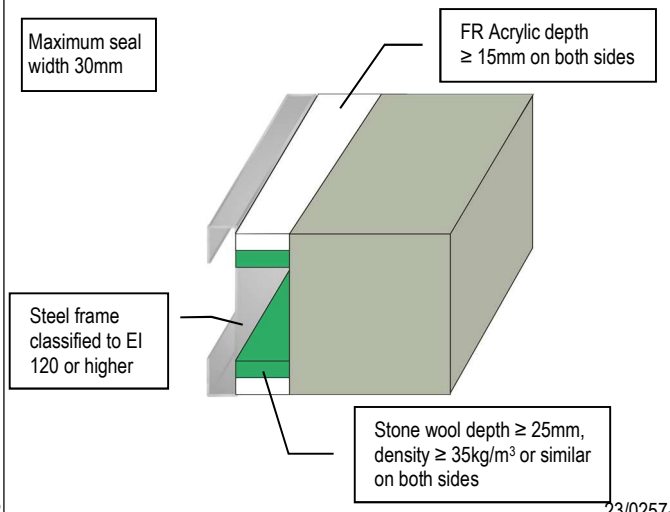

23/0257-A.4.2-5

LINEAR SEALS FIRE RESISTANCE EI 20 (E 180)


IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

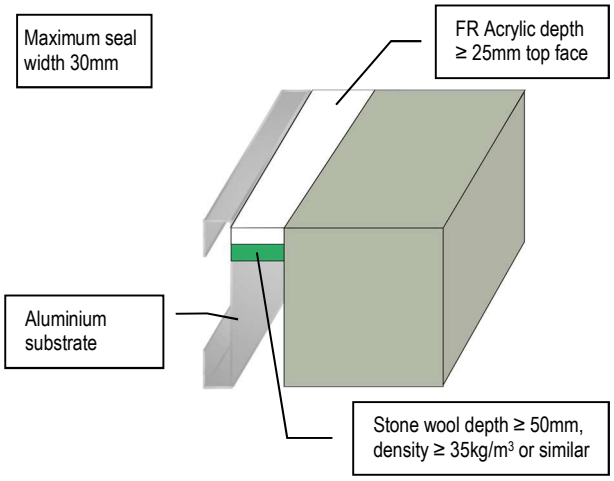

23/0257-A.4.2-3

LINEAR SEALS FIRE RESISTANCE EI 60 (E 180)

IN ≥ 150MM RIGID FLOORS OR BETWEEN FLOORS AND WALLS

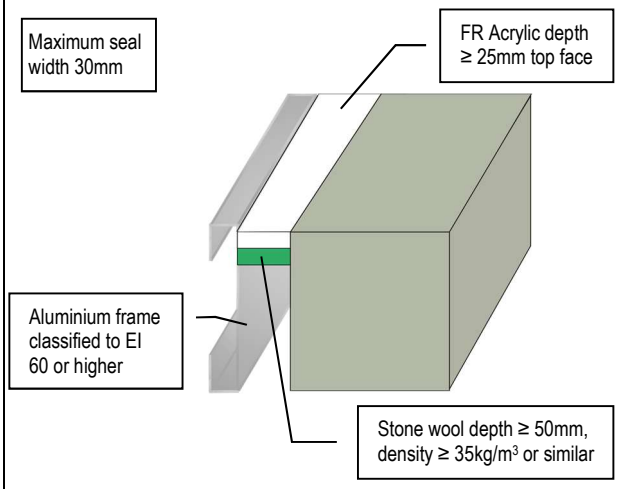


23/0257-A.4.2-6

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CABLE FIRE RESISTANCE EI 60 (E 120)


≥ 150MM RIGID FLOORS

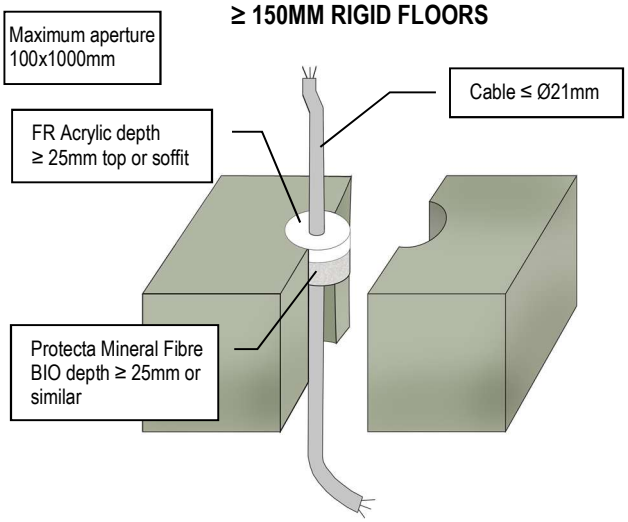

22/0735-A.6.1-1

CABLE FIRE RESISTANCE EI 90 (E 120)


≥ 150MM RIGID FLOORS

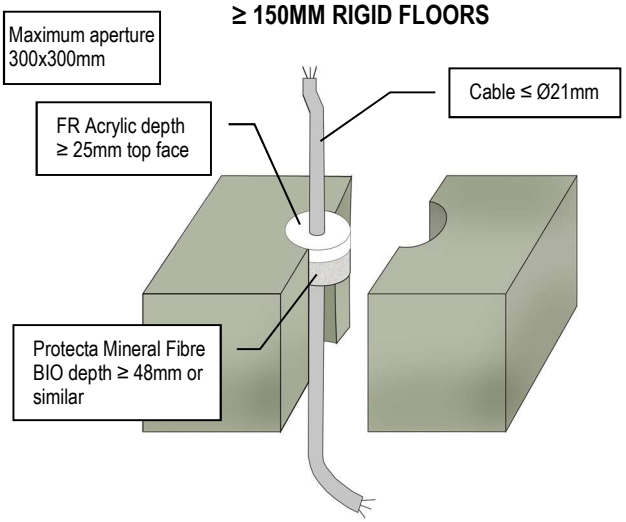

22/0735-A.6.2-4

CABLE FIRE RESISTANCE EI 240 (E 240)


≥ 150MM RIGID FLOORS

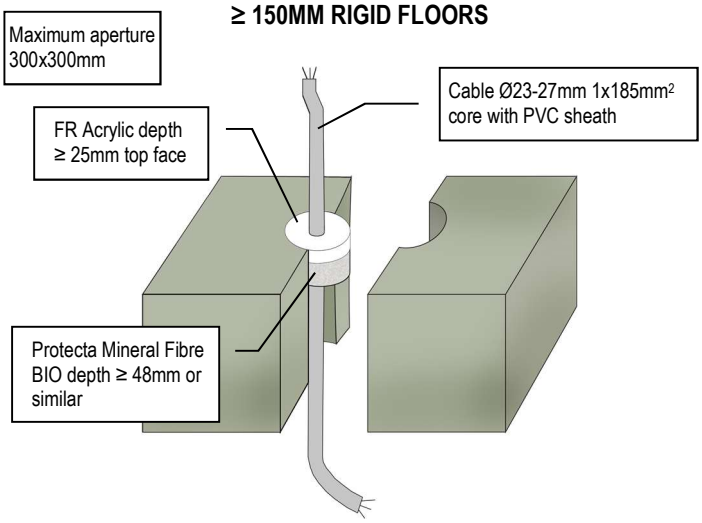

22/0735-A.6.2-5

CABLES FIRE RESISTANCE EI 120 (E 120)


≥ 150MM RIGID FLOORS

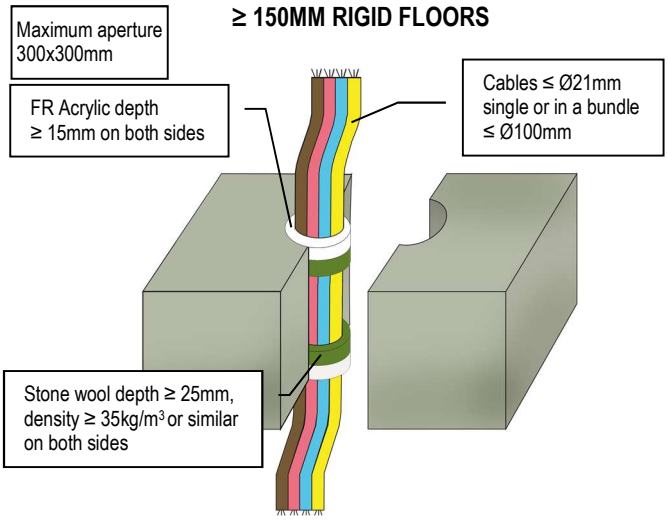

22/0735-A.6.5-1

CABLES FIRE RESISTANCE EI 90 (E 120)


≥ 150MM RIGID FLOORS

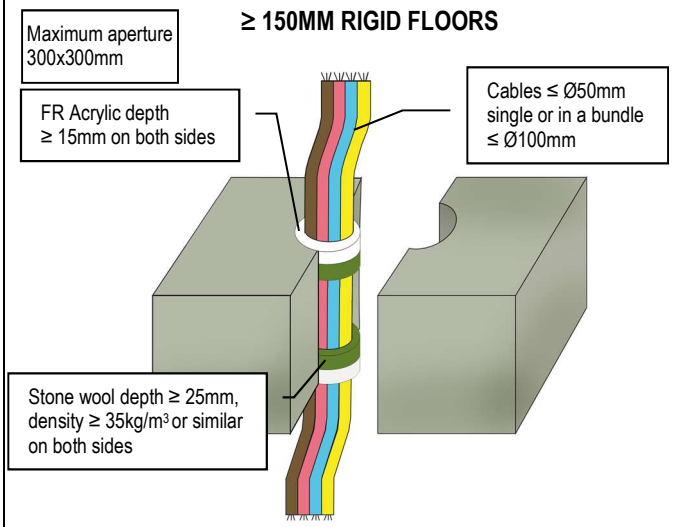

22/0735-A.6.5-2

CABLES FIRE RESISTANCE EI 60 (E 120)

≥ 150MM RIGID FLOORS

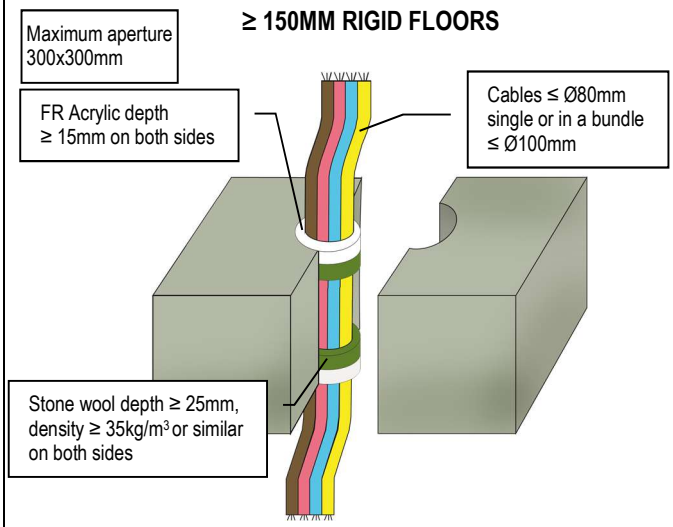


22/0735-A.6.5-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

UNISTRUT CHANNEL FIRE RESISTANCE EI 180 (E 180)


≥ 150MM RIGID FLOORS

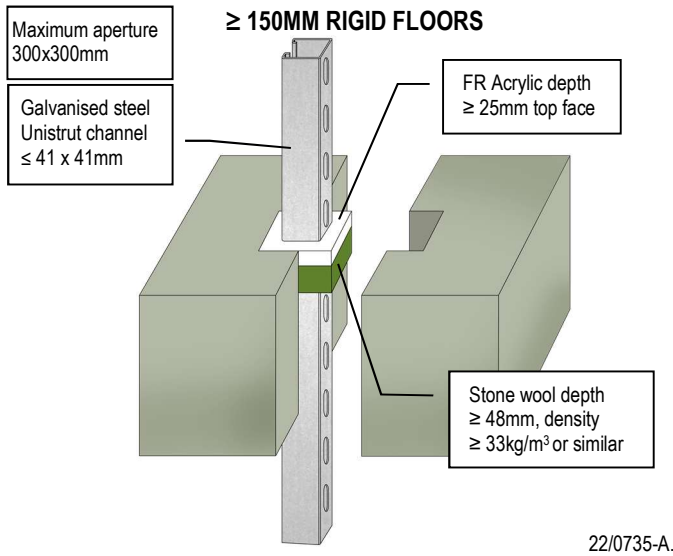

22/0735-A.6.2-6

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 150MM RIGID FLOORS

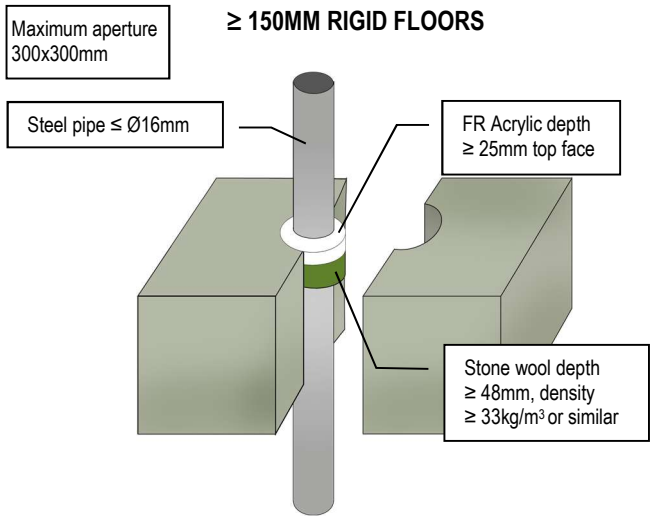

22/0735-A.6.3-1

STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID FLOORS

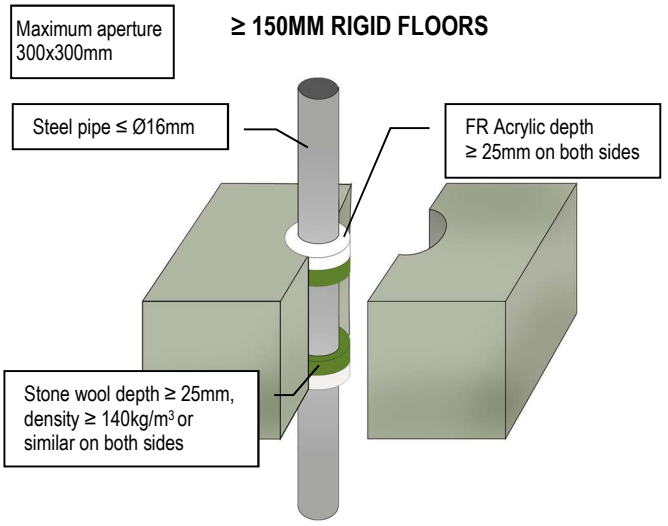

22/0735-A.6.10-3

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 240)


≥ 150MM RIGID FLOORS

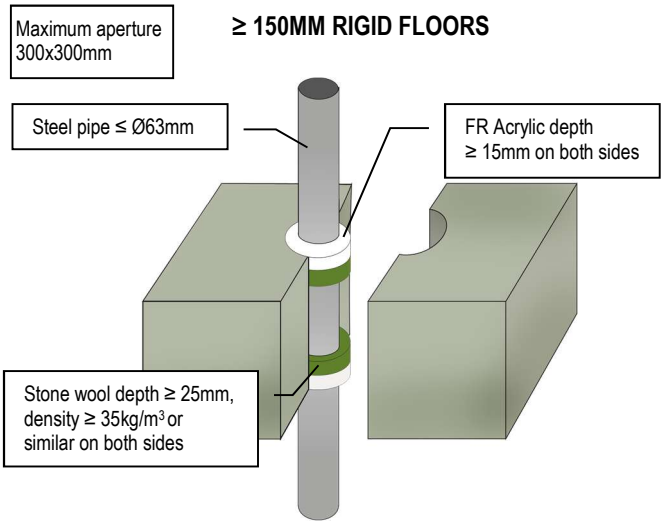

22/0735-A.6.10-4

STEEL PIPE FIRE RESISTANCE E 120 C/U


≥ 150MM RIGID FLOORS

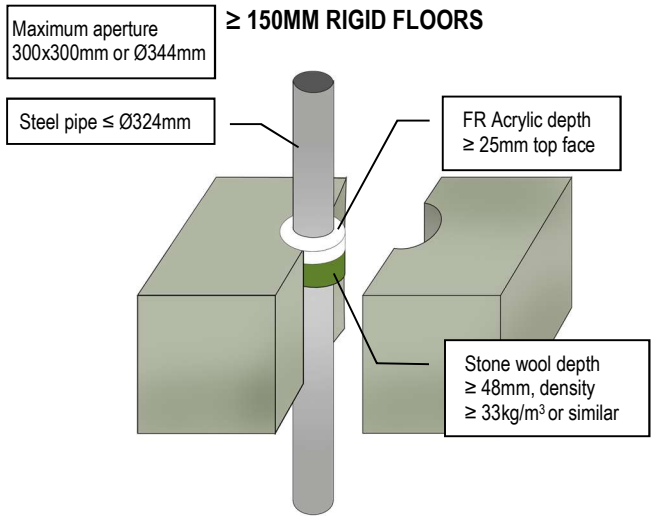

22/0735-A.6.3-2

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 150MM RIGID FLOORS

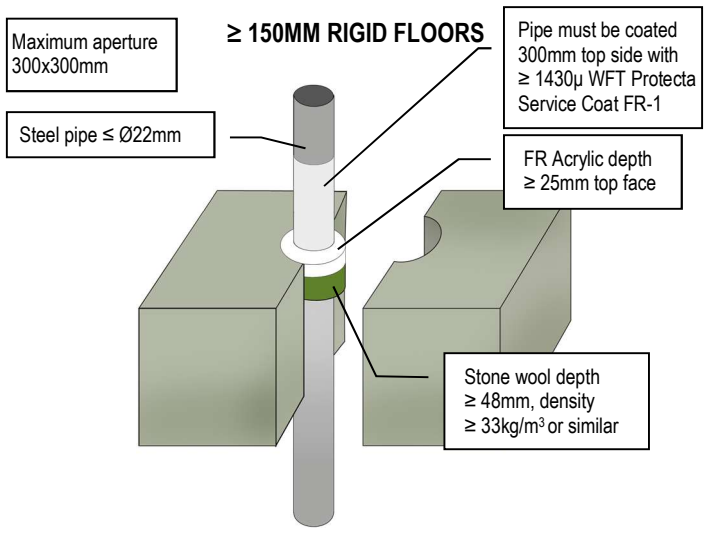

22/0735-A.6.8-5


As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 240)

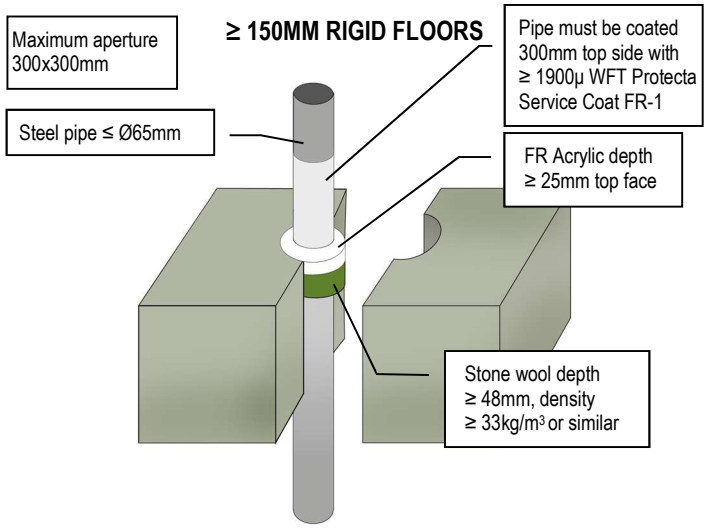


22/0735-A.6.8-6

STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 120)

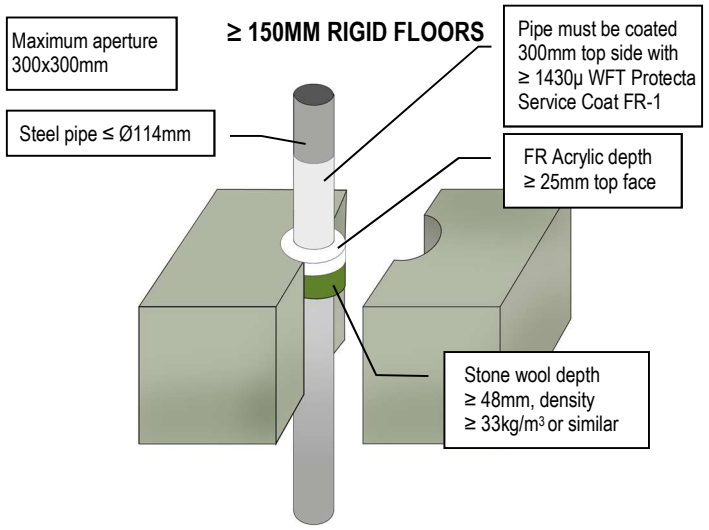


22/0735-A.6.8-7

INSULATED STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)

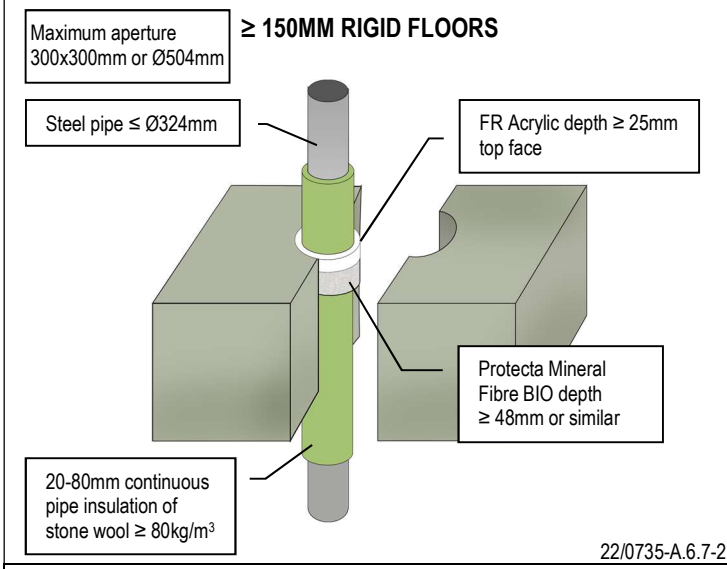


22/0735-A.6.7-2

INSULATED STEEL PIPE FIRE RESISTANCE EI 90 C/C (E 120)

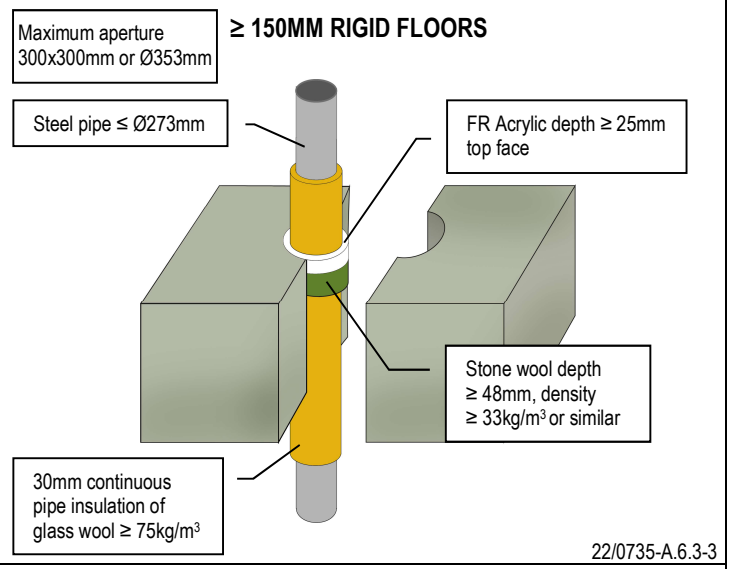


22/0735-A.6.3-3

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)

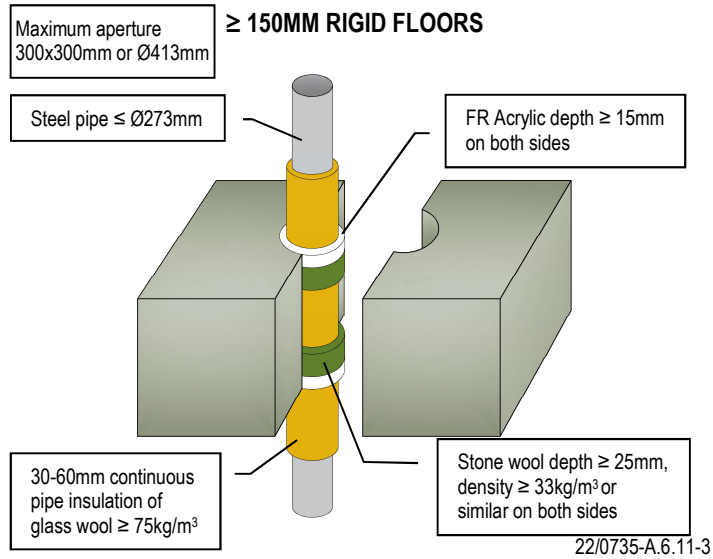

22/0735-A.6.11-3

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 90)

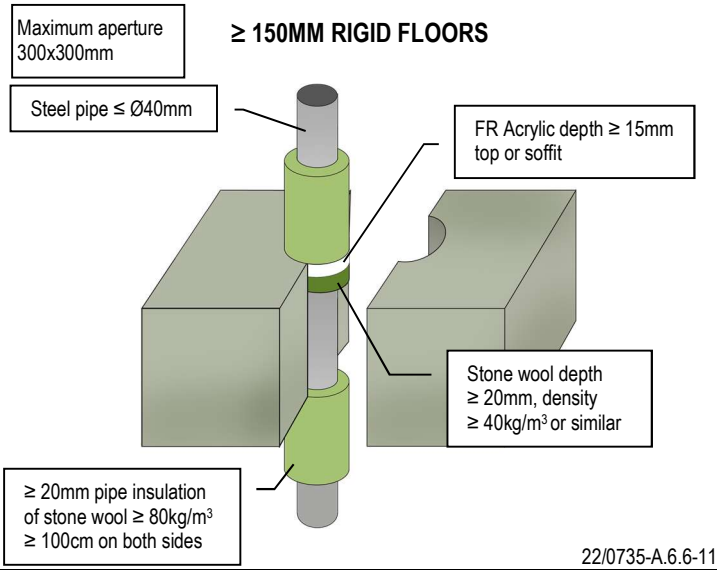


22/0735-A.6.6-11

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 150MM RIGID FLOORS

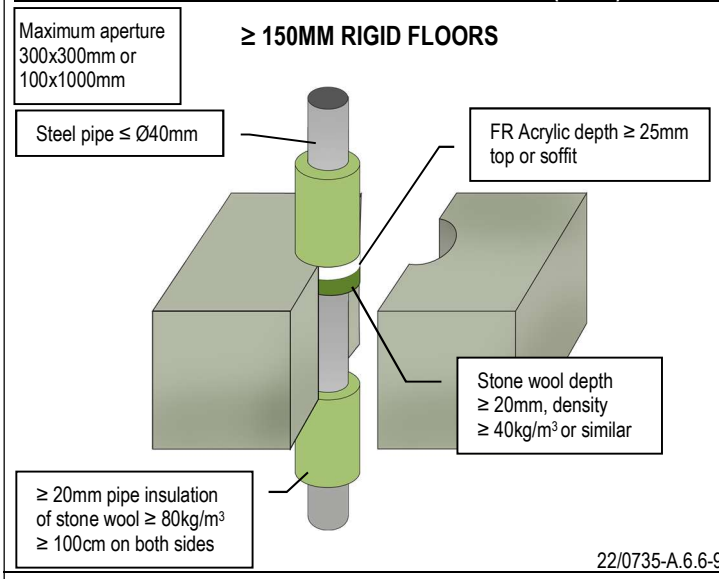

22/0735-A.6.6-9

STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID FLOORS

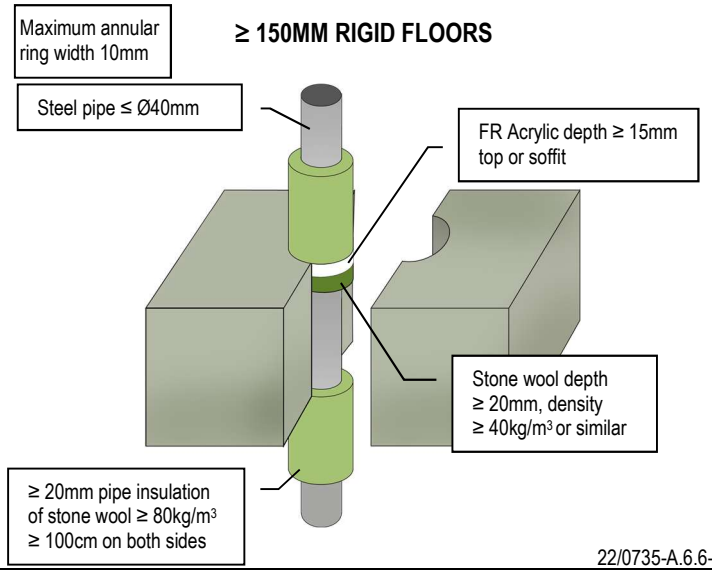

22/0735-A.6.6-7

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 90)


≥ 150MM RIGID FLOORS

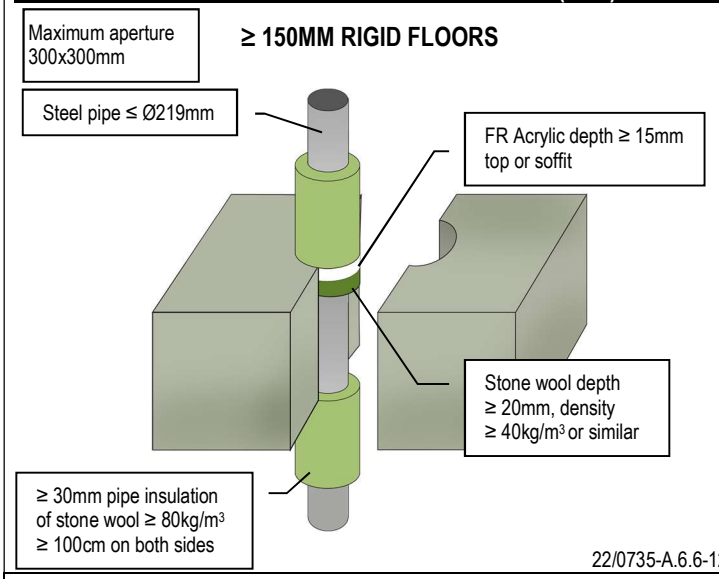

22/0735-A.6.6-12

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 150MM RIGID FLOORS

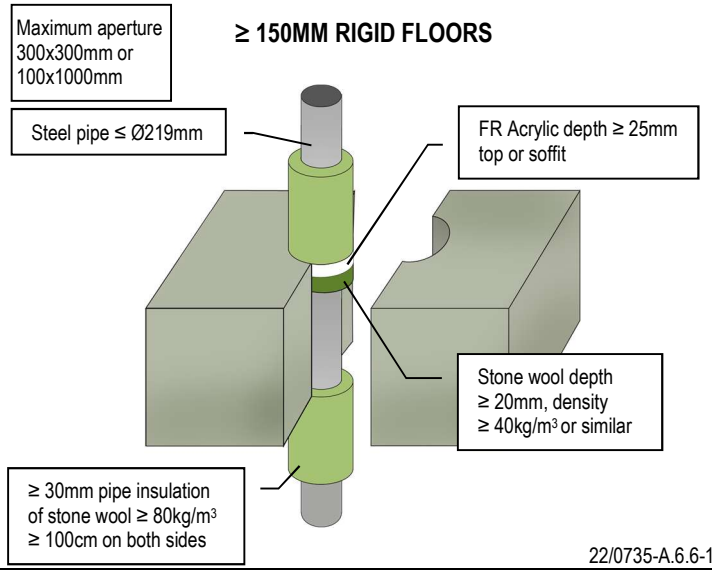

22/0735-A.6.6-10

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 240)


≥ 150MM RIGID FLOORS

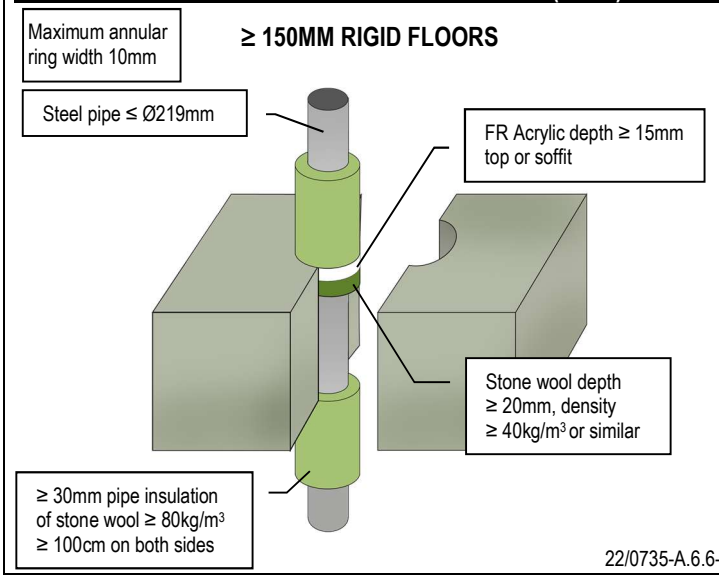

22/0735-A.6.6-8

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 240)

≥ 150MM RIGID FLOORS

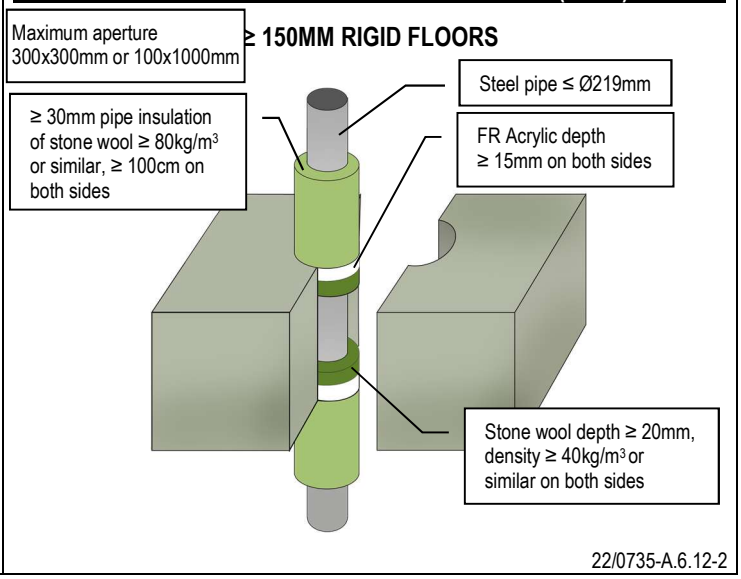


22/0735-A.6.12-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 180)


≥ 150MM RIGID FLOORS

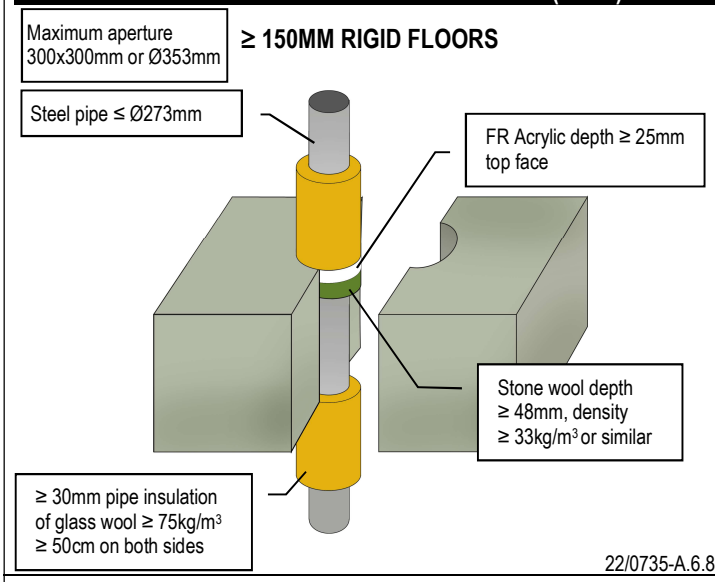

22/0735-A.6.8-8

INSULATED STEEL PIPE FIRE RESISTANCE EI 180 C/U (E 180)


≥ 150MM RIGID FLOORS

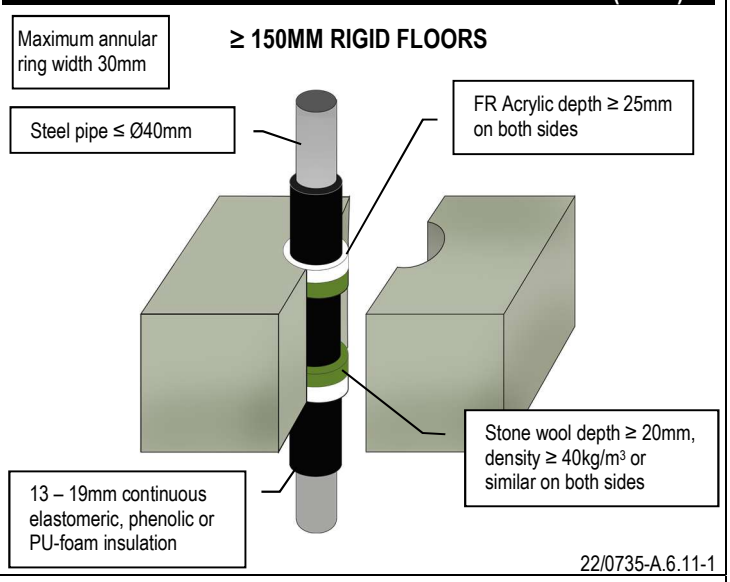

22/0735-A.6.11-1

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 150MM RIGID FLOORS

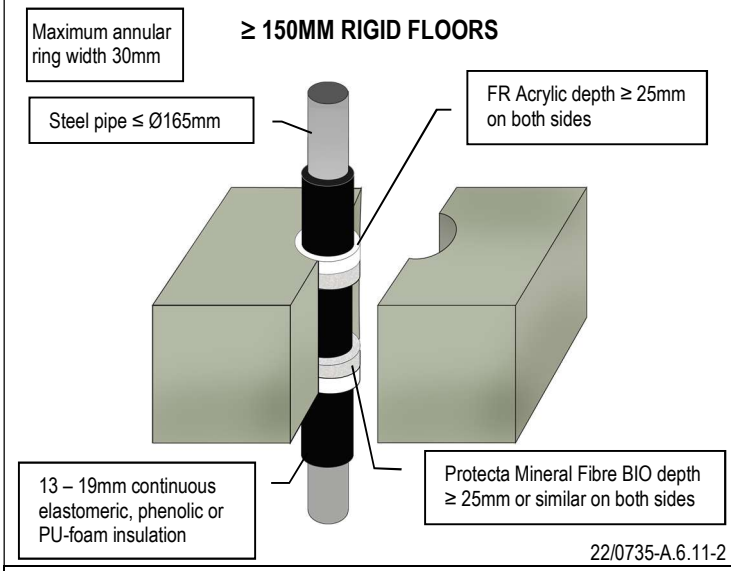

22/0735-A.6.11-2

GAS PIPE FIRE RESISTANCE EI 120 C/C (E 240)


≥ 150MM RIGID FLOORS

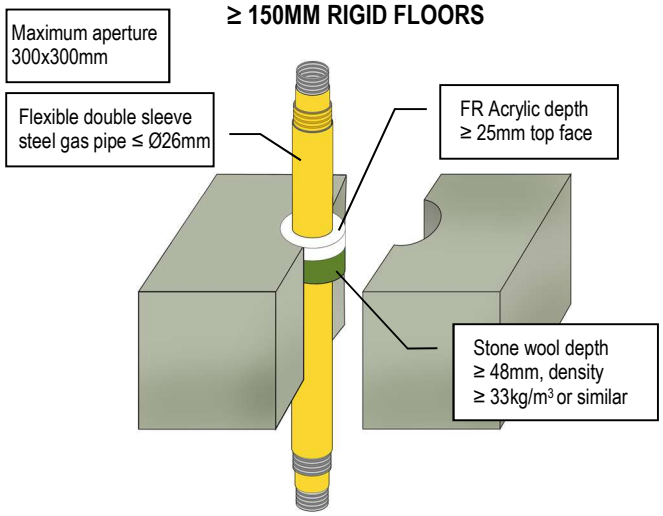

22/0735-A.6.3-15

GAS PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 150MM RIGID FLOORS

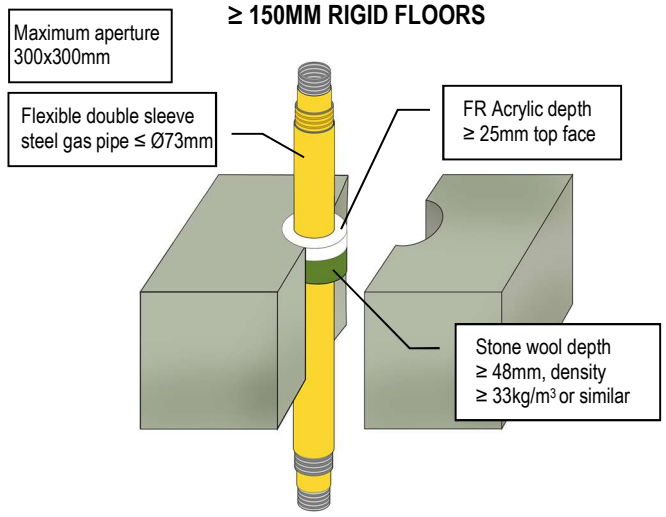

22/0735-A.6.3-16

COPPER PIPE FIRE RESISTANCE EI 120 C/C (E 120)

≥ 150MM RIGID FLOORS

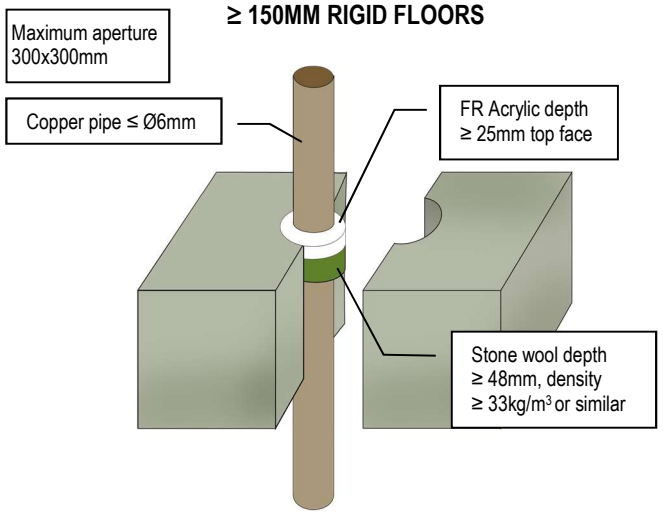


22/0735-A.6.3-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 150MM RIGID FLOORS

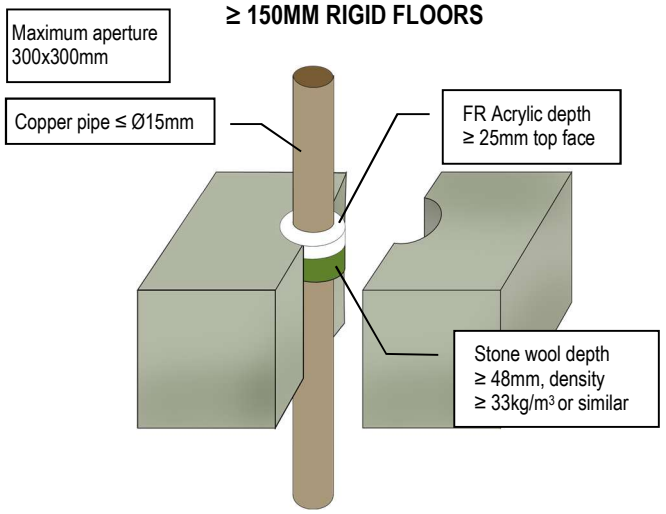

22/0735-A.6.3-5

COPPER PIPE FIRE RESISTANCE E 120 C/C


≥ 150MM RIGID FLOORS

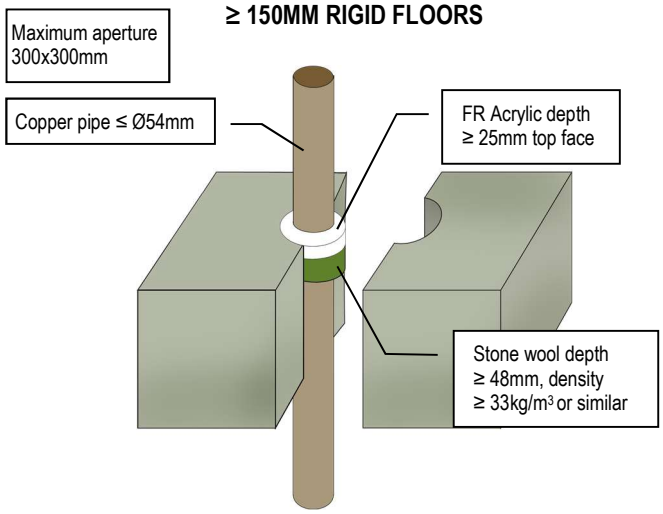

22/0735-A.6.3-6

COPPER PIPE FIRE RESISTANCE EI 20 C/U (E 120)


≥ 150MM RIGID FLOORS

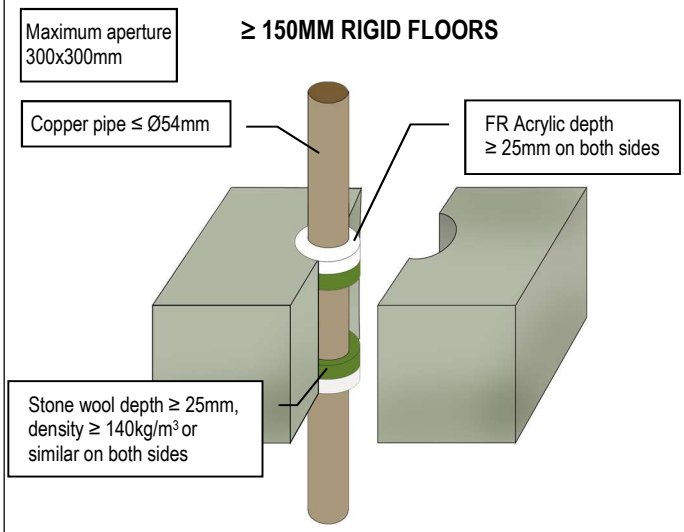

22/0735-A.6.10-1

INSULATED COPPER PIPE FIRE RESISTANCE EI 240 C/C (E 240)


≥ 150MM RIGID FLOORS

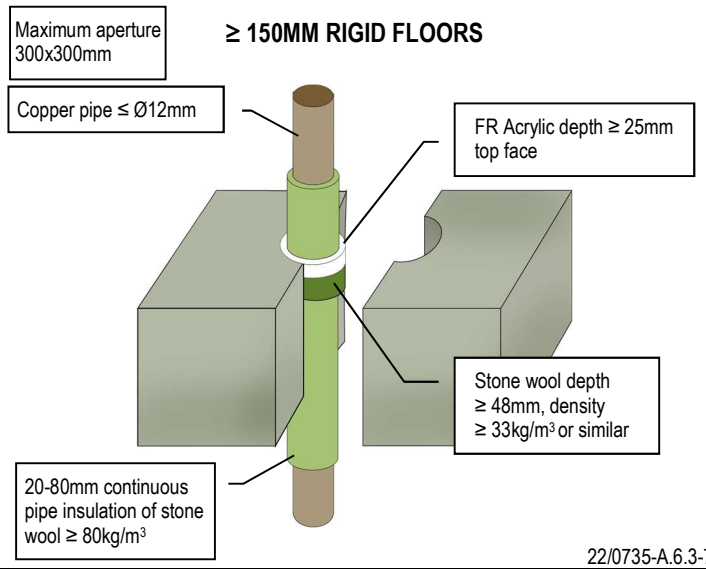

22/0735-A.6.3-7

INSULATED COPPER PIPE FIRE RESISTANCE EI 180 C/C (E 240)


≥ 150MM RIGID FLOORS

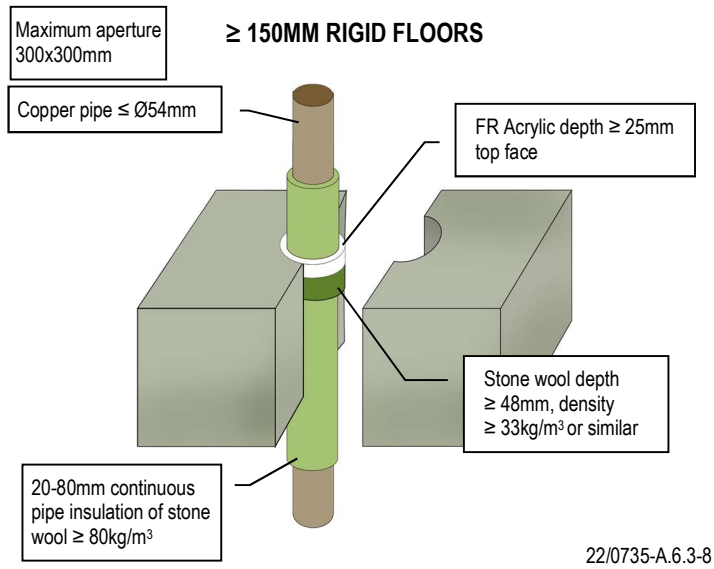

22/0735-A.6.3-8

INSULATED COPPER PIPE FIRE RESISTANCE EI 120 C/C (E 120)

≥ 150MM RIGID FLOORS

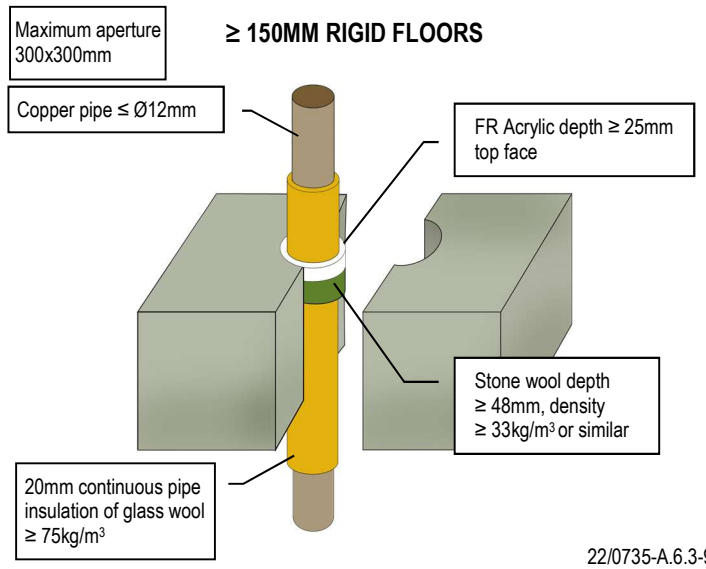


22/0735-A.6.3-9

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED COPPER PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 150MM RIGID FLOORS

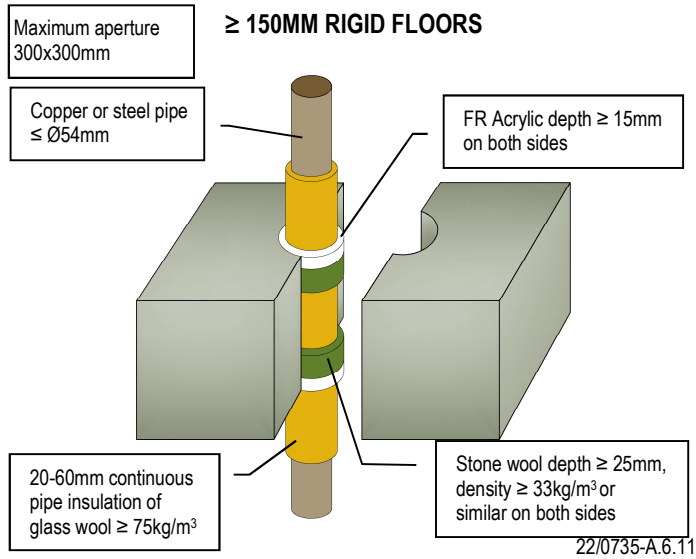

22/0735-A.6.11-7

COPPER PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID FLOORS

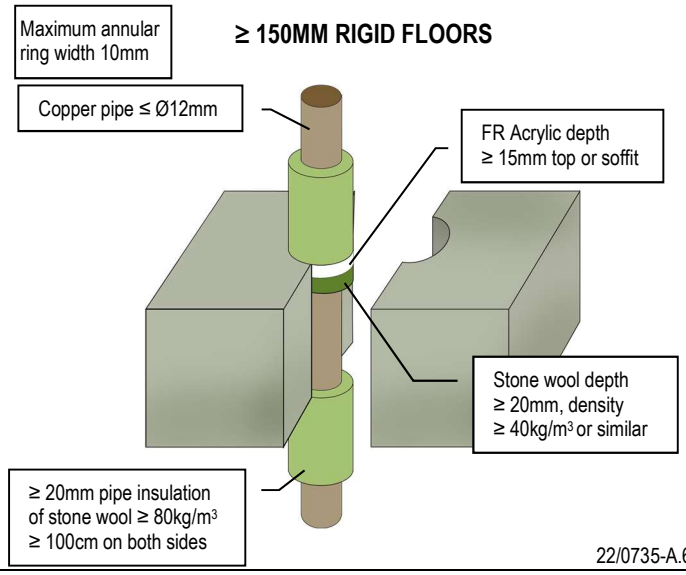

22/0735-A.6.6-2

COPPER PIPE FIRE RESISTANCE EI 60 C/U (E 90)


≥ 150MM RIGID FLOORS

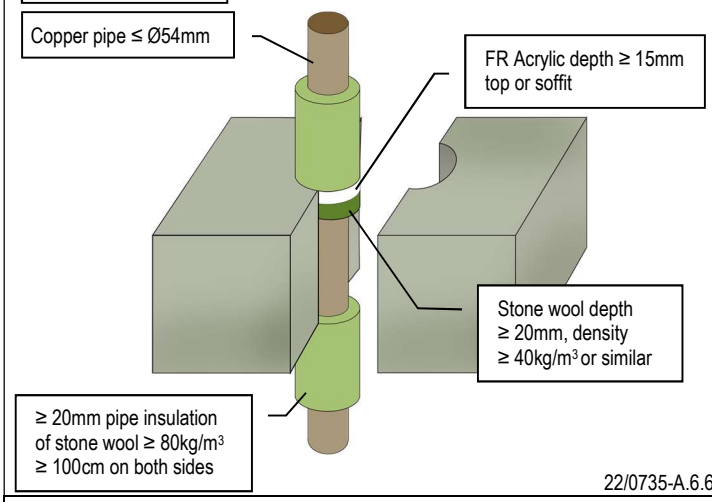

22/0735-A.6.6-4

COPPER OR STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 120)


150MM RIGID FLOORS

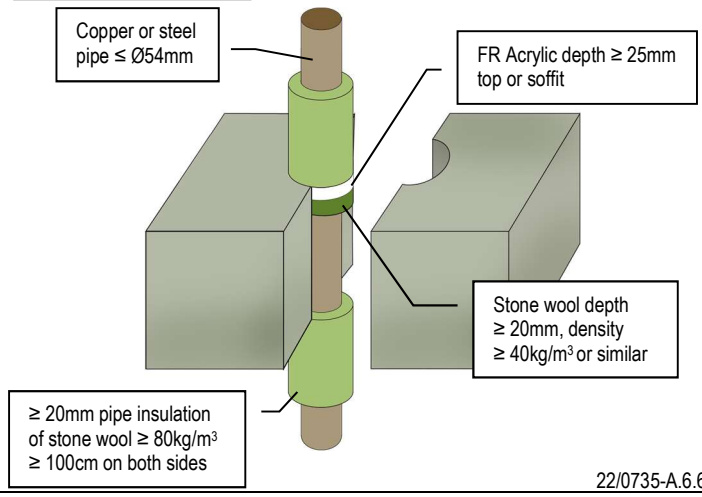

22/0735-A.6.6-3

COPPER OR STEEL PIPE FIRE RESISTANCE EI 180 C/U (E 240)


≥ 150MM RIGID FLOORS

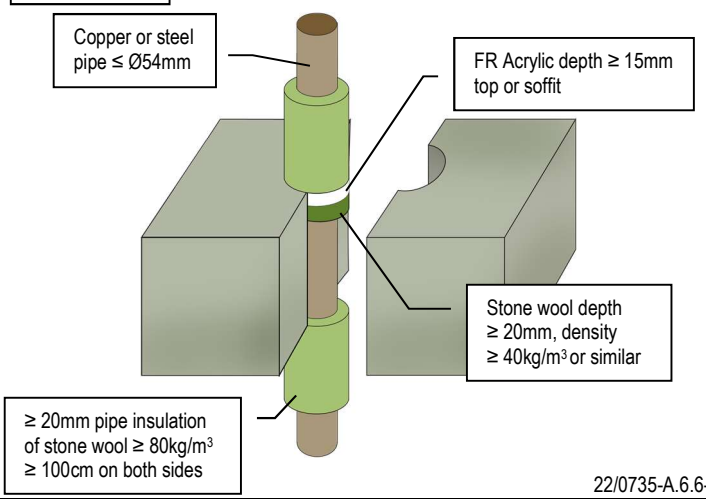

22/0735-A.6.6-1

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 180)

≥ 150MM RIGID FLOORS

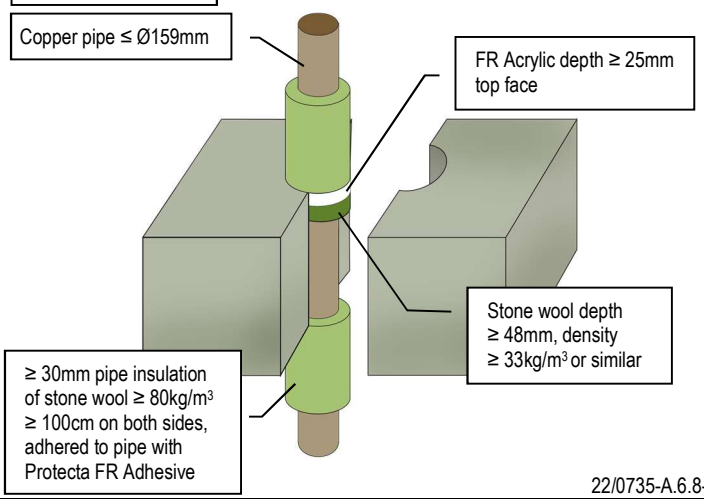


22/0735-A.6.8-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER OR STEEL PIPE FIRE RESISTANCE EI 180 C/C (E 180)

Maximum aperture 300x300mm

≥ 150MM RIGID FLOORS

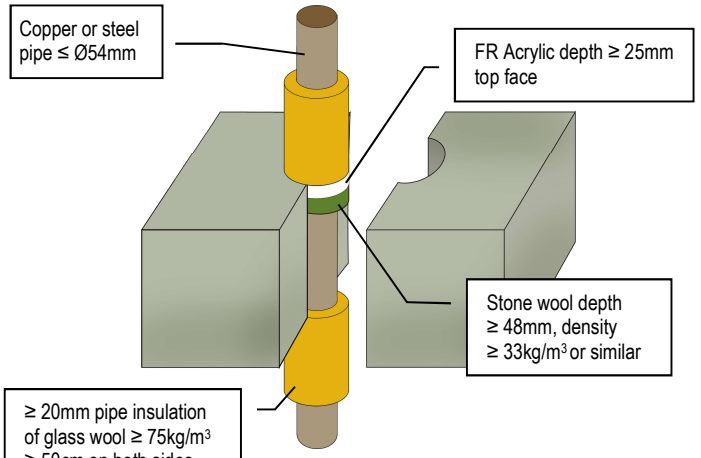


22/0735-A.6.8-1

COPPER PIPE FIRE RESISTANCE EI 30 C/U (E 180)

Maximum aperture 300x300mm

≥ 150MM RIGID FLOORS

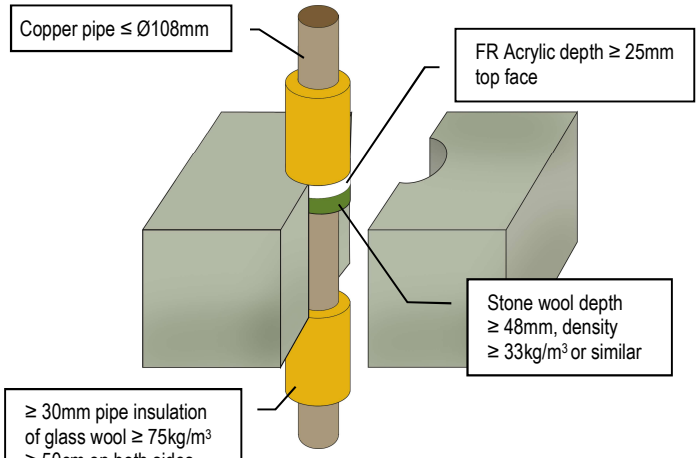


22/0735-A.6.8-2

COPPER OR STEEL PIPE FIRE RESISTANCE EI 180 C/C (E 240)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

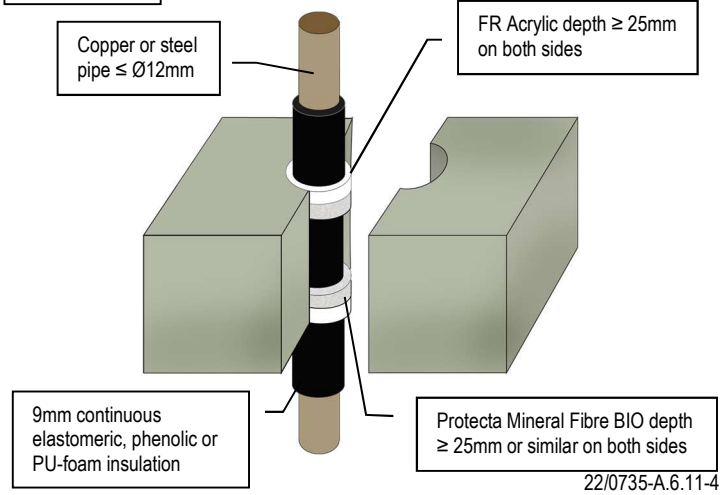


22/0735-A.6.11-4

COPPER OR STEEL PIPE FIRE RESISTANCE EI 120 C/C (E 180)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

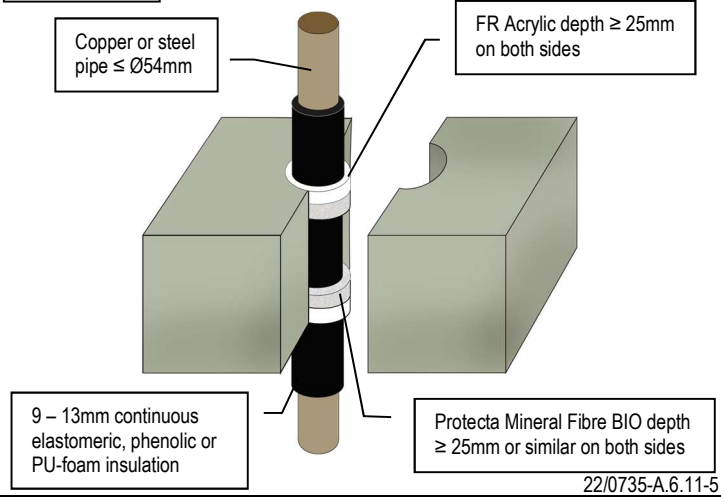


22/0735-A.6.11-5

COPPER OR STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 90)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

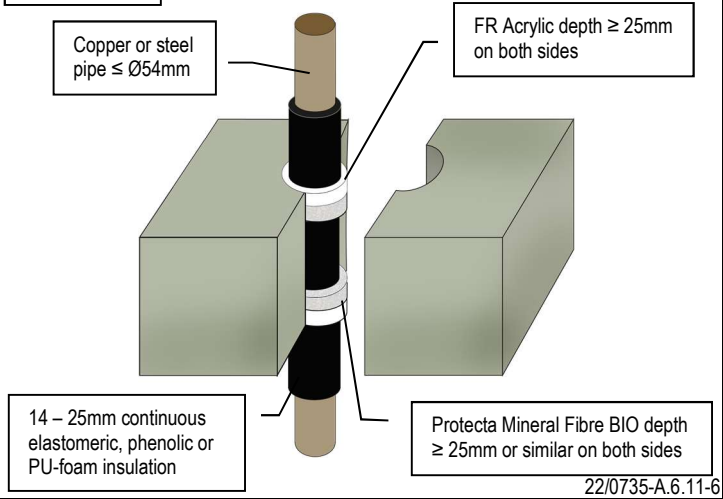


22/0735-A.6.11-6

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)

Maximum aperture 300x300mm

≥ 150MM RIGID FLOORS

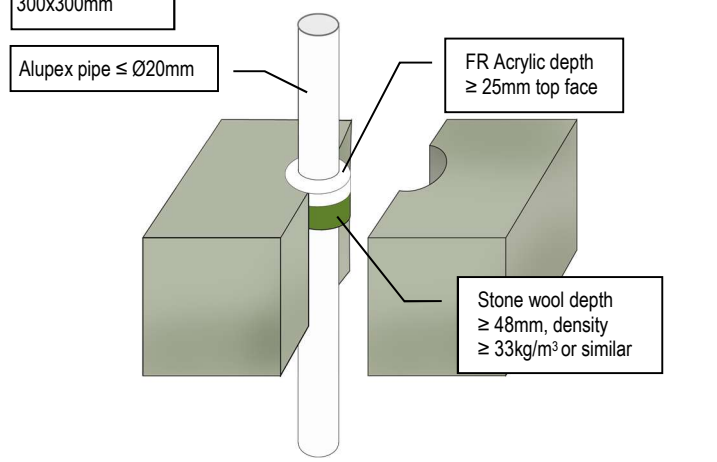


22/0735-A.6.3-10

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 150MM RIGID FLOORS

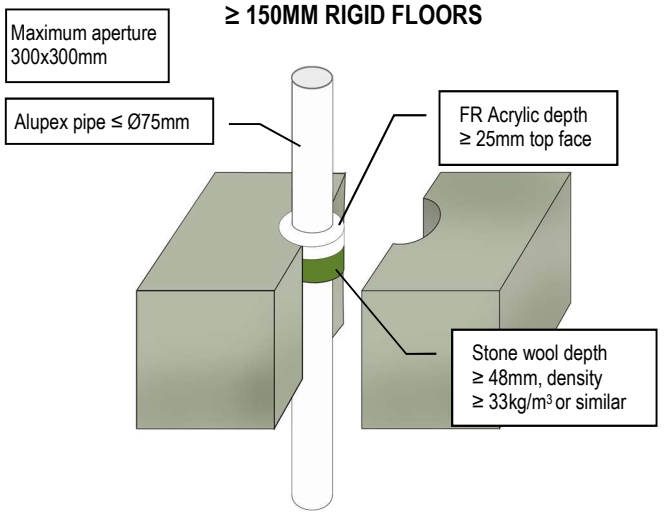

22/0735-A.6.3-11

INSULATED ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 180)


≥ 150MM RIGID FLOORS

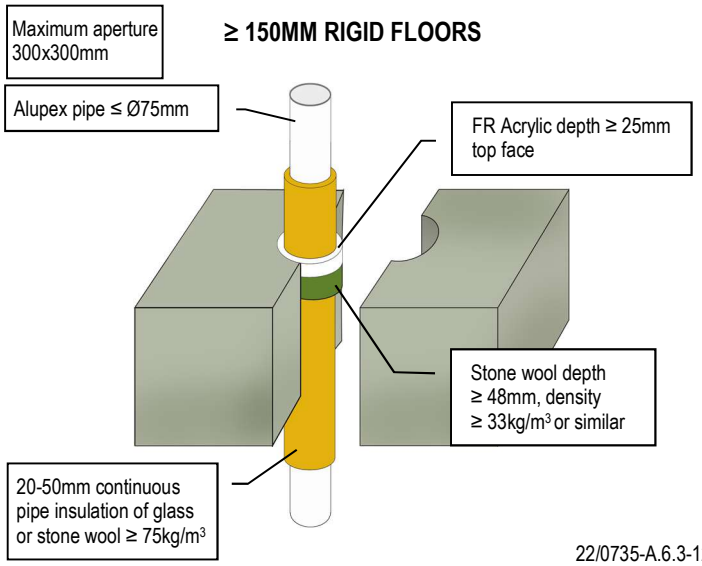

22/0735-A.6.3-12

INSULATED ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 150MM RIGID FLOORS

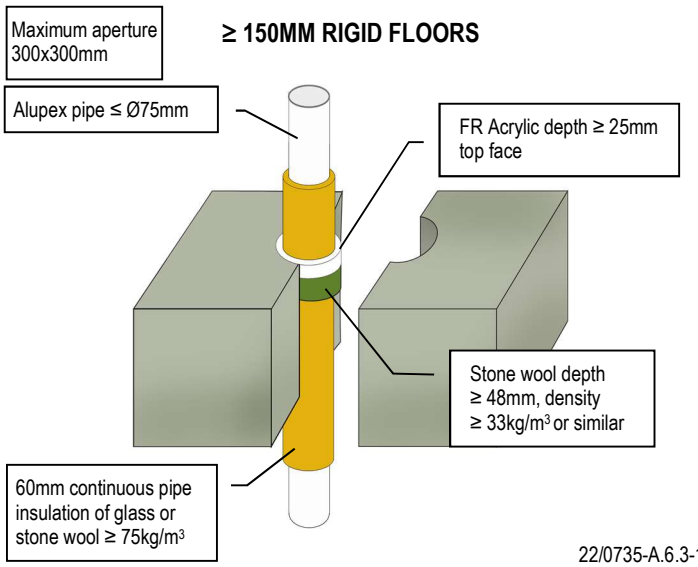

22/0735-A.6.3-13

ALUPEX PIPE FIRE RESISTANCE EI 240 C/C (E 240)


≥ 150MM RIGID FLOORS

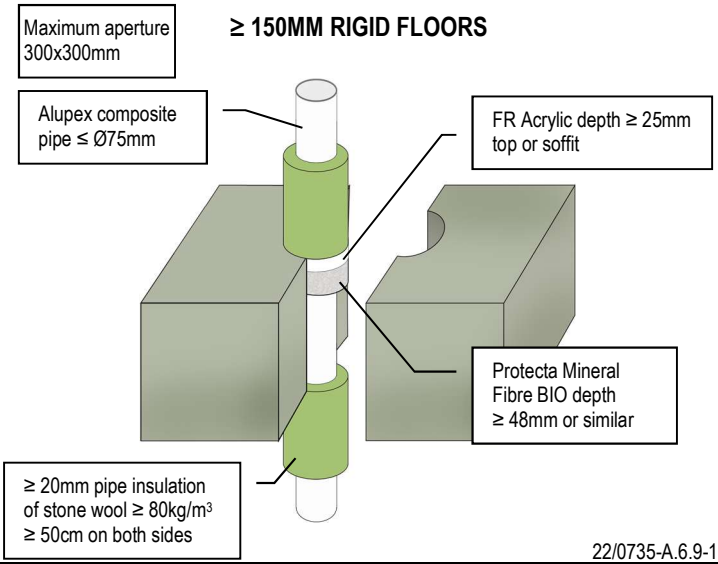

22/0735-A.6.9-1

ALUPEX PIPE FIRE RESISTANCE EI 180 C/C (E 180)


≥ 150MM RIGID FLOORS

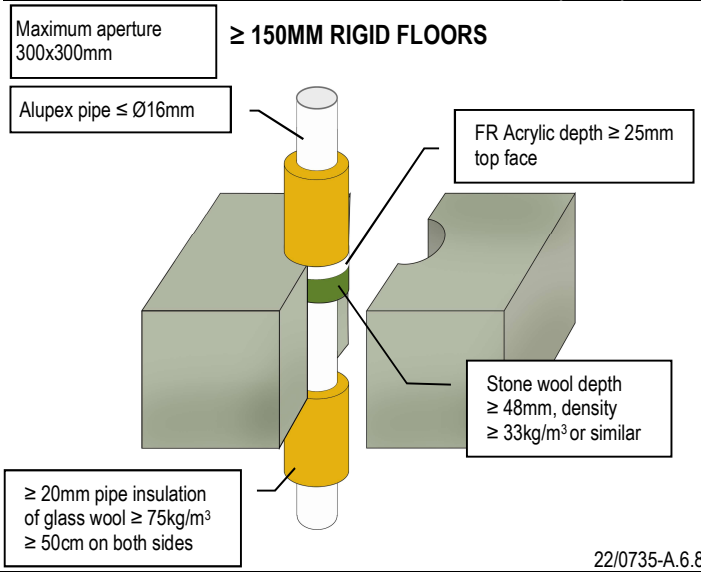

22/0735-A.6.8-9

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 180)

≥ 150MM RIGID FLOORS

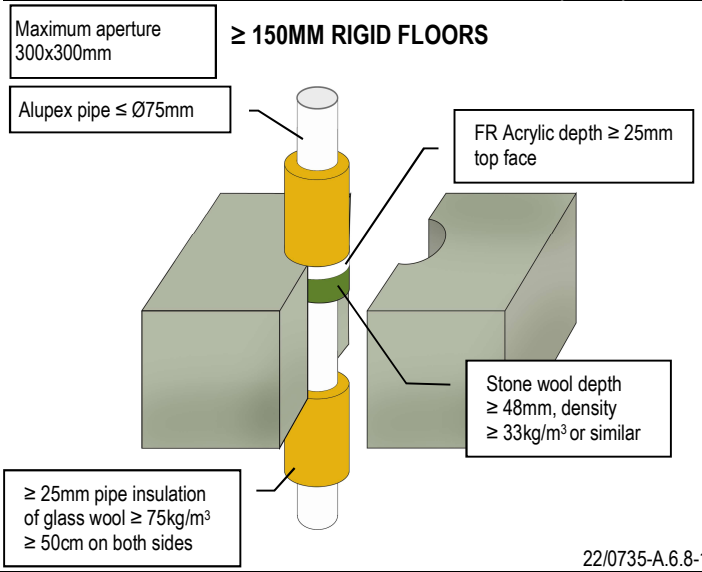

22/0735-A.6.8-10

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.


INSULATED ALUPEX PIPE FIRE RESISTANCE EI 180 C/C (E 180)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

Alupex composite pipe ≤ Ø16mm

FR Acrylic depth ≥ 25mm on both sides

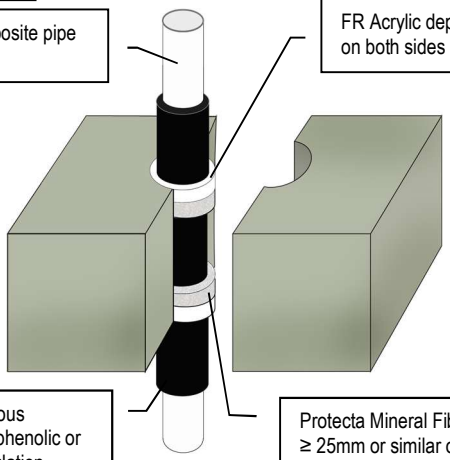

9mm continuous elastomeric, phenolic or PU-foam insulation

Protecta Mineral Fibre BIO depth ≥ 25mm or similar on both sides

22/0735-A.6.11-8


INSULATED ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 120)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

Alupex composite pipe ≤ Ø75mm

FR Acrylic depth ≥ 25mm on both sides

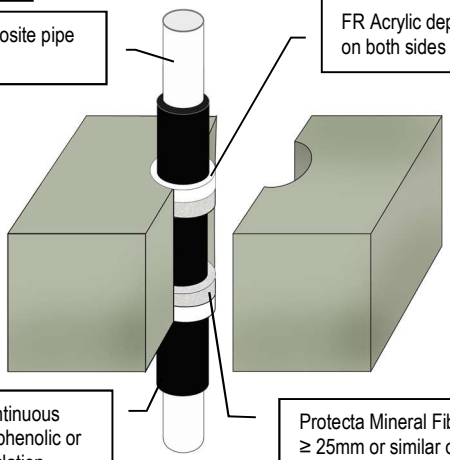

9 - 13mm continuous elastomeric, phenolic or PU-foam insulation

Protecta Mineral Fibre BIO depth ≥ 25mm or similar on both sides

22/0735-A.6.11-9


INSULATED ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

Alupex composite pipe ≤ Ø75mm

FR Acrylic depth ≥ 25mm on both sides

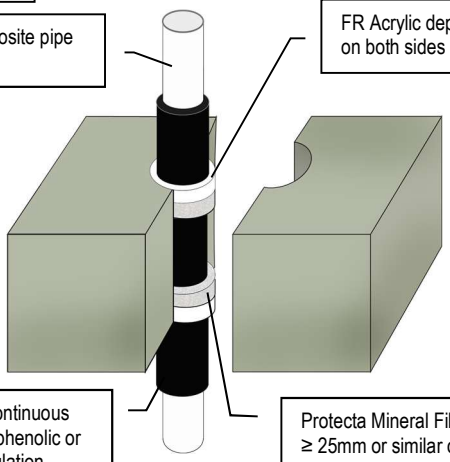

14 - 25mm continuous elastomeric, phenolic or PU-foam insulation

Protecta Mineral Fibre BIO depth ≥ 25mm or similar on both sides

22/0735-A.6.11-10


PVC PLASTIC PIPE FIRE RESISTANCE EI 240 U/C (E 240)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

PVC-U or PVC-C pipe ≤ Ø50mm with wall thickness 1.6-3.7mm

FR Acrylic depth ≥ 25mm on both sides

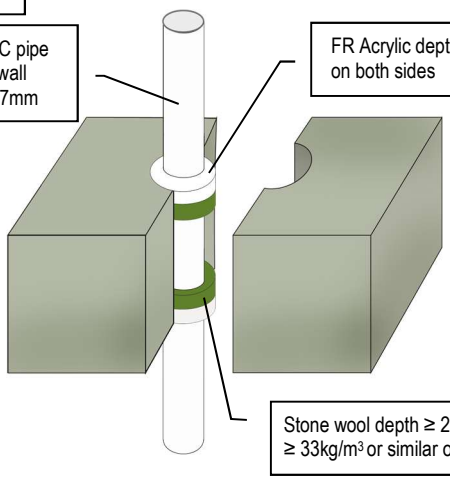

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-1


PE PLASTIC PIPE FIRE RESISTANCE EI 240 U/C (E 240)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

PE, ABS or SAN+PVC pipe ≤ Ø40mm with wall thickness 2.0-3.7mm

FR Acrylic depth ≥ 25mm on both sides

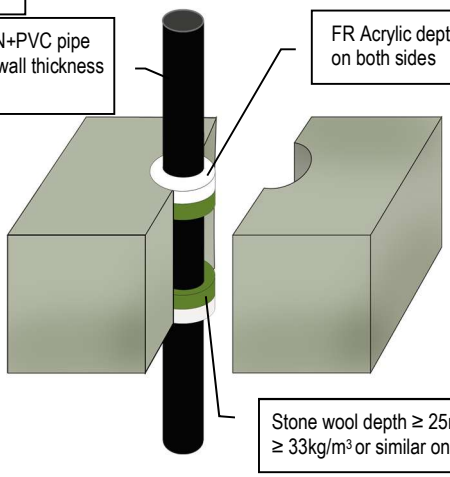

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-7


PP PLASTIC PIPE FIRE RESISTANCE EI 240 U/C (E 240)

Maximum annular ring width 30mm

≥ 150MM RIGID FLOORS

PP pipe ≤ Ø12mm with wall thickness 1.2mm

FR Acrylic depth ≥ 25mm on both sides

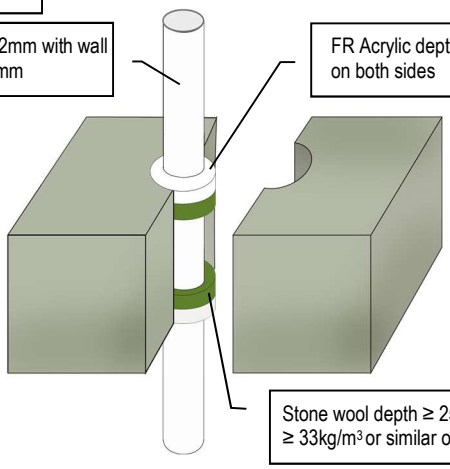

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.


PP PLASTIC PIPE FIRE RESISTANCE EI 180 U/C (E 180)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

PP pipe ≤ Ø40mm with wall thickness 1.2-3.7mm

FR Acrylic depth ≥ 25mm on both sides

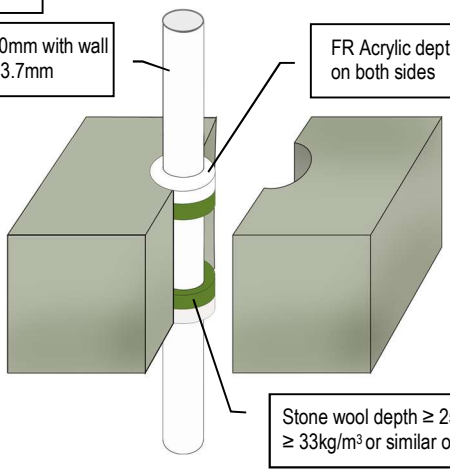

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-4


PP PLASTIC PIPE FIRE RESISTANCE EI 90 U/C (E 90)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

PP pipe ≤ Ø75mm with wall thickness 1.2-6.8mm

FR Acrylic depth ≥ 25mm on both sides

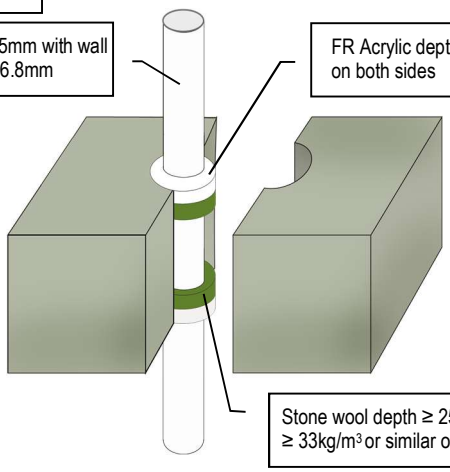

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-5


AQUATECHNIK PIPE FIRE RESISTANCE EI 120 C/C (E 120)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

Aquatechnik Faser Fiber-T pipe ≤ Ø40mm

FR Acrylic depth ≥ 25mm top face

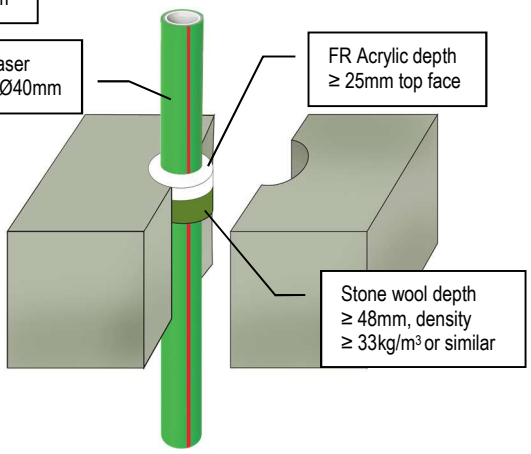

Stone wool depth ≥ 48mm, density ≥ 33kg/m³ or similar

22/0735-A.6.3-14


POLYBUTYLENE PIPE FIRE RESISTANCE EI 240 C/C (E 240)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

Polybutylene pipe ≤ Ø28mm

FR Acrylic depth ≥ 15mm on both sides

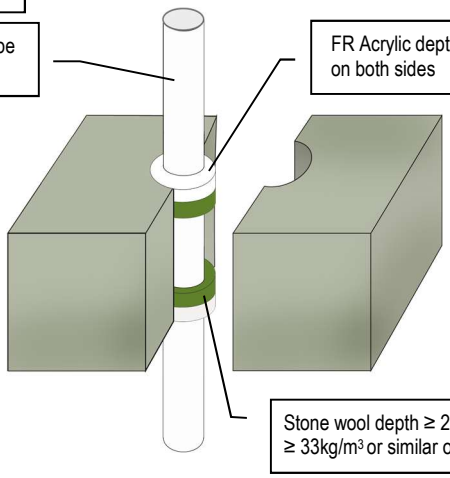

Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-12


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

PEX pipe ≤ Ø25mm

FR Acrylic depth ≥ 25mm top face

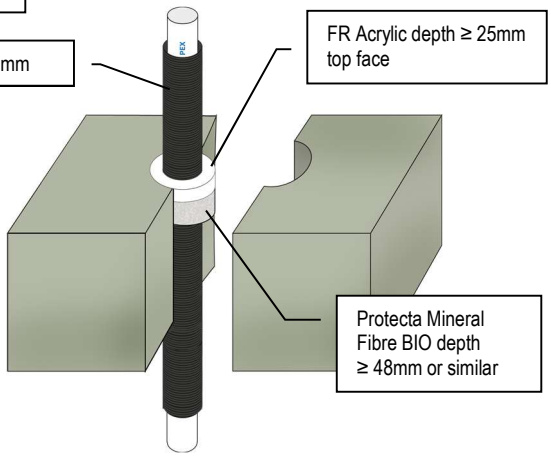

Protecta Mineral Fibre BIO depth ≥ 48mm or similar

22/0735-A.6.7-3


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 240 C/C (E 240)

≥ 150MM RIGID FLOORS

Maximum annular ring width 30mm

PEX pipe ≤ Ø44mm

FR Acrylic depth ≥ 25mm on both sides

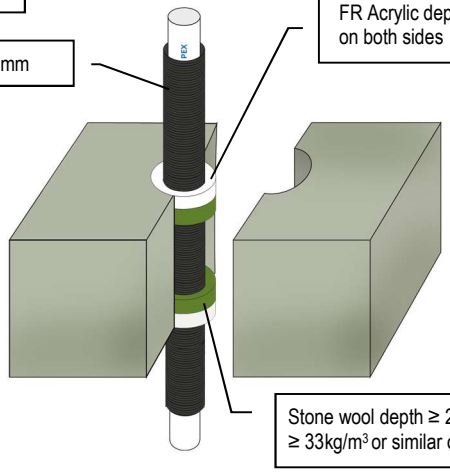


Stone wool depth ≥ 25mm, density ≥ 33kg/m³ or similar on both sides

22/0735-A.6.4-10

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)


≥ 150MM RIGID FLOORS

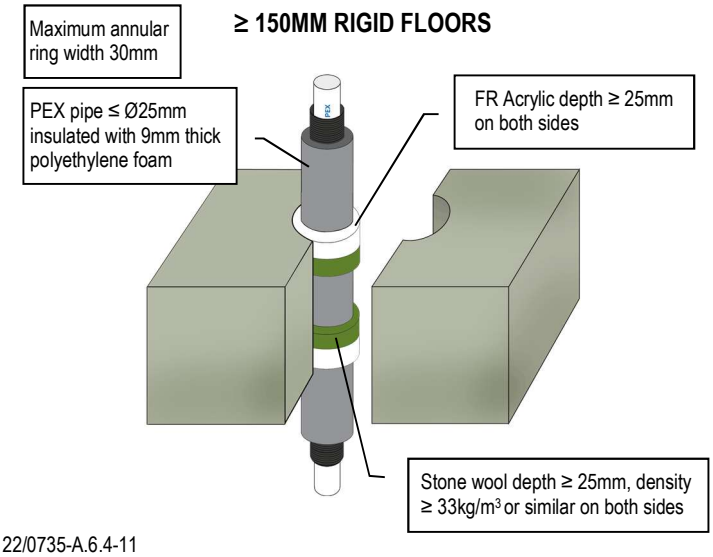

22/0735-A.6.4-11

PVC CONDUIT FIRE RESISTANCE EI 240 U/C (E 240)


≥ 150MM RIGID FLOORS

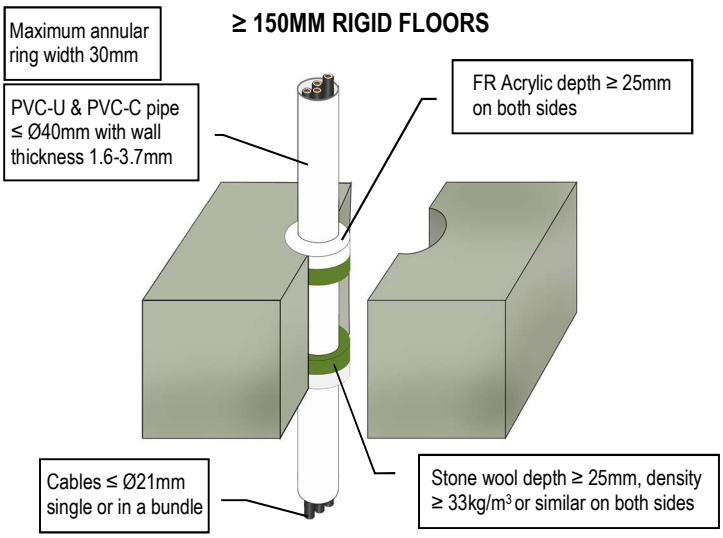

22/0735-A.6.4-2

PE CONDUIT FIRE RESISTANCE EI 180 U/C (E 180)


≥ 150MM RIGID FLOORS

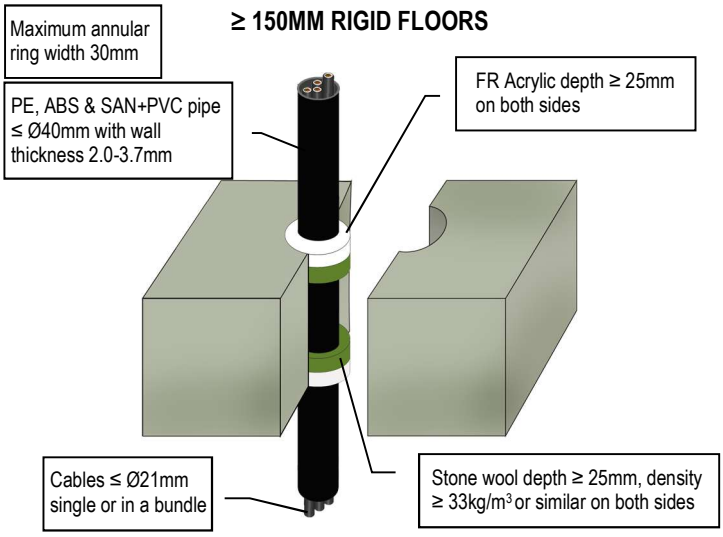

22/0735-A.6.4-8

PP CONDUIT FIRE RESISTANCE EI 180 U/C (E 180)


≥ 150MM RIGID FLOORS

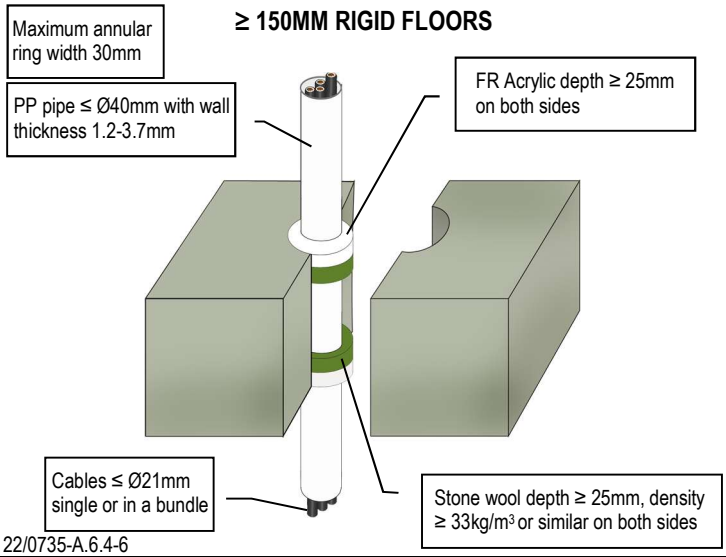

22/0735-A.6.4-6

CABLES FIRE RESISTANCE EI 30 (E 30)


≥ 228MM FLEXIBLE FLOORS

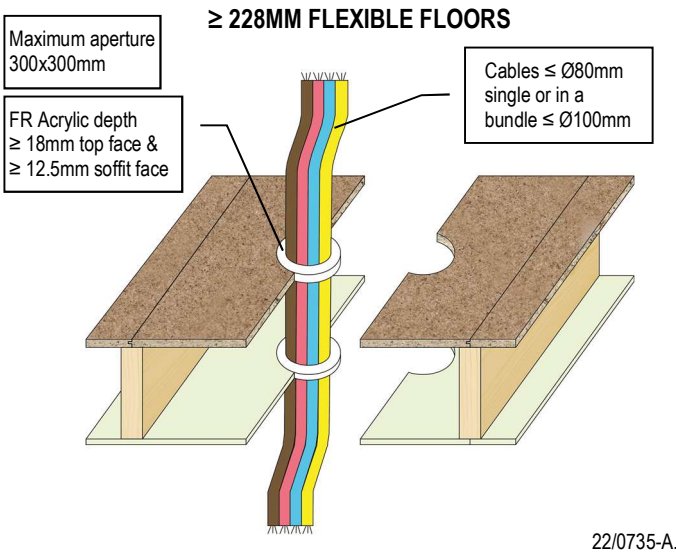

22/0735-A.7.1-2

CABLES FIRE RESISTANCE EI 60 (E 60)

≥ 240MM FLEXIBLE FLOORS

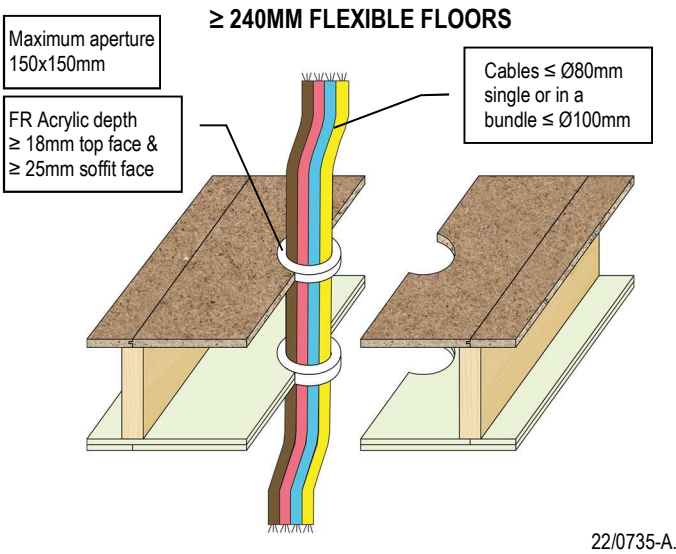

22/0735-A.7.5-2


As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 23/0257, ETA 22/0735, UKTA 22/0031 & UKTA 22/0032

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
15 (60) 2026 5 14

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 30)


≥ 228MM FLEXIBLE FLOORS

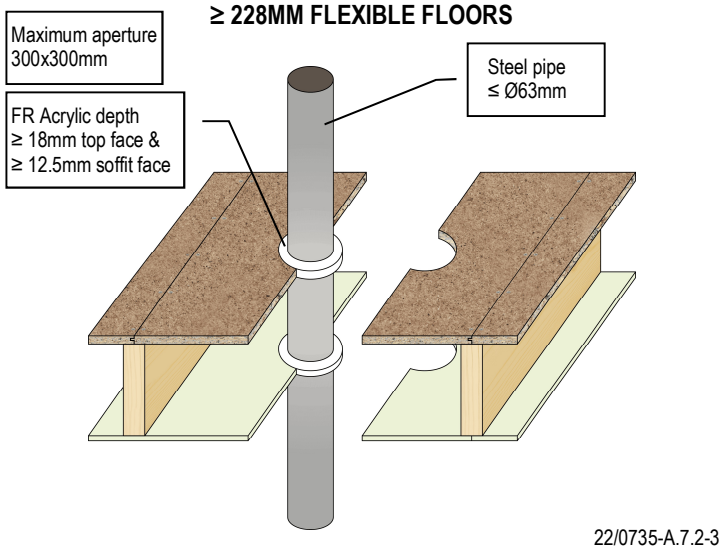

22/0735-A.7.2-3

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 240MM FLEXIBLE FLOORS

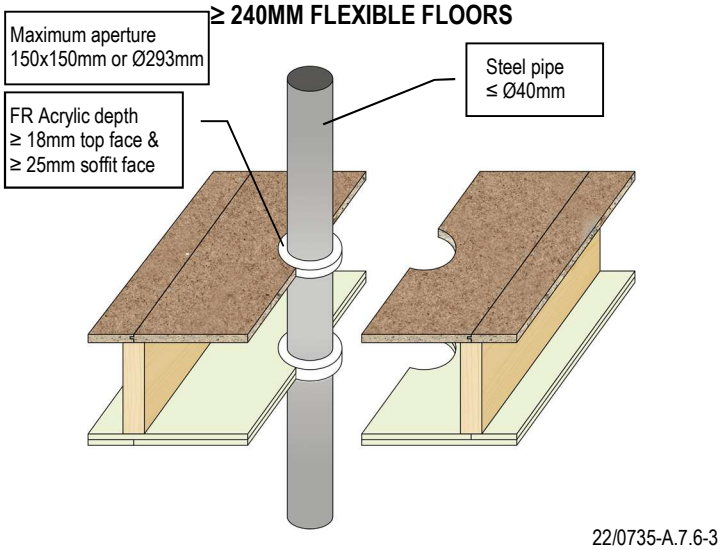

22/0735-A.7.6-3

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 30)


≥ 228MM FLEXIBLE FLOORS

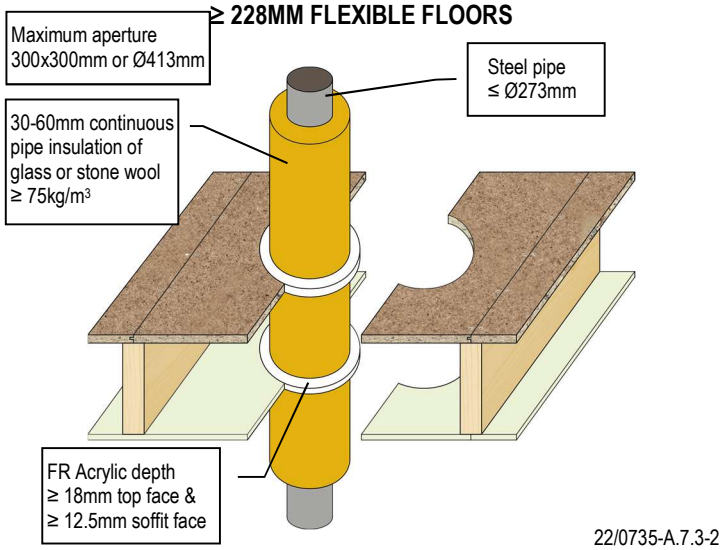

22/0735-A.7.3-2

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 240MM FLEXIBLE FLOORS

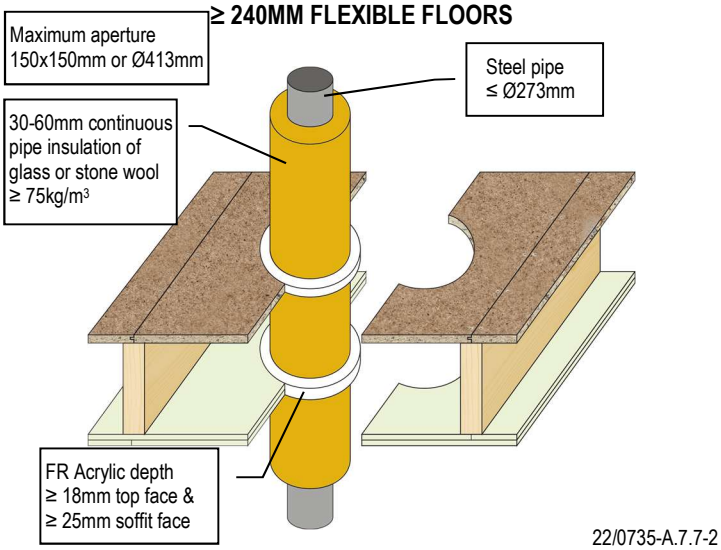

22/0735-A.7.7-2

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 30)


≥ 228MM FLEXIBLE FLOORS

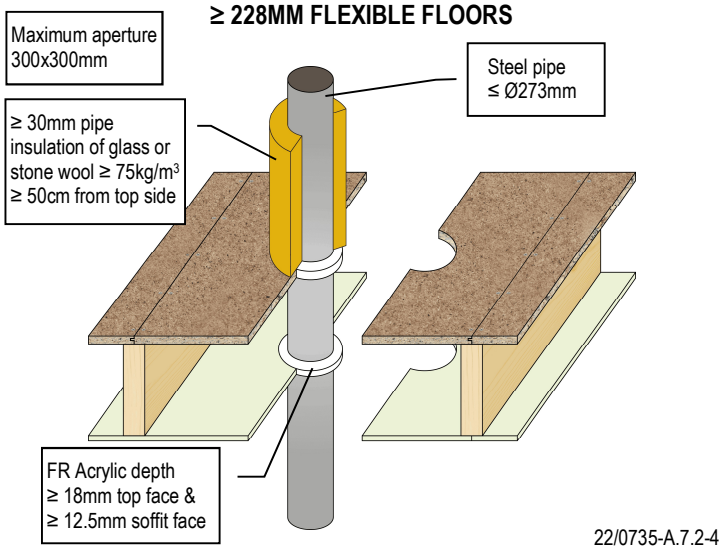

22/0735-A.7.2-4

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)

≥ 240MM FLEXIBLE FLOORS

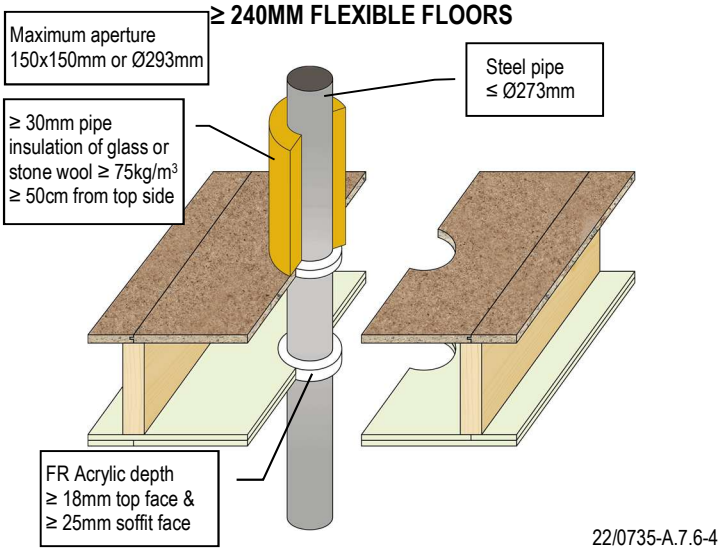


22/0735-A.7.6-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 30)


≥ 228MM FLEXIBLE FLOORS

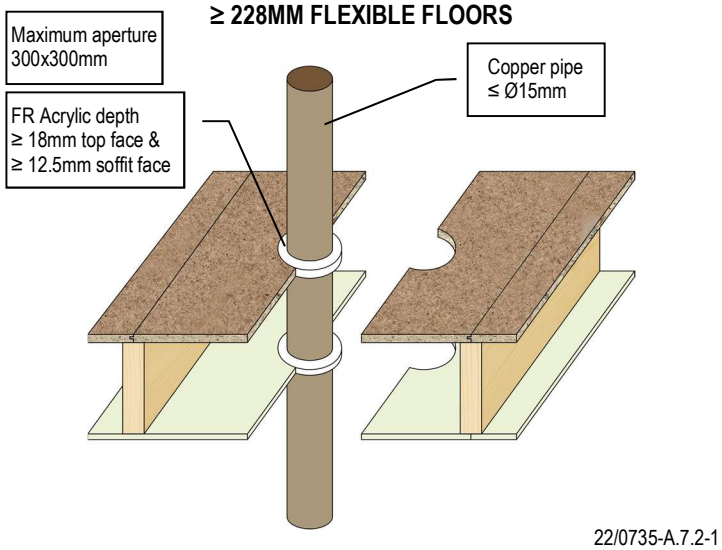

22/0735-A.7.2-1

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 240MM FLEXIBLE FLOORS

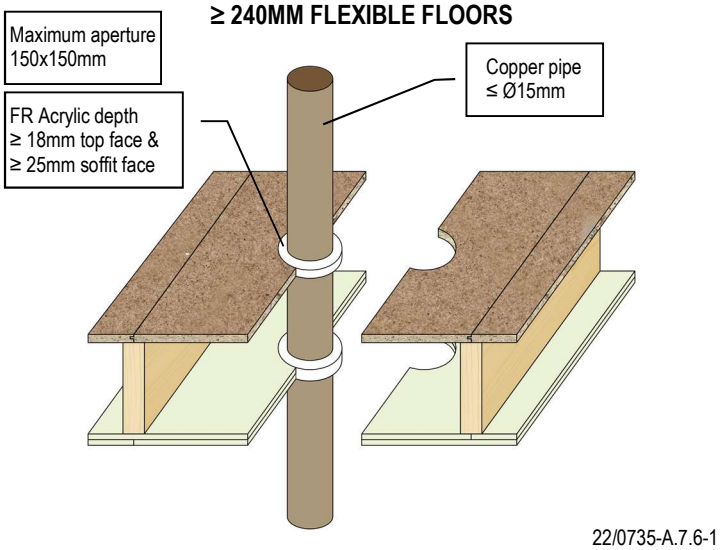

22/0735-A.7.6-1

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 30)


≥ 228MM FLEXIBLE FLOORS

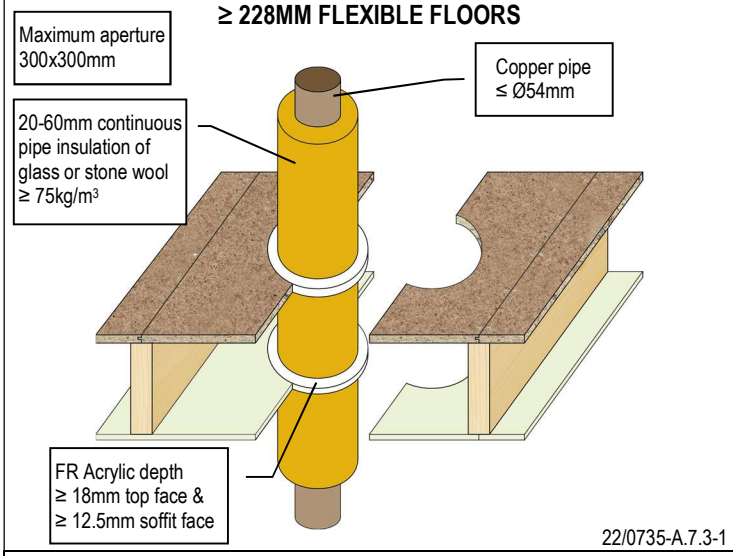

22/0735-A.7.3-1

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 240MM FLEXIBLE FLOORS

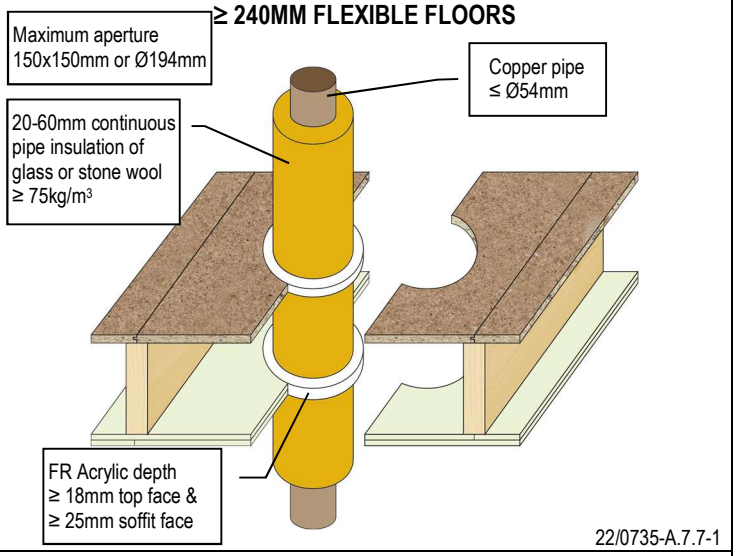

22/0735-A.7.7-1

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 30)


≥ 228MM FLEXIBLE FLOORS

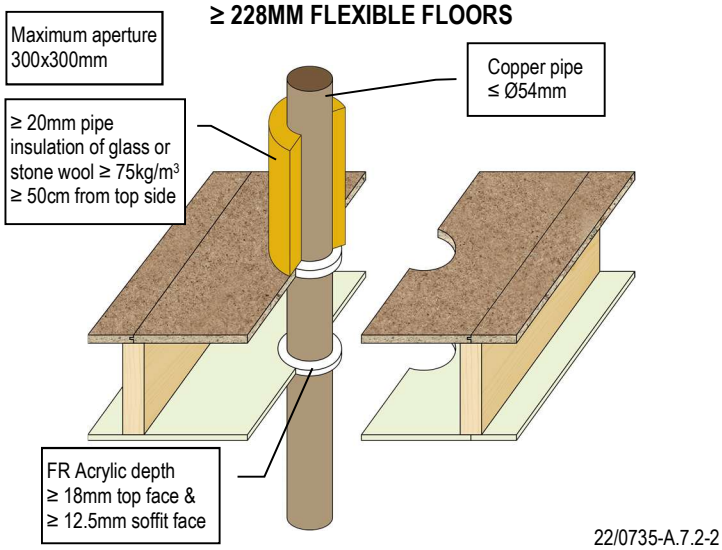

22/0735-A.7.2-2

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)

≥ 240MM FLEXIBLE FLOORS

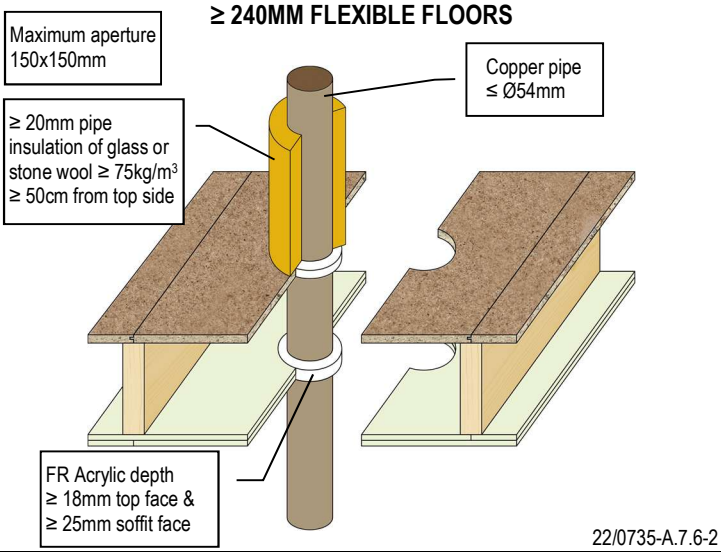


22/0735-A.7.6-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ALUPEX PIPE FIRE RESISTANCE EI 30 C/C (E 30)


≥ 228MM FLEXIBLE FLOORS

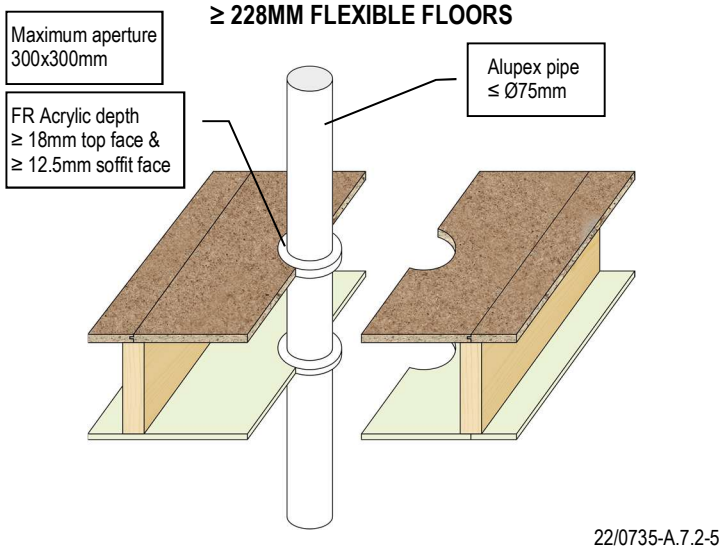

22/0735-A.7.2-5

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 240MM FLEXIBLE FLOORS

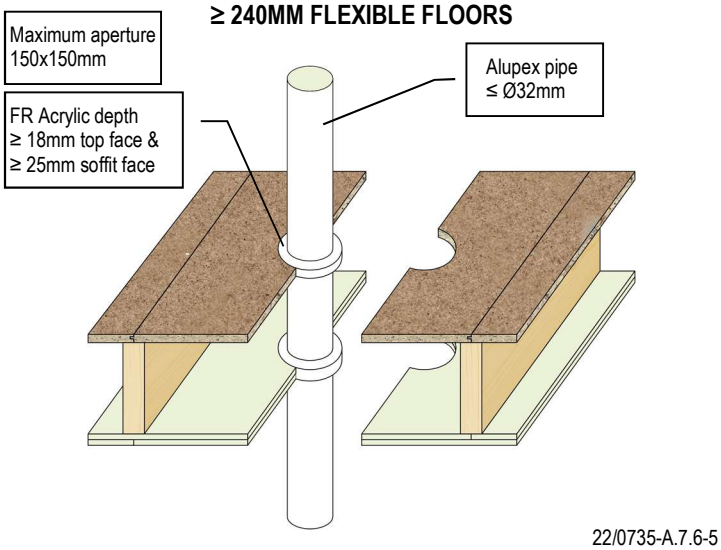

22/0735-A.7.6-5

ALUPEX PIPE FIRE RESISTANCE EI 30 C/C (E 30)


≥ 228MM FLEXIBLE FLOORS

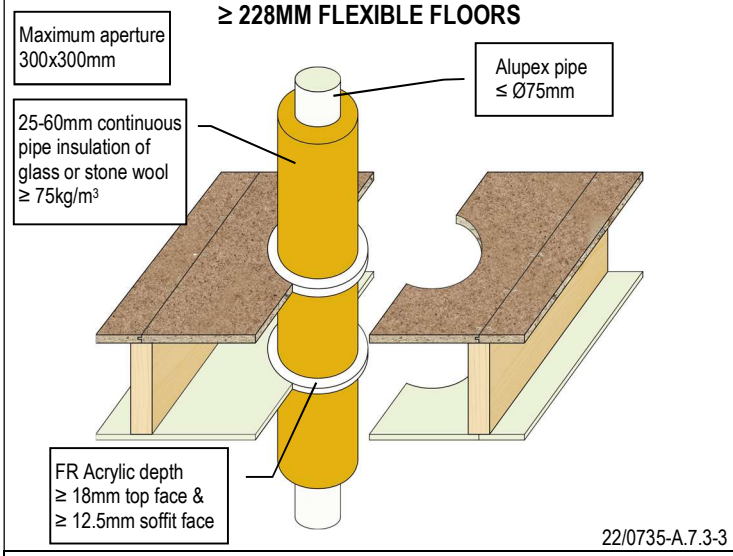

22/0735-A.7.3-3

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 240MM FLEXIBLE FLOORS

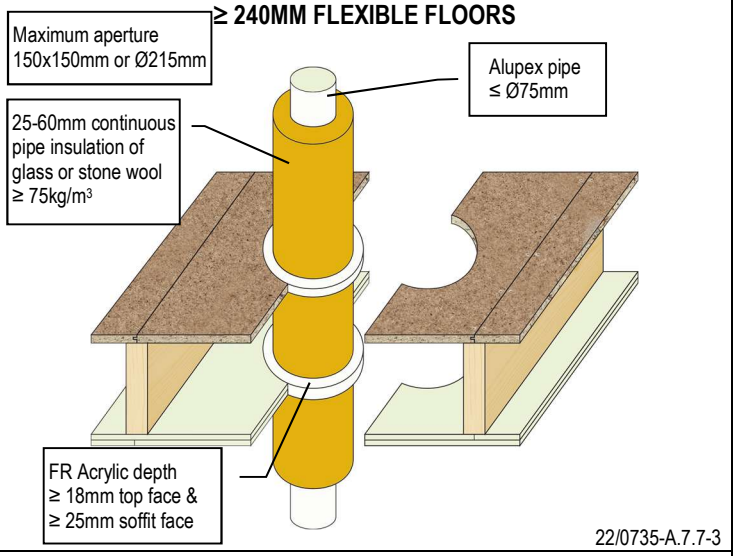

22/0735-A.7.7-3

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 240MM FLEXIBLE FLOORS

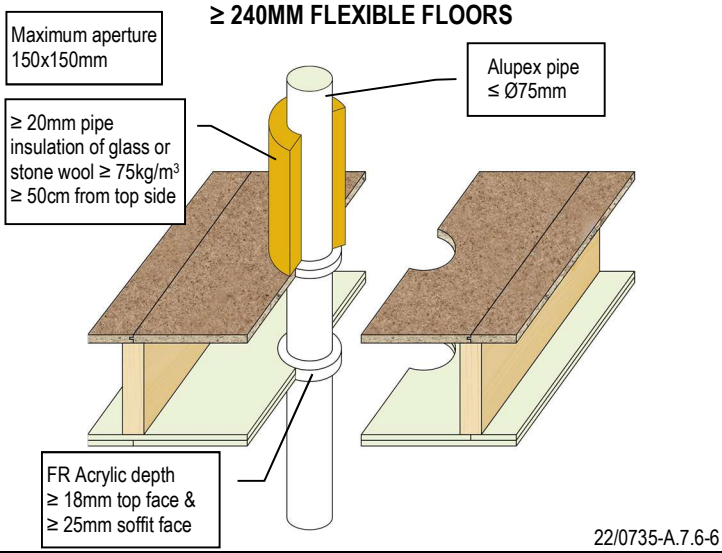

22/0735-A.7.6-6

PVC PLASTIC PIPE FIRE RESISTANCE EI 30 U/C (E 30)

≥ 228MM FLEXIBLE FLOORS

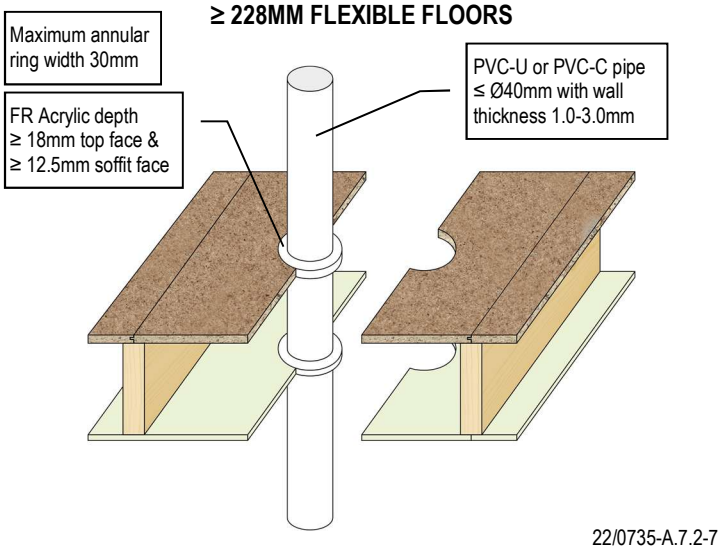


22/0735-A.7.2-7

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PVC PLASTIC PIPE FIRE RESISTANCE EI 60 U/C (E 60)


≥ 240MM FLEXIBLE FLOORS

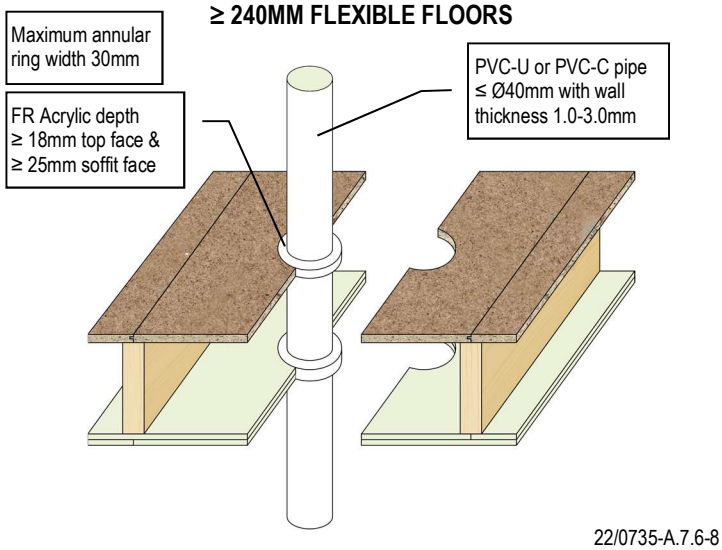

22/0735-A.7.6-8

PE PLASTIC PIPE FIRE RESISTANCE EI 30 U/C (E 30)


≥ 228MM FLEXIBLE FLOORS

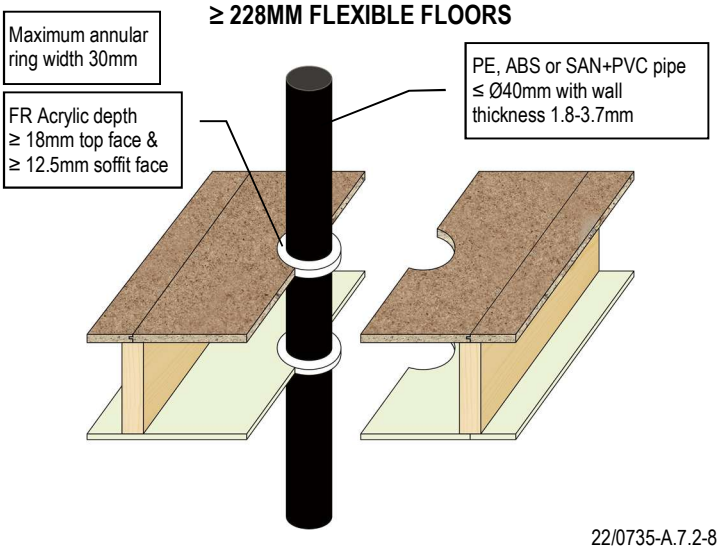

22/0735-A.7.2-8

PE PLASTIC PIPE FIRE RESISTANCE EI 60 U/C (E 60)


≥ 240MM FLEXIBLE FLOORS

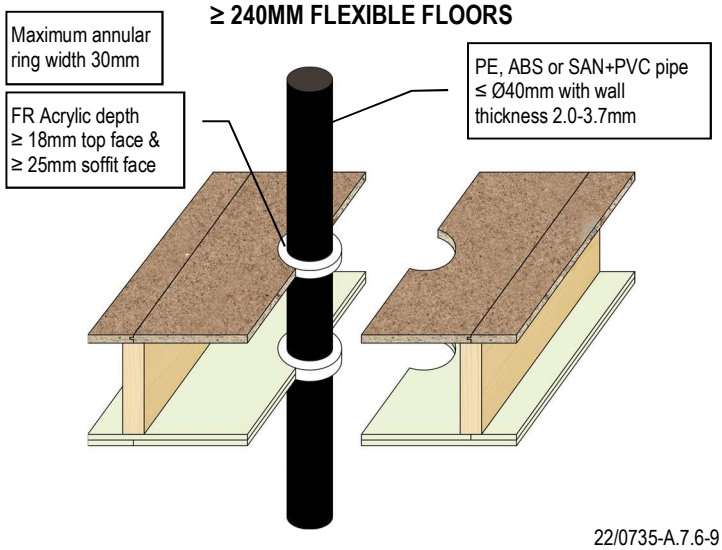

22/0735-A.7.6-9

PP PLASTIC PIPE FIRE RESISTANCE EI 30 U/C (E 30)


≥ 228MM FLEXIBLE FLOORS

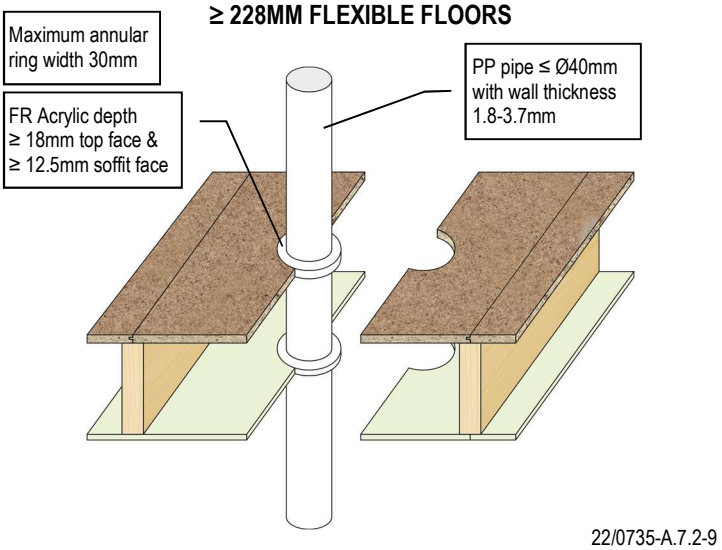

22/0735-A.7.2-9

PP PLASTIC PIPE FIRE RESISTANCE EI 60 U/C (E 60)

≥ 240MM FLEXIBLE FLOORS

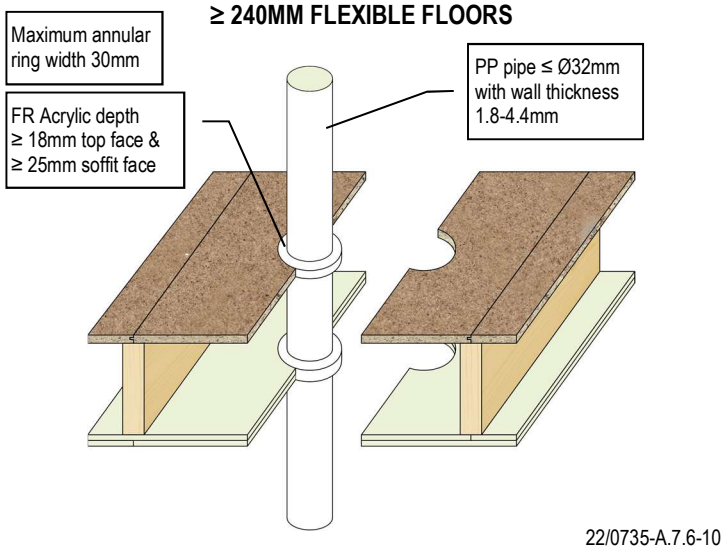


22/0735-A.7.6-10

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PLASTIC PIPE FIRE RESISTANCE EI 30 (E 30)

≥ 228MM FLEXIBLE FLOORS

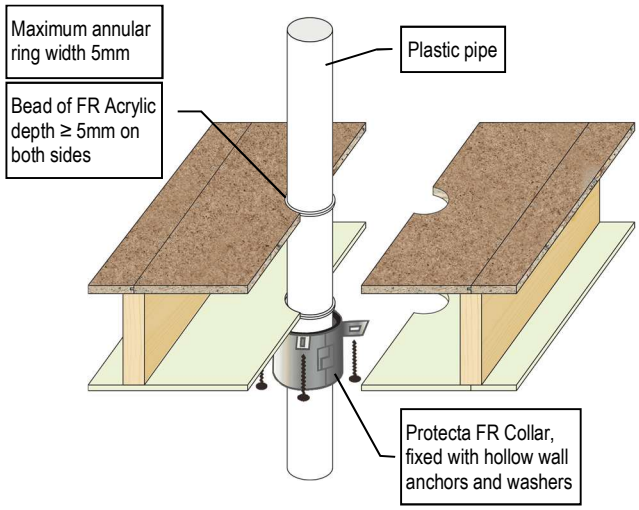


Pipe	Pipe W/T	Collar Ø x h	Config
≤ Ø 50mm PVC	2.4mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 50mm PE	3.0 – 4.6mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 50mm PP	1.8 – 4.6mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 110mm PVC	2.4 – 6.6mm	≤ 110mm x ≥ 30mm	U/U
≤ Ø 110mm PE	3.0 – 10.0mm	≤ 110mm x ≥ 30mm	U/C
≤ Ø 110mm PE	3.0 – 10.0mm	≤ 110mm x ≥ 50mm	U/U
≤ Ø 110mm PP	1.8 – 6.3mm	≤ 110mm x ≥ 30mm	U/C
≤ Ø 110mm PP	1.8 – 6.3mm	≤ 110mm x ≥ 50mm	U/U
≤ Ø 160mm PVC	3.2 – 9.5mm	≤ 160mm x ≥ 60mm	U/C
≤ Ø 160mm PE	3.4 – 14.6mm	≤ 160mm x ≥ 60mm	U/C
≤ Ø 160mm PP	4.2 – 14.6mm	≤ 160mm x ≥ 60mm	U/C

If the annular gap is above 5mm, an oversized collar may be used with maximum size of Ø160mm, subject to an increase in sealant depth to minimum 18mm at top face and 12.5mm at soffit face

22/0735-A.7.4-1

PLASTIC PIPE FIRE RESISTANCE EI 60 (E 60)

≥ 240MM FLEXIBLE FLOORS

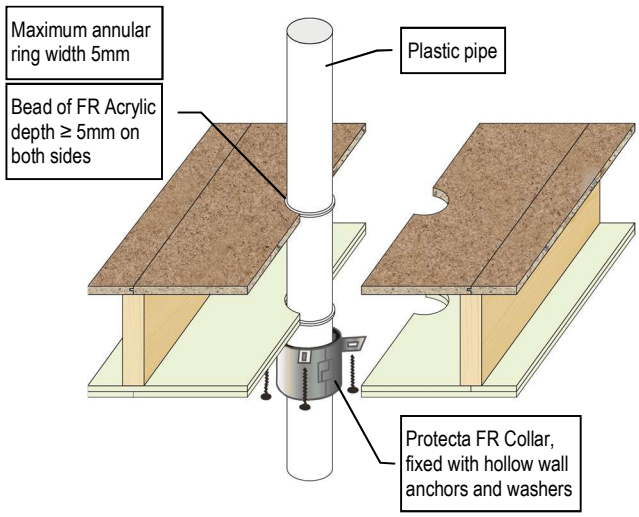


Pipe	Pipe W/T	Collar Ø x h	Config
≤ Ø 50mm PVC	2.4 – 3.7mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 50mm PE	3.0 – 4.6mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 50mm PP	1.8 – 4.6mm	≤ 50mm x ≥ 30mm	U/U
≤ Ø 110mm PVC	2.4 – 6.6mm	≤ 110mm x ≥ 30mm	U/U
≤ Ø 110mm PE	3.0 – 10.0mm	≤ 110mm x ≥ 30mm	U/C
≤ Ø 110mm PE	3.0 – 10.0mm	≤ 110mm x ≥ 50mm	U/U
≤ Ø 110mm PP	1.8 – 6.3mm	≤ 110mm x ≥ 30mm	U/C
≤ Ø 110mm PP	1.8 – 6.3mm	≤ 110mm x ≥ 50mm	U/U
≤ Ø 160mm PVC	3.2 – 9.5mm	≤ 160mm x ≥ 60mm	U/C
≤ Ø 160mm PE	3.4 – 14.6mm	≤ 160mm x ≥ 60mm	U/C
≤ Ø 160mm PP	4.2 – 14.6mm	≤ 160mm x ≥ 60mm	U/C

If the annular gap is above 5mm, an oversized collar may be used with maximum size of Ø160mm, subject to an increase in sealant depth to minimum 18mm at top face and 25mm at soffit face

22/0735-A.7.8-1

PLASTIC PIPES FIRE RESISTANCE EI 30 U/C (E 30)


≥ 228MM FLEXIBLE FLOORS

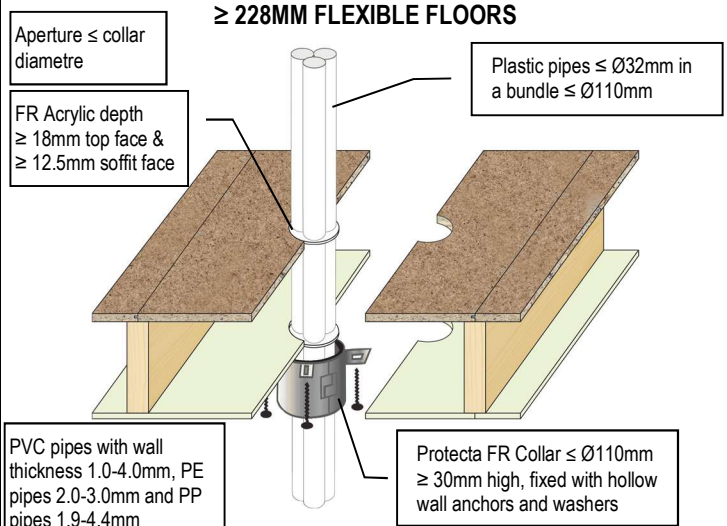

22/0735-A.7.4-4

PLASTIC PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 240MM FLEXIBLE FLOORS

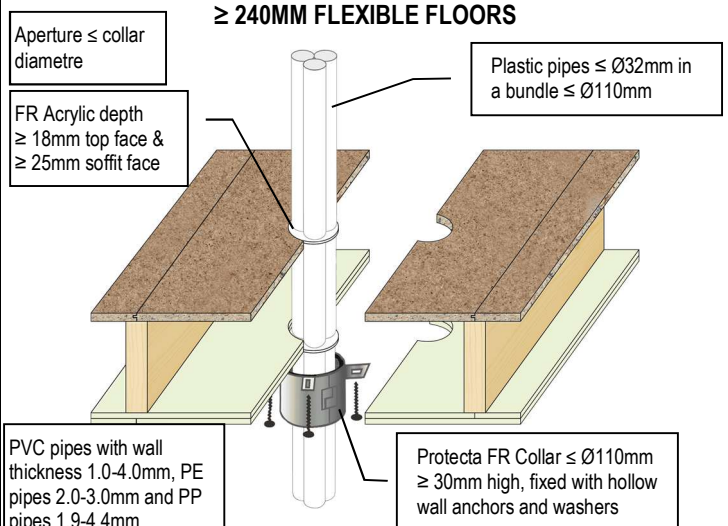

22/0735-A.7.8-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 30 C/C (E 30)

≥ 228MM FLEXIBLE FLOORS

Maximum annular ring width 30mm

FR Acrylic depth ≥ 18mm top face & ≥ 12.5mm soffit face

PEX pipe ≤ Ø25mm

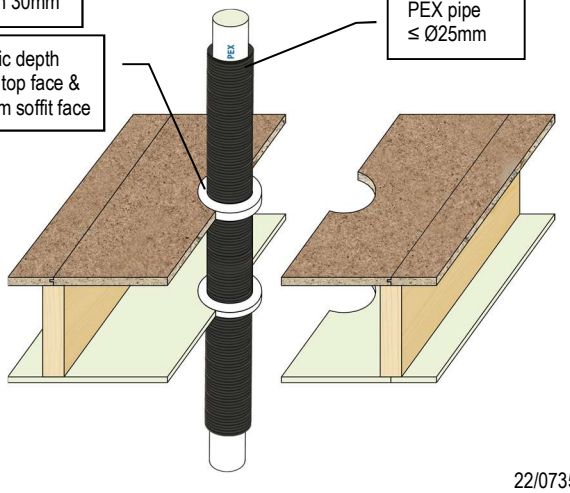

22/0735-A.7.2-6


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 240MM FLEXIBLE FLOORS

Maximum annular ring width 30mm

FR Acrylic depth ≥ 18mm top face & ≥ 25mm soffit face

PEX pipe ≤ Ø25mm

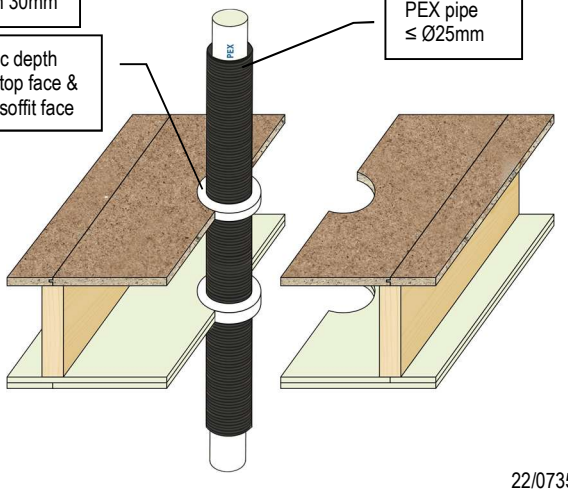

22/0735-A.7.6-7


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 30 C/C (E 30)

≥ 228MM FLEXIBLE FLOORS

Maximum annular ring width 5mm

Bead of FR Acrylic depth ≥ 5mm on both sides

PEX pipe ≤ Ø44mm

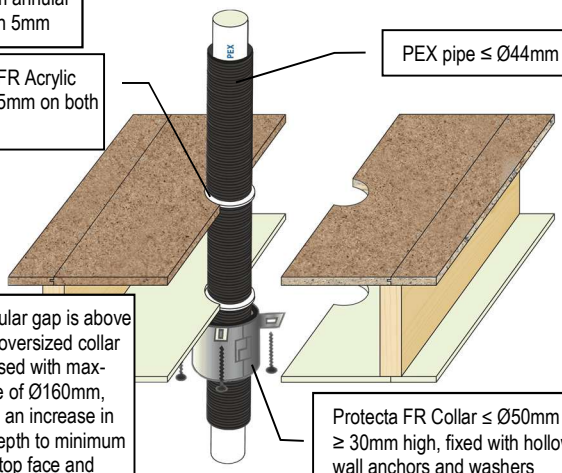

If the annular gap is above 5mm, an oversized collar may be used with maximum size of Ø160mm, subject to an increase in sealant depth to minimum 18mm at top face and 12.5mm at soffit face

Protecta FR Collar ≤ Ø50mm ≥ 30mm high, fixed with hollow wall anchors and washers

22/0735-A.7.4-15


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 240MM FLEXIBLE FLOORS

Maximum annular ring width 5mm

Bead of FR Acrylic depth ≥ 5mm on both sides

PEX pipe ≤ Ø44mm

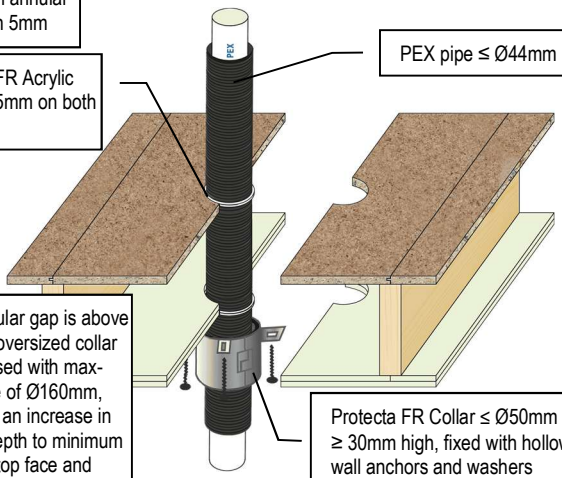

If the annular gap is above 5mm, an oversized collar may be used with maximum size of Ø160mm, subject to an increase in sealant depth to minimum 18mm at top face and 25mm at soffit face

Protecta FR Collar ≤ Ø50mm ≥ 30mm high, fixed with hollow wall anchors and washers

22/0735-A.7.8-15


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 30 C/C (E 30)

≥ 228MM FLEXIBLE FLOORS

Aperture ≤ collar diametre

FR Acrylic depth ≥ 18mm top face & ≥ 12.5mm soffit face

PEX pipes ≤ Ø25mm in a bundle ≤ Ø50mm

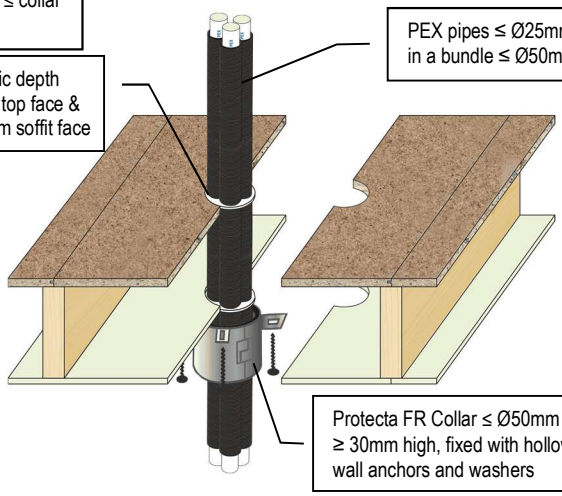

Protecta FR Collar ≤ Ø50mm ≥ 30mm high, fixed with hollow wall anchors and washers

22/0735-A.7.4-16


PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 240MM FLEXIBLE FLOORS

Aperture ≤ collar diametre

FR Acrylic depth ≥ 18mm top face & ≥ 25mm soffit face

PEX pipes ≤ Ø25mm in a bundle ≤ Ø50mm

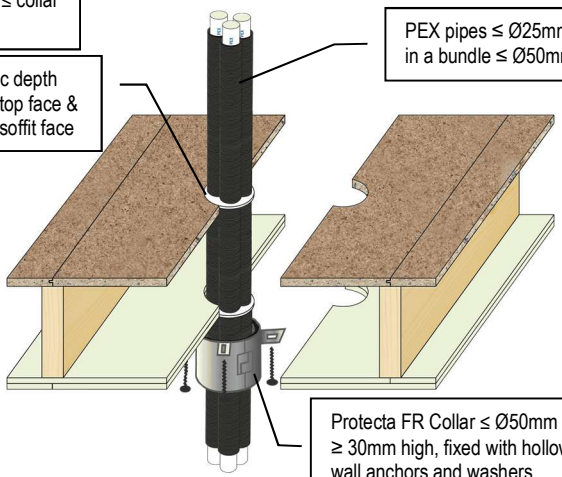


Protecta FR Collar ≤ Ø50mm ≥ 30mm high, fixed with hollow wall anchors and washers

22/0735-A.7.8-16

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CONDUIT FIRE RESISTANCE EI 30 U/U (E 30)


≥ 228MM FLEXIBLE FLOORS

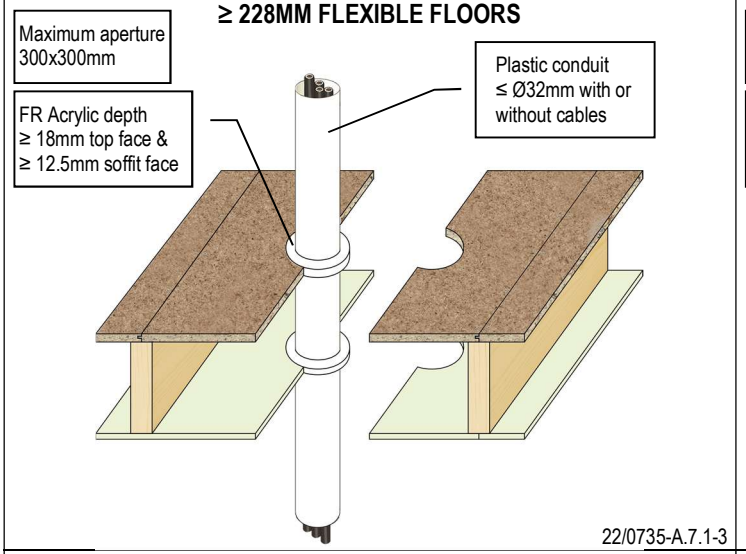

22/0735-A.7.1-3

CONDUIT FIRE RESISTANCE EI 60 U/U (E 60)


≥ 240MM FLEXIBLE FLOORS

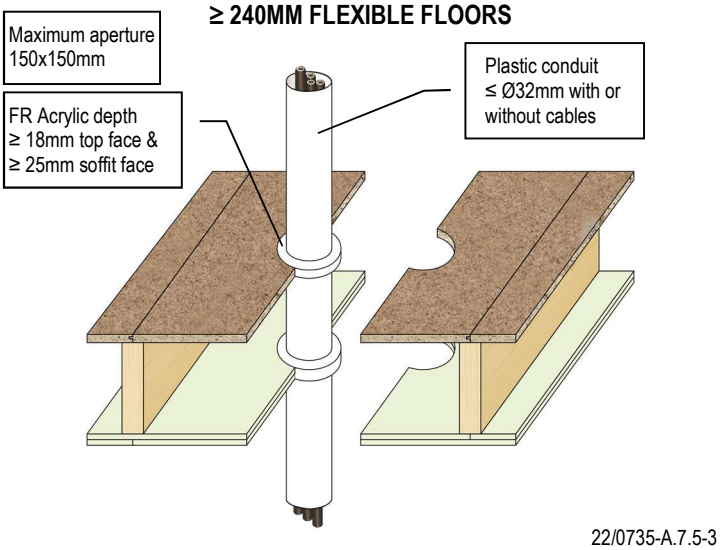

22/0735-A.7.5-3

CONDUITS FIRE RESISTANCE EI 30 U/U (E 30)


≥ 228MM FLEXIBLE FLOORS

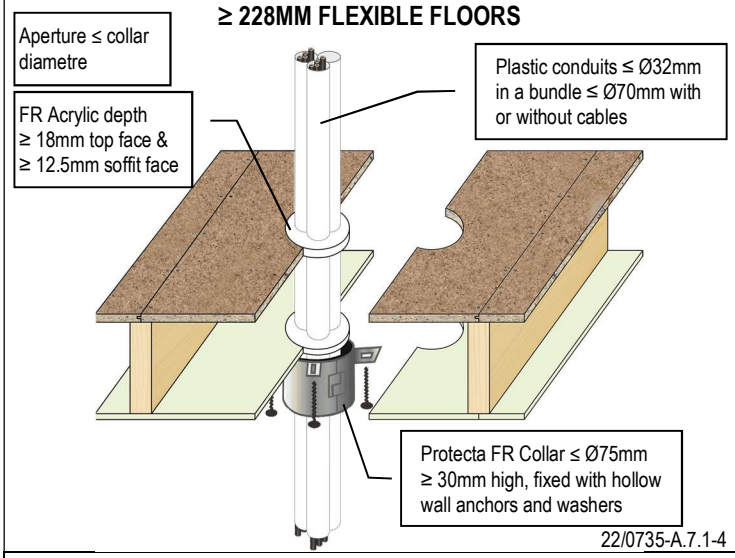

22/0735-A.7.1-4

CONDUITS FIRE RESISTANCE EI 60 U/U (E 60)


≥ 240MM FLEXIBLE FLOORS

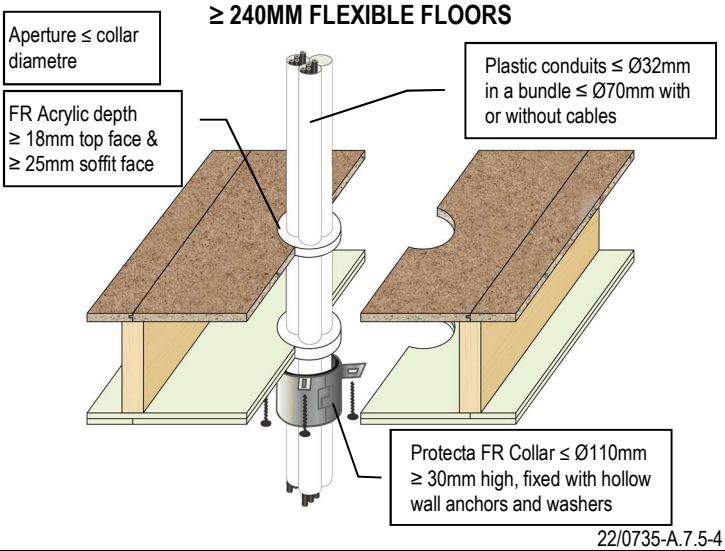

22/0735-A.7.5-4

CABLES FIRE RESISTANCE EI 120 (E 120)


≥ 150MM TIMBER FLOORS

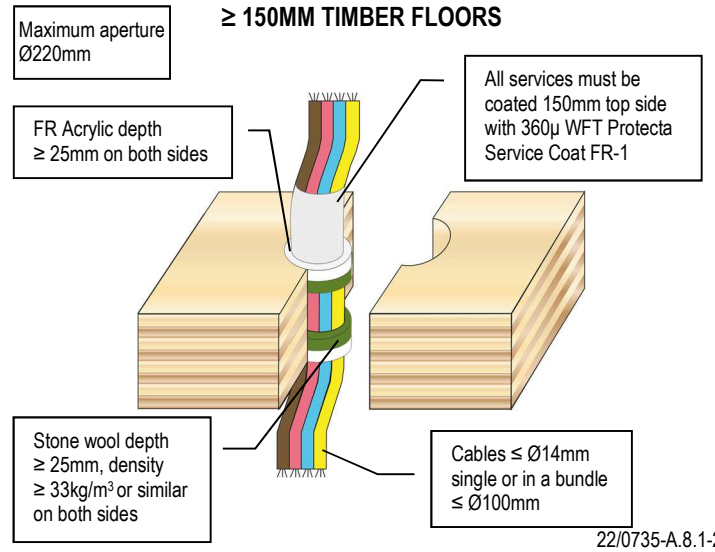

22/0735-A.8.1-2

CABLES FIRE RESISTANCE EI 90 (E 120)

≥ 150MM TIMBER FLOORS

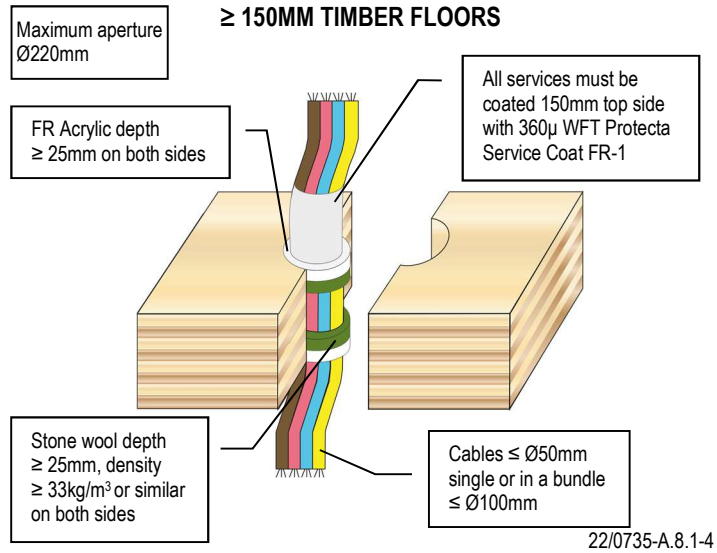


22/0735-A.8.1-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 150MM TIMBER FLOORS

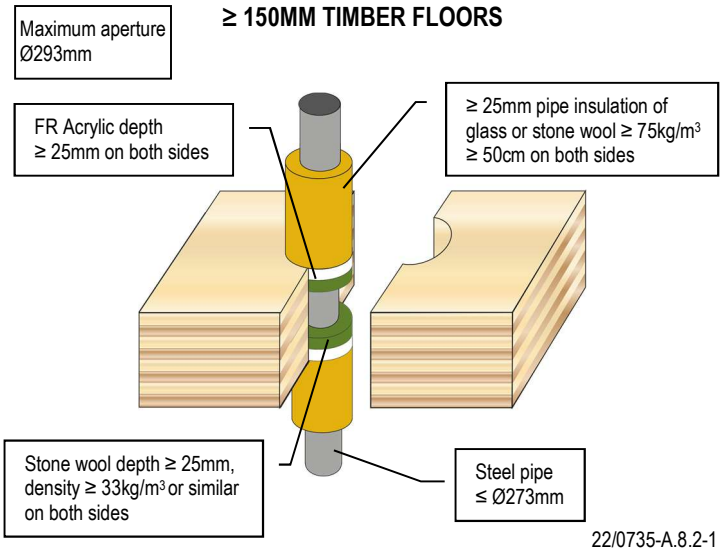

22/0735-A.8.2-1

COPPER OR STEEL PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 150MM TIMBER FLOORS

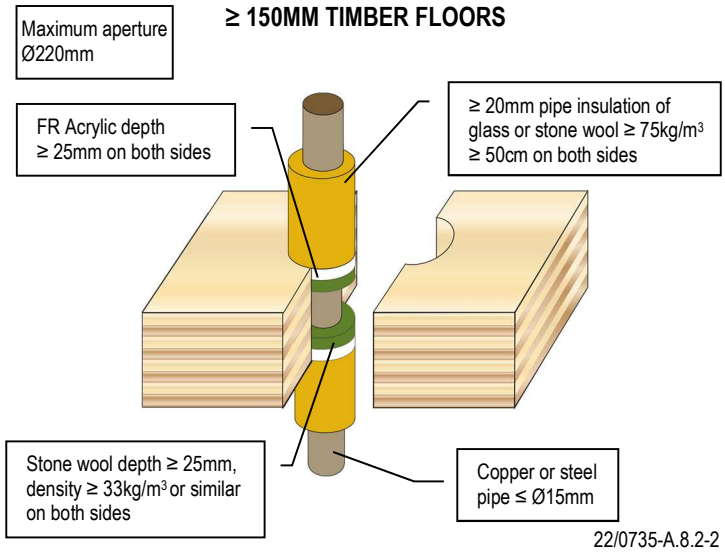

22/0735-A.8.2-2

COPPER OR STEEL PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 150MM TIMBER FLOORS

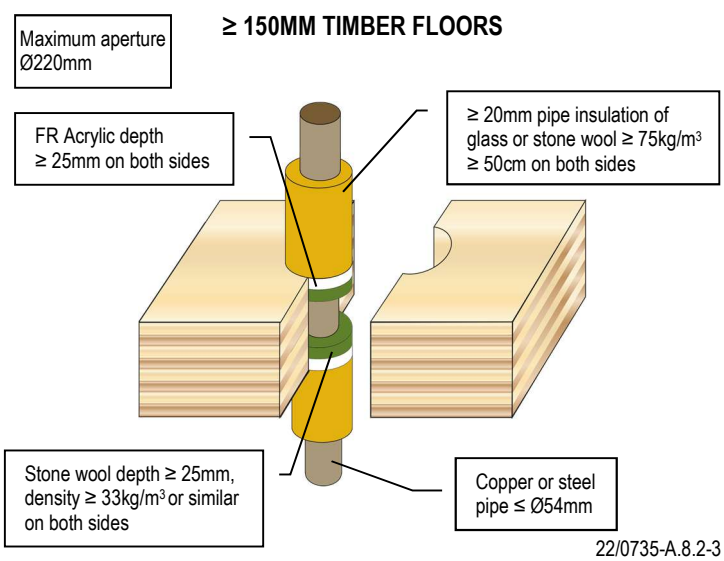

22/0735-A.8.2-3

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 150MM TIMBER FLOORS

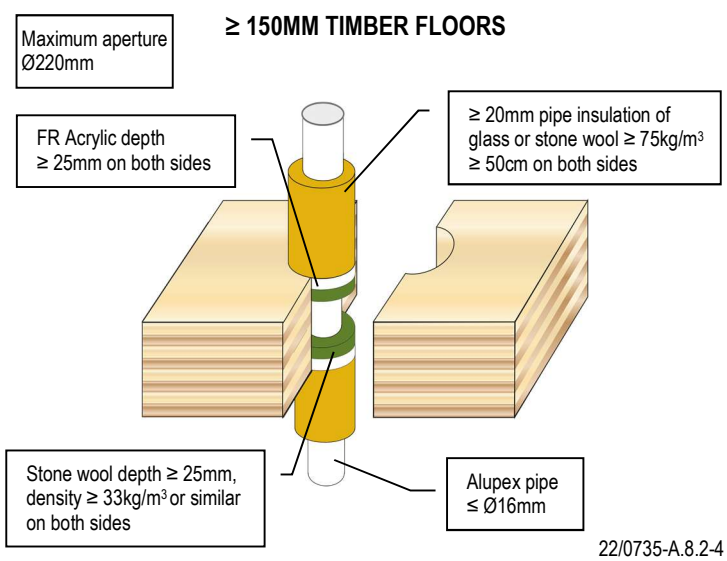

22/0735-A.8.2-4

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 150MM TIMBER FLOORS

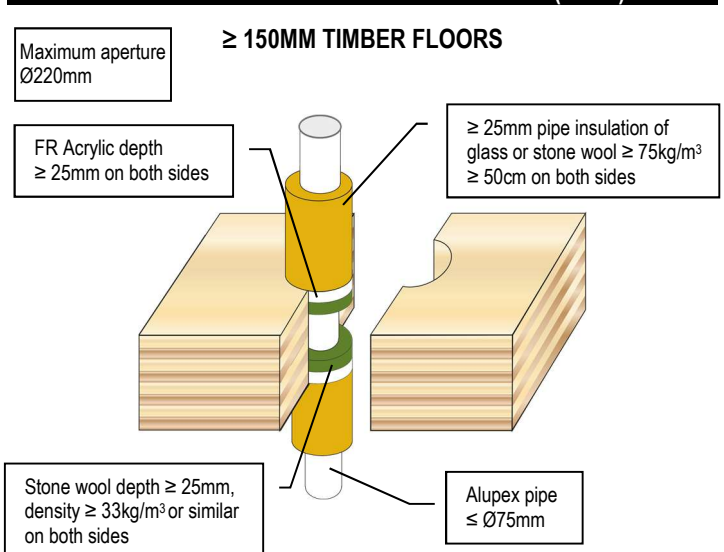

22/0735-A.8.2-5

PVC PIPE FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM TIMBER FLOORS

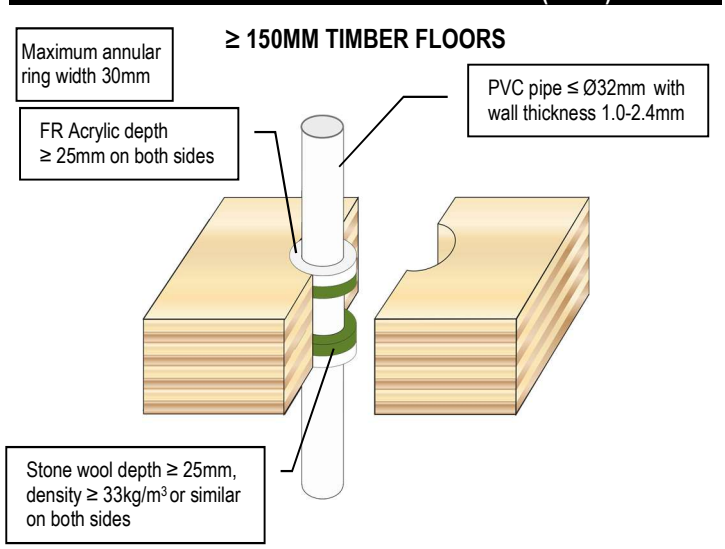


22/0735-A.8.3-1

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PE PIPE FIRE RESISTANCE EI 120 U/C (E 120)


≥ 150MM TIMBER FLOORS

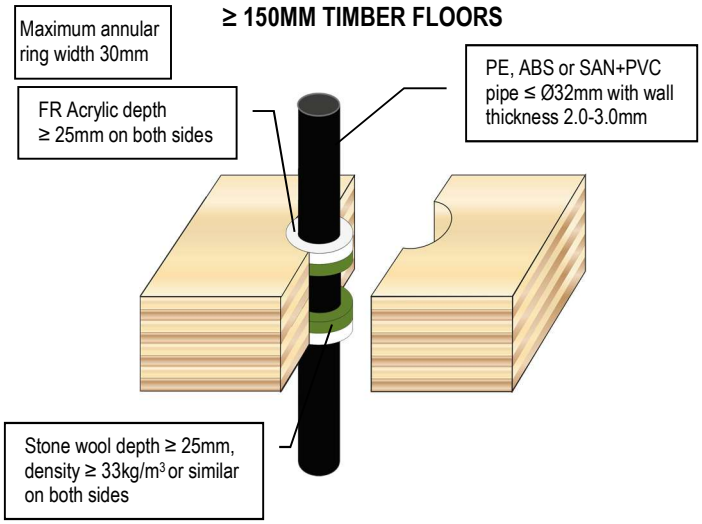

22/0735-A.8.3-2

PP PIPE FIRE RESISTANCE EI 120 U/C (E 120)


≥ 150MM TIMBER FLOORS

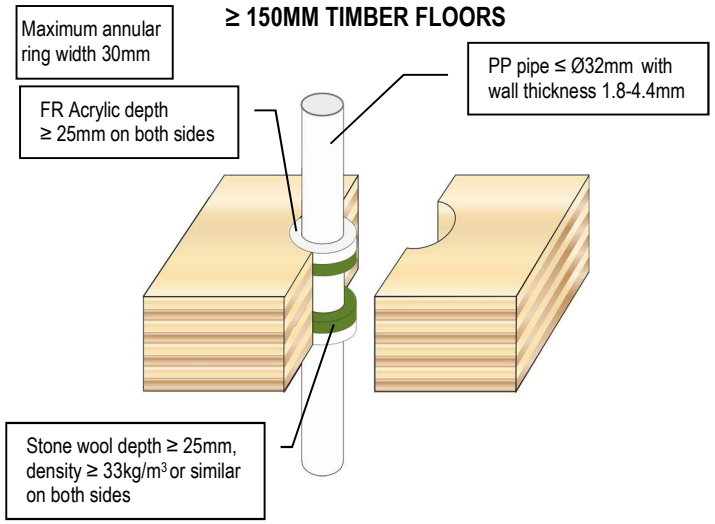

22/0735-A.8.3-3

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 120 C/C (E 120)


≥ 150MM TIMBER FLOORS

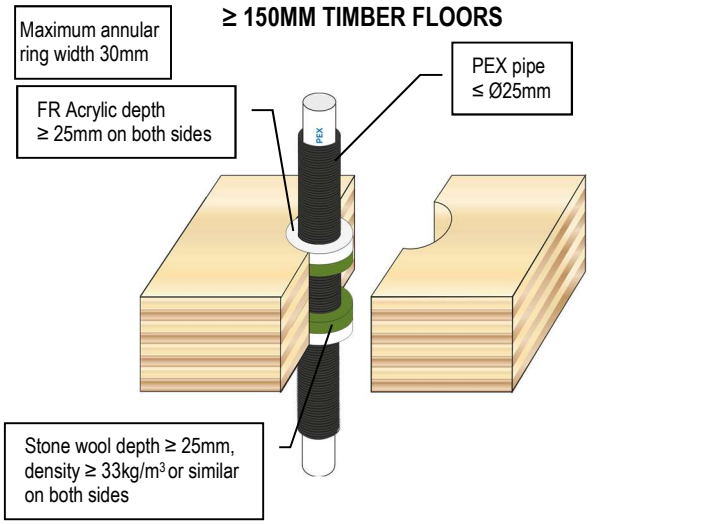

22/0735-A.8.3-4

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 60 (E 240)


IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS AND FLOORS

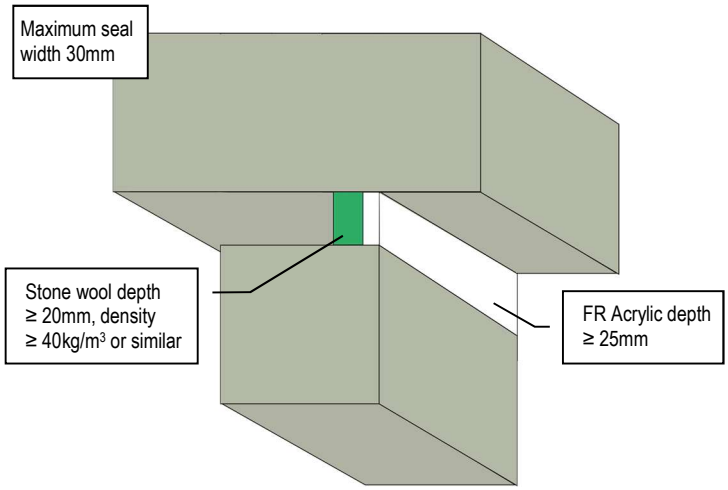

23/0257-A.3.1-1

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 60 (E 240)


IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS AND FLOORS

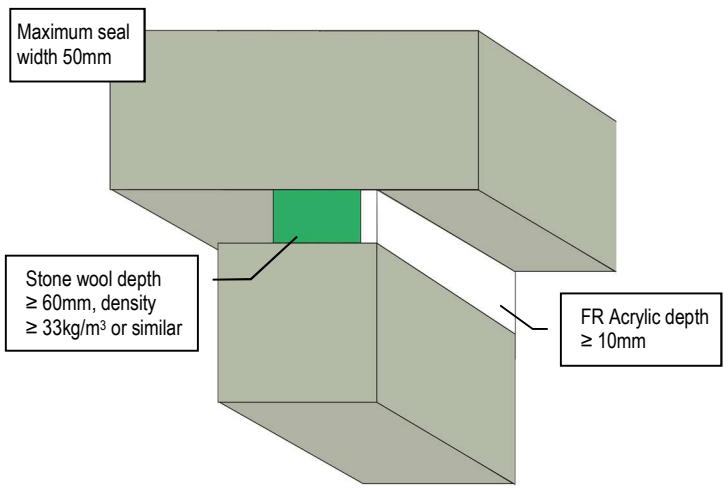

23/0257-A.3.1-4

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 240)

IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS AND FLOORS

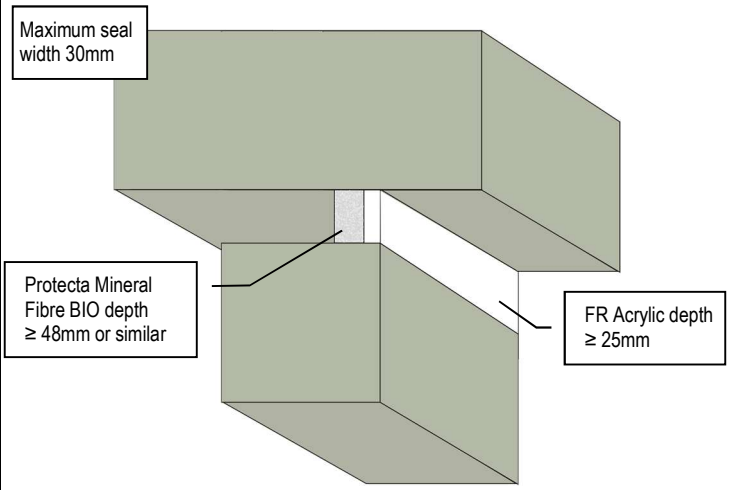


23/0257-A.3.1-6

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 240


IN ≥ 150MM RIGID WALLS TOWARDS WALLS AND FLOORS

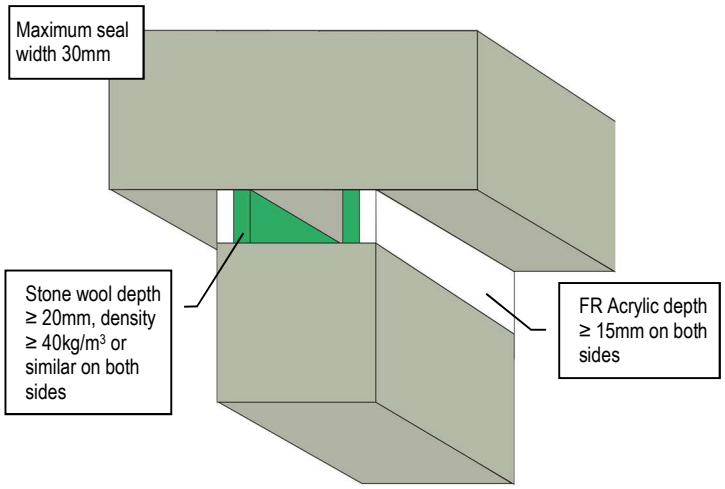

23/0257-A.3.1-2

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)


IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS

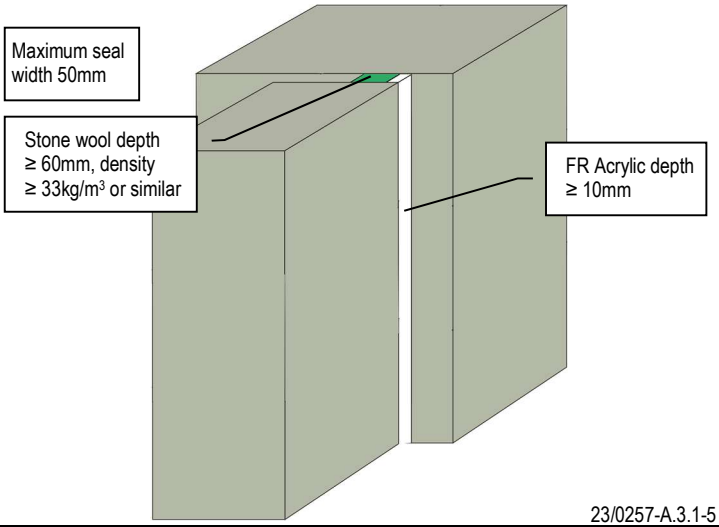

23/0257-A.3.1-5

CABLE FIRE RESISTANCE EI 60 (E 240)


≥ 150MM RIGID WALLS

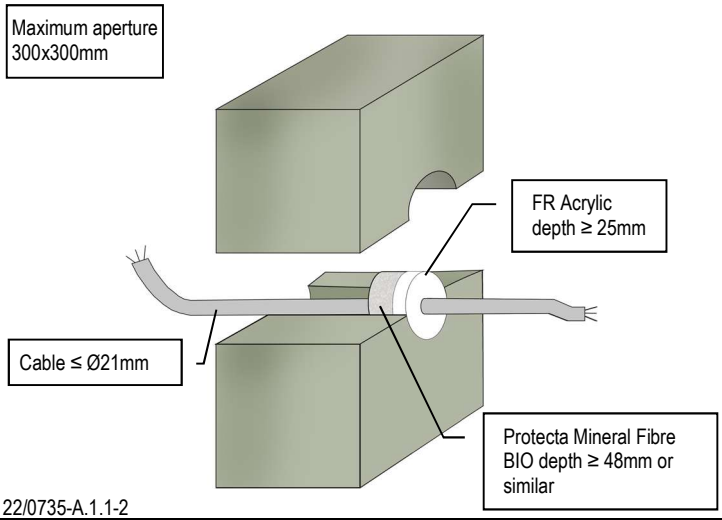

22/0735-A.1.1-2

CABLE FIRE RESISTANCE EI 90 (E 240)


≥ 150MM RIGID WALLS

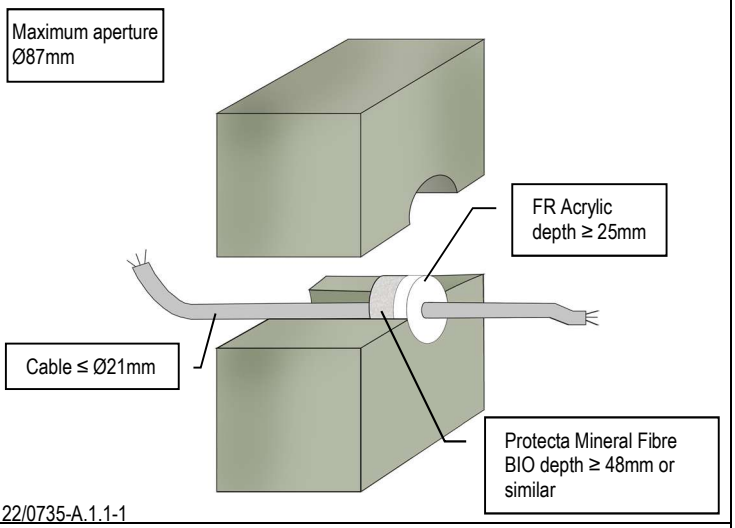

22/0735-A.1.1-1

CABLE FIRE RESISTANCE EI 120 (E 240)


≥ 150MM RIGID WALLS

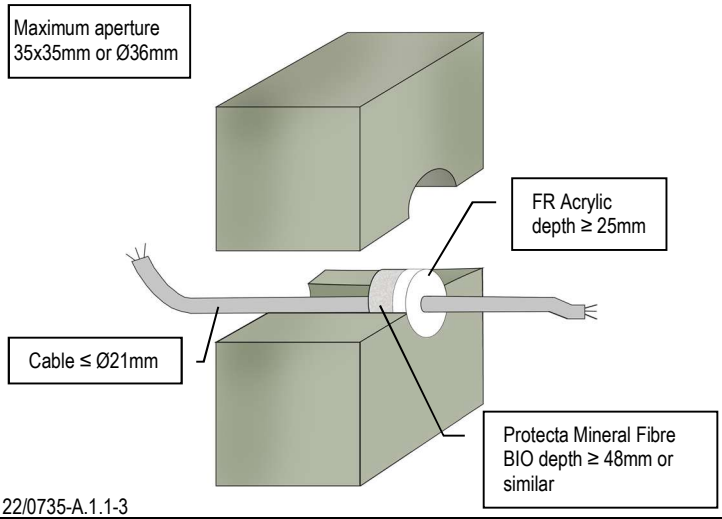

22/0735-A.1.1-3

CABLES FIRE RESISTANCE EI 120 (E 240)

≥ 150MM RIGID WALLS

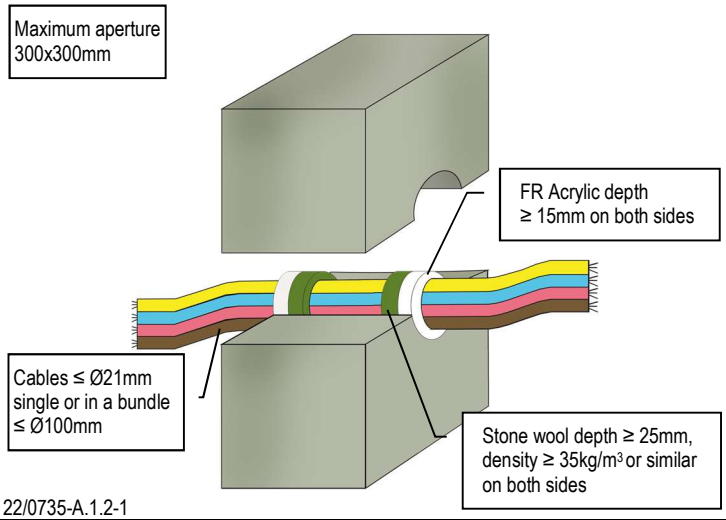


22/0735-A.1.2-1

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CABLES FIRE RESISTANCE EI 240 (E 240)


≥ 150MM RIGID WALLS

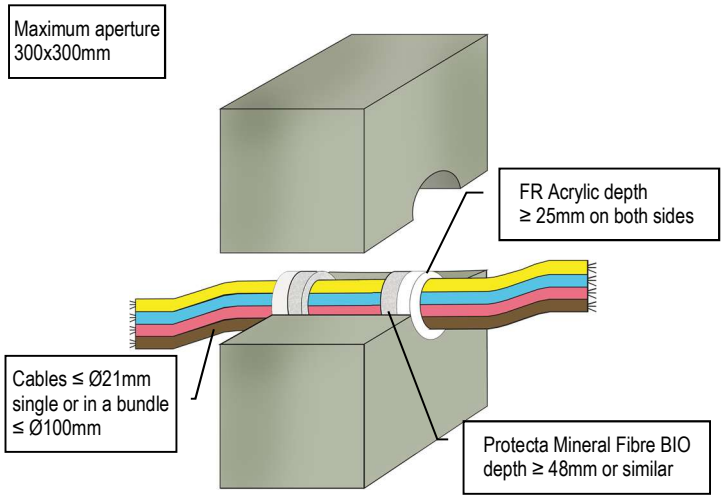

22/0735-A.1.2-4

CABLES FIRE RESISTANCE EI 60 (E 120)


≥ 150MM RIGID WALLS

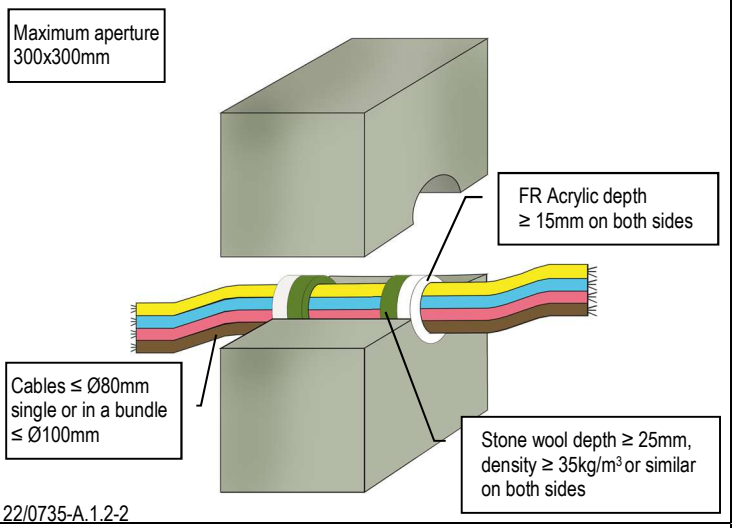

22/0735-A.1.2-2

CABLES FIRE RESISTANCE EI 60 (E 240)


≥ 150MM RIGID WALLS

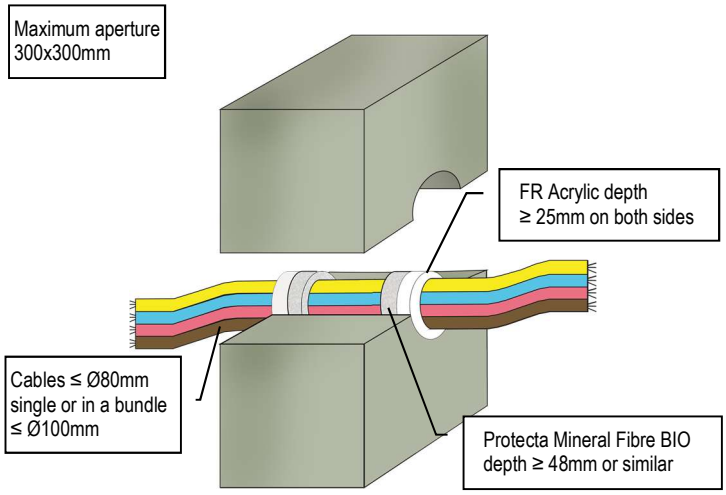

22/0735-A.1.2-3

STEEL PIPE FIRE RESISTANCE EI 20 C/U (E 240)


≥ 150MM RIGID WALLS

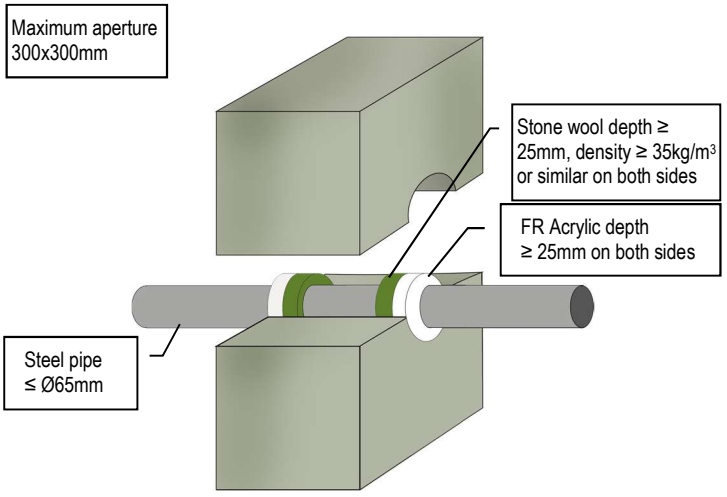

22/0735-A.1.8-1

INSULATED STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID WALLS

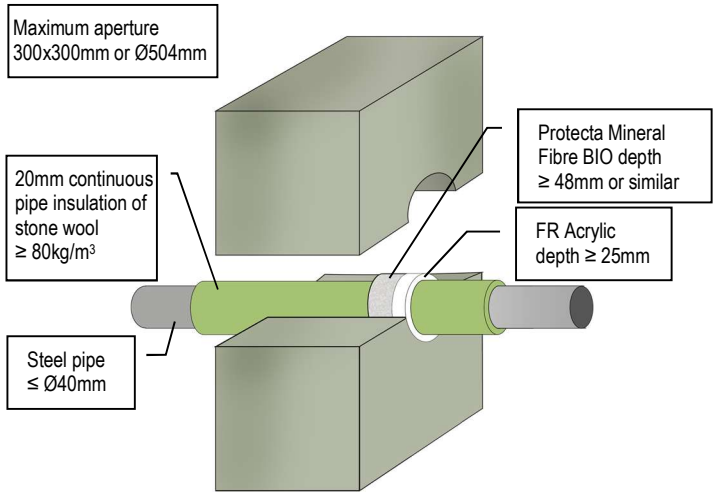

22/0735-A.1.5-1

INSULATED STEEL PIPE FIRE RESISTANCE EI 180 C/U (E 180)

≥ 150MM RIGID WALLS

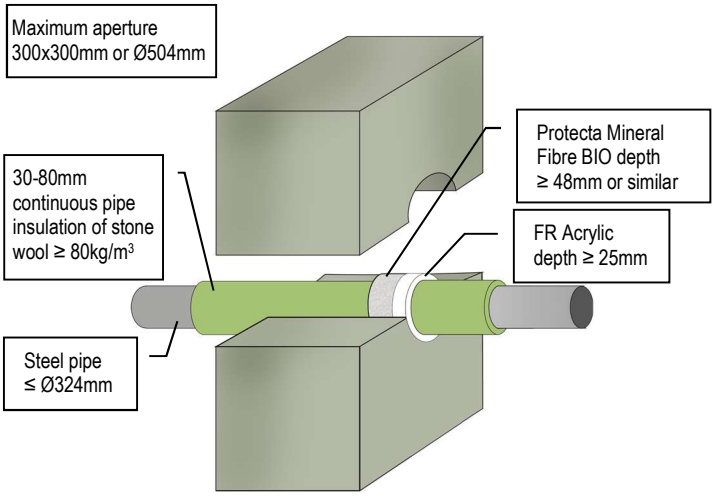


22/0735-A.1.5-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID WALLS

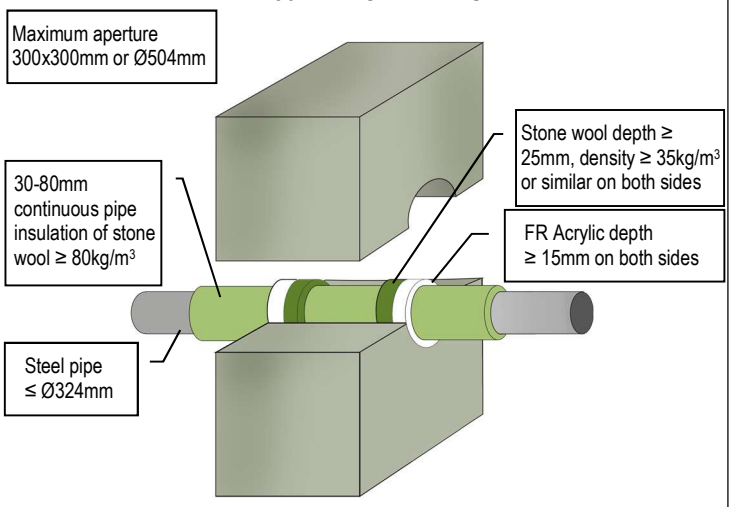

22/0735-A.1.7-2

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 240)


≥ 150MM RIGID WALLS

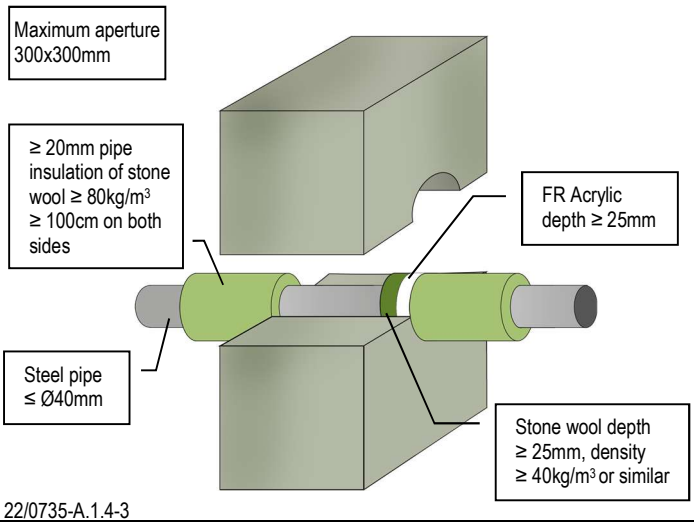

22/0735-A.1.4-3

STEEL PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID WALLS

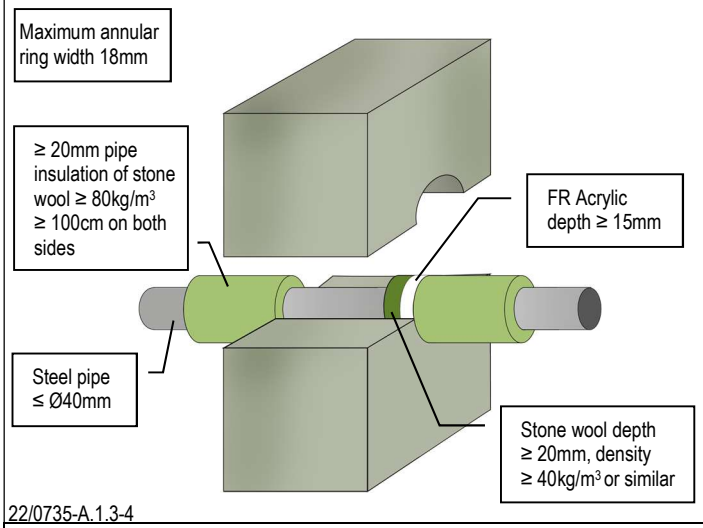

22/0735-A.1.3-4

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 240)


≥ 150MM RIGID WALLS

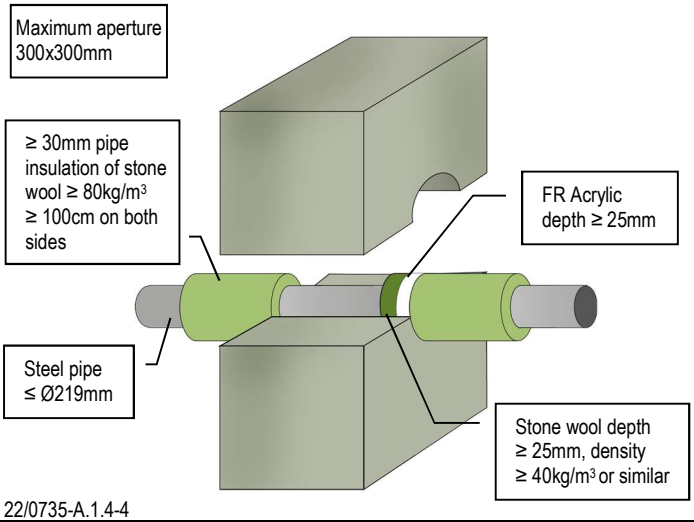

22/0735-A.1.4-4

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 180)


≥ 150MM RIGID WALLS

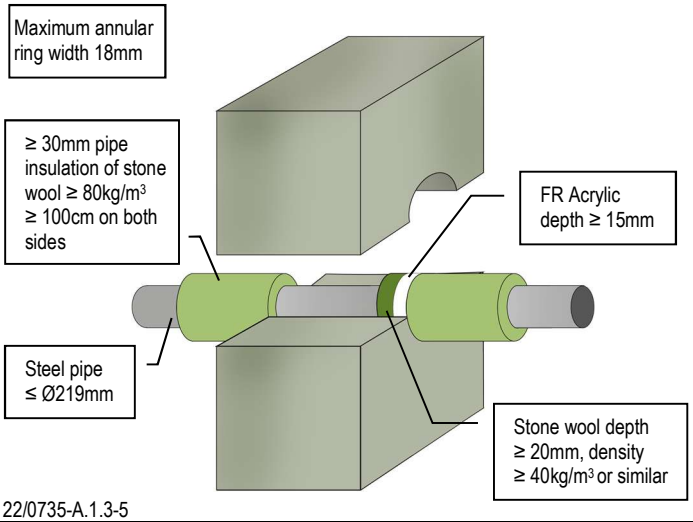

22/0735-A.1.3-5

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 240)

≥ 150MM RIGID WALLS

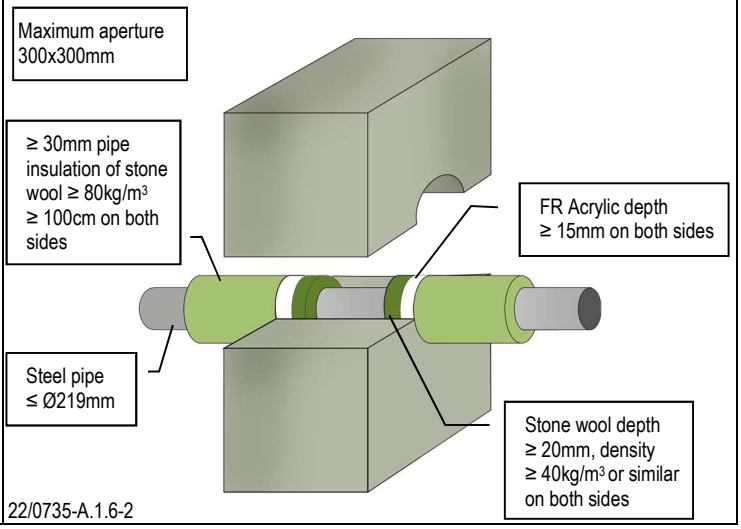


22/0735-A.1.6-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 180 C/U (E 240)


≥ 150MM RIGID WALLS

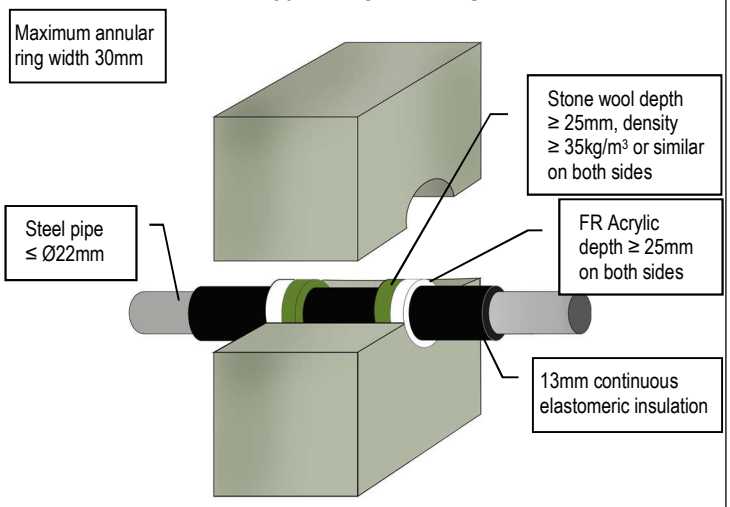

22/0735-A.1.8-2

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 150MM RIGID WALLS

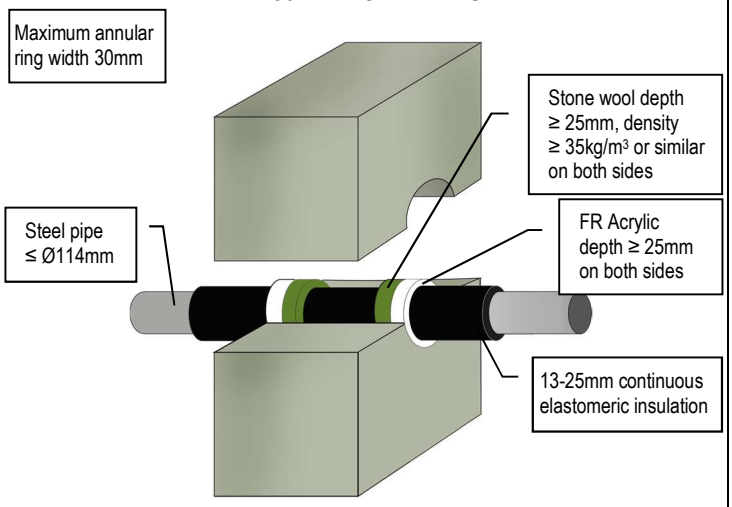

22/0735-A.1.8-3

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 150MM RIGID WALLS

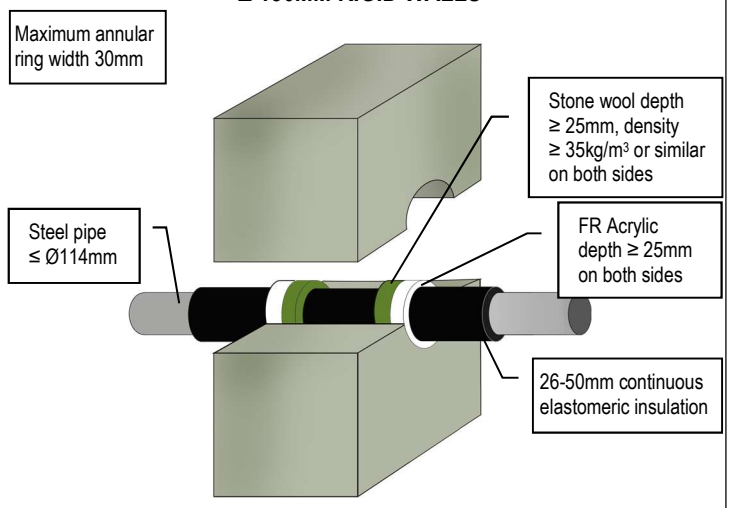

22/0735-A.1.8-4

COPPER OR STEEL PIPE FIRE RESISTANCE EI 120 C/C (E 240)


≥ 150MM RIGID WALLS

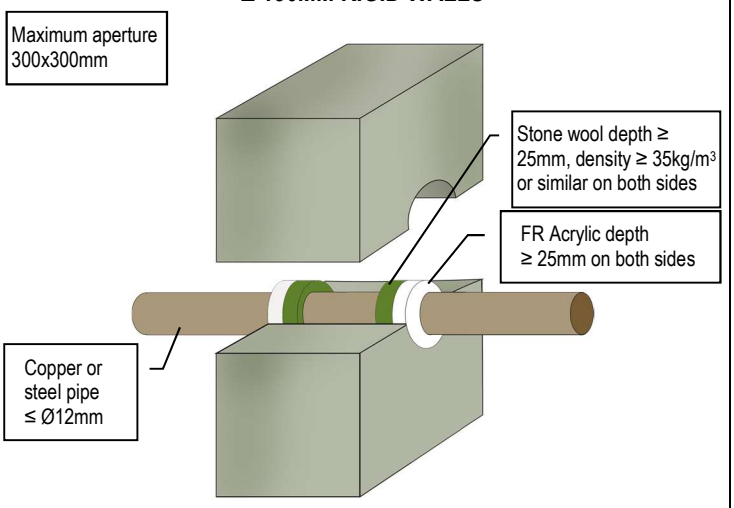

22/0735-A.1.8-5

COPPER PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID WALLS

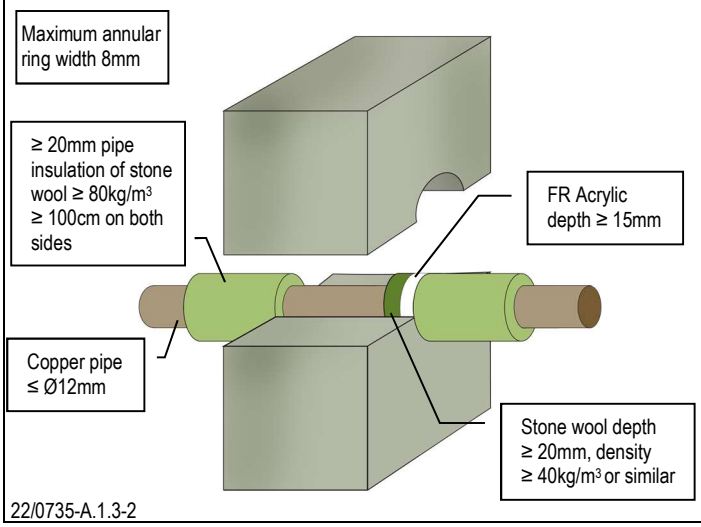

22/0735-A.1.3-2

COPPER PIPE FIRE RESISTANCE EI 60 C/U (E 240)

≥ 150MM RIGID WALLS

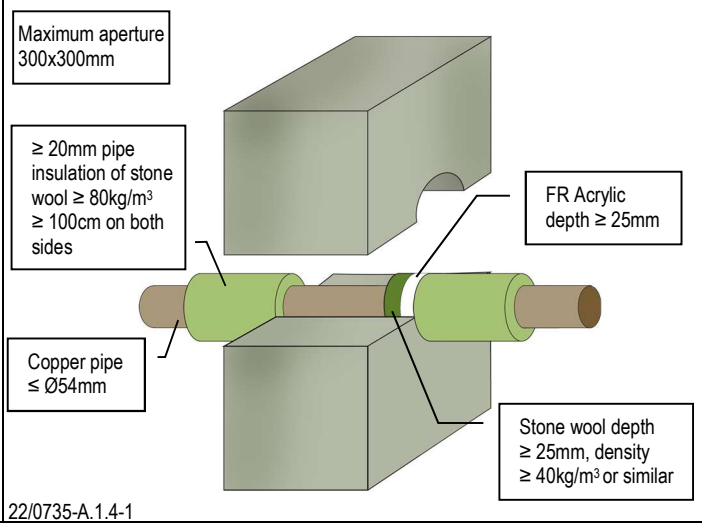


22/0735-A.1.4-1

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER OR STEEL PIPE FIRE RESISTANCE EI 180 C/U (E 240)


≥ 150MM RIGID WALLS

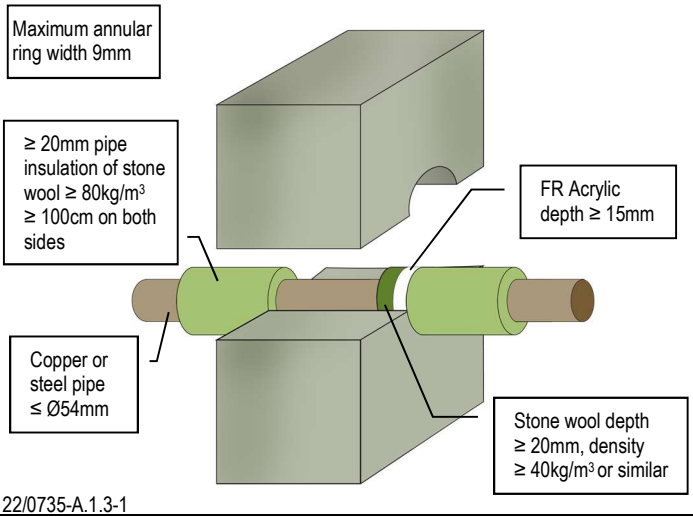

22/0735-A.1.3-1

ALUPEX PIPE FIRE RESISTANCE EI 60 C/U (E 240)


≥ 150MM RIGID WALLS

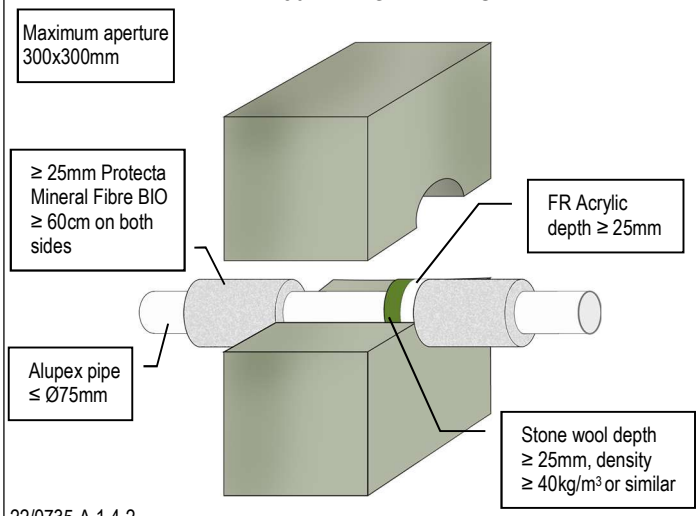

22/0735-A.1.4-2

ALUPEX PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 150MM RIGID WALLS

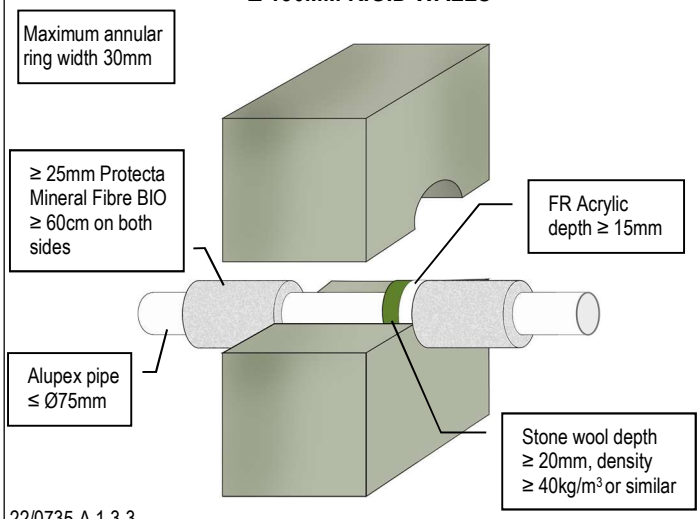

22/0735-A.1.3-3

PVC PLASTIC PIPE FIRE RESISTANCE EI 240 U/C (E 240)


≥ 150MM RIGID WALLS

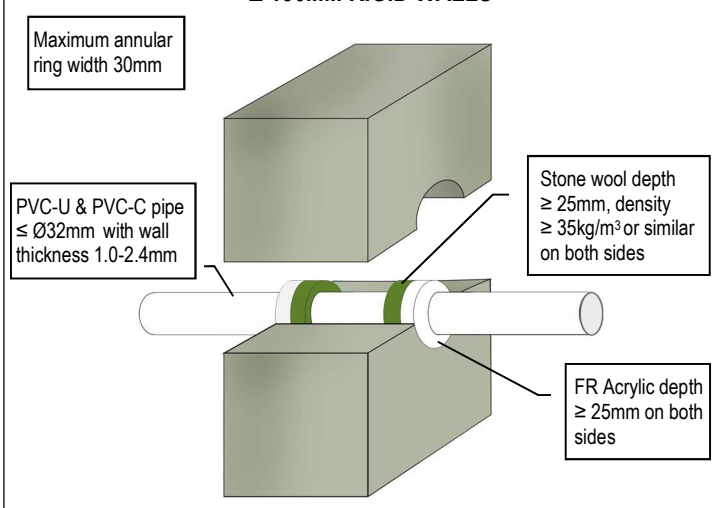

22/0735-A.1.9-1

PE PLASTIC PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 150MM RIGID WALLS

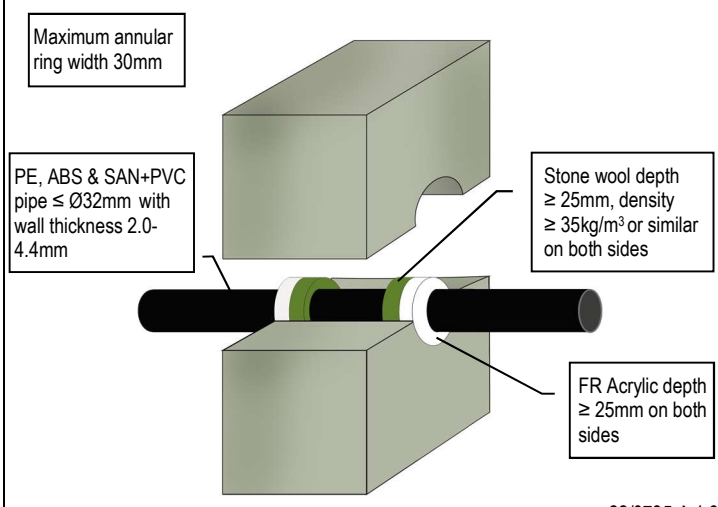

22/0735-A.1.9-9

PE PLASTIC PIPE FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

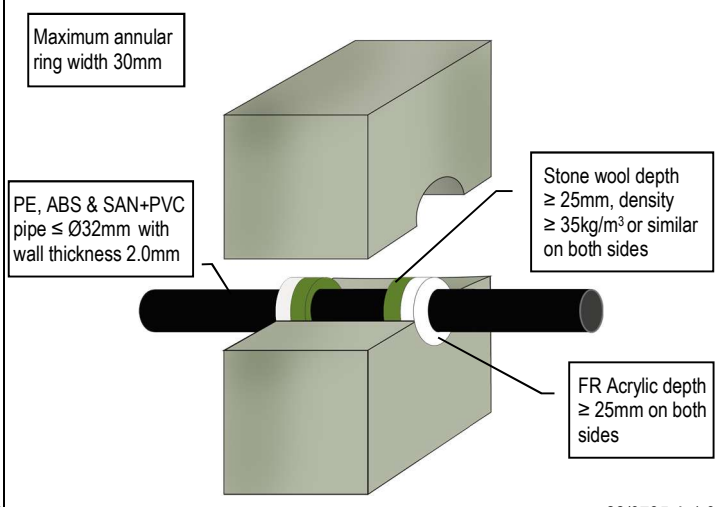


22/0735-A.1.9-8

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PP PLASTIC PIPE FIRE RESISTANCE EI 240 C/U (E 240)


≥ 150MM RIGID WALLS

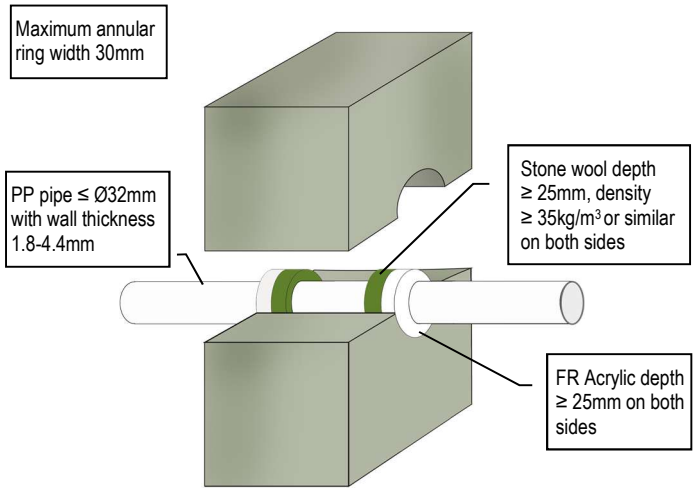

22/0735-A.1.9-5

PVC CONDUIT FIRE RESISTANCE EI 120 U/C (E 240)


≥ 150MM RIGID WALLS

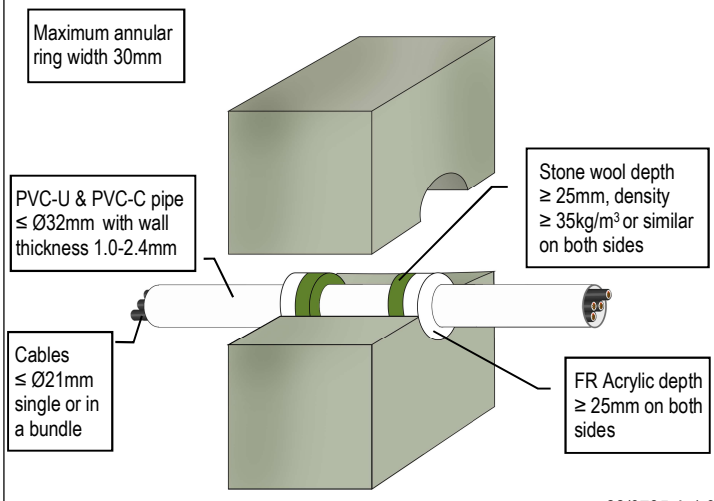

22/0735-A.1.9-2

PVC CONDUIT FIRE RESISTANCE EI 120 U/C (E 240)


≥ 150MM RIGID WALLS

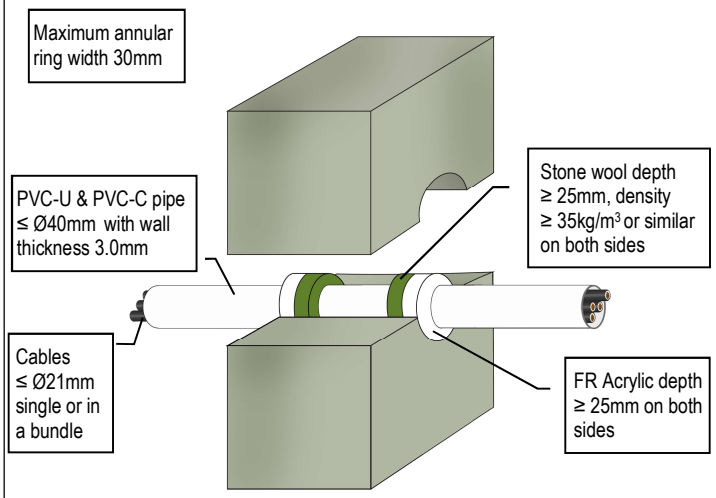

22/0735-A.1.9-3

PE CONDUIT FIRE RESISTANCE EI 120 U/C (E 120)


≥ 150MM RIGID WALLS

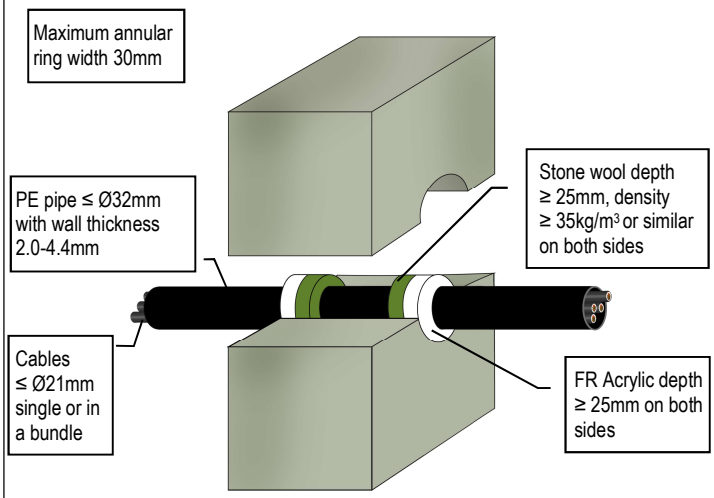

22/0735-A.1.9-10

PE CONDUIT FIRE RESISTANCE EI 240 U/C (E 240)


≥ 150MM RIGID WALLS

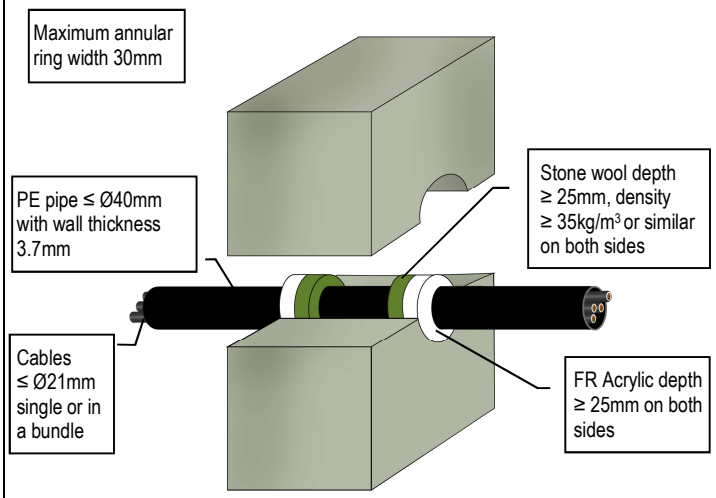

22/0735-A.1.9-11

PP CONDUIT FIRE RESISTANCE EI 120 U/C (E 180)

≥ 150MM RIGID WALLS

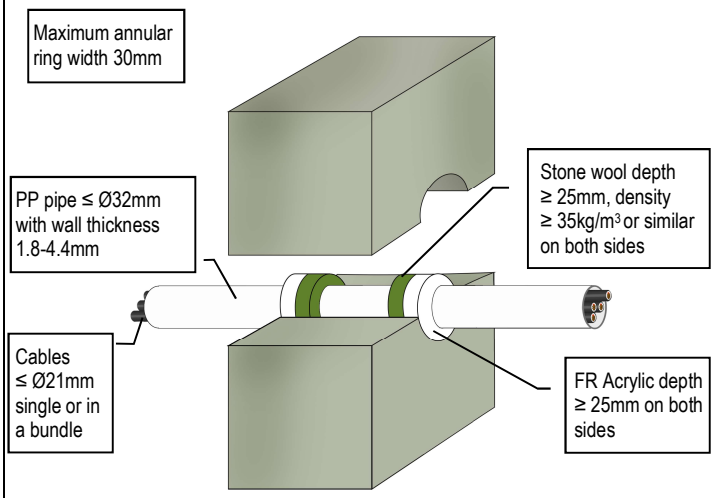


22/0735-A.1.9-6

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PP CONDUIT FIRE RESISTANCE EI 120 U/C (E 180)


≥ 150MM RIGID WALLS

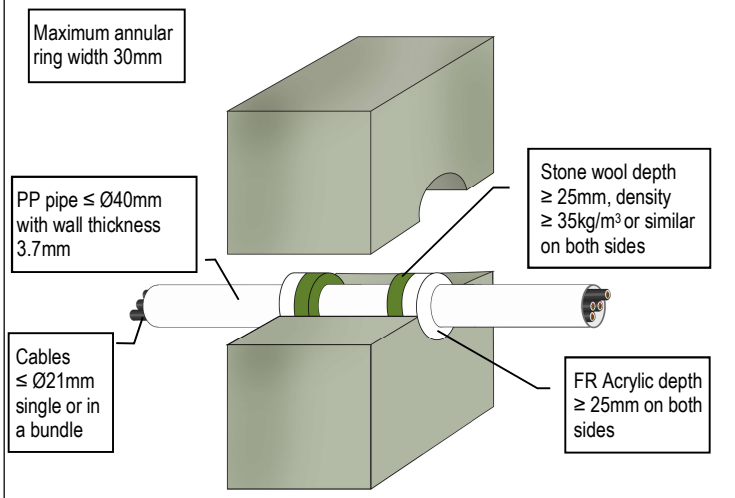

22/0735-A.1.9-7

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 45 (E 60)


BETWEEN ≥ 75MM FLEXIBLE WALLS AND FLOORS

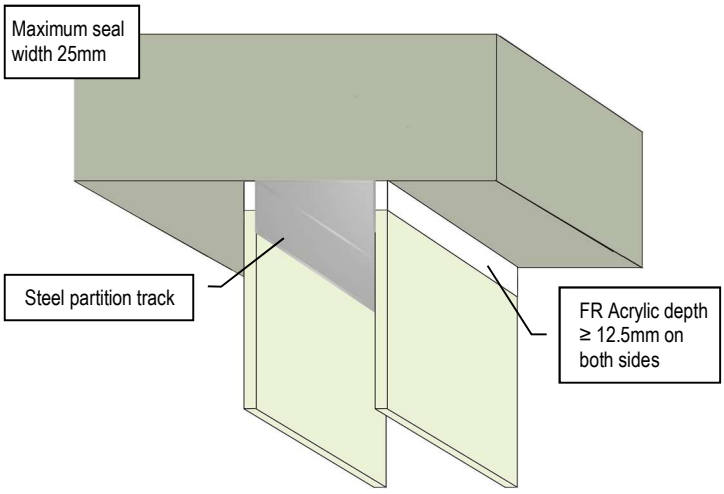

23/0257-A.1.1-1

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 45 (E 60)


IN ≥ 75MM FLEXIBLE WALLS OR BETWEEN WALLS

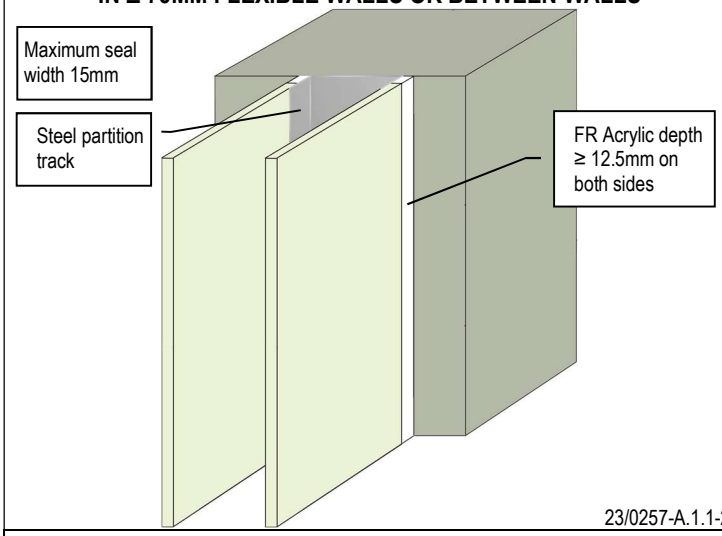

23/0257-A.1.1-2

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)


BETWEEN ≥ 100MM FLEXIBLE WALLS AND FLOORS

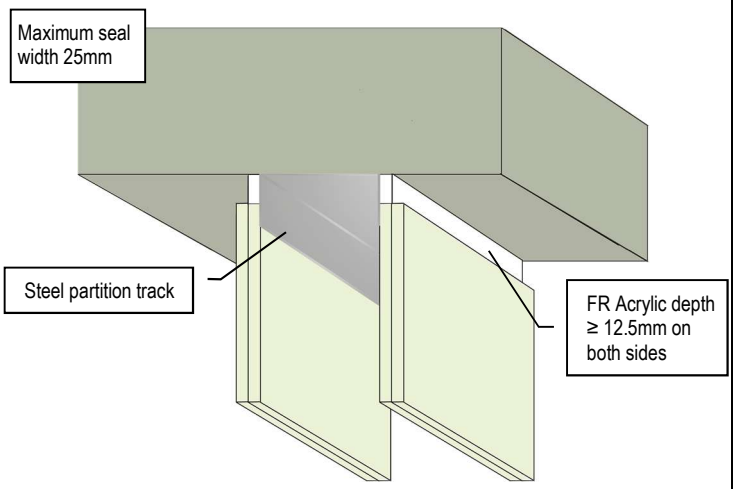

23/0257-A.2.1-4

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)


BETWEEN ≥ 100MM FLEXIBLE WALLS AND FLOORS

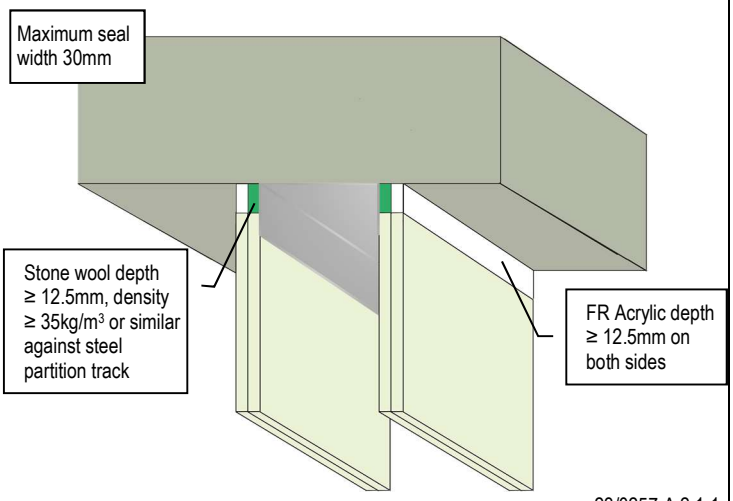

23/0257-A.2.1-1

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)

BETWEEN ≥ 100MM FLEXIBLE WALLS AND FLOORS

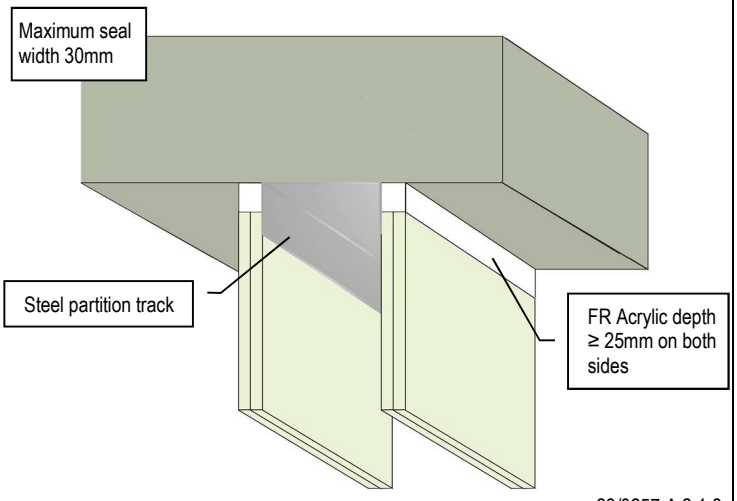


23/0257-A.2.1-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)


IN ≥ 100MM FLEXIBLE WALLS OR BETWEEN WALLS

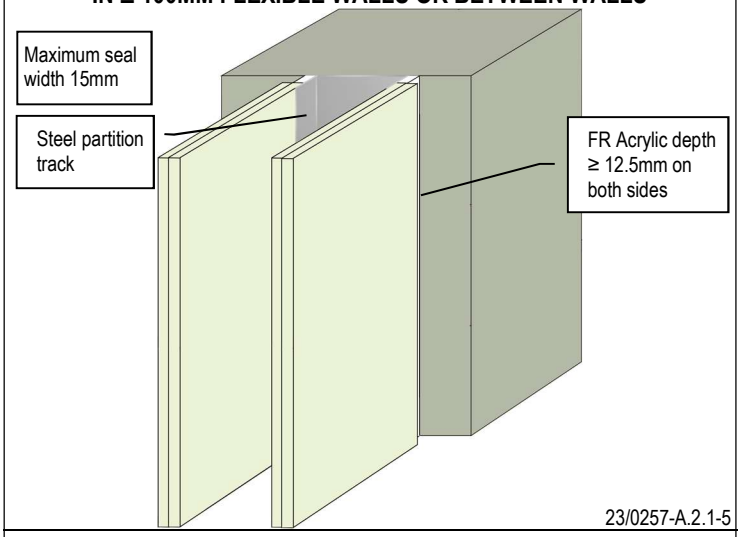

23/0257-A.2.1-5

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)


IN ≥ 100MM FLEXIBLE WALLS OR BETWEEN WALLS

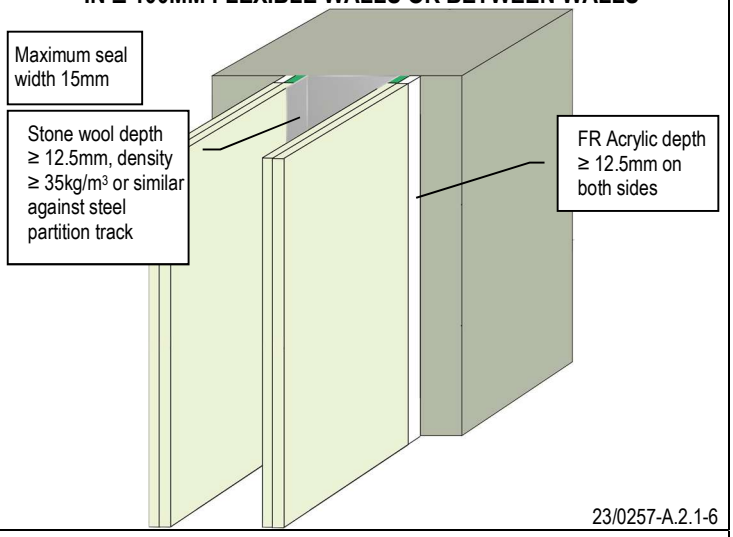

23/0257-A.2.1-6

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)


IN ≥ 100MM FLEXIBLE WALLS OR BETWEEN WALLS

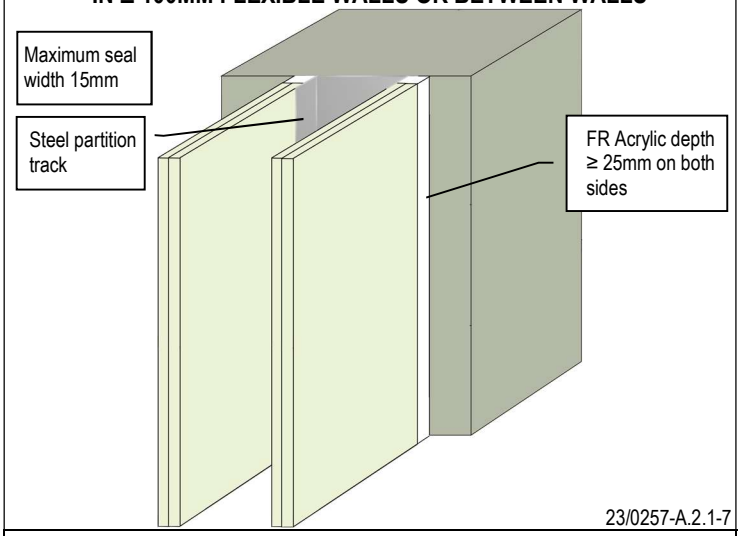

23/0257-A.2.1-7

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 30 (E 120)


IN ≥ 100MM FLEXIBLE OR RIGID WALLS

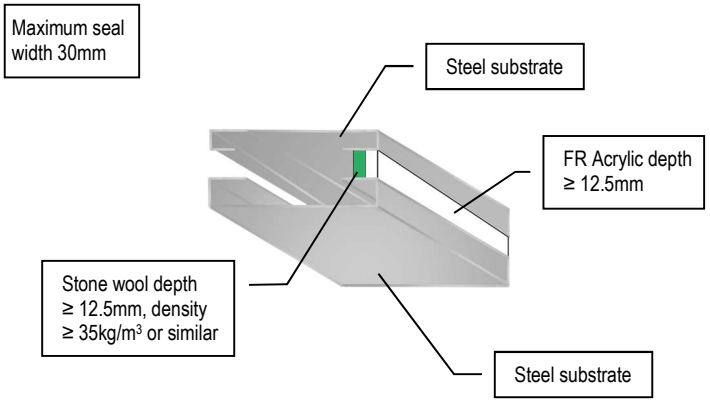

23/0257-A.2.4-1

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 30 (E 120)


IN ≥ 100MM FLEXIBLE OR RIGID WALLS

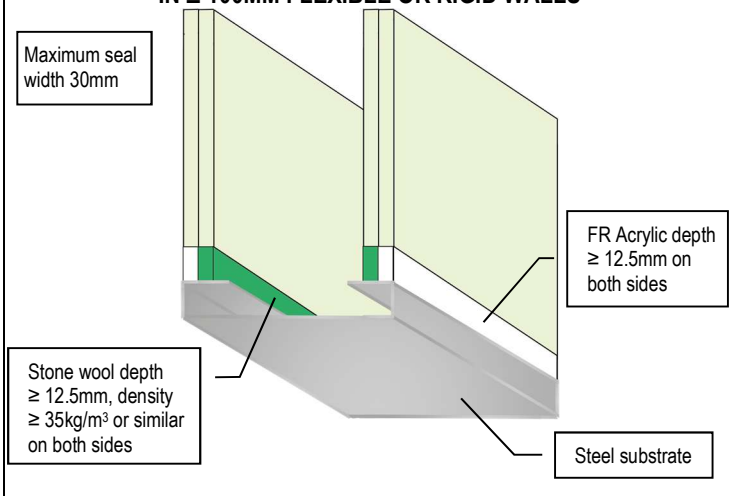

23/0257-A.2.5-1

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 60 (E 120)

IN ≥ 100MM FLEXIBLE OR RIGID WALLS

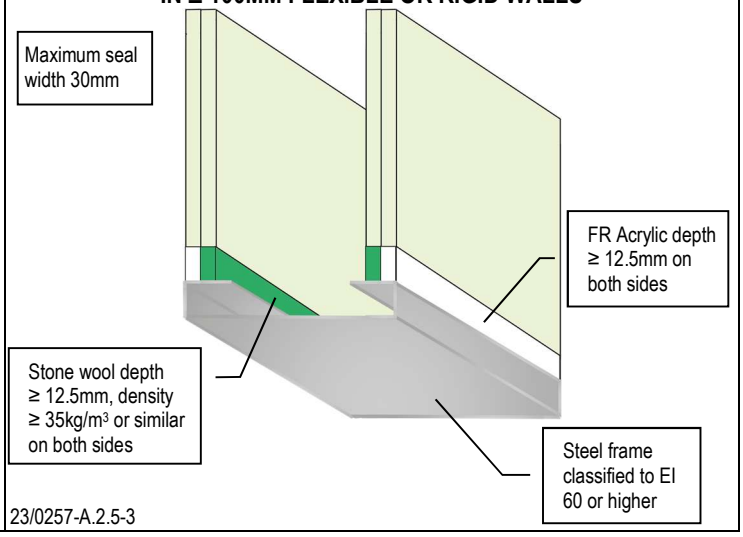


23/0257-A.2.5-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 60 (E 60)


IN ≥ 100MM FLEXIBLE OR RIGID WALLS

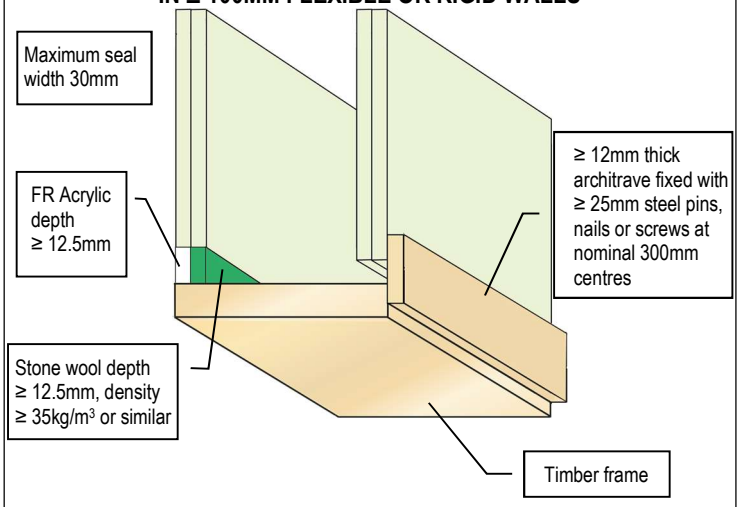

23/0257-A.2.2-1

HORIZONTAL & VERTICAL SEALS FIRE RESISTANCE EI 60 (E 90)


IN ≥ 100MM FLEXIBLE OR RIGID WALLS

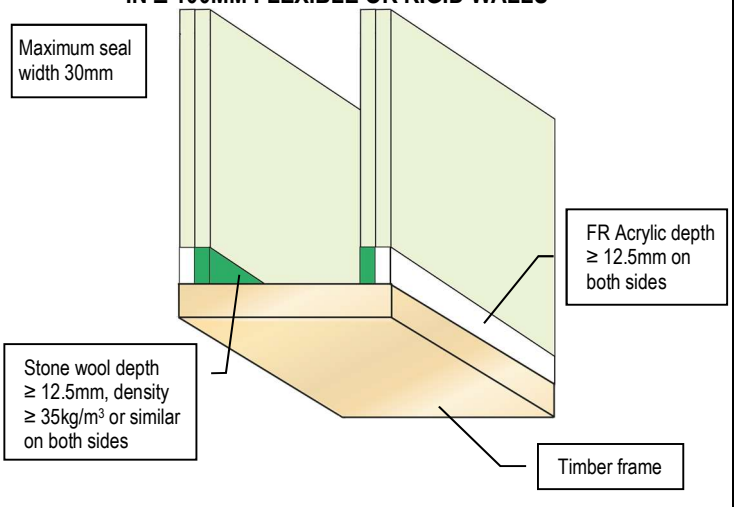

23/0257-A.2.3-1

CABLE FIRE RESISTANCE EI 45 (E 60)


≥ 75MM FLEXIBLE OR RIGID WALLS

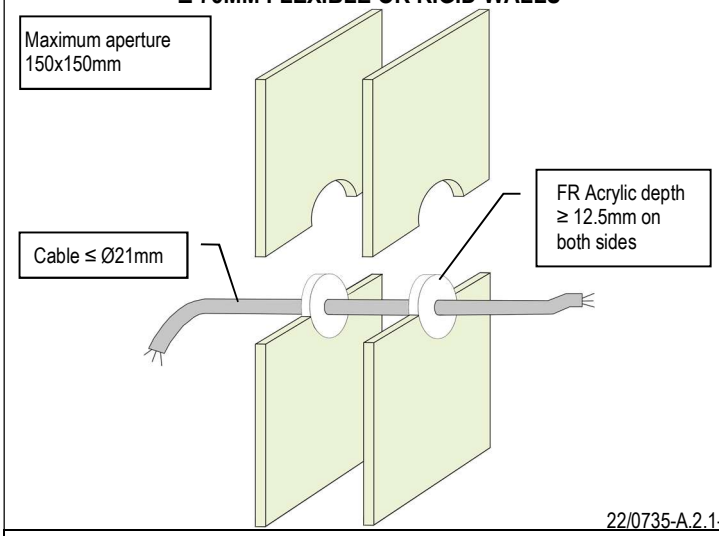

22/0735-A.2.1-2

CABLES FIRE RESISTANCE EI 30 (E 45)


≥ 75MM FLEXIBLE OR RIGID WALLS

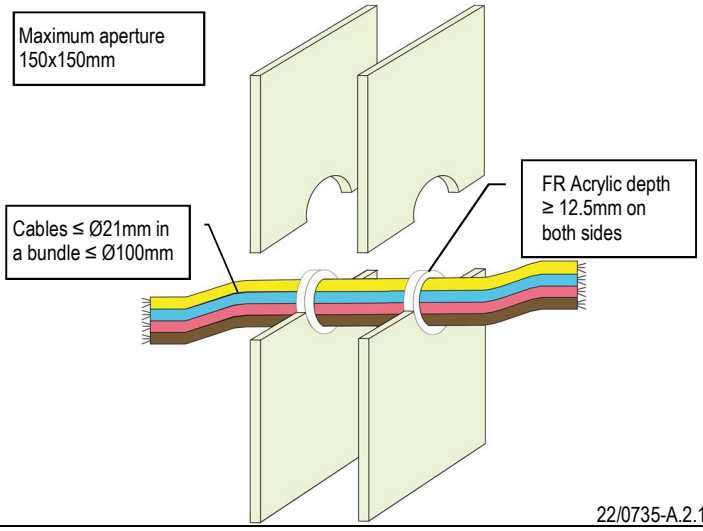

22/0735-A.2.1-3

CABLES FIRE RESISTANCE EI 90 (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

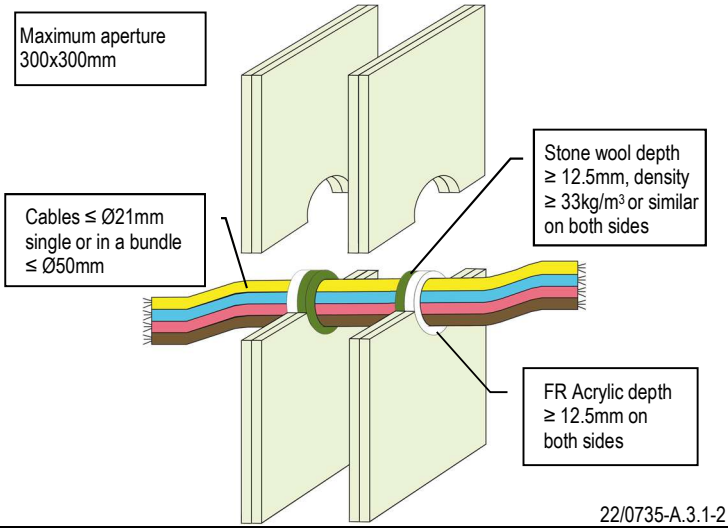

22/0735-A.3.1-2

CABLES FIRE RESISTANCE EI 120 (E 120)

≥ 100MM FLEXIBLE OR RIGID WALLS

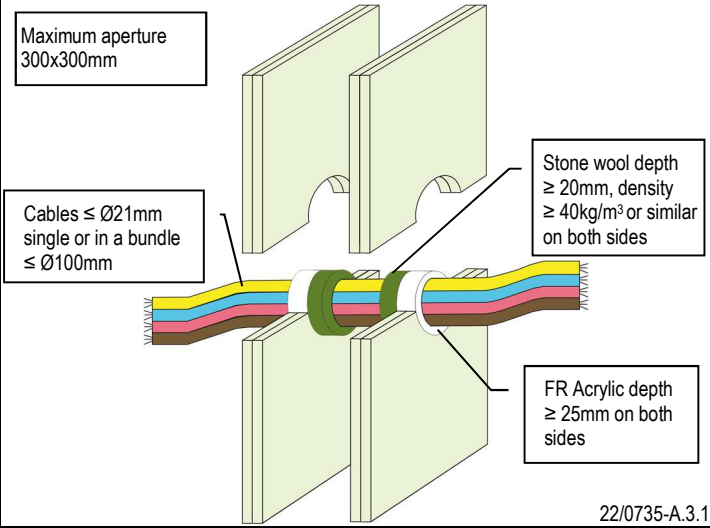


22/0735-A.3.1-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CABLES FIRE RESISTANCE EI 60 (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

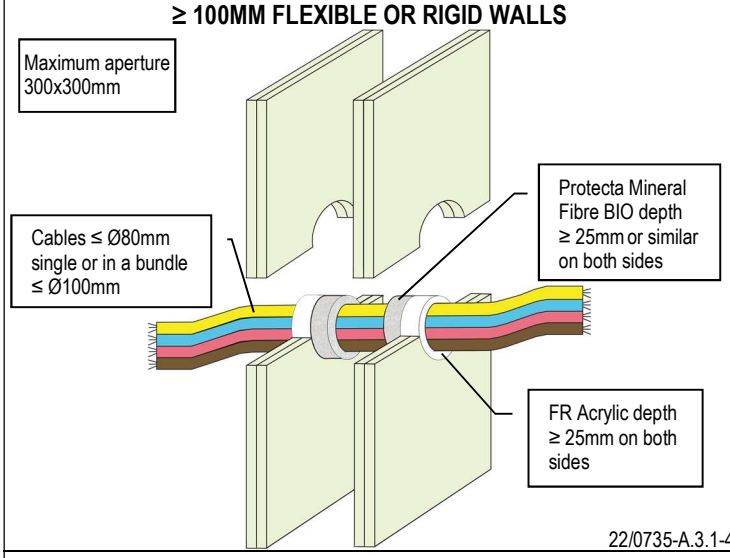

22/0735-A.3.1-4

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

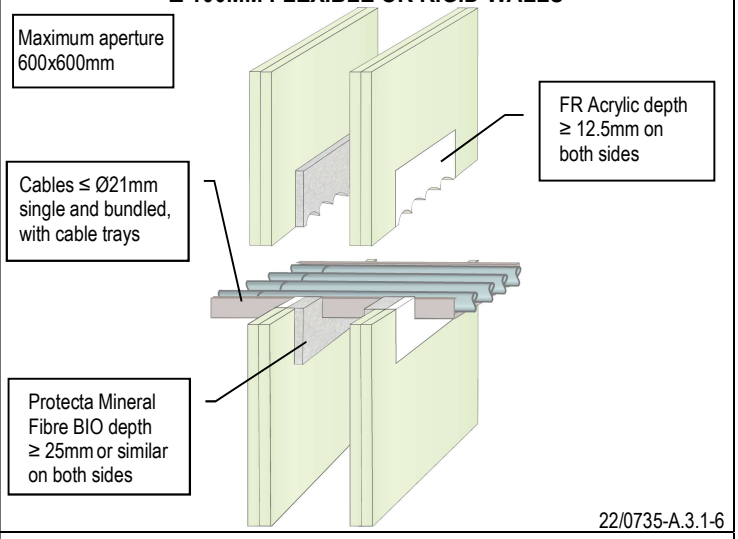

22/0735-A.3.1-6

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 30 (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

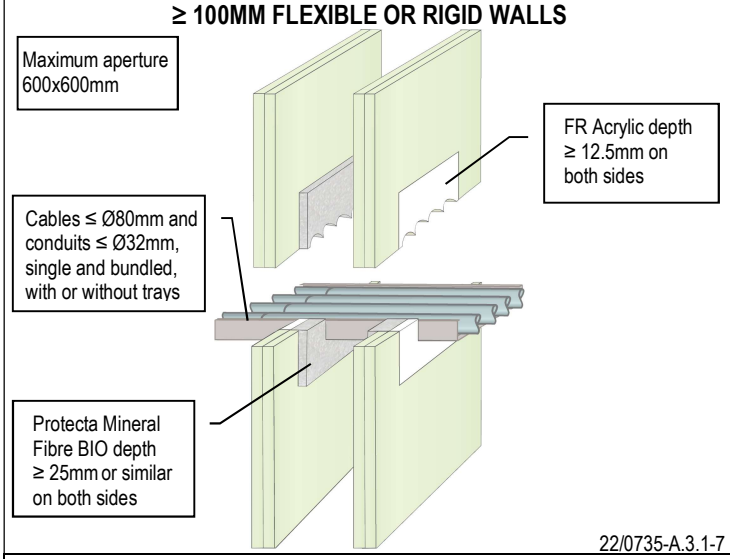

22/0735-A.3.1-7

UNISTRUT CHANNEL FIRE RESISTANCE EI 60 (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

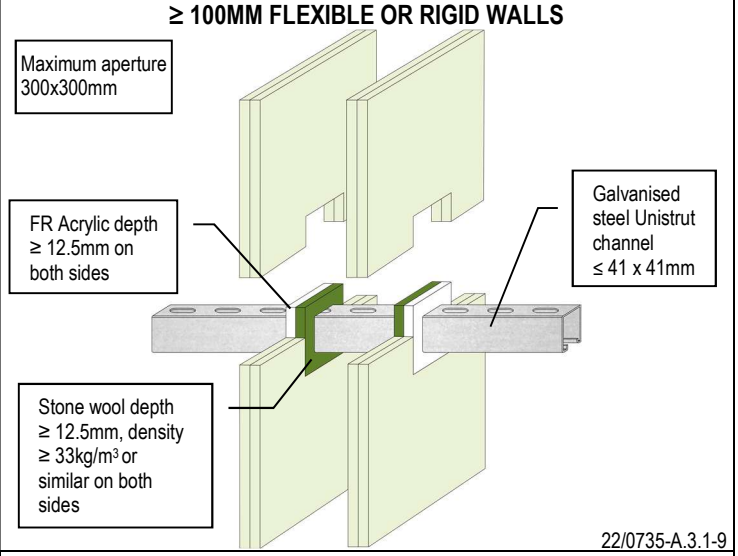

22/0735-A.3.1-9

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 60)


≥ 75MM FLEXIBLE OR RIGID WALLS

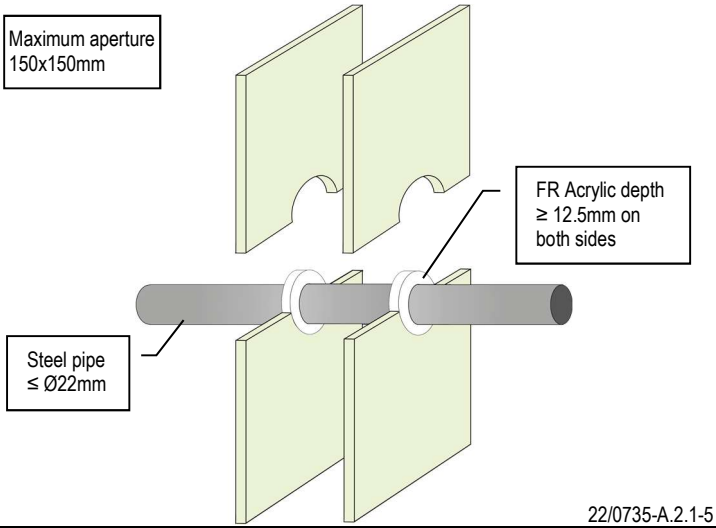

22/0735-A.2.1-5

STEEL PIPE FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM FLEXIBLE OR RIGID WALLS

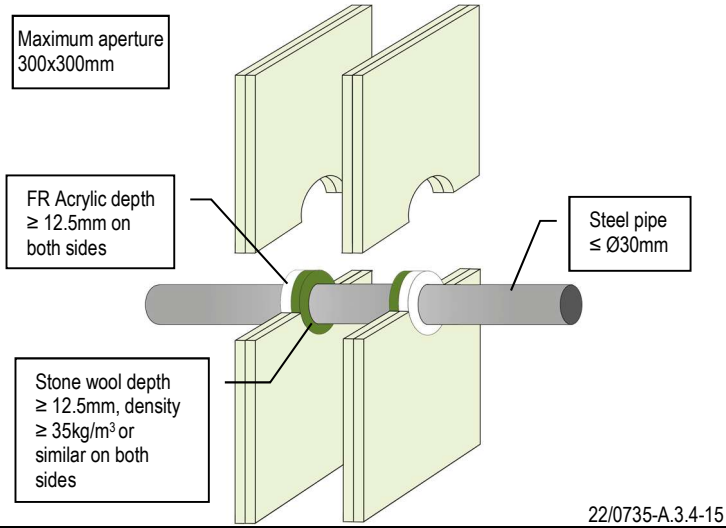


22/0735-A.3.4-15

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

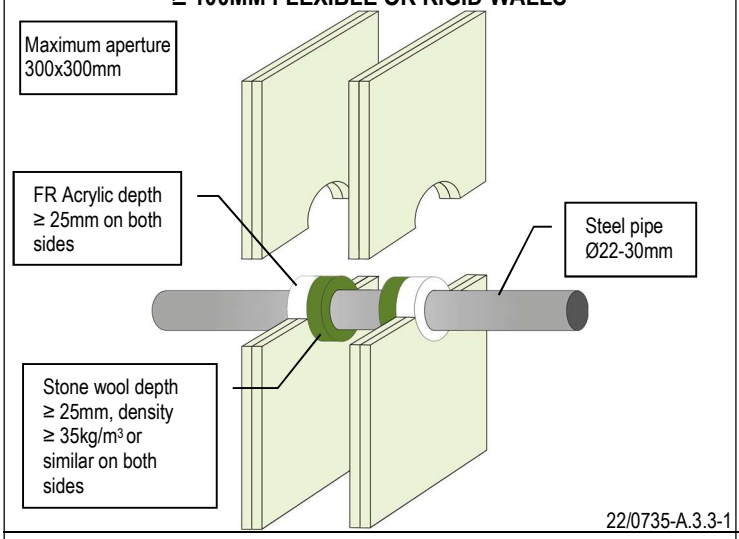

22/0735-A.3.3-1

STEEL PIPE FIRE RESISTANCE E 120 C/U


≥ 120MM FLEXIBLE OR RIGID WALLS

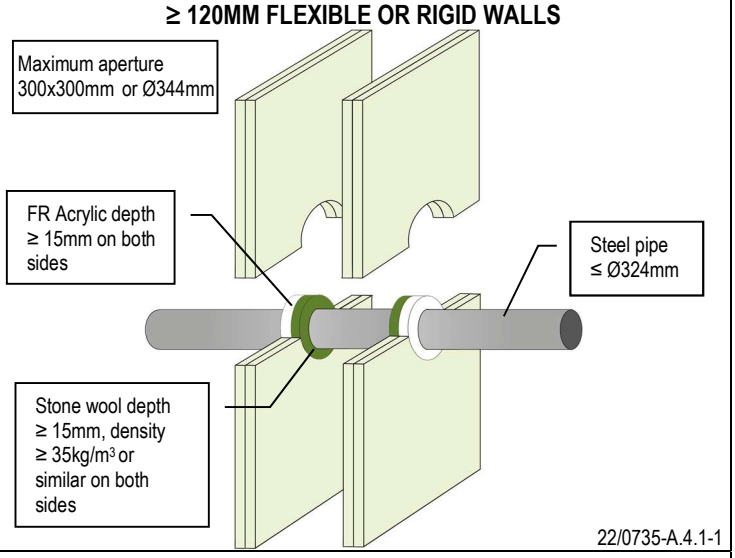

22/0735-A.4.1-1

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

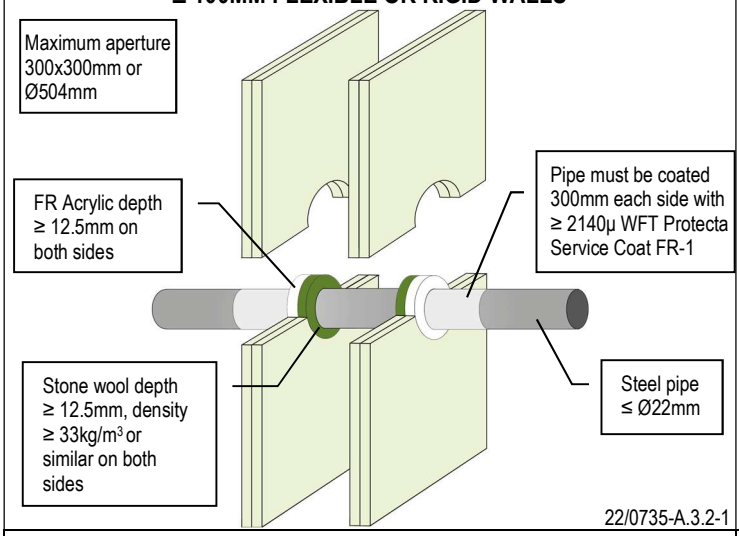

22/0735-A.3.2-1

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

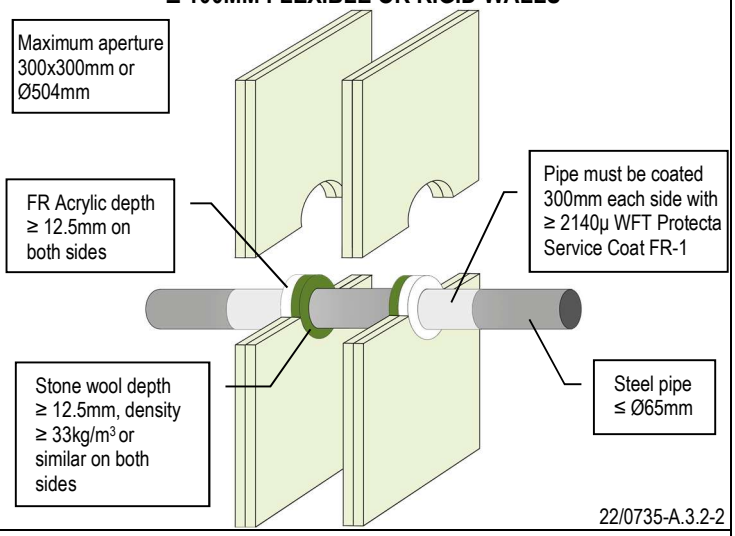

22/0735-A.3.2-2

STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

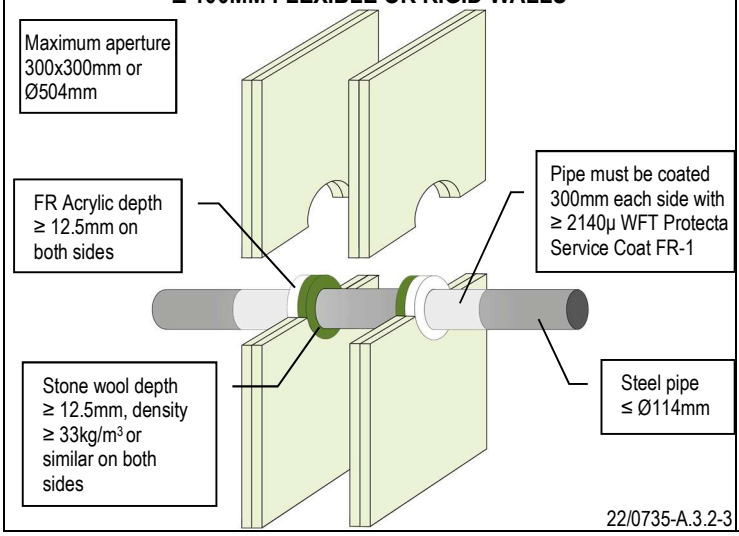

22/0735-A.3.2-3

INSULATED STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 60)

≥ 75MM FLEXIBLE OR RIGID WALLS

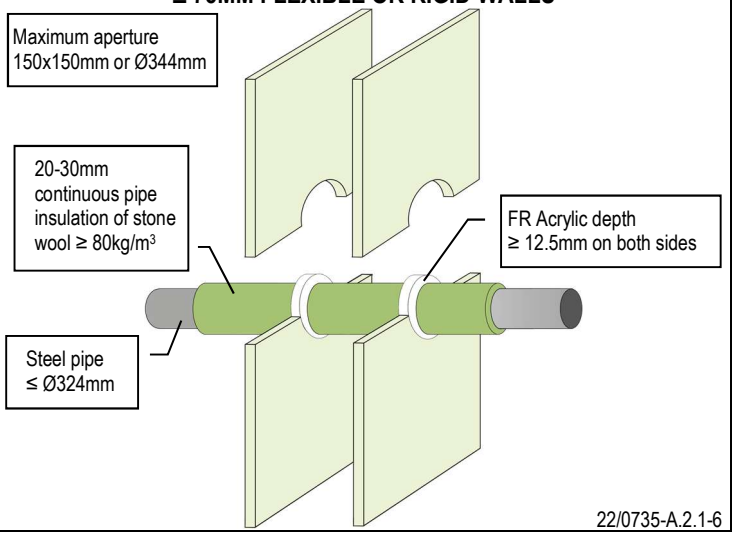


22/0735-A.2.1-6

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

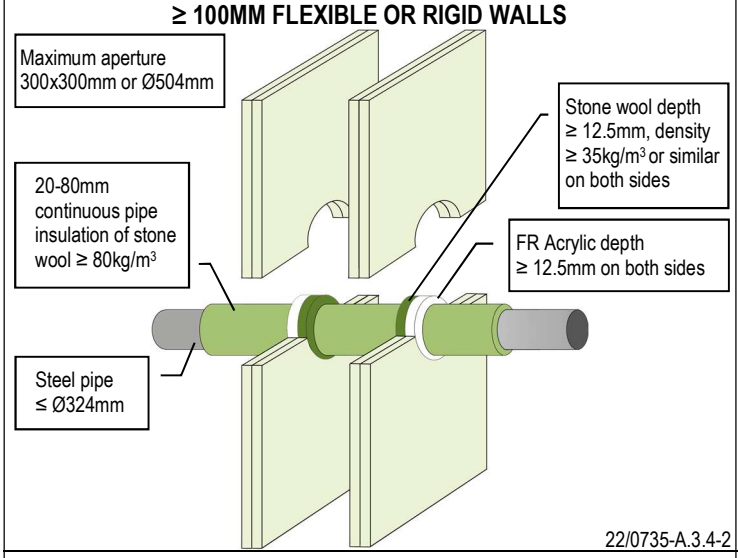

22/0735-A.3.4-2

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

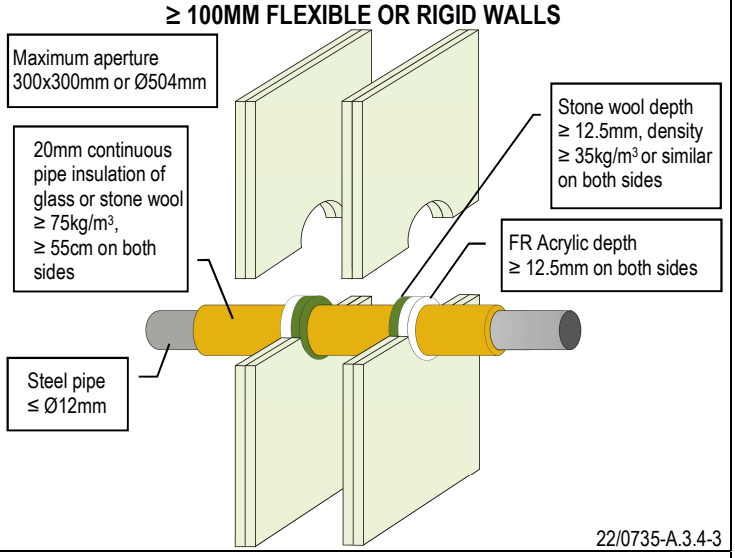

22/0735-A.3.4-3

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

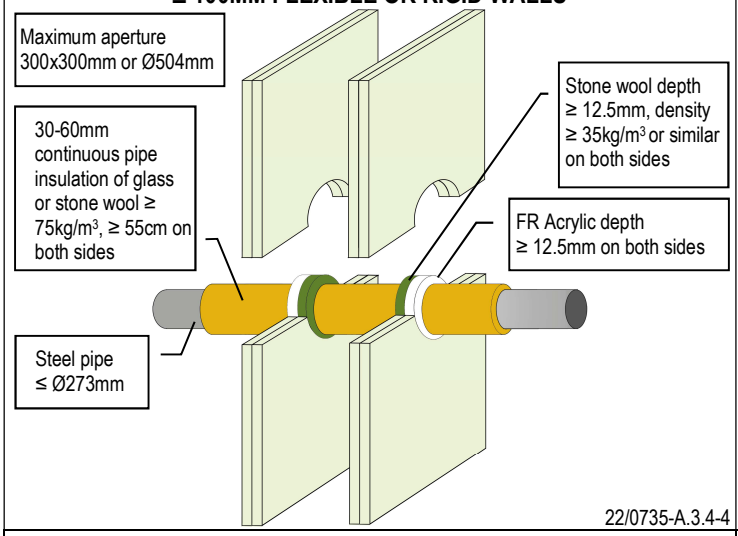

22/0735-A.3.4-4

STEEL PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

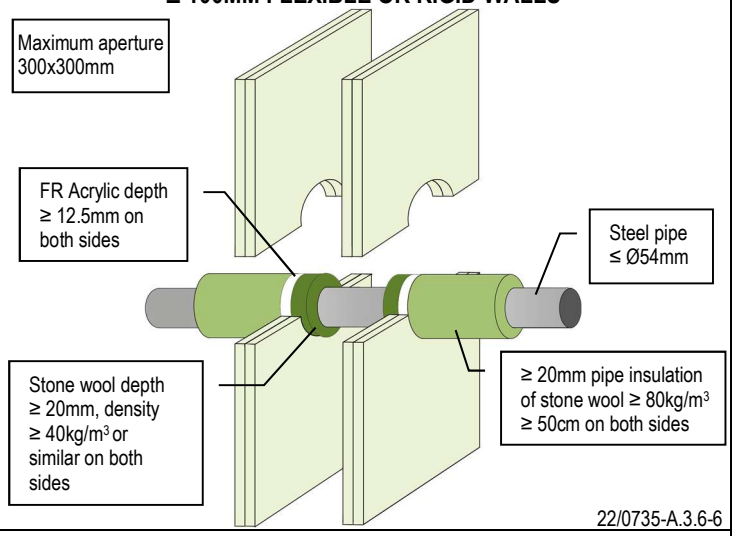

22/0735-A.3.6-6

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

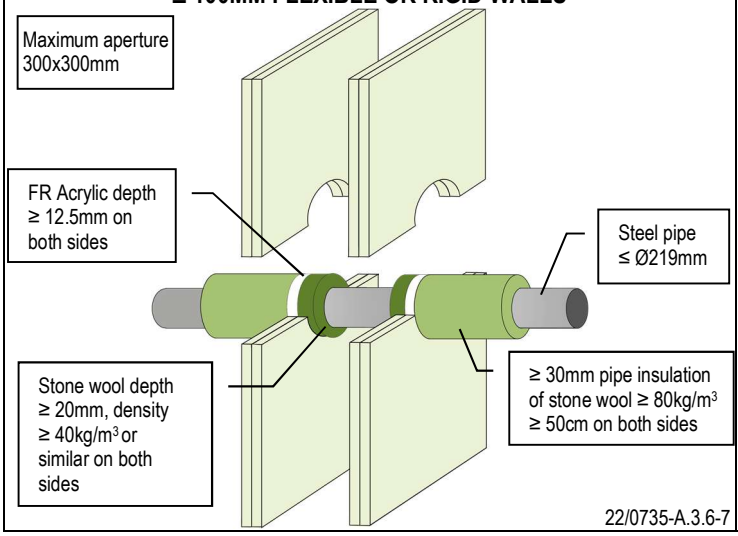

22/0735-A.3.6-7

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM FLEXIBLE OR RIGID WALLS

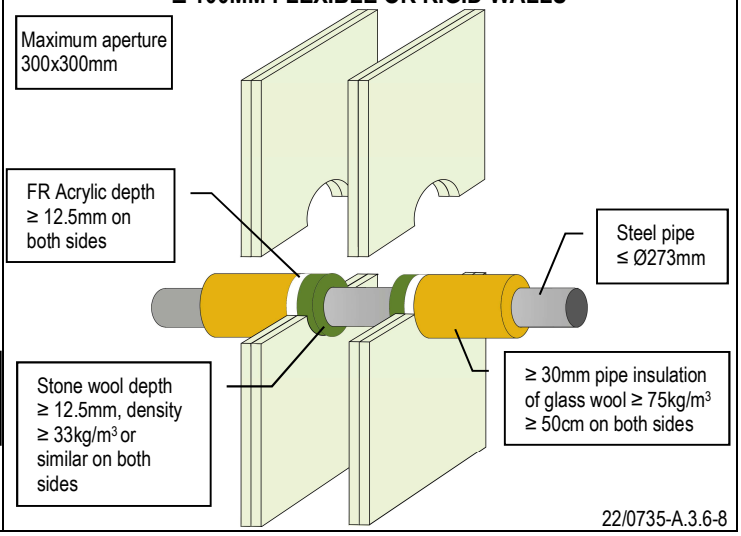


22/0735-A.3.6-8

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

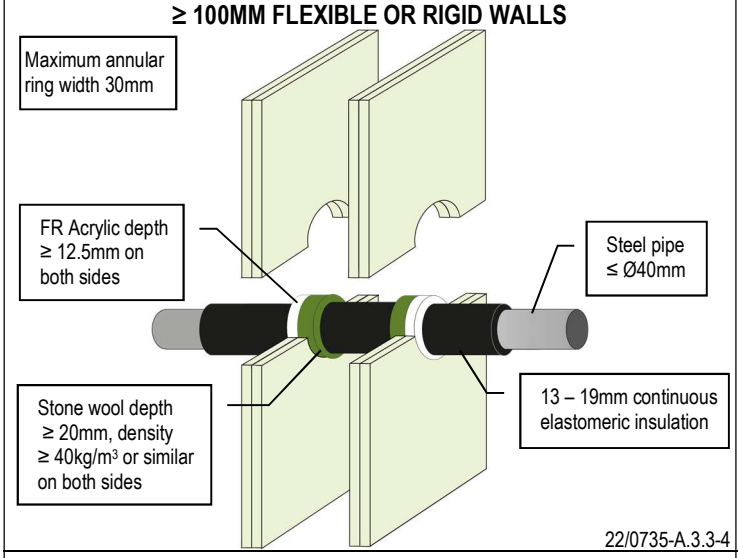

22/0735-A.3.3-4

STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

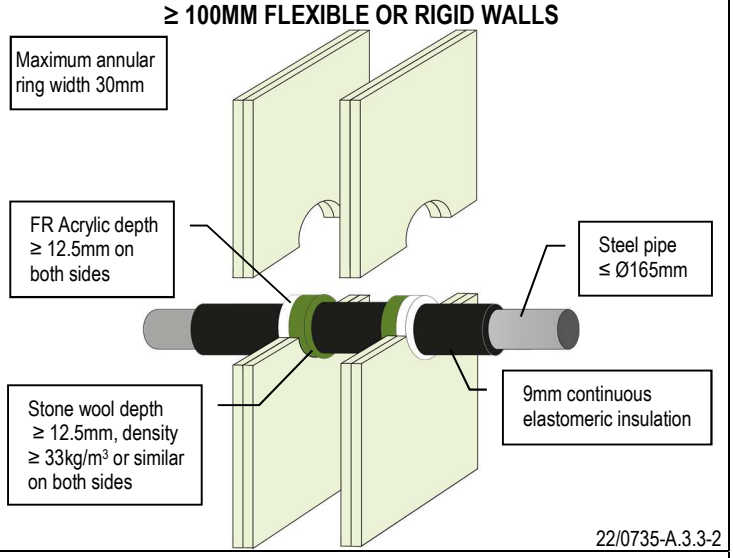

22/0735-A.3.3-2

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

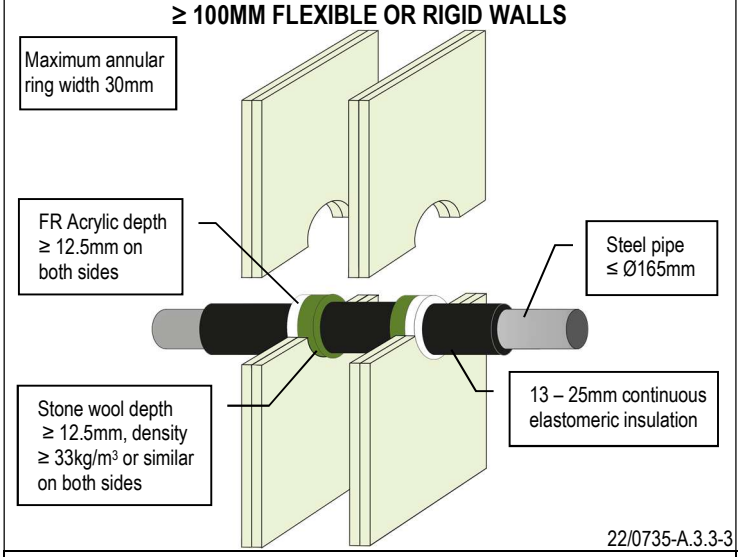

22/0735-A.3.3-3

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

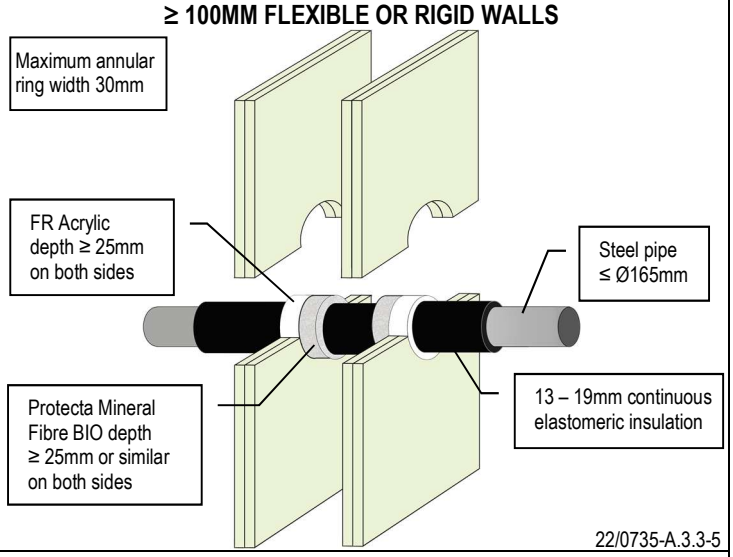

22/0735-A.3.3-5

STEEL PIPE FIRE RESISTANCE EI 90 C/U (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

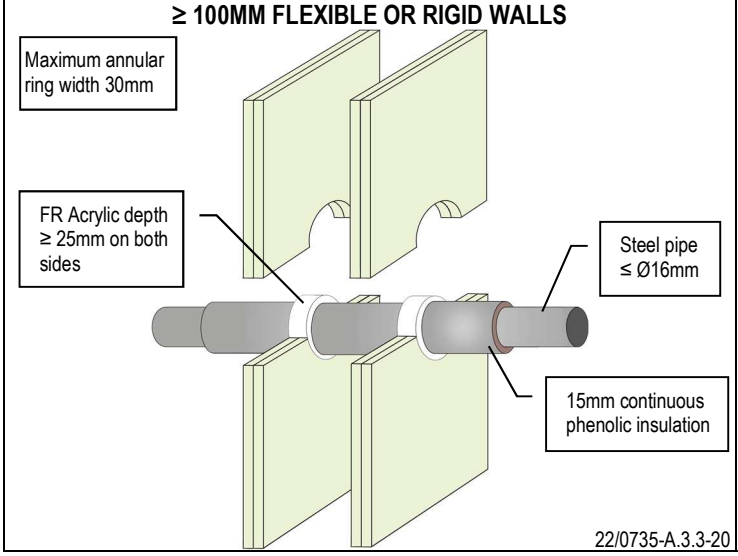

22/0735-A.3.3-20

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM FLEXIBLE OR RIGID WALLS

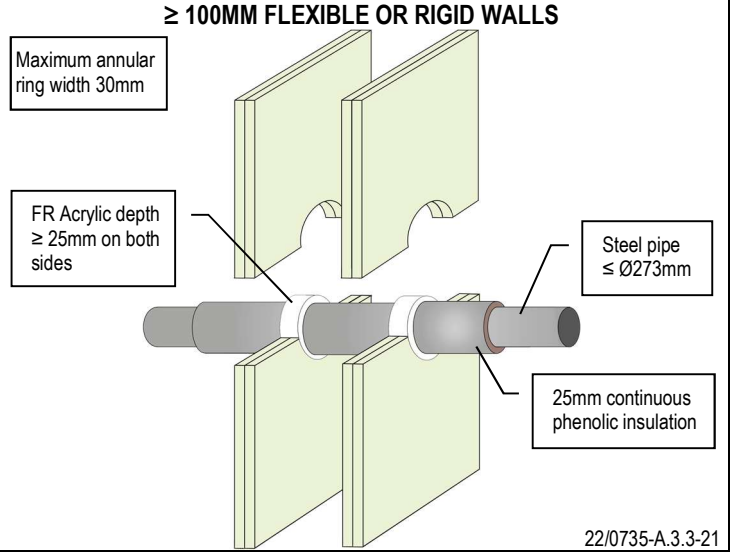


22/0735-A.3.3-21

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

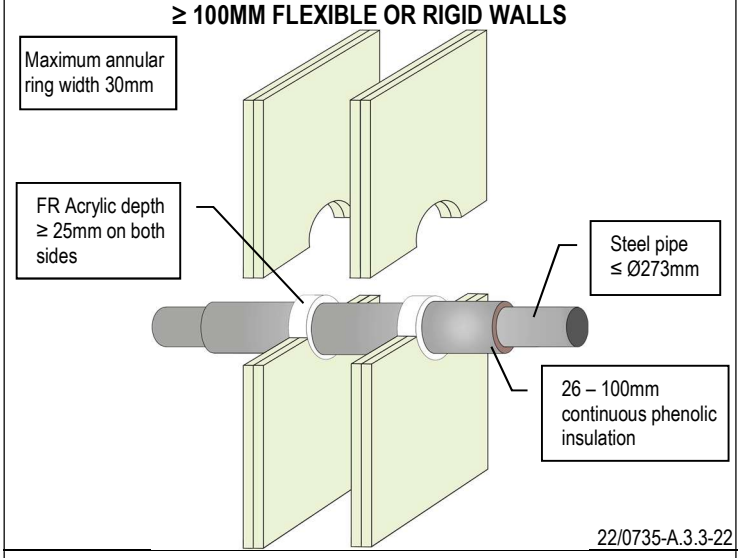

22/0735-A.3.3-22

GAS PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

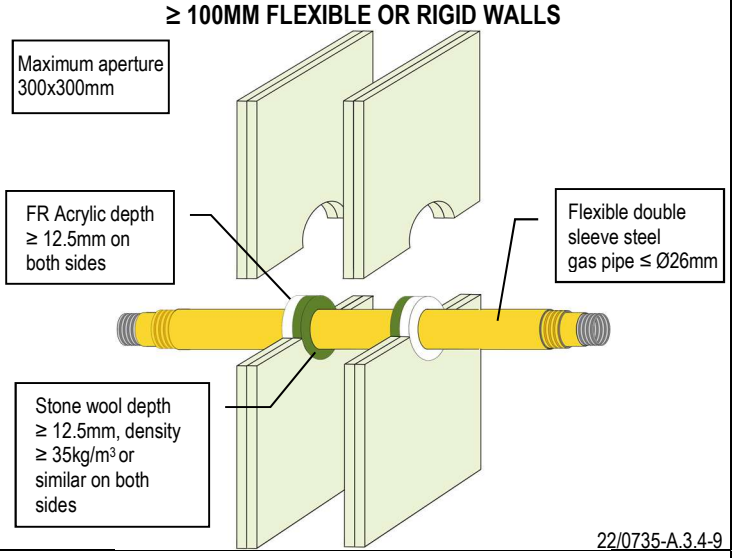

22/0735-A.3.4-9

GAS PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

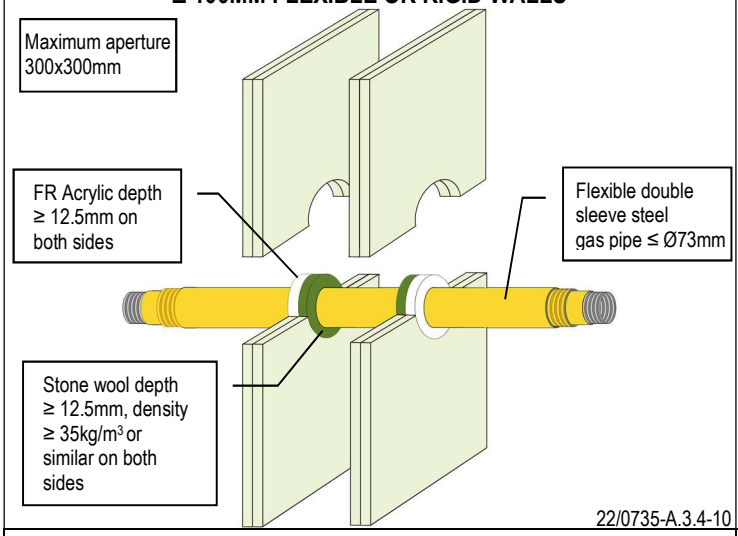

22/0735-A.3.4-10

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

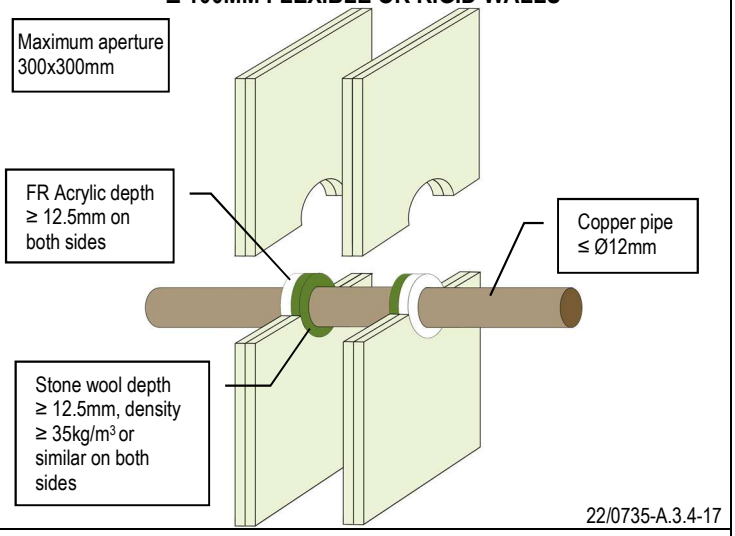

22/0735-A.3.4-17

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

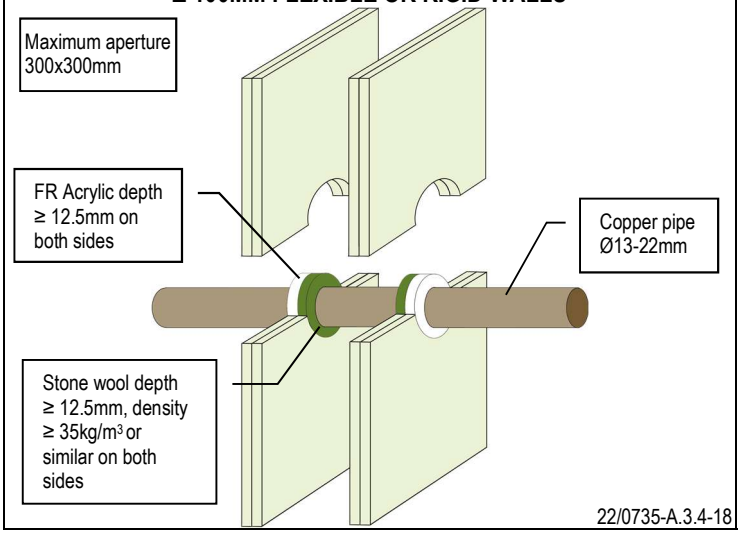

22/0735-A.3.4-18

COPPER PIPE FIRE RESISTANCE E 120 C/C

≥ 120MM FLEXIBLE OR RIGID WALLS

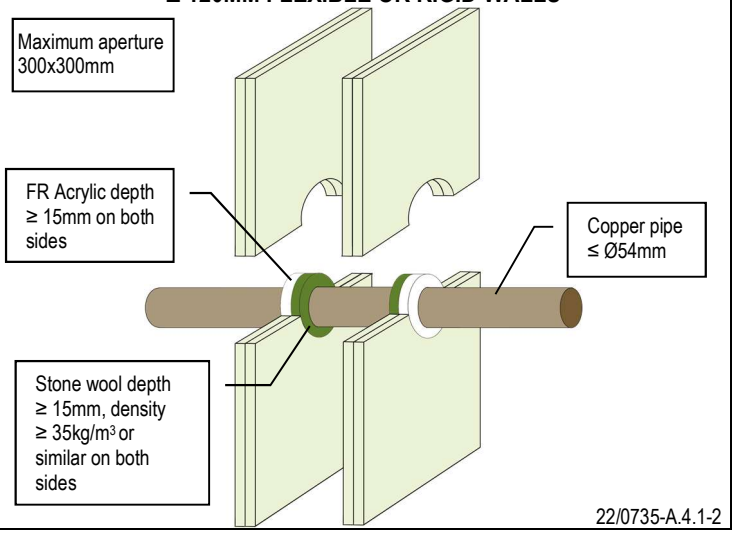


22/0735-A.4.1-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

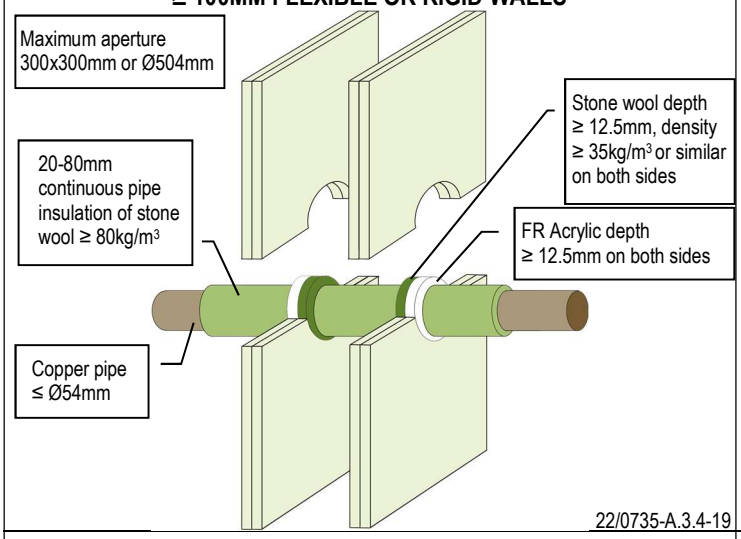

22/0735-A.3.4-19

INSULATED COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

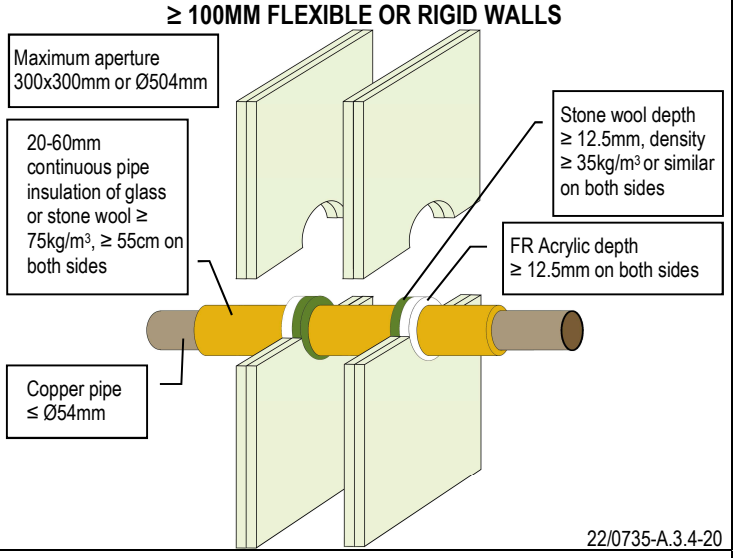

22/0735-A.3.4-20

COPPER PIPE FIRE RESISTANCE EI 120 C/U (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

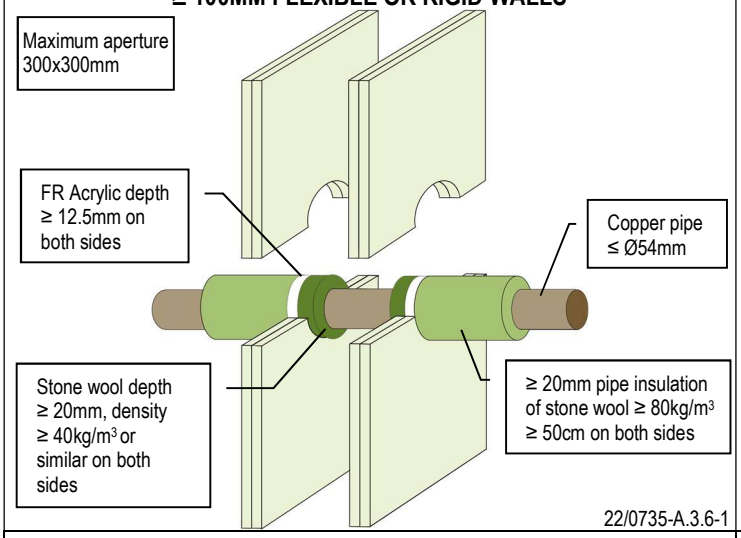

22/0735-A.3.6-1

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

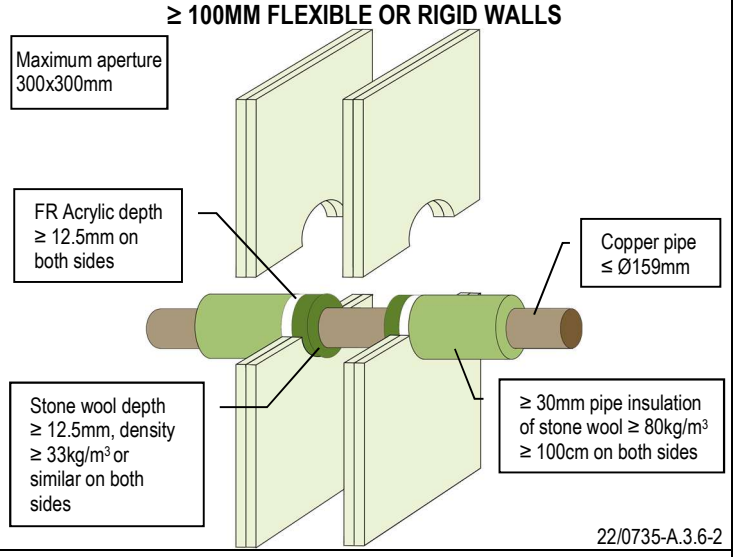

22/0735-A.3.6-2

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

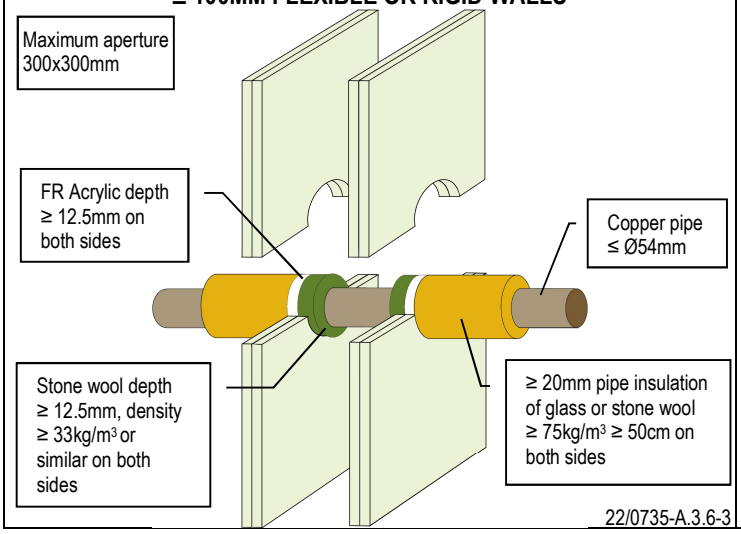

22/0735-A.3.6-3

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 120)

≥ 100MM FLEXIBLE OR RIGID WALLS

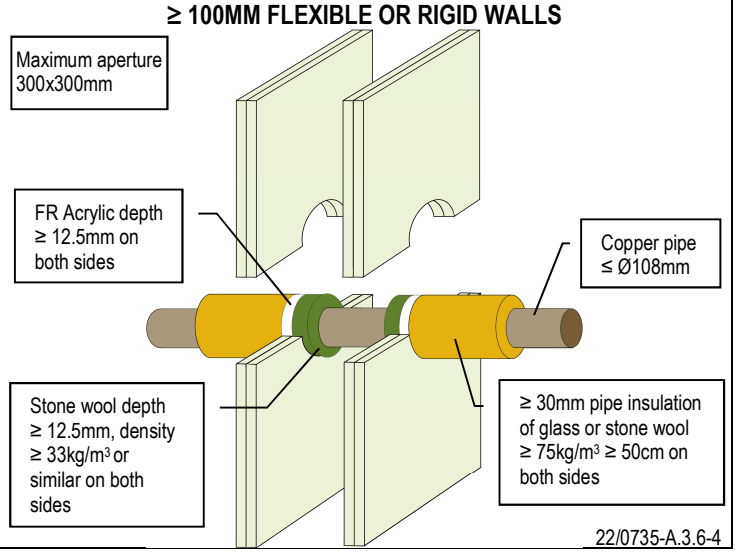


22/0735-A.3.6-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

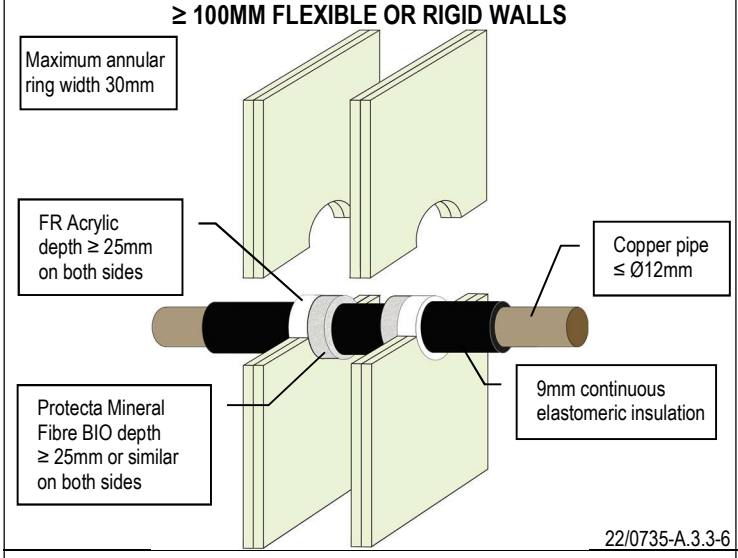

22/0735-A.3.3-6

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

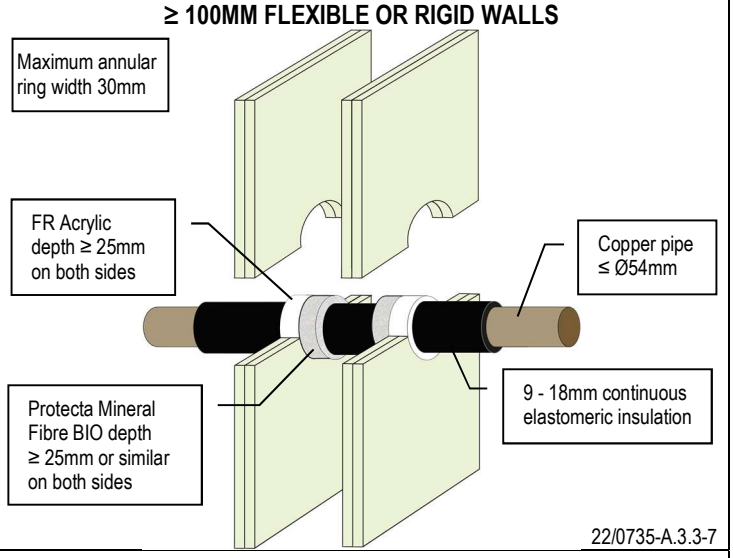

22/0735-A.3.3-7

COPPER PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

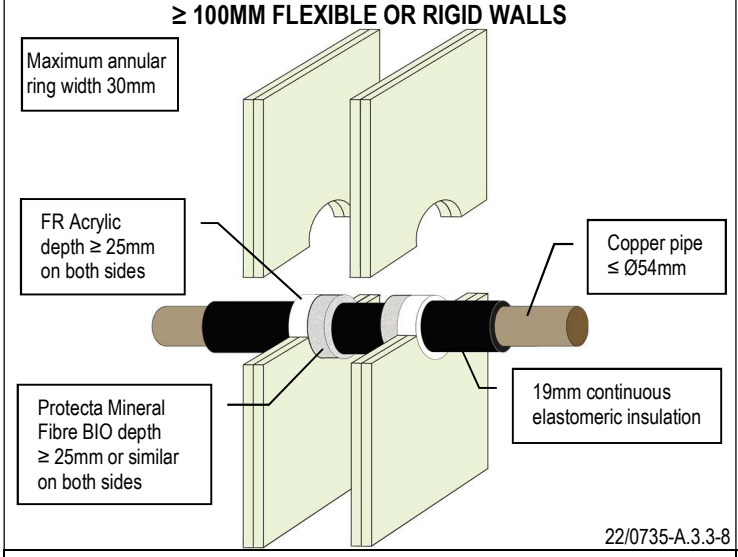

22/0735-A.3.3-8

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

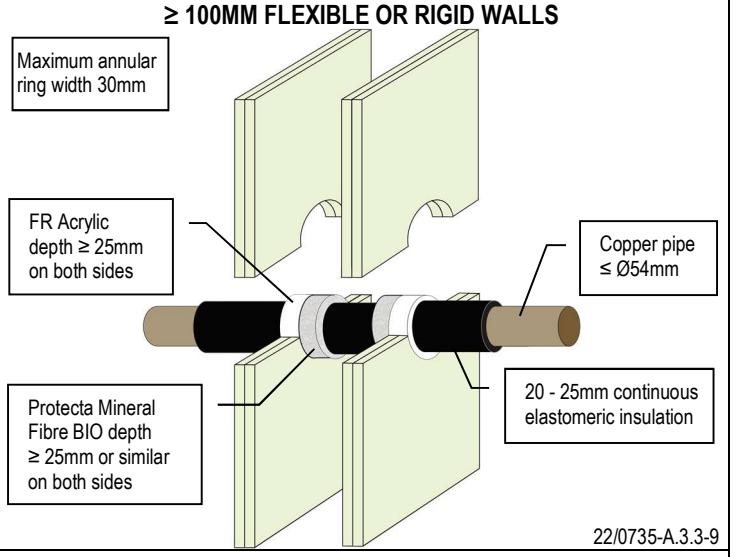

22/0735-A.3.3-9

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

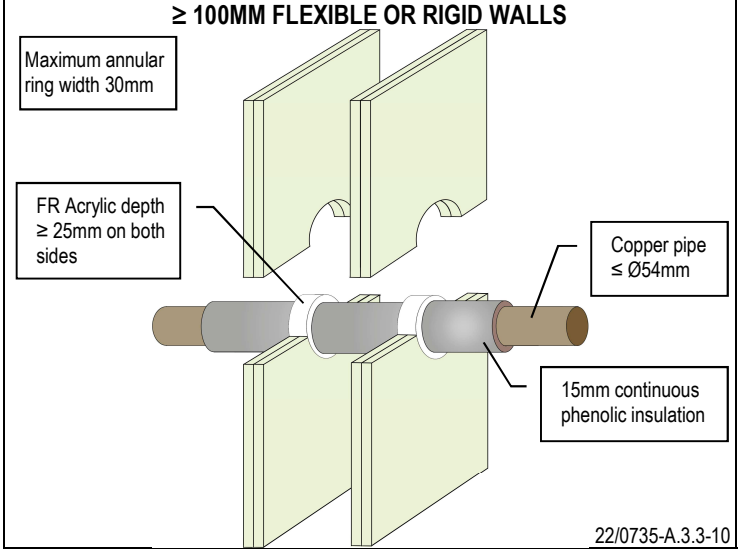

22/0735-A.3.3-10

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM FLEXIBLE OR RIGID WALLS

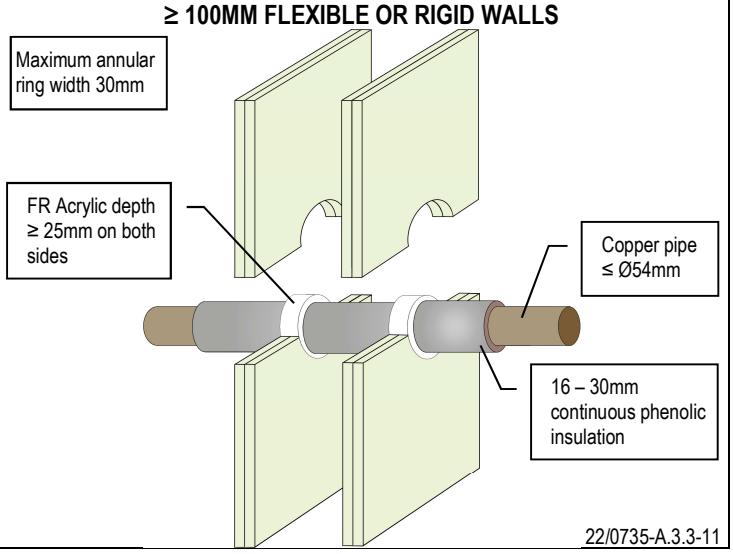


22/0735-A.3.3-11

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 45)


≥ 100MM FLEXIBLE OR RIGID WALLS

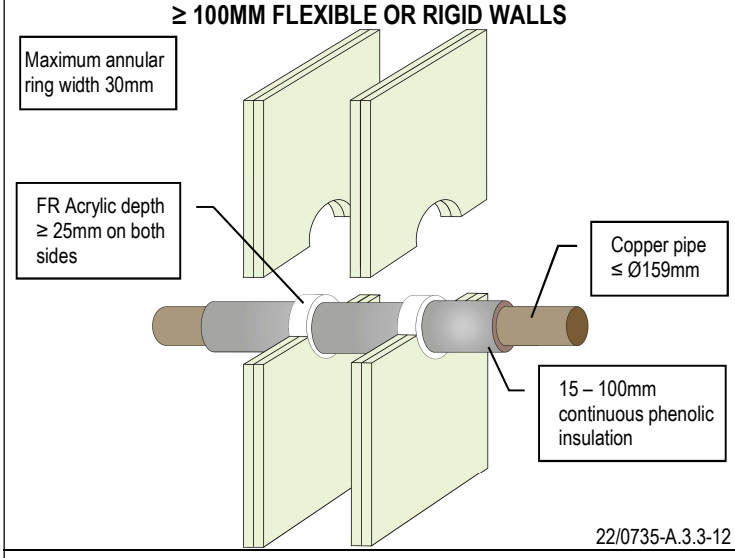

22/0735-A.3.3-12

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

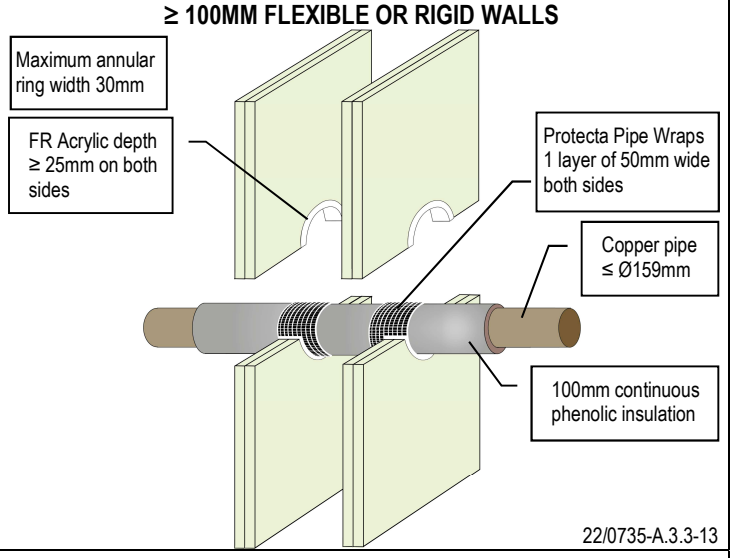

22/0735-A.3.3-13

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

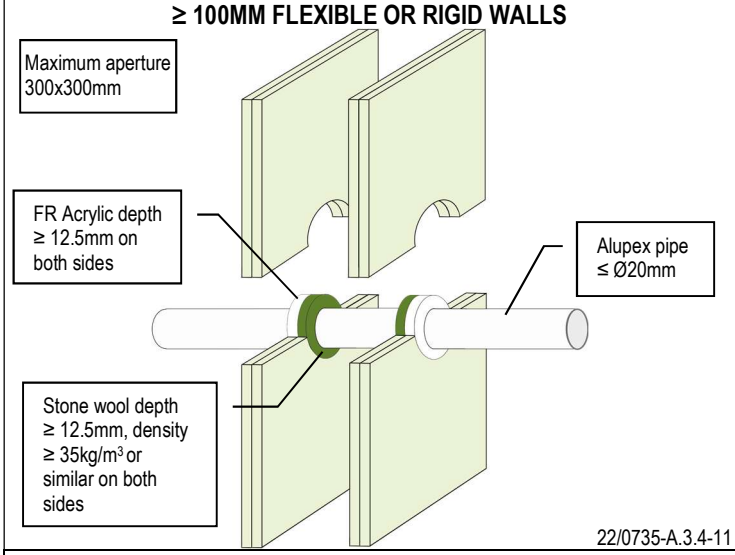

22/0735-A.3.4-11

ALUPEX PIPE FIRE RESISTANCE EI 30 C/C (E 120)


≥ 120MM FLEXIBLE OR RIGID WALLS

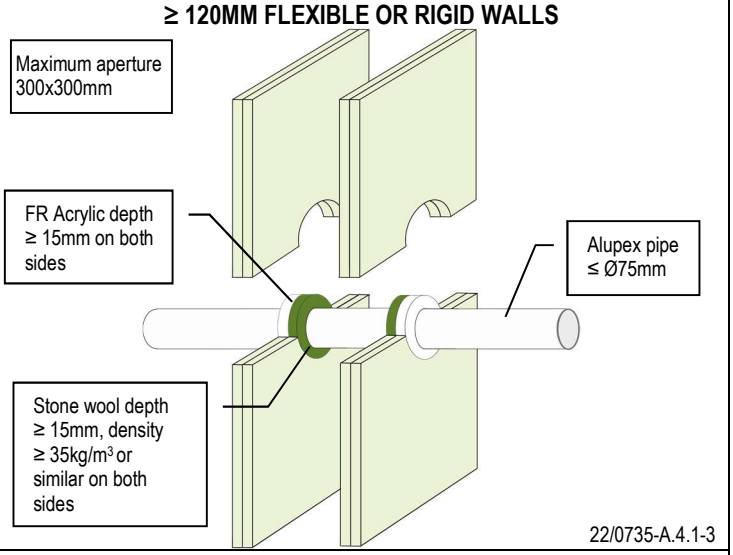

22/0735-A.4.1-3

INSULATED ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

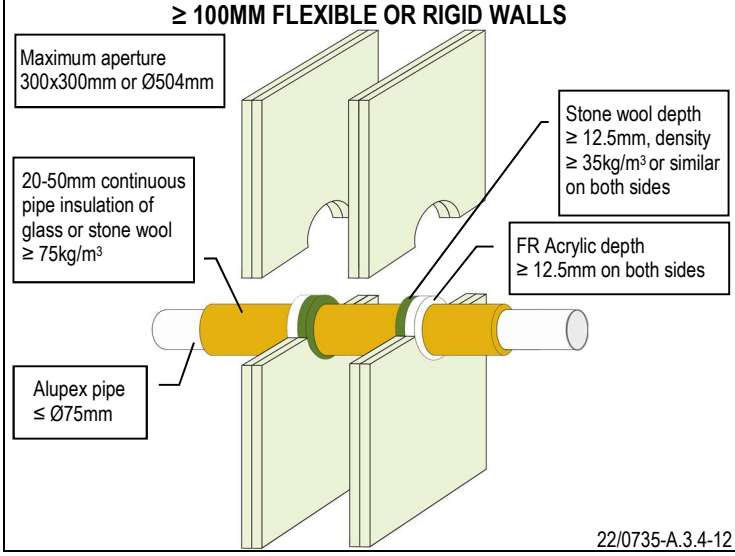

22/0735-A.3.4-12

INSULATED ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM FLEXIBLE OR RIGID WALLS

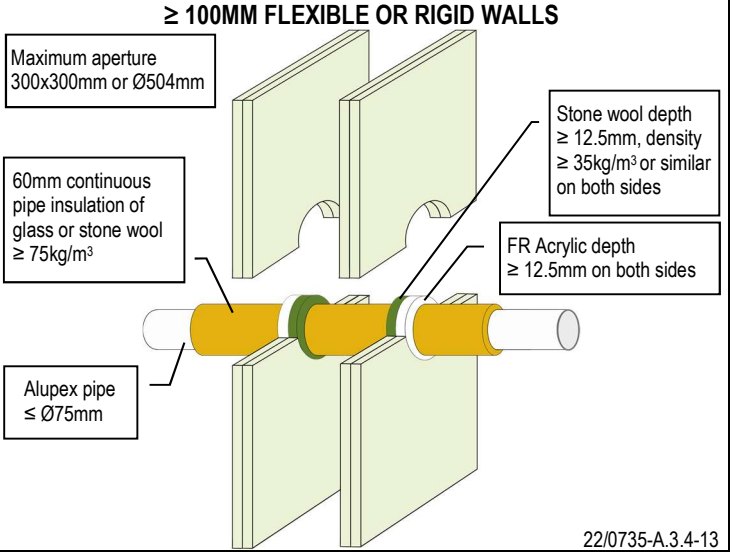


22/0735-A.3.4-13

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

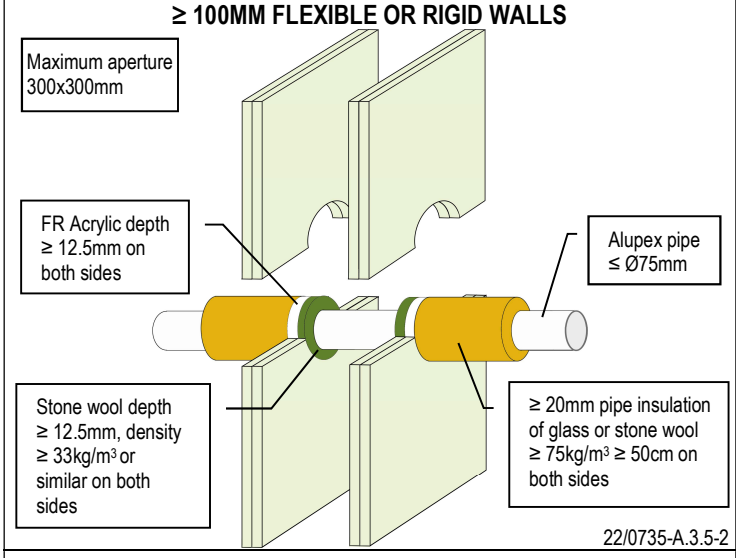

22/0735-A.3.5-2

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

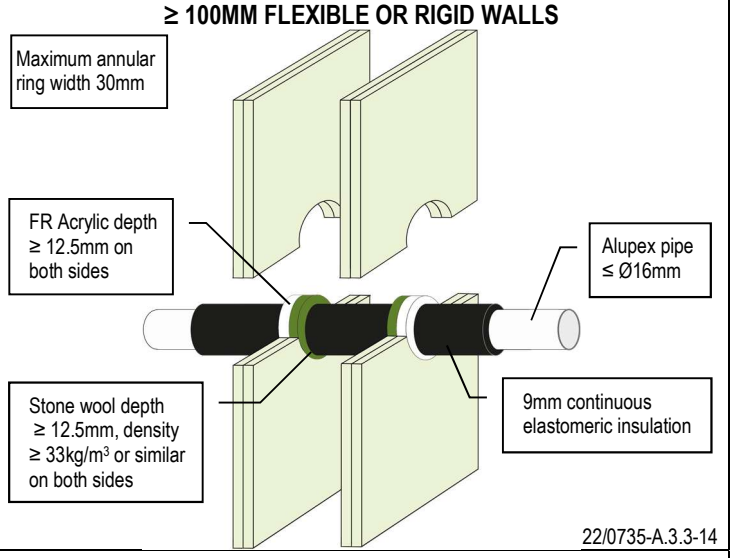

22/0735-A.3.3-14

ALUPEX PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

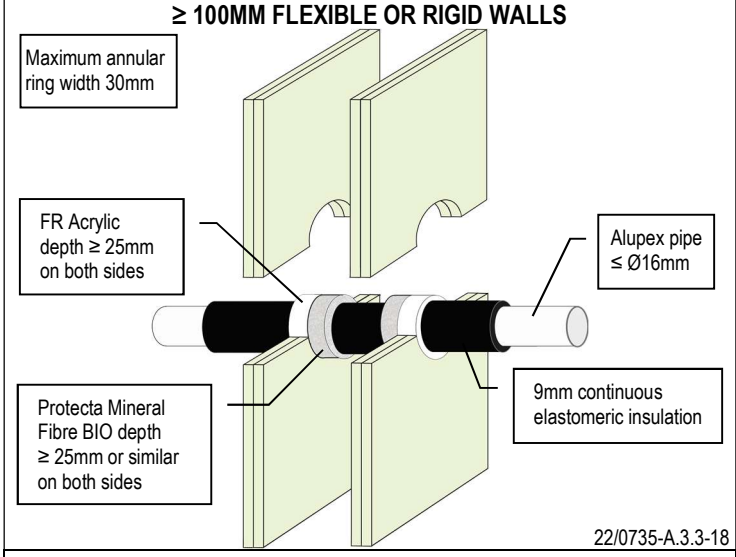

22/0735-A.3.3-18

ALUPEX PIPE FIRE RESISTANCE EI 45 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

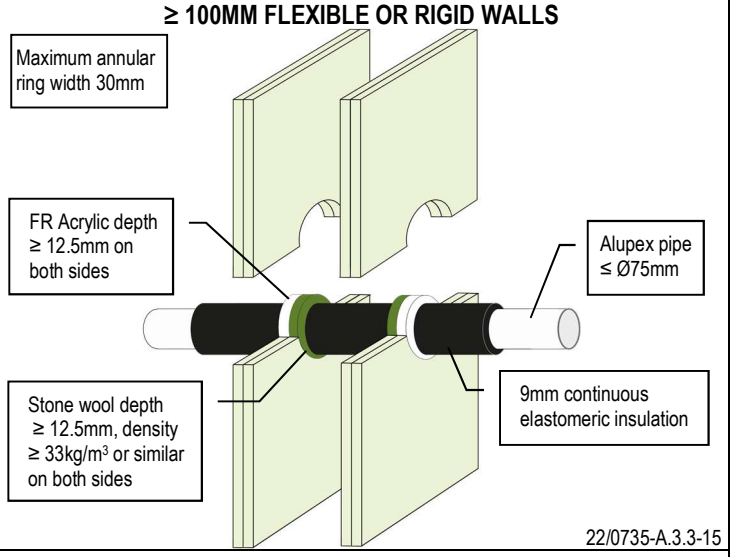

22/0735-A.3.3-15

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

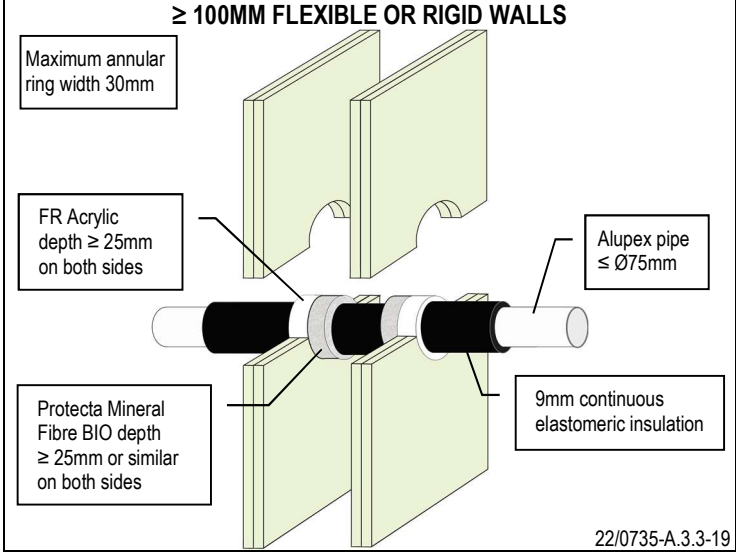

22/0735-A.3.3-19

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM FLEXIBLE OR RIGID WALLS

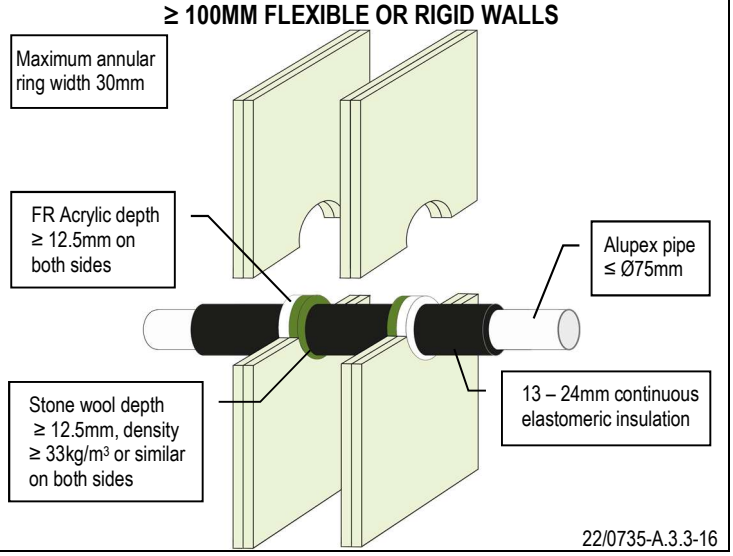


22/0735-A.3.3-16

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

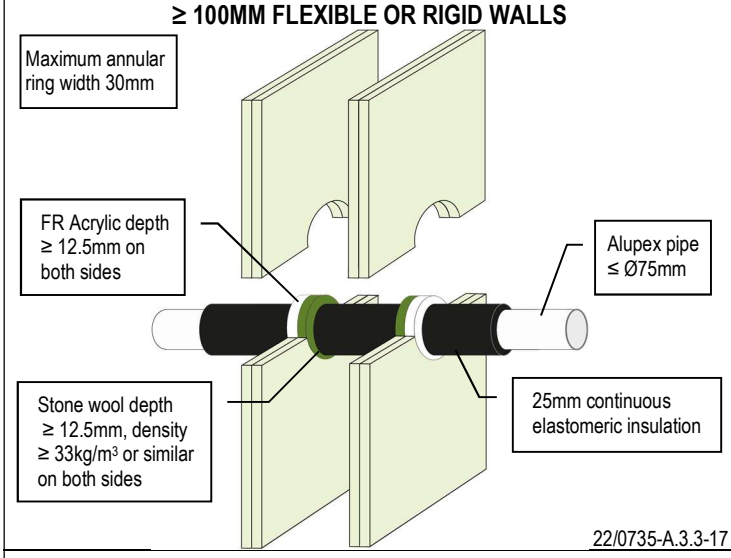

22/0735-A.3.3-17

PVC PLASTIC PIPE FIRE RESISTANCE EI 120 U/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

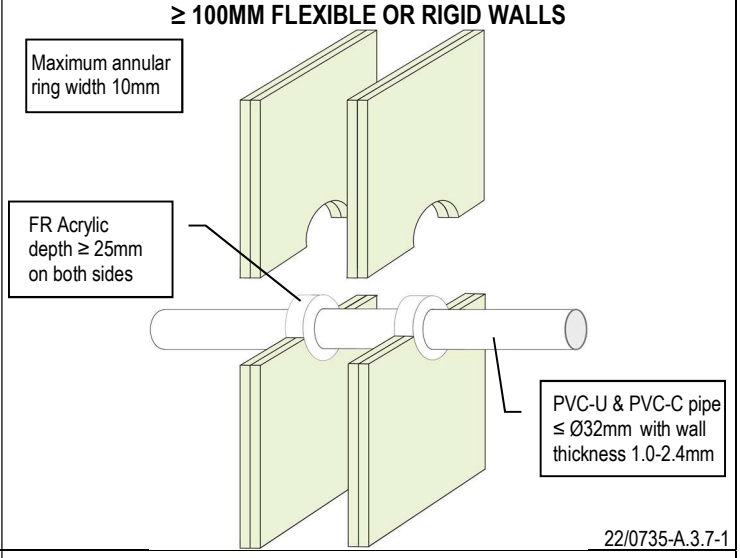

22/0735-A.3.7-1

PVC PLASTIC PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

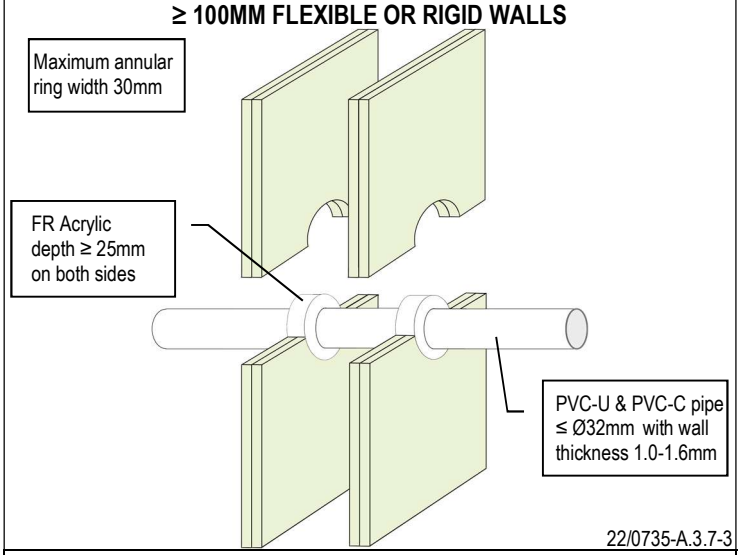

22/0735-A.3.7-3

PVC PLASTIC PIPE FIRE RESISTANCE EI 90 U/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

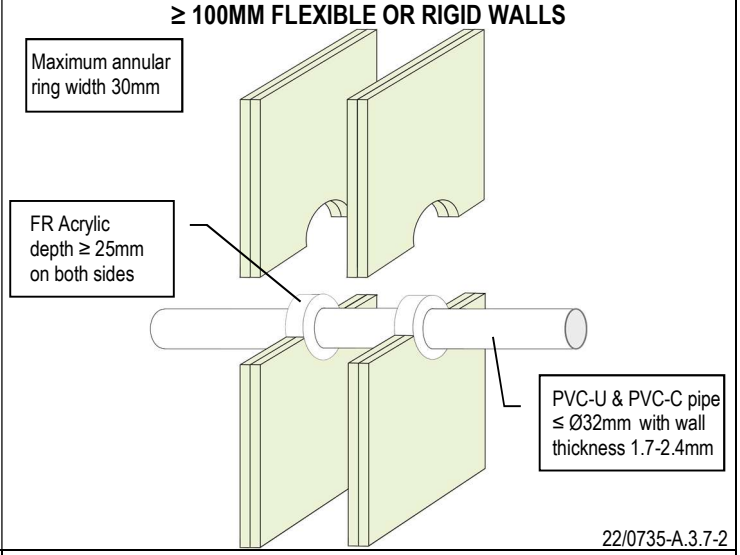

22/0735-A.3.7-2

PE PLASTIC PIPE FIRE RESISTANCE EI 30 U/C (E 30)


≥ 75MM FLEXIBLE OR RIGID WALLS

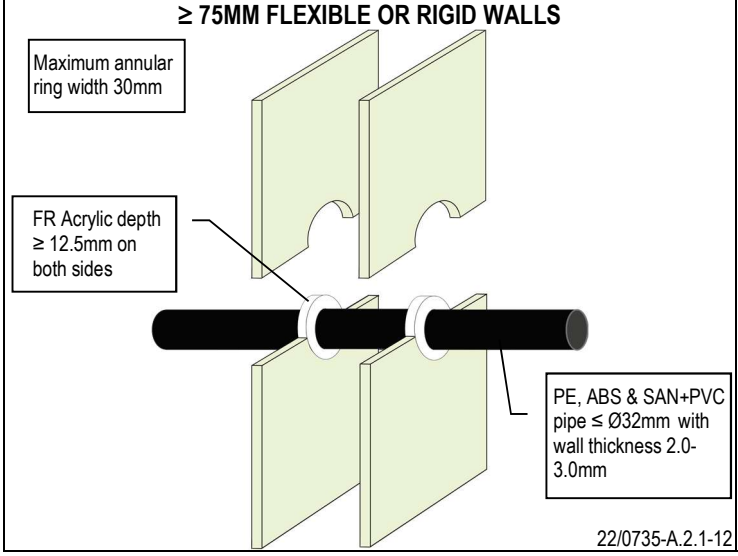

22/0735-A.2.1-12

PE PLASTIC PIPE FIRE RESISTANCE EI 120 U/C (E 120)

≥ 100MM FLEXIBLE OR RIGID WALLS

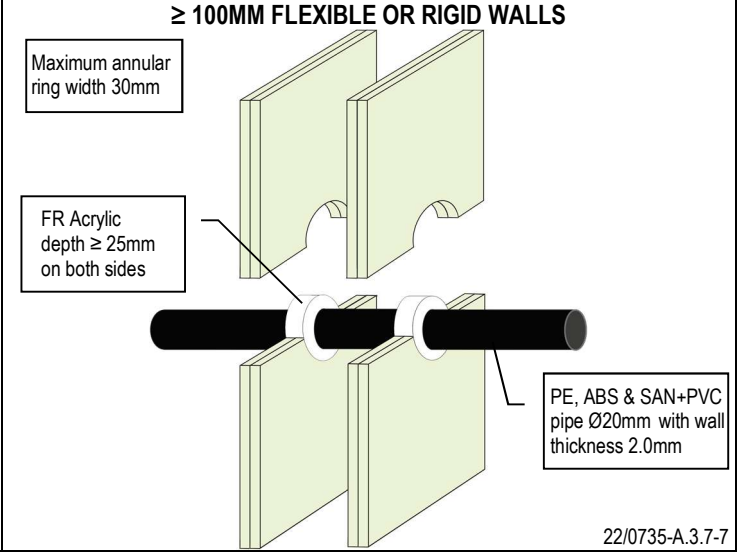


22/0735-A.3.7-7

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PE PLASTIC PIPE FIRE RESISTANCE EI 90 C/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

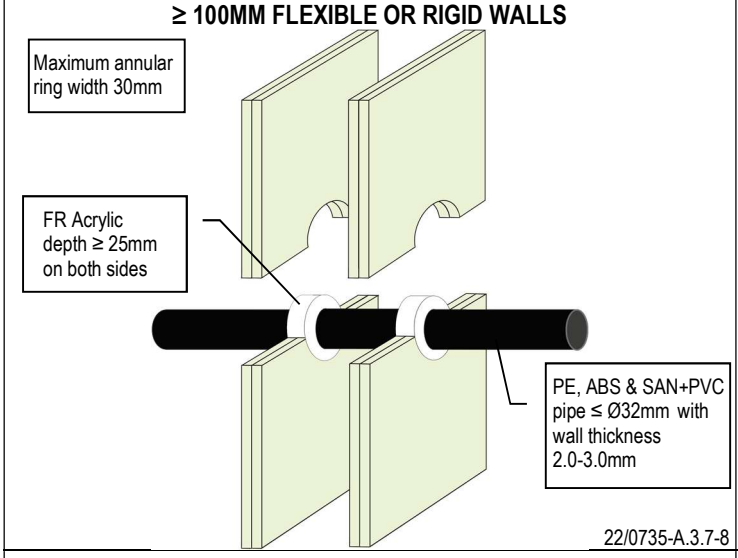

22/0735-A.3.7-8

PP PLASTIC PIPE FIRE RESISTANCE EI 30 U/C (E 30)


≥ 75MM FLEXIBLE OR RIGID WALLS

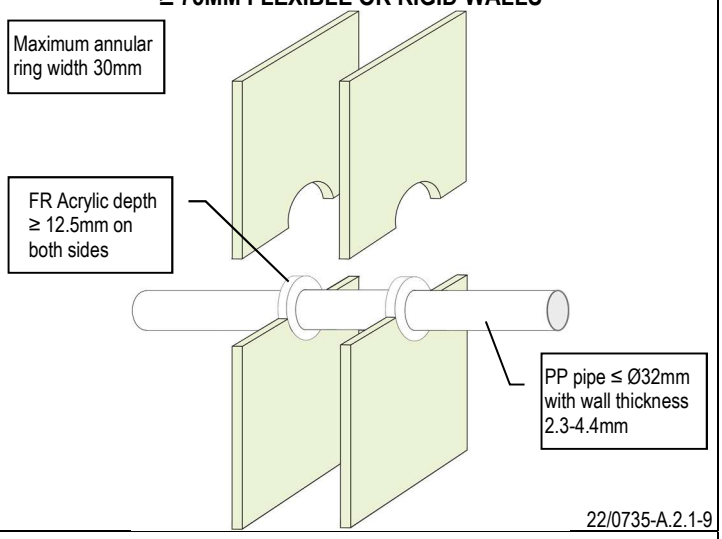

22/0735-A.2.1-9

PP PLASTIC PIPE FIRE RESISTANCE EI 120 U/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

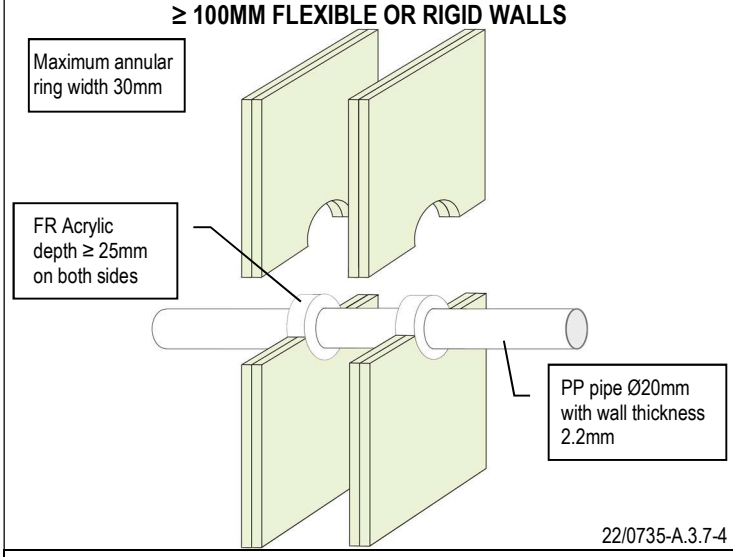

22/0735-A.3.7-4

PP PLASTIC PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

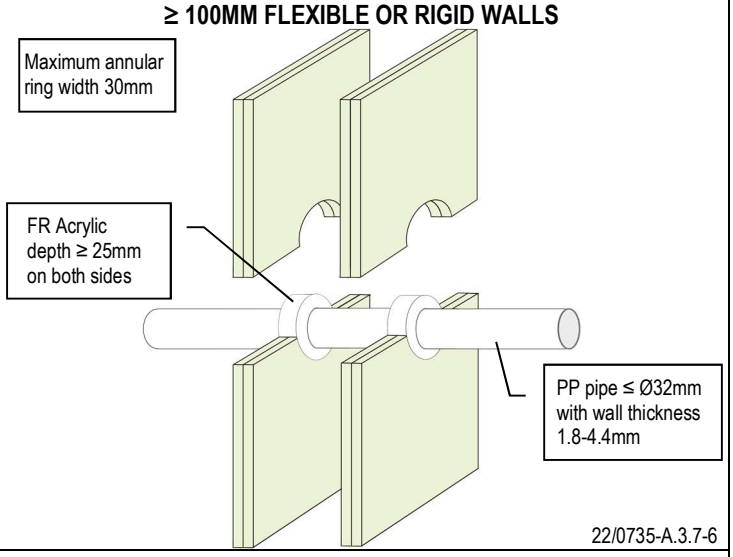

22/0735-A.3.7-6

AQUATECHNIK PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

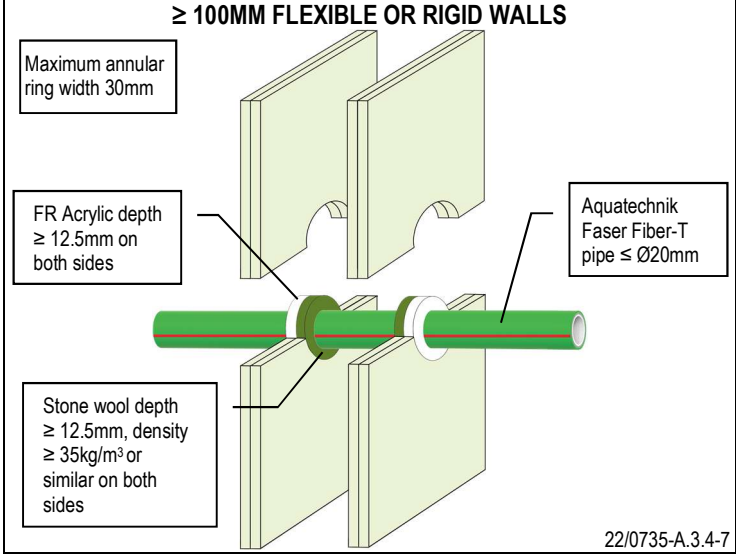

22/0735-A.3.4-7

AQUATECHNIK PIPE FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM FLEXIBLE OR RIGID WALLS

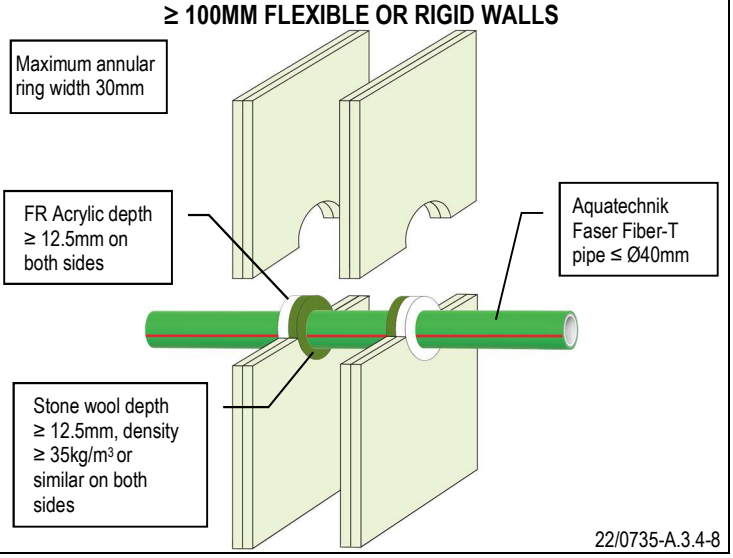


22/0735-A.3.4-8

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

POLYBUTYLENE PIPE FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

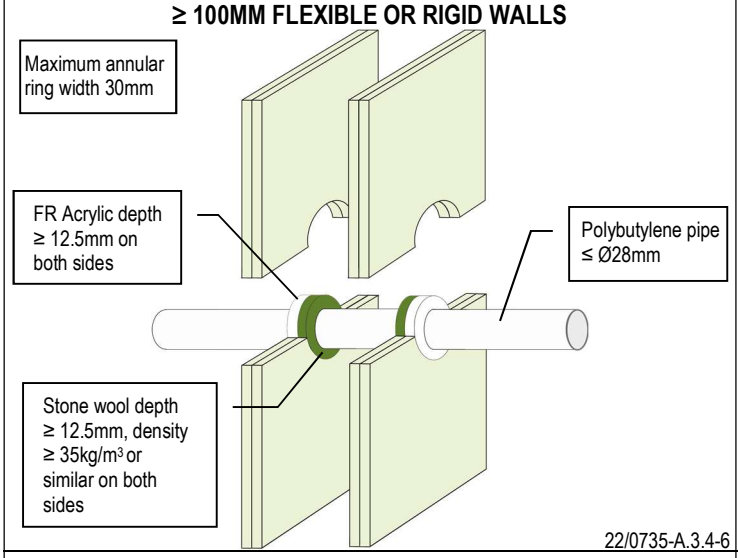

22/0735-A.3.4-6

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 120 C/C (E 120)


≥ 100MM FLEXIBLE OR RIGID WALLS

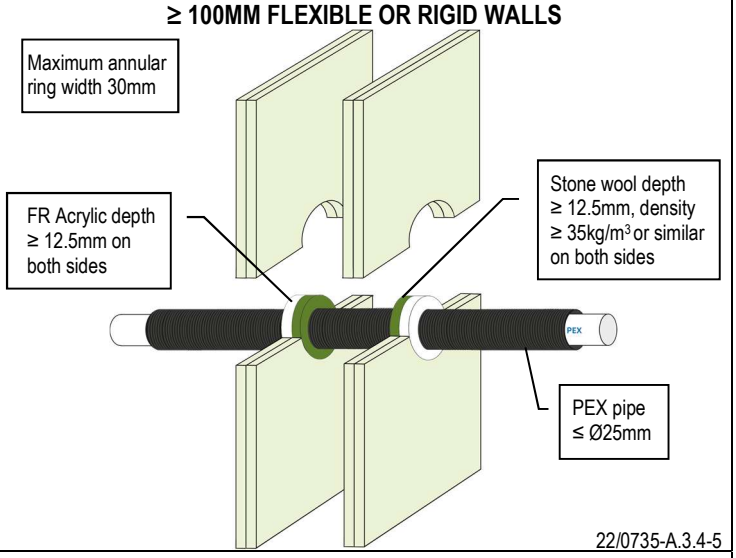

22/0735-A.3.4-5

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 45 C/C (E 60)


≥ 100MM FLEXIBLE OR RIGID WALLS

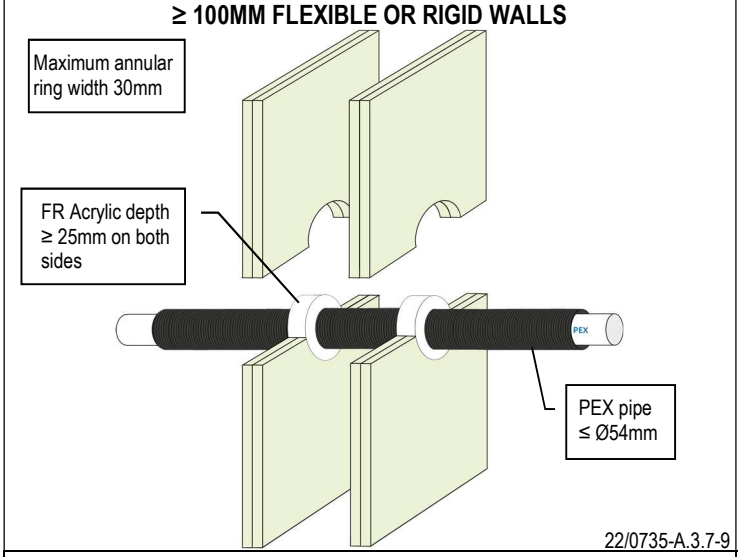

22/0735-A.3.7-9

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 45 C/C (E 45)


≥ 100MM FLEXIBLE OR RIGID WALLS

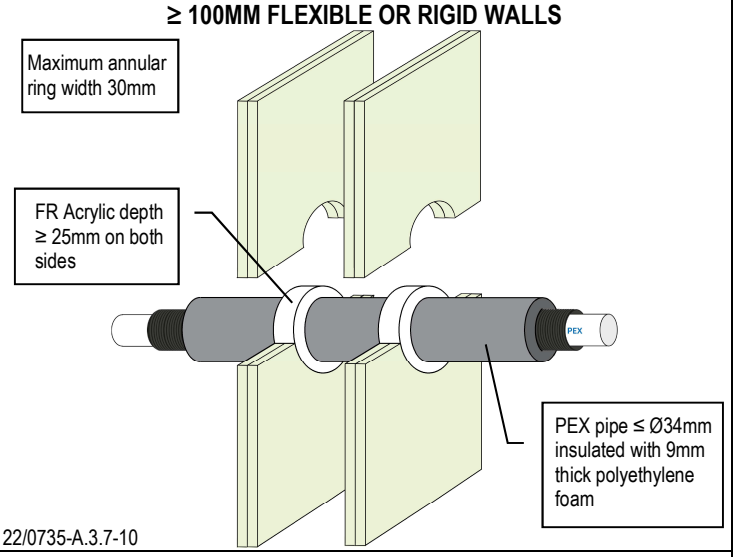

22/0735-A.3.7-10

PVC CONDUIT FIRE RESISTANCE EI 45 U/C (E 60)


≥ 75MM FLEXIBLE OR RIGID WALLS

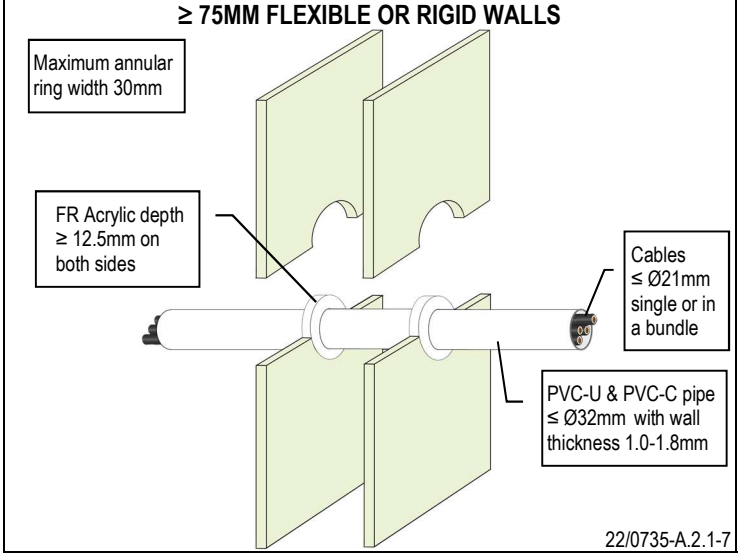

22/0735-A.2.1-7

PVC CONDUIT FIRE RESISTANCE EI 120 U/C (E 120)

≥ 100MM FLEXIBLE OR RIGID WALLS

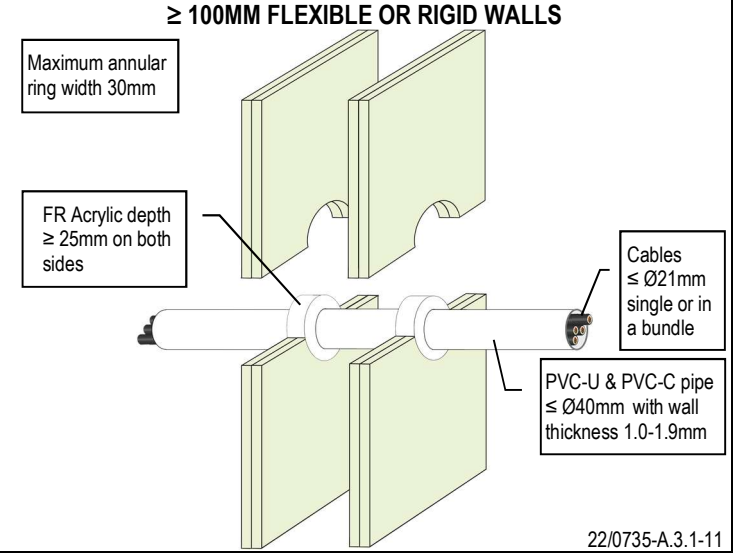


22/0735-A.3.1-11

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PE CONDUIT FIRE RESISTANCE EI 30 U/C (E 45)


≥ 75MM FLEXIBLE OR RIGID WALLS

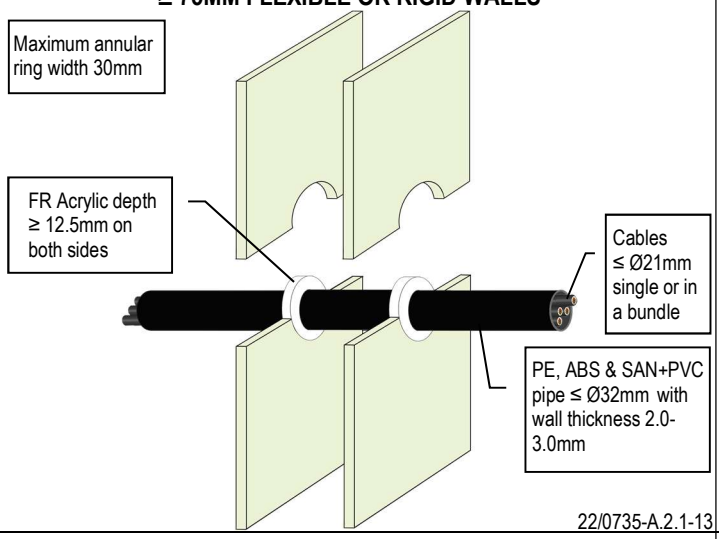

22/0735-A.2.1-13

PE CONDUIT FIRE RESISTANCE EI 90 U/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

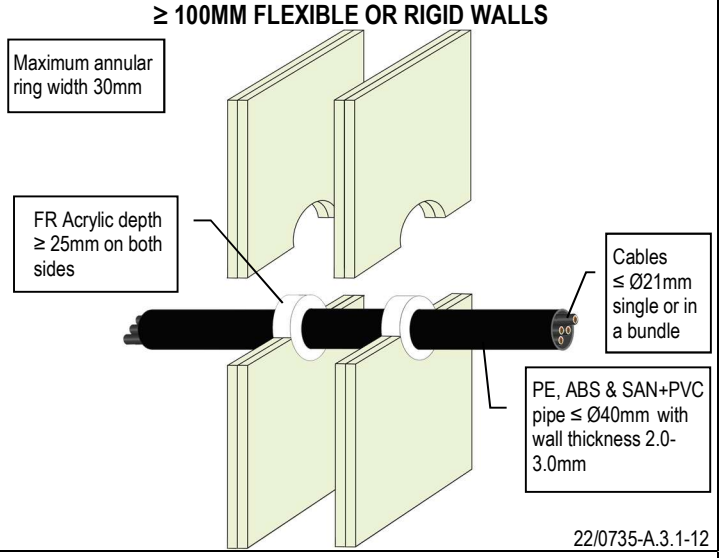

22/0735-A.3.1-12

PP CONDUIT FIRE RESISTANCE EI 30 U/C (E 45)


≥ 75MM FLEXIBLE OR RIGID WALLS

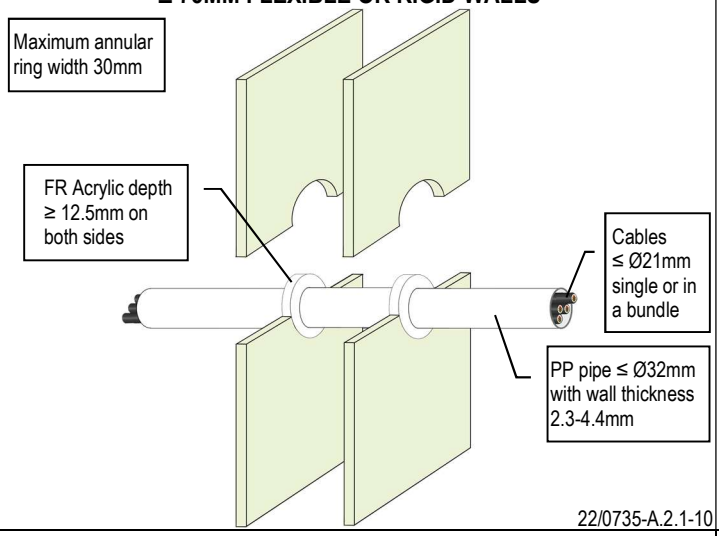

22/0735-A.2.1-10

PP CONDUIT FIRE RESISTANCE EI 90 U/C (E 90)


≥ 100MM FLEXIBLE OR RIGID WALLS

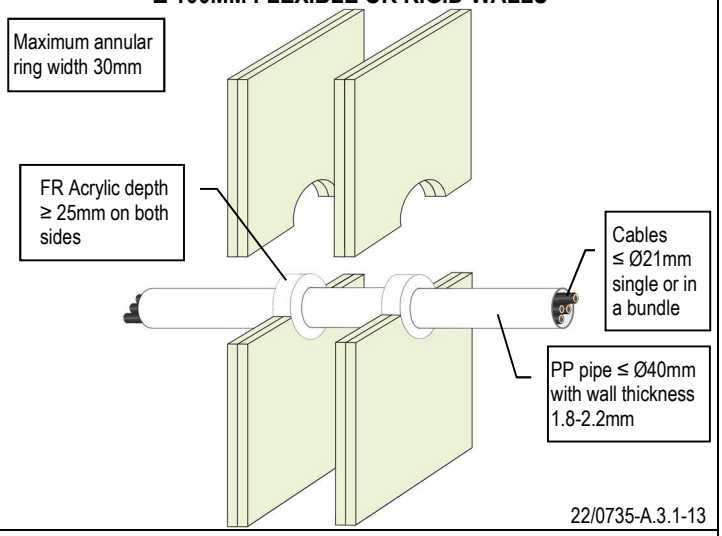

22/0735-A.3.1-13

CABLES FIRE RESISTANCE EI 60 (E 60)


≥ 100MM PANEL WALLS

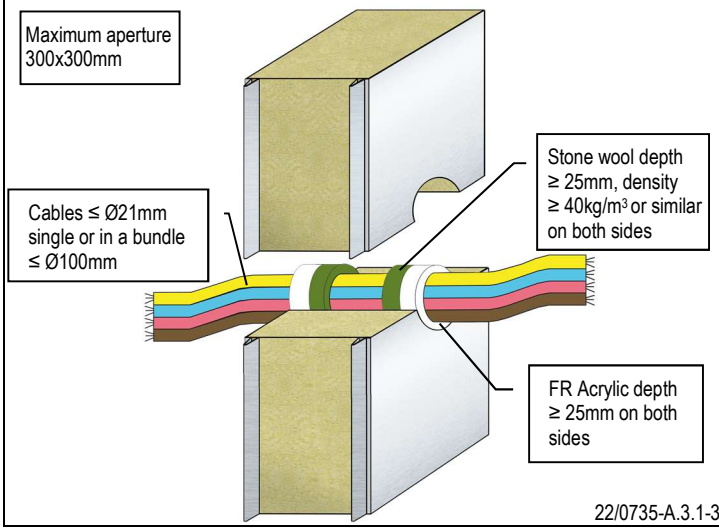

22/0735-A.3.1-3P

CABLES FIRE RESISTANCE EI 60 (E 60)

≥ 100MM PANEL WALLS

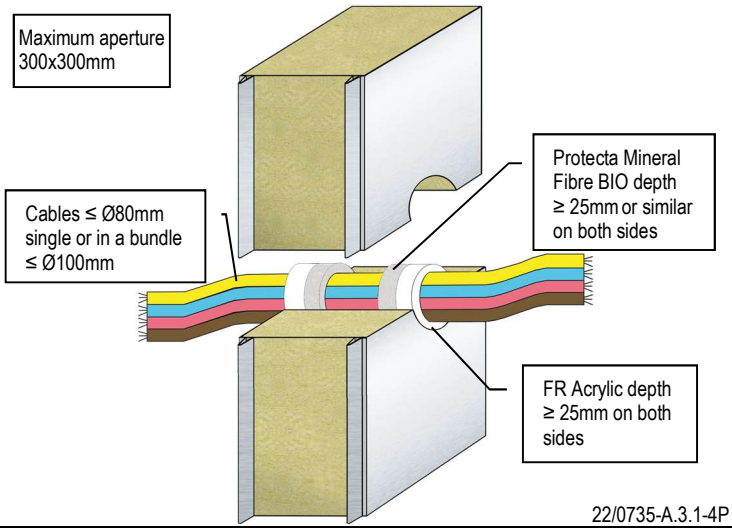


22/0735-A.3.1-4P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 60)


≥ 100MM PANEL WALLS

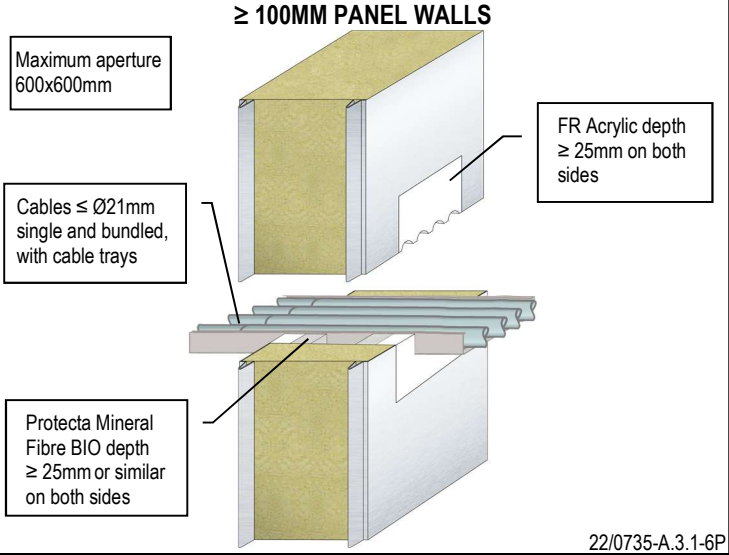

22/0735-A.3.1-6P

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 30 (E 60)


≥ 100MM PANEL WALLS

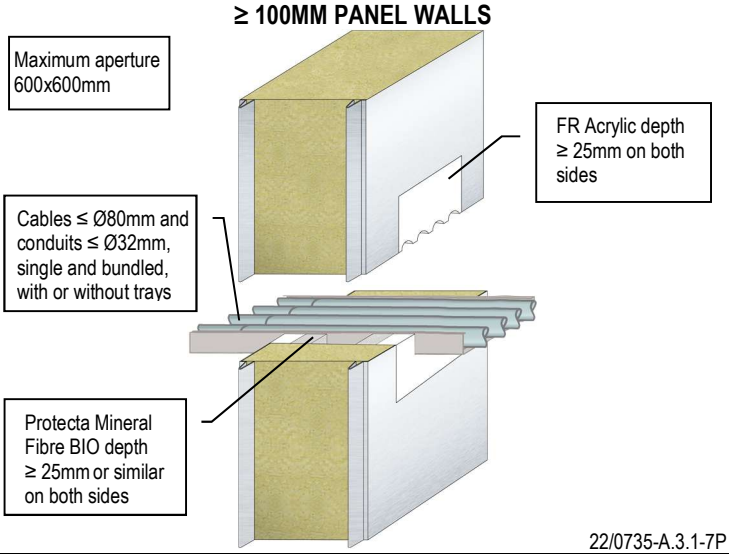

22/0735-A.3.1-7P

UNISTRUT CHANNEL FIRE RESISTANCE EI 60 (E 60)


≥ 100MM PANEL WALLS

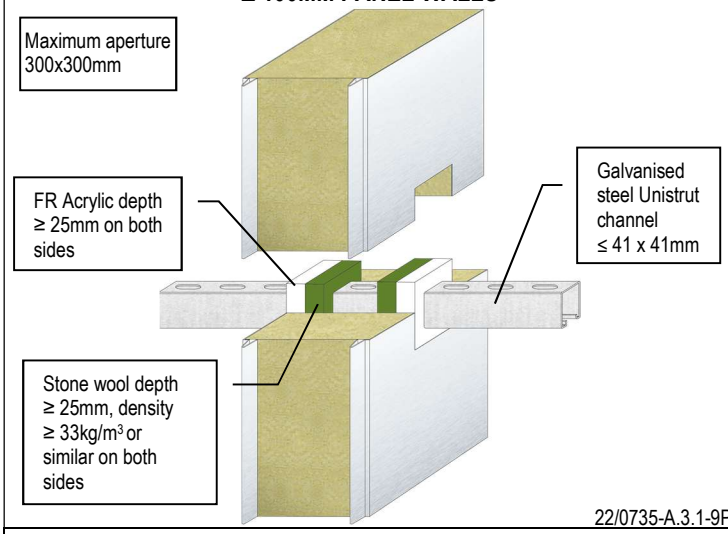

22/0735-A.3.1-9P

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

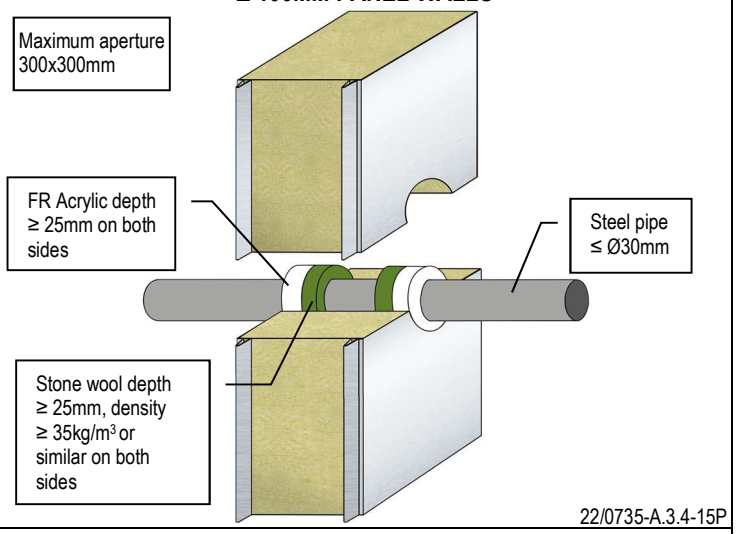

22/0735-A.3.4-15P

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

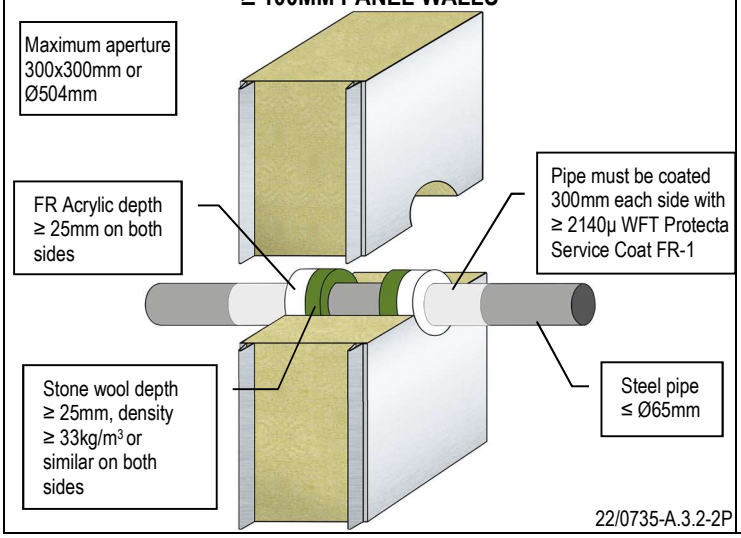

22/0735-A.3.2-2P

STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 60)

≥ 100MM PANEL WALLS

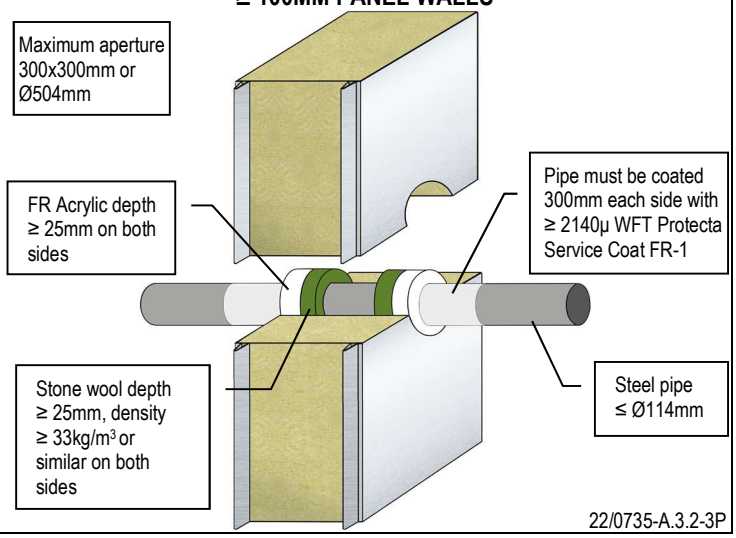


22/0735-A.3.2-3P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

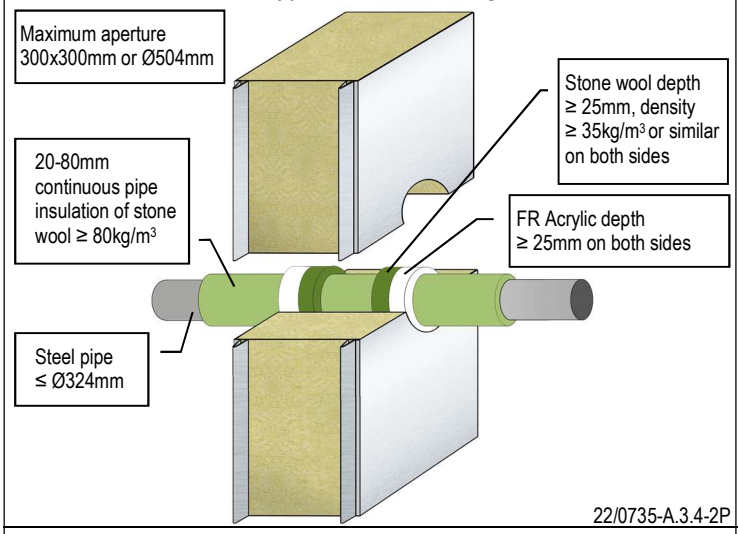

22/0735-A.3.4-2P

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

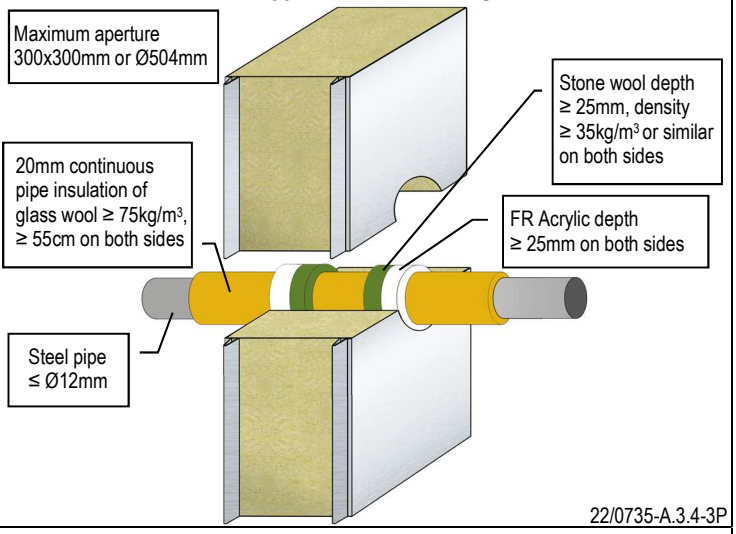

22/0735-A.3.4-3P

INSULATED STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

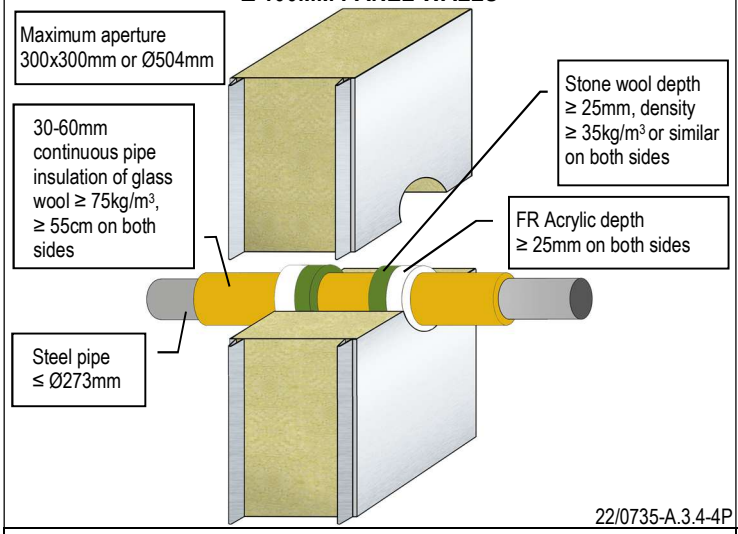

22/0735-A.3.4-4P

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

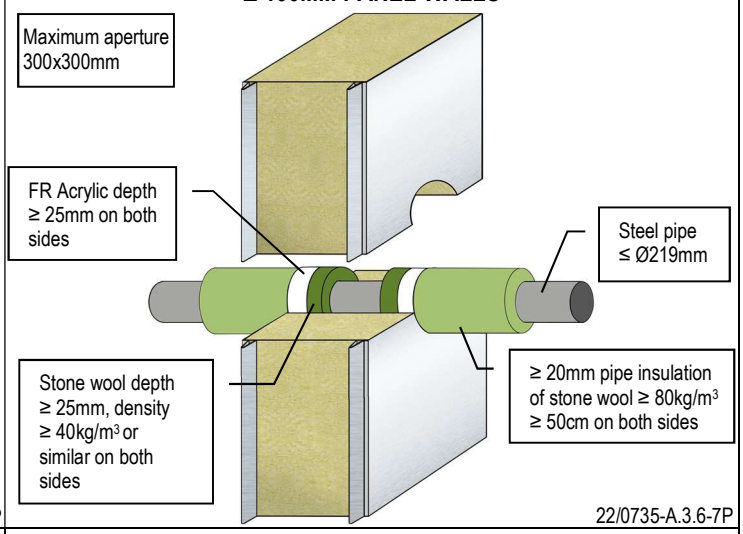

22/0735-A.3.6-7P

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

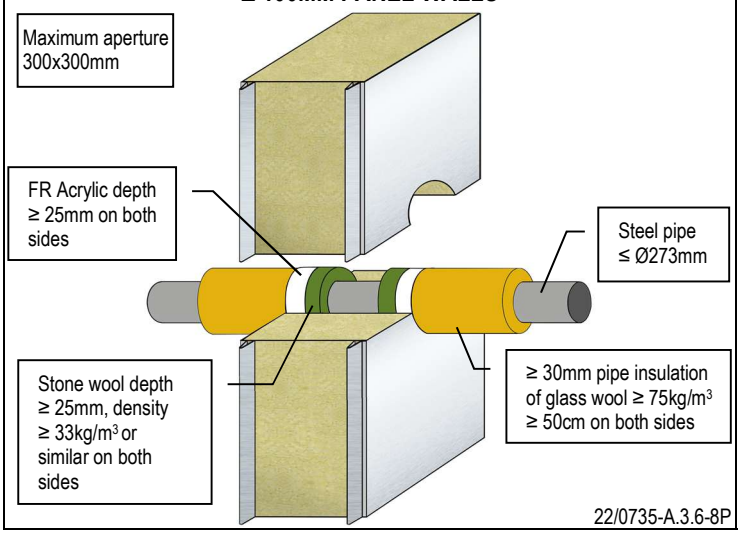

22/0735-A.3.6-8P

STEEL PIPE FIRE RESISTANCE EI 45 C/U (E 60)

≥ 100MM PANEL WALLS

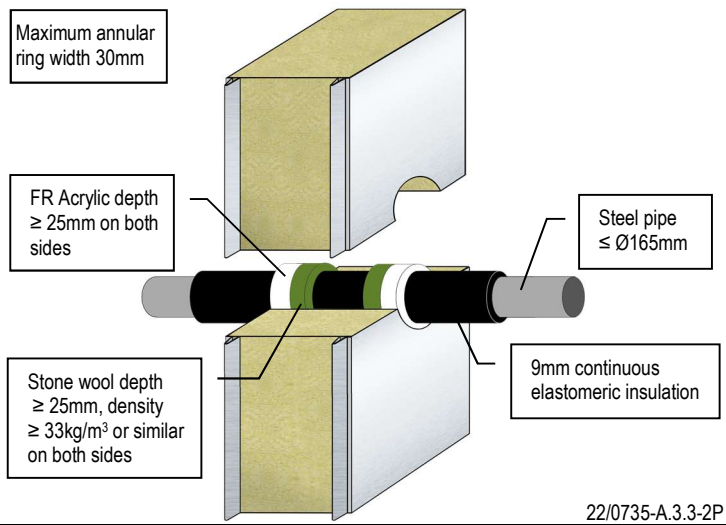


22/0735-A.3.3-2P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

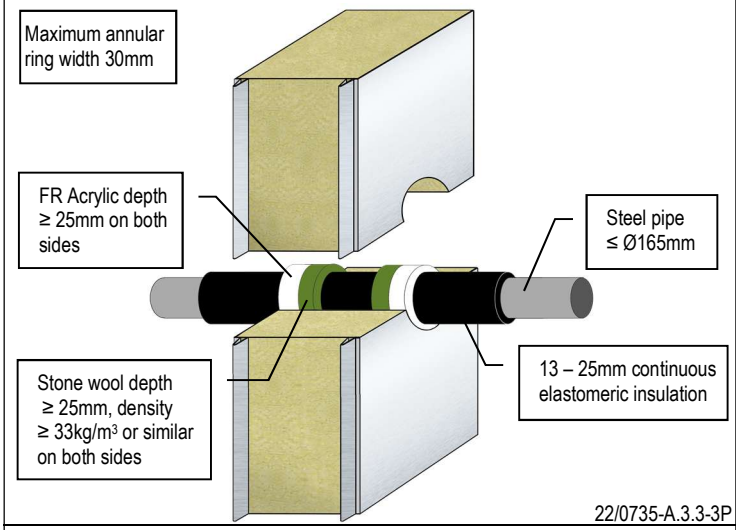

22/0735-A.3.3-3P

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

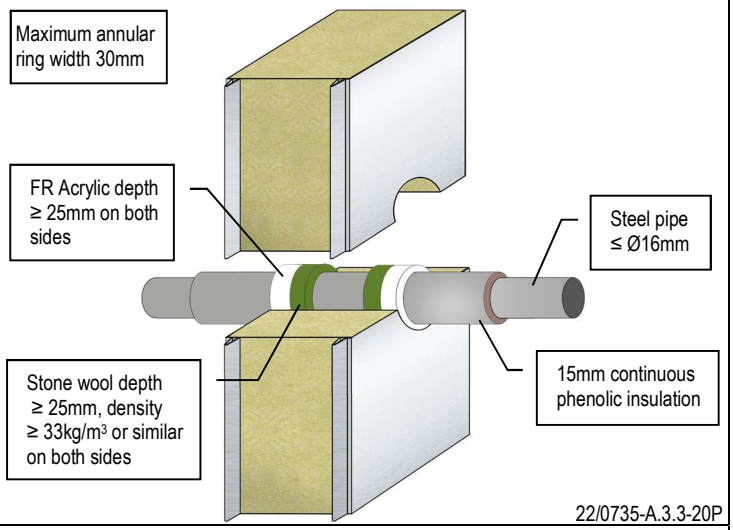

22/0735-A.3.3-20P

STEEL PIPE FIRE RESISTANCE EI 60 C/U (E 60)


≥ 100MM PANEL WALLS

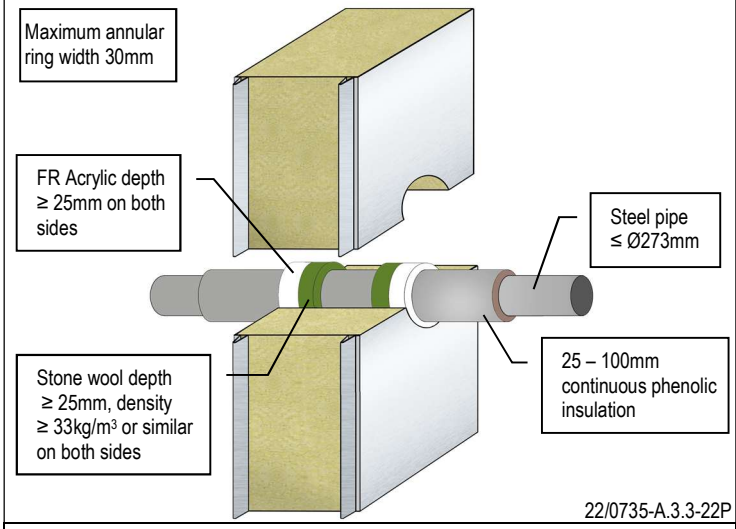

22/0735-A.3.3-22P

GAS PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

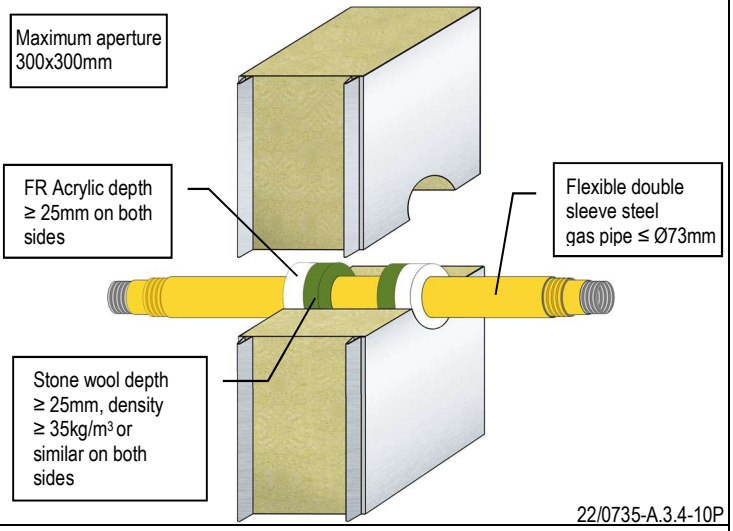

22/0735-A.3.4-10P

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

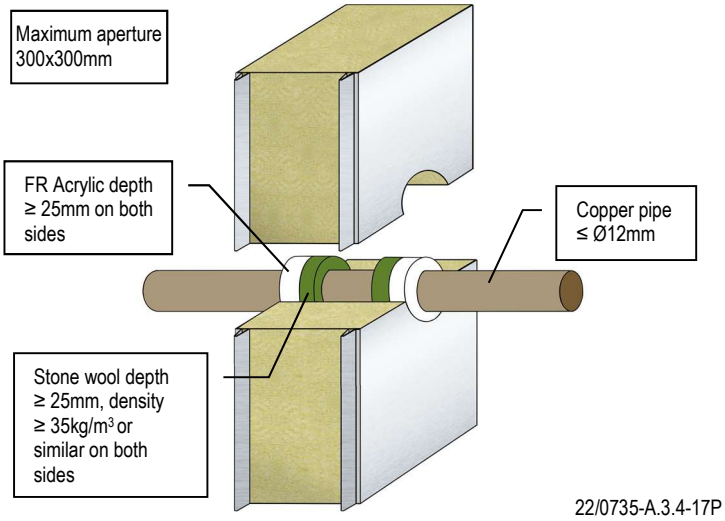

22/0735-A.3.4-17P

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM PANEL WALLS

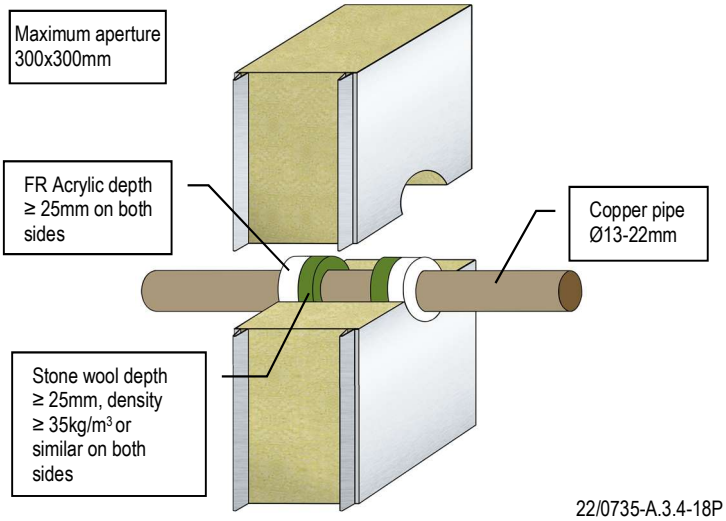


22/0735-A.3.4-18P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

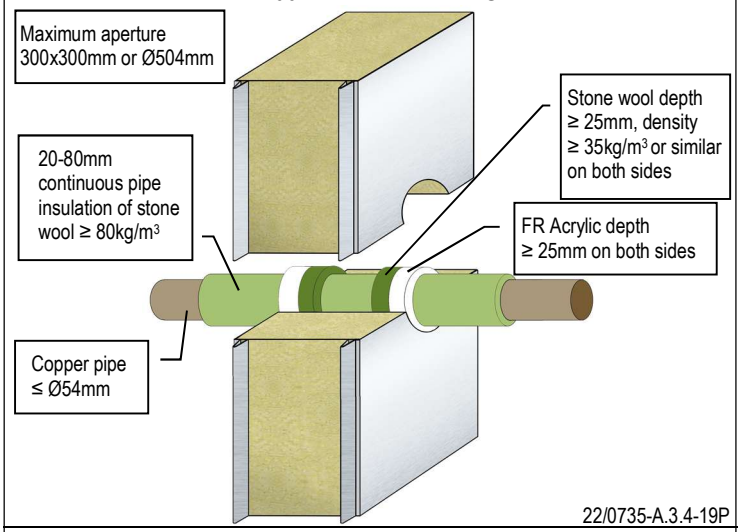

22/0735-A.3.4-19P

INSULATED COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

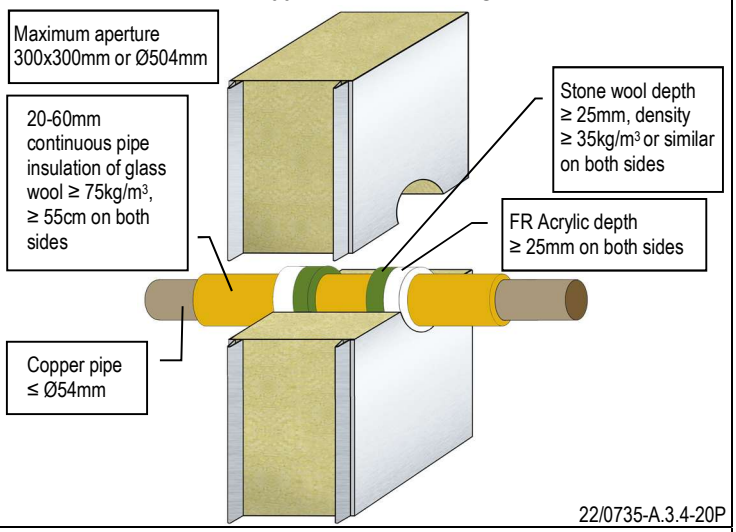

22/0735-A.3.4-20P

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

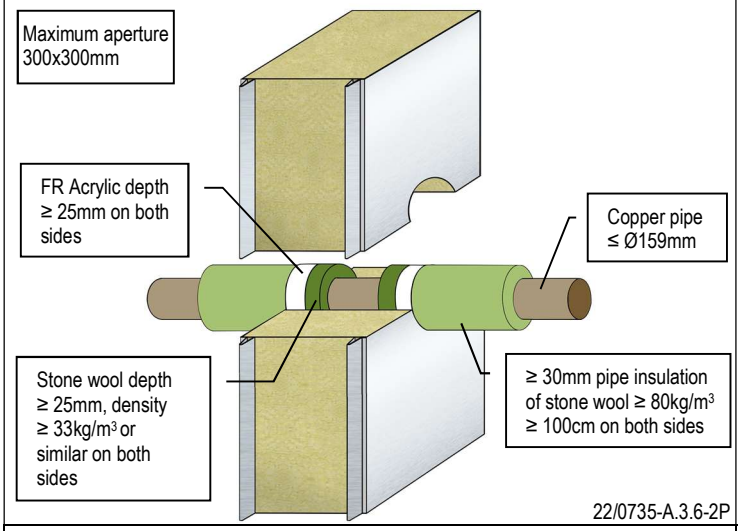

22/0735-A.3.6-2P

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

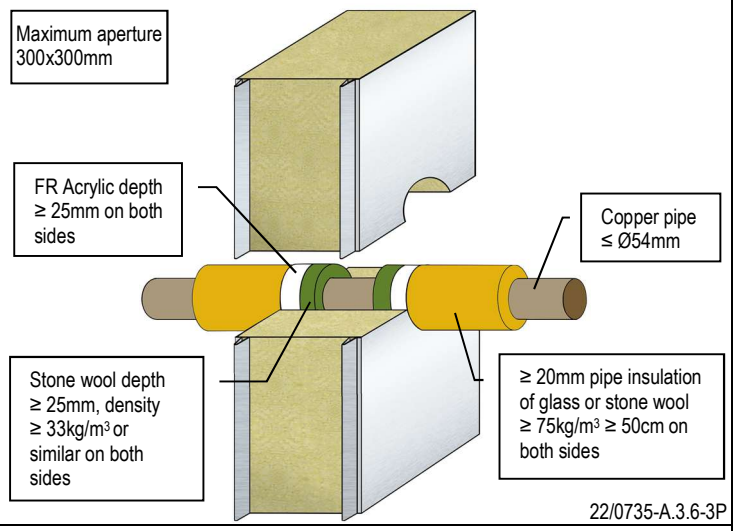

22/0735-A.3.6-3P

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 60)


≥ 100MM PANEL WALLS

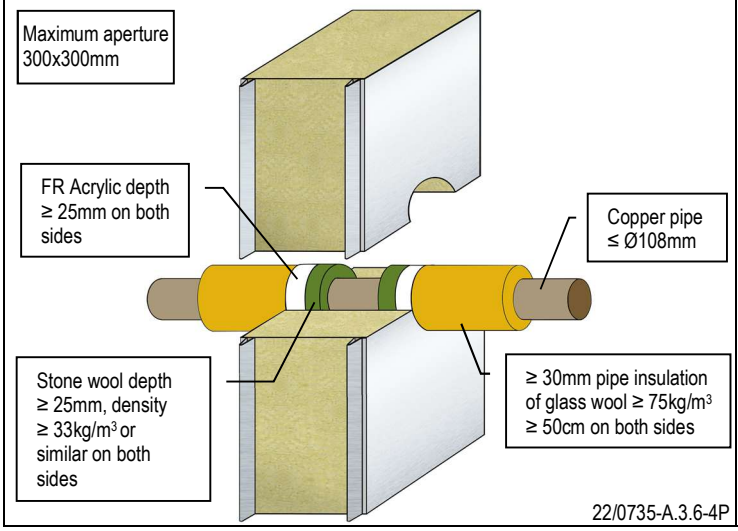

22/0735-A.3.6-4P

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM PANEL WALLS

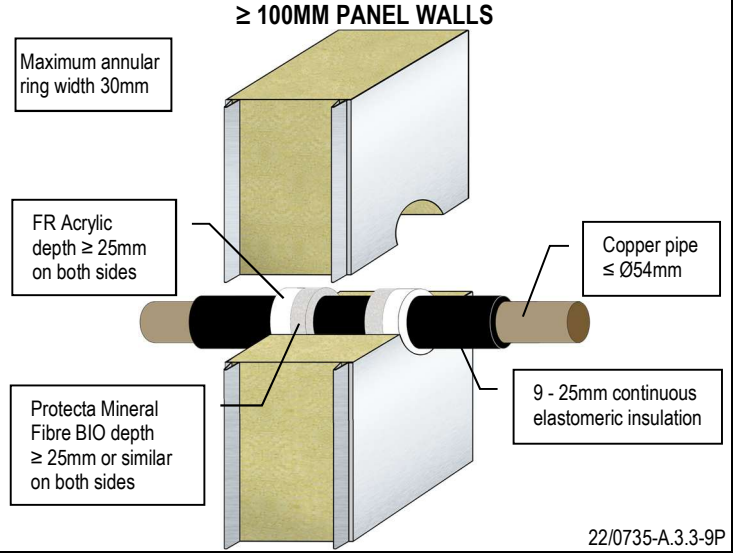


22/0735-A.3.3-9P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

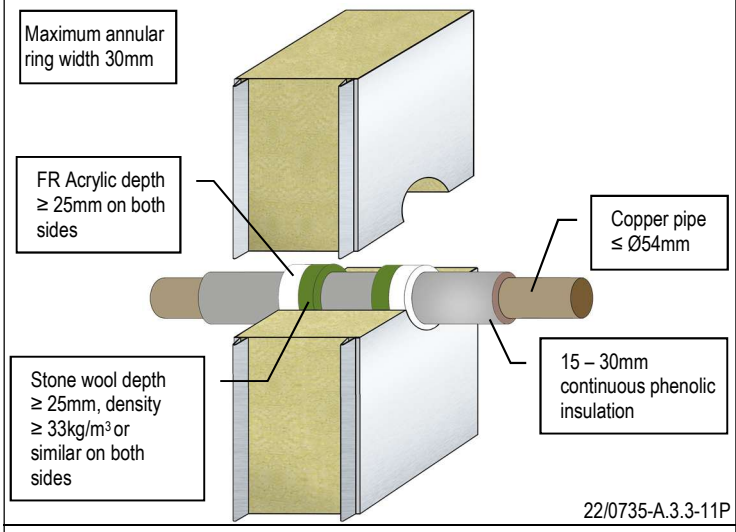

22/0735-A.3.3-11P

COPPER PIPE FIRE RESISTANCE EI 30 C/C (E 45)


≥ 100MM PANEL WALLS

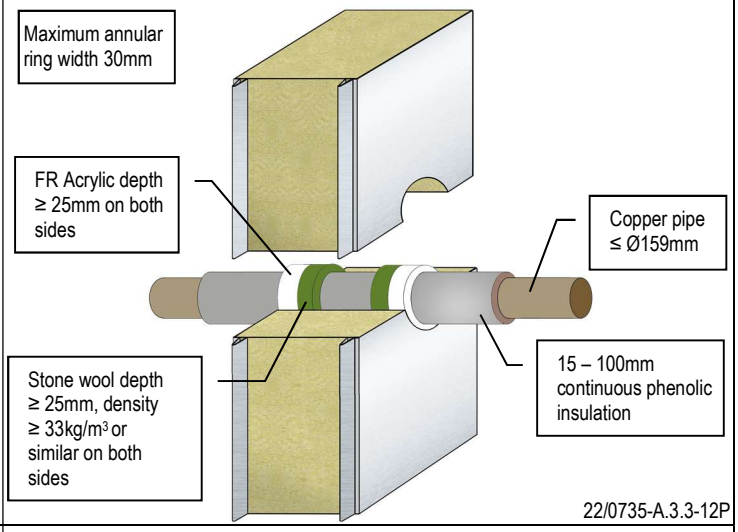

22/0735-A.3.3-12P

COPPER PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

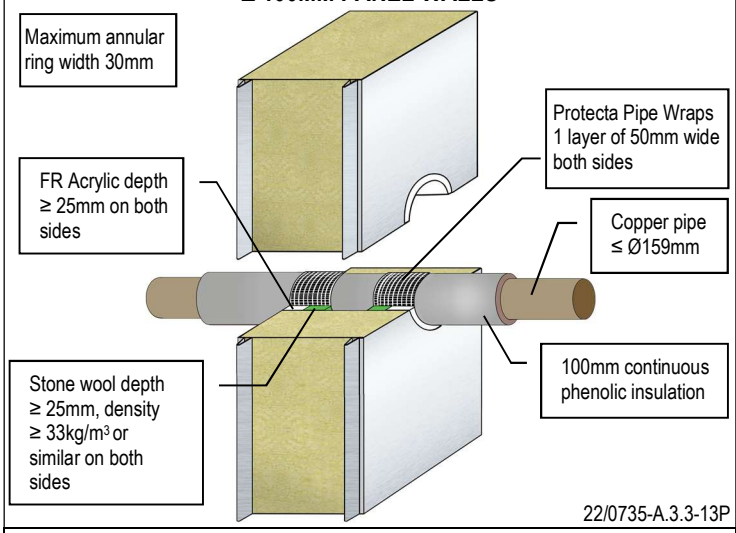

22/0735-A.3.3-13P

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

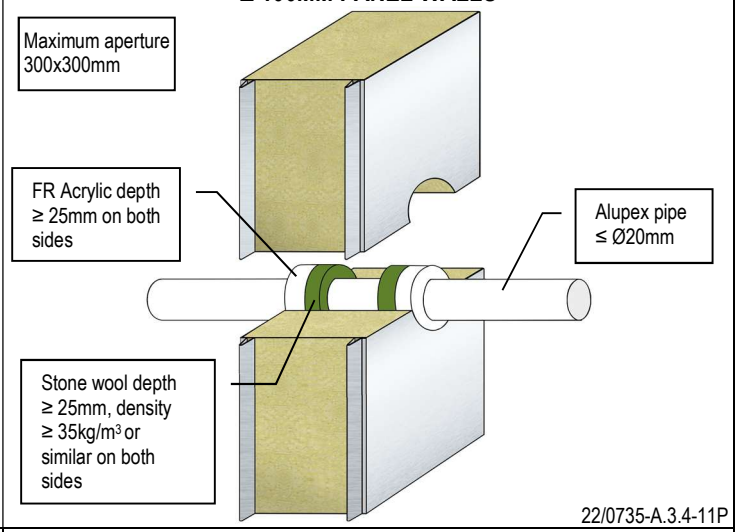

22/0735-A.3.4-11P

INSULATED ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

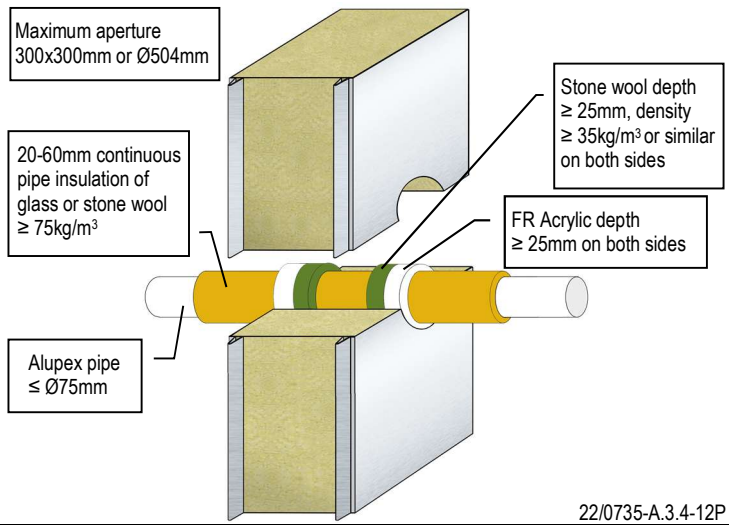

22/0735-A.3.4-12P

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM PANEL WALLS

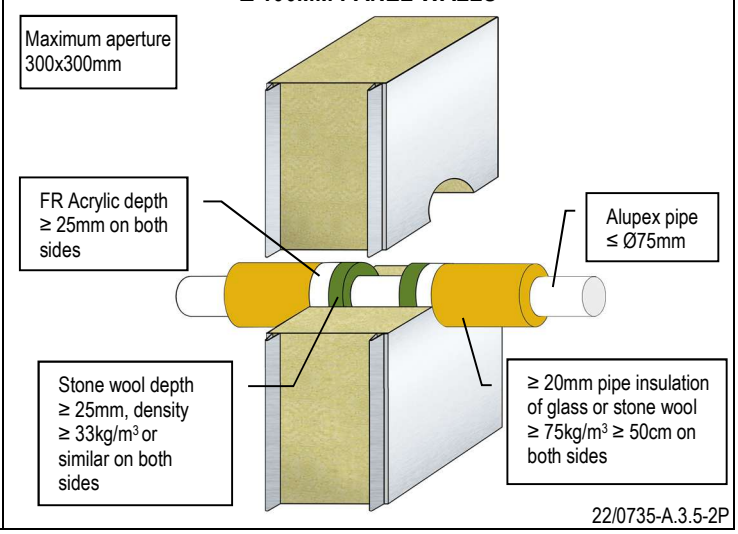


22/0735-A.3.5-2P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

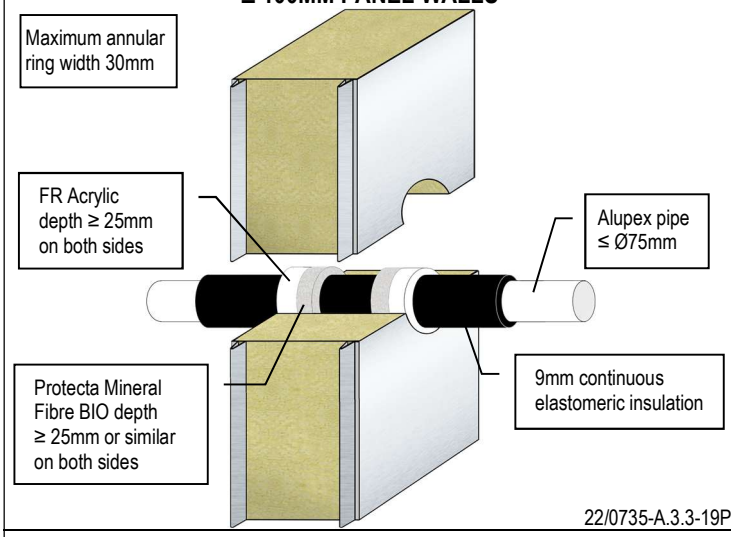

22/0735-A.3.3-19P

ALUPEX PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

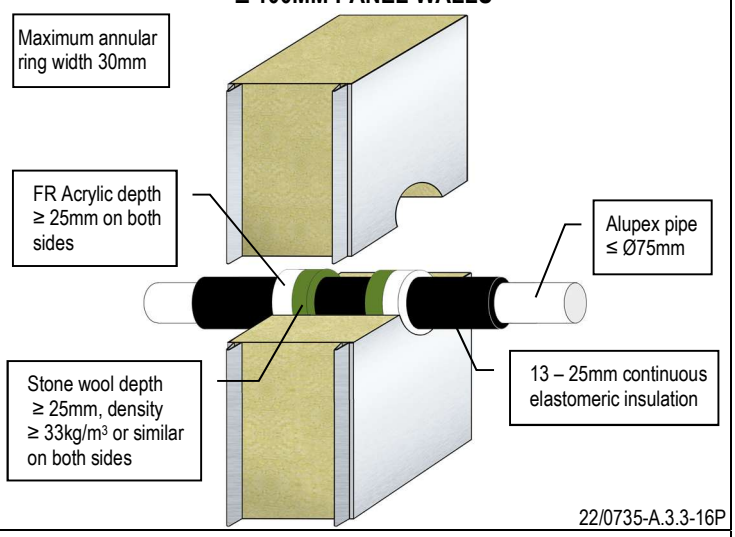

22/0735-A.3.3-16P

PVC PLASTIC PIPE FIRE RESISTANCE EI 60 U/C (E 60)


≥ 100MM PANEL WALLS

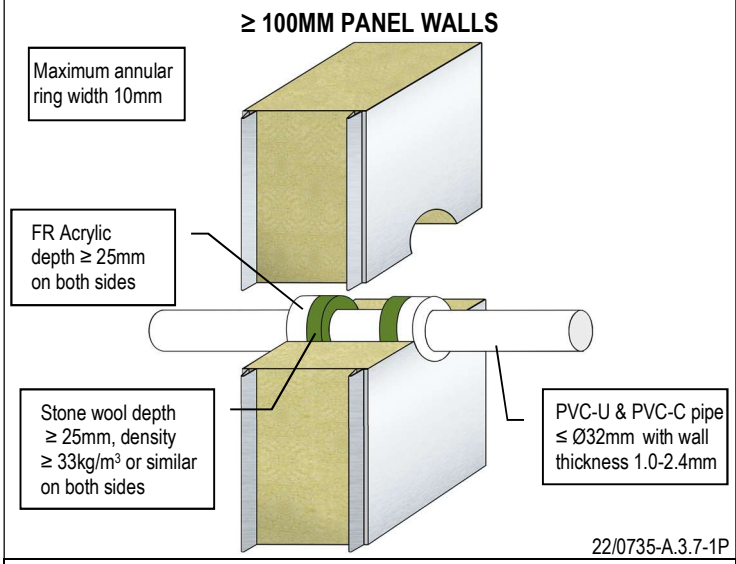

22/0735-A.3.7-1P

PVC PLASTIC PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

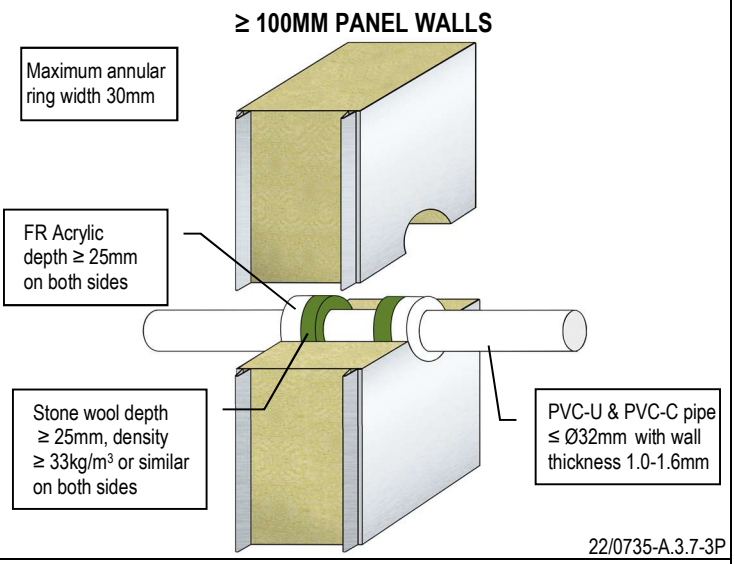

22/0735-A.3.7-3P

PVC PLASTIC PIPE FIRE RESISTANCE EI 60 U/C (E 60)


≥ 100MM PANEL WALLS

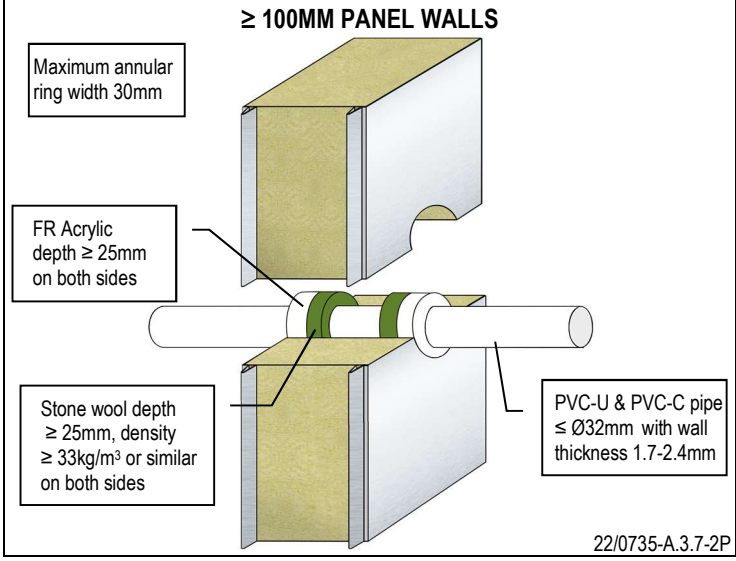

22/0735-A.3.7-2P

PE PLASTIC PIPE FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM PANEL WALLS

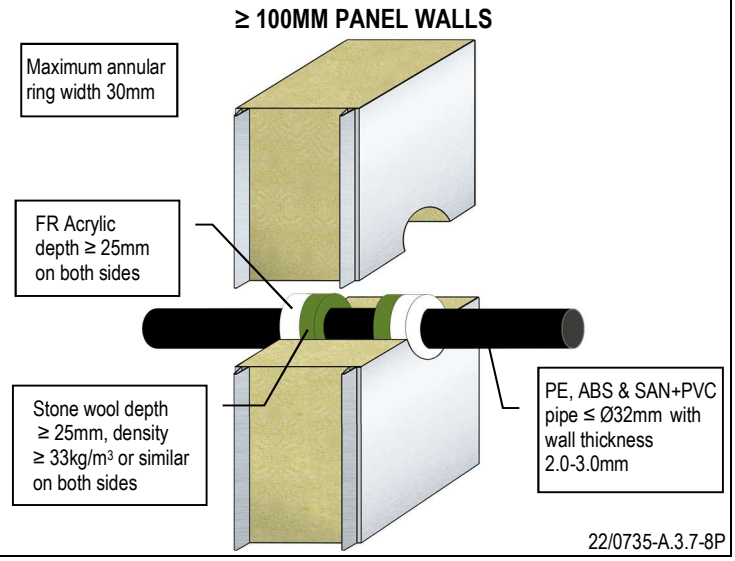


22/0735-A.3.7-8P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PP PLASTIC PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

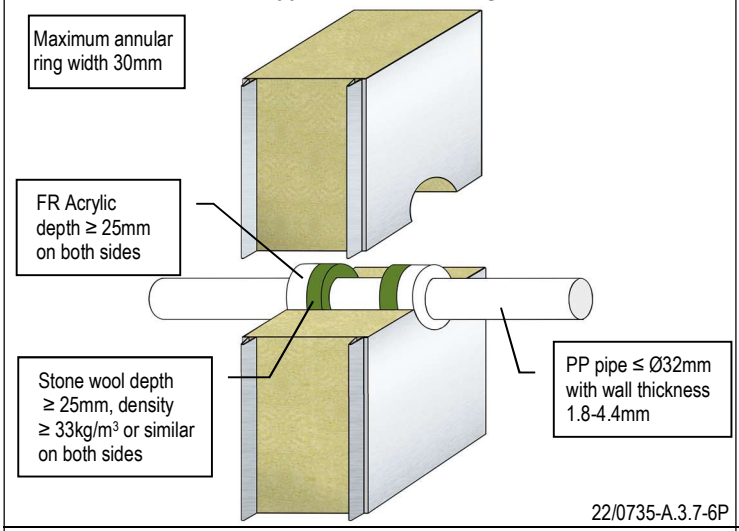

22/0735-A.3.7-6P

AQUATECHNIK PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

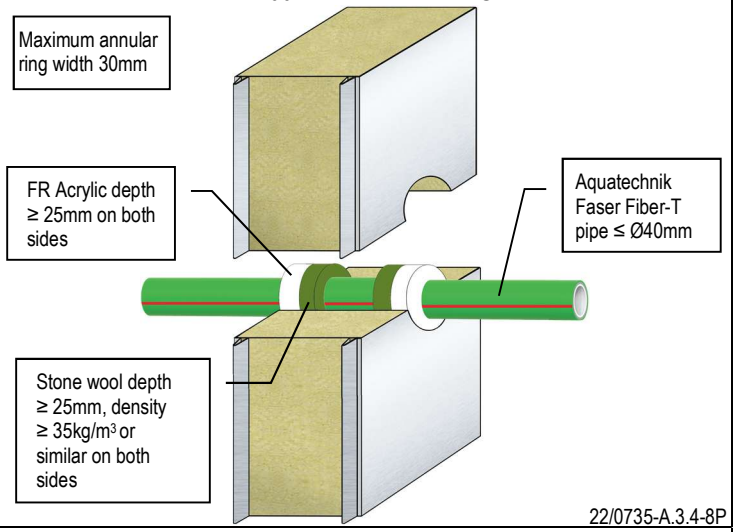

22/0735-A.3.4-8P

POLYBUTYLENE PIPE FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

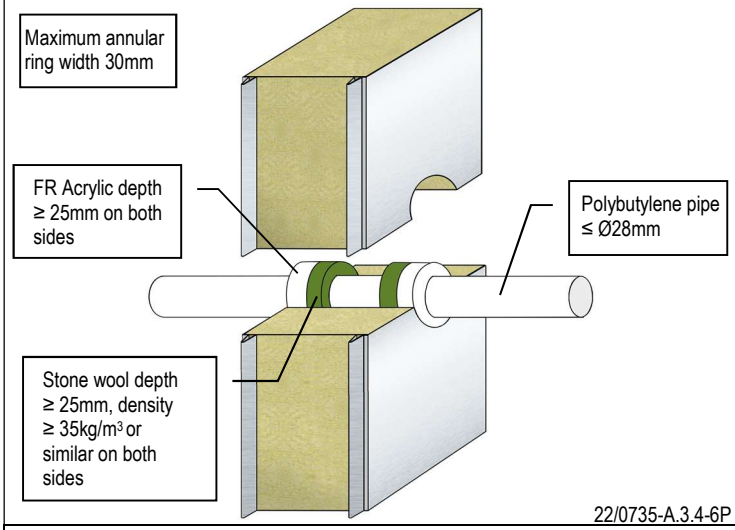

22/0735-A.3.4-6P

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)


≥ 100MM PANEL WALLS

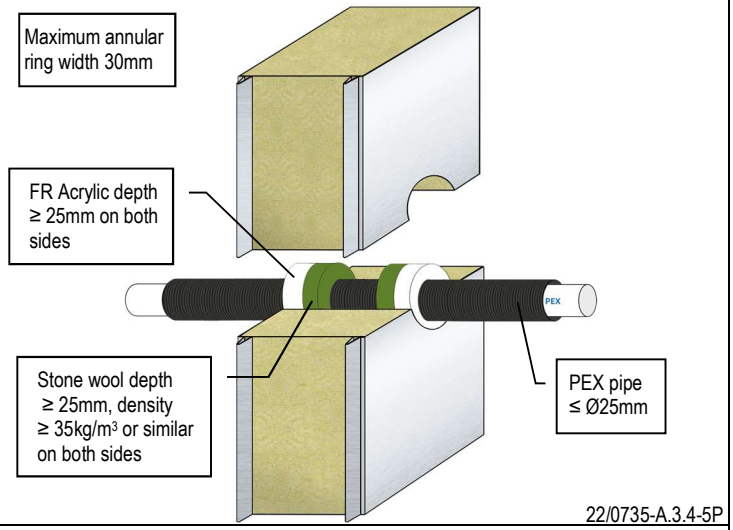

22/0735-A.3.4-5P

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 45 C/C (E 60)


≥ 100MM PANEL WALLS

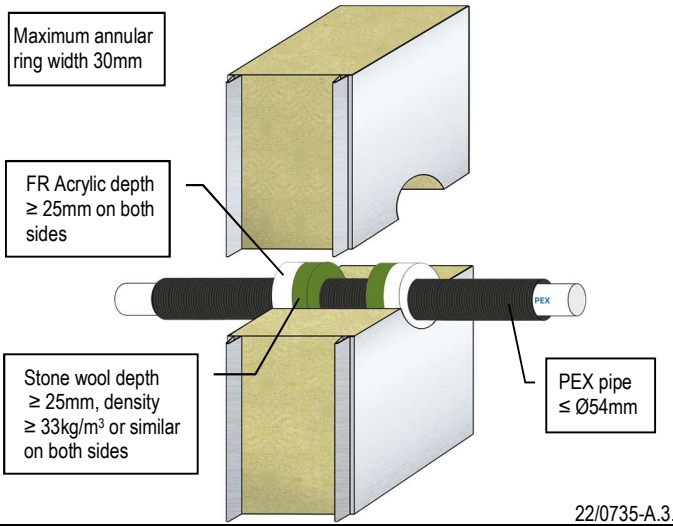

22/0735-A.3.7-9P

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 45 C/C (E 45)

≥ 100MM PANEL WALLS

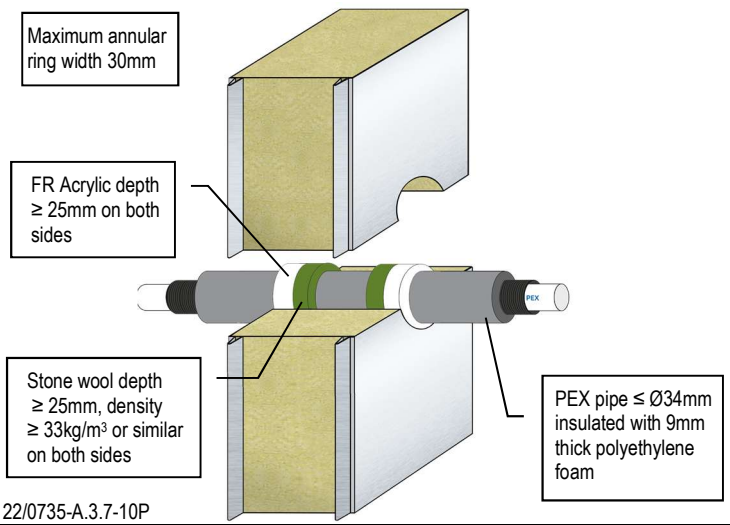


22/0735-A.3.7-10P

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PVC CONDUIT FIRE RESISTANCE EI 60 U/C (E 60)


≥ 100MM PANEL WALLS

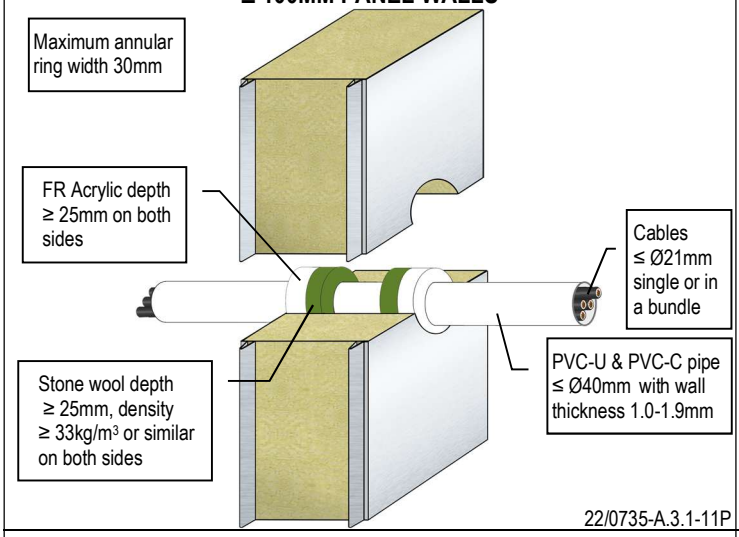

22/0735-A.3.1-11P

PE CONDUIT FIRE RESISTANCE EI 60 U/C (E 60)


≥ 100MM PANEL WALLS

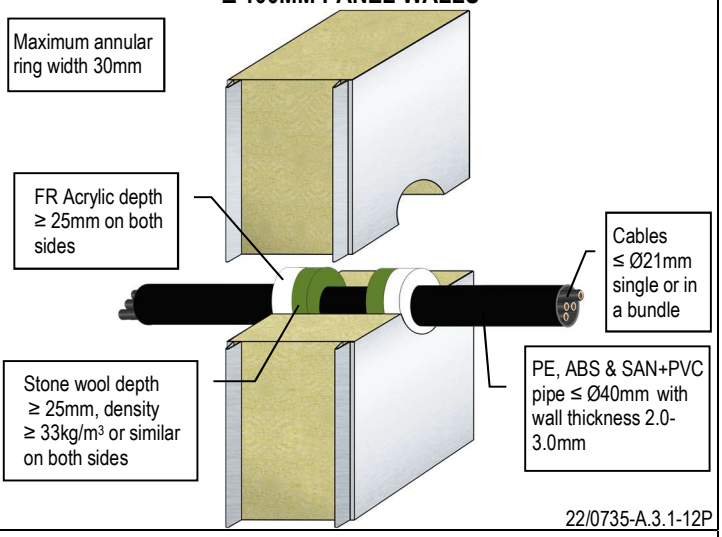

22/0735-A.3.1-12P

PP CONDUIT FIRE RESISTANCE EI 60 U/C (E 60)


≥ 100MM PANEL WALLS

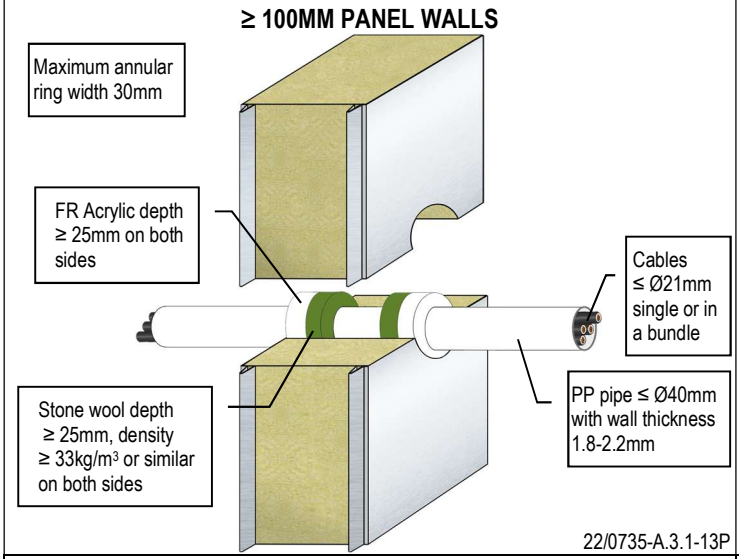

22/0735-A.3.1-13P

CABLES FIRE RESISTANCE EI 90 (E 90)


≥ 100MM TIMBER WALLS

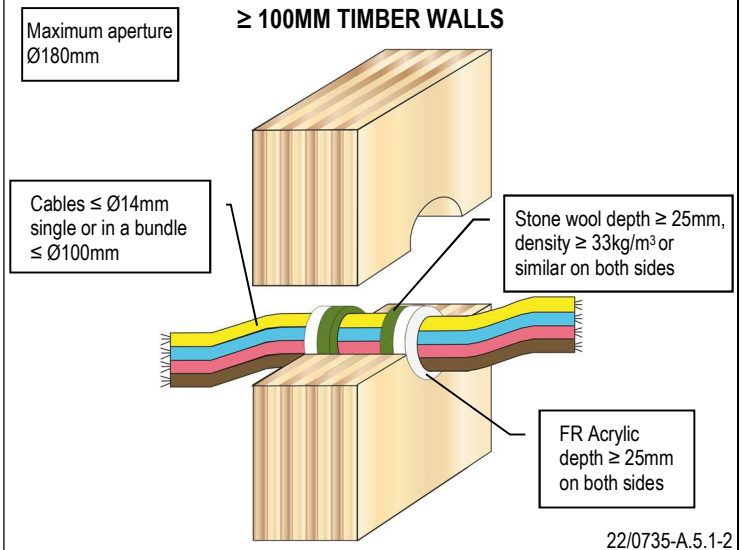

22/0735-A.5.1-2

CABLES FIRE RESISTANCE EI 30 (E 90)


≥ 100MM TIMBER WALLS

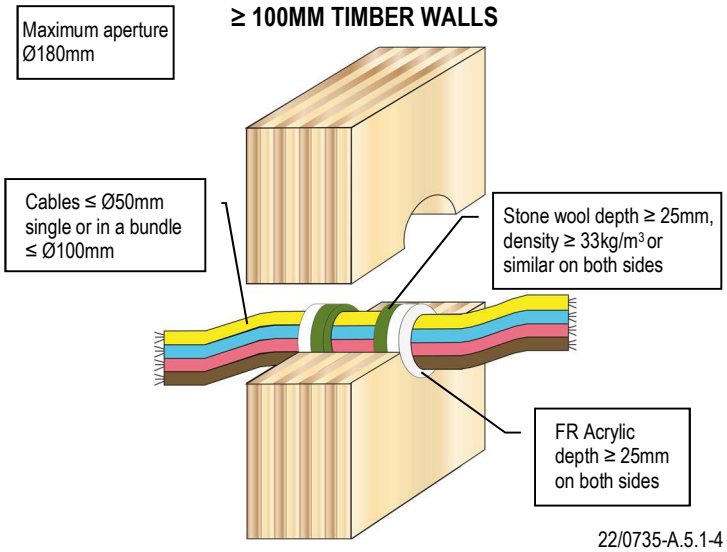

22/0735-A.5.1-4

CABLE FIRE RESISTANCE EI 90 (E 90)

≥ 100MM TIMBER WALLS

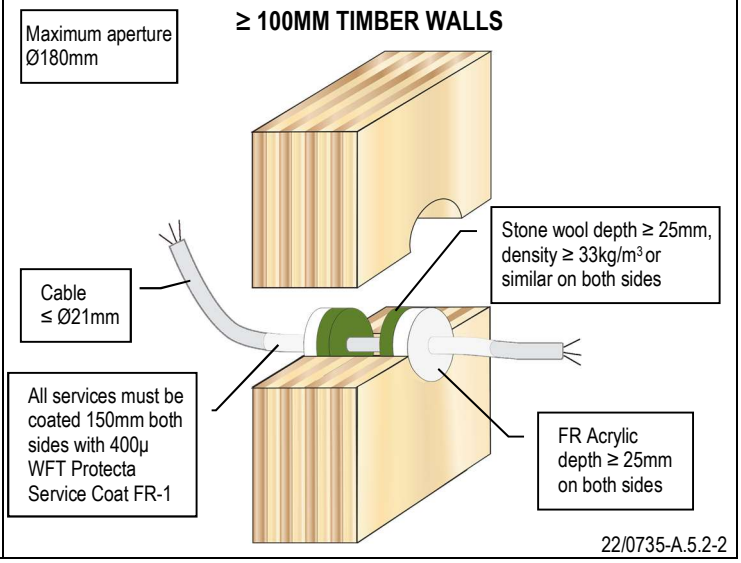


22/0735-A.5.2-2

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

CABLES FIRE RESISTANCE EI 60 (E 90)


≥ 100MM TIMBER WALLS

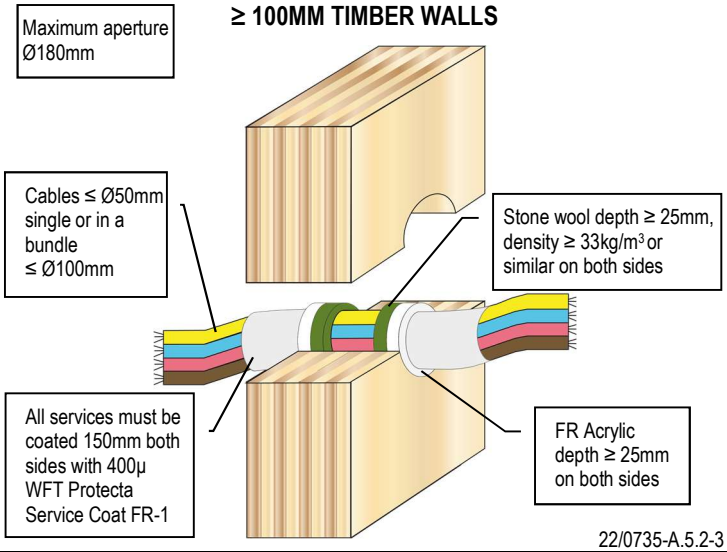

22/0735-A.5.2-3

STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 90)


≥ 100MM TIMBER WALLS

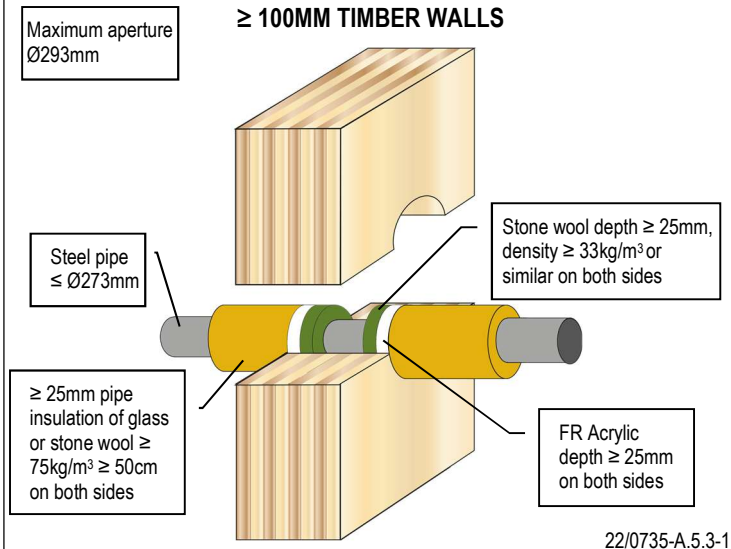

22/0735-A.5.3-1

STEEL PIPE FIRE RESISTANCE EI 30 C/U (E 30)


≥ 100MM TIMBER WALLS

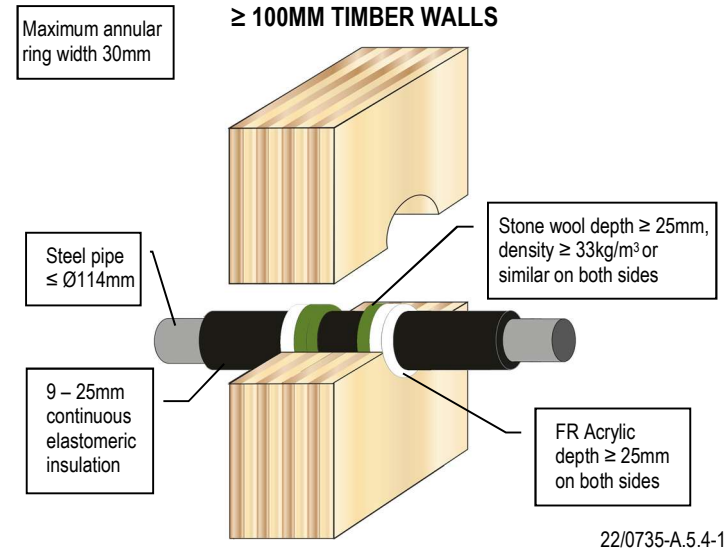

22/0735-A.5.4-1

COPPER OR STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 90)


≥ 100MM TIMBER WALLS

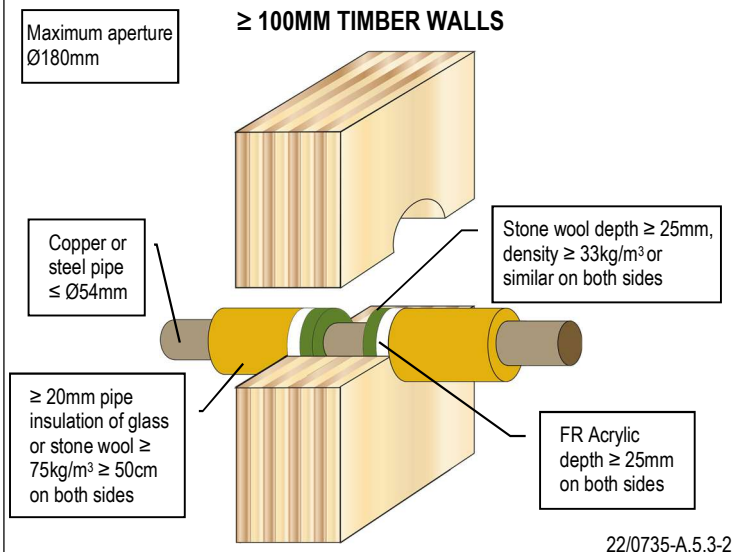

22/0735-A.5.3-2

COPPER OR STEEL PIPE FIRE RESISTANCE EI 60 C/C (E 90)


≥ 100MM TIMBER WALLS

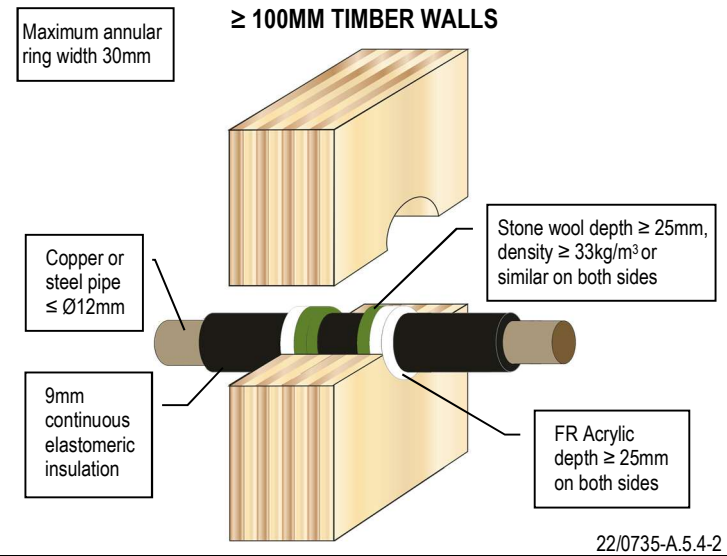

22/0735-A.5.4-2

COPPER OR STEEL PIPE FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM TIMBER WALLS

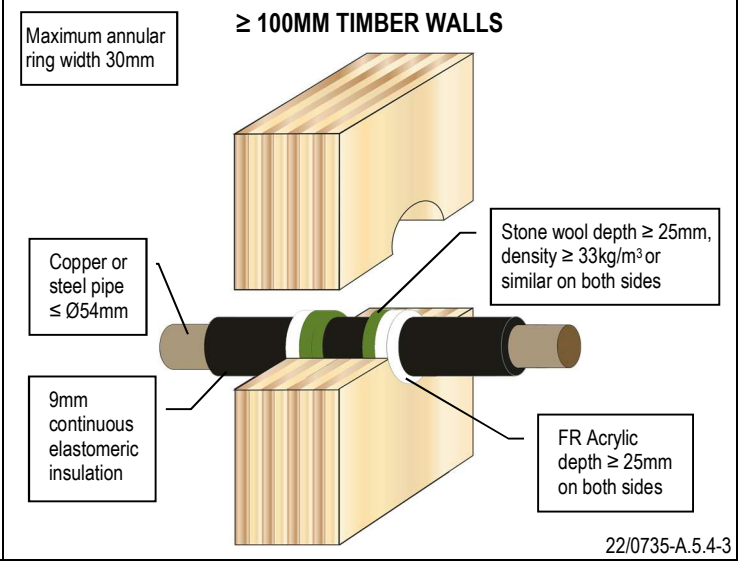


22/0735-A.5.4-3

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COPPER PIPE FIRE RESISTANCE EI 20 C/C (E 30)


≥ 100MM TIMBER WALLS

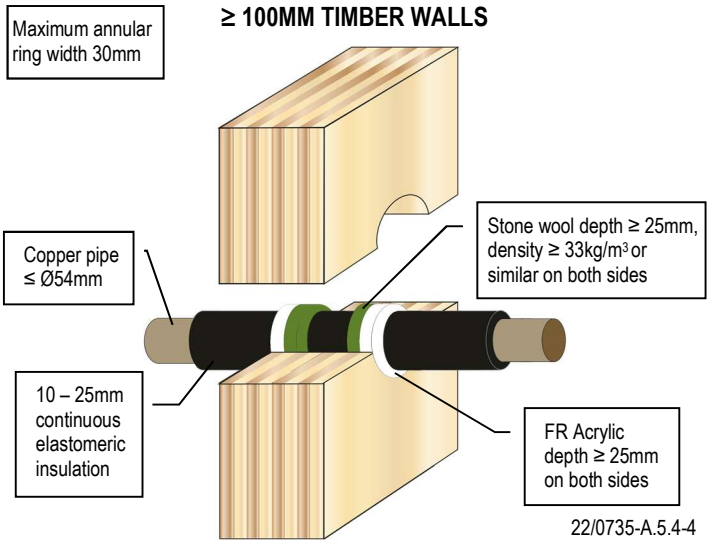

22/0735-A.5.4-4

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 90)


≥ 100MM TIMBER WALLS

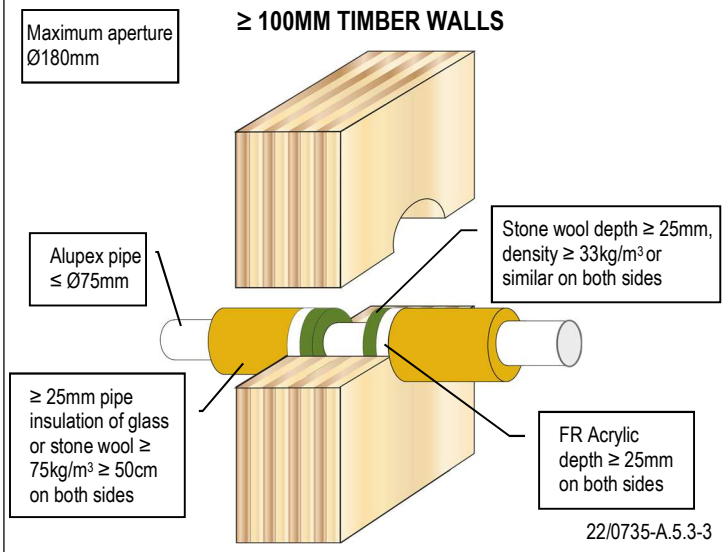

22/0735-A.5.3-3

ALUPEX PIPE FIRE RESISTANCE EI 90 C/C (E 90)


≥ 100MM TIMBER WALLS

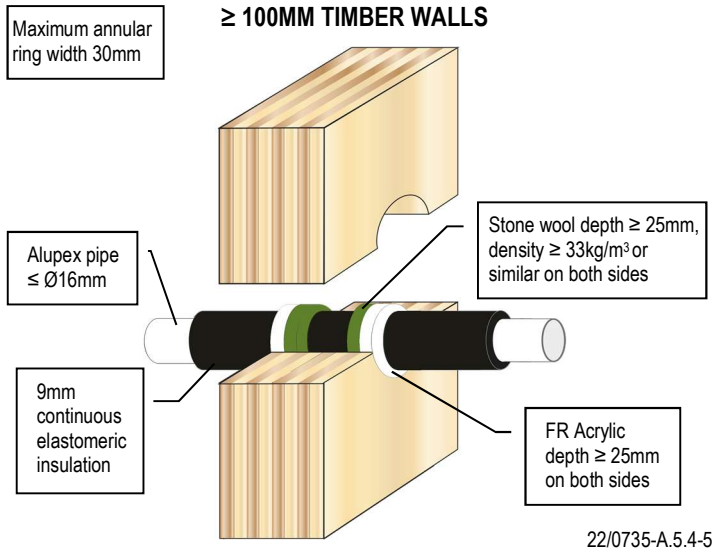

22/0735-A.5.4-5

ALUPEX PIPE FIRE RESISTANCE EI 45 C/C (E 60)


≥ 100MM TIMBER WALLS

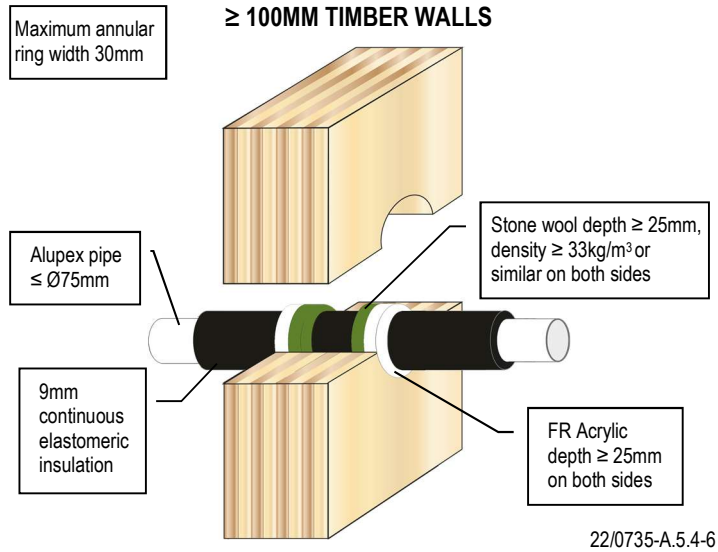

22/0735-A.5.4-6

ALUPEX PIPE FIRE RESISTANCE EI 45 C/C (E 45)


≥ 100MM TIMBER WALLS

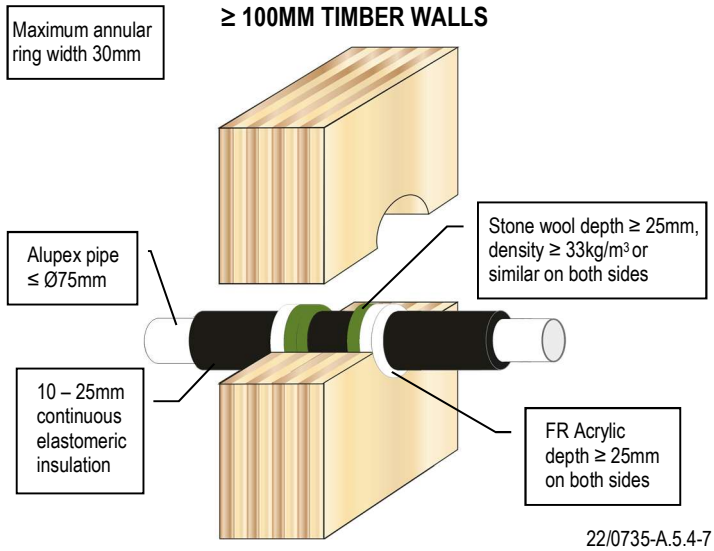

22/0735-A.5.4-7

PVC PIPE FIRE RESISTANCE EI 90 U/C (E 90)


≥ 100MM TIMBER WALLS

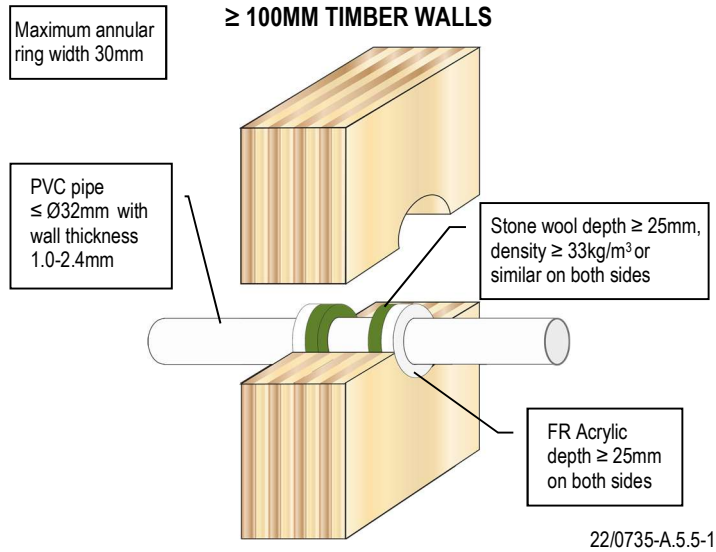

22/0735-A.5.5-1


As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

PE PIPE FIRE RESISTANCE EI 90 U/C (E 90)

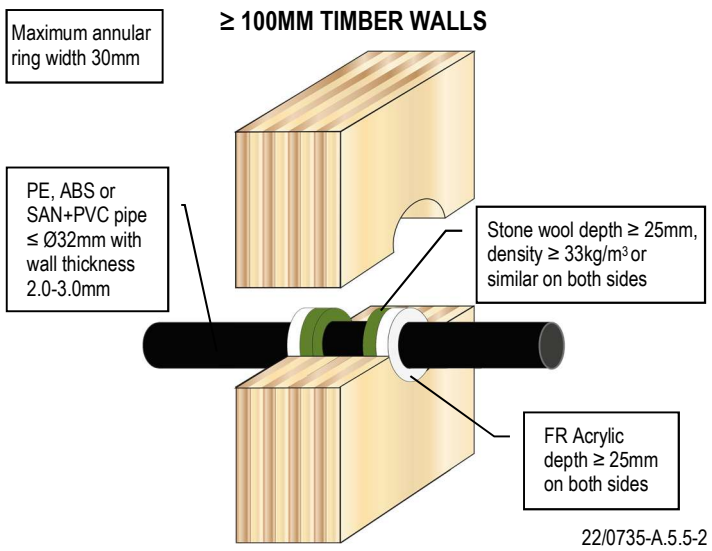


22/0735-A.5.5-2

PP PIPE FIRE RESISTANCE EI 90 U/C (E 90)

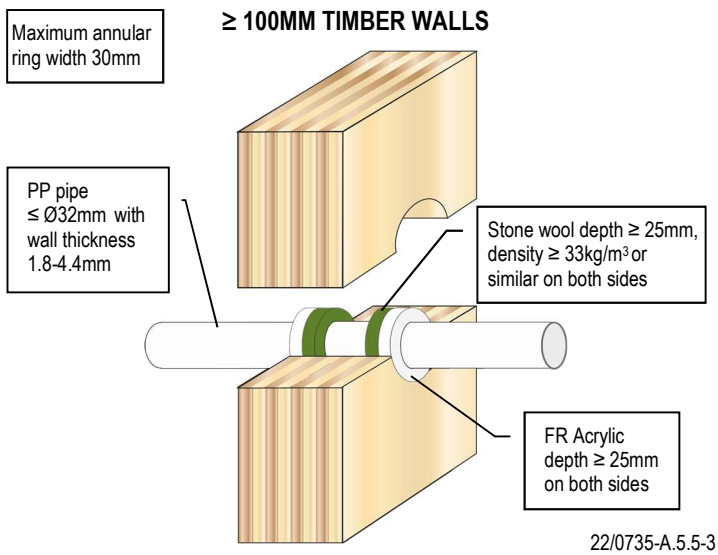

22/0735-A.5.5-3

PEX PIPE-IN-PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

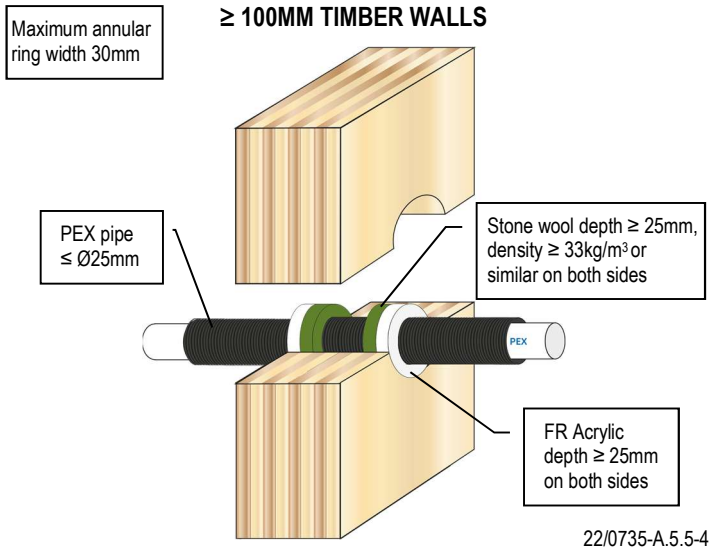

22/0735-A.5.5-4

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INDEX

Rigid floors

Services	Service insulation	Page no.
Linear seals	-	2 – 3
Cables	-	4
Unistrut channel	-	5
Steel pipes	-	5
“	Coat-back	5 – 6
“	Glass- & stone-wool, continuous	6
“	Glass- & stone-wool, interrupted	6 – 8
“	Elastomeric, phenolic or PU-foam, continuous	8
Gas pipes	-	8
Copper pipes	-	8 – 9
“	Glass- & stone-wool, continuous	9 – 10
“	Glass- & stone-wool, interrupted	10 – 11
“	Elastomeric, phenolic or PU-foam, continuous	11
Alupex pipes	-	11 – 12
“	Glass- & stone-wool, continuous	12
“	Glass- & stone-wool, interrupted	12
“	Elastomeric, phenolic or PU-foam, continuous	13
Plastic PVC, PE & PP pipes	-	13 – 14
Plastic Aquatechnik pipes	-	14
Plastic Polybutylene pipes	-	14
Plastic PEX pipe-in-pipes	-	14
“	Polyethylene foam, continuous	15
Plastic conduits	-	15

Flexible floors

Services	Service insulation	Page no.
Cables	-	15
Steel pipes	-	16
“	Glass- & stone-wool, continuous	16
“	Glass- & stone-wool, interrupted	16
Copper pipes	-	17
“	Glass- & stone-wool, continuous	17
“	Glass- & stone-wool, interrupted	17
Alupex pipes	-	18
“	Glass- & stone-wool, continuous	18
“	Glass- & stone-wool, interrupted	18
Plastic PVC, PE & PP pipes	-	18 – 20
Plastic PEX pipe-in-pipes	-	21
Plastic conduits	-	22

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Timber floors

Services	Service insulation	Page no.
Cables	-	22
Steel pipes	Glass- & stone-wool, interrupted	23
Copper pipes	Glass- & stone-wool, interrupted	23
Alupex pipes	Glass- & stone-wool, interrupted	23
Plastic PVC, PE & PP pipes	-	23 – 24
Plastic PEX pipe-in-pipes	-	24

Flexible and rigid walls

Services	Service insulation	Page no.
Linear seals	-	31 – 33
Cables	-	33 – 34
Cables & conduits on cable trays	-	34
Unistrut channel	-	34
Steel pipes	-	34 – 35
“	Coat-back	35
“	Glass- & stone-wool, continuous	35 – 36
“	Glass- & stone-wool, interrupted	36
“	Elastomeric, continuous	37
“	Phenolic, continuous	37 – 38
Gas pipes	-	38
Copper pipes	-	38
“	Glass- & stone-wool, continuous	39
“	Glass- & stone-wool, interrupted	39
“	Elastomeric, continuous	40
“	Phenolic, continuous	40 – 41
Alupex pipes	-	41
“	Glass- & stone-wool, continuous	41
“	Glass- & stone-wool, interrupted	42
“	Elastomeric, continuous	42 – 43
Plastic PVC, PE & PP pipes	-	43 – 44
Plastic Aquatechnik pipes	-	44
Plastic Polybutylene pipes	-	45
Plastic PEX pipe-in-pipes	-	45
“	Polyethylene foam, continuous	45
Plastic conduits	-	45 – 46

Rigid walls, additional items

Services	Service insulation	Page no.
Linear seals	-	24 – 25
Cables	-	25 – 26
Steel pipes	-	26
“	Stone-wool, continuous	26 – 27
“	Stone-wool, interrupted	27
“	Elastomeric, continuous	28
Copper pipes	-	28
“	Stone-wool, interrupted	28 - 29
Alupex pipes	BIO-wool, interrupted	29
Plastic PVC, PE & PP pipes	-	29 – 30
Plastic conduits	-	30 - 31

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Panel walls

Services	Service insulation	Page no.
Cables	-	46
Cables & conduits on cable trays	-	47
Unistrut channel	-	47
Steel pipes	-	47
“	Coat-back	47
“	Glass- & stone-wool, continuous	48
“	Glass- & stone-wool, interrupted	48
“	Elastomeric, continuous	48 – 49
“	Phenolic, continuous	49
Gas pipes	-	49
Copper pipes	-	49
“	Glass- & stone-wool, continuous	50
“	Glass- & stone-wool, interrupted	50
“	Elastomeric, continuous	50
“	Phenolic, continuous	51
Alupex pipes	-	51
“	Glass- & stone-wool, continuous	51
“	Glass- & stone-wool, interrupted	51
“	Elastomeric, continuous	52
Plastic PVC, PE & PP pipes	-	52 – 53
Plastic Aquatechnik pipes	-	53
Plastic Polybutylene pipes	-	53
Plastic PEX pipe-in-pipes	-	53
“	Polyethylene foam, continuous	53
Plastic conduits	-	54

Timber walls

Services	Service insulation	Page no.
Cables	-	54 – 55
Steel pipes	Glass- & stone-wool, interrupted	55
“	Elastomeric, continuous	55
Copper pipes	Glass- & stone-wool, interrupted	55
“	Elastomeric, continuous	55 – 56
Alupex pipes	Glass- & stone-wool, interrupted	56
“	Elastomeric, continuous	56
Plastic PVC, PE & PP pipes	-	56 – 57
Plastic PEX pipe-in-pipes	-	57

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.