PROTECTA® FR BOARD

INSTALLATION INSTRUCTIONS

CONTENT

Solutions in drywalls and rigid walls ..... pages 2-37
Solutions in timber walls ..... pages 37-51
Solutions in rigid walls, additional ..... pages 52-62
Solutions in rigid floors ..... pages 63-69
Solutions in timber and rigid floors ..... pages 70-71
INDEX for detailed drawings ..... pages 72-74

Please refer to Protecta® FR Damper for guidance on fire sealing ventilation ducts. Please also refer to the Technical Data Sheet.

GENERAL GUIDE

Minimum separations and limitations: Services can be sealed as specified in the detailed drawings. An aperture can include several services, and they may also be different. The minimum permitted separation between adjacent seals/apertures is 100 mm. Services should be a minimum of 25 mm from seal edges.

Services within the system Protecta® FR Board seal do not require a minimum separation, except where Protecta® FR Pipe Wraps are used, which should be a minimum of 30 mm from other services in the aperture.

Protecta® FR Board seals which involve services penetrating both sides of a flexible wall may also be used in the situation where the services penetrates one side of the wall only and the remaining side of the wall is not penetrated at the same point (i.e. the services continues on the inside of the wall).

Supporting constructions: Flexible walls must have a minimum thickness of 75 mm and comprise steel studs or timber studs lined on both faces with minimum 1 layer of 12.5 mm thick boards. Timber walls must have a minimum thickness of 100 mm and comprise solid wood or cross-laminated timber. Rigid walls must have a minimum thickness of 75 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 350 kg/m^3 (650 kg/m^3 in rigid wall details). Rigid floors must have a minimum thickness of 125 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m^3. Timber floors must have a minimum thickness of 150 mm and comprise solid wood or cross-laminated timber.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period. Services in floors should be supported at maximum 450 mm from the top face. Services in walls should be supported at maximum 270 mm from both faces of the wall. Where cable trays are discontinued on both sides of the penetration seal, the maximum distance to the trays should be 150 mm. There is no minimum distance required for the fixings of the cable trays, but it is suggested such fixings and the cable trays are constructed so they provide support for the duration of the required fire classification.

Services: Metallic pipes through the system Protecta® FR Board may be used in all angles between 90° and 45° in all directions.

Where steel pipes are mentioned, this includes iron pipes. Where PVC pipes are mentioned, this includes PVC-U, PVC-C and similar if the pipe is according to EN 1329-1, EN 1452-2, EN 1453-1 and EN 1566-1. Where PP pipes are mentioned, this includes PP-MV, PP-H, PP-R and similar if the pipe is according to EN 1451-1 or DIN 8077/8078. Where PE pipes are mentioned, this includes PE-LD, PE-MD, PE-HD, PE-X and similar according to EN 1519-1, EN 12201-2 or EN 12666-1, ABS according to EN 1455-1 and pipes made from SAN+PVC according to EN 1565-1.

INSTALLATION

1. Before installing Protecta® FR Board ensure that the surface of all service penetrations and surrounding construction is free from all loose contaminants, dust and grease.
2. Protecta® FR Coating, FR Acrylic, FR Graphite and Service Coat FR-1 are water based, so in cases where corrosion protection is a problem, some metals may require a barrier between the seal and the surface prior to this installation.
3. When fitting double layer boards into drywalls, the coated side of the board should normally be flush with the surface of the wall on both sides. In seals wider than 2,400 mm, uninterrupted separating studs will be required at 2,400 mm centres or less.
4. When fitting double layer 60 mm thick boards into rigid constructions, the boards should normally be flush with the surface of the construction on both sides to maximize the fire resistance. If this is not possible, there should be an air gap of at least 30 mm between the boards, unless described differently in the detailed drawings.
5. When fitting single layer boards into constructions, the board can be positioned to either side of the construction or anywhere in between, unless described differently in the detailed drawings.
6. When installing boards in hollow floor slabs, the fire seal should be level with the soffit side. There must be sufficient thickness of concrete below the void for the depth of the fire seal. Where this is not the case, or where double layer boards are required, tubular voids should be plugged with FR Board before sealing the aperture.
7. Where single sided top face seals are described, these can also be used in composite floors (e.g., concrete filled, steel trapezoidal decking).
8. An aperture with or without penetrating services, can include a steel or plastic sleeve casted or friction fitted within rigid constructions. Plastic sleeves should have a maximum wall thickness of 9.5 mm (36.3 mm limited to EI 60).
9. The boards may be surrounded on two sides, horizontally and vertically, with Protecta® FR Flexi Board, maximum 400 mm wide. The solution is limited to EI 120.
10. Cut the required board(s) to suit the aperture dimensions and type and size of service penetration(s) (see detailed drawings). All exposed and cut edges of the board must be sealed with Protecta® FR Acrylic prior to fitting which will act as an adhesive (optional in rigid constructions). The board(s) must be friction fitted into the aperture with a tight fit (unless pattress fitted). All joints, gaps or imperfections in the installed seal must be filled with Protecta® FR Acrylic on the coated exposed side(s) of the board(s). Visible edges of Protecta® FR Pipe Wraps can be sealed with Protecta® FR Acrylic (optional).
11. Board(s) can be over-painted with most emulsion or alkyd (gloss) paints. For a moisture proof seal protect the cured Protecta® FR Acrylic and FR Graphite seals by painting over with Protecta® FR Coating.

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
1 (86) 2025 2 7

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 60 (E 60)

≥ 75MM DRYWALLS

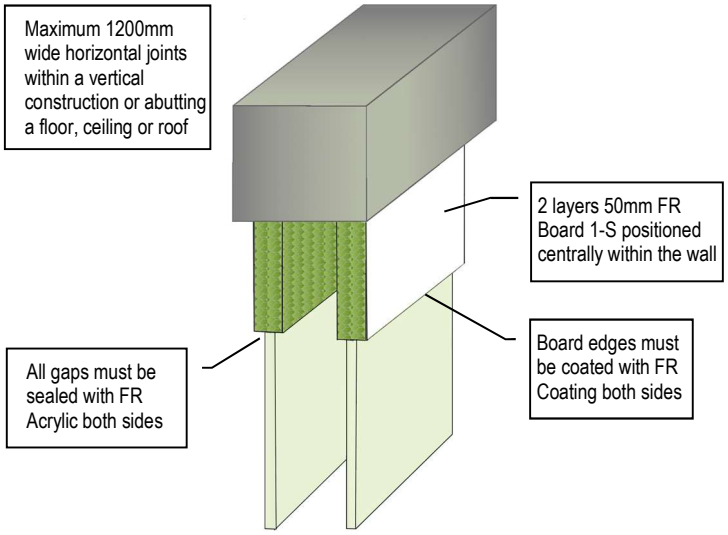

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)

≥ 100MM DRYWALLS

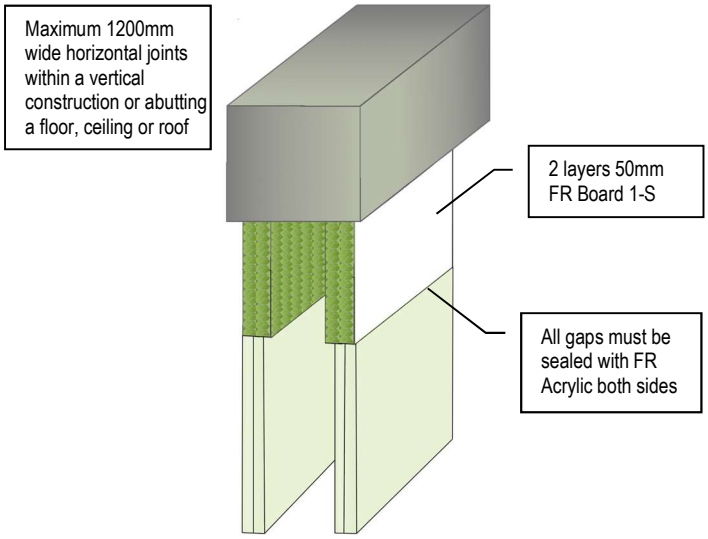

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM DRYWALLS

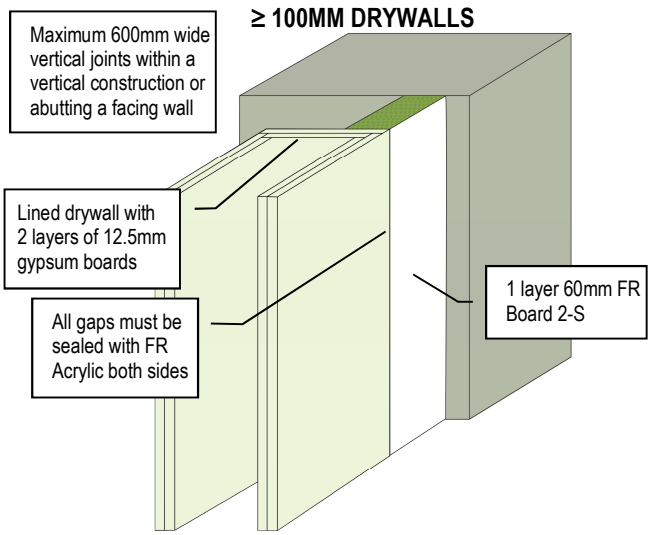

VERTICAL & HORIZONTAL SEALS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM DRYWALLS

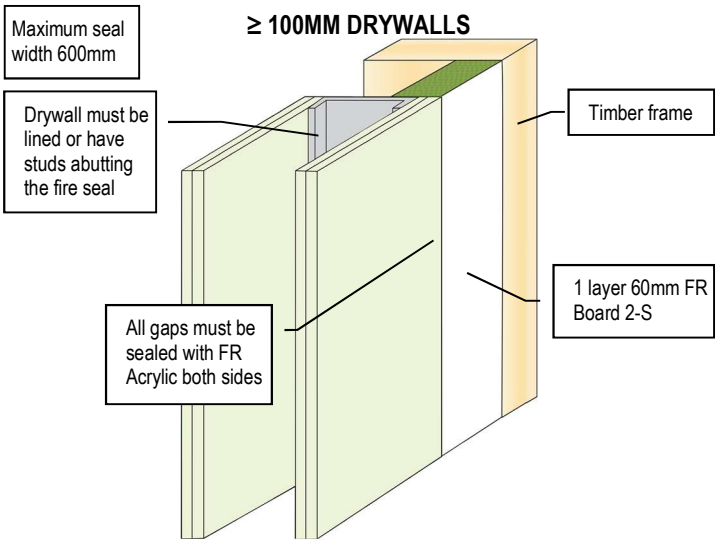

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 30 (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

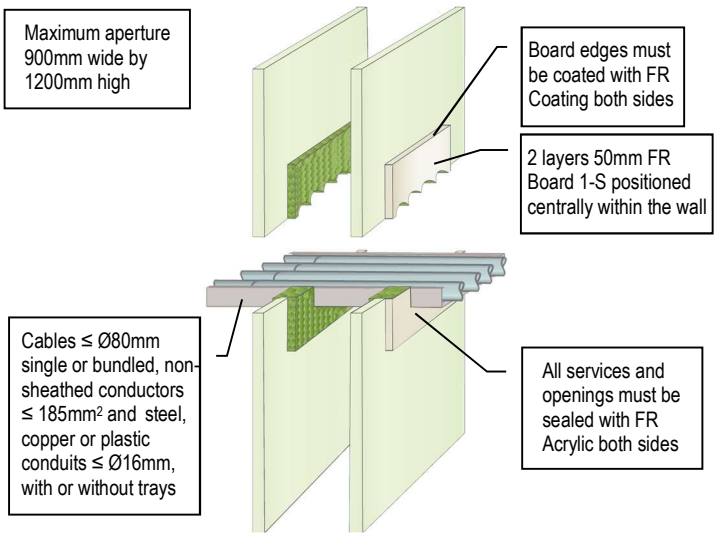

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

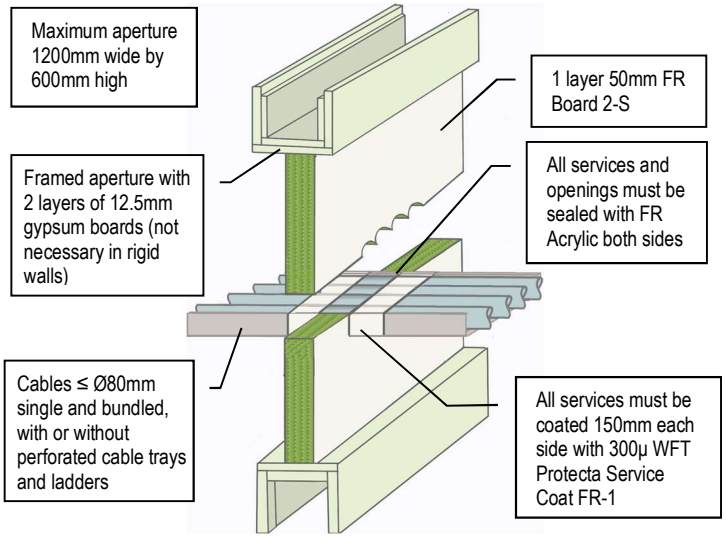

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
2 (86) 2025 2 7

CABLES FIRE RESISTANCE EI 60 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

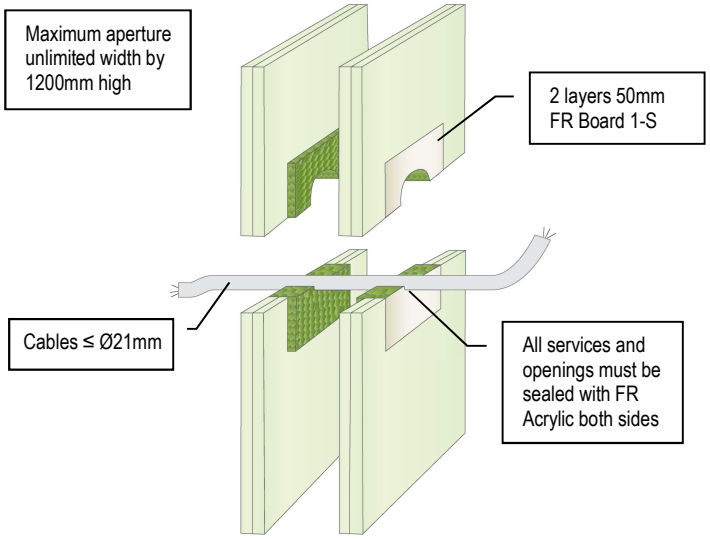

CABLES FIRE RESISTANCE EI 120 (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

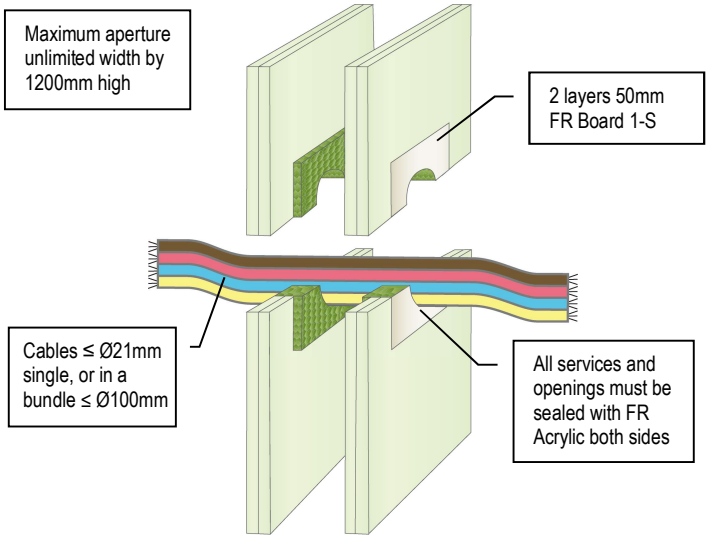

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

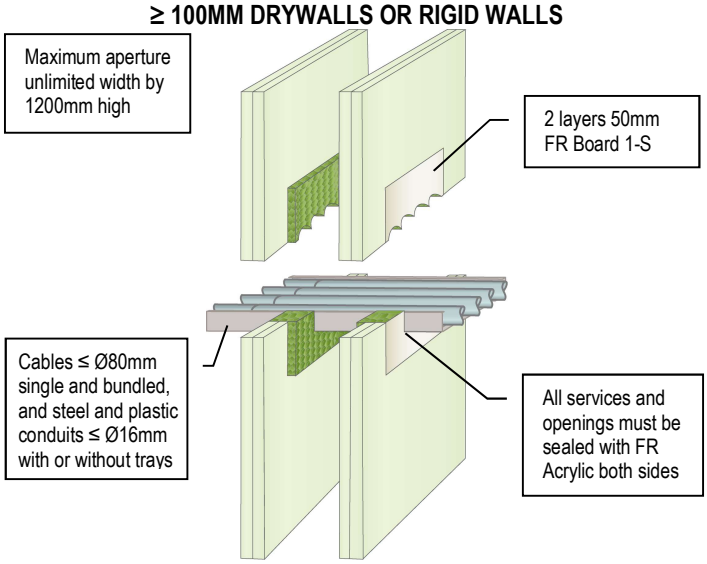

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

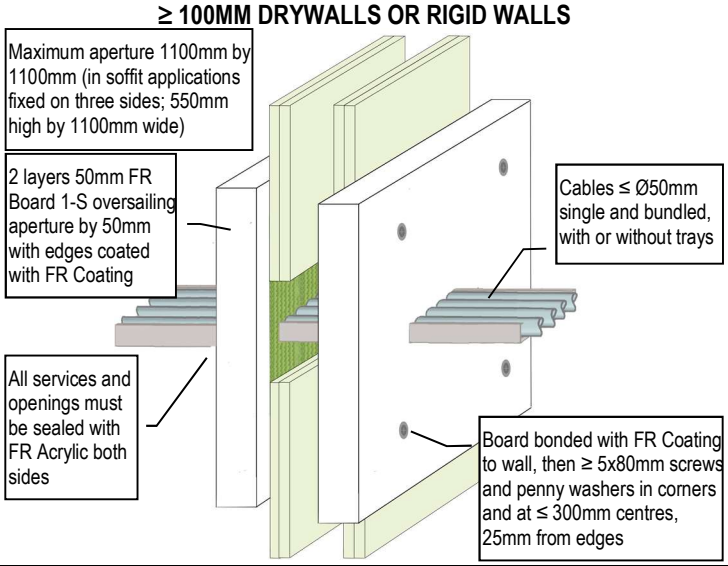

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 90)

≥ 120MM DRYWALLS OR RIGID WALLS

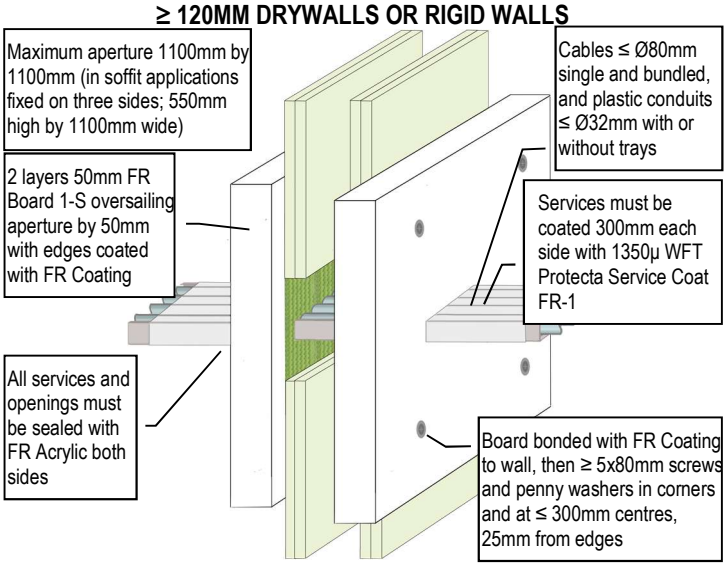

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 120 (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

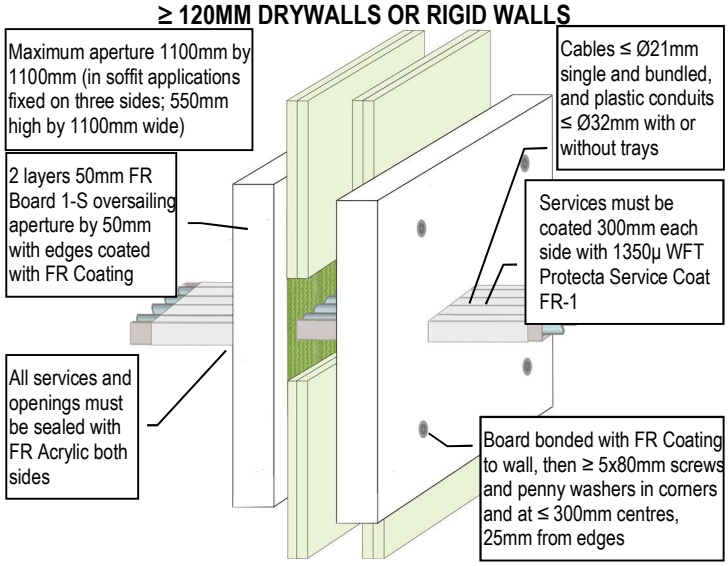

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
3 (86) 2025 2 7

BUS-BARS FIRE RESISTANCE EI 30 (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

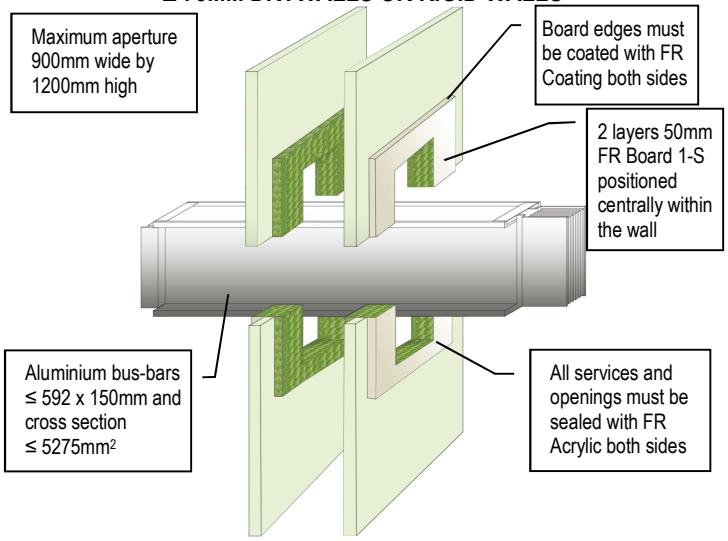

BUS-BARS FIRE RESISTANCE EI 30 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

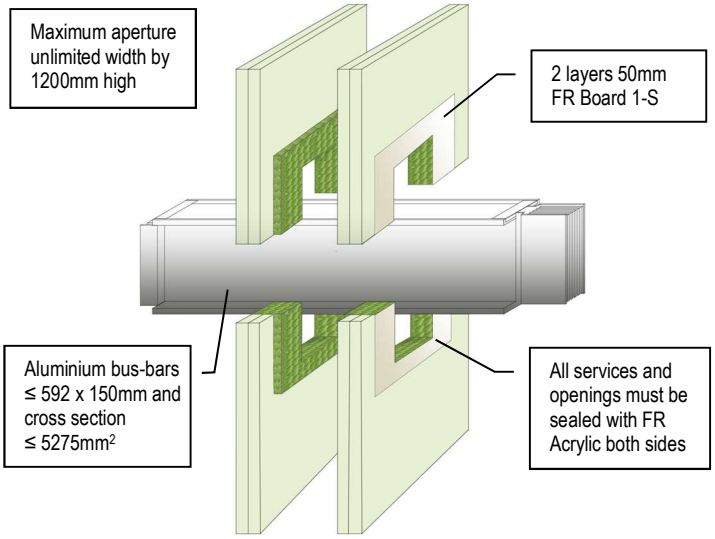

BUS-BARS FIRE RESISTANCE EI 30 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

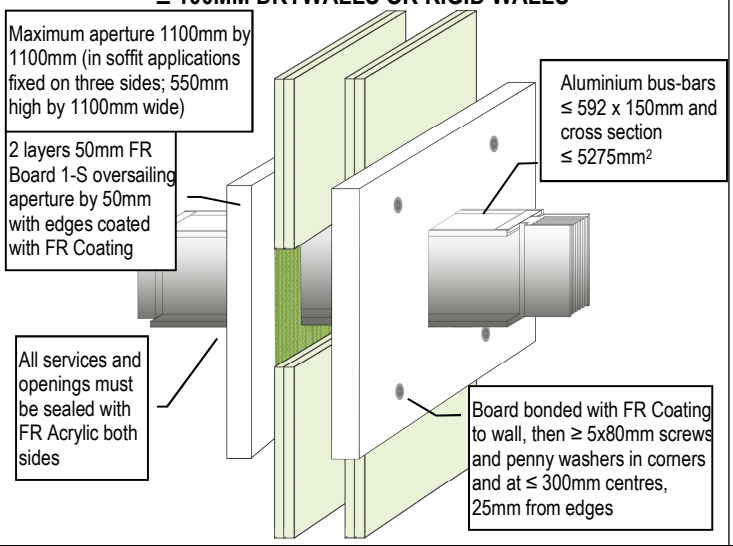

BUS-BARS FIRE RESISTANCE EI 60 (E60)

≥ 75MM DRYWALLS OR RIGID WALLS

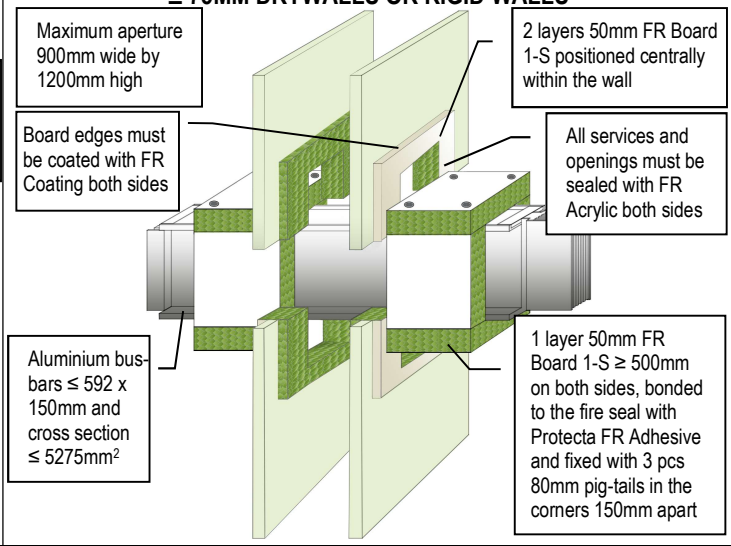

BUS-BARS FIRE RESISTANCE EI 90 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

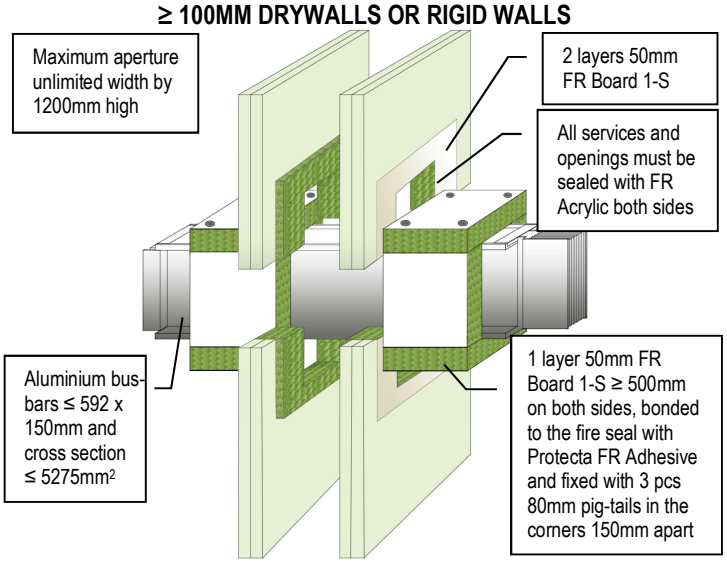

BUS-BARS FIRE RESISTANCE EI 90 (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

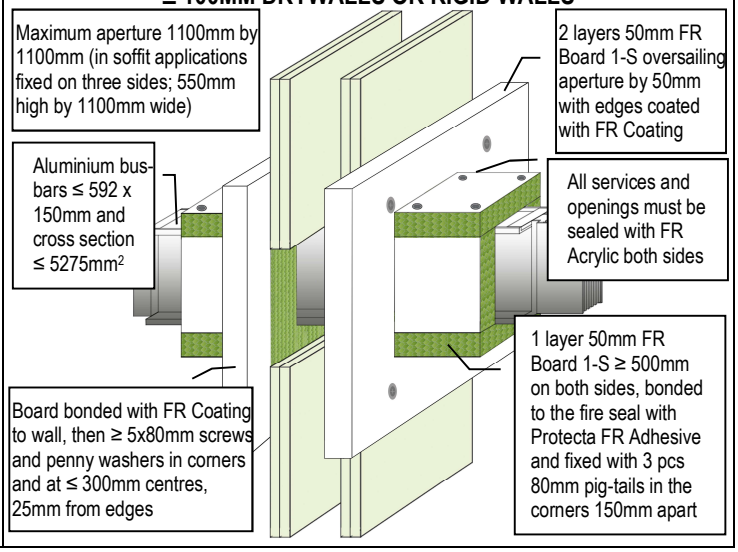

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036

TRUNKING FIRE RESISTANCE EI 120 U/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

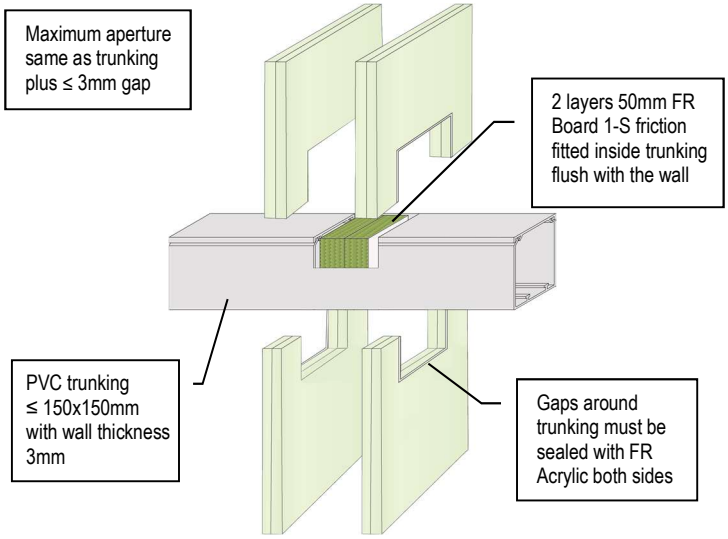

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

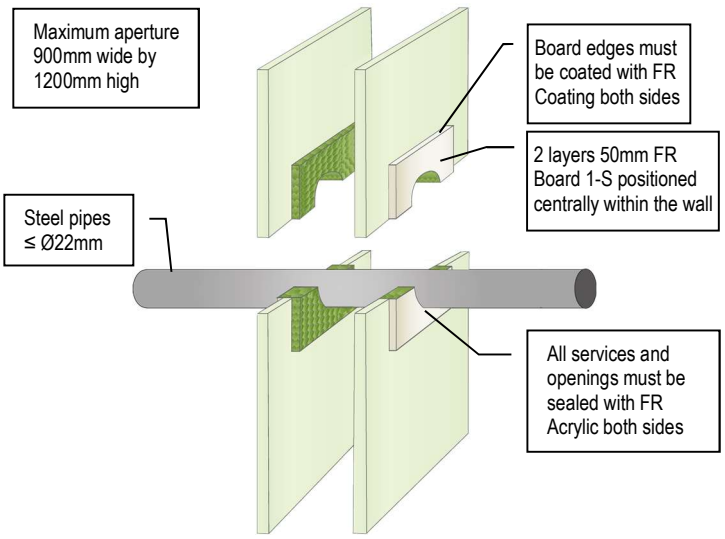

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

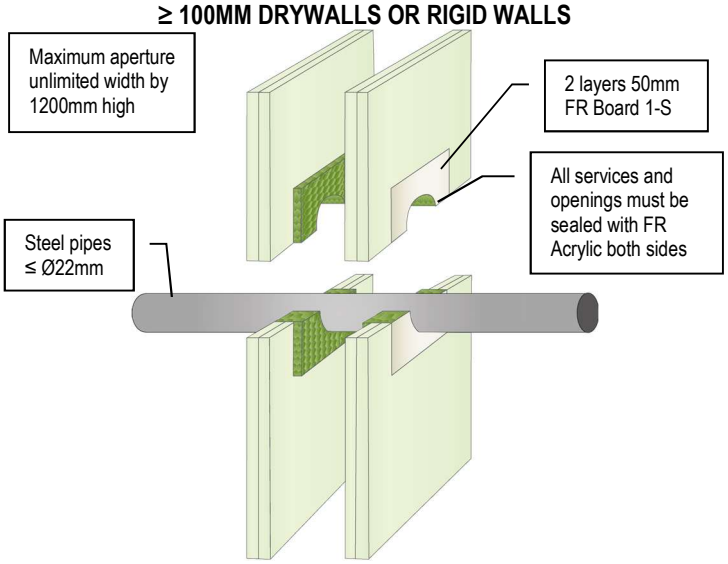

STEEL PIPES FIRE RESISTANCE EI 20 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

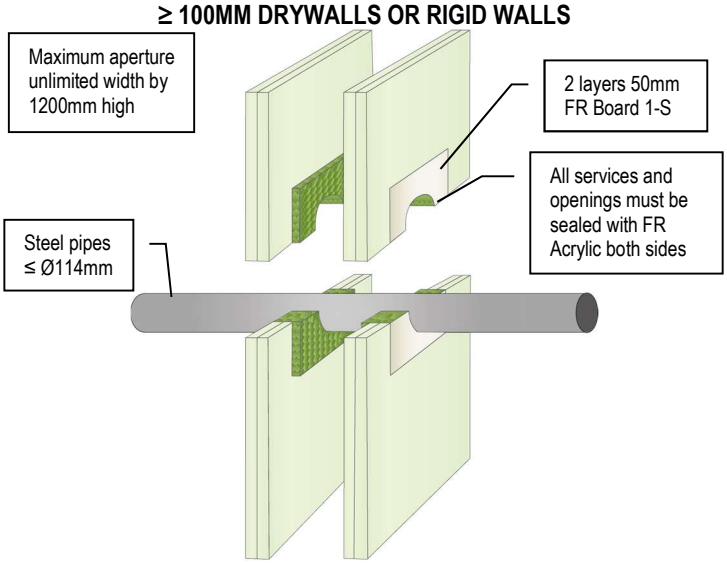

STEEL PIPES FIRE RESISTANCE EI 30 C/U (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

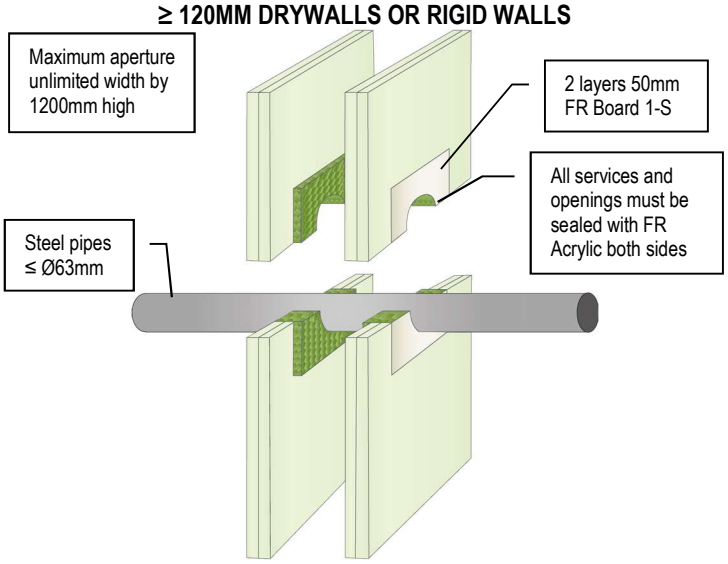

STEEL PIPES FIRE RESISTANCE EI 20 C/U (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

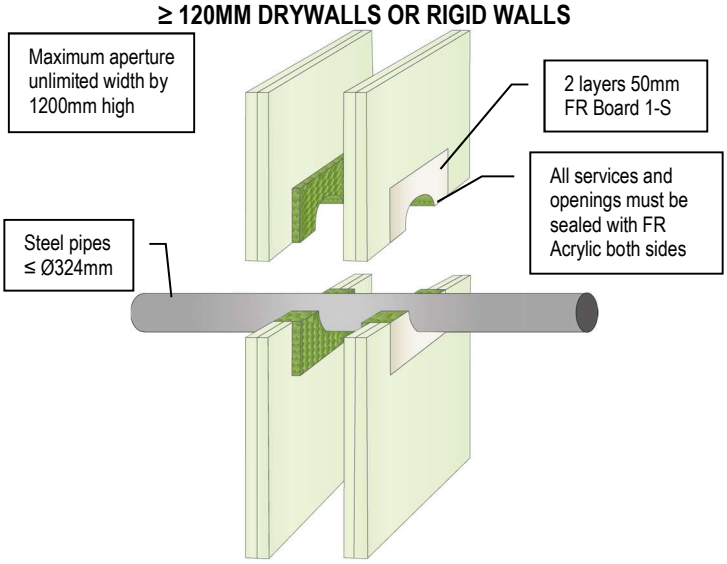

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
5 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

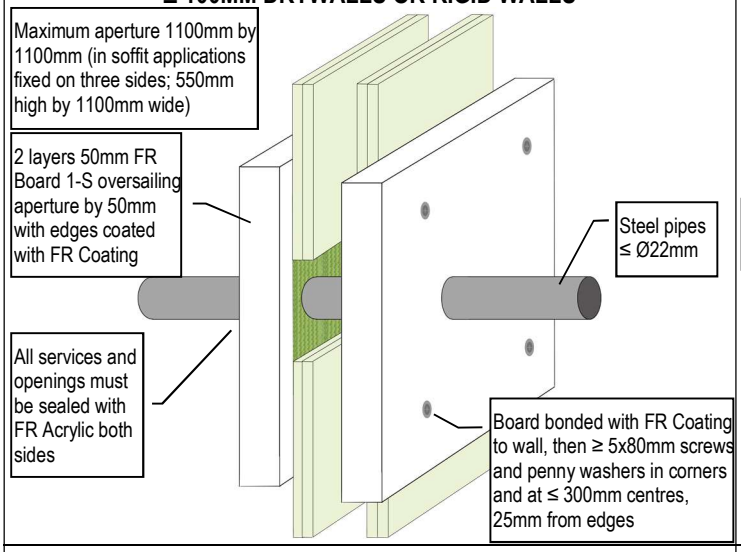

STEEL PIPES FIRE RESISTANCE EI 45 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

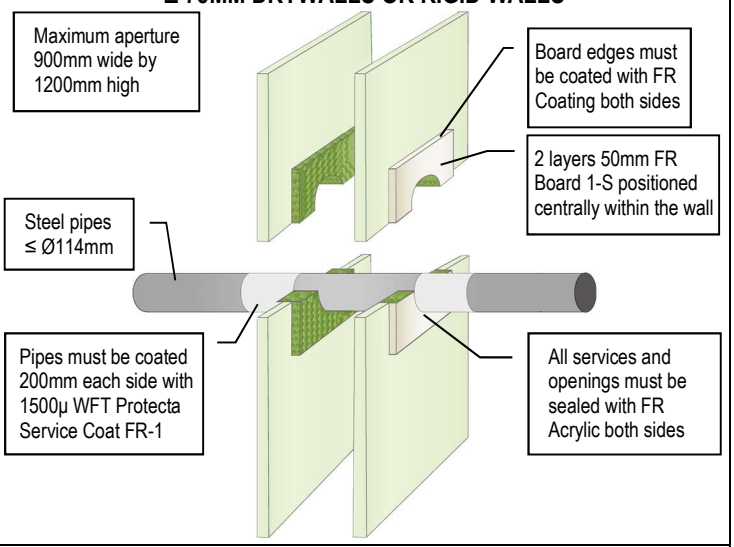

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

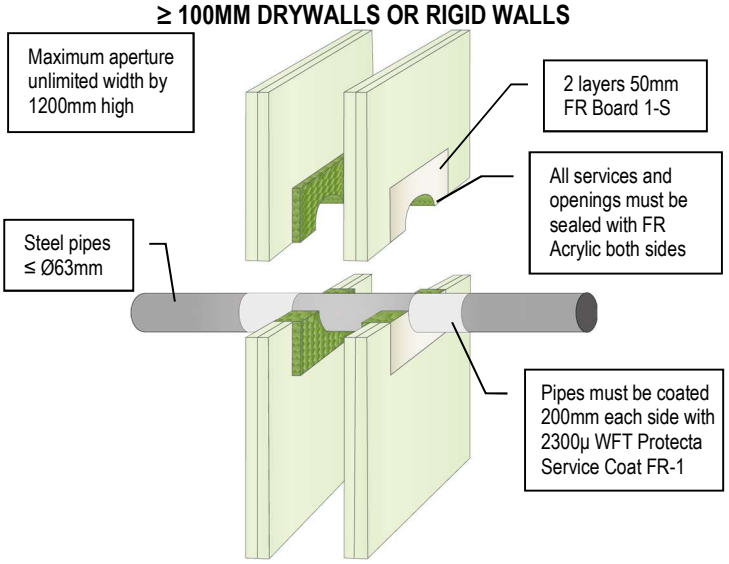

STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

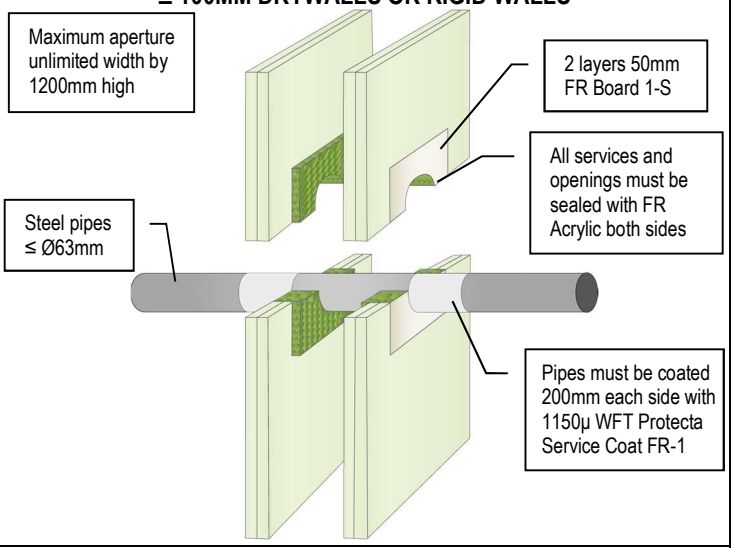

STEEL PIPES FIRE RESISTANCE EI 45 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

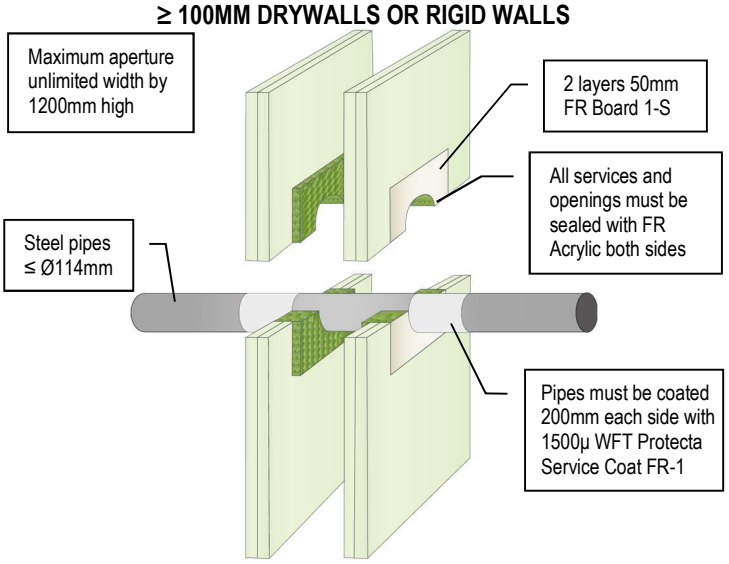

STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

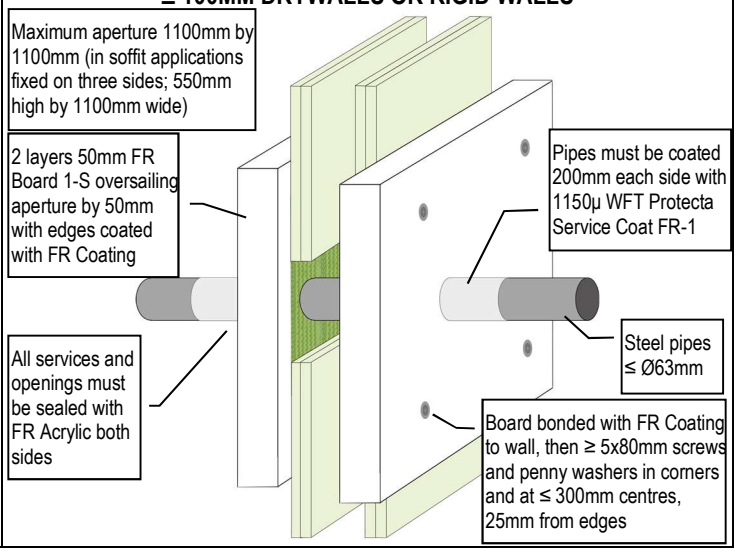

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 U/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

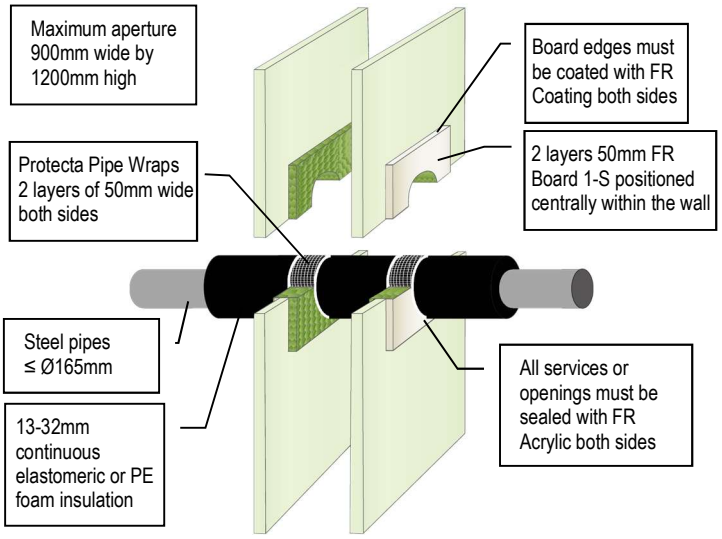

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

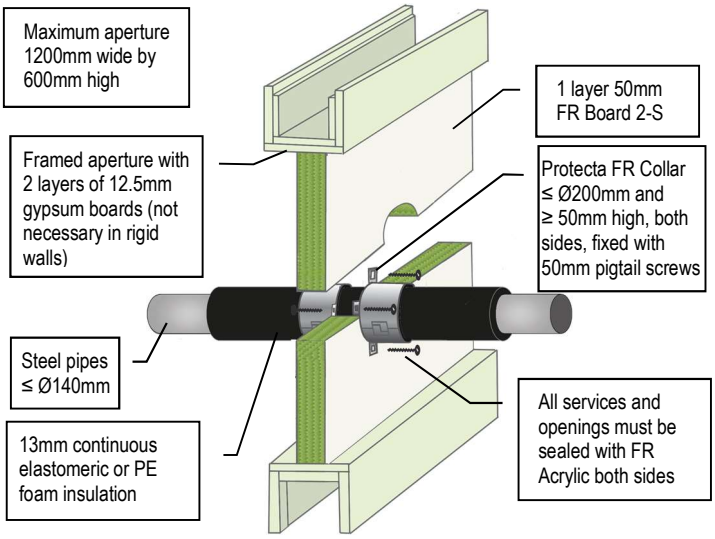

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 U/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

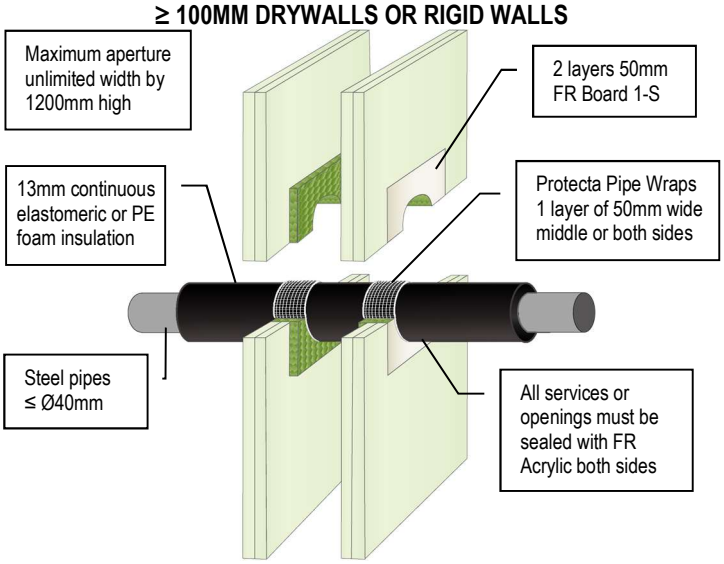

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 U/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

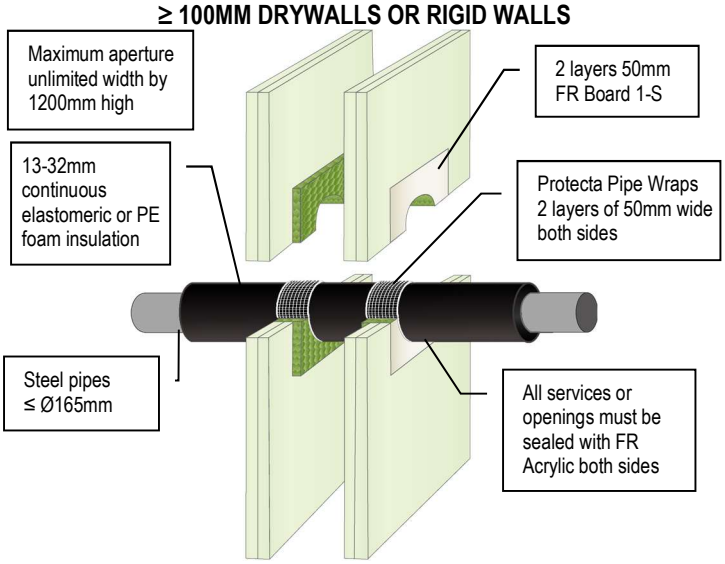

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

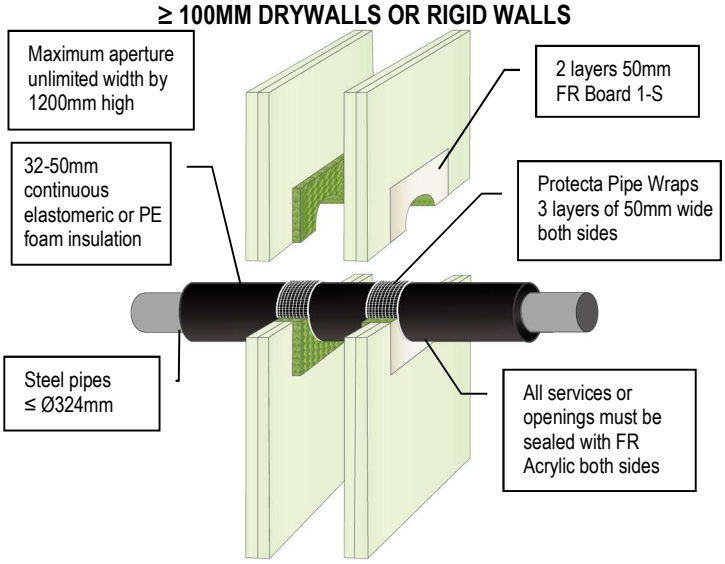

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 U/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

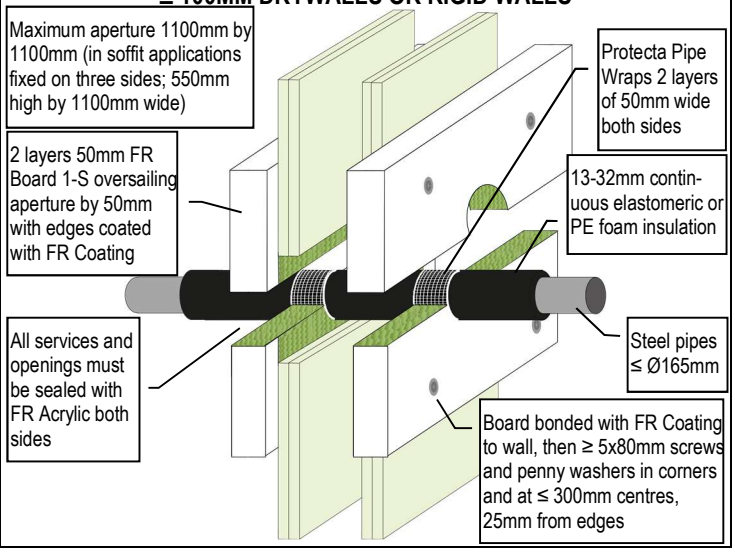

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
7 (86) 2025 2 7

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

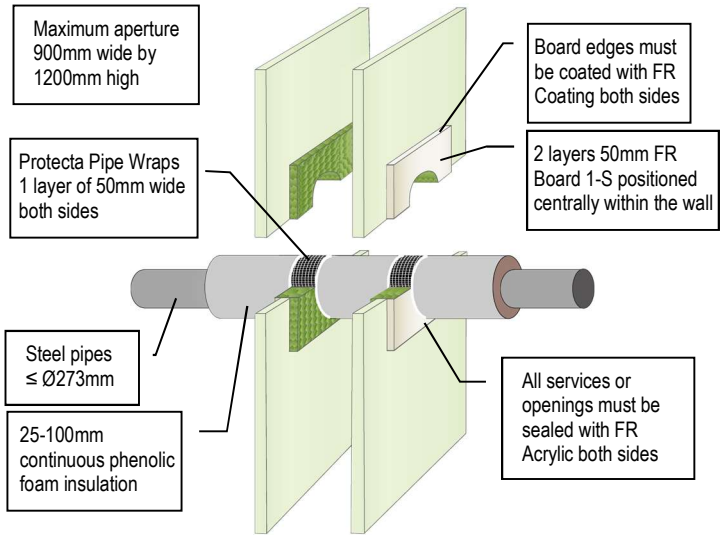

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

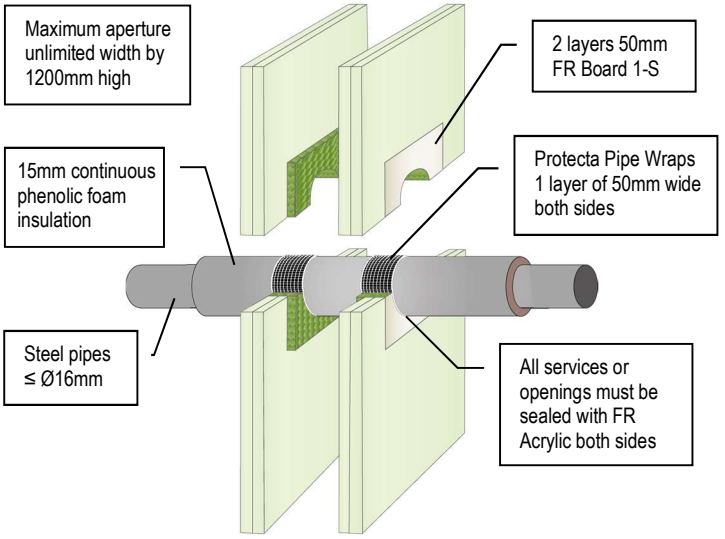

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

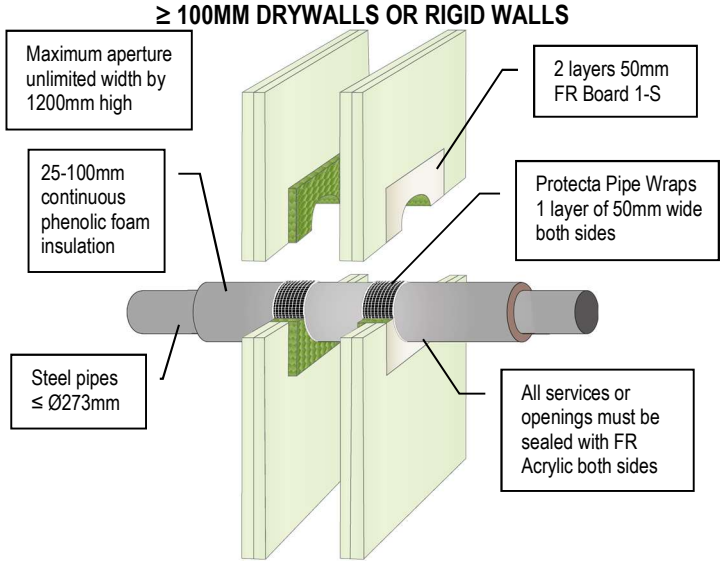

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

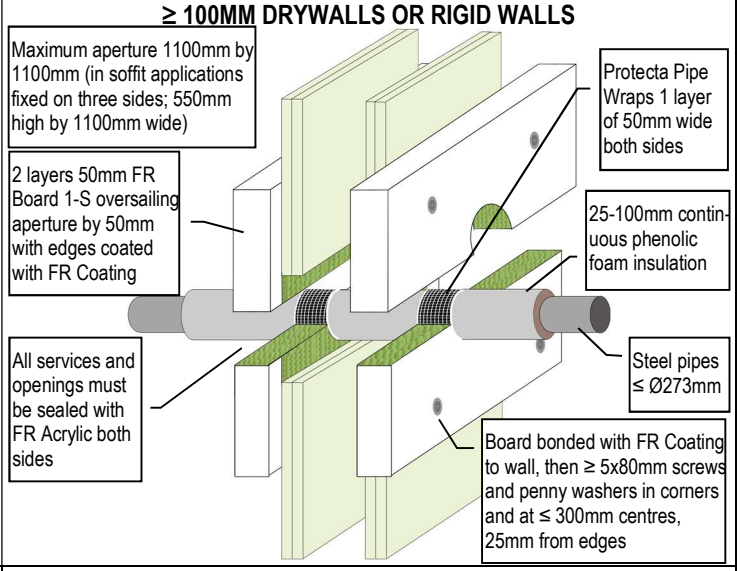

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

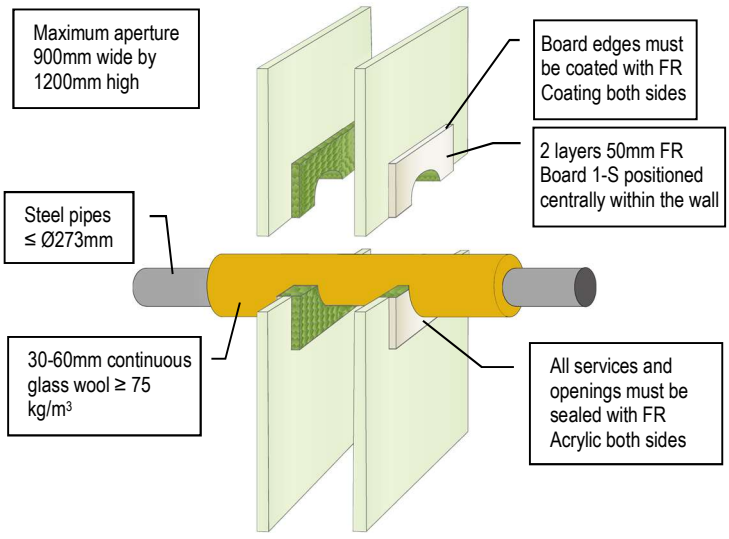

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

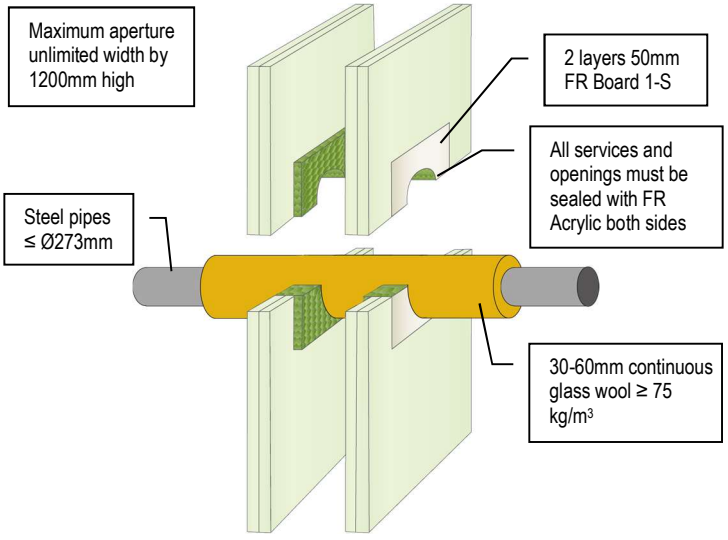

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
8 (86) 2025 2 7

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

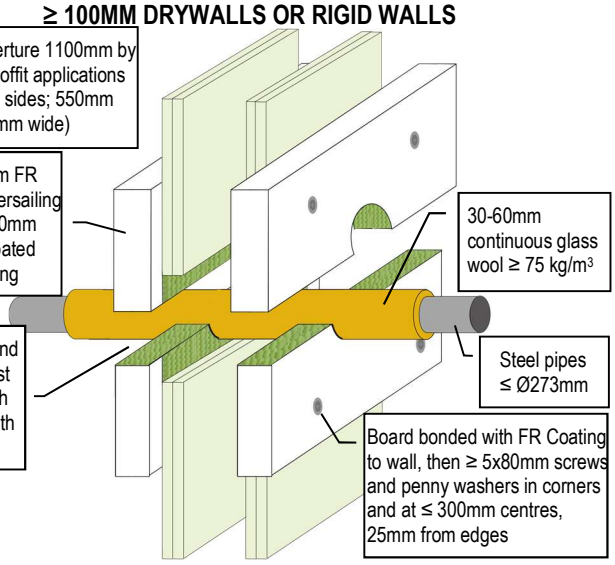

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

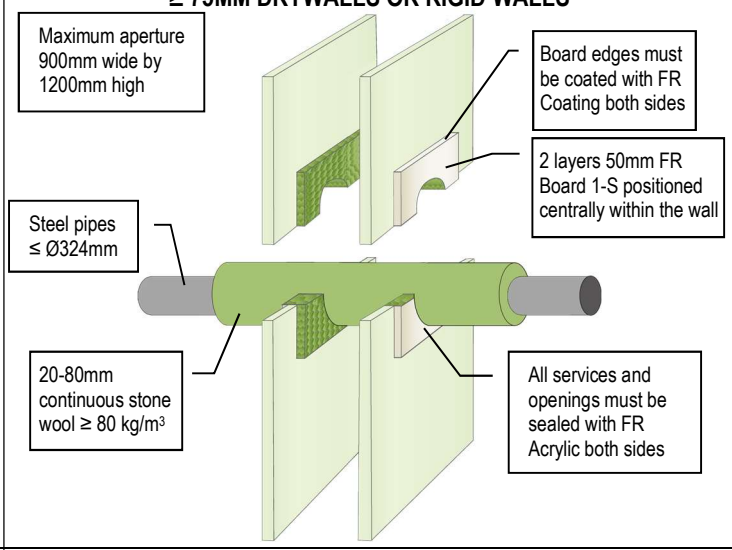

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

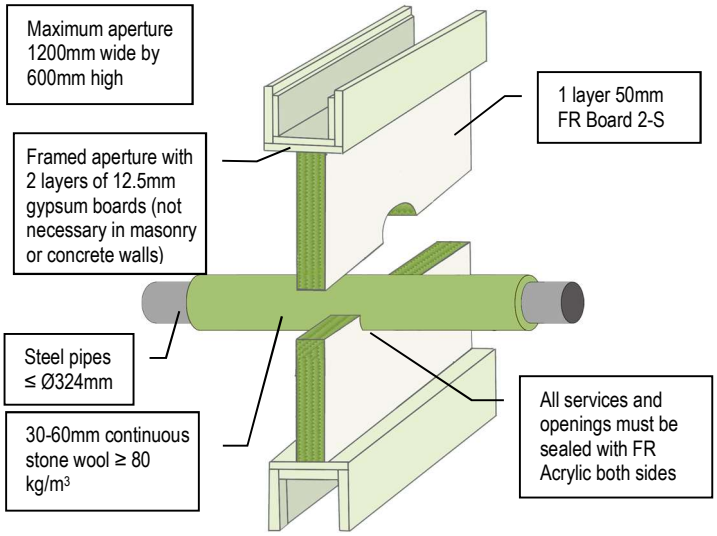

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

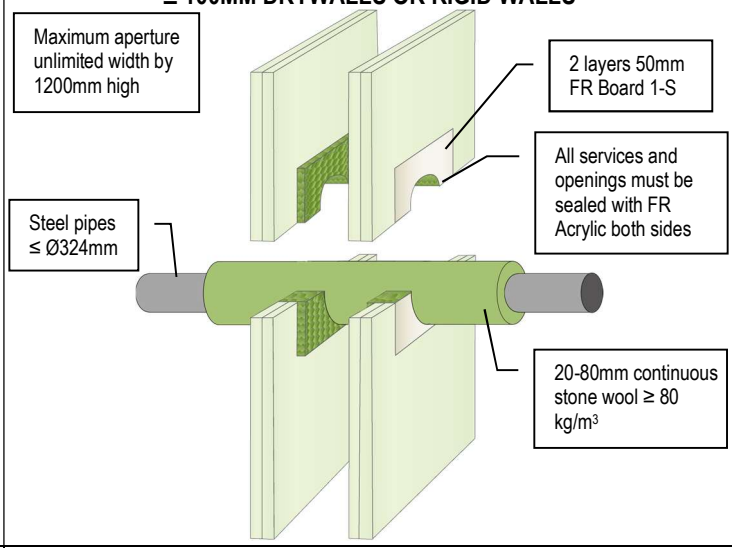

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

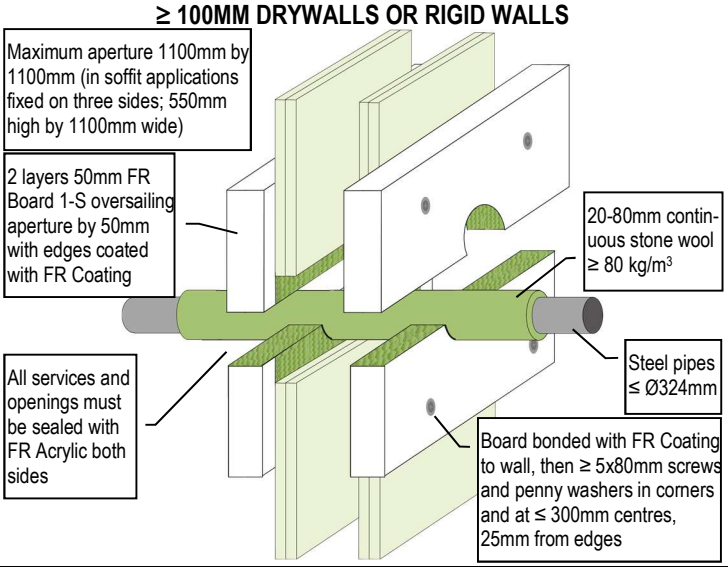

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

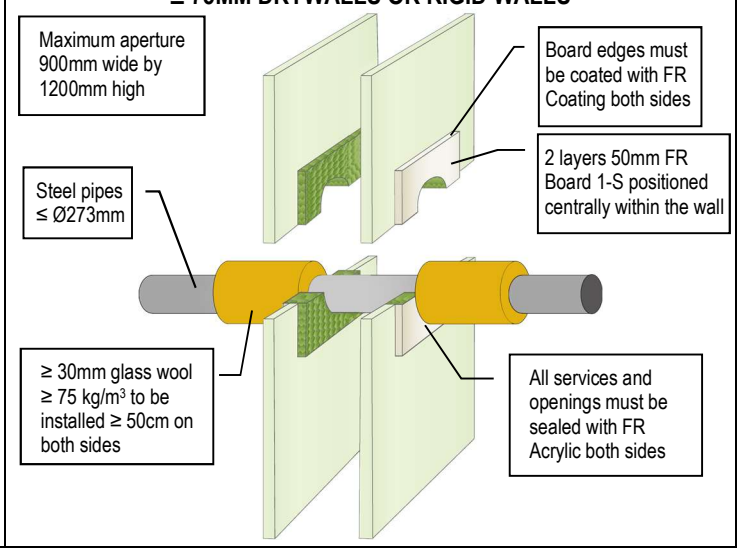

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
9 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

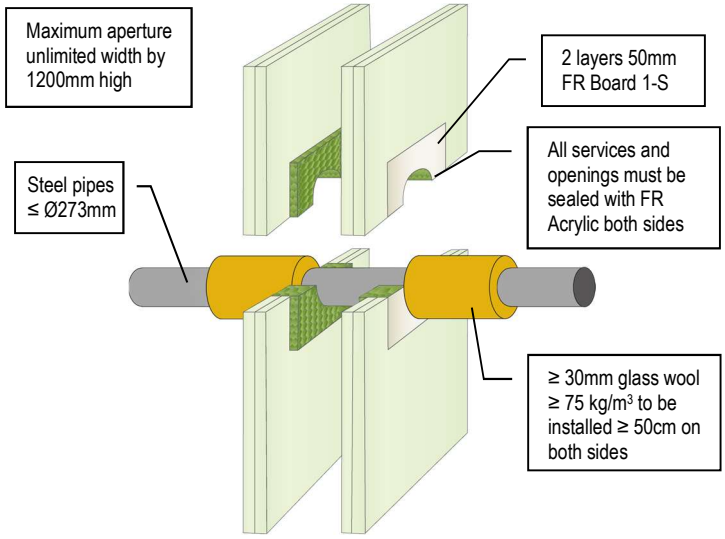

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

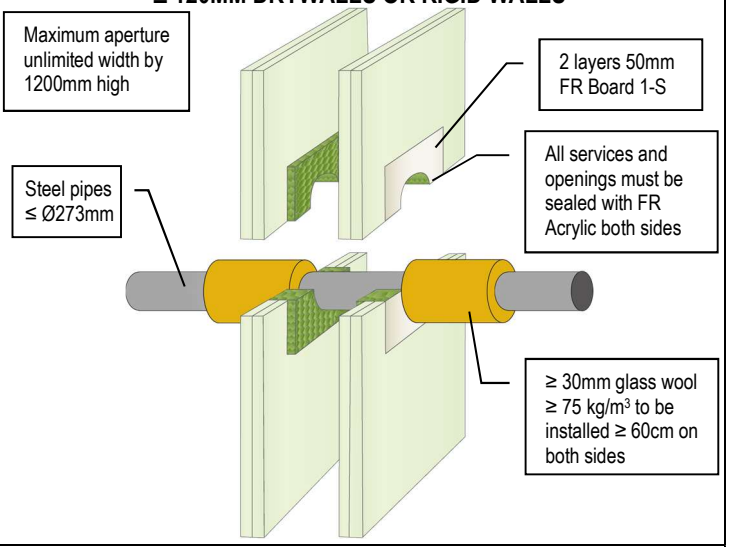

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

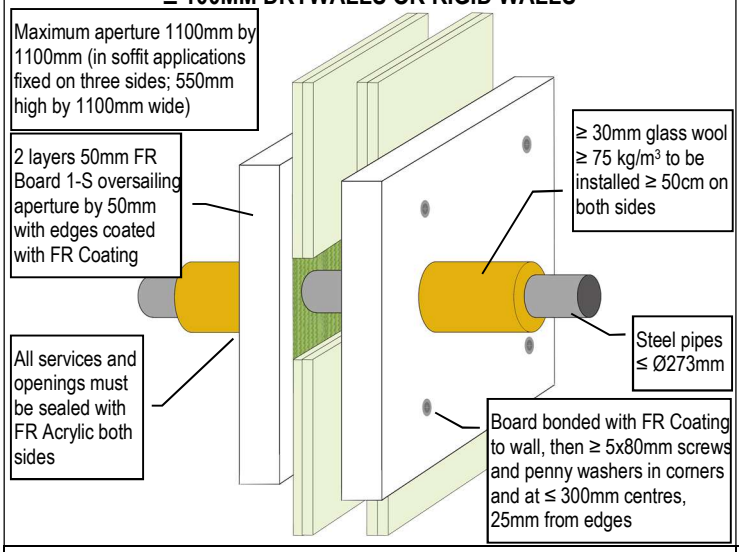

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

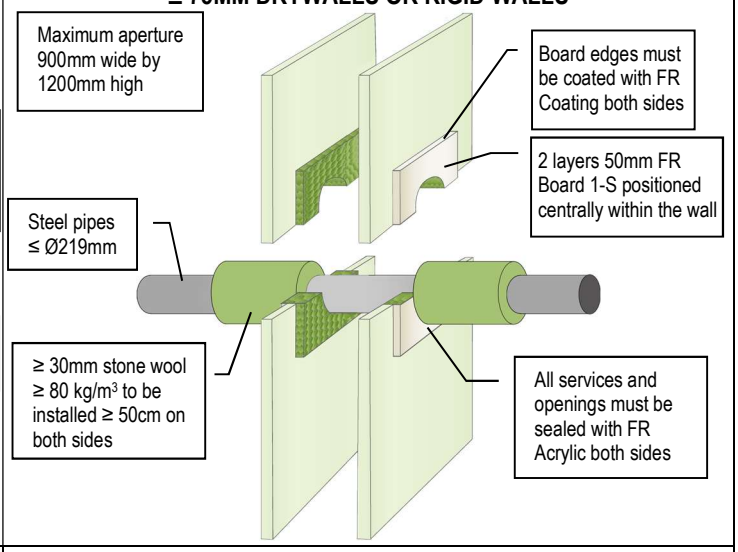

STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

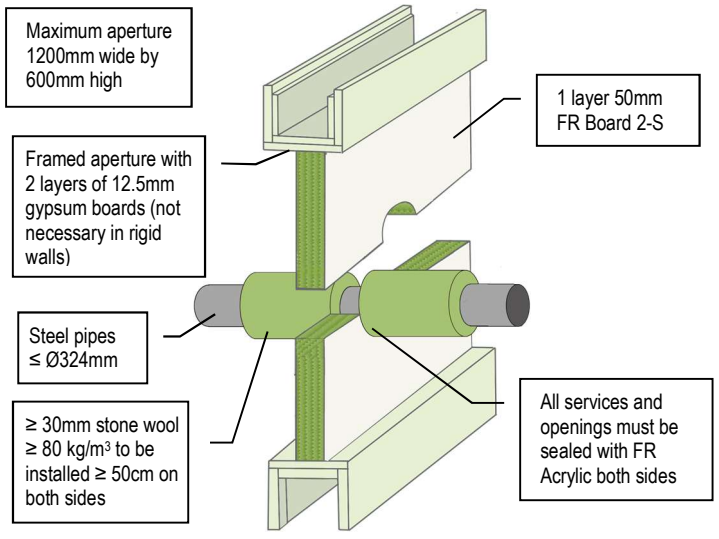

STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

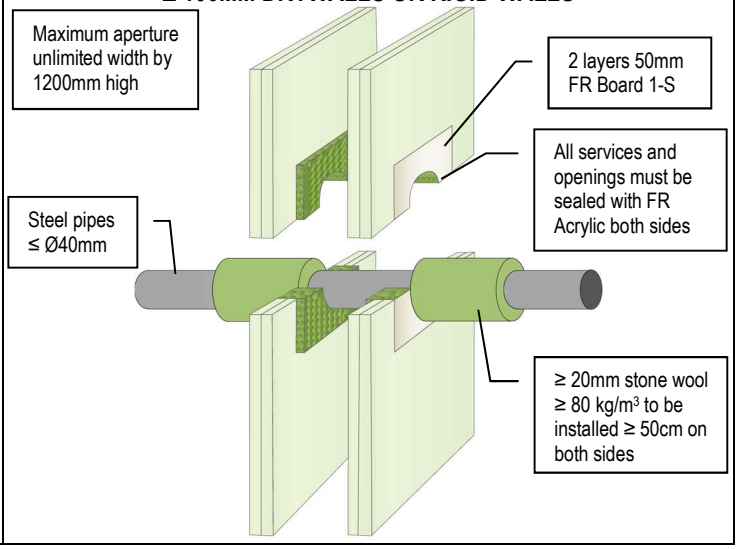

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
10 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

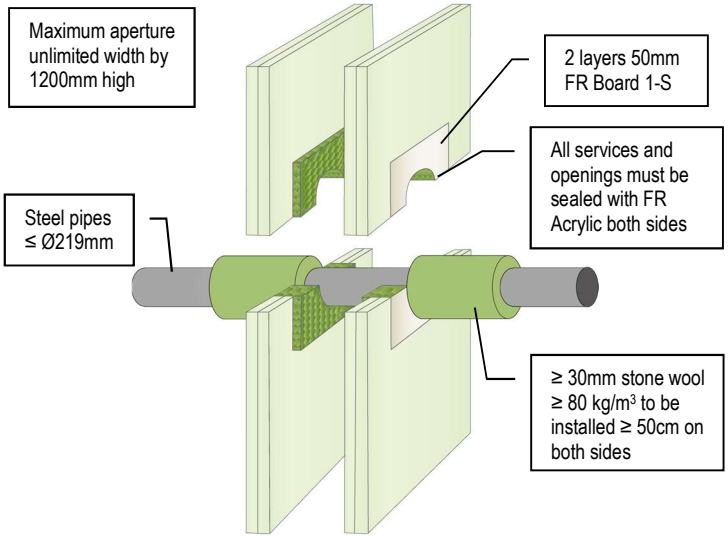

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

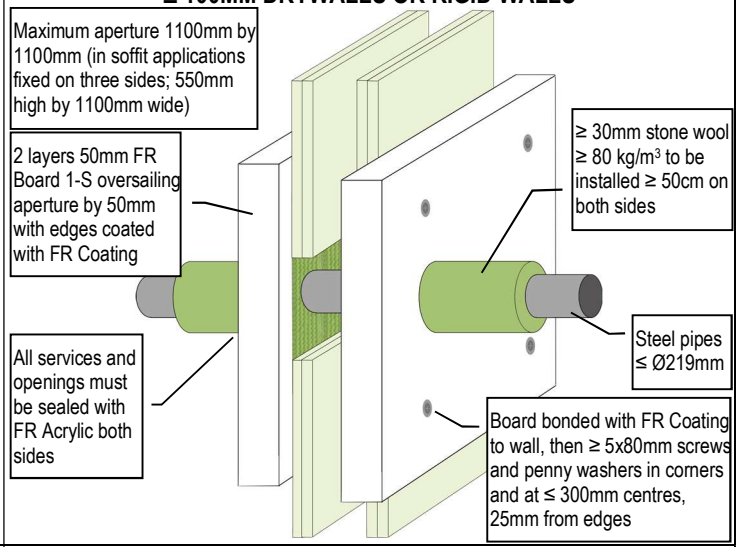

GAS PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

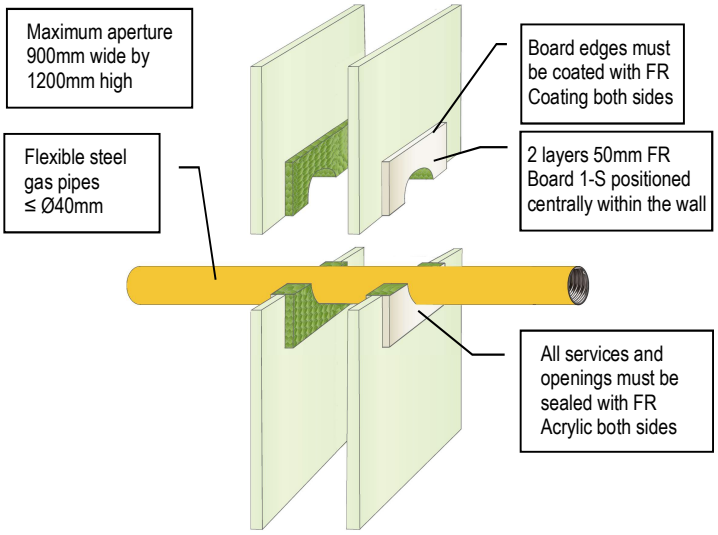

GAS PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

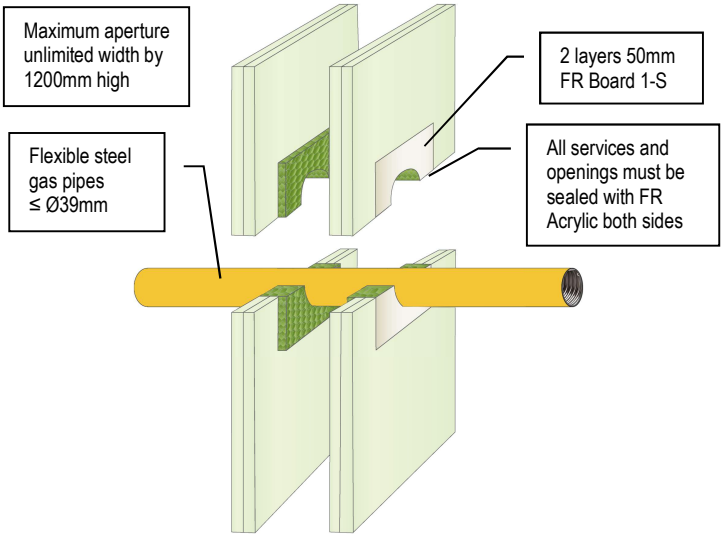

GAS PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

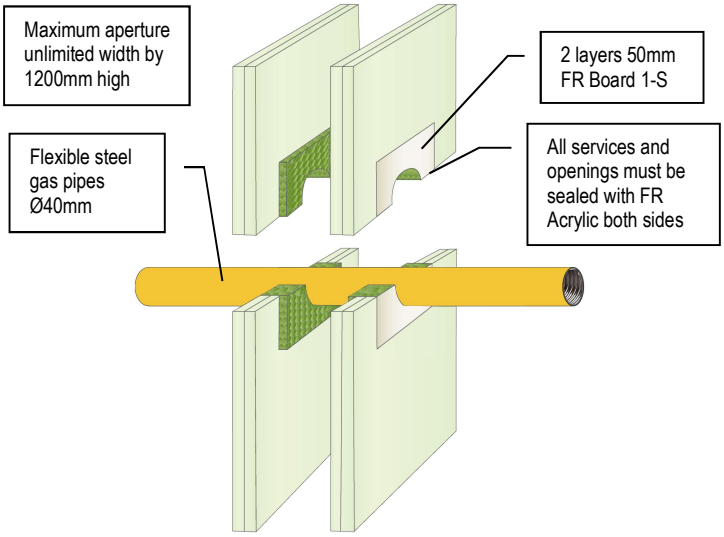

GAS PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

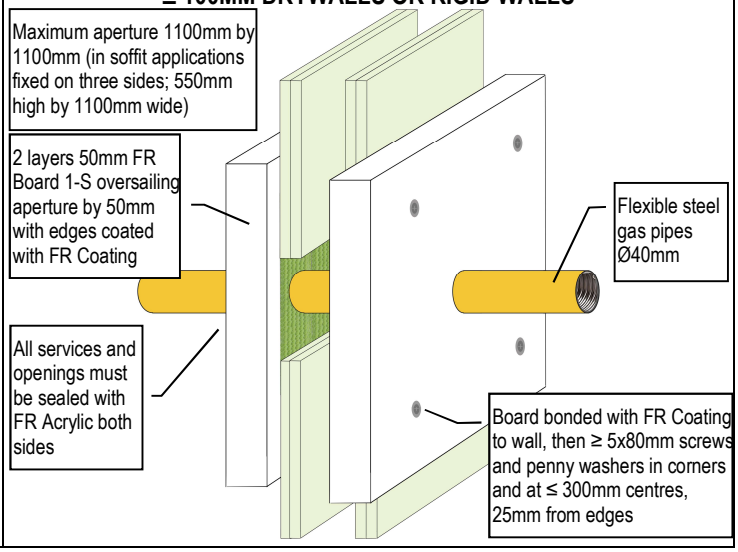

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
11 (86) 2025 2 7

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

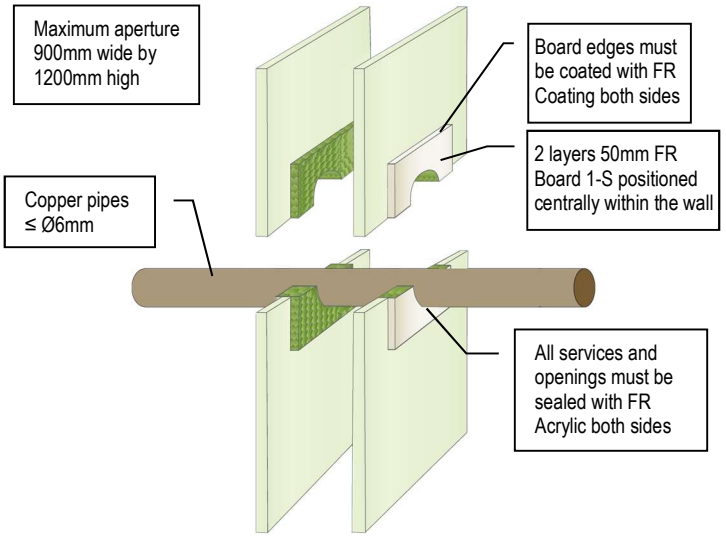

COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

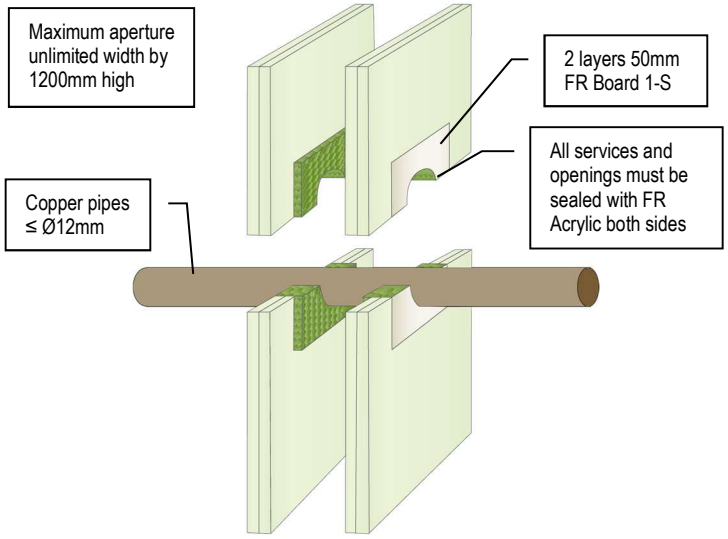

COPPER PIPES FIRE RESISTANCE EI 15 C/C (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

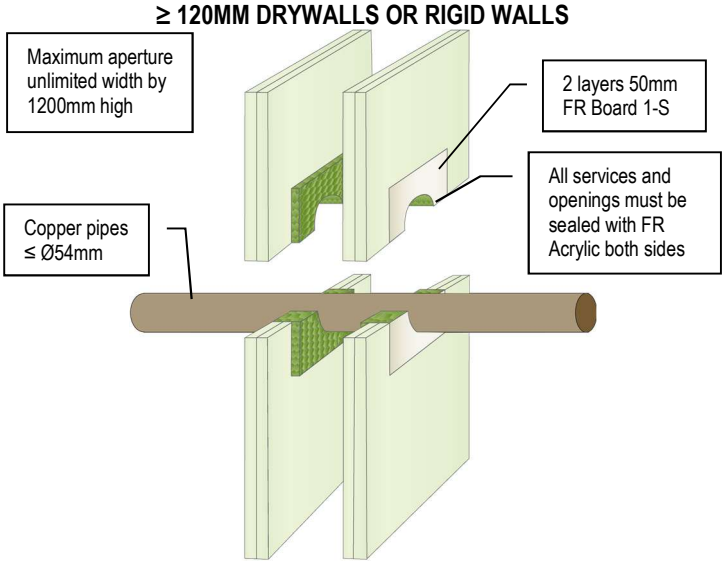

COPPER PIPES FIRE RESISTANCE EI 15 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

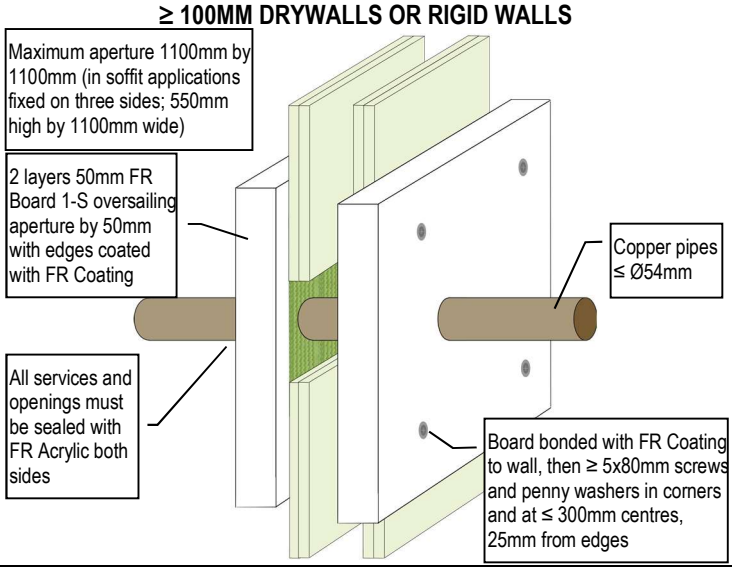

COPPER & STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

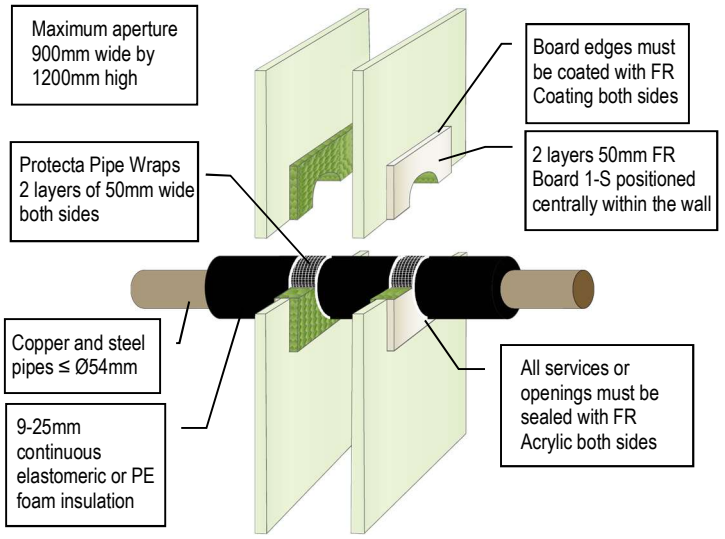

COPPER & STEEL PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

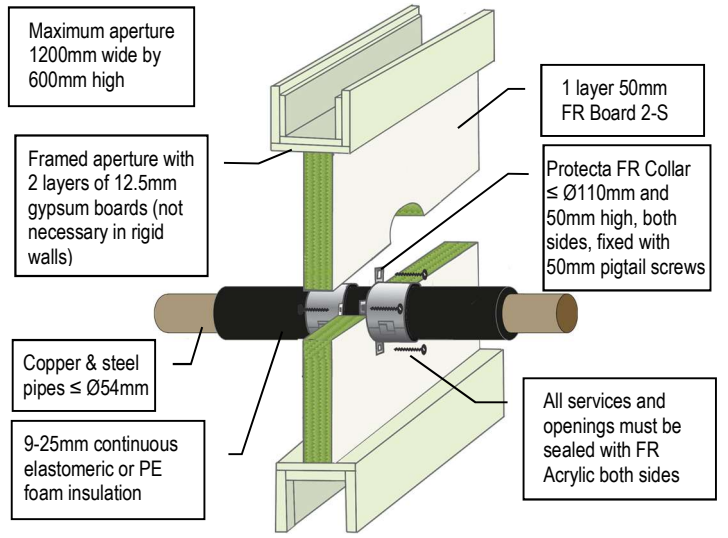

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
12 (86) 2025 2 7

COPPER & STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

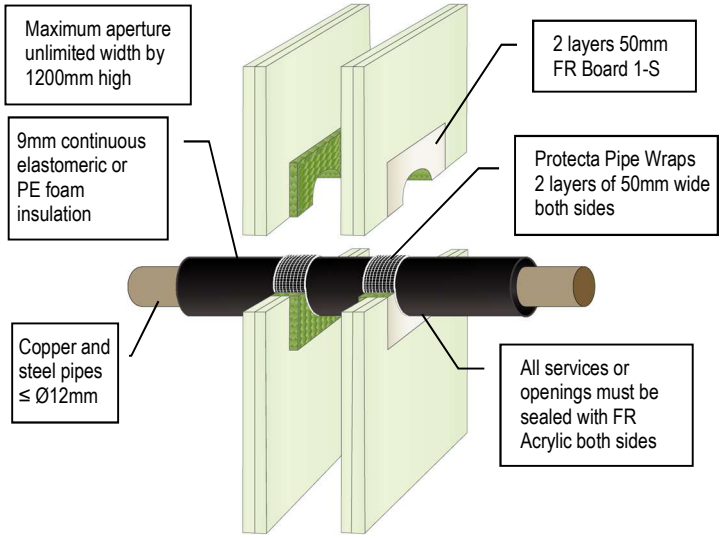

COPPER & STEEL PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

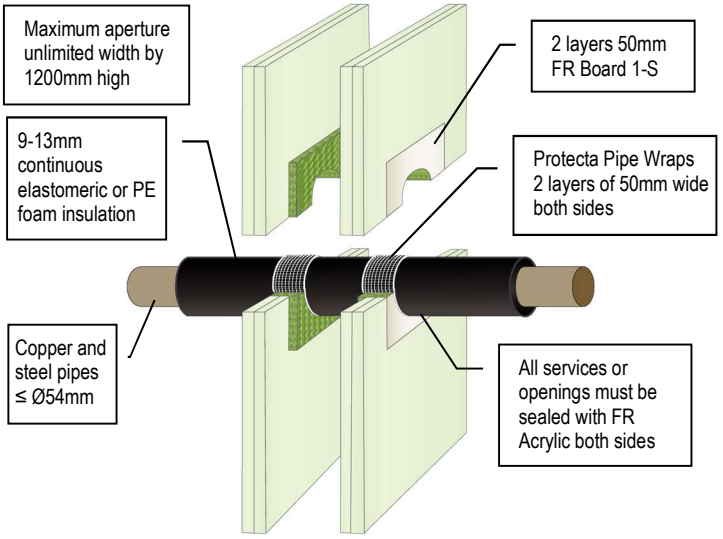

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

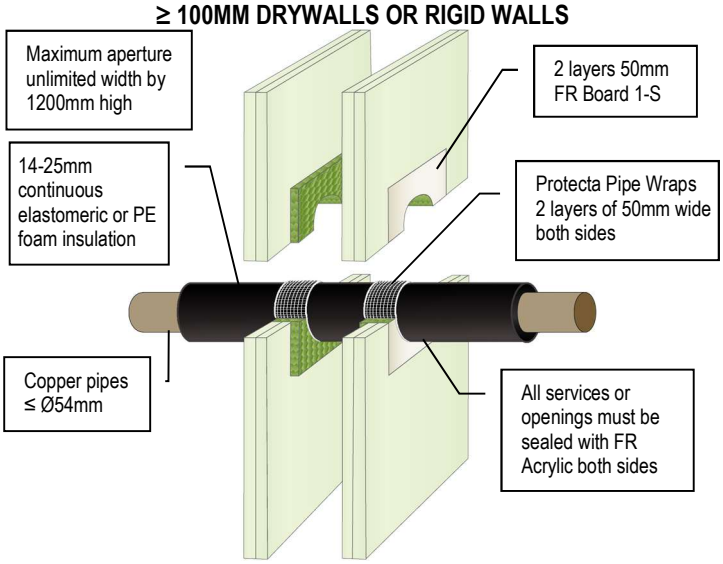

COPPER & STEEL PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

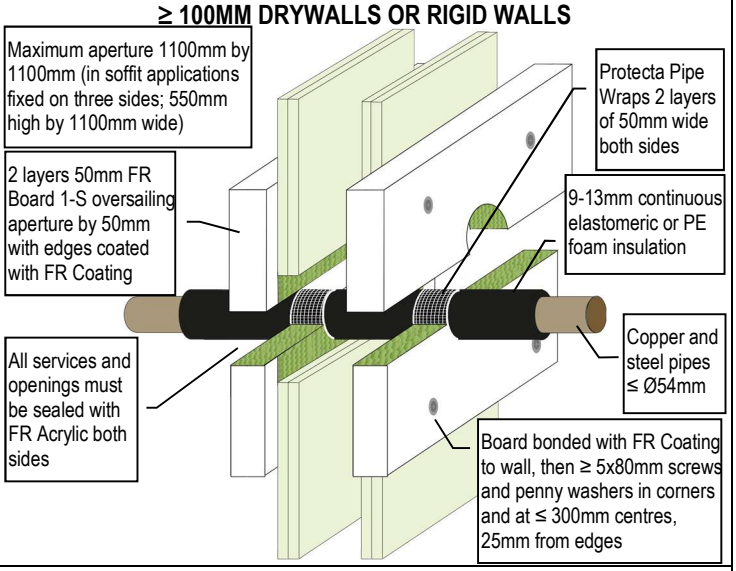

INSULATED COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

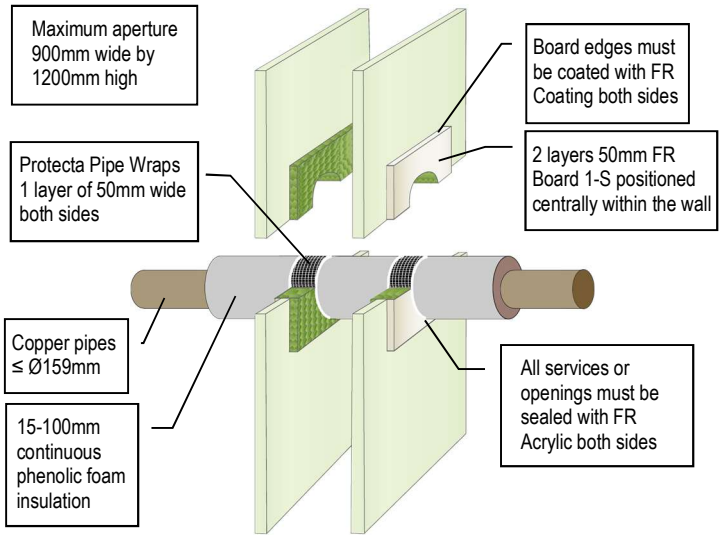

INSULATED COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

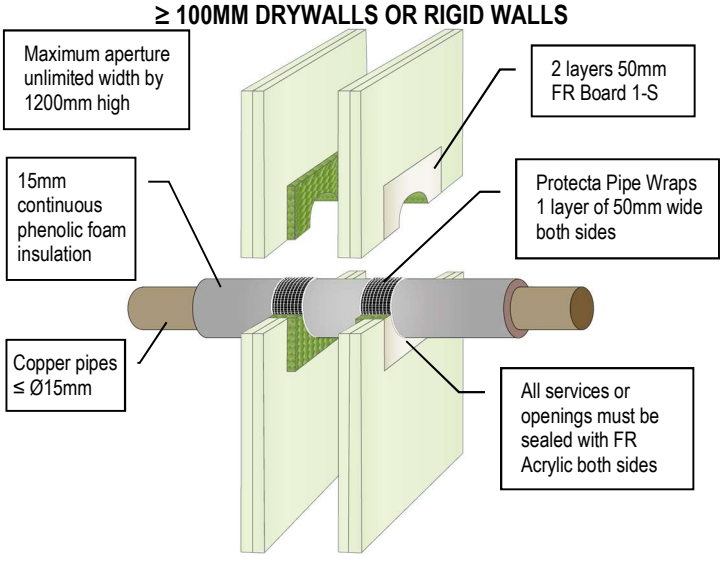

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
13 (86) 2025 2 7

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

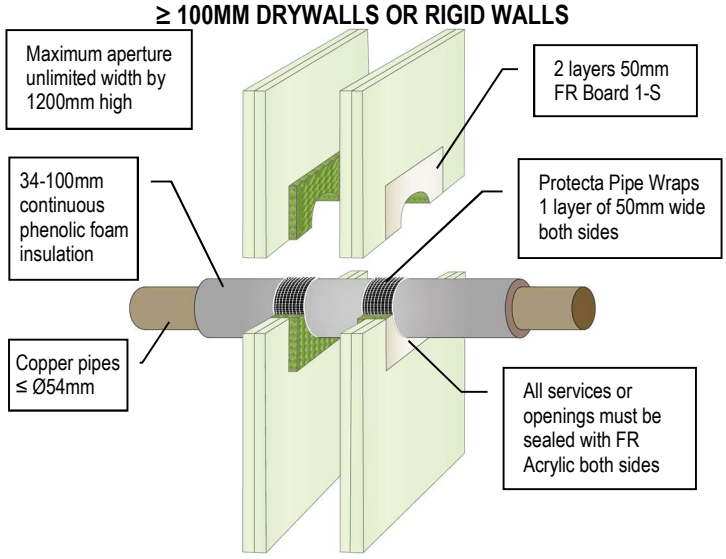

INSULATED COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

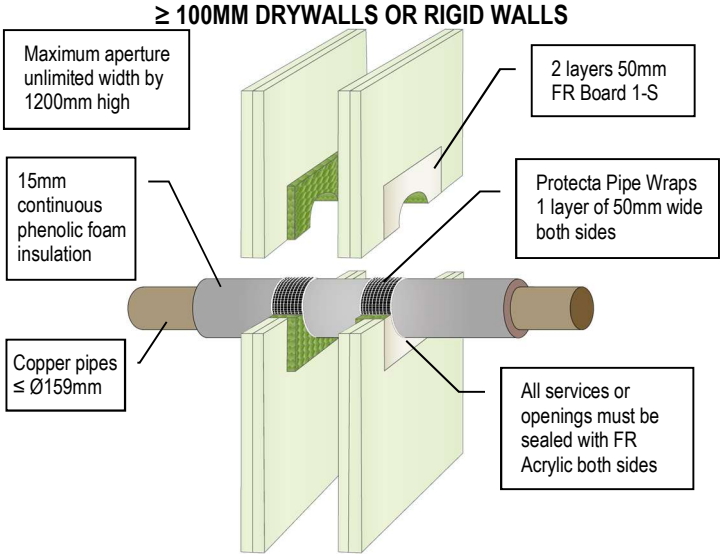

INSULATED COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

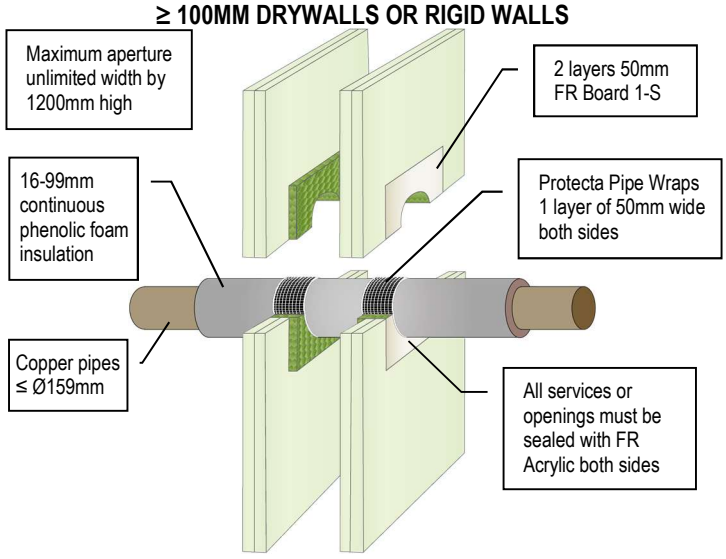

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

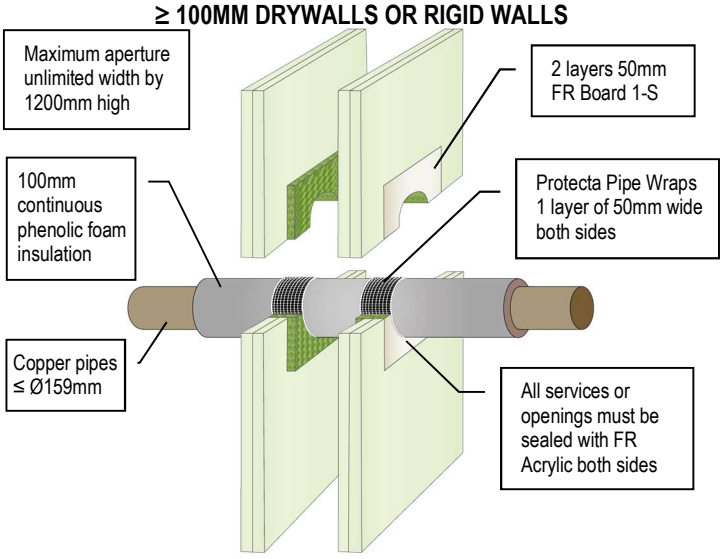

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

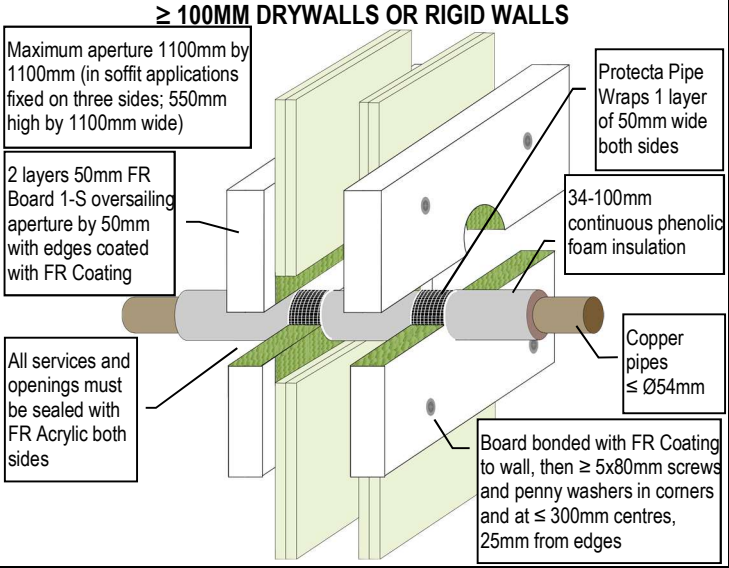

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

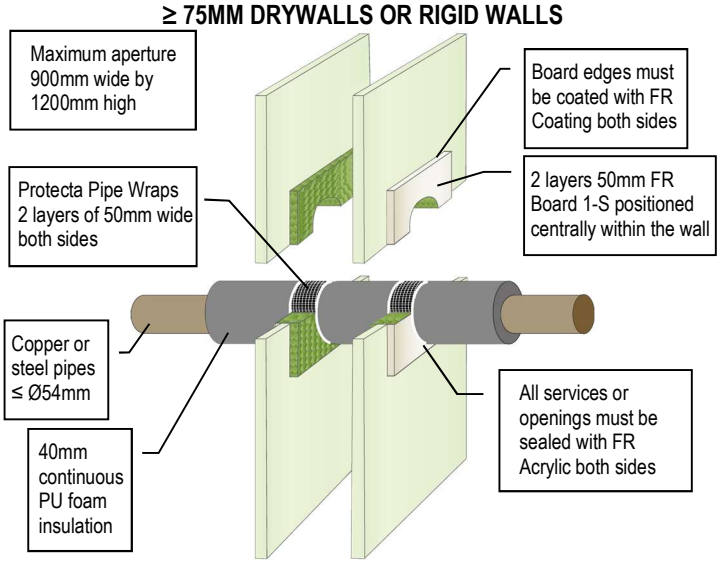

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
14 (86) 2025 2 7

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

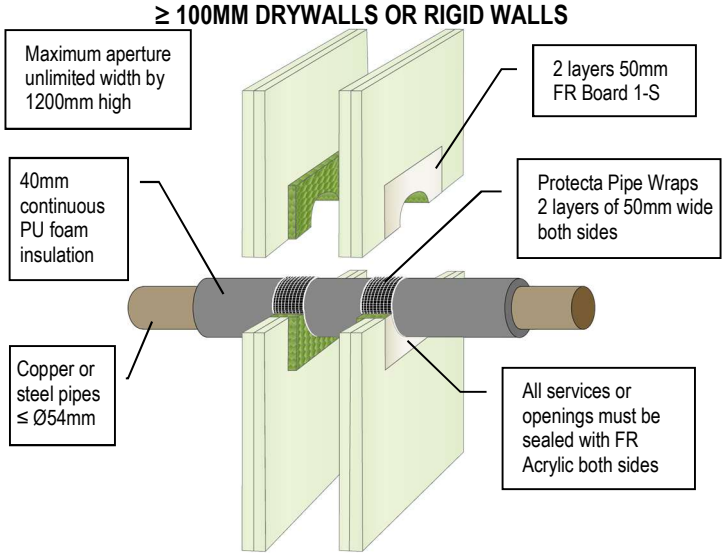

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

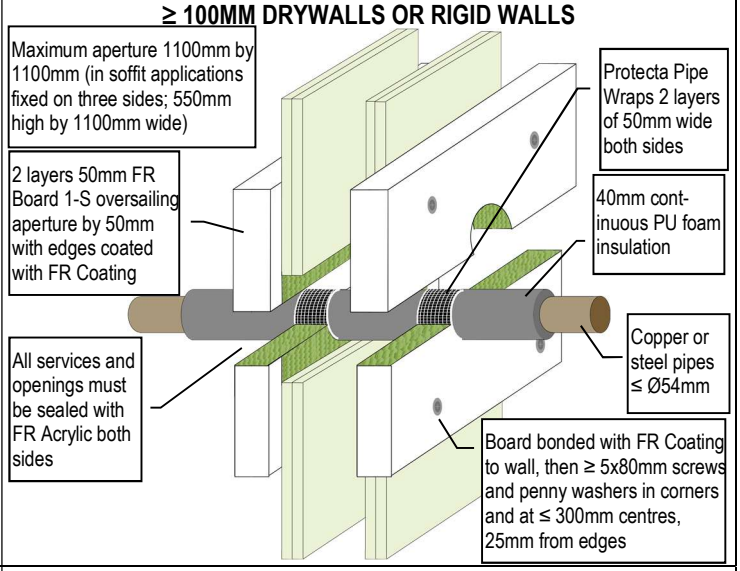

COPPER & STEEL PIPES FIRE RESISTANCE EI 45 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

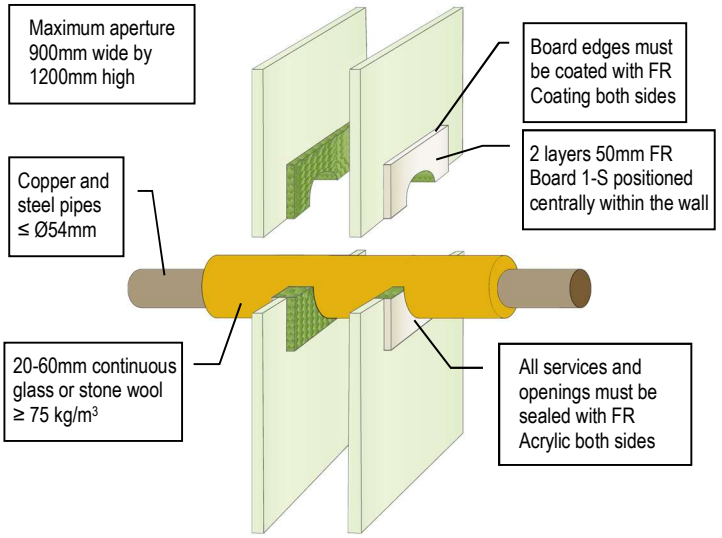

COPPER & STEEL PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

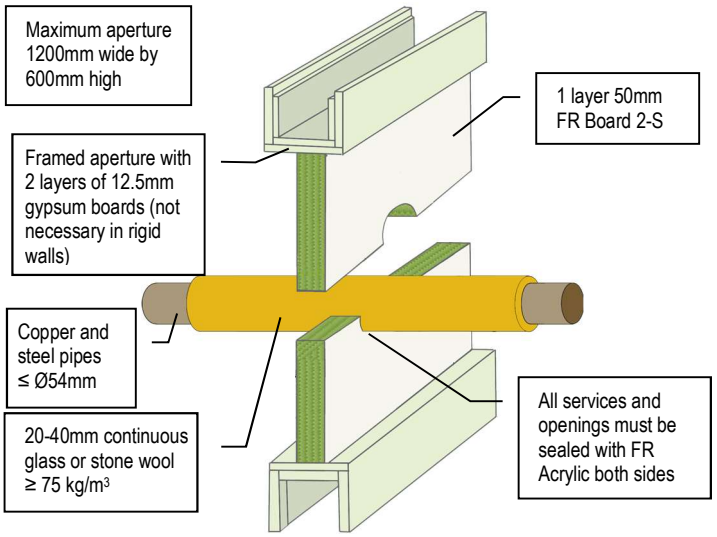

COPPER & STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

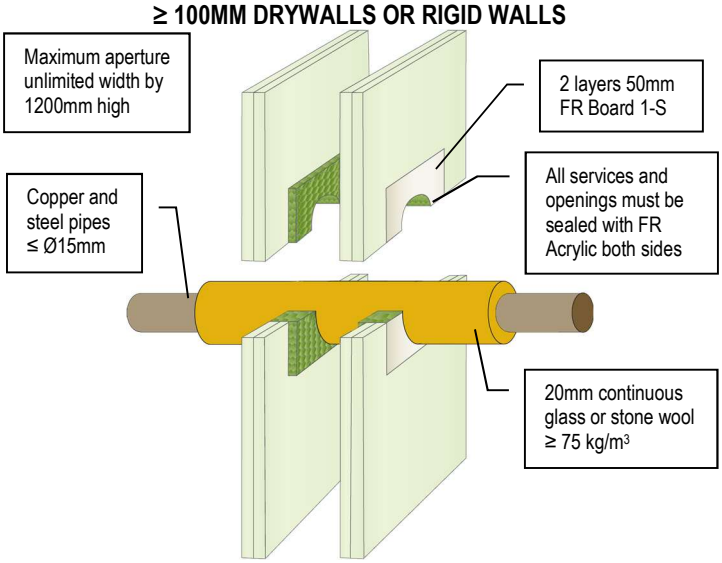

COPPER & STEEL PIPES FIRE RESISTANCE EI 45 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

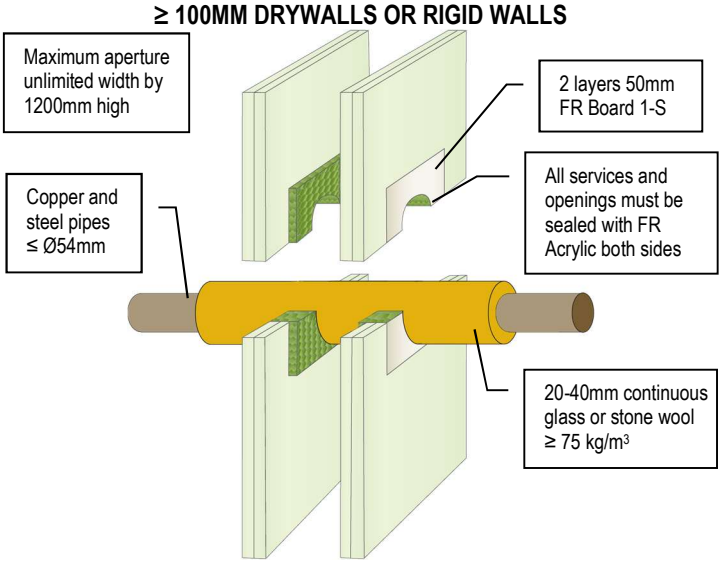

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
15 (86) 2025 2 7

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

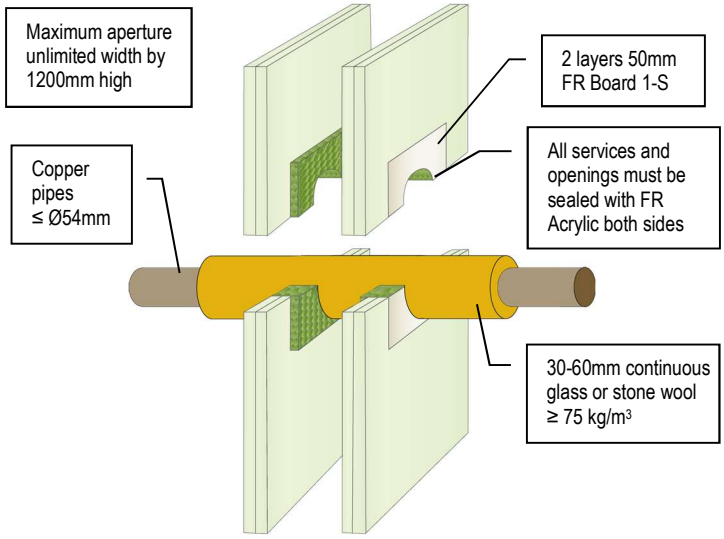

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

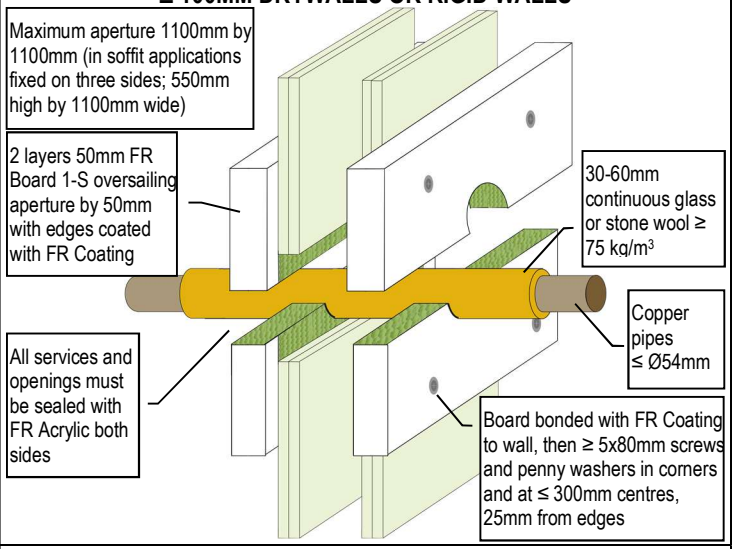

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

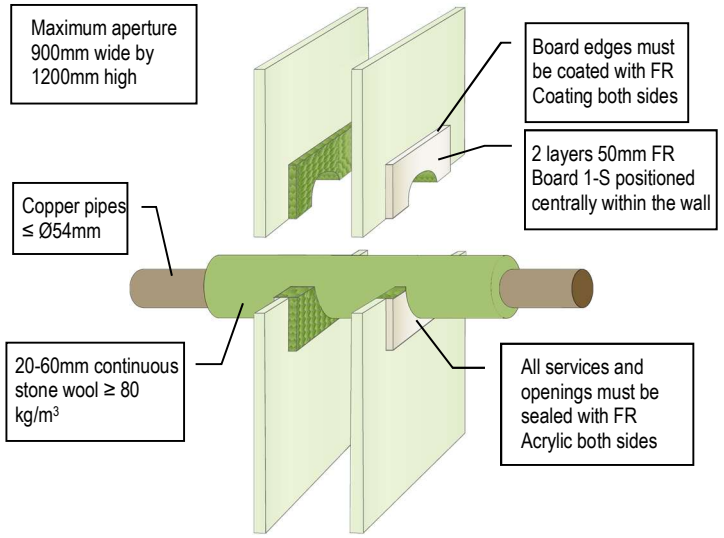

COPPER & STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

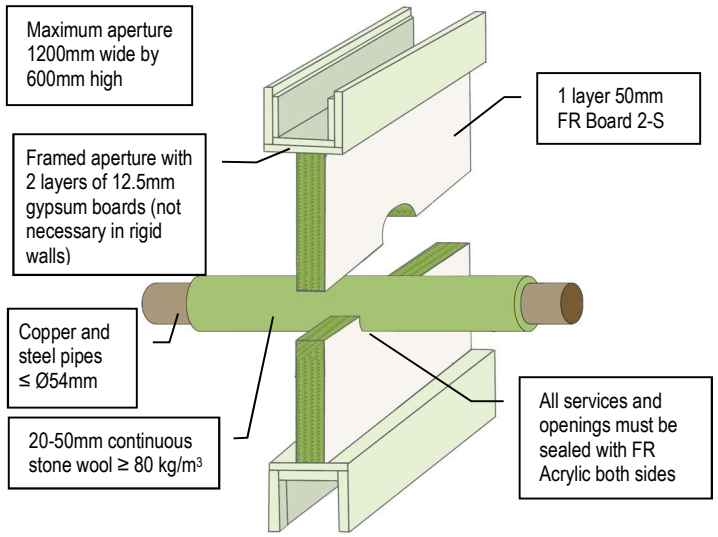

COPPER PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

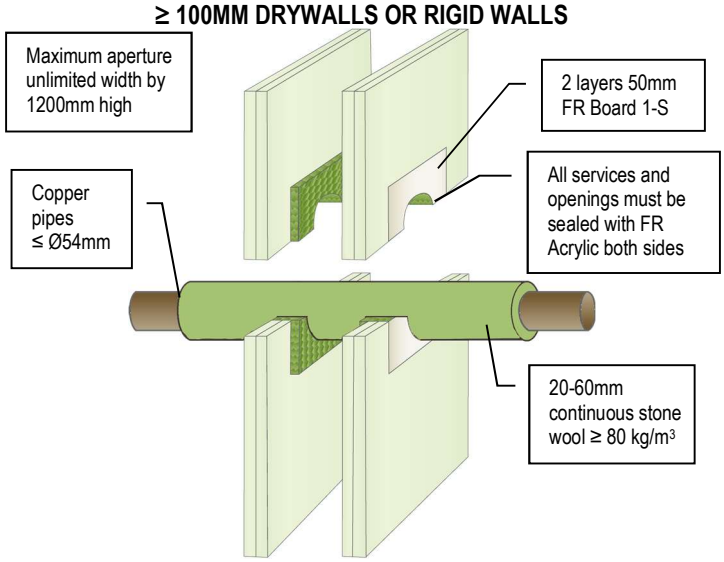

COPPER PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

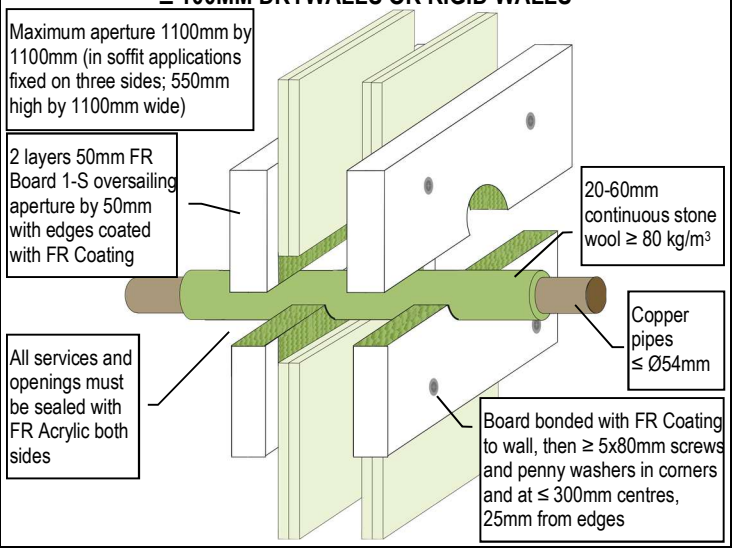

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
16 (86) 2025 2 7

COPPER OR STEEL PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

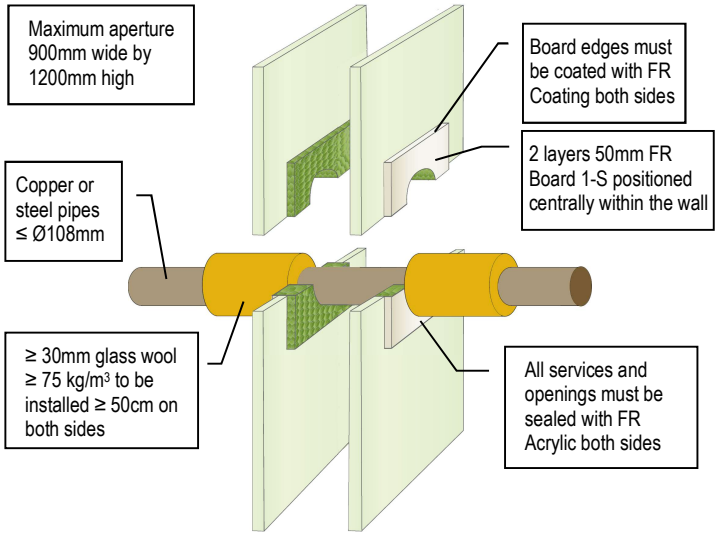

COPPER PIPES FIRE RESISTANCE EI 45 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

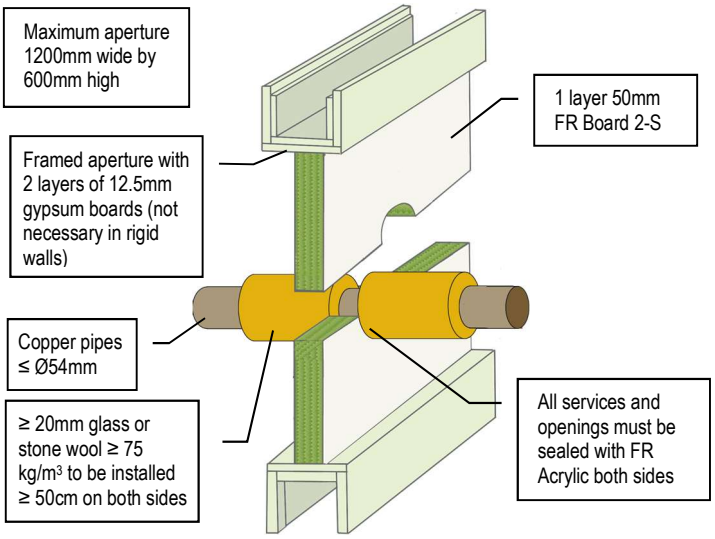

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

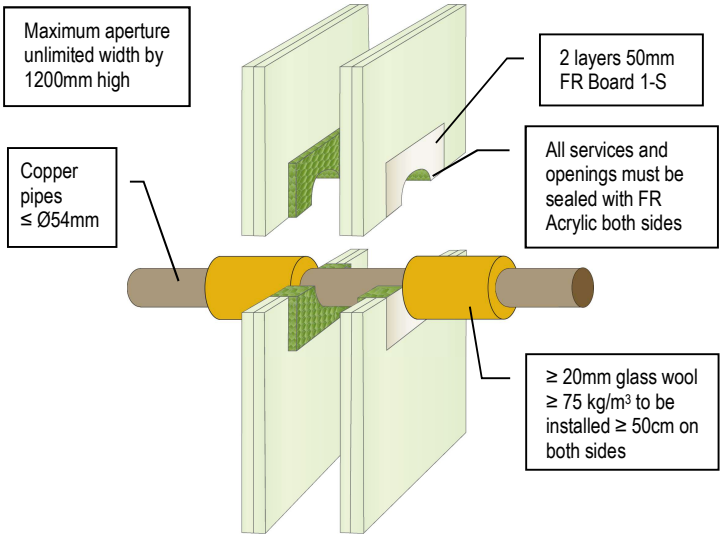

COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

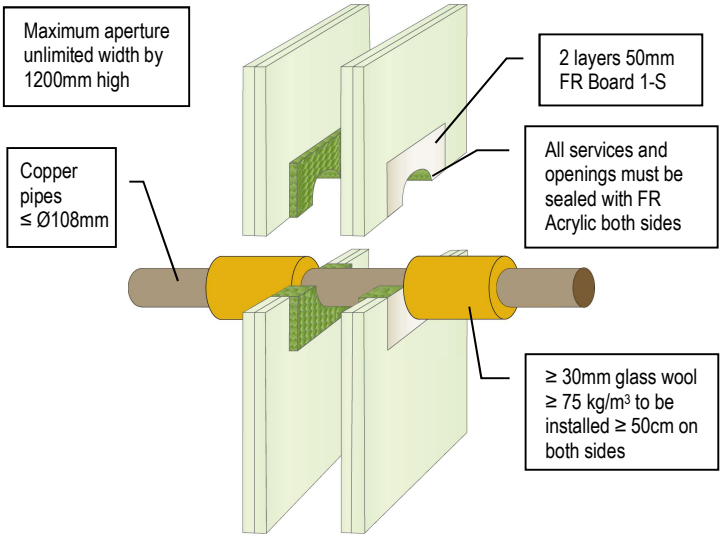

COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

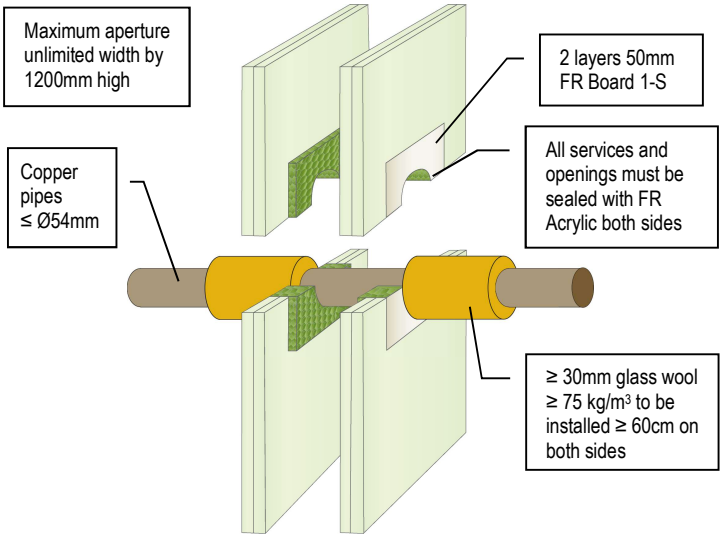

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

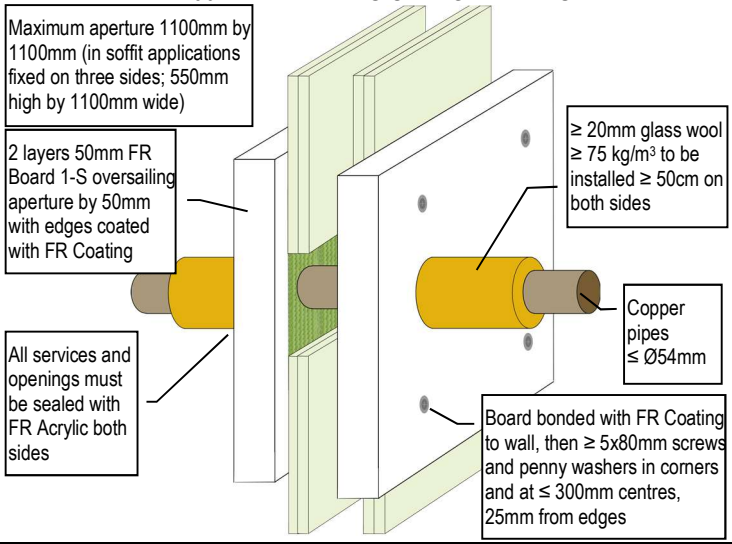

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
17 (86) 2025 2 7

COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

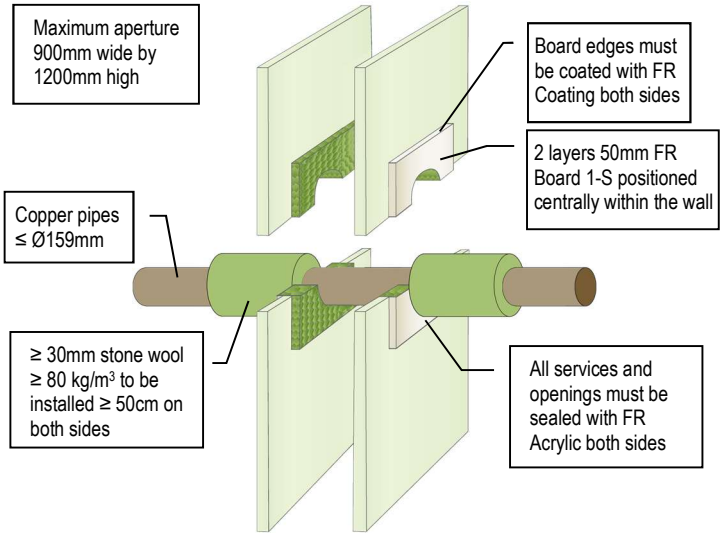

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

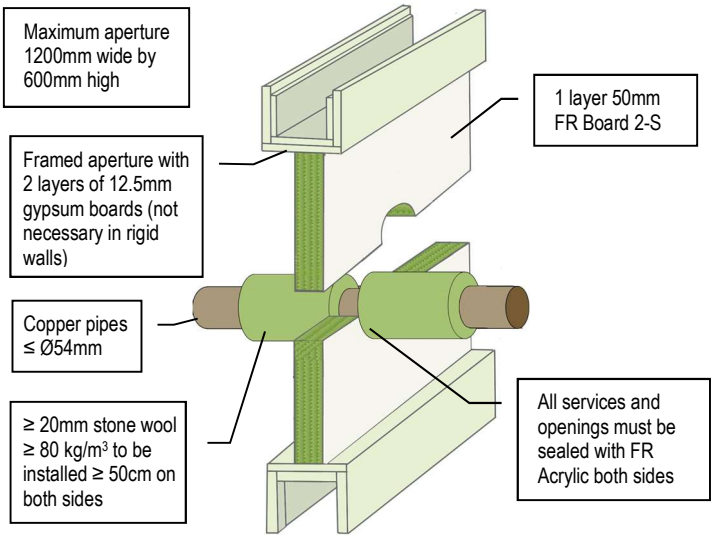

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

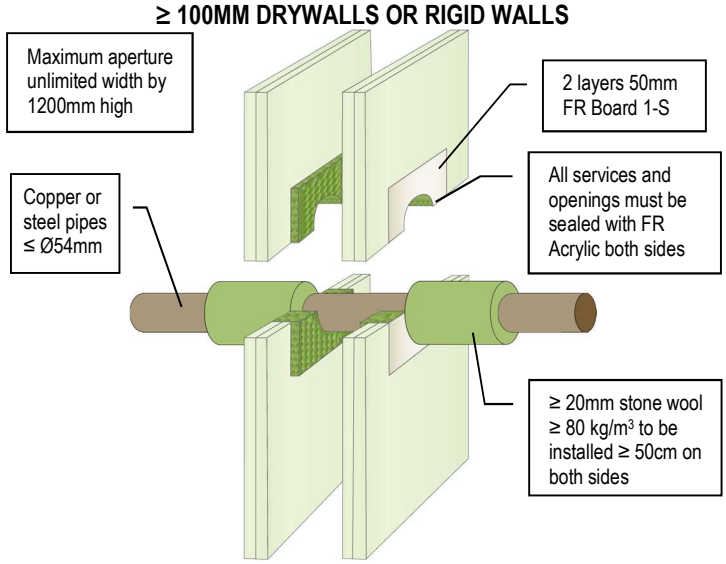

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

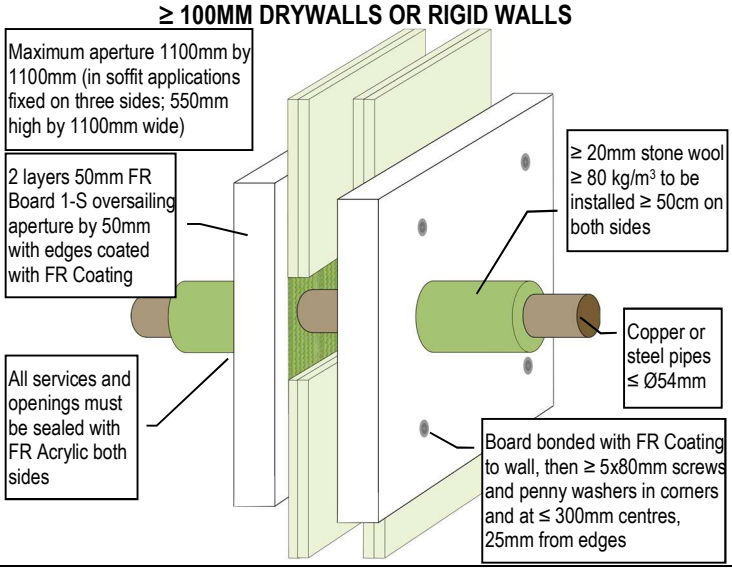

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

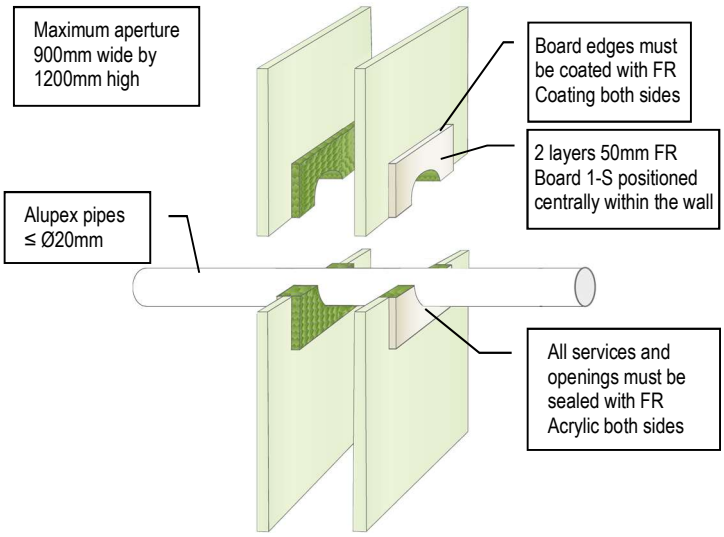

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

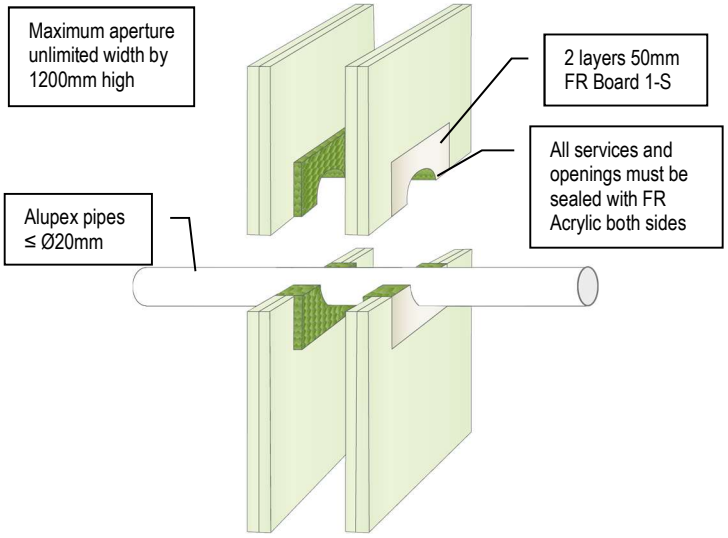

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
18 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 20 C/C (E 120)

≥ 120MM DRYWALLS OR RIGID WALLS

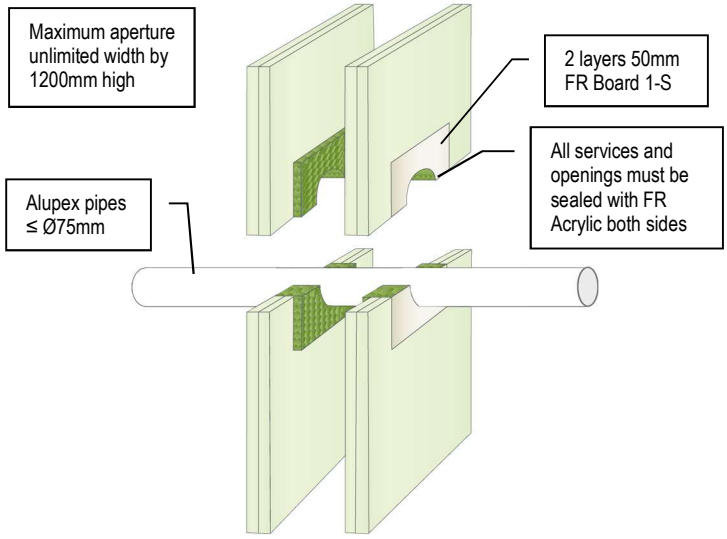

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

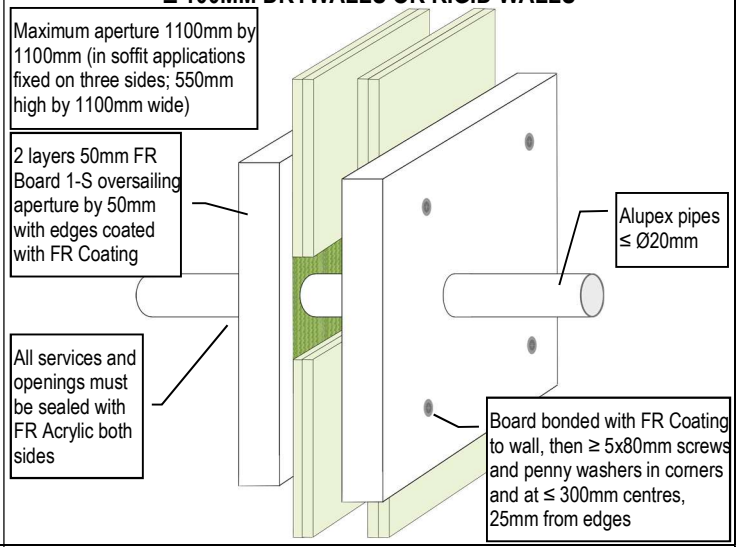

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

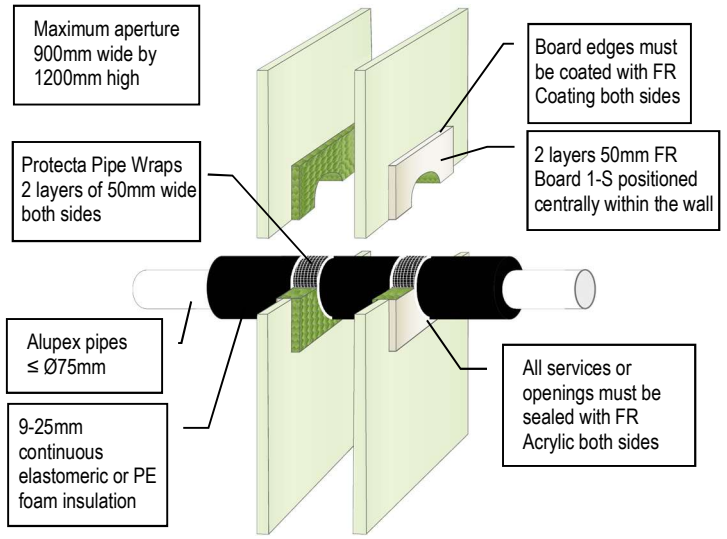

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

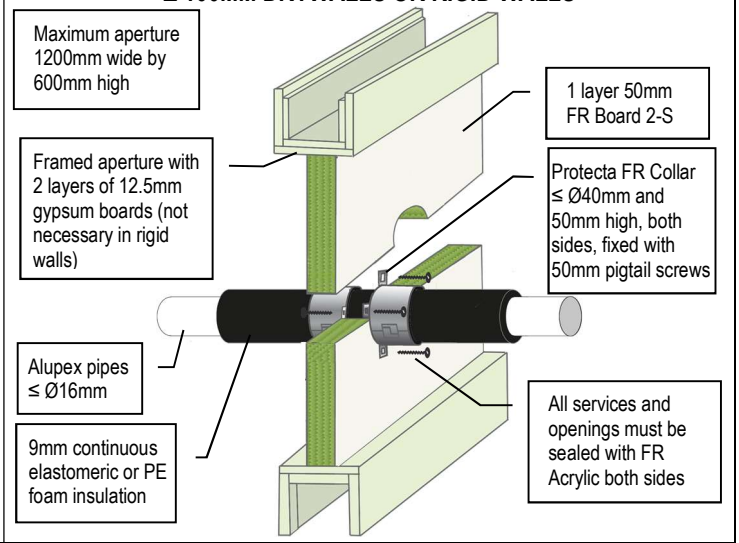

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

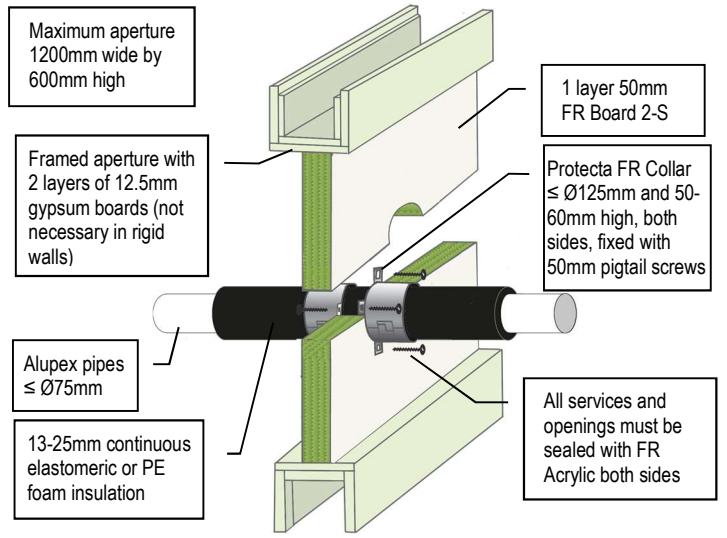

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

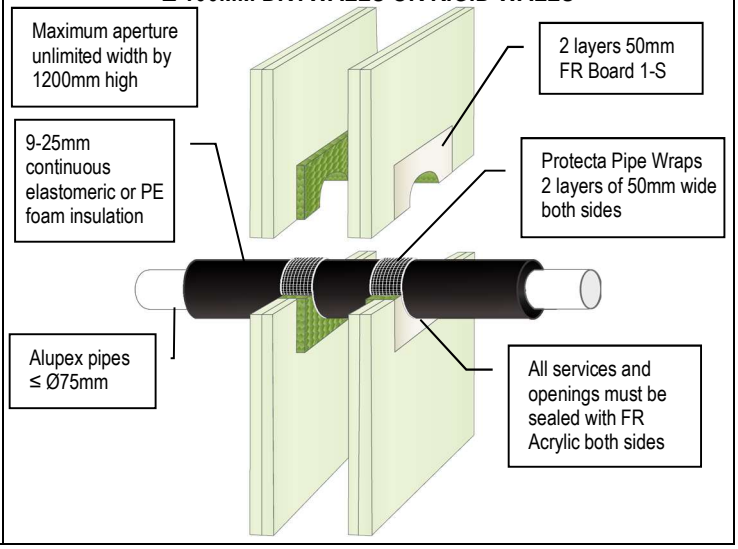

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
19 (86) 2025 2 7

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

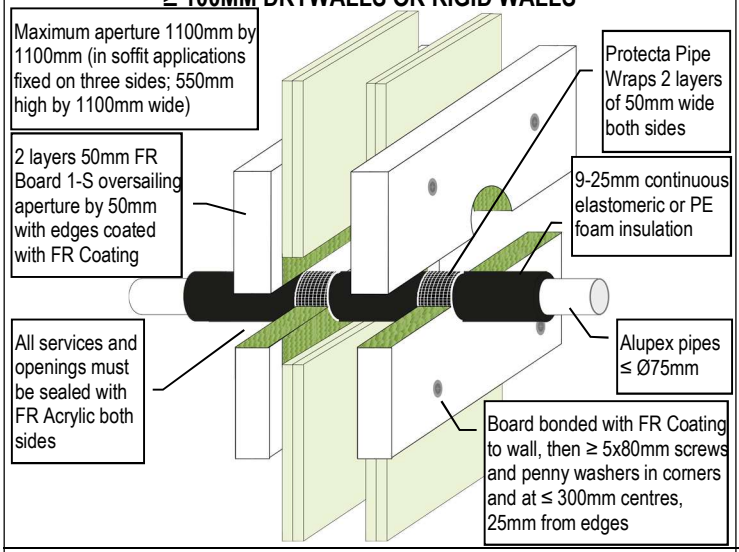

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

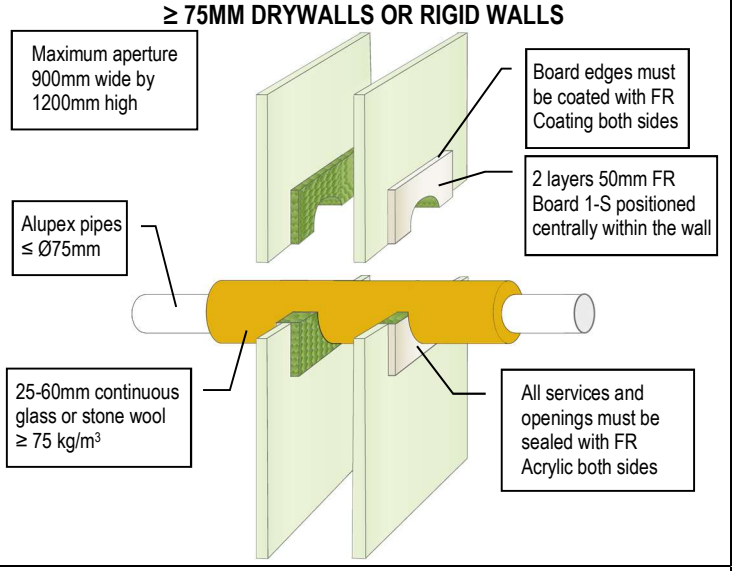

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

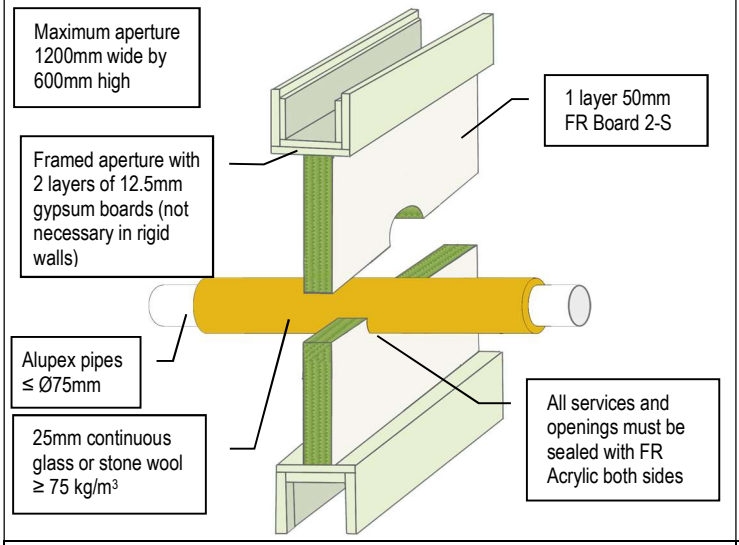

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

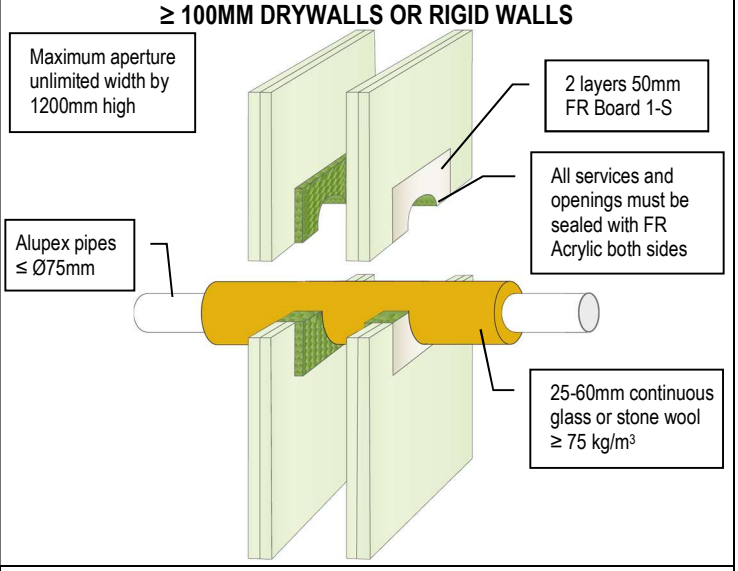

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

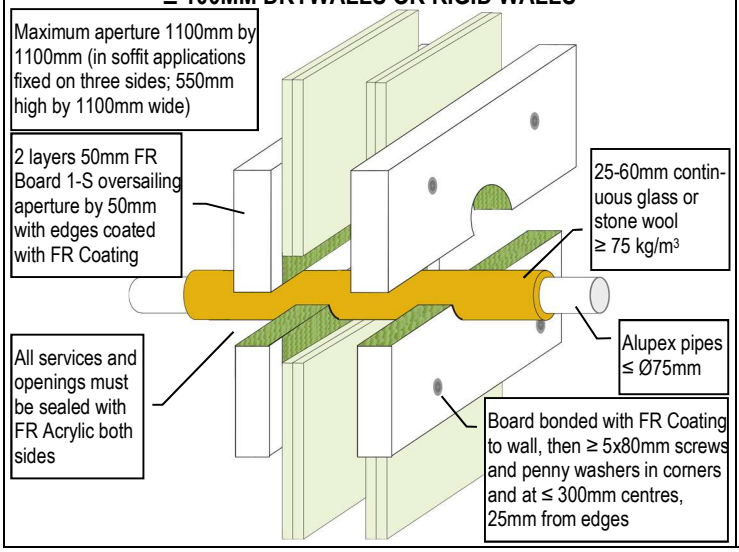

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

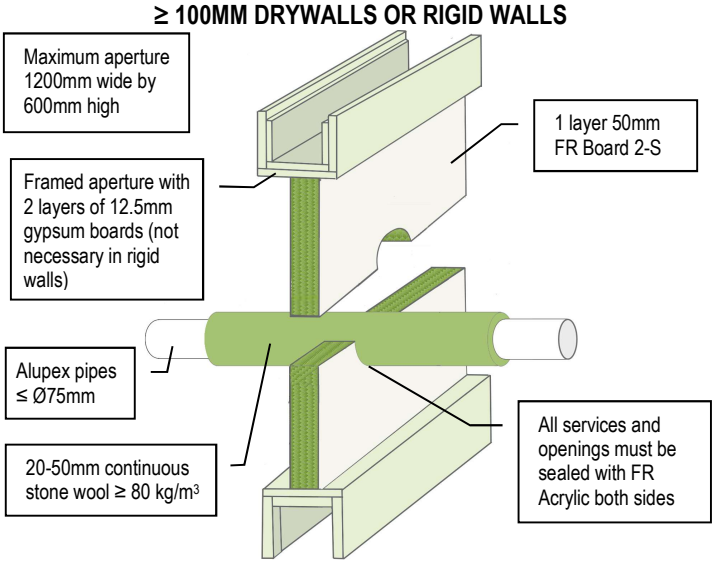

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
20 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

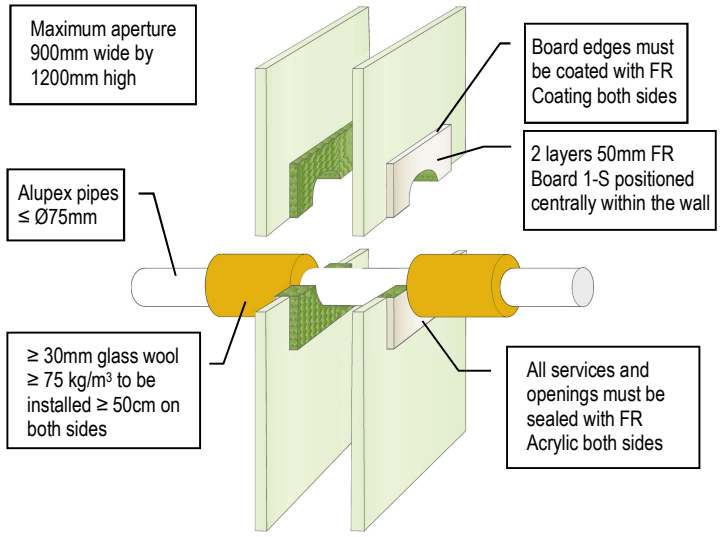

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

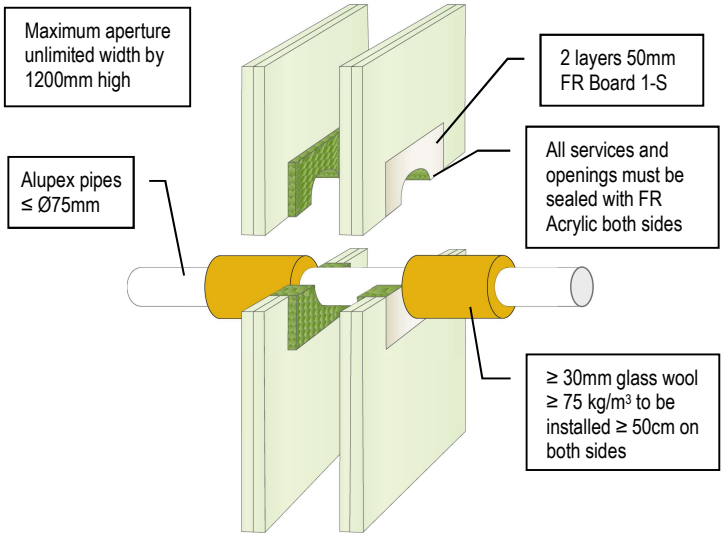

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

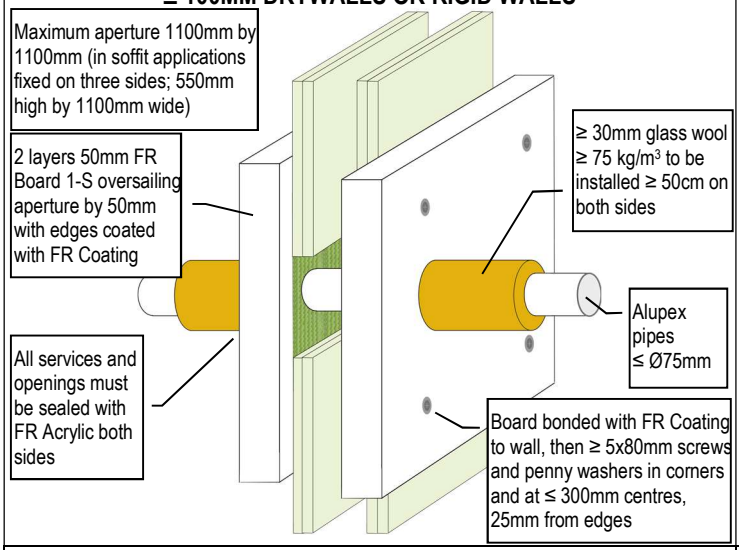

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

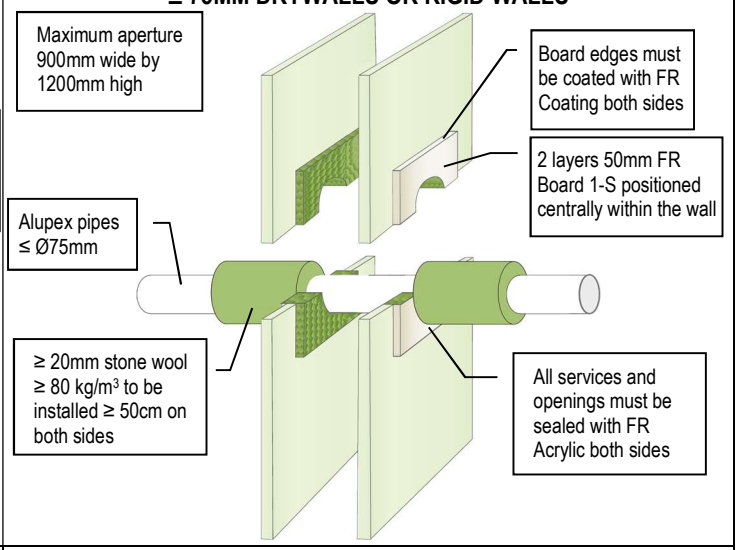

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

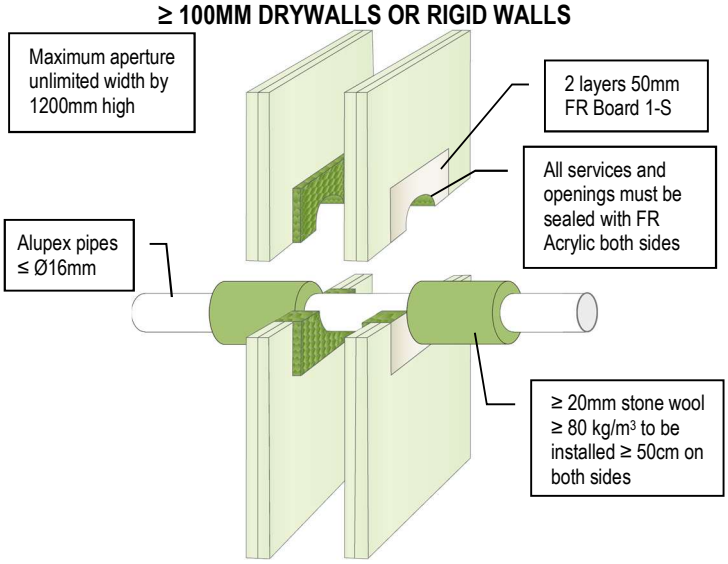

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

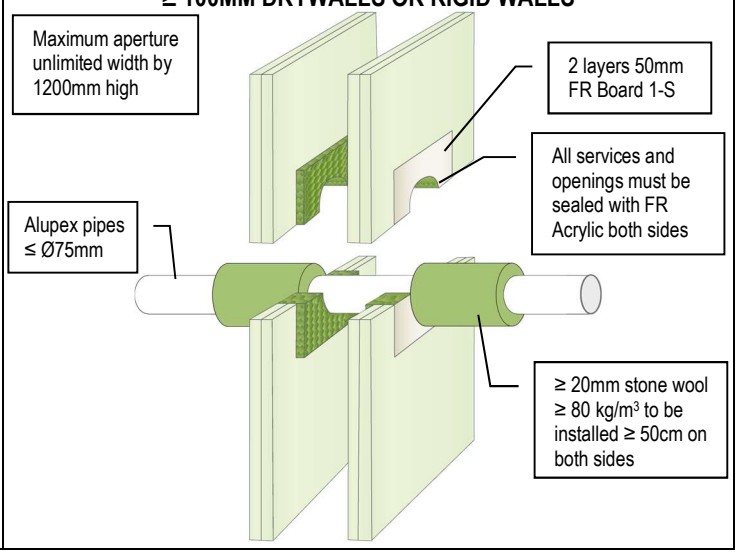

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
21 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

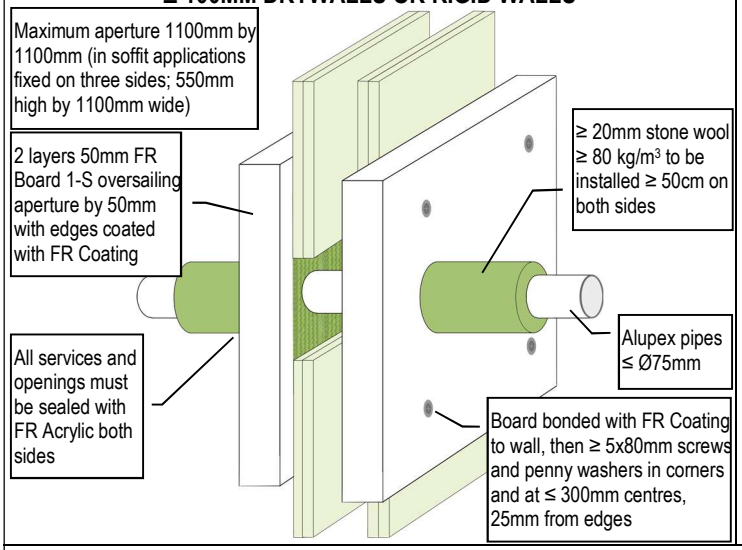

INSULATED METAL PIPES WITH FR GRAPHITE FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

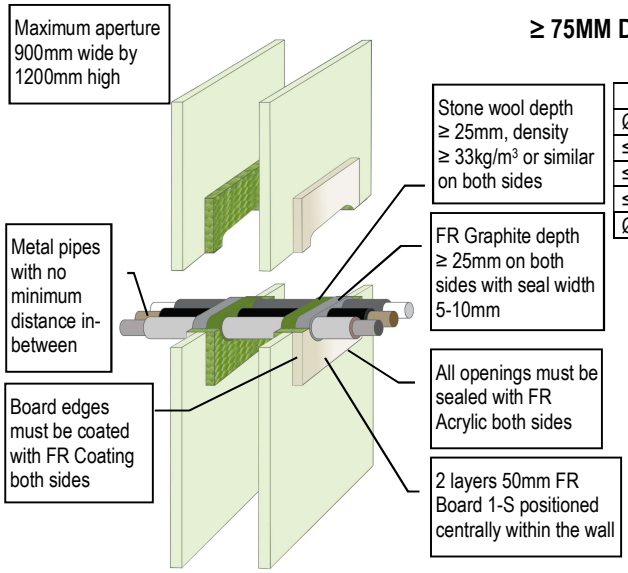

Services	Pipe Insulation	Classification
Ø6mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 60 C/C (E 60 C/C)
≤ Ø18mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 60 C/C (E 60 C/C)
≤ Ø54mm steel or copper pipes	19mm elastomeric insulation class ≥ B-s3, d0	EI 60 C/C (E 60 C/C)
≤ Ø54mm steel or copper pipes	25mm phenolic foam insulation	EI 60 C/C (E 60 C/C)
Ø14mm alupex pipes	6mm PE foam insulation	EI 60 C/C (E 60 C/C)

INSULATED METAL PIPES WITH FR GRAPHITE FIRE RESISTANCE EI 60-120

≥ 100MM DRYWALLS OR RIGID WALLS

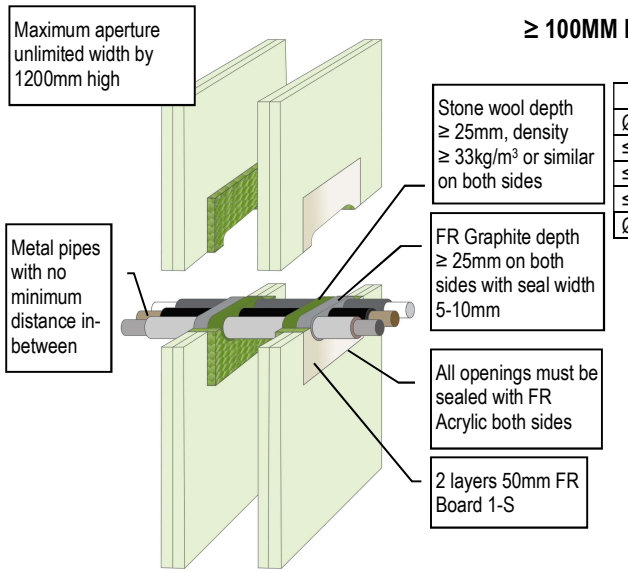

Services	Pipe Insulation	Classification
Ø6mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 120 C/C (E 120 C/C)
≤ Ø18mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	19mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	25mm phenolic foam insulation	EI 60 C/C (E 120 C/C)
Ø14mm alupex pipes	6mm PE foam insulation	EI 60 C/C (E 90 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED METAL PIPES WITH FR GRAPHITE FIRE RESISTANCE EI 60-120

≥ 100MM DRYWALLS OR RIGID WALLS

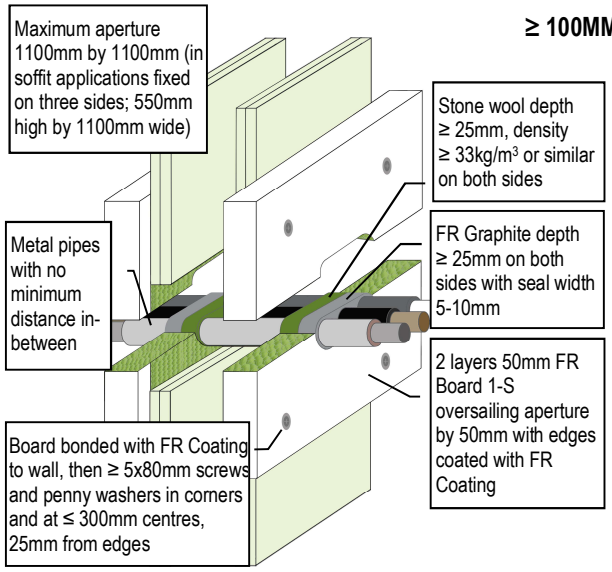

Services	Pipe Insulation	Classification
Ø6mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 120 C/C (E 120 C/C)
≤ Ø18mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	19mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	25mm phenolic foam insulation	EI 60 C/C (E 120 C/C)
Ø14mm alupex pipes	6mm PE foam insulation	EI 60 C/C (E 90 C/C)

PVC PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

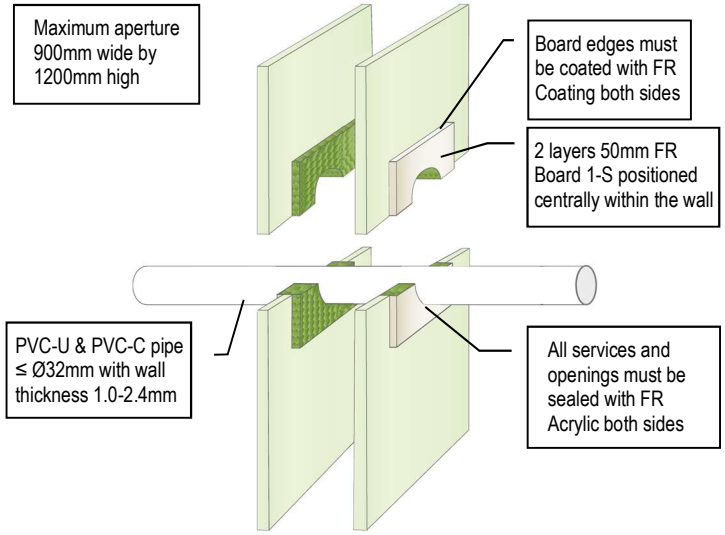

PVC PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

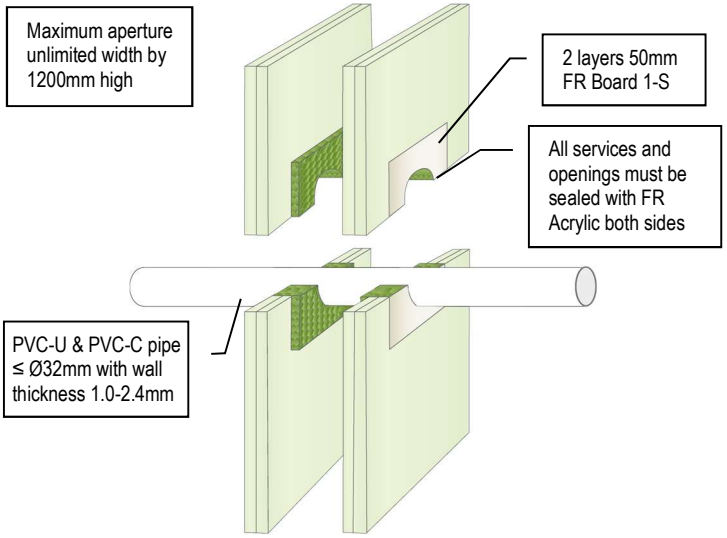

PVC PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

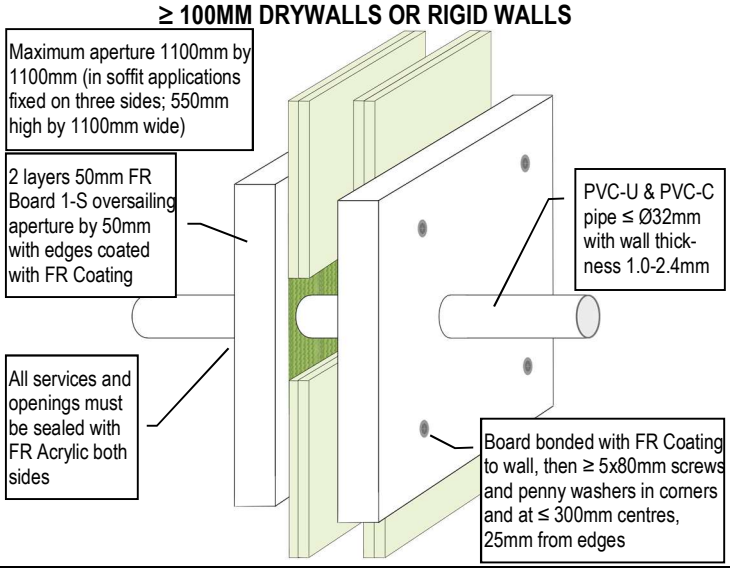

PE PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

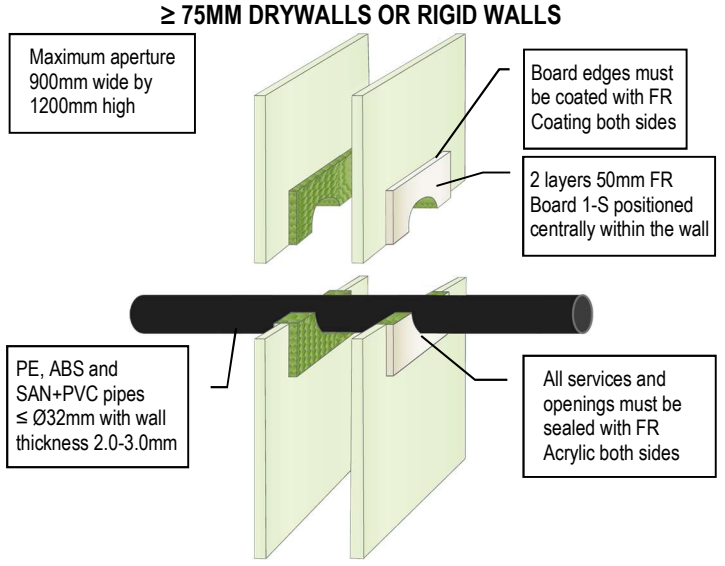

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
23 (86) 2025 2 7

PE PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

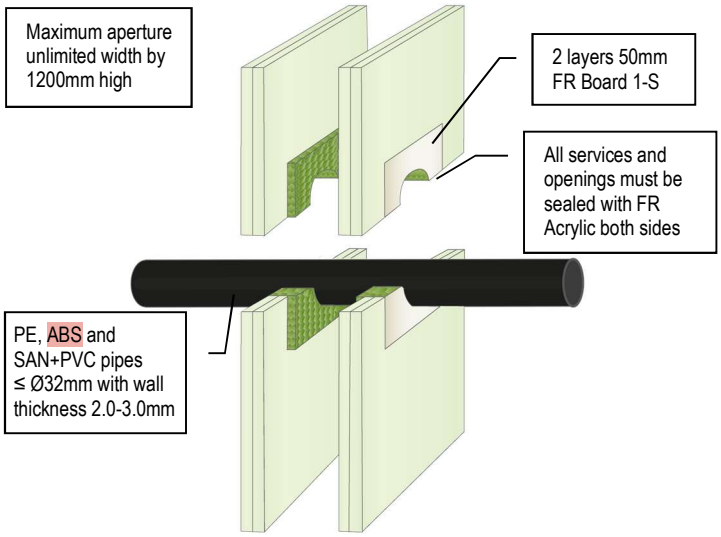

PE PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

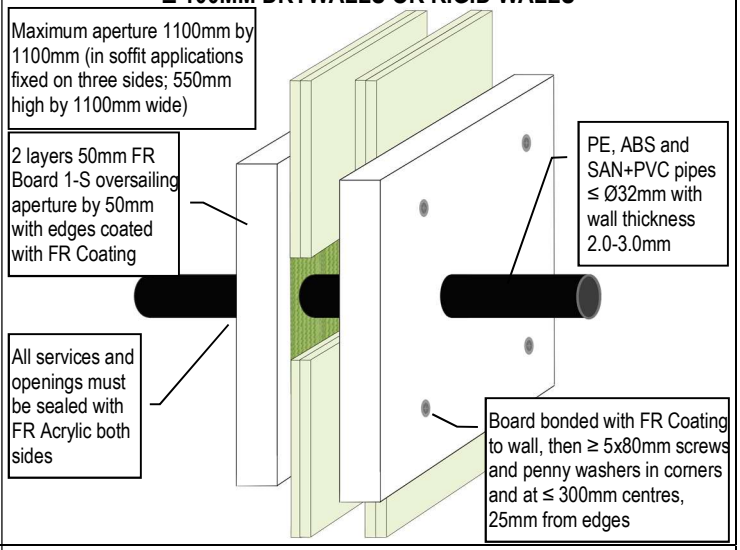

PP PIPES FIRE RESISTANCE EI 45 C/C (E 45)

≥ 75MM DRYWALLS OR RIGID WALLS

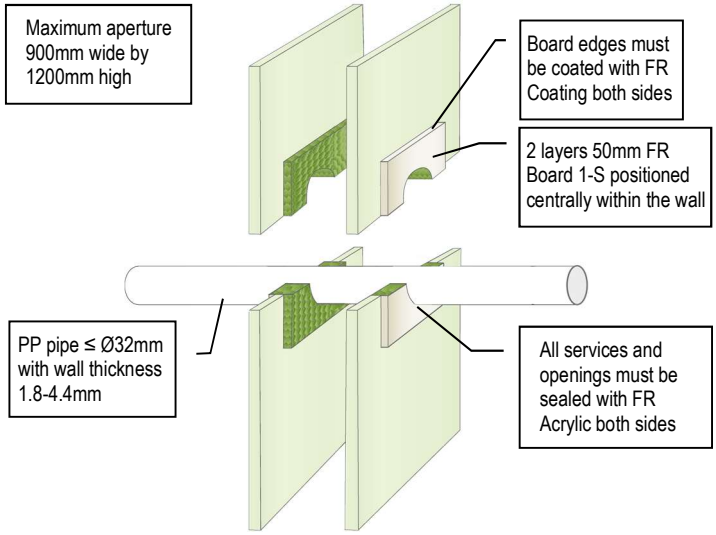

PP PIPES FIRE RESISTANCE EI 60 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

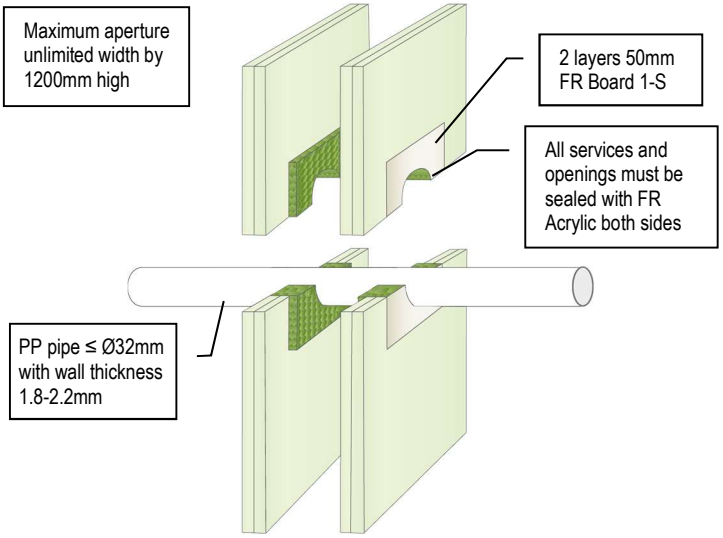

PP PIPES FIRE RESISTANCE EI 45 C/C (E 45)

≥ 100MM DRYWALLS OR RIGID WALLS

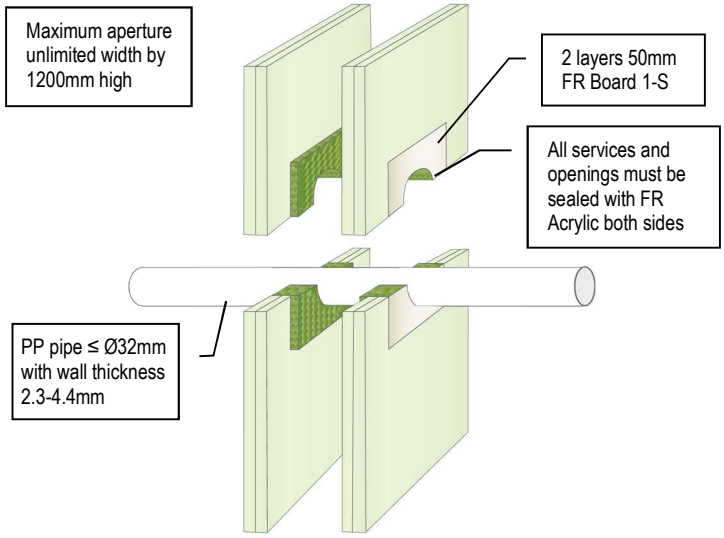

PP PIPES FIRE RESISTANCE EI 60 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

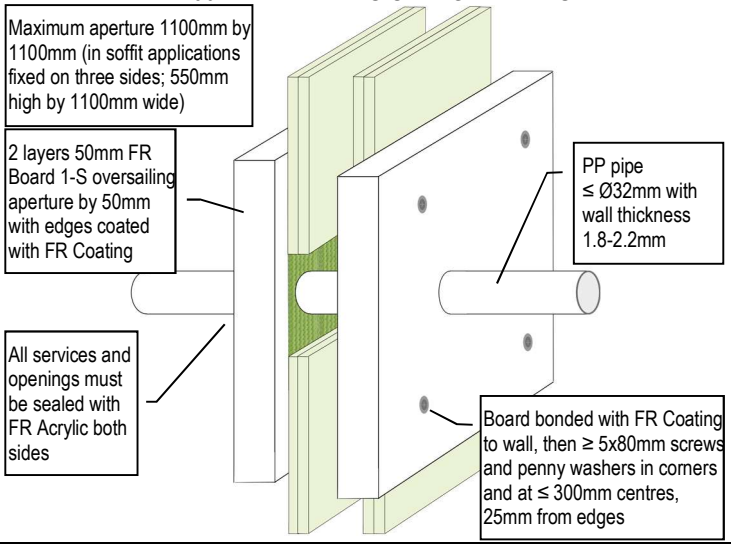

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
24 (86) 2025 2 7

PLASTIC PIPES FIRE RESISTANCE EI 30-60

≥ 75MM DRYWALLS OR RIGIDS

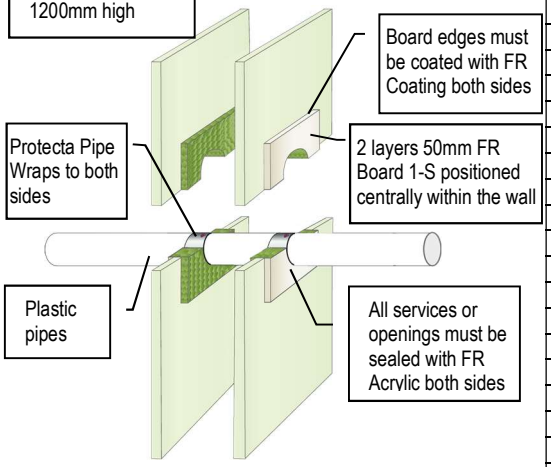

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.0 – 3.0mm	50 x 1.8mm (1 layer)	EI 60 U/U (E 60 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 60 U/U (E 60 U/U)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 60 U/U (E 60 U/U)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	4.2 – 10.0mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 110mm PP	2.7 – 15.1mm	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
≤ Ø 125mm PVC-U & PVC-C	3.7 – 7.4mm	50 x 5.4mm (3 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 125mm PE, ABS & SAN+PVC	4.8 – 12.0mm	50 x 5.4mm (3 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 125mm PP	3.1 – 17.1mm	50 x 5.4mm (3 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 160mm PP	4.9 – 21.9mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 200mm PVC-U & PVC-C	4.9 – 11.9mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 200mm PE, ABS & SAN+PVC	6.2 – 18.2mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 200mm PP	4.9 – 18.2mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 315mm PVC-U & PVC-C	7.7 – 12.1mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	12.1 – 18.7mm	50 x 18.0mm (10 layers)	EI 30 C/C (E 30 C/C)
≤ Ø 315mm PP	12.1 – 28.6mm	50 x 18.0mm (10 layers)	EI 30 C/C (E 30 C/C)
≤ Ø 400mm PVC-U & PVC-C	9.8 – 15.3mm	50 x 28.8mm (16 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	23.7mm	50 x 28.8mm (16 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 400mm PP	22.7mm	50 x 28.8mm (16 layers)	EI 45 C/C (E 45 C/C)

PLASTIC PIPES FIRE RESISTANCE EI 30-60

≥ 100MM DRYWALLS OR RIGID WALLS

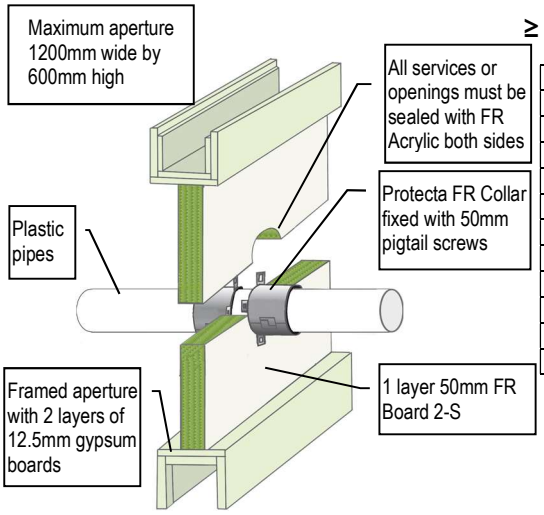

Pipe & Collar Descriptions	Pipe Wall Thickness	Min. Collar Height	Classification
≤ Ø 110mm PVC-U & PVC-C	1.9 – 6.6mm	30mm	EI 30 U/C (E 90 U/C)
≤ Ø 50mm PVC-U & PVC-C	1.9 – 3.7mm	50mm	EI 60 U/C (E 120 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.1 – 6.6mm	50mm	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PVC-U & PVC-C	3.1 – 9.5mm	60mm	EI 60 C/C (E 60 C/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.4 – 10.0mm	30mm	EI 45 U/C (E 60 U/C)
≤ Ø 50mm PE, ABS & SAN+PVC	3.0 – 4.6mm	50mm	EI 60 U/C (E 120 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.0 – 10.0mm	50mm	EI 60 C/C (E 90 C/C)
≤ Ø 160mm PE, ABS & SAN+PVC	3.9 – 9.5mm	60mm	EI 60 C/C (E 60 C/C)
≤ Ø 90mm PP	1.8 – 4.6mm	50mm	EI 60 C/C (E 60 C/C)
≤ Ø 110mm PP	2.7 – 4.2mm	50mm	EI 60 C/C (E 60 C/C)
≤ Ø 160mm PP	3.4 – 9.1mm	60mm	EI 60 C/C (E 60 C/C)

PLASTIC PIPES FIRE RESISTANCE EI 60-120

≥ 100MM DRYWALLS OR RIGIDS

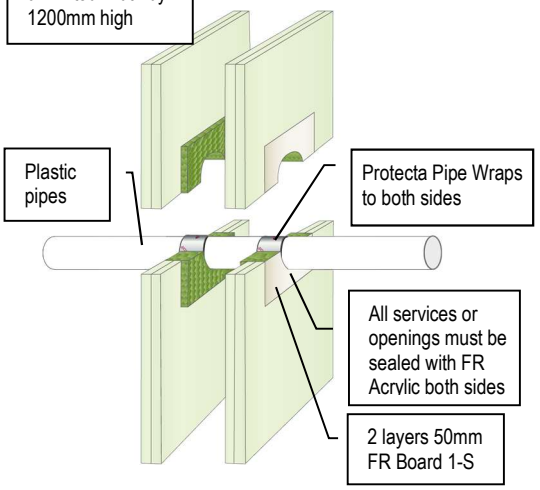

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 50mm PVC-U & PVC-C	1.0 – 1.8mm	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	4.2 – 10.0mm	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 110mm PP	2.7 – 15.1mm	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
≤ Ø 125mm PVC-U & PVC-C	3.7 – 7.4mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 125mm PE, ABS & SAN+PVC	4.8 – 12.0mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 125mm PP	3.1 – 17.1mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PP	4.9 – 21.9mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 200mm PVC-U & PVC-C	4.9 – 11.9mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PE, ABS & SAN+PVC	6.2 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PP	4.9 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PVC-U & PVC-C	7.7 – 12.1mm	50 x 18.0mm (10 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	18.7mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 315mm PP	28.6mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 400mm PVC-U & PVC-C	9.8 – 15.3mm	50 x 28.8mm (16 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	23.7mm	50 x 28.8mm (16 layers)	EI 60 C/C (E 60 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
25 (86) 2025 2 7

PLASTIC PIPES FIRE RESISTANCE EI 120

≥ 120MM DRYWALLS OR RIGID WALLS

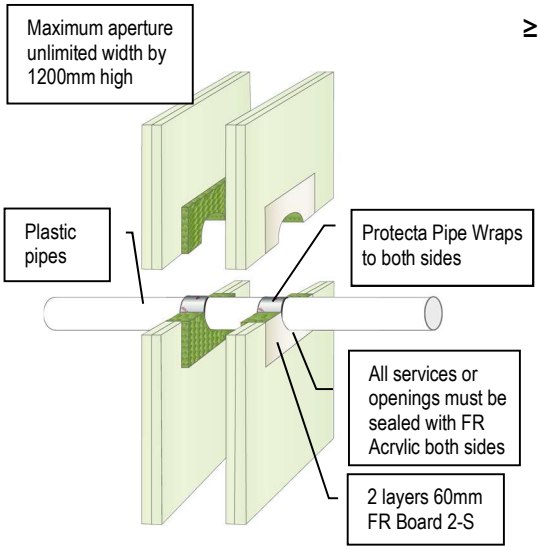

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	3.8 – 4.6mm	50 x 1.8mm (1 layer)	EI 120 C/C (E 120 C/C)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 50mm PVC-U & PVC-C	1.0 – 1.8mm	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.4 – 10.0mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 110mm PP	2.7 – 10.0mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PP	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)

PLASTIC PIPES FIRE RESISTANCE EI 60-120

≥ 120MM DRYWALLS OR RIGID WALLS

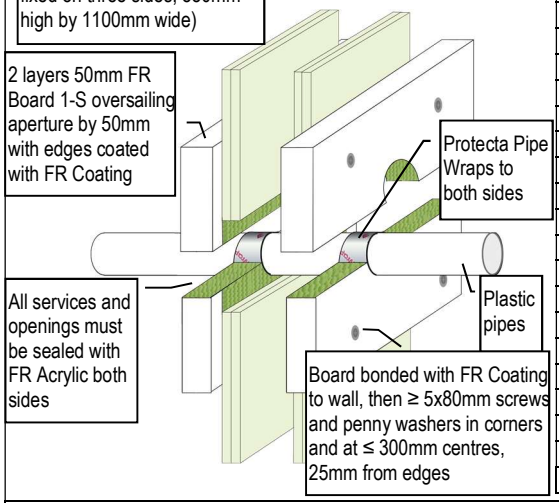

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	3.8 – 4.6mm	50 x 1.8mm (1 layer)	EI 120 C/C (E 120 C/C)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 50mm PVC-U & PVC-C	1.0 – 1.8mm	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.4 – 10.0mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 110mm PP	2.7 – 10.0mm	50 x 3.6mm (2 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 160mm PP	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 200mm PVC-U & PVC-C	4.9 – 11.9mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PE, ABS & SAN+PVC	6.2 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PP	4.9 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PVC-U & PVC-C	7.7 – 12.1mm	50 x 18.0mm (10 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	18.7mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 315mm PP	28.6mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 400mm PVC-U & PVC-C	9.8 – 15.3mm	50 x 28.8mm (16 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	23.7mm	50 x 28.8mm (16 layers)	EI 60 C/C (E 60 C/C)

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

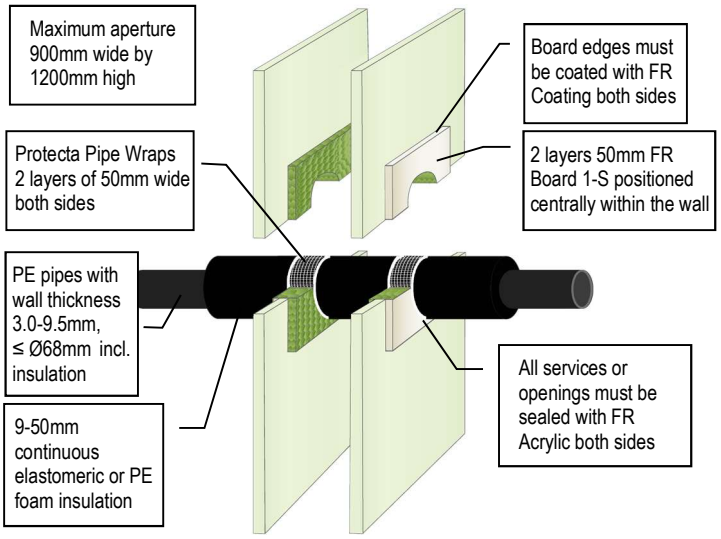

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

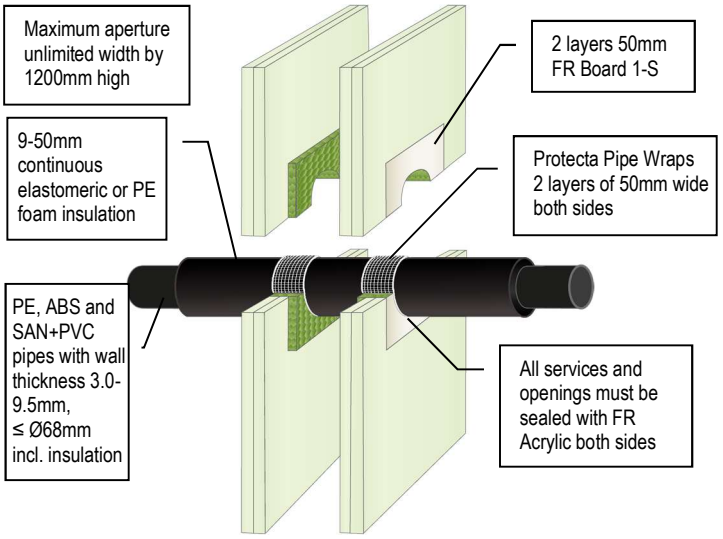

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
26 (86) 2025 2 7

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

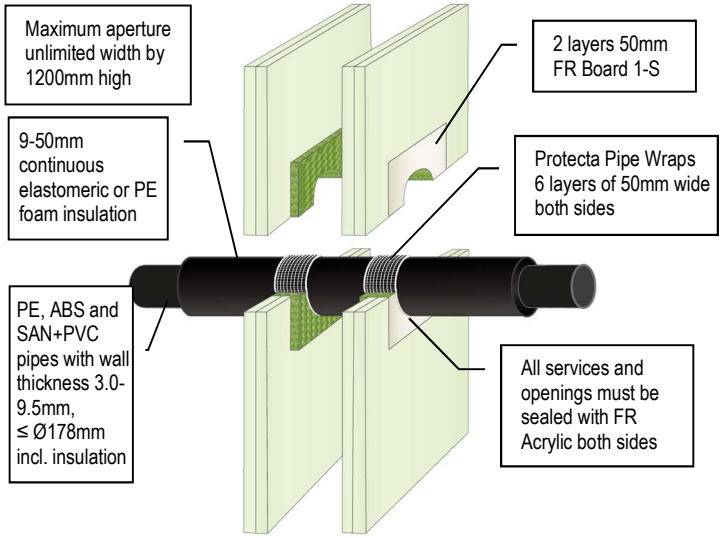

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

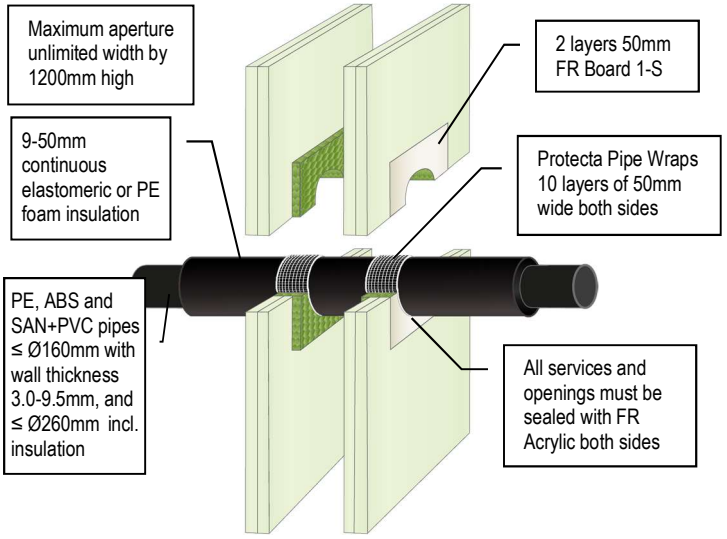

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

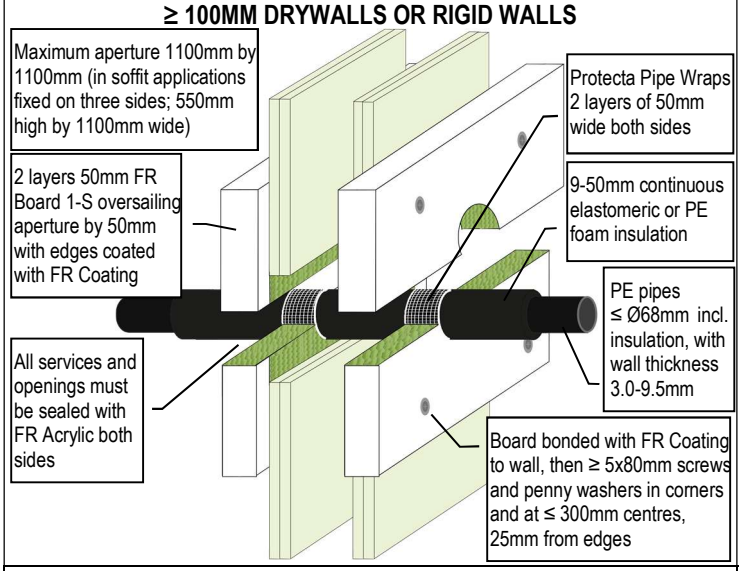

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

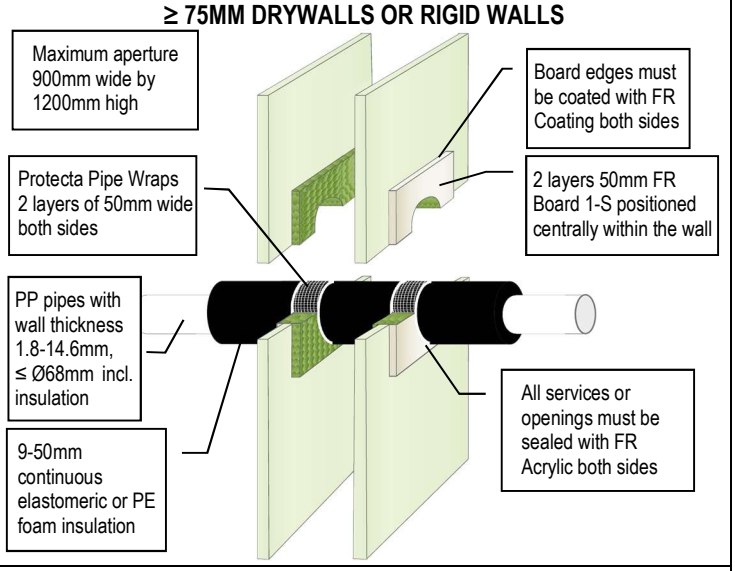

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

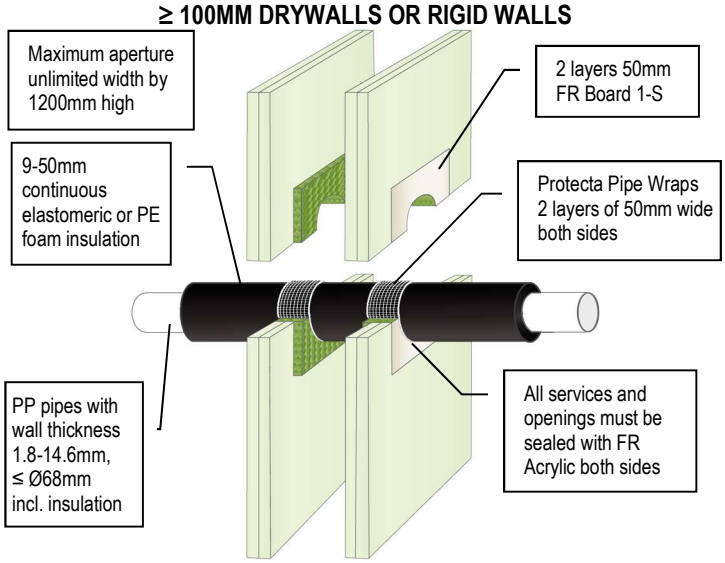

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

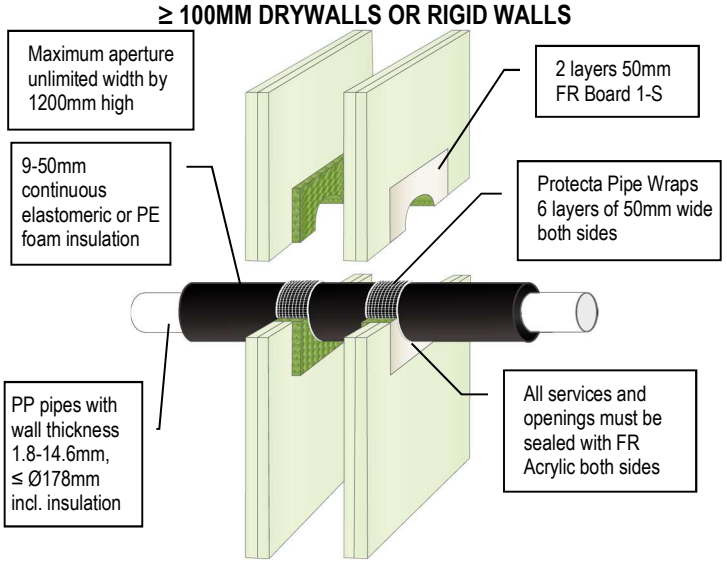

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
27 (86) 2025 2 7

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

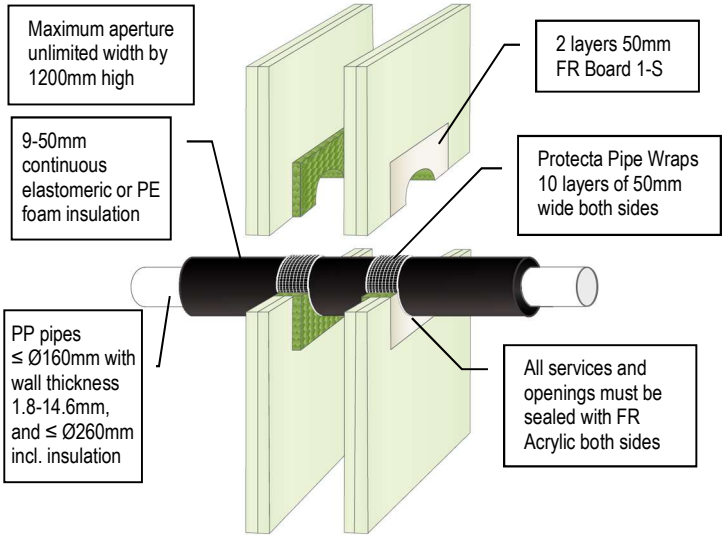

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

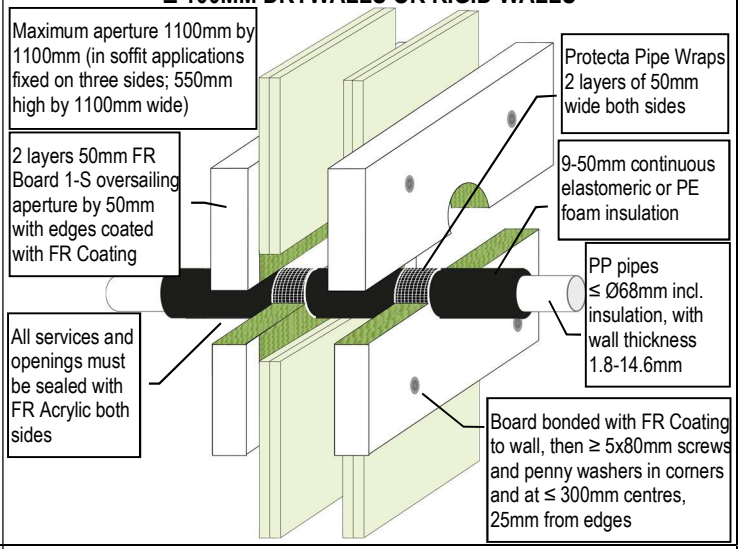

PVC CONDUITS FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

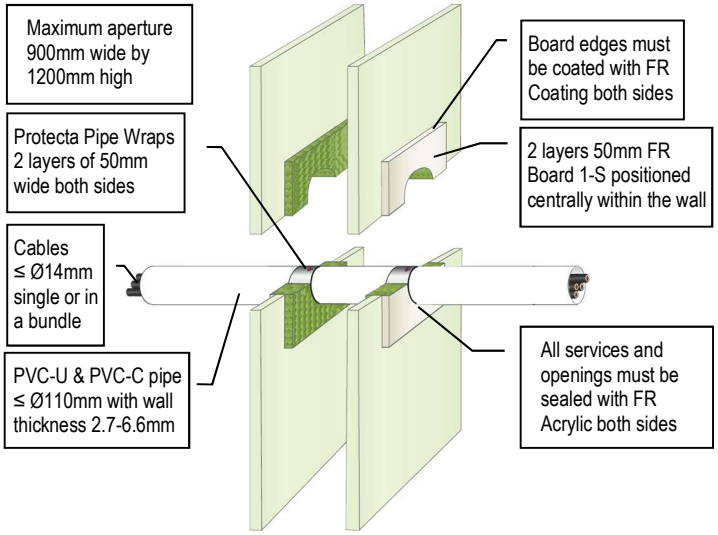

PE CONDUITS FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

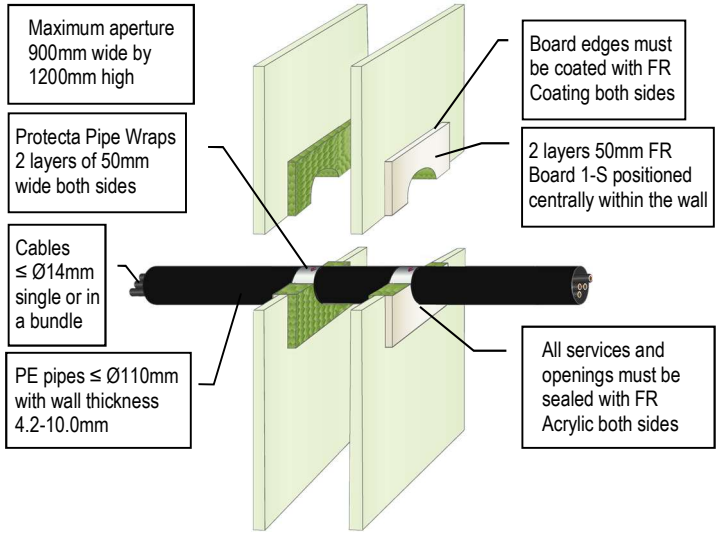

PP CONDUITS FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

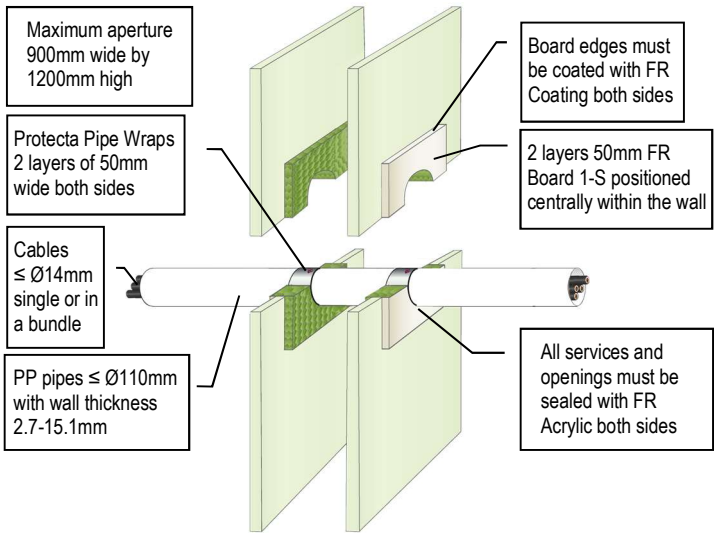

PVC CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

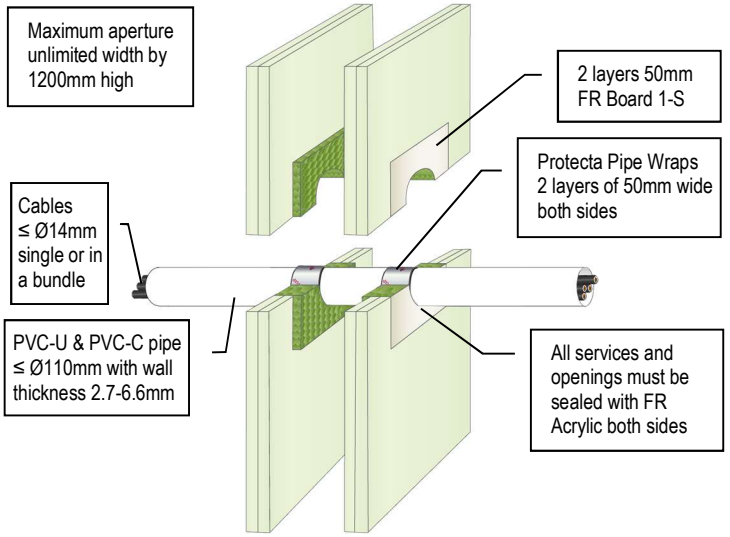

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
28 (86) 2025 2 7

PE CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

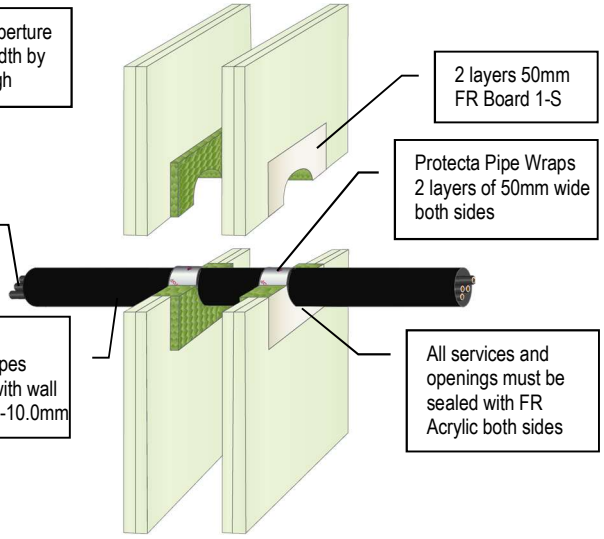

PP CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

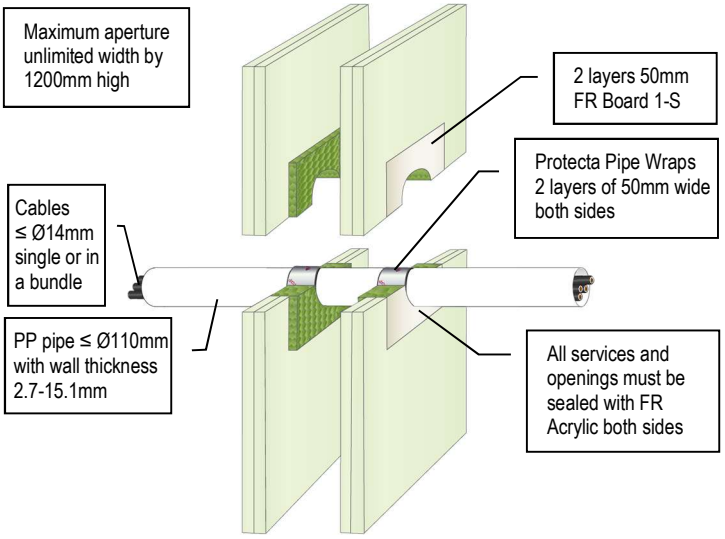

PVC CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

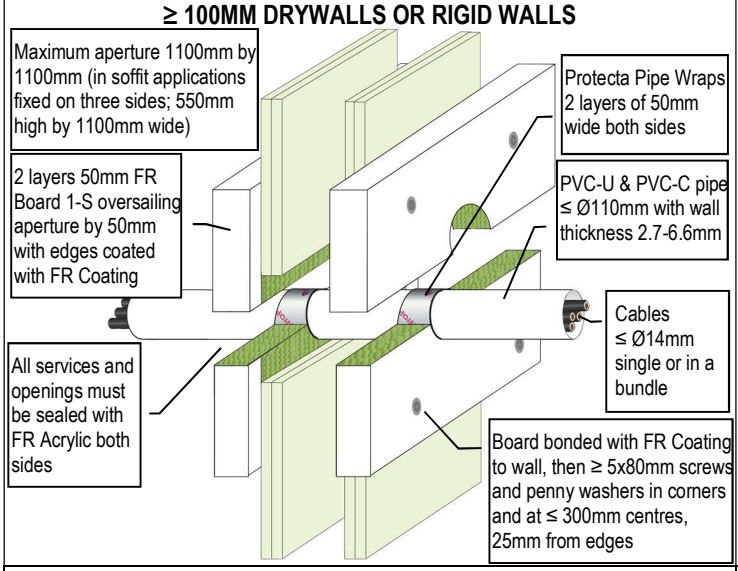

PE CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

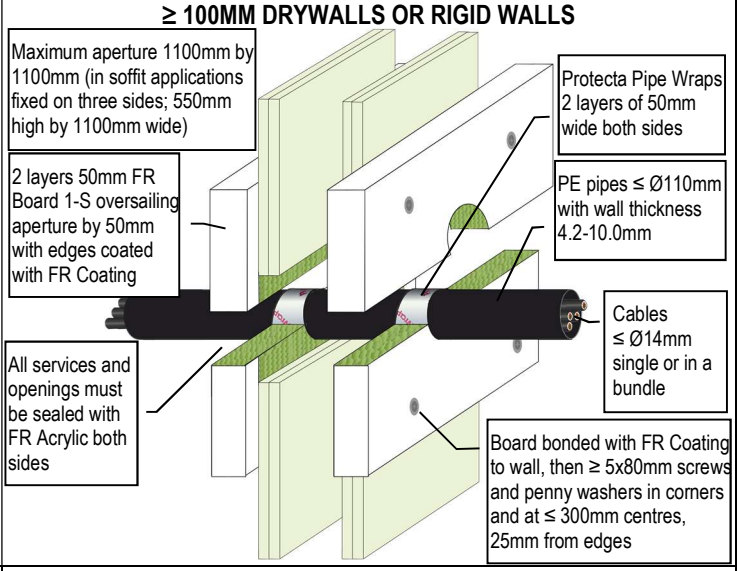

PP CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

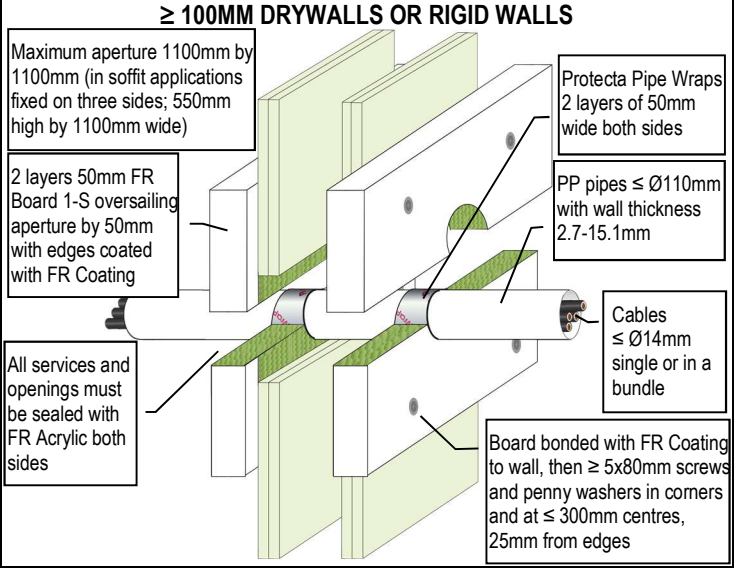

PLASTIC PIPES & CONDUITS FIRE RESISTANCE EI 60 U/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

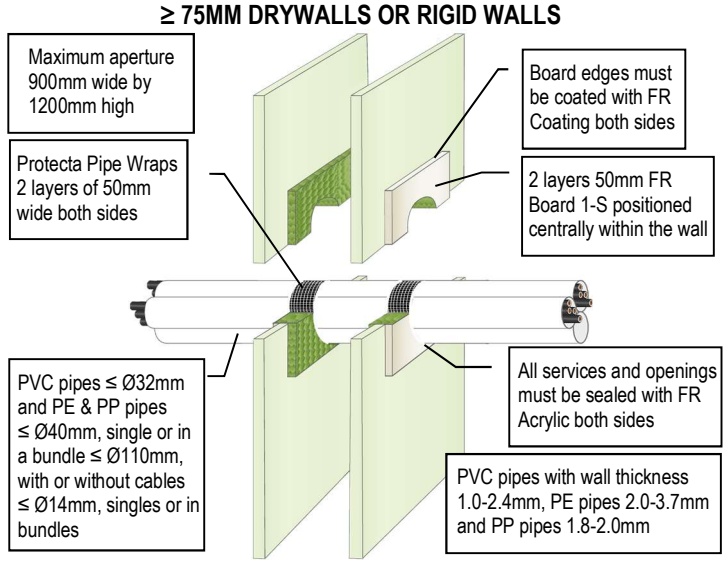

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
29 (86) 2025 2 7

PLASTIC PIPES & CONDUITS FIRE RESISTANCE EI 90 U/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

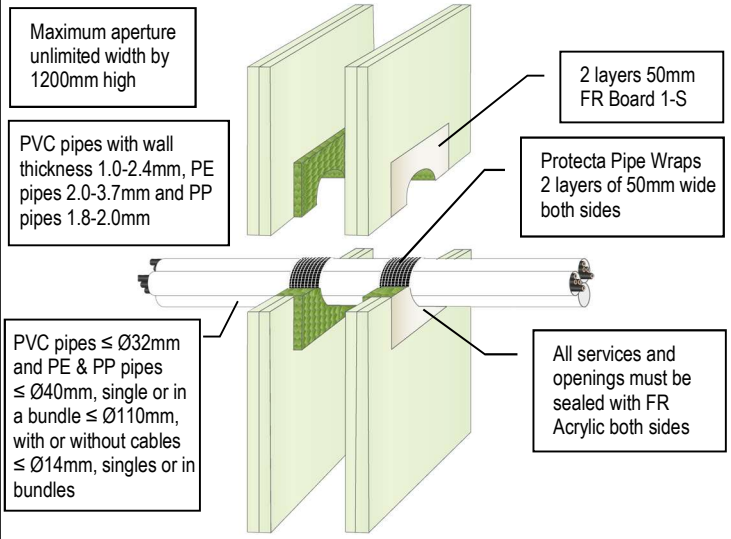

PLASTIC PIPES & CONDUITS FIRE RESISTANCE EI 90 U/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

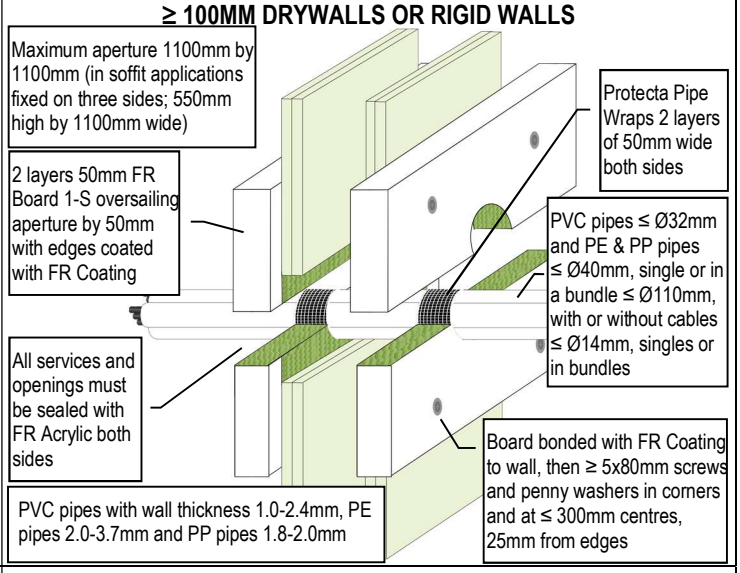

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

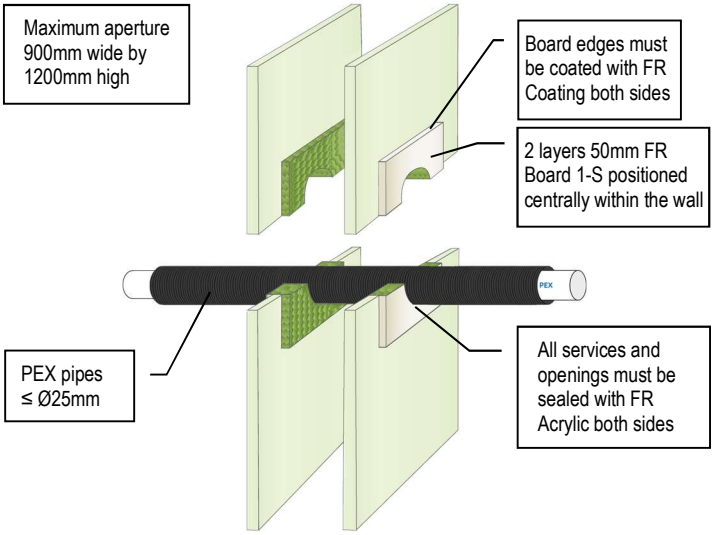

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

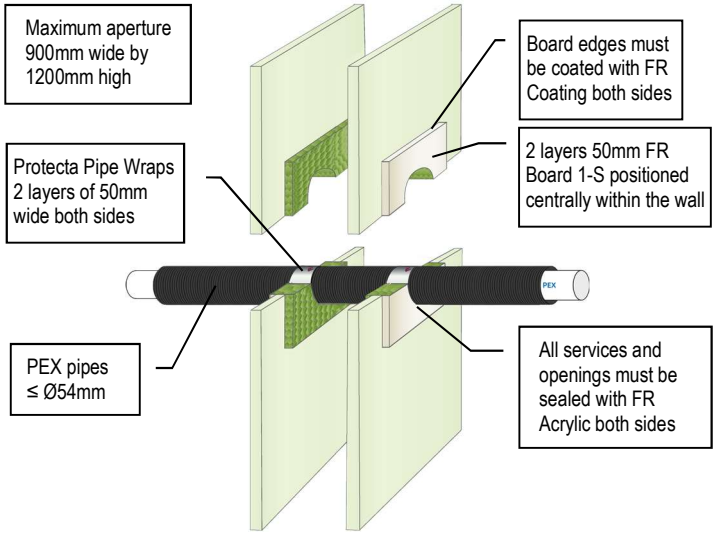

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

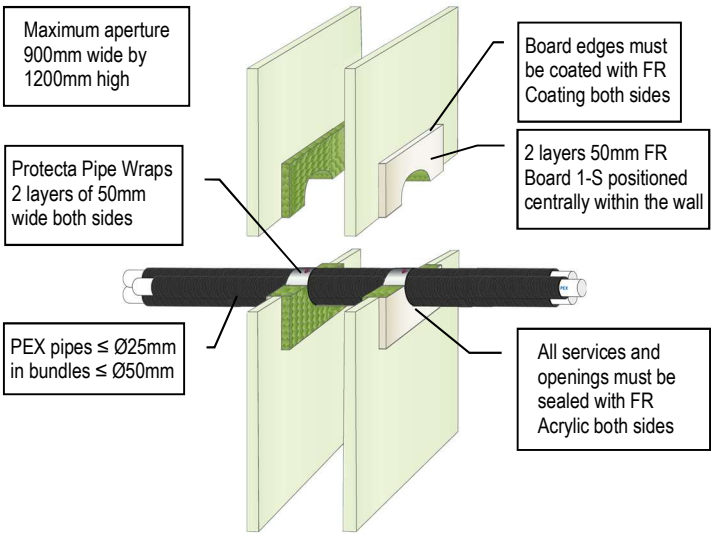

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

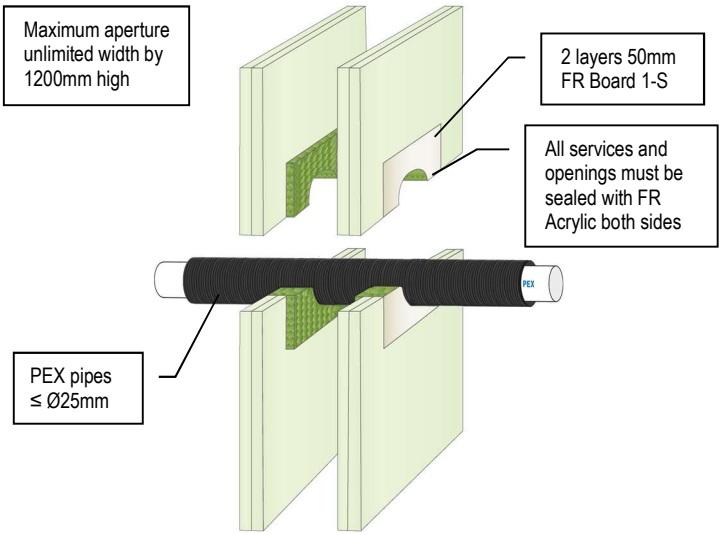

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
30 (86) 2025 2 7

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

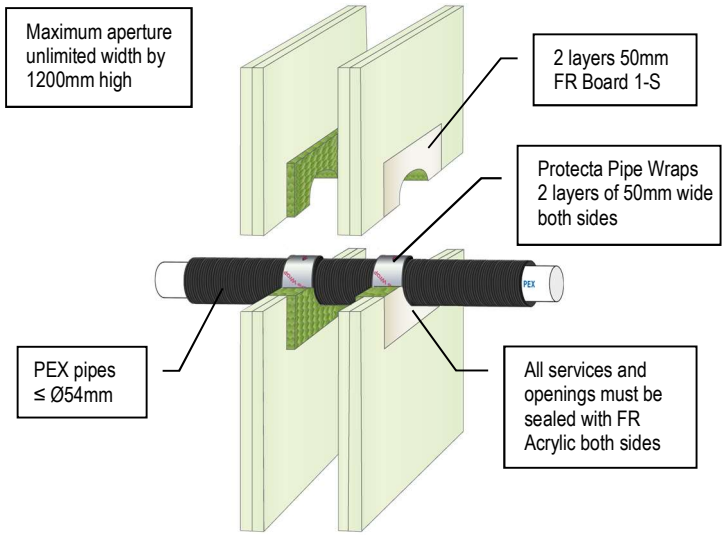

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

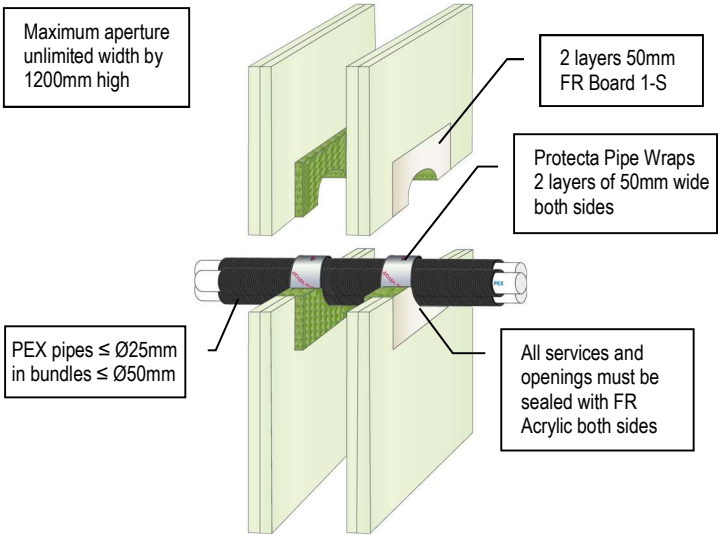

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

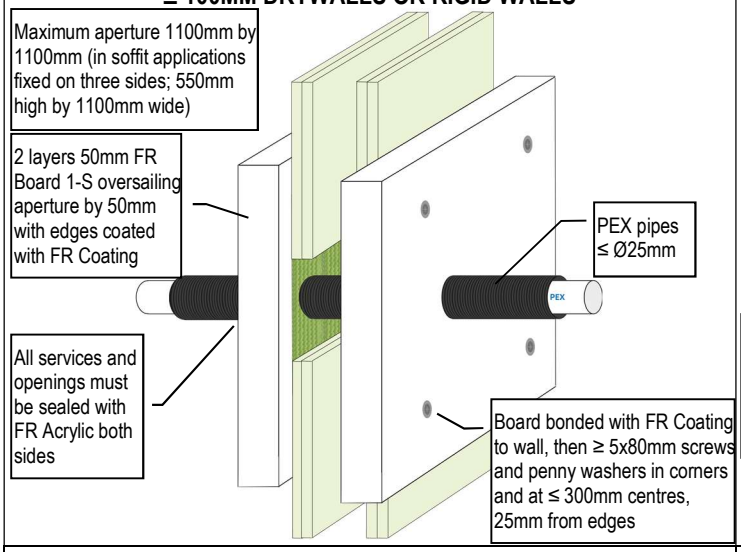

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM DRYWALLS OR RIGID WALLS

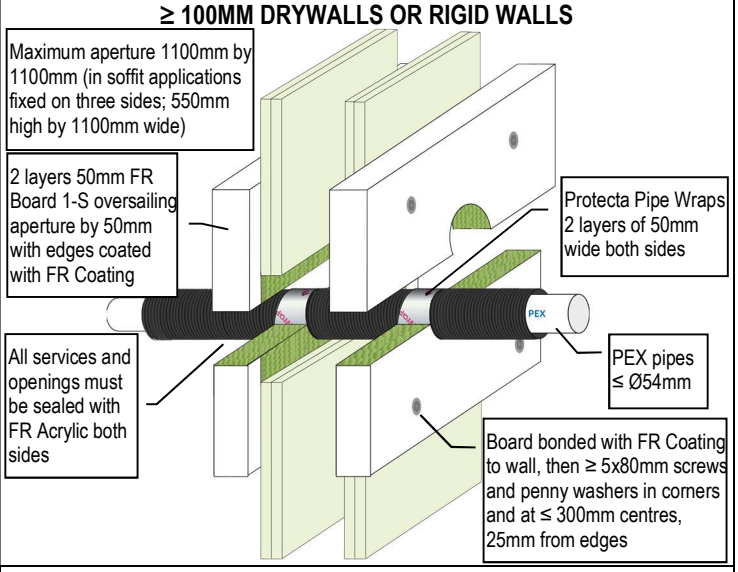

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM DRYWALLS OR RIGID WALLS

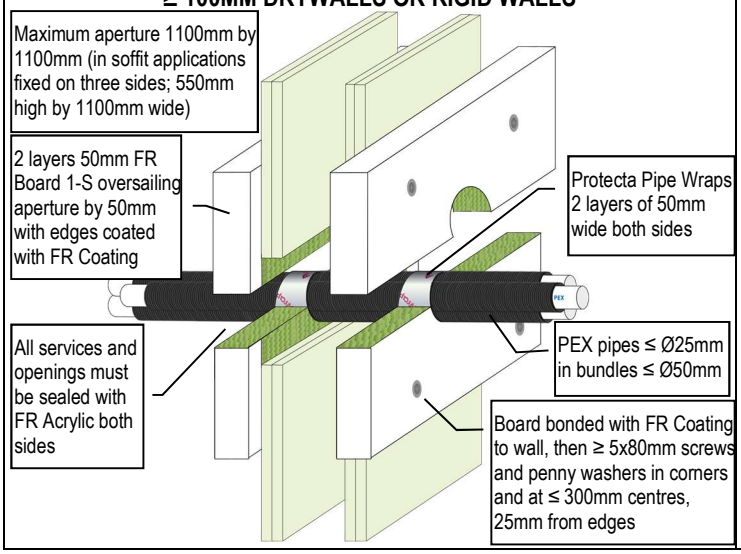

POLYBUTYLENE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM DRYWALLS OR RIGID WALLS

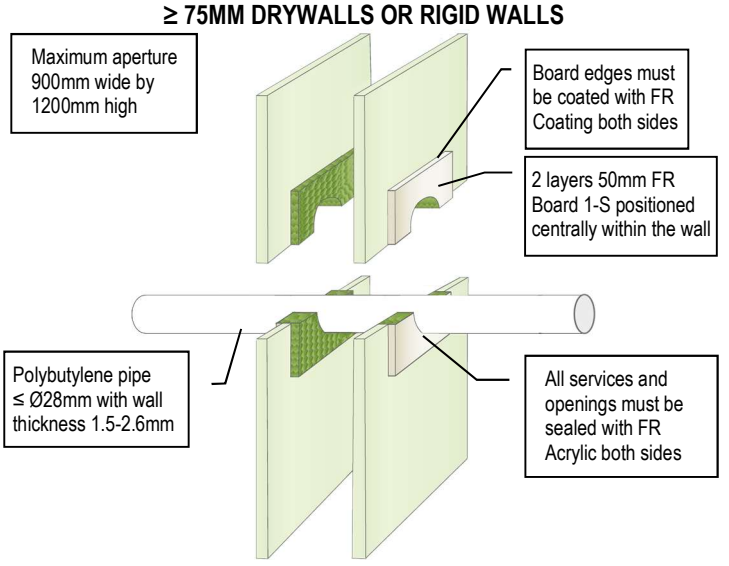

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
31 (86) 2025 2 7

POLYBUTYLENE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

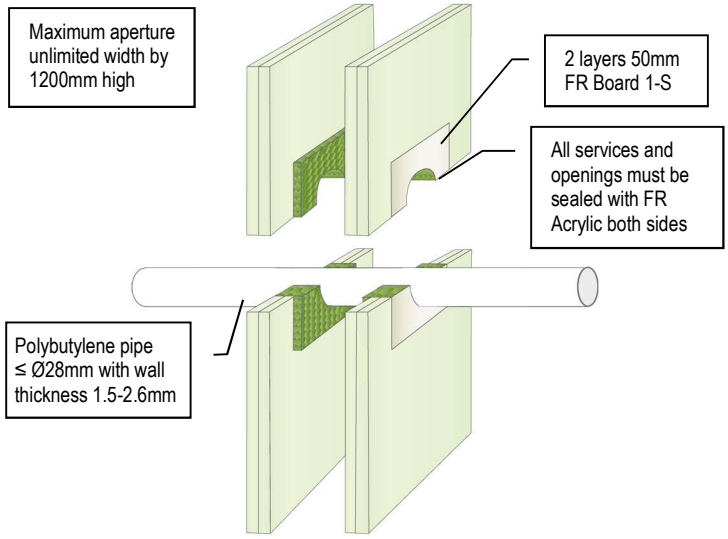

POLYBUTYLENE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM DRYWALLS OR RIGID WALLS

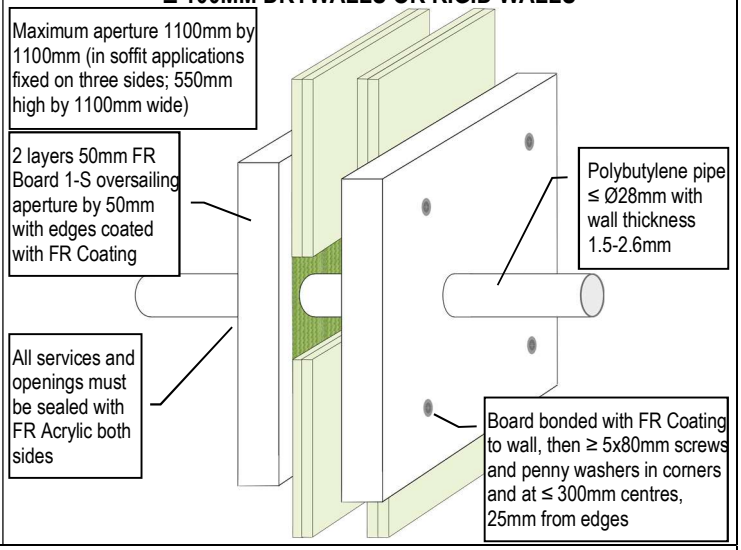

COMPOSITE AQUATHERM GREEN SDR9 PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

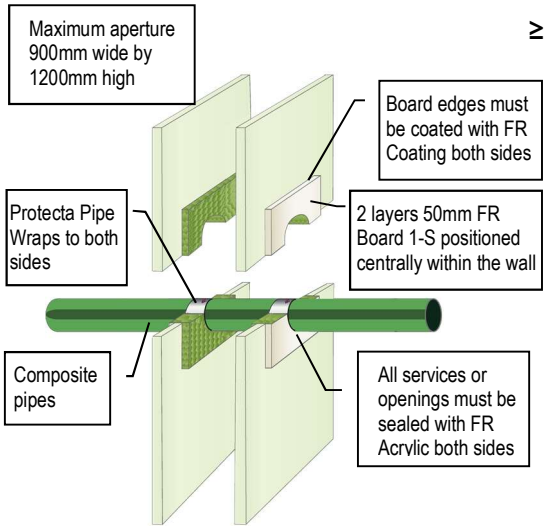

Services	FR Pipe Wrap	Classification
Ø 32mm Aquatherm Green SDR9 pipes	50 x 1.8mm (1 layer)	EI 60 C/C (E 60 C/C)
Ø 40mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)
Ø 50mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)
Ø 63mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)
Ø 75mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)
Ø 90mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)
Ø 110mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 60 C/C (E 60 C/C)

COMPOSITE AQUATHERM GREEN SDR9 PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

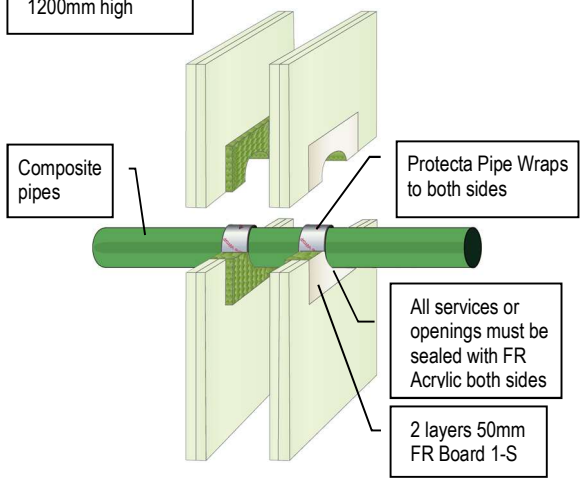

Services	FR Pipe Wrap	Classification
Ø 32mm Aquatherm Green SDR9 pipes	50 x 1.8mm (1 layer)	EI 90 C/C (E 120 C/C)
Ø 40mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 50mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 63mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 75mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 90mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 110mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036

COMPOSITE AQUATHERM GREEN SDR9 PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

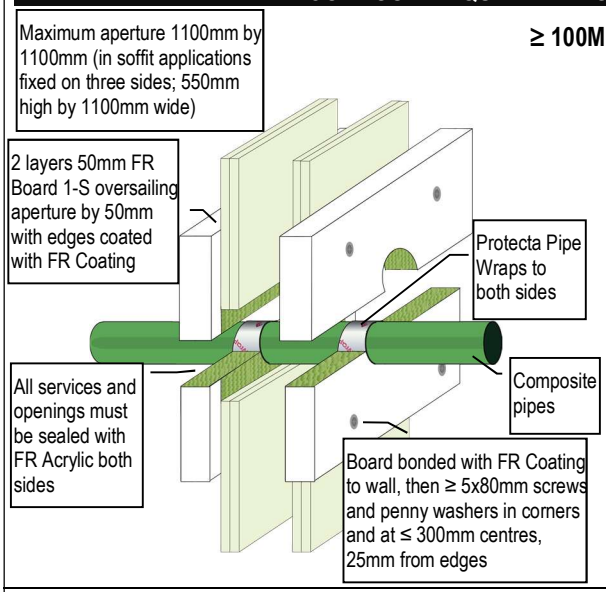

Services	FR Pipe Wrap	Classification
Ø 32mm Aquatherm Green SDR9 pipes	50 x 1.8mm (1 layer)	EI 90 C/C (E 120 C/C)
Ø 40mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 50mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 63mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 75mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 90mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 110mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)

COMPOSITE BLUEPOWER PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

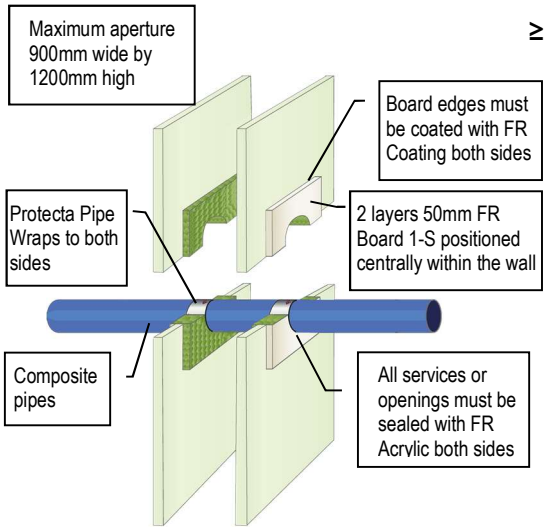

Services	FR Pipe Wrap	Classification
Ø 32mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 40mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 C/U (E 60 C/U)
Ø 90mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 C/U (E 60 C/U)
Ø 110mm BluePower pipes	50 x 3.6mm (2 layers)	EI 60 C/U (E 60 C/U)
Ø 125mm BluePower pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm BluePower pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE BLUEPOWER PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

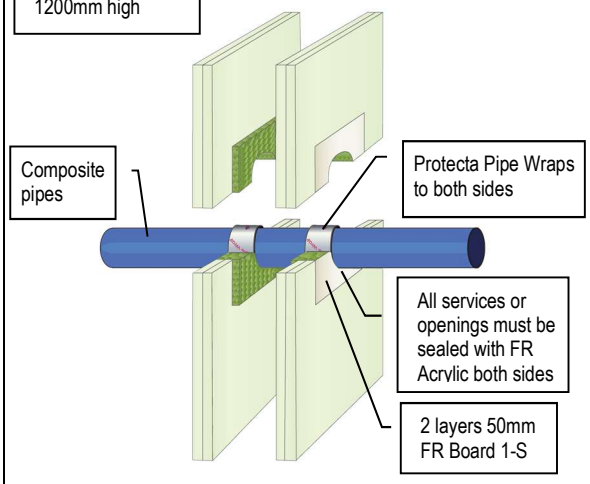

Services	FR Pipe Wrap	Classification
Ø 32mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 40mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 50mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 90mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 110mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 125mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

COMPOSITE BLUEPOWER PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

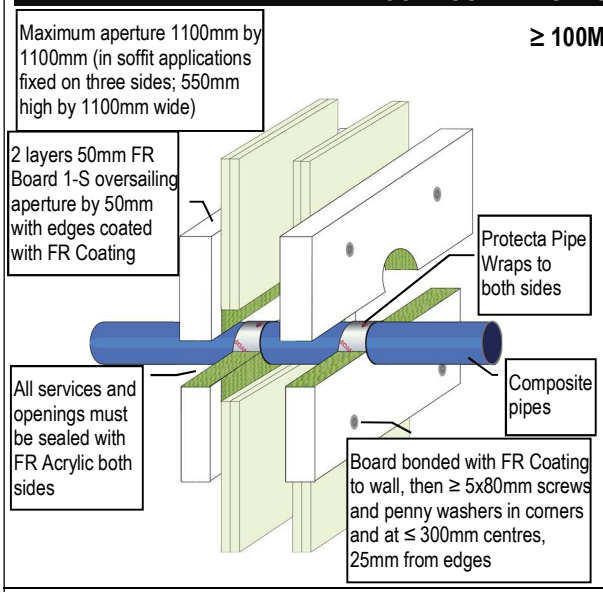

Services	FR Pipe Wrap	Classification
Ø 32mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 40mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 50mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 90mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 110mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 125mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

COMPOSITE GEBERIT SILENT-PP PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

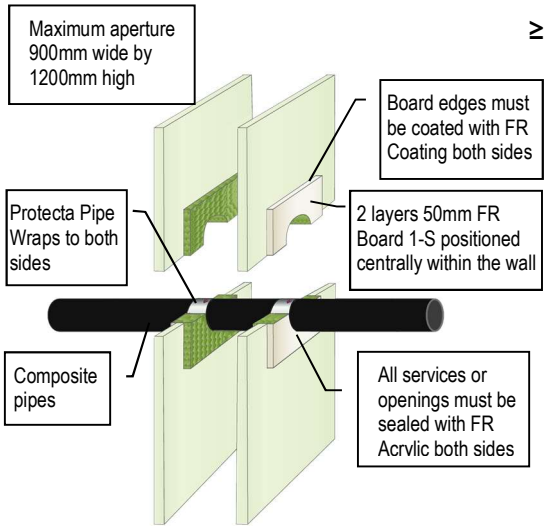

Services	FR Pipe Wrap	Classification
Ø 32mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 40mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE GEBERIT SILENT-PP PIPES FIRE RESISTANCE EI 90-120

≥ 100MM DRYWALLS OR RIGID WALLS

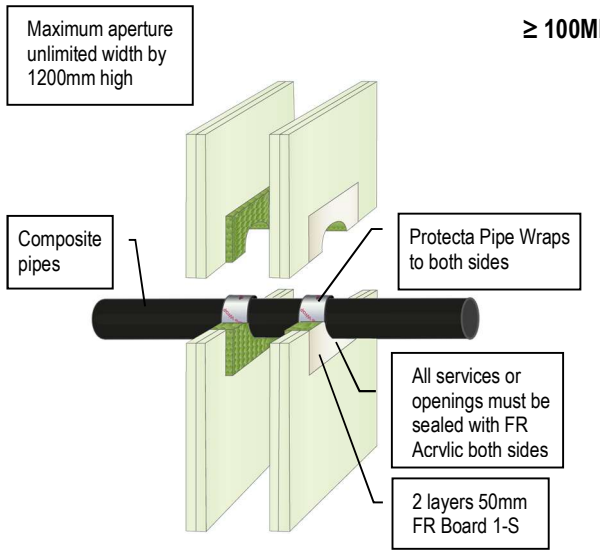

Services	FR Pipe Wrap	Classification
Ø 32mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

COMPOSITE GEBERIT SILENT-PP PIPES FIRE RESISTANCE EI 90-120

≥ 100MM DRYWALLS OR RIGID WALLS

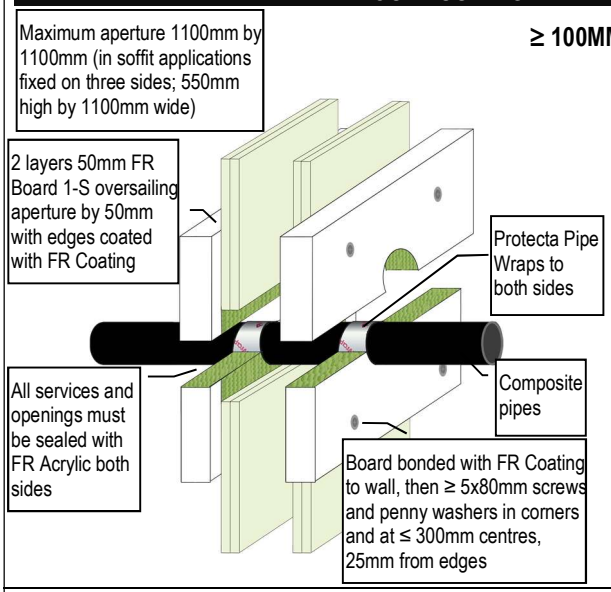

Services	FR Pipe Wrap	Classification
Ø 32mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

COMPOSITE HULIOT ULTRA SILENT PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

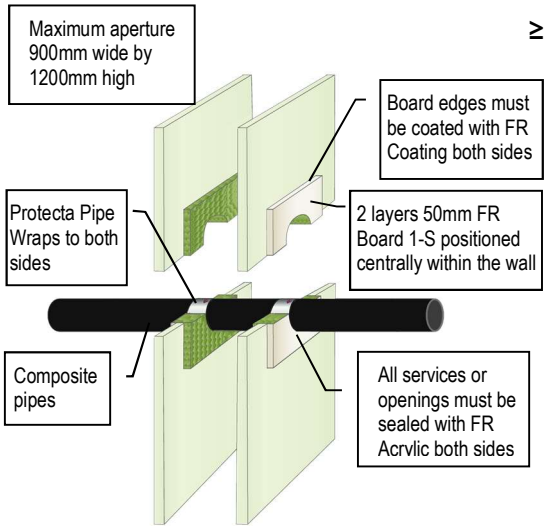

Services	FR Pipe Wrap	Classification
Ø 32mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 40mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 C/C)
Ø 200mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)

COMPOSITE HULIOT ULTRA SILENT PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

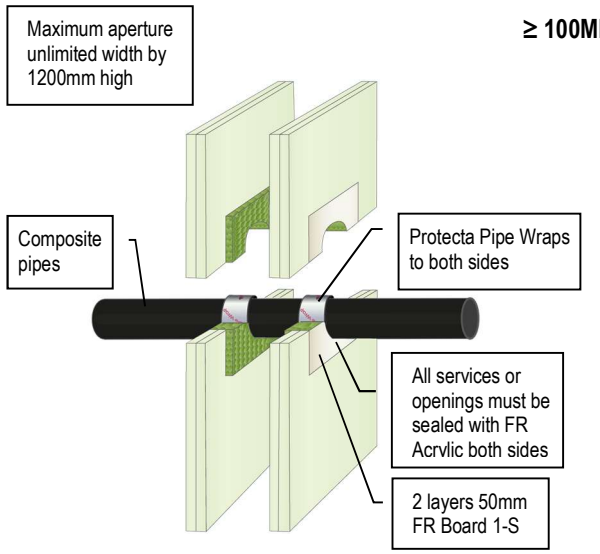

Services	FR Pipe Wrap	Classification
Ø 32mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 90mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 125mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 C/C)
Ø 200mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 120 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COMPOSITE HULIOT ULTRA SILENT PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

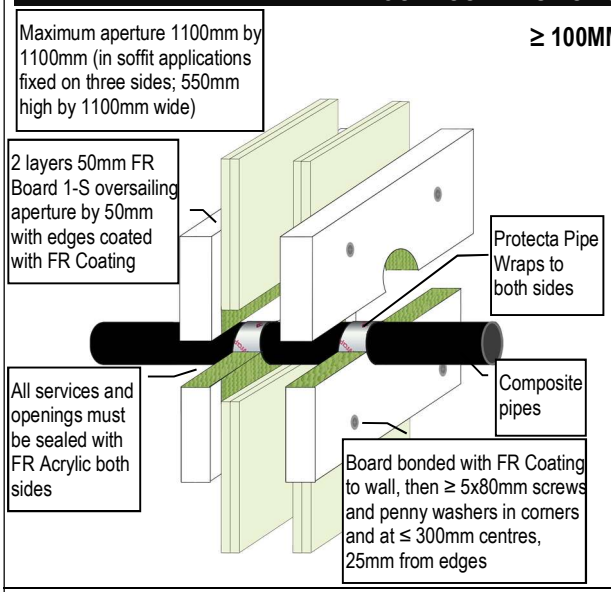

Services	FR Pipe Wrap	Classification
Ø 32mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 90mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 125mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 C/C)
Ø 200mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 120 C/C)

COMPOSITE POLO-KAL NG PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

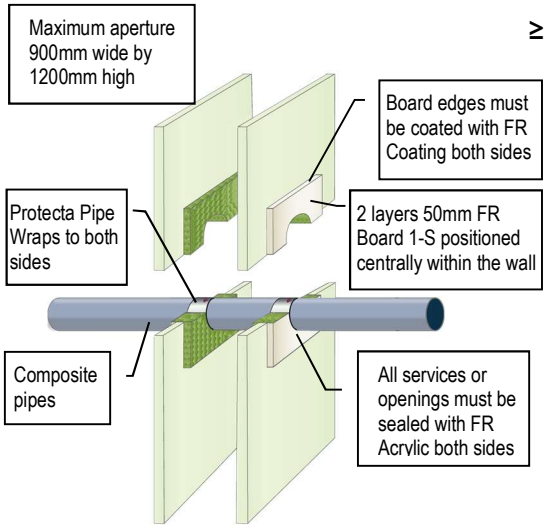

Services	FR Pipe Wrap	Classification
Ø 32mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 40mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Polo-Kal NG pipes	50 x 7.2mm (4 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Polo-Kal NG pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE POLO-KAL NG PLASTIC PIPES FIRE RESISTANCE EI 120

≥ 100MM DRYWALLS OR RIGID WALLS

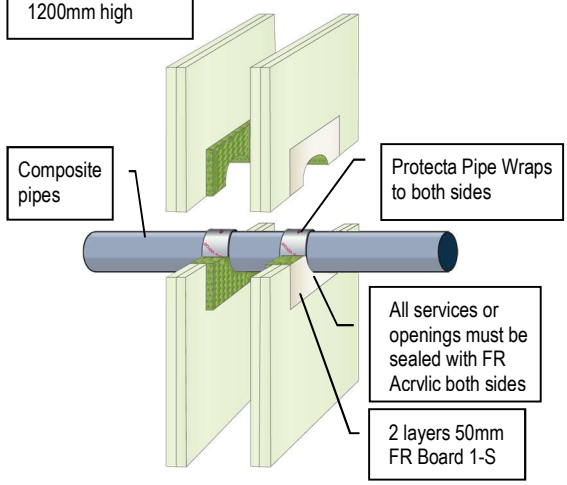

Services	FR Pipe Wrap	Classification
Ø 32mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Polo-Kal NG pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Polo-Kal NG pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

COMPOSITE POLO-KAL NG PLASTIC PIPES FIRE RESISTANCE EI 120

≥ 100MM DRYWALLS OR RIGID WALLS

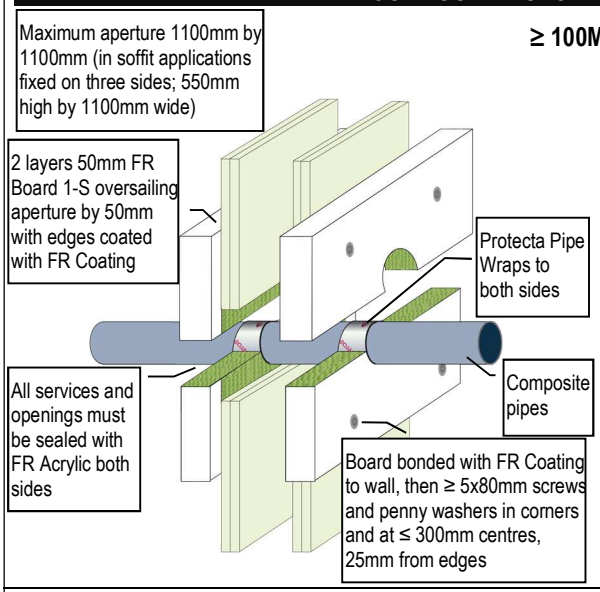

Services	FR Pipe Wrap	Classification
Ø 32mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Polo-Kal NG pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Polo-Kal NG pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE REHAU RAUPIANO PLUS PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

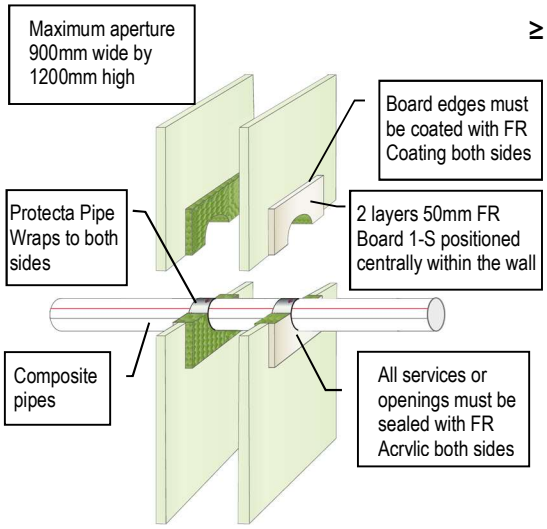

Services	FR Pipe Wrap	Classification
Ø 40mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Rehau Raupiano Plus pipes	50 x 7.2mm (4 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Rehau Raupiano Plus pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE REHAU RAUPIANO PLUS PLASTIC PIPES FIRE RESISTANCE EI 120

≥ 100MM DRYWALLS OR RIGID WALLS

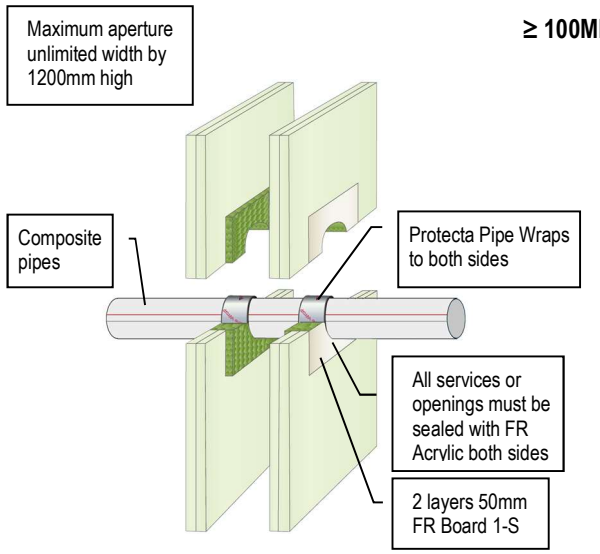

Services	FR Pipe Wrap	Classification
Ø 40mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Rehau Raupiano Plus pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Rehau Raupiano Plus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
37 (86) 2025 2 7

COMPOSITE REHAU RAUPIANO PLUS PLASTIC PIPES FIRE RESISTANCE EI 120

≥ 100MM DRYWALLS OR RIGID WALLS

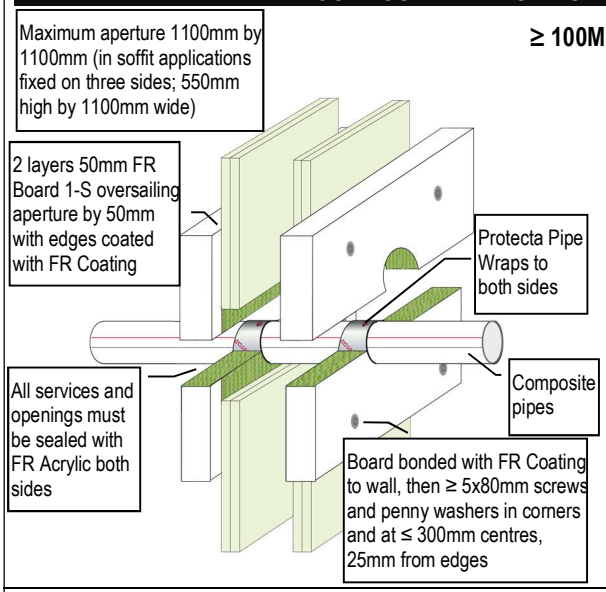

Services	FR Pipe Wrap	Classification
Ø 40mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Rehau Raupiano Plus pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Rehau Raupiano Plus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE UPONOR DECIBEL PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

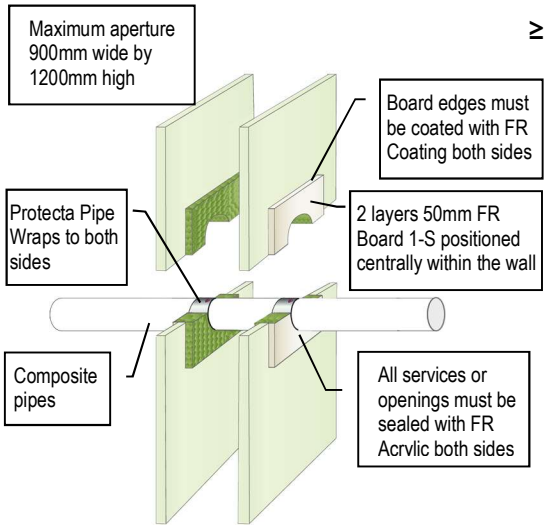

Services	FR Pipe Wrap	Classification
Ø 50mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE UPONOR DECIBEL PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

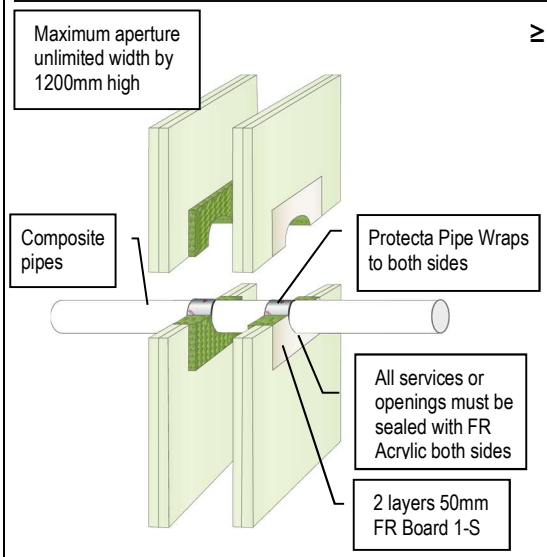

Services	FR Pipe Wrap	Classification
Ø 50mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COMPOSITE UPONOR DECIBEL PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

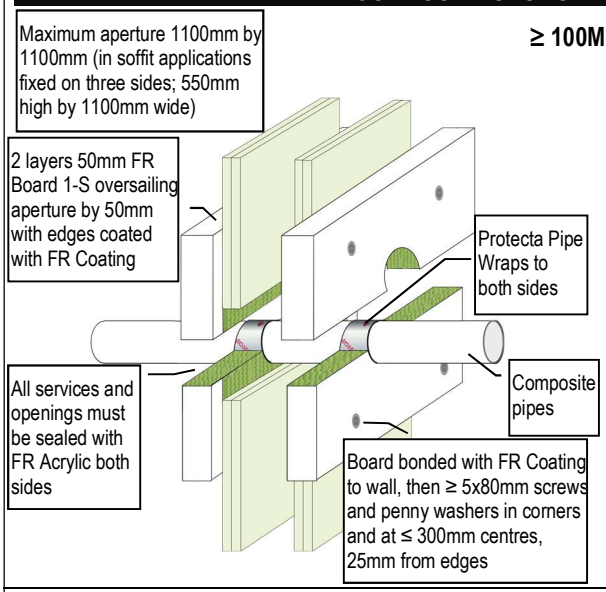

Services	FR Pipe Wrap	Classification
Ø 50mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)

COMPOSITE VALSIR BLACKFIRE PIPES FIRE RESISTANCE EI 0-60

≥ 75MM DRYWALLS OR RIGID WALLS

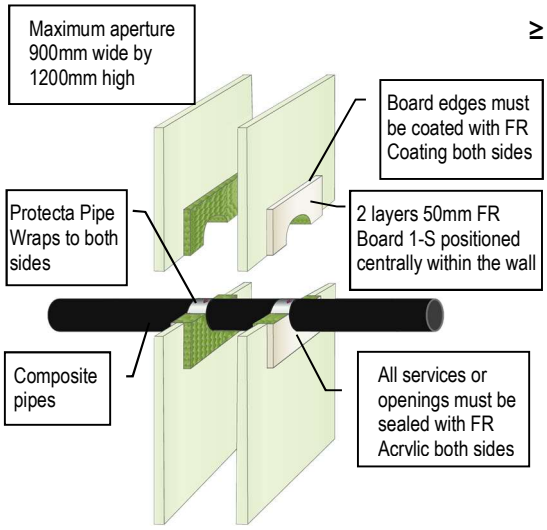

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 40mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 50mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 75mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE VALSIR BLACKFIRE PIPES FIRE RESISTANCE EI 0-120

≥ 100MM DRYWALLS OR RIGID WALLS

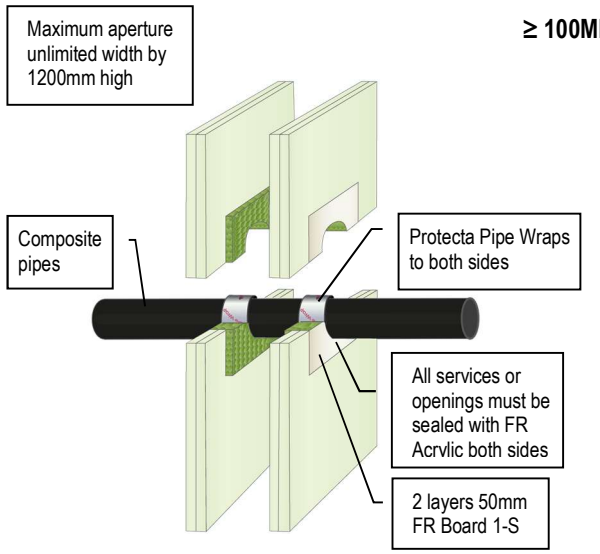

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
39 (86) 2025 2 7

COMPOSITE VALSIR BLACKFIRE PIPES FIRE RESISTANCE EI 0-120

≥ 100MM DRYWALLS OR RIGID WALLS

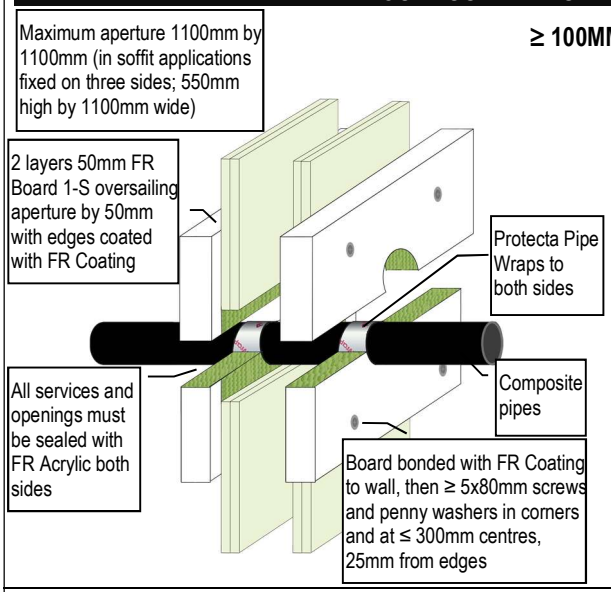

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE VALSIR PP3 PIPES FIRE RESISTANCE EI 20-60

≥ 75MM DRYWALLS OR RIGID WALLS

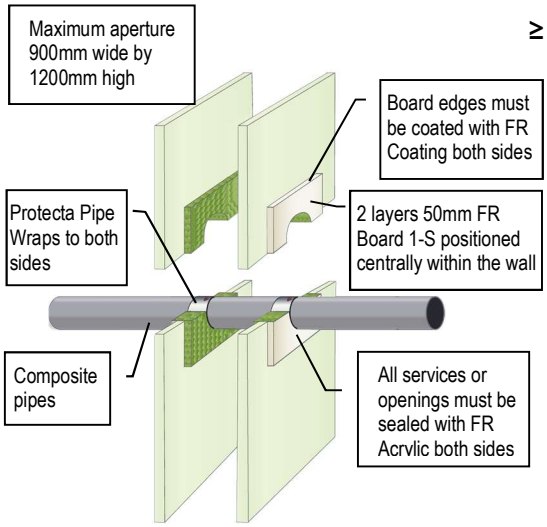

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 60 U/U)
Ø 40mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 60 U/U)
Ø 50mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 60 U/U)
Ø 75mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE VALSIR PP3 PIPES FIRE RESISTANCE EI 20-120

≥ 100MM DRYWALLS OR RIGID WALLS

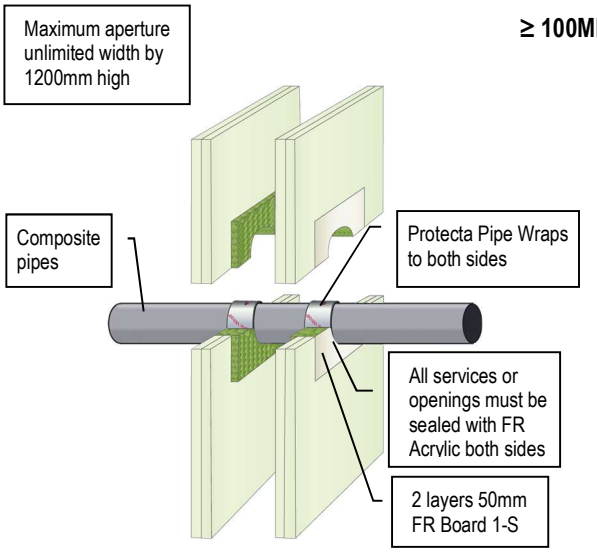

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 40mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 50mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 75mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
40 (86) 2025 2 7

COMPOSITE VALSIR PP3 PIPES FIRE RESISTANCE EI 20-120

≥ 100MM DRYWALLS OR RIGID WALLS

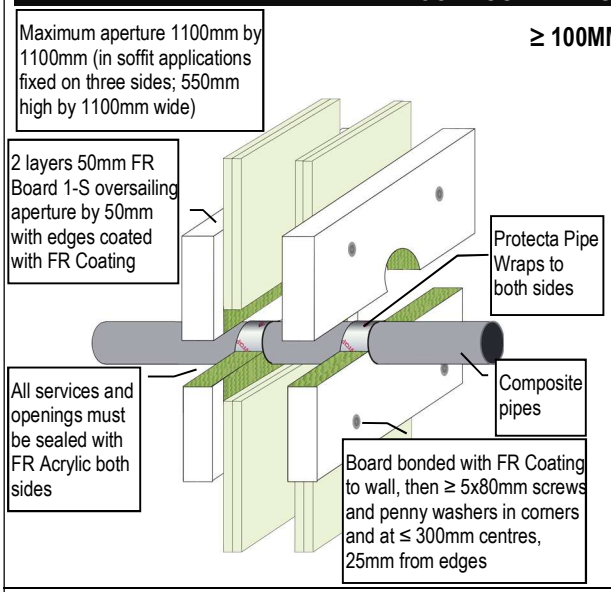

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 40mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 50mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 75mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE VALSIR TRIPLUS PLASTIC PIPES FIRE RESISTANCE EI 0-60

≥ 75MM DRYWALLS OR RIGID WALLS

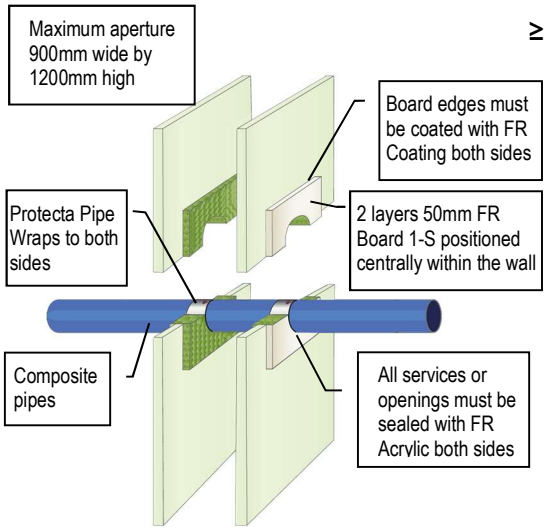

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 40mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 50mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 60 U/U)
Ø 75mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
Ø 160mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE VALSIR TRIPLUS PLASTIC PIPES FIRE RESISTANCE EI 0-120

≥ 100MM DRYWALLS OR RIGID WALLS

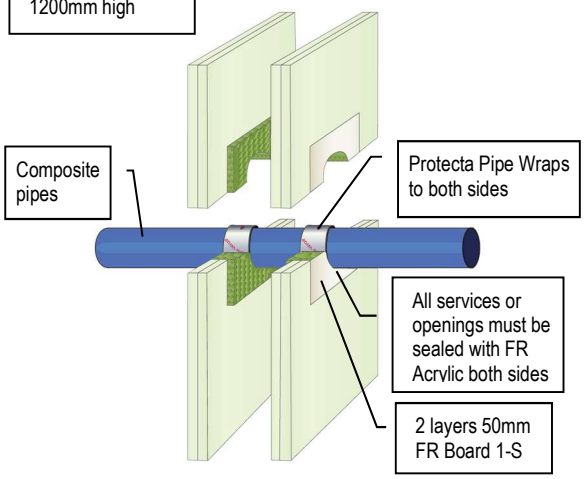

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 U/C)
Ø 160mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COMPOSITE VALSIR TRIPLUS PLASTIC PIPES FIRE RESISTANCE EI 0-120

≥ 100MM DRYWALLS OR RIGID WALLS

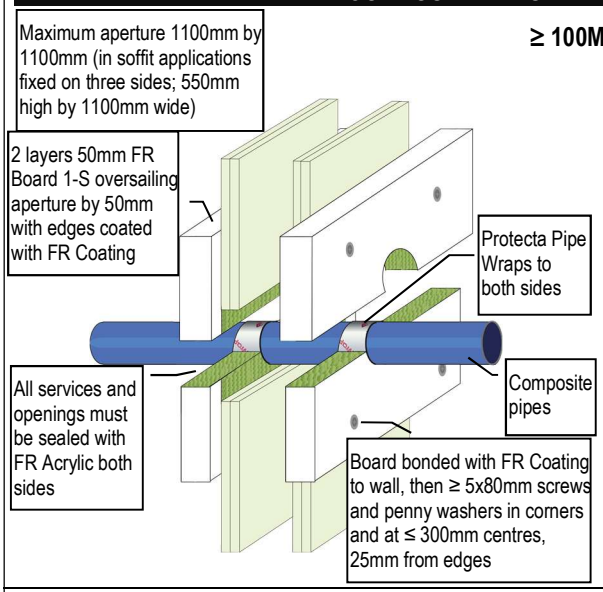

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 U/C)
Ø 160mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE WAVIN AS+ PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

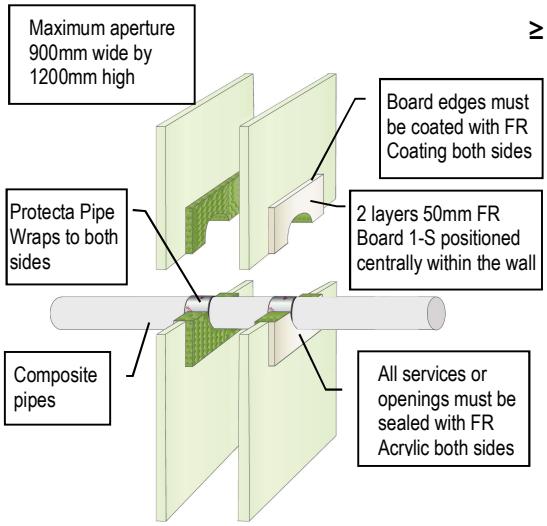

Services	FR Pipe Wrap	Classification
Ø 50mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 75mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 125mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)
Ø 160mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)
Ø 200mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 60 C/C (E 60 C/C)

COMPOSITE WAVIN AS+ PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

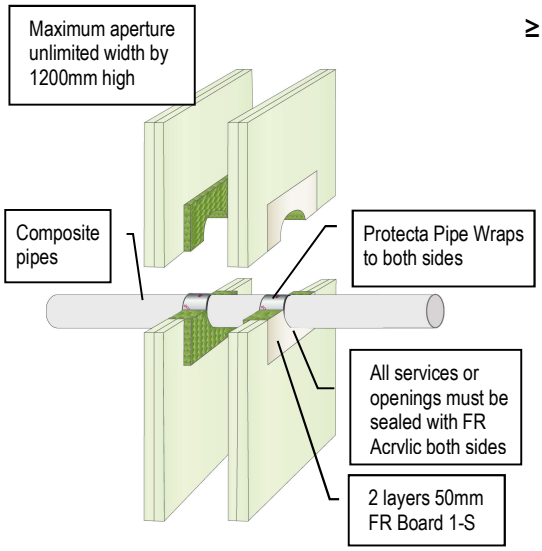

Services	FR Pipe Wrap	Classification
Ø 50mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 75mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 160mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 200mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COMPOSITE WAVIN AS+ PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM DRYWALLS OR RIGID WALLS

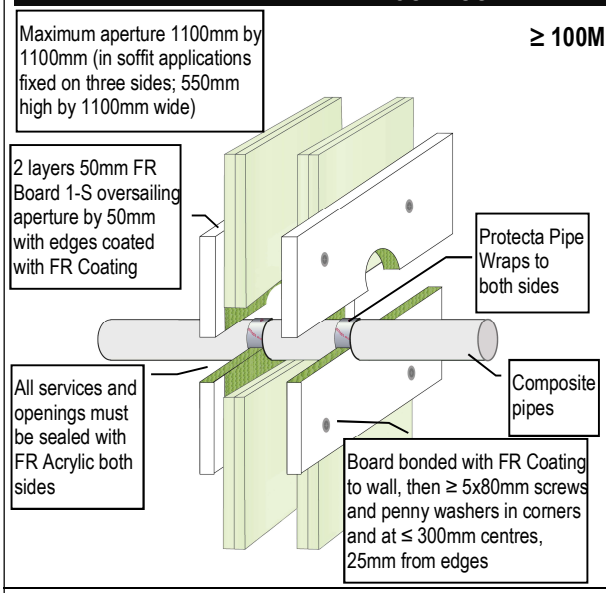

Services	FR Pipe Wrap	Classification
Ø 50mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 75mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 160mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 200mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)

COMPOSITE WAVIN SITECH PIPES FIRE RESISTANCE EI 60

≥ 75MM DRYWALLS OR RIGID WALLS

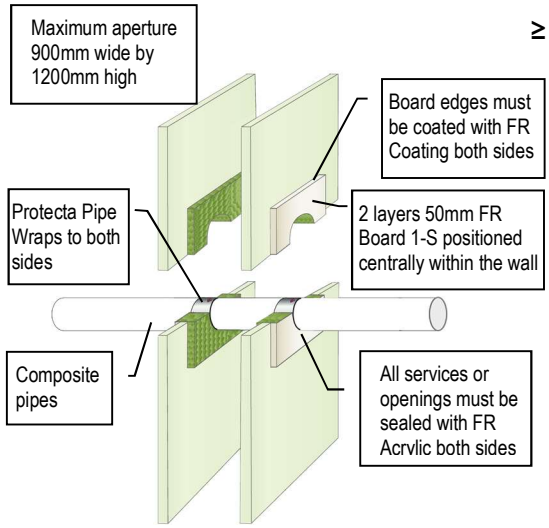

Services	FR Pipe Wrap	Classification
Ø 32mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 40mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 50mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/U (E 60 U/U)
Ø 75mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 90mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)
Ø 110mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 60 U/C)

COMPOSITE WAVIN SITECH PLASTIC PIPES FIRE RESISTANCE EI 60-90

≥ 100MM DRYWALLS OR RIGID WALLS

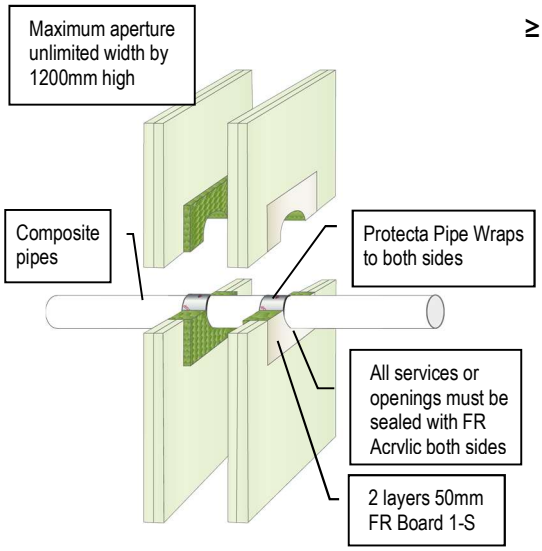

Services	FR Pipe Wrap	Classification
Ø 32mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 90mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 110mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

COMPOSITE WAVIN SITECH PLASTIC PIPES FIRE RESISTANCE EI 60-90

≥ 100MM DRYWALLS OR RIGID WALLS

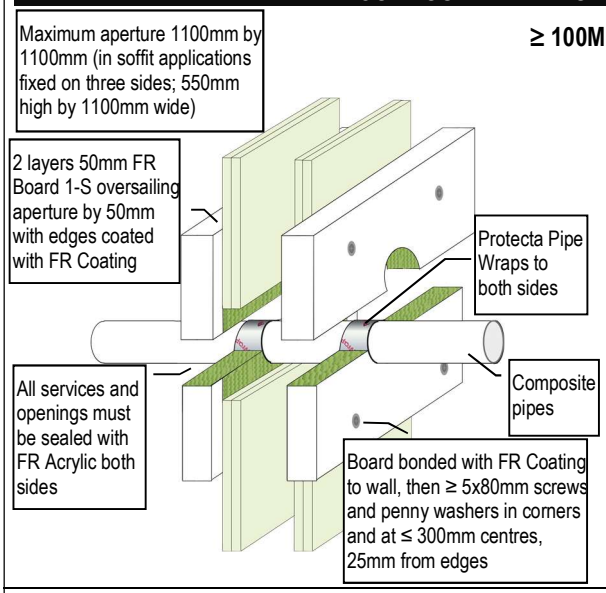

Services	FR Pipe Wrap	Classification
Ø 32mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 90mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 110mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)

HORIZONTAL LINEAR SEALS FIRE RESISTANCE EI 120 (E120)

≥ 100MM TIMBER WALLS

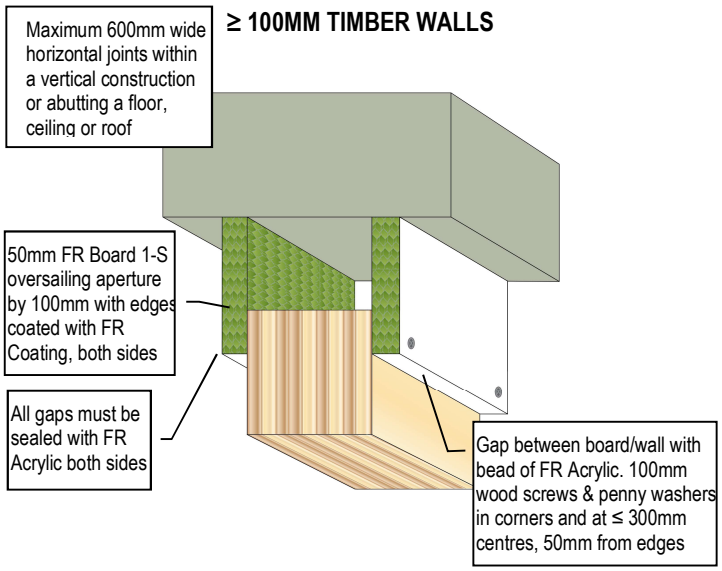

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM TIMBER WALLS

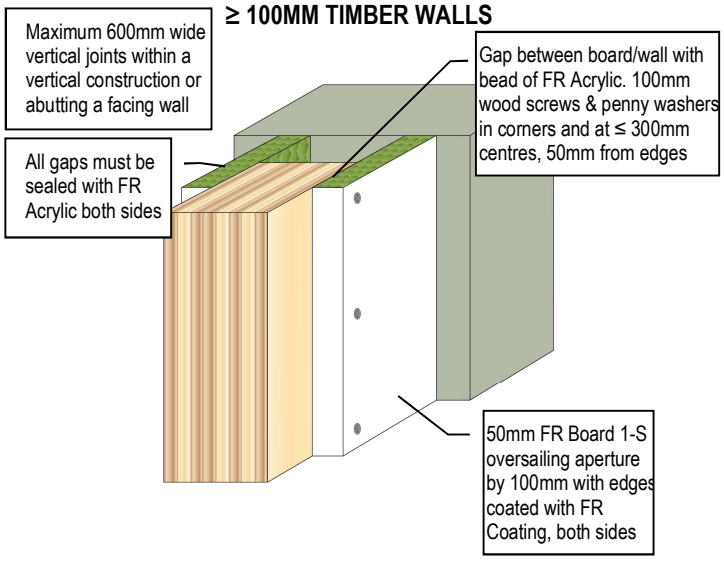

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 120)

≥ 100MM TIMBER WALLS

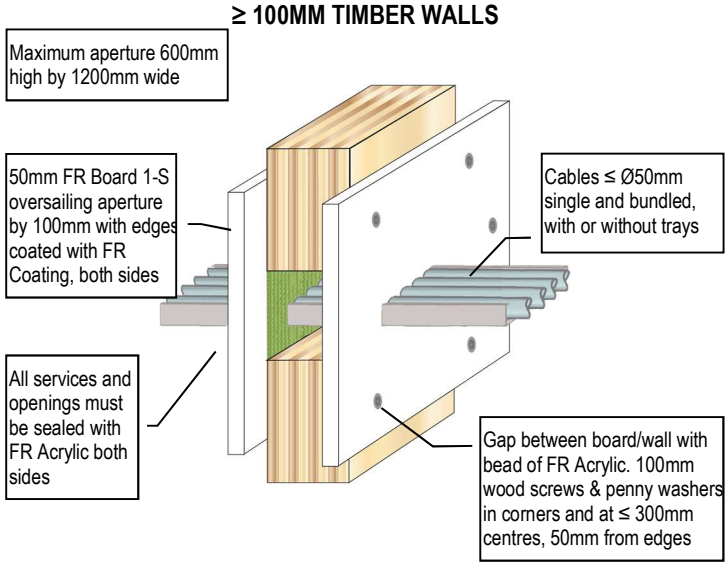

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 60)

≥ 100MM TIMBER WALLS

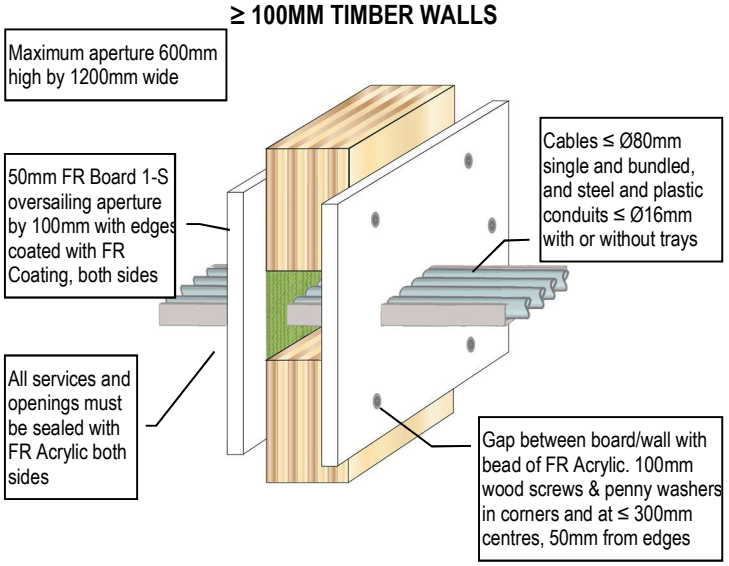

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
44 (86) 2025 2 7

BUS-BARS FIRE RESISTANCE EI 30 (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

Aluminium bus-bars ≤ 592 x 150mm and cross section ≤ 5275mm²

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

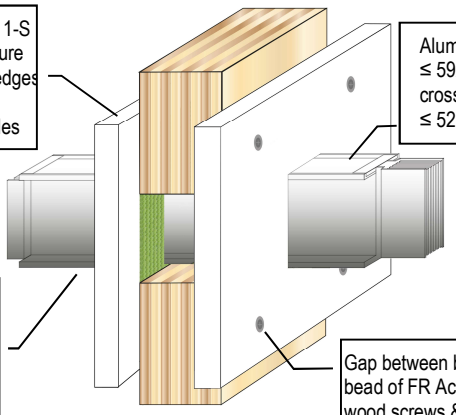

BUS-BARS FIRE RESISTANCE EI 90 (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

Aluminium bus-bars ≤ 592 x 150mm and cross section ≤ 5275mm²

1 layer 50mm FR Board 1-S ≥ 500mm on both sides, bonded to the fire seal with Protecta FR Adhesive and fixed with 3 pcs 80mm pig-tails in the corners 150mm apart

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

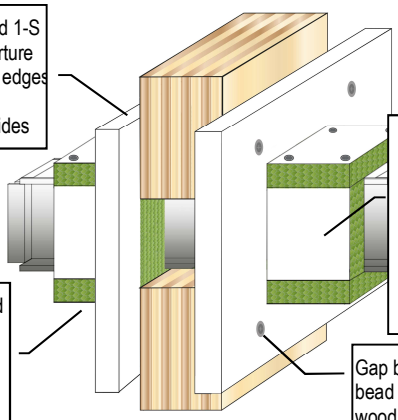

TRUNKING FIRE RESISTANCE EI 120 U/U (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture same as trunking plus ≤ 3mm gap

2 layers 50mm FR Board 1-S friction fitted inside trunking flush with the wall

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

PVC trunking ≤ 150x150mm with wall thickness 3mm

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

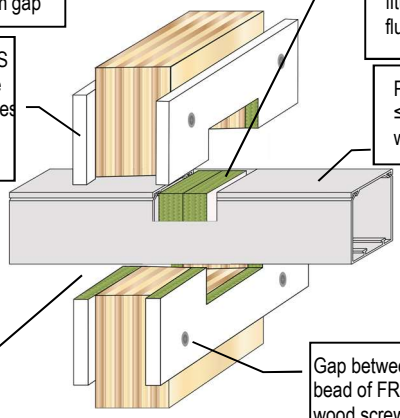

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

Steel pipes ≤ Ø22mm

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

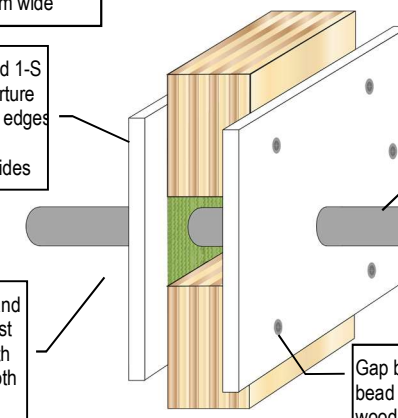

STEEL PIPES FIRE RESISTANCE EI 30 C/U (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

Steel pipes ≤ Ø63mm

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

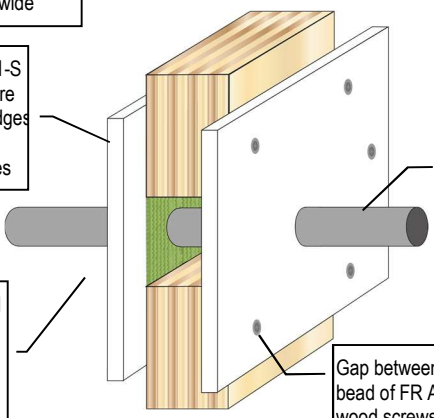

STEEL PIPES FIRE RESISTANCE EI 20 C/U (E 120)

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

50mm FR Board 1-S oversailing aperture by 100mm with edges coated with FR Coating, both sides

Steel pipes ≤ Ø324mm

All services and openings must be sealed with FR Acrylic both sides

Gap between board/wall with bead of FR Acrylic. 100mm wood screws & penny washers in corners and at ≤ 300mm centres, 50mm from edges

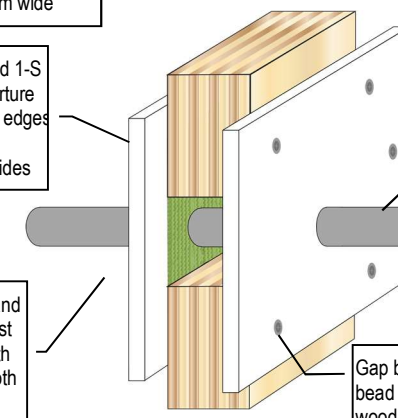

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu

Polyseam Ltd tel.+44(0)1484421036

45 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM TIMBER WALLS

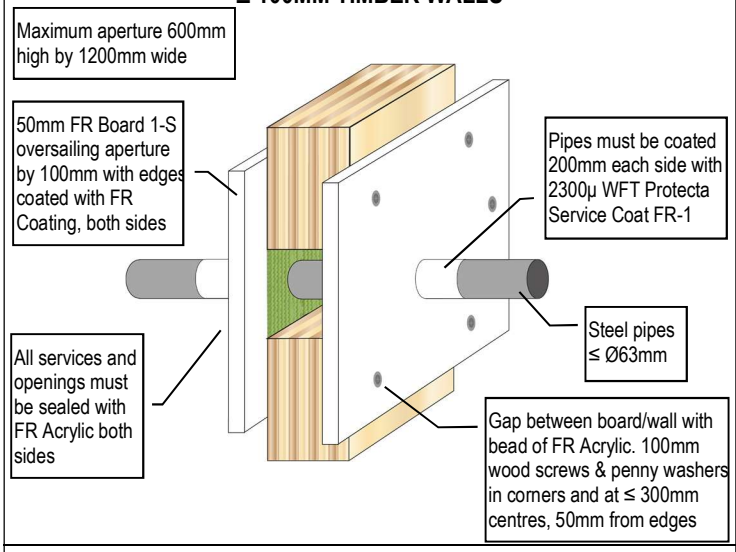

STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

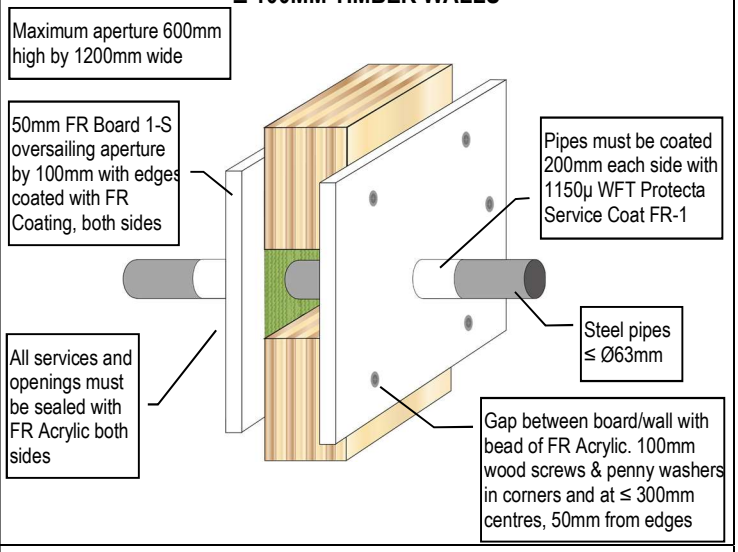

STEEL PIPES FIRE RESISTANCE EI 45 C/U (E 120)

≥ 100MM TIMBER WALLS

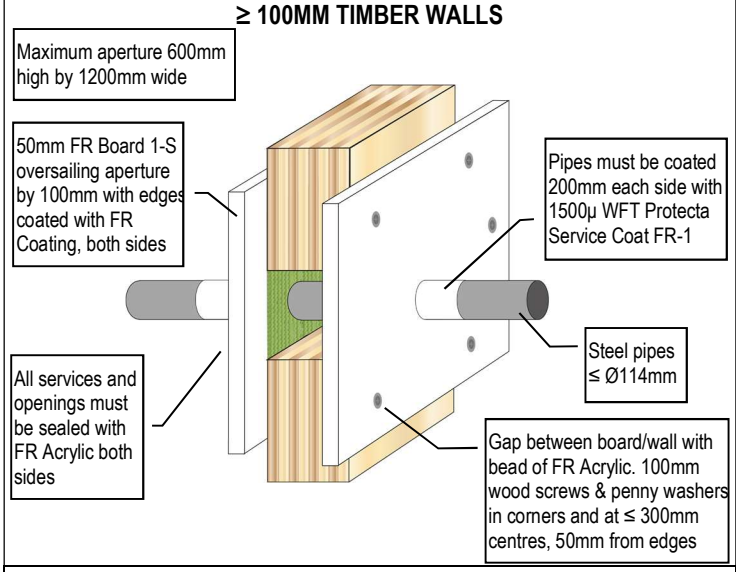

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 U/U (E 120)

≥ 100MM TIMBER WALLS

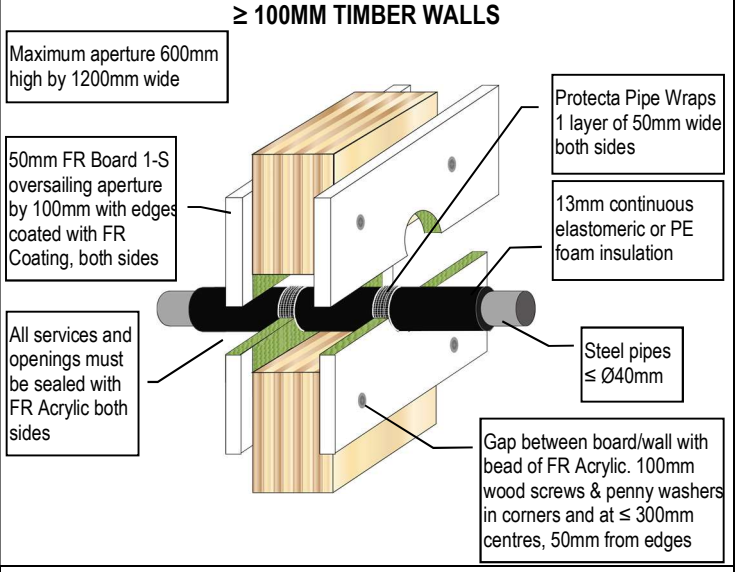

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 U/U (E 120)

≥ 100MM TIMBER WALLS

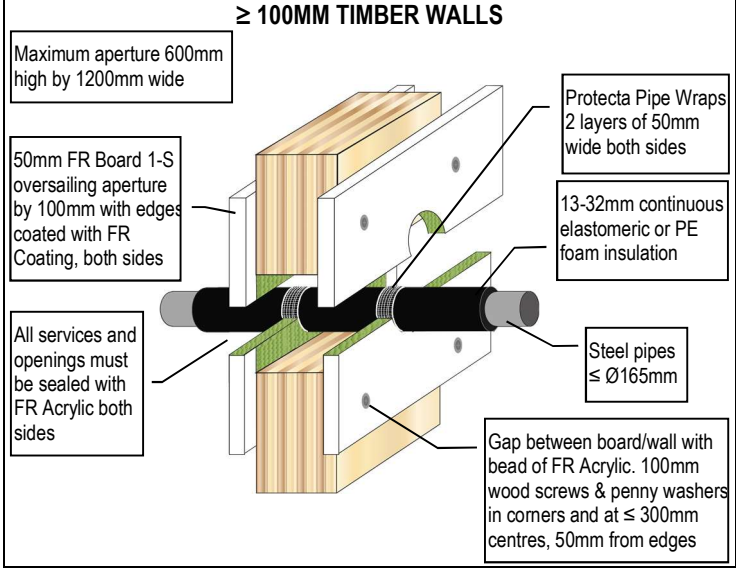

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM TIMBER WALLS

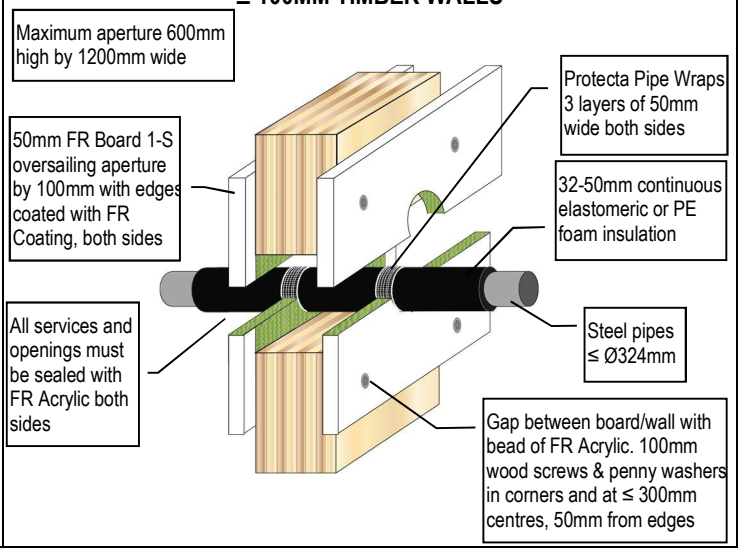

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM TIMBER WALLS

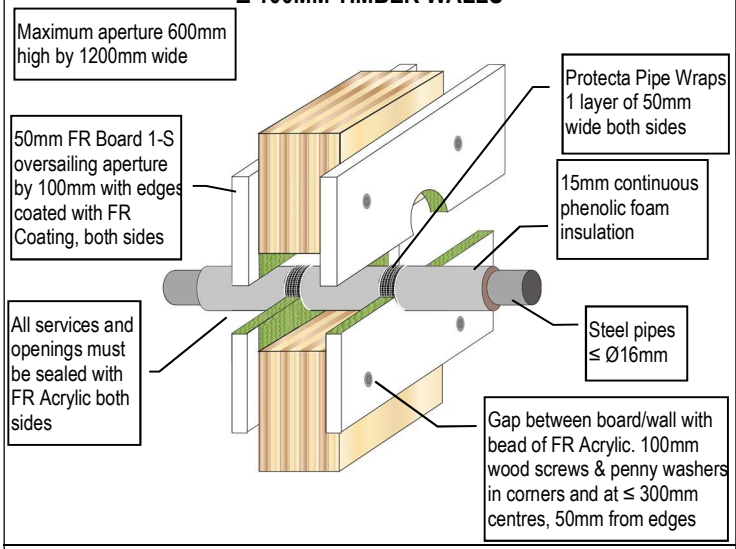

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 100MM TIMBER WALLS

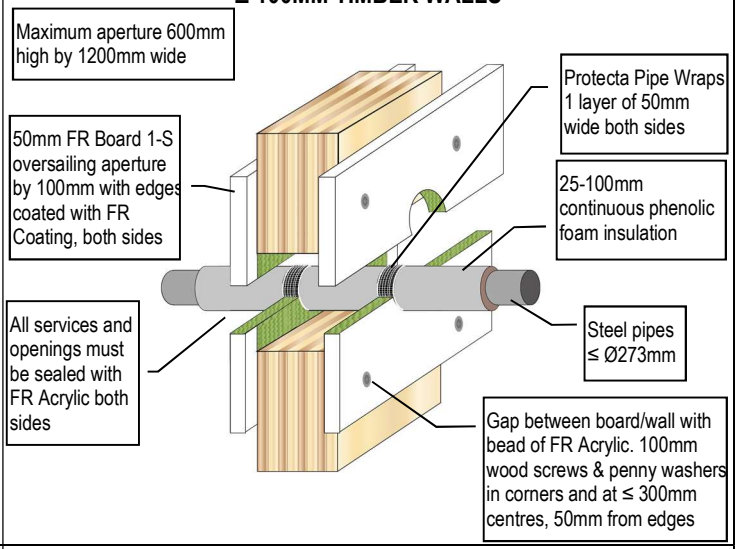

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 60)

≥ 100MM TIMBER WALLS

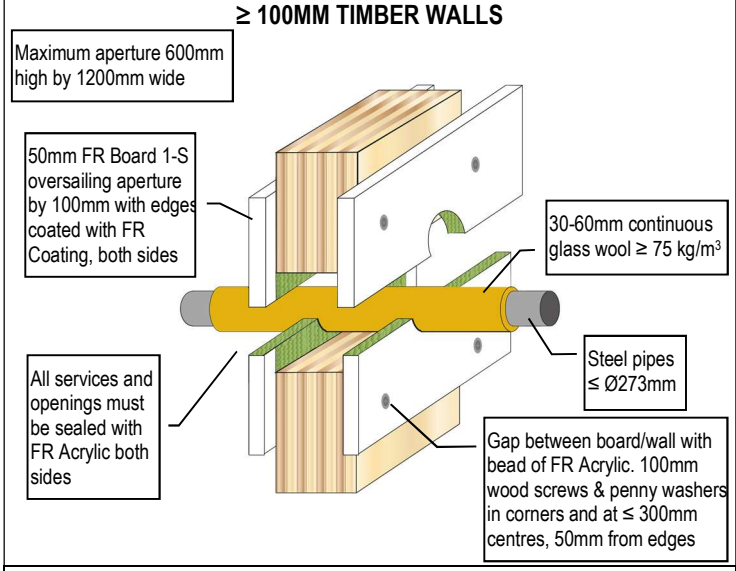

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 100MM TIMBER WALLS

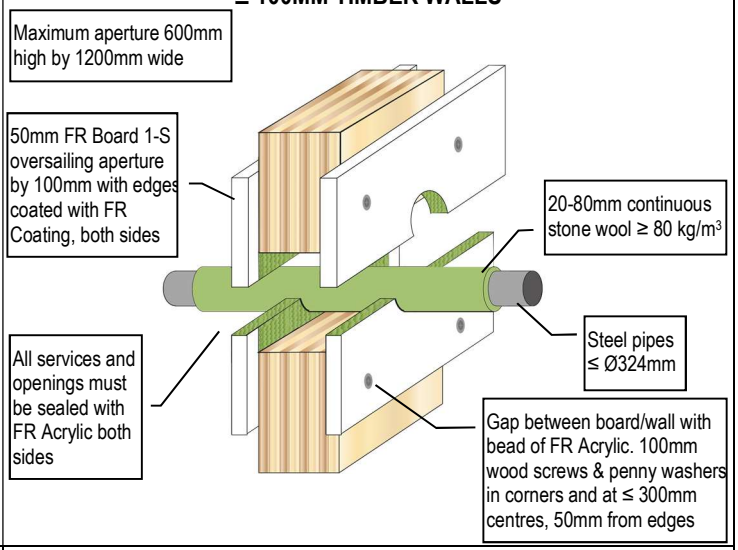

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 100MM TIMBER WALLS

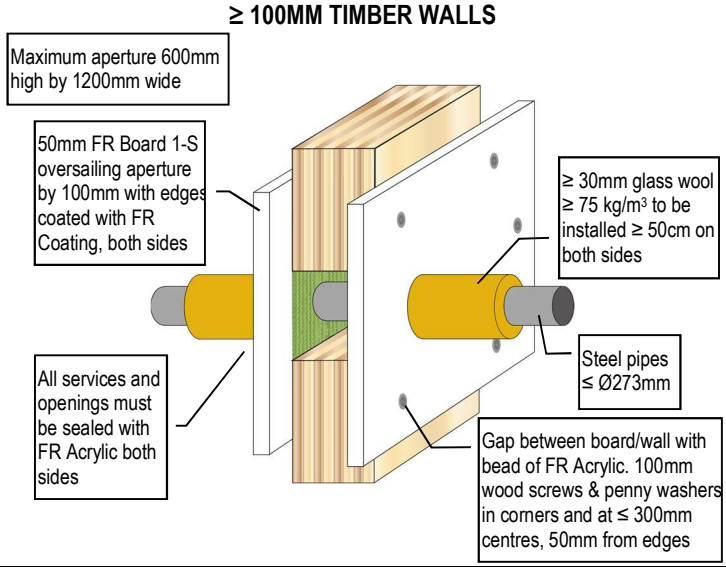

STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 100MM TIMBER WALLS

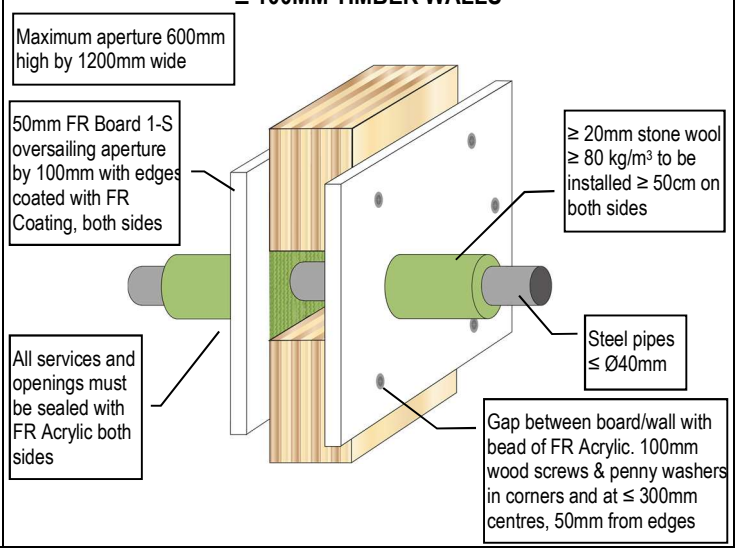

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
47 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 100MM TIMBER WALLS

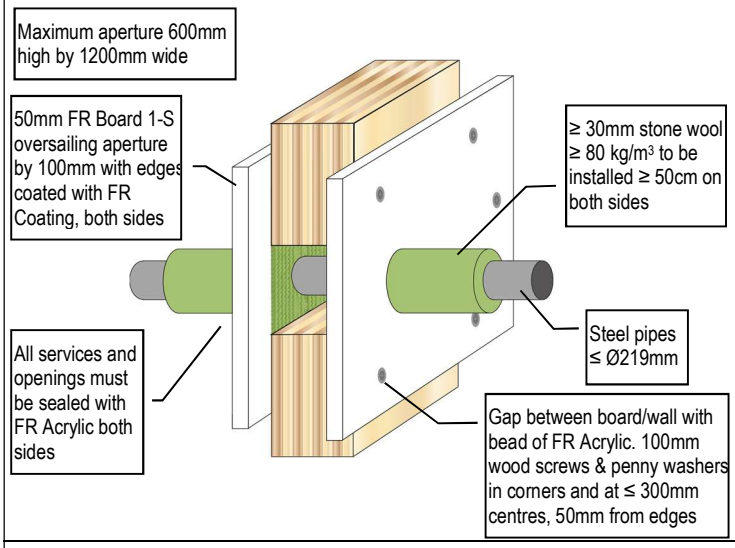

GAS PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM TIMBER WALLS

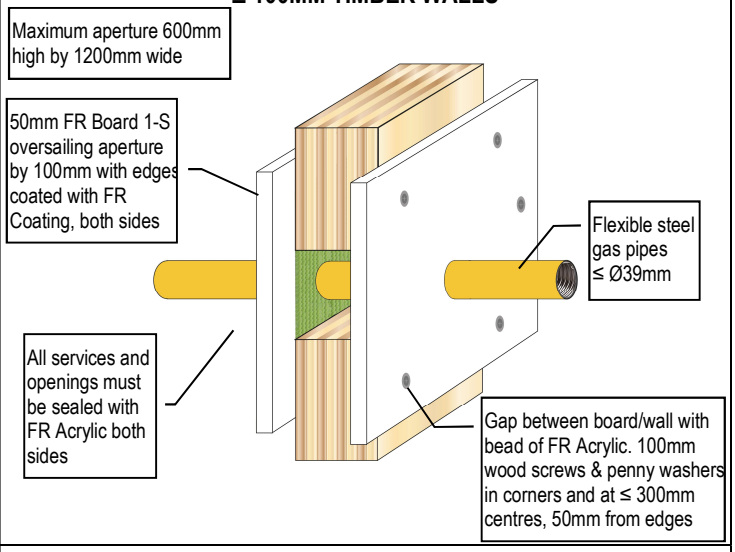

GAS PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

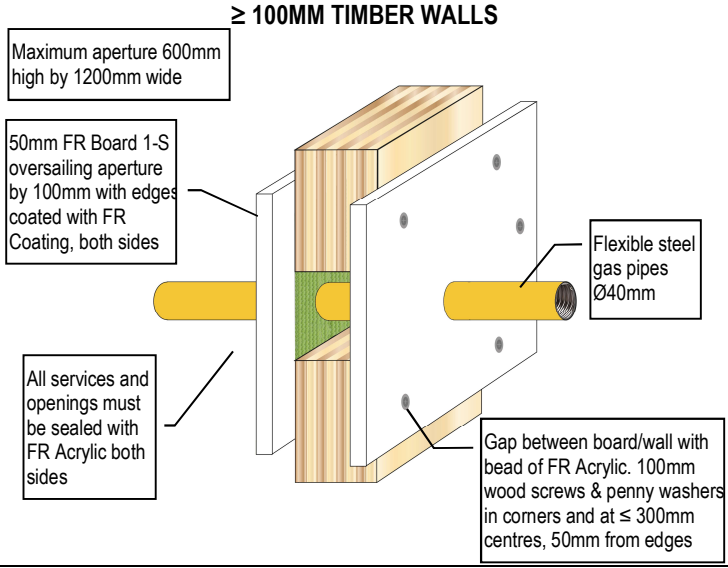

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM TIMBER WALLS

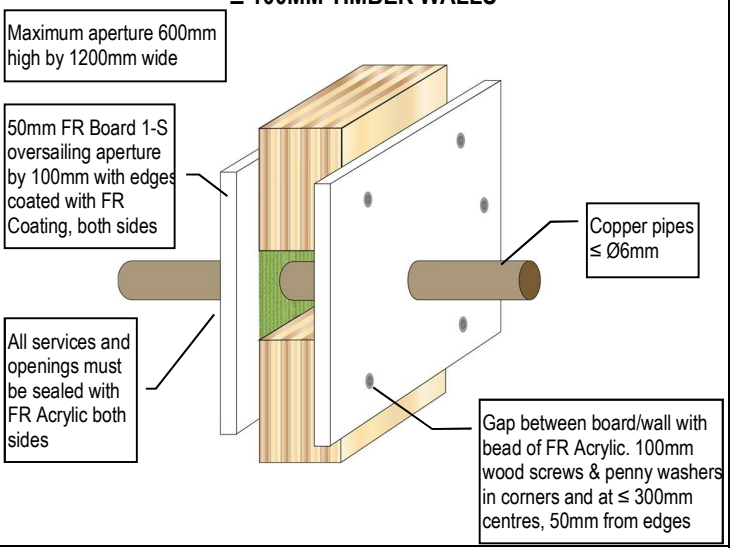

COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 120)

≥ 100MM TIMBER WALLS

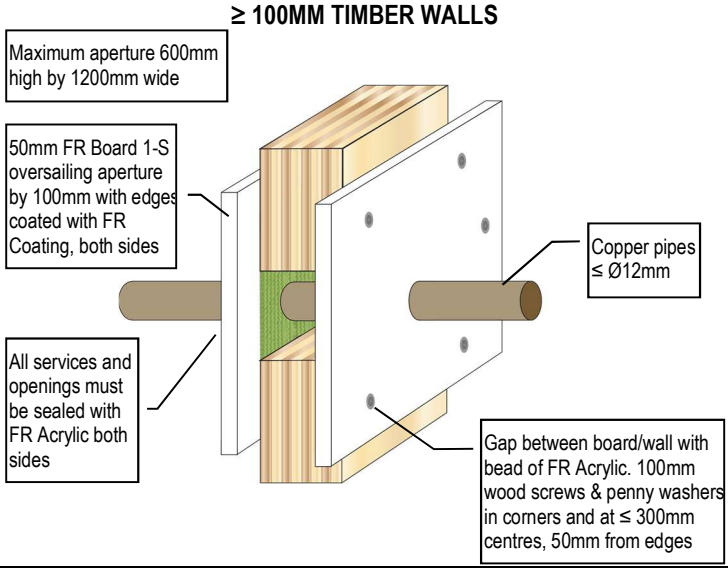

COPPER PIPES FIRE RESISTANCE EI 15 C/C (E 120)

≥ 100MM TIMBER WALLS

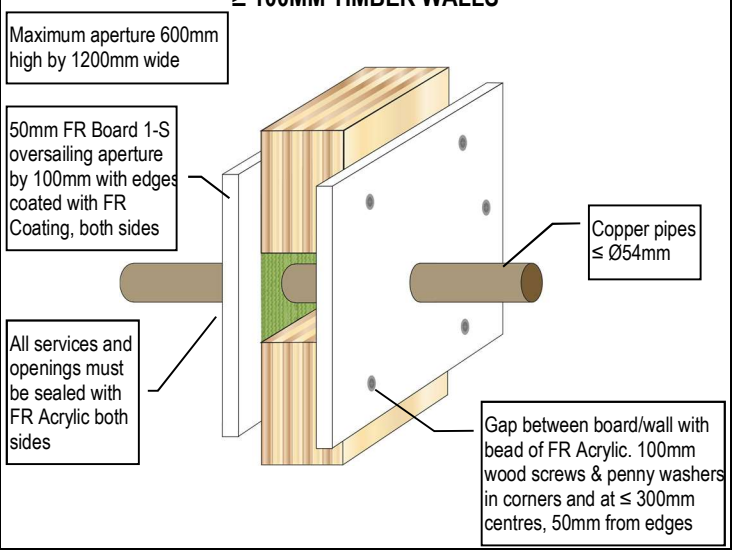

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
48 (86) 2025 2 7

INSULATED COPPER PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

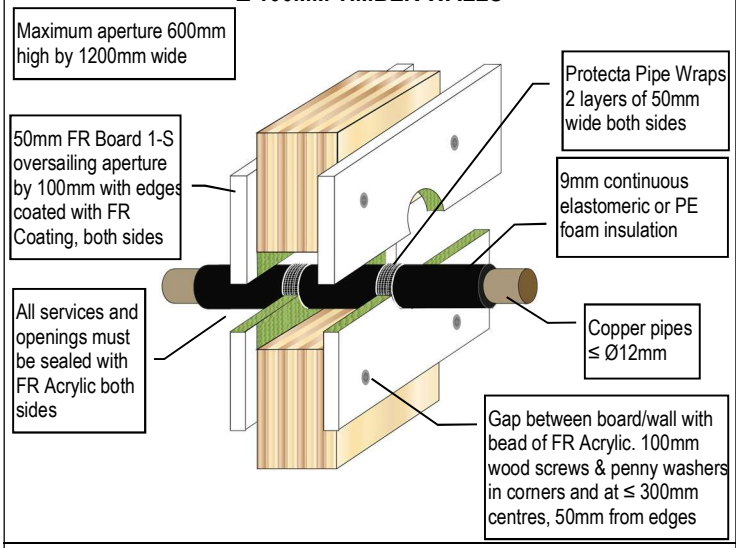

INSULATED COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM TIMBER WALLS

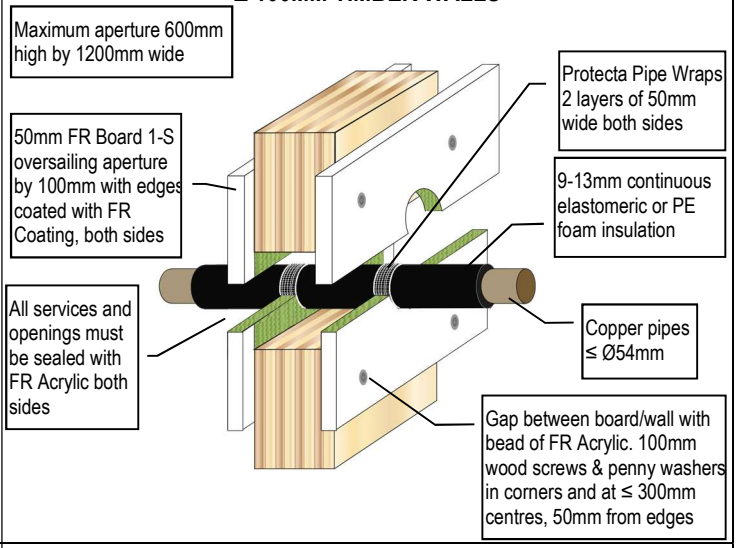

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM TIMBER WALLS

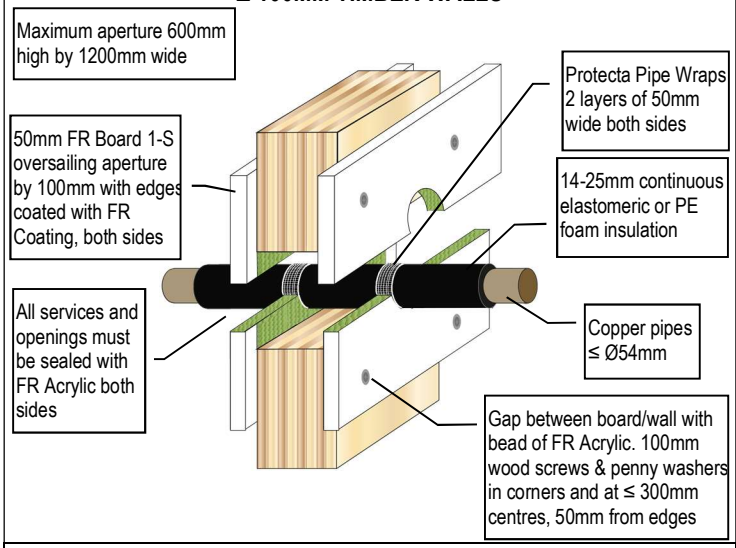

INSULATED COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM TIMBER WALLS

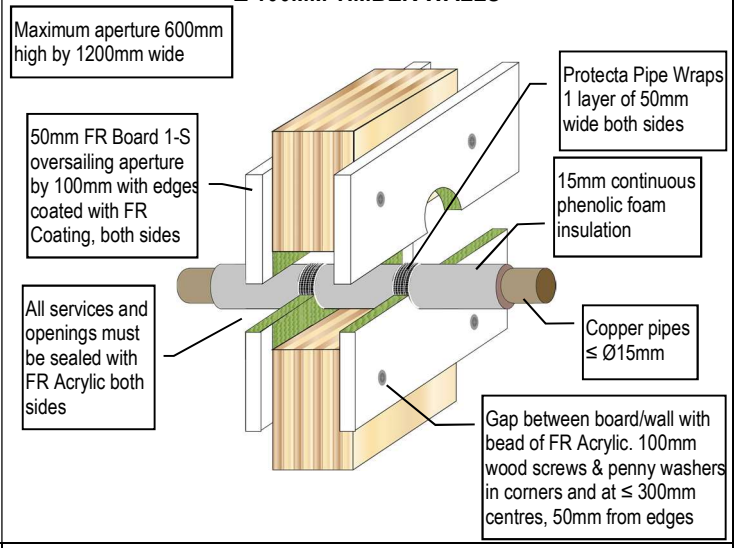

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

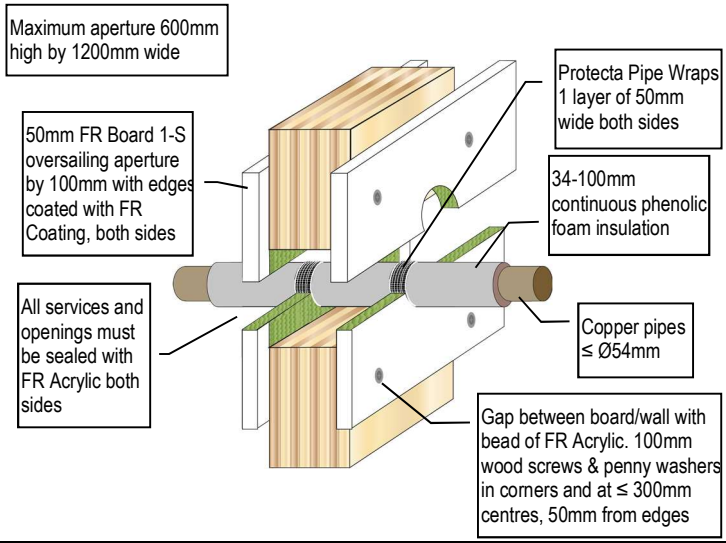

INSULATED COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 100MM TIMBER WALLS

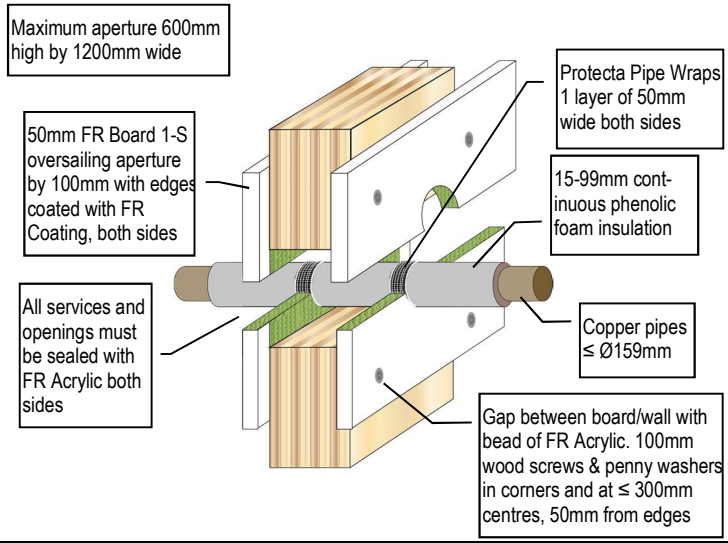

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
49 (86) 2025 2 7

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

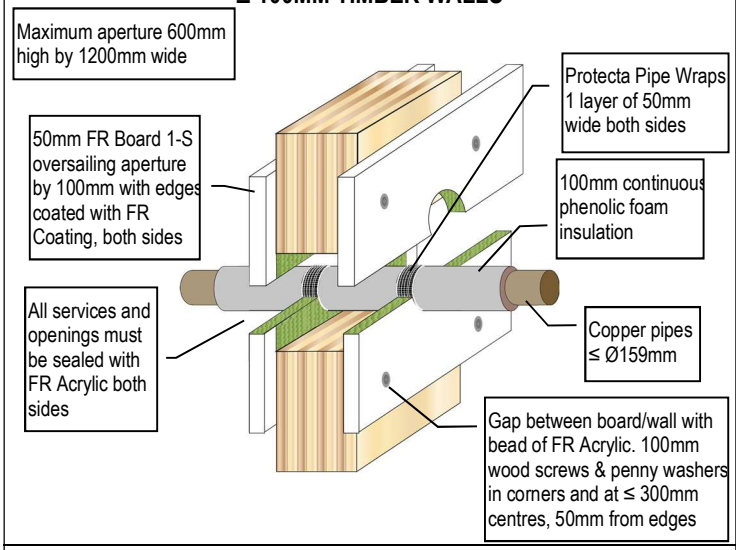

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 100MM TIMBER WALLS

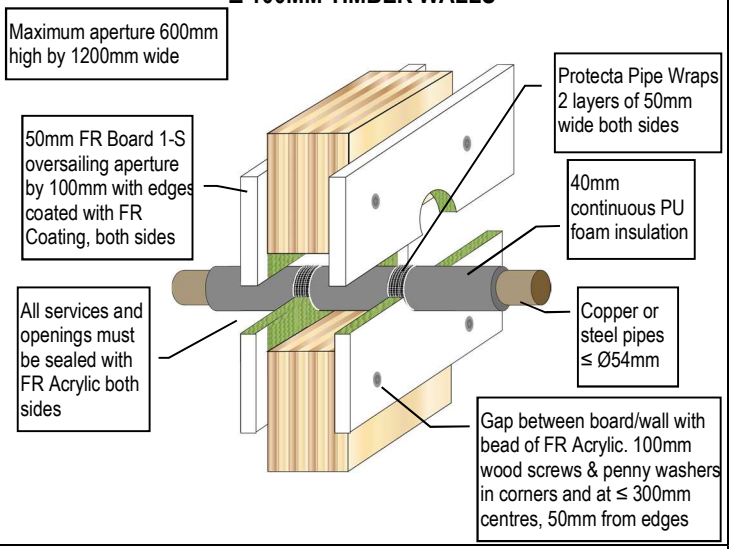

COPPER & STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

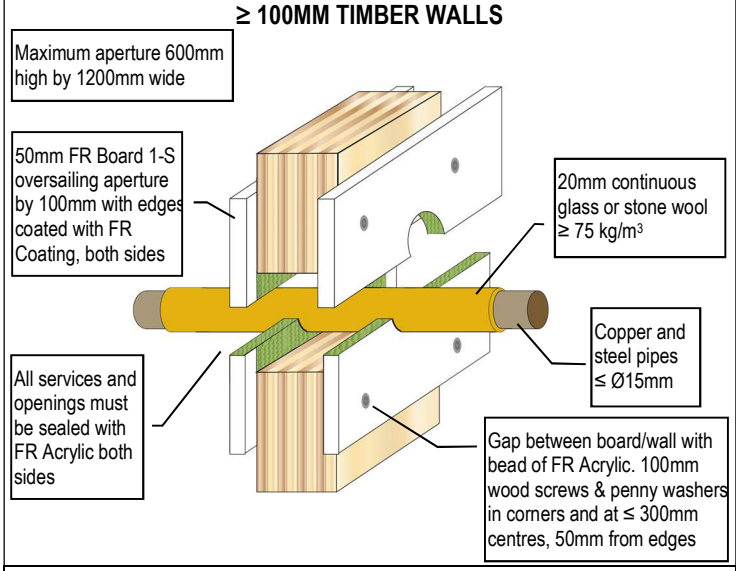

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

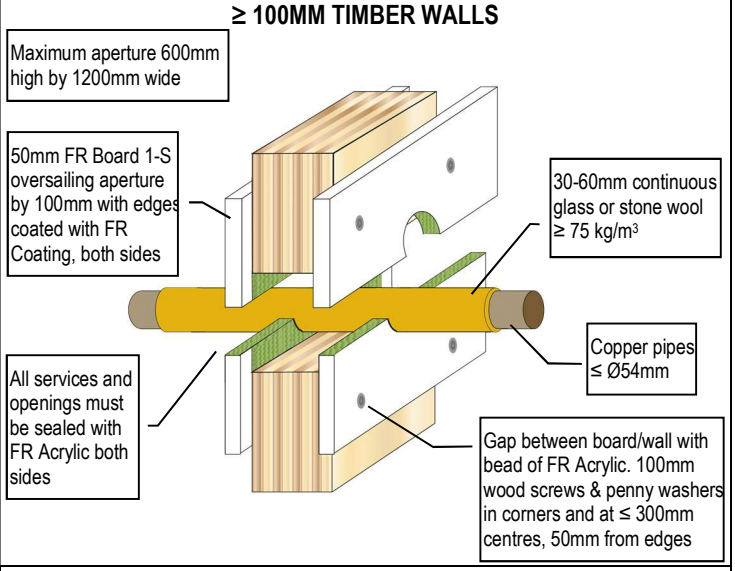

COPPER PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

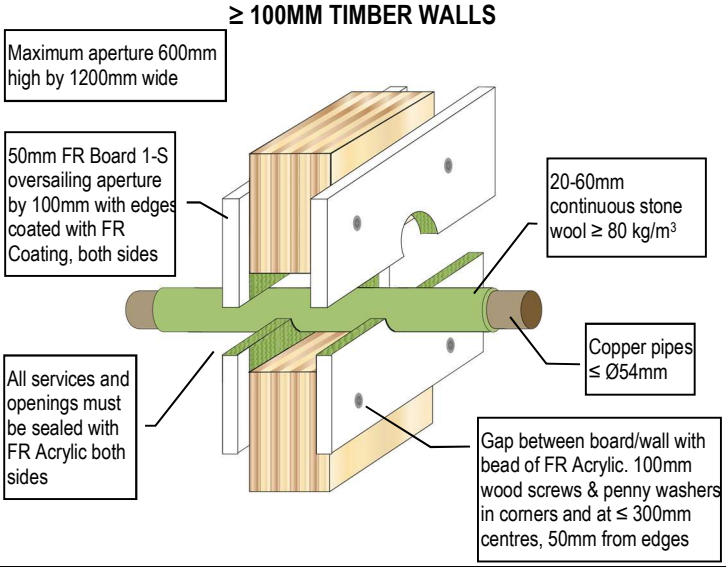

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 100MM TIMBER WALLS

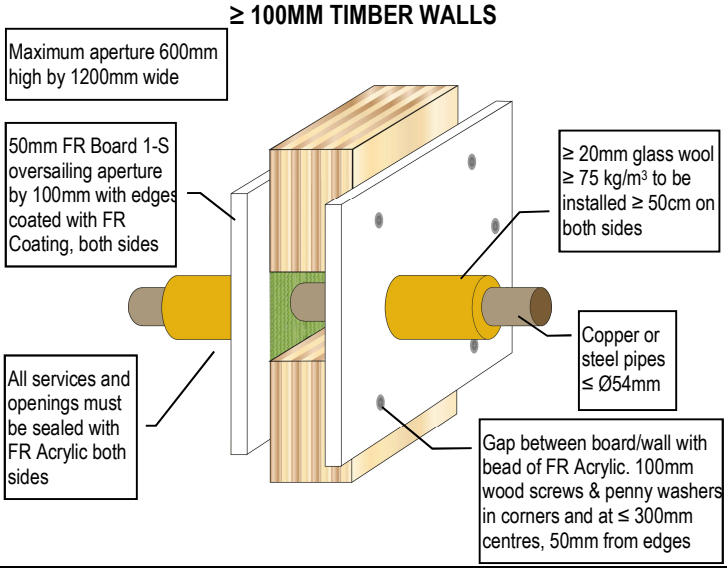

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
50 (86) 2025 2 7

COPPER OR STEEL PIPES FIRE RESISTANCE EI 30 C/C (E 120)

≥ 100MM TIMBER WALLS

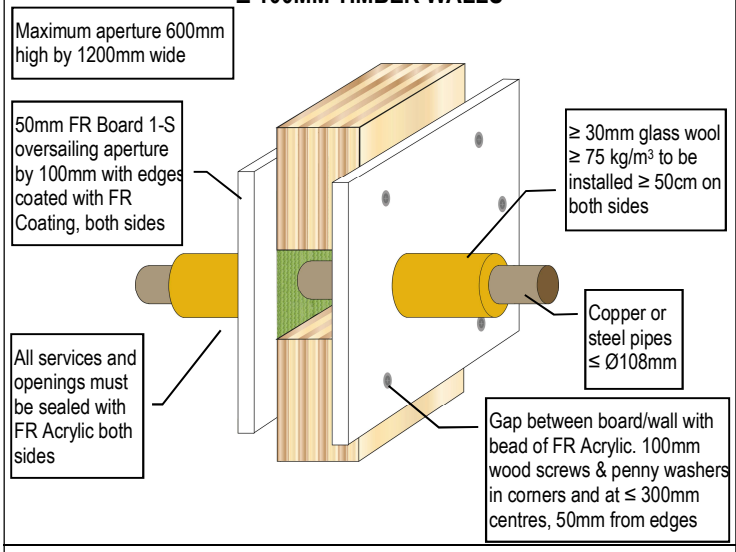

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

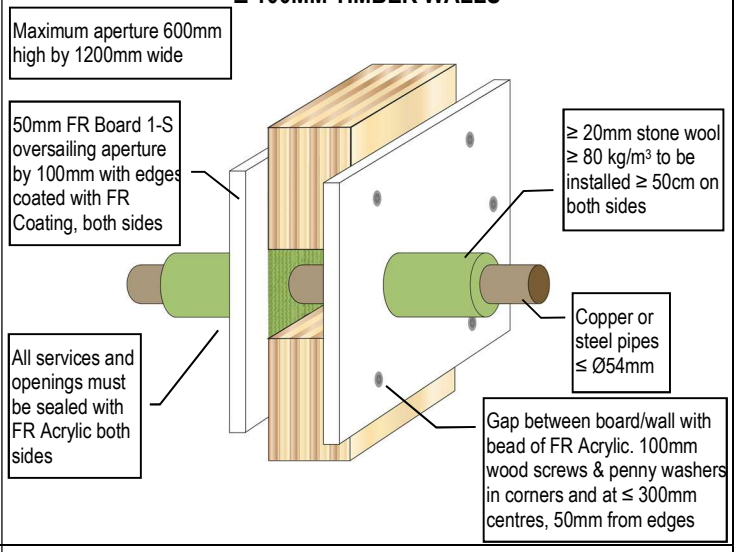

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

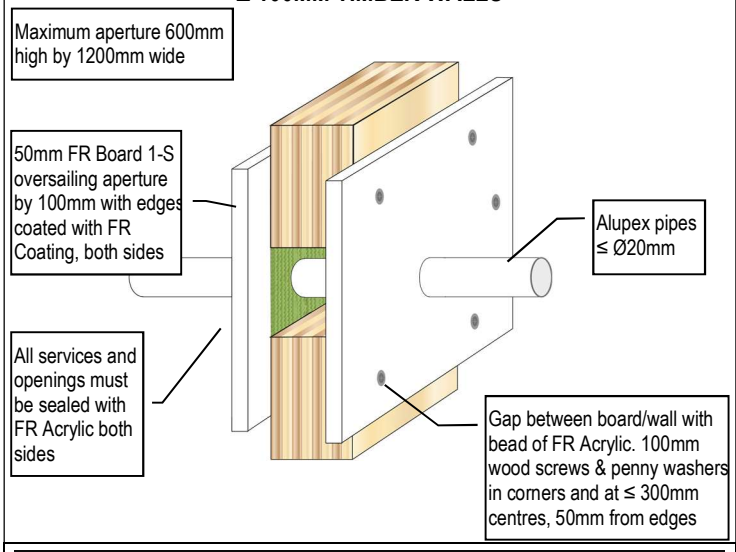

ALUPEX PIPES FIRE RESISTANCE EI 20 C/C (E 120)

≥ 100MM TIMBER WALLS

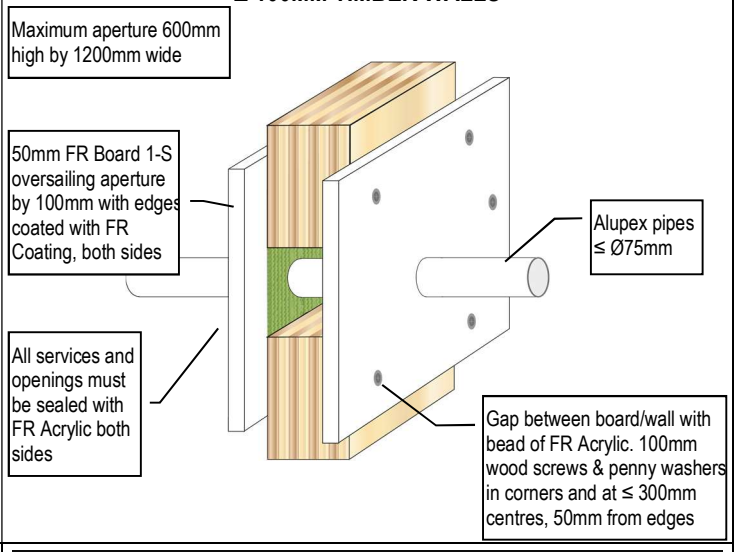

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

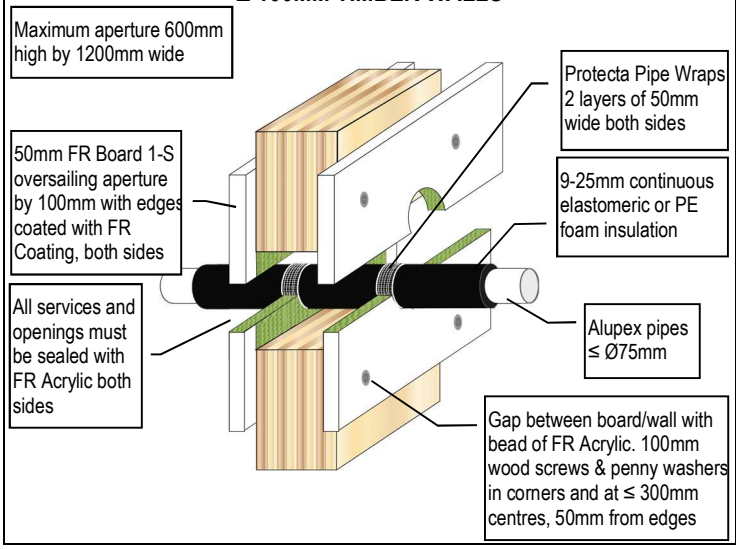

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 100MM TIMBER WALLS

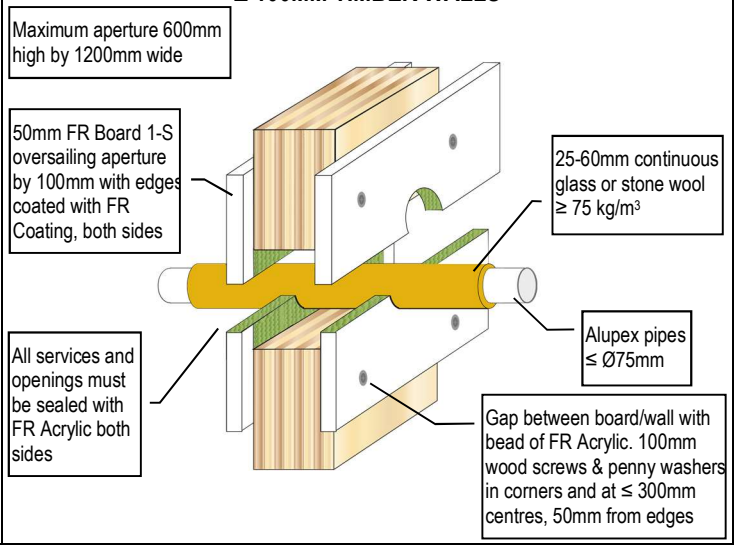

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
51 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM TIMBER WALLS

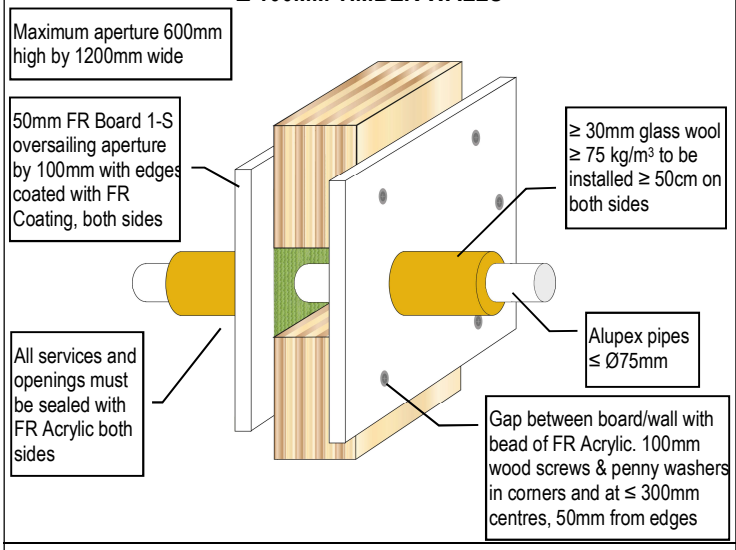

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

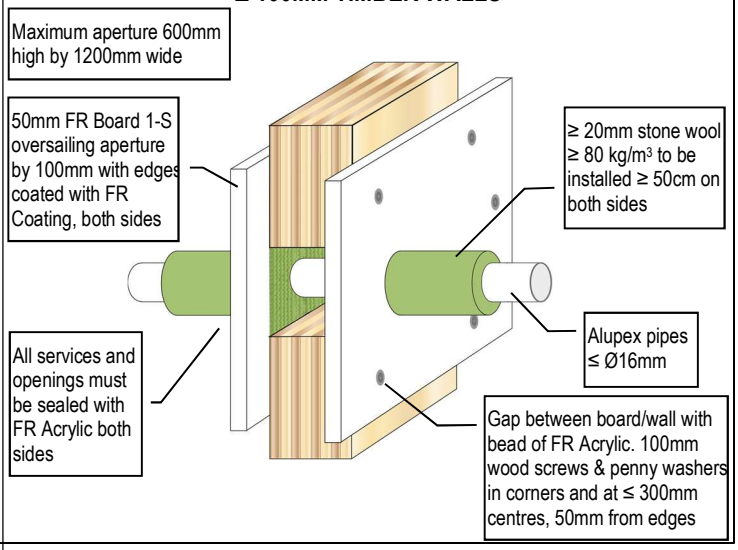

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

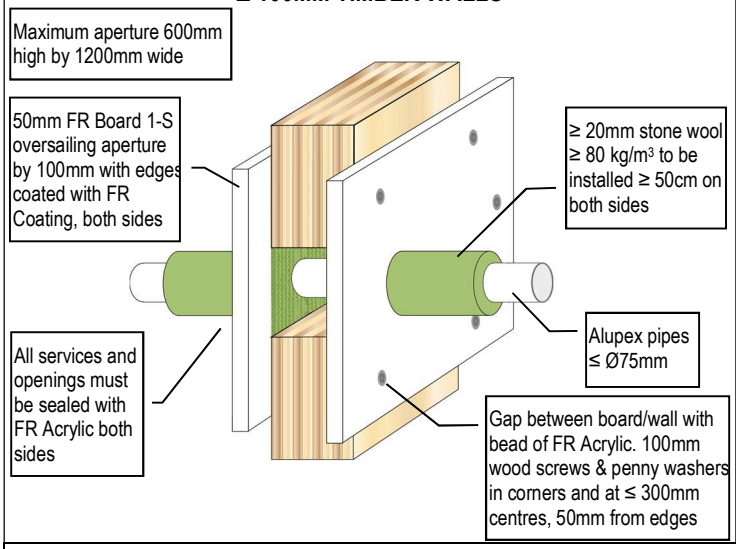

INSULATED METAL PIPES WITH FR GRAPHITE FIRE RESISTANCE EI 60-120

≥ 100MM TIMBER WALLS

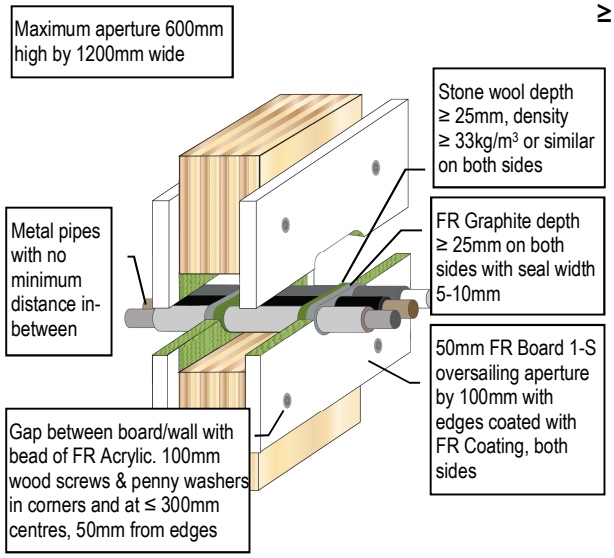

Services	Pipe Insulation	Classification
Ø6mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 120 C/C (E 120 C/C)
≤ Ø18mm steel or copper pipes	9mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	19mm elastomeric insulation class ≥ B-s3, d0	EI 90 C/C (E 120 C/C)
≤ Ø54mm steel or copper pipes	25mm phenolic foam insulation	EI 60 C/C (E 120 C/C)
Ø14mm alupex pipes	6mm PE foam insulation	EI 60 C/C (E 90 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
52 (86) 2025 2 7

PVC PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM TIMBER WALLS

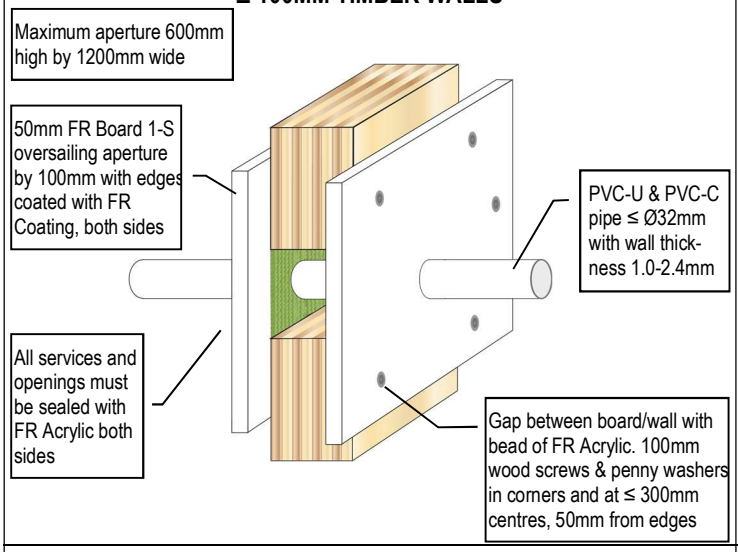

PE PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 100MM TIMBER WALLS

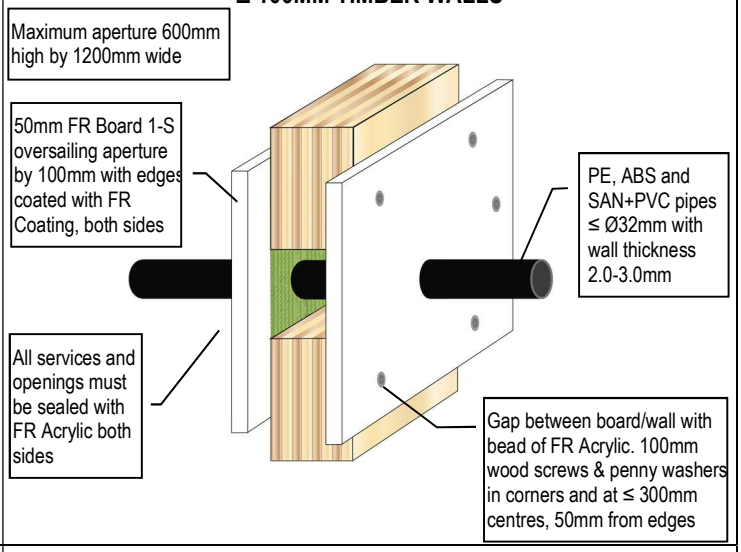

PP PIPES FIRE RESISTANCE EI 60 U/C (E 120)

≥ 100MM TIMBER WALLS

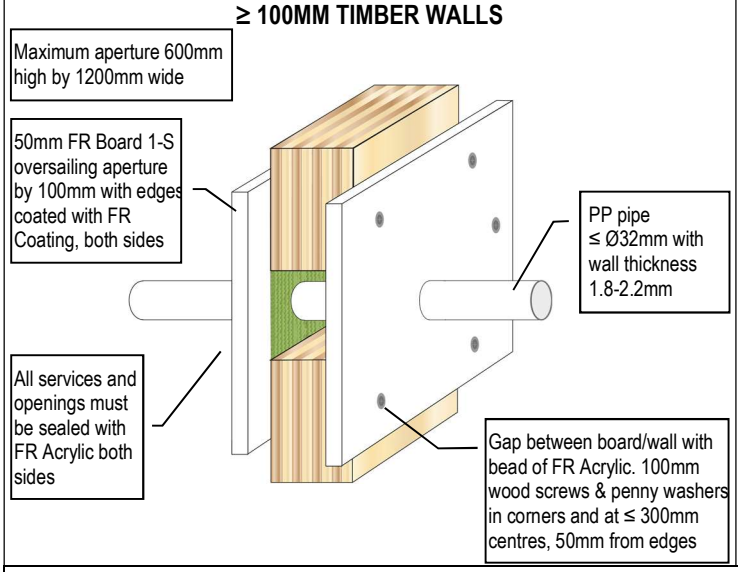

PP PIPES FIRE RESISTANCE EI 45 C/C (E 45)

≥ 100MM TIMBER WALLS

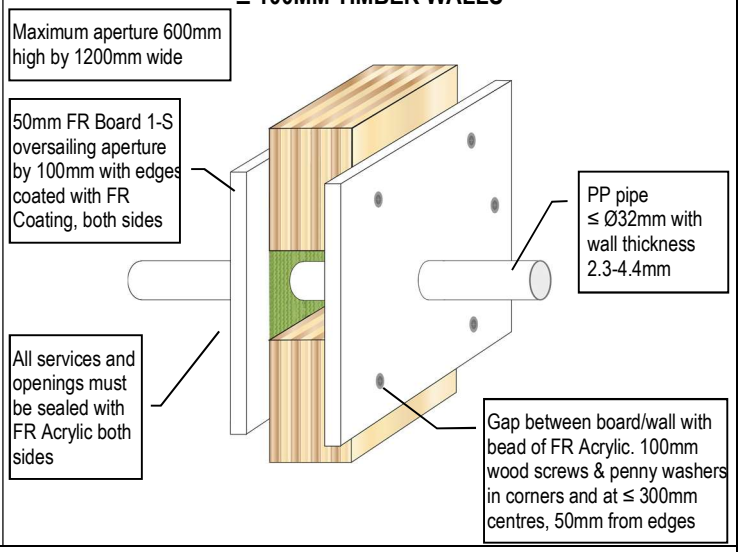

PLASTIC PIPES FIRE RESISTANCE EI 60-120

≥ 100MM TIMBER WALLS

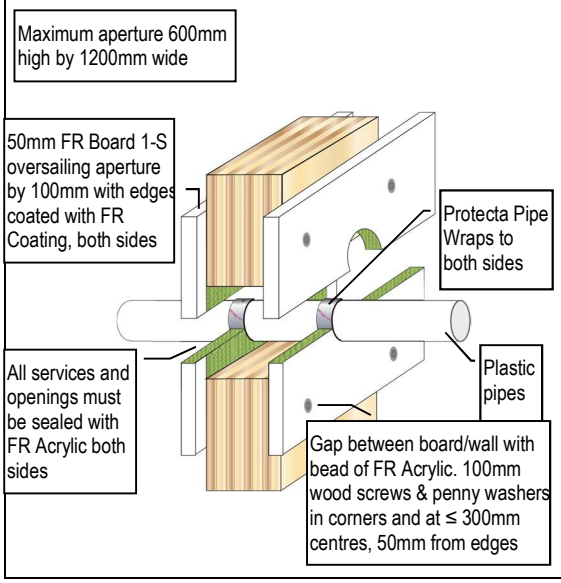

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.0 – 3.0mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 120 U/U (E 120 U/U)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	4.2 – 10.0mm	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 110mm PP	2.7 – 15.1mm	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
≤ Ø 125mm PVC-U & PVC-C	3.7 – 7.4mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 125mm PE, ABS & SAN+PVC	4.8 – 12.0mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 125mm PP	3.1 – 17.1mm	50 x 5.4mm (3 layers)	EI 90 U/C (E 120 U/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PP	4.9 – 21.9mm	50 x 10.8mm (6 layers)	EI 60 U/C (E 60 U/C)
≤ Ø 200mm PVC-U & PVC-C	4.9 – 11.9mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PE, ABS & SAN+PVC	6.2 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 200mm PP	4.9 – 18.2mm	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PVC-U & PVC-C	7.7 – 12.1mm	50 x 18.0mm (10 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	18.7mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 315mm PP	28.6mm	50 x 18.0mm (10 layers)	EI 60 C/C (E 60 C/C)
≤ Ø 400mm PVC-U & PVC-C	9.8 – 15.3mm	50 x 28.8mm (16 layers)	EI 90 C/C (E 90 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	23.7mm	50 x 28.8mm (16 layers)	EI 60 C/C (E 60 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
53 (86) 2025 2 7

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

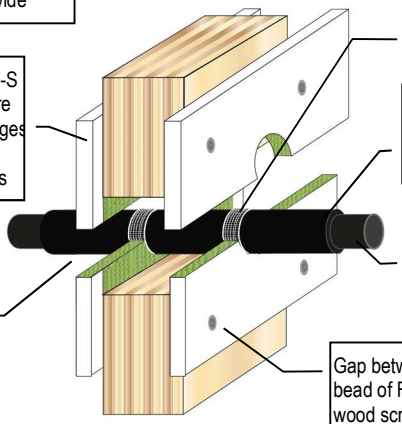

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

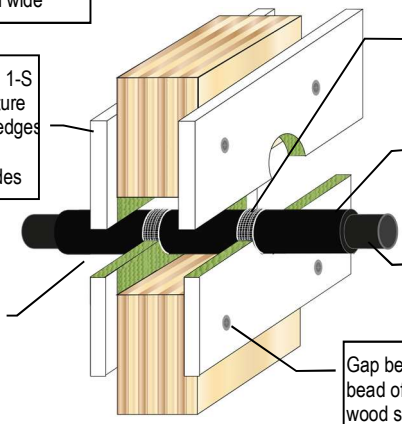

INSULATED PE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

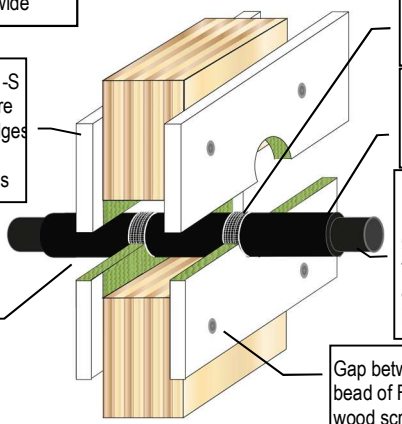

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

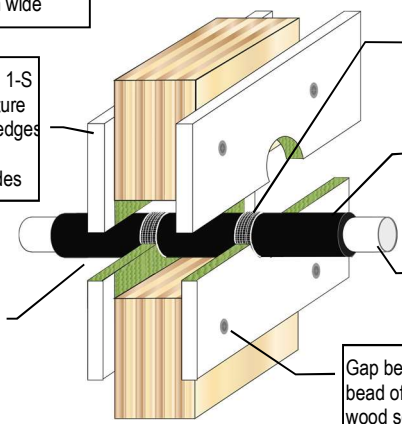

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

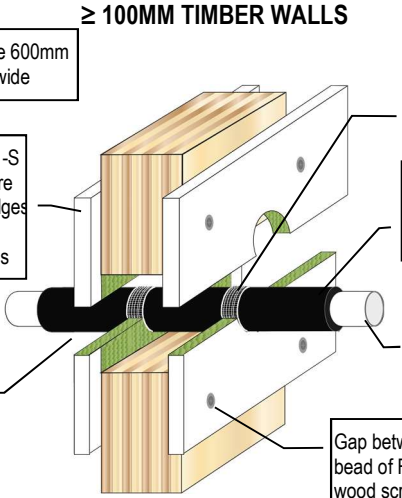

INSULATED PP PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

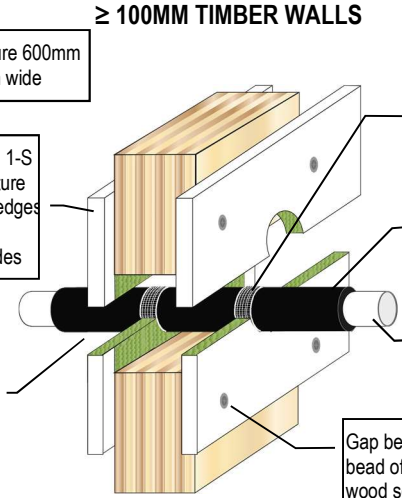

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
54 (86) 2025 2 7

PVC CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM TIMBER WALLS

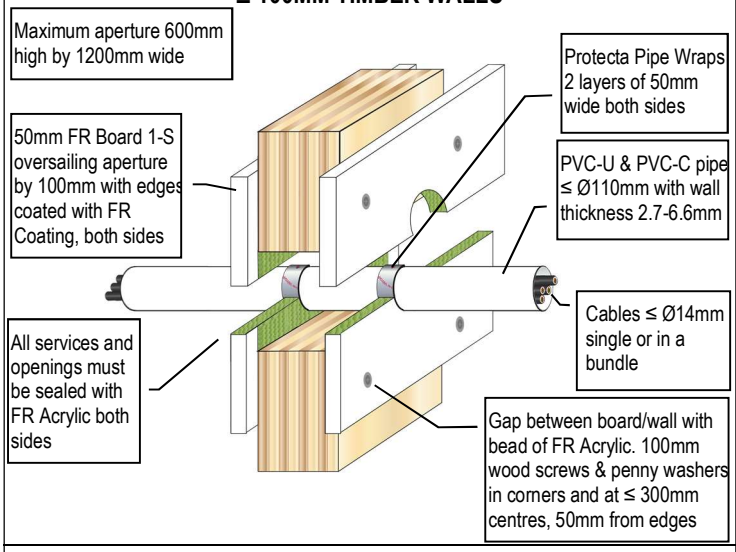

PE CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM TIMBER WALLS

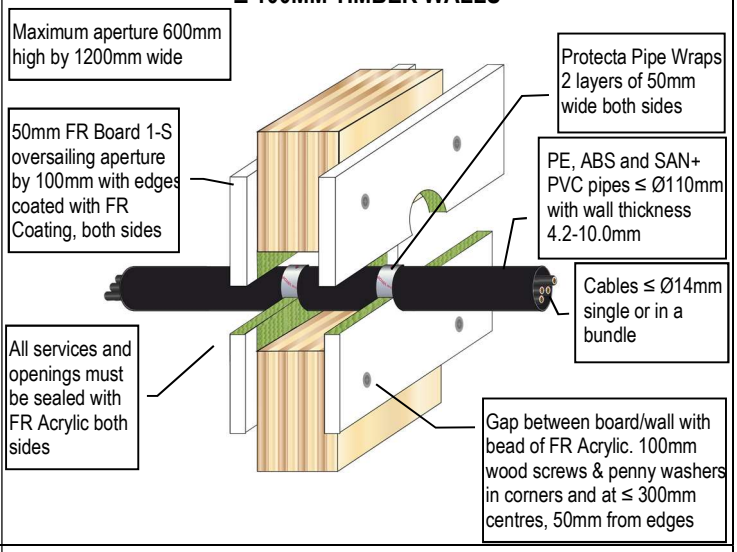

PP CONDUITS FIRE RESISTANCE EI 90 U/C (E 120)

≥ 100MM TIMBER WALLS

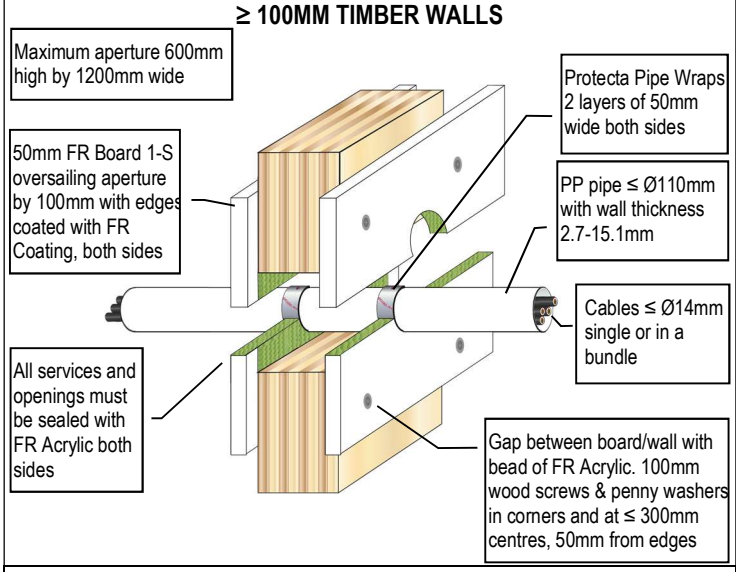

PLASTIC PIPES & CONDUITS FIRE RESISTANCE EI 90 U/C (E 90)

≥ 100MM TIMBER WALLS

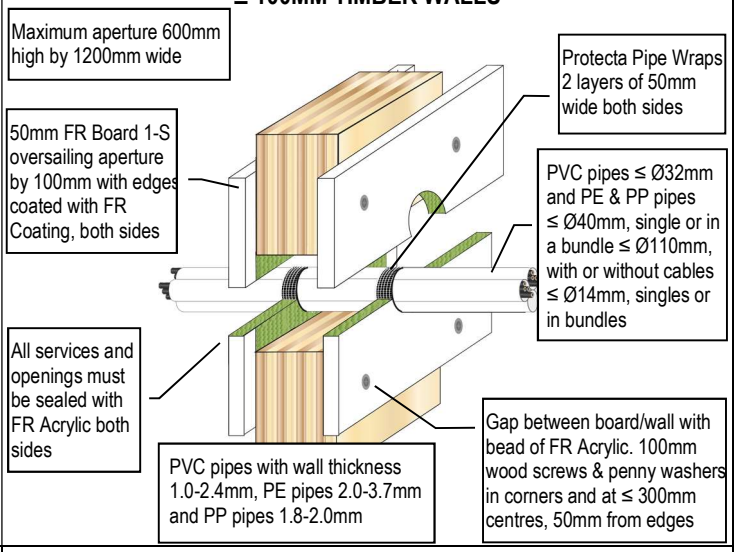

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM TIMBER WALLS

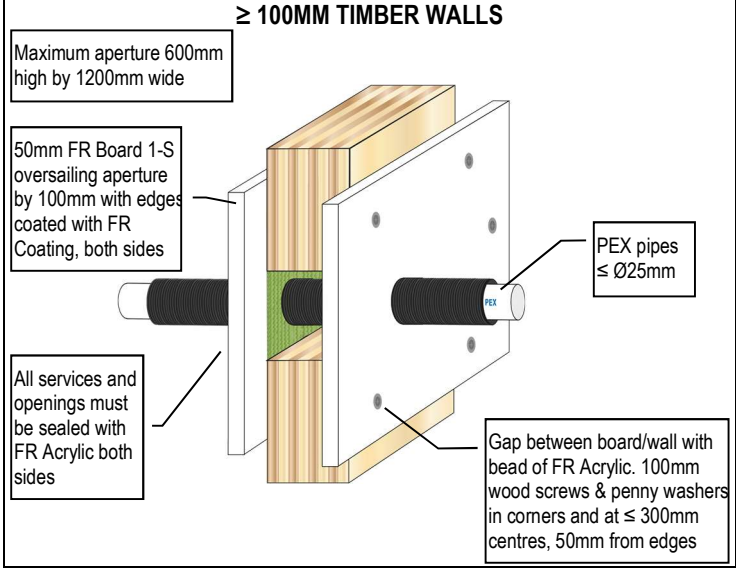

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 120 C/C (E 120)

≥ 100MM TIMBER WALLS

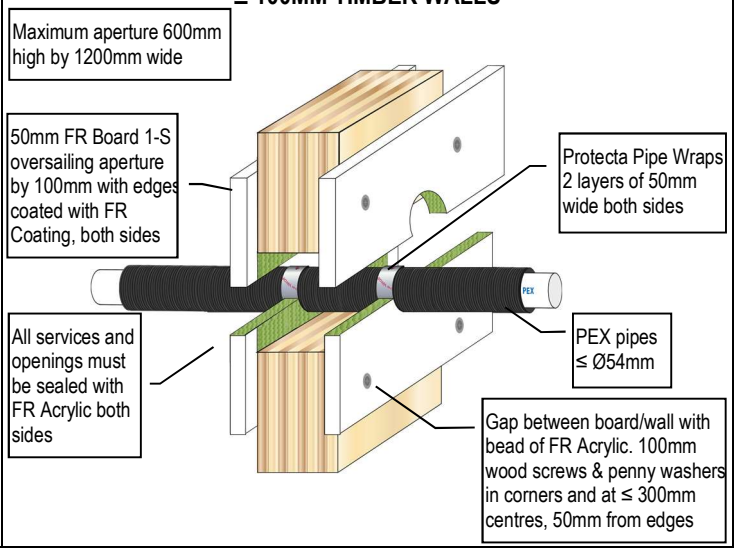

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
55 (86) 2025 2 7

PEX PIPE IN PIPE SYSTEM FIRE RESISTANCE EI 90 C/C (E 90)

≥ 100MM TIMBER WALLS

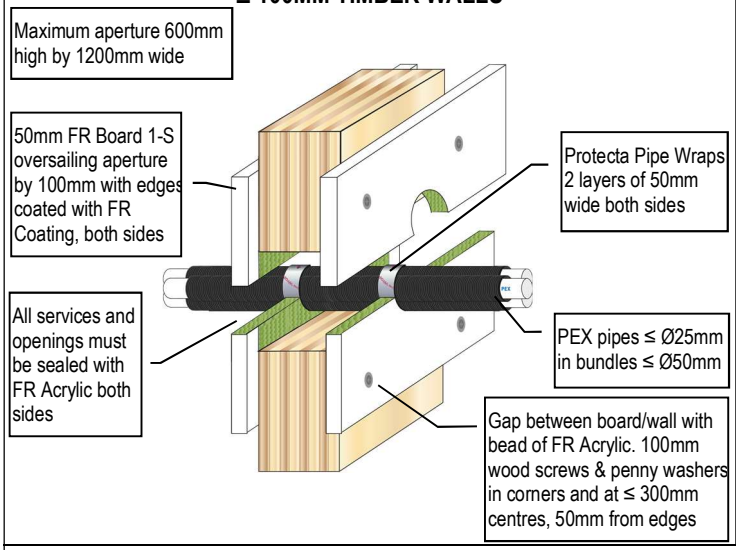

POLYBUTYLENE PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 100MM TIMBER WALLS

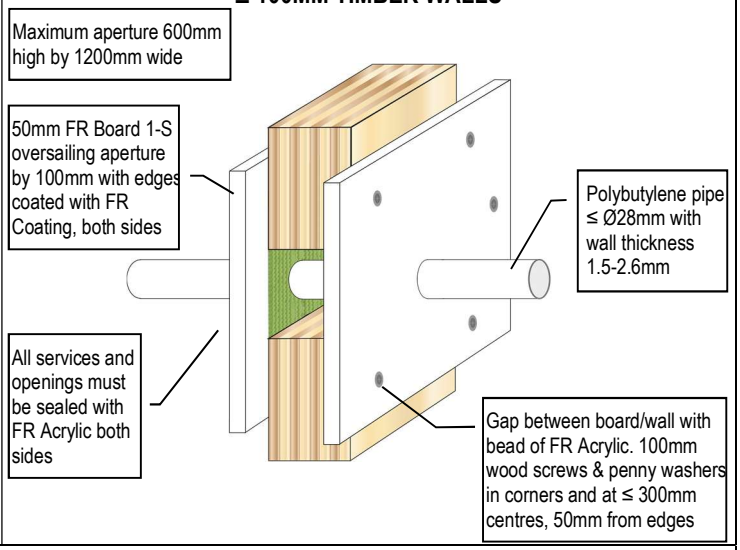

COMPOSITE AQUATHERM GREEN SDR9 PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM TIMBER WALLS

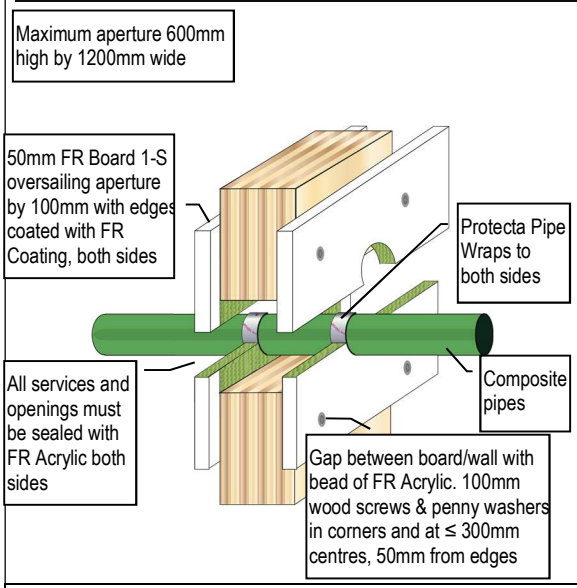

Services	FR Pipe Wrap	Classification
Ø 32mm Aquatherm Green SDR9 pipes	50 x 1.8mm (1 layer)	EI 90 C/C (E 120 C/C)
Ø 40mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 50mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 63mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 75mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 90mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)
Ø 110mm Aquatherm Green SDR9 pipes	50 x 3.6mm (2 layers)	EI 90 C/C (E 120 C/C)

COMPOSITE BLUEPOWER PLASTIC PIPES FIRE RESISTANCE EI 90

≥ 100MM TIMBER WALLS

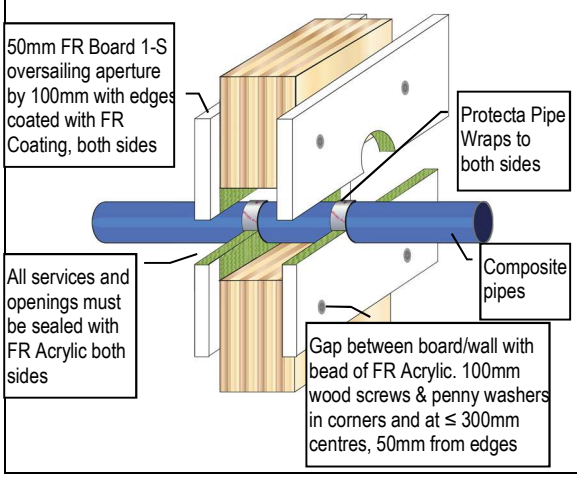

Services	FR Pipe Wrap	Classification
Ø 32mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 40mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 50mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 90mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 110mm BluePower pipes	50 x 3.6mm (2 layers)	EI 90 C/U (E 90 C/U)
Ø 125mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm BluePower pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
56 (86) 2025 2 7

COMPOSITE GEBERIT SILENT-PP PIPES FIRE RESISTANCE EI 90-120

Maximum aperture 600mm high by 1200mm wide

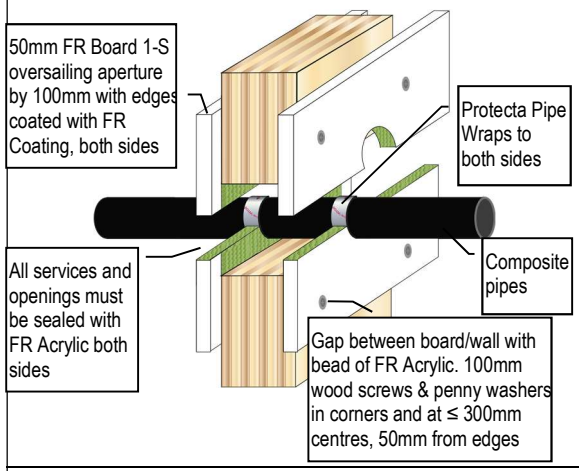

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Geberit Silent-PP pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Geberit Silent-PP pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)

COMPOSITE HULIOT ULTRA SILENT PIPES FIRE RESISTANCE EI 90

Maximum aperture 600mm high by 1200mm wide

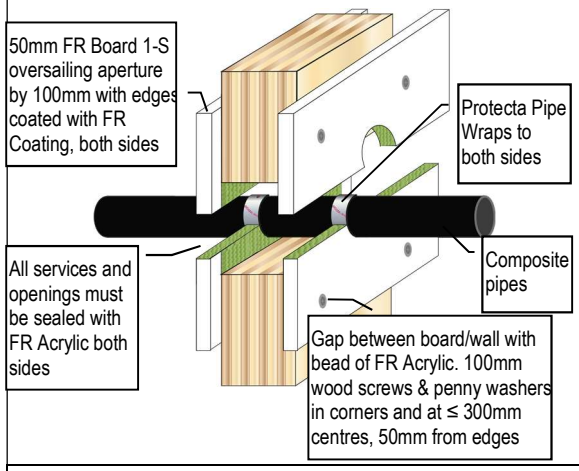

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 90mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Huliot Ultra Silent pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 125mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 90 U/C)
Ø 160mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 C/C)
Ø 200mm Huliot Ultra Silent pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 120 C/C)

COMPOSITE POLO-KAL NG PLASTIC PIPES FIRE RESISTANCE EI 120

Maximum aperture 600mm high by 1200mm wide

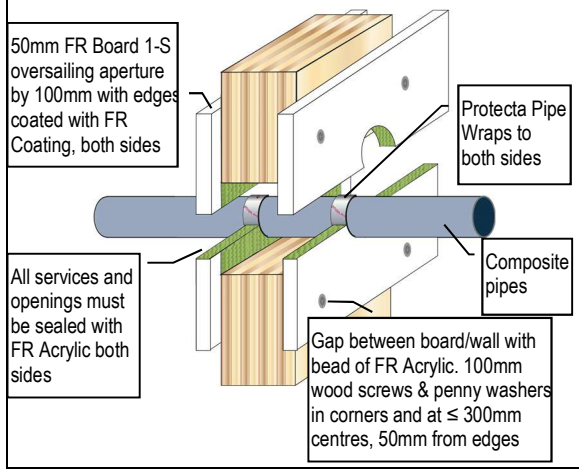

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 40mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Polo-Kal NG pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Polo-Kal NG pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Polo-Kal NG pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
57 (86) 2025 2 7

COMPOSITE REHAU RAUPIANO PLUS PLASTIC PIPES FIRE RESISTANCE EI 120

Maximum aperture 600mm high by 1200mm wide

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 40mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 50mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/U (E 120 U/U)
Ø 75mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Rehau Raupiano Plus pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Rehau Raupiano Plus pipes	50 x 7.2mm (4 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Rehau Raupiano Plus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

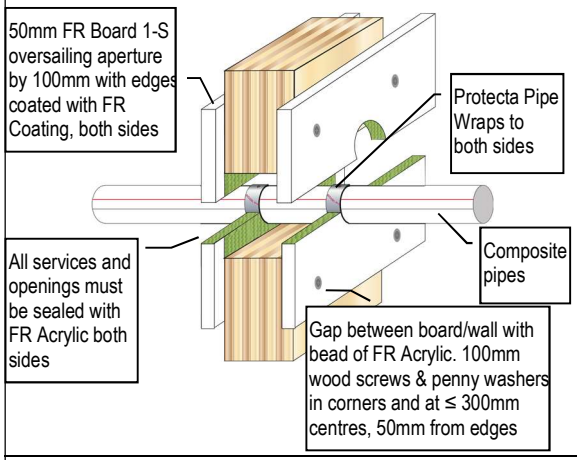

COMPOSITE UPONOR DECIBEL PIPES FIRE RESISTANCE EI 90

Maximum aperture 600mm high by 1200mm wide

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 50mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 90 U/U)
Ø 75mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)
Ø 110mm Uponor Decibel pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 90 U/C)

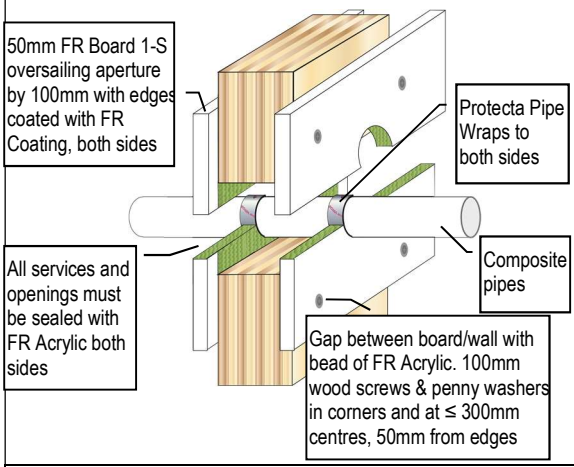

COMPOSITE VALSIR BLACKFIRE PIPES FIRE RESISTANCE EI 0-120

Maximum aperture 600mm high by 1200mm wide

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir Blackfire pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir Blackfire pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

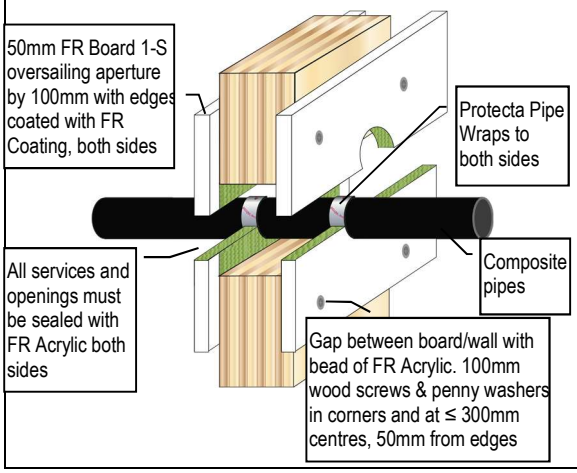

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

COMPOSITE VALSIR PP3 PIPES FIRE RESISTANCE EI 20-120

Maximum aperture 600mm high by 1200mm wide

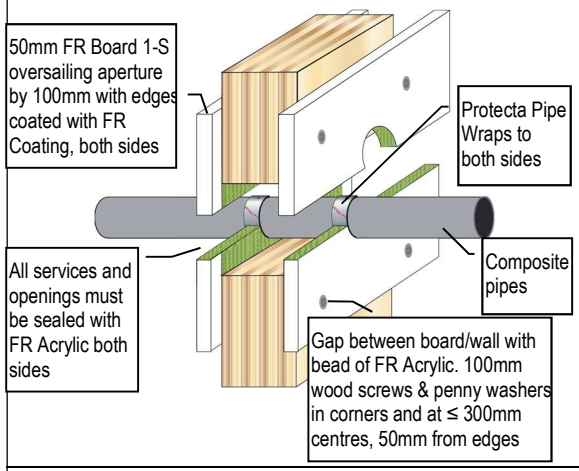

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 40mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 50mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 20 U/U (E 120 U/U)
Ø 75mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 90mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 110mm Valsir PP3 pipes	50 x 3.6mm (2 layers)	EI 120 U/C (E 120 U/C)
Ø 125mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)
Ø 160mm Valsir PP3 pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE VALSIR TRIPLUS PLASTIC PIPES FIRE RESISTANCE EI 0-120

Maximum aperture 600mm high by 1200mm wide

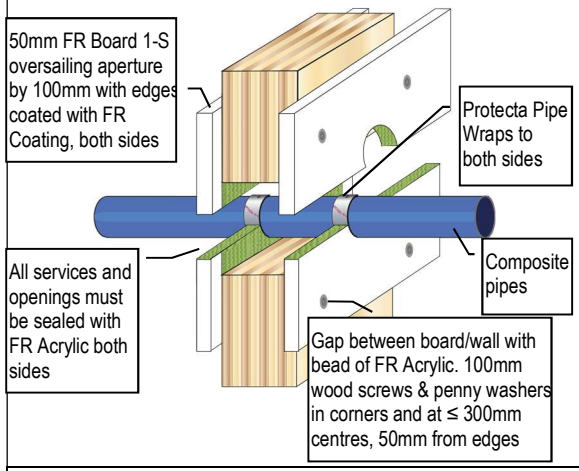

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 32mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 40mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 50mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	(E 120 U/U)
Ø 75mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Valsir Triplus pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 90 U/C (E 120 U/C)
Ø 160mm Valsir Triplus pipes	50 x 10.8mm (6 layers)	EI 120 U/C (E 120 U/C)

COMPOSITE WAVIN AS+ PLASTIC PIPES FIRE RESISTANCE EI 90

Maximum aperture 600mm high by 1200mm wide

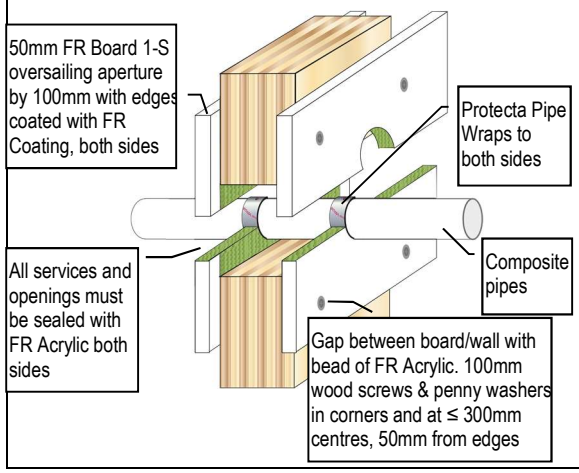

≥ 100MM TIMBER WALLS

Services	FR Pipe Wrap	Classification
Ø 50mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 75mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 90mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 110mm Wavin AS+ pipes	50 x 3.6mm (2 layers)	EI 90 U/C (E 120 U/C)
Ø 125mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 160mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)
Ø 200mm Wavin AS+ pipes	50 x 10.8mm (6 layers)	EI 90 C/C (E 90 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
59 (86) 2025 2 7

COMPOSITE WAVIN SITECH PLASTIC PIPES FIRE RESISTANCE EI 60-90

≥ 100MM TIMBER WALLS

Maximum aperture 600mm high by 1200mm wide

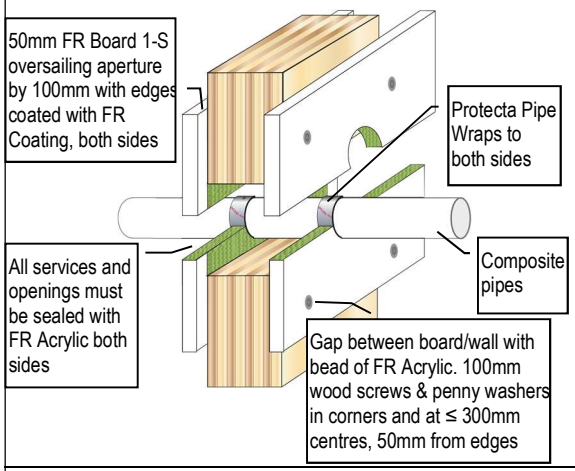

Services	FR Pipe Wrap	Classification
Ø 32mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 40mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 50mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 90 U/U (E 120 U/U)
Ø 75mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 90mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)
Ø 110mm Wavin SiTech pipes	50 x 3.6mm (2 layers)	EI 60 U/C (E 120 U/C)

HORIZONTAL SEALS FIRE RESISTANCE EI 90 (E 240)

≥ 150MM RIGID WALLS

Maximum 1200mm wide between the head of walls and the soffit of floor slabs, or in/between walls

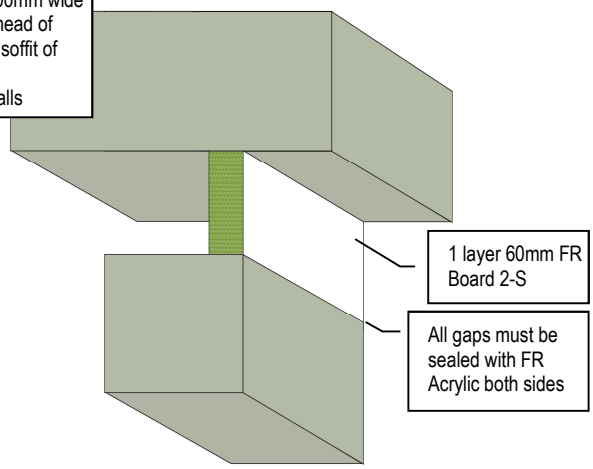

HORIZONTAL SEALS FIRE RESISTANCE EI 180 (E 240)

≥ 150MM RIGID WALLS

Maximum 120mm wide between the head of walls and the soffit of floor slabs, or in/between walls

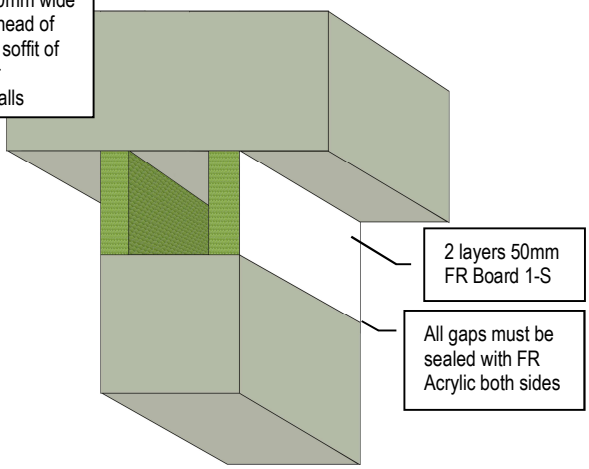

HORIZONTAL SEALS FIRE RESISTANCE EI 180 (E 240)

≥ 150MM RIGID WALLS

Maximum 1200mm wide between the head of walls and the soffit of floor slabs, or in/between walls

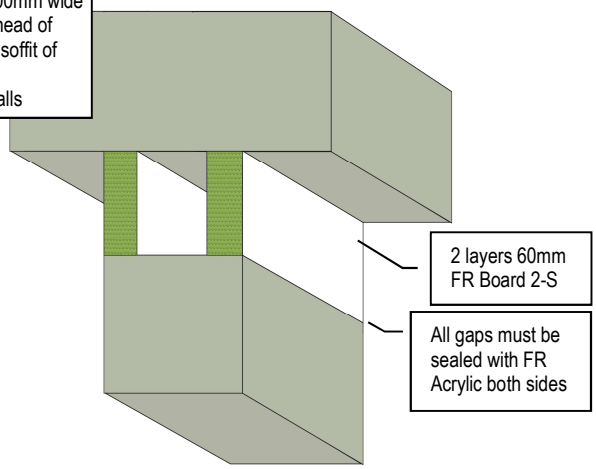

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 240)

IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS

Maximum seal width 200mm

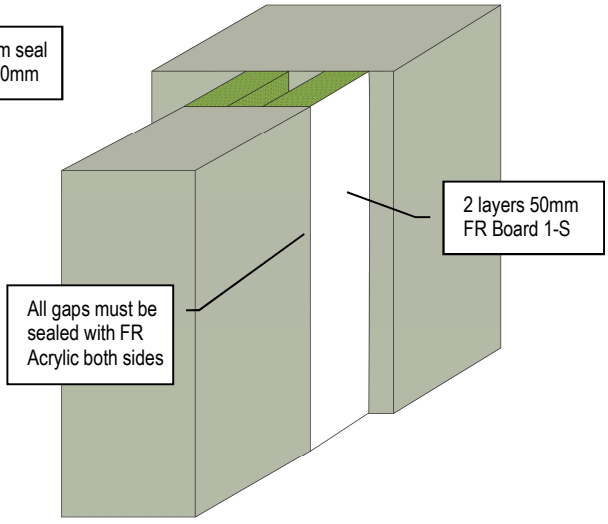

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 180)

BETWEEN ≥ 150MM RIGID WALLS AND GYPSUM SUBSTRATES

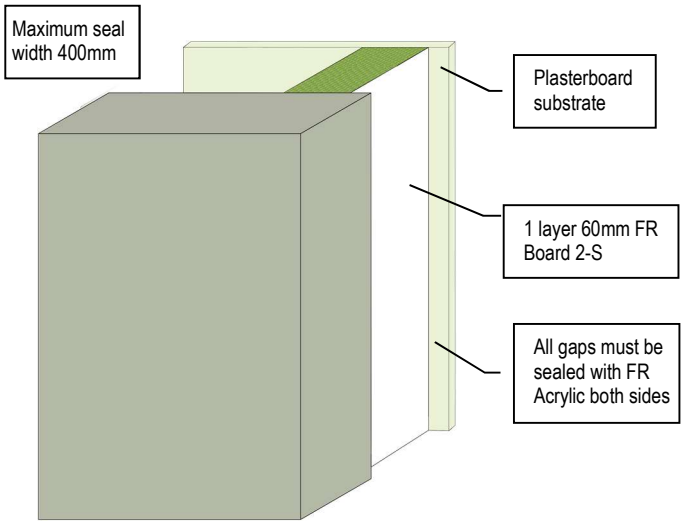

VERTICAL & HORIZONTAL SEALS FIRE RESISTANCE EI 30 (E 120)

BETWEEN ≥ 150MM RIGID WALLS AND STEEL SUBSTRATES

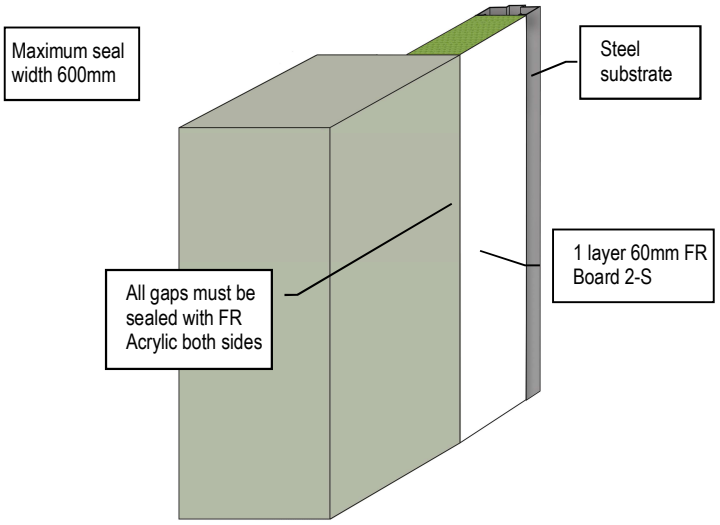

VERTICAL & HORIZONTAL SEALS FIRE RESISTANCE EI 60 (E 120)

BETWEEN ≥ 150MM RIGID WALLS AND STEEL SUBSTRATES

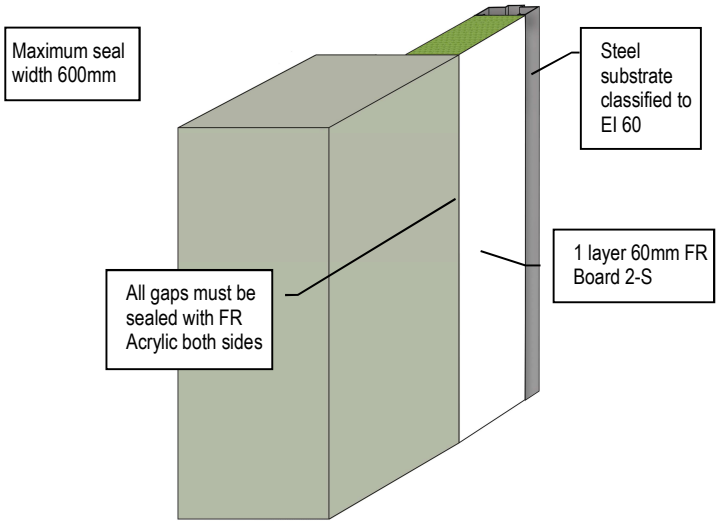

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 30 (E 180)

BETWEEN RIGID WALLS AND ALUMINIUM SUBSTRATES

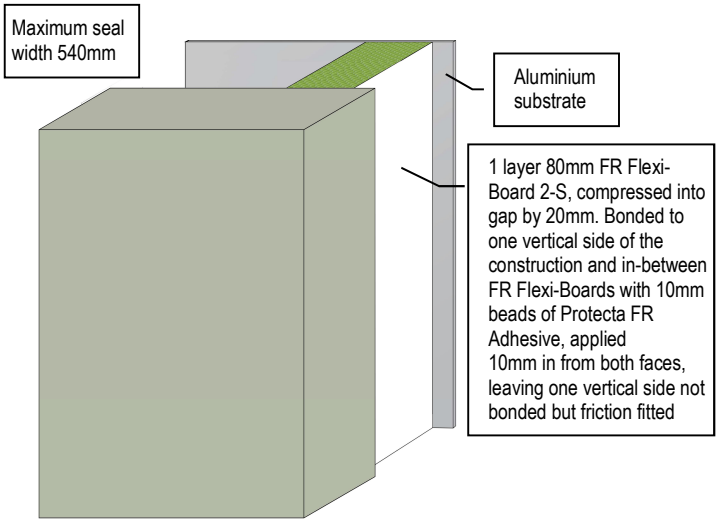

VERTICAL LINEAR SEALS FIRE RESISTANCE EI 120 (E 180)

BETWEEN RIGID WALLS AND ALUMINIUM SUBSTRATES

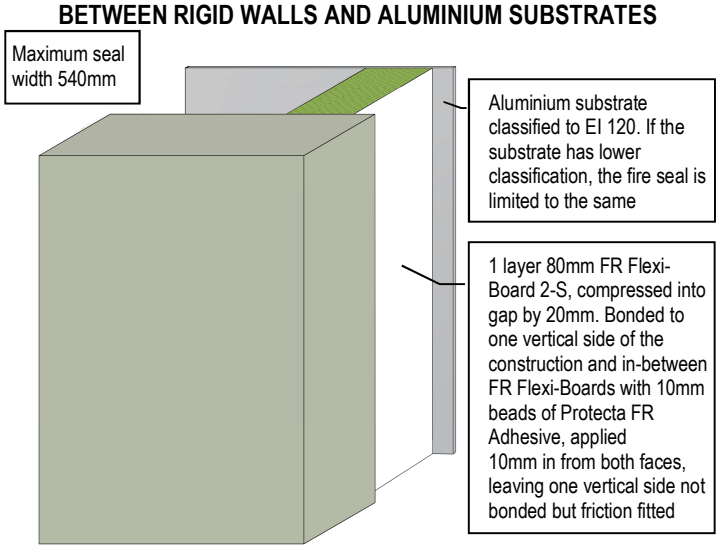

VERTICAL & HORIZONTAL SEALS FIRE RESISTANCE EI 60 (E 60)

IN ≥ 150MM RIGID WALLS OR BETWEEN WALLS

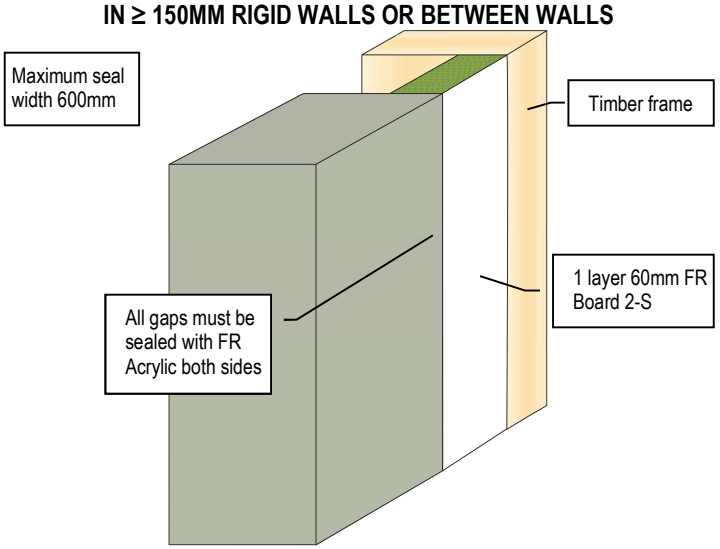

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
61 (86) 2025 7 2

CABLES FIRE RESISTANCE EI 90 (E 120)

≥ 75MM RIGID WALLS

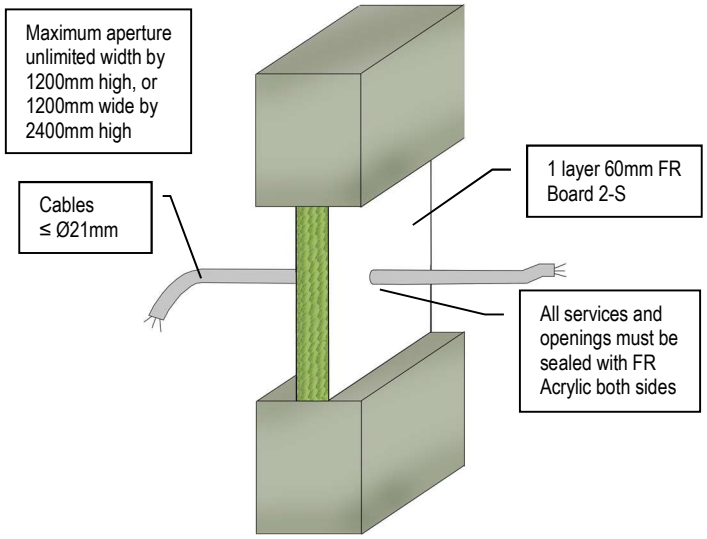

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 60)

≥ 75MM RIGID WALLS

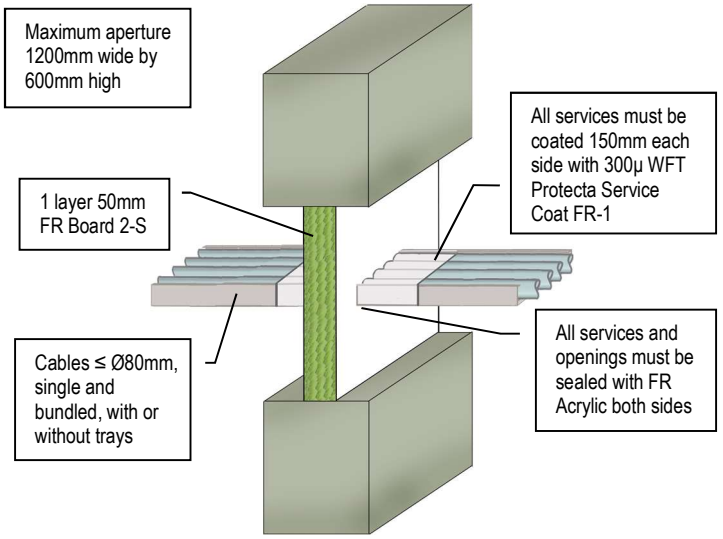

CABLES FIRE RESISTANCE EI 90 (E 240)

≥ 150MM RIGID WALLS

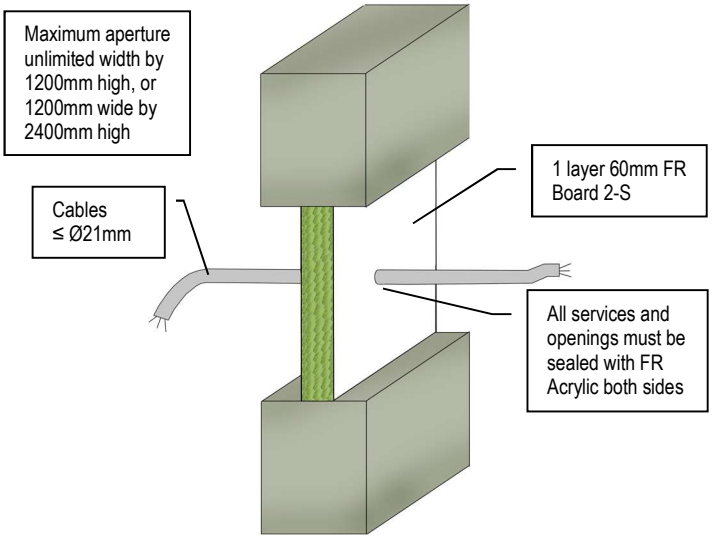

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 180 (E 180)

≥ 150MM RIGID WALLS

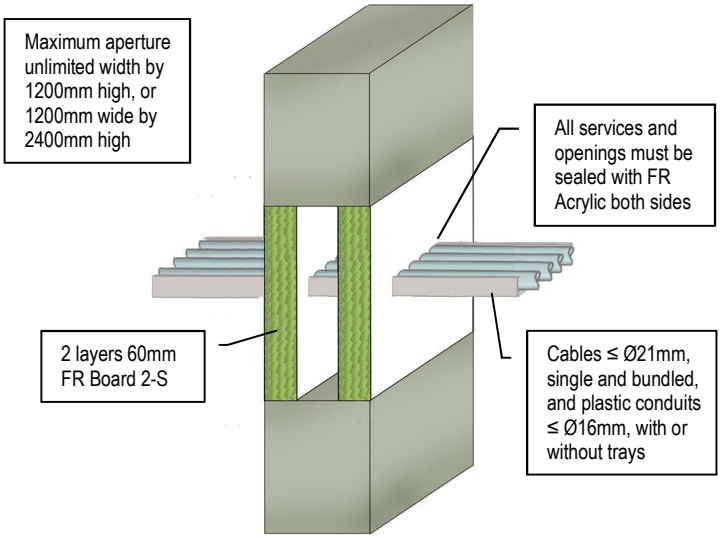

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 180 (E 240)

≥ 150MM RIGID WALLS

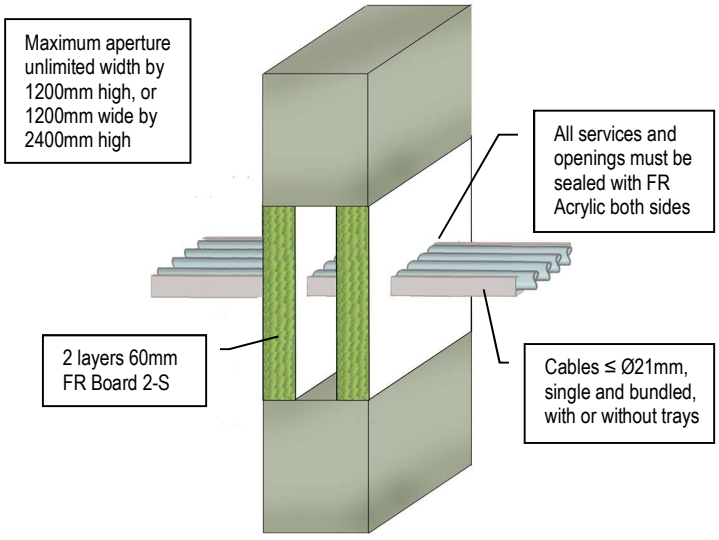

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 180)

≥ 150MM RIGID WALLS

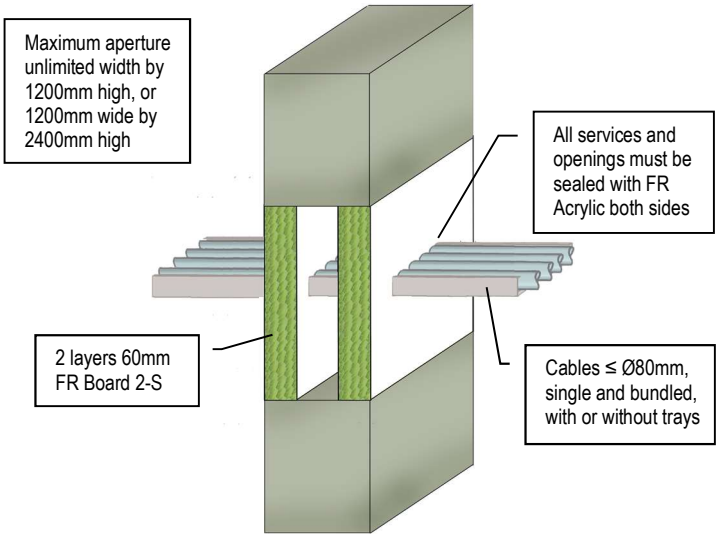

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu

Polyseam Ltd tel.+44(0)1484421036

62 (86) 2025 7 2

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 240 (E 240)

≥ 150MM RIGID WALLS

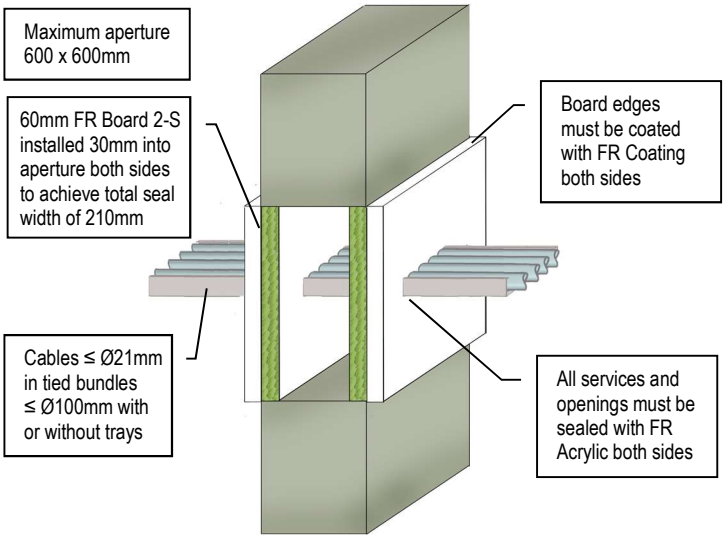

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 240)

≥ 150MM RIGID WALLS

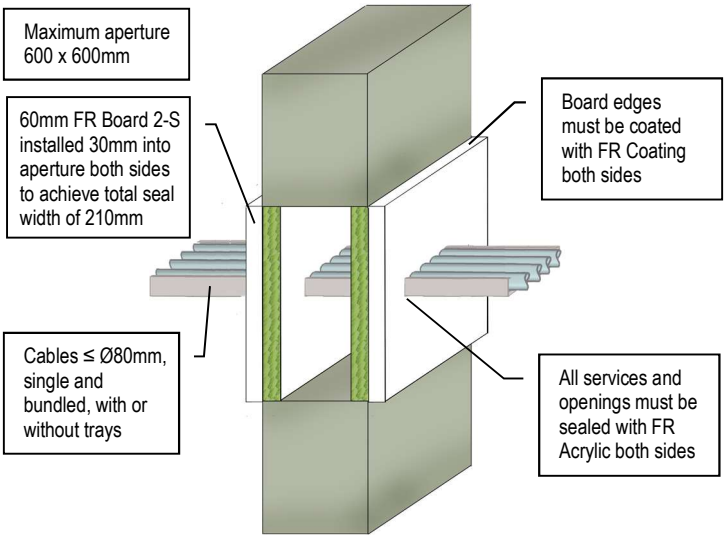

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 180 (E 240)

≥ 150MM RIGID WALLS

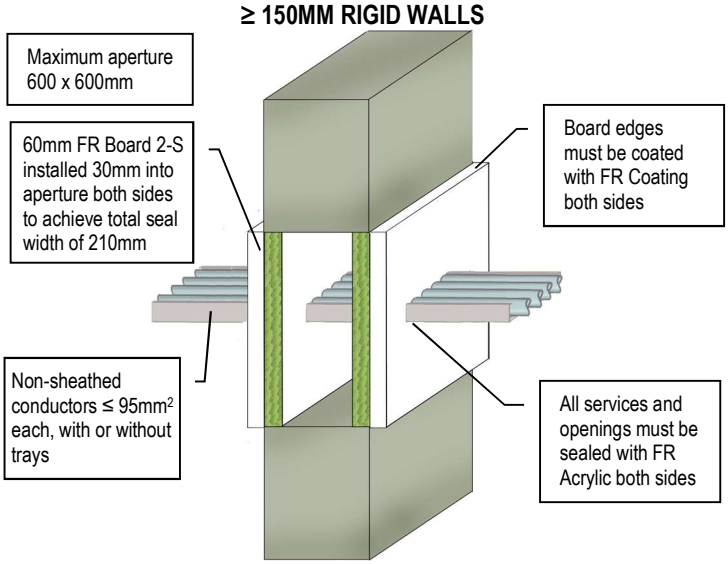

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 240)

≥ 150MM RIGID WALLS

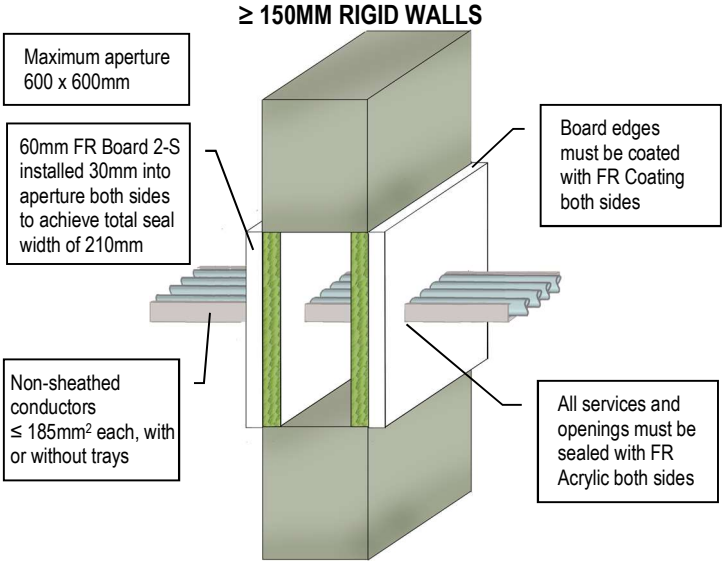

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 240 (E 240)

≥ 150MM RIGID WALLS

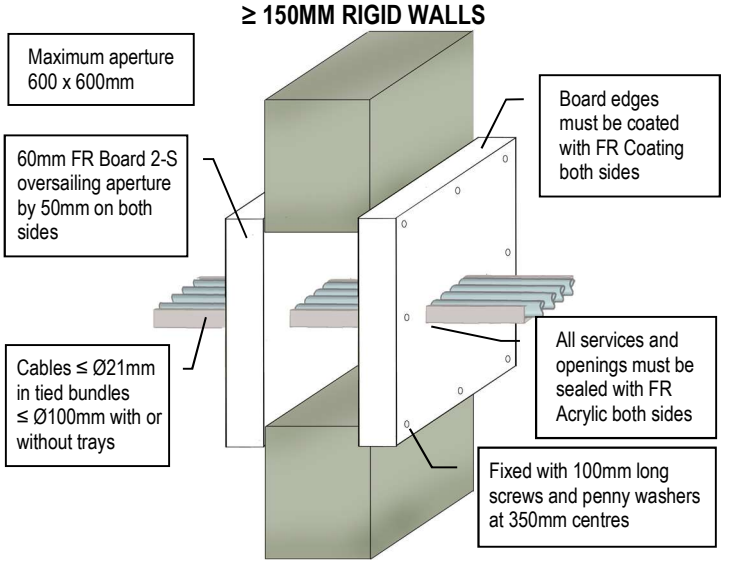

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 240)

≥ 150MM RIGID WALLS

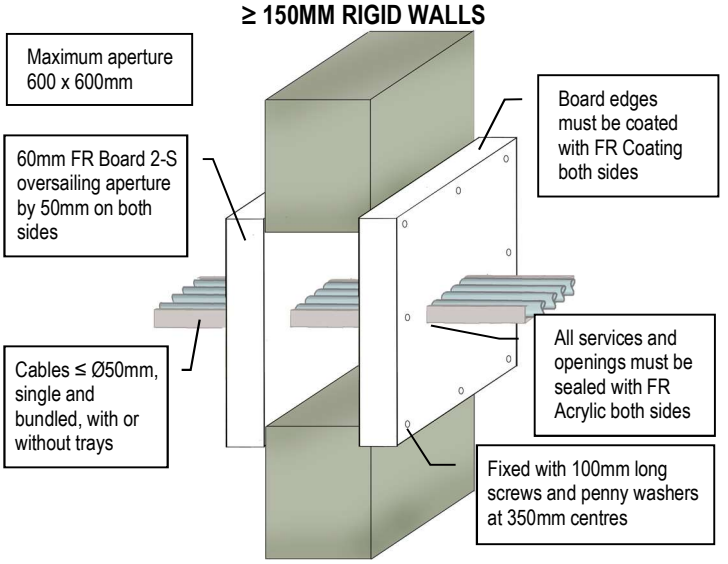

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
63 (86) 2025 7 2

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 240)

≥ 150MM RIGID WALLS

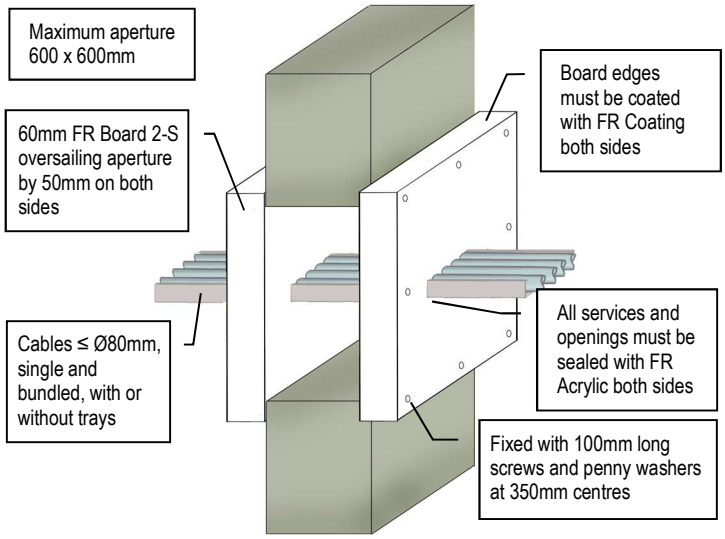

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 120 (E 240)

≥ 150MM RIGID WALLS

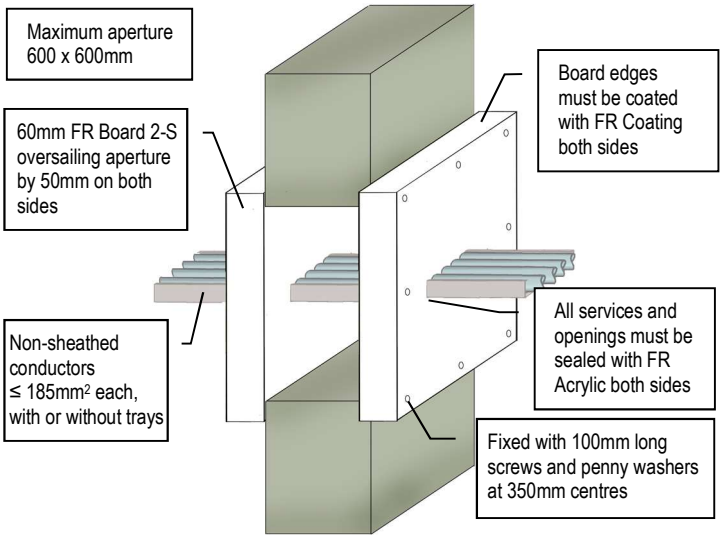

INSULATED STEEL PIPES FIRE RESISTANCE EI 45 C/U (E 120)

≥ 75MM RIGID WALLS

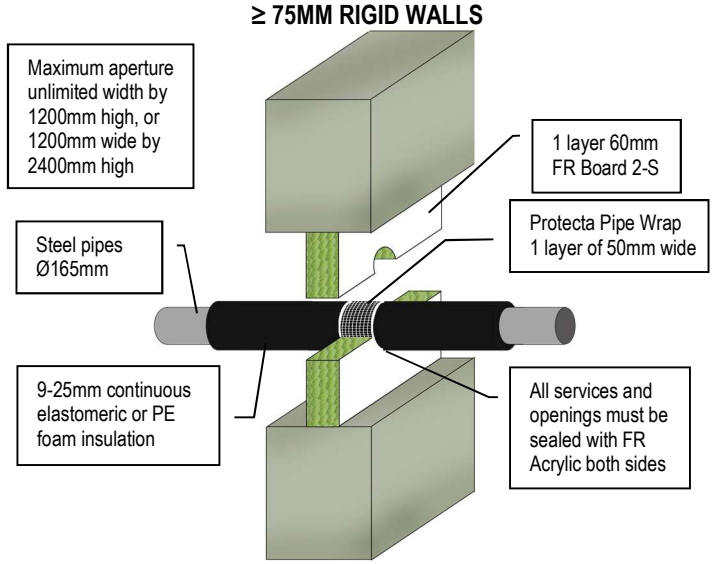

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 75MM RIGID WALLS

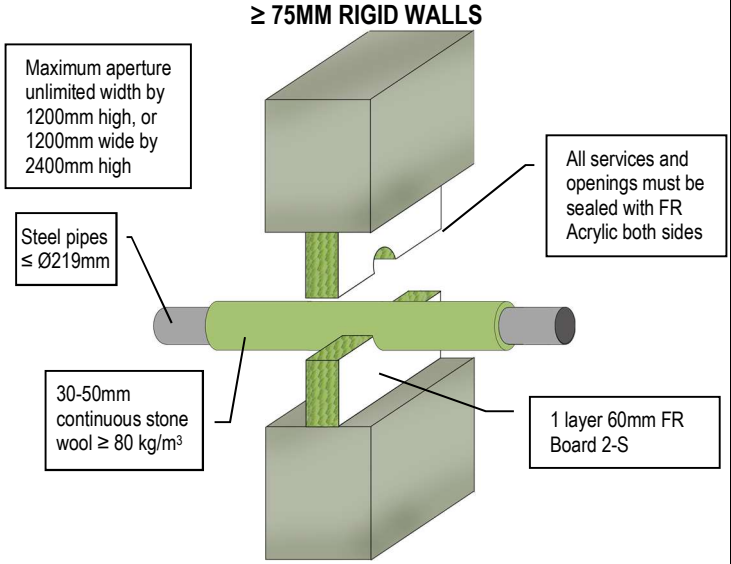

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 75MM RIGID WALLS

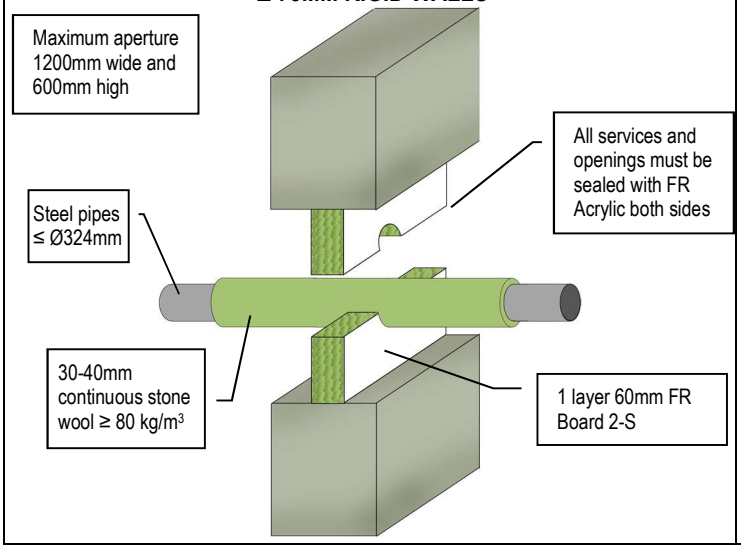

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 75MM RIGID WALLS

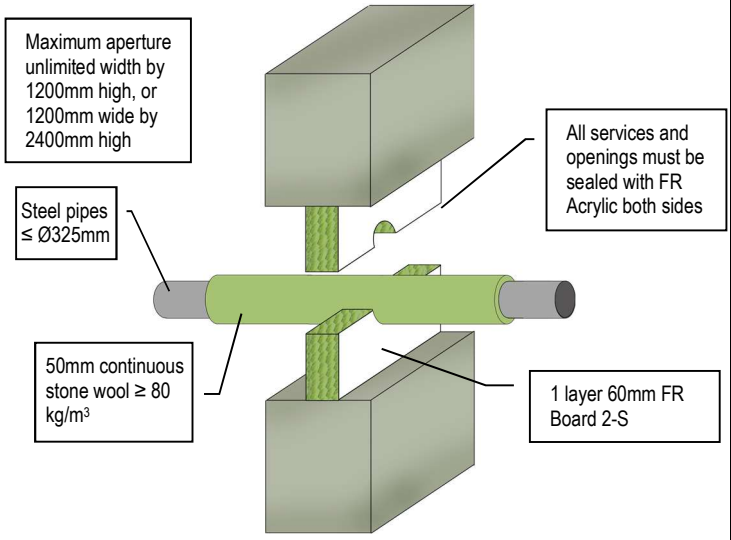

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
64 (86) 2025 7 2

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 240)

≥ 150MM RIGID WALLS

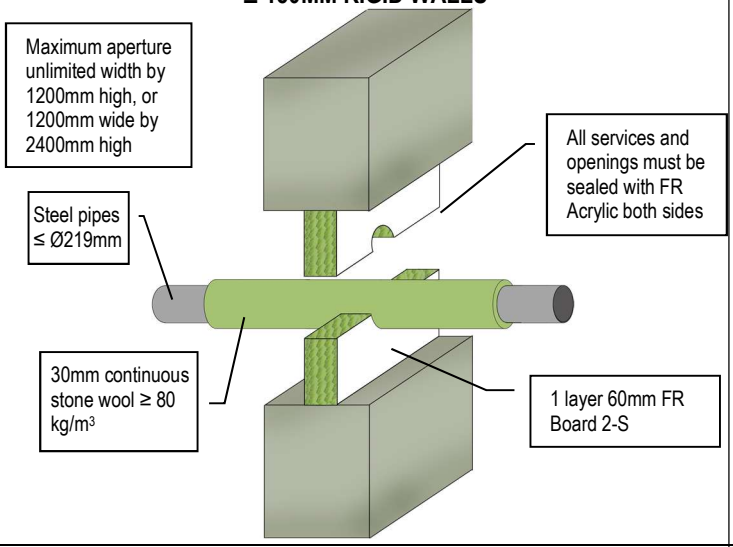

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 180)

≥ 150MM RIGID WALLS

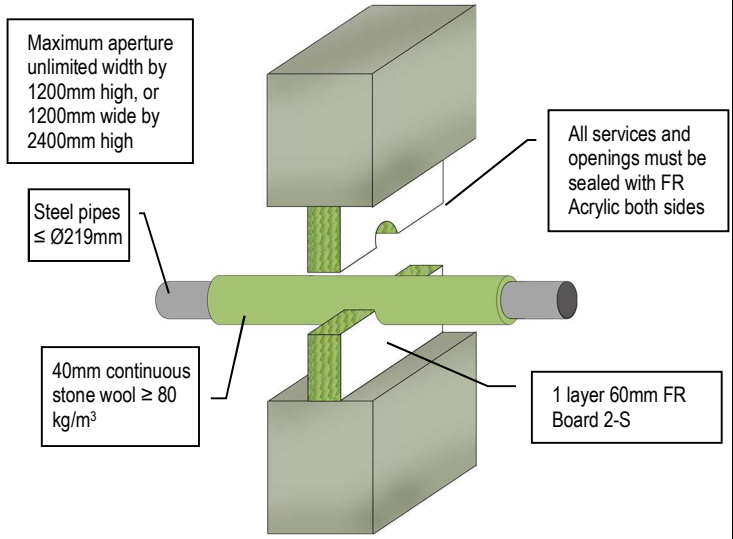

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 180)

≥ 150MM RIGID WALLS

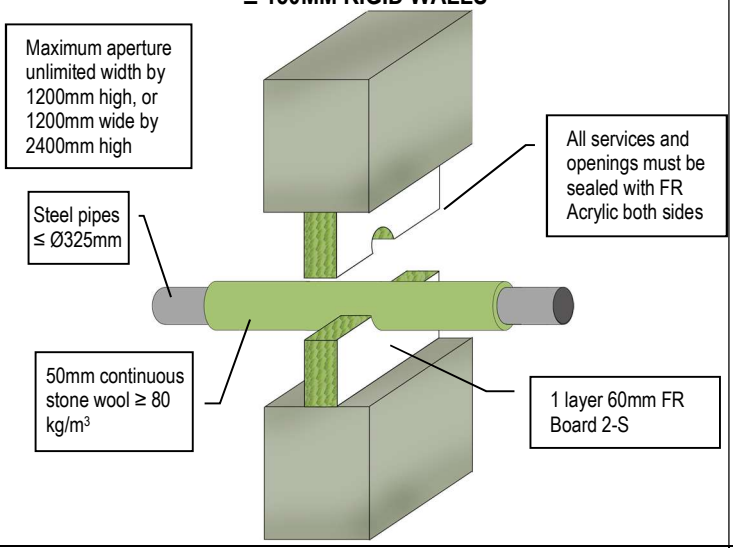

INSULATED STEEL PIPES FIRE RESISTANCE EI 180 C/U (E 240)

≥ 150MM RIGID WALLS

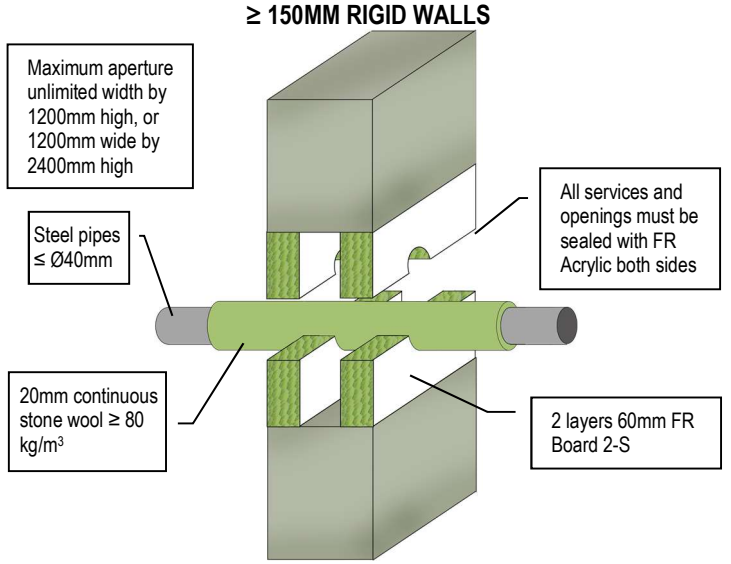

INSULATED STEEL PIPES FIRE RESISTANCE EI 180 C/U (E 240)

≥ 150MM RIGID WALLS

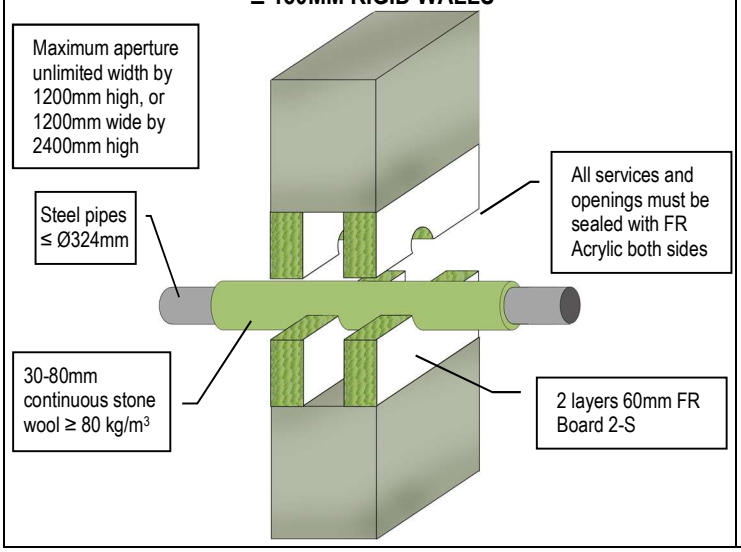

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 75MM RIGID WALLS

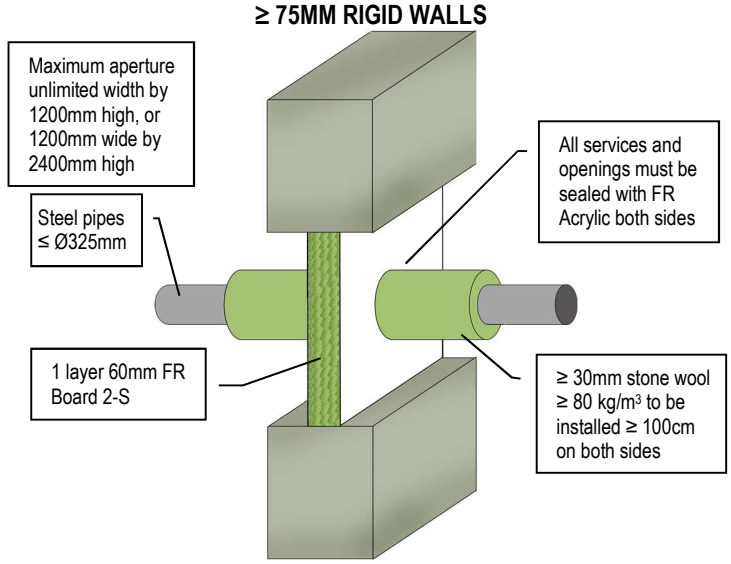

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
65 (86) 2025 7 2

STEEL PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

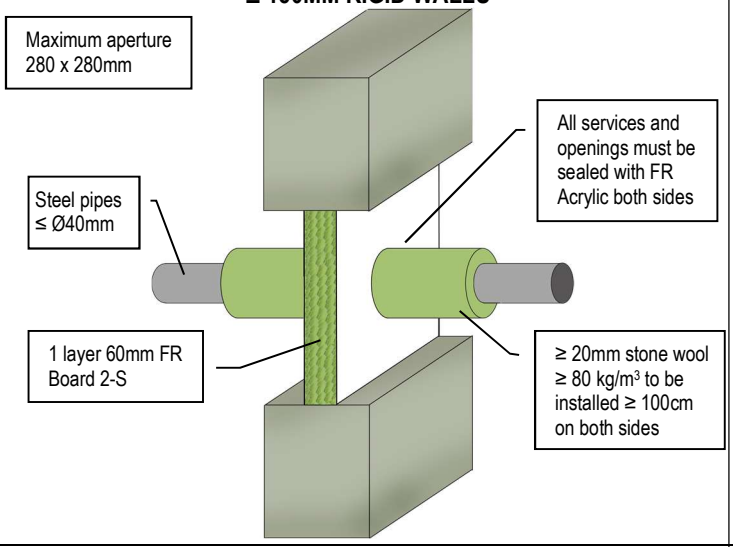

STEEL PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

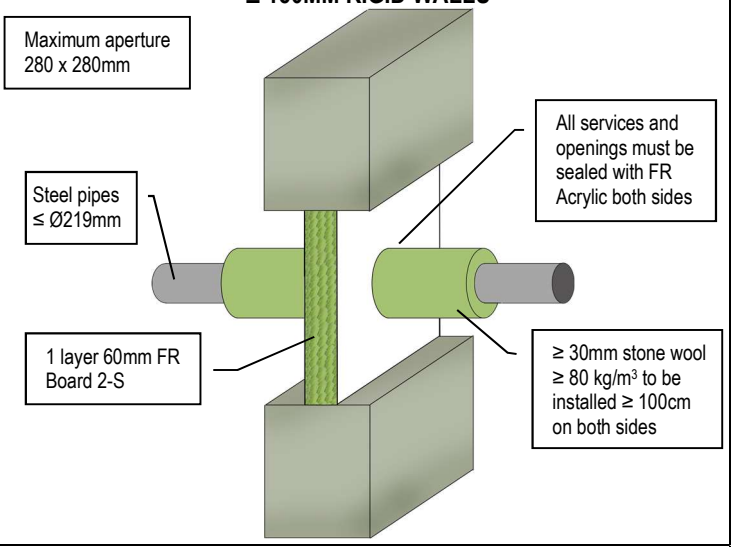

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 240)

≥ 150MM RIGID WALLS

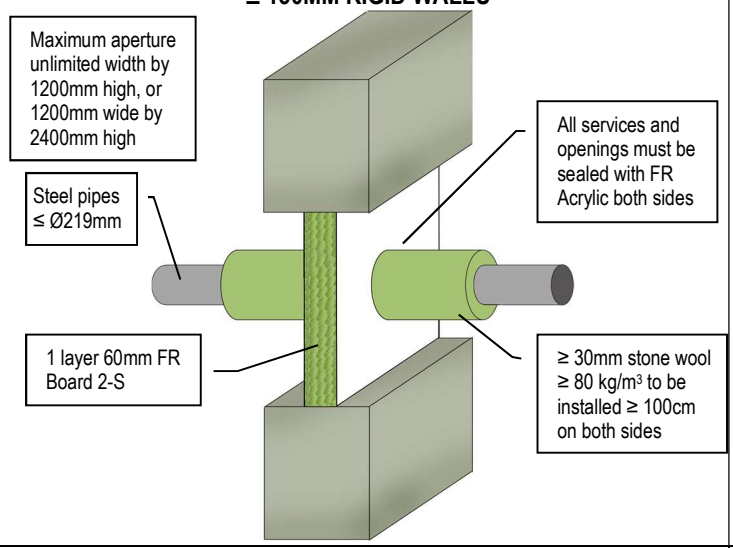

STEEL PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

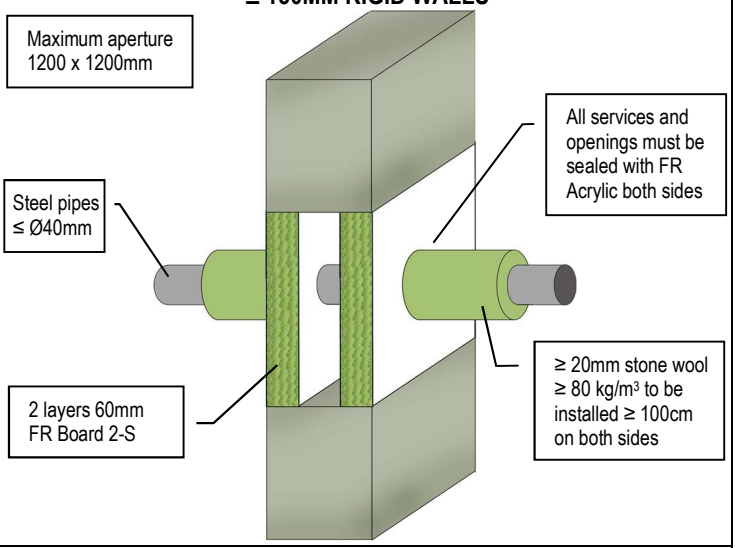

STEEL PIPES FIRE RESISTANCE EI 180 C/U (E 240)

≥ 150MM RIGID WALLS

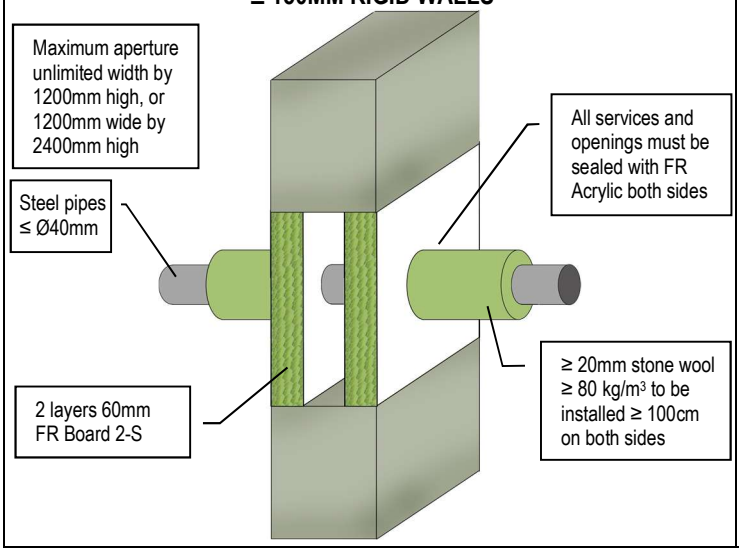

STEEL PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

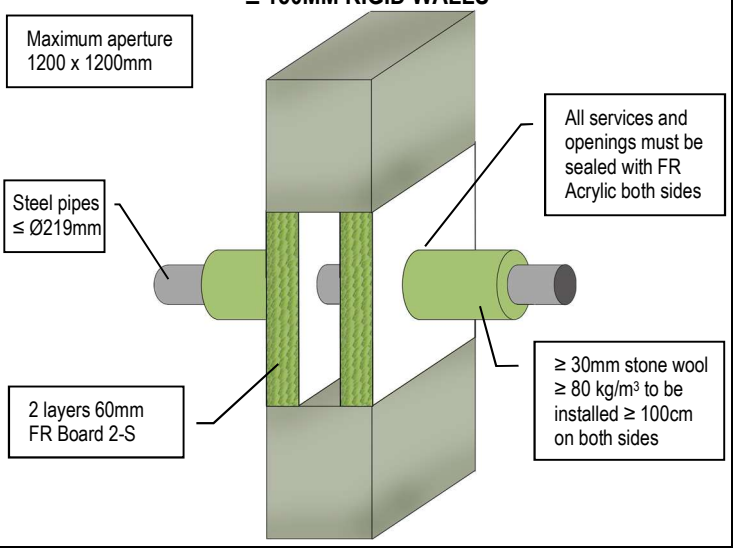

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
66 (86) 2025 7 2

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 120)

≥ 150MM RIGID WALLS

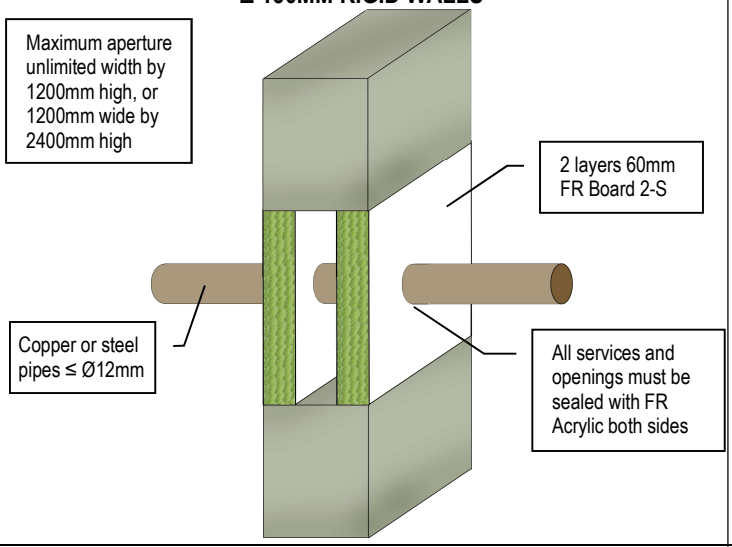

COPPER PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 75MM RIGID WALLS

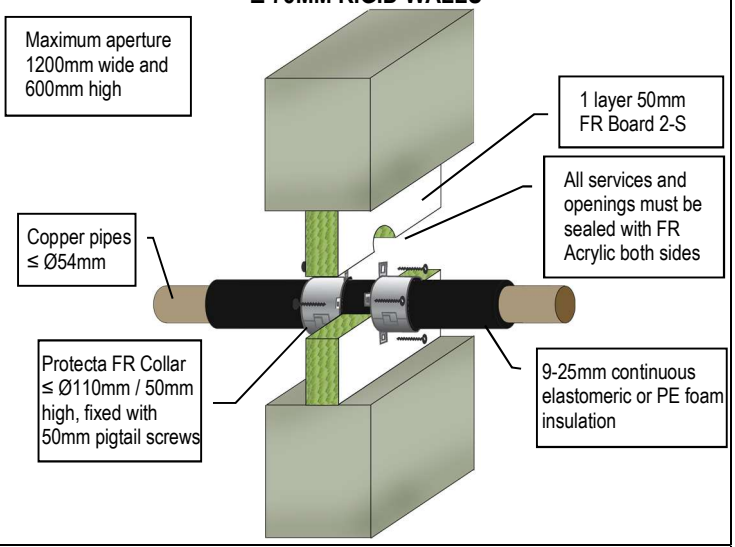

COPPER & STEEL PIPES FIRE RESISTANCE EI 30 C/C (E 60)

≥ 75MM RIGID WALLS

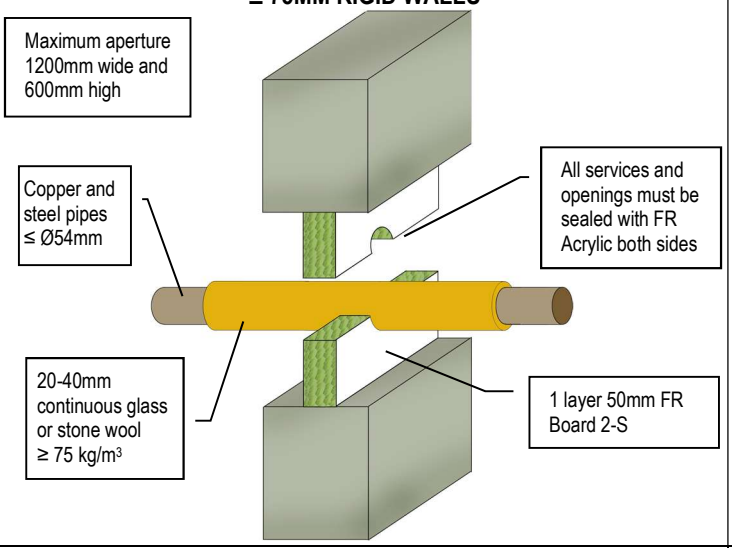

COPPER & STEEL PIPES FIRE RESISTANCE EI 45 C/C (E 60)

≥ 75MM RIGID WALLS

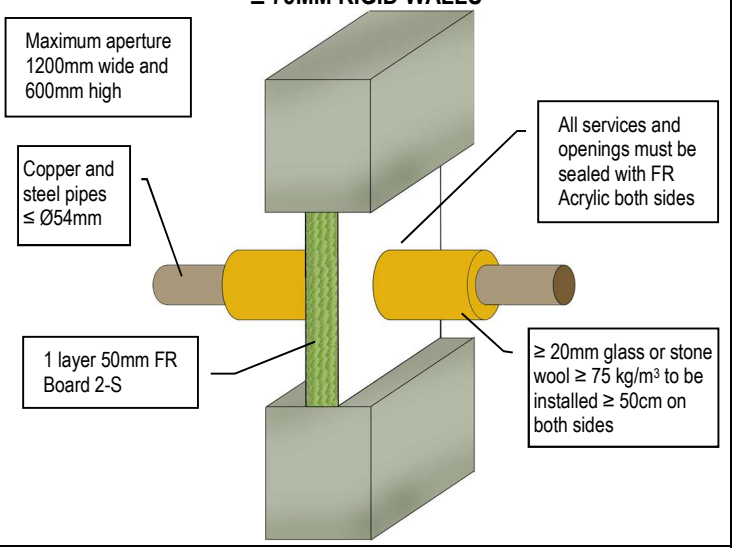

COPPER PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 75MM RIGID WALLS

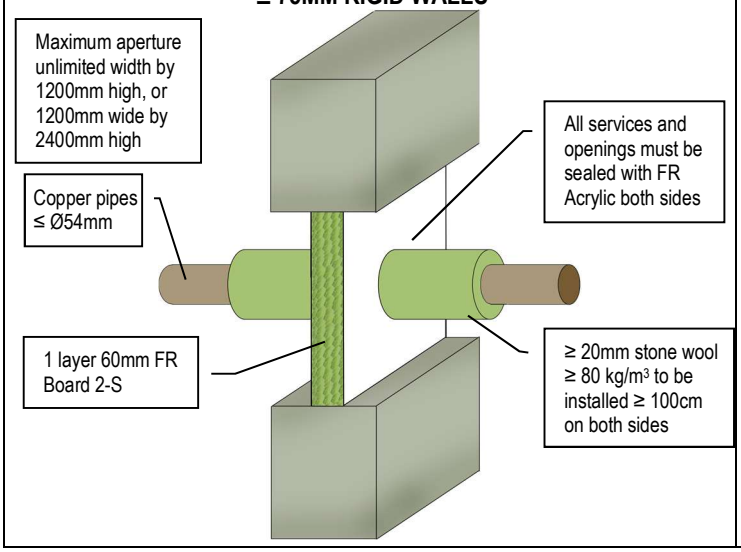

COPPER PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID WALLS

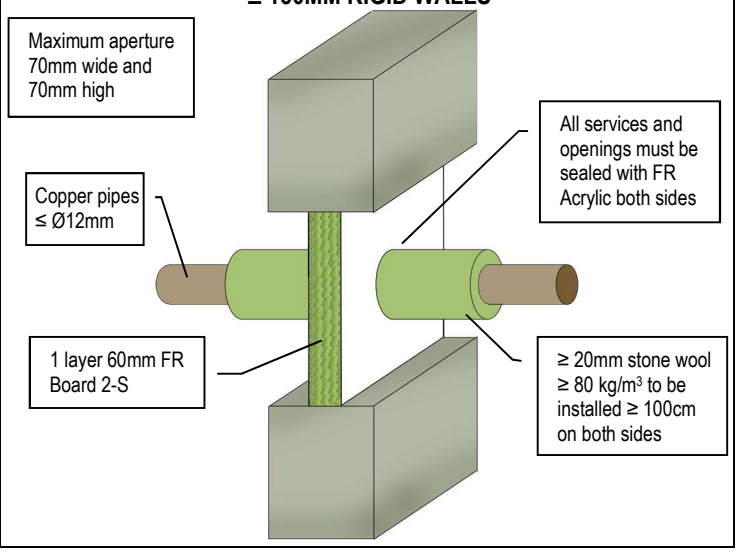

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
67 (86) 2025 7 2

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 240)

≥ 150MM RIGID WALLS

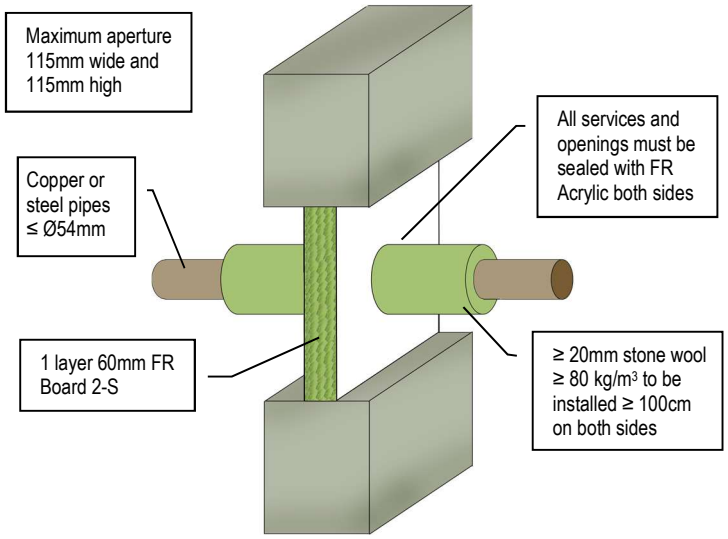

COPPER OR STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 240)

≥ 150MM RIGID WALLS

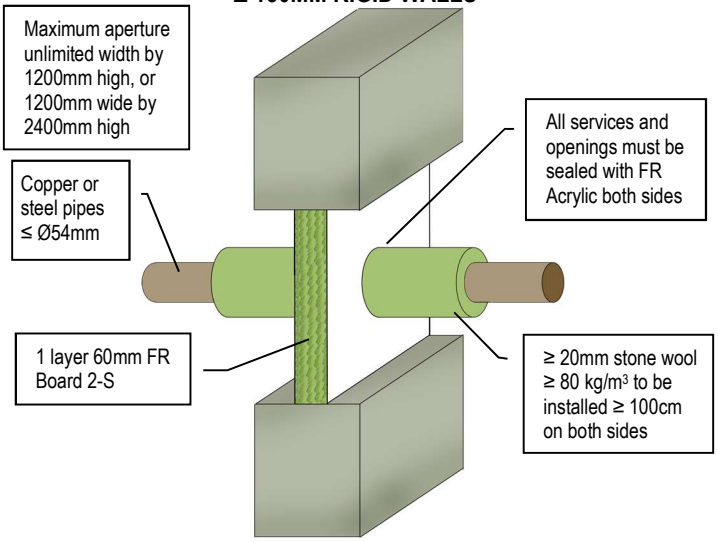

COPPER OR STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 240)

≥ 150MM RIGID WALLS

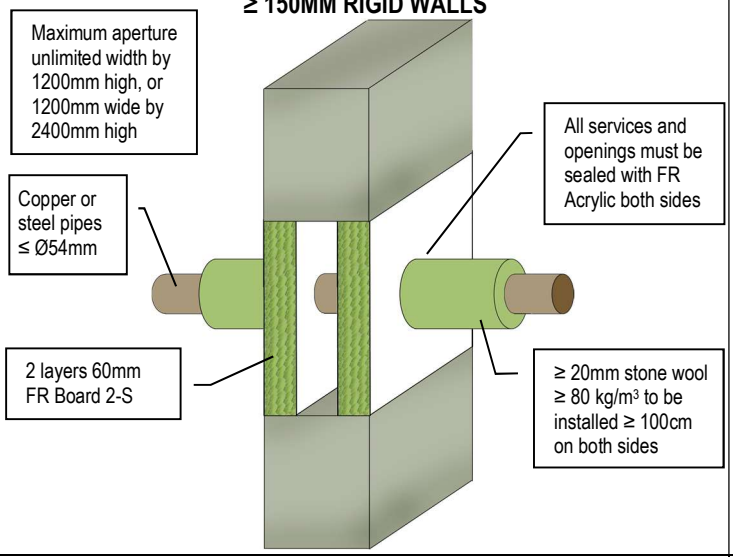

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 75MM RIGID WALLS

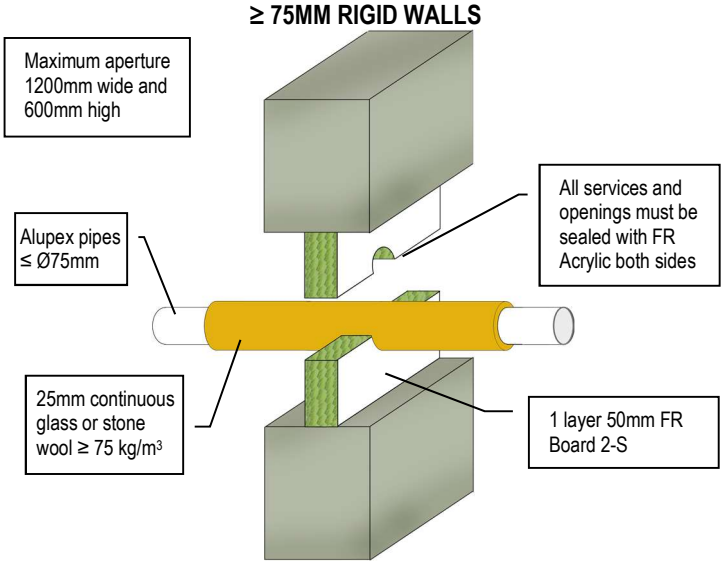

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 75MM RIGID WALLS

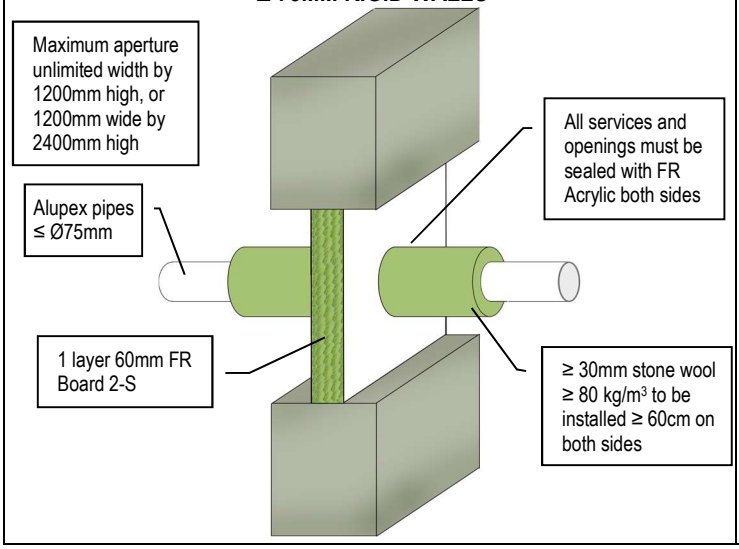

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 150MM RIGID WALLS

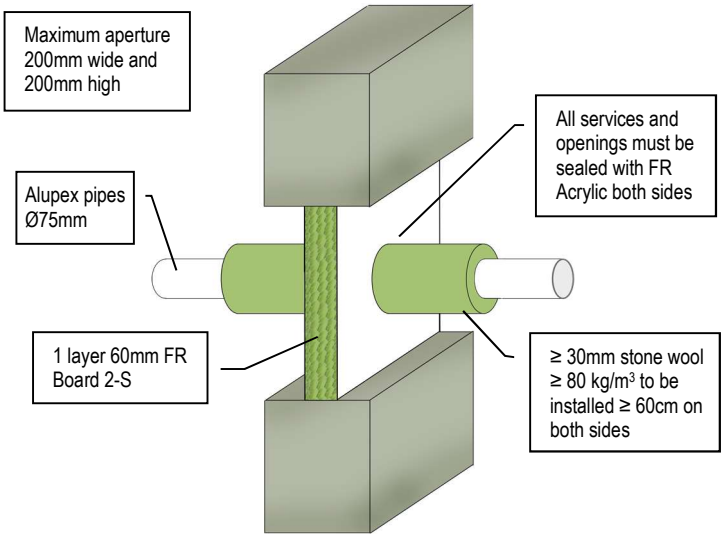

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
68 (86) 2025 7 2

ALUPEX PIPES FIRE RESISTANCE EI 240 U/C (E 240)

≥ 150MM RIGID WALLS

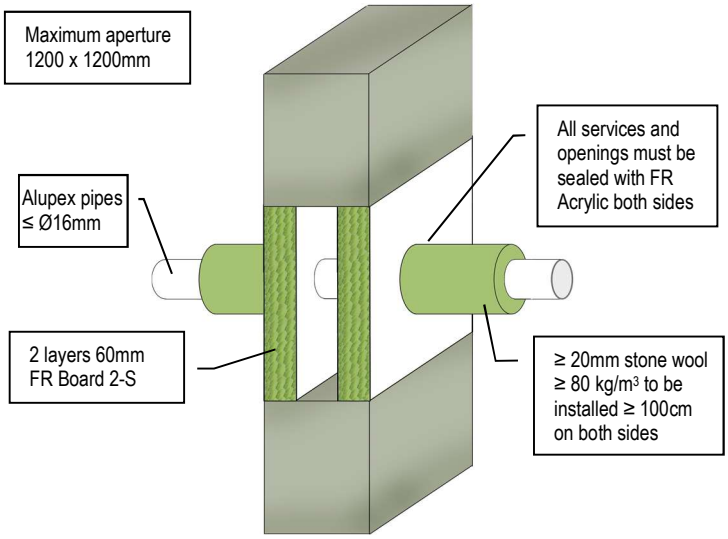

ALUPEX PIPES FIRE RESISTANCE EI 180 U/C (E 240)

≥ 150MM RIGID WALLS

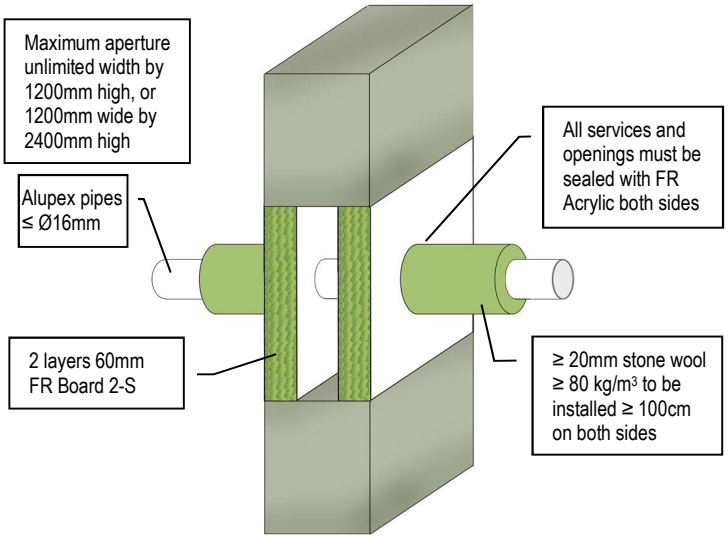

PVC PIPES FIRE RESISTANCE EI 240 U/C (E 240)

≥ 150MM RIGID WALLS

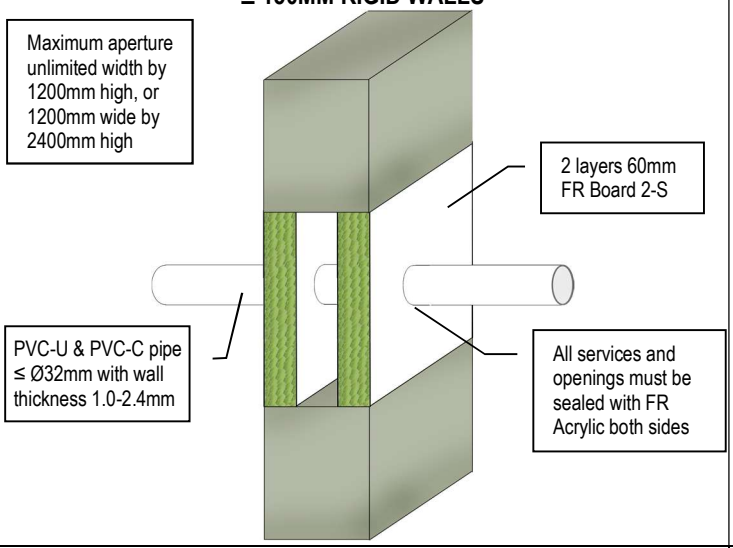

PE PIPES FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM RIGID WALLS

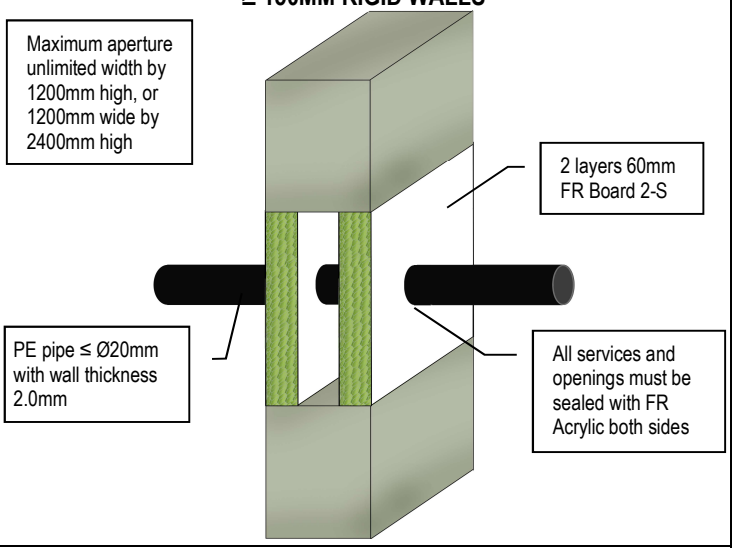

PE PIPES FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM RIGID WALLS

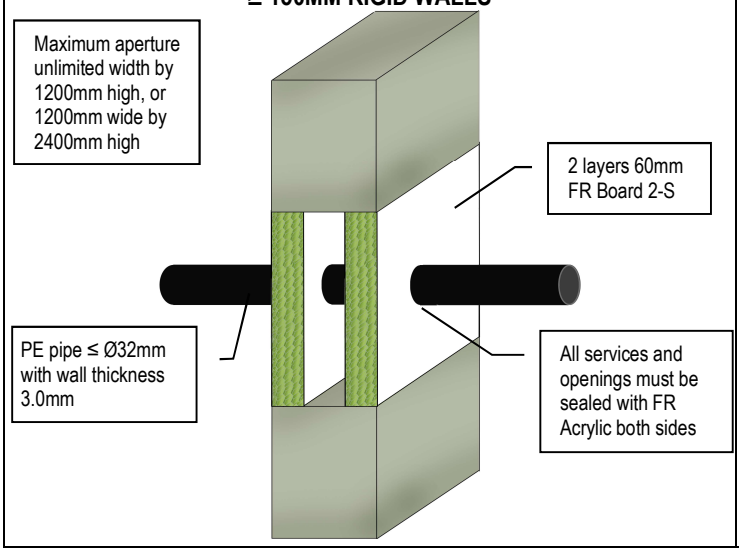

PP PIPES FIRE RESISTANCE EI 60 U/C (E 60)

≥ 150MM RIGID WALLS

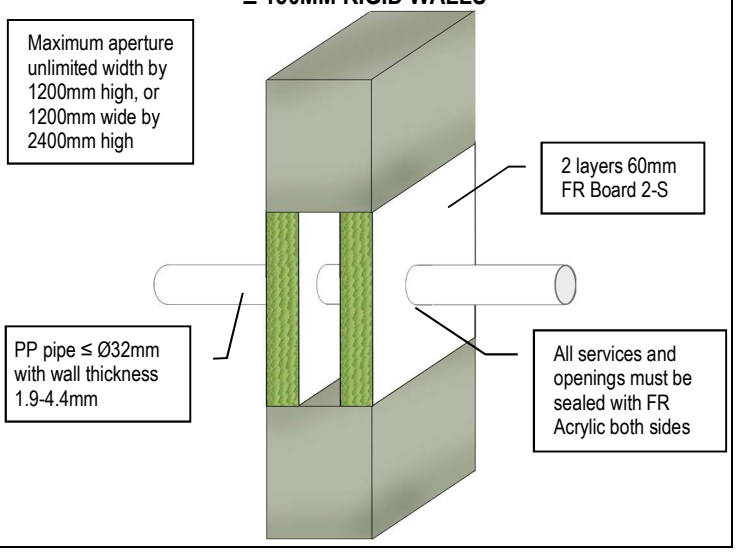

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
69 (86) 2025 7 2

PLASTIC PIPE BUNDLES FIRE RESISTANCE EI 240 U/C (E 240)

≥ 150MM RIGID WALLS

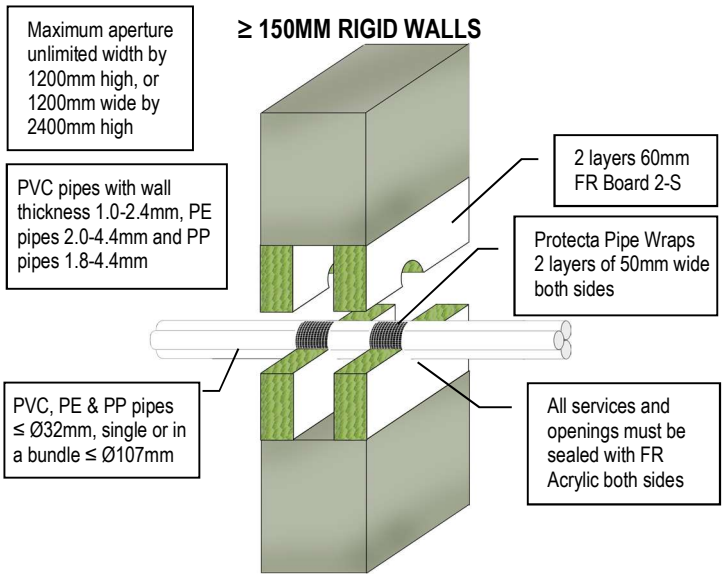

PLASTIC PIPES FIRE RESISTANCE EI 30-60

≥ 75MM RIGID WALLS

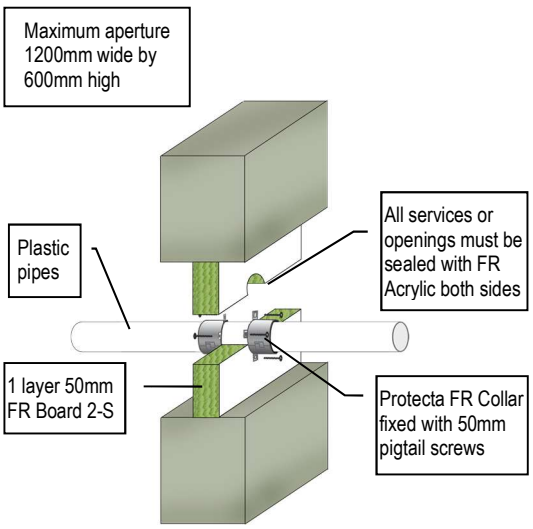

Pipe & Collar Descriptions	Pipe Wall Thickness	Min. Collar Height	Classification
≤ Ø 110mm PVC-U & PVC-C	1.9 – 6.6mm	30mm	EI 30 U/C (E 90 U/C)
≤ Ø 50mm PVC-U & PVC-C	1.9 – 3.7mm	50mm	EI 60 U/C (E 120 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.1 – 6.6mm	50mm	EI 60 U/C (E 90 U/C)
≤ Ø 160mm PVC-U & PVC-C	3.1 – 9.5mm	60mm	EI 60 C/C (E 60 C/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.4 – 10.0mm	30mm	EI 45 U/C (E 60 U/C)
≤ Ø 50mm PE, ABS & SAN+PVC	3.0 – 4.6mm	50mm	EI 60 U/C (E 120 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.0 – 10.0mm	50mm	EI 60 C/C (E 90 C/C)
≤ Ø 160mm PE, ABS & SAN+PVC	3.9 – 9.5mm	60mm	EI 60 C/C (E 60 C/C)
≤ Ø 90mm PP	1.8 – 4.6mm	50mm	EI 60 C/C (E 60 C/C)
≤ Ø 110mm PP	2.7mm	50mm	EI 60 C/C (E 60 C/C)
≤ Ø 160mm PP	3.4 – 9.1mm	60mm	EI 60 C/C (E 60 C/C)

PLASTIC PIPES FIRE RESISTANCE EI 120-240

≥ 150MM RIGID WALLS

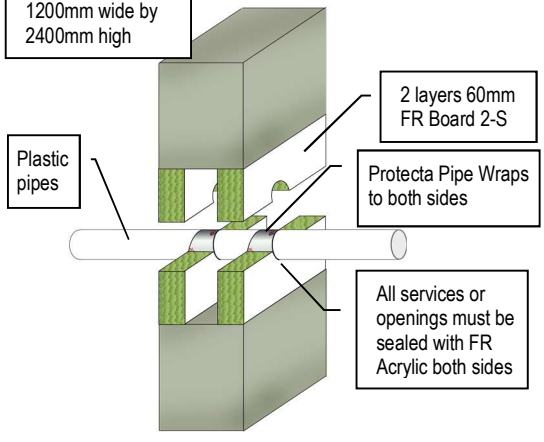

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC-U & PVC-C	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 240 U/C (E 240 U/C)
≤ Ø 40mm PE, ABS & SAN+PVC	2.4 – 4.6mm	50 x 1.8mm (1 layer)	EI 240 U/C (E 240 U/C)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 240 U/C (E 240 U/C)
≤ Ø 110mm PVC-U & PVC-C	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 110mm PE, ABS & SAN+PVC	3.4 – 10.0mm	50 x 3.6mm (2 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 110mm PP	2.7 – 10.0mm	50 x 3.6mm (2 layers)	EI 240 C/C (E 240 C/C)
≤ Ø 125mm PVC-U & PVC-C	4.7 – 7.4mm	50 x 7.2mm (4 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 125mm PE, ABS & SAN+PVC	3.9 – 7.4mm	50 x 7.2mm (4 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 125mm PP	3.1 – 11.4mm	50 x 7.2mm (4 layers)	EI 240 C/C (E 240 C/C)
≤ Ø 160mm PVC-U & PVC-C	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 160mm PE, ABS & SAN+PVC	4.9 – 9.5mm	50 x 10.8mm (6 layers)	EI 240 U/C (E 240 U/C)
≤ Ø 160mm PP	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 240 C/C (E 240 C/C)
≤ Ø 200mm PVC-U & PVC-C	4.9 – 11.9mm	75 x 10.8mm (6 layers)	EI 180 C/C (E 180 C/C)
≤ Ø 200mm PE, ABS & SAN+PVC	4.9 – 18.2mm	75 x 10.8mm (6 layers)	EI 180 C/C (E 180 C/C)
≤ Ø 200mm PP	4.9 – 18.2mm	75 x 10.8mm (6 layers)	EI 180 C/C (E 180 C/C)
≤ Ø 315mm PVC-U & PVC-C	7.7 – 12.1mm	75 x 18.0mm (10 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	18.7 – 28.5mm	75 x 18.0mm (10 layers)	EI 60 C/C (E 180 C/C)
≤ Ø 315mm PE, ABS & SAN+PVC	28.6mm	75 x 18.0mm (10 layers)	EI 120 C/C (E 180 C/C)
≤ Ø 400mm PVC-U & PVC-C	9.8 – 15.3mm	75 x 28.8mm (16 layers)	EI 120 C/C (E 120 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	9.8 – 36.2mm	75 x 28.8mm (16 layers)	EI 30 C/C (E 30 C/C)
≤ Ø 400mm PE, ABS & SAN+PVC	36.3mm	75 x 28.8mm (16 layers)	EI 120 C/C (E 120 C/C)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
70 (86) 2025 7 2

PVC CONDUITS FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM RIGID WALLS

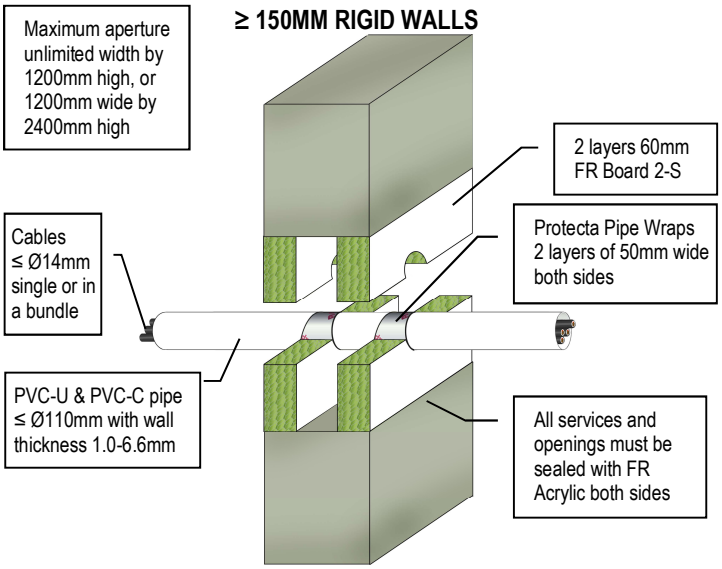

PE CONDUITS FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM RIGID WALLS

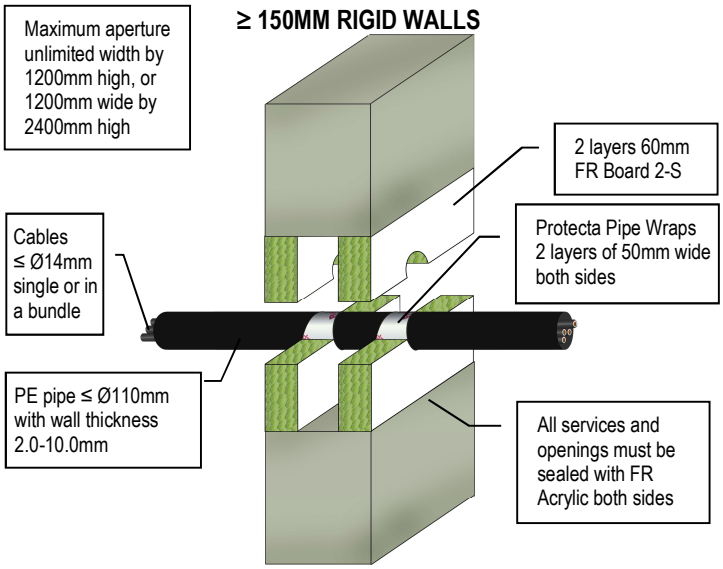

PP CONDUITS FIRE RESISTANCE EI 120 U/C (E 120)

≥ 150MM RIGID WALLS

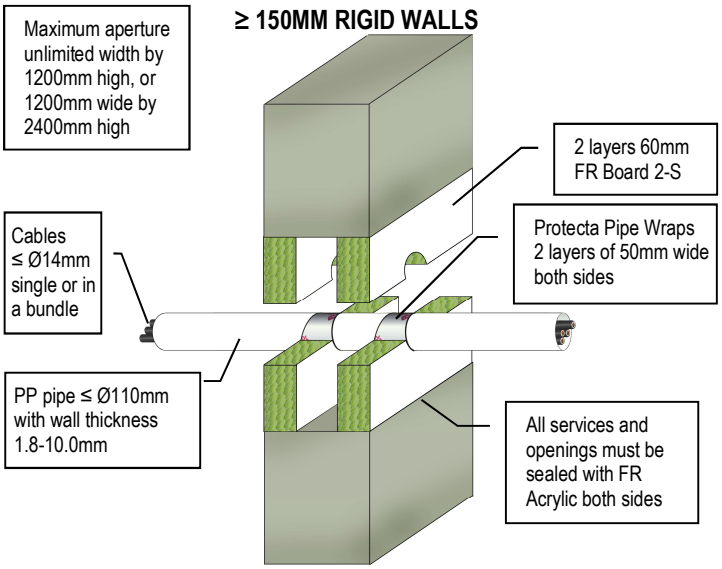

LINEAR SEALS FIRE RESISTANCE EI 90 (E 120)

RIGID FLOORS

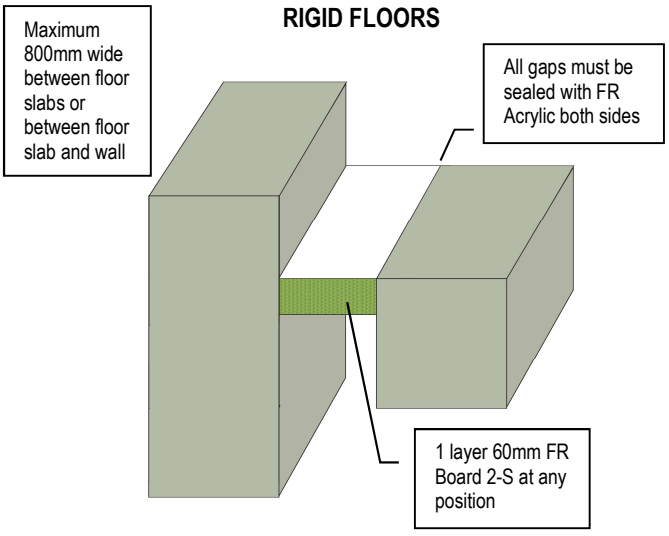

LINEAR SEALS FIRE RESISTANCE EI 120 (E 240)

RIGID FLOORS

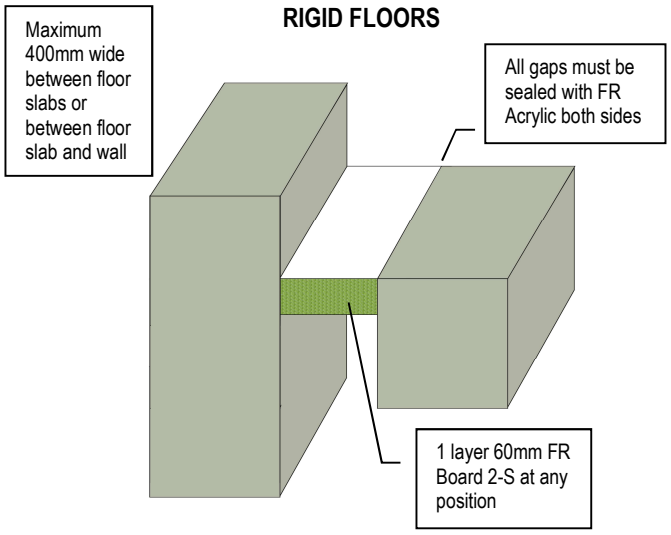

LINEAR SEALS FIRE RESISTANCE EI 120 (E 180)

RIGID FLOORS

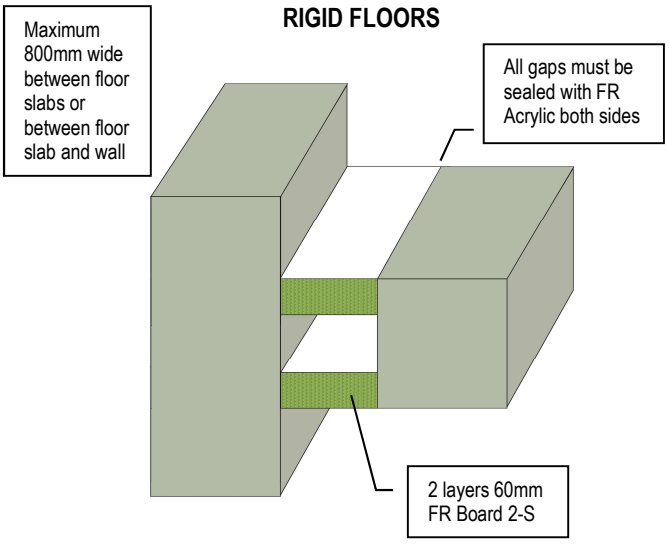

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
71 (86) 2025 7 2

LINEAR SEALS FIRE RESISTANCE EI 240 (E 240)

≥ 150MM RIGID FLOORS

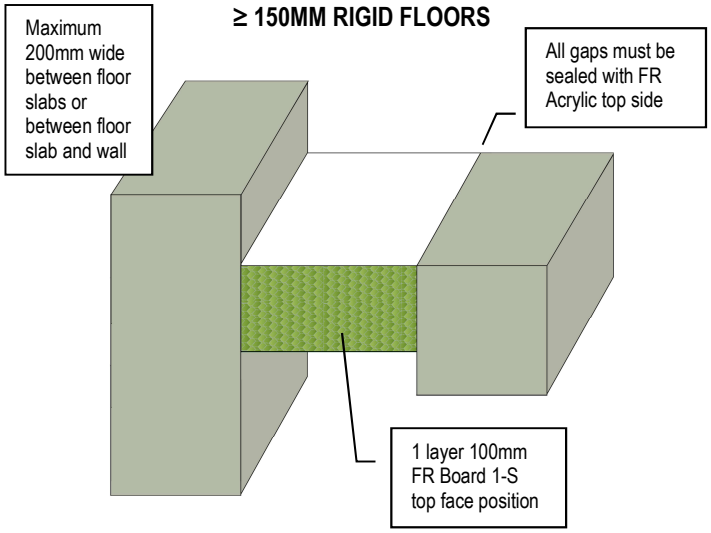

LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)

≥ 150MM RIGID FLOORS

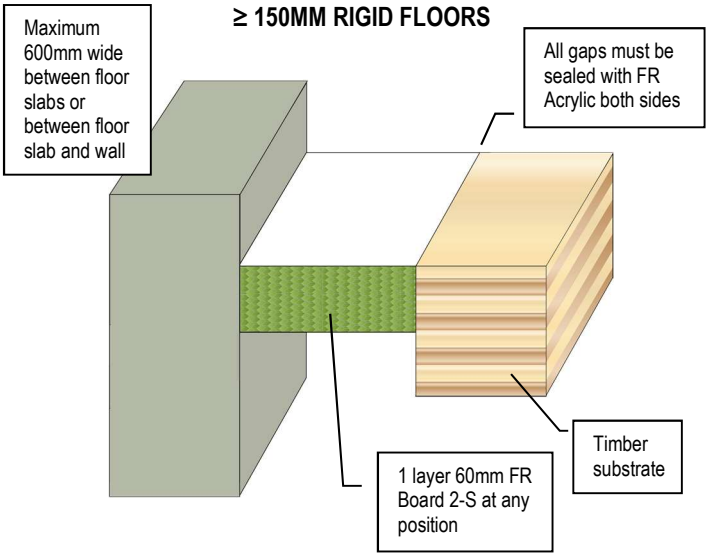

LINEAR SEALS FIRE RESISTANCE EI 60 (E 120)

≥ 150MM RIGID FLOORS

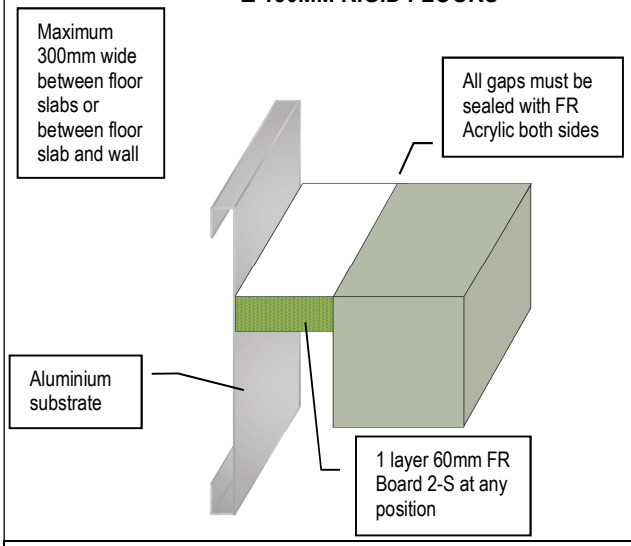

LINEAR SEALS FIRE RESISTANCE EI 90 (E 120)

≥ 150MM RIGID FLOORS

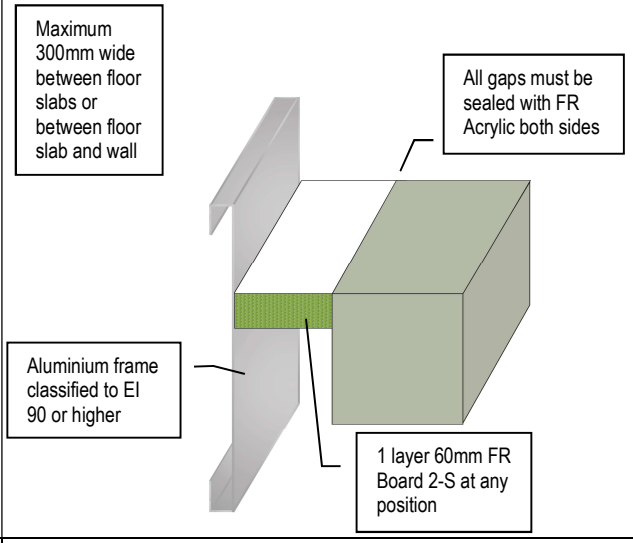

LINEAR SEALS FIRE RESISTANCE E 120

≥ 150MM RIGID FLOORS

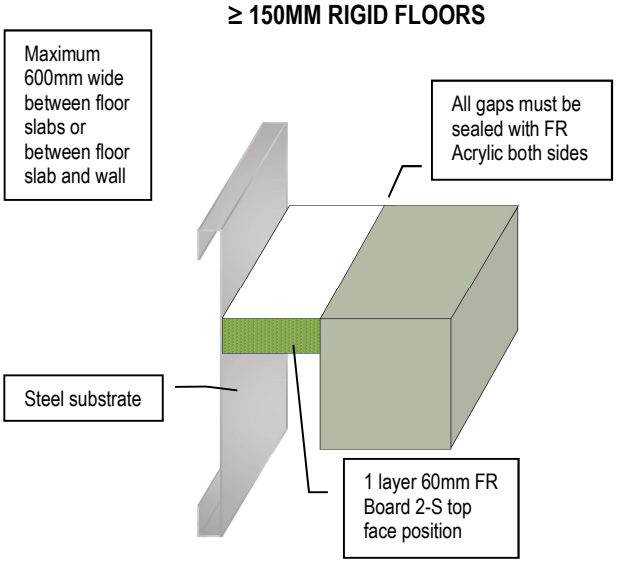

LINEAR SEALS FIRE RESISTANCE EI 120 (E 120)

≥ 150MM RIGID FLOORS

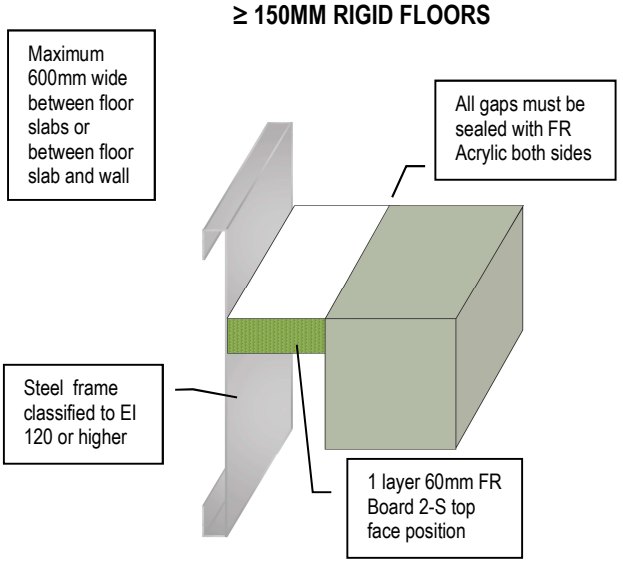

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
72 (86) 2025 2 7

CABLES FIRE RESISTANCE EI 30 (E 240)

≥ 150MM RIGID FLOORS

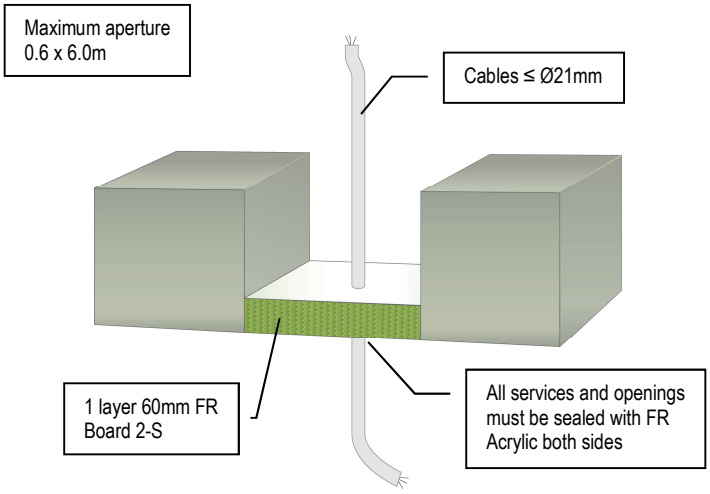

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 30 (E 90)

≥ 150MM RIGID FLOORS

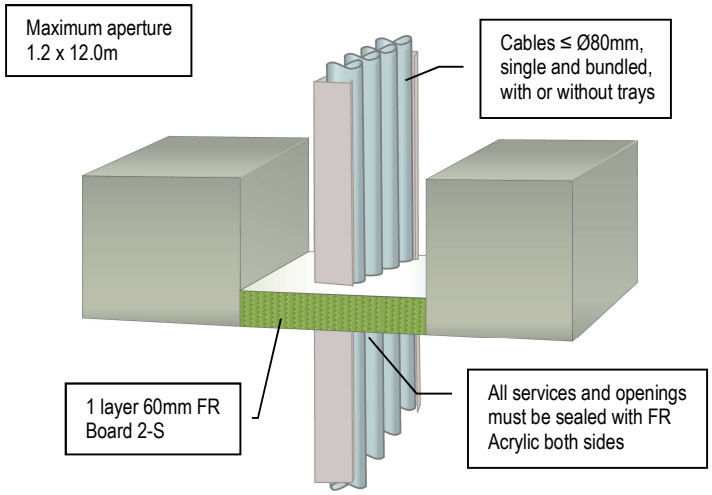

CONDUCTORS AND CONDUITS FIRE RESISTANCE EI 30 (E 45)

≥ 150MM RIGID FLOORS

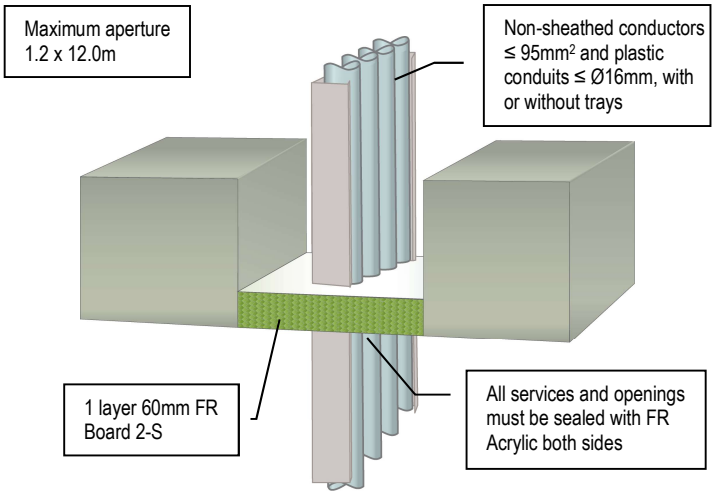

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 120 (E 120)

≥ 150MM RIGID FLOORS

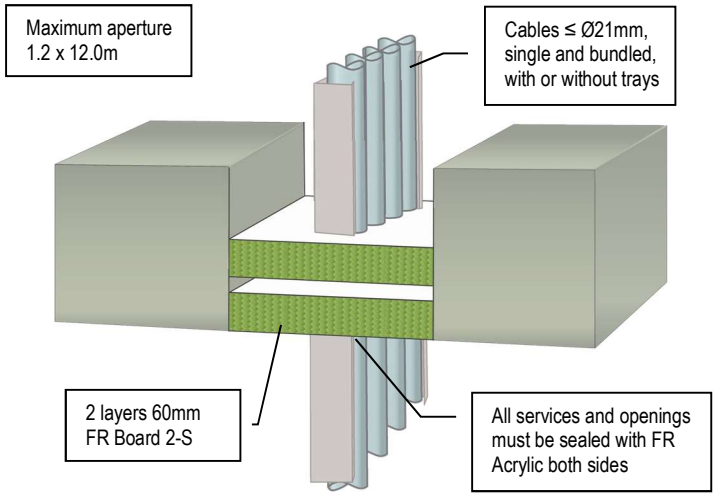

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 120)

≥ 150MM RIGID FLOORS

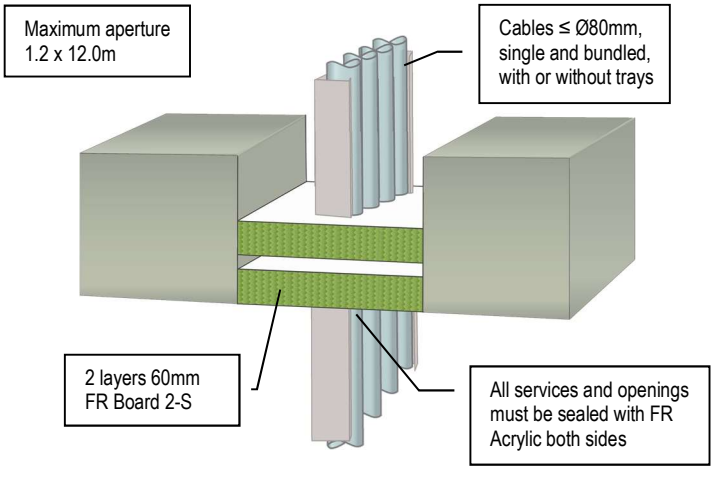

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 90 (E 120)

≥ 150MM RIGID FLOORS

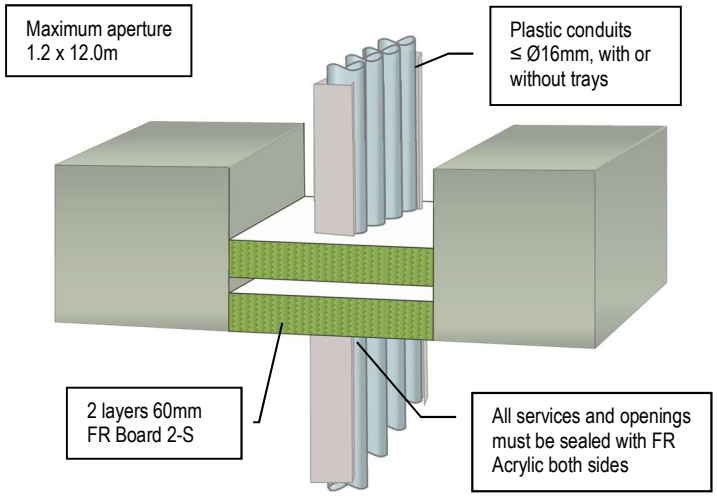

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
73 (86) 2025 2 7

BUS-BARS FIRE RESISTANCE EI 20 (E 180)

≥ 150MM RIGID FLOORS

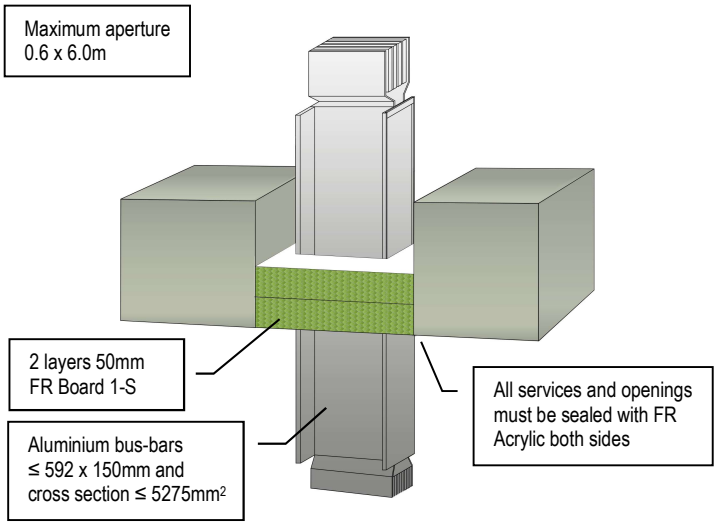

BUS-BARS FIRE RESISTANCE EI 20 (E 120)

≥ 150MM RIGID FLOORS

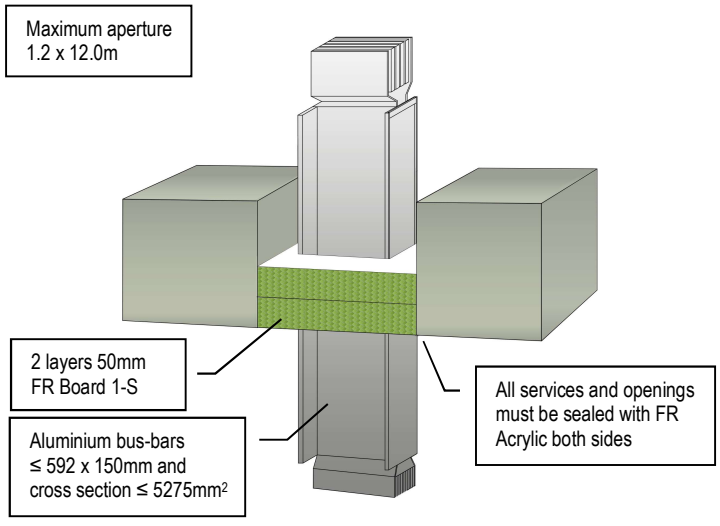

BUS-BARS FIRE RESISTANCE EI 60 (E 240)

≥ 150MM RIGID FLOORS

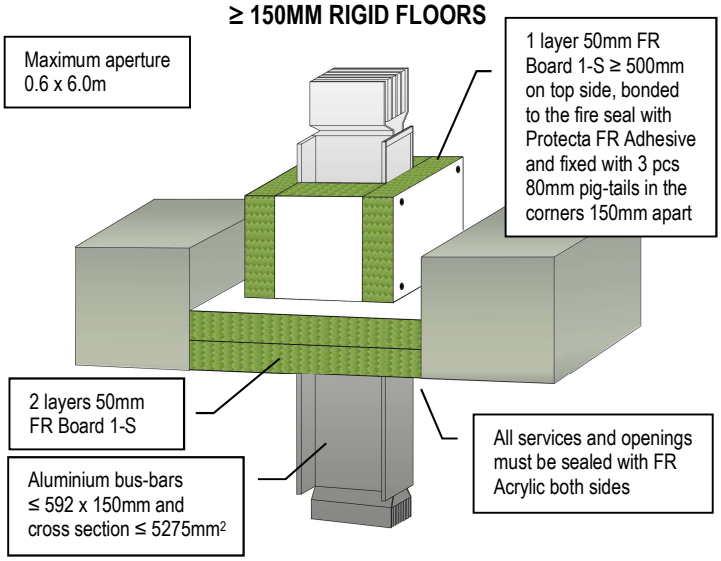

BUS-BARS FIRE RESISTANCE EI 60 (E 120)

≥ 150MM RIGID FLOORS

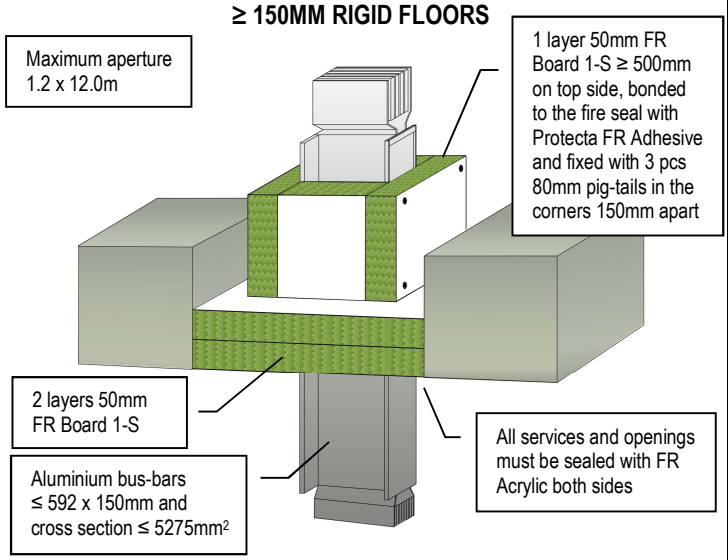

STEEL PIPES FIRE RESISTANCE EI 20 C/C (E 240)

≥ 150MM RIGID FLOORS

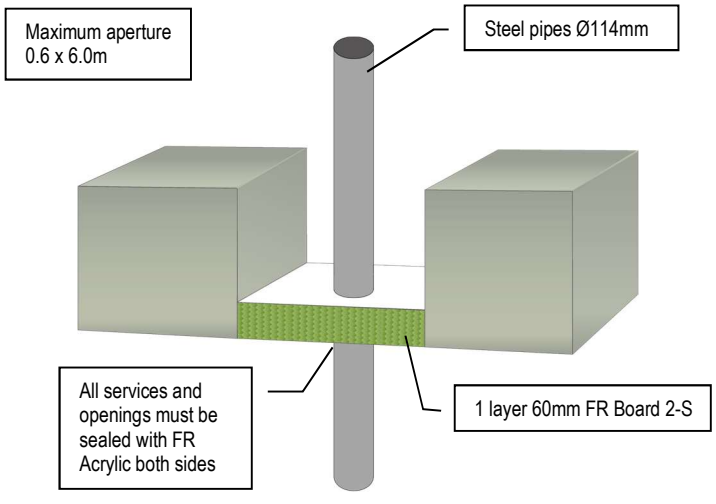

STEEL PIPES FIRE RESISTANCE EI 20 C/C (E 120)

≥ 150MM RIGID FLOORS

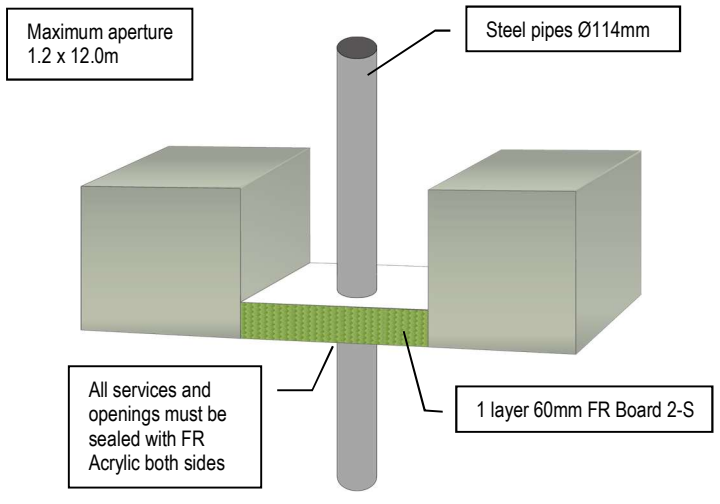

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
74 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 20 C/C (E 120)

≥ 125MM RIGID FLOORS

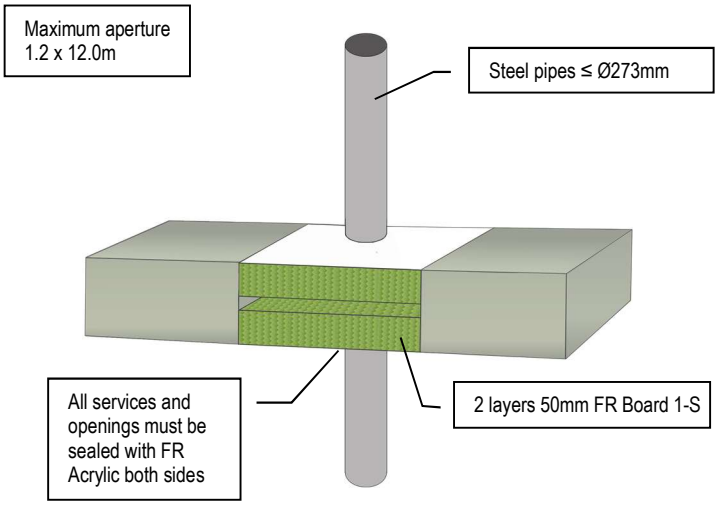

INSULATED STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 90)

≥ 150MM RIGID FLOORS

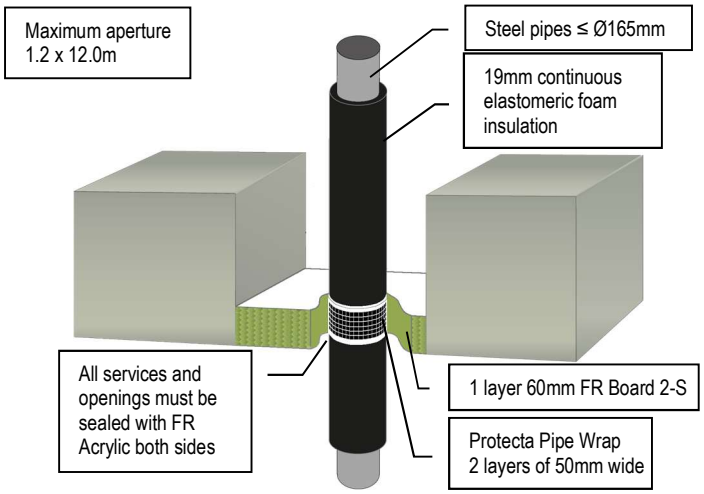

INSULATED STEEL PIPES FIRE RESISTANCE EI 120 C/U (E180)

≥ 150MM RIGID FLOORS

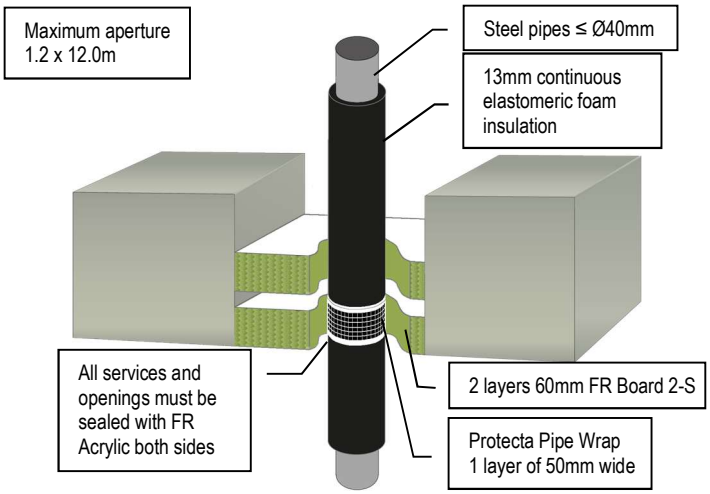

STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 125MM RIGID FLOORS

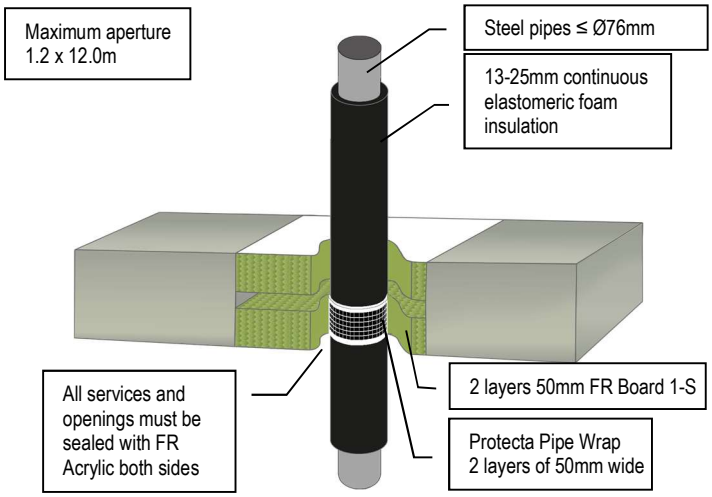

STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 125MM RIGID FLOORS

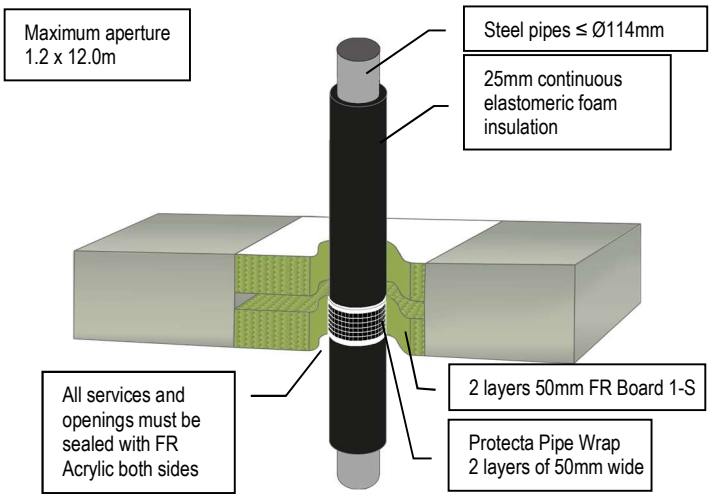

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 125MM RIGID FLOORS

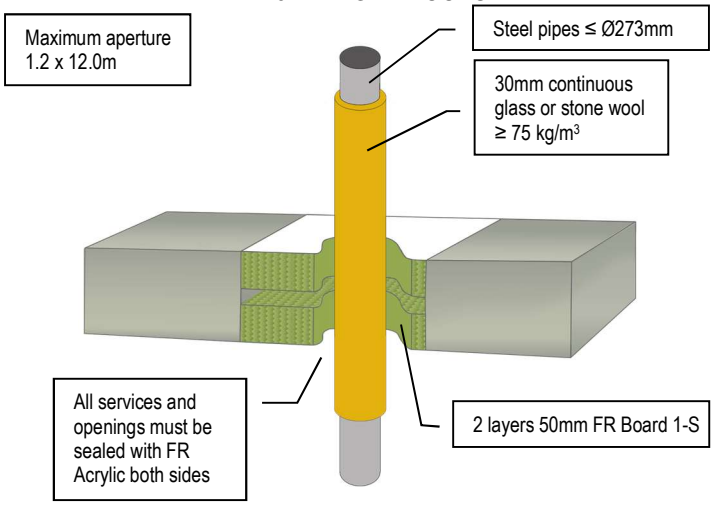

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
75 (86) 2025 2 7

INSULATED STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 150MM RIGID FLOORS

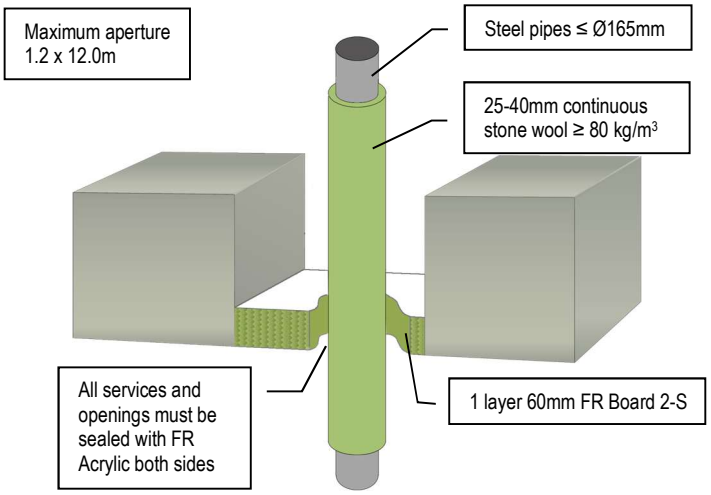

STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 120)

≥ 125MM RIGID FLOORS

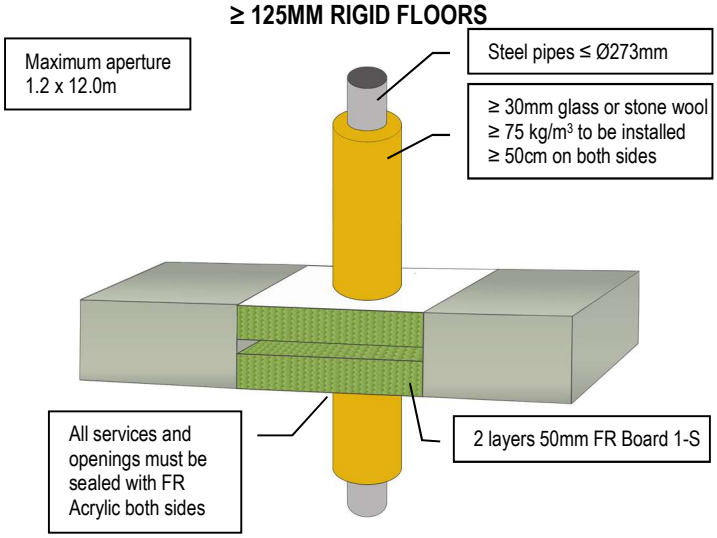

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 240)

≥ 150MM RIGID FLOORS

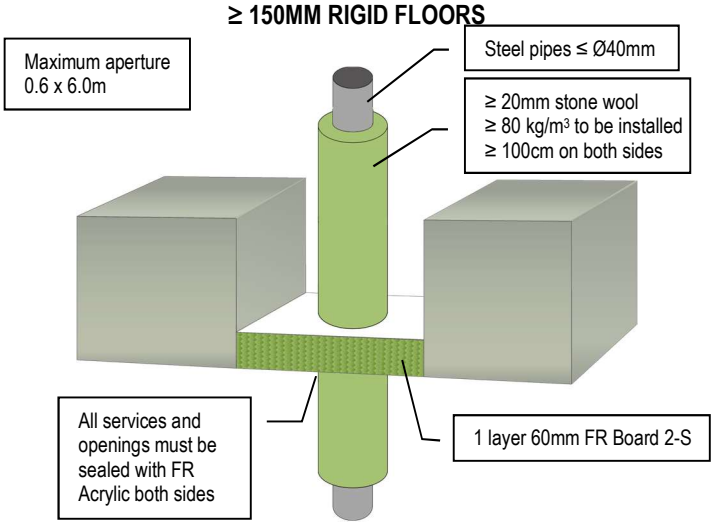

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 120)

≥ 150MM RIGID FLOORS

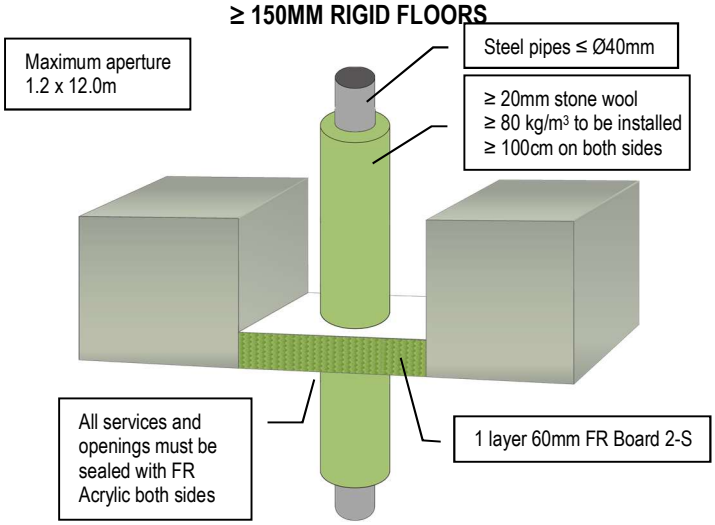

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 240)

≥ 150MM RIGID FLOORS

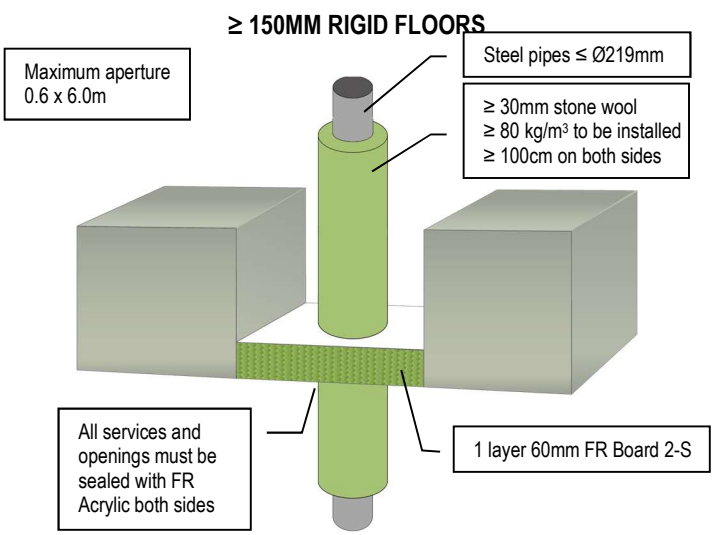

STEEL PIPES FIRE RESISTANCE EI 90 C/U (E 120)

≥ 150MM RIGID FLOORS

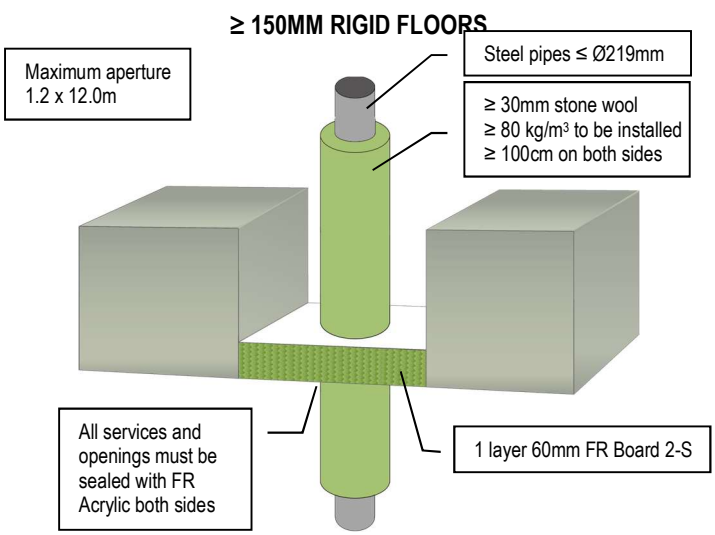

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
76 (86) 2025 2 7

STEEL PIPES FIRE RESISTANCE EI 240 C/U (E 240)

≥ 150MM RIGID FLOORS

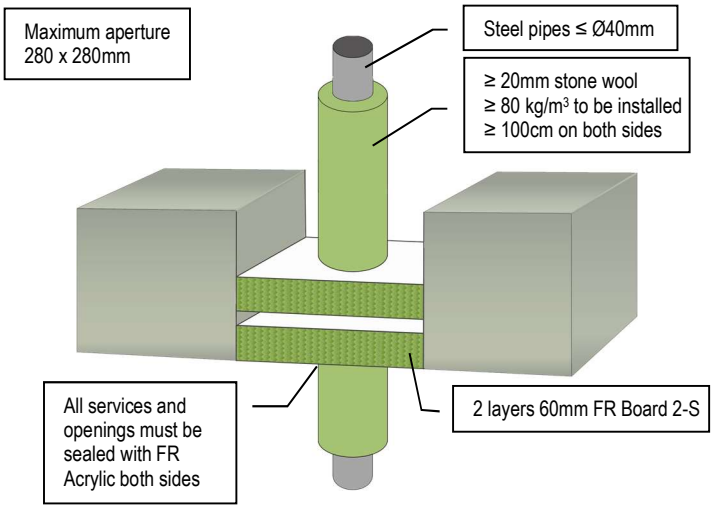

STEEL PIPES FIRE RESISTANCE EI 180 C/U (E 180)

≥ 150MM RIGID FLOORS

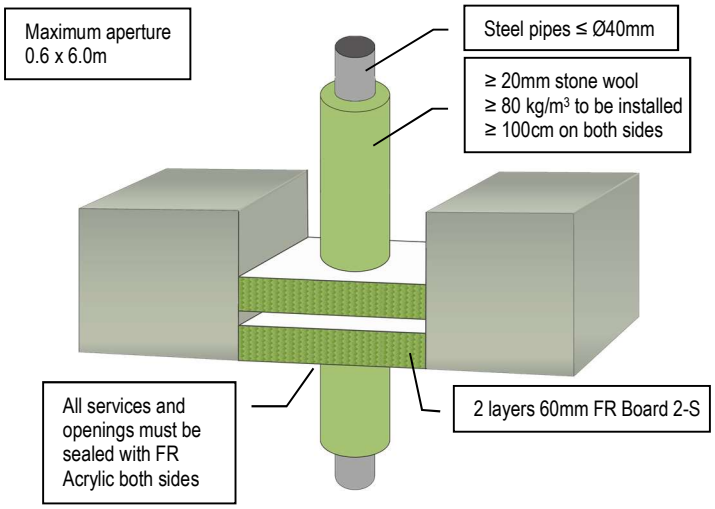

STEEL PIPES FIRE RESISTANCE EI 120 C/U (E 180)

≥ 150MM RIGID FLOORS

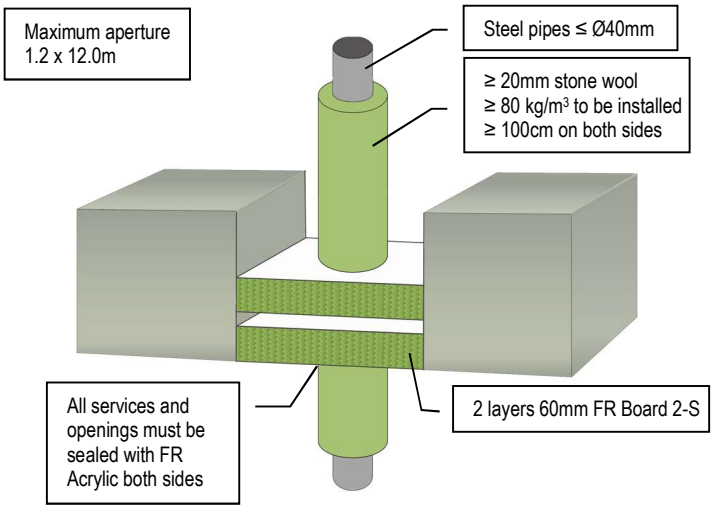

COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 125MM RIGID FLOORS

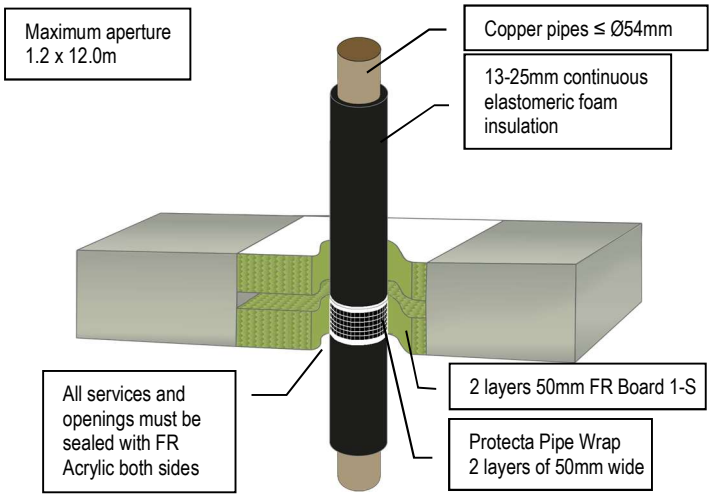

COPPER OR STEEL PIPES FIRE RESISTANCE EI 60 C/C (E 240)

≥ 150MM RIGID FLOORS

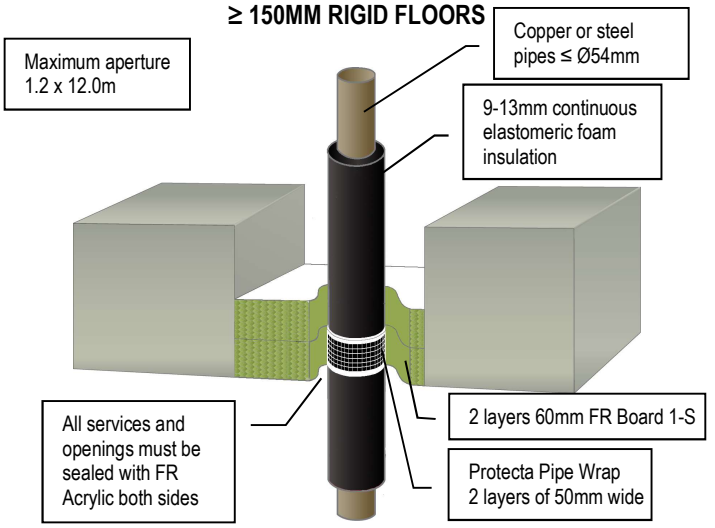

INSULATED COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 125MM RIGID FLOORS

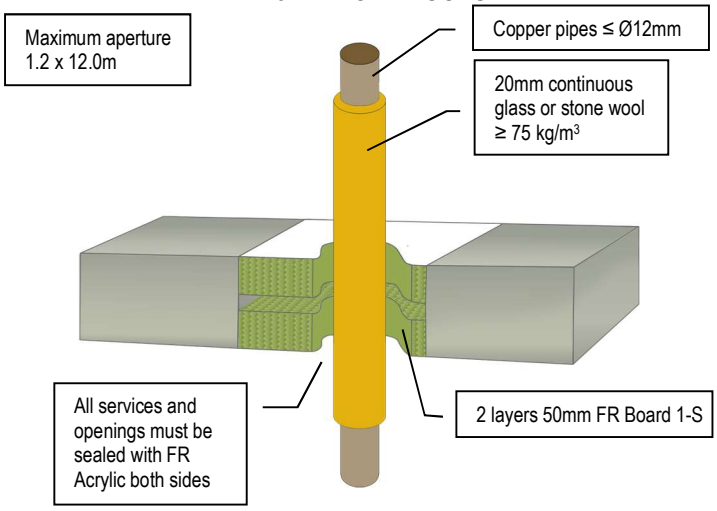

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
77 (86) 2025 2 7

INSULATED COPPER PIPES FIRE RESISTANCE EI 60 C/C (E 60)

≥ 125MM RIGID FLOORS

Maximum aperture
1.2 x 12.0m

Copper pipes ≤ Ø54mm

30-60mm continuous glass or stone wool ≥ 75 kg/m³

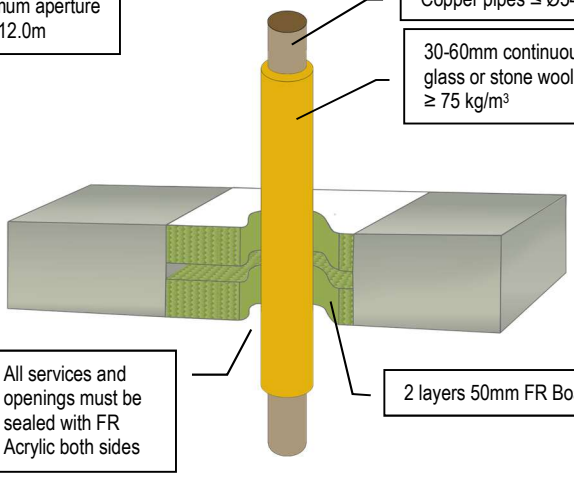

All services and openings must be sealed with FR Acrylic both sides

2 layers 50mm FR Board 1-S

COPPER PIPES FIRE RESISTANCE EI 120 C/C (E 180)

≥ 125MM RIGID FLOORS

Maximum aperture
1.2 x 12.0m

Copper pipes ≤ Ø12mm

≥ 20mm glass or stone wool ≥ 75 kg/m³ to be installed ≥ 50cm on both sides

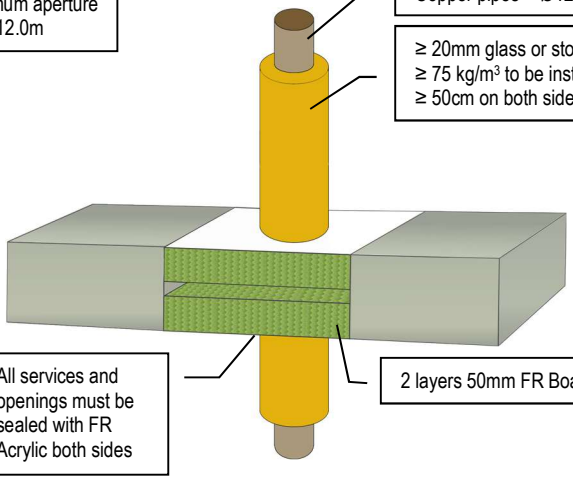

All services and openings must be sealed with FR Acrylic both sides

2 layers 50mm FR Board 1-S

COPPER PIPES FIRE RESISTANCE EI 45 C/C (E 120)

≥ 125MM RIGID FLOORS

Maximum aperture
1.2 x 12.0m

Copper pipes ≤ Ø54mm

≥ 20mm glass or stone wool ≥ 75 kg/m³ to be installed ≥ 50cm on both sides

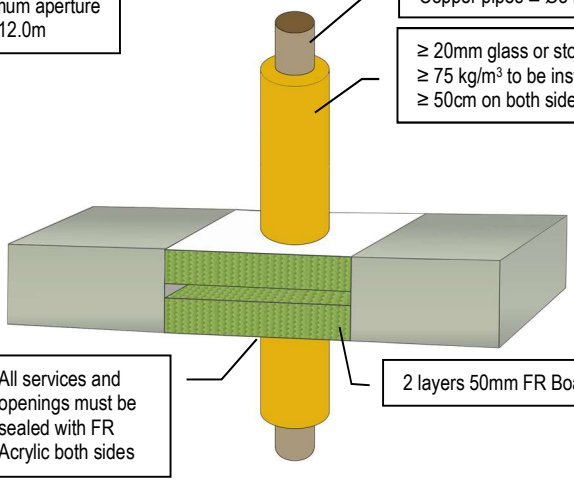

All services and openings must be sealed with FR Acrylic both sides

2 layers 50mm FR Board 1-S

COPPER PIPES FIRE RESISTANCE E 240 C/U

≥ 150MM RIGID FLOORS

Maximum aperture
0.6 x 6.0m

Copper pipes ≤ Ø54mm

≥ 20mm stone wool ≥ 80 kg/m³ to be installed ≥ 100cm on both sides

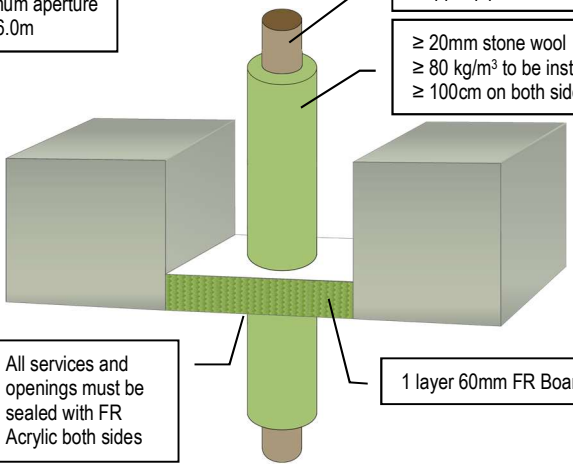

All services and openings must be sealed with FR Acrylic both sides

1 layer 60mm FR Board 2-S

COPPER PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 125MM RIGID FLOORS

Maximum aperture
1.2 x 12.0m

Copper pipes ≤ Ø54mm

≥ 20mm stone wool ≥ 80 kg/m³ to be installed ≥ 50cm on both sides

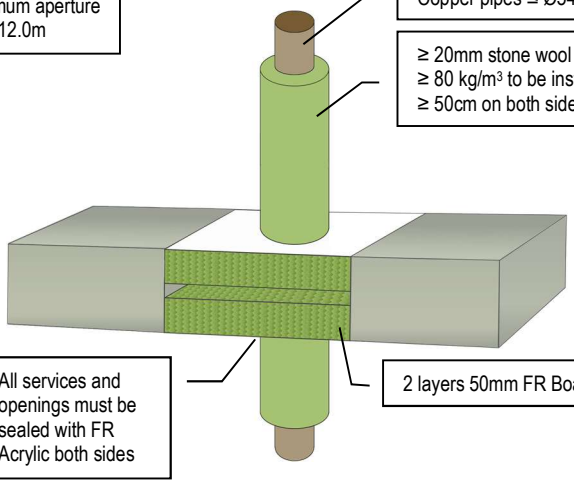

All services and openings must be sealed with FR Acrylic both sides

2 layers 50mm FR Board 1-S

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 180)

≥ 125MM RIGID FLOORS

Maximum aperture
1.2 x 12.0m

Alupex pipes ≤ Ø16mm

13mm continuous elastomeric foam insulation

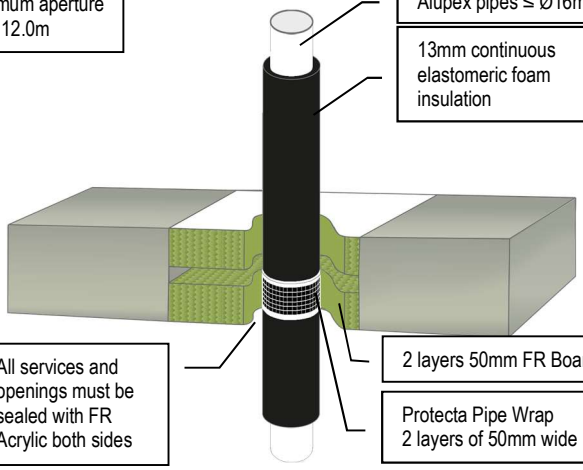

All services and openings must be sealed with FR Acrylic both sides

2 layers 50mm FR Board 1-S

Protecta Pipe Wrap
2 layers of 50mm wide

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
78 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 125MM RIGID FLOORS

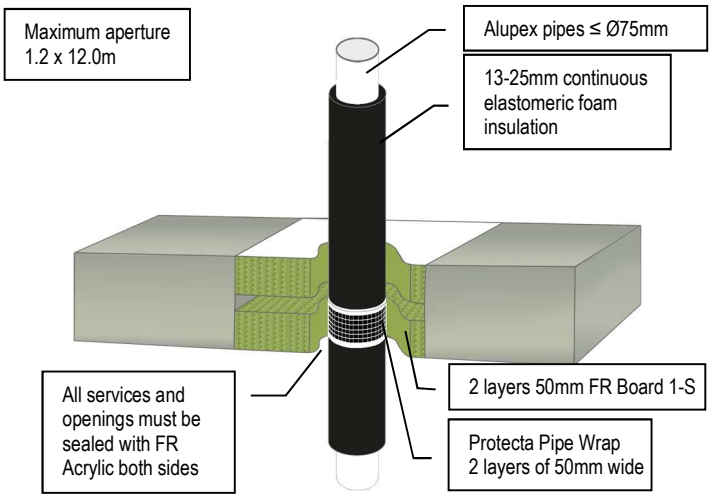

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 150MM RIGID FLOORS

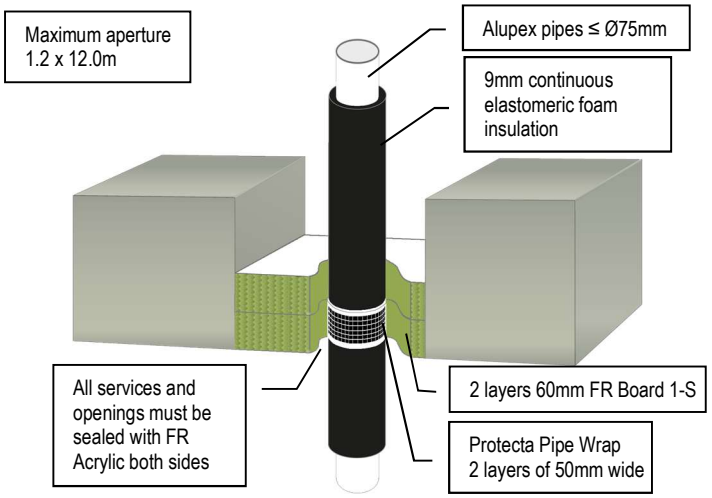

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 125MM RIGID FLOORS

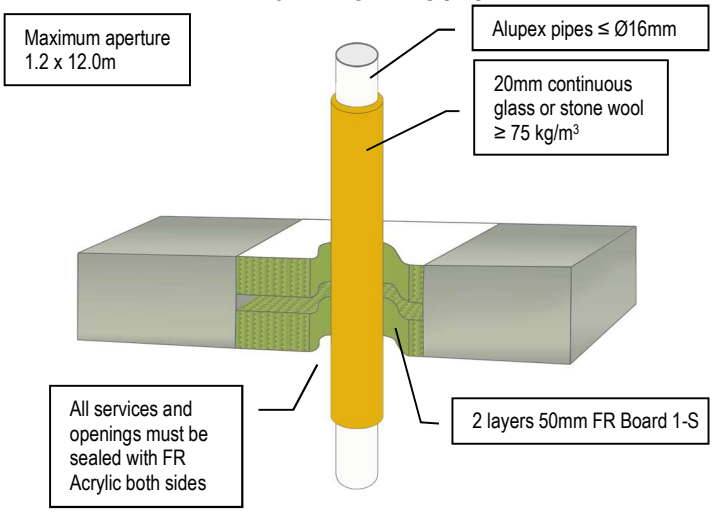

INSULATED ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 125MM RIGID FLOORS

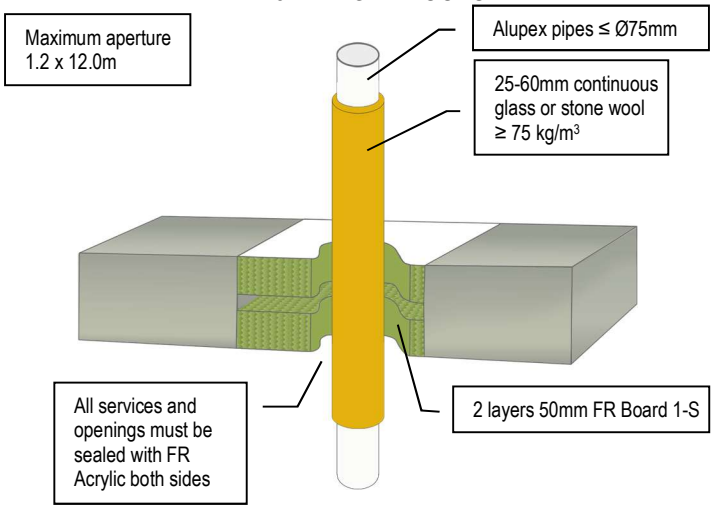

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 125MM RIGID FLOORS

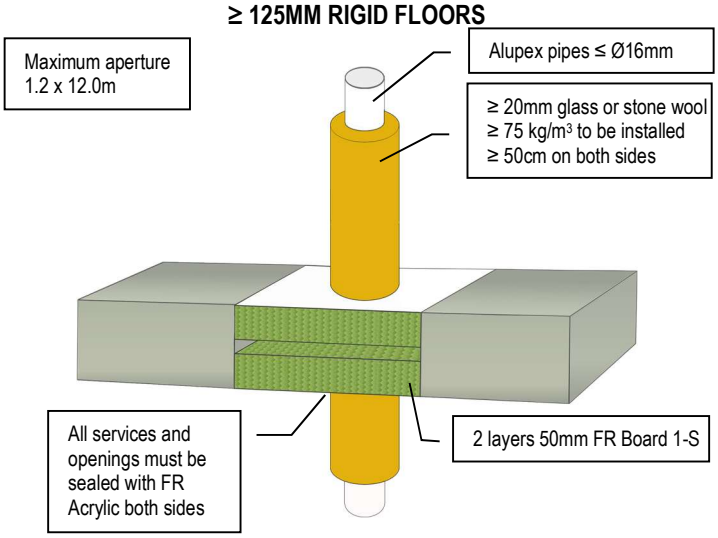

ALUPEX PIPES FIRE RESISTANCE EI 120 C/C (E 120)

≥ 125MM RIGID FLOORS

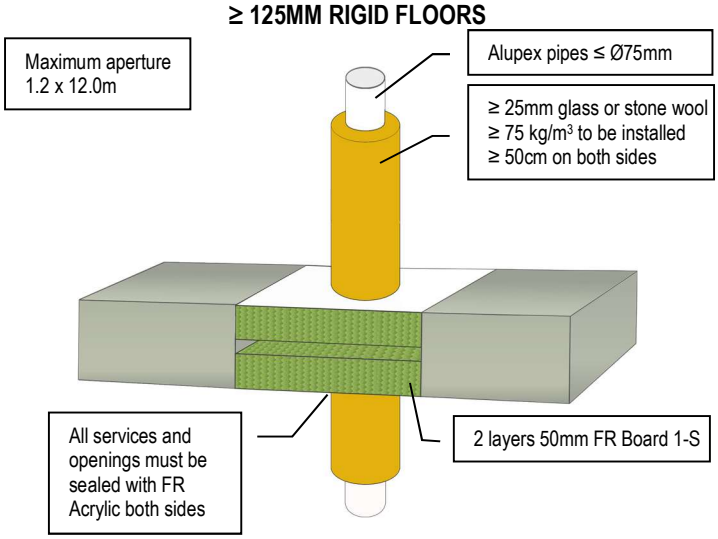

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UKCA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
79 (86) 2025 2 7

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 240)

≥ 150MM RIGID FLOORS

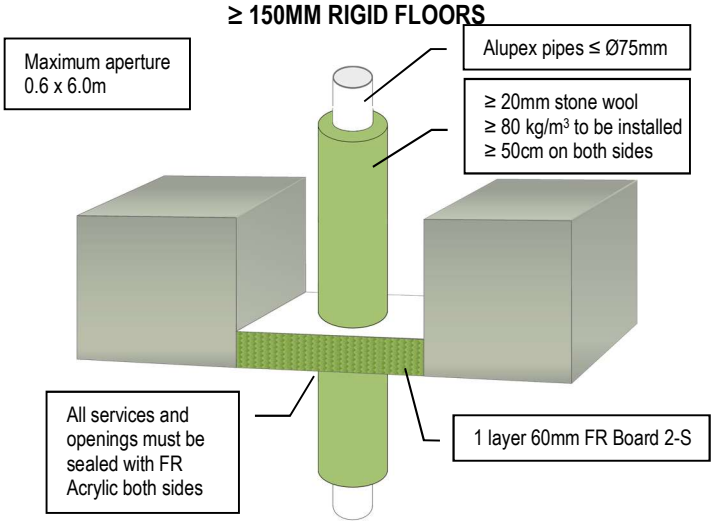

ALUPEX PIPES FIRE RESISTANCE EI 90 C/C (E 120)

≥ 150MM RIGID FLOORS

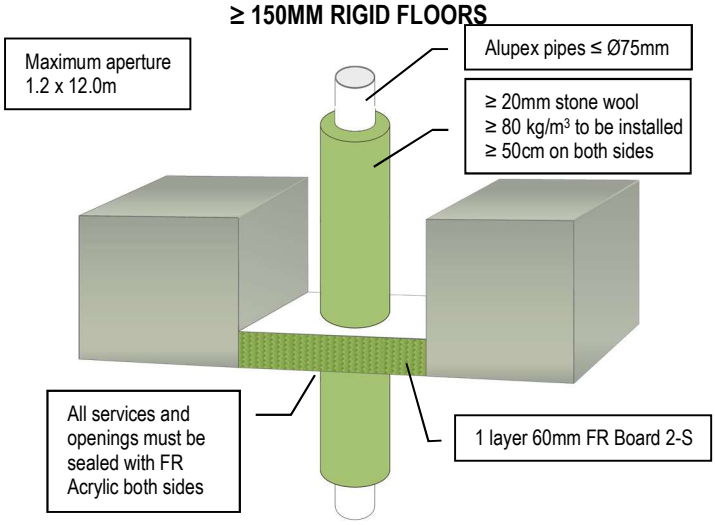

ALUPEX PIPES FIRE RESISTANCE EI 180 C/C (E 240)

≥ 150MM RIGID FLOORS

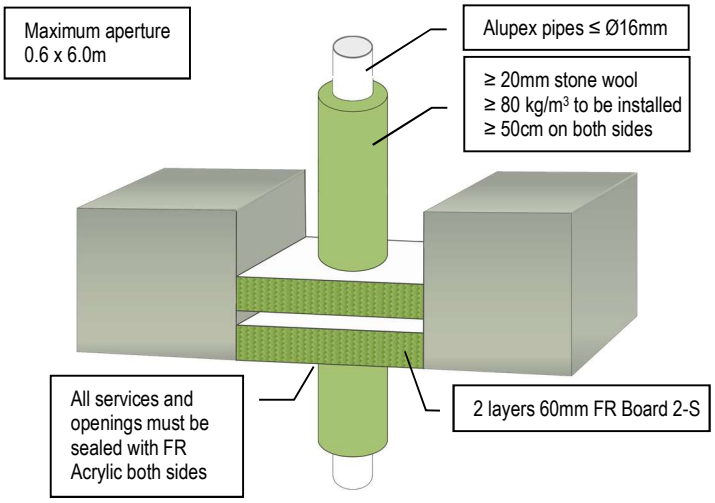

PLASTIC PIPES FIRE RESISTANCE EI 60

≥ 125MM RIGID FLOORS

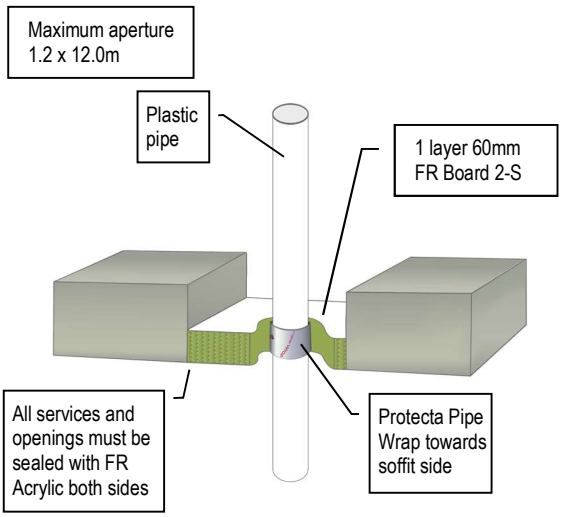

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 120)
≤ Ø 110mm PVC	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60)
≤ Ø 40mm PE	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 60)
≤ Ø 110mm PE	3.4 – 10.0mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 60)
≤ Ø 110mm PP	2.7 – 10.0mm	50 x 3.6mm (2 layers)	EI 60 C/C (E 60)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
80 (86) 2025 2 7

PLASTIC PIPES FIRE RESISTANCE EI 60

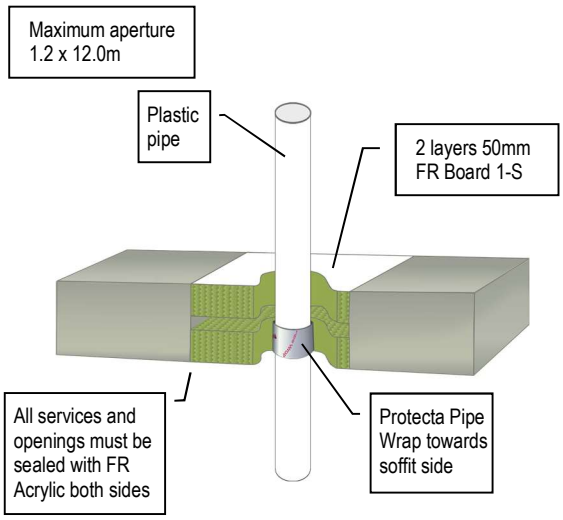

≥ 125MM RIGID FLOORS

Services	Pipe Wall Thickness	FR Pipe Wrap	Classification
≤ Ø 40mm PVC	1.9 – 3.0mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 120)
≤ Ø 110mm PVC	2.7 – 6.6mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60)
≤ Ø 160mm PVC	4.0 – 9.5mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60)
≤ Ø 40mm PE	2.4 – 3.7mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 60)
≤ Ø 110mm PE	3.4 – 10.0mm	50 x 3.6mm (2 layers)	EI 60 U/C (E 60)
≤ Ø 160mm PE	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60)
≤ Ø 40mm PP	1.8 – 5.5mm	50 x 1.8mm (1 layer)	EI 60 U/C (E 60)
≤ Ø 110mm PP	2.7 – 10.0mm	50 x 3.6mm (2 layers)	EI 60 C/C (E 60)
≤ Ø 160mm PP	4.9 – 14.6mm	50 x 10.8mm (6 layers)	EI 60 C/C (E 60)

COMPOSITE PLASTIC PIPES FIRE RESISTANCE EI 60-90

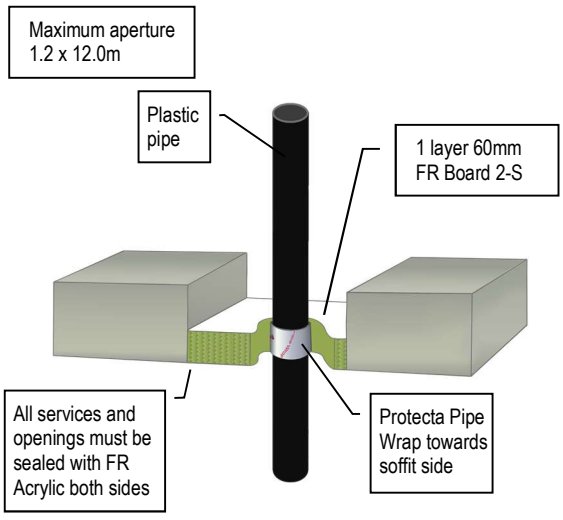

≥ 125MM RIGID FLOORS

Services	FR Pipe Wrap	Classification
≤ Ø 20mm Aquatherm green MF	50 x 1.8mm (1 layer)	EI 60 C/C (E 120)
< Ø 110mm Aquatherm green MF	50 x 3.6mm (2 layers)	EI 60 C/C (E 120)
Ø 110mm Aquatherm green MF	50 x 3.6mm (2 layers)	EI 90 C/C (E 120)
≤ Ø 50mm Geberit Silent PP	50 x 3.6mm (2 layers)	EI 60 U/U (E 120)
≤ Ø 110mm Geberit Silent PP	50 x 3.6mm (2 layers)	EI 60 U/C (E 120)
≤ Ø 50mm Huliot Ultra Silent	50 x 3.6mm (2 layers)	EI 60 U/U (E 120)
< Ø 110mm Huliot Ultra Silent	50 x 3.6mm (2 layers)	EI 60 U/C (E 120)
Ø 110mm Huliot Ultra Silent	50 x 3.6mm (2 layers)	EI 90 U/C (E 120)
Ø 110mm POLO-KAL NG	50 x 3.6mm (2 layers)	EI 60 U/C (E 90)
≤ Ø 50mm Rehau Raupiano Plus	50 x 3.6mm (2 layers)	EI 60 U/U (E 120)
< Ø 110mm Rehau Raupiano Plus	50 x 3.6mm (2 layers)	EI 60 U/C (E 120)
Ø 110mm Rehau Raupiano Plus	50 x 3.6mm (2 layers)	EI 90 U/C (E 120)
≤ Ø 50mm Uponor Decibel	50 x 3.6mm (2 layers)	EI 90 U/U (E 120)
≤ Ø 110mm Uponor Decibel	50 x 3.6mm (2 layers)	EI 90 U/C (E 120)
≤ Ø 50mm Wavin AS+	50 x 3.6mm (2 layers)	EI 60 U/U (E 120)
< Ø 110mm Wavin AS+	50 x 3.6mm (2 layers)	EI 60 U/C (E 120)
Ø 110mm Wavin AS+	50 x 3.6mm (2 layers)	EI 90 U/C (E 120)

COMPOSITE PLASTIC PIPES FIRE RESISTANCE EI 60-120

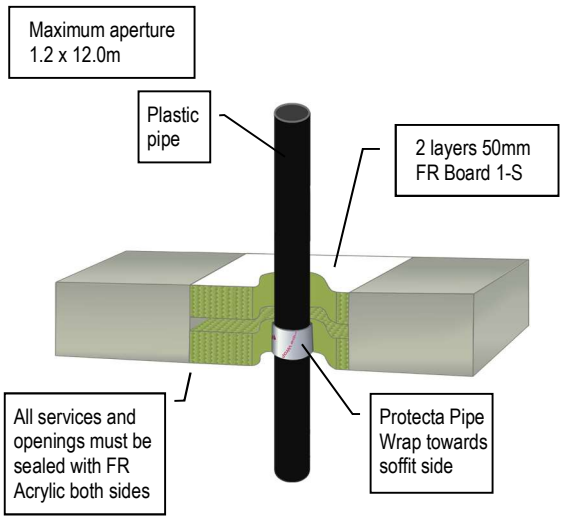

≥ 125MM RIGID FLOORS

Services	FR Pipe Wrap	Classification
< Ø 160mm Geberit Silent PP	50 x 10.8mm (6 layers)	EI 60 U/C (E 120)
Ø 160mm Geberit Silent PP	50 x 10.8mm (6 layers)	EI 120 U/C (E 120)
Ø 125mm POLO-KAL NG	50 x 7.2mm (4 layers)	EI 120 U/C (E 120)
Ø 160mm POLO-KAL NG	50 x 10.8mm (6 layers)	EI 120 U/C (E 120)

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

LINEAR SEALS FIRE RESISTANCE EI 90 (E 90)

≥ 150MM TIMBER & RIGID FLOORS

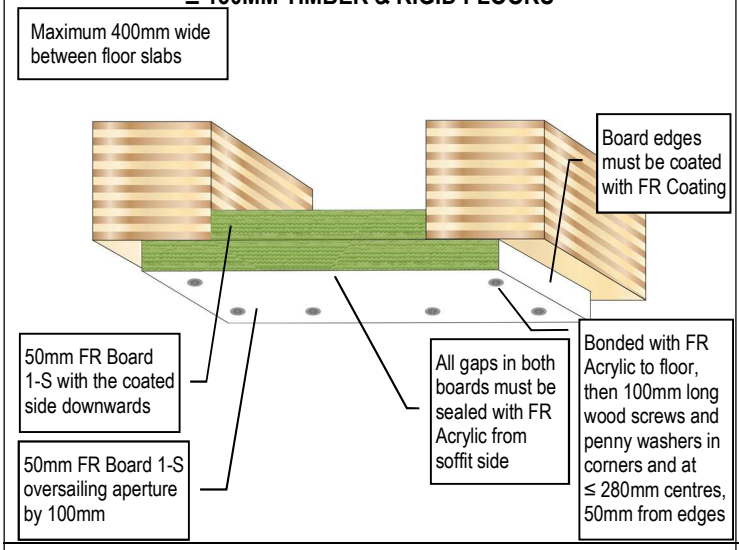

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 45 (E 90)

≥ 150MM TIMBER & RIGID FLOORS

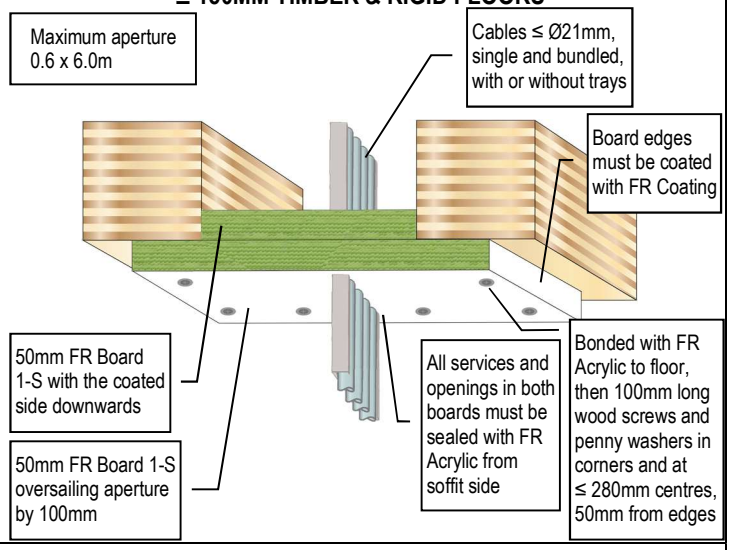

CABLES AND CABLE TRAYS FIRE RESISTANCE EI 60 (E 90)

≥ 150MM TIMBER & RIGID FLOORS

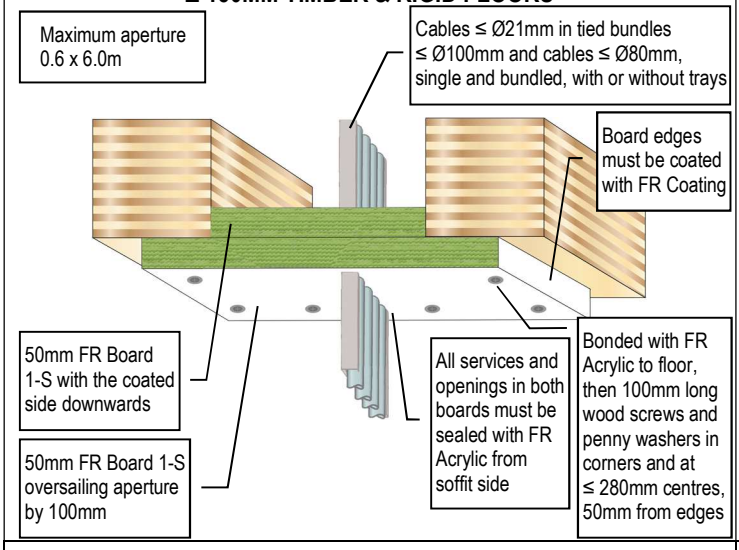

CONDUCTORS AND CABLE TRAYS FIRE RESISTANCE EI 30 (E 90)

≥ 150MM TIMBER & RIGID FLOORS

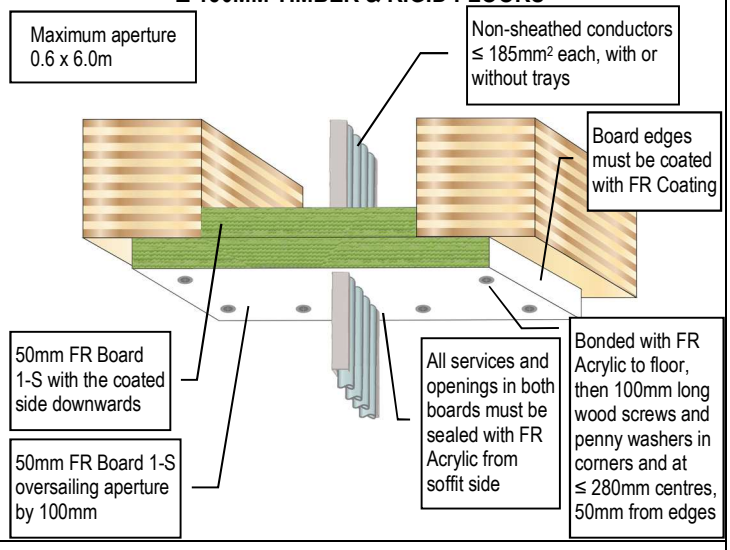

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 150MM TIMBER & RIGID FLOORS

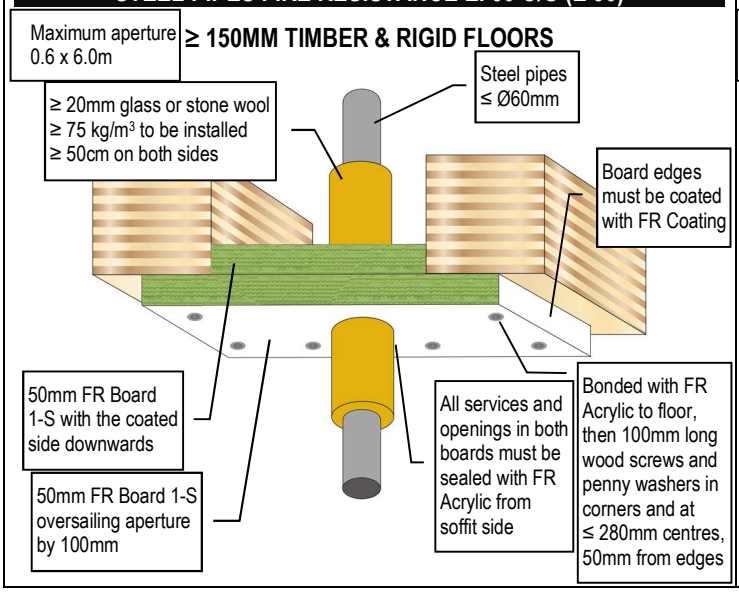

STEEL PIPES FIRE RESISTANCE EI 60 C/U (E 90)

≥ 150MM TIMBER & RIGID FLOORS

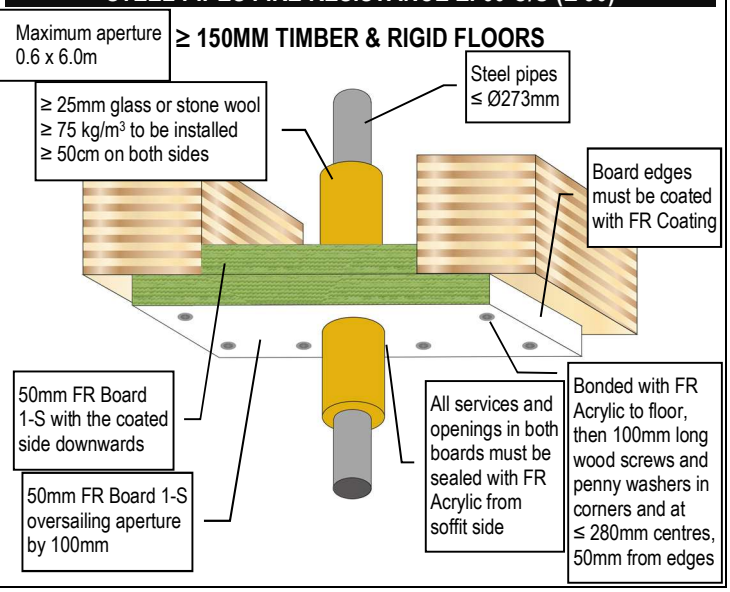

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

ETA UK CA
Installation Guide to ETA 22/0733, ETA 22/0771, UKTA 22/0034 & UKTA 22/0025

www.protecta.eu
Polyseam Ltd tel.+44(0)1484421036
82 (86) 2025 2 7

COPPER & STEEL PIPES FIRE RESISTANCE EI 90 C/C (E 90)

≥ 150MM TIMBER & RIGID FLOORS

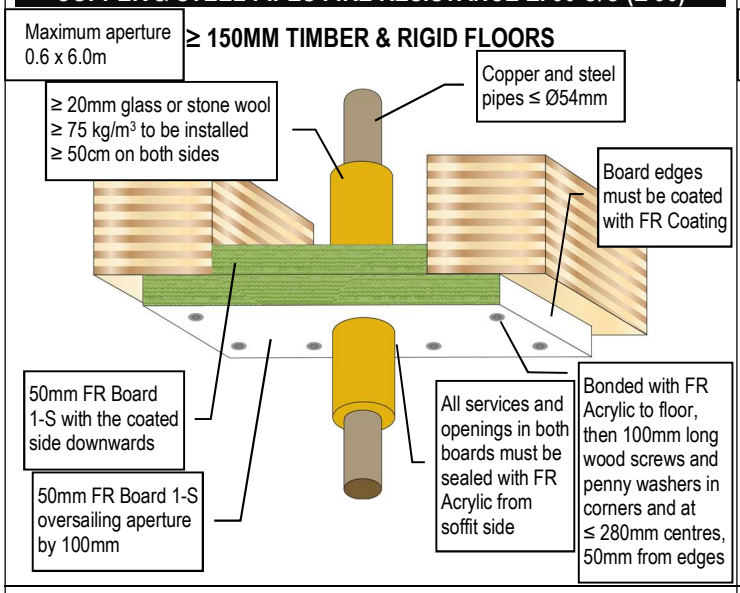

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 150MM TIMBER & RIGID FLOORS

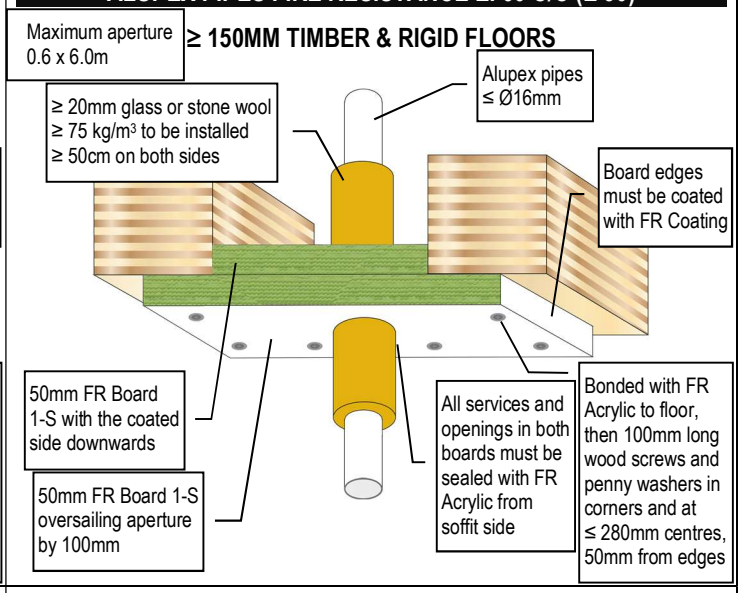

ALUPEX PIPES FIRE RESISTANCE EI 60 C/C (E 90)

≥ 150MM TIMBER & RIGID FLOORS

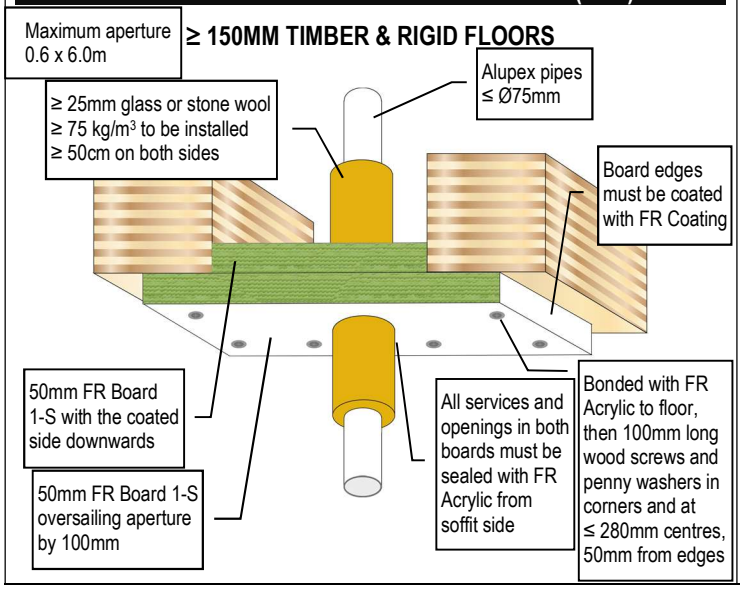

PEX PIPE IN PIPES SYSTEM FIRE RESISTANCE EI 90 (E 90)

≥ 150MM TIMBER & RIGID FLOORS

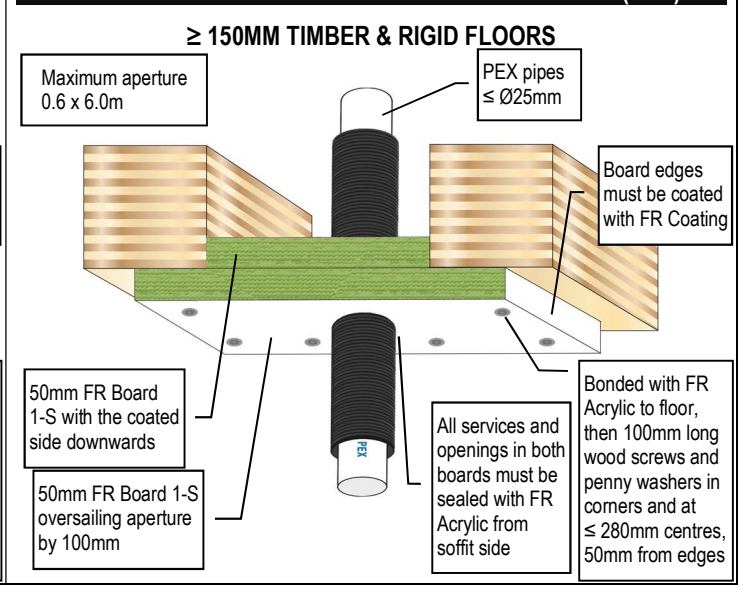

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

INDEX

Drywalls and rigid walls

Services	Service insulation	Page no.
Linear seals	-	2
Cables and cable trays	-	2 - 3
Bus-bars	-	4
“	FR Board	4
Trunking	-	5
Steel pipes	-	5 - 6
“	Coat-back	6
“	Elastomeric & PE, continuous	7
“	Phenolic, continuous	8
“	Glass-wool, continuous	8 -9
“	Stone-wool, continuous	9
“	Glass-wool, interrupted	9 - 10
“	Stone-wool, interrupted	10 - 11
Flexible steel gas pipes	-	11
Copper pipes	-	12
“	Elastomeric & PE, continuous	12 - 13
“	Phenolic, continuous	13 - 14
“	PU, continuous	14 - 15
“	Glass-wool, continuous	15 - 16
“	Stone-wool, continuous	16
“	Glass-wool, interrupted	17
“	Stone-wool, interrupted	18
Alupex pipes	-	18 - 19
“	Elastomeric & PE, continuous	19 - 20
“	Glass-wool, continuous	20
“	Stone-wool, continuous	20
“	Glass-wool, interrupted	21
“	Stone-wool, interrupted	21-22
Metallic pipes w/ FR Graphite	Elastomeric, phenolic & PE, continuous	22 - 23
PVC pipes, small, w/o pipe wraps	-	23
PE pipes, small, w/o wraps	-	23 - 24
PP pipes, small, w/o pipe wraps	-	24
Plastic pipes, large	-	25 - 26
PE pipes	Elastomeric & PE, continuous	26 - 27
PP pipes	Elastomeric & PE, continuous	27 - 28
Plastic conduits	-	28 - 29
Bundled plastic pipes and conduits	-	29 - 30
PEX pipe-in-pipes	-	30 - 31
Polybutylene pipes	-	31 - 32
Aquatherm Green pipes	-	32 - 33
Bluepower pipes	-	33 - 34
Geberit Silent pipes	-	34 - 35
Huliot Ultra Silent pipes	-	35 - 36
POLO-KAL NG pipes	-	36 - 37
Rehau Raupiano pipes	-	37 - 38
Uponor Decibel pipes	-	38 - 39
Valsir Blackfire pipes	-	39 - 40
Valsir PP3 pipes	-	40 - 41
Valsir Triplus pipes	-	41 - 42
Wavin AS+ pipes	-	42 - 43
Wavin SiTech pipes	-	43 - 44

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Timber walls

Services	Service insulation	Page no.
Linear seals	-	44
Cables and cable trays	-	44
Bus-bars	-	45
Trunking	-	45
Steel pipes	-	45
“	Coat-back	46
“	Elastomeric & PE, continuous	46
“	Phenolic, continuous	47
“	Glass-wool, continuous	47
“	Stone-wool, continuous	47
“	Glass-wool, interrupted	47
“	Stone-wool, interrupted	47 - 48
Flexible steel gas pipes	-	48
Copper pipes	-	48
“	Elastomeric & PE, continuous	49
“	Phenolic, continuous	49 - 50
“	PU, continuous	50
“	Glass-wool, continuous	50
“	Stone-wool, continuous	50
“	Glass-wool, interrupted	50 - 51
“	Stone-wool, interrupted	51
Alupex pipes	-	51
“	Elastomeric & PE, continuous	51
“	Glass- & stone-wool, continuous	51
“	Glass-wool, interrupted	52
“	Stone-wool, interrupted	52
Metallic pipes w/ graphite	Elastomeric, phenolic & PE, continuous	52
PVC pipes, small, w/o pipe wraps	-	53
PE pipes, small, w/o wraps	-	53
PP pipes, small, w/o pipe wraps	-	53
Plastic pipes, large	-	53
PE pipes	Elastomeric & PE, continuous	54
PP pipes	Elastomeric & PE, continuous	54
Plastic conduits	-	55
Bundled plastic pipes and conduits	-	55
PEX pipe-in-pipes	-	55 - 56
Polybutylene pipes	-	56
Aquatherm Green pipes	-	56
Bluepower pipes	-	56
Geberit Silent pipes	-	57
Huliot Ultra Silent pipes	-	57
POLO-KAL NG pipes	-	57
Rehau Raupiano pipes	-	58
Uponor Decibel pipes	-	58
Valsir Blackfire pipes	-	58
Valsir PP3 pipes	-	59
Valsir Triplus pipes	-	59
Wavin AS+ pipes	-	59
Wavin SiTech pipes	-	60

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.

Rigid walls, additional items

Services	Service insulation	Page no.
Linear seals	-	60 - 61
Cables and cable trays	-	62 - 64
Steel pipes	Elastomeric & PE, continuous	64
“	Stone-wool, continuous	64 - 65
“	Stone-wool, interrupted	65 - 66
Copper pipes	-	67
“	Elastomeric & PE, continuous	67
“	Glass- & stone-wool, continuous	67
“	Glass-wool, interrupted	67
“	Stone-wool, interrupted	67 - 68
Alupex pipes	Glass- & stone-wool, continuous	68
“	Stone-wool, interrupted	68 - 69
Plastic pipes, small, w/o pipe wraps	-	69
Bundled plastic pipes	-	70
Plastic pipes, large	-	70
Plastic conduits	-	71

Rigid floors

Services	Service insulation	Page no.
Linear seals	-	71 - 72
Cables and cable trays	-	73
Bus-bars	-	74
“	FR Board	74
Steel pipes	-	74 - 75
“	Elastomeric, continuous	75
“	Glass-wool, continuous	75
“	Stone-wool, continuous	76
“	Glass-wool, interrupted	76
“	Stone-wool, interrupted	76 - 77
Copper pipes	Elastomeric, continuous	77
“	Glass- & stone-wool, continuous	77 - 78
“	Glass-wool, interrupted	78
“	Stone-wool, interrupted	78
Alupex pipes	Elastomeric, continuous	78 - 79
“	Glass- & stone-wool, continuous	79
“	Glass-wool, interrupted	79
“	Stone-wool, interrupted	80
Plastic pipes	-	80 - 81
Composite pipes	-	81

Timber & rigid floors

Services	Service insulation	Page no.
Linear seals	-	82
Cables and cable trays	-	82
Steel pipes	Glass & stone-wool, interrupted	82
Copper pipes	Glass & stone-wool, interrupted	83
Alupex pipes	Glass & stone-wool, interrupted	83
PEX pipe-in-pipes	-	83

As a part of our policy of on-going product development and testing, we reserve the right to modify, alter or change product specifications without giving notice. All information contained in this document is given in good faith and is provided for guidance only. Any drawings provided are for illustrative purposes only. As Polyseam has no control over the methods or competence of installation and of prevailing site conditions, no warranties, expressed or implied, are intended to be given as to the actual performance of the product mentioned or referred to herein and no liability whatsoever will be accepted for any loss, damage or injury arising from the use of the information given.