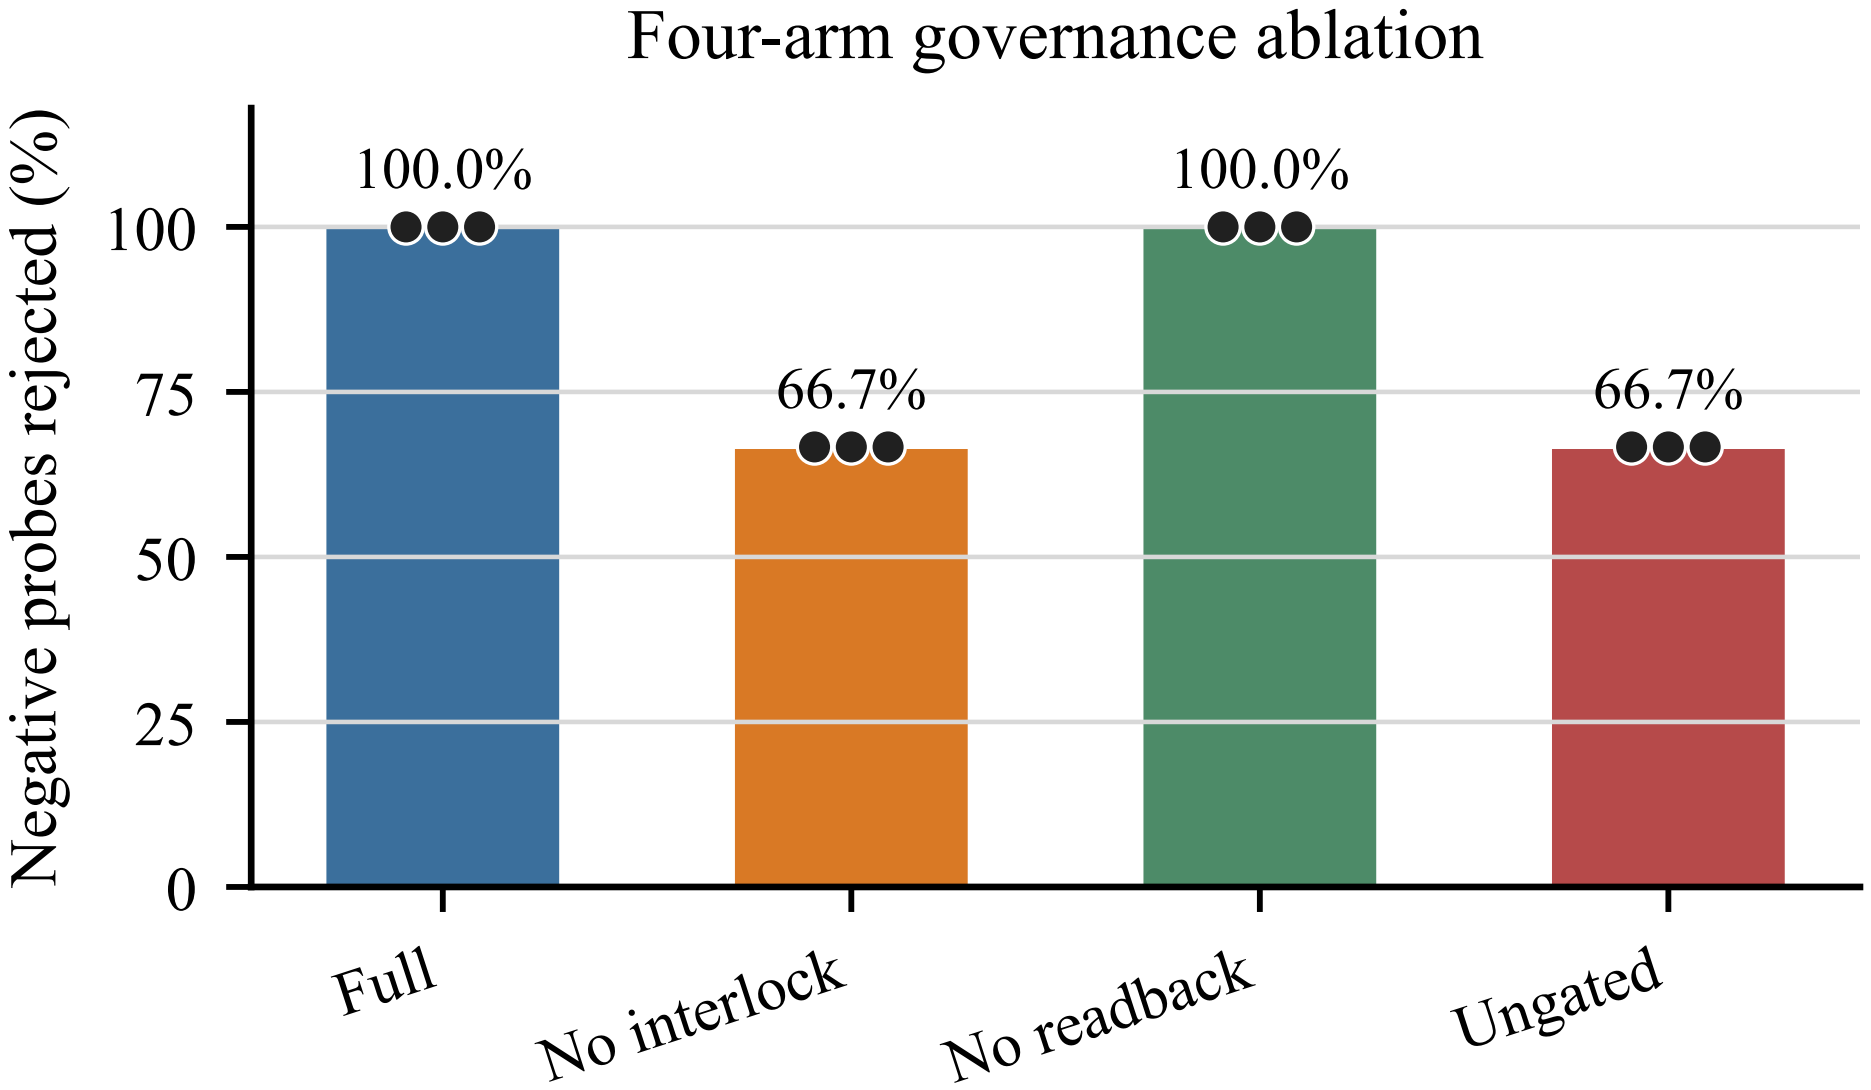
Four-arm governance ablation
Negative probes rejected (%)
100
75
50
25
0
100.0%
66.7%
100.0%
66.7%
Full
No interlock
No readback
Ungated