
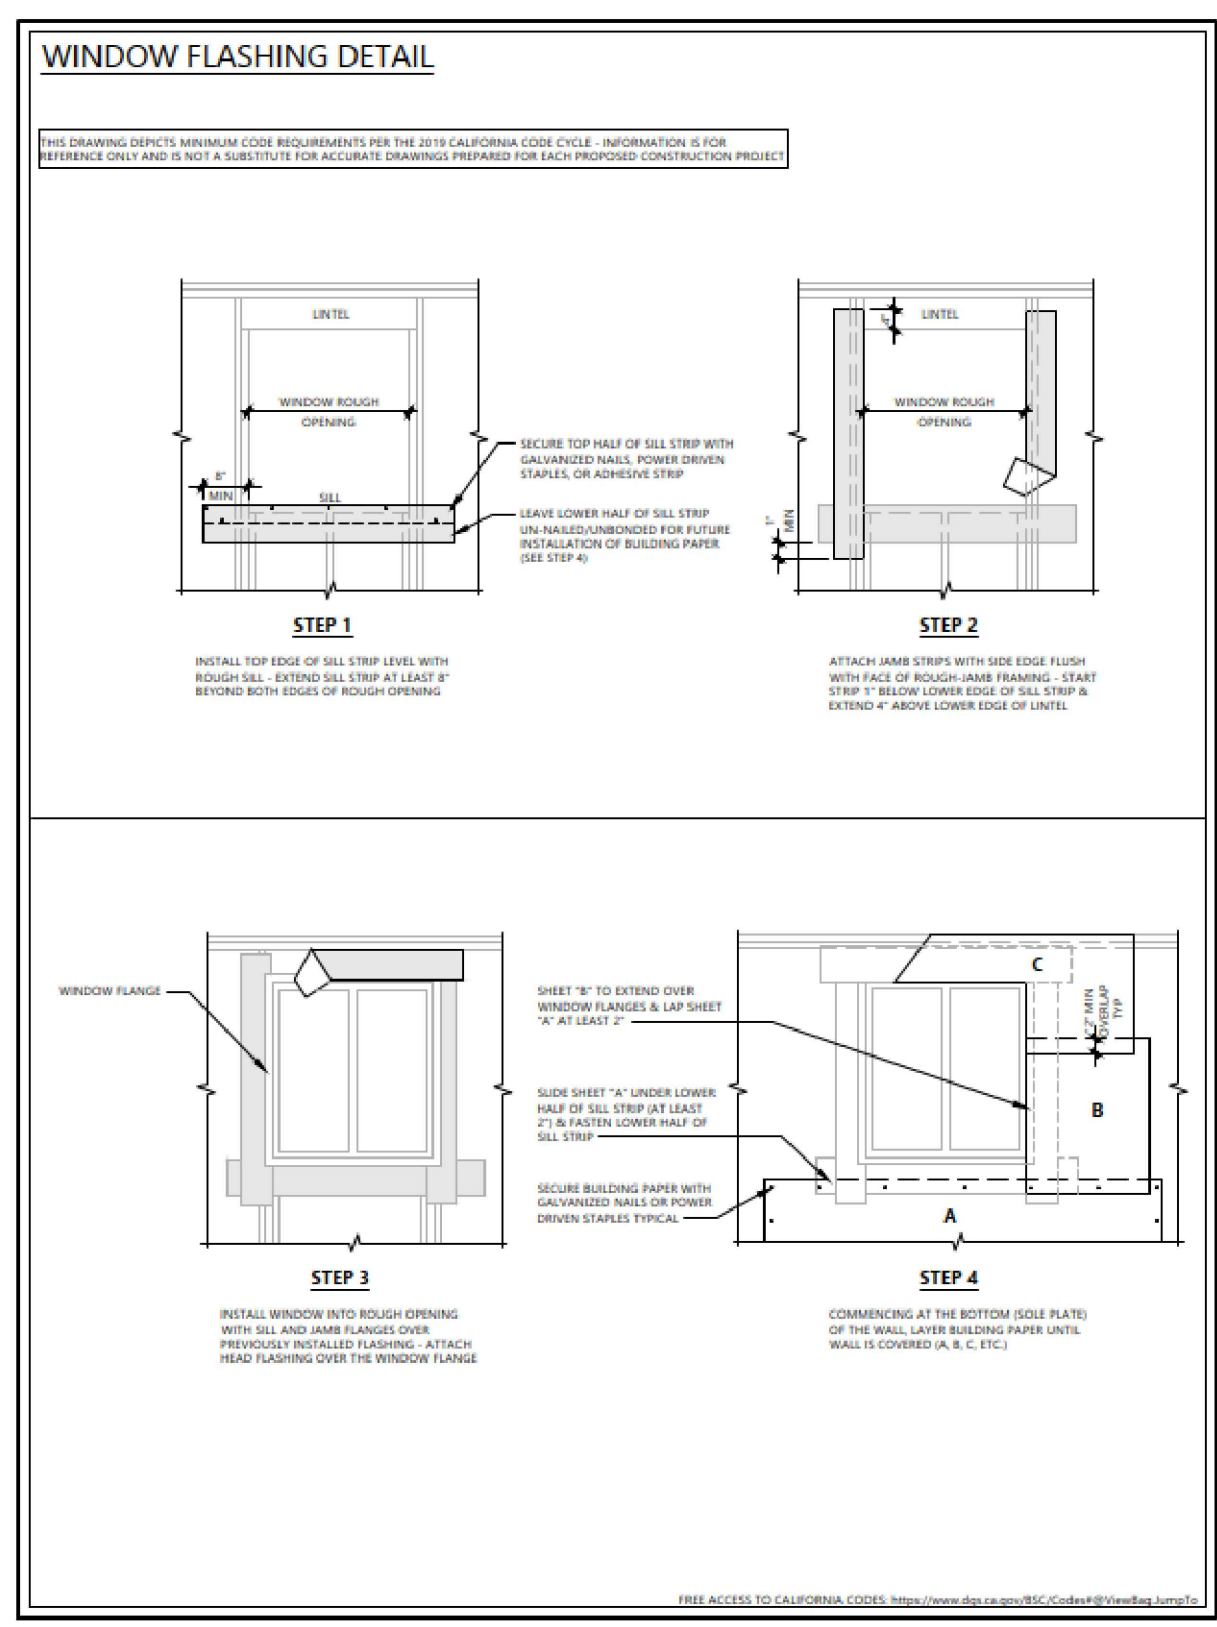
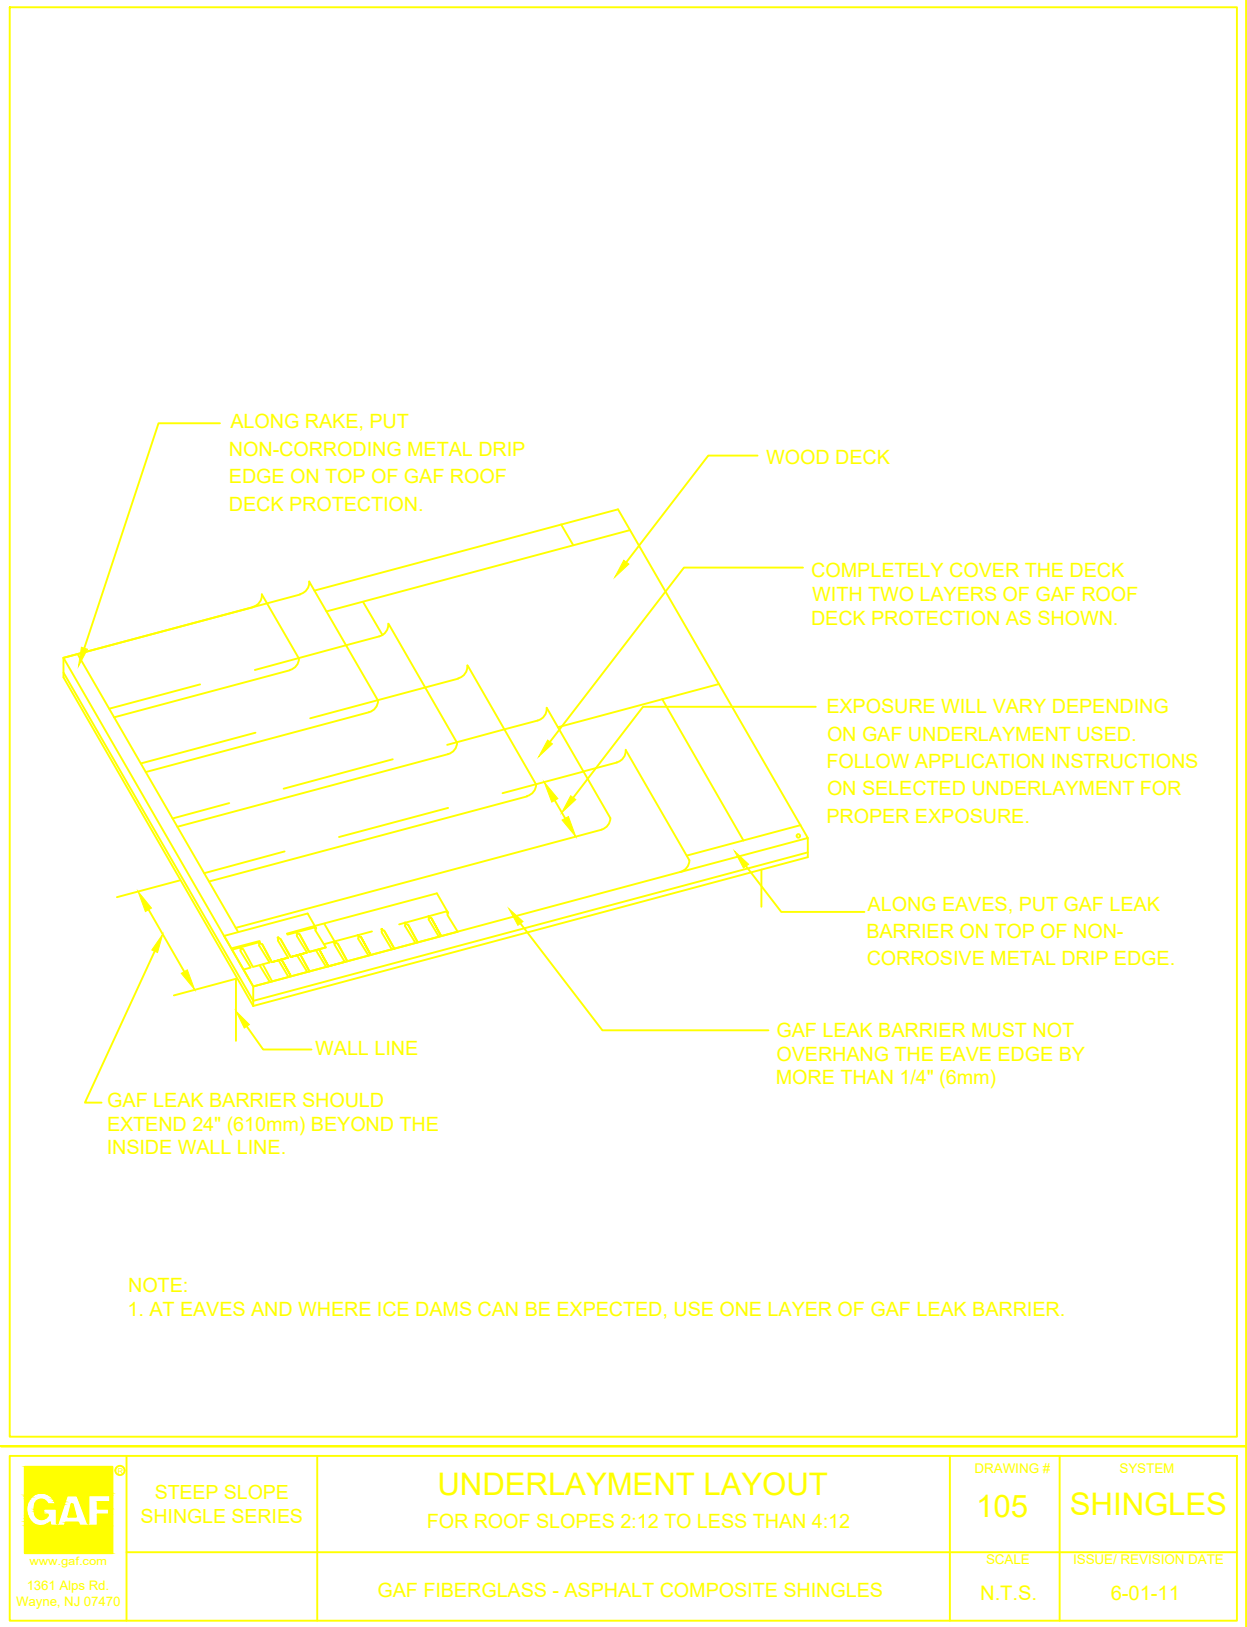
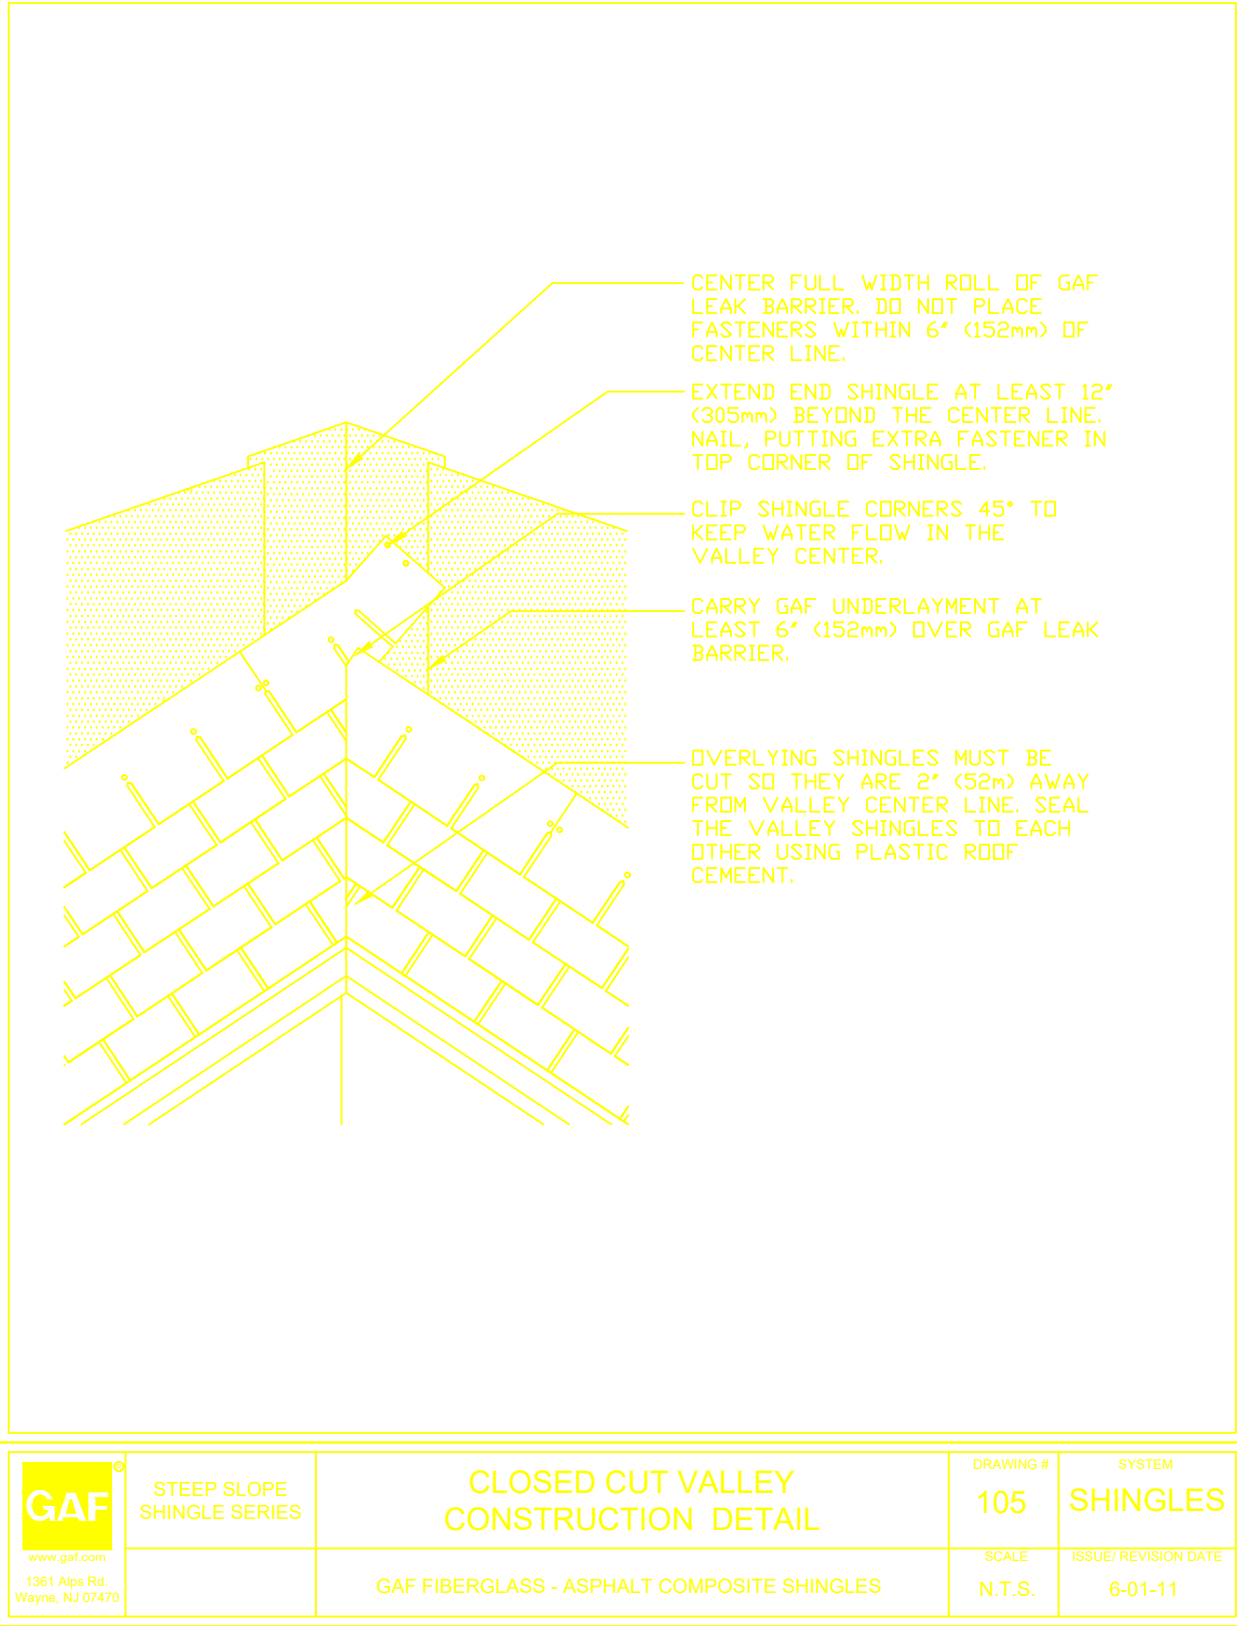


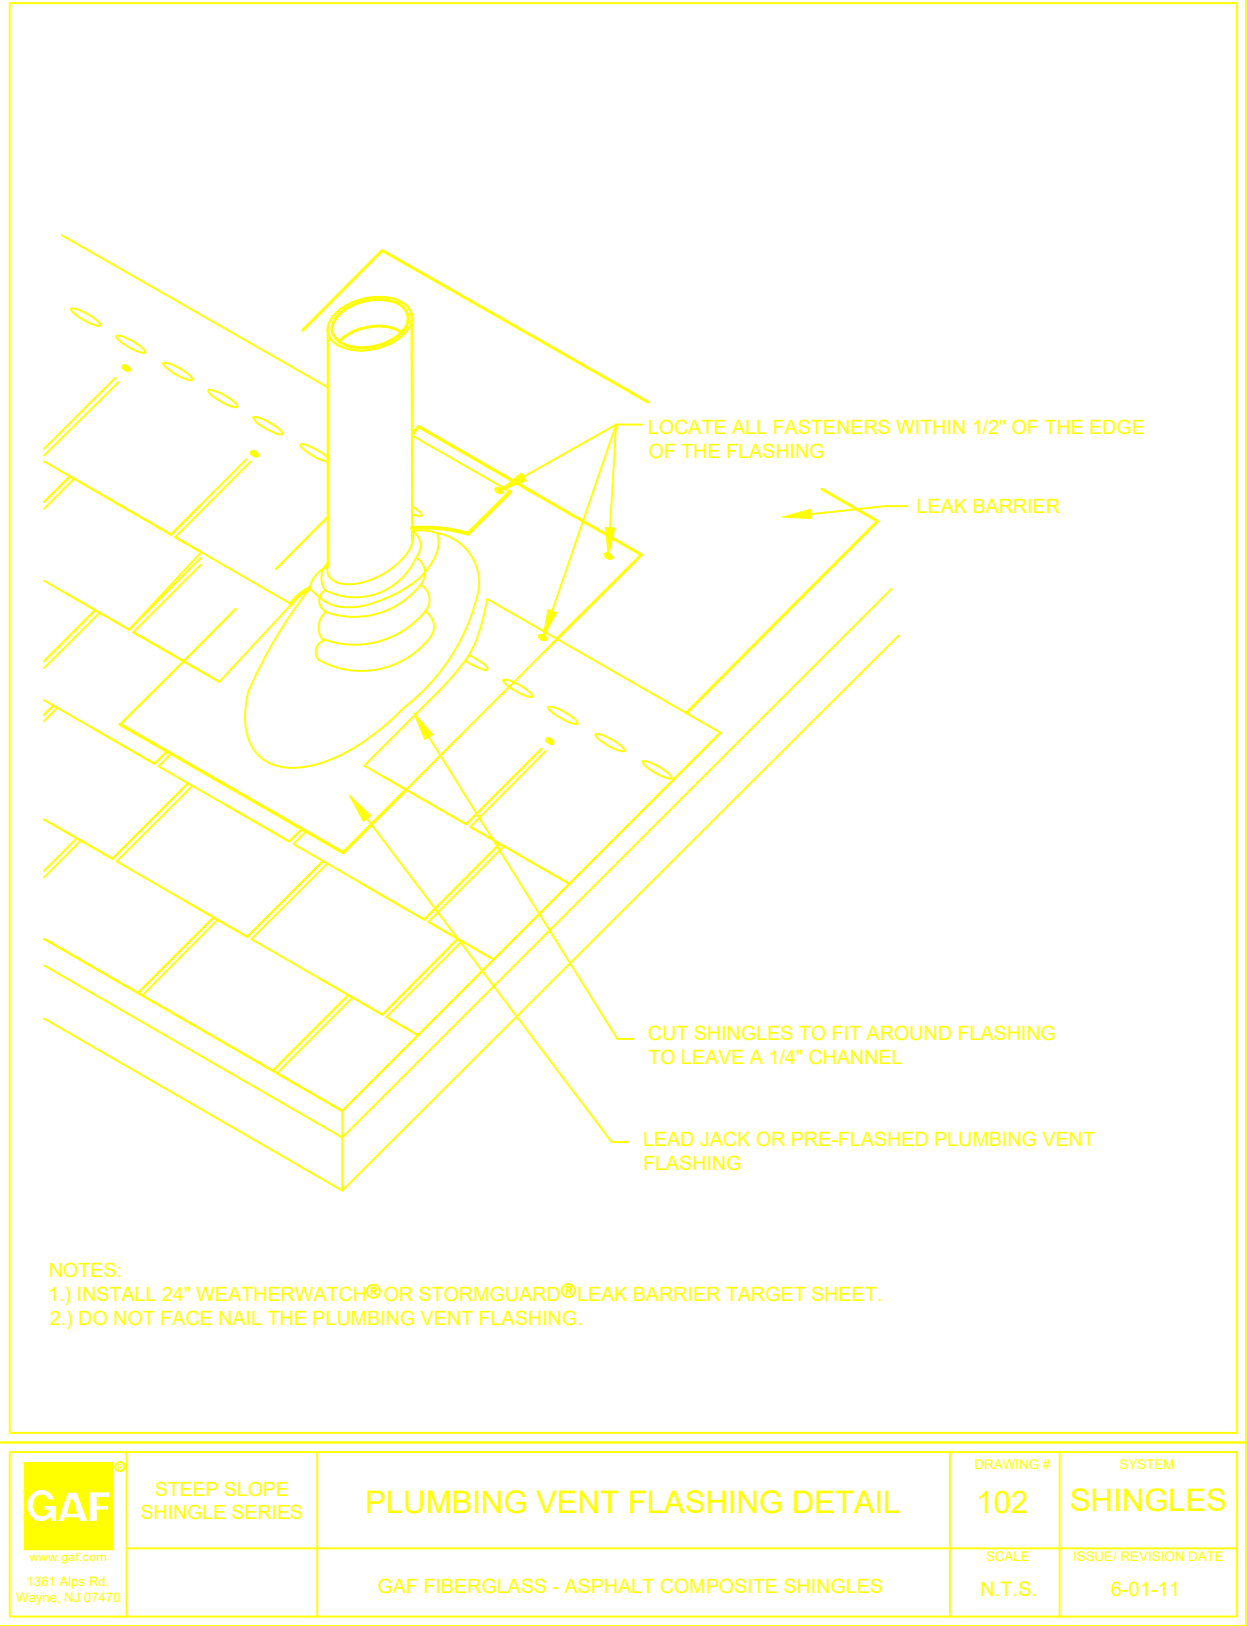

ATTIC VENTILATION CALCULATIONS:


* ATTIC AREA= 425 SQ.FT.
VENT AREA REQUIRED = 425 SQ.FT. X 144 /150 =408 SQ.IN.
PROVIDE 4-DL24 DORMER VENT BY "HARLEN" 100 SQ.IN. EACH

LEGEND:

DL24 DORMER VENT BY "HARLEN" 100 SQ.IN. EACH

ROOF NOTES:

1. ALL VENT OPENINGS SHALL BE COVERED W/ 1/4" CORROSION RESISTANT METAL MESH.
2. ALL VENTS TO BE WATERPROOF AND ALL WALL MOUNTED LOUVERS SHALL BE SEALED AND FLASHED W/ "MOISTOP".
3. PROVIDE APPROVED INSULATION DAMS (BAFFLES) WHERE BLOCKS ARE USED BETWEEN ROOF FRAMING MEMBERS TO PREVENT HOLE BLOCKING BY INSULATION.
4. HIGH VENTS AND/OR DORMERS SHALL BE 3'-0" MIN. VERTICAL DISTANCE ABOVE EAVES.

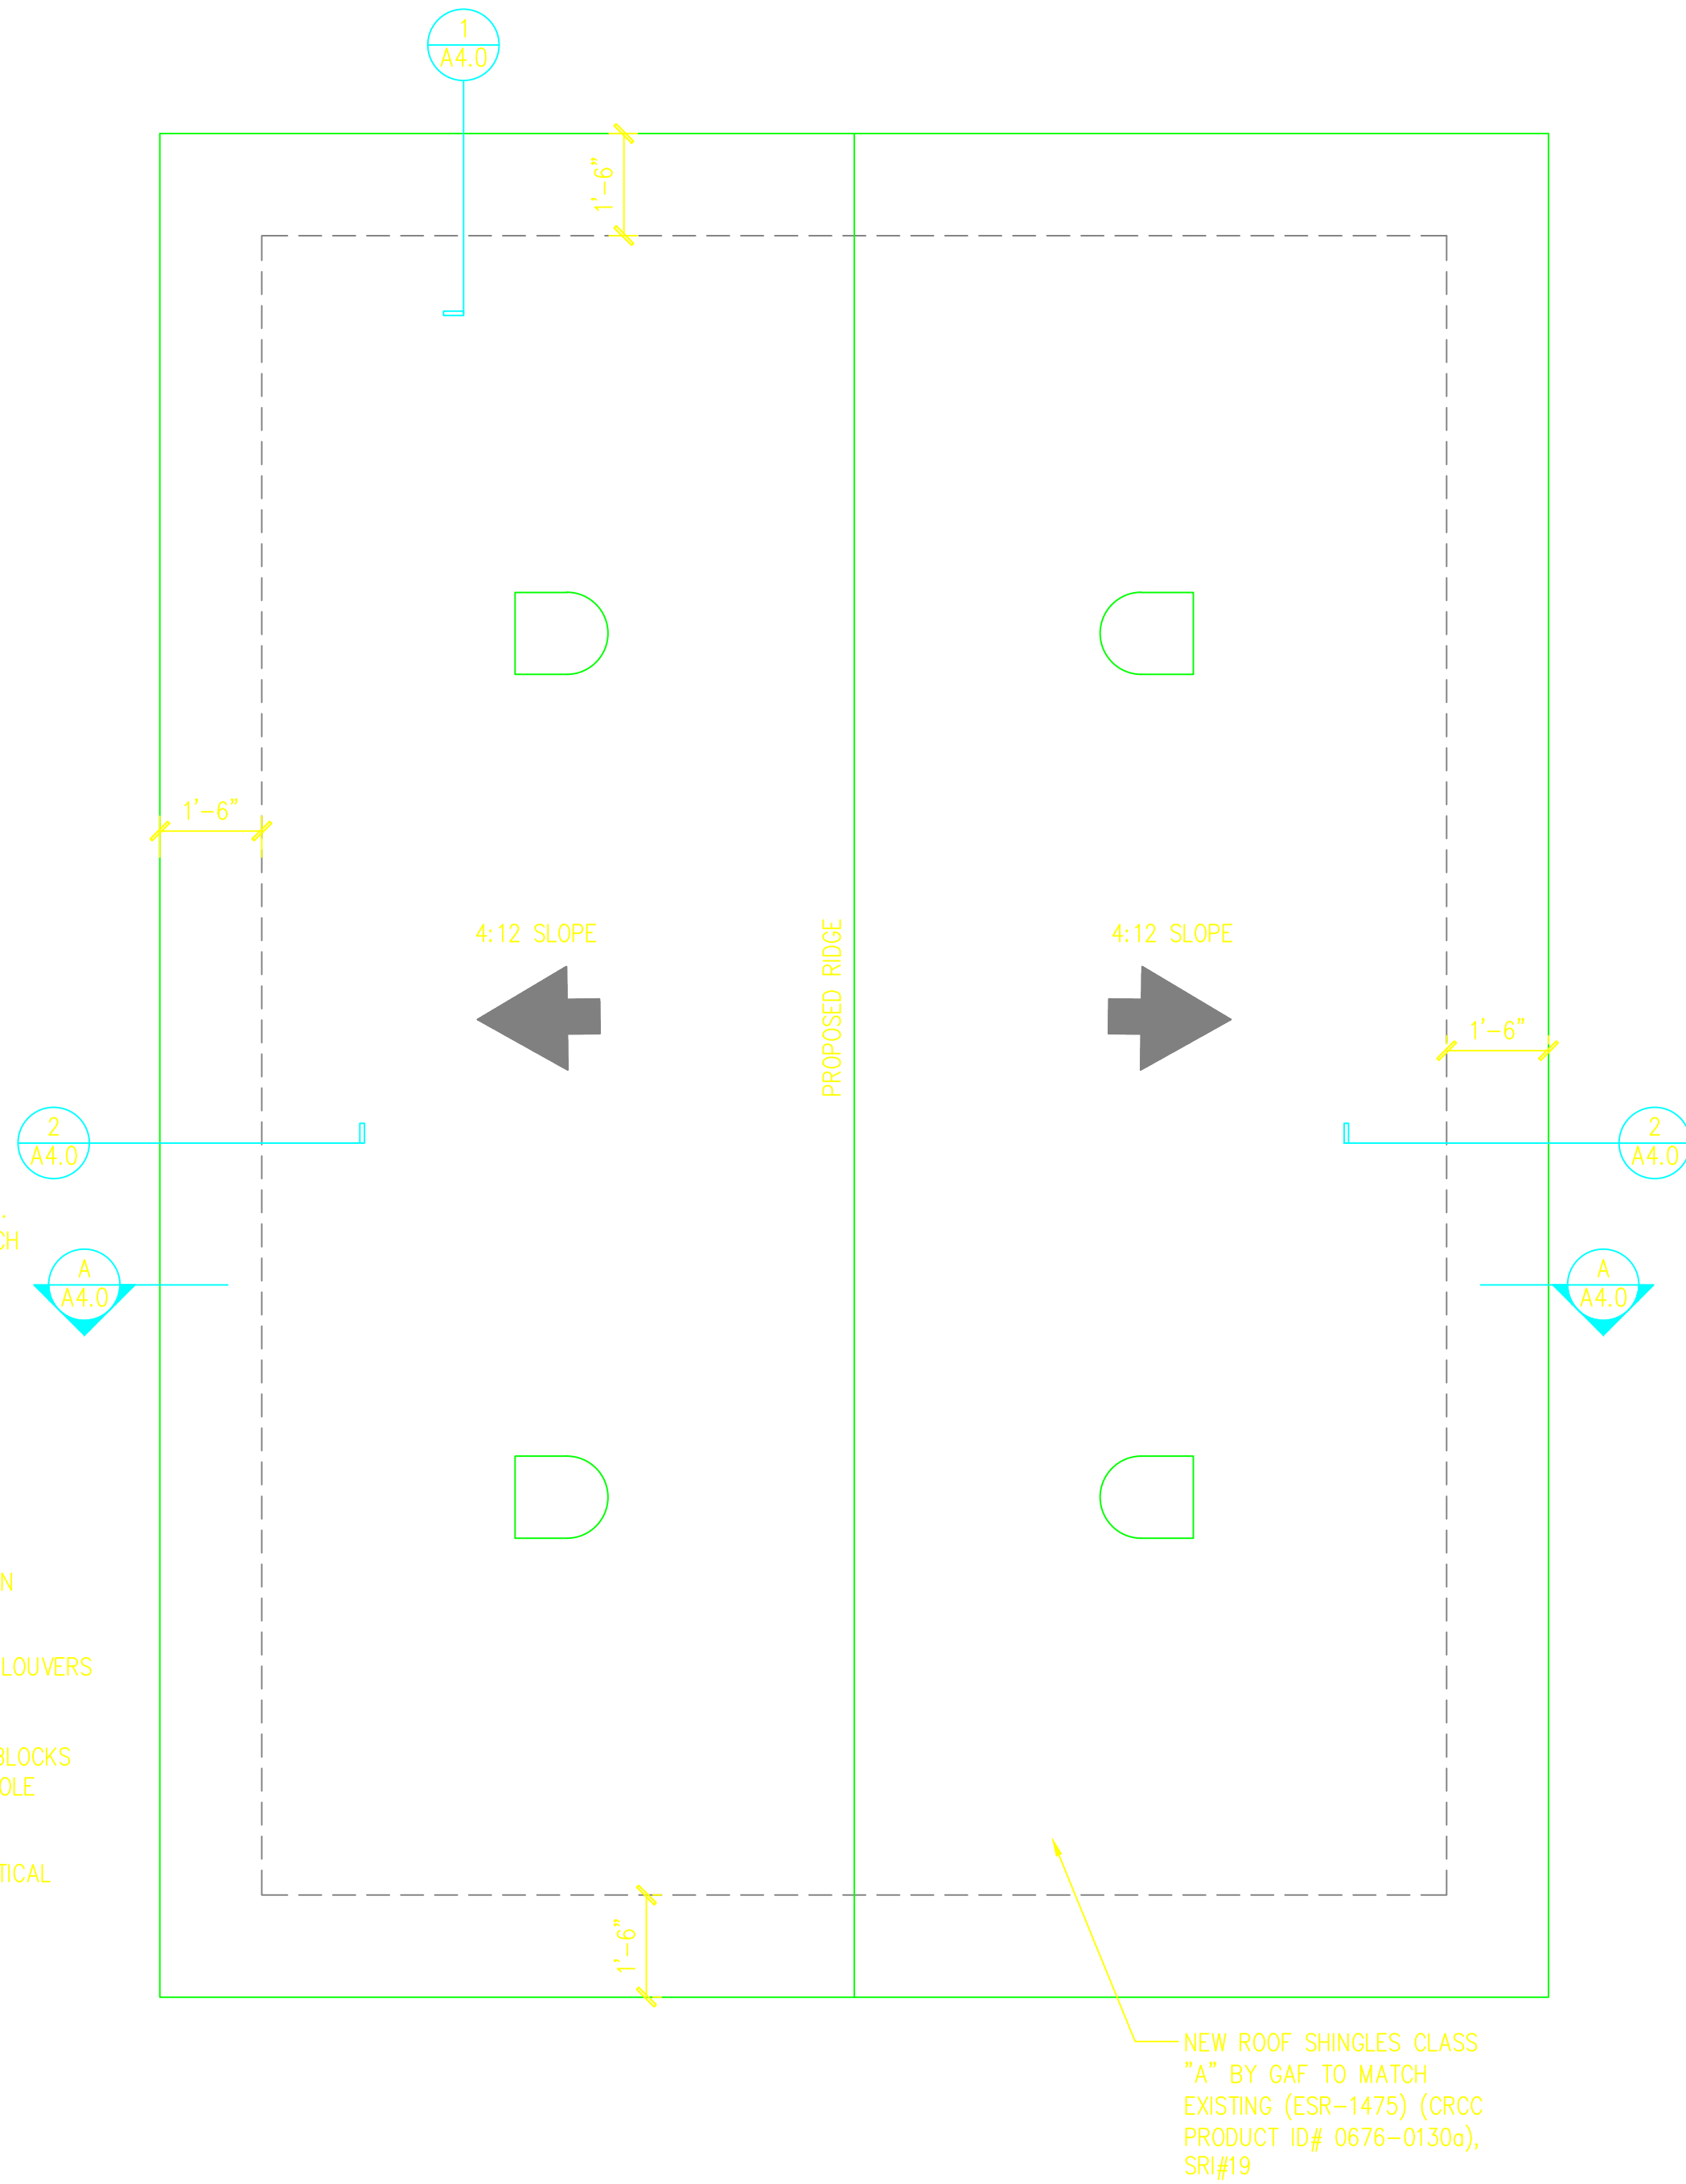

PROPOSED ROOF PLAN
3/8 = 1'-0"

GENERAL NOTES:

1. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITION AND DIMENSIONS BEFORE ORDERING ANY MATERIALS
2. CONTRACTOR SHALL PROVIDE PROPER SHORING BEFORE ANY DEMOLITION
3. ALL PLANS ARE USED FOR CITY PERMIT ONLY AND SHALL NOT BE USED FOR CONSTRUCTION UNLESS PERMIT IS ISSUED