



ELECTRICAL NOTES:

1. CONDUCTORS NORMALLY USED TO CARRY CURRENT SHALL BE OF COPPER.
2. FIXED APPLIANCES SUCH AS FOOD WASTE GRINDERS, DISHWASHERS, WASHING MACHINES, DRYERS, LAUNDRY TRAY LOCATIONS, BUILT-IN REFRIGERATORS OR FREEZERS, FURNACES, AC UNITS, BUILT-IN HEATERS OR ANY OTHER FIXED APPLIANCE WITH A MOTOR OF ¼ HP OR LARGER SHALL BE A SEPARATE 20 AMP BRANCH CIRCUIT.
3. IN ALL AREAS SPECIFIED IN 2022 CEC SEC 210.52 ALL NON-LOCKING-TYPE 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES.
4. LIGHT CONTROLS SHALL COMPLY WITH CEnC 150.(K)2.
5. AT LEAST 50% OF THE LIGHTING WITHIN THE KITCHEN AREA SHALL BE HIGH EFFICACY LIGHT. CEnC 150.0(K)3.
6. ALL BATHROOMS LIGHTS SHALL BE HIGH EFFICACY.CEnC 150.0(K)5.
7. ALL LIGHTS IN LAUNDRY ROOM SHALL BE HIGH EFFICACY AND CONTROLLED BY VACANCY SENSOR. CEnC 150.0(K)6.
8. ALL BEDROOMS AND OFFICE LIGHTS SHALL BE HIGH EFFICACY LUMINAIRE. CEnC 150.0(K)7.
9. OUTDOOR LIGHTING SHALL BE HIGH EFFICACY AND IN COMPLIANCE WITH CEnC 150.0(K)9.
10. RECESSED LUMINAIRES IN CEILINGS SHALL MEET ALL THE FOLLOWING REQUIREMENTS:
 - A. BE LISTED AS DEFINED IN SECTION 100.0, FOR ZERO CLEARANCE INSULATION CONTACT (IC) BU UNDERWRITERS LABORATORIES OR THER NATIONALLY RECOGNIZED TESTING/ RATING LABORATORY.
 - B. HAVE A LABE THAT CERTIFIES THAT THE LUMINAIRE IS AIRTIGHT WITH AIR LEAKAGE LESS THAN 2.0 CFM AT 75 PASCALS WHEN TESTED IN ACCORDANCE WITH ASTM E283. AN EXHAUST FAN HOUSING SHALL NOT BE REQUIRED TO BE CERTIFIED AIRTIGHT.
 - C. BE SEALED WITH GASKET OR CAULK BETWEEN THE LUMINAIRE HOUSING AND CEILING, AND SHALL HAVE ALL AIR LEAK PATHS BETWEEN CONDITIONED AND UNCONDITIONED SPACES SEALED WITH A GASKET OR CAULK.
 - D. FOR RECESSED COMPACT FLUORESCENT LUMINAIRES WITH BALLASTS TO QUALIFY AS HIGH EFFICACY FOR COMPLIANCE WITH SECTION 150.0(K), THE BALLASTS SHALL BE CERTIFIED TO COMMISSION TO COMPLY WITH APPLICABLE REQUIREMENTS IN SECTION 110.9
 - E. ALLOW BALLAST MAINTENANCE AND REPLACEMENT TO READILY ACCESSIBLE TO BUILDING OCCUPANTS FROM BELOW THE CEILING WITHOUT REQUIRING THE CUTTING OF HOLES IN THE CEILING.
11. BATHROOM EXHAUST FANS SHALL COMPLY WITH THE FOLLOWING REQUIREMENTS:
 - A. CONTINOUS FAN
 - B. ENERGY STAR COMPLIANT THAT ARE DUCTED TO THE OUTSIDE OF THE BUILDING
 - C. FANS THAT ARE CONTROLLED BY HUMIDITY CONTROL SHALL BE IN COMPLIANCE WITH CBC 4.506.1
12. SMOKE DETECTOR LOCATION SHALL BE IN COMPLIANCE WITH CRC R314.3.4

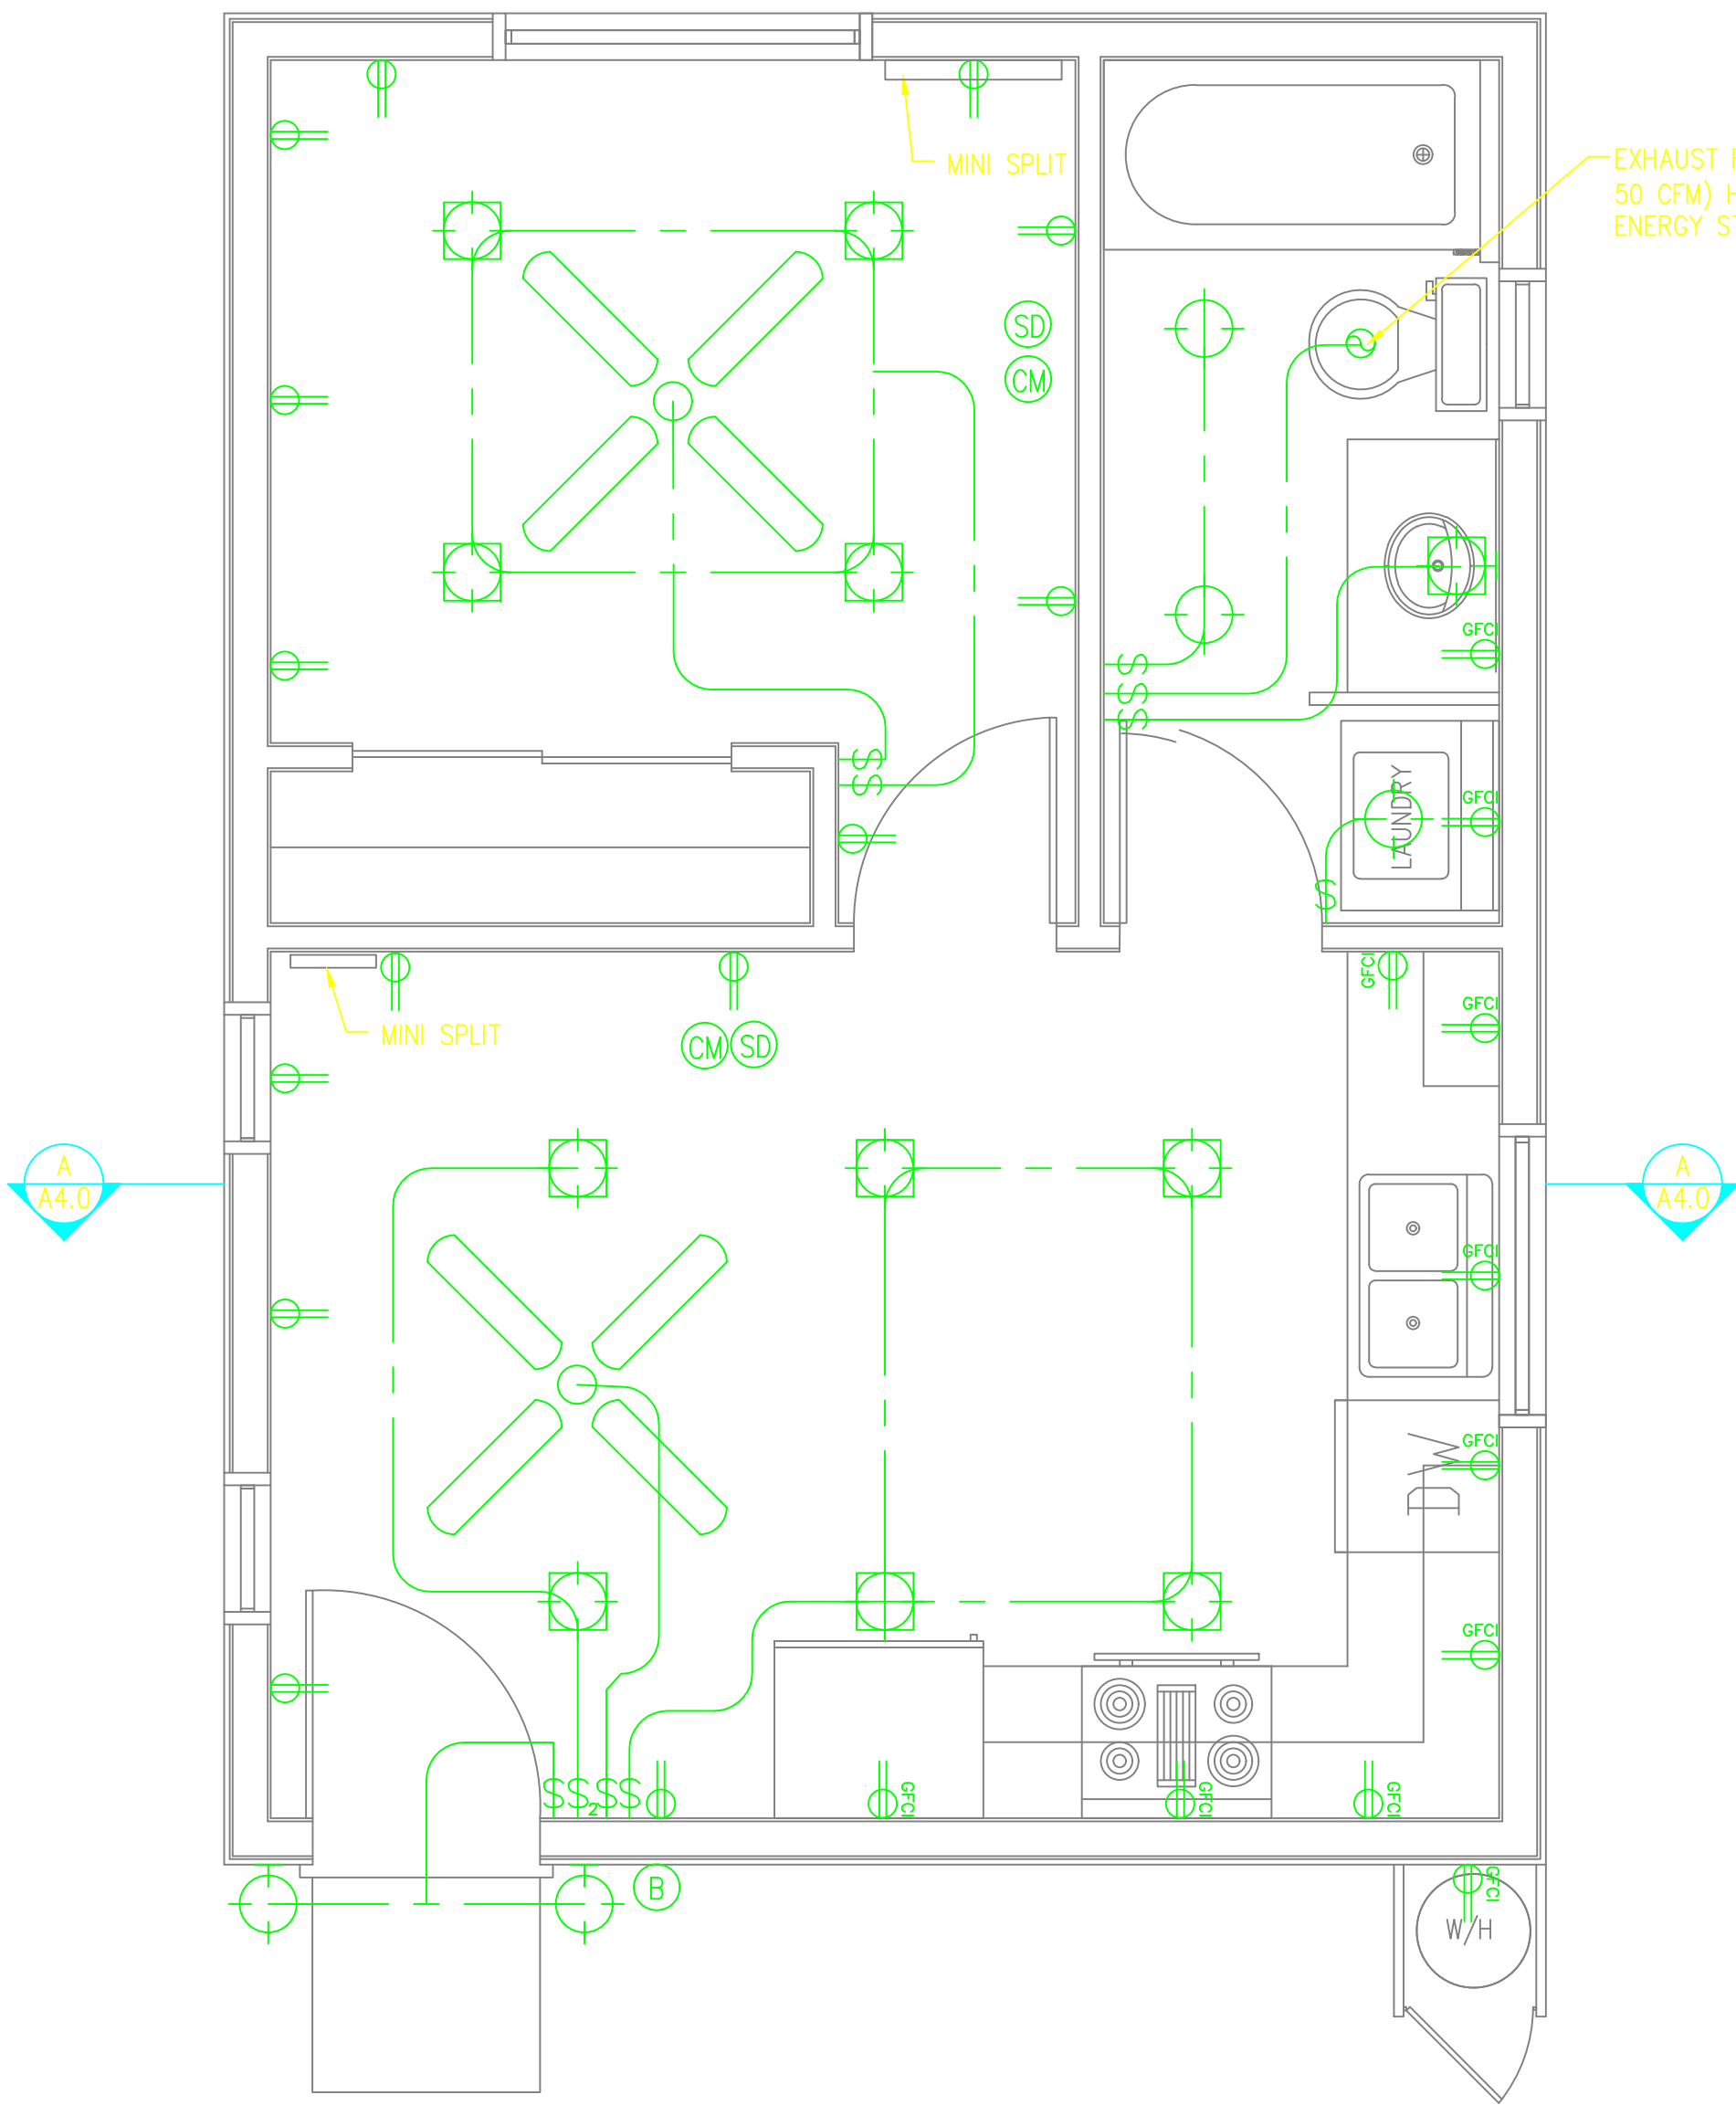

ELECTRICAL LEGEND

- DUPLEX TAMPER-RESISTANT RECEPTACLE WITH ARC FAULT CIRCUIT INTERRUPTOR (AFCI)
- DUPLEX TAMPER-RESISTANT RECEPTACLE WITH GROUND-FAULT CIRCUIT INTERRUPTOR (GFCI)
- (DIMMING CONTROLS) TWO POLE LIGHT SWITCH +36" ABOVE FLOOR , +8" ABOVE COUNTER
- (DIMMING CONTROLS) TWO WAY LIGHT SWITCH +36" ABOVE FLOOR , +8" ABOVE COUNTER
- SURFACE MOUNTED INCANDESCENT LIGHT FIXTURE
- RECESSED INCANDESCENT LIGHT FIXTURE
- WALL MOUNTED INCANDESCENT LIGHT FIXTURE
- WALL MOUNTED INCANDESCENT LIGHT FIXTURE W/ MOTION SENSOR
- RECESSED EXHAUST FAN (MIN 50 CFM) HUMIDSTAT, ENERGY STAR
- SMOKE DETECTOR, HARDWIRED WITH BATTERY BACK-UP, AND LOW BATTERY SIGNAL, STATE FIRE MARSHALL APPROVED IN ALL BEDROOMS AND HALLWAY 120 VOLT W/ AUDIBLE SOUND FROM ALL BRS. PERMANENTLY WIRED W/O DISCONNECTING SWITCHES OTHER THAN OVERCURRENT PROTECTION ONES INTERCONNECTED WITHIN EACH UNIT (WHERE APPLIES)
- CARBON MONOXIDE ALARM COMBINED WITH SMOKE ALARM
- DOORBELL CONTROL NOT EXCEED 48" ABOVE EXTERIOR FLOOR, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY.

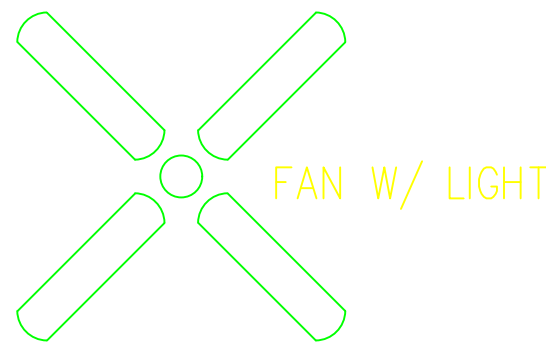

PROPOSED ELECTRICAL PLAN
3/8 = 1'-0"

FOR REFERENCE ONLY

GENERAL NOTES:

1. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITION AND DIMENSIONS BEFORE ORDERING ANY MATERIALS
2. CONTRACTOR SHALL PROVIDE PROPER SHORING BEFORE ANY DEMOLITION
3. ALL PLANS ARE USED FOR CITY PERMIT ONLY AND SHALL NOT BE USED FOR CONSTRUCTION UNLESS PERMIT IS ISSUED