
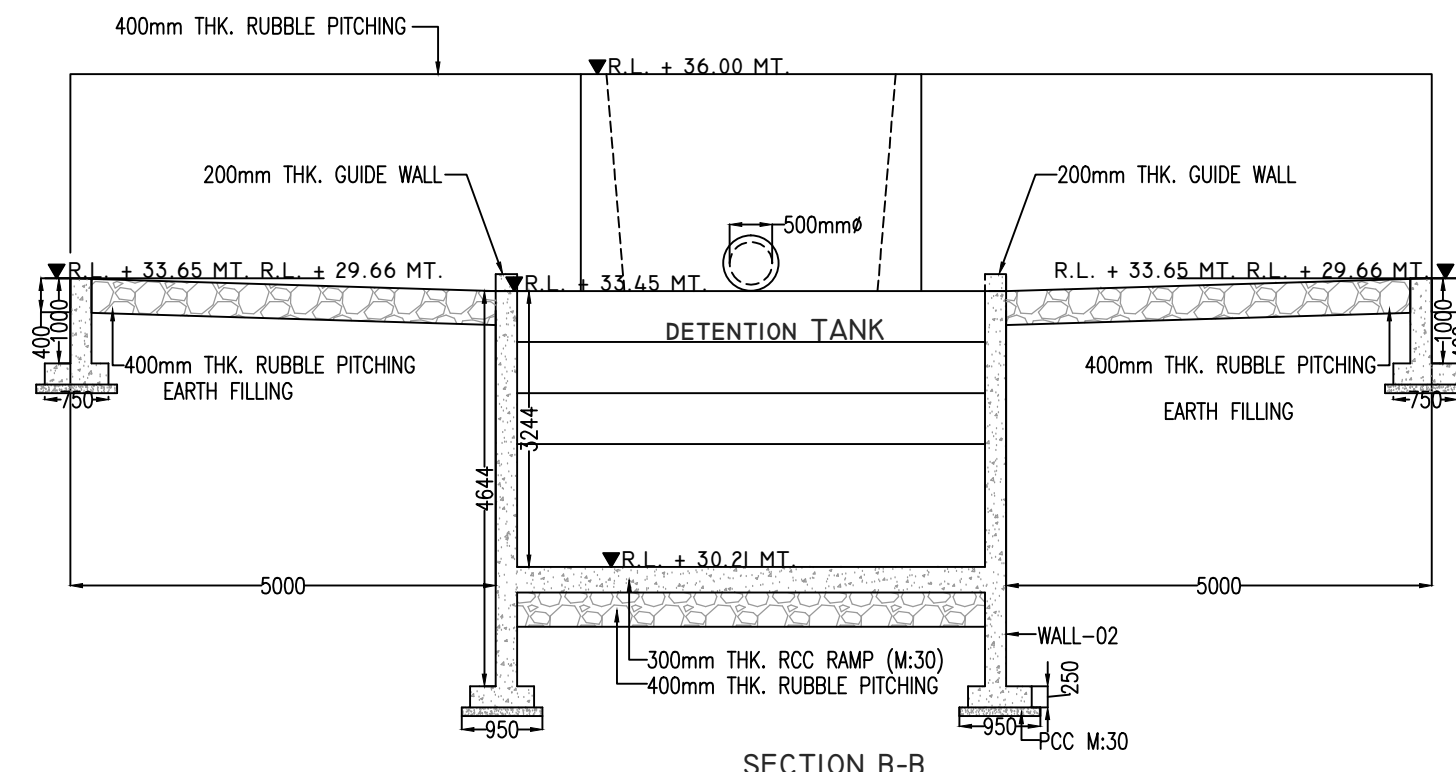
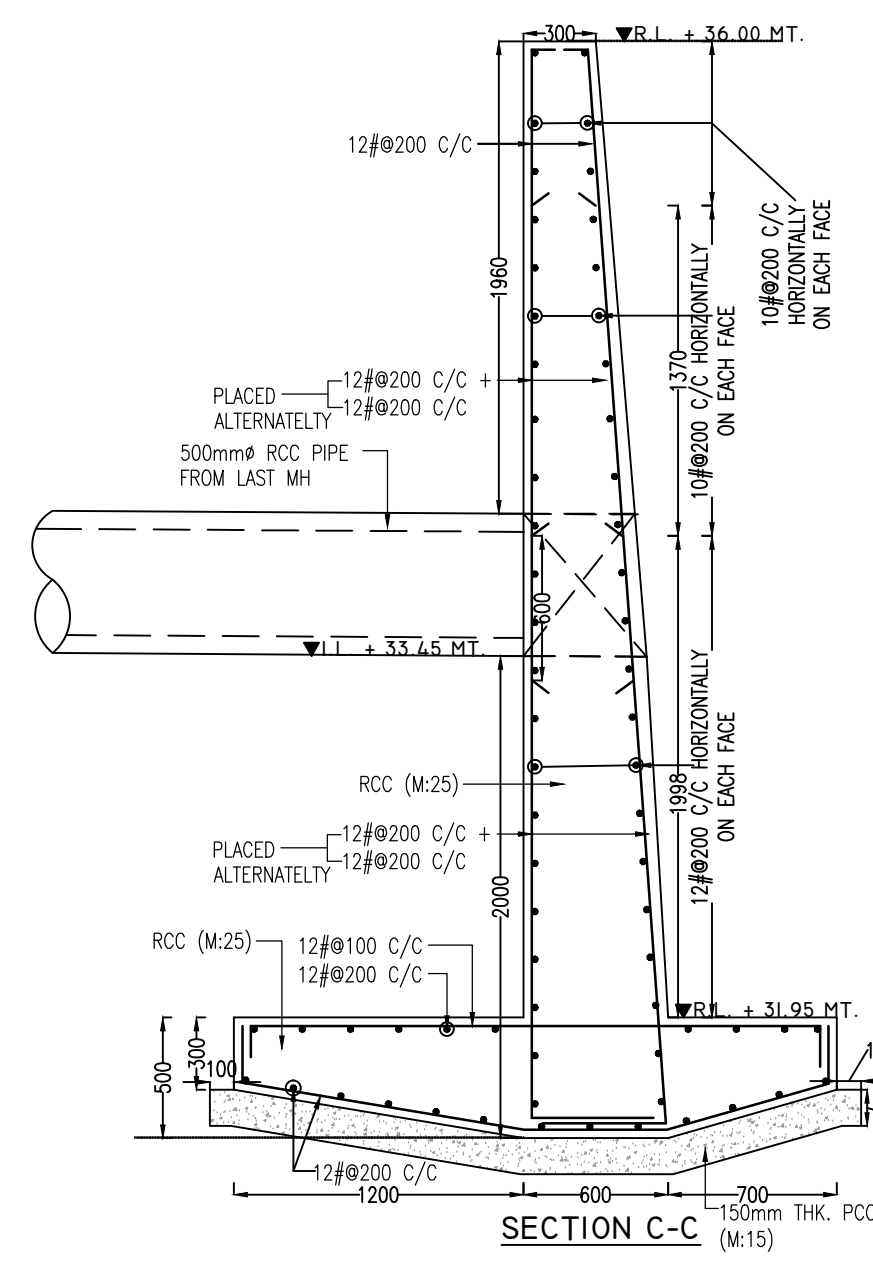
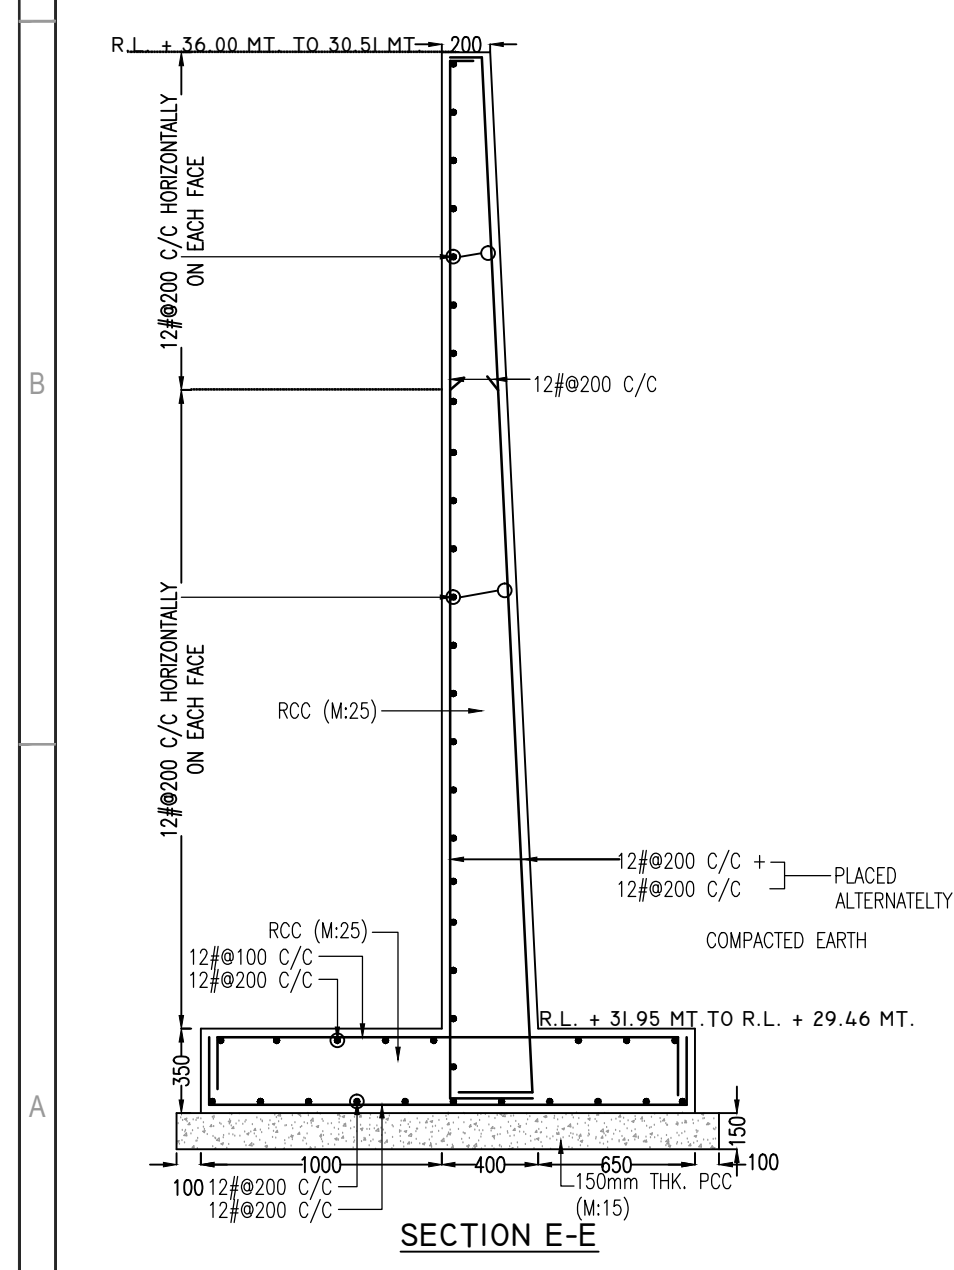
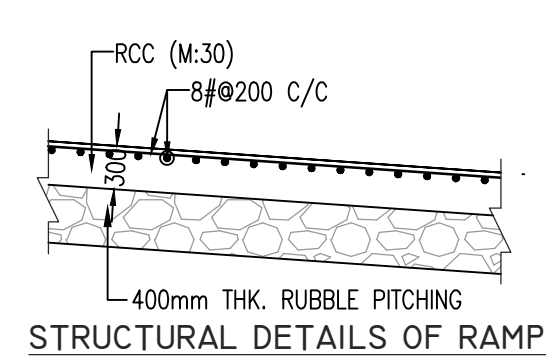
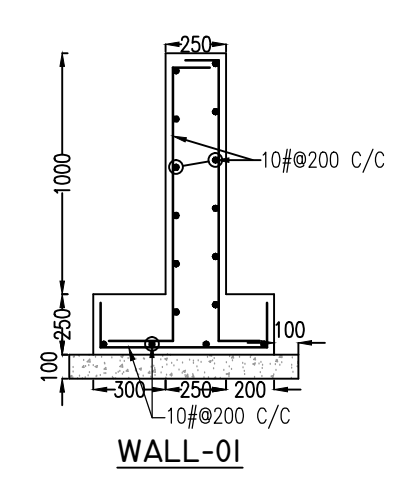
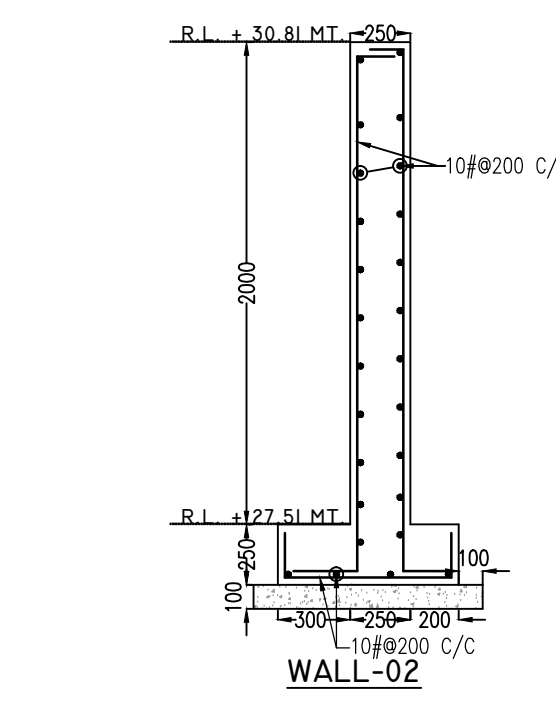
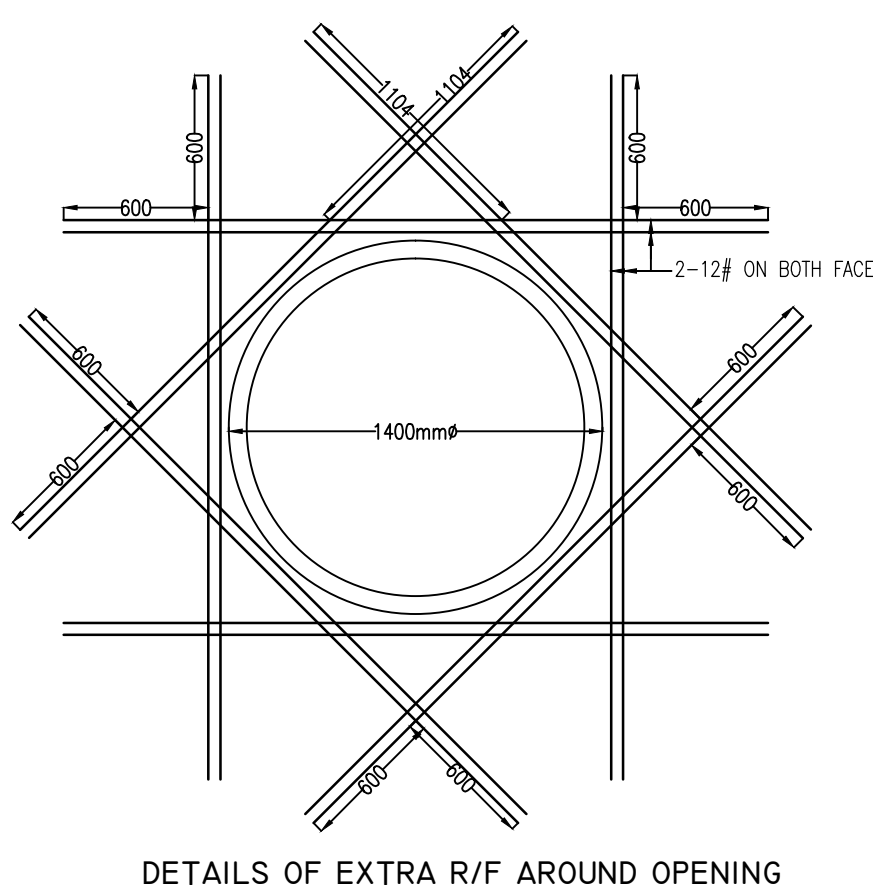


- NOTES:-
1. ALL DIMENSIONS ARE IN MM UNLESS OTHERWISE MENTIONED & LEVEL ARE IN MT.
 2. GROUND LVL AND RIVER PROFILE ALONG SLOPE SHALL BE TAKEN AT THE SITE BEFORE EXECUTION CONFIRM SLOPE DETAILS
 3. ALL REINFORCEMENT SHOWN # SHALL BE CONFORMING TO IS 1786 OF GRADE FE-415.
 4. ALL REINFORCEMENT CONCRETE SHALL BE M:25 GRADE CONFORMING TO IS 456-2000
 5. EXTRA REINFORCEMENT SHALL BE PROVIDED AROUND PIPE OPENING AS SHOWN

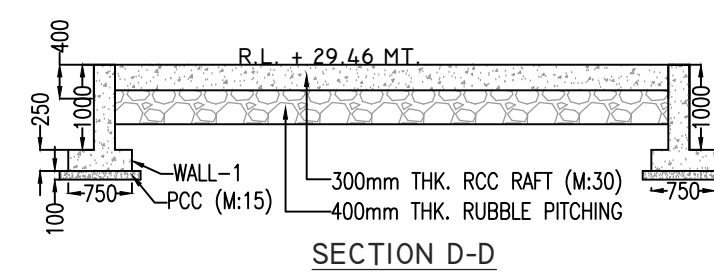

PROJECT :	CONSTRUCTION OF OUTFALL STRUCTURE FOR 8.5 MLD, SAYAJI GARDEN STP
TITLE :	DETAILS OF OUTFALL STRUCTURE FOR 8.50 MLD, SAYAJI GARDEN STP
DRG. NO.	04
SCALE:	N.T.S.