
Saved post-fault trajectories | 40% voltage drop (U_{ret}=0.60 pu)

Widened interval-certified rectangles (M < 10I); sampled containment only

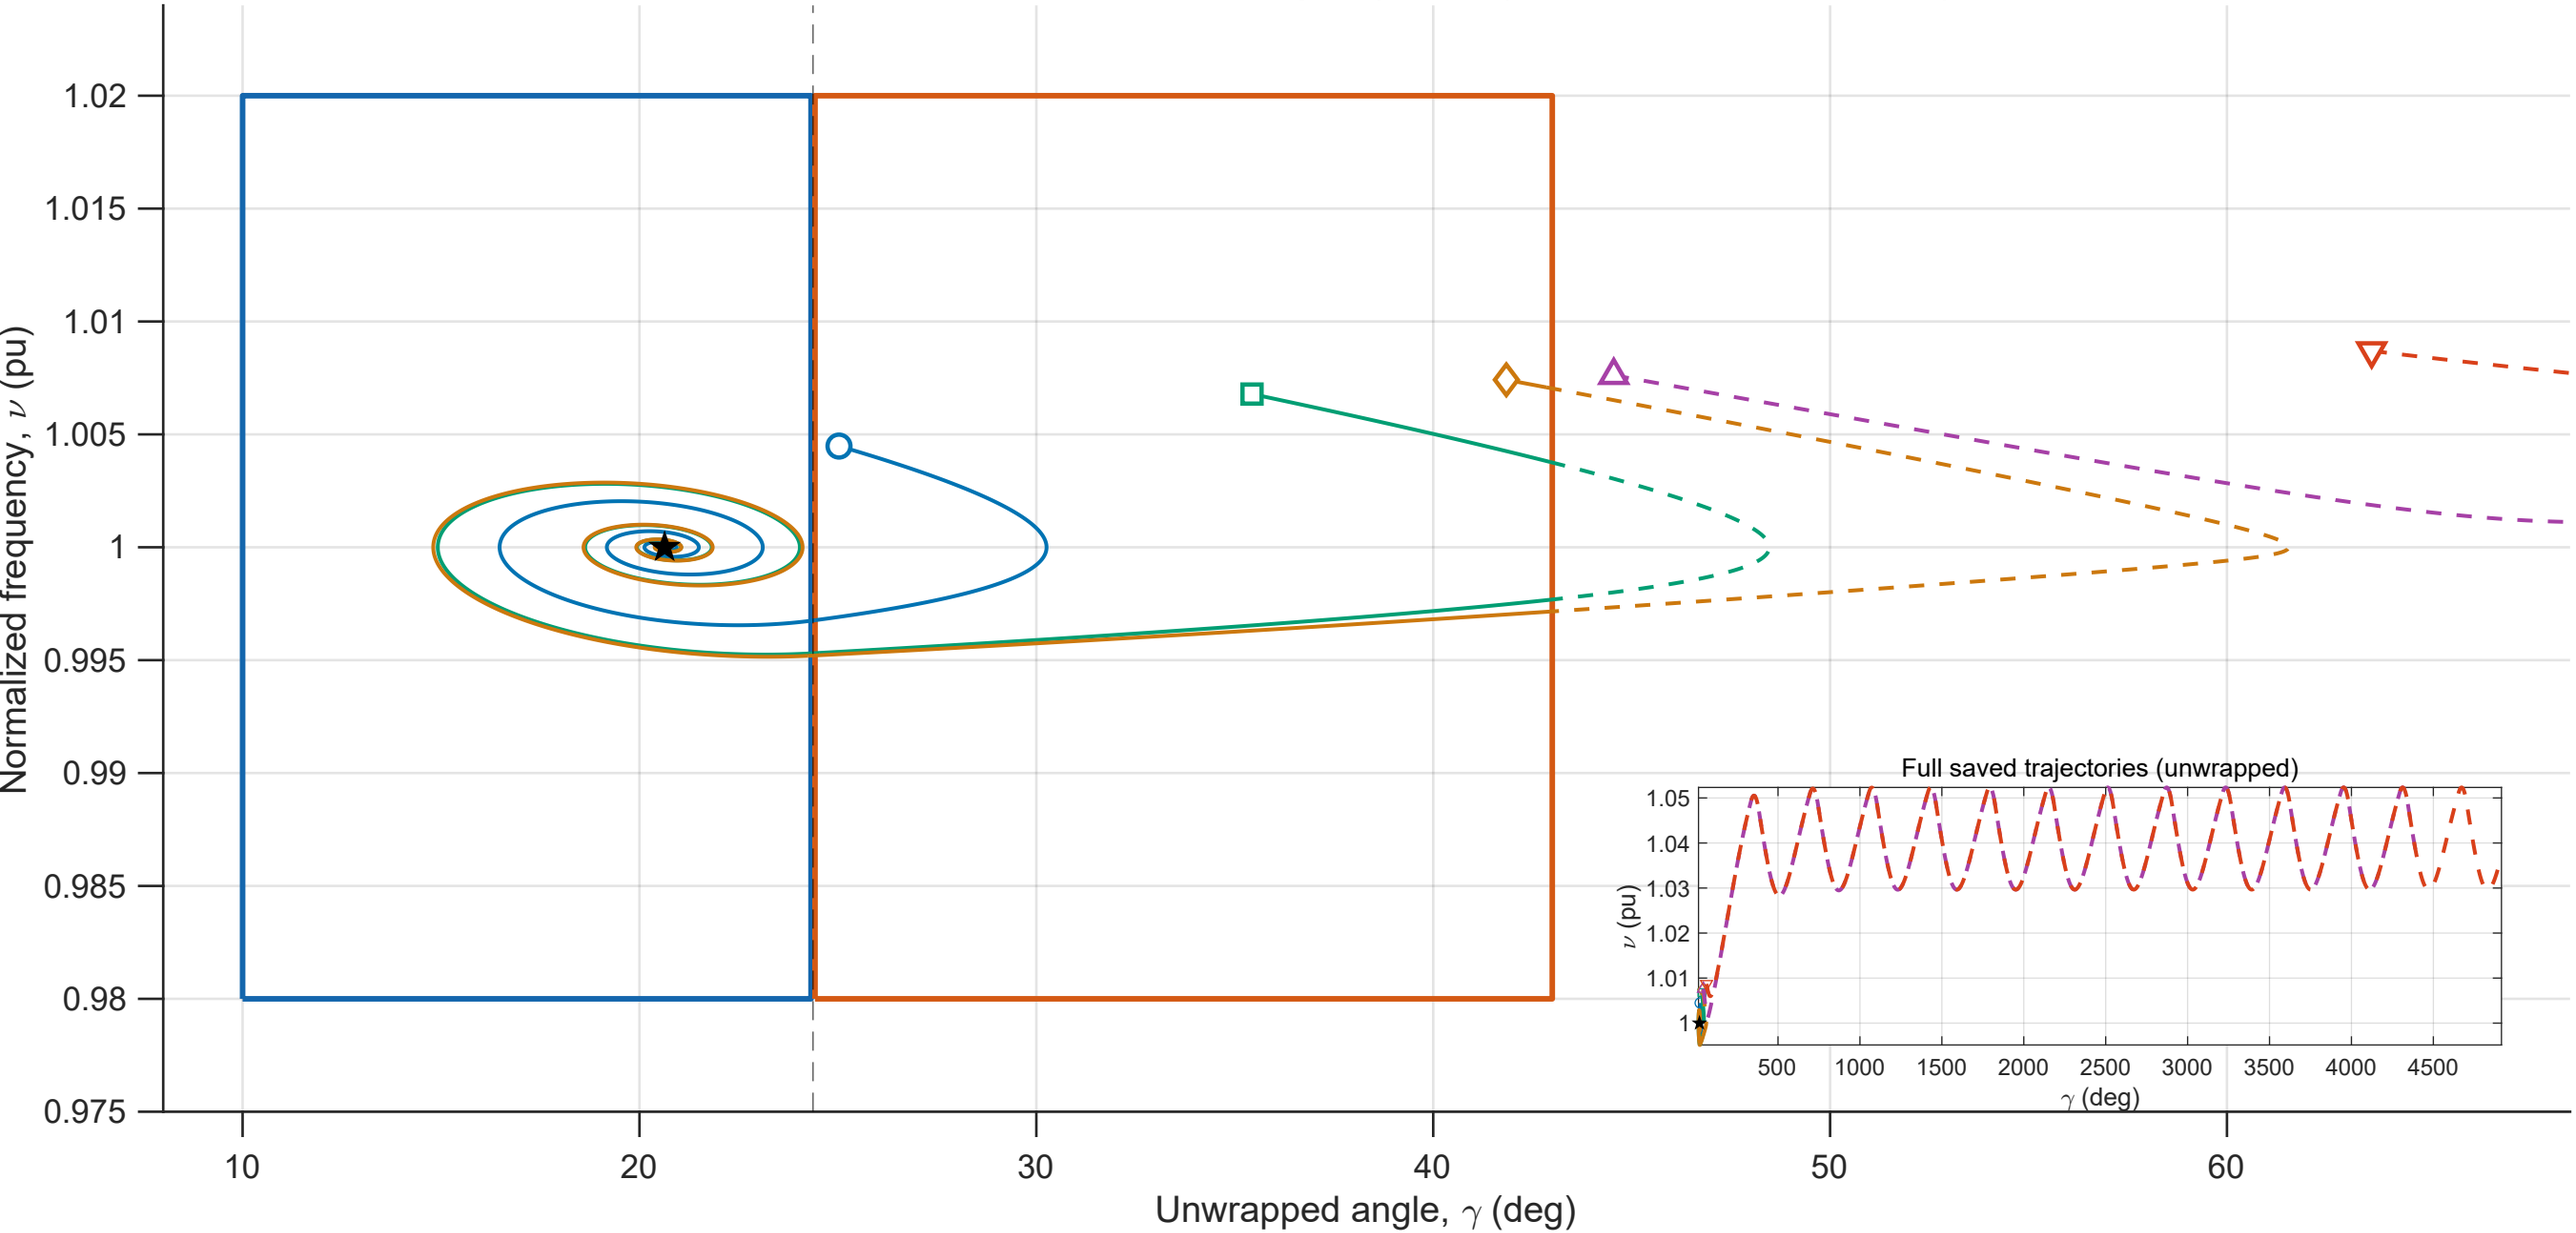

Certified inactive rectangle

Certified active rectangle

FCT 0.10 s | RECOVERED

FCT 0.20 s | RECOVERED

FCT 0.25 s | RECOVERED

FCT 0.27 s | NOT RECOVERED

FCT 0.40 s | NOT RECOVERED

Nominal equilibrium

Inside correct-mode rectangle

Outside / uncertified gap

Solid links join two inside samples; links touching an outside sample are dashed. The uncertified switching gap is excluded.

Time inside: trapezoidal time-weighted estimate from saved sample membership. Main view is zoomed; inset retains complete excursions.

Sampled numerical containment is not a continuous-time containment proof or full stability certification.