
Saved post-fault trajectories | 20% voltage drop (U_{ret}=0.80 pu)

Widened interval-certified rectangles (M < 10I); sampled containment only

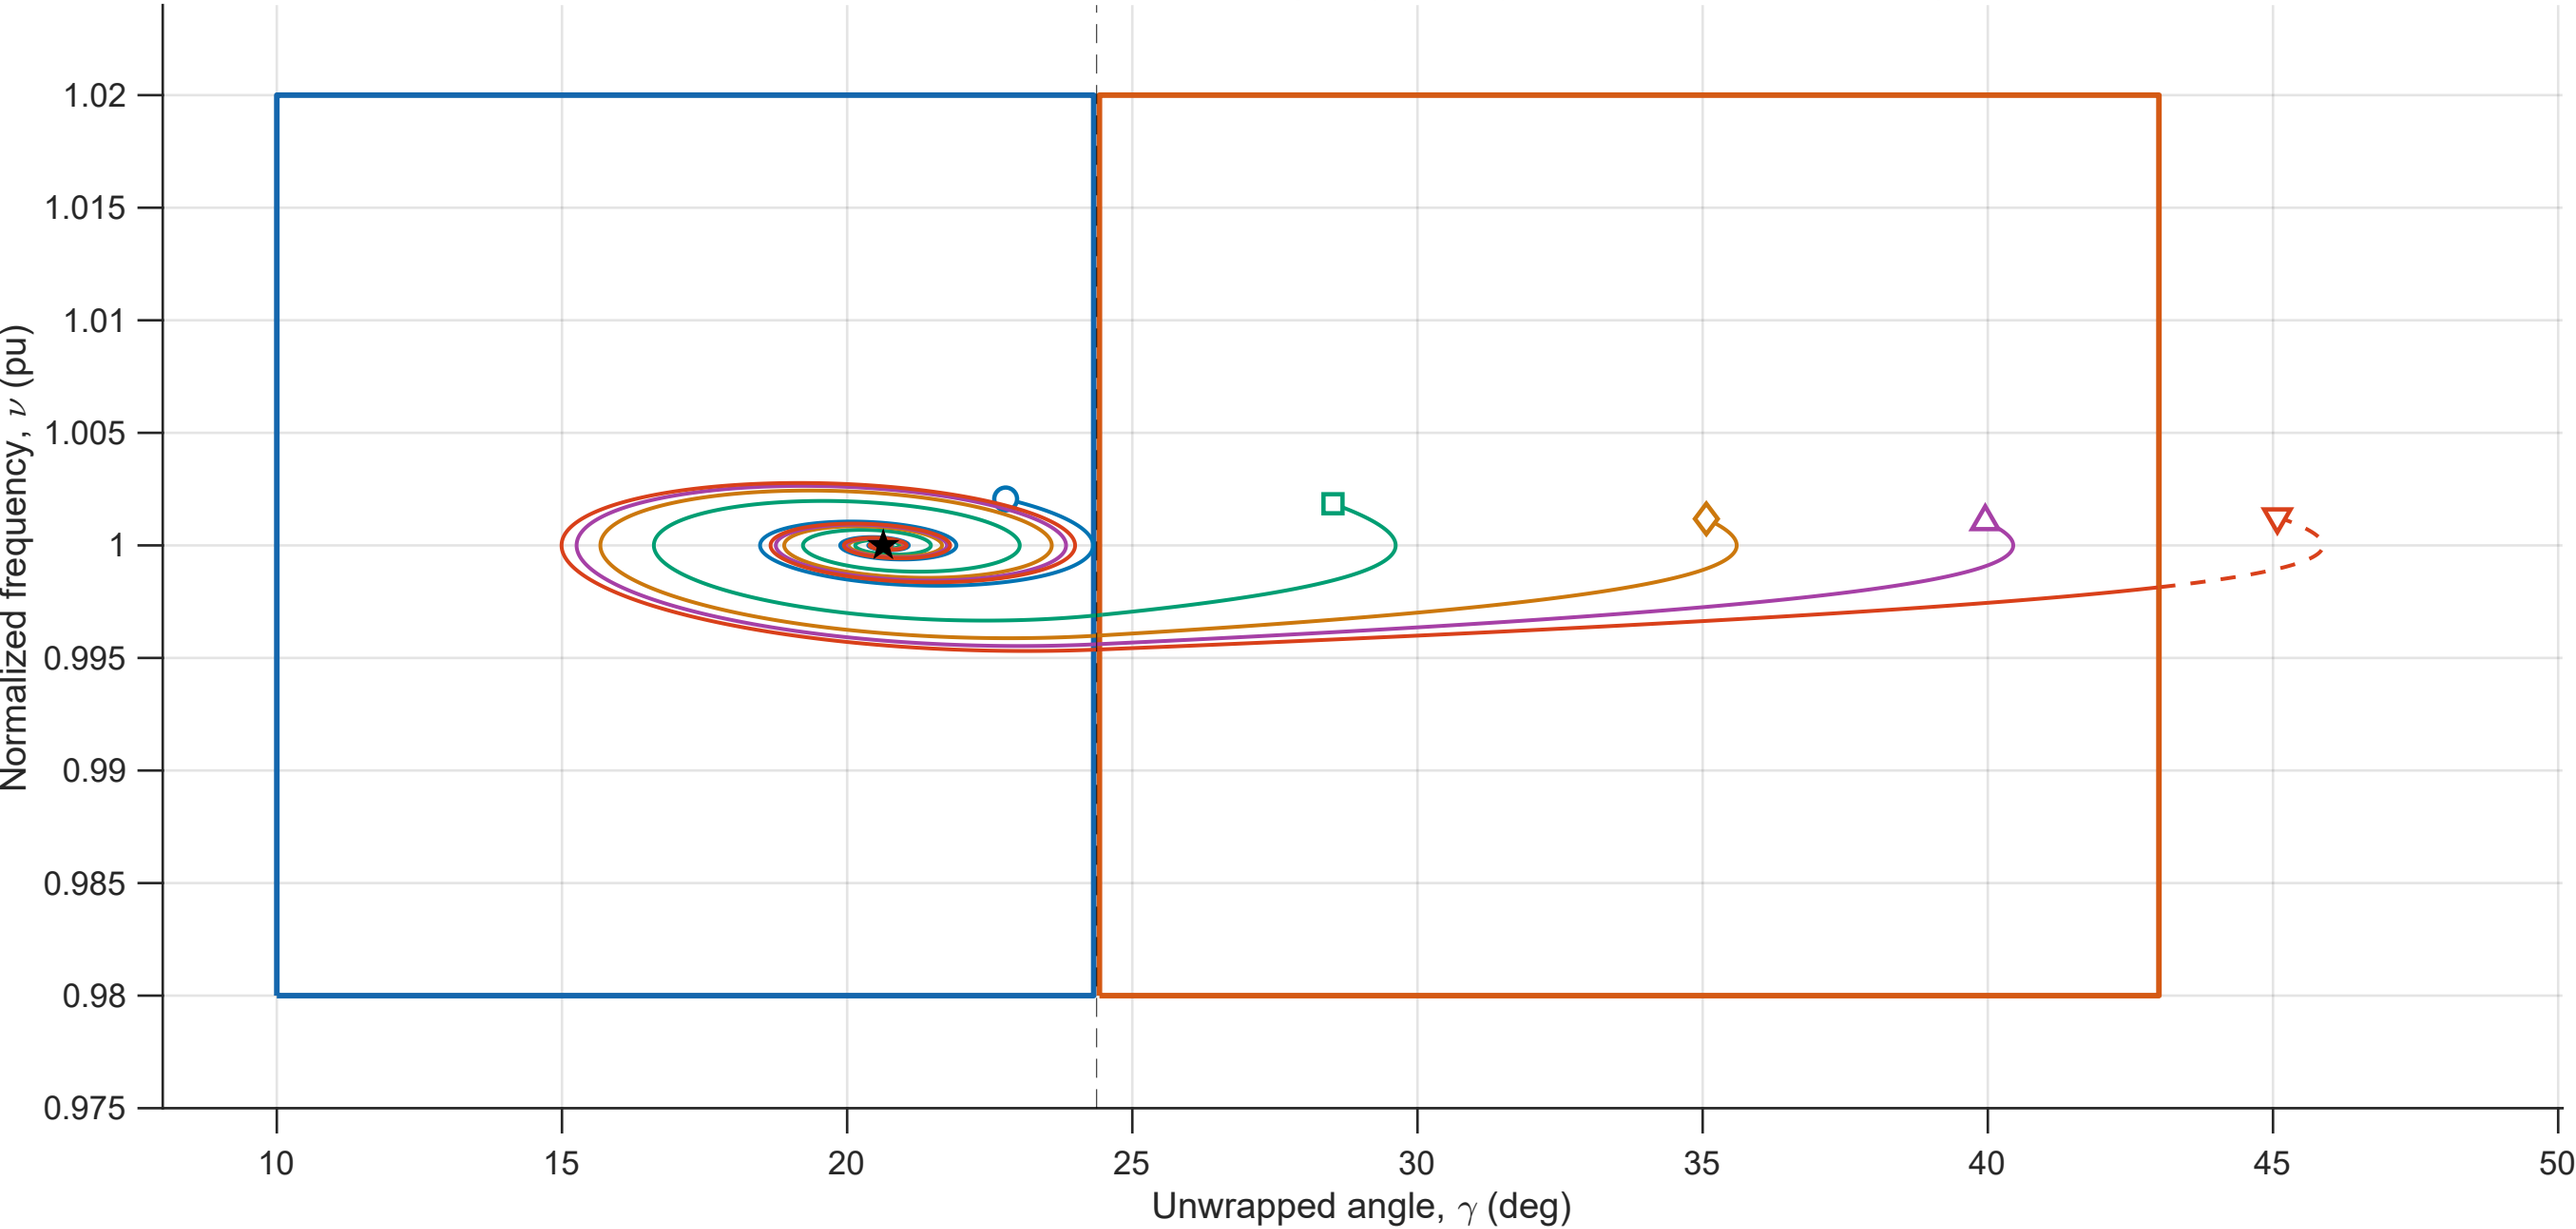

Solid links join two inside samples; links touching an outside sample are dashed. The uncertified switching gap is excluded.
Time inside: trapezoidal time-weighted estimate from saved sample membership. Main view includes all saved excursions.
Sampled numerical containment is not a continuous-time containment proof or full stability certification.