


RUN GAS PIPING BELOW ROOF. GAS PIPING TO BE INSTALLED ABOVE BOTTOM OF JOISTS WHEN POSSIBLE.


7 PAINT ALL EXTERIOR GAS PIPING TO MATCH COLOR OF EXTERIOR WALL.

PRESSURE

6" W.C.

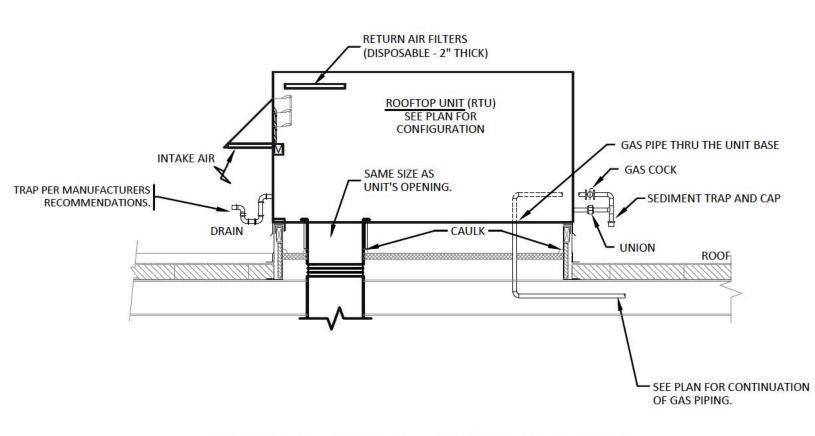

GAS ROOF TOP UNIT DETAIL (LOW PRESSURE) GAS PIPE INSIDE

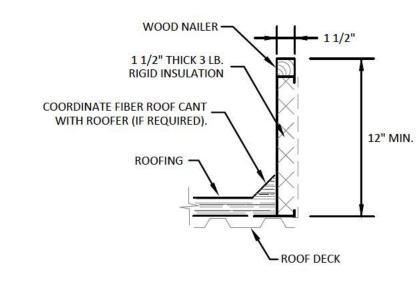

RPS CORPORATION, MODEL: RC-2 OR EQUAL

* 18 GAUGE GALVANIZED STEEL

* WOOD NAILER

* UNITIZED CONSTRUCTION

* SLOPED CURB AS REQUIRED FOR ROOF PITCH

* INTERIOR LINING

* DAMPER SHELF (IF REQUIRED)

ROOF CURB DETAIL

NO SCALE #D-1-11A

All rights reserved. This document is fully protected by copyright and nothing that appears in it may be reproduced, either wholly or in part, without special permission. United Engineering, Inc. specifically excludes warranties, expressed or implied, as to the accuracy of the data and other information set forth in this document and does not assume liability for any losses or damage resulting from the use of the materials or application of the data discussed in this document.

United Engineering, Inc.

PROJECT ENGINEERING AND LAYOUT SERVICES

1006 GENEVA ST. * SHOREWOOD, IL 60404
PHONE: (815)744-1010 * FAX: (815)744-1516
www.unitedmep.com

NOT FOR COORDINATION
FOR BIDDING
FOR PERMIT
NOT FOR CONTRACTING
ANOT FOR CONTRACTING

REVISIONS

1 LAKE COOK ROAD SUITE RFIELD, ILLINOIS 60015—523 7)945—6869 FAX(847)945—028




OLTO PARTS
DOLTON PLAZA
PLVD DOLTON, IL 60419

1317 E. SIBLEY BLVD

SHEET TITLE GAS PIPING PLAN

M 2

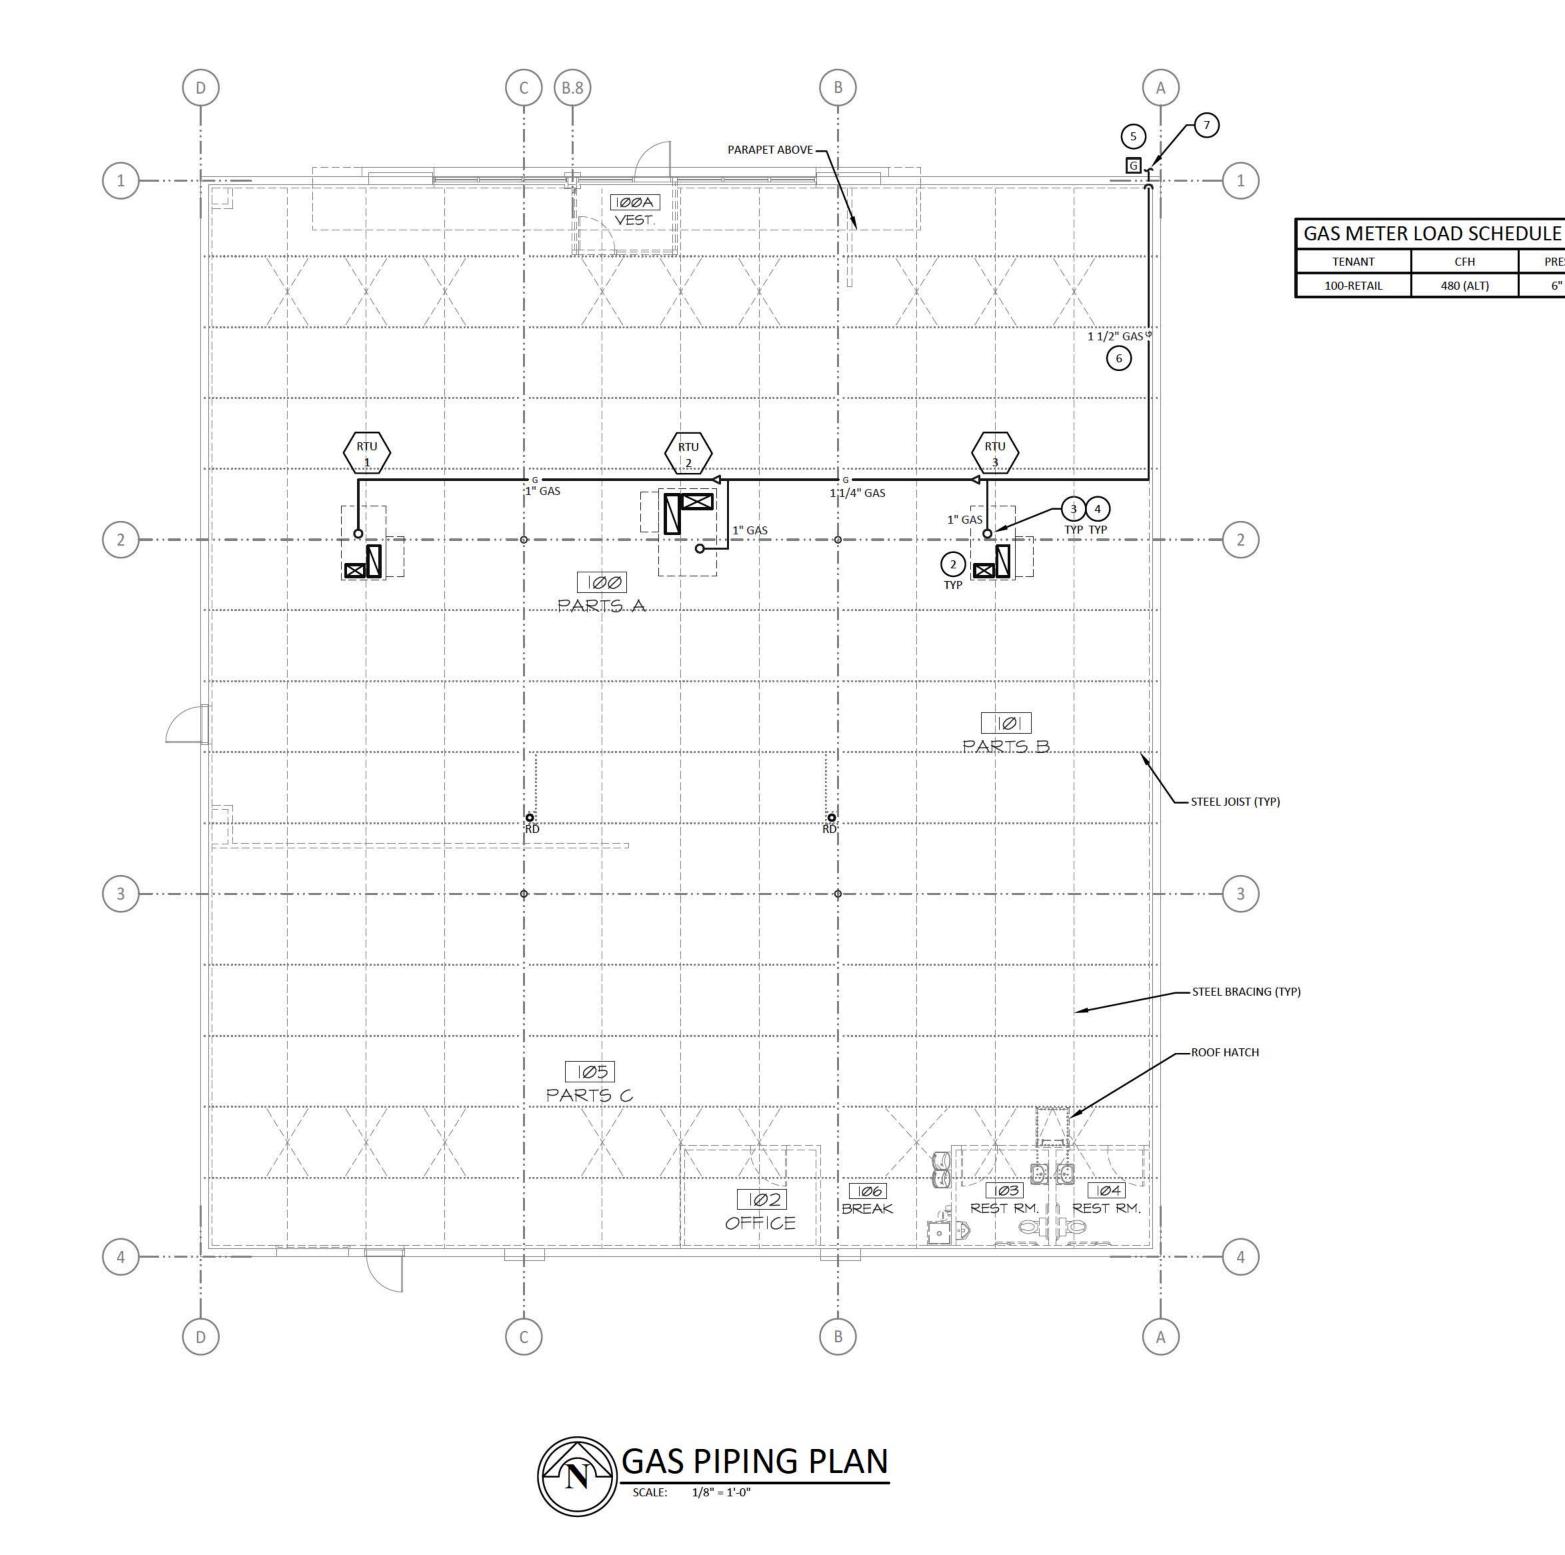

PRIOR TO INSTALLATION, VERIFY ALL DUCTWORK, PIPING, WIRING, CONDUITS AND EQUIPMENT LOCATIONS SHOWN ON DRAWINGS TO AVOID CONFLICTS WITH THE BUILDING STRUCTURE, WALLS, CEILINGS, LIGHTS, ELECTRICAL ITEMS AND/OR OTHER TRADE ITEMS.

NOTIFY DESIGN ENGINEER IN WRITING PRIOR TO ANY CHANGES.