



Abs. Error of Control Inputs


CO₂ supply rate

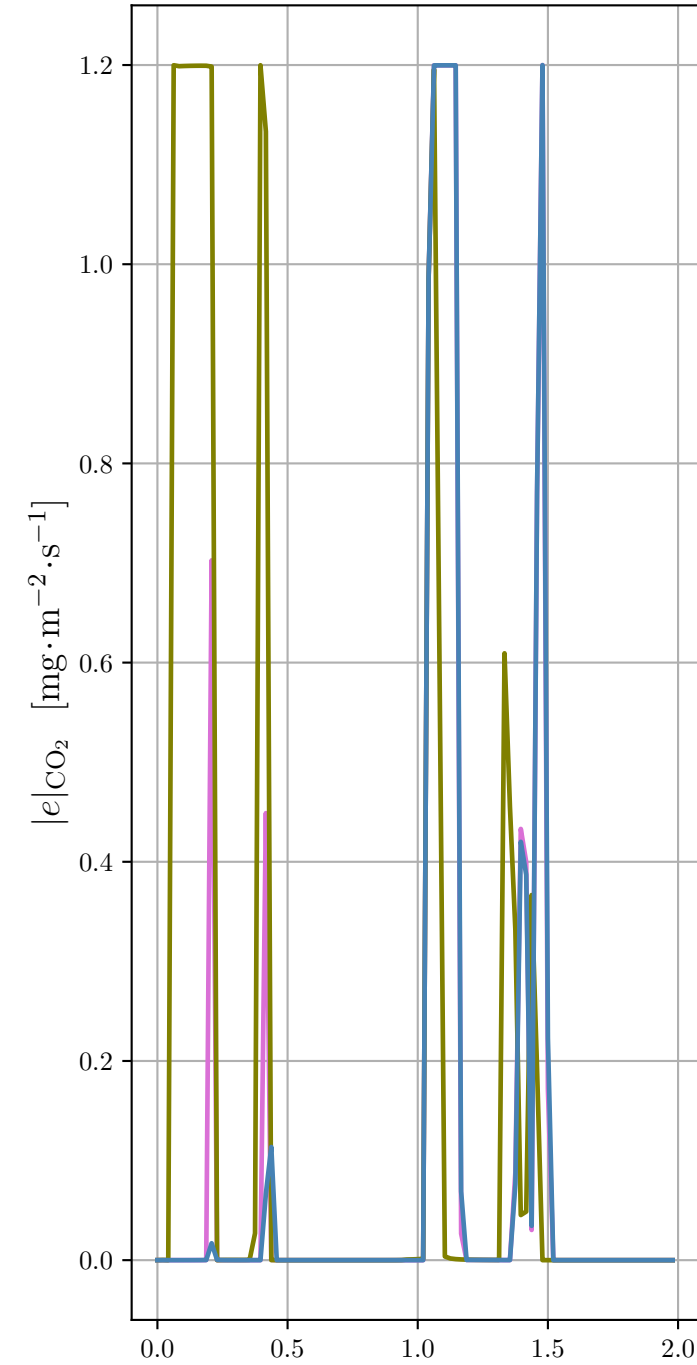

Ventilation rate

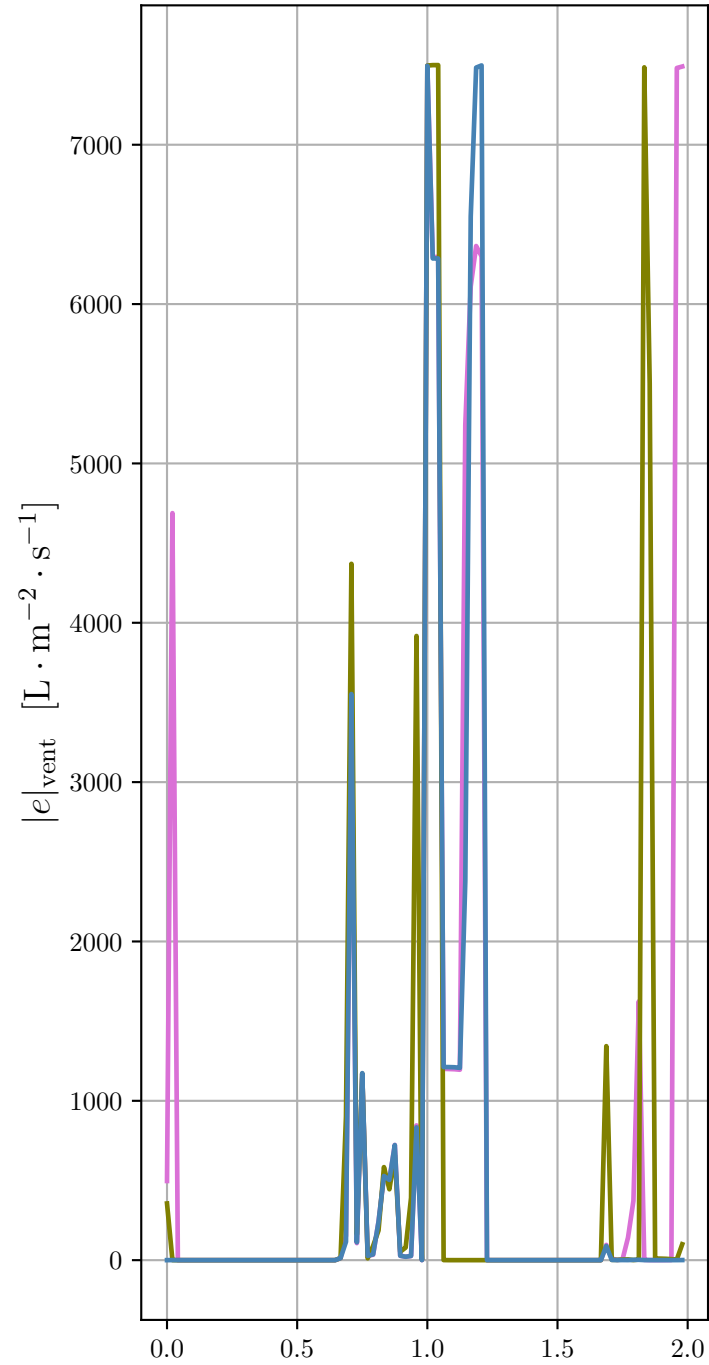

Heating energy supply

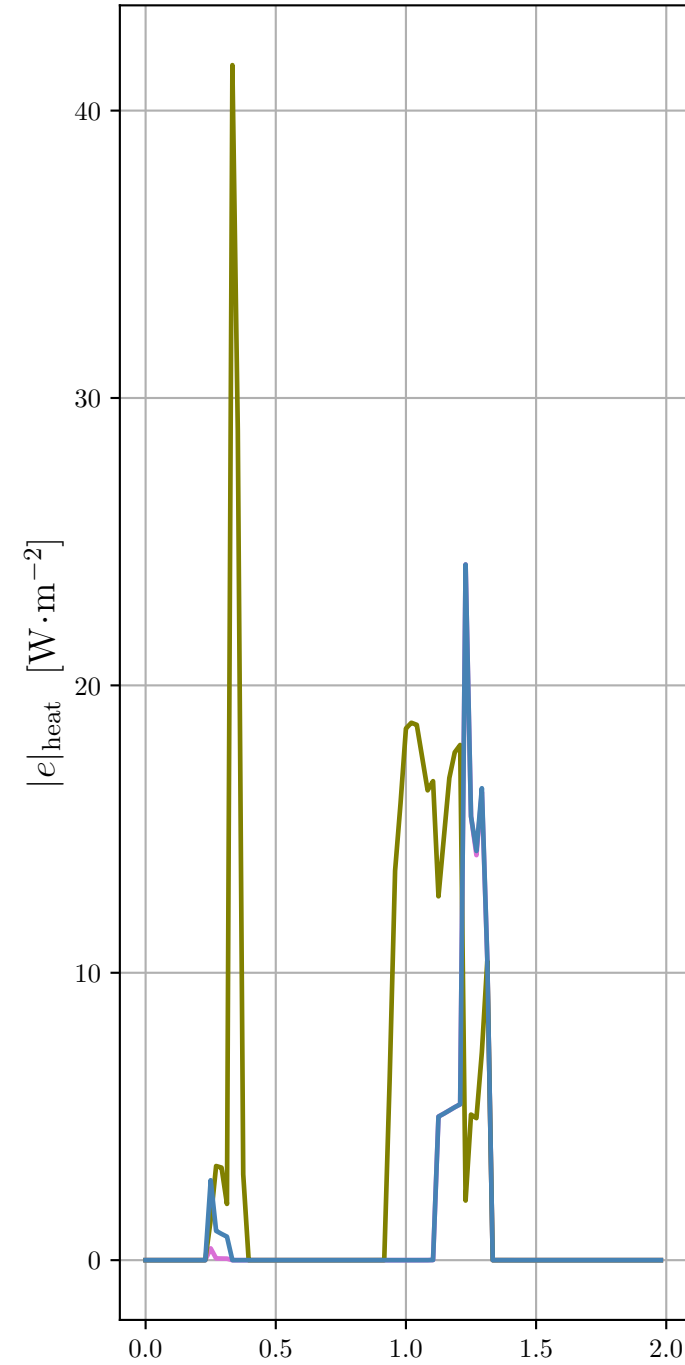

Air Exchange Flow

