



# Abs. Error of Control Inputs


## CO<sub>2</sub> supply rate

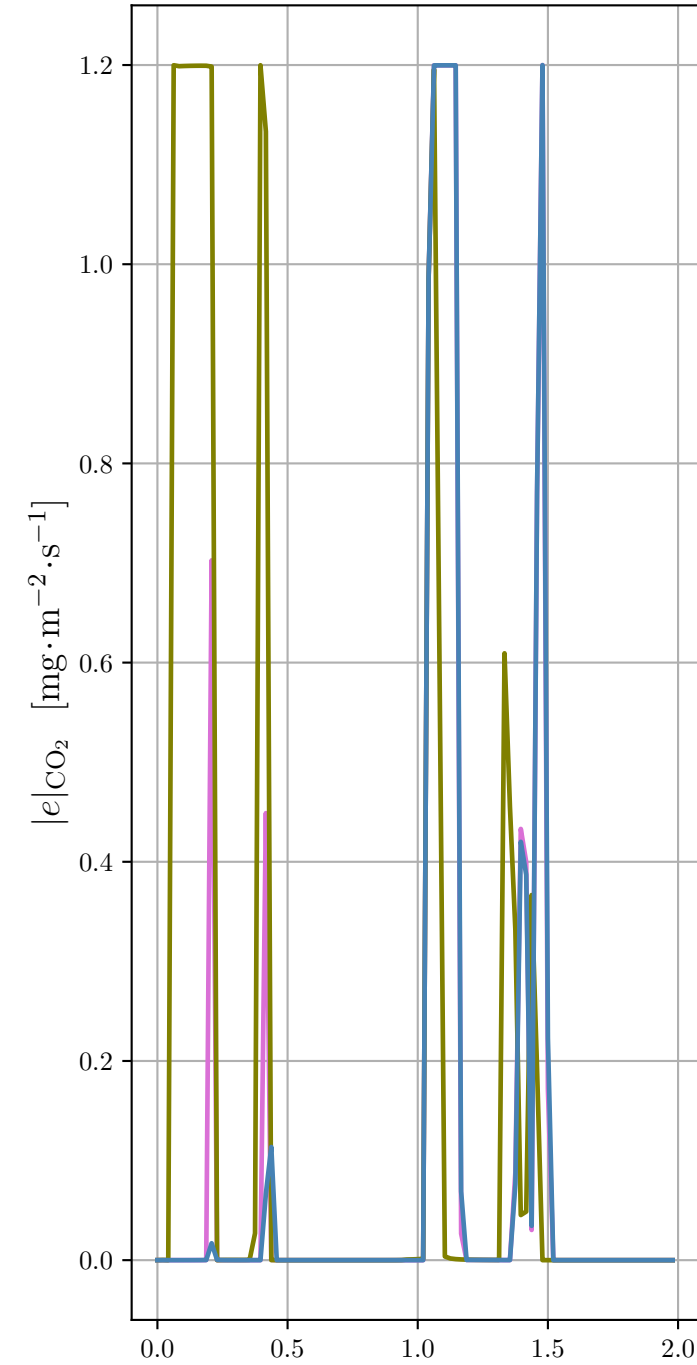

## Ventilation rate

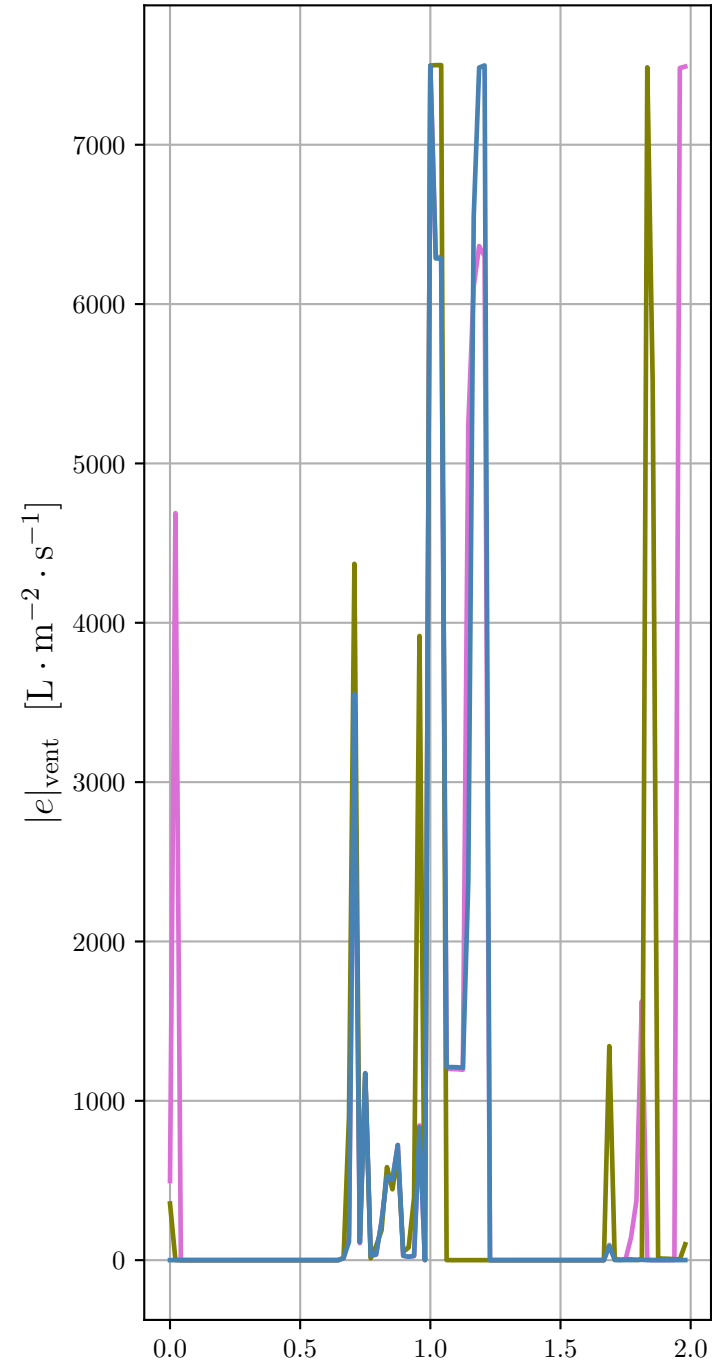

## Heating energy supply

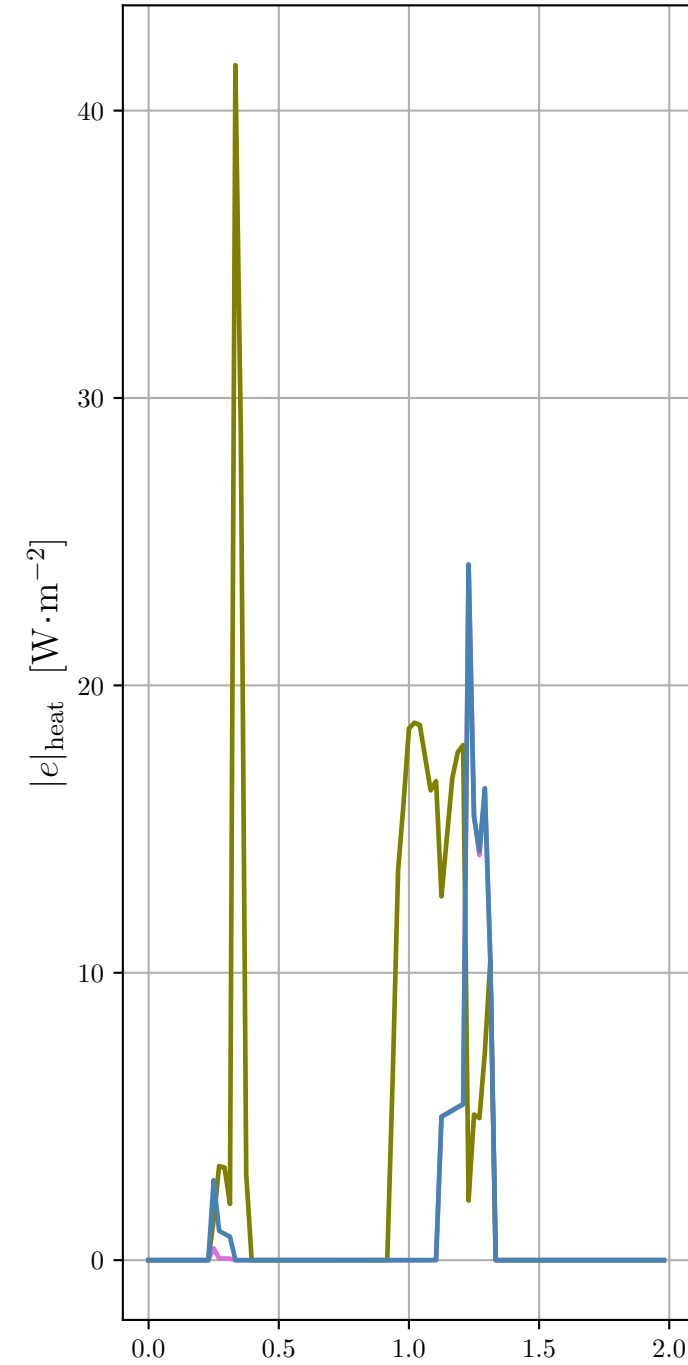

## Air Exchange Flow

