

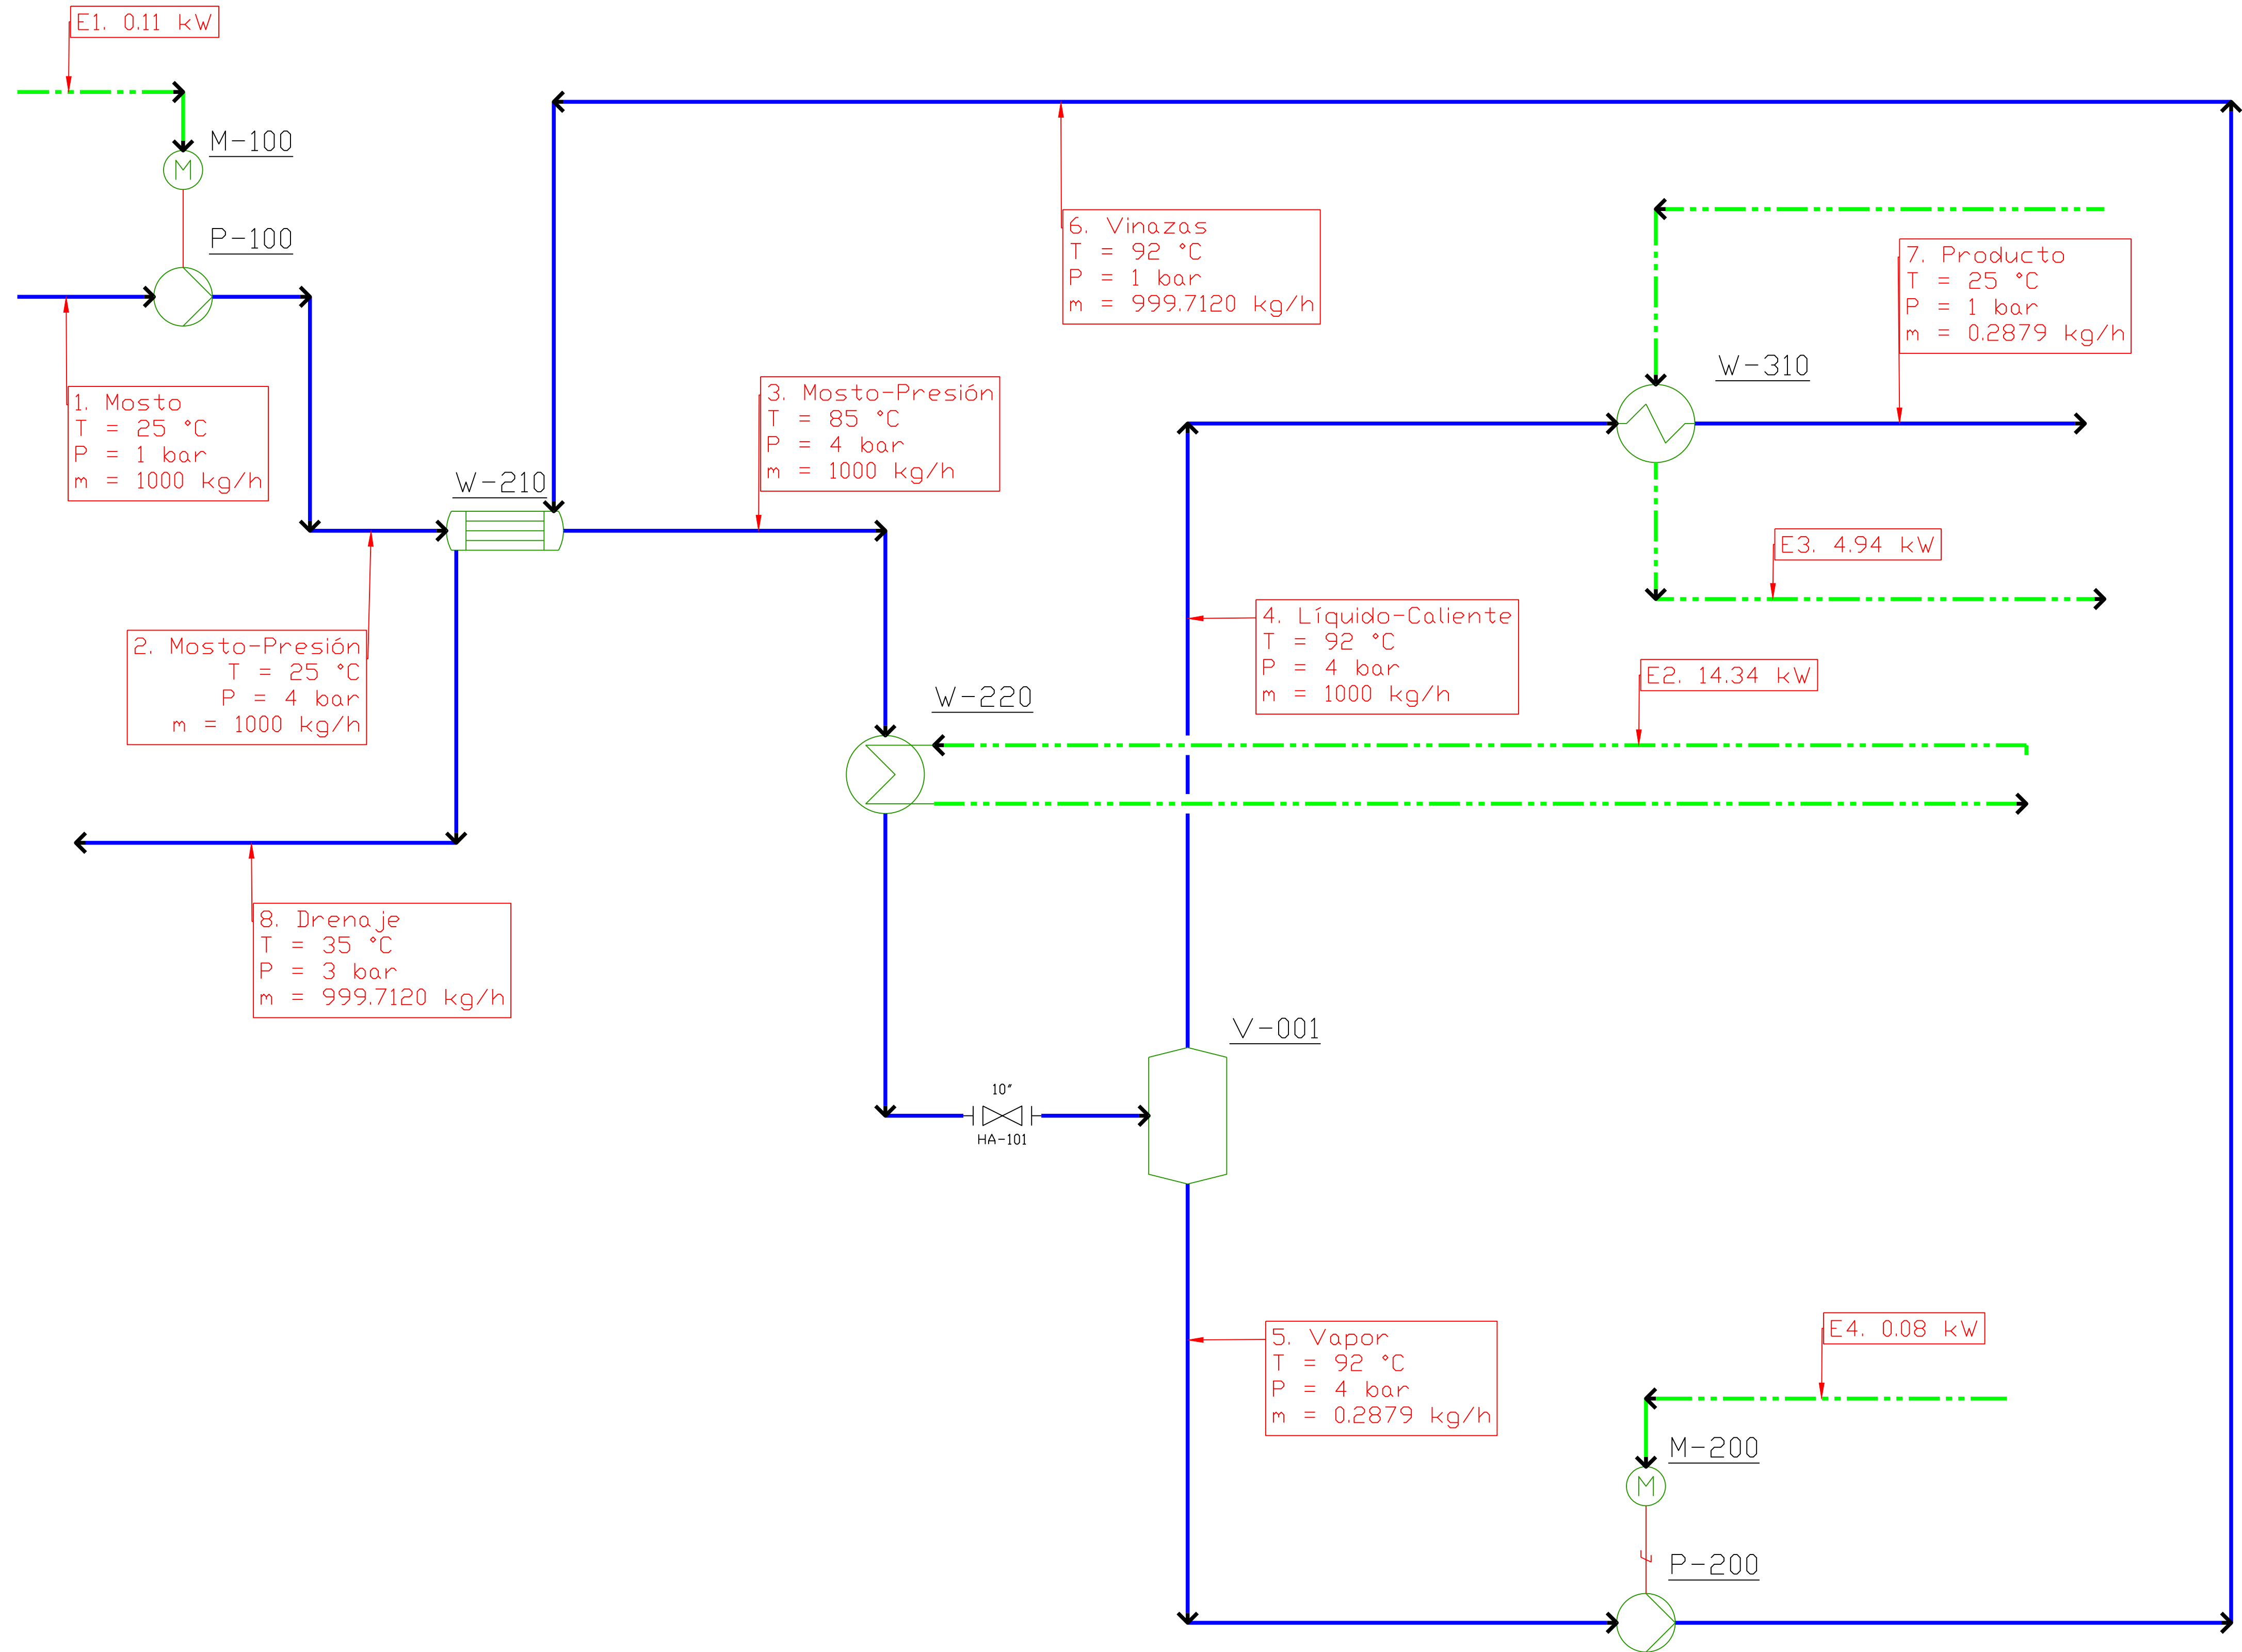


Tabla de Propiedades

	1	2	3	4	5	6	7	8
T (°C)	25	25	85	92	92	92	25	35
P (bar)	1	4	4	4	4	1	1	3
m (kg/h)	1000	1000	1000	1000	0.2879	999.7120	0.2879	999.7120

General Notes

Bomba

Intercambiador de calor

Intercambiador de calor

Tanque Flash

Intercambiador de calor

Motor

Válvula

1	Primera Revisión	28-03 2026
No.	Revision/Issue	Date

Drawing Name

Diagrama de Flujo de Proceso

Project Name and Address

Proceso de Concentración de Mosto

Area	100, 200, 300	Stomp
Drawing Number	1	
Author	IAL Kenia Robles	