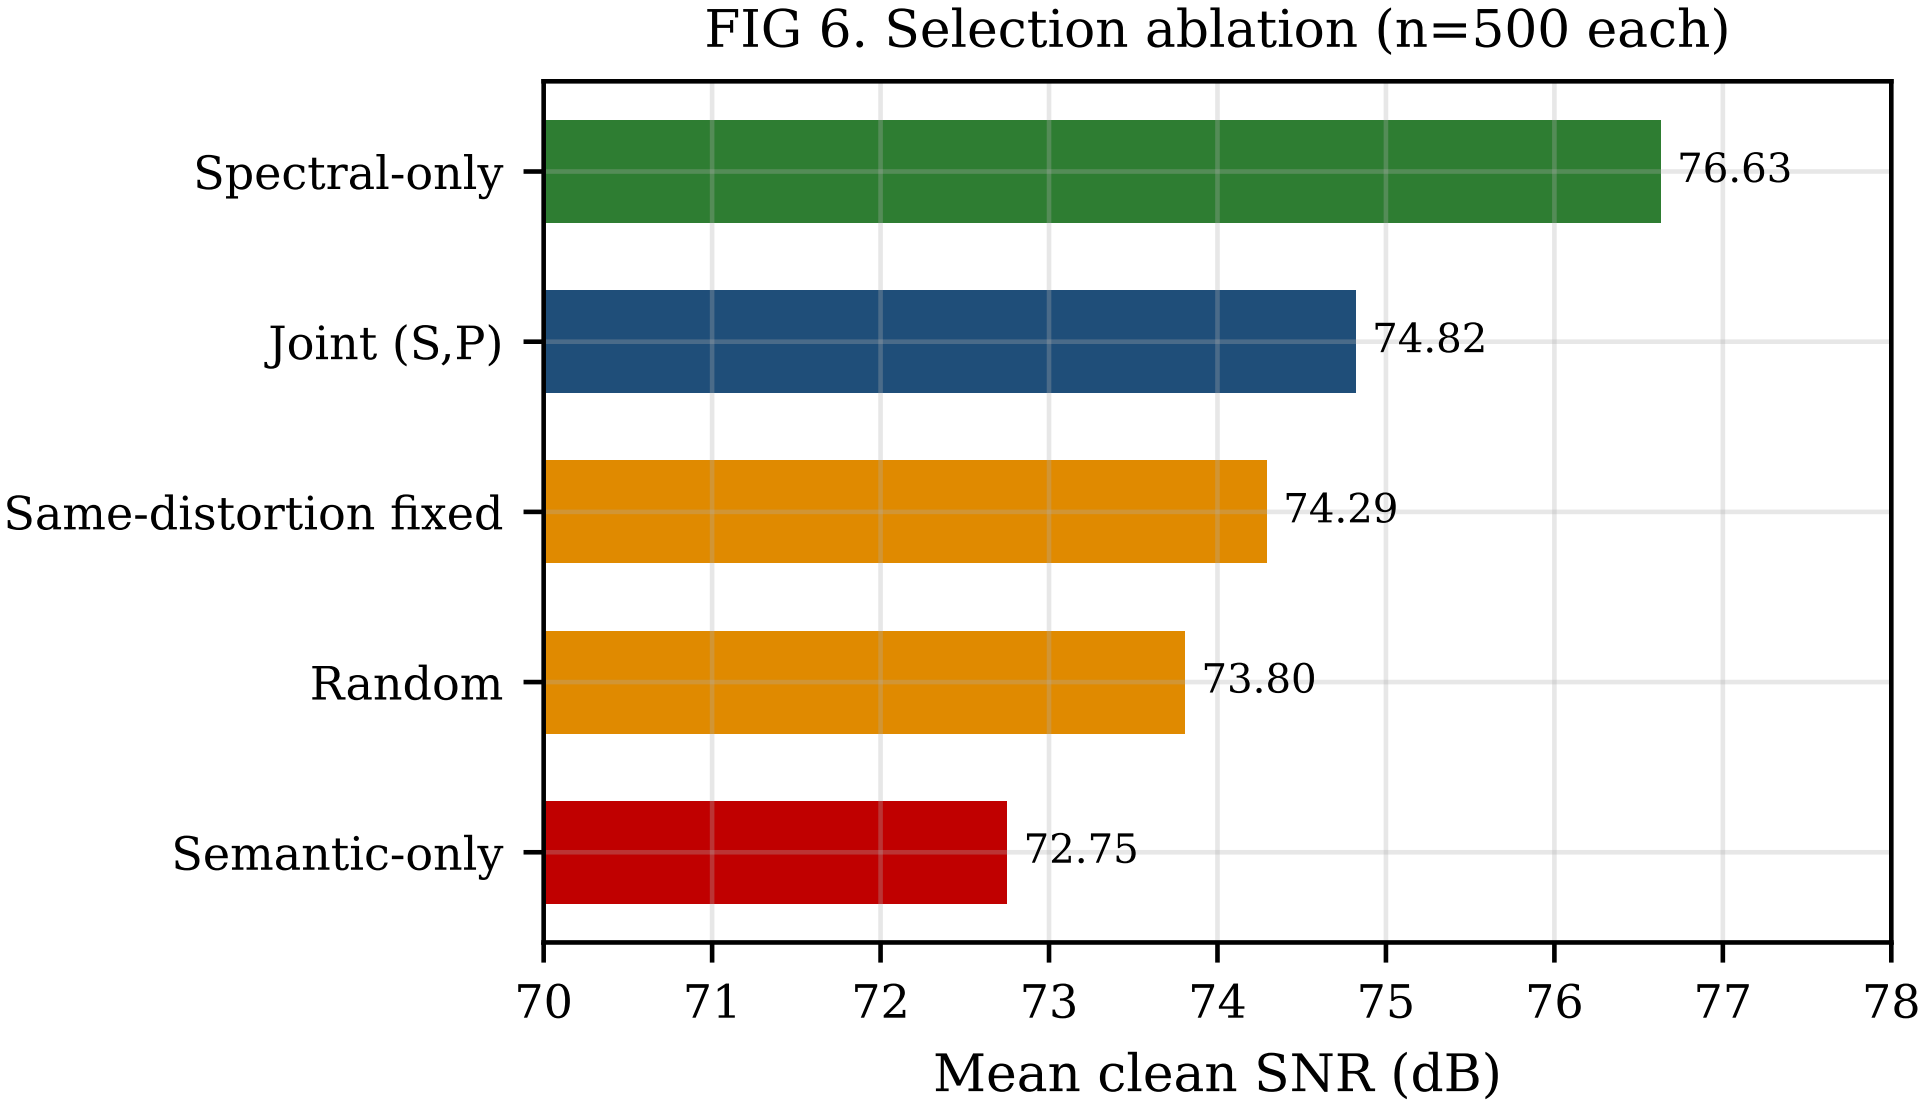
FIG 6. Selection ablation (n=500 each)
Spectral-only
Joint (S,P)
Same-distortion fixed
Random
Semantic-only
76.63
74.82
74.29
73.80
72.75
70
71
72
73
74
75
76
77
78
Mean clean SNR (dB)