



SON, Nino 3.4 Negative (<-0.75)


PDO Negative (<1)

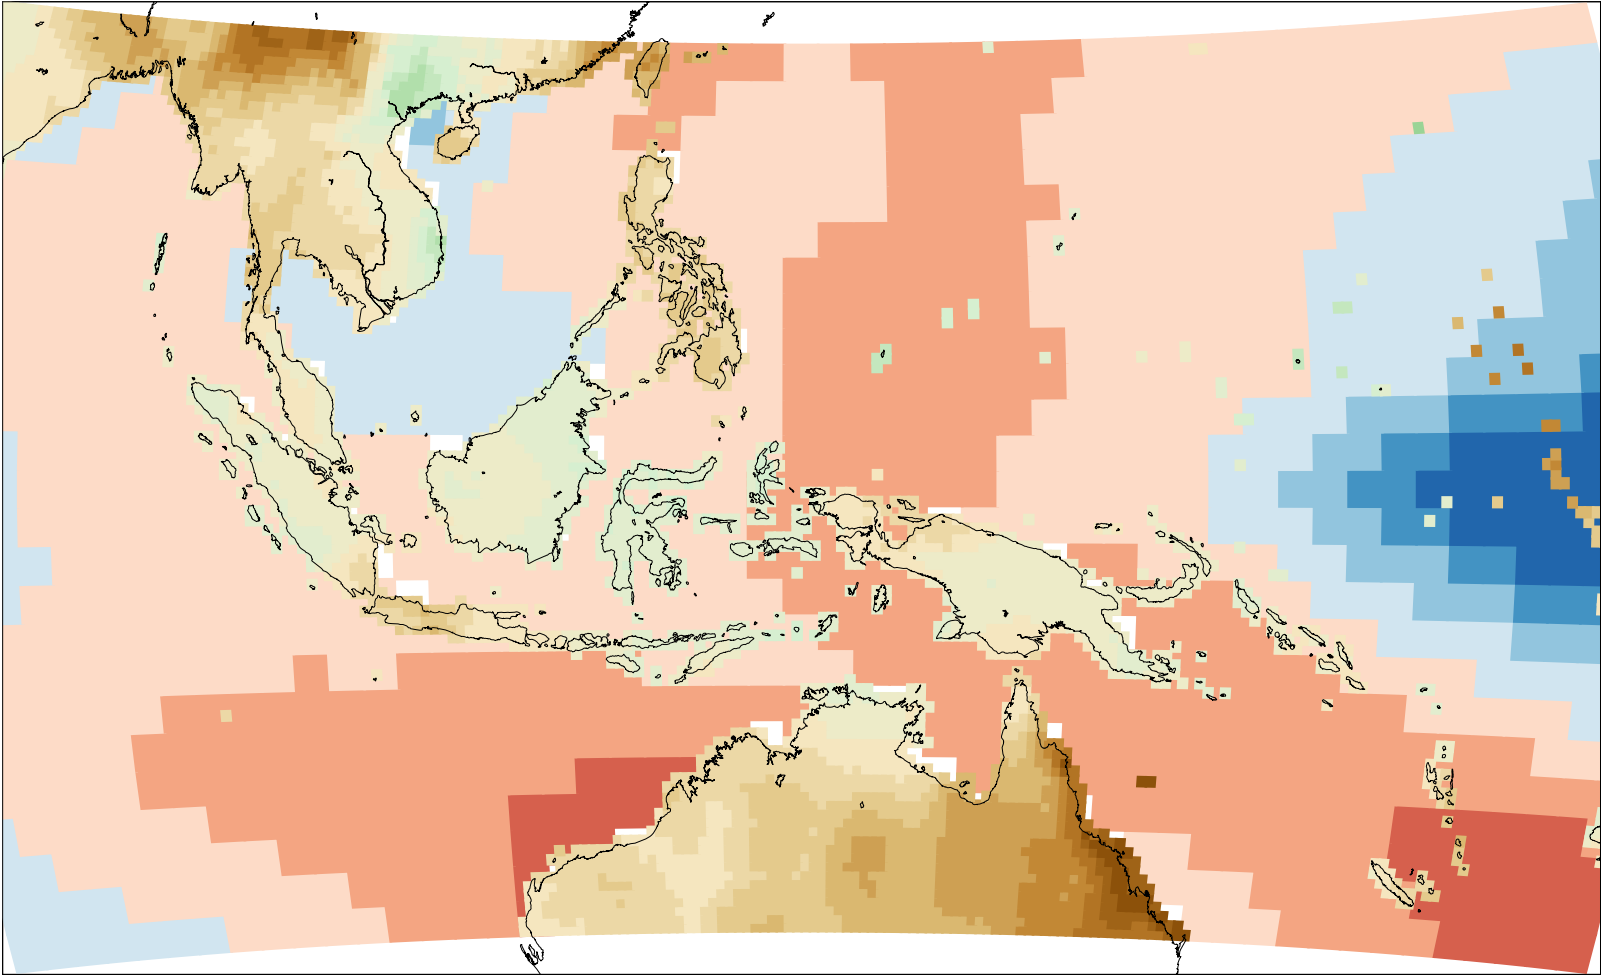

PDO Neutral [-1, 1]

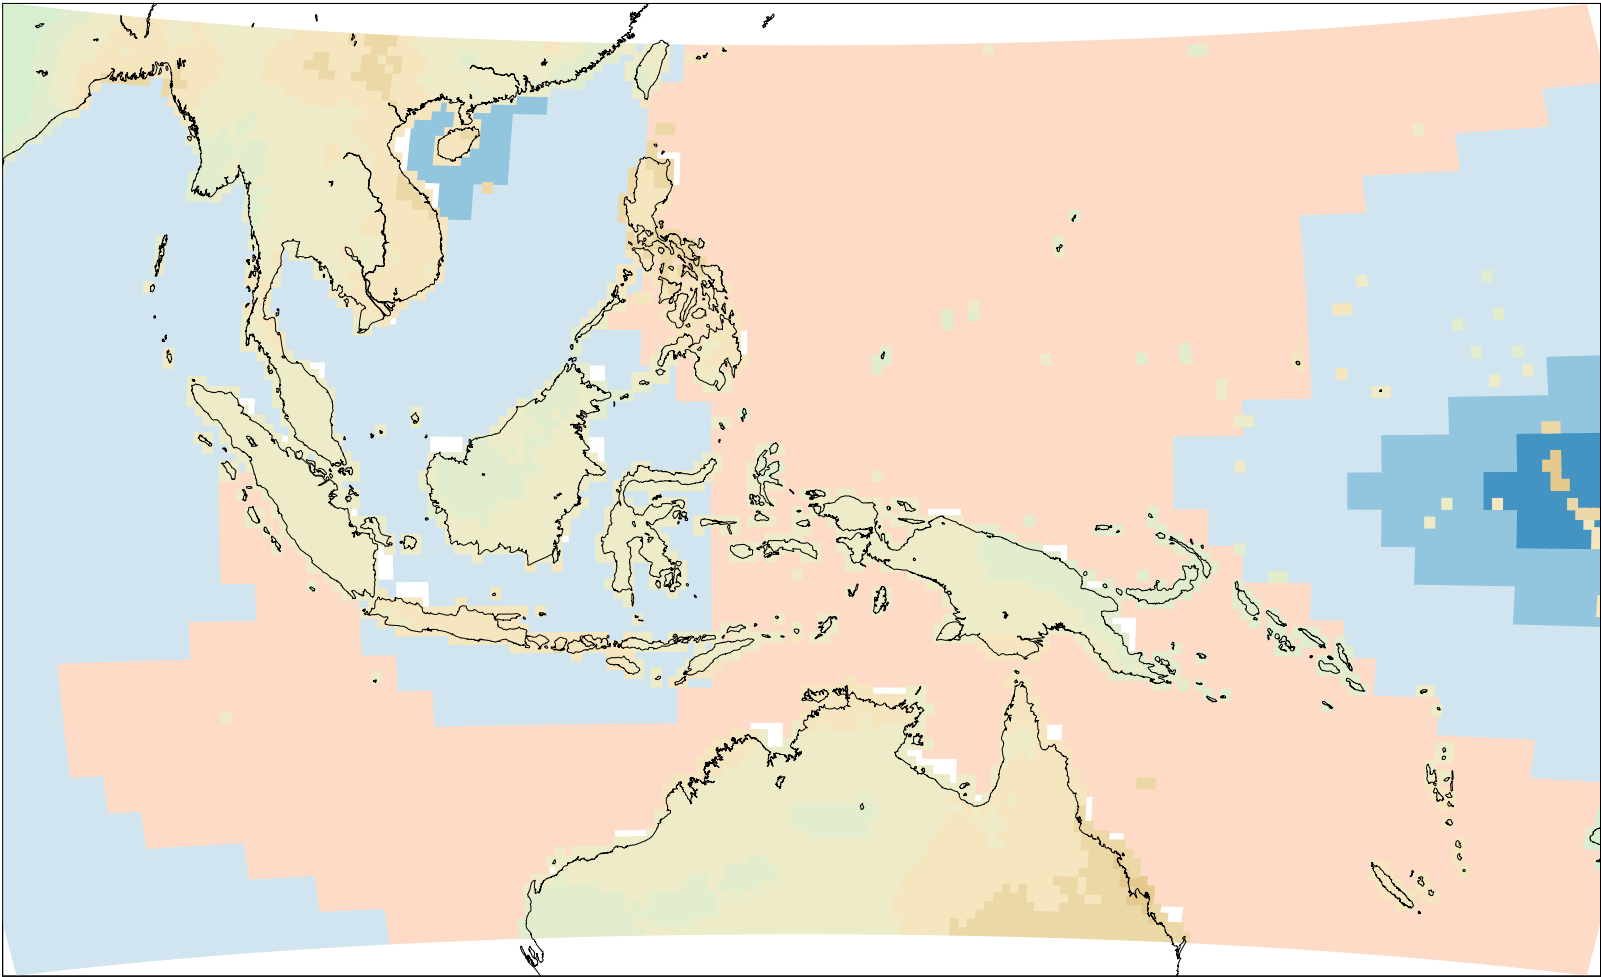

Difference

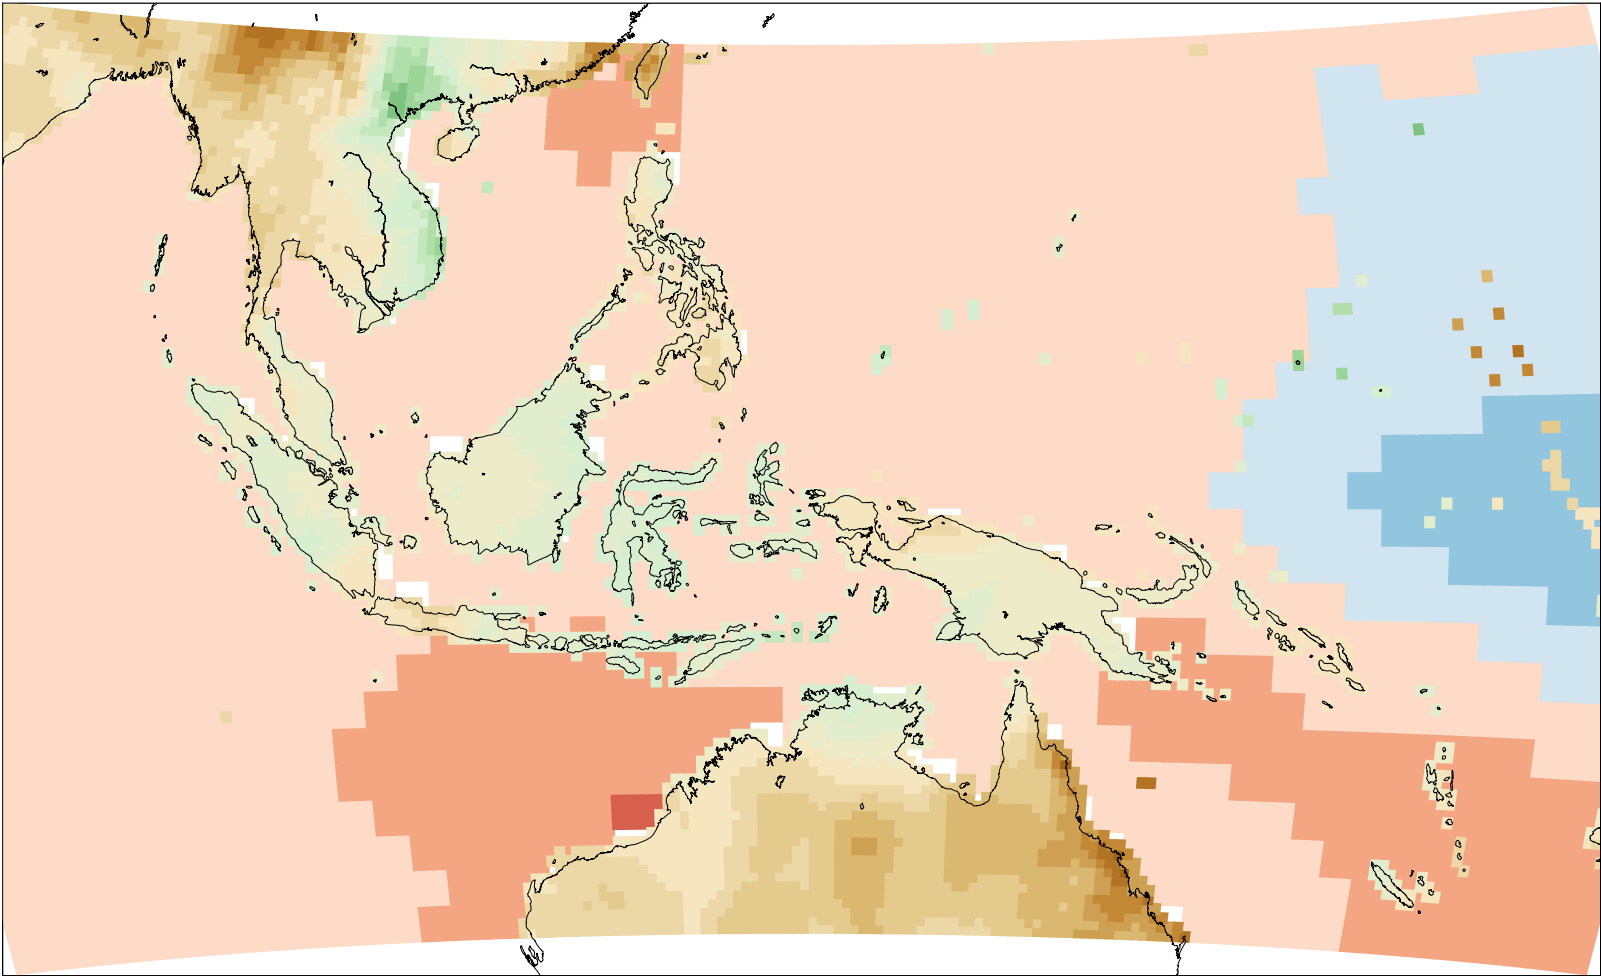

SST anomaly, °C



dtr anomaly, % of norm

