



DJF, Nino 3.4 Positive (>0.75)


PDO Positive (>1)

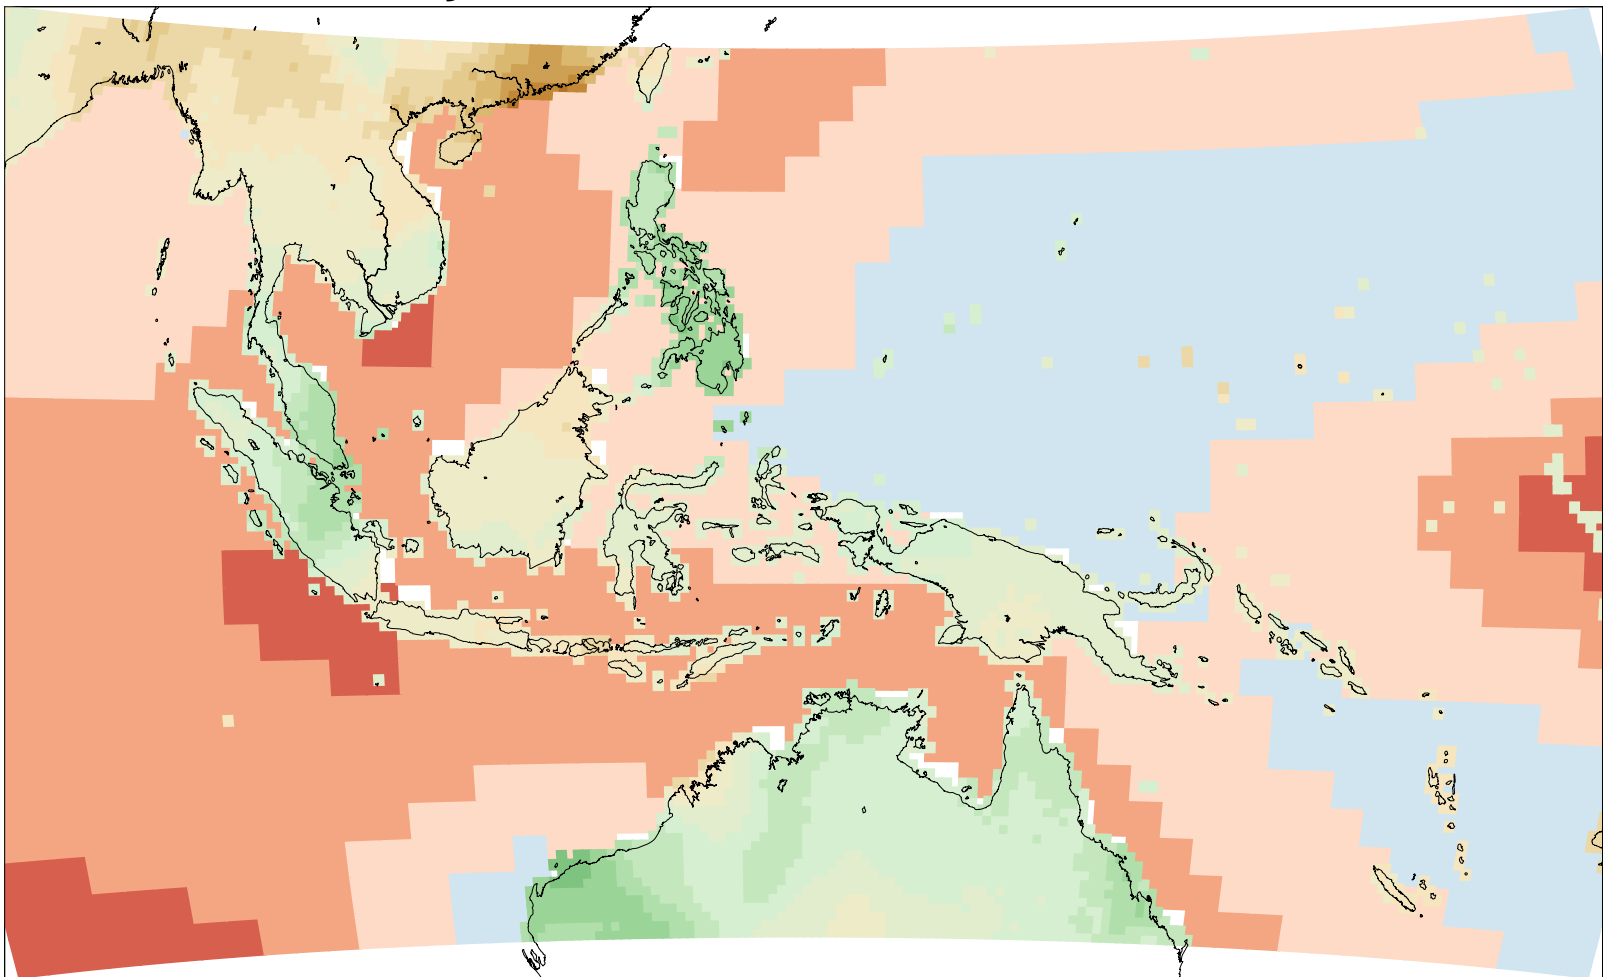

PDO Neutral [-1, 1]

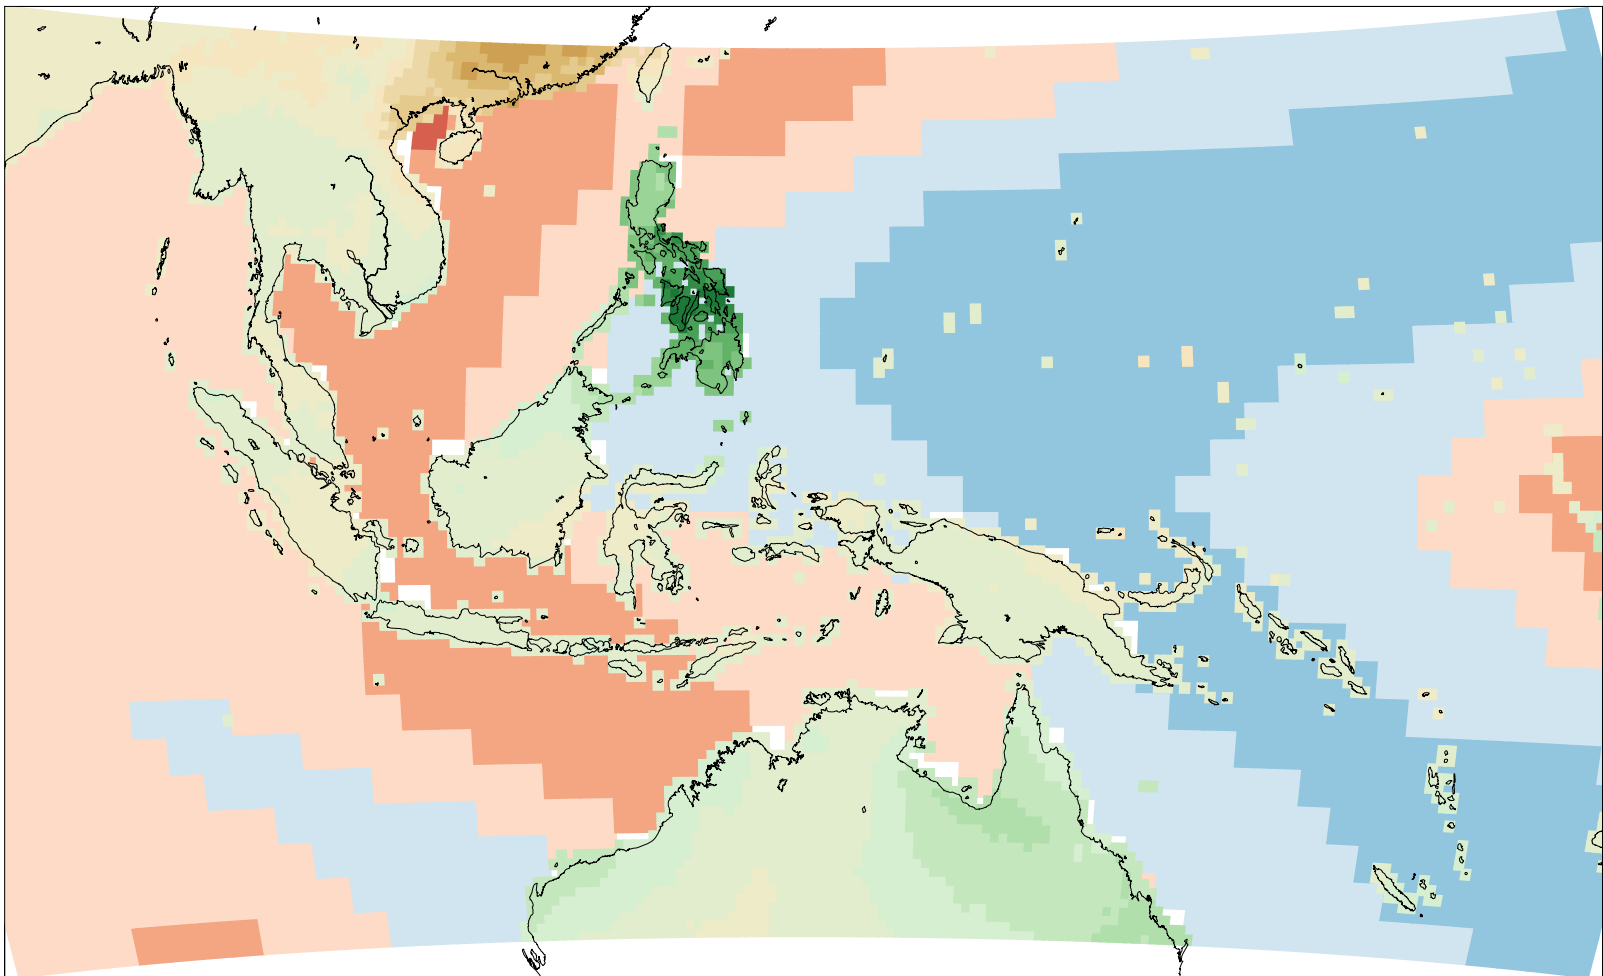

Difference

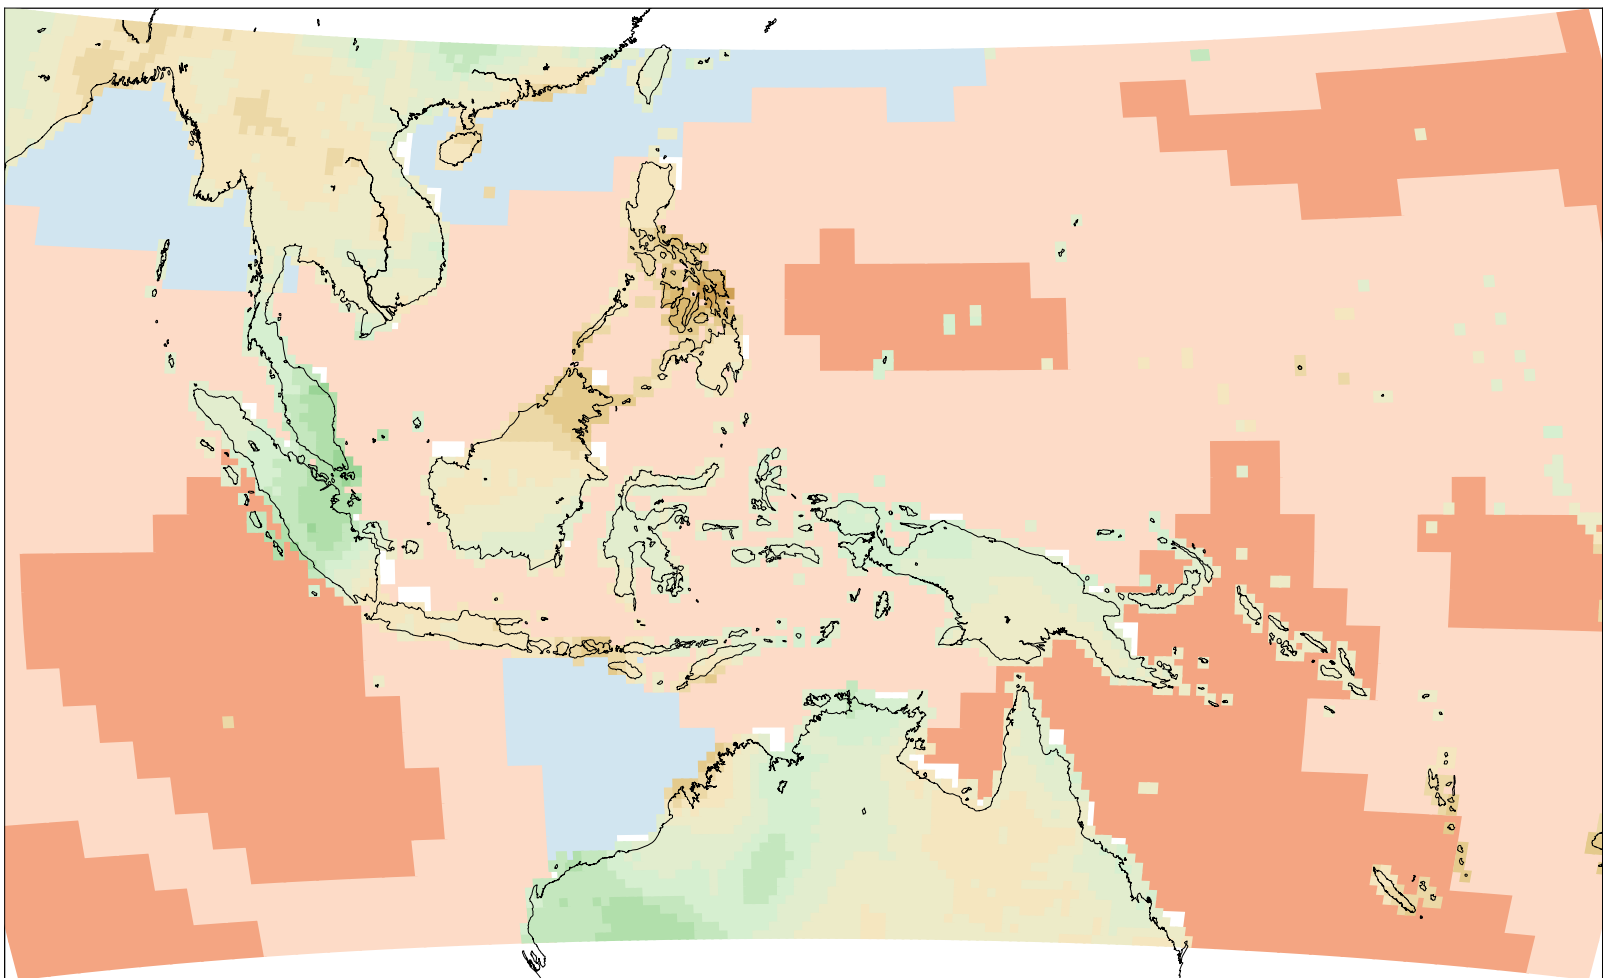

SST anomaly, °C



dtr anomaly, % of norm

