



DJF, Nino 3.4 Negative (<-0.75)


PDO Negative (<1)

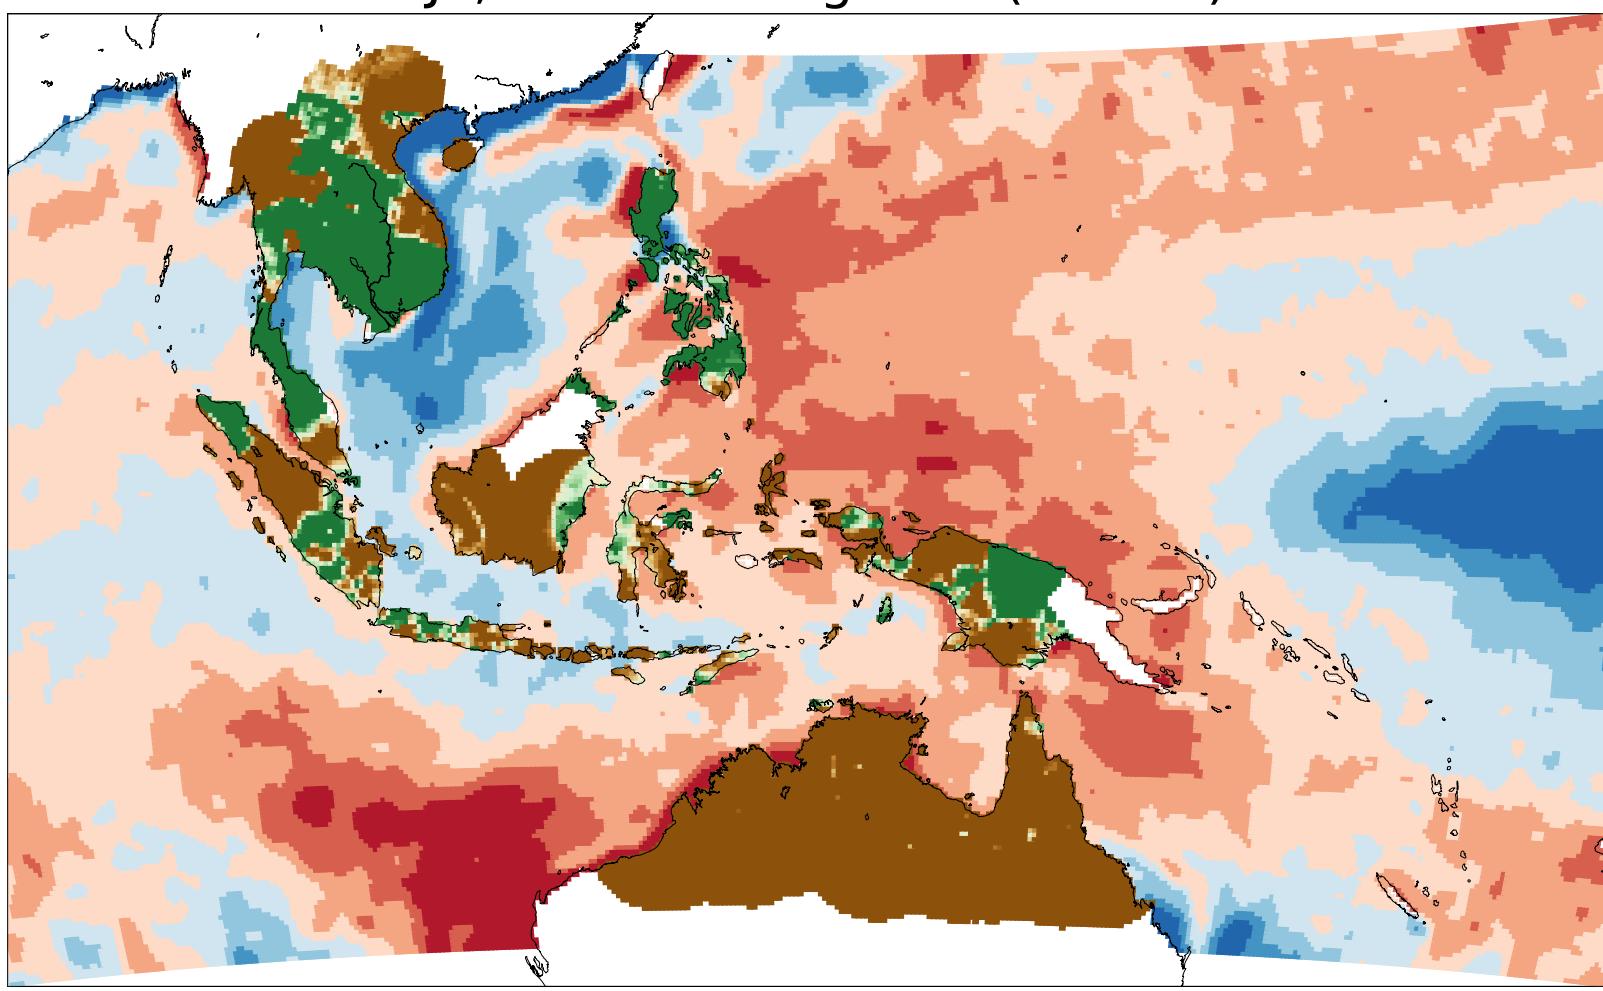


PDO Neutral [-1, 1]

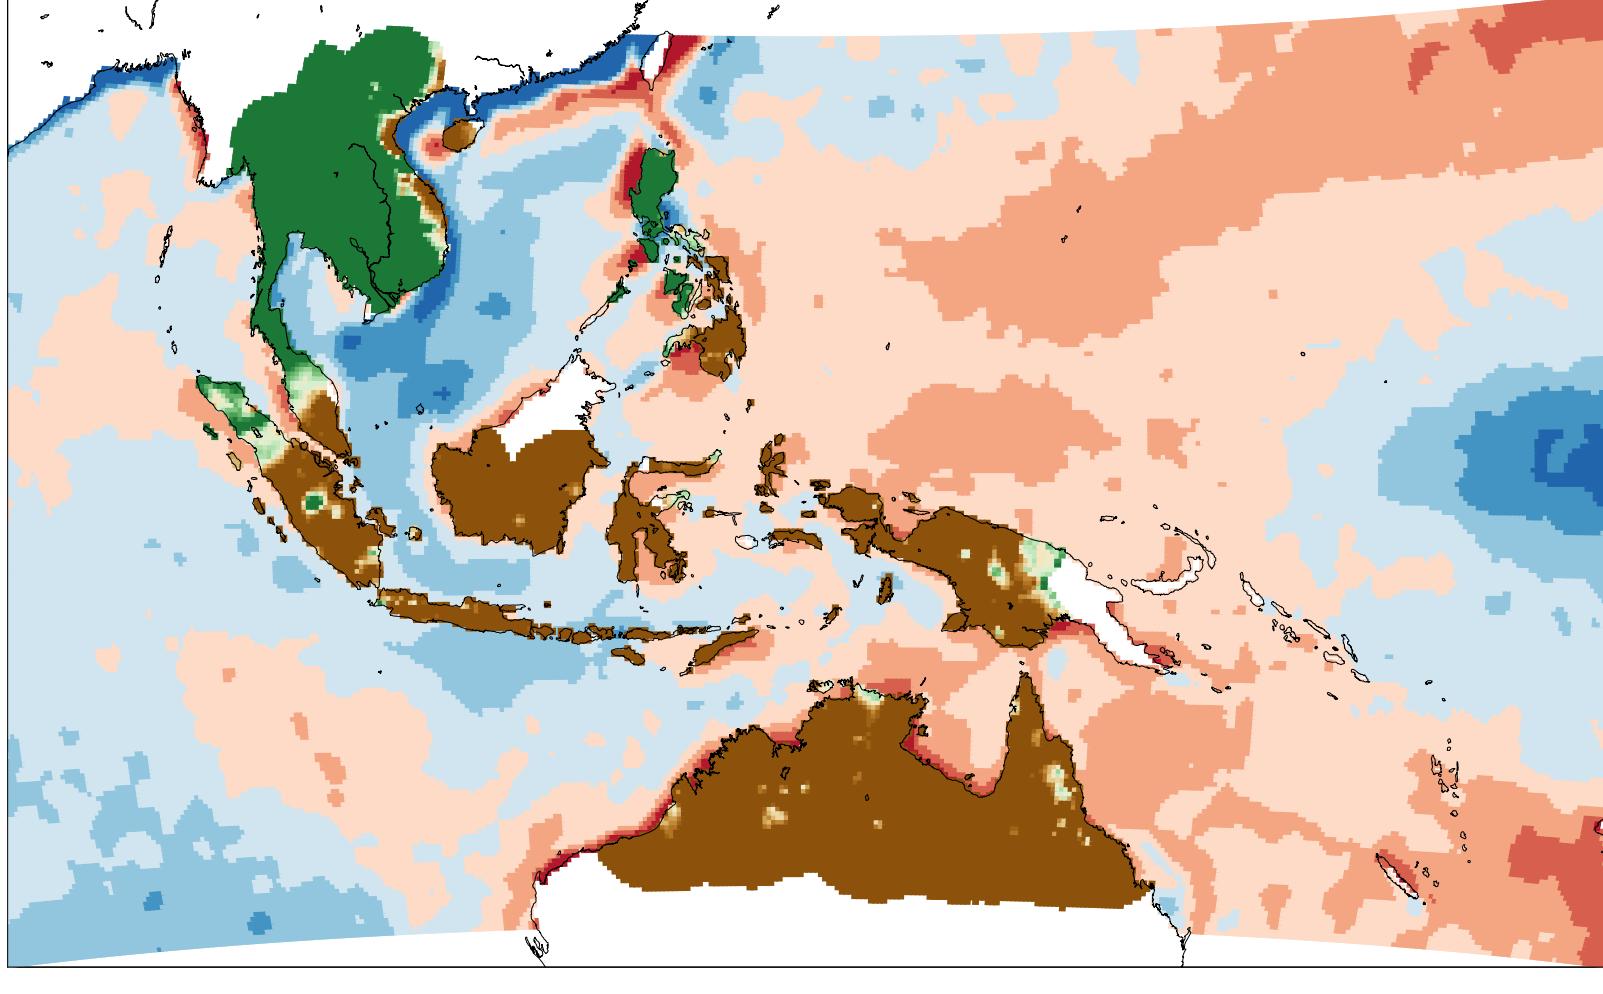

Difference

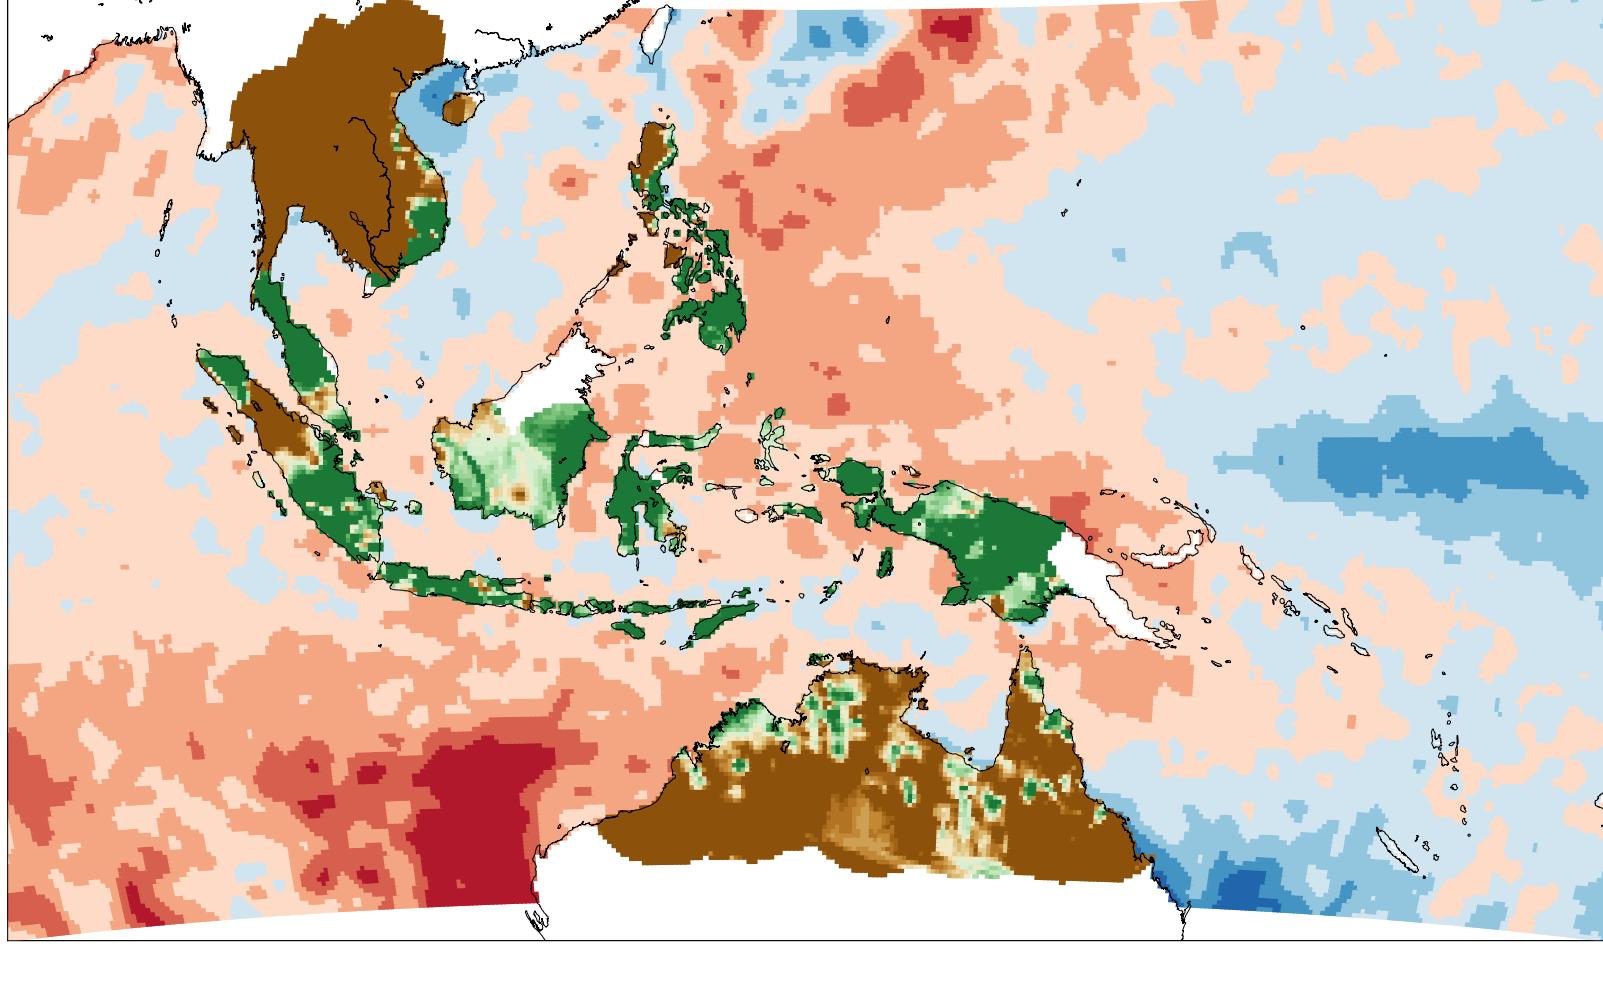

SST anomaly, °C

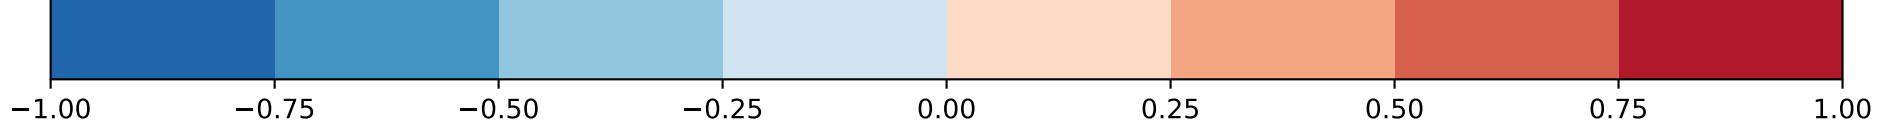

rr anomaly, % of norm

