
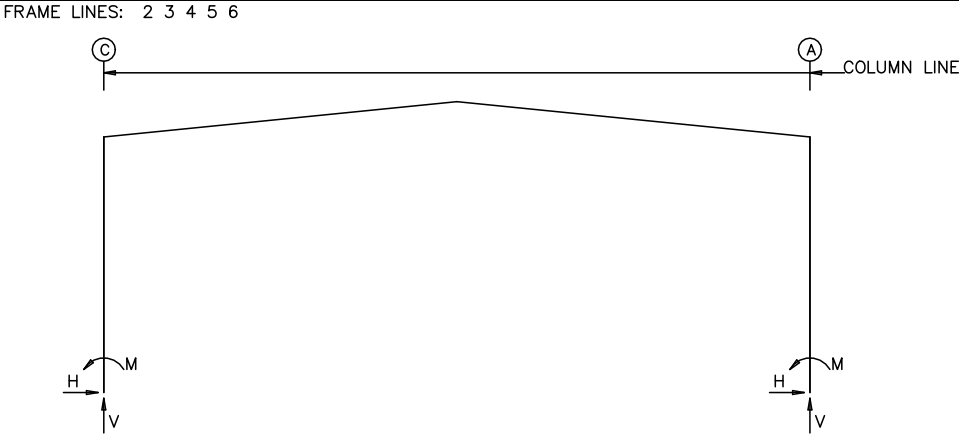


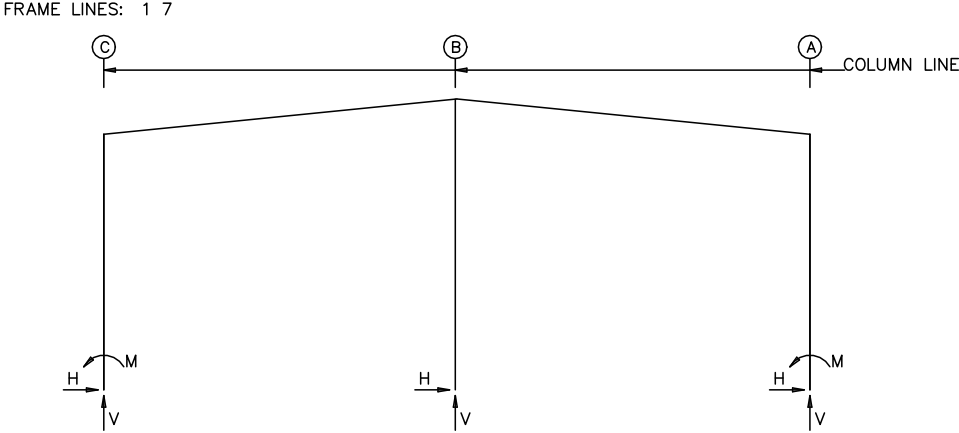

NOTES FOR REACTIONS

- All loading conditions are examined and only maximum/minimum H or V and the corresponding H or V are reported.
- Positive reactions are as shown in the sketch. Foundation loads are in opposite directions.
- Bracing reactions are in the plane of the brace with the H pointing away from the braced bay. The vertical reaction is downward.
- Building reactions are based on the following building data:
 - Width (mm)= 22470
 - Length (mm)= 35390
 - Eave Height (mm)= 8170/ 8170
 - Roof Slope (rise/100) =10.00/10.00
 - Roof Dead Load (kN/m2) = 0.10
 - Wall Dead Load
 - Left Endwall (kN/m2) = 0.10
 - Right Endwall (kN/m2) = 0.10
 - Front Sidewall (kN/m2) = 0.10
 - Back Sidewall (kN/m2) = 0.10
 - Live Load (kN/m2) = 0.57
 - Collateral Load (kN/m2) = 0.05
 - Wind Speed (m/s) = 39.0
 - Wind Code =MBMA10
 - Exposure =B
 - Closure =Enclosed
 - Internal Wind Coeff =-0.18, +0.18
 - Risk Category =-
 - Importance - Wind = 1.00
 - Importance - Seismic = 1.00
 - Seismic Design Category =B
 - Seismic Coeff (Sms) = 0.16
 - Temperature Change = 20
- Loading conditions are:
 - Dead+Collateral+Live
 - Dead+Collateral+0.75Live+0.75Wind_Right2+0.75Floor_Live
 - Dead+Collateral+0.75Live+0.75Wind_Long2L+0.75Floor_Live+0.75LWIND2_L2E
 - 0.6Dead+Wind_Left1
 - 0.6Dead+Wind_Right1
 - 0.6Dead+Wind_Left2
 - 0.6Dead+Wind_Right2
 - 0.6Dead+Wind_Long1L+LWIND1_L2E
 - 0.6Dead+Wind_Long1L+LWIND1_R2E
 - Dead+Collateral+F1CRANE2
 - Dead+Collateral+F1CRANE3
 - Dead+Wind_Left1/2+F1CRANE1
 - Dead+Wind_Right1/2+F1CRANE4
 - Dead+Collateral+F2CRANE2
 - Dead+Collateral+F2CRANE3
 - 0.6Dead+Wind_Right1+Wind_Suction
 - 0.6Dead+Wind_Pressure+Wind_Long1L

RIGID FRAME: BASIC COLUMN REACTIONS (kN,kN-m)

Frame Line	Column Line	Dead			Collateral			Live			Wind_Left1		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	1.3	7.5	-2.07	0.5	1.7	-0.81	5.4	19.3	-9.17	-17.1	-25.5	39.42
1*	A	-1.3	7.5	2.08	-0.5	1.7	0.81	-5.4	19.3	9.22	-9.4	-12.1	25.08
1*	B	0.0	10.7	0.00	0.0	3.3	0.00	-0.8a	37.2	0.00	0.0	-34.9	0.00

Frame Line	Column Line	Wind_Right1			Wind_Left2			Wind_Right2			Wind_Press		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	9.4	-12.0	-25.14	-20.5	-18.1	42.71	6.0	-4.7	-21.85	0.0	0.0	0.00
1*	A	17.1	-25.4	-39.45	-6.0	-4.7	21.80	20.5	-18.1	-42.72	0.0	0.0	0.00
1*	B	0.0	-34.9	0.00	0.0	-23.1	0.00	0.0	-23.1	0.00	-27.8a	0.0	0.00

Frame Line	Column Line	Wind_Suct			Wind_Long1			Wind_Long2			Seismic_Left		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	0.0	0.0	0.00	4.8	-17.4	-3.62	1.3	-10.1	-0.33	-1.3	-0.2	8.20
1*	A	0.0	0.0	0.00	-4.8	-17.4	3.58	-1.3	-10.1	0.31	-1.3	0.2	8.20
1*	B	32.6a	0.0	0.00	0.0	-29.3	0.00	0.0	-17.5	0.00	0.0	0.0	0.00

Frame Line	Column Line	Seismic_Right			Temp			F1CRANE1			F1CRANE2		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	1.3	0.2	-8.20	0.9	0.4	-4.92	0.3	59.3	27.94	8.1	60.0	-11.21
1*	A	1.3	-0.2	-8.20	-0.9	0.4	4.92	-8.1	18.1	36.23	-0.3	17.4	-2.91
1*	B	0.0	0.0	0.00	0.0	-0.7	0.00	0.0	-0.7	0.00	0.0	-0.7	0.00

Frame Line	Column Line	F1CRANE3			F1CRANE4			LWIND1_L2E			LWIND1_R2E		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	0.3	17.4	3.01	8.1	18.1	-36.14	-0.2	-5.1	-3.83	-0.8	0.0	5.34
1*	A	-8.1	60.0	11.28	-0.3	59.3	-27.86	0.8	0.0	-5.35	0.2	-5.1	3.82
1*	B	0.0	-0.7	0.00	0.0	-0.7	0.00	0.0	-0.4	0.00	0.0	-0.5	0.00

Frame Line	Column Line	LWIND2_L2E			LWIND2_R2E			F1PAT_LL_1			F1PAT_LL_2		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	-0.2	-5.1	-3.83	-0.8	0.0	5.34	2.7	21.4	16.52	2.7	-2.1	-25.69
1*	A	0.8	0.0	-5.35	0.2	-5.1	3.82	-2.7	-2.1	25.73	-2.7	21.4	-16.51
1*	B	0.0	-0.4	0.00	0.0	-0.5	0.00	0.0	18.4	0.00	0.0	18.8	0.00

Frame Line	Column Line	Dead			Collateral			Live			Wind_Left1		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	5.8	12.2	-12.93	2.1	3.4	-4.76	24.0	39.0	-53.97	-27.0	-31.6	69.23
2*	A	-5.8	12.2	12.98	-2.1	3.4	4.78	-24.0	39.0	54.20	-0.1	-22.5	3.10

Frame Line	Column Line	Wind_Right1			Wind_Left2			Wind_Right2			Wind_Long1		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.1	-22.5	-3.25	-27.5	-18.0	62.31	-0.4	-8.9	-10.16	-9.6	-48.3	31.21
2*	A	27.0	-31.6	-69.39	0.4	-8.9	10.09	27.5	-18.0	-62.40	9.6	-48.6	-31.39

Frame Line	Column Line	Wind_Long2			Seismic_Left			Seismic_Right			Seismic_Long1		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	-7.3	-34.6	20.51	-1.2	-0.2	7.15	1.2	0.2	-7.15	0.0	-2.0	0.00
2*	A	7.3	-35.0	-20.61	-1.2	0.2	7.16	1.2	-0.2	-7.16	0.0	-2.0	0.00

Frame Line	Column Line	Seismic_Long2			Temp			F2CRANE1			F2CRANE2		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.0	2.0	0.00	0.5	0.0	-4.00	0.2	62.1	27.37	8.2	63.1	-10.76
2*	A	0.0	2.0	0.00	-0.5	0.0	4.00	-8.2	20.4	34.57	-0.2	19.5	-3.57

Frame Line	Column Line	F2CRANE3			F2CRANE4			LWIND1_L2E			LWIND1_R2E		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.2	19.5	3.66	8.2	20.4	-34.47	-0.4	-5.4	-3.36	-1.0	-0.3	5.94
2*	A	-8.2	63.1	10.83	-0.2	62.2	-27.31	1.0	-0.3	-5.95	0.4	-5.4	3.36

Frame Line	Column Line	LWIND2_L2E			LWIND2_R2E								
		Horz	Vert	Mom	Horz	Vert	Mom						
2*	C	-0.4	-5.4	-3.36	-1.0	-0.3	5.94						
2*	A	1.0	-0.3	-5.95	0.4	-5.4	3.36						

1* Frame lines: 1 7

2* Frame lines: 2 3 4 5 6

a - Out-Of-Plane Horizontal Load

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Dia	Base_Plate (mm)			Grout (mm)	
				Width	Length	Thick		
1*	C	8	20	200	705	16	0	Moment connection. See table.
1*	A	8	20	200	705	16	0	
1*	B	4	20	200	450	16	0	

1* Frame lines: 1 7

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Dia	Base_Plate (mm)			Grout (mm)	
				Width	Length	Thick		
2*	C	8	20	200	705	16	0	Moment connection. See table.
2*	A	8	20	200	705	16	0	

2* Frame lines: 2 3 4 5 6

BUILDING BRACING REACTIONS

Loc	Wall Line	Col Line	Reactions in plane of wall		Panel Shear (N/m)	Note
			Wind Horz	Seismic Horz		
L_EW	1					(h)
F_SW	A	2,3 5,6	*	12.2	2.0	
R_EW	7					(h)
B_SW	C	6,5 3,2	*	11.9	2.0	

(h)Rigid frame at endwall

*See RF reactions table for vertical and horizontal reactions in plane of the rigid frame.

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored



RECLA

NOTE-THE DRAWING ARE INTENDED SOLELY FOR APPROVAL PURPOSES. CERTAIN PARTS OR DIMENSIONS MAY NOT BE TO SCALE AND THEREFORE MUST NOT BE USED FOR CONSTRUCTION OR ANY OTHER PURPOSE				
RECLA INTERNATIONALS PRIVATE LIMITED				
PROJECT	SHED			
ID	C323-153		DESIGN: AAB	DRAFT: AAB
PROJECT	PUNE		DATE: 18/JULY/2025	
ADDRESS			C323-153_A03	