
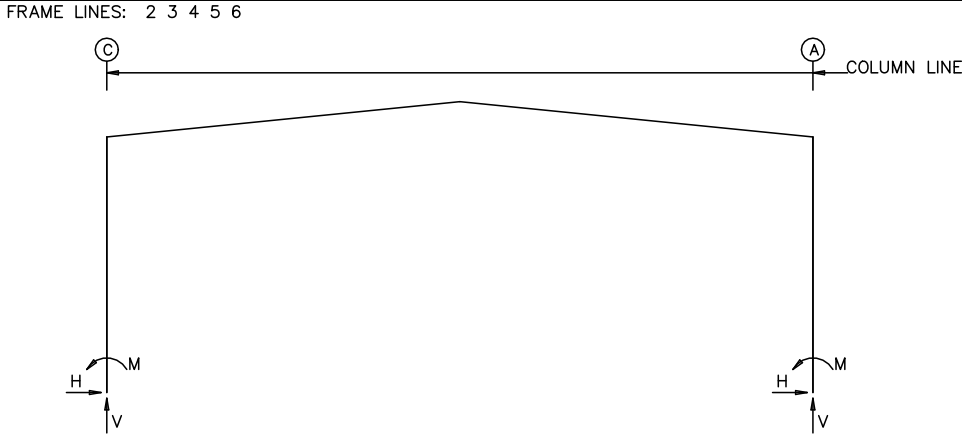


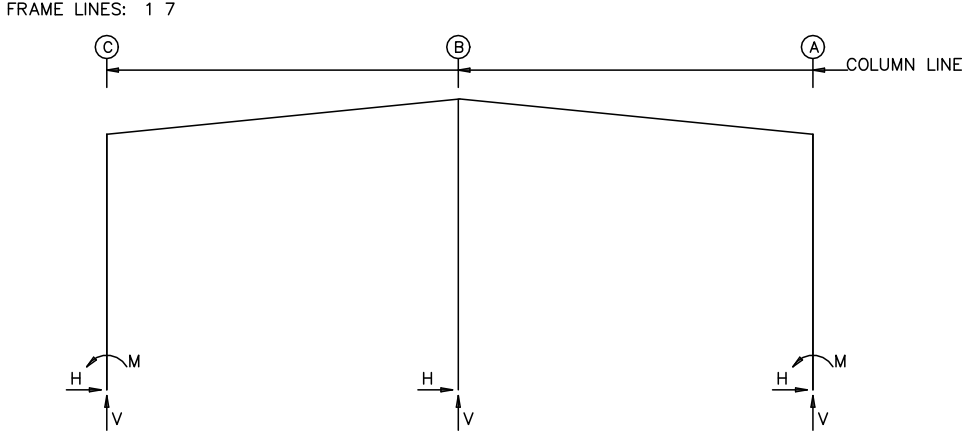

NOTES FOR REACTIONS

- All loading conditions are examined and only maximum/minimum H or V and the corresponding H or V are reported.
- Positive reactions are as shown in the sketch. Foundation loads are in opposite directions.
- Bracing reactions are in the plane of the brace with the H pointing away from the braced bay. The vertical reaction is downward.
- Building reactions are based on the following building data:

Width (mm)= 22470

Length (mm)= 35390

Eave Height (mm)= 8170/ 8170

Roof Slope (rise/100) =10.00/10.00

Roof Dead Load (kN/m2) = 0.10

Wall Dead Load

Left Endwall (kN/m2) = 0.10

Right Endwall (kN/m2) = 0.10

Front Sidewall (kN/m2) = 0.10

Back Sidewall (kN/m2) = 0.10

Live Load (kN/m2) = 0.57

Collateral Load (kN/m2) = 0.05

Wind Speed (m/s) = 39.0

Wind Code =MBMA10

Exposure =B

Closure =Enclosed

Internal Wind Coeff =-0.18, +0.18

Risk Category =-

Importance - Wind = 1.00

Importance - Seismic = 1.00

Seismic Design Category =B

Seismic Coeff (Sms) = 0.16

Temperature Change = 20
- Loading conditions are:

1 Dead+Collateral+Live

2 Dead+Collateral+0.75Live+0.75Wind_Right2+0.75Floor_Live

3 Dead+Collateral+0.75Live+0.75Wind_Long2L+0.75Floor_Live+0.75LWIND2_L2E

4 0.6Dead+Wind_Left1

5 0.6Dead+Wind_Right1

6 0.6Dead+Wind_Left2

7 0.6Dead+Wind_Right2

8 0.6Dead+Wind_Long1L+LWIND1_L2E

9 0.6Dead+Wind_Long1L+LWIND1_R2E

10 Dead+Collateral+F1CRANEA2

11 Dead+Collateral+F1CRANEA3

12 Dead+Wind_Left1/2+F1CRANEA1

13 Dead+Wind_Right1/2+F1CRANEA4

14 Dead+Collateral+F2CRANEA2

15 Dead+Collateral+F2CRANEA3

16 0.6Dead+Wind_Right1+Wind_Suction

17 0.6Dead+Wind_Pressure+Wind_Long1L

RIGID FRAME: BASIC COLUMN REACTIONS (kN,kN-m)

Frame Line	Column Line	---Dead---			---Collateral---			---Live---			---Wind_Left1---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	1.3	7.5	-2.07	0.5	1.7	-0.81	5.4	19.3	-9.17	-17.1	-25.5	39.42
1*	A	-1.3	7.5	2.08	-0.5	1.7	0.81	-5.4	19.3	9.22	-9.4	-12.1	25.08
1*	B	0.0	10.7	0.00	0.0	3.3	0.00	-0.8a	37.2	0.00	0.0	-34.9	0.00

Frame Line	Column Line	---Wind_Right1---			---Wind_Left2---			---Wind_Right2---			---Wind_Press---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	9.4	-12.0	-25.14	-20.5	-18.1	42.71	6.0	-4.7	-21.85	0.0	0.0	0.00
1*	A	17.1	-25.4	-39.45	-6.0	-4.7	21.80	20.5	-18.1	-42.72	0.0	0.0	0.00
1*	B	0.0	-34.9	0.00	0.0	-23.1	0.00	0.0	-23.1	0.00	-27.8a	0.0	0.00

Frame Line	Column Line	---Wind_Suct---			---Wind_Long1---			---Wind_Long2---			---Seismic_Left---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	0.0	0.0	0.00	4.8	-17.4	-3.62	1.3	-10.1	-0.33	-1.3	-0.2	8.20
1*	A	0.0	0.0	0.00	-4.8	-17.4	3.58	-1.3	-10.1	0.31	-1.3	0.2	8.20
1*	B	32.6a	0.0	0.00	0.0	-29.3	0.00	0.0	-17.5	0.00	0.0	0.0	0.00

Frame Line	Column Line	---Seismic_Right---			---Temp---			---F1CRANEA1---			---F1CRANEA2---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	1.3	0.2	-8.20	0.9	0.4	-4.92	0.3	59.3	27.94	8.1	60.0	-11.21
1*	A	1.3	-0.2	-8.20	-0.9	0.4	4.92	-8.1	18.1	36.23	-0.3	17.4	-2.91
1*	B	0.0	0.0	0.00	0.0	-0.7	0.00	0.0	-0.7	0.00	0.0	-0.7	0.00

Frame Line	Column Line	---F1CRANEA3---			---F1CRANEA4---			---LWIND1_L2E---			---LWIND1_R2E---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	0.3	17.4	3.01	8.1	18.1	-36.14	-0.2	-5.1	-3.83	-0.8	0.0	5.34
1*	A	-8.1	60.0	11.28	-0.3	59.3	-27.86	0.8	0.0	-5.35	0.2	-5.1	3.82
1*	B	0.0	-0.7	0.00	0.0	-0.7	0.00	0.0	-0.4	0.00	0.0	-0.5	0.00

Frame Line	Column Line	---LWIND2_L2E---			---LWIND2_R2E---			---F1PAT_LL_1---			---F1PAT_LL_2---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
1*	C	-0.2	-5.1	-3.83	-0.8	0.0	5.34	2.7	21.4	16.52	2.7	-2.1	-25.69
1*	A	0.8	0.0	-5.35	0.2	-5.1	3.82	-2.7	-2.1	25.73	-2.7	21.4	-16.51
1*	B	0.0	-0.4	0.00	0.0	-0.5	0.00	0.0	18.4	0.00	0.0	18.8	0.00

Frame Line	Column Line	---Dead---			---Collateral---			---Live---			---Wind_Left1---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	5.8	12.2	-12.93	2.1	3.4	-4.76	24.0	39.0	-53.97	-27.0	-31.6	69.23
2*	A	-5.8	12.2	12.98	-2.1	3.4	4.78	-24.0	39.0	54.20	-0.1	-22.5	3.10

Frame Line	Column Line	---Wind_Right1---			---Wind_Left2---			---Wind_Right2---			---Wind_Long1---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.1	-22.5	-3.25	-27.5	-18.0	62.31	-0.4	-8.9	-10.16	-9.6	-48.3	31.21
2*	A	27.0	-31.6	-69.39	0.4	-8.9	10.09	27.5	-18.0	-62.40	9.6	-48.6	-31.39

Frame Line	Column Line	---Wind_Long2---			---Seismic_Left---			---Seismic_Right---			---Seismic_Long1---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	-7.3	-34.6	20.51	-1.2	-0.2	7.15	1.2	0.2	-7.15	0.0	-2.0	0.00
2*	A	7.3	-35.0	-20.61	-1.2	0.2	7.16	1.2	-0.2	-7.16	0.0	-2.0	0.00

Frame Line	Column Line	---Seismic_Long2---			---Temp---			---F2CRANEA1---			---F2CRANEA2---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.0	2.0	0.00	0.5	0.0	-4.00	0.2	62.1	27.37	8.2	63.1	-10.76
2*	A	0.0	2.0	0.00	-0.5	0.0	4.00	-8.2	20.4	34.57	-0.2	19.5	-3.57

Frame Line	Column Line	---F2CRANEA3---			---F2CRANEA4---			---LWIND1_L2E---			---LWIND1_R2E---		
		Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom	Horz	Vert	Mom
2*	C	0.2	19.5	3.66	8.2	20.4	-34.47	-0.4	-5.4	-3.36	-1.0	-0.3	5.94
2*	A	-8.2	63.1	10.83	-0.2	62.2	-27.31	1.0	-0.3	-5.95	0.4	-5.4	3.36

Frame Line	Column Line	---LWIND2_L2E---			---LWIND2_R2E---								
		Horz	Vert	Mom	Horz	Vert	Mom						
2*	C	-0.4	-5.4	-3.36	-1.0	-0.3	5.94						
2*	A	1.0	-0.3	-5.95	0.4	-5.4	3.36						

1* Frame lines: 1 7

2* Frame lines: 2 3 4 5 6

a - Out-Of-Plane Horizontal Load

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Dia	Base_Plate (mm)			Grout (mm)	
				Width	Length	Thick		
1*	C	8	20	200	705	16	0	Moment connection. See table.
1*	A	8	20	200	705	16	0	
1*	B	4	20	200	450	16	0	

1* Frame lines: 1 7

RIGID FRAME: ANCHOR BOLTS & BASE PLATES

Frm Line	Col Line	Anc. Bolt Qty	Dia	Base_Plate (mm)			Grout (mm)	
				Width	Length	Thick		
2*	C	8	20	200	705	16	0	Moment connection. See table.
2*	A	8	20	200	705	16	0	

2* Frame lines: 2 3 4 5 6

BUILDING BRACING REACTIONS

Loc	Wall Line	Col Line		Reactions in plane of wall		Panel Shear (N/m)	Note
				Wind Horz	Seismic Horz		
L_EW	1						(h)
F_SW	A	2,3	*	12.2	2.0		
		5,6	*	12.2	2.0		
R_EW	7						(h)
B_SW	C	6,5	*	11.9	2.0		
		3,2	*	11.9	2.0		

(h)Rigid frame at endwall

*See RF reactions table for vertical and horizontal reactions in plane of the rigid frame.

Reactions for seismic represent shear force, Eh
Reaction values shown are unfactored



RECLA

NOTE-THE DRAWING ARE INTENDED SOLELY FOR APPROVAL PURPOSES. CERTAIN PARTS OR DIMENSIONS MAY NOT BE TO SCALE AND THEREFORE MUST NOT BE USED FOR CONSTRUCTION OR ANY OTHER PURPOSE				
RECLA INTERNATIONALS PRIVATE LIMITED				
PROJECT	SHED			
ID	C323-153		DESIGN: AAB	DRAFT: AAB
PROJECT	PUNE		DATE: 7/AUG/2025	
ADDRESS			C323-153_A03	