


HWACO

PRESSED STEEL & STAINLESS STEEL
SECTIONAL TANKS



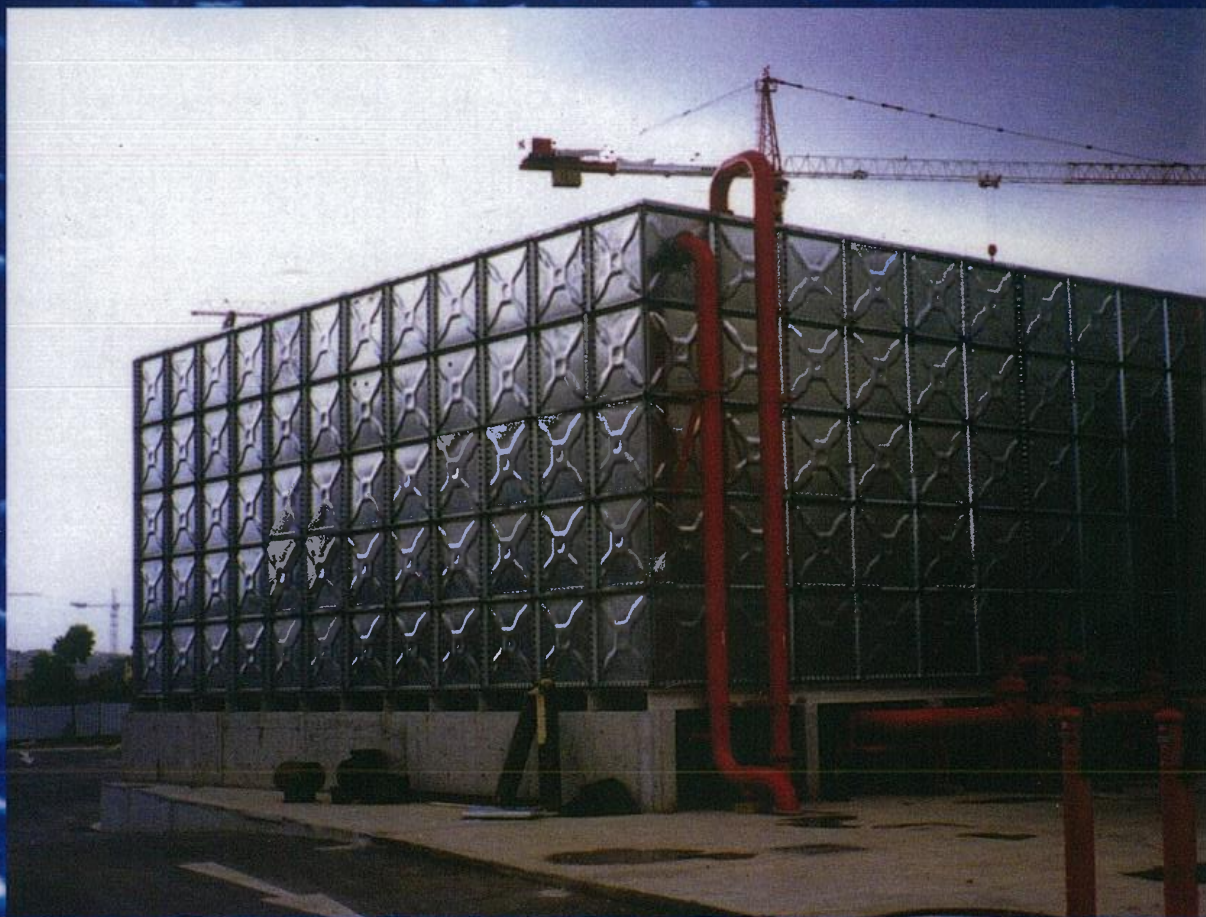

HWACO PRESSED STEEL SECTIONAL WATER TANKS

GENERAL SPECIFICATIONS

STANDARD :

HWACO PRESSED STEEL SECTIONAL WATER TANK (RECTANGULAR) CONSTRUCTED WITH HYDRAULICALLY PRESSED FLANGED PANELS, CONFORM TO SINGAPORE STANDARD 22 : 1979.

MATERIALS :

THE STEEL USED IN THE MANUFACTURE OF THE PLATES, STAYS, CLEATS CONFORM TO THE REQUIREMENTS OF EN 10025 S275JR

STAYS AND CLEATS :

THE SIDES AND ENDS OF ALL TANKS SHALL BE SUPPORTED BY STAYS AT THE JUNCTION OF TWO OR MORE PLATES. THE STAYS SHALL BE MADE FROM MILD STEEL ROLLED SECTIONS OR MILD STEEL ANGLES. CLEATS ARE MADE FROM MILD STEEL PLATES.

BOLTS AND NUTS ;

HOT DIPPED GALVANISED STEEL BOLTS, NUTS AND WASHERS.

JOINTING COMPOUNDS :

PVC FOAM SEALANT ARE SUPPLIED FOR JOINTING BETWEEN FLANGES.

COVERS :

COVERS ARE 1.5MM THICK, SUPPORTED BY COVER STRUCTURES OR POLES.

FINISH :

- HWACO SHOPCOAT, RED OXIDE PRIMER
- BLACK BITUMINOUS PAINT
- HOT DIPPED GALVANISED
- EPOXY COATING

DIMENSION :

THE NOMINAL SIZE OF UNIT PLATES SHALL BE 4 FT. (1.22M) SQUARE. THE SIZE OF THE TANKS SHALL BE SPECIFIED AS MULTIPLES OF THE NOMINAL DIMENSIONS OF 4 FT. (1.22M). THE NOMINAL CAPACITY SHALL BE BASED UPON THE NOMINAL DIMENSIONS OF THE TANK.
(E.G. 1.22M X 1.22M X 1.22M EQUALS 400 GALLONS)

THICKNESS OF THE TANK PANEL : HWACO TANK 1.22M X 1.22M PANEL

TANK HEIGHT	1.22 M	2.44 M	3.66 M	4.88 M
BASE PANEL	5.0 MM	5.0 MM	5.0 MM	6.0 MM
1ST TIER PANEL	5.0 MM	5.0 MM	5.0 MM	6.0 MM
2ND TIER PANEL		5.0 MM	5.0 MM	5.0 MM
3RD TIER PANEL			5.0 MM	5.0 MM
4TH TIER PANEL				5.0 MM
COVER PANEL	1.5 MM	1.5 MM	1.5 MM	1.5 MM

THICKNESS OF THE TANK PANEL : HWACO TANK 1.0M X 1.0M PANEL

TANK HEIGHT	1.0 M	2.0 M	3.0 M	4.0 M	5.0 M
BASE PANEL	5.0 MM	5.0 MM	5.0 MM	5.0 MM	6.0 MM
1ST TIER PANEL	5.0 MM	5.0 MM	5.0 MM	5.0 MM	6.0 MM
2ND TIER PANEL		5.0 MM	5.0 MM	5.0 MM	5.0 MM
3RD TIER PANEL			5.0 MM	5.0 MM	5.0 MM
4TH TIER PANEL				5.0 MM	5.0 MM
5TH TIER PANEL					5.0 MM
COVER PANEL	1.5 MM	1.5 MM	1.5 MM	1.5 MM	1.5 MM




12m x 12m x 5m



28m x 6m x 3m




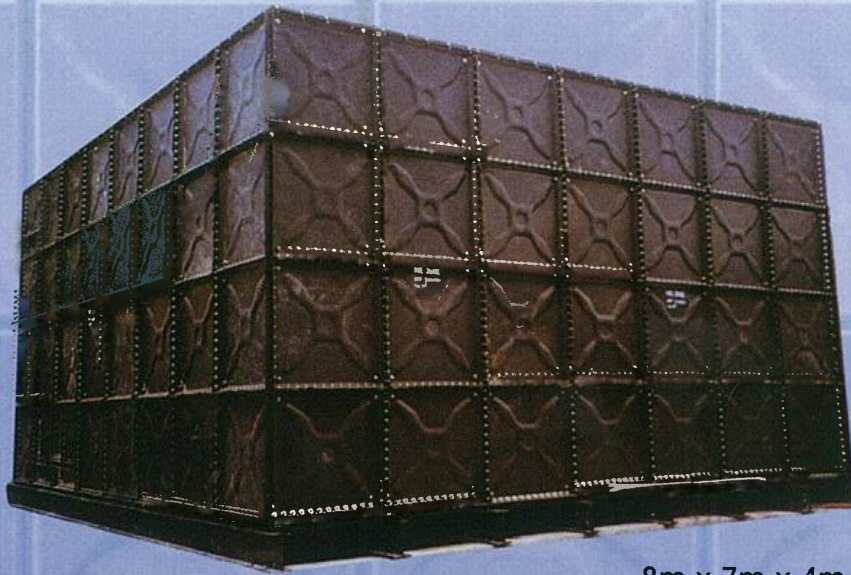

8m x 7m x 4m



64' x 32' x 8'

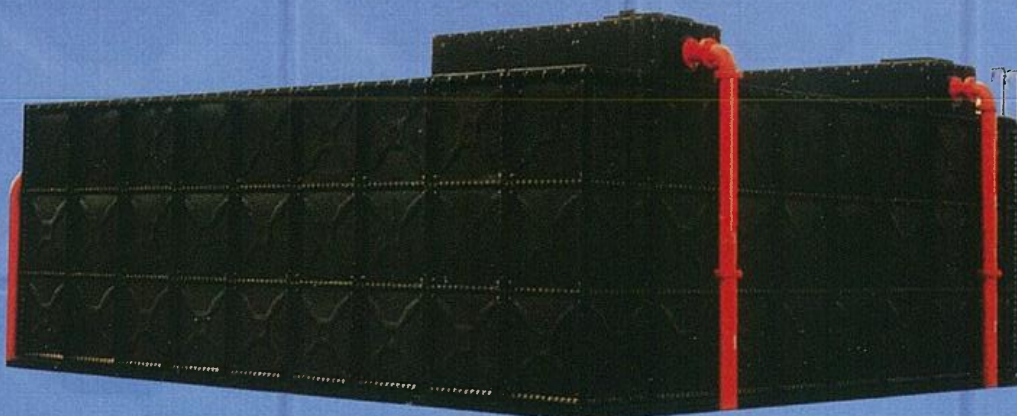

9m x 8m x 3m



1m x 1m x 1m



17m x 8m x 5m



PANEL TYPE COVER & BALL VALVE BOX (TOP SUMP)



BOTTOM SUMP



HWACO PRESSED STAINLESS STEEL SECTIONAL WATER TANKS

GENERAL SPECIFICATIONS

STANDARD :

HWACO PRESSED STAINLESS STEEL SECTIONAL WATER TANK ARE FABRICATED WITH HYDRAULICALLY PRESSED FLANGED PANELS.

MATERIALS :

THE WATER TANK PANELS, ANGLE STAYS AND CLEATS ARE MADE FROM STAINLESS STEEL CONFORMING TO AMERICAN IRON AND STEEL INSTITUTE (AISI) GRADE 316 OR GRADE 304. GRADE OF STAINLESS STEEL TO BE SPECIFIED BY BUYER.

STAYS AND CLEATS :

ALL TANKS ARE INTERNALLY BRACED WITH ANGLE STAYS TO ENSURE RIGIDITY WHEN FILLED WITH WATER.

BOLTS, NUTS AND WASHERS :

(A) ALL BOLTS, NUTS AND WASHERS IN CONTACT WITH WATER CONTAINED WITHIN THE TANK SHALL BE OF STAINLESS STEEL CONFORMING TO AISI 316.

(FOR STAINLESS STEEL GRADE 316 THICK ONLY)

(B) ALL BOLTS, NUTS AND WASHERS FOR THE TANK EXTERNAL FLANGES ARE STAINLESS STEEL AISI 304.

JOINTING COMPOUNDS :

NON TOXIC PVC / PE FOAM SHALL BE SUPPLIED FOR JOINTING BETWEEN FLANGES AND JOINTING OF CLEATS.

COVERS :

STAINLESS STEEL GRADE 316 COVER FOR TANK ARE SUPPLIED IN PANEL FORM OF 1.5MM THICKNESS.

PIPE CONNECTION :

WELDED SOCKETS OR HOLES CUT ON PANELS ARE PROVIDED FOR THREADED PIPING OR FLANGED PIPING CONNECTIONS.

LADDERS AND LEVEL INDICATOR :

INTERNAL CATLADDER SHALL BE MADE OF GRADE 304 STAINLESS STEEL AND EXTERNAL CATLADDER SHALL BE MADE OF ALUMINIUM. LEVEL INDICATOR SHALL BE OF VISUAL TUBE TYPE.

DIMENSION :

HWACO PRESSED STAINLESS STEEL SECTIONAL WATER TANK PANEL COMES IN 2 NOMINAL SIZES OF 1.22M (4 FT) SQUARE AND 1.0M SQUARE.

THICKNESS OF THE TANK PANEL : HWACO TANK 1.22M X 1.22M PANEL

TANK HEIGHT	1.22 M	2.44 M	3.66 M	4.88 M
BASE PANEL	2.5 MM	2.5 MM	4.0 MM	5.0 MM
1ST TIER PANEL	2.5 MM	2.5 MM	4.0 MM	5.0 MM
2ND TIER PANEL		2.5 MM	2.5 MM	4.0 MM
3RD TIER PANEL			2.5 MM	2.5 MM
4TH TIER PANEL				2.5 MM
COVER PANEL	1.5 MM	1.5 MM	1.5 MM	1.5 MM

THICKNESS OF THE TANK PANEL : HWACO TANK 1.0M X 1.0M PANEL

TANK HEIGHT	1.0 M	2.0 M	3.0 M	4.0 M	5.0 M
BASE PANEL	2.5 MM	2.5 MM	3.0 MM	4.0 MM	5.0 MM
1ST TIER PANEL	2.5 MM	2.5 MM	3.0 MM	4.0 MM	5.0 MM
2ND TIER PANEL		2.5 MM	2.5 MM	3.0 MM	4.0 MM
3RD TIER PANEL			2.5 MM	2.5 MM	3.0 MM
4TH TIER PANEL				2.5 MM	2.5 MM
5TH TIER PANEL					2.5 MM
COVER PANEL	1.5 MM	1.5 MM	1.5 MM	1.5 MM	1.5 MM


NOTE: THICKER MATERIALS ARE AVAILABLE. PLEASE SPECIFY THICKNESS ON ENQUIRY.



2m x 2m x 2m



15m x 8m x 3m

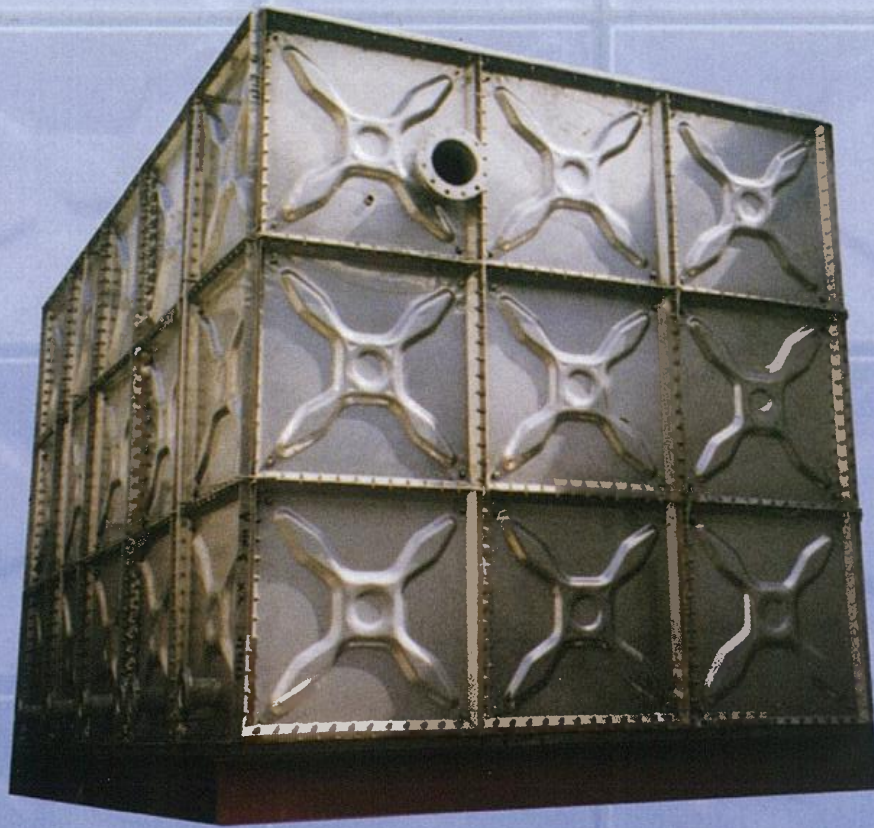

5m x 3m x 3m



12.2m x 4.88m x 2.44m



HWACO PRESSED STEEL & STAINLESS STEEL TANKS

ERECTION INSTRUCTION

1. BEFORE STARTING TO ASSEMBLE THE TANK, PLEASE ENSURE THAT THE SUPPORTS (JOISTS, DWARF WALLS OR OTHER MEANS OF SUPPORTS) ARE LEVELLED AND SPACED ACCORDINGLY.
2. LAYOUT THE BOTTOM PANELS WITH THE FLANGES DOWNWARDS ON THE SUPPORT. LEAVE ABOUT 50MM BETWEEN EACH PANEL, USE THE PVC FOAM SEALANT TO STICK ON THE JOINTING FLANGE OF ONE PANEL AND BRING THE TWO PANELS TOGETHER, PUT THE BOLTS TO THE FLANGE HOLES AND SCREW THE NUTS WITH WASHERS.


DO NOT TIGHTEN YET

3. REPEAT THE ABOVE PROCEDURE ON THE NEXT PANEL UNTIL THE TANK BOTTOM IS COMPLETED. AFTER COMPLETING THE BOTTOM PANELS, CONTINUE THE SAME PROCEDURE TO THE FIRST TIER SIDE PANELS AND THEN THE SECOND TIER SIDE PANELS.
4. PVC FOAM SEALANT TO BE PUT ON THE JOINT JUNCTION BEFORE PUTTING ON THE CLEATS. FOR EACH CLEAT, FIX THE BOLT INSIDE THE TANK AND SCREW ON THE NUT WITH WASHER OUTSIDE THE TANK AND TIGHTEN. FOR CLEATS POSITION PLEASE REFER TO DRAWING.
5. CONNECT THE ANGLE STAYS TO THE CLEATS AS INDICATED IN THE MARKING PLAN, BUT DO NOT TIGHTEN UNTIL ALL THE ANGLE STAYS ARE IN POSITION.
6. AFTER ALL THE PLATES AND STAYS HAVE BEEN ASSEMBLED, TIGHTEN THE BOLTS & NUTS, COMMENCING WITH THOSE IN THE TANK BOTTOM FOLLOWED IN TURN BY THOSE ON EACH SIDE.

GENERAL PRINCIPLES

1. CLEARANCE BETWEEN GROUND AND TANK BOTTOM SHOULD BE A MINIMUM OF 600MM TO ALLOW ACCESS OF MAN TO FASTEN BOLTS AND NUTS.
2. THERE IS ALWAYS A CLEAT AT JOINT JUNCTION INSIDE THE TANK.
3. THERE IS ALWAYS A STAY RUNNING FROM JOINT JUNCTION INSIDE THE TANK.
4. ALL STAYS AND CLEATS TO BE BOLTED IN BEFORE COMMENCING GENERAL TIGHTENING.
5. TO PREVENT LEAKAGE, PLEASE ENSURE THAT ADEQUATE SIZE PVC FOAM IS USED ON EACH JOINT JUNCTION BEFORE THE CLEAT IS FASTENED.

Example A 4 m (L) x 3 m (W) Water Tank
Steel Beam And Concrete Plinth Layout

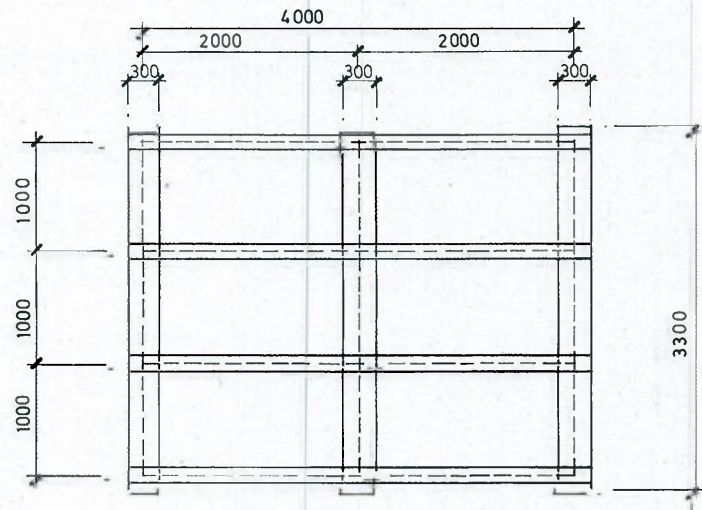


PLAN




ELEVATION


Example B 4.88 m (L) x 3.66 m (W) Water Tank
Steel Beam And Concrete Plinth Layout

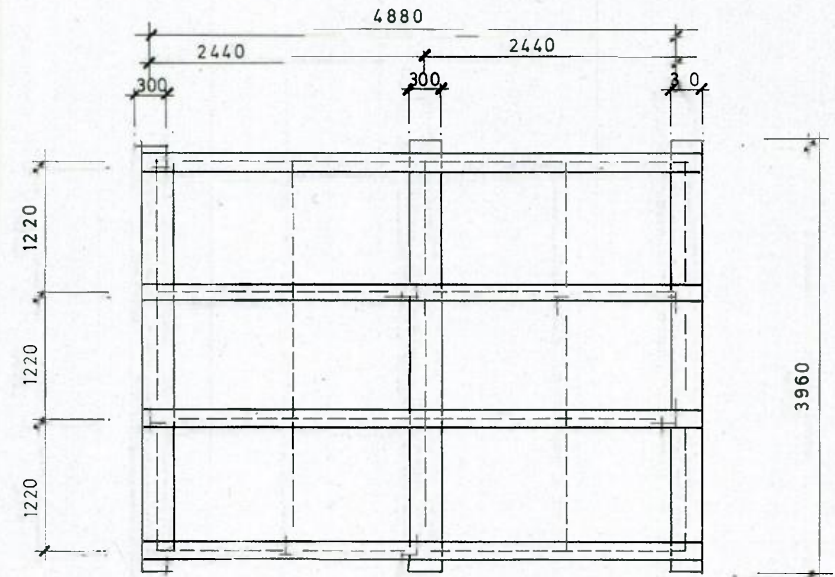

PLAN



ELEVATION



Hwa Yew Iron Works Pte. Ltd.

17 Mandai Estate, #02-01, Hwa Yew Industrial Building, Singapore 729934

Tel: (65) 6366 8118 Fax: (65) 6366 8133

Email: contact_us@hwaco.com.sg

www.hwaco.com.sg

TEST REPORT

(This Report is issued subject to the terms & conditions set out below)

Setsco Services Pte Ltd
 18 Teban Gardens Crescent
 Singapore 608925
 Tel : (65) 6566 7777
 Fax: (65) 6566 7718
 www.setsco.com
 Business Reg. No. 196900269D

Date: 31 August 2020

Your Ref: Letter dated 26-Aug-20

Our Ref: MM-8500121526/CKT

Page 1 of 4

Subject : Testing of "HWACO" brand Pressed Carbon Steel Panel submitted by Hwa Yew Iron Works Pte Ltd on 27 August 2020.

Tested for : **HWA YEW IRON WORKS PTE LTD**
 17 Mandai Estate, #02-01
 Hwa Yew Industrial Building
 Singapore 729934

Attn: Mr. Randy Goh

Date & Place of Test : 29 August 2020 at Setsco Laboratory.

Method of Test : BS EN 10025-2: 2004 - Reduced Section Tensile Test (ISO 6892-1: 2016)
 - Chemical Composition (ASTM E415-17)

Description of Sample : Two (02) pieces of "HWACO" brand Pressed Carbon Steel Panel said to be Grade S275JR were received as follows:

S/No.	Description	Qty
01	Steel Plate 1m x 1m x 5.0mm thk	01
02	Steel Plate 1.22m x 1.22m x 5.0mm thk	01

Terms & Conditions:

- (1) The Report is prepared for the sole use of the Client and is prepared based on the information provided by the Client. The Report is not intended to be representative of similar or equivalent Services on similar or equivalent items. The Report does not constitute an endorsement by SETSCO of the item.
- (2) SETSCO agrees to use reasonable diligence in the performance of the Services but no warranties are given and done may be implied directly or indirectly relating to the Services, the Report or the facilities of SETSCO.
- (3) SETSCO shall under no circumstances be liable to the Client or its agents, servants or representatives, in contract, tort (including negligence or breach of statutory duty) or otherwise for any direct or indirect loss or damage suffered by the Client, its agents, servants or representative howsoever arising or whether connected with the Services provided by SETSCO herein.
- (4) The Report may not be used in any publicity material without the written consent of SETSCO.
- (5) The Report shall not be reproduced in part or in full unless approval in writing has been given by SETSCO.



LA-1993-0051-C LA-1998-0144-D
 LA-1993-0067-G LA-2000-0181-F
 LA-1994-0068-A LA-2012-0519-E
 LA-1987-0001-B LA-1987-0001-B-1

Results

:

1. Reduced Section Tensile Test

The tested samples met the requirements of Grade S275JR of BS EN 10025-2: 2004 specifications Refer to Tables 1 attached.

2. Chemical Composition

The tested samples met the requirements of Grade S275JR of BS EN 10025-2: 2004 specifications Refer to Tables 2 attached.



CHEW KENG TIONG
Testing Officer



ELIAS BIN YEASON
Executive Chemist
Biological & Chemical Technology Division



TEE SENG THIAM
Engineer (Mechanical Testing)
Mechanical Technology Division

Hwa Yew Iron Works Pte Ltd Press Steel Sectional Water Tank Job Reference 2022

Year	Project	Coating	Tank Size	Unit	Deliver Date
2022	5 Stry Research & Development Building @ Prince George's Park	P&B	1m x 1m x 2mH	1	15-Nov-22
2022	Pullman Hotel @ Hill Street	P&B	1m x 1m x 2mH	1	15-Nov-22
2022	Mainnt, 40 Penjuru Lane	P&B	2(1+1)m x 1m x 2mH	1	15-Nov-22
2022	SAFRA @ Chua Chu Kang Park	HDG	1.22m x 1.22m x 1.83mH	1	28-Sep-22
2022	5 Stry Research & Development Building @ Prince George's Park	P&B	9(4+5)m x 7m x 4mH c/w Z Partition	1	23-Sep-22
2022	Tampines North Polyclinic @ 51 Tampines Street 61	P&B	2(1+1)m x 1m x 2mH	1	21-Sep-22
2022	Singapore Island Country Club (SICC) @ 240 Sime Road S(288303)	P&B	2(1+1)m x 1m x 2mH	1	16-Sep-22
2022	Replace Sprinkler Tank at Singapore Land Tower, 50 Raffles Place	P&B	6m x 2.5m x 5.5mH	1	14-Sep-22
2021	Upper Circular Road	P&B	{{(2x2)m + (1x4)m} x 3.5mH	1	7-Sep-22
2022	Ready Mixed Concrete Ecosystem project @ Jurong Port	HDG	2(1+1)m x 1m x 2mH	1	1-Sep-22
2022	The Haus, 12 Stry Condo @ Handy Road / Mount Sophia	P&B	2m x 1m x 1mH	1	26-Aug-22
2022	The Gear @ Changi Business Park Crescent	P&B	1m x 1m x 2mH	1	25-Aug-22
2022	Dairy Resdience @ 8 Dairy Farm Lane	P&B	1m x 1m x 2mH	1	19-Aug-22
2022	102 Bedok North Ave 3	P&B	2m x 3m x 1mH	1	19-Aug-22
2022	20 Stry Hotel Dev. @ 24 Cuscaden Road	HDG	1m x 1m x 2mH	1	12-Aug-22
2020	SGA - Facebook @ Sunview Way	HDG	2m x 1m x 1mH	1	11-Aug-22
2022	New Condo (192 Units) @ Cuscaden Road	HDG	2(1+1)m x 1m x 2mH	1	3-Aug-22
2022	Church of Christ The King @ 2221 Ang Mo Kio Ave 8	HDG	1m x 1m x 2mH	1	3-Aug-22
2022	A&A Work to Bugis Valley @ 52 Queen Street / 1 to 5 and 7 New Bugis Street	Epoxy	1m x 1m x 2mH	1	28-Jul-22
2022	A&A Work to Bugis Valley @ 52 Queen Street / 1 to 5 and 7 New Bugis Street	Epoxy	(3+2)m x 5m x 2mH c/w Top & Bottom Sumps	1	28-Jul-22
2021	Urban Training Facility (UTF) @ 990 Old Choa Chu Kang Road	HDG	7.32(3.66+3.66)m x 9.76m x 4.88mH	1	27-Jul-22
2022	102 Bedok North Ave 3	P&B	1m x 1m x 2mH	1	26-Jul-22
2021	A&A To Existing 6 Stry Bldg @ Gombak Drive	P&B	8(4+4)m x 5m x 4mH	1	23-Jul-22
2022	298 River Valley Road	HDG	4(2+2)m x 2m x 1mH	1	19-Jul-22
2022	298 River Valley Road	HDG	2m x 1m x 1mH	1	19-Jul-22
2022	Replace Sprinkler Tank at Singapore Land Tower, 50 Raffles Place	P&B	3.5m x 5.5m x 2mH	1	12-Jul-22
2022	The Haus, 12 Stry Condo @ Handy Road / Mount Sophia	P&B	2m x 1m x 1mH	1	23-Jun-22
2022	Replace Hose Reel Tank @ Casa Esperanza, 995 Bukit Timah Rd	HDG	2(1+1)m x 1m x 2mH	1	17-Jun-22
2022	Replace Hose Reel Tank @ Casa Esperanza, 995 Bukit Timah Rd	HDG	2(1+1)m x 1m x 2mH	1	17-Jun-22
2020	SGA - Facebook @ Sunview Way	HDG	4(2+2)m X 10m X 4.5mH c/w Top Sumps	1	10-Jun-22
2022	Dairy Resdience @ 8 Dairy Farm Lane	P&B	1m x 1m x 2mH	1	3-Jun-22
2022	Dairy Resdience @ 8 Dairy Farm Lane	P&B	1m x 1m x 2mH	1	3-Jun-22
2022	50 Yishun Insutrial Park A	P&B	9(4+5)m x 3m x 4mH c/w Top Sumps	1	2-Jun-22
2020	MSB SW1a, SW2 & SW3	HDG	1m x 1m x 2mH - Tank 1	1	30-May-22
2021	24 New Industrial Road	HDG	2(1+1)m x 1m x 2mH	1	27-May-22
2021	Mount Alvenia Hospital New Building	HDG	8(4+4)m x 9m x 4mH	1	27-May-22
2022	Dairy Resdience @ 8 Dairy Farm Lane	P&B	1m x 1m x 2mH	1	25-May-22
2022	231 Kaki Bukit Ave 1	HDG	1.22m x 1.22m x 1.22mH	1	18-May-22
2022	Erection of 4 Blks of Multiple-User Industrial Factory @ Tai Seng Ave	HDG	2(1+1)m x 1m x 2mH	1	17-May-22
2022	Animal Dens, Yards and Ancillary Facilities @ 80 Mandai Lake Road	P&B	2(1+1)m x 1m x 1mH	1	17-May-22
2021	940 Old Choa Chu Kang Road	P&B	2(1+1)m x 1m x 1mH	1	13-Apr-22
2021	Home Team Club House @ Bedok North Road	HDG	2(1+1)m x 1m x 2mH	1	9-Apr-22
2021	TFS Merlion @ 31 Joo Koon Circle	HDG	12(6+6)m x 11m x 4.5mH c/w Top & Bottom Sumps	1	9-Apr-22
2022	Mercedes Benz Regional Logistics Centre @ 301 Jalan Ahmad Ibrahim	P&B	3m x 1m x 2mH	1	2-Apr-22

Year	Project	Coating	Tank Size	Unit	Deliver Date
2022	Mount Alvenia Hospital IOSC Building	HDG	1m x 1m x 2mH	1	25-Mar-22
2022	A&A to Thomson Plaza Shopping Mall @ Upper Thomson Road	P&B	2(1+1)m x 1m x 1mH	1	23-Mar-22
2021	Riviere Condo @ 1 Jiak Kim Street	P&B	7(3+4)m x 4m x 4mH c/w Top Sumps	1	17-Mar-22
2021	Riviere Condo @ 1 Jiak Kim Street	P&B	1m x 1m x 2mH	1	17-Mar-22
2022	National Skin Centre @ 1 Mandalay Rd, Singapore 308205	HDG	1m x 1m x 2mH	1	15-Mar-22
2021	1 Draycott Park	P&B	1m x 1m x 1.5mH	1	10-Mar-22
2021	Arena - 20 Guillemard Crescent	HDG	1m x 1m x 2mH	1	25-Feb-22
2019	Mont Botanik @ 1 Jalan Remaja	HDG	(1+1)m x 1m x 2mH	1	24-Feb-2022
2019	Mont Botanik @ 1 Jalan Remaja	HDG	(1+1)m x 1m x 2mH	1	24-Feb-2022
2022	200 Bukit Timah Road	P&B	2m x 1m x 1mH	1	23-Feb-22
2021	Pasir Panjang Wholesale Centre @ 1 Wholesale Centre S(110001)	HDG	8(4+4)m x 6m x 5mH	1	21-Feb-22
2022	Erection of 4 Blks of Multiple-User Industrial Factory @ Tai Seng Ave	HDG	2(1+1)m x 1m x 2mH	1	18-Feb-22
2022	Erection of 4 Blks of Multiple-User Industrial Factory @ Tai Seng Ave	HDG	2(1+1)m x 1m x 2mH	1	18-Feb-22
2012	5 Stry Chinese Temple (Soka Centre @ Sumsang Walk)	HDG	1.22m x 1.22m x 1.22mH	1	17-Feb-22
2022	Erection of 4 Blks of Multiple-User Industrial Factory @ Tai Seng Ave	HDG	2(1+1)m x 1m x 2mH	1	10-Feb-22
2020	JTC Multi-Storey Recycling Facility (MSRF) @ 18 Kranji Loop	HDG	1m x 1m x 2mH - Roof	1	8-Feb-22
2020	Pasir West Plaza @ 735 Pasir Ris Street 72	P&B	10.98(4.88+6.10)m x 4.88m x 3.66mH	1	28-Jan-22
2021	Hub Energy @ 70 Anson Road	P&B	8.5(4+4.5)m x 5m x 3mH c/w Top Sumps	1	27-Jan-22
2021	38 Genting Lane	P&B	6(3+3)m x 3m x 5mH	1	21-Jan-22
2021	Silat Condo @ 1 Silat Ave	P&B	1m x 1m x 2mH	1	19-Jan-22
2021	Silat Condo @ 1 Silat Ave	P&B	1m x 1m x 2mH	1	19-Jan-22
2021	Bayshore Park @ 60 Bayshore Road	HDG	4m x 3m x 2mH c/w Bottom Sumps	1	13-Jan-22
2021	Bayshore Park @ 60 Bayshore Road	HDG	(4m x 3m x 2mH)-(1m x 1m x 2mH) c/w Bottom Sumps	1	13-Jan-22
2021	UMC @ 170 Lorong 6 Toa Payoh	P&B	4(2+2)m x 5m x 3mH c/w Top Sumps	1	7-Jan-22
2021	Bayshore Park @ 60 Bayshore Road	HDG	4m x 3m x 2mH c/w Bottom Sumps	1	6-Jan-22
2021	Bayshore Park @ 60 Bayshore Road	HDG	(4m x 3m x 2mH)-(1m x 1m x 2mH) c/w Bottom Sumps	1	6-Jan-22
2021	Kallang Bahru Substation @ 250 Kallang Basin Singapore 339350	P&B	13(6+7)m x 4m x 4mH	1	5-Jan-22
2021	3 Cuscaden Walk	P&B	[(3m x 3m) - (1m x 1m)] x 3.5mH c/w Top Sumps	1	3-Jan-22
2021	Bayshore Park @ 60 Bayshore Road	HDG	4m x 3m x 2mH c/w Bottom Sumps	1	30-Dec-21
2021	Bayshore Park @ 60 Bayshore Road	HDG	(4m x 3m x 2mH)-(1m x 1m x 2mH) c/w Bottom Sumps	1	30-Dec-21
2021	Vimarikriti Buddhist Centre @ 20 Lorong 27A Geylang Road S(381112)	P&B	4(2+2)m x 9m x 3.5mH c/w Top Sumps	1	24-Dec-21
2021	Nil - Polyline	HDG	1m x 1m x 2mH	1	18-Dec-21
2021	Bayshore Park @ 60 Bayshore Road	HDG	4m x 3m x 2mH c/w Bottom Sumps	1	16-Dec-21
2021	Bayshore Park @ 60 Bayshore Road	HDG	(4m x 3m x 2mH)-(1m x 1m x 2mH) c/w Bottom Sumps	1	16-Dec-21
2020	Mandai Pakage B	HDG	1m x 1m x 2mH - Tank 4	1	30-Nov-21
2021	Mount Alvenia Hospital New Building	HDG	2(1+1)m x 5m x 2mH	1	26-Nov-21
2021	SIN061 @ 18 Loyang Drive	HDG	2(1+1)m x 1m x 2mH	1	13-Nov-21
2019	Jumpier Hill @ 41 Ewe Boon Road	HDG	1m x 1m x 2mH	1	2-Nov-21
2021	Warehouse @ 1 Gul Drive	P&B	16(8+8)m x 2m x 3mH c/w Top Sumps	1	15-Oct-21
2020	JTC Multi-Storey Recycling Facility (MSRF) @ 18 Kranji Loop	HDG	12.2(6.1+6.1)m x 10.98m x 2.44mH c/w Top Sumps	1	6-Oct-21
2021	529 Sims Ave	P&B	2(1+1)m x 1m x 1.5mH	1	5-Oct-21
2020	Neo Garden @ 30B Quality Road	HDG	1m x 1m x 2mH	1	28-Sep-21
2021	Cargo Staging Shed for SATs @ Airport Cargo Road	HDG	(3+3)m x 7m x 4mH c/w Top Sumps	1	27-Sep-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 5 Blk 19	1	25-Sep-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 6 Blk 21	1	25-Sep-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 7 Blk 23	1	25-Sep-21

Year	Project	Coating	Tank Size	Unit	Deliver Date
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 8 Blk 25	1	25-Sep-21
2021	11 Jalan Lembah Kallang	HDG	1m x 1m x 1.5mH	1	20-Sep-21
2021	SIN06 Data Center @ Woodlands Industrial Park E9	HDG	12(6+6)m x 10m x 3mH c/w Top Sumps	1	16-Sep-21
2021	AIR TRUNK C&D	HDG	2m x 1m x 1mH w/o Partition	1	9-Sep-21
2021	A&A Works at Applied Material @ 33 Changi North Crescent	HDG	8(4+4)m x 1m x 4mH	1	1-Sep-21
2021	The NYON @ 12D Amber Road	P&B	1m x 1m x 2mH	1	1-Sep-21
2020	Changi Airport Terminal 2 @ 60 Airport Boulevard	HDG	35(12+11+12)m x 8m x 3mH	1	28-Aug-21
2021	43 Hong Kong Street	P&B	4(2+2)m x 2m x 3mH	1	27-Aug-21
2020	The Peranakan Museum @ 39 Armenian Street	HDG	2m x 1m x 1mH	1	25-Aug-21
2021	FUYU @ 9 Tuas Drive 1	HDG	12(6+6)m x 12m x 4mH	1	21-Aug-21
2021	Replace Hose Reel for 2 Stry Shop House @ 12 Mohamad Sultan Road	HDG	1m x 1m x 1.5mH	1	18-Aug-21
2021	4 Aljunied Ave 1	HDG	1.5m x 1.5m x 1mH	1	2-Aug-21
2021	2 Tuas Ave 8	P&B	15(7+8)m x 5m x 3mH c/w Top & Bottom Sumps	1	28-Jul-21
2021	Micron Fab 10A @ North Coast Ave	HDG	8(4+4)m x 21m x 5mH	1	21-Jul-21
2021	The HYDE @ Balmoral	P&B	1m x 1m x 2mH	1	19-Jul-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 9 Blk 13	1	14-Jul-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 10 Blk 15	1	14-Jul-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 11 Blk 17	1	14-Jul-21
2021	Eaplande Theatre	HDG	2(1+1)m x 0.5m x 2mH	1	28-Jun-21
2021	206 Bedok South Ave 1	P&B	8m x 4m x 3mH c/w Top Sumps	1	21-Jun-21
2021	Potong Pasir Nursing Home @ Potong Pasir Ave 1	P&B	1m x 1m x 2mH	1	15-Jun-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 4 Blk 29	1	11-Jun-21
2021	Mixed Dev @ 120 - 126 Rangoon Road	P&B	5(2+3)m x 5m x 4mH	1	4-Jun-21
2021	Whistler Grand, A 2 Blks of 36 Stry Apartment (718 Unts) @ West Coast Vale	P&B	{{[(2x5)m+(1x2)m] + [(2x3)m+(1x4)m]} x 3mH	1	29-May-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 2 Blk 31	1	27-May-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 3 Blk 33	1	27-May-21
2020	A&A Works to Bedok School @ 50 Bedok Reservoir Crescent	P&B	(4+5)m x 6m x 4mH	1	18-May-21
2020	A&A Works to Bedok School @ 50 Bedok Reservoir Crescent	P&B	(1+1)m x 1m x 1mH	1	18-May-21
2019	5/6 Stry Civic and Community Development @ Punggol Drive / Sentul Crescent	HDG	1m x 1m x 2mH	1	18-May-21
2020	A&A Works to 4 Storey Industrial Building @ 2 & 4 Woodlands Loop	HDG	16(8+8)m x 9m x 2mH	1	7-May-21
2020	A&A Works to 4 Storey Industrial Building @ 2 & 4 Woodlands Loop	HDG	22(11+11)m x 9m x 2mH c/w Top Sumps	1	7-May-21
2021	Henderson Nursing Home @ 98 Henderson Road	P&B	1m x 1m x 2mH	1	5-May-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	4-May-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	4-May-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	4-May-21
2021	206 Bedok South Ave 1	P&B	8(4+4)m x 4m x 3mH c/w Top Sumps	1	3-May-21
2021	Ascendas Porject @ 52 and 53 Serangoon Road North Ave 4	HDG	U Shape [{(4x7) + (3x4) + (1x7)} + {(5x7)}] x 1.5mH c/w Top & Bottom Sur	1	25-Apr-21
2021	Whistier Grand, A 2 Blks of 36 Stry Apartment (718 Unts) @ West Coast Vale	P&B	{{[(1x2)m+(1x4)m+(1x5)m] + [(3x5)m+(1x3)m]} x 3mH	1	23-Apr-21
2019	Animals Wastewater Treatment Plant @ Mandai Lake Road	P&B	(3+3)m x 2m x 2mH	1	22-Apr-21
2021	Ascendas Porject @ 52 and 53 Serangoon Road North Ave 4	HDG	3(1+2)m x 1 x 2mH w/o I-Beam	1	17-Apr-21
2020	Kampong Java 230 KV Sub-station @ 146 Kampong Java Road	HDG	(6+7)m X 8m X 4mH	1	16-Apr-21
2020	SG Tiger @ Tuas West Ave	HDG	(8.54+7.32)m x 9.76m x 4.88mH	1	29-Mar-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	29-Mar-21
2021	Ascendas Porject @ 52 and 53 Serangoon Road North Ave 4	HDG	3(1+2)m x 2 x 3mH w/o I-Beam	1	18-Mar-21
2020	Jurong Port (Ready Mix Concrete)	P&B	7(3+4)m x 5m x 4mH c/w Top Sumps	1	17-Mar-21
2019	Jervios Condo, 2 Blks of 5 Stry residential Flats (55 Units) @ 33 Jervois Road	P&B	6.1(2.44+3.66)m x 6.1m x 3.66mH	1	16-Mar-21

Year	Project	Coating	Tank Size	Unit	Deliver Date
2021	Jalan Tukang Dom @ Jalan Tukang 5.2 Haplot	P&B	1m x 1m x 2mH	1	15-Mar-21
2021	Project No 1 Clementi Loop	HDG	2(1+1)m x 1m x 2mH	1	13-Mar-21
2021	19 Tai Seng Ave	P&B	6(3+3)m x 7m x 2.5mH	1	12-Mar-21
2021	MOE Interim HQ Office @ 51 Grange Road	HDG	10(5+5)m x 5m x 3mH	1	10-Mar-21
2020	Para Botania @ Fernvale Road	P&B	1m x 1m x 1.7mH	1	10-Mar-21
2020	Para Botania @ Fernvale Road	P&B	1m x 1m x 1.7mH	1	10-Mar-21
2020	Mandai Pakage B	HDG	1m x 1m x 2mH - Tank 2	1	9-Mar-21
2020	Mandai Pakage B	HDG	1m x 1m x 2mH - Tank 3	1	9-Mar-21
2020	New 5 Stry Fernvale Comunity Club @ Seng Kang West Ave	HDG	1m x 1m x 2mH	1	9-Mar-21
2019	Punggol Fire Station	P&B	(1+1)m x 1m x 1mH	1	9-Mar-21
2020	NParks @ Old Choa Chu Kang Road (Opposite Home Academy)	P&B	2(1+1)m x 1m x 1mH	1	5-Mar-21
2021	ARC Project Temporary Tank	P&B	3m x 2m x 2mH c/w Top Sumps	1	3-Mar-21
2020	Mixed Dev @ Upper Aljunied Road / Bidadari Park Drive	P&B	2m x 1m x 1mH - Tank 1 Blk 27	1	23-Feb-21
2020	Mandai Pakage B	HDG	1m x 1m x 2mH - Tank 1	1	23-Feb-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	22-Feb-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	22-Feb-21
2021	36 Swiss Club Road	P&B	1m x 1m x 2mH	1	20-Feb-21
2021	Ascendas Porject @ 52 and 53 Serangoon Road North Ave 4	HDG	8(3+5)m x 8m x 3mH c/w Top Sumps	1	18-Feb-21
2021	Pasir Ris Nursing Home @ Pasir Ris Drive 3	P&B	1m x 1m x 2mH	1	18-Feb-21
2021	Tuas Drive	HDG	1m x 1m x 2mH	1	9-Feb-21
2020	Replace Water Tank for HSBC Building @ 21 Collyer Quay	P&B	18(8+10)m x 3.5m x 3mH c/w Top Sumps	1	8-Feb-21
2020	Replace Water Tank for HSBC Building @ 21 Collyer Quay	P&B	19(5+5)m x 3.5m x 3.5mH c/w Bottom Sumps	1	8-Feb-21
2019	Animals Wastewater Treatment Plant @ Mandai Lake Road	P&B	(6+6)m x 5m x 4mH	1	4-Feb-21
2020	Shunfu Condo @ 2 Shunfu Road	P&B	2(1+1)m x 1m x 2mH	1	22-Jan-21
2020	Port Dev. @ Tuas South Boulevard	HDG	8(4+4)m x 6m x 3mH c/w Top Sumps	1	15-Jan-21
2020	Port Dev. @ Tuas South Boulevard	HDG	1m x 1m x 2mH	1	15-Jan-21
2020	Jalan Tukang Dom @ Jalan Tukang 5.2 Haplot	P&B	1m x 1m x 2mH	1	4-Jan-21
2020	Para Botania @ Fernvale Road	P&B	1m x 1m x 1.7mH	1	29-Dec-20
2020	Para Botania @ Fernvale Road	P&B	1m x 1m x 1.7mH	1	29-Dec-20
2020	Kranji Camp 3	HDG	10(5+5)m x 5m x 3mH c/w Top & Bottom Sumps	1	28-Dec-20
2020	Village Hotel Katong @ 25 Marine Parade Road	HDG	6.1m x 4.88m x 2.44mH	1	22-Dec-20
2020	A&A Works to 2 Storey Shophouse @ 434, 436 Joo Chiat Road	P&B	2(1+1)m x 3m x 3mH	1	17-Dec-20
2020	Tanglin Trust School Infant	HDG	2(1+1)m x 1m x 1mH	1	12-Dec-20
2020	Project Woodlands	HDG	1m x 1m x 1.5mH	1	9-Dec-20
2020	Trinity Christian Centre @ 21 Adam Road	P&B	2(1+1)m x 1m x 2mH	1	9-Dec-20
2020	Grab HQ - One North Ave	HDG	1m x 1m x 2mH	1	8-Dec-20
2019	Punggol Nursing Home @ Punggol East / 1 Tebing Lane	P&B	1m x 1m x 2mH	1	30-Nov-20
2020	MOE HQ @ 565 Balestier Road	HDG	(4.88+3.66)m x 6.1m x 3.66mH c/w Top Sumps	1	25-Nov-20
2020	Thermofisher SUT @ No 30A Joo Koon Circle	HDG	12m x 5m x 4mH c/w Top Sumps	1	24-Nov-20
2020	1177 Serangoon Project	P&B	1m x 1m x 1.5mH	1	17-Nov-20
2020	Village Hotel Katong @ 25 Marine Parade Road	HDG	6.1m x 4.88m x 2.44mH	1	13-Nov-20
2020	Tuas South Temp Dorm.	HDG	2(1+1)m x 1m x 2mH	1	12-Nov-20
2020	2 Sims Way Bldg @ Juntion of Sims Way / Lorong 6 Geylang	HDG	(3.66+4.88)m x 3.66m x 3.66mH c/w Top & Bottom Sumps	1	4-Nov-20
2020	2 Sims Way Bldg @ Juntion of Sims Way / Lorong 6 Geylang	HDG	1m x 1m x 2mH	1	4-Nov-20
2019	Mactaggart Foodlink @ 20 Mactaggart Road	P&B	(1.22+2.44)m x 2.44m x 3.66mH	1	20-Oct-20
2020	Cleantech 2 @ Cleantech Ave	P&B	1m x 1m x 2mH	1	17-Oct-20

Year	Project	Coating	Tank Size	Unit	Deliver Date
2020	Nursing Home @ Jurong West Street 52	P&B	2(1+1)m x 1m x 2mH	1	2-Oct-20
2020	Secondary School @ Punggol Site 15, Punggol Way	P&B	2(1+1)m x 1m x 2mH	1	30-Sep-20
2019	JTC Logistics Hub @ Gul Circle	P&B	(6+7)m x 14m x 4mH c/w Top Sumps	1	30-Sep-20
2020	Lim Chu Kang Project	HDG	2.44m x 2.44m x 2.44mH c/w Top Sumps	1	29-Sep-20
2020	PSA Tuas F2	HDG	1m x 1m x 2mH	1	28-Sep-20
2019	NUS E7 @ 15 Kent Ridge Crescent	HDG	1m x 1m x 2mH	1	26-Sep-20
2019	MMT @ Kranji Loop	P&B	(3+3)m x 8m x 6mH	1	18-Sep-20
2020	Kranji Camp III Blk 323B @ 151 Choa Chu Kong Drive	P&B	(3+5)m x 7m x 3mH c/w Top Sumps	1	4-Sep-20
2020	Tampines Nursing Home	HDG	2m x 1m x 1mH w/o Partition	1	3-Sep-20
2019	Tampines Substation @ Tampines Link	HDG	(2.44+2.44)m x 19.52m x 3.66mH c/w Top & Bottom Sumps	1	25-Aug-20
2020	Tuas F2 @ Tuas South Boulevard	HDG	16m x 8m x 4mH w/o Top Sumps	1	21-Aug-20
2020	Tuas F2 @ Tuas South Boulevard	HDG	16m x 8m x 4mH w/o Top Sumps	1	21-Aug-20
2019	JTC Woodlands North Coast @ North Coast Drive	HDG	1m x 1m x 2mH	1	27-Jul-20
2019	JTC Woodlands North Coast @ North Coast Drive	HDG	1m x 1m x 2mH	1	27-Jul-20
2020	Extention of Existing MSCP and Hight Safari Temporary Animal Holding Area @ Mandai Lake Road	HDG	1m x 1m x 2mH	1	22-Jul-20
2020	Margaret Ville @ Margaret Drive	P&B	2(1+1)m x 2m x 2mH	1	22-Jul-20
2020	Margaret Ville @ Margaret Drive	P&B	(7+8)m x 2m x 3mH c/w Top Sumps	1	22-Jul-20
2020	Pasir Leba Camp 25m Range @ 216 Pasir Leba Road	HDG	2m x 2m x 1mH w/o Partition	1	2-Jul-20
2020	5 Stry Factory Bldg for SMC Manufacuring Pte Ltd @ 91 & 93 Tuas Ave 1 and 14 Tuas Ave 7	P&B	12(6+6)m x 10m x 2mH	1	31-Mar-20
2020	No 48 Horne Road	HDG	1m x 1m x 2mH	1	18-Mar-20
2020	Palau Takong Project	HDG	(4+5)m x 4m x 4mH	1	4-Mar-20
2020	Palau Takong Project	HDG	1m x 1m x 2mH	1	4-Mar-20
2019	Mactaggart Foodlink @ 20 Mactaggart Road	P&B	(6+7)m x 5m x 4mH	1	4-Mar-20
2019	Mactaggart Foodlink @ 20 Mactaggart Road	P&B	1.22 x 1.22 x 2.44mH	1	4-Mar-20
2019	JTC Logistics Hub @ Gul Circle	P&B	(6+6)m x 10m x 3mH	1	21-Feb-20
2020	No 7 Tuas Bay Close	HDG	(1+1)m x 1m x 1.5mH	1	6-Feb-20
2019	Nursing Home @ Balestier Rise	HDG	(1+1)m x 1m x 2mH	1	23-Jan-20
2017	National Cancer Centre @ Outram Road	HDG	(7+7)m x 8m x 5mH	1	15-Dec-19
2019	79 Robinson Road	HDG	1.22m x 1.22m x 2.44mH	1	9-Dec-19
2019	Pasir Leba Camp 100m Range @ 216 Pasir Leba Road	HDG	2m x 2m x 1mH w/o Partition	1	6-Dec-19
2019	5 Tuas Ave 5	HDG	1m x 1m x 1.5mH	1	25-Nov-19
2019	LYW @ No 1 Lok Yang Way	HDG	(1+1)m x 1m x 2mH	1	13-Nov-19
2019	A&A Works to Institute of Mental Health @ 10 Buangkok View	HDG	(4+5)m x 5.5mH x 4mH	1	11-Nov-19
2019	A&A Works to Existing SAF Yacht Club Clubhouse @ 43 Admralty Road West	P&B	1m x 1m x 2mH	1	7-Nov-19
2019	LYW @ No 1 Lok Yang Way	HDG	(3+4+4+3)m x 13m x 4mH c/w Top Sumps	1	25-Oct-19
2019	Replace Water Tank @ 19 Enterprise Road	HDG	(4.88+4.88)m x 2.44m x 4.88mH c/w Top & Bottom Sumps	1	24-Oct-19
2019	PG17 Punggol Primary School @ Punggol Central / Punggol Way	P&B	(1+1)m x 1m x 2mH	1	19-Oct-19
2018	Republic Polytechnic @ 9 Woodlands Ave 9	HDG	(5+5)m x 2m x 4mH	1	9-Oct-19
2019	37 Gul Drive	HDG	1m x 1m x 2mH	1	8-Oct-19
2019	Dangerous Goods Yard in Pulau Damar Laut, Jurong Port	HDG	(6+6)m x 15m x 5mH	1	26-Sep-19
2019	Replace Sprinkler Transfer @ Fuji Xerox Level 18	HDG/Red	(2+2)m x 5m x 4mH	1	21-Sep-19
2019	AAC @ Tampines Industrial Crescent	P&B	(7+8)m x 8m x 3mH c/w Top Sumps	1	18-Sep-19
2019	Rezi 35 @ 20 Lorong 35 Geylang	P&B	2m x 1m x 1mH	1	11-Sep-19
2019	Condo @ 45 Amber Road	HDG	2m x 1m x 1mH	1	7-Sep-19
2019	PSA Building @ Pasir Panjang Drive 1	HDG	2m x 1m x 1mH	1	2-Sep-19
2019	A&A Works to Existing 2 Stry Factory @ 10 Woodlands Loop	P&B	(10+10)m x 3m x 3mH c/w Top Sumps	1	31-Aug-19

Year	Project	Coating	Tank Size	Unit	Deliver Date
2019	4 Stry Food Industrial Bldg @ 22 Woodlands Terrace	P&B	(11+11)m x 6m x 3mH	1	27-Aug-19
2019	Ang Mo Kio Nursing Home	P&B	1m x 1m x 2mH	1	15-Aug-19
2018	Le Quest @ Bukit Batok West Ave 6	P&B	(1+1)m x 2m x 1mH	1	15-Aug-19
2018	Le Quest @ Bukit Batok West Ave 6	P&B	(1+1)m x 2m x 1mH	1	15-Aug-19
2019	Mandai Package B	HDG	1m x 1m x 2mH	1	13-Aug-19
2018	Singapore Chinese Girl School @ 19 Dunearn Road	P&B	(2+2)m x 8m x 4mH	1	13-Aug-19
2019	New Primary School @ Punggol Way	HDG	2m x 1m x 1mH	1	7-Aug-19
2019	Replace Water Tank at Chervon House @ 30 Raffles Place	HDG	(9+5)m x 5m x 3mH c/w Z Partition	1	6-Aug-19
2019	422 Tagore Industrial Avenue	HDG	(5+5)m x 5m x 4.5mH	1	1-Aug-19
2018	Le Quest @ Bukit Batok West Ave 6	P&B	(1+1)m x 2m x 1mH	1	8-Jul-19
2019	SIN8 Amazon @ 5B Toh Guan Road East	P&B	(8+8)m x 8m x 4mH	1	5-Jul-19
2019	Pasir Leba Camp 300m Range Blk 319 @ 216 Pasir Leba Road	HDG	2m x 2m x 1mH w/o Partition	1	3-Jul-19
2019	Artra @ 10 Alexandra View	P&B	1m x 1m x 2mH	1	21-Jun-19
2019	88 Boon Lay Place	P&B	(2+2)m x 1m x 4mH	1	19-Jun-19
2019	A&A Works to Childcare Centre and Café @ 93A Clementi Road	P&B	1m x 1m x 1.5mH	1	14-Jun-19
2018	Chinese Temple @ 15 Arumugan Road	HDG	(3+4)m x 3m x 3mH	1	10-Jun-19
2018	Chinese Temple @ 15 Arumugan Road	HDG	1m x 1m x 2mH	1	10-Jun-19
2019	Condo @ West Coast Vale	P&B	2m x 1m x 1mH w/o Partition	1	3-Jun-19
2019	A&A Works to Existing SAF Yacht Club Clubhouse @ 43 Admrality Road West	P&B	(5+5)m x 11m x 4.5mH c/w Top Sumps	1	31-May-19
2019	Replacement of Tank @ 6 Battery Road	HDG	[{(1.22 x 2.44)m+(4.88 x 4.88)m + {(3.66 x 4.88)m}] x 2.44mH	1	29-May-19
2019	4 Pandan Crescent	P&B	(10+10)m x 6m x 2mH	1	28-May-19
2019	Nexus International School, A 12 Stry Bldg @ Aljunied Road	HDG	(1+1)m x 1m x 2mH	1	25-May-19
2019	ST Electronic @ 100 Jurong East St 21	HDG	(4.88+4.88) x 4.88m x 3.66mH c/w Top & Bottom Sumps	1	21-May-19
2019	Condo @ West Coast Vale	P&B	2m x 1m x 1mH w/o Partition	1	15-May-19
2019	DSO @ 20 Science Park Drive	HDG	1m x 1m x 2mH	1	13-May-19
2019	Singtel Data Centre @ 8 Yung Ho Road	HDG	(2+3)m x 5.5m x 4mH	1	2-May-19
2018	Park Mall @ Penang Road	P&B	1m x 1m x 2mH	1	30-Apr-19
2019	Singtel Data Centre @ 8 Yung Ho Road	HDG	(2+3)m x 5.5m x 4mH	1	29-Apr-19
2019	Singtel Data Centre @ 8 Yung Ho Road	HDG	(2+3)m x 5.5m x 4mH	1	24-Apr-19
2019	PUB Water Reclaim Plant @ Pioneer Road	HDG	(2.44+2.44)m x 3.66m x 3.66mH	1	16-Apr-19
2018	Aspial HQ, A 5 Stry Industrial Factory @ 55 Ubi Ave 3	HDG	(3+4)m x 15m x 3.5mH c/w Top Sumps and Step Partion	1	30-Mar-19
2018	Aspial HQ, A 5 Stry Industrial Factory @ 55 Ubi Ave 3	HDG	(3+3)m x 9m x 3.5mH c/w Top Sumps	1	30-Mar-19
2019	DSO @ 20 Science Park Drive	HDG	(2+3+5+5)m x 7m x 6mH	1	28-Mar-19
2019	17 Tuas Ave 6	HDG	1m x 1m x 2mH	1	26-Mar-19
2019	Chuan Park @ 244 Lor Chuan	P&B	(1.22+1.22)m x 1.22m x 1.22mH	1	26-Mar-19
2019	Kung Meng Suan Project @ 88 Bright Hill Road	P&B	(1+1)m x 1m x 2mH	1	26-Mar-19
2019	Replacement of Tank @ 6 Battery Road	HDG	(1.22+1.22+1.22+1.22)m x 2.44m x 3.05mH	1	23-Mar-19
2019	Replacement of Tank at Cherron House @ 6 Battery Road	HDG	(3.66+1.22)m x 10.98m x 2.44mH	1	22-Mar-19
2019	Sungei Gedong Camp	HDG	(3.66+3.66)m x 12.20m x 3.66mH c/w Top & Bottom Sumps	1	19-Mar-19
2019	Sumitomo Warehouse Extension @ 8 Tuas Ave 5	P&B	(3+4)m x 5m x 3.5mH	1	18-Mar-19
2018	Coomercial Bldg @ Mariam Way	P&B	(3+3)m x 5m x 2mH	1	12-Mar-19
2018	8 Stry Mutli User Light Industrial Dev @ 60 Lorong 23 Geylang	HDG	(3+3)m x 3m x 5mH c/w Top Sumps	1	4-Mar-19
2018	CMI @ 5A Tai Seng Drive	HDG	(1+1)m x 1m x 2mH	1	25-Feb-19
2019	Lorong Kismis	HDG	1m x 1m x 1.5mH	1	22-Feb-19
2017	State Court @ Havelock Square	HDG	(3+3)m x 12m x 4mH	1	21-Feb-19
2018	Le Quest @ Bukit Batok West Ave 6	P&B	(1+1)m x 2m x 1mH	1	16-Feb-19