


MSE
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

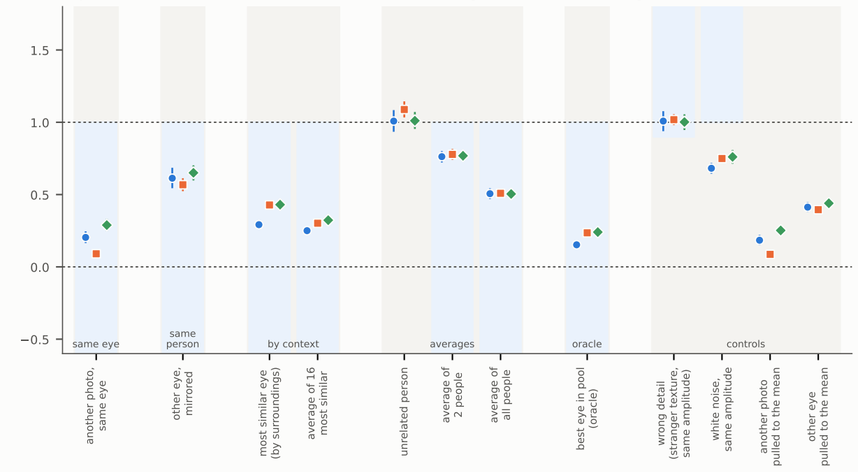


RMSE
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

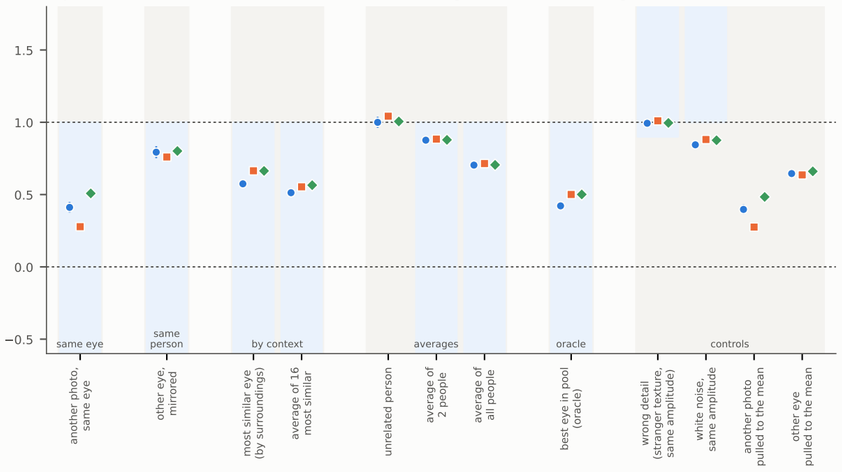


MAE
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

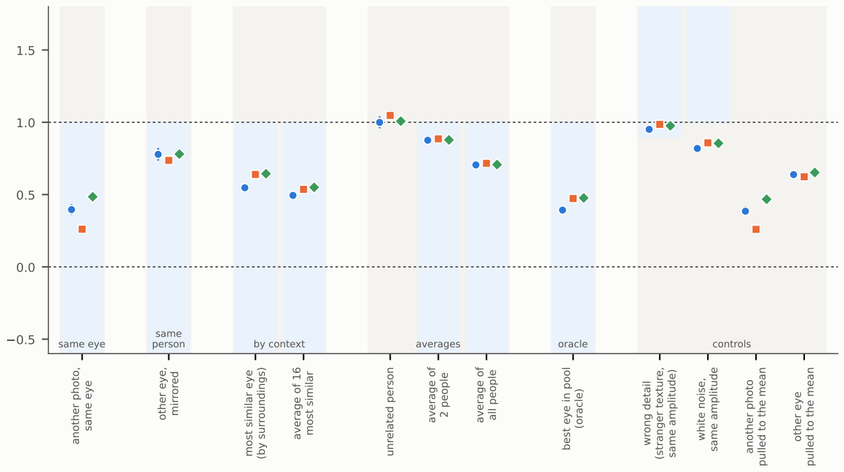


SSIM
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

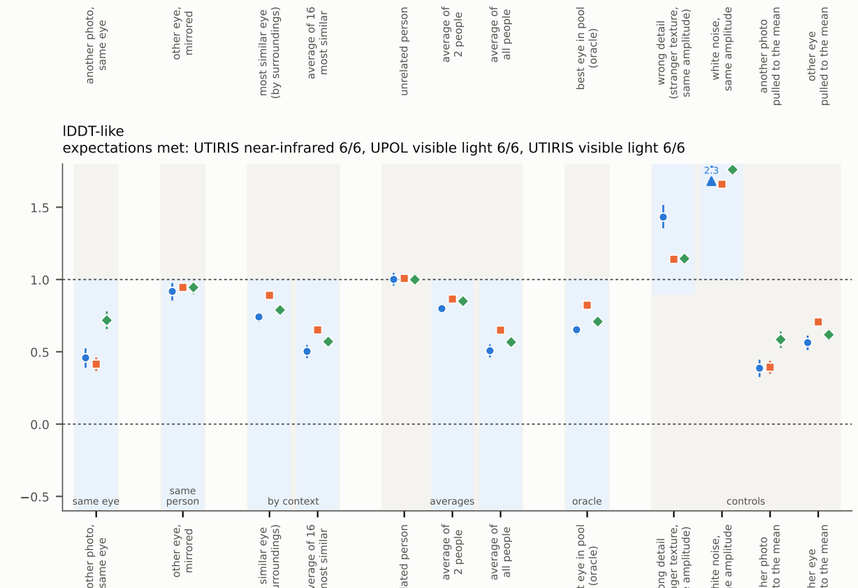

MS-SSIM
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

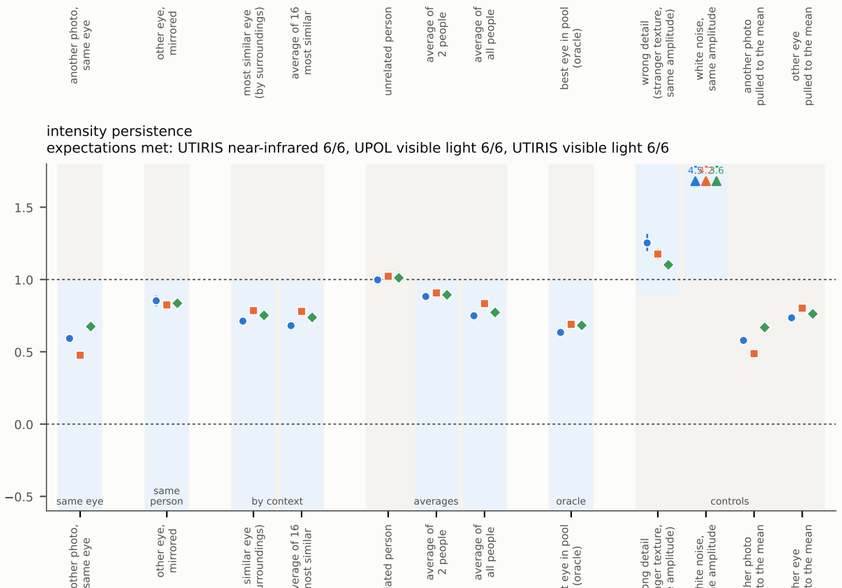

ACC vs dataset mean
expectations met: UTIRIS near-infrared 3/4, UPOL visible light 2/4, UTIRIS visible light 2/4

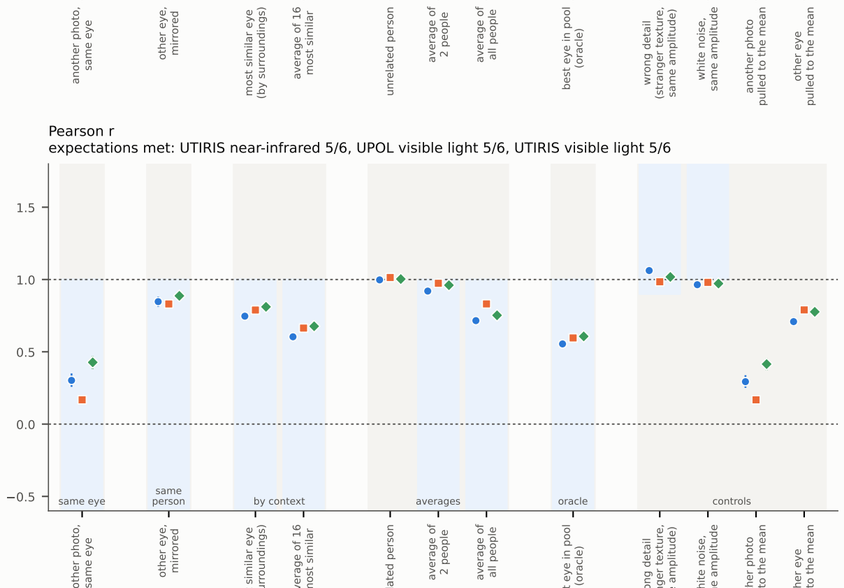

lDDT-like
expectations met: UTIRIS near-infrared 6/6, UPOL visible light 6/6, UTIRIS visible light 6/6

intensity persistence
expectations met: UTIRIS near-infrared 6/6, UPOL visible light 6/6, UTIRIS visible light 6/6

Pearson r
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

TM-like
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6



GDT-like
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6



lDDT, repeat tolerance
expectations met: UTIRIS near-infrared 6/6, UPOL visible light 6/6, UTIRIS visible light 6/6



RMSE / repeat noise
expectations met: UTIRIS near-infrared 5/6, UPOL visible light 5/6, UTIRIS visible light 5/6

iris, 16 px windows on the unwrapped strip
● UTIRIS near-infrared (primary) ■ UPOL visible light ◆ UTIRIS visible light

R = (d - d_self) / (d_stranger - d_self): 0 = the target itself, 1 = unrelated person (mean of 16). Bars: 95% interval, bootstrap over people. Blue bands: expected side (partly correct rungs and averages below 1; wrong detail at or above 0.9; noise above 1).
frame P2 (Worldcoin open-iris segmentation): Kate accepted P2 on the trial and frame QC sheets on 7 Nov 2026 ('хорошо да берем'); the lid-shadow mask (z < -4 connected to the lid) was added after that and its final sheets are not yet re-shown to Kate