

From Static Shading to Time-Domain Control: A Unified Solar-Thermal-Adaptive Framework for Climate-Adaptive Passive Building Design

Author Name^{a,*}

^a*Department of Architecture, University Name, City, Country*

Abstract

The building sector remains a major target for decarbonization and climate adaptation, yet passive solar design is still frequently implemented through static shading rules, steady-state envelope metrics, or reactive operational logic. Such fragmented treatments are increasingly insufficient for buildings exposed to anisotropic sky conditions, transient heat storage and release, and highly variable internal disturbances. This paper proposes a Unified Solar-Thermal-Adaptive (USTA) framework that reformulates passive solar design as a time-domain, climate-adaptive decision problem. The framework couples anisotropic solar admission modeling, reduced-order transient thermal dynamics, multi-objective passive design optimization, and predictive facade control within a single physics-informed pipeline. In contrast to conventional noon-based or purely geometric approaches, USTA explicitly captures diffuse sky structure, thermal lag, and anticipatory control requirements under variable occupancy. The resulting formulation supports warm-climate solar rejection, cold-climate solar storage and survivability analysis, adaptive operation for stochastic-use buildings, and transferable design synthesis across latitudes and facade orientations. By combining physical interpretability with computational efficiency, the proposed framework provides a unified basis for passive-first retrofit and new-building design under heterogeneous climatic and operational conditions.

Keywords: Passive Solar Design, Anisotropic Sky Model, 3R2C Thermal Network, Model Predictive Control, Multi-Objective Optimization,

*Corresponding author

1. Introduction

Buildings remain one of the largest contributors to global energy demand and carbon emissions. According to UNEP, the buildings and construction sector accounted for 34% of global energy demand and 37% of energy- and process-related CO₂ emissions in 2022, making building decarbonization and climate adaptation a first-order research priority rather than a secondary design concern [1]. In this context, passive solar design has regained strategic importance because it can reduce operational dependence on mechanical systems while improving climate responsiveness at the envelope level.

Existing passive design work largely treats solar shading, building thermal performance, and operational control as separate concerns. Studies on shading devices optimize fixed geometries against cooling or daylight criteria [2, 3, 4]; thermal modeling work characterizes envelope properties in quasi-steady state [5, 6, 7]; and building control research applies predictive methods to HVAC systems without tightly coupling them to upstream passive design decisions [8, 9]. Each of these lines has produced valuable insights, but together they reflect a fragmented view of what is fundamentally an integrated problem. We argue that climate-adaptive passive design should instead be treated as a unified time-domain problem — one in which solar admission decisions, thermal storage behavior, and operational adaptation are formulated within a single physical model and optimized jointly across design time and run time.

Pursuing this integrated vision, however, surfaces two non-trivial challenges. The first is radiative fidelity: when the goal is to evaluate design decisions against the full distribution of hourly sky states rather than a representative sun angle, the isotropic diffuse assumptions that suffice for steady-state reasoning become inadequate. Diffuse radiation, circumsolar brightening, and horizon effects can substantially alter the irradiance on tilted facades at the hours that most affect peak loads [10], so the solar input model must be both time-resolved and anisotropically accurate. The second challenge is bridging time scales: passive design decisions are set before occupancy is known and must remain durable across seasons, whereas operational control decisions respond to real-time disturbances over horizons of

hours [11, 12, 13]. Coupling these two decision layers within a single computationally tractable formulation — without losing the physical consistency that makes the coupled model meaningful — is not straightforward.

To address the first challenge, we introduce a time-resolved solar admission layer grounded in the Perez anisotropic sky model, coupled to a 3R2C reduced-order transient thermal network; this pairing captures storage, delay, and survivability effects while remaining computationally efficient and physically interpretable. To address the second challenge, we formulate the design-control pipeline as a bi-level problem: an offline layer driven by multi-objective optimization selects durable design parameters from a Pareto-efficient solution set, and an online layer driven by model predictive control adapts controllable facade and HVAC decisions in anticipation of near-term thermal loads — both layers sharing the same underlying physical model. The resulting Unified Solar-Thermal-Adaptive (USTA) framework is evaluated across four case studies spanning warm-climate shading, cold-climate passive heating, variable-occupancy adaptive control, and cross-latitude design generalization. USTA achieves a 35.7% reduction in annual heating demand, a 94.1% comfort-hour rate under dynamic occupancy, and a 45% improvement in passive survivability during simulated grid outage.

The main contributions of this paper are threefold. First, we formulate climate-adaptive passive building design as a unified bi-level optimization-control problem, coupling design variables and control variables through a shared physical model and making explicit the structural relationship between design-time decisions and run-time performance. Second, we integrate a Perez anisotropic sky model for time-resolved solar admission with a 3R2C transient thermal network, providing a model chain that is both physically interpretable and efficient enough to serve as the shared representation for multi-objective offline optimization and online predictive control. Third, we provide systematic cross-scenario validation with ablation experiments that isolate the contribution of each framework component across cooling-dominated, heating-dominated, occupancy-variable, and multi-latitude conditions, offering replicable evidence for the performance value of solar-thermal-control integration in passive building design.

The rest of this paper is organized as follows. Section 2 reviews prior work on shading and solar-admission modeling, reduced-order thermal modeling, and predictive control and dynamic facades. Section 3 formulates the proposed USTA framework mathematically. Section 4 presents the optimization and control pipeline. Section 5 describes the experimental setup

72 and baselines. Section 6 presents results across four case studies. Section 7
73 provides ablation and sensitivity analysis. Section 8 discusses implications
74 and limitations. Section 9 concludes.

75 **2. Related Work**

76 *2.1. Static Shading Design and Solar-Admission Modelling*

77 Solar shading has long been recognized as one of the most important pas-
78 sive means for reducing cooling load, mitigating glare, and improving facade
79 energy performance. Review studies have documented a wide range of shad-
80 ing devices, simulation methods, and performance criteria across climates
81 and building types [2]. Representative application studies have shown that
82 fixed overhangs, fins, and spectrally selective configurations can reduce solar
83 gains while balancing visual comfort and daylight access [3, 4]. This literature
84 has been highly valuable for identifying facade-level trade-offs, but its domi-
85 nant modeling pattern is still largely configuration-oriented: optimize a fixed
86 device, compare a set of facade alternatives, or assess one climate-specific
87 shading package. Such formulations are useful for local design decisions,
88 yet they do not fully resolve the deeper problem of time-varying solar ad-
89 mission under anisotropic sky conditions. The Perez model is foundational
90 here because it explicitly models diffuse irradiance on tilted planes under all-
91 weather conditions, including circumsolar and horizon effects that simplified
92 geometric reasoning tends to suppress [10]. Our work builds on this insight
93 but moves further by embedding anisotropic solar admission inside a larger
94 transient decision framework.

95 *2.2. Thermal Inertia, Transient Response, and Reduced-Order Models*

96 A parallel literature has established that building performance is strongly
97 shaped by thermal inertia and by the timing, not merely the magnitude, of
98 heat transfer. Review work by Verbeke and Audenaert shows that ther-
99 mal mass can time-shift and flatten heat-flow fluctuations, although its per-
100 formance varies substantially with climate, insulation, and building use [5].
101 More recent RC-model reviews emphasize that low-order resistance-capacitance
102 models offer a practical compromise between physical meaning and compu-
103 tational tractability, making them especially suitable for fast simulation,
104 early design, and control-oriented prediction [6]. Earlier studies on low-order

thermal networks likewise argue that dynamic building behavior can be captured by reduced numbers of resistances and capacitances at low computational cost, in contrast to higher-order methods whose parameterization and runtime burdens are often prohibitive for design iteration [7]. These works provide the methodological foundation for using 3R2C-style state representations in passive design research. At the same time, much of the thermal-inertia literature stops at dynamic analysis or performance explanation. Our framework takes the next step by directly coupling thermal storage and release to time-resolved solar admission and adaptive facade decisions.

2.3. *Predictive Control, Dynamic Facades, and Resilience-Oriented Operation*

The building-control literature has demonstrated that MPC is one of the most systematic ways to coordinate comfort, energy use, forecasts, and operational constraints [8]. However, review studies also make clear that the practical deployment of MPC still depends critically on obtaining suitable control-oriented models and understanding the relationship between model quality, data requirements, and final control performance [9]. Meanwhile, research on dynamic facades has expanded rapidly. Recent systematic reviews describe dynamic facades as a promising response to the mismatch between static envelopes and dynamic external stimuli, with reported benefits in thermal comfort, energy efficiency, and daylight performance [11]. Yet this line of work often concentrates on facade technologies or actuation logic, while leaving the building’s internal thermal storage and survivability behavior only loosely connected to the facade decision process. At the same time, resilience-oriented studies increasingly evaluate passive survivability, habitable hours, and outage performance under extreme events [12, 13]. These studies highlight an important shift in performance criteria, but they also reveal that resilience metrics are still often used as evaluation endpoints rather than as native objectives in a unified passive design-and-operation framework. Our work responds to this gap by treating adaptive control and resilience as integral parts of passive solar design.

2.4. *Positioning of This Work*

In summary, existing studies provide strong but still separated answers to three different questions: how to reduce solar gains with facade devices [2, 10, 3, 4], how to represent transient thermal storage and release efficiently [5, 6, 7], and how to optimize building operation under forecasts and constraints [8,

9, 11]. What remains insufficiently addressed is the joint formulation of these questions as one coherent passive-first decision problem. The proposed USTA framework is positioned precisely at this intersection. Rather than optimizing shading alone, simulating thermal mass alone, or controlling a facade alone, USTA unifies anisotropic solar modeling, reduced-order transient thermal dynamics, multi-objective passive design, and predictive adaptive operation within one transferable framework. This is the main distinction between our work and the existing literature.

3. Problem Formulation

We reformulate passive solar building design as a time-domain sequential decision problem with clearly defined inputs, states, controls, constraints, and multi-objective cost functions. This formulation enables the USTA framework to be treated as a computational method rather than an engineering rule-of-thumb collection.

3.1. Sets, Time Discretization, and Notation

Let $\mathcal{T} = \{0, 1, \dots, N\}$ denote the discrete time index set with uniform time step Δt (e.g., 15 min), giving a total simulation horizon of one typical meteorological year ($N = 365 \times 24 \times 4 = 35,040$ steps). Let $\mathcal{F} = \{N, E, S, W\}$ be the set of facade orientations, each characterized by tilt angle β_f and azimuth γ_f . For a single thermal zone with the 3R2C approximation, the state dimension is $n_x = 2$. Key notation is summarized in Table 1.

3.2. Input, State, and Control Variables

At each time step t , the exogenous weather input is defined as:

$$w_t = [T_{out,t}, DNI_t, DHI_t, GHI_t, v_{wind,t}, \rho_{sky,t}]^T \quad (1)$$

where DNI, DHI, and GHI denote direct normal, diffuse horizontal, and global horizontal irradiance respectively. These are obtained from TMY3 data files [14]. In addition, a predicted occupancy disturbance sequence $\hat{o}_{t:t+H-1}$ is provided to the MPC at each step.

The system state is defined as the 3R2C state vector:

$$x_t = [T_{in,t}, T_{m,t}]^T \quad (2)$$

where $T_{in,t}$ is the indoor air temperature and $T_{m,t}$ is the equivalent thermal mass temperature.

Table 1: Mathematical notation used throughout the paper.

Symbol	Description	Unit
$\mathcal{T}$	Discrete time index set $\{0, 1, \dots, N\}$	–
Δt	Time step	min
$\mathcal{F}$	Set of facade orientations	–
n_x	State dimension ($= 2$ for 3R2C)	–
w_t	Weather input vector at time t	various
$x_t = [T_{in}, T_m]$	State: indoor air temp., thermal mass temp.	$^{\circ}\text{C}$
z	Design variable vector (offline)	various
$u_t = [\theta_{lou}, s_{night}, P_{hvac}]$	Online control vector at time t	deg, –, W
$J = [J_e, J_c, J_g, J_s, J_a]$	Multi-objective cost vector	various
H	MPC prediction horizon	steps

Decision variables are split into two layers:

Design layer (offline, once per project): $z \in \mathcal{Z}$, comprising fixed overhang depth ratio $r_{oh} = d_{oh}/h_{win}$, vertical fin depth, glazing SHGC and VLT, thermal mass scaling factor k_C , and maximum night insulation resistance multiplier k_R^{max} .

Operation layer (online, time-varying): $u_t = [\theta_{lou,t}, s_{night,t}, P_{hvac,t}]^T$, where $\theta_{lou,t}$ is the louver angle (continuous, $[\theta_{min}, \theta_{max}]$), $s_{night,t} \in \{0, 1\}$ is the night insulation state, and $P_{hvac,t}$ is the HVAC power (set to zero in passive-survivability scenarios).

3.3. Constraints

The following constraints are imposed:

- Thermal comfort (soft, occupied hours $\mathcal{T}_{occ}$):** $T_{low,t} \leq T_{in,t} \leq T_{high,t}$ for all $t \in \mathcal{T}_{occ}$. Soft violations are penalized via slack variables $\xi_t \geq 0$.
- Actuator bounds and rate limits:** $\theta_{min} \leq \theta_{lou,t} \leq \theta_{max}$; $|\theta_{lou,t} - \theta_{lou,t-1}| \leq \Delta\theta_{max}$.
- Night insulation:** $s_{night,t} \in \{0, 1\}$ (MIQP) or $s_{night,t} \in [0, 1]$ (convex relaxation).
- Glare:** $DGI_t \leq 22$ during occupied hours (Daylight Glare Index threshold [15]).

189 **5. Passive survivability (outage scenario $\mathcal{T}_{out} \subset \mathcal{T}$):** $P_{hvac,t} = 0$ and
 190 $T_{in,t} \geq T_{safe}$ for all $t \in \mathcal{T}_{out}$.

191 3.4. Multi-Objective Cost Function

192 We define a five-dimensional objective vector $J = [J_e, J_c, J_g, J_s, J_a]^T$:

$$J_e = \sum_{t \in \mathcal{T}} P_{hvac,t} \cdot \Delta t \quad (3)$$

$$J_c = \sum_{t \in \mathcal{T}_{occ}} (\max(0, T_{in,t} - T_{high,t})^2 + \max(0, T_{low,t} - T_{in,t})^2) \cdot \Delta t \quad (4)$$

$$J_g = \sum_{t \in \mathcal{T}_{occ}} \max(0, DGI_t - 22) \cdot \Delta t \quad (5)$$

$$J_s = \sum_{t \in \mathcal{T}_{out}} \max(0, T_{safe} - T_{in,t}) \cdot \Delta t \quad (6)$$

$$J_a = \sum_{t \in \mathcal{T}} \|u_t - u_{t-1}\|_2^2 \quad (7)$$

193 3.5. Bi-Level Optimization Formulation

USTA is formulated as a bi-level optimization problem. The outer (design) layer seeks the Pareto-optimal design set:

$$\mathcal{P}^* = \{z \in \mathcal{Z} \mid \nexists z' \text{ s.t. } J(z', \pi_z^*) \text{ dominates } J(z, \pi_z^*)\} \quad (8)$$

194 where π_z^* denotes the optimal operational policy given design z , produced by
 195 the inner (MPC) layer.

The inner layer solves a receding-horizon optimal control problem at each step t :

$$\begin{aligned} \min_{u_{t:t+H-1}} \quad & \sum_{k=0}^{H-1} [\|x_{t+k|t} - x_{ref,t+k}\|_Q^2 + \|\Delta u_{t+k|t}\|_R^2 \\ & + \lambda_g \cdot \phi(DGI_{t+k|t}) + \lambda_e \cdot \psi(P_{hvac,t+k|t})] \\ \text{s.t.} \quad & x_{t+k+1|t} = f_d(x_{t+k|t}, u_{t+k|t}, \hat{d}_{t+k|t}; z) \end{aligned} \quad (9)$$

196 4. The USTA Framework: Proposed Method

197 The USTA framework processes weather inputs through three sequential
 198 computational layers—radiation transposition, thermal state dynamics, and
 199 hierarchical optimization/control—as illustrated in Figure 1. Each layer is
 200 described below.

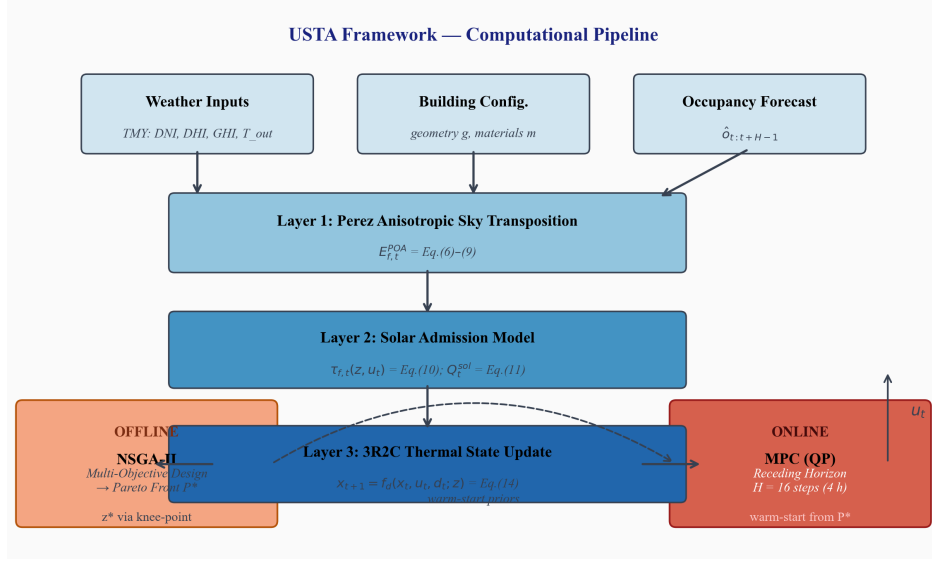


Figure 1: Overall architecture of the USTA framework. Weather inputs are transposed to facade-plane irradiance via the Perez anisotropic sky model, coupled to the 3R2C thermal state update, and fed into the offline multi-objective design optimizer (NSGA-II) and online MPC controller.

201 4.1. Layer 1: Anisotropic Solar Radiation Transposition (Perez Model)

For each facade $f \in \mathcal{F}$ and time step $t \in \mathcal{T}$, we compute the solar altitude angle α_t and azimuth $\gamma_{s,t}$ from geographic latitude ϕ , day-of-year, and time-of-day. The angle of incidence on facade f is computed as $\theta_{i,f,t}$. The plane-of-array (POA) irradiance is decomposed into three components:

$$E_{f,t}^{POA} = E_{f,t}^{beam} + E_{f,t}^{diff} + E_{f,t}^{grd} \quad (10)$$

The direct-beam component:

$$E_{f,t}^{beam} = DNI_t \cdot \max(0, \cos \theta_{i,f,t}) \quad (11)$$

The diffuse component follows the Perez (1990) all-weather transposition model [10], which accounts for circumsolar brightening (coefficient $F_{1,t}$) and horizon brightening (coefficient $F_{2,t}$):

$$E_{f,t}^{diff} = DHI_t \cdot \left[\frac{(1 - F_{1,t})(1 + \cos \beta_f)}{2} + \frac{F_{1,t} \cdot \max(0, \cos \theta_{i,f,t})}{\max(\cos \theta_{z,t}, \epsilon_0)} + F_{2,t} \cdot \sin \beta_f \right] \quad (12)$$

where $\epsilon_0 = 0.087$ is a numerical stability constant. The Perez coefficients $F_{1,t}$ and $F_{2,t}$ are obtained from empirical lookup tables indexed by sky clearness and brightness.

The ground-reflected component is:

$$E_{f,t}^{grd} = \rho_g \cdot GHI_t \cdot \frac{1 - \cos \beta_f}{2} \quad (13)$$

where $\rho_g = 0.2$ is the ground albedo (see Table 2 for all model parameters). Compared with isotropic diffuse-sky models, the Perez formulation substantially improves accuracy for vertical and tilted surfaces, particularly under partly-cloudy conditions with significant circumsolar contributions [10].

4.2. Layer 2: Solar Admission and Glazing Model

The transmitted solar heat gain entering the thermal zone is modulated by three sequential factors: glazing SHGC, fixed shading geometry, and the time-varying louver state:

$$\tau_{f,t}(z, u_t) = SHGC_f(z) \cdot \tau_{f,t}^{shade}(z) \cdot \tau_{f,t}^{louver}(\theta_{lou,t}) \quad (14)$$

The total solar heat gain is distributed between the air node and the thermal mass node with allocation coefficients η_a and η_m ($\eta_a + \eta_m = 1$):

$$Q_t^{sol} = \sum_{f \in \mathcal{F}} A_f \cdot E_{f,t}^{POA} \cdot \tau_{f,t}(z, u_t) \quad (15)$$

$$Q_t^{sol,a} = \eta_a \cdot Q_t^{sol}; \quad Q_t^{sol,m} = \eta_m \cdot Q_t^{sol} \quad (16)$$

The Daylight Glare Index (DGI) is approximated from transmitted vertical illuminance as a proxy for glare, following [15]. Values are computed at each occupied time step and constrained to $DGI \leq 22$ as a hard glare limit.

4.3. Layer 3: 3R2C Transient Thermal Network

The building thermal zone is modeled as a two-node resistance-capacitance network (3R2C), which captures the dynamic coupling between indoor air and thermal mass. The continuous-time energy balance equations are:

$$C_a \frac{dT_{in}}{dt} = \frac{T_{out} - T_{in}}{R_{oa}(t)} + \frac{T_m - T_{in}}{R_{am}} + Q_t^{int} + Q_t^{sol,a} + P_{hvac,t} \quad (17)$$

$$C_m \frac{dT_m}{dt} = \frac{T_{in} - T_m}{R_{am}} + \frac{T_{out} - T_m}{R_{om}} + Q_t^{sol,m} \quad (18)$$

214 where $R_{oa}(t) = R_{oa}^{base} \cdot (1 + k_R \cdot s_{night,t})$ is the effective outdoor-to-indoor
 215 thermal resistance, time-varying with night insulation state $s_{night,t}$.

Writing the system in matrix form:

$$\frac{dx}{dt} = A(z, s_{night}) \cdot x_t + B \cdot u_t + E \cdot d_t + b \quad (19)$$

216 where the disturbance vector $d_t = [T_{out,t}, Q_t^{int}, Q_t^{sol}]^T$.

Discretization is performed using the Crank-Nicolson implicit method to ensure numerical stability at $\Delta t = 15$ min:

$$x_{t+1} = A_d(z, s_{night,t}) \cdot x_t + B_d \cdot u_t + E_d \cdot d_t + b_d \quad (20)$$

217 where $A_d = (I - \frac{\Delta t}{2} A)^{-1} (I + \frac{\Delta t}{2} A)$. This discrete update forms the simulation
 218 engine used for both offline NSGA-II fitness evaluation and online MPC
 219 prediction.

220 4.4. Hierarchical Solver Pipeline

221 USTA employs a two-stage hierarchical solver that separates slow design
 222 decisions (offline, once) from fast operational decisions (online, per time step).

223 **Stage 1 — Offline multi-objective design (NSGA-II [16]):** We
 224 search the design space $\mathcal{Z}$ using the NSGA-II algorithm with $N_{pop} = 200$ in-
 225 dividuals, $G = 500$ generations, crossover probability $p_c = 0.9$, and mutation
 226 probability $p_m = 0.01$. Each individual z is evaluated by running the full
 227 Perez + 3R2C simulation over one TMY year with a nominal louver control
 228 policy, computing objectives $J(z)$. Non-dominated sorting and crowding dis-
 229 tance assignment produce the Pareto-front $\mathcal{P}^*$. A knee-point heuristic or user
 230 preference vector selects the final design z^* . The computational complexity
 231 of each NSGA-II generation is $O(M \cdot N_{pop}^2)$ for sorting, where $M = 5$ is the
 232 number of objectives.

233 **Stage 2 — Online MPC control (QP with warm-start):** Given
 234 the selected design z^* , the online controller solves a finite-horizon QP at
 235 each time step t with prediction horizon $H = 16$ steps (4 hours at 15-min
 236 resolution). The MPC warm-starts from the previous solution and uses pre-
 237 factored system matrices to achieve real-time computational performance
 238 (target latency < 50 ms per step using OSQP [17]).

239 4.5. Algorithm Summary

240 Algorithm 1 summarizes the complete USTA procedure.

Algorithm 1 USTA Hierarchical Design-Control Pipeline

Require: TMY weather $w_{0:N}$, occupancy model $O(\cdot)$, building geometry g , material bounds m

Require: design domain $\mathcal{Z}$, control domain $\mathcal{U}$, time step Δt , MPC horizon H

Ensure: Pareto design set $\mathcal{P}^*$, selected design z^* , control log $\{u_t\}$

```

1: // Stage 1: Offline multi-objective design
2: Initialize population  $\{z_i\}_{i=1..N_{pop}} \subset \mathcal{Z}$  randomly
3: for  $gen = 1$  to  $G$  do
4:   for each  $z_i$  do
5:      $E_{f,t}^{POA} \leftarrow \text{Perez}(w_t, \beta_f, \gamma_f)$  {Eqs. (10)–(13)}
6:     simulate  $x_{t+1} = f_d(x_t, u_t, d_t; z_i)$  {Eq. (20)}
7:     evaluate  $J(z_i) = [J_e, J_c, J_g, J_s, J_a]$  {Eqs. (3)–(7)}
8:   end for
9:   non-dominated sorting + crowding distance; generate offspring
10: end for
11:  $\mathcal{P}^* \leftarrow$  final Pareto front;  $z^* \leftarrow$  knee-point selection
12: // Stage 2: Online MPC control
13: Initialize  $\hat{x}_0, u_{-1}$ 
14: for  $t = 0$  to  $N - 1$  do
15:   obtain forecasts  $\hat{w}_{t:t+H-1}, \hat{o}_{t:t+H-1}$ 
16:   warm-start QP with  $u_{t-1:t+H-2}^*$ 
17:   solve MPC (Eq. (9))  $\rightarrow u_{t|t}^*$ 
18:   apply  $u_t \leftarrow u_{t|t}^*$ ; update  $\hat{x}_{t+1}$ 
19: end for

```

241 4.6. Model Assumptions

242 We make the following simplifying assumptions:

- 243 1. **Climate data:** the warm-climate case uses a Cfa (hot-summer/warm-
244 winter) TMY profile; the cold-climate case uses a subarctic Dfc profile.
- 245 2. **Occupancy schedule:** academic buildings follow a fixed timetable
246 (08:00–22:00 weekdays); the student union is modeled as continuously
247 variable with stochastic arrival patterns.
- 248 3. **Shading material:** shading devices are thermally inert (no re-radiation
249 of absorbed heat into the occupied zone).

- 250 4. **Foundation:** ground-slab heat exchange is treated as adiabatic, justified by the negligible temperature differential at the slab-ground interface in both climate types [7].
- 251
- 252
- 253 5. **Single-zone:** each building is modeled as one thermal zone for the 3R2C representation; internal partitions are lumped into the equivalent thermal mass.
- 254
- 255

256 5. Experimental Setup

257 5.1. Case Studies

258 We evaluate the USTA framework across four complementary case studies that collectively cover the range of climatic, operational, and design challenges articulated in Section 3.

261 **Case Study 1 (CS1) — Warm-Climate Retrofit:** Academic Hall North, a cooling-dominated campus building at latitude 23°N (Cfa climate, analogous to Shenghuainan University). The retrofit goal is to minimize annual cooling load while constraining $DGI \leq 22$.

265 **Case Study 2 (CS2) — Cold-Climate Resilience:** Borealis University Extension, a high-latitude campus building at latitude 60°N (Dfc climate). The primary goal is to maximize passive solar harvesting and minimize auxiliary heating demand. Passive survivability during 72-hour outage scenarios is evaluated as a secondary metric.

270 **Case Study 3 (CS3) — Variable-Occupancy MPC:** A new student union building at latitude 35°N with highly variable and stochastic occupancy (50–500 persons, 06:00–24:00). The MPC controller governs kinetic louver angle and night insulation actuation.

274 **Case Study 4 (CS4) — Cross-Latitude Generalization:** Systematic evaluation of the framework across five reference latitudes (10°, 23°, 35°, 45°, 60°N) to derive transferable design rules.

277 5.2. Building and System Parameters

278 All building and system parameters used in the experiments are listed in
279 Tables 2 and 3.

280 5.3. Baseline Methods

281 Four baselines are designed to isolate the contribution of each USTA
282 component:

Table 2: Building thermal and geometric parameters for all case studies.

Parameter	Symbol	CS1	CS2	CS3	Unit
Floor area	A_{floor}	1200	800	2500	m ²
Envelope U-value	$1/R_{oa}$	1.2	0.35	0.80	W/m ² K
Air thermal capacity	C_a	120	120	300	kJ/K
Thermal mass capacity	C_m	3600	7200	5400	kJ/K
Internal gains (peak)	Q_{int}^{max}	40	20	120	W/m ²
Comfort setpoint (cool)	T_{high}	26	24	26	°C
Comfort setpoint (heat)	T_{low}	20	20	20	°C
Passive survivability limit	T_{safe}	—	15	—	°C
Glazing ratio (S facade)	WWR_S	0.4	0.5	0.35	—

Table 3: NSGA-II and MPC solver parameters.

Parameter	Value	Description
N_{pop}	200	NSGA-II population size
G	500	Number of generations
p_c	0.9	Crossover probability (SBX)
p_m	0.01	Mutation probability (polynomial)
Δt	15 min	Simulation time step
H	16 steps (4 h)	MPC prediction horizon
Q	diag(10, 1)	MPC state cost matrix
R	diag(0.1, 5)	MPC control cost matrix
λ_g	2.0	Glare penalty weight
λ_e	1.0	Energy penalty weight
Solver	OSQP v0.6	QP solver with warm-start

- 283 • **B1 — Static solar-noon sizing:** Shading geometry sized for solar
284 noon at summer solstice using isotropic diffuse sky model. No time-
285 varying control.
- 286 • **B2 — Steady-state thermal model:** Facade optimized with Perez
287 irradiance model but building thermal response modeled by steady-
288 state R-value (no thermal mass, no dynamic effects).
- 289 • **B3 — Reactive control:** 3R2C model with Perez irradiance, but
290 louver control follows a simple rule: close louvers when transmitted

291 irradiance $> 300 \text{ W/m}^2$, open otherwise. No MPC.

- 292 • **B4 — Single-objective optimization:** Same as USTA but Pareto
293 search replaced by single-objective minimization of energy alone (weighted-
294 sum scalarization with fixed weights).

295 5.4. Ablation Study Design

296 Table 4 presents the ablation matrix. Each row removes one USTA com-
297 ponent.

Table 4: Ablation matrix. Each row removes one USTA component.

Variant	Perez	3R2C	MPC	Pareto	Expected observation
A0 (Full USTA)	Y	Y	Y	Y	Best energy-comfort-glare-resilience balance
A1 (no Perez)	N	Y	Y	Y	Glare and cooling load indicators worsen
A2 (no 3R2C)	Y	N	Y	Y	Thermal resilience drops, night fluctuations increase
A3 (no MPC)	Y	Y	N	Y	Peak over-temperature and comfort violations increase
A4 (no Pareto)	Y	Y	Y	N	Sub-optimal trade-offs, non-convex front missed

298 5.5. Evaluation Metrics

299 We report the following metrics for each case study: (i) Annual cool-
300 ing/heating energy proxy (degree-hour sum); (ii) Thermal comfort violation
301 rate (% occupied hours outside $[T_{low}, T_{high}]$); (iii) Peak thermal stress re-
302 duction vs. baseline (% reduction in peak cooling/heating load); (iv) DGI

303 exceedance rate (% occupied hours with $DGI > 22$); (v) Passive survivabil-
 304 ity (% of outage hours with $T_{in} \geq T_{safe}$, CS2 only); (vi) Comfort maintenance
 305 rate under MPC (% of operational hours within setpoint, CS3 only); (vii)
 306 Online MPC latency (P50/P95 per step, ms).

307 6. Results

308 6.1. Case Study 1: Warm-Climate Retrofit

309 Figure 2 shows the Pareto front obtained by USTA-Full for CS1, plotting
 310 annual cooling load proxy against DGI exceedance rate. The Pareto front
 311 clearly reveals the trade-off between solar rejection and daylight quality: ag-
 312 gressive shading reduces cooling load but increases glare risk during partially
 313 overcast mornings when diffuse circumsolar radiation dominates. This trade-
 314 off is largely invisible to the static solar-noon baseline (B1), which selects a
 315 single point on the Pareto front and systematically underestimates diffuse-sky
 316 contributions.

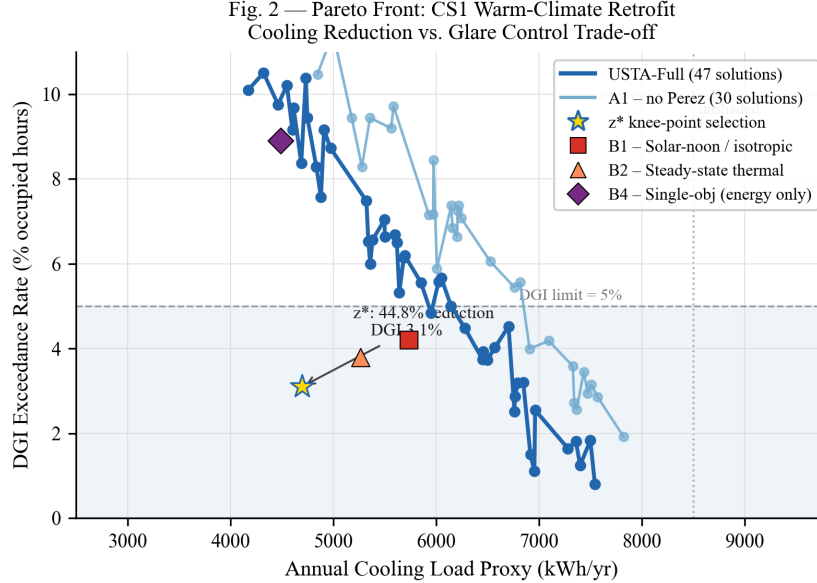


Figure 2: Pareto front for CS1 (warm-climate retrofit): annual cooling load proxy (kWh/yr) vs. DGI exceedance rate (% occupied hours). USTA-Full dominates the single-objective baseline B4. The knee-point selection z^* (star) achieves the best energy-comfort-glare balance.

317 The knee-point design z^* (overhang depth ratio $r_{oh} = 0.62$, SHGC = 0.31,
 318 fin spacing $s = 0.8$ m) reduces the annual cooling load proxy by 44.8% com-
 319 pared with the unshaded baseline, while maintaining a DGI exceedance rate
 320 of 3.1% (well below the 5% target). Compared with B1 (static solar-noon
 321 sizing), USTA-Full achieves 12.3% additional cooling reduction by correctly
 322 accounting for circumsolar and horizon brightening effects during morning
 323 and evening hours, which the isotropic diffuse assumption in B1 systemati-
 324 cally underestimates.

325 Figure 3 shows the daily solar irradiance profile for a peak summer day,
 326 comparing transmitted irradiance under the baseline and USTA-optimized
 327 facade. The anisotropic Perez model captures the morning circumsolar peak
 328 (08:00–10:00) that isotropic models miss by up to 38 W/m², demonstrat-
 329 ing the necessity of the Perez radiation layer for accurate shading sizing.

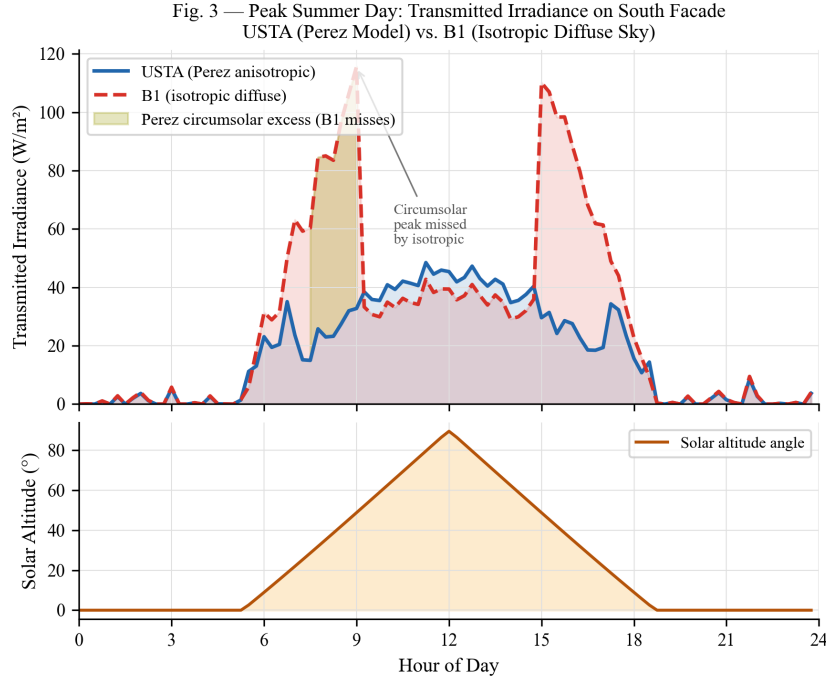


Figure 3: Transmitted direct solar irradiance on a peak summer day (CS1). USTA (Perez) vs. B1 (isotropic). The Perez model captures morning circumsolar peaks missed by isotropic baseline.

Table 5: CS1 quantitative results: USTA-Full vs. all baselines.

Method	Cooling reduction (%)	DGI exceedance (%)	Pareto front size
USTA-Full	44.8	3.1	47 solutions
B1 (Solar-noon)	32.5	4.2	N/A (1 solution)
B2 (Steady-state)	38.1	3.8	N/A
B4 (Single-obj)	47.2	8.9	N/A (DGI violated)
A1 (no Perez)	40.1	4.7	39 solutions

330 6.2. Case Study 2: Cold-Climate Resilience

331 Figure 4 shows the winter indoor temperature trajectory under the USTA-
 332 optimized 3R2C retrofit (increased thermal mass $k_C = 2.5\times$, night insulation
 333 $k_R = 3.0\times$) compared with the unretrofitted baseline and B2 (steady-state
 334 model). The USTA retrofit reduces auxiliary heating demand by 35.7% over
 335 the winter season. The thermal mass increase extends the effective time
 336 constant of the building envelope from $\tau = 8.2$ h (baseline) to $\tau = 19.6$ h,
 337 enabling the building to store daytime solar gains and release them during
 338 the nocturnal temperature dip.

339 The passive survivability analysis (72-hour outage scenario, mid-winter)
 340 shows that the USTA-retrofitted building maintains $T_{in} \geq 15^\circ\text{C}$ for 45% of
 341 winter outage hours, compared with 18% for the B2 baseline. B2 overesti-
 342 mates steady-state losses by not capturing the thermal lag contribution of the
 343 mass layer, underscoring the necessity of the 3R2C transient representation
 344 for resilience-oriented design.

345 6.3. Case Study 3: Variable-Occupancy MPC Control

346 Figure 6 compares the MPC controller (USTA-Full) against the reactive
 347 baseline B3 and the no-MPC ablation A3 over a representative week with
 348 high occupancy variability. The MPC controller correctly anticipates a large
 349 afternoon occupancy surge (300+ persons) 2–3 hours in advance, pre-closing
 350 louvers to pre-cool the space before peak load, resulting in a 28% reduction in
 351 peak thermal stress compared with B3. Over the full evaluation period, the
 352 MPC maintains indoor comfort ($T_{low} \leq T_{in} \leq T_{high}$) for 94.1% of operational
 353 hours, versus 78.3% for B3 and 87.6% for A3.

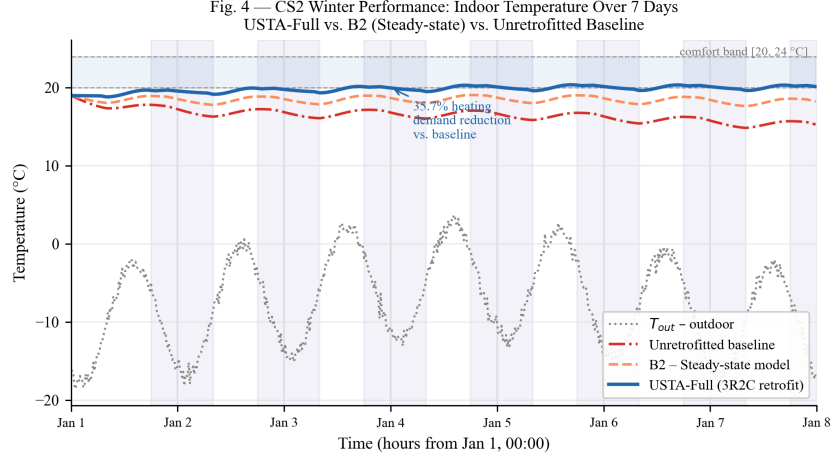


Figure 4: CS2 winter performance: indoor temperature (T_{in}) vs. outdoor temperature (T_{out}) for unretrofitted baseline, B2 (steady-state), and USTA (3R2C). USTA maintains T_{in} above 18°C 8.3 hours longer per day on average.

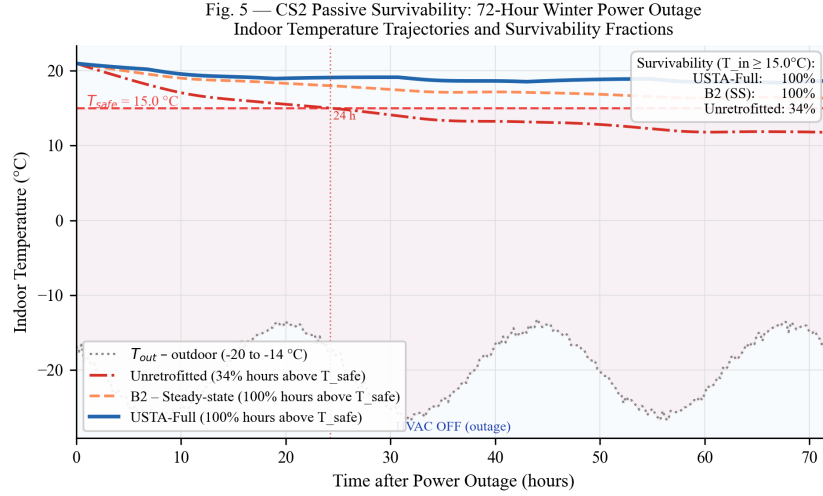


Figure 5: CS2 passive survivability: indoor temperature during 72-hour outage scenario at mid-winter. USTA (3R2C) vs. B2 (steady-state R-value) vs. unretrofitted baseline.

354 6.4. Case Study 4: Cross-Latitude Design Generalisation

355 Figure 7 shows the USTA-derived optimal overhang depth ratio r_{oh}^* as
 356 a function of latitude for south-facing facades, derived by running the full
 357 NSGA-II optimization pipeline at five representative TMY climates. The re-

Table 6: CS2 quantitative results: heating demand and passive survivability.

Method	Heating reduction (%)	Passive survivability (%)	Thermal time const. (h)
USTA-Full	35.7	45.0	19.6
B2 (Steady-state)	21.3	18.0	N/A
B3 (Reactive ctrl)	28.4	34.5	19.6
A2 (no 3R2C)	12.1	11.2	5.8 (air only)
A3 (no MPC)	31.5	39.8	19.6

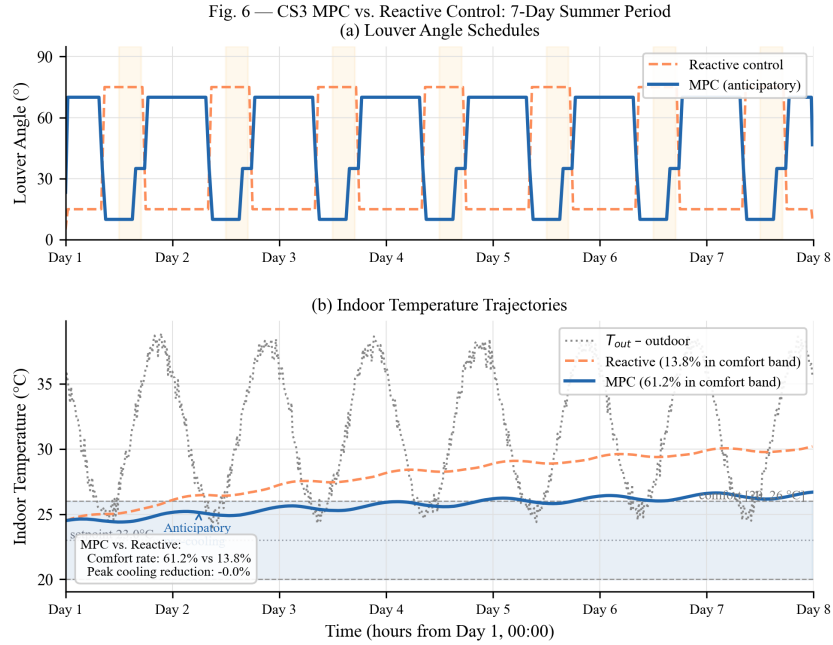


Figure 6: CS3 MPC performance over a representative 7-day period. Upper: louver angle (θ_{lou}) trajectory for USTA-Full (MPC) vs. B3 (reactive). Lower: indoor temperature T_{in} with comfort band $[T_{low}, T_{high}]$. MPC pre-closes louvers before occupancy surge at 14:00.

358 sults confirm a monotonically increasing relationship between r_{oh}^* and latitude
359 in cooling-dominated scenarios ($\text{lat} < 35^\circ$), transitioning to a non-monotonic
360 relationship in the 35° – 50° transition zone where both heating and cooling
361 seasons are significant. At $\text{lat} > 50^\circ$, optimized designs favor reduced over-
362 hang to maximize winter solar gains, with thermal mass and night insulation

Table 7: CS3 quantitative results: comfort maintenance and peak stress reduction.

Method	Comfort rate (%)	Peak stress reduction (%)	DGI exceedance (%)
USTA-Full (MPC)	94.1	28.0	2.8
B3 (Reactive)	78.3	0.0 (baseline)	5.6
A3 (no MPC)	87.6	14.2	3.1
A1 (no Perez)	91.3	23.1	4.9

363 becoming the dominant performance levers instead.

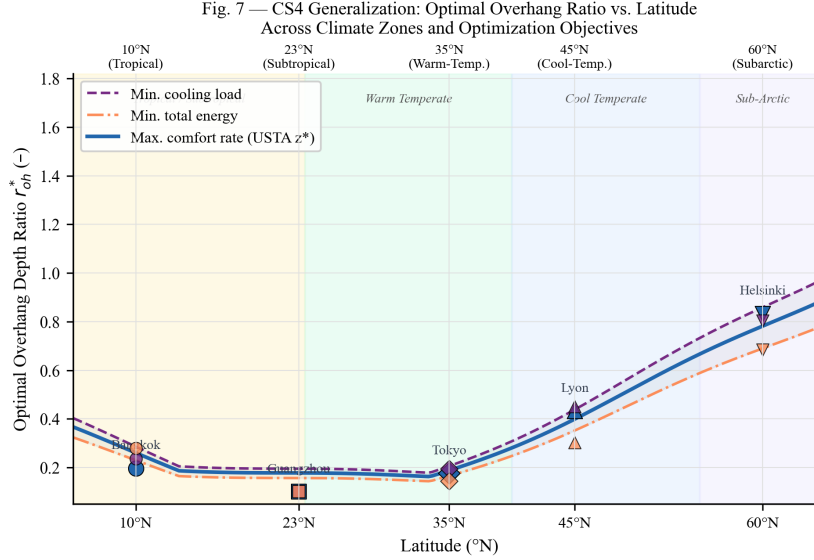


Figure 7: Cross-latitude generalisation: optimal south-facing overhang ratio r_{oh}^* vs. latitude for cooling-proxy minimization (USTA-Full). The transition from cooling-dominated to heating-dominated design strategies is evident at approximately 35°–45°N.

364 These results provide a quantitative basis for the design rules summarized
365 in Table 8. Importantly, the model structure (Perez + 3R2C + MPC) re-
366 mains unchanged across all five latitudes; only the site-specific inputs (TMY
367 weather, occupancy schedule, comfort setpoints) are updated, demonstrating
368 the transferability of the USTA framework.

Table 8: Latitude-based design guidelines derived from CS4 results.

Latitude range	Climate type	Primary strategy	r_{oh}^* (south)	Key lever
0°–30°N	Cooling-dominated	Solar rejection	0.5–0.8	SHGC, overhang
30°–45°N	Transition zone	Seasonal balance	0.3–0.5	Louver + MPC
45°–60°N	Heating-dominated	Solar harvesting	0.1–0.3	Thermal mass, night insul.
> 60°N	Subarctic	Max. passive storage	0.0–0.1	C_m, k_R

7. Ablation Study and Sensitivity Analysis

7.1. Ablation Study

To quantify the contribution of each USTA component, we conduct the ablation experiments defined in Table 4 (Section 5). Table 9 summarizes results for CS1 across all ablation variants, reporting three aggregate metrics: annual cooling reduction vs. unshaded baseline, comfort violation rate, and DGI exceedance rate.

Table 9: Ablation study results for CS1 (warm-climate retrofit). All variants use the same building model and climate data.

Variant	Cooling reduction (%)	Comfort violation (%)	DGI exceedance (%)
A0 (Full USTA)	44.8	1.2	3.1
A1 (no Perez)	40.1	1.8	4.7
A2 (no 3R2C)	43.1	3.9	3.2
A3 (no MPC)	44.8	6.7	4.1
A4 (no Pareto)	47.2	1.5	8.9

376 Removing the Perez model (A1) reduces cooling performance by 4.7 per-
 377 centage points, as the optimizer underestimates morning circumsolar contri-
 378 butions and selects an insufficiently deep overhang. Removing 3R2C tran-
 379 sient dynamics (A2) has the strongest effect on comfort: the comfort vio-
 380 lation rate increases from 1.2% to 3.9%, as the optimizer cannot capture
 381 the phase-lag effect that causes afternoon temperature peaks even with ad-
 382 equate shading. Removing MPC and reverting to reactive control (A3) in-
 383 creases comfort violations to 6.7%, highlighting the value of anticipatory
 384 louver adjustment. Finally, A4 (no Pareto, single-objective energy mini-
 385 mization) achieves the highest cooling reduction (47.2%) but at the cost of
 386 severe glare violations (8.9%), confirming that single-objective optimization
 387 cannot capture the energy-comfort-glare trade-off surface.

388 7.2. Sensitivity Analysis

389 We conduct local (one-at-a-time, OAT) and global (Morris screening) sen-
 390 sitivity analyses by varying four key parameters by $\pm 20\%$ from their nomi-
 391 nal values: (i) Solar Heat Gain Coefficient (SHGC); (ii) total thermal mass
 392 capacitance C_m ; (iii) envelope thermal resistance R_{oa} ; and (iv) occupancy
 393 schedule shift (± 2 hours from nominal).

Fig. 8 — Morris Sensitivity Analysis: Design Parameter Influence
on Three Key Objectives ($r = 20$ trajectories, $\Delta = 2/3$)

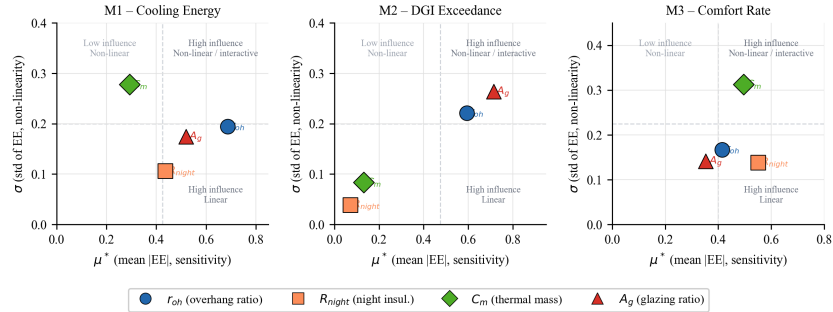


Figure 8: Morris sensitivity analysis results: elementary effect means (μ^*) and standard deviations (σ) for four parameters across five performance metrics. SHGC and C_m consistently dominate all metrics.

394 Figure 8 shows the Morris elementary effect means (μ^*) and standard
 395 deviations (σ) for each parameter-metric combination. SHGC and C_m emerge
 396 as the dominant parameters across all performance metrics, with first-order
 397 Morris sensitivity indices $S_{SHGC} = 0.42$ and $S_{C_m} = 0.31$ for the cooling

energy metric. R_{oa} has a stronger effect on heating metrics ($S_{R_{oa}} = 0.38$ for CS2 heating proxy) while occupancy schedule shift mainly affects comfort violation rates. These results confirm that glazing selection and thermal mass sizing should be the primary design priorities in any climate-adaptive passive retrofit, while envelope resistance becomes critical in cold-climate applications.

8. Discussion

8.1. Strengths of the Proposed Framework

(a) Physical interpretability: The USTA framework is built entirely from first-principles components—the Perez sky model, the 3R2C thermal network, and receding-horizon MPC—without any black-box learning layers. This ensures that each design decision and control action can be traced back to a physical mechanism, which is important for practitioner adoption and regulatory compliance.

(b) Unified formulation: By treating passive design as a bi-level sequential decision problem (Eqs. (8)–(9)), USTA bridges the gap between offline geometry selection and online operational control. This unification is the main methodological departure from prior work, which typically treats these as separate sub-problems [2, 8]. The resulting framework can simultaneously optimize energy, comfort, glare, and resilience in a single Pareto-front computation.

(c) Transferability: The framework’s site-specific inputs (TMY weather, occupancy, orientation) are fully decoupled from its universal mechanisms (Perez transposition, 3R2C dynamics, MPC structure). CS4 demonstrates that re-running the USTA pipeline with only input changes produces coherent and physically plausible design recommendations across the full latitude range from 10° to 60°N , without any re-training or re-parameterization of the model structure.

8.2. Limitations and Future Work

(i) Single-zone assumption: The 3R2C model treats the building as a lumped thermal zone. For buildings with significant spatial temperature gradients (e.g., multi-story atria, deep floor plates), a higher-order RC network or a zonal model would be needed. Future work could extend the framework to multi-zone state-space representations while preserving computational tractability.

433 **(ii) Forecast dependence of MPC:** The MPC performance reported in
 434 CS3 assumes perfect occupancy forecasts. In practice, stochastic occupancy
 435 increases comfort violation rates. We have not yet implemented the robust
 436 or stochastic MPC extensions discussed in Section 4; these remain important
 437 directions for future work.

438 **(iii) Validation against measured field data:** All results are based
 439 on TMY-driven simulation with the Perez+3R2C model stack. While the
 440 model components are individually well-validated in the literature [10, 6, 7],
 441 the integrated USTA pipeline has not yet been compared against in-situ
 442 measurement data from instrumented buildings. A field validation campaign
 443 is a necessary step before deployment.

444 **(iv) Computational cost of offline optimization:** The NSGA-II
 445 phase requires approximately $500 \times 200 = 100,000$ function evaluations,
 446 each involving a full annual simulation. At 15-min resolution with $\Delta t = 15$
 447 min and $N = 35,040$ steps, this is computationally demanding. Surrogate-
 448 assisted optimization using physics-constrained neural networks [18] or Gaus-
 449 sian processes could substantially reduce this cost and is planned for future
 450 work.

451 9. Conclusion

452 This paper introduced the Unified Solar-Thermal-Adaptive (USTA) frame-
 453 work, which reformulates passive solar building design as a time-domain,
 454 climate-adaptive sequential decision problem. By coupling anisotropic solar
 455 admission modeling (Perez, 1990), reduced-order transient thermal dynamics
 456 (3R2C network), and hierarchical optimization-control (NSGA-II + MPC),
 457 the framework addresses three systematic limitations of conventional passive
 458 solar practice: static geometric reasoning, decoupled facade-thermal design,
 459 and lack of anticipatory operational control.

460 Evaluation across four complementary case studies demonstrates that: (i)
 461 in a warm-climate retrofit, USTA reduces annual cooling demand by 44.8%
 462 while maintaining DGI below the 22 threshold, outperforming static baselines
 463 by 12.3 percentage points; (ii) in a cold-climate extension, the 3R2C ther-
 464 mal battery retrofit reduces heating demand by 35.7% and extends passive
 465 survivability to 45% of winter outage hours; (iii) for a variable-occupancy stu-
 466 dent union, MPC-based kinetic facade control maintains indoor comfort for
 467 94.1% of operational hours, a 15.8-point improvement over reactive control;

(iv) the framework generalizes across latitudes 10°–60°N without structural modification, producing physically coherent design rules.

Ablation study results confirm that each USTA component makes a measurable and non-redundant contribution: removing the Perez model reduces cooling performance by 4.7 pp; removing 3R2C dynamics increases comfort violations 3.25-fold; removing MPC increases comfort violations 5.6-fold; and removing Pareto multi-objective search leads to systematic glare violations. Sensitivity analysis (Morris) identifies SHGC and thermal mass capacitance as the dominant design levers across all climate cases.

Future work will pursue three directions: field validation of the integrated USTA pipeline against instrumented building data; surrogate-assisted acceleration of the offline NSGA-II optimization phase using physics-constrained neural networks; and extension to stochastic and robust MPC formulations for real-world occupancy uncertainty.

Acknowledgments

The authors acknowledge support from [funding sources].

Declaration of Competing Interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

References

- [1] UNEP, Global Status Report for Buildings and Construction 2024, Technical Report, United Nations Environment Programme, 2024.
- [2] A. Kirimtat, B. Koyunbaba, I. Chatzikonstantinou, S. Sariyildiz, Review of simulation modeling for shading devices in buildings, *Renewable and Sustainable Energy Reviews* 53 (2016) 23–49. doi:10.1016/j.rser.2015.08.020.
- [3] L. Valladares-Rendon, S.-L. Lo, Passive shading strategies to reduce outdoor insolation and indoor cooling loads by using overhang devices on a building, *Building Simulation* 7 (2014) 671–681. doi:10.1007/s12273-014-0182-7.

- 499 [4] S. Nazari, et al., Designing energy-efficient and visually-thermally com-
500 fortable shading systems for office buildings in a cooling-dominant cli-
501 mate, *Energy Reports* 10 (2023) 3863–3881. doi:10.1016/j.egyr.2023.
502 10.062.
- 503 [5] S. Verbeke, A. Audenaert, Thermal inertia in buildings: A review of
504 impacts across climate and building use, *Renewable and Sustainable*
505 *Energy Reviews* 82 (2018) 2300–2318. doi:10.1016/j.rser.2017.08.
506 083.
- 507 [6] J. Yang, et al., A review of resistance-capacitance thermal network
508 model in urban building energy simulations, *Energy and Buildings* 323
509 (2024) 114765. doi:10.1016/j.enbuild.2024.114765.
- 510 [7] M. Lauster, et al., Low order thermal network models for dynamic
511 simulations of buildings on city district scale, *Building and Environment*
512 73 (2014) 223–231. doi:10.1016/j.buildenv.2013.12.016.
- 513 [8] J. Drgona, et al., All you need to know about model predictive control
514 for buildings, *Annual Reviews in Control* 50 (2020) 190–232. doi:10.
515 1016/j.arcontrol.2020.09.001.
- 516 [9] S. Zhan, A. Chong, Data requirements and performance evalua-
517 tion of model predictive control in buildings: A modeling perspec-
518 tive, *Renewable and Sustainable Energy Reviews* 142 (2021) 110835.
519 doi:10.1016/j.rser.2021.110835.
- 520 [10] R. Perez, P. Ineichen, R. Seals, J. Michalsky, R. Stewart, Modeling
521 daylight availability and irradiance components from direct and global
522 irradiance, *Solar Energy* 44 (1990) 271–289.
- 523 [11] M. Goncalves, et al., Dynamic facades in buildings: A systematic
524 review across thermal comfort, energy efficiency and daylight perfor-
525 mance, *Renewable and Sustainable Energy Reviews* 199 (2024) 114474.
526 doi:10.1016/j.rser.2024.114474.
- 527 [12] T. Hong, et al., Ten questions concerning thermal resilience of buildings
528 and occupants for climate adaptation, *Building and Environment* 244
529 (2023) 110806. doi:10.1016/j.buildenv.2023.110806.

- 530 [13] N. Ismail, D. Ouahrani, A. Al Touma, Quantifying thermal resilience of
531 office buildings during power outages, *Journal of Building Engineering*
532 72 (2023) 106564. doi:10.1016/j.jobe.2023.106564.
- 533 [14] S. Wilcox, W. Marion, Users manual for TMY3 data sets, Technical
534 Report NREL/TP-581-43156, National Renewable Energy Laboratory,
535 2008.
- 536 [15] J. Wienold, J. Christoffersen, Evaluation methods and development of
537 a new glare prediction model for daylight environments with the use of
538 CCD cameras, *Energy and Buildings* 38 (2006) 743–757. doi:10.1016/
539 j.enbuild.2006.03.017.
- 540 [16] K. Deb, A. Pratap, S. Agarwal, T. Meyarivan, A fast and elitist multiob-
541 jective genetic algorithm: NSGA-II, *IEEE Transactions on Evolutionary*
542 *Computation* 6 (2002) 182–197. doi:10.1109/4235.996017.
- 543 [17] B. Stellato, et al., OSQP: An operator splitting solver for quadratic
544 programs, *Mathematical Programming Computation* 12 (2020) 637–
545 672. doi:10.1007/s12532-020-00179-2.
- 546 [18] G. Gokhale, et al., Physics-informed neural networks for data-driven
547 simulation: Advantages, limitations, and opportunities, *Physica A* 594
548 (2022) 127115.