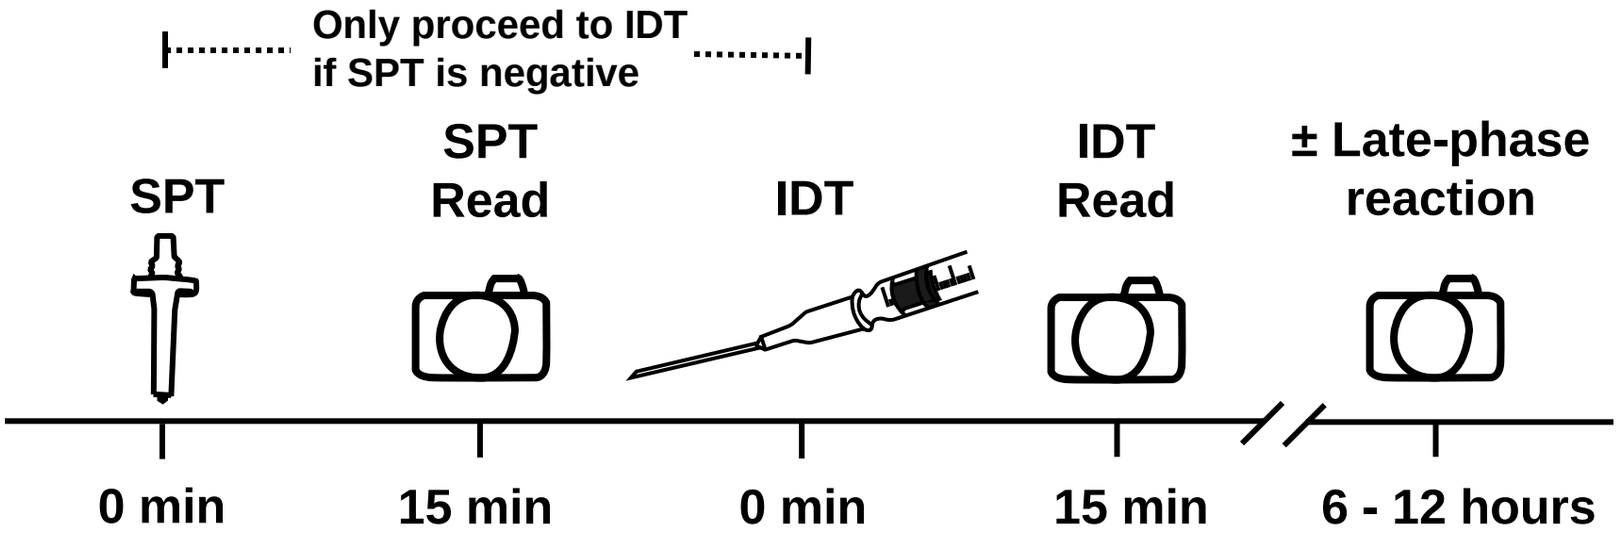
Only proceed to IDT
if SPT is negative
SPT
SPT
Read
IDT
IDT
Read
± Late-phase
reaction
0 min
15 min
0 min
15 min
6 - 12 hours