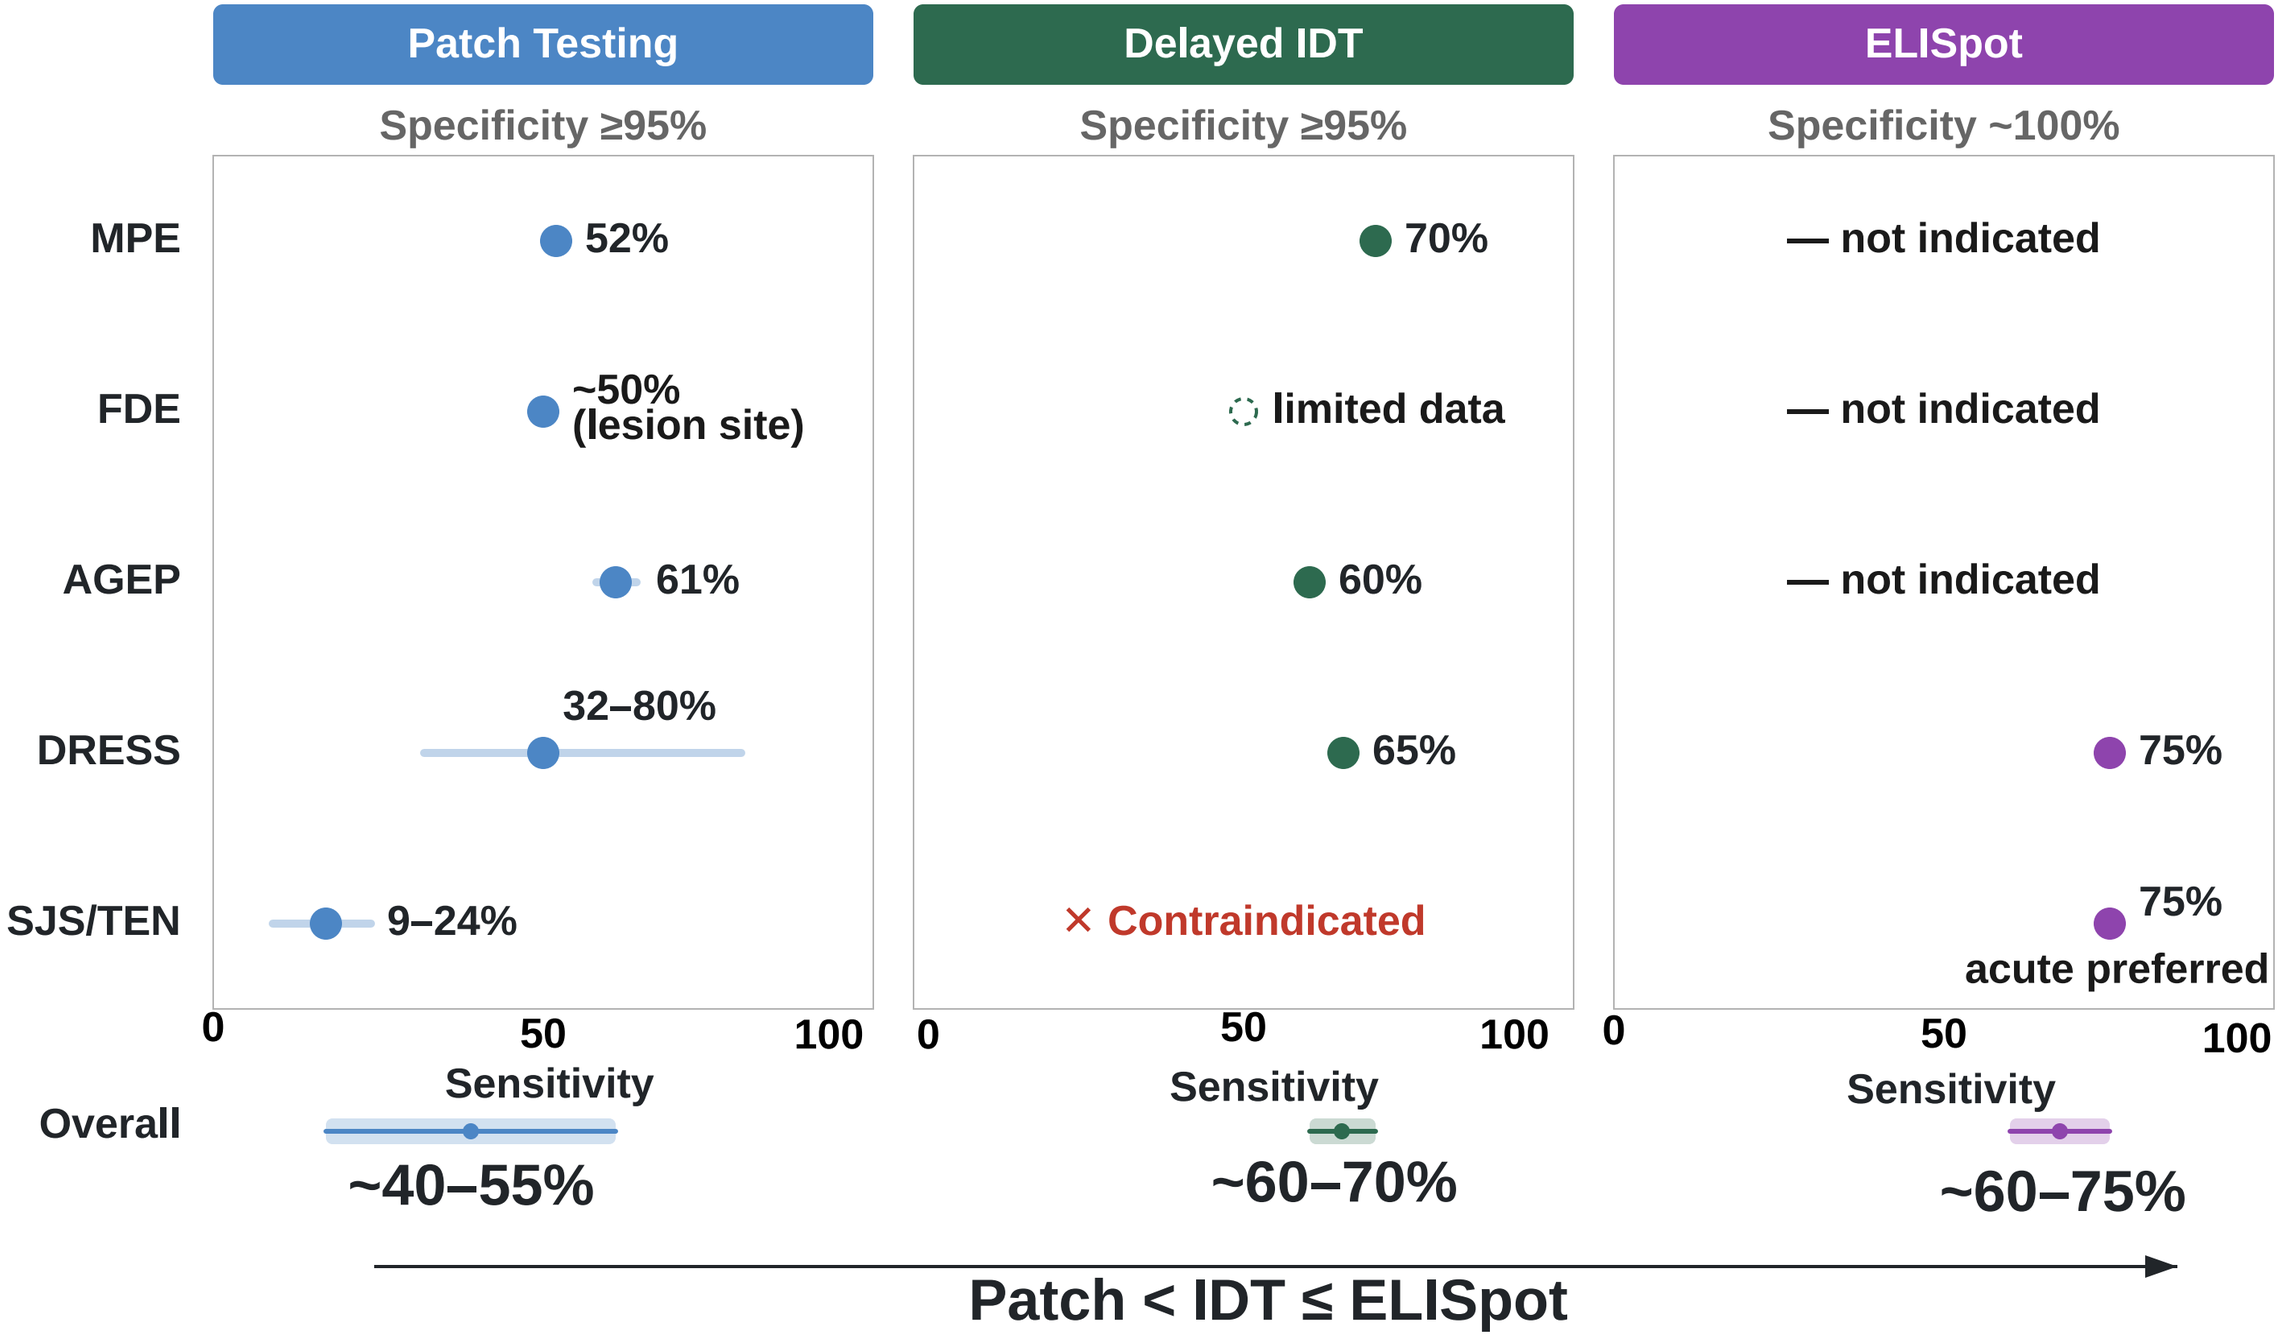
Patch Testing
Delayed IDT
ELISpot
Specificity ≥95%
Specificity ≥95%
Specificity ~100%
MPE
FDE
AGEP
DRESS
SJS/TEN
Overall
52%
~50%
(lesion site)
61%
32–80%
9–24%
70%
limited data
60%
65%
× Contraindicated
— not indicated
— not indicated
— not indicated
75%
75%
acute preferred
0
50
100
Sensitivity
~40–55%
~60–70%
~60–75%
Patch < IDT ≤ ELISpot