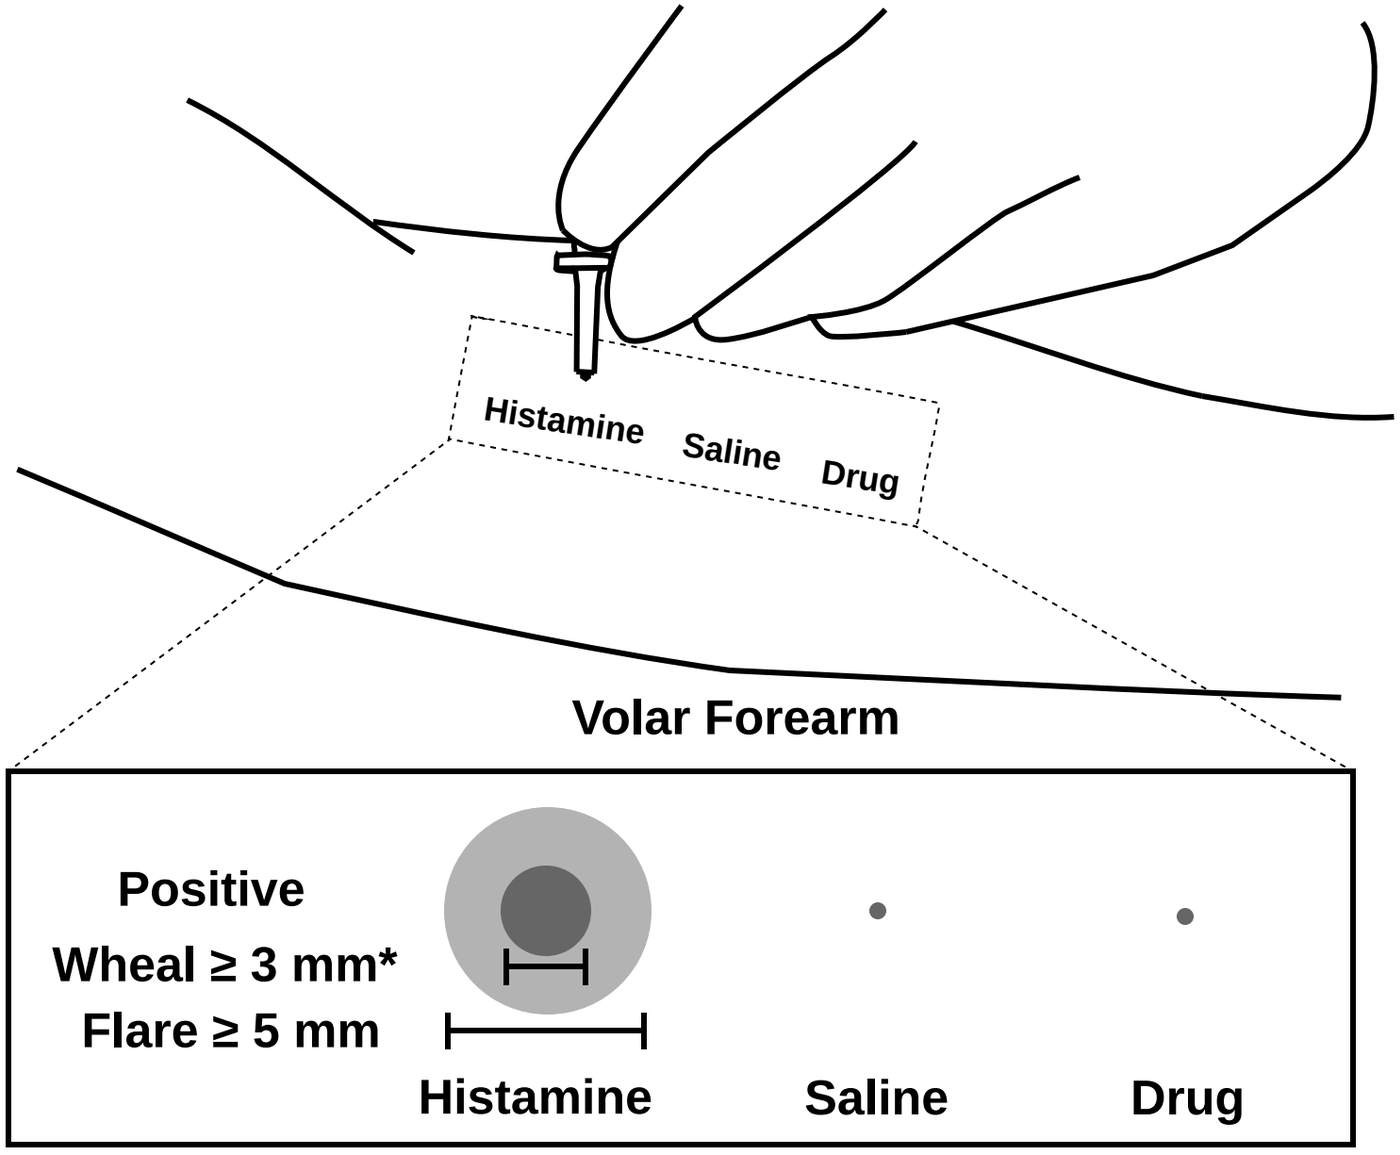

*Wheal must be ≥ 3 mm than the saline wheal (i.e. negative control)