Solar ESS Co. Ltd.
53 Moo 2 Tambon Nanglae, Amphoe Muang
Chiang Rai 57100, Thailand
Tel 063 151 6694, 089 632 5829
www.solaress.org · LINE: solaress1

SOLAR ESS MONTHLY REPORT · OCTOBER 2026 · SOLISCLOUD · PLANT REPORT


Upgrade opportunity

Commercial site, Samut Songkhram


Second battery: ≈ +600 kWh/month

20.079 kWp · 20 kW hybrid inverter · battery

1566	3.25	51%	63.2	1	26.2
kWh solar	kWh/kWp/day	solar share of use	kWh/day bought	kWh exported	kWh/day from battery

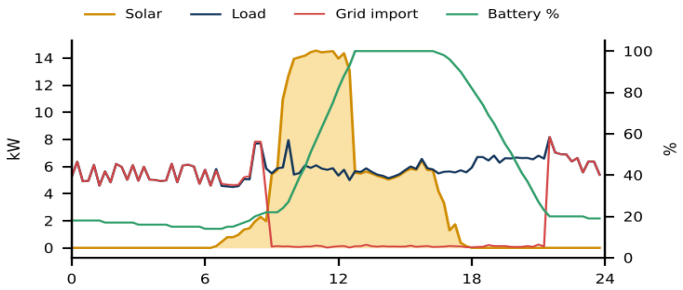

24 October, 5-minute data

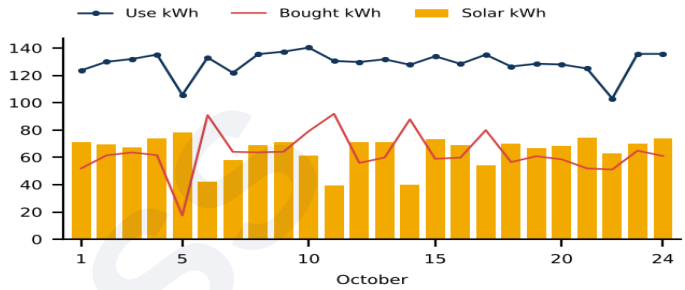

Daily totals, 1–24 October


What we found

• Battery full by 12:45; the panels then drop from 14.5 kW to 5.5 kW for three hours (about 20 kWh/day thrown away).
• Battery empty by 21:30; the site then buys 6–7 kW all night (63 kWh/day).
• Yield 3.25 kWh/kWp/day.

What to do

• Add a second battery of about 20 kWh – it would absorb the afternoon surplus and cover the late evening: about 600 kWh/month less grid.
• Keep battery low SOC at 20%.

How this plant compares with the other SolisCloud plants (kWh per kWp per day, 1–24 Oct)

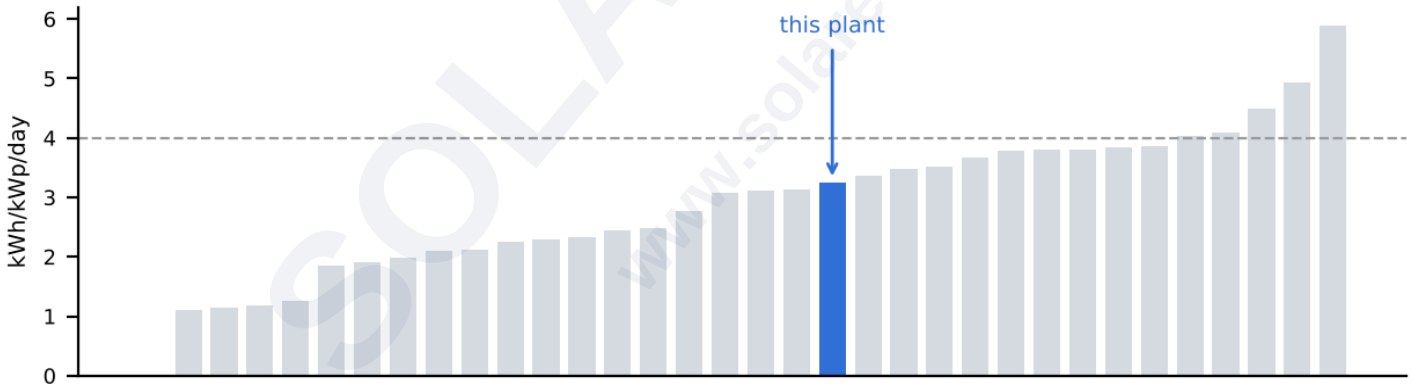

Rank 15 of 34 for yield per kWp. Dashed line ≈ 4.0, a typical clear month in the north and centre. A low yield is not always a fault – a full battery or little daytime load makes the inverter throttle the panels.

This plant report is part of the October 2026 SolisCloud fleet review on www.solaress.org (Technical → Monthly Report), which also lists the recommended standard settings. Figures are estimates from monitoring data; site name removed.