Plant code SG-57100-20-01

Solar ESS Co. Ltd.
53 Moo 2 Tambon Nanglae, Amphoe Muang
Chiang Rai 57100, Thailand
Tel 063 151 6694, 089 632 5829
www.solaress.org · LINE: solaress1

SOLAR ESS MONTHLY REPORT · OCTOBER 2026 · SOLISCLOUD · PLANT REPORT


Change settings

Factory, Chiang Rai


Meter readings · export on closed days

20 kWp · 20 kW 3-phase hybrid inverter · no battery

892	1.86	35%	62.2	207	0.0
kWh solar	kWh/kWp/day	solar share of use	kWh/day bought	kWh exported	kWh/day from battery

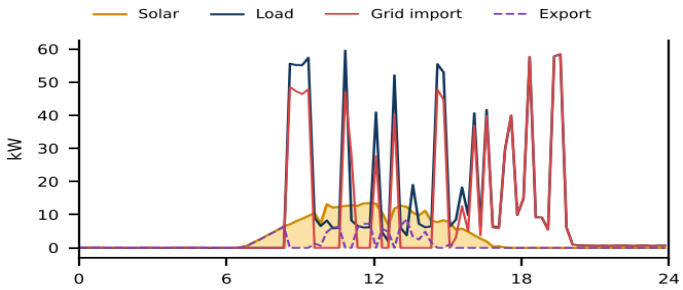

24 October, 5-minute data

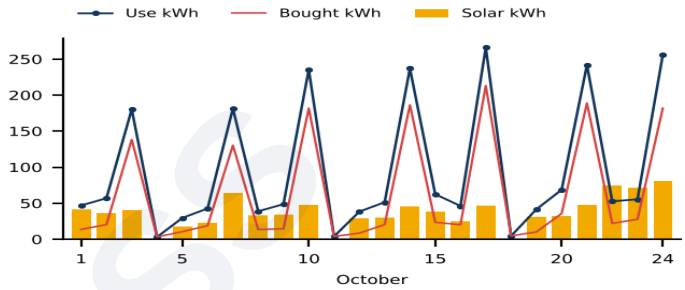

Daily totals, 1–24 October


What we found

• Load readings jump to 55 kW for single samples and grid readings swing ±48 kW – meter/CT readings are unreliable.
• 207 kWh exported; production near zero on Sundays (4, 11, 18 Oct) when the factory is closed.

What to do

• Finish the CT/meter check and confirm zero export works.
• Balance the load across the three phases (being monitored separately).

How this plant compares with the other SolisCloud plants (kWh per kWp per day, 1–24 Oct)

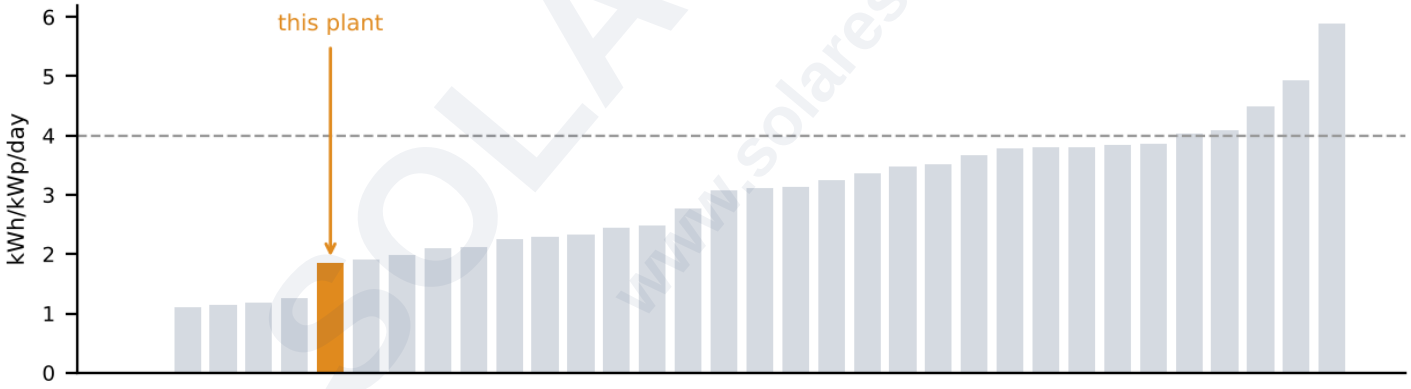

Rank 29 of 34 for yield per kWp. Dashed line ≈ 4.0, a typical clear month in the north and centre. A low yield is not always a fault – a full battery or little daytime load makes the inverter throttle the panels.

This plant report is part of the October 2026 SolisCloud fleet review on www.solaress.org (Technical → Monthly Report), which also lists the recommended standard settings. Figures are estimates from monitoring data; site name removed.