Solar ESS Co. Ltd.
53 Moo 2 Tambon Nanglae, Amphoe Muang
Chiang Rai 57100, Thailand
Tel 063 151 6694, 089 632 5829
www.solaress.org · LINE: solaress1

SOLAR ESS MONTHLY REPORT · OCTOBER 2026 · SOLISCLOUD · PLANT REPORT


Upgrade opportunity

Nursing home, Lampang


Add PV + battery

25.08 kWp · 20 kW 3-phase hybrid inverter · no battery

2291	3.81	38%	154.1	3	0.0
kWh solar	kWh/kWp/day	solar share of use	kWh/day bought	kWh exported	kWh/day from battery

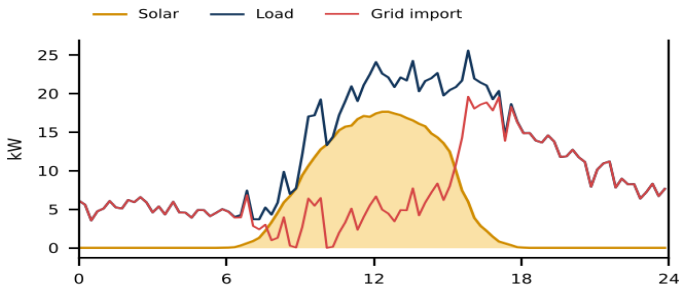

24 October, 5-minute data

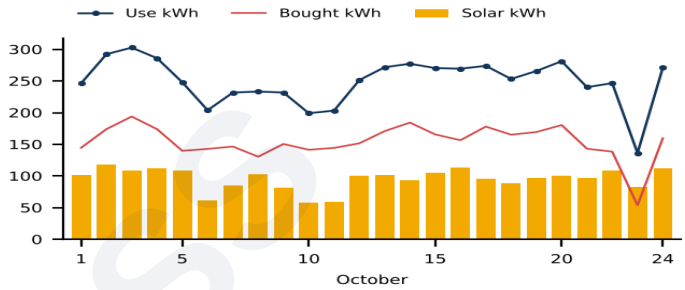

Daily totals, 1–24 October


What we found

• Solar is fully used (good yield 3.8 kWh/kWp/day) but covers only 38% of the load (249 kWh/day).
• 25 kWp on a 20 kW inverter, no battery; the home buys 154 kWh/day, including 7–14 kW at night.

What to do

• Add a second inverter with 20–25 kWp more panels (+2,000–2,500 kWh/month).
• Add a battery for the night load.

How this plant compares with the other SolisCloud plants (kWh per kWp per day, 1–24 Oct)

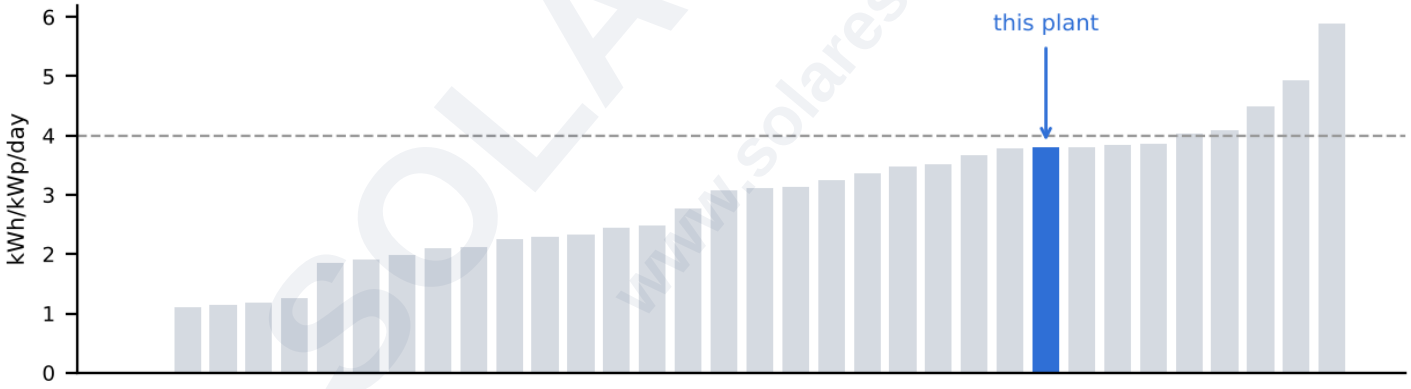

Rank 9 of 34 for yield per kWp. Dashed line ≈ 4.0, a typical clear month in the north and centre. A low yield is not always a fault – a full battery or little daytime load makes the inverter throttle the panels.

This plant report is part of the October 2026 SolisCloud fleet review on www.solaress.org (Technical → Monthly Report), which also lists the recommended standard settings. Figures are estimates from monitoring data; site name removed.