Solar ESS Co. Ltd.
53 Moo 2 Tambon Nanglae, Amphoe Muang
Chiang Rai 57100, Thailand
Tel 063 151 6694, 089 429 6832
www.solaress.org · LINE: solaress1

SOLAR ESS MONTHLY REPORT · OCTOBER 2026 · SOLISCLOUD · PLANT REPORT


Change settings

Home S15, Trang


Battery full by 10:15 · curtailed

10 kWp · 10 kW 3-phase hybrid inverter · battery

458	1.91	70%	5.9	81	10.0
kWh solar	kWh/kWp/day	solar share of use	kWh/day bought	kWh exported	kWh/day from battery

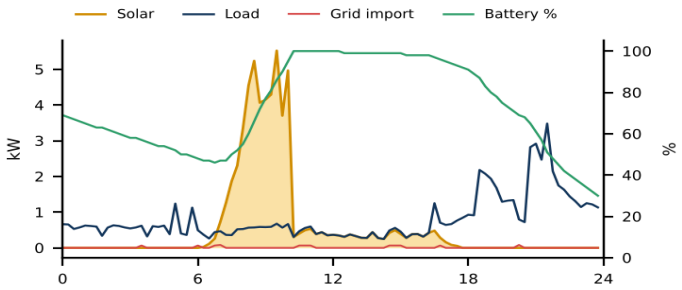

24 October, 5-minute data

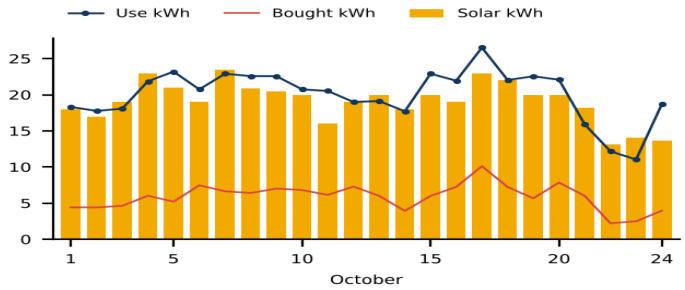

Daily totals, 1–24 October


What we found

• Battery is full by 10:15, after which the panels are throttled to the house load (0.3–0.5 kW).
• Only 1.9 kWh/kWp/day; 81 kWh exported unpaid.

What to do

• Move daytime loads (water heater, washing, air-con, pump) to 10:00–15:00.
• Set export limit to 0 W, or consider a larger battery if evening use grows.

How this plant compares with the other SolisCloud plants (kWh per kWp per day, 1–24 Oct)

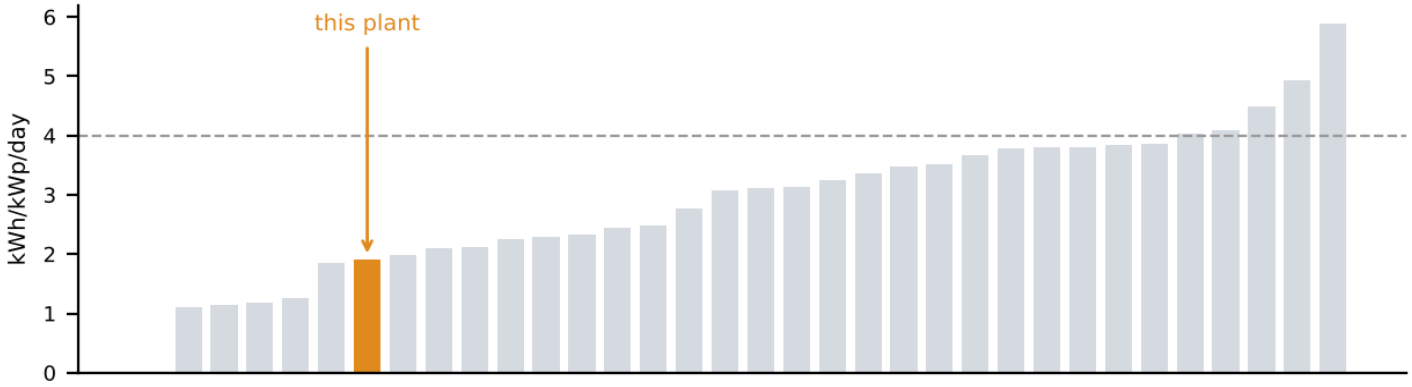

Rank 28 of 34 for yield per kWp. Dashed line ≈ 4.0, a typical clear month in the north and centre. A low yield is not always a fault – a full battery or little daytime load makes the inverter throttle the panels.

This plant report is part of the October 2026 SolisCloud fleet review on www.solaress.org (Technical → Monthly Report), which also lists the recommended standard settings. Figures are estimates from monitoring data; site name removed.